

January 24, 2019

**SOLICITATION ADDENDUM NO. 1**  
**ITB 19-0002**  
**Cedar Mill HVAC, Roof, and Electrical Upgrades**

**THE FOLLOWING CHANGES/ADDITIONS TO THE ABOVE CITED SOLICITATION ARE ANNOUNCED:**

This Addendum modifies the Invitation to Bid (ITB) document(s) only to the extent indicated herein. All other areas not changed or otherwise modified by this Addendum shall remain in full force and effect. This Addendum is hereby made an integral part of the ITB document. Bidder must be responsive to any requirements of this Addendum as if the requirements were set forth in the ITB. Failure to do so may result in Bid rejection. See the ITB regarding requests for clarification or change and protests of this Addendum, and the deadlines for the foregoing.

This addendum is to be acknowledged in the space provided on the Bidder Certification form supplied in the solicitation document. Failure to acknowledge receipt of this addendum may be cause to reject your offer.

The closing date **REMAINS UNCHANGED: February 26, 2019 at 2:00 PM Pacific Time**

**CHANGES:**

1. SECTION V – ATTACHMENTS, Attachment M, Asbestos Abatement Specifications added below.

**CLARIFICATIONS:**

Questions submitted via email

Question: Do you have an engineer's estimate or cost range for this project?

Answer: Cost estimation is between \$2.75 and \$3.0 million.

**-END of Addendum**

Justin Sweet  
Contract Specialist

# **ASBESTOS ABATEMENT CONTRACTOR BID DOCUMENT AND SPECIFICATIONS**

## **Cedar Mill Elementary School HVAC and Roofing Project**

**10265 NW Cornell Road  
Portland, OR 97229**

Prepared for:

## **Beaverton School District**

**16550 SW Merlo Road  
Beaverton, Oregon 97006**

**Submitted:** January 16, 2019

Prepared By:



**4105 SE International Way, Suite 505  
Milwaukie, OR 97222  
503.387.3251**

TRC Project Number: **321417**

# TABLE OF CONTENTS

SECTION .....	PAGE
TABLE OF CONTENTS.....	ii
BID FORM .....	1
PART 1     GENERAL - ASBESTOS .....	3
1.01   SCOPE OF WORK .....	3
1.02   PERMITS AND COMPLIANCE.....	4
1.03   SUBMITTALS.....	5
1.04   PRE-CONSTRUCTION CONFERENCE .....	6
1.05   APPLICABLE STANDARDS AND REGULATIONS .....	7
1.06   NOTICES .....	7
1.07   ENVIRONMENTAL CONSULTANT.....	7
1.08   PERSONAL AIR SAMPLING .....	9
1.09   PROJECT SUPERVISOR.....	9
1.10   RESPIRATORY PROTECTION.....	10
1.11   DELIVERY AND STORAGE .....	10
1.12   TEMPORARY UTILITIES.....	10
PART 2     PRODUCTS .....	11
2.01   MATERIALS.....	11
2.02   TOOLS AND EQUIPMENT .....	11
PART 3     EXECUTION .....	11
3.01   GENERAL REQUIREMENTS.....	11
3.02   PROTECTIVE CLOTHING.....	13
3.03   SIGNS AND LABELS.....	13
DANGER.....	14
RQ, (WASTE) ASBESTOS, 9, NA2212, PGIII.....	14
3.04   FRIABLE ACM REMOVAL BY FULL ENCLOSURE METHOD.....	14
3.05   REMOVAL OF NON-FRIABLE ASBESTOS-CONTAINING MATERIALS .....	17
3.06   WORK AREA DECONTAMINATION AND CLEARANCE PROCEDURES.....	19
3.07   WASTE DISPOSAL .....	19

## Appendices

### Figures

- Figure 1.1 – Asbestos Containing Materials Location Map (Main Level)
- Figure 1.2 – Asbestos Containing Materials Location Map (Lower Level)

## Appendix A – LIMITED SUPPLEMENTAL ASBESTOS AND LEAD PAINT SURVEY REPORT

**BID FORM**

**1. Base Bid: Bid due date will be announced at the Job Walk**

The undersigned, having examined the proposed contract documents titled: Asbestos Abatement Contractor Bid Document and Specifications for 10265 NW Cornell Road in Portland, Oregon 97229 (Project Site), dated January 16, 2019, and having visited the site and examined the conditions affecting the work, hereby proposes and agrees to furnish all labor, materials, equipment, permits, insurance, appliances and to perform operations necessary to complete the work as required by said proposed contract documents, for that portion of the work identified in Scope of Work as "Base Bid" for the stipulated sum of:

\_\_\_\_\_ **DOLLARS (\$\_\_\_\_\_)**

To be completed in \_\_\_\_\_ working days (8 hr. shifts).

**Unit Abatement Costs: Removal as ACM and disposal as applicable by regulations:**

<b>Material</b>	<b>Unit</b>	<b>Unit Cost</b>
Mastic associated with Floor Tile	Square Foot	\$/sq. ft.:
Vinyl Floor Tile and Mastic	Square Foot	\$/sq. ft.:
Plaster Wall/Ceiling Materials	Square Foot	\$/sq. ft.:
Gypsum Board Wall/Ceiling Materials	Square Foot	\$/sq. ft.:
Thermal System Pipe Insulation (Elbows)	Each	\$/ each:
Thermal System Pipe Insulation (Runs)	Linear Foot	\$/ln. ft.:
Cove Base Glue	Linear Foot	\$/ln. ft.:
Built-up Roofing	Square Foot	\$/sq. ft.:
Mobilization Cost Associated with Follow-up Abatement Services	Mobilization	\$/Mob

**BIDDER**

by\_\_\_\_\_

Address\_\_\_\_\_

\_\_\_\_\_  
Contractor License\_\_\_\_\_

License Type\_\_\_\_\_

Type of business entity:

\_\_\_\_\_

Individual partners or individuals of the firm:

---

---

---

President of Corporation \_\_\_\_\_

Secretary of Corporation \_\_\_\_\_

Corporation is organized under laws of the State of \_\_\_\_\_

Bid dated this \_\_\_\_\_ day of \_\_\_\_\_, 2018.

**END OF BID FORM**

## ASBESTOS CONTAINING MATERIALS ABATEMENT SUMMARY OF WORK

The Work includes the abatement of Asbestos Containing Materials (ACM) at 10265 NW Cornell Road, Portland, Oregon in order to prepare the site for renovation. The scope of work includes abatement and proper disposal of the asbestos containing materials identified in this document.

Base Bid: The Asbestos Abatement Contractor shall furnish all labor, materials, services, insurance (specifically covering the handling, transportation of asbestos containing material (ACM) and equipment which is specified, shown, or reasonably implied for the following abatement work.

The removal and disposal as required by applicable regulations, of the following friable and non-friable asbestos containing materials identified in the Supplemental Asbestos and Lead Paint Survey report prepared by TRC and dated January 13, 2019. The asbestos-containing materials to be abated and their general location(s) are as follows:

### Asbestos Containing Materials

Description	Material Location(s)	Friable / non-Friable	Approximate Quantity
Plaster or Gypsum Board & Joint Compound Walls and Ceilings	Throughout Renovation Area – See Figures	Friable	1,220 SF
Vinyl Floor Tile and Mastic	Under and around HVAC Units	Non-Friable	550 SF
Pipe Insulation and Elbows	Behind HVAC Units, Within Wall/Ceiling Cavities & HVAC Units, Crawl Spaces and Tunnel System, and Gym Attic – See Figures	Friable	2,000 LF
Cove Base Glue – OSHA Regulated	Throughout w/ Wall & Floor Removal	Non-Friable	320 LF

## ASBESTOS

### PART 1 GENERAL - ASBESTOS

#### 1.01 SCOPE OF WORK

- A. The asbestos abatement and disturbance work related to this Project will consist of the removal and disposal of asbestos containing materials (ACM) and presumed asbestos containing materials (PACM) within portions of Cedar Mill Elementary School located at 10265 NW Cornell Road in Portland, Oregon 97229 as part of a planned renovation project. This section is intended to provide instruction for requirements in connection with asbestos abatement or disturbance and is complementary to the other contract documents, which apply to this section by reference.
- B. For Work described in this Section, the Abatement Contractor (Contractor) shall furnish all labor, materials, equipment, tools, and any other resources necessary to complete the work in accordance with regulatory requirements and project contract documents, using best available technology and industry standard methods and procedures. The work shall include but not be limited to the removal and proper disposal of ACM and/or presumed ACM (PACM) materials as described below:

## Asbestos Containing Materials

Description	Material Location(s)	Friable / non-Friable	Approximate Quantity
Plaster or Gypsum Board & Joint Compound Walls and Ceilings	Throughout Renovation Area – See Figures	Friable	1,220 SF
Vinyl Floor Tile and Mastic	Under and around HVAC Units	Non-Friable	550 SF
Pipe Insulation and Elbows	Behind HVAC Units, Within Wall/Ceiling Cavities & HVAC Units, Crawl Spaces and Tunnel System, and Gym Attic – See Figures	Friable	2,000 LF
Cove Base Glue – OSHA Regulated	Throughout w/ Wall & Floor Removal	Non-Friable	320 LF

Please refer to Appendix A, Limited Supplemental Asbestos and Lead Paint Survey Report dated, January 13, 2019, for additional and more detailed information on the asbestos materials present at the Site.

Estimated quantities are provided as an approximate guide to the Contractor. The material quantities listed above are approximations and TRC is not responsible for the accuracy of the quantities and measurements provided. The Contractor shall field verify material quantities, locations, and make themselves cognizant of existing field conditions prior to submitting bids for the work of this specification. Submitting of bids for work described herein shall take into consideration and utilize the Contractor's field measurements of materials and observations of the conditions verified on site.

- C. The Contractor shall be aware of all conditions of the Project and is responsible for verifying quantities and locations of all Work to be performed. Failure to do so shall not relieve the Contractor of its obligation to furnish all labor, equipment, and materials necessary to perform the Work.
- D. All Work shall be performed in strict accordance with the Project Documents and all governing codes, rules, and regulations. Where conflicts occur between the Project Documents and applicable codes, rules, and regulations, the more stringent requirement shall apply.
- E. Working hours shall be as required and approved by the Owner. ERM abatement activities including, but not limited to, work area preparation, gross removal activities, waste clean-up activities, waste removal, etc. may need to be performed during the specified time period by the Owner. The Contractor shall coordinate and schedule all Work with the facility and Owner's representative.

### 1.02 PERMITS AND COMPLIANCE

- A. The Contractor shall assume full responsibility and liability for compliance with all applicable Federal, State, and local laws, rules, and regulations pertaining to Work practices, protection of Workers, authorized visitors to the site, persons, and property adjacent to the Work.
- B. Perform asbestos related Work in accordance with Federal, State and Local Regulations (U.S. Environmental Protection Agency (EPA) 40 CFR 61, Occupational Health and Safety (OSHA) 29 CFR 1926 and Oregon Department of Environmental Quality (ODEQ)). Where more

stringent requirements are specified, the Contractor shall adhere to the more stringent requirements.

### 1.03 SUBMITTALS

A. Pre-Work Submittals: Within 15 calendar days prior to the pre-construction conference, the Contractor shall submit copies of the documents listed below to Beaverton School District's Environmental Consultant for review and approval prior to the commencement of asbestos abatement activities:

1. Asbestos Removal Work Plan which includes the means, methods and protective measures which will be used to comply with all applicable Federal, State and Local rules and regulations. This plan shall be completed and signed by an EPA accredited Asbestos Project Designer.
2. Current worker and contractor/supervisor training records.
3. Insurance Certificates
  - a. All Certificates of Insurance must name Beaverton School District as additional insured and will comply with entities noted in the contract as additional insured. These include the following:
    - Asbestos/Pollution Liability - \$1,000,000;
    - Auto Liability - \$1,000,000 per each vehicle on site;
    - Workman's Compensation and Employers Liability - \$500,000 per accident;
    - Commercial General Liability - \$1,000,000 per occurrence with \$2,000,000 general aggregate per project
    - True Umbrella Policy - \$5,000,000
  - b. All insurance will be written through companies having an A.N. rating of at least A VII or with such other companies as may reasonably be approved by Owner. All such liability insurance maintained by the Contractor or any subcontractor will include the condition that it is primary and that any such insurance maintained by Owner or any other additional insured is excess and non-contributory.

B. On-Site Submittals: Refer to Part 3.01.C for all submittals, documentation, and postings required to be maintained on-site during abatement activities.

C. Project Close-out Submittals: Within 30 business days of the completion of the project, the Contractor shall submit digital and hard copies of the documents listed below. The documents shall be transmitted to the Environmental Consultant for review and approval prior to the Contractor's final payment.

1. Originals of all waste disposal manifests, seals, and disposal logs.
2. OSHA personal air monitoring results conducted during the Work.

3. Daily progress log describing in detail the areas of work and ACM/PACM affected by the day's work activities and regulated work area entry/exit logs
4. Project Notifications
5. Safety Meeting Logs
6. Insurance Certificates
7. Workers Certifications and Medical Monitoring
8. Contractors Licenses

#### 1.04 PRE-CONSTRUCTION CONFERENCE

- A. Prior to start of preparatory Work under this Contract, the Contractor shall attend a pre-construction conference attended by Owner, Architect and Environmental Consultant.
- B. Agenda for this conference shall include but not necessarily be limited to:
  1. Contractor's Asbestos Removal Work Plan
  2. Environmental Consultant's duties and functions
  3. Contractor's Work procedures including:
    - a. Methods of job site preparation and removal methods
    - b. Respiratory protection
    - c. Disposal procedures
    - d. Cleanup procedures
    - e. Fire exits and emergency procedures
  4. Contractor's required pre-work and on-site submittals, documentation, and postings
  5. Contractor's plan for twenty-four (24) hour project security both for prevention of theft and for barring entry of unauthorized personnel into work areas
  6. Temporary utilities
  7. Storage of removed asbestos containing materials
  8. Waste disposal requirements and procedures, including waste manifest and container seals
- C. In conjunction with the conference the Contractor shall accompany the Owner, Architect and Environmental Consultant on a pre-construction walk-through of the Project site.

## 1.05 APPLICABLE STANDARDS AND REGULATIONS

All asbestos related work must be performed in accordance with EPA and OSHA regulations (40 CFR 61, 29 CFR 1926) and Oregon Department of Environmental Quality. Where more stringent requirements are specified, the Contractor shall adhere to the more stringent requirements.

## 1.06 NOTICES

- A. The Contractor shall provide notification of intent to commence asbestos abatement activities at least ten (10) working days prior to beginning abatement activities. Written notification shall be sent to the Oregon Department of Environmental Quality Department (DEQ).
- B. The Contractor shall maintain copies of notices, and provide proof of delivery and receipt.
- C. The Contractor shall be responsible for maintaining current project filings with regulatory agencies for the duration of the project.

## 1.07 ENVIRONMENTAL CONSULTANT

- A. The Owner shall engage the services of an Environmental Consultant (the Consultant) who shall serve as the Owner's Representative in regard to the performance of the asbestos abatement Project and provide direction as required throughout the entire abatement Project period.
- B. The Contractor is required to ensure cooperation of its personnel with the Consultant for the air sampling and Project monitoring functions described in this section. The Contractor shall comply with all direction given by the Consultant during the course of the Project.
- C. The Consultant shall review and approve all Contractor submittals.
- D. The Consultant shall staff the Project with a trained and certified person(s) to act on the Owner's behalf at the job site.
  - 1. The consultant's representative shall be on-site at all times the Contractor is on-site. The Contractor shall not be permitted to conduct any Work unless the consultant's representative is on-site (except for inspection of barriers and negative air system during non-working days).
  - 2. The consultant's representative shall have the authority to direct the actions of the Contractor verbally and in writing to ensure compliance with the Project documents and all regulations. The consultant's representative shall have the authority to Stop Work when gross Work practice deficiencies or unsafe practices are observed, or when ambient fiber concentrations outside the removal area exceed 0.01 f/cc or background level.
    - a. Such Stop Work order(s) shall be effective immediately and remain in effect until corrective measures have been taken and the situation has been corrected.
    - b. Standby time required to resolve the situation shall be at the Contractor's expense.
  - 3. The consultant's representative shall provide the following services:

- a. Inspection of the Contractor's Work, practices, and procedures, including temporary protection requirements, for compliance with all regulations and Project specifications including provisions required by Variances, the Work Place Safety Plan and Asbestos Work Permit.
  - b. Provide abatement Project air sampling as required by applicable regulations and the Owner. Sampling will include background, work area preparation, asbestos handling, final cleaning and clearance air sampling.
  - c. Verify daily that all Workers used in the performance of the Project are certified by the appropriate regulatory agency.
  - d. Monitor the progress of the Contractor's Work, and report any deviations from the schedule to the Owner.
  - e. Monitor, verify, and document all waste load-out operations.
  - f. Verify that the Contractor is performing personal air monitoring daily, and that results are being returned and posted at the site as required.
  - g. The consultant's representative shall maintain a log on site that documents all project related and Consultant and Contractor actions, activities, and occurrences.
4. The following minimum inspections shall be conducted by the consultant's representative. Additional inspections shall be conducted as required by Project conditions. Progression from one phase of Work to the next by the Contractor is only permitted with the written approval of the consultant's representative.
- a. Pre-Construction Inspection: The purpose of this inspection is to verify the existing conditions of the Work Areas and to document these conditions.
  - b. Pre-Commencement Inspection: The purpose of this inspection is to verify the integrity of each containment system prior to disturbance of any asbestos containing material. This inspection shall take place only after the Work Area is fully prepped for removal.
  - c. Work Inspections: The purpose of this inspection is to monitor the Work practices and procedures employed on the Project and to monitor the continued integrity of the containment system. Inspections within the removal areas shall be conducted by the consultant's representative during all preparation, removal, and cleaning activities at least twice every Work shift. Additional inspections shall be conducted as warranted.
  - d. Pre-Encapsulation Inspection: The purpose of this inspection is to ensure the complete removal of ACM and/or PACM, from all surfaces in the Work Area prior to encapsulation.
  - e. Visual Clearance Inspection: The purpose of this inspection is to verify that: all materials in the scope of work have been properly removed; no visible asbestos debris/residue remains; no pools of liquid or condensation remains; and all required cleanings are complete. This inspection shall be conducted before final air clearance testing.

- f. Post-Clearance Inspection: The purpose of this inspection is to ensure the complete removal of ACM, including debris, from the Work Area after satisfactory final clearance sampling and removal of all isolation and critical barriers and equipment from the Work Area.
- E. The Consultant shall provide abatement Project air sampling and analysis as required by applicable regulations. Sampling will include background, work area preparation, asbestos handling, and final cleaning and clearance air sampling.
  - 1. Unless otherwise required by applicable regulations, the Consultant shall have samples analyzed by Phase Contrast Microscopy (PCM) for daily area and final clearance air monitoring during asbestos removal or disturbance work. Results shall be available at the Project site within 2 hours of completion of sampling. Should TEM analysis be requested/required, results will be provided within 24 hours of receipt of samples by the accredited laboratory.
  - 2. Samples shall be collected as required by applicable regulations and these specifications.
  - 3. If the air sampling during any phase of the abatement project reveals airborne fiber levels at or above .01 fibers/cc or the established background level, whichever is greater, outside the regulated Work Area, Work shall stop immediately and corrective measures required by applicable regulations shall be initiated. Notify all employers and occupants in adjacent areas. The Contractor shall bear the burden of any and all costs incurred by this delay.
  - 4. At the completion of each abatement phase, the Consultant shall prepare an interim certificate of completion for project records.

#### 1.08 PERSONAL AIR SAMPLING

- A. The Contractor shall perform appropriate personal air monitoring in accordance with 29 CFR 1926.1101, every Work shift in each Work Area during which abatement activities occur in order to determine that appropriate respiratory protection is being worn and utilized.
- B. The Contractor shall conduct air sampling that is representative of both the 8-hour time weighted average and 30-minute short-term exposures to indicate compliance with the permissible exposure and excursion limits.
- C. The Contractor's laboratory analysis of air samples shall be conducted by laboratory accredited by the American Industrial Hygiene Association (AIHA) for PCM analysis.
- D. Results of personnel air sample analyses shall be available within 5 business days of sample collection.

#### 1.09 PROJECT SUPERVISOR

- A. The Contractor shall designate a full-time Project Supervisor who shall meet the following qualifications:

1. The Project Supervisor shall hold an Asbestos Hazard Emergency Response Act (AHERA) certification as an Asbestos Contractor/Supervisor.
  2. The Project Supervisor shall meet the requirements of a "Competent Person" as defined by OSHA 1926.1101 and shall have a minimum of one year experience as a supervisor.
  3. The Project Supervisor must be able to speak, read, and write English fluently, as well as communicate in the primary language of the Workers and immediate community.
- B. The Project Supervisor shall be responsible for the performance of the Work and shall represent the Contractor in all respects at the Project site. The Supervisor shall be the primary point of contact for the Asbestos Project Monitor.

#### 1.10 RESPIRATORY PROTECTION

- A. Select respirators from those approved by the National Institute for Occupational Safety and Health (NIOSH), Department of Health and Human Services.
- B. High Efficiency Particulate Air (HEPA) respirator filters shall be approved by NIOSH and shall conform to the OSHA requirements in 29 CFR 1910.134 and 29 CFR 1926.1101.
- C. A storage area for respirators shall be provided by the Contractor in the clean room side of the personnel decontamination enclosure where they will be kept in a clean environment.
- D. The Contractor shall provide and make available a sufficient quantity of respirator filters so that filter changes can be made as necessary during the work day. Filters used with negative pressure air purifying respirators shall be changed regularly to comply with OSHA.
- E. Any visitor, Worker, or supervisor found in the Work Area not wearing the required respiratory protection shall be removed from the Project site.

#### 1.11 DELIVERY AND STORAGE

- A. Store all materials at the job site in a suitable and designated area.
  1. Store materials subject to deterioration or damage away from wet or damp surfaces and under cover.
  2. Protect materials from unintended contamination and theft.
  3. Storage areas shall be kept clean and organized.
- B. Remove damaged or deteriorated materials from the job site. Materials contaminated with asbestos shall be disposed of as asbestos debris.

#### 1.12 TEMPORARY UTILITIES

- A. Shut down and lock out all electrical power to the asbestos Work Areas.

- B. Provide temporary electric service with Ground Fault Circuit Interrupters (GFCI) for all electric requirements within the asbestos Work Area.
- C. Provide temporary lighting with "weatherproof" fixtures for all Work Areas.
- D. Utilize domestic water service, if available, from Owner's existing system. Provide hot water heaters with sufficient capacity to meet Project demands.

## PART 2 PRODUCTS

### 2.01 MATERIALS

- A. All materials shall be delivered to the job site in the original packages, containers, or bundles bearing the name of the manufacturer, the brand name and product technical description, with Safety Data Sheets (SDSs) as applicable.
- B. No damaged or deteriorating materials shall be used. If material becomes contaminated the material shall be decontaminated or disposed of as asbestos-containing waste material. The cost to decontaminate and dispose of this material shall be at the expense of the Contractor.
- C. Fire retardant polyethylene sheet shall be in roll size to minimize the frequency of joints, with factory label indicating no less than six (6) mil thickness.
- D. Polyethylene disposable bags shall be no less than six (6) mils thick.
- E. A commercial grade duct tape (or equivalent) capable of sealing joints in adjacent polyethylene sheets and for the attachment of polyethylene sheets to finished or unfinished surfaces must be capable of adhering under both dry and wet conditions.
- F. Any planking, bracing, shoring, barricades and/or temporary sheet piling, necessary to appropriately perform work activities shall conform to all applicable federal, state and local regulations.

### 2.02 TOOLS AND EQUIPMENT

The Contractor shall provide tools and equipment that are suitable for asbestos related activities and in good working order.

## PART 3 EXECUTION

### 3.01 GENERAL REQUIREMENTS

- A. The following submittals, documentation, and postings shall be maintained on-site by the Contractor during abatement activities:
  - 1. Asbestos worker and contractor/supervisor certification cards for each person employed in the removal, handling, or disturbance of asbestos

2. Daily OSHA personal air monitoring results
  3. Project documents (specifications and drawings)
  4. Applicable regulations
  5. Safety Data Sheets of supplies/chemicals used on the Project
  6. Approved Abatement Work Plan
  7. List of emergency telephone numbers
  8. Daily Project Log
- B. The following documentation shall be maintained on-site by TRC Environmental Corp. during abatement activities:
1. Air sample results
  2. Project Monitor Daily Log
  3. Asbestos Survey Report
  4. A copy of ASTM Standard E1368 "Standard Practice for Visual Inspection of Asbestos Abatement Projects"
- C. Install emergency exit signage and fire extinguishers throughout the Work Area in accordance with OSHA Construction Industry Standards.
- D. Use the following engineering controls and work practices for all asbestos abatement operations, regardless of measured exposure levels:
1. Vacuum cleaners equipped with HEPA filters to collect all asbestos-containing dust and debris
  2. Wet methods to control exposures during asbestos removal and clean-up, except where proven to be infeasible
  3. Prompt clean-up and disposal of asbestos-contaminated wastes and debris in leak-proof containers
- E. Do not use any of the following equipment or work practices during asbestos abatement operations, regardless of measured exposure levels:
1. High-speed abrasive disc saws not equipped with point-of-cut HEPA ventilation or HEPA filtered exhaust air enclosures
  2. Blowing with compressed air to remove asbestos-containing materials
  3. Dry sweeping, shoveling, or other dry methods to clean up asbestos-containing dust and debris

4. Employee rotation as a means of reducing employee exposure to asbestos
- F. Protect adjacent areas, materials and surfaces from damage due to demolition operations, including but not necessarily limited to the following:
1. Water damage
  2. Dirt, dust and debris
  3. Abrasion
  4. Cuts and scratches
  5. Holes from fasteners for temporary barriers

### 3.02 PROTECTIVE CLOTHING

- A. Provide personnel utilized during the Project with disposable protective whole body clothing, head coverings, gloves and foot coverings. Provide disposable plastic or rubber gloves to protect hands. Cloth gloves may be worn inside the plastic or rubber for comfort, but shall not be used alone. Make sleeves secure at the wrists and make foot coverings secure at the ankles by the use of tape, or provide disposable coverings with elastic wrists or tops.
- B. Authorized visitors shall be provided with suitable protective clothing, headgear, eye protection, and footwear whenever they enter the Work Area.

### 3.03 SIGNS AND LABELS

- A. Provide warning signs and barrier tapes at all approaches to asbestos Work Areas. Locate signs at such distance that personnel may read the sign and take the necessary protective steps required before entering the area.
1. Provide danger signs in vertical format conforming to 29 CFR 1926.1101, minimum 20" x 14" displaying the following legend.

ASBESTOS CANCER AND LUNG DISEASE  
HAZARD  
AUTHORIZED PERSONNEL ONLY  
RESPIRATORS AND PROTECTIVE CLOTHING  
ARE REQUIRED IN THIS AREA

2. Provide 3" wide OSHA-Approved barrier tape printed with black lettered, "DANGER ASBESTOS REMOVAL". Locate barrier tape across all corridors, entrances and access routes to asbestos Work Area. Install tape 3' to 4' Above Finished Floor AFF.
- B. Provide asbestos danger labels affixed to all asbestos materials, scrap, waste, debris and other products contaminated with asbestos.
1. Provide asbestos danger labels of sufficient size to be clearly legible, displaying the following legend:

DANGER  
CONTAINS ASBESTOS FIBERS  
AVOID CREATING DUST  
CANCER AND LUNG DISEASE HAZARD

2. Provide the following asbestos labels, of sufficient size to be clearly legible, for display on waste containers (bags or drums) which will be used to transport asbestos contaminated material in accordance with United States Department of Transportation 49 CFR Parts 171 and 172: (Note: Include "RQ" for friable asbestos waste only.)

RQ, (WASTE) ASBESTOS, 9, NA2212, PGIII

3. Generator identification information shall be affixed to each waste container indicating the following printed in indelible ink:
  - Generator Name
  - Facility Name
  - Facility Address
  - EPA Generator ID Number

### 3.04 FRIABLE ACM REMOVAL BY FULL ENCLOSURE METHOD

#### A. Preparation of the Work Area

1. Install critical barriers over each opening into the regulated area. The following requirements are in addition to, not in lieu of, other indicated surface and object protection requirements:
  - a. Seal each opening between the work area and adjacent areas with not less than 2 layers of 6-mil polyethylene sheeting. Use an expanding-polyurethane foam gun to seal areas with large numbers of pipes, conduits and beams. Openings include, but are not necessarily limited to, windows, skylights, doorways, elevator hoist way openings, corridor entrances, drains, ducts, grills, grates, and diffusers.
  - b. Seal intake and exhaust vents and duct seams within the regulated area with not less than 2 layers of 6-mil polyethylene sheeting.
2. HVAC System Shutdown: Owner's maintenance personnel will shut down heating, cooling, and air conditioning systems when necessary. Coordinate scheduling with Owner's personnel.
3. Protection of Surfaces and Objects: The following requirements are in addition to, not in lieu of, indicated work area sealing requirements. Cover the following surfaces and objects as follows:
  - a. Protect all surfaces beneath all removal activity. Remove moveable objects from the work area, and cover fixed objects with impermeable drop cloths or plastic sheeting with edges securely sealed with tape.

- b. Provide clean, fresh air to mechanical equipment, where required to maintain proper performance of equipment.
  - c. Fully pre-clean all covered surfaces with amended water and a HEPA vacuum.
  - d. Cover walls with not less than 2 layers of 6-mil polyethylene sheeting. Construct free-standing enclosure walls of not less than 6-mil polyethylene sheeting, with supports spaced not more than 3 feet on center.
  - e. Cover floors with not less than 2 layers of 6-mil polyethylene sheeting. Avoid seams where possible. If seams are necessary, overlap not less than 12 inches and tape joints. Extend sheeting 12 inches up the side walls leaving no seams at the wall and floor joint. Immediately repair punctures and leaks, and clean up seepage.
- 4. Cleaning: Do not use cleaning methods that raise dust, such as sweeping or using vacuum cleaners not equipped with HEPA filters. Do not disturb asbestos materials during pre-cleaning phases. Treat water removed from the enclosure as asbestos contaminated waste. Fully seal floor drains.
- 5. Deactivate or install ground-fault circuit interrupters on each electrical circuit within the enclosure.
- 6. Construct a three-chambered decontamination facility that is adjacent to and connected to the regulated area, and that consists of a dirty room, a shower room, and a clean room in series. Construct decontamination facilities that are exposed to weather of lumber and exterior grade plywood. Secure the facility when not in use.
  - a. Supply the equipment room with properly labeled, impermeable bags and containers for the containment and disposal of contaminated protective equipment.
  - b. Construct showers that comply with the requirements of 29 CFR 1910.141 (d) (3), with the shower room adjacent to both the equipment room and the clean room. Filter water waste and shower water through a 5 micron filter, or remove water from site as asbestos waste.
  - c. Equip the clean room with a locker or appropriate storage container for each employee.
- 7. Employee Decontamination Facilities
  - a. Access the work area only through an approved decontamination system. Lock or block other entrances. Seal emergency exits (for use during a fire or accident) with polyethylene sheeting and tape.
  - b. Seal the waste pass-out, except during the removal of asbestos waste from the enclosure.
  - c. Entrance to The Regulated Area: Employees shall enter the decontamination area through the clean room, remove and store clothing, and put on protective clothing and respiratory protection before passing through to the equipment room.

- d. Exit from The Regulated Area: Employees shall exit the regulated area by removing gross contamination and debris from their protective clothing. The clothing shall be removed and disposed of in the equipment room into labeled impermeable bags or containers. Employees shall then shower and enter the clean room before changing into street clothes.
8. Local Exhaust Ventilation: Maintain portable air filtration units with a HEPA filter in use during asbestos abatement operations requiring enclosures. Units shall conform to OSHA Standard 1926.1101, Appendix F, and shall be designed in accordance with 40 CFR 61, Subpart M, Section 61.153.
  - a. Exhaust directly to building exterior. Provide a backup portable air filtration unit at each removal enclosure. Startup ventilation units prior to initiating asbestos removal operations and run until the Owner's consultant has approved their shut-down after cleaning, visual inspection, clearance sampling and tear-down.
  - b. Direct air movement within the enclosure away from the employees' work area and toward the air filtration device.
  - c. Provide not less than 4 air changes per hour within the enclosure.
  - d. Within the enclosure, through the period of its use, maintain a pressure differential of not less than minus 0.02 water gage with respect to ambient conditions outside the enclosure. Provide continuous measurement of the pressure differential at each negative pressure enclosure.
9. Visually inspect the enclosure for breeches and smoke-test for leaks before work begins, and before the start of each work shift. Make all modifications to the enclosure prior to starting removal work.

**B. Work Practices**

1. Immediately preceding asbestos removal, apply a fine mist of water to the asbestos materials and the surrounding area. Keep surrounding areas wet by spraying periodically with amended water. Maintain a high humidity environment to assist in fiber settling.
2. Remove asbestos material using two-person teams, on staging platforms, if necessary.
3. Remove the wet asbestos material as intact sections or components. Carefully lower the material to the floor or place directly into container. Never drop or throw asbestos material on the floor.
4. At working heights between 15 and 50 feet above the floor, place removed asbestos materials in containers at the elevated levels and lower to floor, or place onto inclined chutes or scaffolding for subsequent collection and placement into containers. Clean all debris at the completion of each workday.
5. Once the asbestos material is at ground level, pack in labeled 6-mil polyethylene bags, wet and, if appropriate, hold in drums prior to starting the next section.

6. Use 2 sealed and labeled 6-mil thick bags for storage and transportation of asbestos waste. Standing water shall be in each bag
7. Wrap large components removed intact in two layers of 6-mil polyethylene sheeting, label, and secure with tape for transport to the landfill. Comply with all wetting requirements.
8. Treat wires, hangers, steel bands, nails, screws, metal lath, tin sheeting, and similar sharp objects removed with asbestos material as asbestos waste. Place in drums for disposal.
9. Label containerized asbestos waste in accordance with OSHA, EPA, and Department of Transportation regulations, as follows:
  - a. Label each container with OSHA label that contains the following information:

**DANGER  
CONTAINS ASBESTOS FIBERS  
AVOID CREATING DUST  
CANCER AND LUNG  
DISEASE HAZARD**
  - b. Label each container with Owner's and Asbestos Abatement Firm's names and addresses as required by NESHAP.
  - c. Label each container with Class 9 Label required by DOT and identify waste as "RQ, Asbestos NA 2212."
10. Remove containerized asbestos waste daily from site, or store on site in a locked or secured location until ready for final disposal. Obtain approval of Owner's Representative of the location of disposal containers. Outdoor waste containers shall be fully enclosed and locked. Mark vehicles used to transport waste during the loading and unloading of asbestos waste with a visible sign, as required by NESHAP.

### 3.05 REMOVAL OF NON-FRIABLE ASBESTOS-CONTAINING MATERIALS

#### A. Removal of Vinyl Floor Tile (unless rendered Friable)

1. Prior to removal, critical barriers shall be placed over openings to the regulated area.
2. Prior to removal, clean floors of dirt and debris with vacuums equipped with HEPA filter.
3. Sanding the floor or related backing is not permitted.
4. Mechanical chipping of vinyl floor tile is prohibited, except when performed in a negative pressure enclosure.
5. Thoroughly wet vinyl floor tile with water. Use a slip scraper or equivalent to loosen the floor tile from the floor. Remove the floor tile in an intact state. Keep the floor tile wet throughout the removal and cleanup.

6. Place the resilient flooring material and debris in an asbestos disposal bag. Seal the bag and place it in a properly labeled drum. Comply with the disposal and labeling requirements of this document.

B. Asbestos Mastic Removal

1. Prior to removal, critical barriers shall be placed over openings to the regulated area.
2. Clean the floor of all debris using a HEPA vacuum, wet sweeping, mopping or equivalent.
3. Remove as much mastic as possible using a Consultant approved solvent. Control odors and fumes with engineering controls.
4. Perform scraping of residual adhesive using wet methods.
5. After all debris is removed, thoroughly mop the floor and allow time to dry.
6. Properly dispose of all asbestos and solvent waste according to all applicable regulations, and comply with the disposal and labeling requirements of this Section.

C. Asbestos-Containing Siding and Transite Panels

1. Create a regulated work area and place impermeable drop cloths on surfaces beneath removal activity.
2. Cutting, abrading, or breaking material is not permitted.
3. Wet material with water prior to removal.
4. Carefully disassemble material such a manner as to prevent breakage.
5. Wrap and seal material in two layers 6-mil thick polyethylene, asbestos disposal bags, or equivalent. Seal bags or packages and properly label them with appropriate asbestos warning signs.

D. Non-Friable Asbestos Containing Exterior Sealant, Caulk, Putty and Window Glazing

1. Create a regulated work area and place impermeable drop cloths on surfaces beneath removal activity.
2. Any existing loose material shall be HEPA vacuumed prior to removal.
3. The material shall be thoroughly wetted prior to and during its removal.
4. The material should be removed as intact as possible. Manual methods shall be used.
5. Removed ACM shall be immediately bagged.

6. The removal of windows and other whole building components without disturbing the asbestos is encouraged.
7. If the material becomes friable during the abatement process, comply with the requirements for friable asbestos removal.


### 3.06 WORK AREA DECONTAMINATION AND CLEARANCE PROCEDURES

- A. The Asbestos Abatement Contractor's representative, in presence of Owner's consultant, shall inspect the entire work area for asbestos.
- B. If any suspect asbestos dust or debris is found, repeat final cleaning operation, until the visual inspection is satisfactory to the Owner's consultant.
- C. After final visual clearance criteria have been achieved in the work areas, the Owner's consultant will notify the Abatement Contractor to encapsulate all walls, floors, ceilings, other exposed surfaces, and decontamination facilities.
- D. Clearance air sampling will be completed by the Owner's consultant after the encapsulant has dried. Any costs associated with re-cleaning due to failed clearance results will be the sole responsibility of the Abatement Contractor. All clearance air samples shall be at or below 0.01 fibers per cubic centimeter as measured using Phase Contrast Microscopy (NIOSH 7400 method) or below 70 structures per square millimeter by Transmission Electron Microscopy (TEM) using the AHERA analytical method.
- E. After abatement clearance is given by the Asbestos Project Monitor the Abatement Contractor may remove the containment, which shall be disposed of as ACM.

### 3.07 WASTE DISPOSAL

- A. All waste will be transported and disposed of in compliance with DOT requirements and all applicable Federal, State and local regulations. Disposal must occur at an acceptable landfill accompanied by a waste manifest.
- B. A copy of all waste manifests shall be given to Owner upon completion of the project.

## FIGURES



ASBESTOS ABATEMENT MATERIAL LOCATION MAP - MAIN LEVEL

10265 NW Cornell Road  
Portland, OR 97229

4105 SE International Way  
Suite 505  
Milwaukie, OR 97222  
C: 503-407-0734  
F: 503-762-6882




DATE	01/14/19
SUBJECT NO	221417

PROJECT NO.	SC
DRAWN BY	SC

MC	HECKED BY
----	-----------

REVIEWED BY	RL
-------------	----



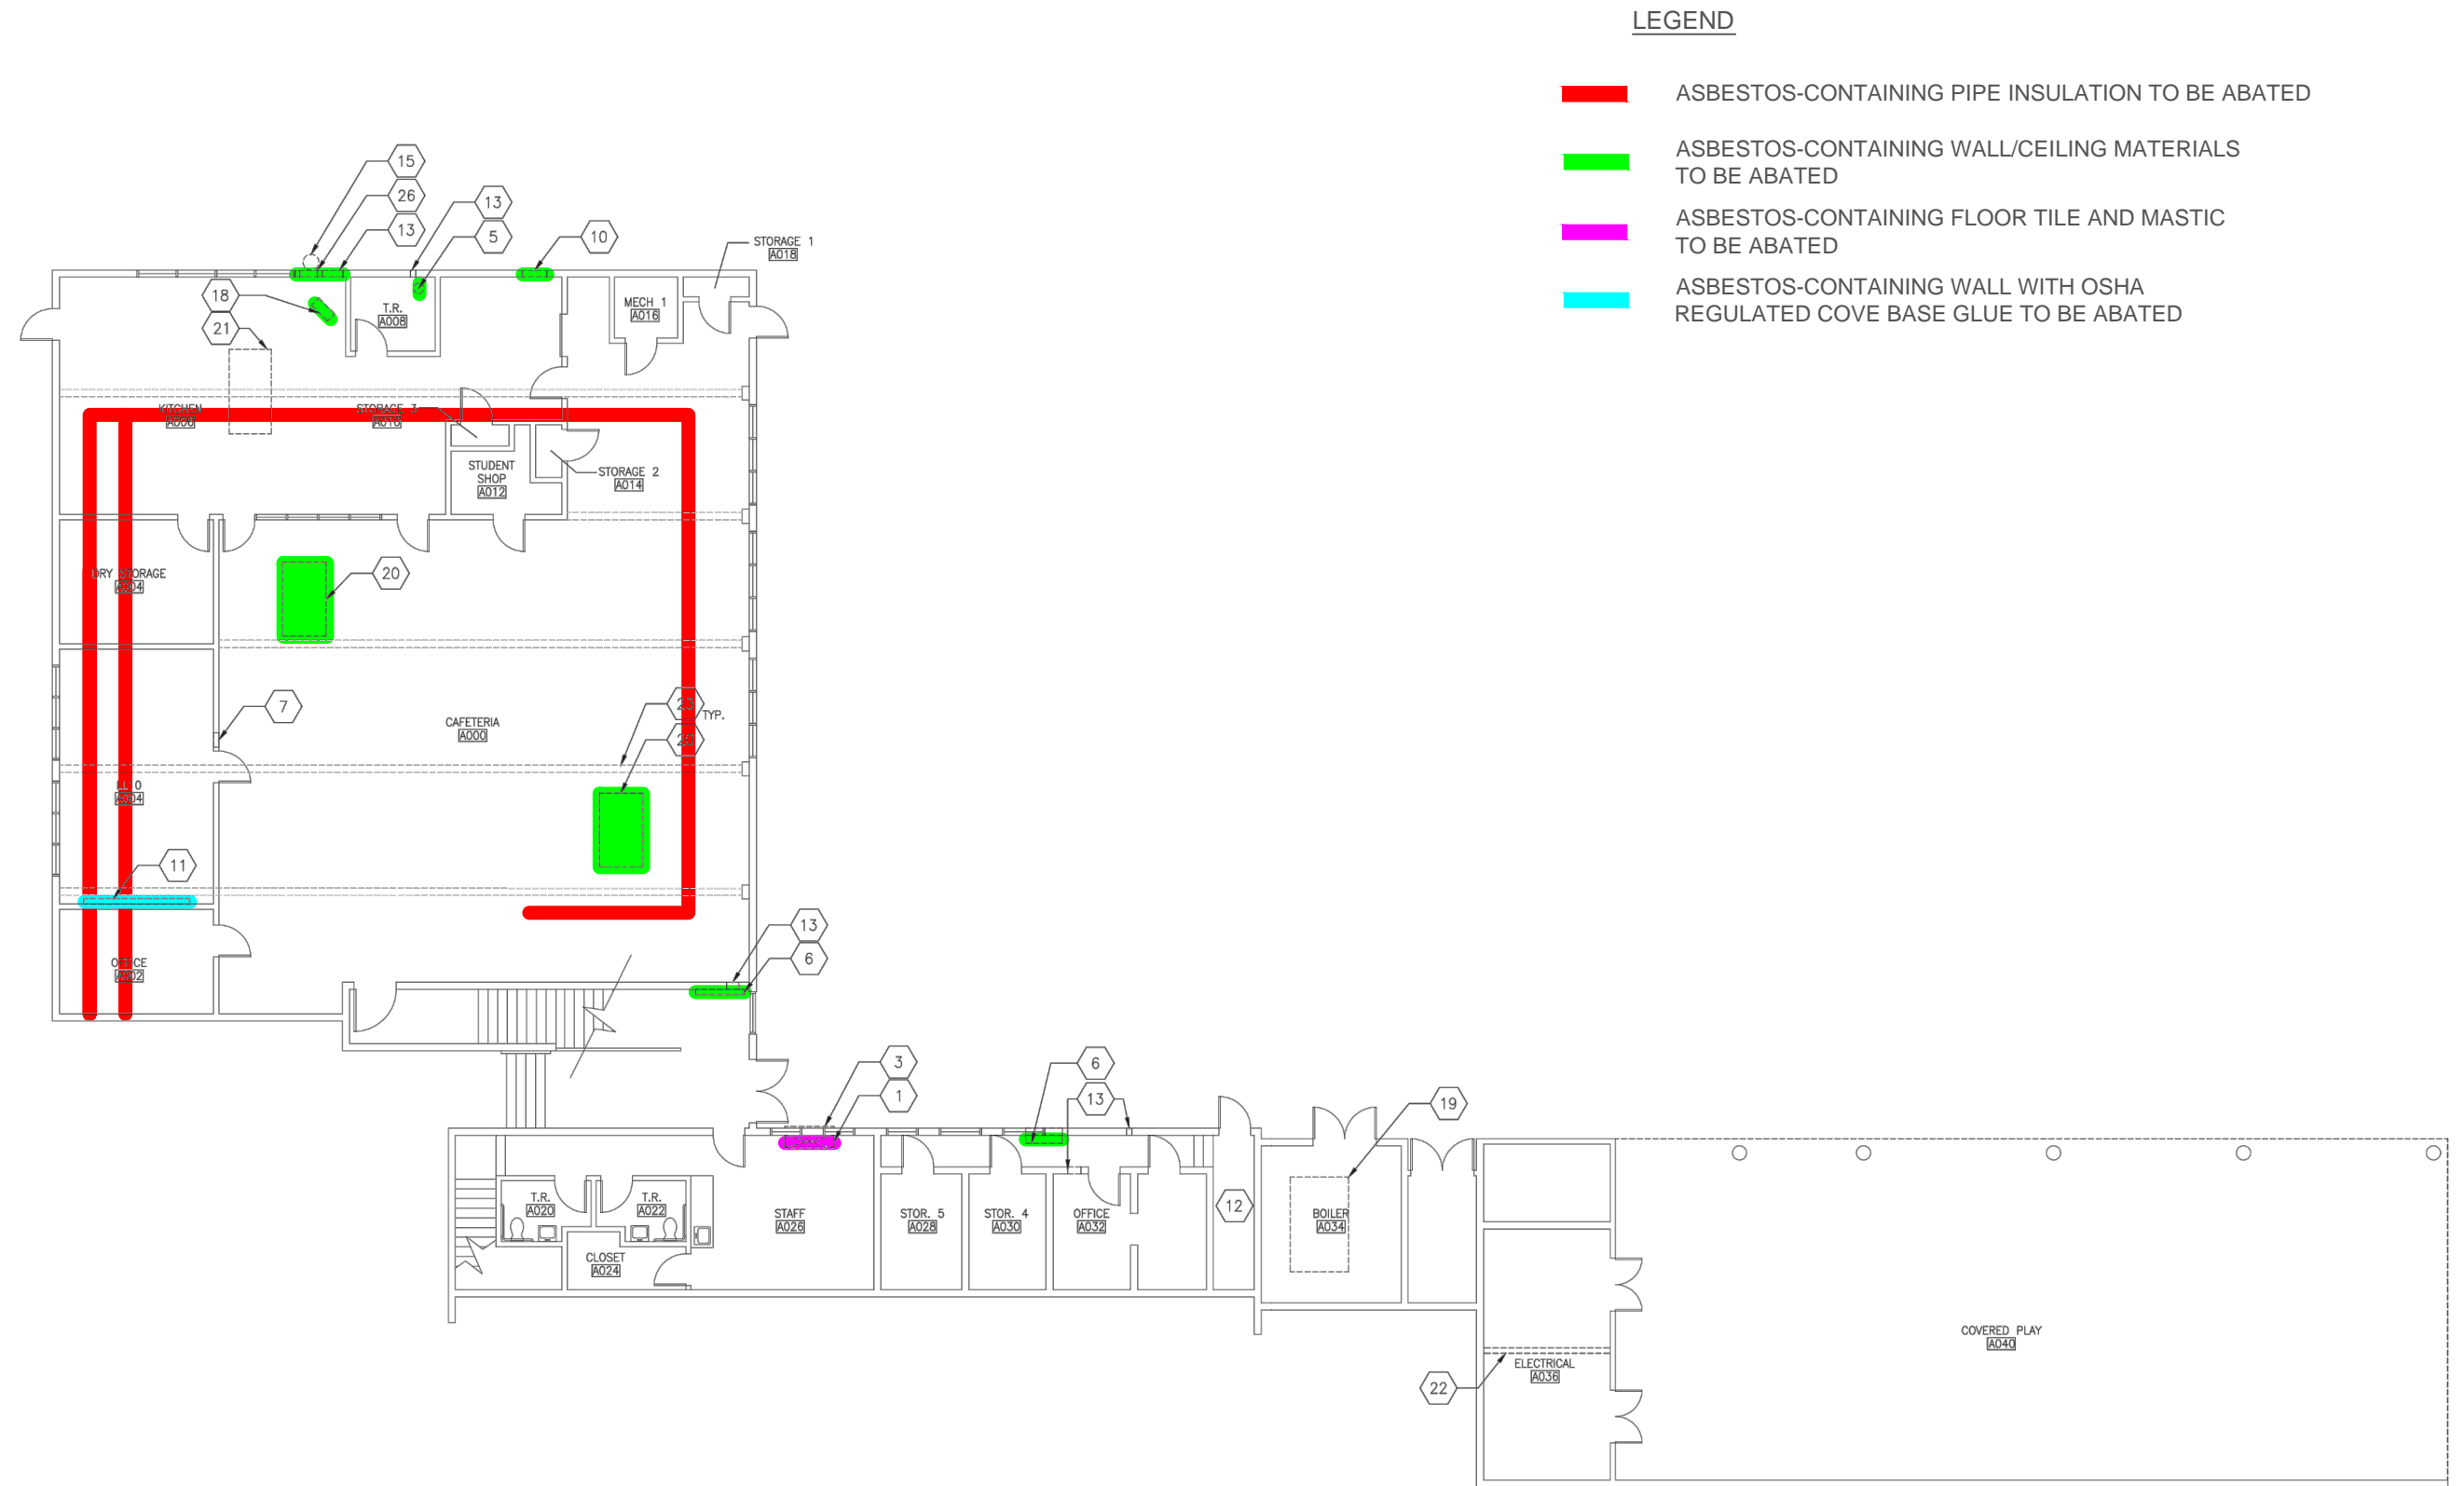

LEGEND

- ASBESTOS-CONTAINING PIPE INSULATION TO BE ABATED
- ASBESTOS-CONTAINING WALL/CEILING MATERIALS TO BE ABATED
- ASBESTOS-CONTAINING FLOOR TILE AND MASTIC TO BE ABATED
- ASBESTOS-CONTAINING WALL WITH OSHA REGULATED COVE BASE GLUE TO BE ABATED

FIGURE NUMBER

1.2

ASBESTOS ABATEMENT MATERIAL LOCATION MAP - LOWER LEVEL

Cedar Mills Elementary School  
10265 NW Cornell Road  
Portland, OR 97229

4105 SE International Way  
Suite 505  
Milwaukie, OR 97222  
C: 503-407-0734  
F: 503-762-6882



DATE

PROJECT NO.

DRAWN BY

CHECKED BY

01/15/19

321417

SC

MC

RL

## **APPENDIX A**

### **LIMITED SUPPLEMENTAL ASBESTOS AND LEAD PAINT SURVEY REPORT**

**Cedar Mill Elementary School**

**10265 NW Cornell Road**

**Portland, Oregon 97229**

**Dated: January 13, 2019**

# **LIMITED SUPPLEMENTAL ASBESTOS AND LEAD PAINT SURVEY REPORT**

## **Cedar Mill Elementary School**

**10265 NW Cornell Road  
Portland, OR 97229**

Prepared for:

### **Beaverton School District**

**16550 SW Merlo Road  
Beaverton, OR 97006**

**Inspection Dates:** November 28 and December 7, 2018 & January 3, 2019

**Report Prepared:** January 13, 2019

Prepared By:



**4105 SE International Way, Suite 505  
Milwaukie, OR 97222  
503.387.3251**

TRC Project Number: 321417

## TABLE OF CONTENTS

EXECUTIVE SUMMARY .....	1
BACKGROUND.....	3
<i>Asbestos Containing Materials</i> .....	3
<i>OSHA Regulated Materials</i> .....	3
<i>Asbestos Sampling and Analytical Procedures</i> .....	3
<i>Lead-based and Lead-containing Paints</i> .....	4
ASBESTOS FINDINGS & RECOMMENDATIONS .....	4
LEAD PAINT FINDINGS & RECOMMENDATIONS .....	7
RECOMMENDATIONS .....	10
DISCLAIMER .....	10

### Appendices

- Appendix A – Figures
- Appendix B – Laboratory Analytical Data Sheets
- Appendix C – Inspector Certification(s)

## **EXECUTIVE SUMMARY**

TRC Environmental Corporation (TRC) was contracted by the Beaverton School District to conduct a supplemental asbestos and lead paint survey, including collection of bulk asbestos samples, laboratory analysis, and preparation of a report for Cedar Mill Elementary School located at 10265 NW Cornell Road in Portland, Oregon 97229. Mr. Matt Cuda and Mr. Jason Stone, AHERA accredited building inspectors and lead risk assessor, performed the survey on November 28<sup>th</sup>, 2018 and December 7<sup>th</sup>, 2018. The survey activities included the review of prior sampling documentation and reports provided by the District, inspection and assessment of accessible suspect building materials, collection of bulk samples of suspect asbestos containing building materials that had previously not be sampled, and submission of bulk samples for laboratory analysis.

### **ASBESTOS MATERIAL SUMMARY**

Suspect asbestos containing building materials were sampled and submitted under the chain-of-custody (COC) protocol to an accredited laboratory for polarized light microscopy (PLM) bulk sample analysis. Inspection, sampling and analytical procedures were performed in general accordance with the U.S. Environmental Protection Agency's (EPA's) National Emission Standards for Hazardous Air Pollutants (NESHAP) EPA 40 CFR 61 Subpart M, the EPA Asbestos Hazard Emergency Response Act (AHERA) 40 CFR Part 763, and Federal Occupational Safety and Health Administration (OSHA) 29 CFR 1926.1101 guidelines.

The following materials sampled during this investigation and prior investigations were identified as asbestos containing materials:

- Pipe Run Insulation (Steam Lines)
- Pipe Fitting Insulation (Steam Lines)
- Joint Compound Associated with Gypsum Board Walls and Ceilings.
- Cement Asbestos Board/Chalkboards (Previously Sampled)
- Cove Base & Mastic (Reportedly Abated)
- Countertop and Mastic (Reportedly Abated)
- Hard Fittings (Reportedly Abated)
- Vinyl Floor Tile and Associated Mastic (Previously Sampled)

The following materials sampled during this investigation and prior investigations were identified as OSHA regulated materials containing less than 1% asbestos:

- Glue under Brown Cove Base (Basement Custodial Room)

TRC inspected accessible wall/ceiling cavities to locate any potential suspect pipe insulation. It appears that all the pipe insulation and fittings associated with the steam piping are asbestos containing; however it appears all the piping found to be associated with the domestic water pipes appears to have been replaced and during this assessment were found either to be fiberglass insulated or uninsulated. It should be noted however that the potential still exists for hidden pipe insulation materials to exist within wall/ceiling/floor cavities and HVAC units that were not accessible.

Additionally, any materials uncovered during renovation activities that are not addressed in this inspection report or prior reports for the building are considered presumed asbestos containing materials and must be sampled by an accredited asbestos inspector prior to disturbance, or they must be treated as asbestos containing.

### **LEAD PAINT/GLAZING MATERIAL SUMMARY**

Lead-based paint (LBP) is defined by the United States Department of House and Urban Development (HUD) as any paint, varnish, stain, or other applied coating that has one mg/cm<sup>2</sup> or more of lead or 0.5% by weight (5,000 micrograms per gram [µg/g] or 5,000 parts of lead per million [ppm]). The United States' Consumer Product Safety Commission (CPSC) banned lead paint in 1977 in residential properties and public buildings (16 Code of Federal Regulations 1303). According the Oregon Occupational Safety and Health Division's (OR OSHA) Program Directive, Lead: Exposure in Construction, "For all occupational exposure to lead occurring in the course of construction work, the standard (1926.62) does not specify a minimum amount or concentration of lead that triggers a determination that lead is present and the potential for occupational exposure exists. Therefore any paint containing less than one (1) mg/cm<sup>2</sup>, but greater than the laboratory or XRF detection limit is considered to be a lead-containing paint.

X-Ray Fluorescence (XRF) of painted/glazed coatings was performed using an EPA/HUD required XRF Cadmium 109 sourced hand-held analyzer. TRC uses a ThermoScientific Niton XLP 300, serial number 101954, registered in the State of Oregon.

Sixty (60) of the eighty-one (81) XRF readings taken in conjunction with this survey were detected to have concentrations of lead. However, only nine (9) of the readings were found to have concentrations of lead that classify them as lead based paints/glazing.

The following paints/glazings were found to be lead-based:

- White Wood wall in the Gym
- White Wood Column in the Gym
- Light Blue Window Casing in the Book Storage Room
- Light Blue Gypsum/ Plaster Walls in Classroom A112
- Beige Gypsum/Plaster within A Hallway
- Beige Ceramic Tile within the Boy's Restroom

Based on applicable federal and state regulations, all identified and/or assumed lead-paints/glazing must be handled and disposed of by trained personnel. In general, demolition contractors are trained to remove, handle and dispose of lead paints/glazing.

## INTRODUCTION

A supplemental asbestos and lead paint survey was conducted by TRC at Cedar Mill Elementary School, located at 10265 NW Cornell Road in Portland, Oregon. It was reported by the client that this limited hazardous materials survey is being conducted in conjunction with their HVAC and re-roof renovation project. The survey activities were performed on November 28<sup>th</sup>, 2018 and December 7<sup>th</sup>, 2018, and included the review of prior sampling documentation and reports as well as the inspection, assessment and bulk sampling of suspect asbestos containing building materials that had not previously been sampled. Sample locations are presented on the Sample Location Diagrams in Appendix A.

Mr. Matt Cuda and Mr. Jason Stone, AHERA accredited building inspectors and lead risk assessor, conducted the asbestos survey inspection and sampling activities. Copies of training certificates and state licenses (where applicable) are presented in Appendix C, Inspector Certifications.

## BACKGROUND

### Asbestos Containing Materials

The United States Environmental Protection Agency (EPA) define an asbestos-containing material (ACM) as any material containing more than one percent (>1.0%) asbestos by weight. In addition, ACMs are designated as:

Friable asbestos - material which can be crumbled, pulverized or reduced to powder by hand pressure, a.k.a. Regulated Asbestos Containing Materials (RACM).

Category I Non-friable - includes resilient floor coverings, asphalt roofing products, gaskets and packing.

Category II Non-friable - any non-friable ACM that is not in Category I (i.e. Asbestos-cement (Transite) siding or roofing material).

### OSHA Regulated Materials

The Occupational Safety and Health Administration (OSHA) regulates all materials containing any detectable level of asbestos by weight, including those materials containing 1.0% or less.

### Asbestos Sampling and Analytical Procedures

Representative bulk samples of suspect asbestos-containing building materials were randomly collected from the interior of the building. Homogenous material determination was based on the following criteria:

- Similar physical characteristics (same color and texture, etc.),
- Application (sprayed or trowel-on, assembly into a system, etc.),
- Material function (thermal insulation, floor tile, wallboard system, etc.).

The bulk samples were collected, labeled, and shipped to the certified analytical laboratory under proper COC documentation, and condition and approximate quantity assessments were performed by the accredited inspector during the inspection. Laboratory services were provided by EMC Labs, Inc., in Phoenix, Arizona, a National Voluntary Laboratory Accreditation Program (NVLAP code #101424-0).

Bulk samples were analyzed by PLM utilizing the EPA's Test Methods: Methods for the Determination of Asbestos in Bulk Building Materials (EPA 600/R-93/116, July 1993) and the McCrone Research Institute's The Asbestos Particle Atlas as method references.

Analysis by PLM was performed by visual observation of the bulk sample and slides prepared of the bulk sample for microscopic examination and identification. The samples were analyzed for asbestos (Chrysotile, Amosite, Crocidolite, Anthophyllite, and Actinolite/Tremolite), fibrous non-asbestos constituents (mineral wool, cellulose, etc.) and non-fibrous constituents. Using a stereoscope, the microscopist visually estimates the relative amounts of each constituent by determining the estimated area of the asbestos compared with the area estimate of the total sample.

#### Lead-based and Lead-containing Paints

Lead-based paint (LBP) is defined by the United States Department of Housing and Urban Development (HUD) as any paint, varnish, stain, or other applied coating that has one (1) mg/cm<sup>2</sup> or more of lead or 0.5% by weight (5,000 micrograms per gram [µg/g] or 5,000 parts of lead per million [ppm]).

According the Occupational Safety and Health Division's (OSHA) Program Directive, Lead: Exposure in Construction, "For all occupational exposure to lead occurring in the course of construction work, the standard (1926.62) does not specify a minimum amount or concentration of lead that triggers a determination that lead is present and the potential for occupational exposure exists. Therefore any paint containing less than one (1) mg/cm<sup>2</sup>, but greater than the laboratory detection limit is considered to be a lead-containing paint.

X-Ray Fluorescence (XRF) analysis of painted coatings was performed using an EPA/HUD required XRF Cadmium 109 sourced hand-held analyzer. TRC uses a ThermoScientific Niton XLP 300, serial number 101954, registered in the State of Oregon. Additionally, TRC collected paint chip samples for laboratory analysis of any loose and flakey paint observed during this survey.

## ASBESTOS FINDINGS & RECOMMENDATIONS

The following table presents the location and quantities of each suspect building material identified and sampled during this survey as well as all applicable analytical results:

Sample No.	Material	Sample Location	Asbestos Content	Approximate Quantity
CMES-01A CMES-01B CMES-01C	Pipe Run Insulation (Steam Lines)	Throughout	10% Amosite 5% Chrysotile	800 LF
CMES-02A CMES-02B CMES-02C	Pipe Fitting Insulation (Steam Lines)	Throughout	60% Chrysotile	240
CMES-03A	HVAC Vibration Damper Cloth (Gym Attic)	Gym Attic	ND	N/A
CMES-04A CMES-04B CMES-04C	1' x 1' Ceiling Tile, Even Holes and Brown Glue	Lower Gym Storage Hallway, Staff Lounge	Tile – ND Glue – ND	N/A

ND = Non-detect

SF = Square feet

LF = Linear Feet

N/A = Not Applicable

Sample No.	Material	Sample Location	Asbestos Content	Approximate Quantity
CMES-05A CMES-05B CMES-05C	1' x 1' Ceiling Tile, Random Holes and Brown Glue	Throughout	Tile – ND Glue – ND	N/A
CMES-06A CMES-06B CMES-06C CMES-06D CMES-06E CMES-06F CMES-06G	Gypsum Board and Joint Compound / Plaster (Wall & Ceiling Systems)	Throughout	G.B. – ND J.C. – 5% Chrysotile	80,000 SF
CMES-07A CMES-07B CMES-07C	Carpet Glue	Throughout	ND	N/A
CMES-08A CMES-08B CMES-08C	12" x 12" White Floor Tile with Gray Streaks and Associated Glue	Throughout	Tile – ND Glue – ND	N/A
CMES-09A CMES-09B CMES-09C	Light Yellow Sheet Vinyl Flooring	Throughout	S.V. – ND Glue – ND	N/A
CMES-10A CMES-10B	12" x 12" Cream Floor Tile and Associated Glue	Room A114	Tile – ND Glue – ND	N/A
CMES-11A CMES-11B CMES-11C	Built-up Roofing (Core)	Gym Roof	ND	N/A
CMES-12A CMES-12B	Built-up Roofing (Core)	See Sample Location Map	ND	N/A
CMES-13A CMES-13B	Built-up Roofing (Core)	See Sample Location Map	ND	N/A
CMES-14A CMES-14B	Built-up Roofing (Core)	See Sample Location Map	ND	N/A
CMES-15A CMES-15B	Built-up Roofing (Core)	See Sample Location Map	ND	N/A
CMES-16A CMES-16B	Built-up Roofing (Core)	See Sample Location Map	ND	N/A
CMES-17A CMES-17B	Built-up Roofing (Core)	See Sample Location Map	ND	N/A
CMES-18A CMES-18B CMES-18C	Roof Mastic	Throughout Roof	ND	N/A
CMES-19A CMES-19B	Wall Patch	Staff Room	ND	N/A
CMES-20A CMES-20B	Brown Cove Base & Glue	Basement Custodial Room	Base – ND Glue - <1% Tremolite	20 LF

ND = Non-detect

SF = Square feet

LF = Linear Feet

N/A = Not Applicable

### Asbestos Containing Materials (ACMs)

Asbestos was detected in the following materials sampled during this and prior investigations:

Material	Approximate Location(s)	Approximate Quantity
Pipe Run Insulation (Steam Lines)	Throughout	800 LF
Pipe Fitting Insulation (Steam Lines)	Throughout	240 Fittings
Gypsum Board and Joint Compound / Plaster	Throughout	80,000 SF
Cement Asbestos Board/ Chalkboard	Level 1 / A104	Unknown – Prior Report
Cove Base and Mastic (Abated 2012)	Level 1 / A114	Unknown – Prior Report
Counter Top and Mastic (Abated 2008)	Level 1/ A116	Unknown – Prior Report
Hard Fittings (Abated 2008)	Lower Level / Cafeteria	Unknown – Prior Report
Floor Tile and Mastic - 9" x 9"	Lower Level / Gym Office Hallway	Unknown – Prior Report

### OSHA Regulated Materials (<1%)

Asbestos was detected in the following materials sampled during this and prior investigations but was analyzed to be less than one percent:

Material	Approximate Location(s)	Approximate Quantity
Glue under Brown Cove Base	Basement Custodial Office	20 LF

### Non-Detect Materials (ND)

Asbestos was not detected in the following materials sampled during this investigation:

Material	Location
Built-up Roofing	Throughout
Roofing Mastic	Throughout
HVAC Vibration Damper Cloth (Gym Attic)	Gym Attic
1' x 1' Ceiling Tile, Even Holes and Brown Glue	Lower Gym Storage Hallway, Staff Lounge
1' x 1' Ceiling Tile, Random Holes and Brown Glue	Throughout
Carpet Glue	Throughout
12" x 12" White Floor Tile with Gray Streaks and Associated Glue	Throughout
Light Yellow Sheet Vinyl Flooring	Throughout
12" x 12" Cream Floor Tile and Associated Glue	Room A114
Material Debris	Attic/ Library
Glued-on Ceiling Tiles	Level 1 / A Hall, A106, Main Corridor, Main Hall, Lower Level / Staff
Joint Compound	Level 1/ A100, A110
Mastic behind Sink Backsplash	Level 1 / A104
Wall and Ceiling Plaster	Level 1/ A104, A108, A122
Countertop and Mastic	Level 1/ A106, A108
Ceramic Tile/Grout	Level 1 Restroom Boy's 2
Cove Base and Mastic, Brown	Lower Level / Cafeteria
Ceiling Tiles	Lower Level / Cafeteria, Kitchen

Due to the Site being an occupied building at the time of the inspection and sampling, a full destructive investigation for concealed materials was not performed. Hidden building materials (e.g., old floor mastic patches hidden under carpeting, chalkboard mastic, mirror mastic, wood paneling mastic, etc.), other than those discussed in this report, could be uncovered when removing building finishes during renovation activities. Any materials encountered during the renovation activities that are not identified in this report, should either be presumed to be asbestos containing and handled as ACM or be sampled by an accredited asbestos inspector to determine if it contains asbestos.

## LEAD PAINT FINDINGS & RECOMMENDATIONS

The following table presents the suspect paints identified and analyzed with X-Ray Fluorescence during this survey as well as all applicable analytical results:

No.	Component	Substrate	Side	Color	Floor	Room	Sub Room	Results	mg/cm <sup>2</sup>
1	ShutterCal								2.86
2	CALIBRATE		UPPER	RED				Positive	1
3	CALIBRATE		UPPER	RED				Positive	1.1
4	CALIBRATE		UPPER	RED				Positive	1
5	CALIBRATE		LOWER	RED				Positive	1.1
6	UPPER WALL	WOOD	A	WHITE	1st	GYM		LBP	1.2
7	LOWER WALL	WOOD	A	BEIGE	1st	GYM		LCP	0.27
8	DOOR CASING	WOOD	A	D. BLUE	1st	GYM		LCP	0.02
9	DOOR CASING	METAL	A	D. BLUE	1st	GYM		LCP	0.02
10	DOOR	METAL	A	L. BLUE	1st	GYM		Negative	0
11	COLUMN	WOOD	A	WHITE	1st	GYM		LBP	1.4
12	UPPER WALL	WOOD	C	WHITE	1st	GYM		LBP	1.6
13	LOWER WALL	WOOD	C	BEIGE	1st	GYM		LCP	0.15
14	DOOR CASING	WOOD	C	D. BLUE	1st	GYM		LCP	0.14
15	DOOR	WOOD	C	L. BLUE	1st	GYM		LCP	0.23
16	WALL	WOOD	A	YELLOW	1st	GYM	STAGE	LCP	0.5
17	WALL	WOOD	C	YELLOW	1st	GYM	STAGE	LCP	0.7
18	DOOR CASING	WOOD	C	BLUE	1st	GYM	STAGE	LCP	0.21
19	DOOR	WOOD	C	BLUE	1st	GYM	STAGE	LCP	0.07
20	DOOR	WOOD	C	L. BLUE	1st	GYM	STAGE	LCP	0.28
21	CEILING	WOOD	UPPER	YELLOW	1st	GYM	STAGE	LCP	0.01
22	HANDRAIL	WOOD	D	YELLOW	1st	GYM	STAGE	LCP	0.13
23	WALL	CONCRETE	A	WHITE	1st	GYM	BOOK STORAGE	LCP	0.13
24	WALL	DRYWALL	B	WHITE	1st	GYM	BOOK STORAGE	Negative	0
25	WALL	CONCRETE	C	WHITE	1st	GYM	BOOK STORAGE	Negative	0
26	DOOR CASING	METAL	C	TAN	1st	GYM	BOOK STORAGE	Negative	0
27	WINDOW CASING	WOOD	C	L. BLUE	1st	GYM	BOOK STORAGE	LBP	1
28	WINDOW	WOOD	C	WHITE	1st	GYM	BOOK STORAGE	LCP	0.6
29	TREAD	WOOD	B	RED	1st	GYM	STAIR	LCP	0.21
30	WALL	DRYWALL	A	RED	1st	A108		LCP	0.05

No.	Component	Substrate	Side	Color	Floor	Room	Sub Room	Results	mg/cm <sup>2</sup>
31	WINDOW CASING	WOOD	A	L. BLUE	1st	A108		LCP	0.07
32	HEATER	METAL	A	L. BLUE	1st	A108		LCP	0.26
33	HEATER	DRYWALL	C	WHITE	1st	A108		LCP	0.02
34	WHITEBOARD CASING	WOOD	C	GRAY	1st	A108		Negative	0
35	WALL	DRYWALL	B	L. BLUE	1st	A112		Negative	0
36	WALL	DRYWALL	D	L. BLUE	1st	A112		LBP	4.9
37	WALL	DRYWALL	A	L. BLUE	1st	A112		LBP	2.9
38	WALL	DRYWALL	C	L. BLUE	1st	A112		Negative	0
39	CHALKBOARD CASING	WOOD	D	L. GRAY	1st	A112		Negative	0
40	UPPER WALL	DRYWALL	B	WHITE	1st	A HALL		LCP	0.09
41	LOWER WALL	PLASTER	B	BEIGE	1st	A HALL		Null	0.9
42	LOWER WALL	PLASTER	B	BEIGE	1st	A HALL		Null	1.2
43	LOWER WALL	PLASTER	B	BEIGE	1st	A HALL		Null	1
44	LOWER WALL	PLASTER	B	BEIGE	1st	A HALL		LBP	1.3
45	LOWER WALL	PLASTER	D	BEIGE	1st	A HALL		LBP	1.2
46	UPPER WALL	PLASTER	D	WHITE	1st	A HALL		LCP	0.25
47	WALL	DRYWALL	A	WHITE	1st	BOYS RR		LCP	0.4
48	WALL	DRYWALL	B	WHITE	1st	BOYS RR		LCP	0.5
49	LOWER WALL	CERAMIC	B	BEIGE	1st	BOYS RR		LBP	9.3
50	DOOR CASING	WOOD	B	BLUE	1st	BOYS RR		Negative	0
51	DOOR	WOOD	B	BLUE	1st	BOYS RR		Negative	0
52	SINK	CERAMIC	C	WHITE	1st	BOYS RR		Negative	0
53	WALL	PLASTER	B	BEIGE	1st	A116		LCP	0.05
54	WINDOW CASING	WOOD	B	WHITE	1st	A116		LCP	0.04
55	WALL	PLASTER	C	BEIGE	1st	A116		LCP	0.02
56	WALL	PLASTER	D	BEIGE	1st	A116		LCP	0.05
57	WALL	PLASTER	A	WHITE	1st	A120		LCP	0.05
58	WALL	PLASTER	B	WHITE	1st	A120		LCP	0.05
59	WALL	DRYWALL	C	WHITE	1st	A120		LCP	0.02
60	WALL	PLASTER	D	WHITE	1st	A120		LCP	0.07
61	UPPER WALL	CONCRETE	A	WHITE	BASEMENT	CAFETERIA		LCP	0.04
62	LOWER WALL	CONCRETE	B	WHITE	BASEMENT	CAFETERIA		LCP	0.04
63	LOWER WALL	DRYWALL	C	BLUE	BASEMENT	CAFETERIA		Negative	0
64	UPPER WALL	DRYWALL	C	WHITE	BASEMENT	CAFETERIA		Negative	0
65	UPPER WALL	CONCRETE	D	WHITE	BASEMENT	CAFETERIA		LCP	0.02
66	LOWER WALL	CONCRETE	D	BLUE	BASEMENT	CAFETERIA		LCP	0.03
67	LOWER WALL	PLASTER	A	WHITE	BASEMENT	KITCHEN		LCP	0.7
68	WALL	WOOD	A	BEIGE		KITCHEN		LCP	0.01
69	WINDOW CASING	METAL	A	BROWN		KITCHEN		LCP	0.12
70	DOOR CASING	METAL	A	D. BLUE		KITCHEN		Negative	0
71	DOOR	METAL	A	L. BLUE		KITCHEN		Negative	0
72	UPPER WALL	WOOD	B	BEIGE		KITCHEN		Negative	0
73	LOWER WALL	CONCRETE	B	BEIGE		KITCHEN		Negative	0

No.	Component	Substrate	Side	Color	Floor	Room	Sub Room	Results	mg/cm <sup>2</sup>
74	DOOR CASING	WOOD	B	BROWN		KITCHEN		Negative	0
75	DOOR	METAL	B	BROWN		KITCHEN		LCP	0.19
76	HANDRAIL	METAL	B	BROWN		KITCHEN		Negative	0
77	LATTICE	WOOD	B	BROWN		KITCHEN		Negative	0
78	STAIR	CONCRETE	B	YELLOW		KITCHEN		Null	0.02
79	STAIR	CONCRETE	B	YELLOW		KITCHEN		Negative	0
80	WALL	CONCRETE	C	BEIGE		KITCHEN		LCP	0.01
81	WINDOW CASING	CONCRETE	C	WHITE		KITCHEN		Null	0.01
82	WINDOW CASING	CONCRETE	C	WHITE		KITCHEN		Negative	0
83	BALUSTRADE	METAL	C	BROWN		KITCHEN		LCP	0.01
84	HANDRAIL	METAL	C	BROWN		KITCHEN		LCP	0.01
85	WALL	WOOD	D	BEIGE		KITCHEN		LCP	0.04
86	DOOR CASING	METAL	D	BROWN		KITCHEN		LCP	0.15
87	DOOR	METAL	D	BROWN		KITCHEN		LCP	0.3
88	CALIBRATE		UPPER	RED				Positive	1
89	CALIBRATE		UPPER	RED				Positive	1.1
90	CALIBRATE		UPPER	RED				Positive	1
91	CALIBRATE		LOWER	RED				Null	1
92	CALIBRATE		LOWER	RED				Positive	1.2

LBP = Lead Based Paint      LCP = Lead Containing Paint

Sixty (60) of the eighty-one (81) XRF readings taken in conjunction with this survey were detected to have concentrations of lead. However, only nine (9) of the readings were found to have concentrations of lead that classify them as lead based paints/glazing.

The following paints/glazings were found to be lead-based:

- White Wood wall in the Gym
- White Wood Column in the Gym
- Light Blue Window Casing in the Book Storage Room
- Light Blue Gypsum/ Plaster Walls in Classroom A112
- Beige Gypsum/Plaster within A Hallway
- Beige Ceramic Tile within the Boy's Restroom

Based on applicable federal and state regulations, all identified and/or assumed lead-paints/glazing must be handled and disposed of by trained personnel. In general, demolition contractors are trained to remove, handle and dispose of lead paints/glazing which will not typically generate a large amount of additional cost above and beyond the general demolition activities.

## RECOMMENDATIONS

All identified asbestos containing materials and OSHA regulated materials from this investigation and previous investigations must be removed by a licensed asbestos abatement contractor prior to them being impacted by any renovation or demolition activities. Additionally, any materials uncovered during renovation or demolition activities that are not addressed in this inspection report or prior reports for the building are considered presumed asbestos containing materials and must be sampled by an accredited asbestos inspector prior to disturbance, or they must be treated as asbestos containing.

All identified lead paint must be removed and disposed of in accordance with all applicable federal, state and local regulations.

## DISCLAIMER

The content presented in this report is based on data collected during the site inspection and survey, review of pertinent regulations, requirements, guidelines and commonly followed industry standards, and information provided by the Beaverton School District, their clients, agents, and representatives.

The work has been conducted in an objective and unbiased manner and in accordance with generally accepted professional practice for this type of work. TRC believes the data and analysis to be accurate and relevant, but cannot accept responsibility for the accuracy or completeness of available documentation or possible withholding of information by other parties.

This asbestos and lead paint survey report is designed to aid the property owner, architect, construction manager, general contractor, and asbestos abatement contractor in locating potential ACMs. This report is not intended for, and may not be utilized as, a bidding document or as an abatement project specification document.

If you have any questions, or need any further clarification regarding this report, please do not hesitate to contact Mr. Ron Landolt at (503) 407-0734.

Sincerely,

**TRC Environmental Corporation**



Matthew Cuda  
Project Manager



Ron Landolt, CAC  
NW Region BSI Practice Manager

## **Appendix A – Figure(s)**



LEGEND

- SAMPLE LOCATION
- ▲ ASBESTOS-CONTAINING SAMPLE LOCATION
- OSHA REGULATED MATERIAL SAMPLE LOCATION

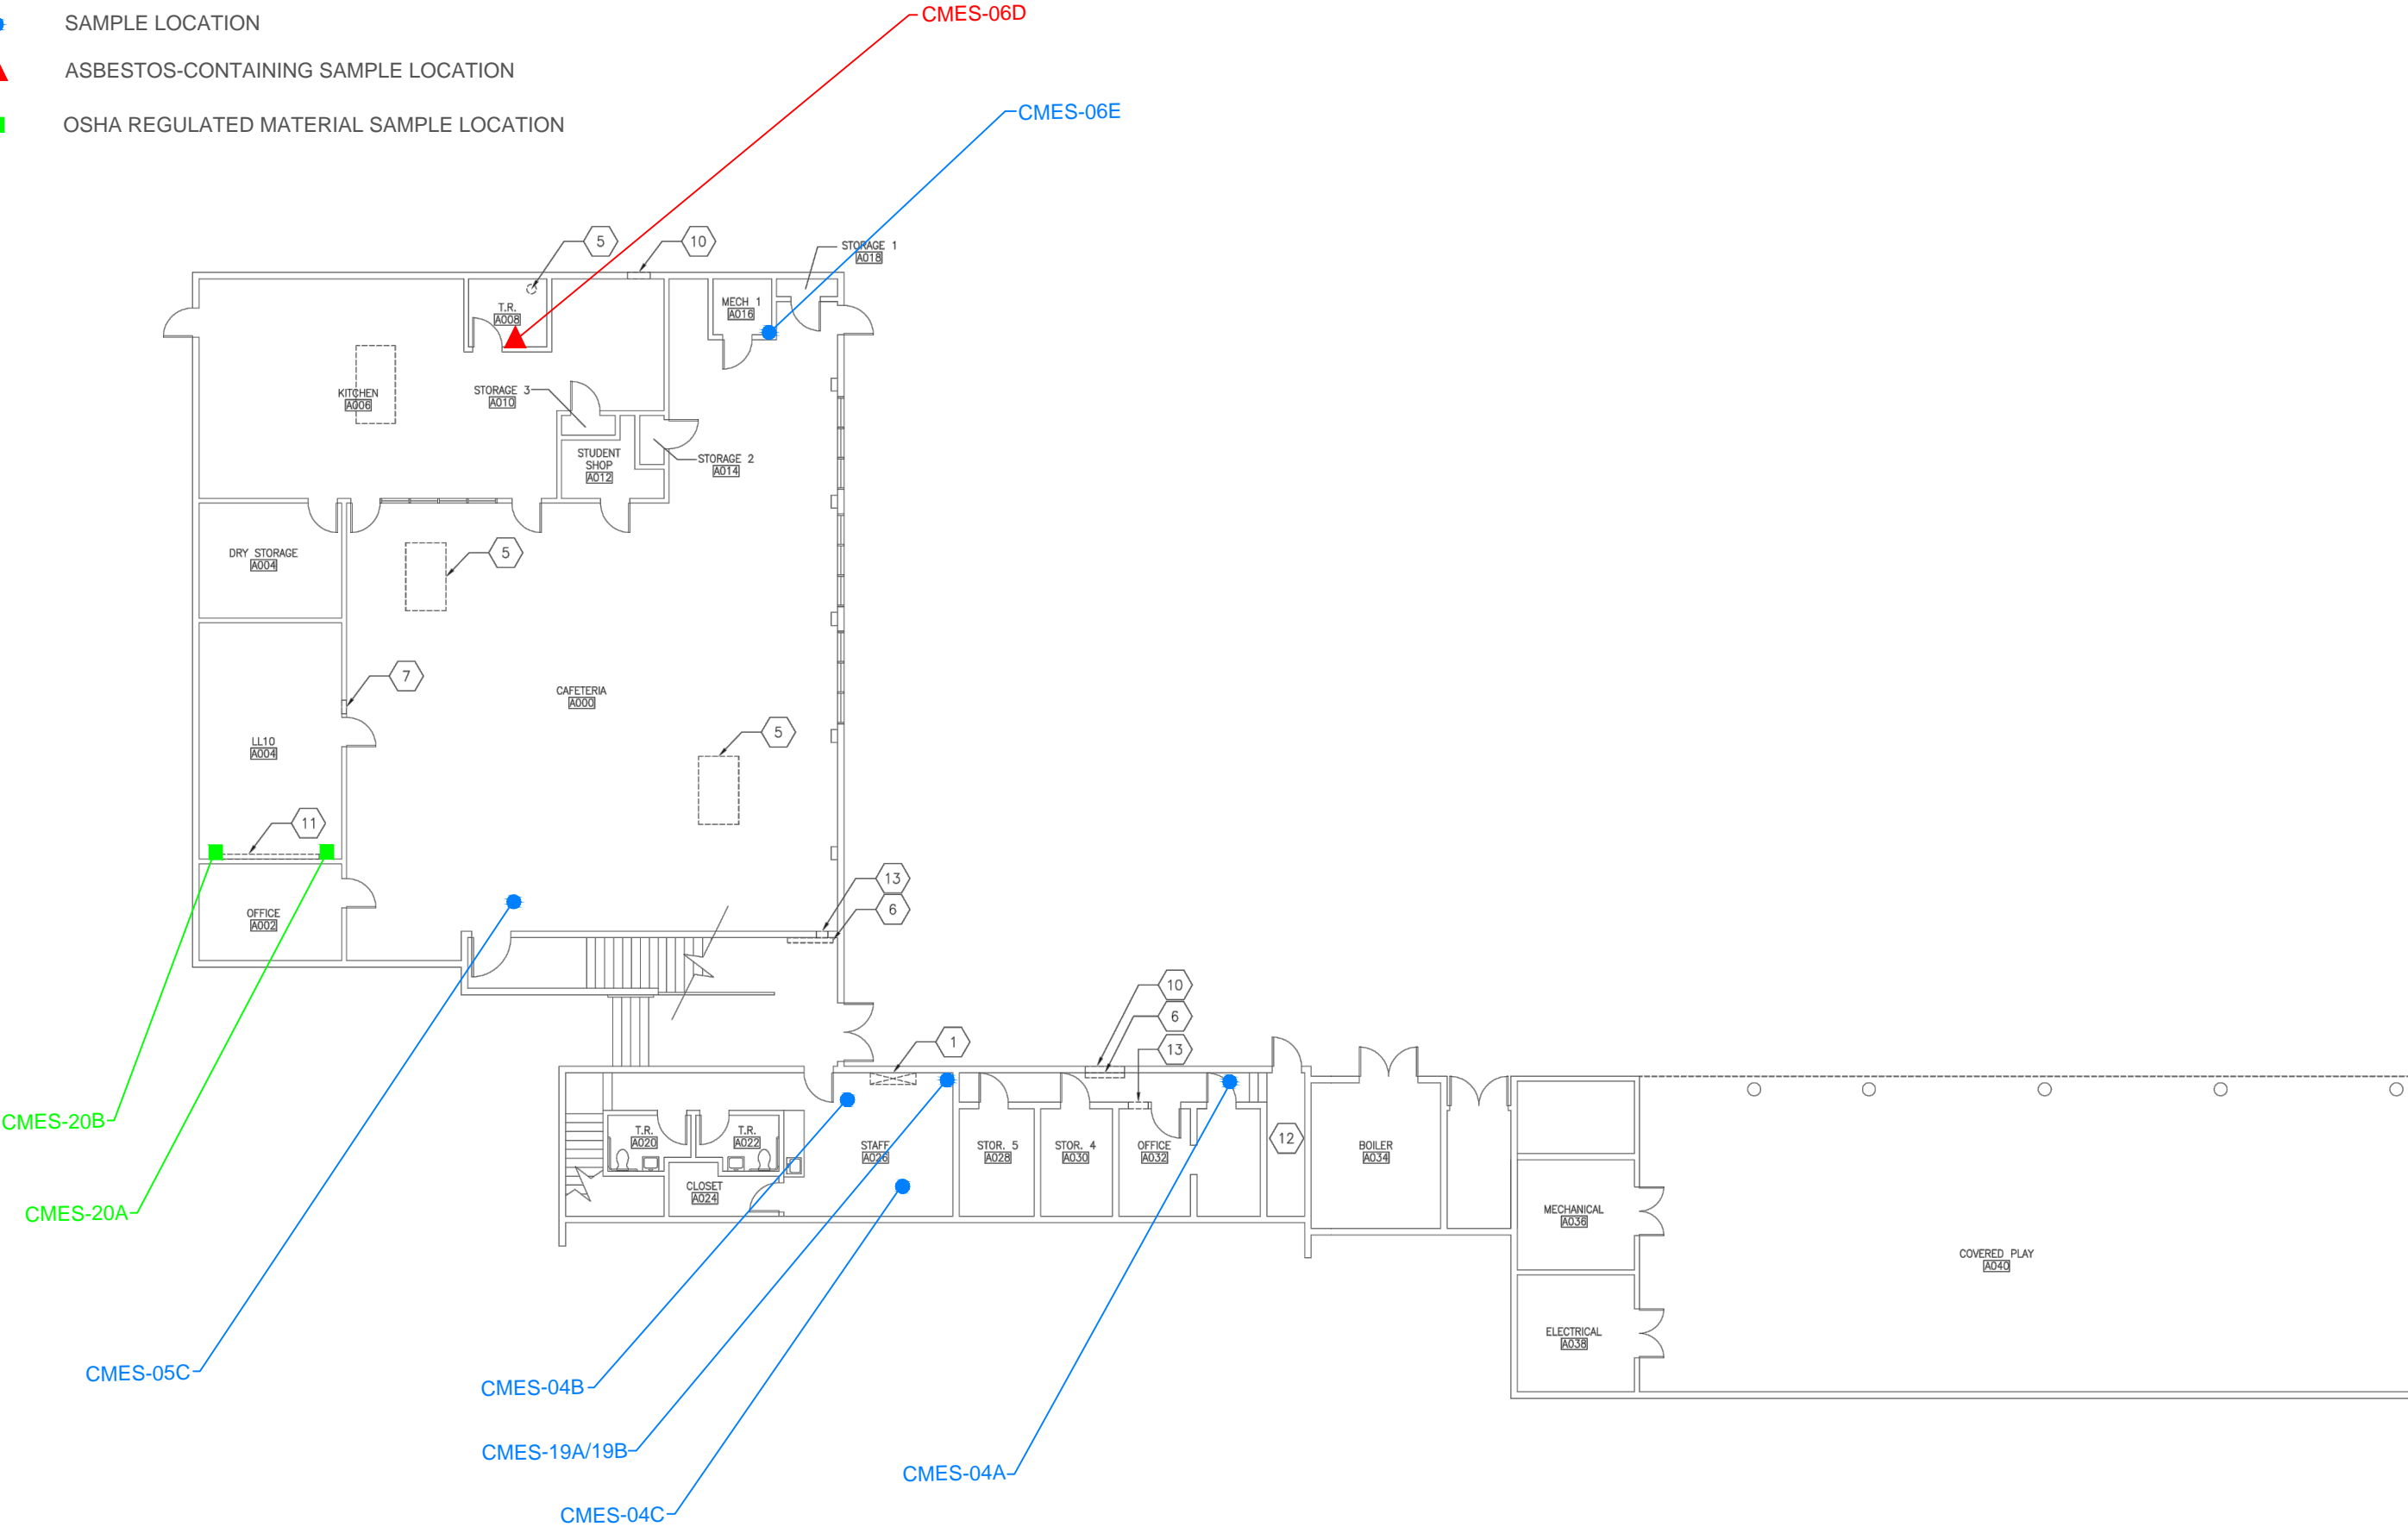


FIGURE NUMBER

1.2

SAMPLE LOCATION MAP - LOWER LEVEL

Cedar Mills Elementary School  
10265 NW Cornell Road  
Portland, OR 97229

4105 SE International Way  
Suite 505  
Milwaukie, OR 97222  
C: 503-407-0734  
F: 503-762-6882



DATE

PROJECT NO.

32/417

DRAWN BY

SC

CHECKED BY

MC

CHECKED BY

RL

## **Appendix B – Laboratory Analytical Data Sheets**

# EMC LABS, INC.

9830 S. 51st Street, Suite B109, Phoenix, AZ 85044  
Phone: 800-362-3373 or 480-940-5294 - Fax: (480) 893-1726

Laboratory Report

**0212048**

## Bulk Asbestos Analysis by Polarized Light Microscopy

NVLAP#101926-0

Client:	TRC SOLUTIONS	Job# / P.O. #:	321417
Address:	13370 SE MEADOWPARK DRIVE	Date Received:	11/30/2018
	PORTLAND OR 97086	Date Analyzed:	12/05/2018
Collected:	11/28/2018	Date Reported:	12/05/2018
Project Name:	BSD-CEDAR MILL ES, HVAC UPGRADE	EPA Method:	EPA 600/R-93/116
Address:		Submitted By:	MATT CUDA
		Collected By:	

Lab ID Client ID	Sample Location	Layer Name / Sample Description	Asbestos Detected	Asbestos Type (%)	Non-Asbestos Constituents
0212048-001 CMES-01A	GYM ATTIC	Pipe Run Insulation, White	Yes	Amosite Chrysotile 10% 2%	Carbonates Gypsum Binder/Filler 88%
0212048-002 CMES-01B	TUNNEL ACCESS IN BOY'S RESTRM	LAYER 1 Pipe Run Insulation, White	Yes	Amosite Chrysotile 10% 5%	Carbonates Gypsum Binder/Filler 85%
		LAYER 2 Pipe Run Insulation, Black	Yes	Amosite 2%	Cellulose Fiber 80% Carbonates Gypsum Binder/Filler 18%
0212048-003 CMES-01C	TUNNEL UNDER A110	LAYER 1 Pipe Run Insulation, White	Yes	Amosite Chrysotile 10% 5%	Carbonates Gypsum Binder/Filler 85%
		LAYER 2 Pipe Run Insulation, Black	Yes	Amosite 2%	Cellulose Fiber 80% Carbonates Gypsum Binder/Filler 18%
0212048-004 CMES-02A	GYM ATTIC	LAYER 1 Pipe Run Insulation, White	Yes	Amosite Chrysotile 10% 5%	Carbonates Gypsum Binder/Filler 85%
		LAYER 2 Pipe Run Insulation, Cream	Yes	Amosite 2%	Cellulose Fiber 40% Carbonates Quartz Binder/Filler 58%

# EMC LABS, INC.

9830 S. 51st Street, Suite B109, Phoenix, AZ 85044  
Phone: 800-362-3373 or 480-940-5294 - Fax: (480) 893-1726

Laboratory Report

**0212048**

## Bulk Asbestos Analysis by Polarized Light Microscopy

NVLAP#101926-0

Client:	TRC SOLUTIONS	Job# / P.O. #:	321417
Address:	13370 SE MEADOWPARK DRIVE	Date Received:	11/30/2018
	PORTLAND OR 97086	Date Analyzed:	12/05/2018
Collected:	11/28/2018	Date Reported:	12/05/2018
Project Name:	BSD-CEDAR MILL ES, HVAC UPGRADE	EPA Method:	EPA 600/R-93/116
Address:		Submitted By:	MATT CUDA
		Collected By:	

Lab ID Client ID	Sample Location	Layer Name / Sample Description	Asbestos Detected	Asbestos Type (%)	Non-Asbestos Constituents
0212048-005 CMES-02B	TUNNEL ACCESS IN BOY'S RESTRM	LAYER 1 Pipe Run Insulation, Lt. Gray	Yes	Chrysotile 60%	Cellulose Fiber 5%
					Gypsum Quartz Binder/Filler 35%
		LAYER 2 Pipe Run Insulation, Black	No	None Detected	Cellulose Fiber 90%
					Carbonates Gypsum Binder/Filler 10%
0212048-006 CMES-02C	TUNNEL UNDER A110	Pipe Run Insulation, Lt. Gray	Yes	Chrysotile 60%	Cellulose Fiber 5%
					Gypsum Quartz Binder/Filler 35%
0212048-007 CMES-03A	GYM ATTIC	HVAC Vibration Damper Cloth, Beige	No	None Detected	Cellulose Fiber 95%
					Gypsum Binder/Filler 5%
0212048-008 CMES-04A	LOWER GYM STORAGE HALLWAY	LAYER 1 1x1 Ceiling Tile, White/ Brown	No	None Detected	Cellulose Fiber 85%
					Gypsum Binder/Filler 15%
		LAYER 2 Glue, Brown	No	None Detected	Cellulose Fiber <1%
					Gypsum Quartz Binder/Filler 99%

# EMC LABS, INC.

9830 S. 51st Street, Suite B109, Phoenix, AZ 85044  
Phone: 800-362-3373 or 480-940-5294 - Fax: (480) 893-1726

Laboratory Report

**0212048**

## Bulk Asbestos Analysis by Polarized Light Microscopy

NVLAP#101926-0

Client:	TRC SOLUTIONS	Job# / P.O. #:	321417
Address:	13370 SE MEADOWPARK DRIVE	Date Received:	11/30/2018
	PORTLAND OR 97086	Date Analyzed:	12/05/2018
Collected:	11/28/2018	Date Reported:	12/05/2018
Project Name:	BSD-CEDAR MILL ES, HVAC UPGRADE	EPA Method:	EPA 600/R-93/116
Address:		Submitted By:	MATT CUDA
		Collected By:	

Lab ID Client ID	Sample Location	Layer Name / Sample Description	Asbestos Detected	Asbestos Type (%)	Non-Asbestos Constituents	
0212048-009 CMES-04B	STAFF LOUNGE	LAYER 1	No	None Detected	Cellulose Fiber	85%
		1x1 Ceiling Tile, White/ Brown			Gypsum Binder/Filler	15%
		LAYER 2			Cellulose Fiber	<1%
		Glue, Brown			Gypsum Quartz Binder/Filler	99%
0212048-010 CMES-04C	STAFF LOUNGE	LAYER 1	No	None Detected	Cellulose Fiber	85%
		1x1 Ceiling Tile, White/ Brown			Gypsum Binder/Filler	15%
		LAYER 2			Cellulose Fiber	2%
		Glue, Brown			Gypsum Quartz Binder/Filler	98%
0212048-011 CMES-05A	MAIN HALLWAY	LAYER 1	No	None Detected	Cellulose Fiber	85%
		1x1 Ceiling Tile, White/ Brown			Gypsum Binder/Filler	15%
		LAYER 2			Cellulose Fiber	1%
		Glue, Brown			Synthetic Fiber Gypsum Quartz Binder/Filler	<1% 98%
0212048-012 CMES-05B	A118	LAYER 1	No	None Detected	Cellulose Fiber	85%
		1x1 Ceiling Tile, White/ Brown			Gypsum Binder/Filler	15%
		LAYER 2			Cellulose Fiber	3%
		Glue, Brown			Gypsum Quartz Binder/Filler	97%

# EMC LABS, INC.

9830 S. 51st Street, Suite B109, Phoenix, AZ 85044  
Phone: 800-362-3373 or 480-940-5294 - Fax: (480) 893-1726

Laboratory Report

**0212048**

## **Bulk Asbestos Analysis by Polarized Light Microscopy**

NVLAP#101926-0

Client:	TRC SOLUTIONS	Job# / P.O. #:	321417
Address:	13370 SE MEADOWPARK DRIVE	Date Received:	11/30/2018
	PORTLAND OR 97086	Date Analyzed:	12/05/2018
Collected:	11/28/2018	Date Reported:	12/05/2018
Project Name:	BSD-CEDAR MILL ES, HVAC UPGRADE	EPA Method:	EPA 600/R-93/116
Address:		Submitted By:	MATT CUDA
		Collected By:	

Lab ID Client ID	Sample Location	Layer Name / Sample Description	Asbestos Detected	Asbestos Type (%)	Non-Asbestos Constituents	
0212048-013 CMES-05C	CAFETERIA	LAYER 1	No	None Detected	Cellulose Fiber	85%
		1x1 Ceiling Tile, White/ Brown			Gypsum Binder/Filler	15%
		LAYER 2	No	None Detected	Cellulose Fiber	2%
		Glue, Brown			Gypsum Quartz Binder/Filler	98%
0212048-014 CMES-06A	BOY'S RESTRM CUSTODIAL CLOSET	LAYER 1	No	None Detected	Cellulose Fiber	<1%
		Plaster-Scratch Coat, Off White			Gypsum Carbonates Mica Quartz Perlite Binder/Filler	99%
		LAYER 2	No	None Detected	Cellulose Fiber	<1%
		Plaster-Finish Coat, White			Quartz Gypsum Mica Carbonates Perlite Binder/Filler	99%

# EMC LABS, INC.

9830 S. 51st Street, Suite B109, Phoenix, AZ 85044  
Phone: 800-362-3373 or 480-940-5294 - Fax: (480) 893-1726

Laboratory Report

**0212048**

## Bulk Asbestos Analysis by Polarized Light Microscopy

NVLAP#101926-0

Client:	TRC SOLUTIONS	Job# / P.O. #:	321417
Address:	13370 SE MEADOWPARK DRIVE	Date Received:	11/30/2018
	PORTLAND OR 97086	Date Analyzed:	12/05/2018
Collected:	11/28/2018	Date Reported:	12/05/2018
Project Name:	BSD-CEDAR MILL ES, HVAC UPGRADE	EPA Method:	EPA 600/R-93/116
Address:		Submitted By:	MATT CUDA
		Collected By:	

Lab ID Client ID	Sample Location	Layer Name / Sample Description	Asbestos Detected	Asbestos Type (%)	Non-Asbestos Constituents
0212048-015 CMES-06B	RM A108	LAYER 1 Plaster-Scratch Coat, Off White	No	None Detected	Cellulose Fiber <1% Gypsum Carbonates Mica Quartz Perlite Binder/Filler 99%
		LAYER 2 Plaster-Finish Coat, White	No	None Detected	Cellulose Fiber <1% Quartz Gypsum Mica Carbonates Perlite Binder/Filler 99%
		LAYER 1 Gypsum Board, White/ Brown	No	None Detected	Cellulose Fiber 10% Fibrous Glass 2% Gypsum Mica Quartz Carbonates 88%
		LAYER 2 Joint Compound, Off White	Yes	Chrysotile 5%	Carbonates Mica Quartz Binder/Filler 95%
0212048-017 CMES-06D	KITCHEN RESTRM CLOSET	LAYER 1 Gypsum Board, White/ Brown	No	None Detected	Cellulose Fiber 10% Fibrous Glass 2% Gypsum Mica Quartz Carbonates 88%
		LAYER 2 Joint Compound, Off White	Yes	Chrysotile 5%	Carbonates Mica Quartz Binder/Filler 95%

# EMC LABS, INC.

9830 S. 51st Street, Suite B109, Phoenix, AZ 85044  
Phone: 800-362-3373 or 480-940-5294 - Fax: (480) 893-1726

Laboratory Report

**0212048**

## Bulk Asbestos Analysis by Polarized Light Microscopy

NVLAP#101926-0

Client:	TRC SOLUTIONS	Job# / P.O. #:	321417
Address:	13370 SE MEADOWPARK DRIVE	Date Received:	11/30/2018
	PORTLAND OR 97086	Date Analyzed:	12/05/2018
Collected:	11/28/2018	Date Reported:	12/05/2018
Project Name:	BSD-CEDAR MILL ES, HVAC UPGRADE	EPA Method:	EPA 600/R-93/116
Address:		Submitted By:	MATT CUDA
		Collected By:	

Lab ID Client ID	Sample Location	Layer Name / Sample Description	Asbestos Detected	Asbestos Type (%)	Non-Asbestos Constituents
0212048-018 CMES-06E	CAFETERIA HOT WATER CLOSET	LAYER 1 Gypsum Board, White/ Brown	No	None Detected	Cellulose Fiber 10% Fibrous Glass 2% Gypsum Mica Quartz Carbonates 88%
		LAYER 2 Joint Compound, Off White	No	None Detected	Carbonates Mica Quartz Perlite Binder/Filler 100%
0212048-019 CMES-06F	CUSTODIAL CLOSET A126	LAYER 1 Plaster-Scratch Coat, Off White	No	None Detected	Gypsum Carbonates Mica Quartz Perlite Binder/Filler 100%
		LAYER 2 Plaster-Finish Coat, White	No	None Detected	Cellulose Fiber <1% Quartz Gypsum Mica Binder/Filler 99%

# EMC LABS, INC.

9830 S. 51st Street, Suite B109, Phoenix, AZ 85044  
Phone: 800-362-3373 or 480-940-5294 - Fax: (480) 893-1726

Laboratory Report

**0212048**

## Bulk Asbestos Analysis by Polarized Light Microscopy

NVLAP#101926-0

Client:	TRC SOLUTIONS	Job# / P.O. #:	321417
Address:	13370 SE MEADOWPARK DRIVE	Date Received:	11/30/2018
	PORTLAND OR 97086	Date Analyzed:	12/05/2018
Collected:	11/28/2018	Date Reported:	12/05/2018
Project Name:	BSD-CEDAR MILL ES, HVAC UPGRADE	EPA Method:	EPA 600/R-93/116
Address:		Submitted By:	MATT CUDA
		Collected By:	

Lab ID Client ID	Sample Location	Layer Name / Sample Description	Asbestos Detected	Asbestos Type (%)	Non-Asbestos Constituents
0212048-020 CMES-06G	RM A100 CLOSET	LAYER 1 Gypsum Board, White/ Brown	No	None Detected	Cellulose Fiber 12% Gypsum Mica Quartz Carbonates 88%
		LAYER 2 Plaster-Scratch Coat, Off White	No	None Detected	Gypsum Carbonates Mica Quartz Perlite Binder/Filler 100%
		LAYER 3 Plaster-Finish Coat, White	No	None Detected	Cellulose Fiber <1% Quartz Gypsum Mica Carbonates Binder/Filler 99%
0212048-021 CMES-07A	RM A108	Carpet Glue, Yellow	No	None Detected	Cellulose Fiber 5% Carbonates Gypsum Quartz Binder/Filler 95%
0212048-022 CMES-07B	RM A122	Carpet Glue, Yellow/ Red	No	None Detected	Cellulose Fiber 1% Carbonates Quartz Gypsum Binder/Filler 99%
0212048-023 CMES-07C	CUSTODIAL CLOSET A126	Carpet Glue, Yellow	No	None Detected	Cellulose Fiber 5% Carbonates Quartz Gypsum Binder/Filler 95%

# EMC LABS, INC.

9830 S. 51st Street, Suite B109, Phoenix, AZ 85044  
Phone: 800-362-3373 or 480-940-5294 - Fax: (480) 893-1726

Laboratory Report

**0212048**

## Bulk Asbestos Analysis by Polarized Light Microscopy

NVLAP#101926-0

Client:	TRC SOLUTIONS	Job# / P.O. #:	321417
Address:	13370 SE MEADOWPARK DRIVE	Date Received:	11/30/2018
	PORTLAND OR 97086	Date Analyzed:	12/05/2018
Collected:	11/28/2018	Date Reported:	12/05/2018
Project Name:	BSD-CEDAR MILL ES, HVAC UPGRADE	EPA Method:	EPA 600/R-93/116
Address:		Submitted By:	MATT CUDA
		Collected By:	

Lab ID Client ID	Sample Location	Layer Name / Sample Description	Asbestos Detected	Asbestos Type (%)	Non-Asbestos Constituents
0212048-024 CMES-08A	RM A108	LAYER 1	No	None Detected	
		12"x12" Floor Tile, White/ Gray			Carbonates Quartz Binder/Filler
					100%
		LAYER 2			Cellulose Fiber
		Glue, Yellow	No	None Detected	1%
					Carbonates Gypsum Binder/Filler
					99%
0212048-025 CMES-08B	RM A102	LAYER 1	No	None Detected	
		12"x12" Floor Tile, White/ Gray			Carbonates Quartz Binder/Filler
					100%
		LAYER 2			Cellulose Fiber
		Glue, Yellow	No	None Detected	1%
					Synthetic Fiber
					<1%
					Carbonates Gypsum Quartz Binder/Filler
					98%
0212048-026 CMES-08C	RM A120	LAYER 1	No	None Detected	
		12"x12" Floor Tile, White/ Gray			Carbonates Quartz Binder/Filler
					100%
		LAYER 2			Cellulose Fiber
		Glue, Yellow	No	None Detected	2%
					Carbonates Gypsum Quartz Binder/Filler
					98%

# EMC LABS, INC.

9830 S. 51st Street, Suite B109, Phoenix, AZ 85044  
Phone: 800-362-3373 or 480-940-5294 - Fax: (480) 893-1726

Laboratory Report

**0212048**

## Bulk Asbestos Analysis by Polarized Light Microscopy

NVLAP#101926-0

Client:	TRC SOLUTIONS	Job# / P.O. #:	321417
Address:	13370 SE MEADOWPARK DRIVE	Date Received:	11/30/2018
	PORTLAND OR 97086	Date Analyzed:	12/05/2018
Collected:	11/28/2018	Date Reported:	12/05/2018
Project Name:	BSD-CEDAR MILL ES, HVAC UPGRADE	EPA Method:	EPA 600/R-93/116
Address:		Submitted By:	MATT CUDA
		Collected By:	

Lab ID Client ID	Sample Location	Layer Name / Sample Description	Asbestos Detected	Asbestos Type (%)	Non-Asbestos Constituents
0212048-027 CMES-09A	RM A116	LAYER 1 Sheet Vinyl Flooring, Lt. Yellow	No	None Detected	Cellulose Fiber 20% Carbonates Quartz Binder/Filler 80%
		LAYER 2 Mastic, Yellow	No	None Detected	Cellulose Fiber 3% Carbonates Gypsum Quartz Binder/Filler 97%
		LAYER 3 Leveling Compound, Gray	No	None Detected	Cellulose Fiber 5% Carbonates Gypsum Quartz Binder/Filler 95%
0212048-028 CMES-09B	RM A122	LAYER 1 Sheet Vinyl Flooring, Lt. Yellow	No	None Detected	Cellulose Fiber 20% Carbonates Quartz Binder/Filler 80%
		LAYER 2 Mastic, Yellow	No	None Detected	Cellulose Fiber 5% Carbonates Gypsum Quartz Binder/Filler 95%
0212048-029 CMES-09C	CUSTODIAL CLOSET A126	LAYER 1 Sheet Vinyl Flooring, Lt. Yellow	No	None Detected	Cellulose Fiber 20% Carbonates Quartz Binder/Filler 80%
		LAYER 2 Mastic, Yellow	No	None Detected	Cellulose Fiber 5% Carbonates Gypsum Quartz Binder/Filler 95%

# EMC LABS, INC.

9830 S. 51st Street, Suite B109, Phoenix, AZ 85044  
Phone: 800-362-3373 or 480-940-5294 - Fax: (480) 893-1726

Laboratory Report  
**0212048**

## Bulk Asbestos Analysis by Polarized Light Microscopy

NVLAP#101926-0

Client:	TRC SOLUTIONS	Job# / P.O. #:	321417
Address:	13370 SE MEADOWPARK DRIVE	Date Received:	11/30/2018
	PORTLAND OR 97086	Date Analyzed:	12/05/2018
Collected:	11/28/2018	Date Reported:	12/05/2018
Project Name:	BSD-CEDAR MILL ES, HVAC UPGRADE	EPA Method:	EPA 600/R-93/116
Address:		Submitted By:	MATT CUDA
		Collected By:	

Lab ID Client ID	Sample Location	Layer Name / Sample Description	Asbestos Detected	Asbestos Type (%)	Non-Asbestos Constituents
0212048-030 CMES-10A	RM A114	12"x12" Floor Tile, Cream	No	None Detected	Carbonates Quartz Binder/Filler 100%
0212048-031 CMES-10B	RM A114	LAYER 1 12"x12" Floor Tile, Cream	No	None Detected	Carbonates Quartz Binder/Filler 100%
		LAYER 2 Glue, Yellow	No	None Detected	Carbonates Quartz Gypsum Binder/Filler 100%



Analyst - Octavio Gavarreteayestas



Signatory - Lab Director - Kurt Kettler

Distinctly stratified, easily separable layers of samples are analyzed as subsamples of the whole and are reported separately for each discernible layer. All analyses are derived from calibrated visual estimate and measured in area percent unless otherwise noted. The report applies to the standards or procedures identified and to the sample(s) tested. The test results are not necessarily indicative or representative of the qualities of the lot from which the sample was taken or of apparently identical or similar products, nor do they represent an ongoing quality assurance program unless so noted. These reports are for the exclusive use of the addressed client and that they will not be reproduced wholly or in part for advertising or other purposes over our signature or in connection with our name without special written permission. The report shall not be reproduced except in full, without written approval by our laboratory. The samples not destroyed in testing are retained a maximum of thirty days. The laboratory measurement of uncertainty for the test method is approximately less than 1 by area percent. Accredited by the National Institute of Standards and Technology, Voluntary Laboratory Accreditation Program for selected test method for asbestos. The accreditation or any reports generated by this laboratory in no way constitutes or implies product certification, approval, or endorsement by the National Institute of Standards and Technology. The report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the Federal Government. Polarized Light Microscopy may not be consistently reliable in detecting asbestos in floor coverings and similar non-friable organically bound materials.

# EMC LABS, INC.

9830 S. 51st Street, Suite B109, Phoenix, AZ 85044  
Phone: 800-362-3373 or 480-940-5294 - Fax: (480) 893-1726

Laboratory Report

**0212546**

## **Bulk Asbestos Analysis by Polarized Light Microscopy**

NVLAP#101926-0

Client:	TRC SOLUTIONS	Job# / P.O. #:	321417
Address:	4105 SE INTERNATIONAL WAY	Date Received:	12/10/2018
	STE 505	Date Analyzed:	12/13/2018
	MILWAUKIE OR 97222		
Collected:	12/07/2018	Date Reported:	12/13/2018
Project Name:	BSD-CEDAR MILL ES, HVAC UPGRADE	EPA Method:	EPA 600/R-93/116
Address:		Submitted By:	JASON STONE
		Collected By:	

Lab ID Client ID	Sample Location	Layer Name / Sample Description	Asbestos Detected	Asbestos Type (%)	Non-Asbestos Constituents	
0212546-001 CMES-11A		LAYER 1 Roofing, Silver	No	None Detected	Cellulose Fiber	1%
					Carbonates	
					Quartz	
					Binder/Filler	99%
		LAYER 2 Roofing, Black	No	None Detected	Cellulose Fiber	8%
					Carbonates	
					Quartz	
					Binder/Filler	92%
		LAYER 3 Roofing, Black	No	None Detected	Synthetic Fiber	15%
					Fibrous Glass	5%
					Carbonates	
					Quartz	
		LAYER 4 Roofing, Brown/ Tan	No	None Detected	Binder/Filler	80%
					Cellulose Fiber	85%
					Carbonates	
					Gypsum	
					Binder/Filler	15%

Please see EMC Labs Sample Number 0212546-019 for Additional Layers

# EMC LABS, INC.

9830 S. 51st Street, Suite B109, Phoenix, AZ 85044  
Phone: 800-362-3373 or 480-940-5294 - Fax: (480) 893-1726

Laboratory Report

**0212546**

## **Bulk Asbestos Analysis by Polarized Light Microscopy**

NVLAP#101926-0

Client:	TRC SOLUTIONS	Job# / P.O. #:	321417
Address:	4105 SE INTERNATIONAL WAY	Date Received:	12/10/2018
	STE 505	Date Analyzed:	12/13/2018
	MILWAUKIE OR 97222		
Collected:	12/07/2018	Date Reported:	12/13/2018
Project Name:	BSD-CEDAR MILL ES, HVAC UPGRADE	EPA Method:	EPA 600/R-93/116
Address:		Submitted By:	JASON STONE
		Collected By:	

Lab ID Client ID	Sample Location	Layer Name / Sample Description	Asbestos Detected	Asbestos Type (%)	Non-Asbestos Constituents		
0212546-002 CMES-11B		LAYER 1 Roofing, Silver	No	None Detected	Cellulose Fiber	3%	
						Carbonates	97%
						Quartz	
						Binder/Filler	
		LAYER 2 Roofing, Black	No	None Detected	Cellulose Fiber	5%	
						Fibrous Glass	3%
						Carbonates	92%
						Quartz	
	Binder/Filler						
		LAYER 3 Roofing, Black	No	None Detected	Cellulose Fiber	15%	
						Fibrous Glass	3%
Synthetic Fiber						2%	
Carbonates						80%	
Quartz							
Binder/Filler							
	LAYER 4 Roofing, Brown/ Tan	No	None Detected	Cellulose Fiber	85%		
					Carbonates	15%	
					Gypsum		
					Binder/Filler		

Please see EMC Labs Sample Number 0212546-020 for Additional Layers

# EMC LABS, INC.

9830 S. 51st Street, Suite B109, Phoenix, AZ 85044  
Phone: 800-362-3373 or 480-940-5294 - Fax: (480) 893-1726

Laboratory Report

**0212546**

## **Bulk Asbestos Analysis by Polarized Light Microscopy**

NVLAP#101926-0

Client:	TRC SOLUTIONS	Job# / P.O. #:	321417
Address:	4105 SE INTERNATIONAL WAY	Date Received:	12/10/2018
	STE 505	Date Analyzed:	12/13/2018
	MILWAUKIE OR 97222		
Collected:	12/07/2018	Date Reported:	12/13/2018
Project Name:	BSD-CEDAR MILL ES, HVAC UPGRADE	EPA Method:	EPA 600/R-93/116
Address:		Submitted By:	JASON STONE
		Collected By:	

Lab ID Client ID	Sample Location	Layer Name / Sample Description	Asbestos Detected	Asbestos Type (%)	Non-Asbestos Constituents
0212546-003 CMES-11C		LAYER 1 Roofing, Silver	No	None Detected	Cellulose Fiber 1% Carbonates Quartz Binder/Filler 99%
		LAYER 2 Roofing, Black	No	None Detected	Fibrous Glass 5% Cellulose Fiber 2% Synthetic Fiber 1% Carbonates Quartz Binder/Filler 92%
		LAYER 3 Roofing, Black	No	None Detected	Fibrous Glass 5% Cellulose Fiber 2% Synthetic Fiber 1% Carbonates Quartz Binder/Filler 92%
		LAYER 4 Roofing, Brown/ Tan	No	None Detected	Cellulose Fiber 85% Carbonates Gypsum Binder/Filler 15%

**Please see EMC Labs Sample Number 0212546-021 for Additional Layers**

# EMC LABS, INC.

9830 S. 51st Street, Suite B109, Phoenix, AZ 85044  
Phone: 800-362-3373 or 480-940-5294 - Fax: (480) 893-1726

Laboratory Report

**0212546**

## Bulk Asbestos Analysis by Polarized Light Microscopy

NVLAP#101926-0

Client:	TRC SOLUTIONS	Job# / P.O. #:	321417
Address:	4105 SE INTERNATIONAL WAY	Date Received:	12/10/2018
	STE 505	Date Analyzed:	12/13/2018
	MILWAUKIE OR 97222		
Collected:	12/07/2018	Date Reported:	12/13/2018
Project Name:	BSD-CEDAR MILL ES, HVAC UPGRADE	EPA Method:	EPA 600/R-93/116
Address:		Submitted By:	JASON STONE
		Collected By:	

Lab ID Client ID	Sample Location	Layer Name / Sample Description	Asbestos Detected	Asbestos Type (%)	Non-Asbestos Constituents
0212546-004 CMES-12A		LAYER 1 Roofing, Silver	No	None Detected	Fibrous Glass 15% Cellulose Fiber 5% Carbonates Quartz Binder/Filler 80%
		LAYER 2 Roofing, Black	No	None Detected	Fibrous Glass 15% Cellulose Fiber 3% Synthetic Fiber 2% Carbonates Quartz Binder/Filler 80%
		LAYER 3 Roofing, Black	No	None Detected	Cellulose Fiber 15% Fibrous Glass 3% Synthetic Fiber 2% Carbonates Quartz Binder/Filler 80%
		LAYER 4 Roofing, Brown/ Tan	No	None Detected	Cellulose Fiber 85% Carbonates Gypsum Binder/Filler 15%

# EMC LABS, INC.

9830 S. 51st Street, Suite B109, Phoenix, AZ 85044  
Phone: 800-362-3373 or 480-940-5294 - Fax: (480) 893-1726

Laboratory Report

**0212546**

## **Bulk Asbestos Analysis by Polarized Light Microscopy**

NVLAP#101926-0

Client:	TRC SOLUTIONS	Job# / P.O. #:	321417
Address:	4105 SE INTERNATIONAL WAY	Date Received:	12/10/2018
	STE 505	Date Analyzed:	12/13/2018
	MILWAUKIE OR 97222		
Collected:	12/07/2018	Date Reported:	12/13/2018
Project Name:	BSD-CEDAR MILL ES, HVAC UPGRADE	EPA Method:	EPA 600/R-93/116
Address:		Submitted By:	JASON STONE
		Collected By:	

Lab ID Client ID	Sample Location	Layer Name / Sample Description	Asbestos Detected	Asbestos Type (%)	Non-Asbestos Constituents	
0212546-005 CMES-12B		LAYER 1 Roofing, Silver	No	None Detected	Fibrous Glass	15%
					Synthetic Fiber	5%
					Carbonates	
					Quartz	
		LAYER 2 Roofing, Black	No	None Detected	Fibrous Glass	15%
					Cellulose Fiber	3%
					Synthetic Fiber	2%
					Carbonates	
		LAYER 3 Roofing, Black	No	None Detected	Quartz	
					Binder/Filler	80%
					Cellulose Fiber	20%
					Carbonates	
LAYER 4 Roofing, Brown/ Tan	No	None Detected	Quartz			
			Binder/Filler	80%		
			Cellulose Fiber	85%		
			Carbonates			
					Gypsum	
					Binder/Filler	15%

Please see EMC Labs Sample Number 0212546-022 for Additional Layers

# EMC LABS, INC.

9830 S. 51st Street, Suite B109, Phoenix, AZ 85044  
Phone: 800-362-3373 or 480-940-5294 - Fax: (480) 893-1726

Laboratory Report

**0212546**

## **Bulk Asbestos Analysis by Polarized Light Microscopy**

NVLAP#101926-0

Client:	TRC SOLUTIONS	Job# / P.O. #:	321417
Address:	4105 SE INTERNATIONAL WAY	Date Received:	12/10/2018
	STE 505	Date Analyzed:	12/13/2018
	MILWAUKIE OR 97222		
Collected:	12/07/2018	Date Reported:	12/13/2018
Project Name:	BSD-CEDAR MILL ES, HVAC UPGRADE	EPA Method:	EPA 600/R-93/116
Address:		Submitted By:	JASON STONE
		Collected By:	

Lab ID Client ID	Sample Location	Layer Name / Sample Description	Asbestos Detected	Asbestos Type (%)	Non-Asbestos Constituents
0212546-006 CMES-13A		LAYER 1 Roofing, Silver	No	None Detected	Cellulose Fiber 1%
					Carbonates
					Quartz
					Binder/Filler 99%
		LAYER 2 Roofing, Gray/ Tan	No	None Detected	Fibrous Glass 5%
					Carbonates
					Quartz
					Binder/Filler 95%
		LAYER 3 Roofing, Black	No	None Detected	Fibrous Glass 10%
					Synthetic Fiber 10%
					Carbonates
					Quartz
					Binder/Filler 80%
		LAYER 4 Roofing, Black	No	None Detected	Cellulose Fiber 15%
					Fibrous Glass 5%
					Carbonates
					Quartz
					Binder/Filler 80%

**Please see EMC Labs Sample Number 0212546-023 for Additional Layers**

# EMC LABS, INC.

9830 S. 51st Street, Suite B109, Phoenix, AZ 85044  
Phone: 800-362-3373 or 480-940-5294 - Fax: (480) 893-1726

Laboratory Report

**0212546**

## **Bulk Asbestos Analysis by Polarized Light Microscopy**

NVLAP#101926-0

Client:	TRC SOLUTIONS	Job# / P.O. #:	321417
Address:	4105 SE INTERNATIONAL WAY	Date Received:	12/10/2018
	STE 505	Date Analyzed:	12/13/2018
	MILWAUKIE OR 97222		
Collected:	12/07/2018	Date Reported:	12/13/2018
Project Name:	BSD-CEDAR MILL ES, HVAC UPGRADE	EPA Method:	EPA 600/R-93/116
Address:		Submitted By:	JASON STONE
		Collected By:	

Lab ID Client ID	Sample Location	Layer Name / Sample Description	Asbestos Detected	Asbestos Type (%)	Non-Asbestos Constituents	
0212546-007 CMES-13B		LAYER 1	No	None Detected	Cellulose Fiber	1%
		Roofing, Silver			Carbonates	
					Quartz	
					Binder/Filler	99%
		LAYER 2	No	None Detected	Fibrous Glass	15%
		Roofing, Black			Cellulose Fiber	3%
					Synthetic Fiber	2%
					Carbonates	
					Quartz	
					Binder/Filler	80%
		LAYER 3	No	None Detected	Cellulose Fiber	15%
		Roofing, Black			Fibrous Glass	5%
					Carbonates	
					Quartz	
					Binder/Filler	80%
		LAYER 4	No	None Detected	Cellulose Fiber	85%
		Roofing, Brown/ Tan			Carbonates	
					Gypsum	
					Binder/Filler	15%

**Please see EMC Labs Sample Number 0212546-024 for Additional Layers**

# EMC LABS, INC.

9830 S. 51st Street, Suite B109, Phoenix, AZ 85044  
Phone: 800-362-3373 or 480-940-5294 - Fax: (480) 893-1726

Laboratory Report

**0212546**

## Bulk Asbestos Analysis by Polarized Light Microscopy

NVLAP#101926-0

Client:	TRC SOLUTIONS	Job# / P.O. #:	321417
Address:	4105 SE INTERNATIONAL WAY	Date Received:	12/10/2018
	STE 505	Date Analyzed:	12/13/2018
	MILWAUKIE OR 97222		
Collected:	12/07/2018	Date Reported:	12/13/2018
Project Name:	BSD-CEDAR MILL ES, HVAC UPGRADE	EPA Method:	EPA 600/R-93/116
Address:		Submitted By:	JASON STONE
		Collected By:	

Lab ID Client ID	Sample Location	Layer Name / Sample Description	Asbestos Detected	Asbestos Type (%)	Non-Asbestos Constituents
0212546-008 CMES-14A		LAYER 1 Roofing, Silver	No	None Detected	Cellulose Fiber <1%
					Carbonates
					Quartz
					Binder/Filler 99%
		LAYER 2 Roofing, Gray/ Tan	No	None Detected	Fibrous Glass 5%
					Carbonates
					Quartz
					Binder/Filler 95%
		LAYER 3 Roofing, Black	No	None Detected	Fibrous Glass 15%
					Synthetic Fiber 5%
					Carbonates
					Quartz
					Binder/Filler 80%
		LAYER 4 Roofing, Black	No	None Detected	Fibrous Glass 15%
					Cellulose Fiber 3%
					Synthetic Fiber 2%
					Carbonates
					Quartz
					Binder/Filler 80%

Please see EMC Labs Sample Number 0212546-025 for Additional Layers

# EMC LABS, INC.

9830 S. 51st Street, Suite B109, Phoenix, AZ 85044  
Phone: 800-362-3373 or 480-940-5294 - Fax: (480) 893-1726

Laboratory Report

**0212546**

## Bulk Asbestos Analysis by Polarized Light Microscopy

NVLAP#101926-0

Client:	TRC SOLUTIONS	Job# / P.O. #:	321417
Address:	4105 SE INTERNATIONAL WAY	Date Received:	12/10/2018
	STE 505	Date Analyzed:	12/13/2018
	MILWAUKIE OR 97222		
Collected:	12/07/2018	Date Reported:	12/13/2018
Project Name:	BSD-CEDAR MILL ES, HVAC UPGRADE	EPA Method:	EPA 600/R-93/116
Address:		Submitted By:	JASON STONE
		Collected By:	

Lab ID Client ID	Sample Location	Layer Name / Sample Description	Asbestos Detected	Asbestos Type (%)	Non-Asbestos Constituents
0212546-009 CMES-14B		LAYER 1 Roofing, Silver	No	None Detected	Cellulose Fiber <1% Carbonates Quartz Binder/Filler 99%
		LAYER 2 Roofing, Gray/ Tan	No	None Detected	Fibrous Glass 5% Carbonates Quartz Binder/Filler 95%
		LAYER 3 Roofing, Black	No	None Detected	Fibrous Glass 15% Synthetic Fiber 5% Carbonates Quartz Binder/Filler 80%
		LAYER 4 Roofing, Black	No	None Detected	Cellulose Fiber 15% Fibrous Glass 5% Carbonates Quartz Binder/Filler 80%

Please see EMC Labs Sample Number 0212546-026 for Additional Layers

# EMC LABS, INC.

9830 S. 51st Street, Suite B109, Phoenix, AZ 85044  
Phone: 800-362-3373 or 480-940-5294 - Fax: (480) 893-1726

Laboratory Report

**0212546**

## Bulk Asbestos Analysis by Polarized Light Microscopy

NVLAP#101926-0

Client:	TRC SOLUTIONS	Job# / P.O. #:	321417
Address:	4105 SE INTERNATIONAL WAY	Date Received:	12/10/2018
	STE 505	Date Analyzed:	12/13/2018
	MILWAUKIE OR 97222		
Collected:	12/07/2018	Date Reported:	12/13/2018
Project Name:	BSD-CEDAR MILL ES, HVAC UPGRADE	EPA Method:	EPA 600/R-93/116
Address:		Submitted By:	JASON STONE
		Collected By:	

Lab ID Client ID	Sample Location	Layer Name / Sample Description	Asbestos Detected	Asbestos Type (%)	Non-Asbestos Constituents
0212546-010 CMES-15A		LAYER 1 Roofing, Silver	No	None Detected	Cellulose Fiber <1% Carbonates Quartz Binder/Filler 99%
		LAYER 2 Roofing, Black	No	None Detected	Cellulose Fiber 15% Fibrous Glass 5% Carbonates Quartz Binder/Filler 80%
		LAYER 3 Roofing, Gray/ Tan	No	None Detected	Fibrous Glass 5% Carbonates Quartz Binder/Filler 95%
		LAYER 4 Roofing, Black	No	None Detected	Fibrous Glass 15% Synthetic Fiber 3% Cellulose Fiber 2% Carbonates Quartz Binder/Filler 80%

**Please see EMC Labs Sample Number 0212546-027 for Additional Layers**

0212546-011 CMES-15B		LAYER 1 Roofing, Silver	No	None Detected	Cellulose Fiber <1% Carbonates Quartz Binder/Filler 99%
		LAYER 2 Roofing, Black	No	None Detected	Fibrous Glass 15% Synthetic Fiber 5% Carbonates Quartz Binder/Filler 80%
		LAYER 3 Roofing, Black	No	None Detected	Fibrous Glass 15% Synthetic Fiber 3% Cellulose Fiber 2% Carbonates Quartz Binder/Filler 80%

# EMC LABS, INC.

9830 S. 51st Street, Suite B109, Phoenix, AZ 85044  
Phone: 800-362-3373 or 480-940-5294 - Fax: (480) 893-1726

Laboratory Report

**0212546**

## **Bulk Asbestos Analysis by Polarized Light Microscopy**

NVLAP#101926-0

Client:	TRC SOLUTIONS	Job# / P.O. #:	321417
Address:	4105 SE INTERNATIONAL WAY	Date Received:	12/10/2018
	STE 505	Date Analyzed:	12/13/2018
	MILWAUKIE OR 97222		
Collected:	12/07/2018	Date Reported:	12/13/2018
Project Name:	BSD-CEDAR MILL ES, HVAC UPGRADE	EPA Method:	EPA 600/R-93/116
Address:		Submitted By:	JASON STONE
		Collected By:	

Lab ID Client ID	Sample Location	Layer Name / Sample Description	Asbestos Detected	Asbestos Type (%)	Non-Asbestos Constituents
0212546-012 CMES-16A		LAYER 1 Roofing, Silver	No	None Detected	Cellulose Fiber 1% Carbonates Quartz Gypsum Binder/Filler 99%
		LAYER 2 Roofing, Gray/ Tan	No	None Detected	Fibrous Glass 5% Cellulose Fiber <1% Carbonates Quartz Binder/Filler 94%
		LAYER 3 Roofing, Black	No	None Detected	Fibrous Glass 17% Cellulose Fiber 3% Carbonates Quartz Binder/Filler 80%
		LAYER 4 Roofing, Black	No	None Detected	Fibrous Glass 15% Cellulose Fiber 5% Carbonates Quartz Binder/Filler 80%

Please see EMC Labs Sample Number 0212546-028 for Additional Layers

# EMC LABS, INC.

9830 S. 51st Street, Suite B109, Phoenix, AZ 85044  
Phone: 800-362-3373 or 480-940-5294 - Fax: (480) 893-1726

Laboratory Report

**0212546**

## Bulk Asbestos Analysis by Polarized Light Microscopy

NVLAP#101926-0

Client: TRC SOLUTIONS Job# / P.O. #: 321417  
Address: 4105 SE INTERNATIONAL WAY Date Received: 12/10/2018  
STE 505 Date Analyzed: 12/13/2018  
MILWAUKIE OR 97222  
Collected: 12/07/2018 Date Reported: 12/13/2018  
Project Name: BSD-CEDAR MILL ES, HVAC UPGRADE EPA Method: EPA 600/R-93/116  
Address: Submitted By: JASON STONE  
Collected By:

Lab ID Client ID	Sample Location	Layer Name / Sample Description	Asbestos Detected	Asbestos Type (%)	Non-Asbestos Constituents
0212546-013 CMES-16B		LAYER 1 Roofing, Black	No	None Detected	Cellulose Fiber 10% Carbonates Quartz Gypsum Binder/Filler 90%
		LAYER 2 Roofing, Gray/ Tan	No	None Detected	Fibrous Glass 5% Carbonates Quartz Binder/Filler 95%
		LAYER 3 Roofing, Black	No	None Detected	Fibrous Glass 5% Synthetic Fiber <1% Carbonates Quartz Binder/Filler 94%
		LAYER 4 Roofing, Black	No	None Detected	Fibrous Glass 20% Carbonates Quartz Binder/Filler 80%

Please see EMC Labs Sample Number 0212546-029 for Additional Layers

# EMC LABS, INC.

9830 S. 51st Street, Suite B109, Phoenix, AZ 85044  
Phone: 800-362-3373 or 480-940-5294 - Fax: (480) 893-1726

Laboratory Report

**0212546**

## Bulk Asbestos Analysis by Polarized Light Microscopy

NVLAP#101926-0

Client:	TRC SOLUTIONS	Job# / P.O. #:	321417
Address:	4105 SE INTERNATIONAL WAY	Date Received:	12/10/2018
	STE 505	Date Analyzed:	12/13/2018
	MILWAUKIE OR 97222		
Collected:	12/07/2018	Date Reported:	12/13/2018
Project Name:	BSD-CEDAR MILL ES, HVAC UPGRADE	EPA Method:	EPA 600/R-93/116
Address:		Submitted By:	JASON STONE
		Collected By:	

Lab ID Client ID	Sample Location	Layer Name / Sample Description	Asbestos Detected	Asbestos Type (%)	Non-Asbestos Constituents
0212546-014 CMES-17A		LAYER 1 Roofing, Silver	No	None Detected	Cellulose Fiber 1% Carbonates Quartz Binder/Filler 99%
		LAYER 2 Roofing, Black	No	None Detected	Cellulose Fiber 15% Synthetic Fiber 3% Fibrous Glass 2% Carbonates Quartz Binder/Filler 80%
		LAYER 3 Roofing, Black	No	None Detected	Fibrous Glass 15% Synthetic Fiber 3% Cellulose Fiber 2% Carbonates Quartz Binder/Filler 80%
		LAYER 4 Roofing, Black	No	None Detected	Fibrous Glass 15% Synthetic Fiber 3% Cellulose Fiber 2% Carbonates Quartz Binder/Filler 80%

Please see EMC Labs Sample Number 0212546-030 for Additional Layers

# EMC LABS, INC.

9830 S. 51st Street, Suite B109, Phoenix, AZ 85044  
Phone: 800-362-3373 or 480-940-5294 - Fax: (480) 893-1726

Laboratory Report

**0212546**

## **Bulk Asbestos Analysis by Polarized Light Microscopy**

NVLAP#101926-0

Client:	TRC SOLUTIONS	Job# / P.O. #:	321417
Address:	4105 SE INTERNATIONAL WAY	Date Received:	12/10/2018
	STE 505	Date Analyzed:	12/13/2018
	MILWAUKIE OR 97222		
Collected:	12/07/2018	Date Reported:	12/13/2018
Project Name:	BSD-CEDAR MILL ES, HVAC UPGRADE	EPA Method:	EPA 600/R-93/116
Address:		Submitted By:	JASON STONE
		Collected By:	

Lab ID Client ID	Sample Location	Layer Name / Sample Description	Asbestos Detected	Asbestos Type (%)	Non-Asbestos Constituents
0212546-015 CMES-17B		LAYER 1 Roofing, Silver	No	None Detected	Cellulose Fiber 1% Carbonates Quartz Binder/Filler 99%
		LAYER 2 Roofing, Black	No	None Detected	Fibrous Glass 10% Synthetic Fiber 10% Carbonates Quartz Binder/Filler 80%
		LAYER 3 Roofing, Black	No	None Detected	Fibrous Glass 10% Synthetic Fiber 10% Carbonates Quartz Binder/Filler 80%
		LAYER 4 Roofing, Black	No	None Detected	Fibrous Glass 15% Synthetic Fiber 3% Cellulose Fiber 2% Carbonates Quartz Binder/Filler 80%

**Please see EMC Labs Sample Number 0212546-031 for Additional Layers**

0212546-016 CMES-18A		LAYER 1 Roofing, Silver	No	None Detected	Cellulose Fiber <1% Carbonates Quartz Binder/Filler 99%
		LAYER 2 Roof Mastic, Black	No	None Detected	Cellulose Fiber 7% Carbonates Quartz Binder/Filler 93%

# EMC LABS, INC.

9830 S. 51st Street, Suite B109, Phoenix, AZ 85044  
Phone: 800-362-3373 or 480-940-5294 - Fax: (480) 893-1726

Laboratory Report  
**0212546**

## Bulk Asbestos Analysis by Polarized Light Microscopy

NVLAP#101926-0

Client:	TRC SOLUTIONS	Job# / P.O. #:	321417
Address:	4105 SE INTERNATIONAL WAY	Date Received:	12/10/2018
	STE 505	Date Analyzed:	12/13/2018
	MILWAUKIE OR 97222		
Collected:	12/07/2018	Date Reported:	12/13/2018
Project Name:	BSD-CEDAR MILL ES, HVAC UPGRADE	EPA Method:	EPA 600/R-93/116
Address:		Submitted By:	JASON STONE
		Collected By:	

Lab ID Client ID	Sample Location	Layer Name / Sample Description	Asbestos Detected	Asbestos Type (%)	Non-Asbestos Constituents
0212546-017 CMES-18B		LAYER 1 Roofing, Silver	No	None Detected	Cellulose Fiber <1% Carbonates Quartz Binder/Filler 99%
		LAYER 2 Roof Mastic, Black	No	None Detected	Cellulose Fiber 7% Carbonates Quartz Binder/Filler 93%
0212546-018 CMES-18C		LAYER 1 Roofing, Silver	No	None Detected	Cellulose Fiber <1% Carbonates Quartz Binder/Filler 99%
		LAYER 2 Roof Mastic, Black	No	None Detected	Cellulose Fiber 7% Carbonates Quartz Binder/Filler 93%
0212546-019 CMES-11A	ADDITIONAL LAYERS	LAYER 1 Roofing, Black/ Gray	No	None Detected	Cellulose Fiber 85% Fibrous Glass 10% Gypsum Binder/Filler 5%
		LAYER 2 Roofing, Yellow	No	None Detected	Foam Gypsum Binder/Filler 100%
0212546-020 CMES-11B	ADDITIONAL LAYERS	LAYER 1 Roofing, Black/ Gray	No	None Detected	Cellulose Fiber 85% Fibrous Glass 10% Gypsum Binder/Filler 5%
		LAYER 2 Roofing, Yellow	No	None Detected	Foam Gypsum Binder/Filler 100%

# EMC LABS, INC.

9830 S. 51st Street, Suite B109, Phoenix, AZ 85044  
Phone: 800-362-3373 or 480-940-5294 - Fax: (480) 893-1726

Laboratory Report

**0212546**

## Bulk Asbestos Analysis by Polarized Light Microscopy

NVLAP#101926-0

Client:	TRC SOLUTIONS	Job# / P.O. #:	321417
Address:	4105 SE INTERNATIONAL WAY	Date Received:	12/10/2018
	STE 505	Date Analyzed:	12/13/2018
	MILWAUKIE OR 97222		
Collected:	12/07/2018	Date Reported:	12/13/2018
Project Name:	BSD-CEDAR MILL ES, HVAC UPGRADE	EPA Method:	EPA 600/R-93/116
Address:		Submitted By:	JASON STONE
		Collected By:	

Lab ID Client ID	Sample Location	Layer Name / Sample Description	Asbestos Detected	Asbestos Type (%)	Non-Asbestos Constituents
0212546-021 CMES-11C	ADDITIONAL LAYERS	LAYER 1 Roofing, Black/ Gray	No	None Detected	Cellulose Fiber 85% Fibrous Glass 10% Gypsum Binder/Filler 5%
		LAYER 2 Roofing, Yellow	No	None Detected	Foam Gypsum Binder/Filler 100%
0212546-022 CMES-12B	ADDITIONAL LAYERS	LAYER 1 Roofing, Black/ Gray	No	None Detected	Cellulose Fiber 85% Fibrous Glass 10% Gypsum Binder/Filler 5%
		LAYER 2 Roofing, Yellow	No	None Detected	Foam Gypsum Binder/Filler 100%
0212546-023 CMES-13A	ADDITIONAL LAYERS	LAYER 1 Roofing, Beige/ Tan	No	None Detected	Cellulose Fiber 95% Gypsum Binder/Filler 5%
		LAYER 2 Roofing, Gray/ Tan	No	None Detected	Cellulose Fiber 75% Perlite Gypsum Binder/Filler 25%
0212546-024 CMES-13B	ADDITIONAL LAYERS	LAYER 1 Roofing, Black/ Gray	No	None Detected	Cellulose Fiber 85% Fibrous Glass 10% Gypsum Binder/Filler 5%
		LAYER 2 Roofing, Yellow	No	None Detected	Foam Gypsum Binder/Filler 100%

# EMC LABS, INC.

9830 S. 51st Street, Suite B109, Phoenix, AZ 85044  
Phone: 800-362-3373 or 480-940-5294 - Fax: (480) 893-1726

Laboratory Report

**0212546**

## Bulk Asbestos Analysis by Polarized Light Microscopy

NVLAP#101926-0

Client:	TRC SOLUTIONS	Job# / P.O. #:	321417
Address:	4105 SE INTERNATIONAL WAY	Date Received:	12/10/2018
	STE 505	Date Analyzed:	12/13/2018
	MILWAUKIE OR 97222		
Collected:	12/07/2018	Date Reported:	12/13/2018
Project Name:	BSD-CEDAR MILL ES, HVAC UPGRADE	EPA Method:	EPA 600/R-93/116
Address:		Submitted By:	JASON STONE
		Collected By:	

Lab ID Client ID	Sample Location	Layer Name / Sample Description	Asbestos Detected	Asbestos Type (%)	Non-Asbestos Constituents	
0212546-025 CMES-14A	ADDITIONAL LAYERS	LAYER 1 Roofing, Black	No	None Detected	Cellulose Fiber	15%
					Carbonates Gypsum Quartz Binder/Filler	85%
		LAYER 2 Roofing, Brown/ Tan	No	None Detected	Cellulose Fiber	90%
					Gypsum Binder/Filler	10%
0212546-026 CMES-14B	ADDITIONAL LAYERS	LAYER 1 Roofing, Black	No	None Detected	Synthetic Fiber Cellulose Fiber	15% 5%
					Carbonates Gypsum Quartz Binder/Filler	80%
		LAYER 2 Roofing, Brown/ Tan	No	None Detected	Cellulose Fiber	90%
					Gypsum Binder/Filler	10%
0212546-027 CMES-15A	ADDITIONAL LAYERS	LAYER 1 Roofing, Black	No	None Detected	Synthetic Fiber Cellulose Fiber	15% 5%
					Carbonates Gypsum Quartz Binder/Filler	80%
		LAYER 2 Roofing, Brown/ Tan	No	None Detected	Cellulose Fiber	90%
					Gypsum Binder/Filler	10%

# EMC LABS, INC.

9830 S. 51st Street, Suite B109, Phoenix, AZ 85044  
Phone: 800-362-3373 or 480-940-5294 - Fax: (480) 893-1726

Laboratory Report

**0212546**

## Bulk Asbestos Analysis by Polarized Light Microscopy

NVLAP#101926-0

Client: TRC SOLUTIONS Job# / P.O. #: 321417  
Address: 4105 SE INTERNATIONAL WAY Date Received: 12/10/2018  
STE 505 Date Analyzed: 12/13/2018  
MILWAUKIE OR 97222  
Collected: 12/07/2018 Date Reported: 12/13/2018  
Project Name: BSD-CEDAR MILL ES, HVAC UPGRADE EPA Method: EPA 600/R-93/116  
Address: Submitted By: JASON STONE  
Collected By:

Lab ID Client ID	Sample Location	Layer Name / Sample Description	Asbestos Detected	Asbestos Type (%)	Non-Asbestos Constituents
0212546-028 CMES-16A	ADDITIONAL LAYERS	LAYER 1 Roofing, Black	No	None Detected	Fibrous Glass 20% Cellulose Fiber 2% Carbonates Quartz Binder/Filler 78%
		LAYER 2 Roofing, Beige	No	None Detected	Cellulose Fiber 75% Carbonates Binder/Filler 25%
		LAYER 1 Roofing, Black	No	None Detected	Fibrous Glass 20% Cellulose Fiber 2% Carbonates Quartz Binder/Filler 78%
		LAYER 2 Roofing, Beige	No	None Detected	Cellulose Fiber 75% Carbonates Binder/Filler 25%
0212546-030 CMES-17A	ADDITIONAL LAYERS	LAYER 1 Roofing, Black	No	None Detected	Synthetic Fiber 15% Cellulose Fiber 5% Carbonates Gypsum Quartz Binder/Filler 80%
		LAYER 2 Roofing, Brown/ Tan	No	None Detected	Cellulose Fiber 90% Gypsum Binder/Filler 10%
		LAYER 1 Roofing, Black	No	None Detected	Synthetic Fiber 15% Cellulose Fiber 5% Carbonates Gypsum Quartz Binder/Filler 80%
		LAYER 2 Roofing, Brown/ Tan	No	None Detected	Cellulose Fiber 90% Gypsum Binder/Filler 10%

# EMC LABS, INC.

9830 S. 51st Street, Suite B109, Phoenix, AZ 85044  
Phone: 800-362-3373 or 480-940-5294 - Fax: (480) 893-1726

Laboratory Report  
**0212546**

## Bulk Asbestos Analysis by Polarized Light Microscopy

NVLAP#101926-0

Client:	TRC SOLUTIONS	Job# / P.O. #:	321417
Address:	4105 SE INTERNATIONAL WAY	Date Received:	12/10/2018
	STE 505	Date Analyzed:	12/13/2018
	MILWAUKIE OR 97222		
Collected:	12/07/2018	Date Reported:	12/13/2018
Project Name:	BSD-CEDAR MILL ES, HVAC UPGRADE	EPA Method:	EPA 600/R-93/116
Address:		Submitted By:	JASON STONE
		Collected By:	

Lab ID Client ID	Sample Location	Layer Name / Sample Description	Asbestos Detected	Asbestos Type (%)	Non-Asbestos Constituents
0212546-031 CMES-17B	ADDITIONAL LAYERS	LAYER 1 Roofing, Black	No	None Detected	Synthetic Fiber 15% Cellulose Fiber 5% Carbonates Gypsum Quartz Binder/Filler 80%
		LAYER 2 Roofing, Brown/ Tan	No	None Detected	Cellulose Fiber 90% Gypsum Binder/Filler 10%



Analyst - Octavio Gavarreteayestas



Signatory - Lab Director - Kurt Kettler

Distinctly stratified, easily separable layers of samples are analyzed as subsamples of the whole and are reported separately for each discernible layer. All analyses are derived from calibrated visual estimate and measured in area percent unless otherwise noted. The report applies to the standards or procedures identified and to the sample(s) tested. The test results are not necessarily indicated or representative of the qualities of the lot from which the sample was taken or of apparently identical or similar products, nor do they represent an ongoing quality assurance program unless so noted. These reports are for the exclusive use of the addressed client and that they will not be reproduced wholly or in part for advertising or other purposes over our signature or in connection with our name without special written permission. The report shall not be reproduced except in full, without written approval by our laboratory. The samples not destroyed in testing are retained a maximum of thirty days. The laboratory measurement of uncertainty for the test method is approximately less than 1 by area percent. Accredited by the National Institute of Standards and Technology, Voluntary Laboratory Accreditation Program for selected test method for asbestos. The accreditation or any reports generated by this laboratory in no way constitutes or implies product certification, approval, or endorsement by the National Institute of Standards and Technology. The report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the Federal Government. Polarized Light Microscopy may not be consistently reliable in detecting asbestos in floor coverings and similar non-friable organically bound materials.

# EMC LABS, INC.

9830 S. 51st Street, Suite B109, Phoenix, AZ 85044  
Phone: 800-362-3373 or 480-940-5294 - Fax: (480) 893-1726

Laboratory Report

**0213504**

## Bulk Asbestos Analysis by Polarized Light Microscopy

NVLAP#101926-0

Client:	TRC SOLUTIONS	Job# / P.O. #:	321417
Address:	4105 SE INTERNATIONAL WAY	Date Received:	01/04/2019
	STE 505	Date Analyzed:	01/09/2019
	MILWAUKIE OR 97222		
Collected:	01/03/2019	Date Reported:	01/09/2019
Project Name:	BSD-CEDAR MILL E.S.	EPA Method:	EPA 600/R-93/116
Address:		Submitted By:	JASON STONE
		Collected By:	

Lab ID Client ID	Sample Location	Layer Name / Sample Description	Asbestos Detected	Asbestos Type (%)	Non-Asbestos Constituents
0213504-001 CMES-19A	STAFF RM	Wall Patch, White/ Off White	No	None Detected	Fibrous Glass 95% Carbonates Gypsum 5%
0213504-002 CMES-19B	STAFF RM	Wall Patch, White/ Off White	No	None Detected	Fibrous Glass 95% Carbonates Gypsum 5%
0213504-003 CMES-20A	BASEMENT CUST. OFFICE	LAYER 1 4" Covebase, Brown	No	None Detected	Carbonates Quartz Binder/Filler 100%
		LAYER 2 Glue, Brown	Yes	Tremolite <1%	Non-Fibrous Tremolite 2% Talc 2% Gypsum Quartz Carbonates Binder/Filler 95%
0213504-004 CMES-20B	BASEMENT CUST. OFFICE	LAYER 1 4" Covebase, Brown	No	None Detected	Carbonates Quartz Binder/Filler 100%
		LAYER 2 Glue, Brown	Yes	Tremolite <1%	Non-Fibrous Tremolite 2% Talc 2% Gypsum Quartz Carbonates Binder/Filler 95%

# EMC LABS, INC.

9830 S. 51st Street, Suite B109, Phoenix, AZ 85044  
Phone: 800-362-3373 or 480-940-5294 - Fax: (480) 893-1726


Laboratory Report  
**0213504**

## Bulk Asbestos Analysis by Polarized Light Microscopy

NVLAP#101926-0

Client:	TRC SOLUTIONS	Job# / P.O. #:	321417
Address:	4105 SE INTERNATIONAL WAY	Date Received:	01/04/2019
	STE 505	Date Analyzed:	01/09/2019
	MILWAUKIE OR 97222		
Collected:	01/03/2019	Date Reported:	01/09/2019
Project Name:	BSD-CEDAR MILL E.S.	EPA Method:	EPA 600/R-93/116
Address:		Submitted By:	JASON STONE
		Collected By:	

Lab ID Client ID	Sample Location	Layer Name / Sample Description	Asbestos Detected	Asbestos Type (%)	Non-Asbestos Constituents
---------------------	--------------------	------------------------------------	----------------------	----------------------	------------------------------



Analyst - Kenneth Scheske



Signatory - Lab Director - Kurt Kettler

Distinctly stratified, easily separable layers of samples are analyzed as subsamples of the whole and are reported separately for each discernible layer. All analyses are derived from calibrated visual estimate and measured in area percent unless otherwise noted. The report applies to the standards or procedures identified and to the sample(s) tested. The test results are not necessarily indicated or representative of the qualities of the lot from which the sample was taken or of apparently identical or similar products, nor do they represent an ongoing quality assurance program unless so noted. These reports are for the exclusive use of the addressed client and that they will not be reproduced wholly or in part for advertising or other purposes over our signature or in connection with our name without special written permission. The report shall not be reproduced except in full, without written approval by our laboratory. The samples not destroyed in testing are retained a maximum of thirty days. The laboratory measurement of uncertainty for the test method is approximately less than 1 by area percent. Accredited by the National Institute of Standards and Technology, Voluntary Laboratory Accreditation Program for selected test method for asbestos. The accreditation or any reports generated by this laboratory in no way constitutes or implies product certification, approval, or endorsement by the National Institute of Standards and Technology. The report must not be used by the client to claim product certification, approval, or endorsement by NVLAP, NIST, or any agency of the Federal Government. Polarized Light Microscopy may not be consistently reliable in detecting asbestos in floor coverings and similar non-friable organically bound materials.

## CHAIN OF CUSTODY

EMC Labs, Inc.  
9830 S. 51<sup>st</sup> St., Ste B-109  
Phoenix, AZ 85044  
(800) 362-3373 Fax (480) 893-1726

LAB#: 212048  
TAT: 3 day  
Rec'd: NOV 30 P.M.

COMPANY NAME: TRC SOLUTIONS

4105 SE International Way, Suite 505  
Milwaukie, Oregon 97222

BILL TO: (If Different Location)

Phoenix, AZ

CONTACT: Ron Landolt Scan &amp; Excel

Phone/Fax: (503) 387-3251 / (503) 908-1318

Email: rlandolt@trcsolutions.com

Now Accepting: VISA - MASTERCARD

Price Quoted: \$ / Sample \$ / Layers

COMPLETE ITEMS 1-4: (Failure to complete any items may cause a delay in processing or analyzing your samples)

1. TURNAROUND TIME: [4hr rush] [8hr rush] [1-Day] [2-Day] [3-Day] [5-Day] [6-10 Day]

\*\*\*\*Prior confirmation of turnaround time is required

\*\*\*\*Additional charges for rush analysis (please call marketing department for pricing details)

\*\*\*\*Laboratory analysis may be subject to delay if credit terms are not met

2. TYPE OF ANALYSIS: [Bulk-PLM] [Air-PCM] [Lead] [Point Count] [Fungi: AOC, W-C, Bulk, Swab, Tape]3. DISPOSAL INSTRUCTIONS: [Dispose of samples at EMC] / [Return samples to me at my expense]

(If you do not indicate preference, EMC will dispose of samples 60 days from analysis.)

4. Project Name: BSD-Cedar Mill ES, HVAC upgradeP.O. Number: Project Number: 321417

EMC SAMPLE #	CLIENT SAMPLE #	DATE & TIME SAMPLED	LOCATION/MATERIAL TYPE	Samples Accepted Yes / No	AIR SAMPLE INFO / COMMENTS		
					ON	OFF	FLOW RATE
1	CMES-01A	11/28/18	See Attached field log	Y N			
				Y N			
				Y N			
				Y N			
				Y N			
				Y N			
				Y N			
34	CMES-00B			Y N			
31				Y N			
				Y N			
				Y N			
				Y N			
				Y N			
				Y N			
				Y N			

## SPECIAL INSTRUCTIONS:

Sample Collector: (Print) Math Casda


(Signature)

Relinquished by: [Signature] Date/Time: 11-29-18 100Received by: Diana Federico Date/Time: 11/30/18Relinquished by: Diana Federico Date/Time: 11/30/18Received by: [Signature] Date/Time: 11/30/18

Relinquished by: Date/Time:

Received by: Date/Time:

\*\* In the event of any dispute between the above parties for these services or otherwise, parties agree that jurisdiction and venue will be in Phoenix, Arizona and prevailing party will be entitled to attorney's fees and court costs.



ASBESTOS INSPECTION FIELD DATA SHEET

Project #: 321417

Inspector Name and License #:

Name: BSD - Cedar Mill E.S HVAC Upgrade

Date of Inspection: 11-28-18

Location: 10265 NW Cornell Road, Portland, OR

Inspector Signature: [Signature]

Page 1 of 2

Sample #	Material Description	Sample Location	Quantity (SF or LF)	Friability (NF or F)	Damage (ND, D, SD)
CMES-01A	Pipe Run Insulation (Steam Lines)	Gym Attic			
CMES-01B		Tunnel Access in Boy's Restroom			
CMES-01C		Tunnel under A110			
CMES-02A	Pipe Fitting Insulation (Steam Lines)	Gym Attic			
CMES-02B		Tunnel Access in Boy's Restroom			
CMES-02C		Tunnel under A110			
CMES-03A	HVAC Vibration Damper Cloth (Gym Attic Unit)	Gym Attic			
CMES-04A	1' x 1' Ceiling Tile, Even Holes and Brown Glue	Lower Gym Storage Hallway			
CMES-04B		Staff Lounge			
CMES-04C		Staff Lounge			
CMES-05A	1' x 1' Ceiling Tile, Random Holes and Brown Glue	Main Hallway			
CMES-05B		A118			
CMES-05C		Cafeteria			
CMES-06A	Gypsum Board and Joint Compound	Boy's Restroom Custodial Closet			
CMES-06B		Room A108			
CMES-06C		Room A120			
CMES-06D		Kitchen Restroom Closet			
CMES-06E		Cafeteria Hot Water Closet			
CMES-06F		Custodial Closet A126			
CMES-06G		Room A100 Closet			
CMES-07A	Carpet Glue	Room A108			
CMES-07B		Room A122			
CMES-07C		Custodial Closet A126			



Page 2 of 2

Inspector Name and License #:

Date of Inspection: 11-28-15

Inspector Signature: \_\_\_\_\_

~~2~~ ~~2~~ ~~2~~ ~~2~~ 4 5 6 7 8 9 30 31

## CHAIN OF CUSTODY

EMC Labs, Inc.  
 9830 S. 51<sup>st</sup> St., Ste B-109  
 Phoenix, AZ 85044  
 (480) 940-5294 Fax (480) 893-1726

LAB#: 212546TAT: 3 dayRec'd: DEC 10 AM

COMPANY NAME: TRC SOLUTIONS  
 Address: 4105 SE International Way, Suite 505  
Milwaukie, Oregon 97222  
 CONTACT: Ron Landolt Scan & Excel  
 Phone/Fax: (503) 387-3251 / (503) 908-1318  
 Email: randolt@trcsolutions.com and mlanda@trcsolutions.com

BILL TO: \_\_\_\_\_ (If Different Location)  
 Phoenix, AZ \_\_\_\_\_

Now Accepting: VISA - MASTERCARD

Price Quoted: \$ \_\_\_\_\_ / Sample \$ \_\_\_\_\_ / Layers

COMPLETE ITEMS 1-4: (Failure to complete any items may cause a delay in processing or analyzing your samples)

1. TURNAROUND TIME: [Same Day Rush] [1-2 Days] [3-4-5 Days] [6-10 Days]\*\*\*\*Prior confirmation of turnaround time is required

\*\*\*\*Additional charges for rush analysis (please call marketing department for pricing details)

\*\*\*\*Laboratory analysis may be subject to delay if credit terms are not met

2. TYPE OF ANALYSIS: [Bulk-PLM] [Air-PCM] [Lead] [Point Count] [Fungi: AOC, W-C, Bulk, Swab, Tape]

3. DISPOSAL INSTRUCTIONS: [Dispose of samples at EMC] / [Return samples to me at my expense]

(If you do not indicate preference, EMC will dispose of samples 30 days from analysis.)

4. Project Name: BSD Cedar Mill E.S. HVAC Upgrade

P.O. Number: \_\_\_\_\_

Project Number: 321417

EMC SAMPLE #	CLIENT SAMPLE #	DATE & TIME SAMPLED	LOCATION/MATERIAL TYPE	Samples Accepted Yes / No	AIR SAMPLE INFO / COMMENTS		
					ON	OFF	FLOW RATE
1	CMES-11A	12/2/18	Roof (Gym)	Y N			
2	-11B			Y N			
3	-11C			Y N			
4	-12A		Build-up Roof	Y N			
5	-12B			Y N			
6	-13A			Y N			
7	-13B			Y N			
8	-14A			Y N			
9	-14B			Y N			
10	-15A			Y N			
11	-15B			Y N			
12	-16A			Y N			
13	-16B			Y N			
14	-17A			Y N			
15	-17B			Y N			

## SPECIAL INSTRUCTIONS:

Sample Collector: (Print) Daron Stone(Signature) Daron StoneRelinquished by: Daron Stone Date/Time: 12/7/18 Received by: Diana Federico Date/Time: 12/10/18Relinquished by: Diana Federico Date/Time: 12/10/18 Received by: [Signature] Date/Time: 12/10/18

Relinquished by: \_\_\_\_\_ Date/Time: \_\_\_\_\_ Received by: \_\_\_\_\_ Date/Time: \_\_\_\_\_

\*\* In the event of any dispute between the above parties for these services or otherwise, parties agree that jurisdiction and venue will be in Phoenix, Arizona and prevailing party will be entitled to attorney's fees and court costs.

## CHAIN OF CUSTODY

EMC Labs, Inc.  
9830 S. 51<sup>st</sup> St., Ste B-109  
Phoenix, AZ 85044  
(480) 940-5294 Fax (480) 893-1726

LAB#:

TAT:

Rec'd:

COMPANY NAME: **TRC SOLUTIONS**  
Address: 4105 SE International Way, Suite 505  
Milwaukie, Oregon 97222  
CONTACT: Ron Landolt **Scan & Excel**  
Phone/Fax: (503) 387-3251 / (503) 908-1318  
Email: [randolt@trcsolutions.com](mailto:randolt@trcsolutions.com) and [moulton@trcsolutions.com](mailto:moulton@trcsolutions.com)

BILL TO: (If Different Location)

Phoenix, AZ

Now Accepting: **VISA - MASTERCARD**

Price Quoted: \$ \_\_\_\_\_ / Sample \$ \_\_\_\_\_ / Layers

**COMPLETE ITEMS 1-4: (Failure to complete any items may cause a delay in processing or analyzing your samples)**1. **TURNAROUND TIME:** [Same Day Rush] [1-2 Days] [3-4-5 Days] [6-10 Days]\*\*\*\*Prior confirmation of turnaround time is required

\*\*\*\*Additional charges for rush analysis (please call marketing department for pricing details)

\*\*\*\*Laboratory analysis may be subject to delay if credit terms are not met

2. **TYPE OF ANALYSIS:** [Bulk-PLM] [Air-PCM] [Lead] [Point Count] [Fungi: AOC, W-C, Bulk, Swab, Tape]3. **DISPOSAL INSTRUCTIONS:** [Dispose of samples at EMC] / [Return samples to me at my expense]

(If you do not indicate preference, EMC will dispose of samples 30 days from analysis.)

4. **Project Name:** BSD - Cedar Mill E.S. HVAC Upgrade**P.O. Number:** \_\_\_\_\_ **Project Number:** 321417

EMC SAMPLE #	CLIENT SAMPLE #	DATE & TIME SAMPLED	LOCATION/MATERIAL TYPE	Samples Accepted Yes / No	AIR SAMPLE INFO / COMMENTS		
					ON	OFF	FLOW RATE
16	CMES-18A	12/7/18	Roof Mastic	Y N			
17	-18B	↓	↓	Y N			
18	-18C	↓	↓	Y N			
19	CMES-11A	↓	ADDITIONAL LAYERS	Y N			
20	-11B	↓	↓	Y N			
21	-11C	↓	↓	Y N			
22	-12B	↓	↓	Y N			
23	-13A	↓	↓	Y N			
24	-13B	↓	↓	Y N			
25	-14A	↓	↓	Y N			
26	-14B	↓	↓	Y N			
27	-15A	↓	↓	Y N			
28	-15B	↓	↓	Y N			
29	-16A	↓	↓	Y N			
30	-17A	↓	↓	Y N			
31	-17B	↓	↓	Y N			

## SPECIAL INSTRUCTIONS:

Sample Collector: (Print) Jason Stone(Signature) Jason StoneRelinquished by: Jason Stone Date/Time: 12/7/18 Received by: Diana Federico Date/Time: 12/10/18Relinquished by: Diana Federico Date/Time: 12/10/18 Received by: At Date/Time: 12/10/18

Relinquished by: \_\_\_\_\_ Date/Time: \_\_\_\_\_ Received by: \_\_\_\_\_ Date/Time: \_\_\_\_\_

\*\* In the event of any dispute between the above parties for these services or otherwise, parties agree that jurisdiction and venue will be in Phoenix, Arizona and prevailing party will be entitled to attorney's fees and court costs.

LAB#: 213504  
TAT: 3 day  
Rec'd: JAN 04 P.M.

**EMC Labs, Inc.**  
**9830 S. 51<sup>st</sup> St., Ste B-109**  
**Phoenix, AZ 85044**  
**(480) 940-5294 Fax (480) 893-1726**

COMPANY NAME:

**TRC SOLUTIONS**

**BILL TO:**

(If Different Location)

**Address:**

4105 SE International Way, Suite 505

Phoenix, AZ

Milwaukie, Oregon 97222

CONTACT:

Ron Landolt                      **Scan & Excel****Phone/Fax:**

(503) 387-3251 / (503) 908-1318

**Email:**

randall@tresolutions.com and mcuda@tresolutions.com

**Now Accepting: VISA – MASTERCARD**

**Price Quoted: \$\_\_\_\_\_ / Sample \$\_\_\_\_ / Layers**

**COMPLETE ITEMS 1-4: (Failure to complete any items may cause a delay in processing or analyzing your samples)**

1. **TURNAROUND TIME:** [Same Day Rush] [1-2 Days] **(3)** [4-5 Days] [6-10 Days]

\*\*\***Prior confirmation of turnaround time is required**

**Additional charges for rush analysis (please call marketing department for pricing details)**

\*\*\*\* Laboratory analysis may be subject to delay if credit terms are not met

2. TYPE OF ANALYSIS: [Bulk-PLM] [Air-PCM] [Lead] [Point Count] [Fungi: AOC, W-C, Bulk, Swab, Tape]

3. DISPOSAL INSTRUCTIONS: [Dispose of samples at EMC] / [Return samples to me at my expense]

(If you do not indicate preference, EMC will dispose of samples 30 days from analysis.)

4. Project Name: BSD-Cedar Mill E.S.

**P.O. Number:**

Project Number: 321417

[illegible]

SPECIAL INSTRUCTIONS:

Sample Collector: (Print) Jason Stone

(Signature) Lisa M. Stine

Relinquished by: Lisa Stone

Date/Time: 1/3/19

Received by: Diana Federica

Date/Time: 11/2/17

Relinquished by: Diana Federico

Date/Time: 1/4/19

Received by:

Date/Time: 11/11/2019

Relinquished by:

Date/Time

Received by:

Date/Time: 7/7

\*\* In the event of any dispute between the above parties for these services or otherwise, parties agree that jurisdiction and venue will be in Phoenix, Arizona and prevailing party will be entitled to attorney's fees and court costs.

## **Appendix C – Inspector Certification(s)**

---

# ***The Environmental Institute***

---

---

## ***Matthew Cuda***

---

Social Security Number - XXX-XX-8274

TRC Solutions - 4105 SE International Way, Suite 505 - Milwaukie, Oregon 97222

*Has completed coursework and satisfactorily passed  
an examination that meets all criteria required for  
EPA/AHERA/ASHARA (TSCA Title II) Approved Reaccreditation*

### ***Asbestos in Buildings: Inspector Refresher***

***February 2, 2018***

Course Date

***16657***

Certificate Number

***February 2, 2018***

Examination Date

***February 1, 2019***

Expiration Date



*Thomas G. Laubenthal*  
Thomas G. Laubenthal - Principal Instructor

*Rachel G. McCain*  
Rachel G. McCain - Exam Administrator

*David W. Hogue*  
David W. Hogue - Training Manager

(Approved by the ABIH Certification Maintenance Committee for 1/2 CM point - Approval #11-577)

(Florida Provider Registration Number FL49-0001342 - Course #FL49-0002805)

TEI - 1841 West Oak Parkway, Suite F - Marietta, Georgia 30062 - (770) 427-3600 - [www.tei-atl.com](http://www.tei-atl.com)

# Certificate of Completion

This is to certify that

**Jason Stone**

has satisfactorily completed  
4 hours of refresher training as an  
AHERA Building Inspector

to comply with the training requirements of  
TSCA Title II, 40 CFR 763 (AHERA)

EPA Provider # 1085

170699

Certificate Number



Dec 12, 2018 Expires in 1 year.

Date(s) of Training

Exam Score (if applicable):

A handwritten signature in black ink, appearing to read "M. Stone", written over a horizontal line.

Instructor

ARGUS PACIFIC, INC / 21905 64th AVE W, SUITE 100 / MOUNTLAKE TERRACE, WASHINGTON 98043 / 206.285.3373 / ARGUSPACIFIC.COM