



**ROCKFORD BOARD OF EDUCATION  
INVITATION FOR BID ON SUPPLIES, MATERIALS, EQUIPMENT OR SERVICES  
FOR SCHOOL DISTRICT NO. 205  
ROCKFORD, ILLINOIS**

IFB No.       **16-25 Lincoln Middle School Mechanical and Electrical Renovations**

DATE:         **Friday, January 29, 2016**

RE:            **ADDENDUM NO. 2**

---

To All Bidders:

Attached are modifications, clarifications and/or corrections for the Project Manual and are hereby made a part of the contract documents. Please attach this addendum to the Project Manual(s) in your possession. Please note the receipt of this addendum on the bid form. Bidders shall review changes to all portions of this work as changes to one portion may affect the work of another.

**If you plan to hand deliver your IFB submission on the due date, please note you must check in on the 3rd floor prior to delivering your bid submission. Please allow time for this as late submission will not be accepted.**

Refer all questions relative to the business aspect, Instructions to Bidders, Special Conditions, and questions concerning the technical aspect of the documents to the Purchasing Process Manager by email at [tamara.pugh@rps205.com](mailto:tamara.pugh@rps205.com).

## **ADDENDUM TWO**

Project No.: **15-042**

Date: **January 29, 2016**


Subject: **CHANGES to the BIDDING DOCUMENTS**

Project: **MECHANICAL AND ELECTRICAL RENOVATION  
WORK FOR  
LINCOLN MIDDLE SCHOOL  
ROCKFORD PUBLIC SCHOOLS  
ROCKFORD, ILLINOIS**

Bids Due: **2:00PM, TUESDAY, FEBRUARY 2, 2016**

From: **RICHARD L. JOHNSON ASSOCIATES, INC.  
4703 CHARLES STREET  
ROCKFORD, IL 61108**


To: **ALL PROJECT DOCUMENT HOLDERS**

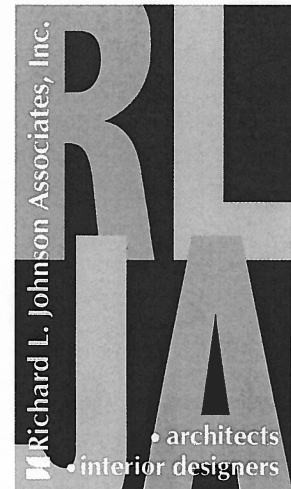

Please reproduce this Addendum as needed, and attach to the Project Manuals for the above project.

Bidders shall indicate receipt of this and all Addenda in the space provided on the Bid Form. Failure to do so may be sufficient cause to reject the bid.

Sincerely,  
RICHARD L. JOHNSON ASSOCIATES, INC.

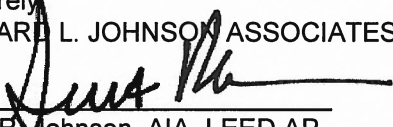  
\_\_\_\_\_  
Scott R. Johnson, AIA, LEED AP

This Addendum consists of:  
Pages 1 thru 2.

**NOTE:** Wherein this Addendum conflicts with the original Project Manual and Drawings, this Addendum shall govern.

## **CHANGES to the PROJECT MANUAL**

### **1. RFI QUESTIONS**

- 1.1.** Questions - A pad mounted NEMA 3R lockable enclosure with a 2500/1200 Amp Main Switch is shown on Addendum Drawing ADE1.2. A 2500/1200 Amp Main Switch is also shown on Addendum Drawing ADE1.3 as part of the New Main Switchboard. If a Main Switch is part of the pad mounted NEMA 3R enclosure with the C/T and meter, is one also needed in the main switchboard?

Answer - Yes, the main switchboard is rated over 1000 Amps and serves as a service entrance/accessible disconnect point for the system; it is required for ground fault protection per NEC 230.95, per NEC 230.92, and to provide an Instantaneous trip capability for Arc Flash reduction per NEC 240.87.

## **CHANGES to the DRAWINGS**

### **2. SHEET E113**

- 2.1.** Feeder sizes noted on Panel Schedules shall be revised to sizes indicated on the Wiring and Conduit Schedule on sheet E115. (Typical for all Panel Schedule Feeder Sizes on this sheet).
- 2.2.** Feeder sizes noted on Panel Schedules shall be revised to sizes indicated on the Wiring and Conduit Schedule on sheet E115. (Typical for all Panel Schedule Feeder Sizes on this sheet).

**END ADDENDUM NUMBER 2**