


April 2020 Monthly Energy Report

Facility	Monthly Information								Current Year Performance				
	Electric Usage		Electric Saved		Gas Usage		Gas Saved		Last 12 Mths % Total Energy Saved vs Base Yr	Wisconsin EUI- kBTU/SqFt Benchmark for Like Facilities	Ongoing kBTU per SqFt	Square Footage	*E-Star Score (From website)
	5 Year Average 2016-2020 (kWh)	Actual 2020 (kWh)	Monthly Savings kWh	Monthly Percent kWh Saved	5 Year Average 2016-2020 (Therms)	Actual 2020 (Therms)	Monthly Savings Therms	Monthly Percent Therms Saved					
Admin / Central	17,257	15,120	2,137	12.4%	607	662	-55	-9.1%	35.3%	100	72	16,260	84
E-Cook Elem	7,988	4,587	3,401	42.6%	912	1,103	-191	-20.9%	50.9%	78	47	30,598	92
Franklin Elem	14,643	8,486	6,157	42.0%	1,656	1,807	-151	-9.1%	40.8%	68	47	50,455	78
Jefferson Elem	17,040	11,600	5,440	31.9%	575	712	-137	-23.8%	29.2%	64	29	53,600	94
Lakeside Elem	9,032	6,240	2,792	30.9%	1,093	782	311	28.4%	25.5%	78	40	42,144	89
Maintenance	5,264	5,280	-16	-0.3%	1,353	1,149	204	15.1%	-1.9%		67	25,000	51
Merrill	41,024	30,240	10,784	26.3%	4,077	4,003	74	1.8%	44.0%	66	40	166,941	88
North HS	138,601	91,800	46,801	33.8%	7,111	6,891	220	3.1%	32.8%	83	46	309,000	90
Oaklawn Elem	32,752	25,920	6,832	20.9%	171	241	-70	-40.6%	3.6%	64	24	68,000	93
Oakwood Elem	15,576	9,600	5,976	38.4%	1,661	1,840	-179	-10.8%	28.6%	68	49	51,916	80
Read Elem	14,880	8,320	6,560	44.1%	1,284	1,002	282	22.0%	19.4%	68	40	51,075	89
Rec Dept	2,728	1,905	823	30.2%	1,075	1,281	-206	-19.2%	-8.8%		52	29,700	N/A
Roosevelt Elem	9,669	5,760	3,909	40.4%	1,697	1,413	284	16.7%	44.2%	78	48	47,800	88
Shapiro Elem	19,936	9,600	10,336	51.8%	1,229	1,240	-11	-0.9%	30.2%	64	36	63,000	91
Smith Elem	8,480	0	8,480	100.0%	1,110	0	1,110	100.0%	81.5%	78	20	32,687	80
South Park	33,280	21,000	12,280	36.9%	4,308	4,143	165	3.8%	46.2%	87	43	138,010	90
Tipler Middle	27,456	11,520	15,936	58.0%	1,753	1,825	-72	-4.1%	56.4%	66	31	87,560	96
Traeger	70,200	29,700	40,500	57.7%	3,705	3,686	19	0.5%	32.1%	62	33	194,288	96
Washington Elem	8,580	6,065	2,515	29.3%	1,500	1,580	-80	-5.3%	37.8%	78	66	33,286	73
Webster-Stanley	26,328	14,640	11,688	44.4%	3,740	3,094	646	17.3%	38.5%	74	50	118,043	81
West HS	149,660	102,900	46,760	31.2%	13,500	10,596	2,904	21.5%	47.0%	82	55	341,470	80
TOTAL	670,374	420,283	250,091	37.3%	54,117	49,050	5,067	9.4%	40.2%		45	Avg Score	85

* Energy Star Rating is based on many different building characteristics and energy profiles for that school. A score of 75 is required for certification.

District Wide Electric Usage History

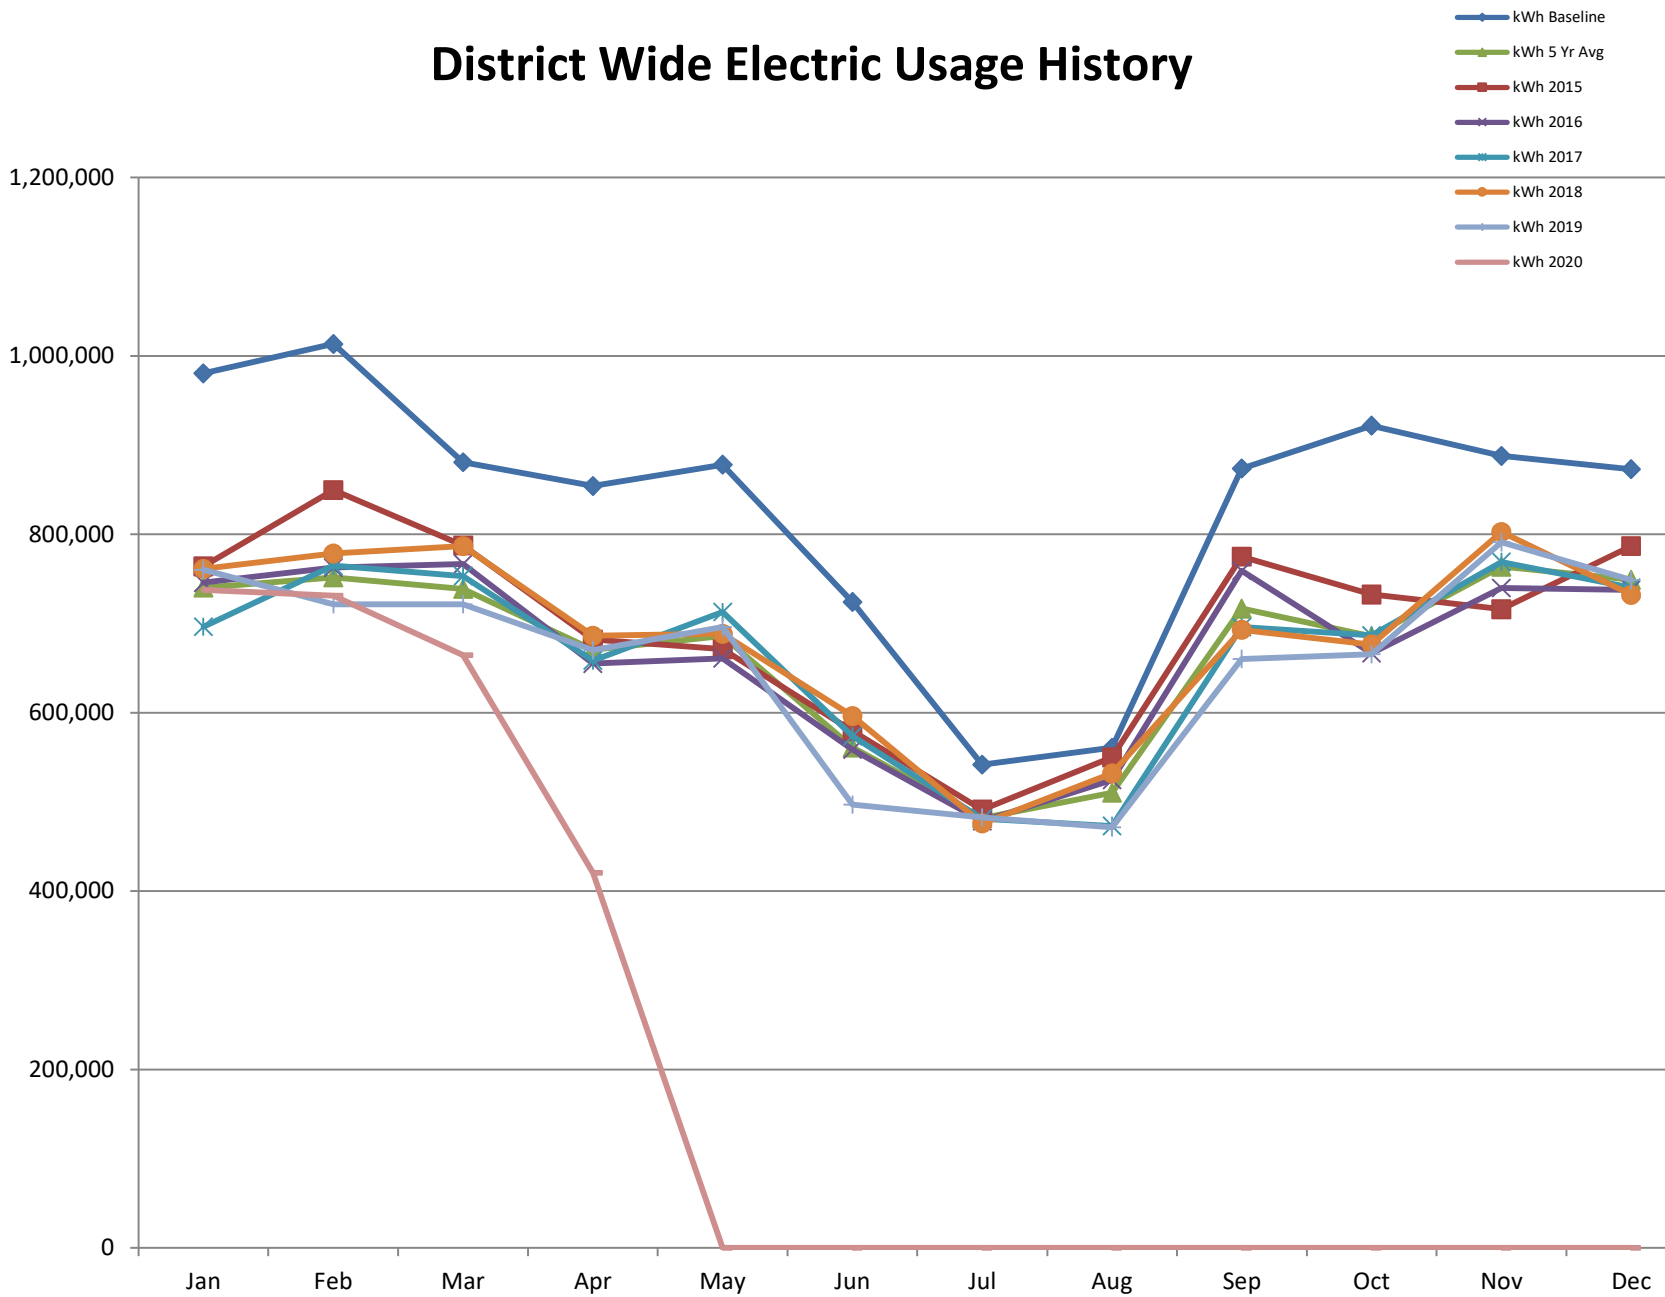

District Wide Gas Usage History

