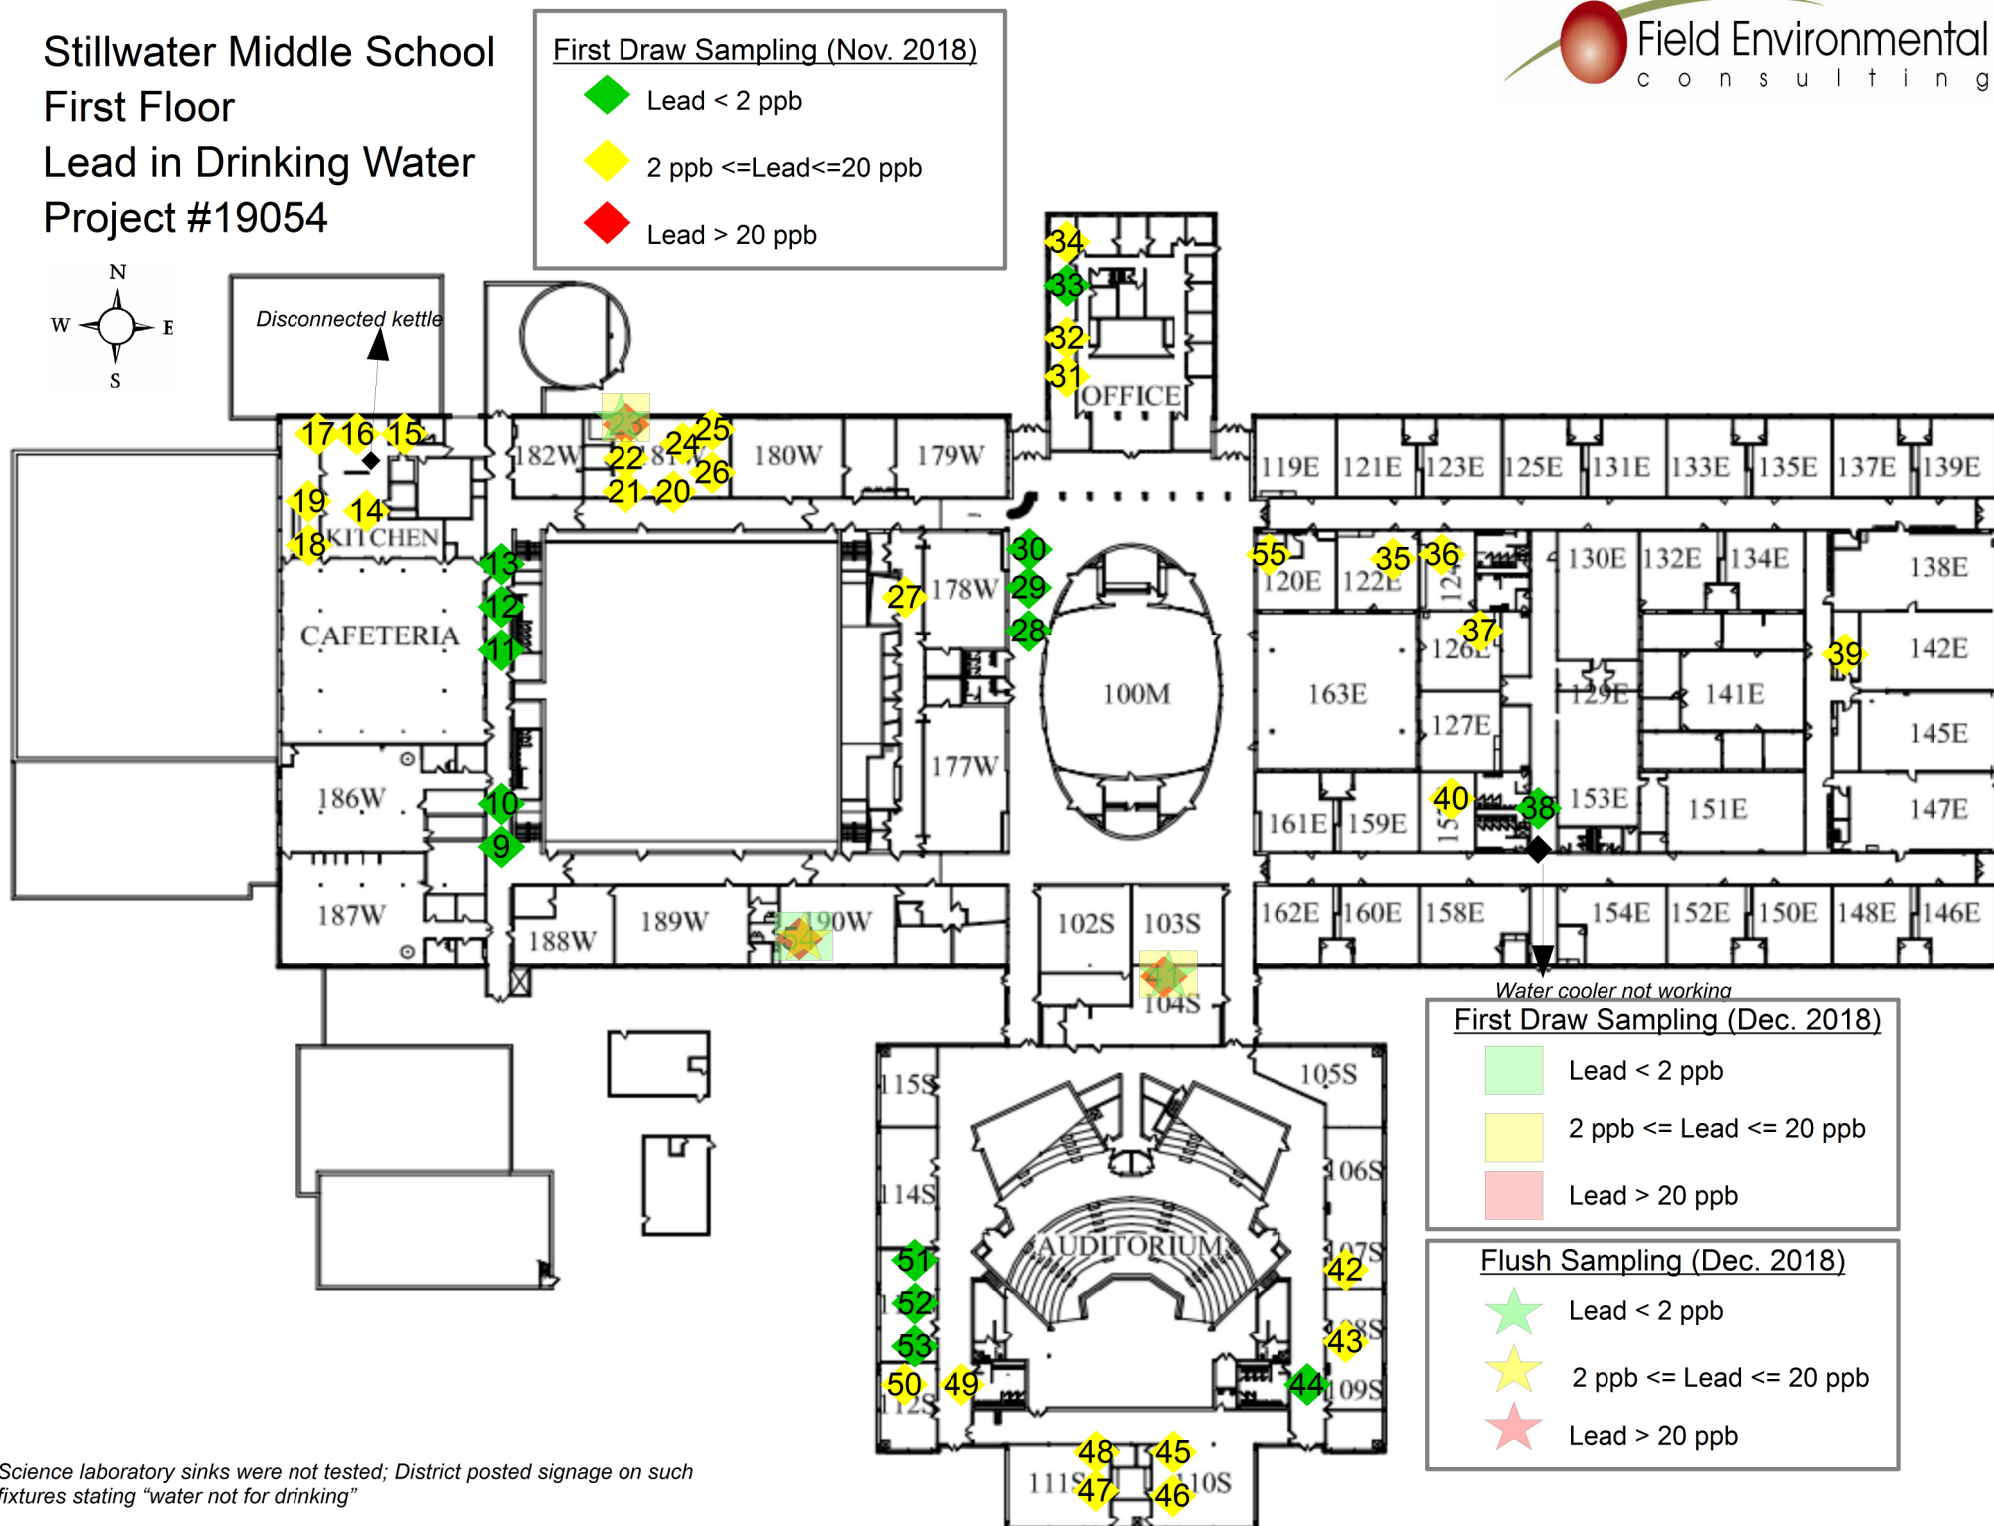


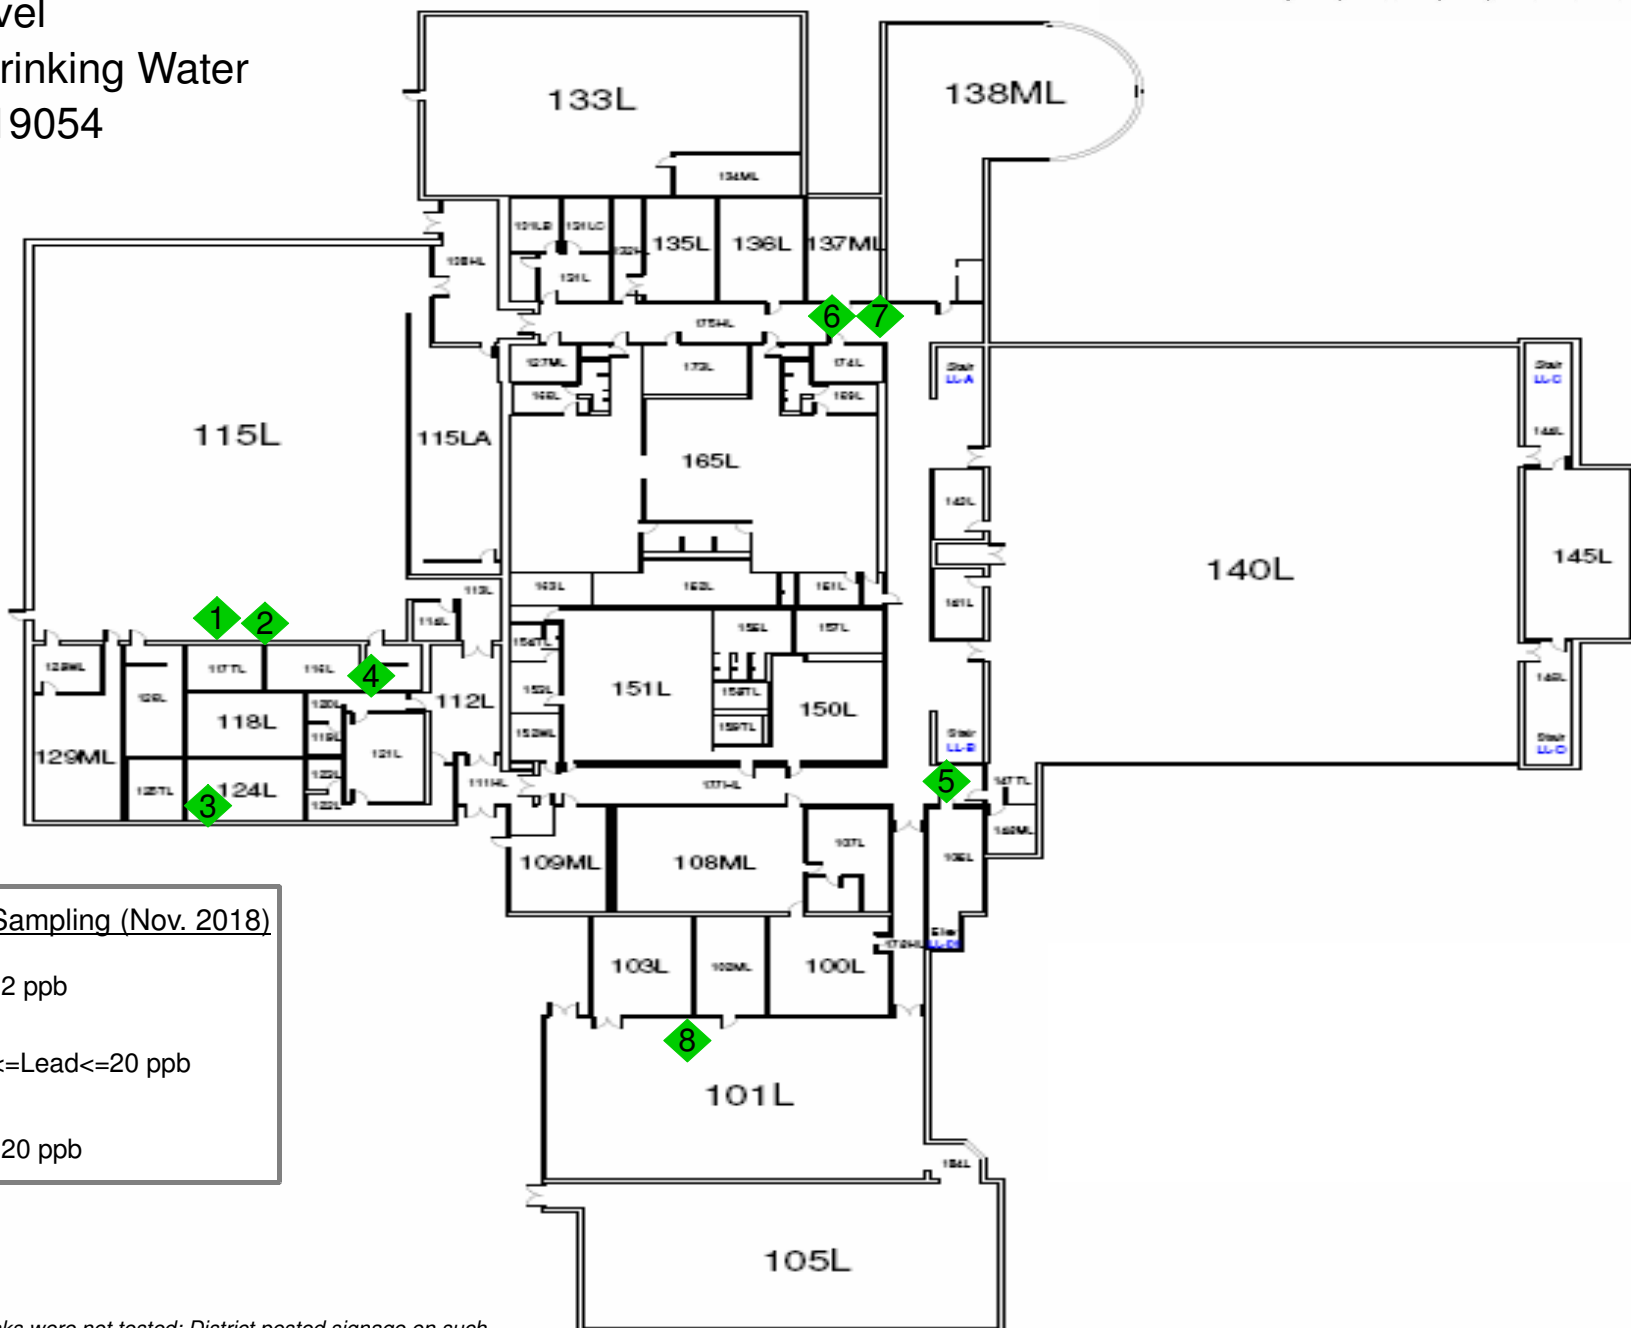

School Name: **Stillwater Middle School (SMS)**
 Date: **11/2/2018, 12/4/2018, 12/18/2018**

Floor	Room Number	Location	Sample ID	Type DF = Drinking Fountain S = Sink WC = Water Cooler BF = Bottle Filler K=Kettle	Lead Result 11/2/2018 (ppb)	Lead Result 12/4/2018 or 12/18/2018 (ppb)	Lead Result 30 Sec Flush 12/4/2018 or 12/18/2018 (ppb)	Lead Result 3 Min Flush 12/4/2018 or 12/18/2018 (ppb)
Lower	115L	Pool	1	BF	ND	-	-	-
Lower	115L	Pool	2	WC	ND	-	-	-
Lower	124L	Locker Room	3	WC	ND	-	-	-
Lower	116L	Locker Room	4	WC	ND	-	-	-
Lower	-	Hallway	5	WC	1.6	-	-	-
Lower	-	Hallway	6	BF	ND	-	-	-
Lower	-	Hallway	7	WC	ND	-	-	-
Lower	101L	Gym	8	F	1.1	-	-	-
First	-	Hallway	9	WC	ND	-	-	-
First	-	Hallway	10	BF	ND	-	-	-
First	-	Hallway	11	WC	ND	-	-	-
First	-	Hallway	12	BF	ND	-	-	-
First	-	Hallway	13	WC	ND	-	-	-
First	-	Kitchen- South	14	S	3.3	-	-	-
First	-	Kitchen-North West	15	S	2.4	-	-	-
First	-	Kitchen-North Middle	16	S	3.7	-	-	-
First	-	Kitchen- North East	17	S	2.4	-	-	-
First	-	Dish Room - South	18	SP	2.5	-	-	-
First	-	Dish Room - North	19	SP	2.7	-	-	-
First	180W	FACS Classroom-South	20	S	4.4	-	-	-
First	180W	FACS Classroom-West Wall South	21	S	6.4	-	-	-
First	180W	FACS Classroom-West Wall Middle	22	S	13.1	-	-	-
First	180W	FACS Classroom-West Wall North	23	S	22.8	8	0.43	1.1
First	180W	FACS Classroom- North	24	S	3.4	-	-	-
First	180W	FACS Classroom- East Wall North	25	S	11.9	-	-	-
First	180W	FACS Classroom-East Wall South	26	S	8.9	-	-	-
First	-	Hallway	27	WC	3	-	-	-
First	-	Hallway	28	WC	ND	-	-	-
First	-	Hallway	29	BF	ND	-	-	-
First	-	Hallway	30	WC	ND	-	-	-
First	-	Office-South	31	S	2.5	-	-	-
First	-	Office-South	32	T	2.7	-	-	-
First	-	Office-North	33	T	ND	-	-	-
First	-	Office-North	34	S	3.8	-	-	-
First	122E	Classroom	35	S	4.4	-	-	-
First	124E	Classroom	36	S	6.6	-	-	-
First	125E	Classroom	37	S	7.8	-	-	-
First	-	Hallway	38	WC	ND	-	-	-
First	142E	Prep	39	S	17.8	-	-	-
First	157E	Classroom	40	S	3.1	-	-	-
First	104S	Classroom	41	S	50.4	17.6	1.2	0.82
First	107S	Classroom	42	S	2.2	-	-	-
First	108S	Classroom	43	S	3.1	-	-	-
First	-	Hallway	44	WC	1.7	-	-	-
First	110S	Classroom-North	45	S	2.9	-	-	-
First	110S	Classroom- South	46	S	4.7	-	-	-
First	111S	Classroom-South	47	S	4.6	-	-	-
First	111S	Classroom-North	48	S	3.2	-	-	-
First	-	Hallway	49	F	6.3	-	-	-
First	112S	Classroom	50	S	2	-	-	-
First	113S	Classroom-North	51	S	1.3	-	-	-
First	113S	Classroom-Middle	52	S	1.6	-	-	-
First	113S	Classroom-South	53	S	1.3	-	-	-
First	190W	Orchestra	54	S	214	0.94	1.3	12.2
First	120E	Classroom	55	S	3.4	-	-	-




Stillwater Middle School First Floor Lead in Drinking Water Project #19054



Stillwater Middle School
Lower Level
Lead in Drinking Water
Project #19054



First Draw Sampling (Nov. 2018)

-  Lead < 2 ppb
-  2 ppb <= Lead <= 20 ppb
-  Lead > 20 ppb

Science laboratory sinks were not tested; District posted signage on such fixtures stating "water not for drinking"