

**School Name: Afton-Lakeland Elementary (AL)**

**Dates: 5/4/2018, 9/18/2018, 11/2/2018**

Floor	Room Number	Location	Sample ID	Type DF = Drinking Fountain S = Sink WC = Water Cooler BF = Bottle Filler K=Kettle	Lead Result 5/4/2018 (ppb)	Lead Result 9/18/2018 (ppb)	Lead Result 11/2/2018 (ppb)	Lead Result - 30 Sec Flush - 11/2/2018 (ppb)
First Floor	110	Kitchen	1	S	4.2	-	-	-
First Floor	110	Kitchen	2	S	14.4	-	-	-
First Floor	110	Kitchen	3	S	ND	-	-	-
First Floor	110	Kitchen	4	S	ND	-	-	-
First Floor	108	Cafeteria	5	WC	ND	-	-	-
First Floor	108	Cafeteria	6	BF	ND	-	-	-
First Floor	107	Classroom	7	S	24.1	1.5	-	-
First Floor	105	Classroom	8	S	10.9	-	-	-
First Floor	104	Classroom	9	S	9.2	-	-	-
First Floor	103	Classroom	10	S	13.7	-	-	-
First Floor	-	100 Hallway	11	WC	ND	-	-	-
First Floor	-	100 Hallway	12	BF	ND	-	-	-
First Floor	101	Classroom	13	S	9.5	-	-	-
First Floor	102	Classroom	14	S	11.6	-	-	-
First Floor	109	Classroom	15	S	12.4	-	-	-
First Floor	115	Classroom	16	S	11.5	-	-	-
First Floor	-	Hallway Outside 115	17	WC	ND	-	-	-
First Floor	-	Hallway Outside 115	18	BF	ND	-	-	-
First Floor	-	Nurse	19	S	4.1	-	-	-
First Floor	116	Classroom	20	S	11.2	-	-	-
First Floor	119	Classroom	21	S	14.5	-	-	-
First Floor	118	Classroom	22	S	11.1	-	-	-
First Floor	121	Classroom	23	S	4.9	-	-	-
First Floor	211	Staff Lounge	24	S	4.6	-	-	-
First Floor	-	200 Hallway	25	WC	ND	-	-	-
First Floor	-	200 Hallway	26	BF	ND	-	-	-
First Floor	207	Classroom	27	S	95.2	4.6	8.2	ND
First Floor	206	Classroom	28	S	6.7	-	-	-
First Floor	205	Classroom	29	S	16.3	-	-	-
First Floor	204	Classroom	30	S	24.6	10.1	3.2	ND
First Floor	203	Classroom	31	S	32.9	8.1	3.1	ND
First Floor	202	Classroom	32	S	40.7	5.7	1.8	ND
First Floor	305	Classroom	33	S	31.5	2.9	3.7	ND
First Floor	-	300 Hallway	34	BF	ND	-	-	-
First Floor	-	300 Hallway	35	WC	ND	-	-	-

School Name: **Afton-Lakeland Elementary (AL)**

Dates: **5/4/2018, 9/18/2018, 11/2/2018**

Floor	Room Number	Location	Sample ID	Type DF = Drinking Fountain S = Sink WC = Water Cooler BF = Bottle Filler K=Kettle	Lead Result 5/4/2018 (ppb)	Lead Result 9/18/2018 (ppb)	Lead Result 11/2/2018 (ppb)	Lead Result - 30 Sec Flush - 11/2/2018 (ppb)
First Floor	307	Classroom	36	S	5.2	-	-	-
First Floor	309	Classroom	37	S	5	-	-	-
First Floor	310	Classroom	38	S	2.1	-	-	-
First Floor	312	Classroom	39	S	ND	-	-	-
First Floor	311	Classroom	40	S	ND	-	-	-
First Floor	313	Classroom	41	S	6.1	-	-	-
First Floor	313	Classroom	42	S	2.1	-	-	-
First Floor	314	Classroom	43	S	18.5	-	-	-

**First Draw Sampling (May 2018)**


- ◆ Lead < 2 ppb
- ◆ 2 ppb <= Lead <= 20 ppb
- ◆ Lead > 20 ppb

**First Draw Sampling (Sep. 2018)**

- Lead < 2 ppb
- 2 ppb <= Lead <= 20 ppb
- Lead > 20 ppb

**Flush Sampling (Nov. 2018)**

- ★ Lead < 2 ppb
- ★ 2 ppb <= Lead <= 20 ppb
- ★ Lead > 20 ppb

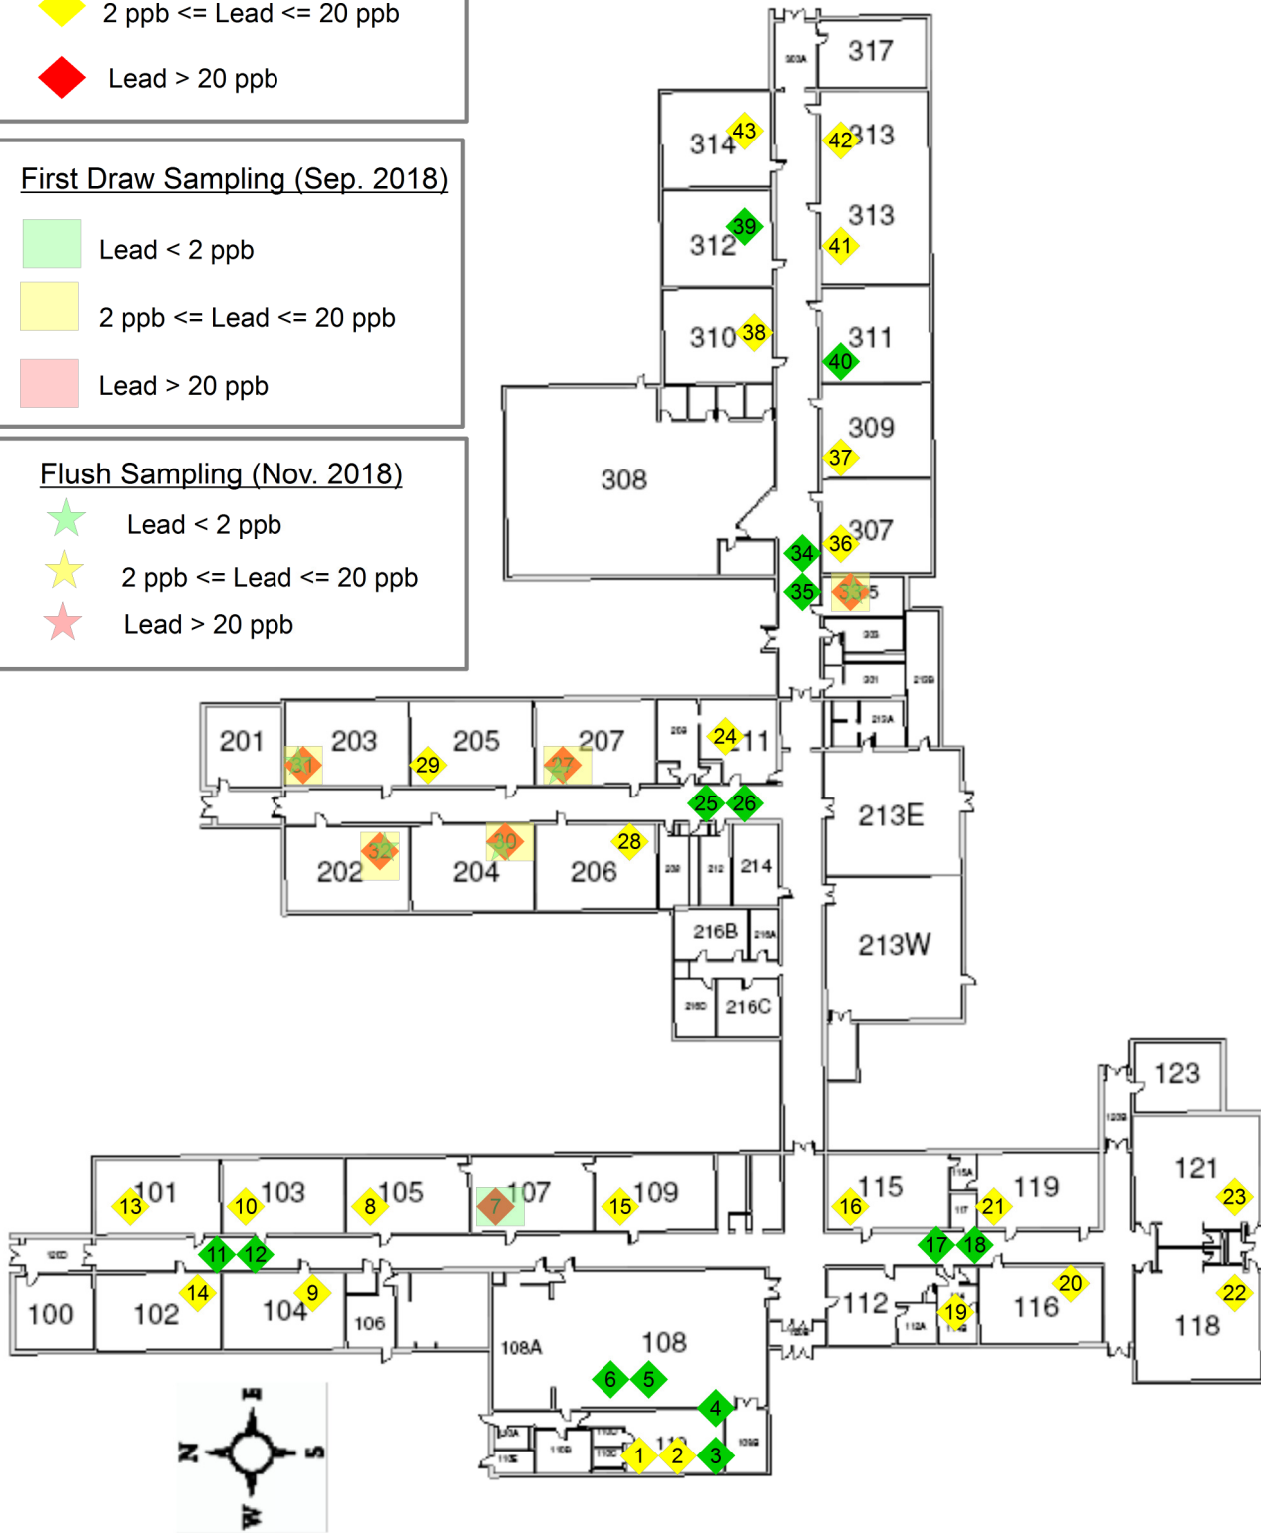

Afton-Lakeland Elementary  
 Lead in Drinking Water  
 Project #18115