


School Name: **Afton-Lakeland Elementary (AL)**  
 Date: **5/4/2018**

Floor	Room Number	Location	Sample ID	Type DF = Drinking Fountain S = Sink WC = Water Cooler BF = Bottle Filler K=Kettle	Lead Result (ppb)
First Floor	110	Kitchen	1	S	4.2
First Floor	110	Kitchen	2	S	14.4
First Floor	110	Kitchen	3	S	ND
First Floor	110	Kitchen	4	S	ND
First Floor	108	Cafeteria	5	WC	ND
First Floor	108	Cafeteria	6	BF	ND
First Floor	107	Classroom	7	S	24.1
First Floor	105	Classroom	8	S	10.9
First Floor	104	Classroom	9	S	9.2
First Floor	103	Classroom	10	S	13.7
First Floor	-	100 Hallway	11	WC	ND
First Floor	-	100 Hallway	12	BF	ND
First Floor	101	Classroom	13	S	9.5
First Floor	102	Classroom	14	S	11.6
First Floor	109	Classroom	15	S	12.4
First Floor	115	Classroom	16	S	11.5
First Floor	-	Hallway Outside 115	17	WC	ND
First Floor	-	Hallway Outside 115	18	BF	ND
First Floor	-	Nurse	19	S	4.1
First Floor	116	Classroom	20	S	11.2
First Floor	119	Classroom	21	S	14.5
First Floor	118	Classroom	22	S	11.1
First Floor	121	Classroom	23	S	4.9
First Floor	211	Staff Lounge	24	S	4.6
First Floor	-	200 Hallway	25	WC	ND
First Floor	-	200 Hallway	26	BF	ND
First Floor	207	Classroom	27	S	95.2
First Floor	206	Classroom	28	S	6.7
First Floor	205	Classroom	29	S	16.3
First Floor	204	Classroom	30	S	24.6
First Floor	203	Classroom	31	S	32.9
First Floor	202	Classroom	32	S	40.7
First Floor	305	Classroom	33	S	31.5
First Floor	-	300 Hallway	34	BF	ND
First Floor	-	300 Hallway	35	WC	ND
First Floor	307	Classroom	36	S	5.2
First Floor	309	Classroom	37	S	5
First Floor	310	Classroom	38	S	2.1
First Floor	312	Classroom	39	S	ND
First Floor	311	Classroom	40	S	ND
First Floor	313	Classroom	41	S	6.1
First Floor	313	Classroom	42	S	2.1
First Floor	314	Classroom	43	S	18.5

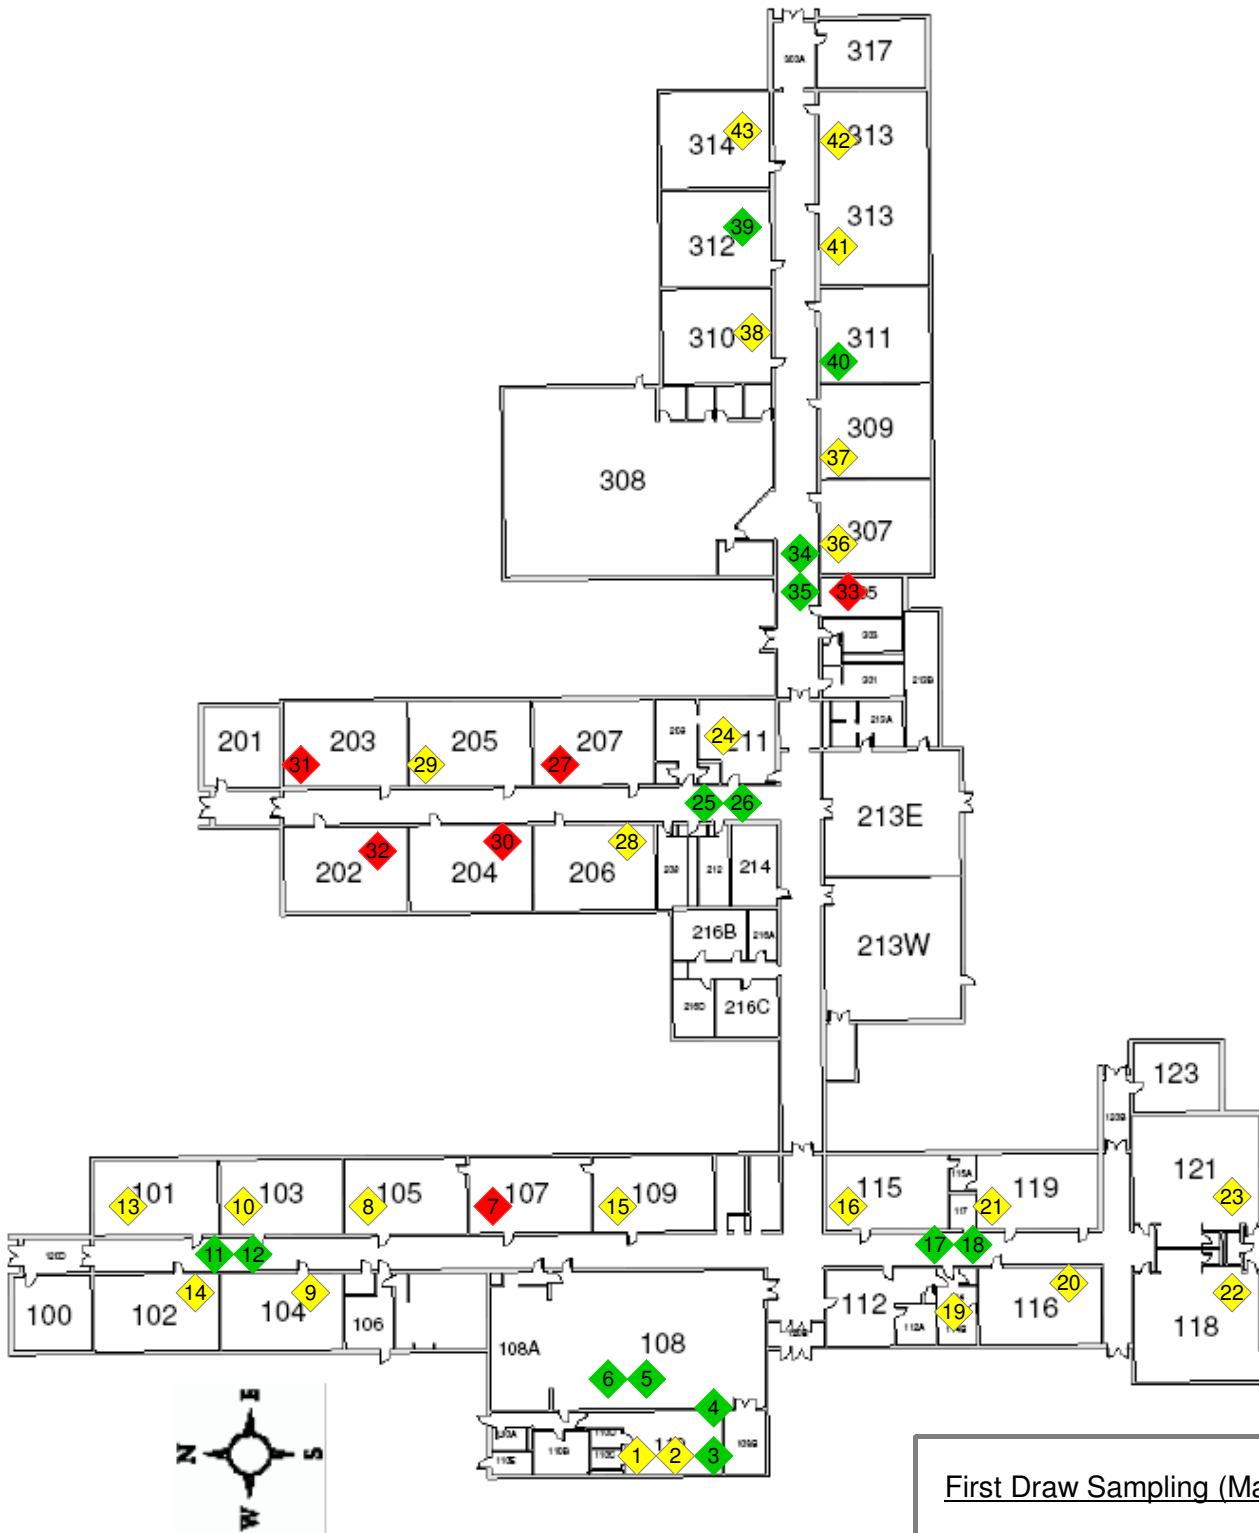

Afton-Lakeland Elementary  
Lead in Drinking Water  
Project #18115

**First Draw Sampling (May 2018)**

- ◆ Lead < 2 ppb
- ◆ 2 ppb <= Lead <= 20 ppb
- ◆ Lead > 20 ppb