



School Name: **Anderson Elementary (AN)**
 Date: **5/4/2018**

Floor	Room Number	Location	Sample ID	Type DF = Drinking Fountain S = Sink WC = Water Cooler BF = Bottle Filler K=Kettle	Lead Result (ppb)
First Floor	-	Kitchen	1	S	ND
First Floor	-	Kitchen	2	S	ND
First Floor	-	Kitchen	3	S	ND
First Floor	-	Kitchen	4	S	ND
First Floor	101A	Classroom	5	S	ND
First Floor	-	Hallway Outside 101	6	DF	ND
First Floor	102A	Classroom	7	S	ND
First Floor	104	Classroom	8	S	ND
First Floor	-	Hallway Outside 104	9	BF	ND
First Floor	-	Hallway Outside 104	10	WC	ND
First Floor	-	Hallway Outside 106	11	DF	ND
First Floor	133	Classroom	12	S	ND
First Floor	107	Classroom	13	S	ND
First Floor	107	Classroom	14	DF	ND
First Floor	107	Classroom	15	S	ND
First Floor	108	Classroom	16	S	ND
First Floor	109	Classroom	17	S	ND
Second Floor	201	Classroom	18	S	ND
Second Floor	-	Hallway Outside 201	19	WC	ND
Second Floor	202	Classroom	20	S	ND
Second Floor	-	Staff Lounge	21	S	ND
Second Floor	203	Classroom	22	S	ND
Second Floor	204	Classroom	23	S	ND
Second Floor	205	Classroom	24	S	ND
Second Floor	-	Hallway Outside 206	25	WC	ND
Second Floor	-	Hallway Outside 206	26	BF	ND
Second Floor	206	Classroom	27	S	ND
First Floor	-	Nurse	28	S	ND
Second Floor	207	Classroom	29	S	ND
Second Floor	208	Classroom	30	S	ND

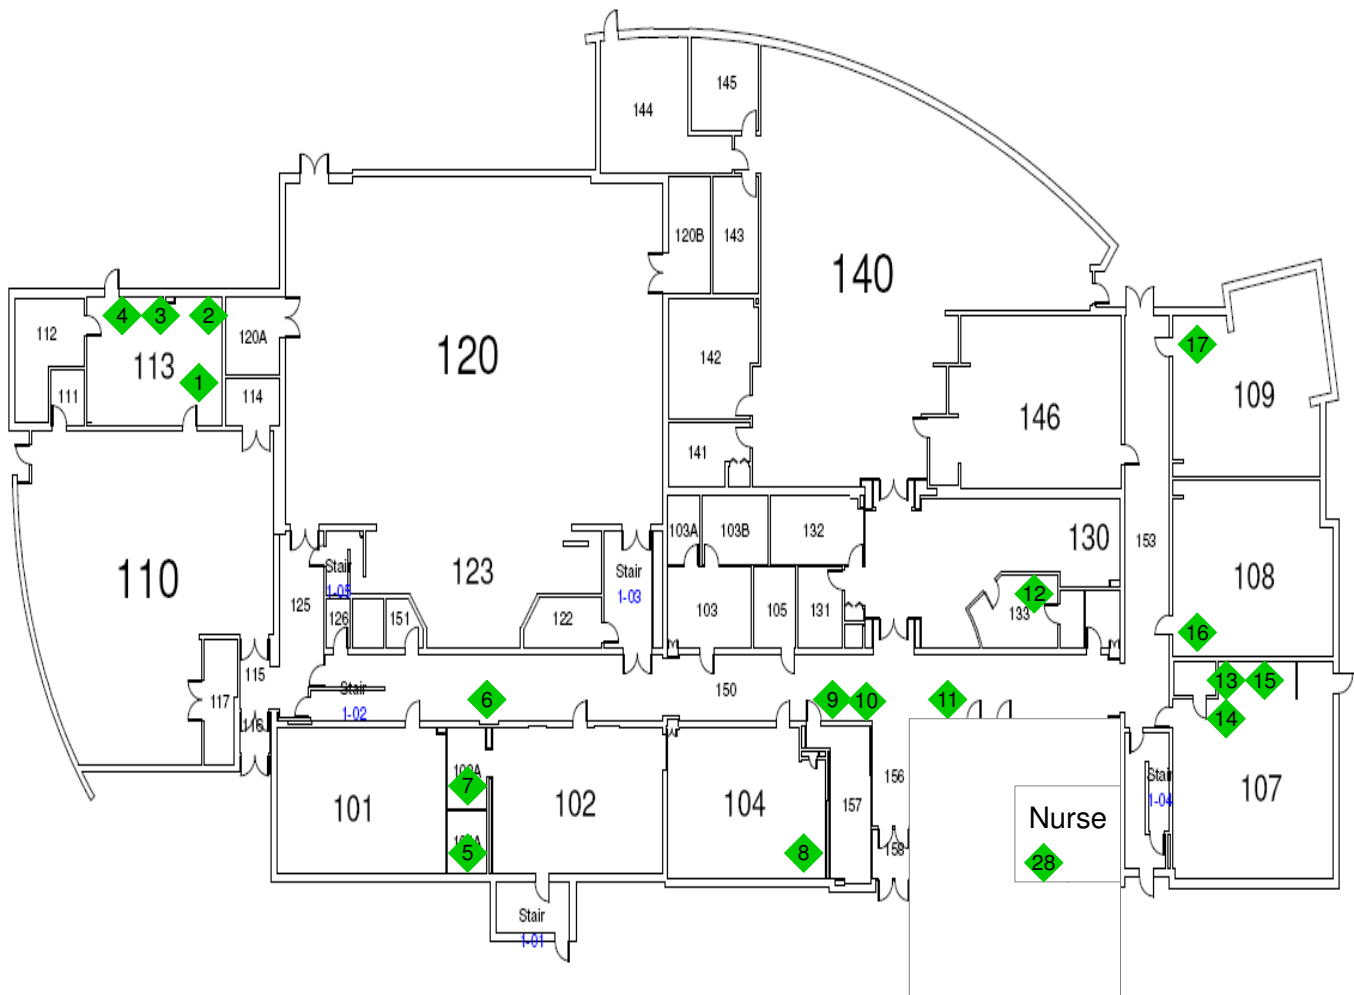


Anderson Elementary
Lead in Drinking Water
First Floor
Project #18115



First Draw Sampling (May 2018)

- ◆ Lead < 2 ppb
- ◆ 2 ppb <= Lead <= 20 ppb
- ◆ Lead > 20 ppb



Anderson Elementary
 Lead in Drinking Water
 Second Floor
 Project #18115

First Draw Sampling (May 2018)

- ◆ Lead < 2 ppb
- ◆ 2 ppb <= Lead <= 20 ppb
- ◆ Lead > 20 ppb