



8612 Eagle Creek Parkway, Savage, MN 55378
Tel: (952) 746-5880 ♦ Fax: (952) 746-5882
Mailbox@FieldConsultingInc.com
www.FieldConsultingInc.com

Independent School District #191
200 Burnsville Pkwy
Burnsville, MN 55337
Attn: Mr. Glenn Simon

RE: Lead in Drinking Water Sampling
SITE: Harriet Bishop Elementary
DATE: January 2019

Dear Glenn Simon,

Field Environmental Consulting, Inc. (FIELD ENVIRONMENTAL) appreciates the opportunity to provide results for lead in drinking water sampling conducted at Harriet Bishop Elementary.

Initial sampling ("first draw") was completed on Friday, October 26, 2018⁺. One (1) out of the forty-seven (47) initial first draw samples collected at Harriet Bishop Elementary School was above the recommended limit of 20 ppb. Provided with results, ISD #191 cleaned the aerator for the identified tap within Linden 1. After aerator cleaning was completed, ISD #191 re-sampled this tap on November 29, 2018. The re-sampling result was below the recommended limit of 20 ppb.

Analysis was conducted by Pace Analytical Services, Inc. of Minneapolis, Minnesota using EPA Method 200.8 ICPMS for determination of trace elements in drinking water.

PREPARED and REVIEWED BY:

Field Environmental Consulting, Inc.

A handwritten signature in cursive script that reads "Amy Weinzierl".

Amy Weinzierl (CSP #27824)
Environmental Health and Safety Manager
amy@fieldconsultinginc.com
952-746-5880

*sampling was performed by ISD #191 Health & Safety Supervisor

LEAD IN THE WATER TESTING**BUILDING: Harriet Bishop LL****DATE 10/26/2018**

TYPE OF FAUCET WC - water cooler DF - drinking fountain S - Sink K - Kettle BF - Bottle Filler HW - Hot Water Dispenser

Lead < = 20 ppb, Lead > 20 ppb (Action Level), ND= None Detected

	LABEL	BUILDING	ROOM/LOCATION	TYPE OF FAUCET	LEAD RESULT (ppb or µg/L)
1	01	HB	Kitchen by steamer	K	ND
2	02	HB	Oven side of island	S	9.7
3	03	HB	Sinks closer to walk in cooler	S (sprayer)	4.3
4	04	HB	Sinks closer to walk in cooler	S	9.5
5	05	HB	Left WC outside gym	WC	ND
6	06	HB	Right WC outside gym	WC	ND
7	07	HB	RO Ctr	WC	ND
8	08	HB	Red Oak 1	S	3.8
9	09	HB	Red Oak 2	S	1.4
10	10	HB	Red Oak 3	S	ND
11	11	HB	Red Oak 4	S	3.0
12	12	HB	River Birch Ctr	WC	ND
13	13	HB	River Birch	S	1.8
14	14	HB	River Birch 2	S	3.0
15	15	HB	River Birch 3	S	2.5
16	16	HB	River Birch 4	S	2.7
17	17	HB	River Birch 5	S	2.2
18	18	HB	Media Ctr workroom	S	2.4
19	19	HB	Willow Ctr	WC	ND
20	20	HB	Willow 1	S	6.0
21	21	HB	Willow 2	S	8.6
22	22	HB	Willow 3	S	4.0
23	23	HB	Willow 4	S	4.0
24	24	HB	Staff Lounge	S	1.8


LEAD IN THE WATER TESTING**BUILDING: Harriet Bishop UL****DATE 10/26/2018**

TYPE OF FAUCET WC - water cooler DF - drinking fountain S - Sink K - Kettle BF - Bottle Filler HW - Hot Water Dispenser

Lead < = 20 ppb, Lead > 20 ppb (Action Level), ND= None Detected

	LABEL	BUILDING	ROOM/LOCATION	TYPE OF FAUCET	LEAD RESULT (ppb or µg/L)
1	25	HBE	Nurses Office	S	1.3
2	26	HB	Staff Resource	S	3.4
3	27	HB	In hallway outside Linden	WC	ND
4	28	HB	Linden Ctr	WC	ND
5	29	HB	Linden 1	S	26.5
29- Resample 11/29/2018					.87
6	30	HB	Linden 2	S	4.5
7	31	HB	Linden 3	S	2.1
8	32	HB	Linden 4	S	4.3
9	33	HB	Linden 5	S	2.3
10	34	HB	Maple Ctr	WC	ND
11	35	HB	Maple 1	S	7.4
12	36	HB	Maple 2	S	6.0
13	37	HB	Maple 3	S	3.3
14	38	HB	Maple 4	S	3.8
15	39	HB	Maple 5	S	2.2
16	40	HB	Multi-Purpose Room Left	S	10.4
17	41	HB	Multi-Purpose Room Right	S	15.0
18	42	HB	Norway Pine Ctr	WC	ND
19	43	HB	Norway Pine 1	S	1.2
20	44	HB	Norway Pine 2	S	1.7
21	45	HB	Norway Pine 3	S	2.3
22	46	HB	Norway Pine 4	S	2.5
23	47	HB	Norway Pine 5	S	2.3

Harriet Bishop Elementary

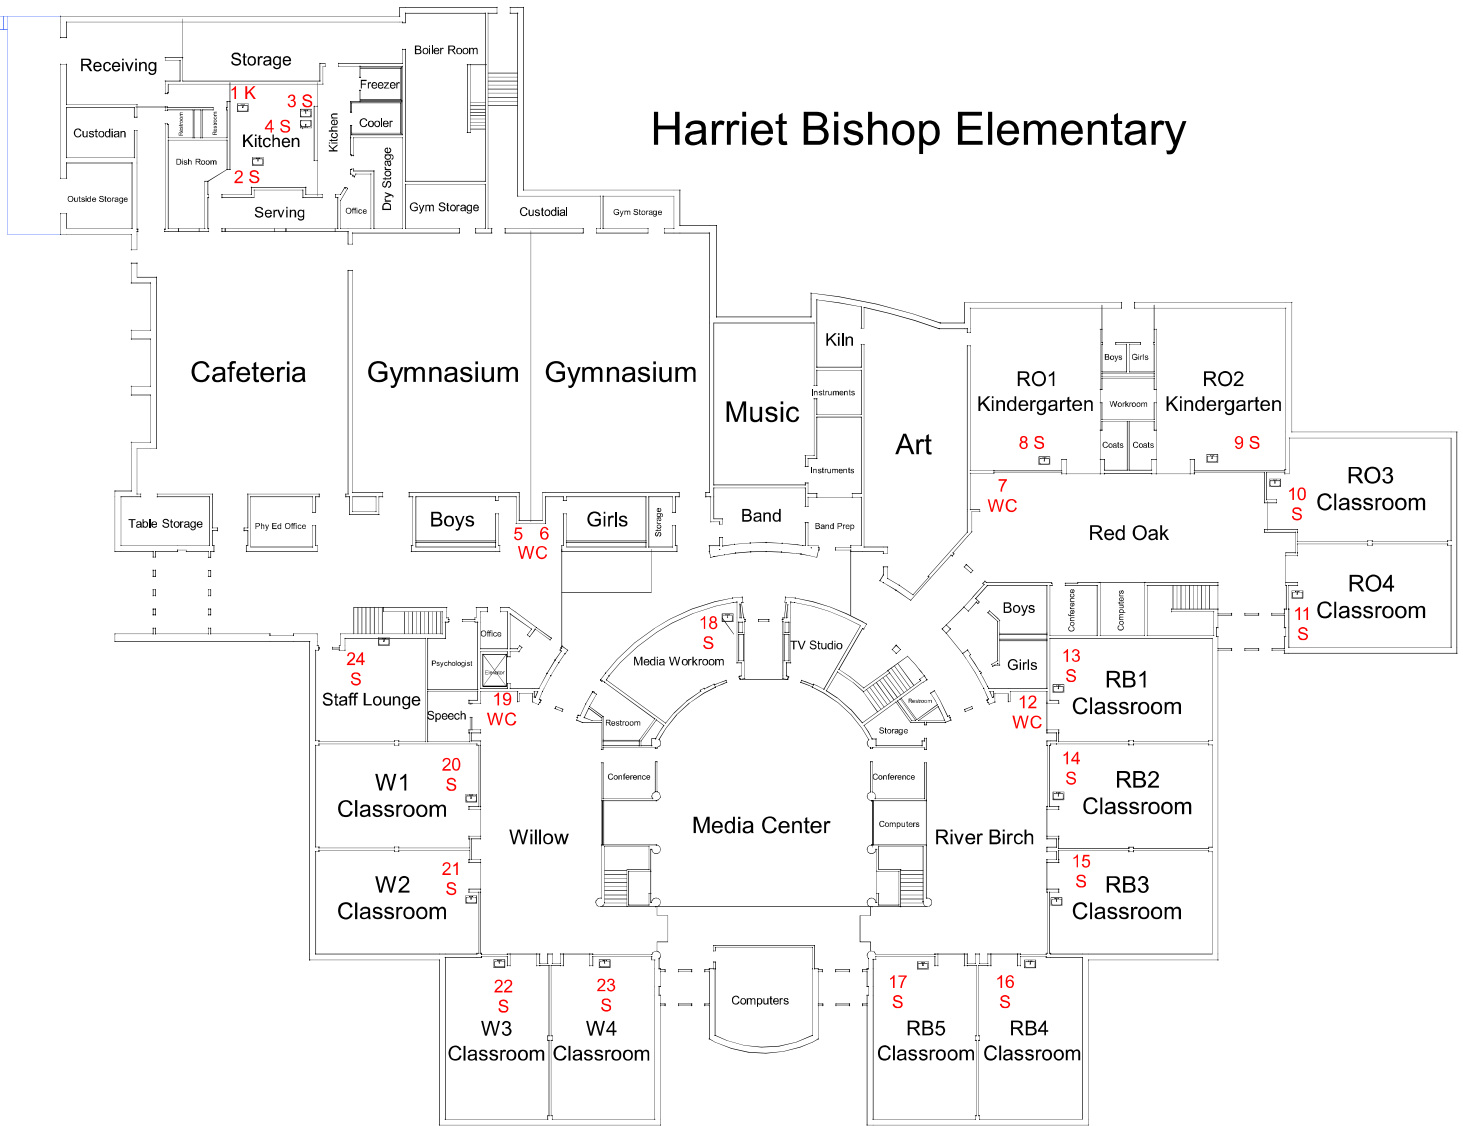

Harriet Bishop Elementary

