



8612 Eagle Creek Parkway, Savage, MN 55378
Tel: (952) 746-5880 ♦ Fax: (952) 746-5882
Mailbox@FieldConsultingInc.com
www.FieldConsultingInc.com

Independent School District #191
200 Burnsville Pkwy
Burnsville, MN 55337
Attn: Mr. Glenn Simon

RE: Lead in Drinking Water Sampling
SITE: Cedar Alternative
DATE: January 2019

Dear Glenn Simon,

Field Environmental Consulting, Inc. (FIELD ENVIRONMENTAL) appreciates the opportunity to provide results for lead in drinking water sampling conducted at Cedar Alternative.

Initial sampling ("first draw") was completed on Tuesday, October 30, 2018*. All ten (10) initial first draw samples collected at Cedar Alternative were below the recommended limit of 20 ppb (or µg/L).

Analysis was conducted by Pace Analytical Services, Inc. of Minneapolis, Minnesota using EPA Method 200.8 ICPMS for determination of trace elements in drinking water.

PREPARED and REVIEWED BY:

Field Environmental Consulting, Inc.

A handwritten signature in cursive script that reads "Amy Weinzierl".

Amy Weinzierl (CSP #27824)
Environmental Health and Safety Manager
amy@fieldconsultinginc.com
952-746-5880


*sampling was performed by ISD #191 Health & Safety Supervisor

LEAD IN THE WATER TESTING**BUILDING: CEDAR****DATE:10/30/2018**

TYPE OF FAUCET WC - water cooler DF - drinking fountain S - Sink K - Kettle BF - Bottle Filler

Lead < = 20 ppb, **Lead > 20 ppb** (Action Level), ND= None Detected

	LABEL	BUILDING	ROOM/LOCATION	TYPE OF FAUCET	LEAD RESULT (ppb or µg/L)
1	01	CA	Nurse's Office	S	ND
2	02	CA	203	S	3.5
3	03	CA	WC outside the main office	WC	0.91
4	04	CA	WC outside girls bathroom, across the hall from 111 , left	WC	ND
5	05	CA	WC outside girls bathroom, across the hall from 111 , right	WC	ND
6	06	CA	Staff Lounge by media center	S	3.4
7	07	CA	305	S	0.78
8	08	CA	WC outside girls bathroom, across the hall from 315 , left	WC	ND
9	09	CA	WC outside girls bathroom, across the hall from 315 , right	WC	ND
10	10	CA	215 Staff Lounge	S	0.55

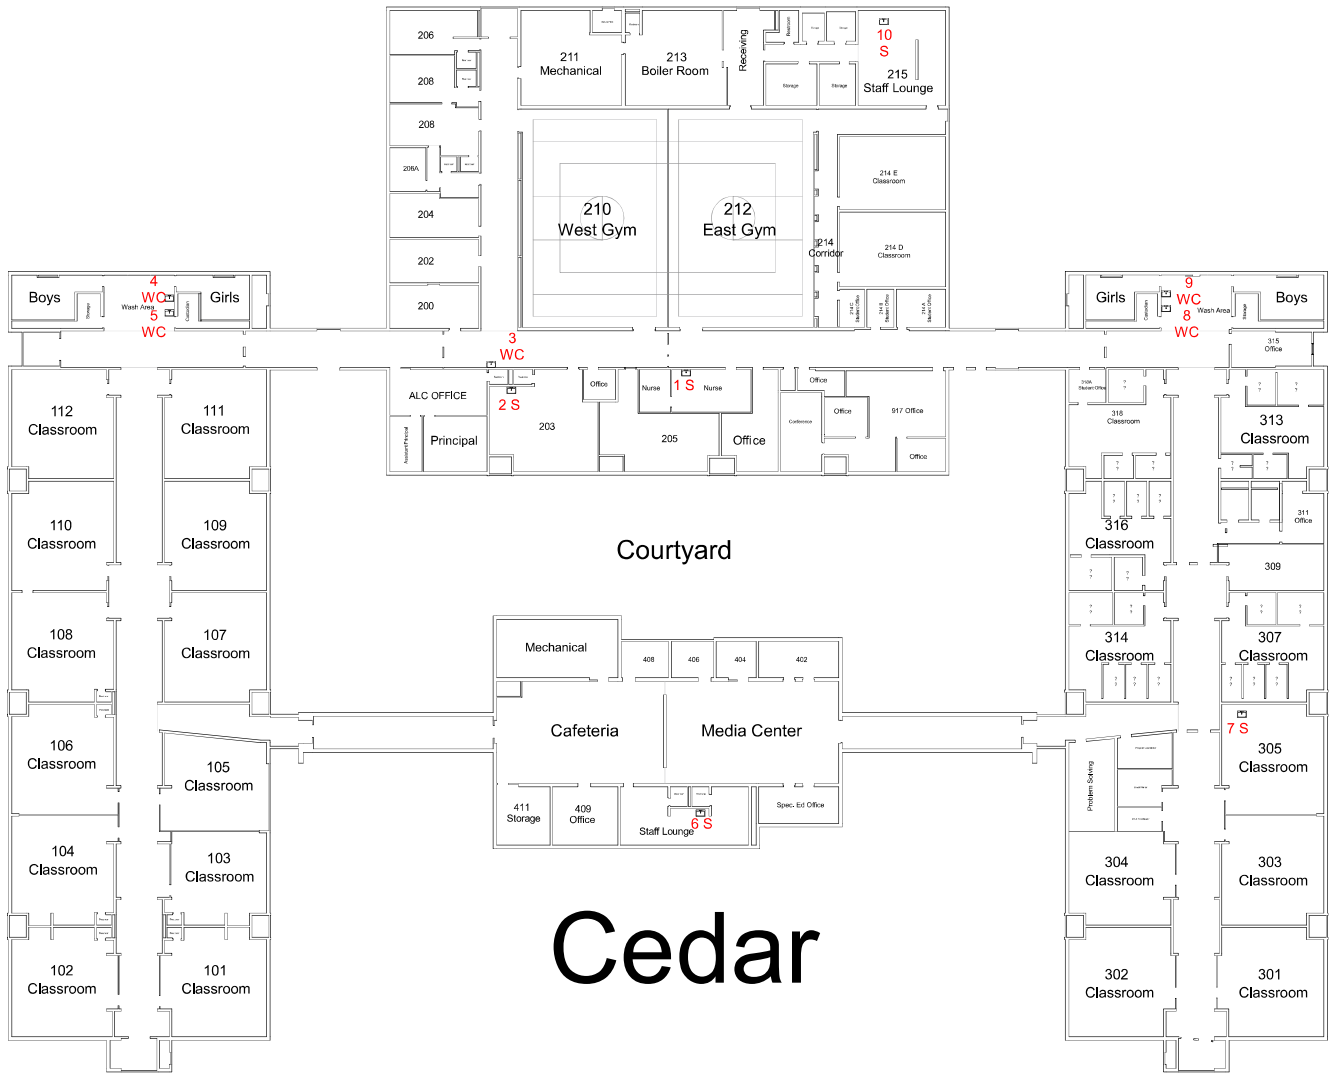

Cedar

First Floor