

“A samples” exceeded the action level, no “B samples” were analyzed. A table listing the analytical results by outlet sampled is included in Appendix B.

Recommendations

With no detection above the action level at this school, no further action is recommended.

TRC appreciates the opportunity to assist MMSD with this project. If you have any questions or comments concerning this report, please call James at (608) 826-3666.

Sincerely,

TRC Environmental Corporation




James E. Wedekind, P.G.
Project Manager



John B. Tweddale, P.G., CHMM
Principal Consultant

cc: Mike MacDonald

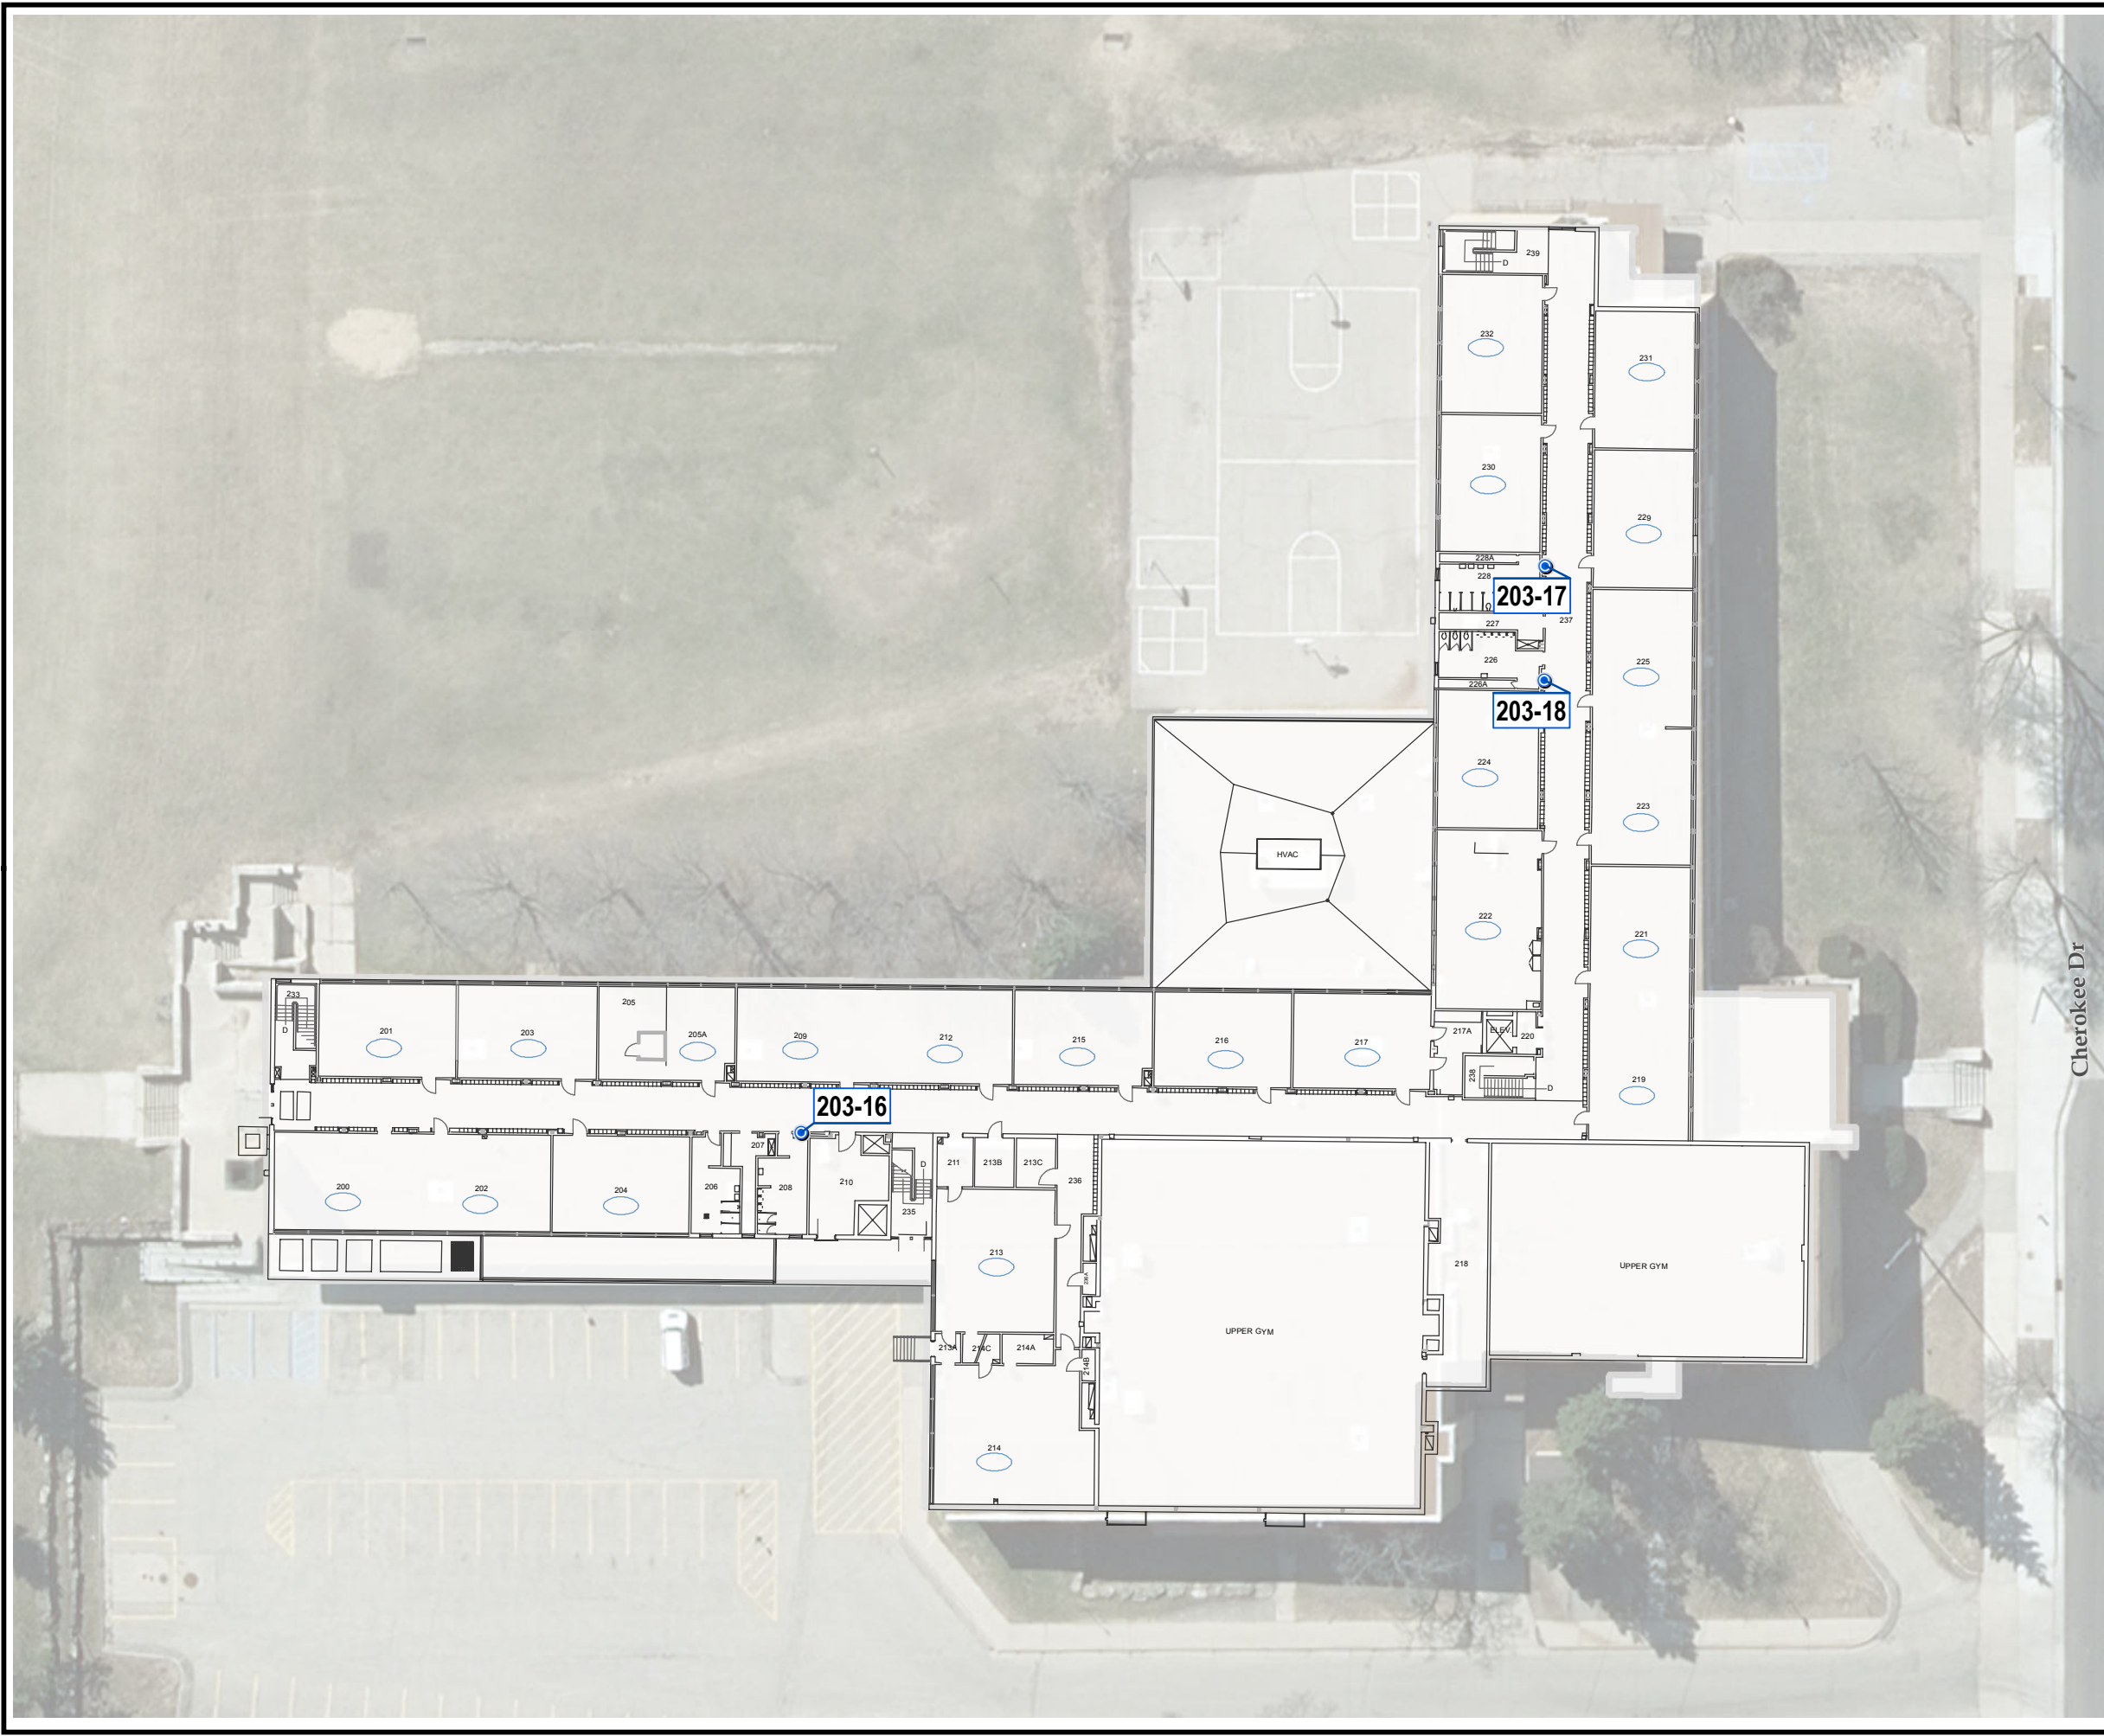


LEGEND

- WATER SAMPLE LOCATION

NOTES

1. BASE MAP IMAGERY FROM DANE COUNTY, 2014.
2. SCHOOL FACILITIES PLAN DRAWINGS SUPPLIED BY MMSD.
3. SAMPLE LOCATIONS AND FEATURES SHOWN ARE APPROXIMATE.

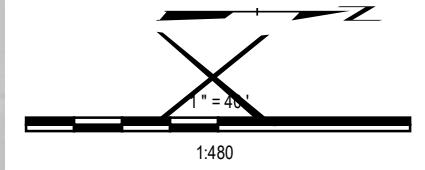

| | | | |
|--------------|----------------|---|--------|
| PROJECT: | | MMSD WATER SAMPLING | |
| TITLE: | | CHEROKEE (203) FLOOR 2 SAMPLES | |
| DRAWN BY: | J. PAPEZ | PROJ NO.: | 274235 |
| CHECKED BY: | A. SCHROEDER | FIGURE 1.C | |
| APPROVED BY: | J. WEDEKIND | | |
| DATE: | APRIL 2017 | | |
| | | 708 Heartland Trail, Suite 3000 Madison, WI 53717 Phone: 608.826.3600 www.trcsolutions.com | |
| FILE NO.: | MMSD_FINAL.mxd | | |

Appendix B
Analytical Results

Table 1
 Summary of Lead Results
 Cherokee - 203
 Madison, Wisconsin

| SAMPLE NUMBER | FIXTURE TYPE | SAMPLE DATE | LEAD CONCENTRATION (ppb) |
|---------------|--------------------|-------------|--------------------------|
| 203-1-A | Faucet/sink | 03/18/2017 | 0.65 |
| 203-2-A | Service connection | 03/18/2017 | 0.80 |
| 203-3-A | Water cooler | 03/18/2017 | 0.32 |
| 203-4-A | Bubbler/fountain | 03/18/2017 | 6.4 |
| 203-5-A | Bubbler/fountain | 03/18/2017 | 0.79 |
| 203-6-A | Faucet/sink | 03/18/2017 | 2.0 |
| 203-7-A | Faucet/sink | 03/18/2017 | 1.6 |
| 203-8-A | Faucet/sink | 03/18/2017 | 1.7 |
| 203-9-A | Faucet/sink | 03/18/2017 | 4.2 |
| 203-10-A | Faucet/sink | 03/18/2017 | 1.2 |
| 203-11-A | Faucet/sink | 03/18/2017 | 3.4 |
| 203-12-A | Faucet/sink | 03/18/2017 | 1.3 |
| 203-14-A | Water cooler | 03/18/2017 | 0.17 J |
| 203-15-A | Water cooler | 03/18/2017 | 0.21 J |
| 203-16-A | Water cooler | 03/18/2017 | 0.44 |
| 203-17-A | Bubbler/fountain | 03/18/2017 | 5.0 |
| 203-18-A | Water cooler | 03/18/2017 | 0.16 J |
| 203-19-A | Faucet/sink | 03/18/2017 | 0.76 |
| 203-20-A | Bubbler/fountain | 03/18/2017 | 2.6 |
| 203-21-A | Bubbler/fountain | 03/18/2017 | 1.9 |
| 203-22-A | Service connection | 03/18/2017 | 12 |

Notes:

1. Flush Sample (B) is only analyzed if the First Draw Sample (A) met or exceeded 15 ppb.
2. Service connection samples are flush samples (one per sample point), but sample IDs end with "A".
3. Samples were not able to be collected at sample point 13 (flow too low).
4. J indicates that result is less than the reporting limit but greater than or equal to the method detection limit, and the concentration is an approximate value.
5. The sample number is derived with the MMSD school identification number (e.g., 010) followed by a unique sample point identifier (e.g., 1, 2, 3, etc.). Fixtures with multiple taps include an additional locator (e.g., TAP 1, TAP 2). The first draw sample is then identified with the "A" suffix and the flush sample identified with a "B" suffix.

Created by: LCA 3/31/17
 Checked by: AES 3/31/17