

Project No. 2021_097

MIDLOTHIAN ISD ARCHITECTURAL SERVICES

ADDENDUM NO. 1

JUNE 17, 2021

GENERAL: The following changes, additions or deletions for the above project shall be made to the Contract Documents; all other Conditions shall remain the same. Note: the additions, deletions or changes listed in this Addendum may affect more than the specific instance(s) mentioned. Coordination may be necessary to fully revise cases of duplicate information. The Addendum supersedes current conditions shown. Acknowledge receipt of this Addendum. This addendum forms a part of the Contract Documents and modifies them as follows:

A1.1 PRE-PROPOSAL SIGN IN SHEET:
See attached Pre-Proposal Sign In Sheet.


SPECIFICATIONS

A1.2: INSTRUCTION TO BIDDERS:
Page 12, DELETED second bullet point in its entirety.

A1.3: SECTION 08 7100 DOOR HARDWARE:
REPLACE Section in its entirety.

ATTACHMENTS:

Pre-Proposal Sign in Sheet
Spec Section 08 7100, Door Hardware

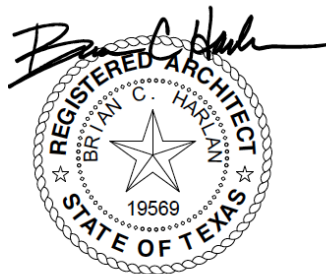

2021-020 Safety & Security Upgrades

	Company Name	Representative Name	Date	Contact Number	Email
1	MISD	Rola Fadel	6/8/21	817-233-2627	rola.fadel@misd.gs
2	Orcutt / Winslow	Brian Harlan	6/8/21	817-235-8364	harlanb@owp.com
3	Orcutt / Winslow	Khoi Nguyen	6/8/21	214-396-2090	nguyen.k@owp.com
4	PETE DURANT & ASSOC.	KENDALL JEMENS	6/8/21	817-999-5532	Kendall@petedurant.com
5	MISD	Shana Volentine	6/8/21	469-856-5032	shana_volentine@misd.gs
6	Phillips / May Corp	Christopher Escobedo	6/8/21	214 354-8915	christopher@phillipsmay.com
7					
8					
9					
10					
11					
12					
13					
14					
15					
16					

SECTION 08 7100

DOOR HARDWARE

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes commercial door hardware for the following:
 - 1. Swinging doors.
- B. Door hardware includes, but is not necessarily limited to, the following:
 - 1. Mechanical door hardware.
- C. Related Sections:
 - 1. Division 08 Section "Hollow Metal Doors and Frames".
 - 2. Division 08 Section "Flush Wood Doors".
 - 3. Division 08 Section "Sound Control Hollow Metal Door Assemblies".
 - 4. Division 08 Section "Sound Control Wood Door Assemblies".
- D. Codes and References: Comply with the version year adopted by the Authority Having Jurisdiction.
 - 1. ANSI A117.1 - Accessible and Usable Buildings and Facilities.
 - 2. ICC/IBC - International Building Code.
 - 3. NFPA 70 - National Electrical Code.
 - 4. NFPA 80 - Fire Doors and Windows.
 - 5. NFPA 101 - Life Safety Code.
 - 6. NFPA 105 - Installation of Smoke Door Assemblies.
 - 7. State Building Codes, Local Amendments.
- E. Standards: All hardware specified herein shall comply with the following industry standards as applicable. Any undated reference to a standard shall be interpreted as referring to the latest edition of that standard:
 - 1. ANSI/BHMA Certified Product Standards - A156 Series.
 - 2. UL10C - Positive Pressure Fire Tests of Door Assemblies.
 - 3. ANSI/UL 294 - Access Control System Units.
 - 4. UL 305 - Panic Hardware.
 - 5. ANSI/UL 437- Key Locks.

1.3 SUBMITTALS

- A. Product Data: Manufacturer's product data sheets including installation details, material descriptions, dimensions of individual components and profiles, operational descriptions and finishes.

- B. Door Hardware Schedule: Prepared by or under the supervision of supplier, detailing fabrication and assembly of door hardware, as well as procedures and diagrams. Coordinate the final Door Hardware Schedule with doors, frames, and related work to ensure proper size, thickness, hand, function, and finish of door hardware.
1. Format: Comply with scheduling sequence and vertical format in DHI's "Sequence and Format for the Hardware Schedule."
 2. Organization: Organize the Door Hardware Schedule into door hardware sets indicating complete designations of every item required for each door or opening. Organize door hardware sets in same order as in the Door Hardware Sets at the end of Part 3. Submittals that do not follow the same format and order as the Door Hardware Sets will be rejected and subject to resubmission.
 3. Content: Include the following information:
 - a. Type, style, function, size, label, hand, and finish of each door hardware item.
 - b. Manufacturer of each item.
 - c. Fastenings and other pertinent information.
 - d. Location of door hardware set, cross-referenced to Drawings, both on floor plans and in door and frame schedule.
 - e. Explanation of abbreviations, symbols, and codes contained in schedule.
 - f. Mounting locations for door hardware.
 - g. Door and frame sizes and materials.
 - h. Warranty information for each product.
 4. Submittal Sequence: Submit the final Door Hardware Schedule at earliest possible date, particularly where approval of the Door Hardware Schedule must precede fabrication of other work that is critical in the Project construction schedule. Include Product Data, Samples, Shop Drawings of other work affected by door hardware, and other information essential to the coordinated review of the Door Hardware Schedule.
- C. Keying Schedule: After a keying meeting with the owner has taken place prepare a separate keying schedule detailing final instructions. Submit the keying schedule in electronic format. Include keying system explanation, door numbers, key set symbols, hardware set numbers and special instructions. Owner must approve submitted keying schedule prior to the ordering of permanent cylinders/cores.
- D. Informational Submittals:
1. Product Test Reports: Indicating compliance with cycle testing requirements, based on evaluation of comprehensive tests performed by manufacturer and witnessed by a qualified independent testing agency.
- E. Operating and Maintenance Manuals: Provide manufacturers operating and maintenance manuals for each item comprising the complete door hardware installation in quantity as required in Division 01, Closeout Procedures.

1.4 QUALITY ASSURANCE

- A. Manufacturers Qualifications: Engage qualified manufacturers with a minimum 5 years of documented experience in producing hardware and equipment similar to that indicated for this Project and that have a proven record of successful in-service performance.

- B. Certified Products: Where specified, products must maintain a current listing in the Builders Hardware Manufacturers Association (BHMA) Certified Products Directory (CPD).
- C. Installer Qualifications: A minimum 3 years documented experience installing both standard and electrified door hardware similar in material, design, and extent to that indicated for this Project and whose work has resulted in construction with a record of successful in-service performance.
- D. Door Hardware Supplier Qualifications: Experienced commercial door hardware distributors with a minimum 5 years documented experience supplying both mechanical and electromechanical hardware installations comparable in material, design, and extent to that indicated for this Project. Supplier recognized as a factory direct distributor by the manufacturers of the primary materials with a warehousing facility in Project's vicinity. Supplier to have on staff a certified Architectural Hardware Consultant (AHC) available during the course of the Work to consult with Contractor, Architect, and Owner concerning both standard and electromechanical door hardware and keying.
- E. Each unit to bear third party permanent label demonstrating compliance with the referenced standards.
- F. Keying Conference: Conduct conference to comply with requirements in Division 01 Section "Project Meetings." Keying conference to incorporate the following criteria into the final keying schedule document:
 - 1. Function of building, purpose of each area and degree of security required.
 - 2. Plans for existing and future key system expansion.
 - 3. Requirements for key control storage and software.
 - 4. Installation of permanent keys, cylinder cores and software.
 - 5. Address and requirements for delivery of keys.
- G. Pre-Submittal Conference: Conduct coordination conference in compliance with requirements in Division 01 Section "Project Meetings" with attendance by representatives of Supplier(s), Installer(s), and Contractor(s) to review proper methods and the procedures for receiving, handling, and installing door hardware.
 - 1. Prior to installation of door hardware, conduct a project specific training meeting to instruct the installing contractors' personnel on the proper installation and adjustment of their respective products. Product training to be attended by installers of door hardware (including electromechanical hardware) for aluminum, hollow metal and wood doors. Training will include the use of installation manuals, hardware schedules, templates and physical product samples as required.
 - 2. Inspect and discuss electrical roughing-in, power supply connections, and other preparatory work performed by other trades.
 - 3. Review sequence of operation narratives for each unique access controlled opening.
 - 4. Review and finalize construction schedule and verify availability of materials.
 - 5. Review the required inspecting, testing, commissioning, and demonstration procedures
- H. At completion of installation, provide written documentation that components were applied to manufacturer's instructions and recommendations and according to approved schedule.

1.5 DELIVERY, STORAGE, AND HANDLING

- A. Inventory door hardware on receipt and provide secure lock-up and shelving for door hardware delivered to Project site. Do not store electronic access control hardware, software or accessories at Project site without prior authorization.

- B. Tag each item or package separately with identification related to the final Door Hardware Schedule, and include basic installation instructions with each item or package.
- C. Deliver, as applicable, permanent keys, cylinders, cores, access control credentials, software and related accessories directly to Owner via registered mail or overnight package service. Instructions for delivery to the Owner shall be established at the "Keying Conference".

1.6 COORDINATION

- A. Templates: Obtain and distribute to the parties involved templates for doors, frames, and other work specified to be factory prepared for installing standard and electrified hardware. Check Shop Drawings of other work to confirm that adequate provisions are made for locating and installing hardware to comply with indicated requirements.
- B. Door and Frame Preparation: Doors and corresponding frames are to be prepared, reinforced and pre-wired (if applicable) to receive the installation of the specified electrified, monitoring, signaling and access control system hardware without additional in-field modifications.

1.7 WARRANTY

- A. General Warranty: Reference Division 01, General Requirements. Special warranties specified in this Article shall not deprive Owner of other rights Owner may have under other provisions of the Contract Documents and shall be in addition to, and run concurrent with, other warranties made by Contractor under requirements of the Contract Documents.
- B. Warranty Period: Written warranty, executed by manufacturer(s), agreeing to repair or replace components of standard and electrified door hardware that fails in materials or workmanship within specified warranty period after final acceptance by the Owner. Failures include, but are not limited to, the following:
 - 1. Structural failures including excessive deflection, cracking, or breakage.
 - 2. Faulty operation of the hardware.
 - 3. Deterioration of metals, metal finishes, and other materials beyond normal weathering.
 - 4. Electrical component defects and failures within the systems operation.
- C. Standard Warranty Period: One year from date of Substantial Completion, unless otherwise indicated.
- D. Special Warranty Periods:
 - 1. Ten years for extra heavy duty cylindrical (bored) locks and latches.
 - 2. Five years for exit hardware.
 - 3. Twenty five years for manual overhead door closer bodies.

1.8 MAINTENANCE SERVICE

- A. Maintenance Tools and Instructions: Furnish a complete set of specialized tools and maintenance instructions as needed for Owner's continued adjustment, maintenance, and removal and replacement of door hardware.

PART 2 - PRODUCTS

2.1 SCHEDULED DOOR HARDWARE

- A. General: Provide door hardware for each door to comply with requirements in Door Hardware Sets and each referenced section that products are to be supplied under.
- B. Designations: Requirements for quantity, item, size, finish or color, grade, function, and other distinctive qualities of each type of door hardware are indicated in the Door Hardware Sets at the end of Part 3. Products are identified by using door hardware designations, as follows:
 - 1. Named Manufacturer's Products: Product designation and manufacturer are listed for each door hardware type required for the purpose of establishing requirements. Manufacturers' names are abbreviated in the Door Hardware Schedule.
- C. Substitutions: Requests for substitution and product approval for inclusive mechanical and electromechanical door hardware in compliance with the specifications must be submitted in writing and in accordance with the procedures and time frames outlined in Division 01, Substitution Procedures. Approval of requests is at the discretion of the architect, owner, and their designated consultants.

2.2 HANGING DEVICES

- A. Hinges: ANSI/BHMA A156.1 certified butt hinges with number of hinge knuckles and other options as specified in the Door Hardware Sets.
 - 1. Quantity: Provide the following hinge quantity:
 - a. Two Hinges: For doors with heights up to 60 inches.
 - b. Three Hinges: For doors with heights 61 to 90 inches.
 - c. Four Hinges: For doors with heights 91 to 120 inches.
 - d. For doors with heights more than 120 inches, provide 4 hinges, plus 1 hinge for every 30 inches of door height greater than 120 inches.
 - 2. Hinge Size: Provide the following, unless otherwise indicated, with hinge widths sized for door thickness and clearances required:
 - a. Widths up to 3'0": 4-1/2" standard or heavy weight as specified.
 - b. Sizes from 3'1" to 4'0": 5" standard or heavy weight as specified.
 - 3. Hinge Weight and Base Material: Unless otherwise indicated, provide the following:
 - a. Exterior Doors: Heavy weight, non-ferrous, ball bearing or oil impregnated bearing hinges unless Hardware Sets indicate standard weight.
 - b. Interior Doors: Standard weight, steel, ball bearing or oil impregnated bearing hinges unless Hardware Sets indicate heavy weight.
 - 4. Hinge Options: Comply with the following:
 - a. Non-removable Pins: Provide set screw in hinge barrel that, when tightened into a groove in hinge pin, prevents removal of pin while door is closed; for the all out-swinging lockable doors.
 - 5. Manufacturers:

- a. Bommer Industries (BO).
- b. Ives; Allegion (IVE).
- c. McKinney Products; ASSA ABLOY Architectural Door Accessories (MK).

2.3 DOOR OPERATING TRIM

- A. Flush Bolts and Surface Bolts: ANSI/BHMA A156.3 and A156.16, Grade 1, certified.
 - 1. Flush bolts to be furnished with top rod of sufficient length to allow bolt retraction device location approximately six feet from the floor.
 - 2. Furnish dust proof strikes for bottom bolts.
 - 3. Surface bolts to be minimum 8" in length and U.L. listed for labeled fire doors and U.L. listed for windstorm components where applicable.
 - 4. Provide related accessories (mounting brackets, strikes, coordinators, etc.) as required for appropriate installation and operation.
 - 5. Manufacturers:
 - a. Burns Manufacturing (BU).
 - b. Ives; Allegion (IVE).
 - c. Rockwood Products; ASSA ABLOY Architectural Door Accessories (RO).
- B. Coordinators: ANSI/BHMA A156.3 certified door coordinators consisting of active-leaf, hold-open lever and inactive-leaf release trigger. Model as indicated in hardware sets.
 - 1. Manufacturers:
 - a. Burns Manufacturing (BU).
 - b. Ives; Allegion (IVE).
 - c. Rockwood Products; ASSA ABLOY Architectural Door Accessories (RO).
- C. Door Push Plates and Pulls: ANSI/BHMA A156.6 certified door pushes and pulls of type and design specified in the Hardware Sets. Coordinate and provide proper width and height as required where conflicting hardware dictates.
 - 1. Push/Pull Plates: Minimum .050 inch thick, size as indicated in hardware sets, with beveled edges, secured with exposed screws unless otherwise indicated.
 - 2. Door Pull and Push Bar Design: Size, shape, and material as indicated in the hardware sets. Minimum clearance of 2 1/2-inches from face of door unless otherwise indicated.
 - 3. Offset Pull Design: Size, shape, and material as indicated in the hardware sets. Minimum clearance of 2 1/2-inches from face of door and offset of 90 degrees unless otherwise indicated.
 - 4. Fasteners: Provide manufacturer's designated fastener type as indicated in Hardware Sets.
 - 5. Manufacturers:
 - a. Burns Manufacturing (BU).
 - b. Ives; Allegion (IVE).
 - c. Rockwood Products; ASSA ABLOY Architectural Door Accessories (RO).

2.4 CYLINDERS AND KEYING

- A. General: Cylinder manufacturer to have minimum (10) years experience designing secured master key systems and have on record a published security keying system policy.

- B. Source Limitations: Obtain each type of keyed cylinder and keys from the same source manufacturer as locksets and exit devices, unless otherwise indicated.
 - C. Cylinder Types: Original manufacturer cylinders able to supply the following cylinder formats and types:
 - 1. Threaded mortise cylinders with rings and cams to suit hardware application.
 - 2. Rim cylinders with back plate, flat-type vertical or horizontal tailpiece, and raised trim ring.
 - 3. Mortise and rim cylinder collars to be solid and recessed to allow the cylinder face to be flush and be free spinning with matching finishes.
 - 4. Keyway: Match Facility Standard.
 - D. Keying System: Each type of lock and cylinders to be factory keyed.
 - 1. Supplier shall conduct a "Keying Conference" to define and document keying system instructions and requirements.
 - 2. Furnish factory cut, nickel-silver large bow permanently inscribed with a visual key control number as directed by Owner.
 - 3. Existing System: Field verify and key cylinders to match Owner's existing system.
 - E. Key Quantity: Provide the following minimum number of keys:
 - 1. Change Keys per Cylinder: Three (3).
 - 2. Construction Keys (where required): Ten (10).
 - F. Construction Keying: Provide construction master keyed cylinders.
 - G. Key Registration List (Bitting List):
 - 1. Provide keying transcript list to Owner's representative in the proper format for importing into key control software.
 - 2. Provide transcript list in writing or electronic file as directed by the Owner.
- 2.5 MECHANICAL LOCKS AND LATCHING DEVICES
- A. Mortise Locksets, Grade 1 (Commercial Duty): ANSI/BHMA A156.13, Series 1000, Operational Grade 1 Certified Products Directory (CPD) listed.
 - 1. Locks are to be non-handed and fully field reversible.
 - 2. Manufacturers:
 - a. Schlage; Allegion (SCH) – L9000 Series.
 - b. No Substitution.
- 2.6 LOCK AND LATCH STRIKES
- A. Strikes: Provide manufacturer's standard strike with strike box for each latch or lock bolt, with curved lip extended to protect frame, finished to match door hardware set, unless otherwise indicated, and as follows:
 - 1. Extra-Long-Lip Strikes: For locks used on frames with applied wood casing trim.
 - 2. Aluminum-Frame Strike Box: Provide manufacturer's special strike box fabricated for aluminum framing.

B. Standards: Comply with the following:

1. Strikes for Mortise Locks and Latches: BHMA A156.13.
2. Strikes for Auxiliary Deadlocks: BHMA A156.36.
3. Dustproof Strikes: BHMA A156.16.

2.7 CONVENTIONAL EXIT DEVICES

A. General Requirements: All exit devices specified herein shall meet or exceed the following criteria:

1. At doors not requiring a fire rating, provide devices complying with NFPA 101 and listed and labeled for "Panic Hardware" according to UL305. Provide proper fasteners as required by manufacturer including sex nuts and bolts at openings specified in the Hardware Sets.
2. Where exit devices are required on fire rated doors, provide devices complying with NFPA 80 and with UL labeling indicating "Fire Exit Hardware". Provide devices with the proper fasteners for installation as tested and listed by UL. Consult manufacturer's catalog and template book for specific requirements.
3. Except on fire rated doors, provide exit devices with hex key dogging device to hold the pushbar and latch in a retracted position. Provide optional keyed cylinder dogging on devices where specified in Hardware Sets.
4. Devices must fit flat against the door face with no gap that permits unauthorized dogging of the push bar. The addition of filler strips is required in any case where the door light extends behind the device as in a full glass configuration.
5. Lever Operating Trim: Where exit devices require lever trim, furnish manufacturer's heavy duty escutcheon trim with threaded studs for thru-bolts.
 - a. Lock Trim Design: As indicated in Hardware Sets, provide finishes and designs to match that of the specified locksets.
 - b. Where function of exit device requires a cylinder, provide a cylinder (Rim or Mortise) as specified in Hardware Sets.
6. Vertical Rod Exit Devices: Where surface or concealed vertical rod exit devices are used at interior openings, provide as less bottom rod (LBR) unless otherwise indicated. Provide dust proof strikes where thermal pins are required to project into the floor.
7. Narrow Stile Applications: At doors constructed with narrow stiles, or as specified in Hardware Sets, provide devices designed for maximum 2" wide stiles.
8. Dummy Push Bar: Nonfunctioning push bar matching functional push bar.
9. Rail Sizing: Provide exit device rails factory sized for proper door width application.
10. Through Bolt Installation: For exit devices and trim as indicated in Door Hardware Sets.

B. Conventional Push Rail Exit Devices: ANSI/BHMA A156.3, Grade 1 Certified Products Directory (CPD) listed panic and fire exit hardware devices furnished in the functions specified in the Hardware Sets. Exit device latch to be stainless steel, pullman type, with deadlock feature.

1. Manufacturers:
 - a. Von Duprin; Allegion (VON) – 33A/99 Series.
 - b. No Substitution

2.8 DOOR CLOSERS

A. All door closers specified herein shall meet or exceed the following criteria:

1. General: Door closers to be from one manufacturer, matching in design and style, with the same type door preparations and templates regardless of application or spring size. Closers to be non-handed with full sized covers.
 2. Standards: Closers to comply with UL-10C for Positive Pressure Fire Test and be U.L. listed for use of fire rated doors.
 3. Size of Units: Comply with manufacturer's written recommendations for sizing of door closers depending on size of door, exposure to weather, and anticipated frequency of use. Where closers are indicated for doors required to be accessible to the Americans with Disabilities Act, provide units complying with ANSI ICC/A117.1.
 4. Closer Arms: Provide heavy duty, forged steel closer arms unless otherwise indicated in Hardware Sets.
 5. Closers shall not be installed on exterior or corridor side of doors; where possible install closers on door for optimum aesthetics.
 6. Closer Accessories: Provide door closer accessories including custom templates, special mounting brackets, spacers and drop plates as required for proper installation. Provide through-bolt and security type fasteners as specified in the hardware sets.
- B. Door Closers, Surface Mounted (Commercial Duty): ANSI/BHMA 156.4, Grade 1 Certified Products Directory (CPD) listed surface mounted, institutional grade door closers with complete spring power adjustment, sizes 1 thru 6; and fully operational adjustable according to door size, frequency of use, and opening force. Closers to be rack and pinion type, one piece cast iron or aluminum alloy body construction, with adjustable backcheck, closing sweep, and latch speed control valves. Provide non-handed units standard.
1. Manufacturers:
 - a. LCN; Allegion (LCN) – 4040XP Series.
 - b. No Substitution.

2.9 ARCHITECTURAL TRIM

A. Door Protective Trim

1. General: Door protective trim units to be of type and design as specified below or in the Hardware Sets.
2. Size: Fabricate protection plates (kick, armor, or mop) not more than 2" less than door width (LDW) on stop side of single doors and 1" LDW on stop side of pairs of doors, and not more than 1" less than door width on pull side. Coordinate and provide proper width and height as required where conflicting hardware dictates. Height to be as specified in the Hardware Sets.
3. Where plates are applied to fire rated doors with the top of the plate more than 16" above the bottom of the door, provide plates complying with NFPA 80. Consult manufacturer's catalog and template book for specific requirements for size and applications.
4. Protection Plates: ANSI/BHMA A156.6 certified protection plates (kick, armor, or mop), fabricated from the following:
 - a. Stainless Steel: 300 grade, 050-inch thick.
5. Options and fasteners: Provide manufacturer's designated fastener type as specified in the Hardware Sets. Provide countersunk screw holes.
6. Manufacturers:
 - a. Burns Manufacturing (BU).
 - b. Ives; Allegion (IVE).
 - c. Rockwood Products; ASSA ABLOY Architectural Door Accessories (RO).

2.10 DOOR STOPS AND HOLDERS

- A. General: Door stops and holders to be of type and design as specified below or in the Hardware Sets.
- B. Door Stops and Bumpers: ANSI/BHMA A156.16, Grade 1 certified door stops and wall bumpers. Provide wall bumpers, either convex or concave types with anchorage as indicated, unless floor or other types of door stops are specified in Hardware Sets. Do not mount floor stops where they will impede traffic. Where floor or wall bumpers are not appropriate, provide overhead type stops and holders.
 - 1. Manufacturers:
 - a. Burns Manufacturing (BU).
 - b. Ives; Allegion (IVE).
 - c. Rockwood Products; ASSA ABLOY Architectural Door Accessories (RO).
- C. Overhead Door Stops and Holders: ANSI/BHMA A156.8, Grade 1 Certified Products Directory (CPD) listed overhead stops and holders to be surface or concealed types as indicated in Hardware Sets. Track, slide, arm and jamb bracket to be constructed of extruded bronze and shock absorber spring of heavy tempered steel. Provide non-handed design with mounting brackets as required for proper operation and function.
 - 1. Manufacturers:
 - a. Glynn Johnson; Allegion (GLY).
 - b. Rixson Door Controls (RF).
 - c. Rockwood Products; ASSA ABLOY Architectural Door Accessories (RO).
 - d. Sargent Manufacturing (SA).

2.11 ARCHITECTURAL SEALS

- A. General: Thresholds, weatherstripping, and gasket seals to be of type and design as specified below or in the Hardware Sets. Provide continuous weatherstrip gasketing on exterior doors and provide smoke, light, or sound gasketing on interior doors where indicated. At exterior applications provide non-corrosive fasteners and elsewhere where indicated.
- B. Smoke Labeled Gasketing: Assemblies complying with NFPA 105 that are listed and labeled by a testing and inspecting agency acceptable to authorities having jurisdiction, for smoke control ratings indicated, based on testing according to UL 1784.
 - 1. Provide smoke labeled perimeter gasketing at all smoke labeled openings.
- C. Fire Labeled Gasketing: Assemblies complying with NFPA 80 that are listed and labeled by a testing and inspecting agency acceptable to authorities having jurisdiction, for fire ratings indicated, based on testing according to UL-10C.
 - 1. Provide intumescent seals as indicated to meet UL10C Standard for Positive Pressure Fire Tests of Door Assemblies, and NPFA 252, Standard Methods of Fire Tests of Door Assemblies.
- D. Sound-Rated Gasketing: Assemblies that are listed and labeled by a testing and inspecting agency, for sound ratings indicated.
- E. Replaceable Seal Strips: Provide only those units where resilient or flexible seal strips are easily replaceable and readily available from stocks maintained by manufacturer.

F. Manufacturers:

1. Pemko Products; ASSA ABLOY Architectural Door Accessories (PE).
2. Reese Enterprises, Inc. (RE).
3. Zero International; Allegion (ZER).

2.12 FABRICATION

- A. Fasteners: Provide door hardware manufactured to comply with published templates generally prepared for machine, wood, and sheet metal screws. Provide screws according to manufacturers recognized installation standards for application intended.

2.13 FINISHES

- A. Standard: Designations used in the Hardware Sets and elsewhere indicate hardware finishes complying with ANSI/BHMA A156.18, including coordination with traditional U.S. finishes indicated by certain manufacturers for their products.
- B. Provide quality of finish, including thickness of plating or coating (if any), composition, hardness, and other qualities complying with manufacturer's standards, but in no case less than specified by referenced standards for the applicable units of hardware
- C. Protect mechanical finishes on exposed surfaces from damage by applying a strippable, temporary protective covering before shipping.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine scheduled openings, with Installer present, for compliance with requirements for installation tolerances, labeled fire door assembly construction, wall and floor construction, and other conditions affecting performance.
- B. Notify architect of any discrepancies or conflicts between the door schedule, door types, drawings and scheduled hardware. Proceed only after such discrepancies or conflicts have been resolved in writing.

3.2 PREPARATION

- A. Hollow Metal Doors and Frames: Comply with ANSI/DHI A115 series.
- B. Wood Doors: Comply with ANSI/DHI A115-W series.

3.3 INSTALLATION

- A. Install each item of mechanical and electromechanical hardware and access control equipment to comply with manufacturer's written instructions and according to specifications.
1. Installers are to be trained and certified by the manufacturer on the proper installation and adjustment of fire, life safety, and security products including: hanging devices; locking devices; closing devices; and seals.

- B. Mounting Heights: Mount door hardware units at heights indicated in following applicable publications, unless specifically indicated or required to comply with governing regulations:
 - 1. Standard Steel Doors and Frames: DHI's "Recommended Locations for Architectural Hardware for Standard Steel Doors and Frames."
 - 2. Wood Doors: DHI WDHS.3, "Recommended Locations for Architectural Hardware for Wood Flush Doors."
 - 3. Where indicated to comply with accessibility requirements, comply with ANSI A117.1 "Accessibility Guidelines for Buildings and Facilities."
 - 4. Provide blocking in drywall partitions where wall stops or other wall mounted hardware is located.
- C. Retrofitting: Install door hardware to comply with manufacturer's published templates and written instructions. Where cutting and fitting are required to install door hardware onto or into surfaces that are later to be painted or finished in another way, coordinate removal, storage, and reinstallation of surface protective trim units with finishing work specified in Division 9 Sections. Do not install surface-mounted items until finishes have been completed on substrates involved.
- D. Thresholds: Set thresholds for exterior and acoustical doors in full bed of sealant complying with requirements specified in Division 7 Section "Joint Sealants."
- E. Storage: Provide a secure lock up for hardware delivered to the project but not yet installed. Control the handling and installation of hardware items so that the completion of the work will not be delayed by hardware losses before and after installation.

3.4 FIELD QUALITY CONTROL

- A. Field Inspection (Punch Report): Reference Division 01 Sections "Closeout Procedures" and "Cash Allowances". Produce project punch report for each installed door opening indicating compliance with approved submittals and verification hardware is properly installed, operating and adjusted. Include list of items to be completed and corrected, indicating the reasons or deficiencies causing the Work to be incomplete or rejected.
 - 1. Organization of List: Include separate Door Opening and Deficiencies and Corrective Action Lists organized by Mark, Opening Remarks and Comments, and related Opening Images and Video Recordings.
 - 2. Submit documentation of incomplete items in the following formats:
 - a. PDF electronic file.
 - b. Electronic formatted file integrated with the Openings Studio™ door opening management software platform.

3.5 ADJUSTING

- A. Initial Adjustment: Adjust and check each operating item of door hardware and each door to ensure proper operation or function of every unit. Replace units that cannot be adjusted to operate as intended. Adjust door control devices to compensate for final operation of heating and ventilating equipment and to comply with referenced accessibility requirements.

3.6 CLEANING AND PROTECTION

- A. Protect all hardware stored on construction site in a covered and dry place. Protect exposed hardware installed on doors during the construction phase. Install any and all hardware at the latest possible time frame.

- B. Clean adjacent surfaces soiled by door hardware installation.
- C. Clean operating items as necessary to restore proper finish. Provide final protection and maintain conditions that ensure door hardware is without damage or deterioration at time of owner occupancy.

3.7 DEMONSTRATION

- A. Instruct Owner's maintenance personnel to adjust, operate, and maintain mechanical and electromechanical door hardware.

3.8 DOOR HARDWARE SETS

- A. The hardware sets represent the design intent and direction of the owner and architect. They are a guideline only and should not be considered a detailed hardware schedule. Discrepancies, conflicting hardware and missing items should be brought to the attention of the architect with corrections made prior to the bidding process. Omitted items not included in a hardware set should be scheduled with the appropriate additional hardware required for proper application and functionality.

1. Quantities listed are for each pair of doors, or for each single door.
2. The supplier is responsible for handing and sizing all products.
3. Where multiple options for a piece of hardware are given in a single line item, the supplier shall provide the appropriate application for the opening.
4. At existing openings with new hardware the supplier shall field inspect existing conditions prior to the submittal stage to verify the specified hardware will work as required. Provide alternate solutions and proposals as needed.

- B. Manufacturer's Abbreviations:

1. IVE - Ives
2. SCH - Schlage
3. VON – Von Duprin
4. LCN - LCN
5. GLY – Glynn Johnson
6. ZER – Zero International

END OF SECTION 087100

Door Numbers	HwSet#
A101	CR710AM
A102	CR710ACM
B102	C201
C101	CER201
D101	CE201
E101	CE201
F101	C701
G101	C701
H101	CE201
H102	CE201
J101	CE201A
XB100	EX-CER201T
XB101	EX-CE201
XC100	EX-CER201
XD100	EX-CER201
XE100	EX-CER201
XF100	EX-CE201
XG100	EX-CER201
XG101	EX-CE201
XH100	EX-CER201
XJ100	EX-CER201

Hardware Group No. C201

Provide each SGL door(s) with the following:

QTY		DESCRIPTION	CATALOG NUMBER	FINISH	MFR
3	EA	HINGE	5BB1 4.5 X 4.5	652	IVE
1	EA	POWER TRANSFER	EPT10 CON	↗ 689	VON
1	EA	EU MORTISE LOCK	L9092HD EU 07A RX CON (FAIL SECURE)	↗ 626	SCH
1	EA	SFIC EVEREST CORE	80-037	626	SCH
1	EA	SURFACE CLOSER	4040XP RW/PA TBWMS X MTG BRKT, SPCR & PLATE AS REQ	689	LCN
1	EA	KICK PLATE	8400 10" X 2" LDW B-CS	630	IVE
1	EA	FLOOR STOP	FS436/FS438 AS REQ.	626	IVE
1	EA	GASKETING	488S PSA H & J (USE SILENCERS @ NON-RATED DOORS)	BK	ZER
2	EA	HARNESS (1 IN DOOR & 1 IN FRAME)	ALLEGION CONNECT TYPE & LENGTH AS REQ		SCH
1	EA	HARNESS (TO POWER SUPPLY)	CON-6W - CONNECTION LEADS		SCH
1	EA	CREDENTIAL READER	MT SERIES - COORDINATE WITH SECURITY CONTRACTOR	↗ BLK	SCE
1	EA	DOOR CONTACT	679-05 TYPE AS REQ	↗ WHT	SCE
1	EA	POWER SUPPLY	POWER SUPPLY FOR CREDENTIAL READER BY ANOTHER SECTION		
1	EA	POWER SUPPLY	PS902 120/240 VAC - COORDINATE WITH SECURITY CONTRACTOR (COORDINATE PS WITH SECURITY CONTRACTOR PRIOR TO SUBMITTALS)	↗ LGR	SCE

- INGRESS BY THE CARD READER OR KEY OVERRIDE.
- FREE EGRESS BY LEVER.

Hardware Group No. C701

Provide each SGL door(s) with the following:

QTY		DESCRIPTION	CATALOG NUMBER	FINISH	MFR
3	EA	HINGE	5BB1HW 4.5 X 4.5	652	IVE
1	EA	POWER TRANSFER	EPT10 CON	↗ 689	VON
1	EA	ELEC PANIC HARDWARE	RX-QEL-99-L-NL-07-CON-SNB 24 VDC	↗ 626	VON
1	EA	SFIC EVEREST CORE	80-037	626	SCH
1	EA	SFIC RIM CYLINDER	80-159 W/KEYED CONST. CORE	626	SCH
1	EA	SURFACE CLOSER	4040XP SCUSH TBWMS X MTG BRKT, SPCR & PLATE AS REQ	689	LCN
1	EA	KICK PLATE	8400 10" X 2" LDW B-CS	630	IVE
1	EA	RAIN DRIP	142A DW + 4"	AA	ZER
1	EA	GASKETING	328AA H & J	AA	ZER
1	EA	DOOR SWEEP	8198AA LENGTH AS REQ	AA	ZER
1	EA	THRESHOLD	65A LENGTH AS REQ	A	ZER
2	EA	HARNESS (1 IN DOOR & 1 IN FRAME)	ALLEGION CONNECT TYPE & LENGTH AS REQ		SCH
1	EA	HARNESS (TO POWER SUPPLY)	CON-6W - CONNECTION LEADS		SCH
1	EA	CREDENTIAL READER	MT SERIES - COORDINATE WITH SECURITY CONTRACTOR	↗ BLK	SCE
1	EA	DOOR CONTACT	679-05 TYPE AS REQ	↗ WHT	SCE
1	EA	POWER SUPPLY	POWER SUPPLY FOR CREDENTIAL READER BY ANOTHER SECTION		
1	EA	POWER SUPPLY	PS902 120/240 VAC - COORDINATE WITH SECURITY CONTRACTOR (COORDINATE PS WITH SECURITY CONTRACTOR PRIOR TO SUBMITTALS)	↗ LGR	SCE

-INGRESS BY THE CARD READER OR KEY OVERRIDE.

-FREE EGRESS BY THE PUSH PAD.

Hardware Group No. CE201

Provide each SGL door(s) with the following:

QTY		DESCRIPTION	CATALOG NUMBER	FINISH	MFR
3	EA	HINGE	5BB1 4.5 X 4.5	652	IVE
1	EA	STOREROOM LOCK	L9080HD 07A	626	SCH
1	EA	SFIC EVEREST CORE	80-037	626	SCH
1	EA	ELECTRIC STRIKE (SGL DOOR - HMF)	6211-FSE-CON (FAIL SECURE) VOLTAGE AS REQ	✓ 630	VON
1	EA	SURFACE CLOSER	4040XP RW/PA TBWMS X MTG BRKT, SPCR & PLATE AS REQ	689	LCN
1	EA	KICK PLATE	8400 10" X 2" LDW B-CS	630	IVE
1	EA	FLOOR STOP	FS436/FS438 AS REQ.	626	IVE
1	EA	GASKETING	488S PSA H & J (USE SILENCERS @ NON-RATED DOORS)	BK	ZER
1	EA	HARNESS (TO POWER SUPPLY)	CON-6W - CONNECTION LEADS		SCH
1	EA	CREDENTIAL READER	MT SERIES - COORDINATE WITH SECURITY CONTRACTOR	✓ BLK	SCE
1	EA	DOOR CONTACT	679-05 TYPE AS REQ	✓ WHT	SCE
1	EA	MOTION SENSOR	SCANII 12/24 VDC	✓ WHT	SCE
1	EA	POWER SUPPLY	POWER SUPPLY FOR CREDENTIAL READER BY ANOTHER SECTION		
1	EA	POWER SUPPLY	PS902 FA900 120/240 VAC (COORDINATE PS WITH SECURITY CONTRACTOR PRIOR TO SUBMITTALS)	✓ LGR	SCE

VERIFY THAT EXISTING HARDWARE IS IN PROPER WORKING ORDER.

-REUSE EXISTING HARDWARE WHEREVER POSSIBLE AND PROVIDE NEW HARDWARE BASED ON THE HARDWARE SET.

-INGRESS BY THE CARD READER OR KEY OVERRIDE.

-EGRESS BY THE LEVER.

-AT FIRE RATED DOORS, WIRE THE ELECTRIC STRIKE TO THE FIRE ALARM SYSTEM.

-AT FIRE RATED DOORS, THE ELECTRIC STRIKE WILL BECOME FAIL SECURE UPON ACTIVATION OF THE FIRE ALARM SYSTEM.

Hardware Group No. CE201A

Provide each SGL door(s) with the following:

QTY		DESCRIPTION	CATALOG NUMBER	FINISH	MFR
3	EA	HINGE	5BB1 4.5 X 4.5	652	IVE
1	EA	STOREROOM LOCK	L9080HD 07A	626	SCH
1	EA	SFIC EVEREST CORE	80-037	626	SCH
1	EA	ELECTRIC STRIKE (SGL DOOR - HMF)	6211-FSE-CON (FAIL SECURE) VOLTAGE AS REQ	✓ 630	VON
1	EA	SURFACE CLOSER	4040XP RW/PA TBWMS X MTG BRKT, SPCR & PLATE AS REQ	689	LCN
1	EA	FLOOR STOP	FS436/FS438 AS REQ.	626	IVE
1	SET	SEAL	PERIMETER SEAL BY FRAME MFR.		
2	EA	HARNESS (1 IN DOOR & 1 IN FRAME)	ALLEGION CONNECT TYPE & LENGTH AS REQ		SCH
1	EA	CREDENTIAL READER	MT SERIES - COORDINATE WITH SECURITY CONTRACTOR	✓ BLK	SCE
1	EA	DOOR CONTACT	679-05 TYPE AS REQ	✓ WHT	SCE
1	EA	POWER SUPPLY	POWER SUPPLY FOR CREDENTIAL READER BY ANOTHER SECTION		
1	EA	POWER SUPPLY	PS902 120/240 VAC - COORDINATE WITH SECURITY CONTRACTOR (COORDINATE PS WITH SECURITY CONTRACTOR PRIOR TO SUBMITTALS)	✓ LGR	SCE

- A 5" LOCK STILE IS REQUIRED FOR THE USE OF THE DISTRICT STANDARD MORTISE LOCK - VERIFY PRIOR TO ORDERING HARDWARE
- INGRESS BY THE CARD READER OR KEY OVERRIDE.
- FREE EGRESS BY LEVER.

Hardware Group No. CER201

Provide each SGL door(s) with the following:

QTY		DESCRIPTION	CATALOG NUMBER	FINISH	MFR
3	EA	HINGE	5BB1 4.5 X 4.5	652	IVE
1	EA	STOREROOM LOCK	L9080HD 07A	626	SCH
1	EA	SFIC EVEREST CORE	80-037	626	SCH
1	EA	ELECTRIC STRIKE (SGL DOOR - HMF)	6211-FSE-CON (FAIL SECURE) VOLTAGE AS REQ	✓ 630	VON
1	EA	SURFACE CLOSER	4040XP RW/PA TBWMS X MTG BRKT, SPCR & PLATE AS REQ	689	LCN
1	EA	KICK PLATE	8400 10" X 2" LDW B-CS	630	IVE
1	EA	FLOOR STOP	FS436/FS438 AS REQ.	626	IVE
1	EA	GASKETING	488S PSA H & J (USE SILENCERS @ NON-RATED DOORS)	BK	ZER
2	EA	HARNESS (1 IN DOOR & 1 IN FRAME)	ALLEGION CONNECT TYPE & LENGTH AS REQ		SCH
1	EA	CREDENTIAL READER	MT SERIES - COORDINATE WITH SECURITY CONTRACTOR	✓ BLK	SCE
1	EA	DESK MOUNT BUTTON	660-PB	✓ 628	SCE
1	EA	MOTION SENSOR	SCANII 12/24 VDC	✓ WHT	SCE
1	EA	POWER SUPPLY	POWER SUPPLY FOR CREDENTIAL READER BY ANOTHER SECTION		
1	EA	POWER SUPPLY	PS902 120/240 VAC - COORDINATE WITH SECURITY CONTRACTOR (COORDINATE PS WITH SECURITY CONTRACTOR PRIOR TO SUBMITTALS)	✓ LGR	SCE

-INGRESS BY CARD READER OR REMOTE RELEASE.

-FREE EGRESS AT ALL TIMES..

Hardware Group No. CR710ACM

Provide each PR door(s) with the following:

QTY		DESCRIPTION	CATALOG NUMBER	FINISH	MFR
2	EA	CONT. HINGE	112XY EPT HEIGHT AS REQ	628	IVE
2	EA	POWER TRANSFER	EPT10 CON	✎ 689	VON
1	EA	REMOVABLE MULLION	KR4954 HEIGHT AS REQ	689	VON
1	EA	ELEC PANIC HARDWARE	RX-QEL-33A-EO-CON LENGTH AS REQ	✎ 626	VON
1	EA	ELEC PANIC HARDWARE	RX-QEL-33A-NL-OP-CON LENGTH AS REQ	✎ 626	VON
2	EA	SFIC EVEREST CORE	80-037	626	SCH
1	EA	SFIC MORTISE CYL.	80-132 W/KEYED CONST. CORE	626	SCH
1	EA	SFIC RIM CYLINDER	80-159 W/KEYED CONST. CORE	626	SCH
2	EA	90 DEG OFFSET PULL	8190-O 10"	630	IVE
2	EA	SURFACE CLOSER	4040XP RW/PA TBWMS X MTG BRKT, SPCR & PLATE AS REQ	689	LCN
1	SET	SEAL	PERIMETER SEAL BY FRAME MFR.		
1	SET	ASTRAGAL	MEETING STILE SEAL BY DOOR MFR.		
4	EA	HARNESS (1 IN DOOR & 1 IN FRAME)	ALLEGION CONNECT TYPE & LENGTH AS REQ		SCH
2	EA	HARNESS (TO POWER SUPPLY)	CON-6W - CONNECTION LEADS		SCH
1	EA	CREDENTIAL READER	MT SERIES - COORDINATE WITH SECURITY CONTRACTOR	✎ BLK	SCE
1	EA	DESK MOUNT BUTTON	660-PB	✎ 628	SCE
2	EA	DOOR CONTACT	679-05 TYPE AS REQ	✎ WHT	SCE
1	EA	POWER SUPPLY	POWER SUPPLY FOR CREDENTIAL READER BY ANOTHER SECTION		
1	EA	POWER SUPPLY	PS902 900-2RS 120/240 VAC - COORDINATE WITH SECURITY CONTRACTOR (COORDINATE PS WITH SECURITY CONTRACTOR PRIOR TO SUBMITTALS)	✎	VON

-INGRESS BY THE CARD READER OR KEY OVERRIDE OR REMOTE RELEASE BUTTON.

-FREE EGRESS BY THE PUSH PADS.

Hardware Group No. CR710AM

Provide each PR door(s) with the following:

QTY		DESCRIPTION	CATALOG NUMBER	FINISH	MFR
2	EA	CONT. HINGE	112XY EPT HEIGHT AS REQ	628	IVE
2	EA	POWER TRANSFER	EPT10 CON	✎ 689	VON
1	EA	REMOVABLE MULLION	KR4954 HEIGHT AS REQ	689	VON
1	EA	ELEC PANIC HARDWARE	RX-QEL-33A-EO-CON LENGTH AS REQ	✎ 626	VON
1	EA	ELEC PANIC HARDWARE	RX-QEL-33A-NL-OP-CON LENGTH AS REQ	✎ 626	VON
2	EA	SFIC EVEREST CORE	80-037	626	SCH
1	EA	SFIC MORTISE CYL.	80-132 W/KEYED CONST. CORE	626	SCH
1	EA	SFIC RIM CYLINDER	80-159 W/KEYED CONST. CORE	626	SCH
2	EA	90 DEG OFFSET PULL	8190-O 10"	630	IVE
2	EA	SURFACE CLOSER	4040XP RW/PA TBWMS X MTG BRKT, SPCR & PLATE AS REQ	689	LCN
2	EA	FLOOR STOP	FS436/FS438 AS REQ.	626	IVE
1	SET	SEAL	PERIMETER SEAL BY FRAME MFR.		
1	SET	ASTRAGAL	MEETING STILE SEAL BY DOOR MFR.		
4	EA	HARNESS (1 IN DOOR & 1 IN FRAME)	ALLEGION CONNECT TYPE & LENGTH AS REQ		SCH
2	EA	HARNESS (TO POWER SUPPLY)	CON-6W - CONNECTION LEADS		SCH
1	EA	CREDENTIAL READER	MT SERIES - COORDINATE WITH SECURITY CONTRACTOR	✎ BLK	SCE
1	EA	DESK MOUNT BUTTON	660-PB	✎ 628	SCE
2	EA	DOOR CONTACT	679-05 TYPE AS REQ	✎ WHT	SCE
1	EA	POWER SUPPLY	POWER SUPPLY FOR CREDENTIAL READER BY ANOTHER SECTION		
1	EA	POWER SUPPLY	PS902 900-2RS 120/240 VAC - COORDINATE WITH SECURITY CONTRACTOR (COORDINATE PS WITH SECURITY CONTRACTOR PRIOR TO SUBMITTALS)	✎	VON

-INGRESS BY THE CARD READER OR KEY OVERRIDE OR REMOTE RELEASE BUTTON.

-FREE EGRESS BY THE PUSH PADS.

Hardware Group No. EX-CE201

Provide each SGL door(s) with the following:

QTY		DESCRIPTION	CATALOG NUMBER	FINISH	MFR
3	EA	HINGE	5BB1 4.5 X 4.5	652	IVE
1	EA	STOREROOM LOCK	L9080HD 07A	626	SCH
1	EA	SFIC EVEREST CORE	80-037	626	SCH
1	EA	ELECTRIC STRIKE (SGL DOOR - HMF)	6211-FSE-CON (FAIL SECURE) VOLTAGE AS REQ	✓ 630	VON
1	EA	SURFACE CLOSER	4040XP RW/PA TBWMS X MTG BRKT, SPCR & PLATE AS REQ	689	LCN
1	EA	KICK PLATE	8400 10" X 2" LDW B-CS	630	IVE
1	EA	FLOOR STOP	FS436/FS438 AS REQ.	626	IVE
1	EA	GASKETING	488S PSA H & J (USE SILENCERS @ NON-RATED DOORS)	BK	ZER
1	EA	HARNESS (TO POWER SUPPLY)	CON-6W - CONNECTION LEADS		SCH
1	EA	CREDENTIAL READER	MT SERIES - COORDINATE WITH SECURITY CONTRACTOR	✓ BLK	SCE
1	EA	DOOR CONTACT	679-05 TYPE AS REQ	✓ WHT	SCE
1	EA	MOTION SENSOR	SCANII 12/24 VDC	✓ WHT	SCE
1	EA	POWER SUPPLY	POWER SUPPLY FOR CREDENTIAL READER BY ANOTHER SECTION		
1	EA	POWER SUPPLY	PS902 FA900 120/240 VAC (COORDINATE PS WITH SECURITY CONTRACTOR PRIOR TO SUBMITTALS)	✓ LGR	SCE

VERIFY THAT EXISTING HARDWARE IS IN PROPER WORKING ORDER.

-REUSE EXISTING HARDWARE WHEREVER POSSIBLE AND PROVIDE NEW HARDWARE BASED ON THE HARDWARE SET.

-INGRESS BY THE CARD READER OR KEY OVERRIDE.

-EGRESS BY THE LEVER.

-AT FIRE RATED DOORS, WIRE THE ELECTRIC STRIKE TO THE FIRE ALARM SYSTEM.

-AT FIRE RATED DOORS, THE ELECTRIC STRIKE WILL BECOME FAIL SECURE UPON ACTIVATION OF THE FIRE ALARM SYSTEM.

Hardware Group No. EX-CER201

Provide each SGL door(s) with the following:

QTY		DESCRIPTION	CATALOG NUMBER	FINISH	MFR
3	EA	HINGE	5BB1 4.5 X 4.5	652	IVE
1	EA	STOREROOM LOCK	L9080HD 07A	626	SCH
1	EA	SFIC EVEREST CORE	80-037	626	SCH
1	EA	ELECTRIC STRIKE (SGL DOOR - HMF)	6211-FSE-CON (FAIL SECURE) VOLTAGE AS REQ	✓ 630	VON
1	EA	SURFACE CLOSER	4040XP RW/PA TBWMS X MTG BRKT, SPCR & PLATE AS REQ	689	LCN
1	EA	KICK PLATE	8400 10" X 2" LDW B-CS	630	IVE
1	EA	FLOOR STOP	FS436/FS438 AS REQ.	626	IVE
1	EA	GASKETING	488S PSA H & J (USE SILENCERS @ NON-RATED DOORS)	BK	ZER
1	EA	HARNESS (TO POWER SUPPLY)	CON-6W - CONNECTION LEADS		SCH
1	EA	CREDENTIAL READER	MT SERIES - COORDINATE WITH SECURITY CONTRACTOR	✓ BLK	SCE
1	EA	DOOR CONTACT	679-05 TYPE AS REQ	✓ WHT	SCE
1	EA	MOTION SENSOR	SCANII 12/24 VDC	✓ WHT	SCE
1	EA	POWER SUPPLY	POWER SUPPLY FOR CREDENTIAL READER BY ANOTHER SECTION		
1	EA	POWER SUPPLY	PS902 FA900 120/240 VAC (COORDINATE PS WITH SECURITY CONTRACTOR PRIOR TO SUBMITTALS)	✓ LGR	SCE

VERIFY THAT EXISTING HARDWARE IS IN PROPER WORKING ORDER.

-REUSE EXISTING HARDWARE WHEREVER POSSIBLE AND PROVIDE NEW HARDWARE BASED ON THE HARDWARE SET.

-INGRESS BY THE CARD READER, REMOTE RELEASE, OR KEY OVERRIDE.

-EGRESS BY THE LEVER.

-AT FIRE RATED DOORS, WIRE THE ELECTRIC STRIKE TO THE FIRE ALARM SYSTEM.

-AT FIRE RATED DOORS, THE ELECTRIC STRIKE WILL BECOME FAIL SECURE UPON ACTIVATION OF THE FIRE ALARM SYSTEM.

Hardware Group No. EX-CER201T

Provide each SGL door(s) with the following:

QTY		DESCRIPTION	CATALOG NUMBER	FINISH	MFR
4	EA	HINGE	5BB1 4.5 X 4.5	652	IVE
1	EA	STOREROOM LOCK	L9080HD 07A	626	SCH
1	EA	SFIC EVEREST CORE	80-037	626	SCH
1	EA	ELECTRIC STRIKE (SGL DOOR - HMF)	6211-FSE-CON (FAIL SECURE) VOLTAGE AS REQ	✓ 630	VON
1	EA	SURFACE CLOSER	4040XP RW/PA TBWMS X MTG BRKT, SPCR & PLATE AS REQ	689	LCN
1	EA	KICK PLATE	8400 10" X 2" LDW B-CS	630	IVE
1	EA	FLOOR STOP	FS436/FS438 AS REQ.	626	IVE
1	EA	GASKETING	488S PSA H & J (USE SILENCERS @ NON-RATED DOORS)	BK	ZER
1	EA	HARNESS (TO POWER SUPPLY)	CON-6W - CONNECTION LEADS		SCH
1	EA	CREDENTIAL READER	MT SERIES - COORDINATE WITH SECURITY CONTRACTOR	✓ BLK	SCE
1	EA	DOOR CONTACT	679-05 TYPE AS REQ	✓ WHT	SCE
1	EA	MOTION SENSOR	SCANII 12/24 VDC	✓ WHT	SCE
1	EA	POWER SUPPLY	POWER SUPPLY FOR CREDENTIAL READER BY ANOTHER SECTION		
1	EA	POWER SUPPLY	PS902 FA900 120/240 VAC (COORDINATE PS WITH SECURITY CONTRACTOR PRIOR TO SUBMITTALS)	✓ LGR	SCE

VERIFY THAT EXISTING HARDWARE IS IN PROPER WORKING ORDER.

-COORDINATE HINGE WEIGHT AND SIZE IF HINGES NEED TO BE REPLACED.

-REUSE EXISTING HARDWARE WHEREVER POSSIBLE AND PROVIDE NEW HARDWARE BASED ON THE HARDWARE SET.

-INGRESS BY THE CARD READER, REMOTE RELEASE, OR KEY OVERRIDE.

-EGRESS BY THE LEVER.

-AT FIRE RATED DOORS, WIRE THE ELECTRIC STRIKE TO THE FIRE ALARM SYSTEM.

-AT FIRE RATED DOORS, THE ELECTRIC STRIKE WILL BECOME FAIL SECURE UPON ACTIVATION OF THE FIRE ALARM SYSTEM.