

November 6, 2017

Kennewick School District No. 17
Attn: Keith Colee, Maintenance and Operations Manager
1000 West Fourth Avenue
Kennewick, Washington, 99336

**RE: Winter 2016 Drinking Water Sampling Results
Hawthorne Elementary School, 3520 West John Day Avenue, Kennewick,
Washington**

Dear Keith:

On Thursday, December 22, 2016, Fulcrum Environmental Consulting, Inc. (Fulcrum) collected 42 drinking water samples for lead and copper analysis from Hawthorne Elementary School (School) located at 3520 West John Day Avenue in Kennewick, Washington. Initial sampling identified two fixture locations with copper concentrations above guidance levels. Fulcrum returned to the School on February 25, 2017 to collect samples after remediation of the fixtures and found results below guidance levels. Sampling was completed as part of a District-wide project and all analysis was completed by Washington State Department of Ecology (Ecology) accredited laboratories.

Summary

The purpose of initial sampling was to evaluate current drinking water quality conditions with respect to lead and copper as a result of the increased national and local interest related to lead in drinking water. The intent of sampling was to meet the requirements of the pending regulations set forth in Washington Administrative Code (WAC) 246-366A-130 and 246-366A-135¹. Consistent with the regulations, Fulcrum completed sampling at the rates of at least 50% of plumbing fixtures used regularly for drinking or cooking in elementary and preschools and at least 25% of drinking or cooking fixtures in middle schools, junior high schools, and high schools. In addition, Fulcrum sampled administrative facilities in the District at the same rate as elementary schools, of at least 50% of drinking and cooking fixtures.

Fulcrum completed initial sampling on December 22, 2016. Initial results identified two samples with copper concentrations above the Environmental Protection Agency (EPA) action level of 1,300 micrograms per liter ($\mu\text{g/L}$). Upon receipt of results, the District removed the identified fixtures from service pending remediation and further testing.

Copper is not a significant component in fixtures, but is the primary material in the plumbing system. To remediate elevated copper, the District aggressively flushed the fixtures with cold water to clear the plumbing of copper construction debris. Fulcrum returned on February 25, 2017 and collected samples to

¹ Washington State Department of Health, WAC 246-366A, *The Environmental Health and Safety Standards of Primary and Secondary Schools*, <http://apps.leg.wa.gov/WAC/default.aspx?cite=246-366A>, July 26, 2016

evaluate the success of the remediation. The follow-up samples yielded results confirming the remediation was successful at reducing copper below the EPA action level. Following sampling and review of laboratory results, Fulcrum recommended, and the District elected, to return the fixtures to service.

As all samples now report concentrations below lead and copper action levels, at this time Fulcrum does not recommend any additional sampling. However, consistent with industry practice and the intent of WAC 246-366A, Fulcrum recommends that the District complete re-sampling of the building within the next five years (before December 2021). Additionally, if WAC 246-366A-130 is enacted, the regulations would require testing of all remaining fixtures within two years of the effective date (July 1, 2017). See Figure 1 Attachment A for fixture locations and laboratory results.

Sampling Methodology

As a portion of this project, Fulcrum prepared a Sampling and Analysis Plan (SAP) intended to satisfy future initial sampling requirements under pending regulations.

For initial evaluation purposes, Fulcrum collected “first draw” samples. This “first draw” water volume consists of 250 milliliters (mL) and is intended to represent the water quality in the fixture, tubing connecting the fixture to the building piping, and potentially a portion of the building piping. If lead and copper are present, this first-draw sample typically contains the highest lead levels and indicates high copper from the associated building piping.

For most post-remediation evaluation sampling, Fulcrum collected three-part samples consisting of the first draw, “second draw”, and “third draw” water volumes. Second and third draw samples are intended to represent the water quality of building piping and plumbing components behind the fixture and the water entering the building from the water main.

As a quality control measure, Fulcrum also included a laboratory blank of distilled water and a laboratory “spike” sample with known concentrations of lead and copper at the selected action levels for the project during all sampling events. Blank and spike sample results are included in the results tables for reference.

Blank and spike samples were used to evaluate laboratory performance. The reported lead and copper concentrations of quality assurance samples provided a metric to determine accuracy of the analyses. If the reported concentration of the spike sample differed from the action level, then the spike sample concentration was used as the action level.

Field evaluation of pH and temperature of drinking water was completed during the cold water flush and immediately following sample collection on select fixtures during the initial sampling event as a general evaluation of water quality.

Sampling Activities

Fulcrum's two-part sampling process consisted of an initial site visit the prior afternoon/evening to locate and flush each water sampling location (fixture). Sample collection occurred the following morning, after the fixture sat motionless for more than eight but no less than 18 hours, typically approximately 14 hours.

Initial Sampling

On the initial visit, Fulcrum flushed cold water through each fixture selected for sampling for approximately one minute. Following the flush, each fixture was covered and secured within a plastic bag. The plastic bags were marked with signage indicating testing was in progress and the fixture should not be used. Fulcrum returned to the school eight to 18 hours later to collect the samples. Each sample consisted of the first draw collected into 250-mL unpreserved polyethylene bottles and was immediately placed on ice in a chilled cooler.

Samples collected from the initial sampling event were delivered under chain-of-custody to RJ Lee Group's Columbia Basin Analytical Laboratory (Ecology Lab ID: C859-16) in Pasco, Washington for analysis.

Fixture Replacement and Flushing

Fixtures identified with elevated lead concentrations were replaced and preconditioned by running cold water continuously through the fixture for 24 hours, as outlined in WAC 246-366A-130. Following replacement and preconditioning, Fulcrum collected follow-up samples to confirm the success of fixture replacement.

Fixtures producing elevated copper concentrations were generally identified in newer District buildings and were not associated with specific fixture styles. The relationship between building construction age and fixture styles indicates elevated copper concentrations are principally associated with construction debris in the plumbing system.

All fixtures with elevated copper were flushed aggressively by running water through the fixture at high flow with the aerator removed for approximately 30 minutes to clear the plumbing of any debris potentially causing elevated copper concentrations. Following an aggressive flush, fixtures were resampled to evaluate the effectiveness at reducing copper concentrations. The District elected to install filters on fixtures that did not respond to an aggressive flush. Filtered fixtures were resampled following filter installation to verify effectiveness of the filter.

Remedial Sampling

Remedial sampling typically consisted of first, second, and third draw samples from the fixture location and plumbing system in question. First draw samples were collected into 250 mL polyethylene bottles preserved with nitric acid. The second draw water volume consists of water collected into a 250 mL unpreserved polyethylene container immediately following the first draw. No water was lost between collection of the first and second draw samples. The third draw water volume is a 1,000 mL sample collected

into a one liter unpreserved polyethylene container after the fixture has been flushed for about three to five minutes.

Samples collected following remedial activities were shipped by common carrier under chain of custody to Fremont Analytical Laboratory (Ecology Lab ID: C910-16) in Seattle, Washington for analysis. Fremont was selected based on their availability to complete analysis on an expedited schedule.

Analytical Results

Samples from both initial and remedial sampling events were analyzed for lead and copper in drinking water by EPA Method 200.8.

Initial Sampling

Sample locations from the initial sampling event are presented in Figure 1 in Attachment A of this letter. A site-specific sampling and analysis plan (SSSAP) that provides a building specific summary of the location, number, and sampling frequency of water fixture locations is located in Attachment B. Initial analytical results are summarized in Table 1 located in Attachment C of this letter. Laboratory analytical results from the initial sampling event are located in Attachment D of this letter.

In addition, pH and temperature data from the initial sampling event is presented in Table 2 in Attachment C of this letter.

Remedial Sampling

Sample locations from the remedial sampling event are presented in Figure 1 in Attachment A of this letter. The remedial analytical results from this project are summarized in Table 3 located in Attachment C of this letter. Laboratory analytical results from the remedial sampling event are located in Attachment E of this letter.

Discussion

Initial Sampling

Analytical results identified two samples with copper concentrations above the EPA action level of 1,300 µg/L. No samples were identified with lead concentrations above the EPA action level of 15 µg/L.

Remedial Sampling

Immediately following receipt of initial sampling results, the District removed the identified fixtures from service pending remediation and further testing. To remediate elevated copper concentrations, the District completed an aggressive flush of the fixtures. Fulcrum returned on the morning following the aggressive flush, February 25, 2017, to collect follow-up samples.

Analytical results from remedial sampling indicated the aggressive flush was successful at reducing copper concentrations below the action level for the fixtures in question.

Recommendations

No samples were found to contain lead concentrations above the EPA action level of 15 µg/L. Two initial samples contained copper above the EPA action level of 1,300 µg/L. The District completed an aggressive flush to reduce the copper concentration of the fixtures and follow-up samples yielded results below the action level, confirming the remediation was successful. Following sampling and review of laboratory results, Fulcrum recommended, and the District elected, to return the fixtures to service.

As all samples now report concentrations below lead and copper action levels, Fulcrum does not recommend any additional sampling at this time. However, consistent with industry practice and the intent of WAC 246-366A, Fulcrum recommends that the District complete re-sampling of the building within the next five years (before December 2021). Additionally, if WAC 246-366A-130 is enacted, the regulations would require testing of all remaining fixtures within two years of the effective date (July 1, 2017).

If you have any questions, please feel free to contact me at (509) 574-0839.

Sincerely,



Amanda Enbysk, GIT
Environmental Geologist




Ryan K. Mathews, CIH, CHMM
Principal



ATTACHMENT A

Figure 1: Sample Location Map




LEGEND

- KF-## - Kitchen faucet
- CF-## - Classroom faucet
- CDF-## - Classroom drinking fountain
- OF-## - Office faucet
- WC-## - Water cooler fountain
- BF-## - Bottle filler fountain
- NF-## - Nurse's faucet

- - Sample location: faucet
- - Sample location: drinking fountain at sink
- ■ - Sample location: faucet and drinking fountain at same sink
- ▼ - Sample location: water cooler fountain

-Lead (Pb) and copper (Cu) results for each sample location are below each identifier. All results reported in µg/L.

-Samples in **BOLD RED** indicate fixture locations where the initial concentrations of lead or copper were above the respective action level.

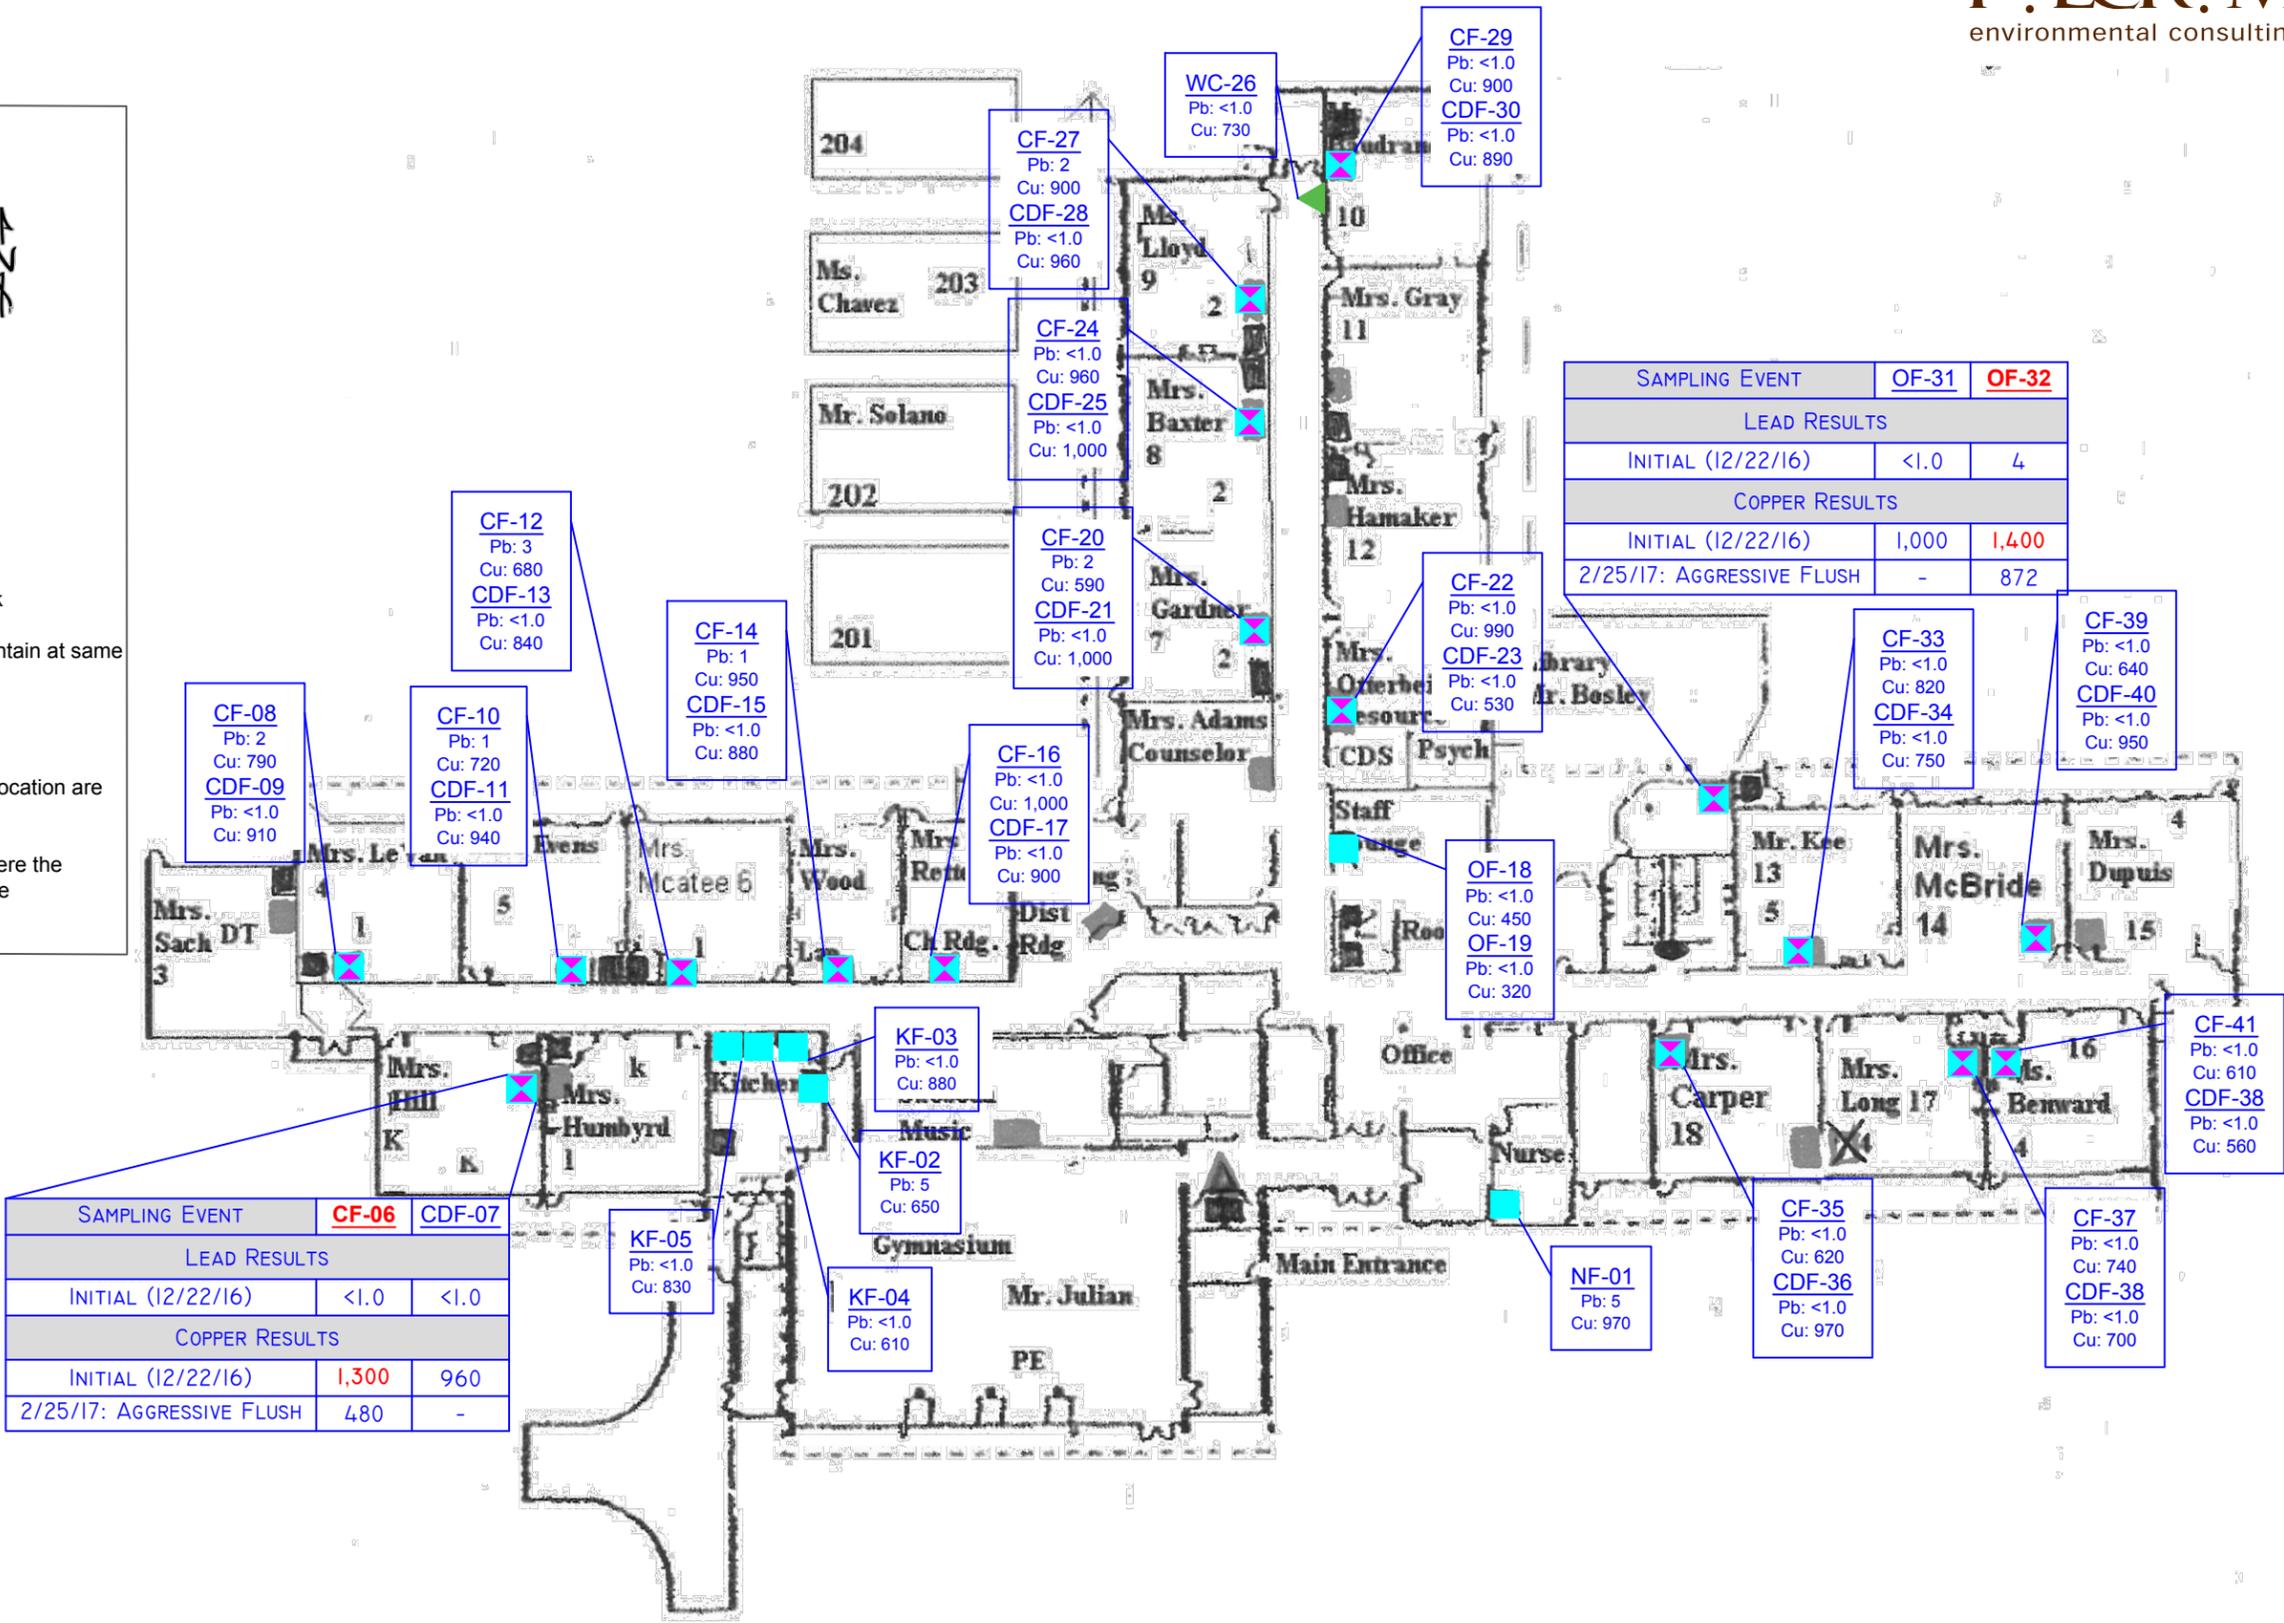

ATTACHMENT B

Site-Specific Sampling and Analysis Plan



Site-Specific Sampling and Analysis Plan

Kennewick School District – Winter 2016 Drinking Water Sampling

Note: This SSSAP has been prepared as a supplement to the project SAP/QAPP and provide a building specific summary of the location, number, and sampling frequency of water fixture locations.

Campus/Building: Hawthorne Elementary Address: 3520 West John Day Avenue, Kennewick, WA

Elementary Middle School High School Administration

Date of Construction: 1956 Modernizations: 1995

Fixture Type	Locations	Fixture Styles¹	Samples	Ratio
Drinking fountain/water cooler (DF/WC)	2	1	1	50%
Kitchen Fixture (KF)	4	4	4	100%
Classroom faucet, including faucets in Food Labs and Life Sciences Classrooms (CF)	23	1	15	65%
Classroom drinking fountain at sink (CDF)	26	1	17	65%
Nurse's Office/Health Room (NF)	1	1	1	100%
Teacher's Lounges/Work Rooms (OF)	4	2	4	100%
TOTALS	60		42	70%

¹ Fixture styles are approximate based on sampler's observations

Lead Sampler: Logan Lopez Date: 12/22/2016

Sample Prefix: HTE – 122216 – P (first-draw) – 01-44
School Code Date Sample Type Fixture Type Sample Number

Laboratory: R. J. Lee Group, Columbia Basin Analytical Delivery Date: December 22, 2016

Comments:

ATTACHMENT C

Table 1: Initial Sampling Analytical Results Summary Table
Table 2: pH and Temperature Data Summary Table
Table 3: Remedial Sampling Analytical Results Summary Table




Table 1: Initial Sampling Analytical Results

Sample Identification and Location	Fixture Type	Lead Results (µg/L)	Copper Results (µg/L)
122216-HTE-P-NF-01: Nurse's Office	Nurse's Faucet	5	970
122216-HTE-P-KF-02: Kitchen, East wall	Kitchen Faucet	2	650
122216-HTE-P-KF-03: Kitchen, North wall, rightmost fixture	Kitchen Faucet	<1.0	880
122216-HTE-P-KF-04: Kitchen, North wall, center sprayer	Kitchen Faucet	<1.0	610
122216-HTE-P-KF-05: Kitchen, North wall, faucet	Kitchen Faucet	<1.0	830
122216-HTE-P-CF-06: Room 2	Classroom Faucet	<1.0	1,300
122216-HTE-P-CDF-07: Room 2	Classroom Drinking Fountain	<1.0	960
122216-HTE-P-CF-08: Room 4	Classroom Faucet	2	790
122216-HTE-P-CDF-09: Room 4	Classroom Drinking Fountain	<1.0	910
122216-HTE-P-CF-10: Room 5	Classroom Faucet	1	720
122216-HTE-P-CDF-11: Room 5	Classroom Drinking Fountain	<1.0	940
122216-HTE-P-CF-12: Room 6	Classroom Faucet	3	680
122216-HTE-P-CDF-13: Room 6	Classroom Drinking Fountain	<1.0	840
122216-HTE-P-CF-14: Support Services A	Classroom Faucet	1	950
122216-HTE-P-CDF-15: Support Services A	Classroom Drinking Fountain	<1.0	880
122216-HTE-P-CF-16: Support Services B	Classroom Faucet	<1.0	1,000
122216-HTE-P-CDF-17: Support Services B	Classroom Drinking Fountain	<1.0	900
122216-HTE-P-OF-18: Staff Lounge	Office Faucet	<1.0	450
122216-HTE-P-OF-19: Staff Lounge, instant hot	Office Faucet	<1.0	320
122216-HTE-P-CF-20: Counselor's Office	Classroom Faucet	2	590
122216-HTE-P-CDF-21: Counselor's Office	Classroom Drinking Fountain	<1.0	1,000
122216-HTE-P-CF-22: Resource Room	Classroom Faucet	<1.0	990
122216-HTE-P-CDF-23: Resource Room	Classroom Drinking Fountain	<1.0	530
122216-HTE-P-CF-24: Room 8	Classroom Faucet	<1.0	960
122216-HTE-P-CDF-25: Room 8	Classroom Drinking Fountain	<1.0	1,000
122216-HTE-P-WC-26: Corridor adjacent Room 10	Water Cooler Fountain	<1.0	730
122216-HTE-P-CF-27: Room 9	Classroom Faucet	2	900
122216-HTE-P-CDF-28: Room 9	Classroom Drinking Fountain	<1.0	960
122216-HTE-P-CF-29: Room 10	Classroom Faucet	<1.0	900
122216-HTE-P-CDF-30: Room 10	Classroom Drinking Fountain	<1.0	890
122216-HTE-P-OF-31: Library Workroom	Office Faucet	<1.0	1,000
122216-HTE-P-OF-32: Library Workroom	Classroom Drinking Fountain	4	1,400
122216-HTE-P-CF-33: Room 13	Classroom Faucet	<1.0	820
122216-HTE-P-CDF-34: Room 13	Classroom Drinking Fountain	<1.0	750
122216-HTE-P-CF-35: Room 18	Classroom Faucet	<1.0	620
122216-HTE-P-CDF-36: Room 18	Classroom Drinking Fountain	<1.0	970
122216-HTE-P-CF-37: Room 17	Classroom Faucet	<1.0	740
122216-HTE-P-CDF-38: Room 17	Classroom Drinking Fountain	<1.0	700
122216-HTE-P-CF-39: Room 14	Classroom Faucet	<1.0	640
122216-HTE-P-CDF-40: Room 14	Classroom Drinking Fountain	<1.0	950
122216-HTE-P-CF-41: Room 16	Classroom Faucet	<1.0	610
122216-HTE-P-CDF-42: Room 16	Classroom Drinking Fountain	<1.0	560

Sample Identification and Location	Fixture Type	Lead Results (µg/L)	Copper Results (µg/L)
<i>122216-HTE-P-OF-43: Laboratory Blank</i>	<i>Distilled Water Blank</i>	<1.0	<10
<i>122216-HTE-P-OF-44: Laboratory Spike</i>	<i>Lead and Copper Spike</i>	13	1,100
EPA Action Level		15	1,300

- 1 µg/L means microgram per liter or parts per billion (ppb).
- 2 Action levels based on the U.S. EPA's Lead and Copper Rule.

Results indicated in **bold** indicate concentrations above the action levels of 15 µg/L for lead and 1,300 µg/L for copper
Results indicated in *italics* are quality assurance spike and blank samples.


Table 2: pH and Temperature Data Summary

Sample Number	Fixture Type	pH Flush	pH Sample	Temperature (°C) Flush	Temperature (°C) Sample
122216-HTE-P-NF-01: Nurses Office	Nurse's Faucet	7.91	7.95	20.2	19.6
122216-HTE-P-KF-05: Kitchen North Sink	Kitchen Faucet	8.05	7.83	13.4	20.3
122216-HTE-P-CDF-09: Room 4	Classroom Drinking Fountain	7.58	7.63	20.7	20.5
122216-HTE-P-CDF-13: Room 6	Classroom Drinking Fountain	7.52	7.54	21.3	20.5
122216-HTE-P-CDF-17: Support Services B	Classroom Drinking Fountain	7.51	7.58	22.1	20.7
122216-HTE-P-CDF-21: Counselor's Office	Classroom Drinking Fountain	7.55	7.61	19.7	20.3
122216-HTE-P-CDF-25: Room 8	Classroom Drinking Fountain	7.74	7.54	21.2	19.4
122216-HTE-P-CF-29: Room 10	Classroom Faucet	7.87	7.71	21.6	19.8
122216-HTE-P-CF-33: Room 13	Classroom Faucet	7.87	7.76	18.9	20.0
122216-HTE-P-CF-37: Room 17	Classroom Faucet	7.86	7.78	20.4	20.3
122216-HTE-P-CF-41: Room 16	Classroom Faucet	7.79	7.77	20.3	20.6

Table 3: Remedial Sampling Analytical Results


Sampling Event	Sample Identification			
	CF-06	OF-32	Laboratory Blank (-43)	Laboratory Spike (-44)
Initial (12/22/2016)	1,300	1,400	<10	<i>1,100</i>
Aggressive Flush (2/25/2017)	480	872	<0.5	<i>1,220</i>
EPA Action Level	1,300	1,300	1,300	1,300

- 1 µg/L means microgram per liter or parts per billion (ppb).
- 2 Action levels based on the U.S. EPA’s Lead and Copper Rule.
 Results indicated in **bold** indicate concentrations above the action levels of 15 µg/L for lead and 1,300 µg/L for copper
 Results indicated in *italics* are quality assurance spike and blank samples.



ATTACHMENT D

Initial Analytical Results





RJ LeeGroup, Inc. | Columbia Basin Analytical Laboratories

2710 North 20th Avenue, Pasco WA 99301

Tel: (509) 545-4989 | Fax: (509) 544-6010

Fulcrum Environmental
406 N. 2nd St.
Yakima, WA 98901

Subject: Chemical Analysis Report

Columbia Basin Analytical Laboratories received 44 sample(s) on 12/22/16 for analysis. These sample(s) have been assigned a login order number of W612120. Enclosed is the final report that consists of a summary report of the sample(s), and a copy of the chain of custody.

General Lab Comments

The results provided in this report relate only to the items tested. Sample(s) were received in acceptable conditions unless otherwise noted in the comments above. Sample(s) have not been field blank corrected unless otherwise noted in the general set comments above. The sample(s) were prepared in accordance with EPA 200.8 and analyzed in compliance with EPA 200.8. This test report shall not be reproduced, except in full, without written approval of Columbia Basin Analytical Laboratories. Any questions, please contact our office.

Matrix spike failures for copper attributed to calibration range exceedance and matrix effects have been qualified per the analytical method.

All samples were diluted 1:10.

X - Samples that exceeded the instrument calibration range were rerun at a 1:100 dilution, necessitating a 10-fold increase in the PQL.

Release of the data contained in the hard copy report has been authorized by the Laboratory Director or a designee as verified by the following signature. This report has been administratively reviewed by the following individual:

02/09/17

Project Coordinator II, M. Fernanda Pincheira

Date

If you have any questions please feel free to contact Fernanda Pincheira at MPincheira@rjleegroup.com.

Columbia Basin Analytical Laboratories | 2710 North 20th Avenue, Pasco WA 99301 | 509.545.4989

WWW.RJLEEGROUP.COM

Report Template: GenMetalReportFull_v12.rpt

Approved: 02/9/17 12:33
Report Time Stamp: 02/09/17 15:13



Laboratory Report

Ryan Mathews
Fulcrum Environmental
406 N. 2nd St.
Yakima, WA 98901

RJ Lee Group No.: W612120
COC No.: Kennewick
Samples Received: 12/22/16
Analysis/Prep Date: 02/01/17
Report Date: 02/09/17

Client Project:

Fulcrum Kennewick

Sample Name: 122216-HTE-P-NF-01 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-01 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.97	0.01	
Lead	EPA 200.8	0.005	0.001	

Sample Name: 122216-HTE-P-KF-02 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-02 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.65	0.01	
Lead	EPA 200.8	0.002	0.001	

Sample Name: 122216-HTE-P-KF-03 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-03 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.88	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122216-HTE-P-KF-04 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-04 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.61	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122216-HTE-P-KF-05 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-05 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.83	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Columbia Basin Analytical Laboratories | 2710 North 20th Avenue, Pasco WA 93301 | 509.545.4989

WWW.RJLEEGROUP.COM

Report Template: GenMetalReportFull_v12.rpt

Approved: 02/9/17 12:33
Report Time Stamp: 02/09/17 15:13



Sample Name: 122216-HTE-P-CF-06 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-06 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	1.3	0.1	X
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122216-HTE-P-CDF-07 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-07 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.96	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122216-HTE-P-CF-08 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-08 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.79	0.01	
Lead	EPA 200.8	0.002	0.001	

Sample Name: 122216-HTE-P-CDF-09 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-09 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.91	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122216-HTE-P-CF-10 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-10 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.72	0.01	
Lead	EPA 200.8	0.001	0.001	

Sample Name: 122216-HTE-P-CDF-11 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-11 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.94	0.01	
Lead	EPA 200.8	< 0.0010	0.001	



Sample Name: 122216-HTE-P-CF-12 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-12 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.68	0.01	
Lead	EPA 200.8	0.003	0.001	

Sample Name: 122216-HTE-P-CDF-13 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-13 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.84	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122216-HTE-P-CF-14 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-14 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.95	0.01	
Lead	EPA 200.8	0.001	0.001	

Sample Name: 122216-HTE-P-CDF-15 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-15 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.88	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122216-HTE-P-CF-16 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-16 **Date Analyzed:** 02/02/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	1.0	0.1	X
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122216-HTE-P-CDF-17 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-17 **Date Analyzed:** 02/02/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.9	0.1	X
Lead	EPA 200.8	< 0.0010	0.001	



Sample Name: 122216-HTE-P-OF-18 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-18 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.45	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122216-HTE-P-OF-19 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-19 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.32	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122216-HTE-P-CF-20 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-20 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.59	0.01	
Lead	EPA 200.8	0.002	0.001	

Sample Name: 122216-HTE-P-CDF-21 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-21 **Date Analyzed:** 02/02/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	1.0	0.1	X
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122216-HTE-P-CF-22 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-22 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.99	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122216-HTE-P-CDF-23 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-23 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.53	0.01	
Lead	EPA 200.8	< 0.0010	0.001	



Sample Name: 122216-HTE-P-CF-24 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-24 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.96	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122216-HTE-P-CDF-25 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-25 **Date Analyzed:** 02/02/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	1.0	0.1	X
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122216-HTE-P-WC-26 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-26 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.73	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122216-HTE-P-CF-27 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-27 **Date Analyzed:** 02/02/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.9	0.1	X
Lead	EPA 200.8	0.002	0.001	

Sample Name: 122216-HTE-P-CDF-28 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-28 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.96	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122216-HTE-P-CF-29 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-29 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.90	0.01	
Lead	EPA 200.8	< 0.0010	0.001	



Sample Name: 122216-HTE-P-CDF-30 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-30 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.89	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122216-HTE-P-OF-31 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-31 **Date Analyzed:** 02/02/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	1.0	0.1	X
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122216-HTE-OF-32 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-32 **Date Analyzed:** 02/02/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	1.4	0.1	X
Lead	EPA 200.8	0.004	0.001	

Sample Name: 122216-HTE-CF-33 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-33 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.82	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122216-HTE-P-CDF-34 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-34 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.75	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122216-HTE-P-CF-35 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-35 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.62	0.01	
Lead	EPA 200.8	< 0.0010	0.001	



Sample Name: 122216-HTE-P-CDF-36 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-36 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.97	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122216-HTE-P-CF-37 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-37 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.74	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122216-HTE-P-CDF-38 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-38 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.70	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122216-HTE-P-CF-39 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-39 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.64	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122216-HTE-P-CDF-40 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-40 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.95	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122216-HTE-P-CF-41 **Matrix:** Potable Water **Date Received:** 12/22/16
RJ Lee Grp. ID: W612120-41 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.61	0.01	
Lead	EPA 200.8	< 0.0010	0.001	



Sample Name: 122216-HTE-P-CDF-42 **Matrix:** Potable Water
RJ Lee Grp. ID: W612120-42

Date Received: 12/22/16
Date Analyzed: 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.56	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122216-HTE-P-OF-43 **Matrix:** Potable Water
RJ Lee Grp. ID: W612120-43

Date Received: 12/22/16
Date Analyzed: 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	< 0.010	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122216-HTE-P-OF-44 **Matrix:** Potable Water
RJ Lee Grp. ID: W612120-44

Date Received: 12/22/16
Date Analyzed: 02/02/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	1.1	0.1	X
Lead	EPA 200.8	0.013	0.001	

Report Qualifiers:

A = Target Analyte media breakthrough suspect, see analytical report

D = Analyte analyzed in a dilution

E = Report concentration was above the instrument calibration range

J = Analyte detected below quantitation limits, concentration is estimated

P = Library spectrum match, rsd >90% w RT match

Q = Result out of method specific acceptance QC criteria

S = Spike Recovery outside accepted recovery limits

Z = Not ELAP accredited analyte

ND = Not Detected

B = Analyte detected in the associated blank

d = Data that exceeds the RSD criteria set by the SOP

H = Holding times for preparation or analysis exceeded

L = Sample condition at receipt out of compliance with method defined conditions

R = RPD (relative percent difference) outside accepted recovery limits

U = Analyte analyzed for but not detected

N/A = Not Applicable

J. Cassman

Scientist III J Grissmerson

These results are submitted pursuant to RJ Lee Group's current terms and conditions of sale, including the company's standard warranty and limitation of liability provisions. No responsibility or liability is assumed for the manner in which the results are used or interpreted. Unless notified in writing to return the samples covered by this report, RJ Lee Group will store the samples for a period of ninety (90) days before discarding. A shipping and handling fee will be assessed for the return of any samples. Unless otherwise noted, samples were received in an acceptable condition. This laboratory operates in accordance with ISO 17025 guidelines, and holds limited scopes of accreditation under ORELAP Lab Code 4061 AIHA-LAP, LLC Lab ID 178656 EPA ID WA01195 and WA DOE Lab ID C859. This report may not be used to claim product endorsement by any laboratory accrediting agency. The results contained in this report relate only to the items tested or to the sample(s) as received by the laboratory. Any reproduction of this document must be in full for the report to be valid. Quality control data is available upon request.

Columbia Basin Analytical Laboratories | 2710 North 20th Avenue, Pasco WA 93301 | 509.545.4989

WWW.RJLEEGROUP.COM

Report Template: GenMetalReportFull_v12.rpt

Approved: 02/9/17 12:33
 Report Time Stamp: 02/09/17 15:13

Request for Environmental and IH Laboratory Analytical Services

W612120

ATTENTION TO: RYAN MATHEWS		Client No.:		Purchase Order No.:		Client Job No.:	
Lab Use Only	Project No.:	Client No.:	Logged In By:	Standard:	Yes	No	If 'No', No. of Business Days:
Report Results To	Name: Amanda Enbysk, Ryan Mathews			Sample Purpose: Information <input checked="" type="checkbox"/> Regulatory <input type="checkbox"/> Accreditation (please list below):			
	Company: Fulcrum Environmental Consulting			System ID #:			
	Address: 406 North 2nd Street			DOH Source #:			
	City, State, Zip: Yakima, WA, 98901			Multiple Sources #:			
	Phone: (509) 574-0839			Sample Purpose: A <input type="checkbox"/> B <input type="checkbox"/> Other <input type="checkbox"/>			
	Fax: (509) 575-8453			Preservation: Unpres <input type="checkbox"/> H ₂ SO ₄ <input type="checkbox"/> 4°C <input type="checkbox"/> HCl <input type="checkbox"/> NaOH <input type="checkbox"/> HNO ₃ <input type="checkbox"/> Other <input type="checkbox"/>	Matrix: WW=Wastewater <input type="checkbox"/> GW=Groundwater <input type="checkbox"/> S=Soil/Sludge <input type="checkbox"/> E=Extract <input type="checkbox"/>	Container: P=Plastic <input type="checkbox"/> G=Glass <input type="checkbox"/> W=Wipe <input type="checkbox"/> A=Air (filter or tube) <input type="checkbox"/>	
Send Invoice To	Name: Lorrie Boutilier			SW=Surface Water <input type="checkbox"/> DW=Drinking Water <input type="checkbox"/> O=Oil <input type="checkbox"/> X=Other <input type="checkbox"/>			
	Company: Fulcrum Environmental						
	Address: 406 North 2nd Street						
	City, State, Zip: Yakima, WA, 98901						
	Phone: (509) 574-0839						
	Fax: (509) 575-8453						
Special Instructions	EPA 200.8: Pb, Cu						
Client Sample ID	Sample Description	Sample Date	Sample Time	Start	Stop	Wipe Area / Air Volume	Analysis Requested
122216-HTE-P-N-F-01	Nurses office	12/22					UNPR
122216-HTE-P-KF-02	Kitchen East						DW
122216-HTE-P-KF-03	Kitchen N Entry						
122216-HTE-P-KF-04	Kitchen Busser						
122216-HTE-P-KF-05	Kitchen Sink						
122216-HTE-P-CT-06	Rm 2 Sink						
122216-HTE-P-CP-07	Rm 2 DF						
122216-HTE-P-CE-08	Rm 4 Sink						
122216-HTE-P-CP-09	Rm 4 DF						
122216-HTE-P-CE-10	Rm 5 Sink						
122216-HTE-P-DF-11	Rm 5 DF						
Chain of Custody	Relinquished By (Signature):	Date:	Time:	Relinquished To:	Date:	Time:	Method of Shipment:
Chain of Custody	Relinquished By (Print Name): Logan Joyce	12/22	1:05	Relinquished To:	12/22	1315	
Chain of Custody	Company Name:			Method of Shipment:			
Chain of Custody	Relinquished By (Signature):	Date:	Time:	Relinquished To:	Date:	Time:	Method of Shipment:
Chain of Custody	Relinquished By (Print Name):			Relinquished To:			
Chain of Custody	Company Name:			Method of Shipment:			

Pennsylvania - HQ
350 Hochberg Road
Monroeville, PA 15146

Washington
Columbia Basin Analytical Laboratories
2710 North 20th Avenue
Pasco, WA 99301

724.325.1776 Phone
724.733.1799 Fax

509.545.4989 Phone
509.544.6010 Fax



Request for Environmental and IH Laboratory Analytical Services

ATTENTION TO: RYAN MATHEWS		Purchase Order No.: 162017		Client Job No.: 162017				
Lab Use Only	Project No.: Date Logged In: Logged In By:	Client No.: Logged In By:		Turnaround Request	Standard: Yes <input type="checkbox"/> No <input type="checkbox"/> If 'No,' No. of Business Days: _____			
Report Results To	Name: Amanda Enbysk, Ryan Mathews Company: Fulcrum Environmental Consulting Address: 406 North 2nd Street City, State, Zip: Yakima, WA, 98901 Phone: (509) 574-0839 Fax: (509) 575-8453 Call with Verbal Results: Email Results To: aenbysk@fulcrum.net, CC: rmathews@fulcrum.net Fax Results To:	Sample Only Drinking Water System ID #: _____ DOH Source #: _____ Multiple Sources #: _____ Sample Purpose: A <input type="checkbox"/> B <input type="checkbox"/> Other <input type="checkbox"/>		Chemistry Analysis Key	Preservation: Unpres H ₂ SO ₄ 4°C HCl NaOH HNO ₃ Other Matrix: WW=Wastewater GW=Groundwater S=Soil/Sludge E=Extract Container: P=Plastic G=Glass W=Wipe A=Air (filter or tube)			
Send Invoice To	Name: Lorrie Boutillier Company: Fulcrum Environmental Address: 406 North 2nd Street City, State, Zip: Yakima, WA, 98901 Phone: (509) 574-0839 Fax: (509) 575-8453	Analysis Requested		Analysis Requested				
Special Instructions		EPA 200.8: Pb, Cu	Pres. Upon Receipt (Y/N)	Preservation	Matrix	Container Type	pH	No. Containers
Client Sample ID	Sample Description	Sample Date	Start	Stop	Wipe Area / Air Volume			
122216-HTE-P-CF-12	Rmb sink	12/22						18.8
122216-HTE-P-CDF-13	Rmb DF							18.8
122216-HTE-P-CF-14	Supp. Services A Sink							19.2
122216-HTE-P-DF-15	Supp. Serv ADF							18.6
122216-HTE-P-CF-16	Supp. Serv BDF							18.1
122216-HTE-P-CDF-17	Supp. Serv BDF							19.9
122216-HTE-P-DF-18	Lounge gc sink							20.6
122216-HTE-P-DF-19	Lounge HOT							21.5
122216-HTE-P-CF-20	Cyna Sectors							19.9
122216-HTE-P-CF-21	Counselors DF							19.5
122216-HTE-P-CF-22	Resource sink							21.2
Chain of Custody	Relinquished By (Signature): Relinquished By (Print Name): Company Name:	Date: 12/22 Time: 1315	Received By (Signature): Received By (Print Name): Company Name:		Date: DEC 22 2016 Time: 1315			
Chain of Custody	Relinquished By (Signature): Relinquished By (Print Name): Company Name:	Date: Time:	Received By (Signature): Received By (Print Name): Company Name:		Date: Time:			
Chain of Custody	Relinquished By (Signature): Relinquished By (Print Name): Company Name:	Date: Time:	Received By (Signature): Received By (Print Name): Company Name:		Date: Time:			

Pennsylvania - HQ
350 Hochberg Road
Monroeville, PA 15146
724.325.1776 Phone
724.733.1799 Fax

Washington
Columbia Basin Analytical Laboratories
2710 North 20th Avenue
Pasco, WA 99301
509.545.4989 Phone
509.544.6010 Fax



Request for Environmental and IH Laboratory Analytical Services

ATTENTION TO: RYAN MATHEWS		Purchase Order No.: 162017		Client Job No.: 162017			
Lab Use Only	Project No.:	Client No.:	Turnaround Request	Standard: Yes	No	If 'No,' No. of Business Days:	
Report Results To	Name: Amanda Embysk, Ryan Mathews	Logged In By:	Drinking Water Sample Only	System ID #:	DOH Source #:	Sample Purpose: Information X Regulatory <input type="checkbox"/> Accreditation (please list below):	
Company:	Fulcrum Environmental Consulting		Multiple Sources #s:	Sample Purpose: A <input type="checkbox"/> B <input type="checkbox"/> Other <input type="checkbox"/>		Matrix: WW=Wastewater GW=Groundwater S=Soil/Sludge E=Extract	
Address:	406 North 2nd Street		Sample Purpose: A <input type="checkbox"/> B <input type="checkbox"/> Other <input type="checkbox"/>	SW=Surface Water DW=Drinking Water O=Oil X=Other		Container: P=Plastic G=Glass W=Wipe A=Air (filter or tube)	
City, State, Zip:	Yakima, WA, 98901		Preservation:	Unpres H ₂ SO ₄ HCl NaOH HNO ₃ Other			
Phone:	(509) 574-0839		Matrix:	WW=Wastewater GW=Groundwater S=Soil/Sludge E=Extract			
Fax:	(509) 575-8453		Other:				
Call with Verbal Results:			Analysis Requested				
Email Results To:	aembysk@fulcrum.net; Cc: rmathews@fulcrum.net						
Fax Results To:							
Name:	Lorrie Boutillier						
Company:	Fulcrum Environmental						
Address:	406 North 2nd Street						
City, State, Zip:	Yakima, WA, 98901						
Phone:	(509) 574-0839						
Fax:	(509) 575-8453						
Special Instructions							
Client Sample ID	Sample Description	Sample Date	Sample Time	Start	Stop	Wipe Area / Air Volume	
122216-HTE-P-CDF-23	Resource DF 12/22						
122216-HTE-P-CF-24	Rm 8 Sink						
122216-HTE-P-CDF-25	Rm 8 DF						
122216-HTE-P-DC-26	Watercooler N						
122216-HTE-P-CF-27	Rm 9 Sink						
122216-HTE-P-CDF-28	Rm 9 DF						
122216-HTE-P-CF-29	Rm 10 Sink						
122216-HTE-P-CDF-30	Rm 10 DF						
122216-HTE-P-DF-31	Library Sink						
122216-HTE-DF-32	Library DF						
122216-HTE-DF-33	Rm 13 Sink						
Chain of Custody	Relinquished By (Signature):	Date:	Time:	Chain of Custody	Received By (Signature):	Date:	Time:
Relinquished By (Print Name):	Logan Lopez	12/22	3:15	Chain of Custody	Received By (Print Name):	12/22	13:15
Company Name:		Method of Shipment:		Company Name:		Method of Shipment:	
Relinquished By (Signature):		Date:	Time:	Chain of Custody	Received By (Signature):	Date:	Time:
Relinquished By (Print Name):		Relinquished To:		Chain of Custody	Received By (Print Name):	Relinquished To:	
Company Name:		Method of Shipment:		Company Name:		Method of Shipment:	

Pennsylvania - HQ
350 Hochberg Road
Monroeville, PA 15146

Washington
Columbia Basin Analytical Laboratories
2710 North 20th Avenue
Pasco, WA 99301

724.325.1776 Phone
724.733.1799 Fax

509.545.4989 Phone
509.544.6010 Fax



Request for Environmental and IH Laboratory Analytical Services

ATTENTION TO: RYAN MATHEWS		Purchase Order No.:		Client Job No.:		162017	
Lab Use Only	Project No.:	Client No.:	Standard: Yes No		If 'No,' No. of Business Days:		
	Date Logged In:	Logged In By:	Sample Purpose: Information X Regulatory <input type="checkbox"/> Accreditation (please list below):				
Report Results To	Name: Amanda Embysk, Ryan Mathews	Company: Fulcrum Environmental Consulting	System ID #:				
	Address: 406 North 2nd Street	City, State, Zip: Yakima, WA, 98901	DOH Source #:				
	Phone: (509) 574-0839	Fax: (509) 575-8453	Multiple Sources #:				
	Call with Verbal Results:		Preservation Purpose: <input type="checkbox"/> A <input type="checkbox"/> B <input type="checkbox"/> Other <input type="checkbox"/>				
	Email Results To: aembysk@fulcrum.net, CC: rmathews@fulcrum.net		Matrix: <input type="checkbox"/> WW=Wastewater <input type="checkbox"/> GW=Groundwater <input type="checkbox"/> S=Soil/Sludge <input type="checkbox"/> E=Extract				
	Fax Results To:		SW=Surface Water <input type="checkbox"/> DW=Drinking Water <input type="checkbox"/> O=Oil <input type="checkbox"/> X=Other				
	Name: Lorrie Boutillier		Container: <input type="checkbox"/> P=Plastic <input type="checkbox"/> G=Glass <input type="checkbox"/> W=Wipe <input type="checkbox"/> A=Air (filter or tube)				
Send Invoice To	Company: Fulcrum Environmental	Email: lboutillier@fulcrum.net	Analysis Requested				
	Address: 406 North 2nd Street		Pres. Upon Receipt (Y/N)				
	City, State, Zip: Yakima, WA, 98901	Fax: (509) 575-8453	Preservation				
Special Instructions			Matrix				
			Container Type				
			pH				
			No. Containers				
			EPA 200.8: Pb, Cu				
Client Sample ID	Sample Description	Sample Date	Start	Stop	Wipe Area / Air Volume		
122216-HTE-p-COF-34	Rm 130E 12/22						
122216-HTE-p-CF-35	Rm 18 Sink						
122216-HTE-p-COF-36	Rm 18 DF						
122216-HTE-p-CF-37	Rm 17 Sink						
122216-HTE-p-COF-38	Rm 17 DF						
122216-HTE-p-CF-39	Rm 14 Sink						
122216-HTE-p-COF-40	Rm 14 DF						
122216-HTE-p-CF-41	Rm 16 Sink						
122216-HTE-p-COF-42	Rm 16 DF						
122216-HTE-p-CF-43	Work Rm Sink						
122216-HTE-p-COF-44	Work Rm DF						
Chain of Custody	Relinquished By (Signature):	Date: 12/22	Time: 135				
	Relinquished By (Print Name): Logan Lopez	Method of Shipment:					
Chain of Custody	Received By (Signature):	Date: 12/22	Time: 135				
	Received By (Print Name): Ryan Mathews	Method of Shipment:					
Chain of Custody	Relinquished By (Signature):	Date:	Time:				
	Relinquished By (Print Name):	Method of Shipment:					
Chain of Custody	Received By (Signature):	Date:	Time:				
	Received By (Print Name):	Method of Shipment:					


Pennsylvania - HQ
350 Hochberg Road
Monroeville, PA 15146
724.325.1776 Phone
724.733.1799 Fax

Washington
Columbia Basin Analytical Laboratories
2710 North 20th Avenue
Pasco, WA 99301
509.545.4989 Phone
509.544.6010 Fax



ATTACHMENT E

Remedial Analytical Results





Fulcrum Environmental

Ryan Mathews
406 N. 2nd Street
Yakima, WA 98901

RE: Kennewick SD Drinking Water - Hawthorne Elementary
Work Order Number: 1702289

February 27, 2017

Attention Ryan Mathews:

Fremont Analytical, Inc. received 8 sample(s) on 2/27/2017 for the analyses presented in the following report.

Drinking Water Metals by EPA Method 200.8

This report consists of the following:

- Case Narrative
- Analytical Results
- Applicable Quality Control Summary Reports
- Chain of Custody

All analyses were performed consistent with the Quality Assurance program of Fremont Analytical, Inc. Please contact the laboratory if you should have any questions about the results.

Thank you for using Fremont Analytical.

Sincerely,

Chelsea Ward
Project Manager

CC:
Amanda Enbysk



Date: 02/27/2017

CLIENT: Fulcrum Environmental
Project: Kennewick SD Drinking Water - Hawthorne
Work Order: 1702289

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Date/Time Collected	Date/Time Received
1702289-001	22517-HTE-P-CF-06	02/25/2017 8:20 AM	02/27/2017 9:19 AM
1702289-002	22517-HTE-S-CF-06	02/25/2017 8:20 AM	02/27/2017 9:19 AM
1702289-003	22517-HTE-T-CF-06	02/25/2017 8:20 AM	02/27/2017 9:19 AM
1702289-004	22517-HTE-P-OF-32	02/25/2017 8:20 AM	02/27/2017 9:19 AM
1702289-005	22517-HTE-S-OF-32	02/25/2017 8:20 AM	02/27/2017 9:19 AM
1702289-006	22517-HTE-T-OF-32	02/25/2017 8:20 AM	02/27/2017 9:19 AM
1702289-007	22517-HTE-P-OF-43	02/25/2017 8:20 AM	02/27/2017 9:19 AM
1702289-008	22517-HTE-P-OF-44	02/25/2017 8:20 AM	02/27/2017 9:19 AM

CLIENT: Fulcrum Environmental
Project: Kennewick SD Drinking Water - Hawthorne Elementary

WorkOrder Narrative:

I. SAMPLE RECEIPT:

Samples receipt information is recorded on the attached Sample Receipt Checklist.

II. GENERAL REPORTING COMMENTS:

Results are reported on a wet weight basis unless dry-weight correction is denoted in the units field on the analytical report ("mg/kg-dry" or "ug/kg-dry").

Matrix Spike (MS) and MS Duplicate (MSD) samples are tested from an analytical batch of "like" matrix to check for possible matrix effect. The MS and MSD will provide site specific matrix data only for those samples which are spiked by the laboratory. The sample chosen for spike purposes may or may not have been a sample submitted in this sample delivery group. The validity of the analytical procedures for which data is reported in this analytical report is determined by the Laboratory Control Sample (LCS) and the Method Blank (MB). The LCS and the MB are processed with the samples and the MS/MSD to ensure method criteria are achieved throughout the entire analytical process.

III. ANALYSES AND EXCEPTIONS:

Exceptions associated with this report will be footnoted in the analytical results page(s) or the quality control summary page(s) and/or noted below.

Prep Sample Comments:

1702289-007A 208803: Prep Comments for EPA200.8, Sample 1702289-007A: Turbidity: 0.00 NTU
1702289-001A 208801: Prep Comments for EPA200.8, Sample 1702289-001A: Turbidity: 0.04 NTU
1702289-004A 208802: Prep Comments for EPA200.8, Sample 1702289-004A: Turbidity: 0.17 NTU
1702289-008A 208804: Prep Comments for EPA200.8, Sample 1702289-008A: Turbidity: 0.01 NTU

Qualifiers:

- * - Flagged value is not within established control limits
- B - Analyte detected in the associated Method Blank
- D - Dilution was required
- E - Value above quantitation range
- H - Holding times for preparation or analysis exceeded
- I - Analyte with an internal standard that does not meet established acceptance criteria
- J - Analyte detected below Reporting Limit
- N - Tentatively Identified Compound (TIC)
- Q - Analyte with an initial or continuing calibration that does not meet established acceptance criteria (<20%RSD, <20% Drift or minimum RRF)
- S - Spike recovery outside accepted recovery limits
- ND - Not detected at the Reporting Limit
- R - High relative percent difference observed

Acronyms:

- %Rec - Percent Recovery
- CCB - Continued Calibration Blank
- CCV - Continued Calibration Verification
- DF - Dilution Factor
- HEM - Hexane Extractable Material
- ICV - Initial Calibration Verification
- LCS/LCSD - Laboratory Control Sample / Laboratory Control Sample Duplicate
- MB or MBLANK - Method Blank
- MDL - Method Detection Limit
- MS/MSD - Matrix Spike / Matrix Spike Duplicate
- PDS - Post Digestion Spike
- Ref Val - Reference Value
- RL - Reporting Limit
- RPD - Relative Percent Difference
- SD - Serial Dilution
- SGT - Silica Gel Treatment
- SPK - Spike
- Surr - Surrogate



CLIENT: Fulcrum Environmental
Project: Kennewick SD Drinking Water - Hawthorne Elementary

Lab ID: 1702289-001 **Collection Date:** 2/25/2017 8:20:00 AM
Client Sample ID: 22517-HTE-P-CF-06 **Matrix:** Drinking Water

Analyses	Result	RL	Qual	Units	DF	Date Analyzed
----------	--------	----	------	-------	----	---------------

Drinking Water Metals by EPA Method 200.8

Batch ID: 16360 Analyst: TN

Copper	480	0.500		µg/L	1	2/27/2017 4:58:41 PM
--------	-----	-------	--	------	---	----------------------

Lab ID: 1702289-004 **Collection Date:** 2/25/2017 8:20:00 AM
Client Sample ID: 22517-HTE-P-OF-32 **Matrix:** Drinking Water

Analyses	Result	RL	Qual	Units	DF	Date Analyzed
----------	--------	----	------	-------	----	---------------

Drinking Water Metals by EPA Method 200.8

Batch ID: 16360 Analyst: TN

Copper	872	0.500		µg/L	1	2/27/2017 5:02:17 PM
--------	-----	-------	--	------	---	----------------------

Lab ID: 1702289-007 **Collection Date:** 2/25/2017 8:20:00 AM
Client Sample ID: 22517-HTE-P-OF-43 **Matrix:** Drinking Water

Analyses	Result	RL	Qual	Units	DF	Date Analyzed
----------	--------	----	------	-------	----	---------------

Drinking Water Metals by EPA Method 200.8

Batch ID: 16360 Analyst: TN

Copper	ND	0.500		µg/L	1	2/27/2017 5:13:08 PM
--------	----	-------	--	------	---	----------------------



CLIENT: Fulcrum Environmental
Project: Kennewick SD Drinking Water - Hawthorne Elementary

Lab ID: 1702289-008

Collection Date: 2/25/2017 8:20:00 AM

Client Sample ID: 22517-HTE-P-OF-44

Matrix: Drinking Water

Analyses	Result	RL	Qual	Units	DF	Date Analyzed
-----------------	---------------	-----------	-------------	--------------	-----------	----------------------

Drinking Water Metals by EPA Method 200.8

Batch ID: 16360

Analyst: TN

Copper	1,220	0.500		µg/L	1	2/27/2017 5:16:44 PM
--------	-------	-------	--	------	---	----------------------

Work Order: 1702289
CLIENT: Fulcrum Environmental
Project: Kennewick SD Drinking Water - Hawthorne

QC SUMMARY REPORT
Drinking Water Metals by EPA Method 200.8

Sample ID MB-16360	SampType: MBLK	Units: µg/L			Prep Date: 2/27/2017	RunNo: 34678					
Client ID: MBLKW	Batch ID: 16360				Analysis Date: 2/27/2017	SeqNo: 662272					
Analyte	Result	RL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Copper ND 0.500

Sample ID LCS-16360	SampType: LCS	Units: µg/L			Prep Date: 2/27/2017	RunNo: 34678					
Client ID: LCSW	Batch ID: 16360				Analysis Date: 2/27/2017	SeqNo: 662273					
Analyte	Result	RL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Copper 95.8 0.500 100.0 0 95.8 85 115

Sample ID 1702286-001ADUP	SampType: DUP	Units: µg/L			Prep Date: 2/27/2017	RunNo: 34678					
Client ID: BATCH	Batch ID: 16360				Analysis Date: 2/27/2017	SeqNo: 662277					
Analyte	Result	RL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Copper 521 0.500 546.9 4.82 30

Sample ID 1702286-001AMS	SampType: MS	Units: µg/L			Prep Date: 2/27/2017	RunNo: 34678					
Client ID: BATCH	Batch ID: 16360				Analysis Date: 2/27/2017	SeqNo: 662278					
Analyte	Result	RL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Copper 728 0.500 200.0 546.9 90.5 70 130

Sample ID 1702286-001AMSD	SampType: MSD	Units: µg/L			Prep Date: 2/27/2017	RunNo: 34678					
Client ID: BATCH	Batch ID: 16360				Analysis Date: 2/27/2017	SeqNo: 662279					
Analyte	Result	RL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Copper 737 0.500 200.0 546.9 94.9 70 130 727.8 1.21 30



3600 Fremont Ave N.
Seattle, WA 98103

Tel: 206-352-3790
Fax: 206-352-7178

Chain of Custody Record and Laboratory Services Agreement

Date: 2/25/2017

Laboratory Project No (Internal):

1702289

Client: Fulcrum Environmental Consulting, Inc.
Address: 406 North Second Street
City, State, Zip: Yakima, WA 98901
Telephone: 509.574.0839

Project Name: Kennewick SD Drinking Water - Hawthorne Elementary
Project No: 162017.20
Location: Hawthorne Elementary, Kennewick, WA
Report To (PM): Ryan Mathews
PM Email: rmathews@fulcrum.net

*Matrix Codes: A = Air, AQ = Aqueous, B = Bulk, O = Other, P = Product, S = Soil, SD = Sediment, SL = Solid, W = Water, DW = Drinking Water, GW = Ground Water, SW = Storm Water, WW = Waste Water

Sample Name	Sample Date	Sample Time	Sample Type (Matrix)*	Analytes											Comments			
				VOCs (EPA 8260 / 624)	GX/BTEX	BTEX	Gasoline Range Organics (GX)	Hydrocarbon Identification (HCID)	Diesel/Heavy Oil Range Organics (DX)	SVOCs (EPA 8270 / 625)	PAHs (EPA 8270 - SIM)	PCBs (EPA 8082 / 608)	Metals ** (EPA 6020 / 200.8)	Total (T) Dissolved (D)		Anions (IC)***	EDB (8011)	
22517-HTE-R-CF-06	2/25/2017	0800	DW															H2O2 preserved
22517-HTE-S-CF-06																		H2O2 preserved
22517-HTE-T-CF-06																		H2O2 preserved
22517-HTE-R-CF-32																		H2O2 preserved
22517-HTE-S-CF-32																		H2O2 preserved
22517-HTE-T-CF-32																		H2O2 preserved
22517-HTE-R-CF-44																		H2O2 preserved

**Metals Analysis (Circle): MTCA-5 RCAA-8 Priority Pollutants TAL Individual: Ag Al As B Ba Be Ca Cd Co Cr Cu Fe Hg K Mg Mn Mo Na Ni Pb Sb Se Sr Sn Tl U V Zn

***Anions (Circle): Nitrate Nitrite Chloride Sulfate Bromide O-Phosphate Fluoride Nitrate+Nitrite

Sample Disposal: Return to Client Disposal by Lab (samples will be held for 30 days unless otherwise noted. A fee may be assessed if samples are retained after 30 days.)

I represent that I am authorized to enter into this Agreement with Fremont Analytical on behalf of the Client named above, that I have verified Client's agreement to each of the terms on the front and backside of this Agreement.

Relinquished Received
 Relinquished Date/Time: 2/25/2017, 1300 Received Date/Time: 2/27/17 0919

Special Remarks: *please preserve all unpreserved samples*

TAT: ASAP

TAT → SameDay^ NextDay^ 2 Day 3 Day STD

*Please coordinate with the lab in advance