

November 6, 2017

Kennewick School District No. 17  
Attn: Keith Colee, Maintenance and Operations Manager  
1000 West Fourth Avenue  
Kennewick, Washington, 99336

**RE: Winter 2016 Drinking Water Sampling Results  
Horse Heaven Hills Middle School, 3500 South Vancouver Street, Kennewick,  
Washington**

Dear Keith:

On Thursday, December 22, 2016, Fulcrum Environmental Consulting, Inc. (Fulcrum) collected 32 drinking water samples for lead and copper analysis from Horse Heaven Hills Middle School (School) located at 3500 South Vancouver Street in Kennewick, Washington. Initial sampling identified one fixture location with a lead concentration above guidance levels and one fixture location with a copper concentration above guidance levels. Fulcrum returned to the School on March 31, 2017 to collect samples after remediation of the fixtures and laboratory results found concentrations to be below guidance levels. Sampling was completed as part of a District-wide project and all analysis was completed by Washington State Department of Ecology (Ecology) accredited laboratories.

### Summary

The purpose of initial sampling was to evaluate current drinking water quality conditions with respect to lead and copper as a result of the increased national and local interest related to lead in drinking water. The intent of sampling was to meet the requirements of the pending regulations set forth in Washington Administrative Code (WAC) 246-366A-130 and 246-366A-135<sup>1</sup>. Consistent with the regulations, Fulcrum completed sampling at the rates of at least 50% of plumbing fixtures used regularly for drinking or cooking in elementary and preschools and at least 25% of drinking or cooking fixtures in middle schools, junior high schools, and high schools. In addition, Fulcrum sampled administrative facilities in the District at the same rate as elementary schools, of at least 50% of drinking and cooking fixtures.

Fulcrum completed initial sampling on December 22, 2016. Initial results identified one sample with a lead concentration of 19 micrograms per liter ( $\mu\text{g/L}$ ), above the Environmental Protection Agency (EPA) action level of 15  $\mu\text{g/L}$ , and two samples with copper concentrations above the EPA action level of 1,300  $\mu\text{g/L}$ . Upon receipt of results, the District removed the identified fixtures from service pending remediation and further testing.

---

<sup>1</sup> Washington State Department of Health, WAC 246-366A, *The Environmental Health and Safety Standards of Primary and Secondary Schools*, <http://apps.leg.wa.gov/WAC/default.aspx?cite=246-366A>, July 26, 2016

The fixture identified with an elevated lead concentration was replaced and preconditioned by running cold water continuously through the fixture for 24 hours, as specified in WAC 246-366A-130. Following replacement and preconditioning, Fulcrum returned to the School on March 31, 2017 and collected follow-up samples to confirm the success of fixture replacement. No other fixtures of like style were replaced. Follow-up samples yielded results below the EPA action level, confirming fixture replacement was successful.

Copper is not a significant component in fixtures, but is the primary material in the plumbing system. To remediate elevated copper, the District aggressively flushed the fixture with cold water to clear the plumbing of copper construction debris. Fulcrum returned on March 31, 2017 and collected a sample to evaluate the success of the remediation. The follow-up sample found copper concentrations below the EPA action level, confirming the remediation was successful. Following sampling and review of laboratory results, Fulcrum recommended, and the District elected, to return the fixtures to service. Fulcrum recommended that the District replace all fixtures of like style to those initially identified with elevated lead.

As all samples now report concentrations below lead and copper action levels, at this time Fulcrum does not recommend any additional sampling. However, consistent with industry practice and the intent of WAC 246-366A, Fulcrum recommends that the District complete re-sampling of the building within the next five years (before December 2021).

## **Sampling Methodology**

As a portion of this project, Fulcrum prepared a Sampling and Analysis Plan (SAP) intended to satisfy future initial sampling requirements under pending regulations.

For initial evaluation purposes, Fulcrum collected “first draw” samples. This “first draw” water volume consists of 250 milliliters (mL) and is intended to represent the water quality in the fixture, tubing connecting the fixture to the building piping, and potentially a portion of the building piping. If lead and copper are present, this first-draw sample typically contains the highest lead levels and indicates high copper from the associated building piping.

For most post-remediation evaluation sampling, Fulcrum collected three-part samples consisting of the first draw, “second draw”, and “third draw” water volumes. Second and third draw samples are intended to represent the water quality of building piping and plumbing components behind the fixture and the water entering the building from the water main.

As a quality control measure, Fulcrum also included a laboratory blank of distilled water and a laboratory “spike” sample with known concentrations of lead and copper at the selected action levels for the project during all sampling events. Blank and spike sample results are included in the results tables for reference.

Blank and spike samples were used to evaluate laboratory performance. The reported lead and copper concentrations of quality assurance samples provided a metric to determine accuracy of the analyses. If the reported concentration of the spike sample differed from the action level, then the spike sample

concentration was used as the action level.

Field evaluation of pH and temperature of drinking water was completed during the cold water flush and immediately following sample collection on select fixtures during the initial sampling event as a general evaluation of water quality.

## **Sampling Activities**

Fulcrum's two-part sampling process consisted of an initial site visit the prior afternoon/evening to locate and flush each water sampling location (fixture). Sample collection occurred the following morning, after the fixture sat motionless for more than eight but no less than 18 hours, typically approximately 14 hours.

### Initial Sampling

On the initial visit, Fulcrum flushed cold water through each fixture selected for sampling for approximately one minute. Following the flush, each fixture was covered and secured within a plastic bag. The plastic bags were marked with signage indicating testing was in progress and the fixture should not be used. Fulcrum returned to the school eight to 18 hours later to collect the samples. Each sample consisted of the first draw collected into 250-mL unpreserved polyethylene bottles and was immediately placed on ice in a chilled cooler.

Samples collected from the initial sampling event were delivered under chain-of-custody to RJ Lee Group's Columbia Basin Analytical Laboratory (Ecology Lab ID: C859-16) in Pasco, Washington for analysis.

### Fixture Replacement and Flushing

Fixtures identified with elevated lead concentrations were replaced and preconditioned by running cold water continuously through the fixture for 24 hours, as outlined in WAC 246-366A-130. Following replacement and preconditioning, Fulcrum collected follow-up samples to confirm the success of fixture replacement.

Fixtures producing elevated copper concentrations were generally identified in newer District buildings and were not associated with specific fixture styles. The relationship between building construction age and fixture styles indicates elevated copper concentrations are principally associated with construction debris in the plumbing system.

All fixtures with elevated copper were flushed aggressively by running water through the fixture at high flow with the aerator removed for approximately 30 minutes to clear the plumbing of any debris potentially causing elevated copper concentrations. Following an aggressive flush, fixtures were resampled to evaluate the effectiveness at reducing copper concentrations. The District elected to install filters, install signage indicating the fixtures should be used only for handwashing, or permanently removed fixtures that did not respond to an aggressive flush. Filtered fixtures were resampled following filter installation to verify effectiveness of the filter.

### Remedial Sampling

Remedial sampling typically consisted of first, second, and third draw samples from the fixture locations and plumbing system in question. First draw samples were collected into 250 mL polyethylene bottles preserved with nitric acid. The second draw water volume consists of water collected into a 250 mL unpreserved polyethylene container immediately following the first draw. No water was lost between collection of the first and second draw samples. The third draw water volume is a 1,000 mL sample collected into a one liter unpreserved polyethylene container after the fixture has been flushed for about three to five minutes.

Samples collected following remedial activities were shipped by common carrier under chain of custody to Fremont Analytical Laboratory (Ecology Lab ID: C910-16) in Seattle, Washington for analysis. Fremont was selected based on their availability to complete analysis on an expedited schedule.

### **Analytical Results**

Samples from both initial and remedial sampling events were analyzed for lead and copper in drinking water by EPA Method 200.8.

#### Initial Sampling

Sample locations from the initial sampling event are presented in Figure 1 in Attachment A of this letter. A site-specific sampling and analysis plan (SSSAP) that provides a building specific summary of the location, number, and sampling frequency of water fixture locations is located in Attachment B. Initial analytical results are summarized in Table 1 located in Attachment C of this letter. Laboratory analytical results from the initial sampling event are located in Attachment D of this letter.

In addition, pH and temperature data from the initial sampling event is presented in Table 2 in Attachment C of this letter.

#### Remedial Sampling

Sample locations from remedial sampling events are presented in Figure 1 in Attachment A of this letter. The remedial analytical results from this project are summarized in Table 3 located in Attachment C of this letter. Laboratory analytical results from the remedial sampling event are located in Attachment E of this letter.

### **Discussion**

#### Initial Sampling

Analytical results identified one sample with a lead concentration of 19  $\mu\text{g/L}$ , above the EPA action level of 15  $\mu\text{g/L}$ , located in Room 810, and one sample with a copper concentration of 1,300  $\mu\text{g/L}$ , at or above the EPA action level of 1,300  $\mu\text{g/L}$ , located in Room 301.

Remedial Sampling

Immediately following receipt of initial sampling results, the District removed the identified fixtures from service pending remediation and further testing. To remediate elevated lead concentrations, the District replaced the identified fixture. Fulcrum returned on March 31, 2017 following fixture replacement and preconditioning to collect follow-up samples from the initially identified fixture. No other fixtures of like style were replaced. See Attachment F for a photograph layout with the identified fixture style.

To remediate elevated copper concentrations, the District completed an aggressive flush of the identified fixture. Fulcrum returned on the morning following the aggressive flush, March 31, 2017, to collect a follow-up sample from the fixture.

Analytical results from remedial sampling indicated the fixture replacement and aggressive flushing were successful at reducing lead and copper concentrations below action levels for the fixtures in question.

**Recommendations**

One initial sample contained lead above the EPA action level of 15 µg/L and one initial sample contained copper above the EPA action level of 1,300 µg/L. The District replaced the identified fixture with elevated lead and preconditioned the fixture for 24 hours as specified in WAC 246-366A-130. The District completed an aggressive flush of the fixture identified with elevated copper. Follow-up sampling demonstrated that all lead and copper concentrations were below action levels. Following remedial sampling and review of laboratory results, Fulcrum recommended, and the District elected, to return the fixtures to service. Fulcrum recommends the District replace all fixtures of like style to those initially identified with elevated lead. See Attachment F for a photograph layout of the identified fixture style.

As all samples now report concentrations below lead and copper action levels, Fulcrum does not recommend any additional sampling at this time. However, consistent with industry practice and the intent of WAC 246-366A, Fulcrum recommends that the District complete re-sampling of the building within the next five years (before December 2021).

If you have any questions, please feel free to contact me at (509) 574-0839.

Sincerely,



Amanda Enbysk, GIT  
Environmental Geologist




Ryan K. Mathews, CIH, CHMM  
Principal



**ATTACHMENT A**

Figure 1: Sample Location Map




**LEGEND**

- KF-## - Kitchen faucet
- CF-## - Classroom faucet
- CDF-## - Classroom drinking fountain
- OF-## - Office faucet
- WC-## - Water cooler fountain
- BF-## - Bottle filler fountain
- NF-## - Nurse's faucet

■ - Sample location: faucet  
■ - Sample location: drinking fountain at sink  
■ ■ - Sample location: faucet and drinking fountain at same sink  
▼ - Sample location: water cooler fountain

-Lead (Pb) and copper (Cu) results for each sample location are below each identifier. All results reported in µg/L.


-Samples in **BOLD RED** indicate fixture locations where the initial concentrations of lead or copper were above the respective action level.

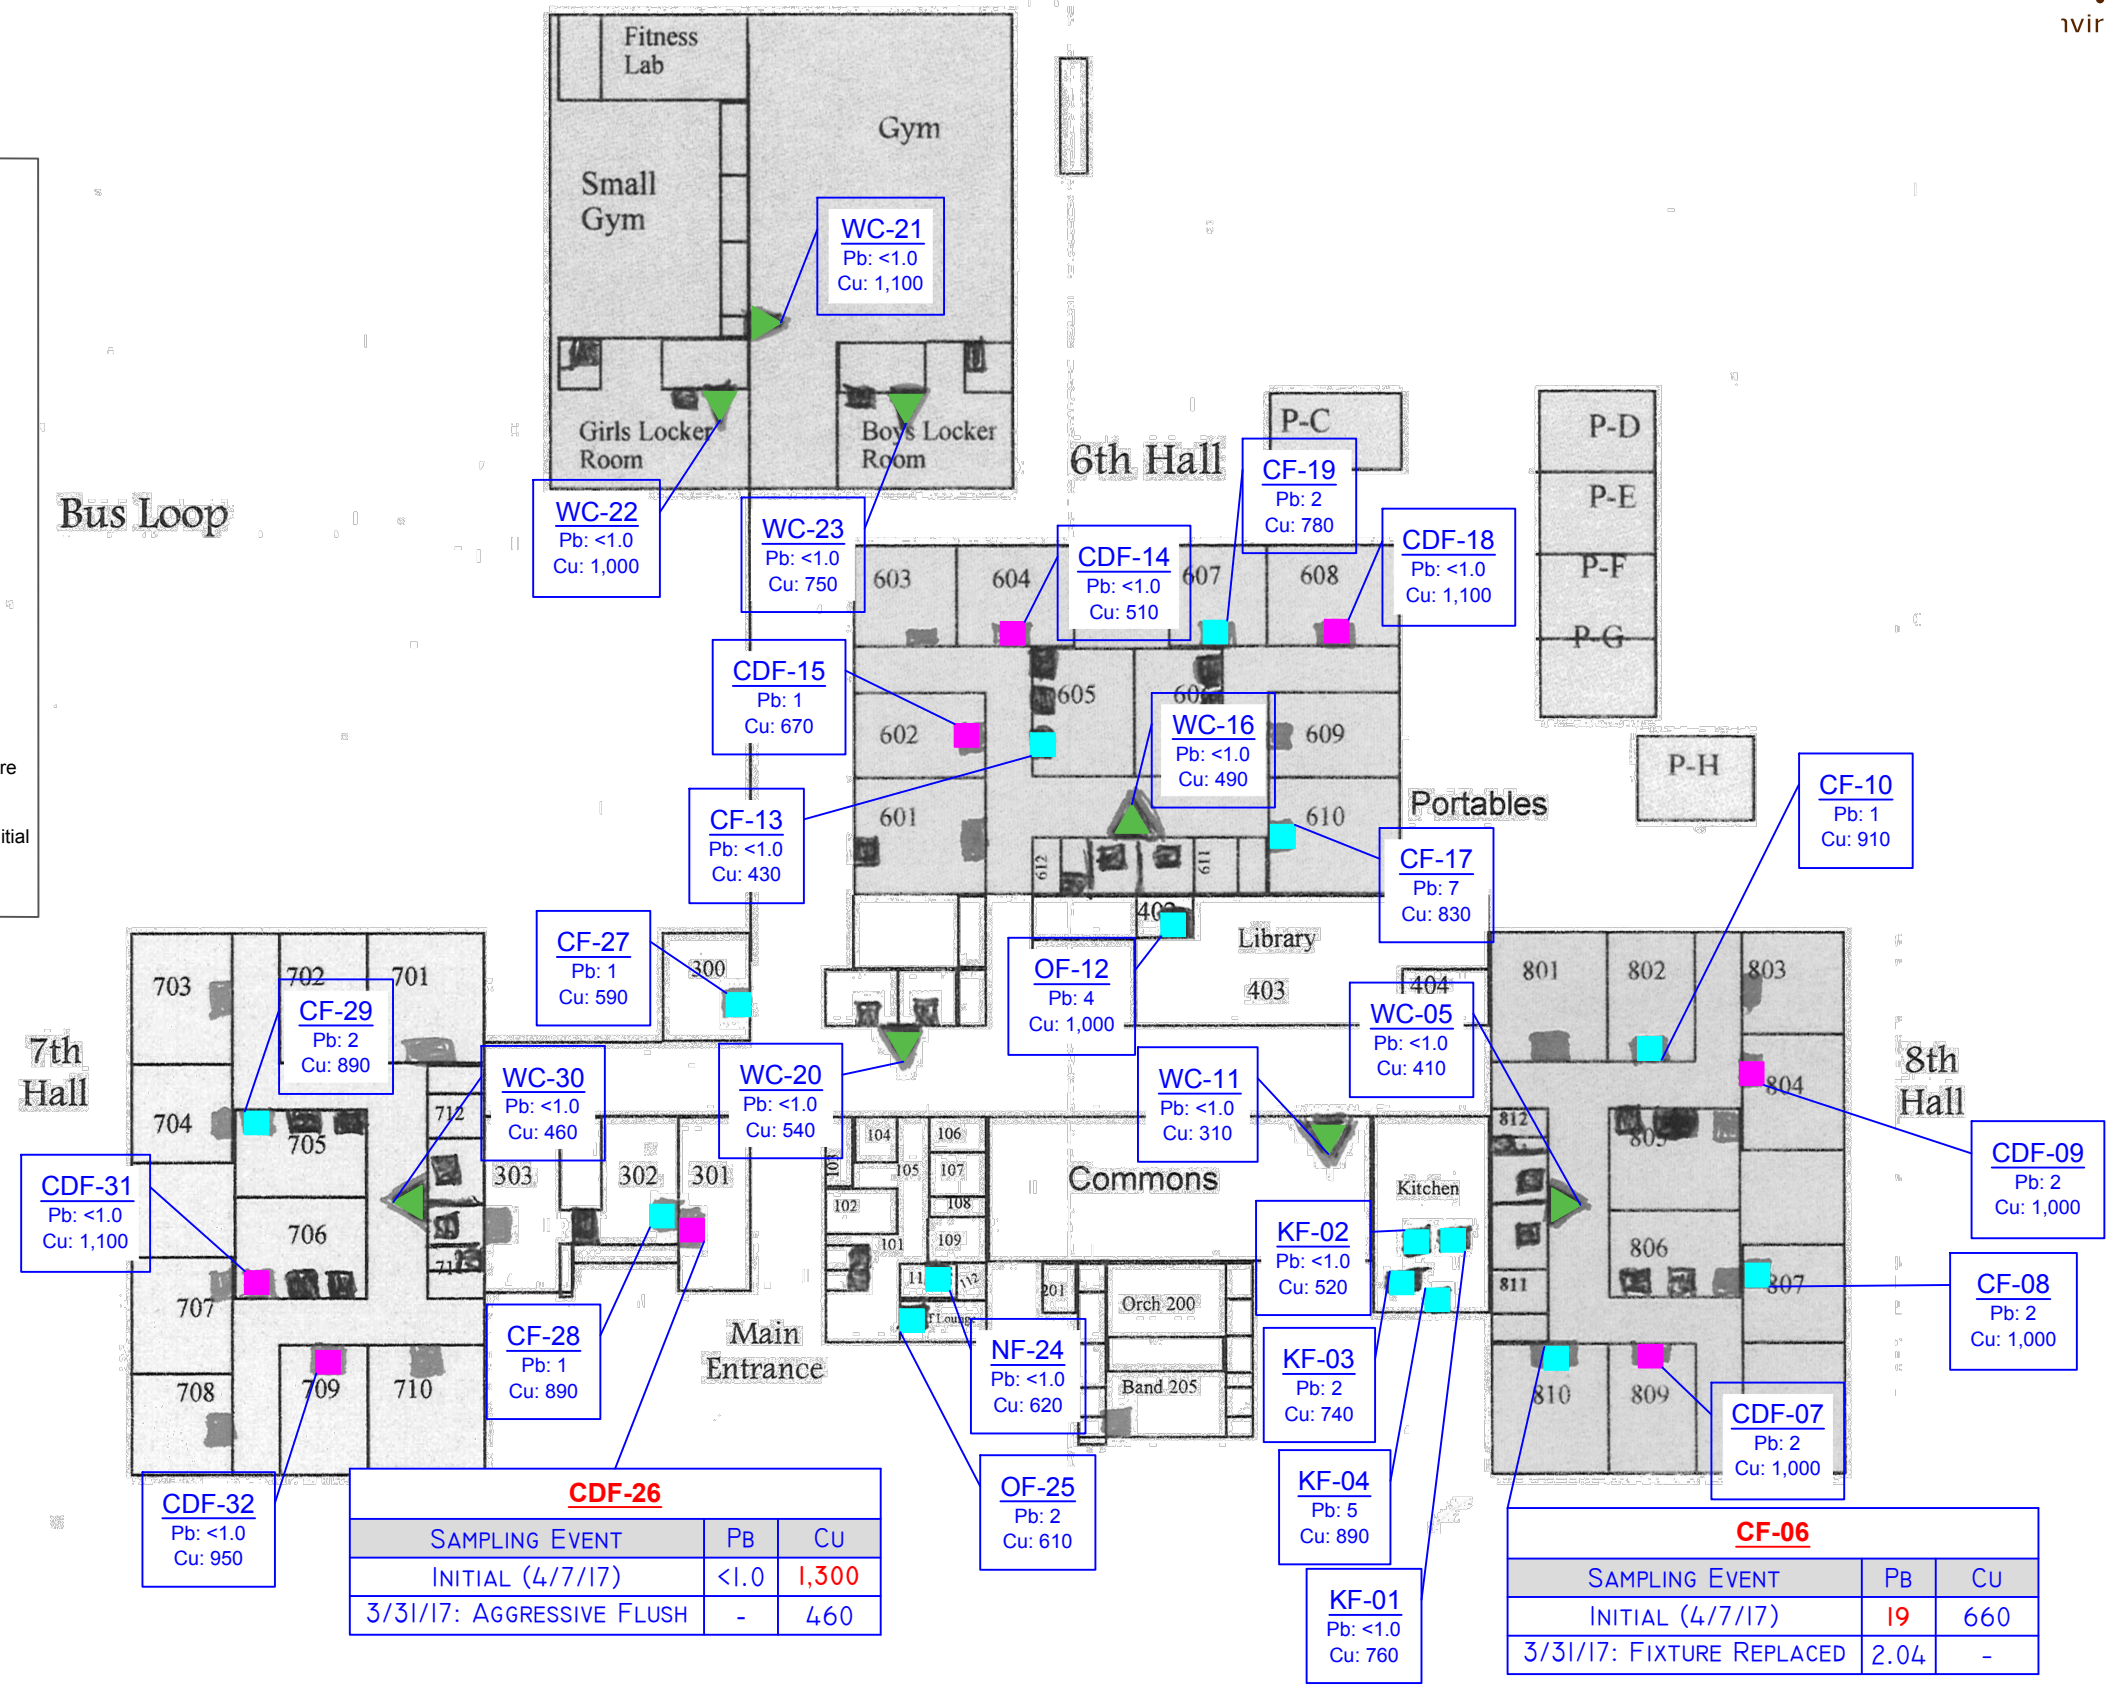

DRAWING PROVIDED BY KENNEWICK SCHOOL DISTRICT

**ATTACHMENT B**

Site-Specific Sampling and Analysis Plan





## Site-Specific Sampling and Analysis Plan

### **Kennewick School District – Winter 2016 Drinking Water Sampling**

*Note: This SSSAP has been prepared as a supplement to the project SAP/QAPP and provide a building specific summary of the location, number, and sampling frequency of water fixture locations.*

Campus: Horse Heaven Hills Middle School Address: 3500 South Vancouver Street, Kennewick, WA

Elementary  Middle School  High School  Administration

Date of Construction: 1993 Modernizations: N/A

Fixture Type	Locations	Fixture Styles <sup>1</sup>	Samples	Ratio
Drinking fountain/water cooler (DF/WC)	9	3	8	89%
Kitchen Fixture (KF)	4	3	4	100%
Classroom faucet, including faucets in Food Labs and Life Sciences Classrooms (CF)	36	3	9	25%
Classroom drinking fountain at sink (CDF)	35	3	8	23%
Nurse's Office/Health Room (NF)	1	1	1	100%
Teacher's Lounges/Work Rooms (OF)	2	2	2	66%
<b>TOTALS</b>	<b>87</b>		<b>32</b>	<b>37%</b>

<sup>1</sup> Fixture styles are approximate based on sampler's observations

Lead Sampler: Kyle Ames Date: 12/22/2016


Sample Prefix: HHH – 122216 – P (first-draw) – 01-34  
*School Code Date Sample Type Fixture Type Sample Number*

Laboratory: R. J. Lee Group, Columbia Basin Analytical Delivery Date: December 22, 2016

Comments:

**ATTACHMENT C**

Table 1: Initial Sampling Analytical Results Summary Table  
Table 2: pH and Temperature Data Summary Table  
Table 3: Remedial Sampling Analytical Results Summary Table



**Table 1: Initial Sampling Analytical Results**

Sample Identification and Location	Fixture Type	Lead Results (µg/L)	Copper Results (µg/L)
HHH122216-P-KF-01: Kitchen, N.W. Sink	Kitchen Faucet	<1.0	760
HHH122216-P-KF-02: Kitchen, S.W. Sink	Kitchen Faucet	<1.0	520
HHH122216-P-KF-03: Kitchen, N.E. Sink	Kitchen Faucet	2	740
HHH122216-P-KF-04: Kitchen, S.E. Sink	Kitchen Faucet	5	890
HHH122216-P-WC-05: 8th hall corridor	Water Cooler Fountain	<1.0	410
<b>HHH122216-P-CF-06: Room 810</b>	<b>Classroom Faucet</b>	<b>19</b>	660
HHH122216-P-CDF-07: Room 809	Classroom Drinking Fountain	2	1,000
HHH122216-P-CF-08: Room 807	Classroom Faucet	2	1,000
HHH122216-P-CDF-09: Room 804	Classroom Drinking Fountain	2	1,000
HHH122216-P-CF-10: Room 802	Classroom Faucet	1	910
HHH122216-P-WC-11: Commons	Water Cooler Fountain	<1.0	310
HHH122216-P-OF-12: Library Office	Office Faucet	4	1,000
HHH122216-P-CF-13: Room 605, left fixture	Classroom Faucet	<1.0	430
HHH122216-P-CDF-14: Room 604	Classroom Drinking Fountain	<1.0	510
HHH122216-P-CDF-15: Room 602	Classroom Drinking Fountain	1	670
HHH122216-P-WC-16: 6th Hall corridor	Water Cooler Fountain	<1.0	490
HHH122216-P-CF-17: Room 610	Classroom Faucet	7	830
HHH122216-P-CDF-18: Room 608	Classroom Drinking Fountain	<1.0	1,100
HHH122216-P-CF-19: Room 607	Classroom Faucet	2	780
HHH122216-P-WC-20: Main Entrance	Water Cooler Fountain	<1.0	540
HHH122216-P-WC-21: Gym	Water Cooler Fountain	<1.0	1,100
HHH122216-P-WC-22: Girl's locker room	Water Cooler Fountain	<1.0	1,000
HHH122216-P-WC-23: Boy's locker room	Water Cooler Fountain	<1.0	750
HHH122216-P-NF-24: Nurses Room	Nurse's Faucet	<1.0	620
HHH122216-P-OF-25: Staff Lounge	Office Faucet	2	610
<b>HHH122216-P-CDF-26: Room 301</b>	<b>Classroom Drinking Fountain</b>	<1.0	<b>1,300</b>
HHH122216-P-CF-27: Room 300	Classroom Faucet	1	590
HHH122216-P-CF-28: Room 302	Classroom Faucet	1	890
HHH122216-P-CF-29: Room 705	Classroom Faucet	2	890
HHH122216-P-WC-30: 7th Hall corridor	Water Cooler Fountain	<1.0	460
HHH122216-P-CDF-31: Room 706	Classroom Drinking Fountain	<1.0	1,100
HHH122216-P-CDF-32: Room 709	Classroom Drinking Fountain	<1.0	950
<i>HHH122216-P-CF-33: Laboratory Blank</i>	<i>Distilled Water Blank</i>	<i>&lt;1.0</i>	<i>&lt;10</i>
<i>HHH122216-P-CF-34: Laboratory Spike</i>	<i>Lead and Copper Spike</i>	<i>14</i>	<i>1,300</i>
<b>EPA Action Level</b>		<b>15</b>	<b>1,300</b>

- 1 µg/L means microgram per liter or parts per billion (ppb).
- 2 Action levels based on the U.S. EPA's Lead and Copper Rule.

Results in **bold** indicate concentrations above the action levels of 15 µg/L for lead and 1,300 µg/L for copper  
Results in *italics* are quality assurance spike and blank samples.

**Table 2: pH and Temperature Data Summary**

Sample Number	Fixture Type	pH Flush	pH Sample	Temperature (°C) Flush	Temperature (°C) Sample
HHH122216-P-KF-04: Kitchen Southeast	Kitchen Faucet	-	7.05	-	30.8
HHH122216-P-CF-08: Room 807	Classroom Faucet	7.01	7.13	20.6	21.5
HHH122216-P-OF-12: Library Office	Office Faucet	7.09	7.11	20.4	22.6
HHH122216-P-WC-16: 6th hall corridor	Water Cooler Fountain	7.18	7.22	16.4	15.9
HHH122216-P-WC-20: Entrance	Water Cooler Fountain	7.08	-	15.7	-
HHH122216-P-NF-24: Nurses Fixture	Nurse's Faucet	6.97	7.17	21.7	22.0
HHH122216-P-CF-28: Room 302	Classroom Faucet	7.12	7.13	20.1	22.2
HHH122216-P-CDF-32: Room 709	Classroom Drinking Fountain	6.96	7.16	21.1	21.4


**Table 3: Remedial Sampling Analytical Results Summary**

Sampling Event	Sample Identification			
	CF-06	CDF-26	Laboratory Blank (-33)	Laboratory Spike (-34)
<b>Lead Results</b>				
Initial (12/2/16)	<b>19</b>	<1.0	<1.0	<i>14</i>
Follow-Up (3/31/17)	2.04	-	<1.00	<i>16.4</i>
<b>EPA Action Level</b>	<b>15</b>	<b>15</b>	<b>15</b>	<b>15</b>
<b>Copper Results</b>				
Initial (12/2/16)	-	<b>1,300</b>	<1.0	<i>1,300</i>
Follow-Up (3/31/17)	-	460	<0.500	<i>1,290</i>
<b>EPA Action Level</b>	<b>1,300</b>	<b>1,300</b>	<b>1,300</b>	<b>1,300</b>

- 1 Results reported in micrograms per liter (µg/L) or parts per billion (ppb).
- 2 Action levels based on the U.S. EPA's Lead and Copper Rule.  
Results indicated in **bold** indicate concentrations above the action levels of 15 µg/L for lead  
Results indicated in *italics* are quality assurance spike and blank samples.

**ATTACHMENT D**

Initial Analytical Results





RJ LeeGroup, Inc. | Columbia Basin Analytical Laboratories

2710 North 20th Avenue, Pasco WA 99301

Tel: (509) 545-4989 | Fax: (509) 544-6010

Fulcrum Environmental  
406 N. 2nd St.  
Yakima, WA 98901

### Subject: Chemical Analysis Report

Columbia Basin Analytical Laboratories received 34 sample(s) on 12/22/16 for analysis. These sample(s) have been assigned a login order number of W612119. Enclosed is the final report that consists of a summary report of the sample(s), and a copy of the chain of custody.

### General Lab Comments

The results provided in this report relate only to the items tested. Sample(s) were received in acceptable conditions unless otherwise noted in the comments above. Sample(s) have not been field blank corrected unless otherwise noted in the general set comments above. The sample(s) were prepared in accordance with EPA 200.8 and analyzed in compliance with EPA 200.8. This test report shall not be reproduced, except in full, without written approval of Columbia Basin Analytical Laboratories. Any questions, please contact our office.

*Sample W612119-25 reported for Lead at DF1, thereby lowering the PQL.*

*X- Samples that exceeded the instrument calibration range were rerun at a 1:100 dilution, necessitating a 10-fold increase in the PQL.*

*All other samples were diluted 1:10.*

Release of the data contained in the hard copy report has been authorized by the Laboratory Director or a designee as verified by the following signature. This report has been administratively reviewed by the following individual:

02/13/17

Project Coordinator II, M. Fernanda Pincheira

Date

If you have any questions please feel free to contact Fernanda Pincheira at [MPincheira@rjleegroup.com](mailto:MPincheira@rjleegroup.com).



## Laboratory Report

Ryan Mathews

Fulcrum Environmental  
406 N. 2nd St.  
Yakima, WA 98901

Client Project:

Fulcrum Kennewick

RJ Lee Group No.: W612119

COC No.: Kennewick

Samples Received: 12/22/16

Analysis/Prep Date: 02/01/17

Report Date: 02/13/17

**Sample Name:** HHH122216-P-KF-01 **Matrix:** Potable Water **Date Received:** 12/22/16  
**RJ Lee Grp. ID:** W612119-01 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.76	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

**Sample Name:** HHH122216-P-KF-02 **Matrix:** Potable Water **Date Received:** 12/22/16  
**RJ Lee Grp. ID:** W612119-02 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.52	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

**Sample Name:** HHH122216-P-KF-03 **Matrix:** Potable Water **Date Received:** 12/22/16  
**RJ Lee Grp. ID:** W612119-03 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.74	0.01	
Lead	EPA 200.8	0.002	0.001	

**Sample Name:** HHH122216-P-KF-04 **Matrix:** Potable Water **Date Received:** 12/22/16  
**RJ Lee Grp. ID:** W612119-04 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.89	0.01	
Lead	EPA 200.8	0.005	0.001	

**Sample Name:** HHH122216-P-WC-05 **Matrix:** Potable Water **Date Received:** 12/22/16  
**RJ Lee Grp. ID:** W612119-05 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.41	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Columbia Basin Analytical Laboratories | 2710 North 20th Avenue, Pasco WA 93301 | 509.545.4989

WWW.RJLEEGROUP.COM

Report Template: GenMetalReportFull\_v12.rpt

Approved: 02/13/17 13:55  
Report Time Stamp: 02/13/17 16:26



**Sample Name:** HHH122216-P-CF-06 **Matrix:** Potable Water **Date Received:** 12/22/16  
**RJ Lee Grp. ID:** W612119-06 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.66	0.01	
Lead	EPA 200.8	0.019	0.001	

**Sample Name:** HHH122216-P-CDF-07 **Matrix:** Potable Water **Date Received:** 12/22/16  
**RJ Lee Grp. ID:** W612119-07 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	1.0	0.1	X
Lead	EPA 200.8	0.002	0.001	

**Sample Name:** HHH122216-P-CF-08 **Matrix:** Potable Water **Date Received:** 12/22/16  
**RJ Lee Grp. ID:** W612119-08 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	1.0	0.1	X
Lead	EPA 200.8	0.002	0.001	

**Sample Name:** HHH122216-P-CDF-09 **Matrix:** Potable Water **Date Received:** 12/22/16  
**RJ Lee Grp. ID:** W612119-09 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	1.0	0.1	X
Lead	EPA 200.8	0.002	0.001	

**Sample Name:** HHH122216-P-CF-10 **Matrix:** Potable Water **Date Received:** 12/22/16  
**RJ Lee Grp. ID:** W612119-10 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.91	0.01	
Lead	EPA 200.8	0.001	0.001	

**Sample Name:** HHH122216-P-WC-11 **Matrix:** Potable Water **Date Received:** 12/22/16  
**RJ Lee Grp. ID:** W612119-11 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.31	0.01	
Lead	EPA 200.8	< 0.0010	0.001	





**Sample Name:** HHH122216-P-OF-12 **Matrix:** Potable Water **Date Received:** 12/22/16  
**RJ Lee Grp. ID:** W612119-12 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	1.0	0.1	X
Lead	EPA 200.8	0.004	0.001	

**Sample Name:** HHH122216-P-CF-13 **Matrix:** Potable Water **Date Received:** 12/22/16  
**RJ Lee Grp. ID:** W612119-13 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.43	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

**Sample Name:** HHH122216-P-CDF-14 **Matrix:** Potable Water **Date Received:** 12/22/16  
**RJ Lee Grp. ID:** W612119-14 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.51	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

**Sample Name:** HHH122216-P-CDF-15 **Matrix:** Potable Water **Date Received:** 12/22/16  
**RJ Lee Grp. ID:** W612119-15 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.67	0.01	
Lead	EPA 200.8	0.001	0.001	

**Sample Name:** HHH122216-P-WC-16 **Matrix:** Potable Water **Date Received:** 12/22/16  
**RJ Lee Grp. ID:** W612119-16 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.49	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

**Sample Name:** HHH122216-P-CF-17 **Matrix:** Potable Water **Date Received:** 12/22/16  
**RJ Lee Grp. ID:** W612119-17 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.83	0.01	
Lead	EPA 200.8	0.007	0.001	



**Sample Name:** HHH122216-P-CDF-18 **Matrix:** Potable Water  
**RJ Lee Grp. ID:** W612119-18

**Date Received:** 12/22/16  
**Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	1.1	0.1	X
Lead	EPA 200.8	< 0.0010	0.001	

**Sample Name:** HHH122216-P-CF-19 **Matrix:** Potable Water  
**RJ Lee Grp. ID:** W612119-19

**Date Received:** 12/22/16  
**Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.78	0.01	
Lead	EPA 200.8	0.002	0.001	

**Sample Name:** HHH122216-P-WC-20 **Matrix:** Potable Water  
**RJ Lee Grp. ID:** W612119-20

**Date Received:** 12/22/16  
**Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.54	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

**Sample Name:** HHH122216-P-WC-21 **Matrix:** Potable Water  
**RJ Lee Grp. ID:** W612119-21

**Date Received:** 12/22/16  
**Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	1.1	0.1	X
Lead	EPA 200.8	< 0.0010	0.001	

**Sample Name:** HHH122216-P-WC-22 **Matrix:** Potable Water  
**RJ Lee Grp. ID:** W612119-22

**Date Received:** 12/22/16  
**Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	1.0	0.1	X
Lead	EPA 200.8	< 0.0010	0.001	

**Sample Name:** HHH122216-P-WC-23 **Matrix:** Potable Water  
**RJ Lee Grp. ID:** W612119-23

**Date Received:** 12/22/16  
**Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.75	0.01	
Lead	EPA 200.8	< 0.0010	0.001	



**Sample Name:** HHH122216-P-NF-24 **Matrix:** Potable Water **Date Received:** 12/22/16  
**RJ Lee Grp. ID:** W612119-24 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.62	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

**Sample Name:** HHH122216-P-OF-25 **Matrix:** Potable Water **Date Received:** 12/22/16  
**RJ Lee Grp. ID:** W612119-25 **Date Analyzed:** 02/13/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.61	0.01	
Lead	EPA 200.8	0.0016	0.0001	

**Sample Name:** HHH122216-P-CDF-26 **Matrix:** Potable Water **Date Received:** 12/22/16  
**RJ Lee Grp. ID:** W612119-26 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	1.3	0.1	X
Lead	EPA 200.8	< 0.0010	0.001	

**Sample Name:** HHH122216-P-CF-27 **Matrix:** Potable Water **Date Received:** 12/22/16  
**RJ Lee Grp. ID:** W612119-27 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.59	0.01	
Lead	EPA 200.8	0.001	0.001	

**Sample Name:** HHH122216-P-CF-28 **Matrix:** Potable Water **Date Received:** 12/22/16  
**RJ Lee Grp. ID:** W612119-28 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.89	0.01	
Lead	EPA 200.8	0.001	0.001	

**Sample Name:** HHH122216-P-CF-29 **Matrix:** Potable Water **Date Received:** 12/22/16  
**RJ Lee Grp. ID:** W612119-29 **Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.89	0.01	
Lead	EPA 200.8	0.002	0.001	



**Sample Name:** HHH122216-P-WC-30 **Matrix:** Potable Water  
**RJ Lee Grp. ID:** W612119-30

**Date Received:** 12/22/16  
**Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.46	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

**Sample Name:** HHH122216-P-CDF-31 **Matrix:** Potable Water  
**RJ Lee Grp. ID:** W612119-31

**Date Received:** 12/22/16  
**Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	1.1	0.1	X
Lead	EPA 200.8	< 0.0010	0.001	

**Sample Name:** HHH122216-P-CDF-32 **Matrix:** Potable Water  
**RJ Lee Grp. ID:** W612119-32

**Date Received:** 12/22/16  
**Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.95	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

**Sample Name:** HHH122216-P-CF-33 **Matrix:** Potable Water  
**RJ Lee Grp. ID:** W612119-33

**Date Received:** 12/22/16  
**Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	< 0.010	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

**Sample Name:** HHH122216-P-CF-34 **Matrix:** Potable Water  
**RJ Lee Grp. ID:** W612119-34

**Date Received:** 12/22/16  
**Date Analyzed:** 02/01/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	1.3	0.1	X
Lead	EPA 200.8	0.014	0.001	



*Report Qualifiers:*

*A = Target Analyte media breakthrough suspect, see analytical report*

*D = Analyte analyzed in a dilution*

*E = Report concentration was above the instrument calibration range*

*J = Analyte detected below quantitation limits, concentration is estimated*

*P = Library spectrum match,  $rsd > 90\%$  w RT match*

*Q = Result out of method specific acceptance QC criteria*

*S = Spike Recovery outside accepted recovery limits*

*Z = Not ELAP accredited analyte*

*ND = Not Detected*

*B = Analyte detected in the associated blank*

*d = Data that exceeds the RSD criteria set by the SOP*

*H = Holding times for preparation or analysis exceeded*

*L = Sample condition at receipt out of compliance with method defined conditions*

*R = RPD (relative percent difference) outside accepted recovery limits*

*U = Analyte analyzed for but not detected*

*N/A = Not Applicable*

**Scientist II DeNomy Dage**

*These results are submitted pursuant to RJ Lee Group's current terms and conditions of sale, including the company's standard warranty and limitation of liability provisions. No responsibility or liability is assumed for the manner in which the results are used or interpreted. Unless notified in writing to return the samples covered by this report, RJ Lee Group will store the samples for a period of ninety (90) days before discarding. A shipping and handling fee will be assessed for the return of any samples. Unless otherwise noted, samples were received in an acceptable condition. This laboratory operates in accordance with ISO 17025 guidelines, and holds limited scopes of accreditation under ORELAP Lab Code 4061 AIHA-LAP, LLC Lab ID 178656 EPA ID WA01195 and WA DOE Lab ID C859. This report may not be used to claim product endorsement by any laboratory accrediting agency. The results contained in this report relate only to the items tested or to the sample(s) as received by the laboratory. Any reproduction of this document must be in full for the report to be valid. Quality control data is available upon request.*

# Request for Environmental and IH Laboratory Analytical Services

W612119

<b>ATTENTION TO:</b>		<b>RYAN MATHEWS</b>		<b>Purchase Order No.:</b>		<b>Client Job No.:</b>		<b>162017</b>				
<b>Lab Use Only</b>	<b>Project No.:</b>	<b>Client No.:</b>	<b>Date Logged In:</b>	<b>Logged In By:</b>	<b>Standard:</b>	<input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	<b>If 'No,' No. of Business Days:</b>					
<b>Report Results To</b>	Name: Amanda Embysk, Ryan Mathews Company: Fulcrum Environmental Consulting Address: 406 North 2nd Street City, State, Zip: Yakima, WA, 98901 Phone: (509) 574-0839 Fax: (509) 575-8453		Call with Verbal Results: Email Results To: aembysk@fulcrum.net, CC: rmathews@fulcrum.net Fax Results To:		<b>Drinking Water Sample Only</b>	Sample Purpose: Information <input checked="" type="checkbox"/> Regulatory <input type="checkbox"/> Accreditation (please list below): DOH Source #: Multiple Sources #:						
<b>Send Invoice To</b>	Name: Lorrie Boutillier Company: Fulcrum Environmental Address: 406 North 2nd Street City, State, Zip: Yakima, WA, 98901 Phone: (509) 574-0839 Fax: (509) 575-8453		Email: lboutillier@fulcrum.net		<b>Chemistry Analysis Key</b>	Preservation: Unpres H <sub>2</sub> SO <sub>4</sub> 4°C HCl NaOH Na <sub>2</sub> SO <sub>4</sub> Other Matrix: WW=Wastewater GW=Groundwater S=Soil/Sludge E=Extract Container: P=Plastic G=Glass W=Wipe A=Air (filter or tube)						
<b>Special Instructions</b>	<b>Analysis Requested</b>											
<b>Client Sample ID</b>	<b>Sample Description</b>	<b>Sample Date</b>	<b>Sample Time</b>		<b>EPA 200.8: Pb, Cu</b>	<b>Pres. Upon Receipt (Y/N)</b>	<b>Preservation</b>	<b>Matrix</b>	<b>Container Type</b>	<b>pH</b>	<b>No. Containers</b>	
HHH122216-P-KF-01	Kitchen fixture	12-22			X		UNPR	DW			19.1	
HHH122216-P-KF-02											19.1	
HHH122216-P-KF-03											19.1	
HHH122216-P-KF-04	8th Hall corridor										19.1	
HHH122216-P-WC-05	Room 810										17.4	
HHH122216-P-GF-06	Room 809										19.1	
HHH122216-P-GF-07	Room 807										19.5	
HHH122216-P-GF-08	Room 807										19.5	
HHH122216-P-GF-09	Room 804										19.9	
HHH122216-P-GF-10	Room 802										19.9	
HHH122216-P-WC-11	Sawm-015										19.9	
<b>Chain of Custody</b>	Relinquished By (Signature): Relinquished By (Print Name): Company Name:	Date: 12-22-16 Time: 1:30 Method of Shipment:	Relinquished To: Method of Shipment:		<b>Chain of Custody</b>	Received By (Signature): Received By (Print Name): Company Name:	Date: DEC 22 2016 Time: 1:30 Method of Shipment:	Relinquished To: Method of Shipment:		<b>Chain of Custody</b>	Received By (Signature): Received By (Print Name): Company Name:	Date: Time: Method of Shipment:

Pennsylvania - HQ  
350 Hochberg Road  
Monroeville, PA 15146  
724.325.1776 Phone  
724.733.1799 Fax

Washington  
Columbia Basin Analytical Laboratories  
2710 North 20th Avenue  
Pasco, WA 99301  
509.545.4989 Phone  
509.544.6010 Fax



# Request for Environmental and IH Laboratory Analytical Services

ATTENTION TO: RYAN MATHEWS		Purchase Order No.: 162017		Client Job No.: 162017							
Lab Use Only	Project No.: Date Logged In:	Client No.: Logged In By:	Turnaround Request								
Report Results To	Name: Amanda Enbyk, Ryan Mathews Company: Fulcrum Environmental Consulting Address: 406 North 2nd Street City, State, Zip: Yakima, WA, 98901 Phone: (509) 574-0839 Fax: (509) 575-8453 Call with Verbal Results:		Standard: <input checked="" type="radio"/> Yes <input type="radio"/> No	If No, No. of Business Days: _____							
Send Invoice To	Name: Lorrie Boutillier Company: Fulcrum Environmental Address: 406 North 2nd Street City, State, Zip: Yakima, WA, 98901 Phone: (509) 574-0839 Fax: (509) 575-8453		Sample Purpose: Information <input checked="" type="checkbox"/> Regulatory <input type="checkbox"/> Accreditation (please list below):								
Special Instructions			Drinking Water Sample Only	System ID #: _____	DOH Source #: _____						
			Chemistry Analysis Key	Multiple Sources #: _____	Sample Purpose: A <input type="checkbox"/> B <input type="checkbox"/> Other <input type="checkbox"/>						
				Preservation: Unpres H <sub>2</sub> SO <sub>4</sub> 4°C HCl HNO <sub>3</sub> Other	Matrix: WW=Wastewater GW=Groundwater S=soil/Sludge E=Extract						
				Na <sub>2</sub> SO <sub>4</sub>	SW=Surface Water DW=Drinking Water O=Oil X=Other						
					Container: P=Plastic G=Glass W=Wipe A=Air (filter or tube)						
Client Sample ID	Sample Description	Sample Date	Sample Time	Wipe Area / Air Volume	Analysis Requested	Pres. Upon Receipt (Y/N)	Preservation	Matrix	Container Type	pH	No. Containers
HHH102216-P-CF-12	Library office	12-22			X		UNPR	DW			19.8
HHH102216-P-CF-13	Room 605										19.8
HHH102216-P-CF-14	Room 604										18.6
HHH102216-P-CF-15	Room 602										18.6
HHH102216-P-WC-16	6 <sup>th</sup> Hall corridor										16.5
HHH102216-P-CF-17	Room 610										19.5
HHH102216-P-CF-18	Room 608										17.5
HHH102216-P-CF-19	Room 607										17.7
HHH102216-P-WC-20	Entrance										16.4
HHH102216-P-WC-21	GYM										17.6
HHH102216-P-WC-22	Girls locker room										18.7
Chain of Custody	Relinquished By (Signature): Relinquished By (Print Name): Company Name:	Date: 12-22-16 Time: 3:00	Relinquished To:	Method of Shipment:	Chain of Custody	Received By (Signature): Received By (Print Name): Company Name:	Date: DEC 22 2016	Relinquished To:	Time: 13:00		
Chain of Custody	Relinquished By (Signature): Relinquished By (Print Name): Company Name:	Date:	Relinquished To:	Method of Shipment:	Chain of Custody	Received By (Signature): Received By (Print Name): Company Name:	Date:	Relinquished To:	Time:		

Pennsylvania - HQ  
350 Hochberg Road  
Monroeville, PA 15146

Washington  
Columbia Basin Analytical Laboratories  
2710 North 20th Avenue  
Pasco, WA 99301

724.325.1776 Phone  
724.733.1799 Fax

509.545.4989 Phone  
509.544.6010 Fax



# Request for Environmental and IH Laboratory Analytical Services

ATTENTION TO: <b>RYAN MATHEWS</b>		Client No.:		Purchase Order No.:		Client Job No.:		<b>162017</b>	
Lab Use Only	Project No.:	Client No.:		Standard: <input checked="" type="checkbox"/> See		No		If 'No', No. of Business Days:	
Report Results To	Date Logged In:	Logged In By:		Sample Purpose: Information <input checked="" type="checkbox"/> Regulatory <input type="checkbox"/> Accreditation (please list below):		System ID #:			
	Name: Amanda Embysk, Ryan Mathews			DOH Source #:		Multiple Sources #:			
	Company: Fulcrum Environmental Consulting			Sample Purpose: A <input type="checkbox"/> B <input type="checkbox"/> Other <input type="checkbox"/>		Preservation:			
	Address: 406 North 2nd Street			Matrix: WW=Wastewater GW=Groundwater S=Soil/Sludge E=Extract		Container:			
	City, State, Zip: Yakima, WA, 98901			Preservation: Unpres H <sub>2</sub> SO <sub>4</sub> 4°C HCl HNO <sub>3</sub> NaOH Other Na <sub>2</sub> SO <sub>4</sub>		SW=Surface Water DW=Drinking Water O=Oil X=Other		P=Plastic G=Glass W=Wipe A=Air (filter or tube)	
Send Invoice To	Name: Lorrie Boutillier	Email: lboutillier@fulcrum.net		Analysis Requested		Pres. Upon Receipt (Y/N)			
	Company: Fulcrum Environmental			EPA 200.8: Pb, Cu					
	Address: 406 North 2nd Street								
	City, State, Zip: Yakima, WA, 98901								
	Phone: (509) 574-0839	Fax: (509) 575-8453							
Special Instructions									
Client Sample ID	Sample Description	Sample Date	Sample Time	Wipe Area / Air Volume					
HHH02216-P-UC-33	Boys locker room	12-22							
HHH02216-P-NF-24	Nurse								
HHH02216-P-OF-25	Staff lounge								
HHH02216-P-CDF-26	Room 301								
HHH02216-P-OF-27	Room 300								
HHH02216-P-OF-28	Room 302								
HHH02216-P-OF-29	Room 705								
HHH02216-P-UC-30	7th hall corridor								
HHH02216-P-OF-31	Room 706								
HHH02216-P-OF-32	Room 709								
HHH02216-P-OF-33	Room 904								
Chain of Custody	Relinquished By (Signature): <i>[Signature]</i>	Date: 12-22-16	Time: 1300						
	Relinquished By (Print Name): <i>Kyle Ayers</i>								
	Company Name: Fulcrum								
Chain of Custody	Relinquished By (Signature): <i>[Signature]</i>	Date:	Time:						
	Relinquished By (Print Name):								
	Company Name:								
Chain of Custody	Received By (Signature): <i>[Signature]</i>	Date: DEC 22 2016	Time: 1300						
	Received By (Print Name): <i>[Signature]</i>								
	Company Name:								
Chain of Custody	Received By (Signature):	Date:	Time:						
	Received By (Print Name):								
	Company Name:								

Pennsylvania - HQ  
350 Hochberg Road  
Monroeville, PA 15146

Washington  
Columbia Basin Analytical Laboratories  
2710 North 20th Avenue  
Pasco, WA 99301

724.325.1776 Phone  
724.733.1799 Fax

509.545.4989 Phone  
509.544.6010 Fax





# Request for Environmental and IH Laboratory Analytical Services

<b>ATTENTION TO:</b> RYAN MATHEWS		<b>Purchase Order No.:</b>		<b>Client Job No.:</b> 162017	
<b>Lab Use Only</b>	<b>Project No.:</b>	<b>Client No.:</b>		<b>Turnaround Request</b>	
<b>Date Logged In:</b>	<b>Logged In By:</b>		<b>Standard:</b> Yes No	<b>If 'No,' No. of Business Days:</b>	
<b>Name:</b> Amanda Enbysk, Ryan Mathews			<b>Sample Purpose:</b> Information X Regulatory <input type="checkbox"/> Accreditation (please list below):		
<b>Company:</b> Fulcrum Environmental Consulting			<b>System ID #:</b>		
<b>Address:</b> 406 North 2nd Street			<b>DOH Source #:</b>		
<b>City, State, Zip:</b> Yakima, WA, 98901			<b>Multiple Sources #:</b>		
<b>Phone:</b> (509) 574-0839 <b>Fax:</b> (509) 575-8453			<b>Sample Purpose:</b> A <input type="checkbox"/> B <input type="checkbox"/> Other <input type="checkbox"/>		
<b>Call with Verbal Results:</b>			<b>Preservation:</b>		
<b>Email Results To:</b> aenbysk@fulcrum.net, CC: rmathews@fulcrum.net			<b>Unpres:</b> H <sub>2</sub> SO <sub>4</sub> <b>Matrix:</b> WW=Wastewater SW=Surface Water		
<b>Fax Results To:</b>			<b>4 °C:</b> HCl <b>GW=Groundwater</b> DW=Drinking Water		
<b>Name:</b> Lorrie Boutillier			<b>HNO<sub>3</sub>:</b> NaOH <b>S=Soil/Sludge</b> O=Oil		
<b>Company:</b> Fulcrum Environmental <b>Email:</b> lboutillier@fulcrum.net			<b>Other:</b> Na <sub>2</sub> SO <sub>4</sub> <b>E=Extract</b> X=Other		
<b>Address:</b> 406 North 2nd Street			<b>Analysis Requested</b>		
<b>City, State, Zip:</b> Yakima, WA, 98901			<b>Pres. Upon Receipt (Y/N)</b>		
<b>Phone:</b> (509) 574-0839 <b>Fax:</b> (509) 575-8453			<b>Preservation</b>		
<b>Special Instructions</b>			<b>Matrix</b>		
<b>Client Sample ID</b>			<b>Container Type</b>		
<b>Sample Description</b>			<b>pH</b>		
<b>Sample Date</b>			<b>No. Containers</b>		
<b>Sample Start</b>					
<b>Sample Stop</b>					
<b>Wipe Area / Air Volume</b>					
<b>Chain of Custody</b>			<b>Chain of Custody</b>		
<b>Relinquished By (Signature):</b> <i>[Signature]</i> <b>Date:</b> 12-22-16 <b>Time:</b> 1:30			<b>Received By (Signature):</b> <i>[Signature]</i> <b>Date:</b> DEC 22 2016 <b>Time:</b> 1:30		
<b>Relinquished By (Print Name):</b> KATHY ENBYSK			<b>Received By (Print Name):</b> RYAN MATHEWS		
<b>Company Name:</b> FULCRUM			<b>Method of Shipment:</b>		
<b>Relinquished By (Signature):</b>			<b>Received By (Signature):</b>		
<b>Relinquished By (Print Name):</b>			<b>Received By (Print Name):</b>		
<b>Company Name:</b>			<b>Method of Shipment:</b>		

Pennsylvania - HQ  
350 Hochberg Road  
Monroeville, PA 15146

Washington  
Columbia Basin Analytical Laboratories  
2710 North 20th Avenue  
Pasco, WA 99301


724.325.1776 Phone  
724.733.1799 Fax

509.545.4989 Phone  
509.544.6010 Fax



**ATTACHMENT E**

Remedial Analytical Results





**Fulcrum Environmental**

Ryan Mathews  
406 N. 2nd Street  
Yakima, WA 98901

**RE: Kennewick SD Drinking Water - Horse Heaven Hills MS**  
**Work Order Number: 1704001**

April 03, 2017

**Attention Ryan Mathews:**

Fremont Analytical, Inc. received 8 sample(s) on 4/3/2017 for the analyses presented in the following report.

***Drinking Water Metals by EPA Method 200.8***

This report consists of the following:

- Case Narrative
- Analytical Results
- Applicable Quality Control Summary Reports
- Chain of Custody

All analyses were performed consistent with the Quality Assurance program of Fremont Analytical, Inc. Please contact the laboratory if you should have any questions about the results.

Thank you for using Fremont Analytical.

Sincerely,

Chelsea Ward  
Project Manager



Date: 04/03/2017

---

**CLIENT:** Fulcrum Environmental  
**Project:** Kennewick SD Drinking Water - Horse Heav  
**Work Order:** 1704001

## Work Order Sample Summary

---

Lab Sample ID	Client Sample ID	Date/Time Collected	Date/Time Received
1704001-001	HHH33117-P-CF-06	03/31/2017 6:00 AM	04/03/2017 9:22 AM
1704001-002	HHH33117-S-CF-06	03/31/2017 6:00 AM	04/03/2017 9:22 AM
1704001-003	HHH33117-T-CF-06	03/31/2017 6:00 AM	04/03/2017 9:22 AM
1704001-004	HHH33117-P-CDF-26	03/31/2017 6:00 AM	04/03/2017 9:22 AM
1704001-005	HHH33117-S-CDF-26	03/31/2017 6:00 AM	04/03/2017 9:22 AM
1704001-006	HHH33117-T-CDF-26	03/31/2017 6:00 AM	04/03/2017 9:22 AM
1704001-007	HHH33117-P-CF-33	03/31/2017 6:00 AM	04/03/2017 9:22 AM
1704001-008	HHH33117-P-CF-34	03/31/2017 6:00 AM	04/03/2017 9:22 AM

---

**CLIENT:** Fulcrum Environmental  
**Project:** Kennewick SD Drinking Water - Horse Heaven Hills MS

---

WorkOrder Narrative:

I. SAMPLE RECEIPT:

Samples receipt information is recorded on the attached Sample Receipt Checklist.

II. GENERAL REPORTING COMMENTS:

Results are reported on a wet weight basis unless dry-weight correction is denoted in the units field on the analytical report ("mg/kg-dry" or "ug/kg-dry").

Matrix Spike (MS) and MS Duplicate (MSD) samples are tested from an analytical batch of "like" matrix to check for possible matrix effect. The MS and MSD will provide site specific matrix data only for those samples which are spiked by the laboratory. The sample chosen for spike purposes may or may not have been a sample submitted in this sample delivery group. The validity of the analytical procedures for which data is reported in this analytical report is determined by the Laboratory Control Sample (LCS) and the Method Blank (MB). The LCS and the MB are processed with the samples and the MS/MSD to ensure method criteria are achieved throughout the entire analytical process.

III. ANALYSES AND EXCEPTIONS:

Exceptions associated with this report will be footnoted in the analytical results page(s) or the quality control summary page(s) and/or noted below.

Prep Sample Comments:

1704001-001A 213702: Prep Comments for EPA200.8, Sample 1704001-001A: Turbidity: 0.01 NTU  
1704001-004A 213706: Prep Comments for EPA200.8, Sample 1704001-004A: Turbidity: 0.00 NTU  
1704001-007A 213707: Prep Comments for EPA200.8, Sample 1704001-007A: Turbidity: 0.04 NTU  
1704001-008A 213708: Prep Comments for EPA200.8, Sample 1704001-008A: Turbidity: 0.05 NTU

## Qualifiers:

- \* - Flagged value is not within established control limits
- B - Analyte detected in the associated Method Blank
- D - Dilution was required
- E - Value above quantitation range
- H - Holding times for preparation or analysis exceeded
- I - Analyte with an internal standard that does not meet established acceptance criteria
- J - Analyte detected below Reporting Limit
- N - Tentatively Identified Compound (TIC)
- Q - Analyte with an initial or continuing calibration that does not meet established acceptance criteria (<20%RSD, <20% Drift or minimum RRF)
- S - Spike recovery outside accepted recovery limits
- ND - Not detected at the Reporting Limit
- R - High relative percent difference observed

## Acronyms:

- %Rec - Percent Recovery
- CCB - Continued Calibration Blank
- CCV - Continued Calibration Verification
- DF - Dilution Factor
- HEM - Hexane Extractable Material
- ICV - Initial Calibration Verification
- LCS/LCSD - Laboratory Control Sample / Laboratory Control Sample Duplicate
- MB or MBLANK - Method Blank
- MDL - Method Detection Limit
- MS/MSD - Matrix Spike / Matrix Spike Duplicate
- PDS - Post Digestion Spike
- Ref Val - Reference Value
- RL - Reporting Limit
- RPD - Relative Percent Difference
- SD - Serial Dilution
- SGT - Silica Gel Treatment
- SPK - Spike
- Surr - Surrogate



**CLIENT:** Fulcrum Environmental  
**Project:** Kennewick SD Drinking Water - Horse Heaven Hills MS

**Lab ID:** 1704001-001      **Collection Date:** 3/31/2017 6:00:00 AM  
**Client Sample ID:** HHH33117-P-CF-06      **Matrix:** Drinking Water

Analyses	Result	RL	Qual	Units	DF	Date Analyzed
----------	--------	----	------	-------	----	---------------

**Drinking Water Metals by EPA Method 200.8**

Batch ID: 16676      Analyst: TN

Lead	2.04	1.00		µg/L	1	4/3/2017 1:11:26 PM
------	------	------	--	------	---	---------------------

**Lab ID:** 1704001-004      **Collection Date:** 3/31/2017 6:00:00 AM  
**Client Sample ID:** HHH33117-P-CDF-26      **Matrix:** Drinking Water

Analyses	Result	RL	Qual	Units	DF	Date Analyzed
----------	--------	----	------	-------	----	---------------

**Drinking Water Metals by EPA Method 200.8**

Batch ID: 16676      Analyst: TN

Copper	460	0.500		µg/L	1	4/3/2017 1:35:38 PM
--------	-----	-------	--	------	---	---------------------

**Lab ID:** 1704001-007      **Collection Date:** 3/31/2017 6:00:00 AM  
**Client Sample ID:** HHH33117-P-CF-33      **Matrix:** Drinking Water

Analyses	Result	RL	Qual	Units	DF	Date Analyzed
----------	--------	----	------	-------	----	---------------

**Drinking Water Metals by EPA Method 200.8**

Batch ID: 16676      Analyst: TN

Copper	ND	0.500		µg/L	1	4/3/2017 1:39:39 PM
Lead	ND	1.00		µg/L	1	4/3/2017 1:39:39 PM



**CLIENT:** Fulcrum Environmental

**Project:** Kennewick SD Drinking Water - Horse Heaven Hills MS

**Lab ID:** 1704001-008

**Collection Date:** 3/31/2017 6:00:00 AM

**Client Sample ID:** HHH33117-P-CF-34

**Matrix:** Drinking Water

Analyses	Result	RL	Qual	Units	DF	Date Analyzed
----------	--------	----	------	-------	----	---------------

**Drinking Water Metals by EPA Method 200.8**

Batch ID: 16676

Analyst: TN

Copper	1,290	0.500		µg/L	1	4/3/2017 1:43:41 PM
Lead	16.4	1.00		µg/L	1	4/3/2017 1:43:41 PM



**Work Order:** 1704001  
**CLIENT:** Fulcrum Environmental  
**Project:** Kennewick SD Drinking Water - Horse Heav

**QC SUMMARY REPORT**  
**Drinking Water Metals by EPA Method 200.8**

Sample ID <b>MB-16676</b>	SampType: <b>MBLK</b>	Units: <b>µg/L</b>			Prep Date: <b>4/3/2017</b>	RunNo: <b>35295</b>					
Client ID: <b>MBLKW</b>	Batch ID: <b>16676</b>				Analysis Date: <b>4/3/2017</b>	SeqNo: <b>675377</b>					
Analyte	Result	RL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Copper	ND	0.500									
Lead	ND	1.00									

Sample ID <b>LCS-16676</b>	SampType: <b>LCS</b>	Units: <b>µg/L</b>			Prep Date: <b>4/3/2017</b>	RunNo: <b>35295</b>					
Client ID: <b>LCSW</b>	Batch ID: <b>16676</b>				Analysis Date: <b>4/3/2017</b>	SeqNo: <b>675378</b>					
Analyte	Result	RL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Copper	98.8	0.500	100.0	0	98.8	85	115				
Lead	55.6	1.00	50.00	0	111	85	115				

Sample ID <b>1704001-001ADUP</b>	SampType: <b>DUP</b>	Units: <b>µg/L</b>			Prep Date: <b>4/3/2017</b>	RunNo: <b>35295</b>					
Client ID: <b>HHH33117-P-CF-06</b>	Batch ID: <b>16676</b>				Analysis Date: <b>4/3/2017</b>	SeqNo: <b>675380</b>					
Analyte	Result	RL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Copper	347	0.500						366.4	5.37	30	
Lead	1.90	1.00						2.037	7.05	30	

Sample ID <b>1704001-001AMS</b>	SampType: <b>MS</b>	Units: <b>µg/L</b>			Prep Date: <b>4/3/2017</b>	RunNo: <b>35295</b>					
Client ID: <b>HHH33117-P-CF-06</b>	Batch ID: <b>16676</b>				Analysis Date: <b>4/3/2017</b>	SeqNo: <b>675381</b>					
Analyte	Result	RL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Copper	544	0.500	200.0	366.4	88.8	70	130				
Lead	103	1.00	100.0	2.037	101	70	130				

Sample ID <b>1704001-001AMSD</b>	SampType: <b>MSD</b>	Units: <b>µg/L</b>			Prep Date: <b>4/3/2017</b>	RunNo: <b>35295</b>					
Client ID: <b>HHH33117-P-CF-06</b>	Batch ID: <b>16676</b>				Analysis Date: <b>4/3/2017</b>	SeqNo: <b>675384</b>					
Analyte	Result	RL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Copper	551	0.500	200.0	366.4	92.5	70	130	544.0	1.35	30	
--------	-----	-------	-------	-------	------	----	-----	-------	------	----	--

**Work Order:** 1704001  
**CLIENT:** Fulcrum Environmental  
**Project:** Kennewick SD Drinking Water - Horse Heav

**QC SUMMARY REPORT**  
**Drinking Water Metals by EPA Method 200.8**

Sample ID	1704001-001AMSD	SampType:	MSD	Units:	µg/L	Prep Date:	4/3/2017	RunNo:	35295		
Client ID:	HHH33117-P-CF-06	Batch ID:	16676	Analysis Date:	4/3/2017	SeqNo:	675384				
Analyte	Result	RL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Lead	104	1.00	100.0	2.037	102	70	130	102.8	1.24	30	

Client Name: **FE**  
 Logged by: **Erica Silva**

Work Order Number: **1704001**  
 Date Received: **4/3/2017 9:22:00 AM**

### Chain of Custody

1. Is Chain of Custody complete? Yes  No  Not Present   
 2. How was the sample delivered? UPS

### Log In

3. Coolers are present? Yes  No  NA   
 4. Shipping container/cooler in good condition? Yes  No   
 5. Custody Seals present on shipping container/cooler?  
 (Refer to comments for Custody Seals not intact) Yes  No  Not Required   
 6. Was an attempt made to cool the samples? Yes  No  NA   
 7. Were all items received at a temperature of >0°C to 10.0°C\* Yes  No  NA   
 8. Sample(s) in proper container(s)? Yes  No   
 9. Sufficient sample volume for indicated test(s)? Yes  No   
 10. Are samples properly preserved? Yes  No   
 11. Was preservative added to bottles? Yes  No  NA   
HNO3 to 002A, 003A, 005A, 006A  
 12. Is there headspace in the VOA vials? Yes  No  NA   
 13. Did all samples containers arrive in good condition(unbroken)? Yes  No   
 14. Does paperwork match bottle labels? Yes  No   
 15. Are matrices correctly identified on Chain of Custody? Yes  No   
 16. Is it clear what analyses were requested? Yes  No   
 17. Were all holding times able to be met? Yes  No

### Special Handling (if applicable)

18. Was client notified of all discrepancies with this order? Yes  No  NA

Person Notified:	<input type="text"/>	Date:	<input type="text"/>
By Whom:	<input type="text"/>	Via:	<input type="checkbox"/> eMail <input type="checkbox"/> Phone <input type="checkbox"/> Fax <input type="checkbox"/> In Person
Regarding:	<input type="text"/>		
Client Instructions:	<input type="text"/>		

19. Additional remarks:

### Item Information

Item #	Temp °C
Cooler	5.4
Sample	1.1

\* Note: DoD/ELAP and TNI require items to be received at 4°C +/- 2°C



**Fremont**  
Analytical

3600 Fremont Ave N. Tel: 206-352-3790  
Seattle, WA 98103 Fax: 206-352-7178

Fulcrum Environmental Consulting

406 North Second Street  
Yakima, WA, 98901

City, State, Zip:

Telephone: 509.574.0839

Fax: 509.575.8453

**Chain of Custody Record and Laboratory Services Agreement**

Date: 3/31/2017

Laboratory Project No (Internal): 1704001

Page: 1 of 1

Project Name: Kennewick 500 Drinking Water - Horse Haven Hills MS

Project No: 162017.28 Collected by: Amanda Enbysk

Location: Horse Haven Hills MS, Kennewick WA

Report To (PM): Ryan Mathews

PM Email: rmathews@fulcrum.net; cc: aenbysk@fulcrum.net

\*Matrix Codes: A = Air, AQ = Aqueous, B = Bulk, O = Other, P = Product, S = Soil, SD = Sediment, SL = Solid, W = Water, DW = Drinking Water, GW = Ground Water, SW = Storm Water, WW = Waste Water

Sample Name	Sample Date	Sample Time	Sample Type (Matrix)*	Analytes														Comments			
				VOCs (EPA 8260 / 624)	GY/BTEX	BTEX	Gasoline Range Organics (GX)	Hydrocarbon Identification (HCID)	Diesel/Heavy Oil Range Organics (DX)	SVOCs (EPA 8270 / 625)	PAHs (EPA 8270 - SIM)	PCBs (EPA 8082 / 608)	Metals* (EPA 6020 / 200.8)	Total (T)   Dissolved (D)	Anions (C)***	EDB (8011)					
1 HHH33117-P-OCF-06	3/31/17	0600	DW																		HHG passed; Pb only
2 HHH33117-S-CF-06																					HHG imp.
3 HHH33117-T-CF-06																					HHG passed; Cu only
4 HHH33117-P-COF-26																					HHG imp.
5 HHH33117-S-COF-26																					HHG2 passed; Pb+Cu
6 HHH33117-T-COF-26																					
7 HHH33117-P-CF-33																					
8 HHH33117-P-CF-34																					
9																					
10																					

\*\*\*Anions (Circle): Nitrate Nitrite Chloride Sulfate Bromide O-Phosphate Fluoride Nitrate+Nitrite

Sample Disposal:  Return to Client  Disposal by Lab (Samples will be held for 30 days unless otherwise noted. A Tee may be assessed if samples are retained after 30 days.)

Turn-around times for samples received after 4:00pm will begin on the following business day.

I represent that I am authorized to enter into this Agreement with Fremont Analytical on behalf of the Client named above, that I have verified Client's agreement to each of the terms on the front and backside of this Agreement.

Refringished x DMC Date/Time 3/31/2017; 1600 Received x [Signature] Date/Time 4/3/17  
Retingished x [Signature] Date/Time [Signature] Date/Time 0922


TAT → SameDay^ NextDay^ 2 Day 3 Day STD

Special Remarks: Please preserve all imp. Samples

\*Please coordinate with the lab in advance

**ATTACHMENT F**

Fixture Style Photographs





Sample HHH122216-P-CF-06: **19 µg/L** initial lead concentration. Fixture style above is identified producing elevated lead concentrations.



Sample HHH122216-P-CF-17: **7 µg/L** initial lead concentration. Same fixture style as initial sample identified with an elevated lead concentration.