

November 3, 2017

Kennewick School District No. 17  
Attn: Keith Colee, Maintenance and Operations Manager  
1000 West Fourth Avenue  
Kennewick, Washington, 99336

**RE: Winter 2016 Drinking Water Sampling Results  
MTS Building, 622 North Kellogg Street, Kennewick, Washington**

Dear Keith:

On Thursday, December 22, 2016, Fulcrum Environmental Consulting, Inc. (Fulcrum) collected eight drinking water samples for lead and copper analysis from the MTS Building (Building) located at 600 North Kellogg Street in Kennewick, Washington. Initial sampling identified one fixture location with lead concentrations above guidance levels and two fixture locations with copper concentrations above guidance levels. Fulcrum returned to the Building to collect samples after remediation of the fixtures and found results below guidance levels. Sampling was completed as part of a District-wide project and all analysis was completed by Washington State Department of Ecology (Ecology) accredited laboratories.

**Summary**

The purpose of initial sampling was to evaluate current drinking water quality conditions with respect to lead and copper as a result of the increased national and local interest related to lead in drinking water. The intent of sampling was to meet the requirements of the pending regulations set forth in Washington Administrative Code (WAC) 246-366A-130 and 246-366A-135<sup>1</sup>. Consistent with the regulations, Fulcrum completed sampling at the rates of at least 50% of plumbing fixtures used regularly for drinking or cooking in elementary and preschools and at least 25% of drinking or cooking fixtures in middle schools, junior high schools, and high schools. In addition, Fulcrum sampled administrative facilities in the District at the same rate as elementary schools, of at least 50% of drinking and cooking fixtures.

Fulcrum completed initial sampling on December 22, 2016. Initial results identified one sample with a lead concentration of 29 micrograms per liter ( $\mu\text{g/L}$ ), above the Environmental Protection Agency (EPA) action level of 15  $\mu\text{g/L}$ , and two samples with copper concentrations above the EPA action level of 1,300  $\mu\text{g/L}$ . Upon receipt of results, the District removed the identified fixtures from service pending remediation and further testing.

The fixture identified with an elevated lead concentration and two of the same style were replaced and preconditioned by running cold water continuously through the fixtures for 24 hours, as specified in WAC 246-366A-130. Following replacement and preconditioning, Fulcrum returned to the building on March 2,

<sup>1</sup> Washington State Department of Health, WAC 246-366A, *The Environmental Health and Safety Standards of Primary and Secondary Schools*, <http://apps.leg.wa.gov/WAC/default.aspx?cite=246-366A>, July 26, 2016

2017 and collected follow-up samples to confirm the success of fixture replacement. Follow-up samples yielded results below the EPA action level, confirming fixture replacement was successful.

Copper is not a significant component in fixtures, but is the primary material in the plumbing system. One of the identified fixtures, located in the Warehouse, was also found with an elevated lead concentration. Both identified fixtures were of the same style. To remediate elevated copper, the District replaced and preconditioned both identified fixtures to clear the plumbing of copper construction debris. Fulcrum returned on March 2, 2017 and collected samples to evaluate the success of the remediation. Follow-up samples found copper concentrations below the EPA action level, confirming the remediation was successful. Following sampling and review of laboratory results, Fulcrum recommended, and the District elected, to return the fixtures to service.

As all samples now report concentrations below lead and copper action levels, at this time Fulcrum does not recommend any additional sampling. However, consistent with industry practice and the intent of WAC 246-366A, Fulcrum recommends that the District complete re-sampling of the building within the next five years (before December 2021).

### **Sampling Methodology**

As a portion of this project, Fulcrum prepared a Sampling and Analysis Plan (SAP) intended to satisfy future initial sampling requirements under pending regulations.

For initial evaluation purposes, Fulcrum collected “first draw” samples. This “first draw” water volume consists of 250 milliliters (mL) and is intended to represent the water quality in the fixture, tubing connecting the fixture to the building piping, and potentially a portion of the building piping. If lead and copper are present, this first-draw sample typically contains the highest lead levels and indicates high copper from the associated building piping.

For most post-remediation evaluation sampling, Fulcrum collected three-part samples consisting of the first draw, “second draw”, and “third draw” water volumes. Second and third draw samples are intended to represent the water quality of building piping and plumbing components behind the fixture and the water entering the building from the water main.

As a quality control measure, Fulcrum also included a laboratory blank of distilled water and a laboratory “spike” sample with known concentrations of lead and copper at the selected action levels for the project during all sampling events. Blank and spike sample results are included in the results tables for reference.

Blank and spike samples were used to evaluate laboratory performance. The reported lead and copper concentrations of quality assurance samples provided a metric to determine accuracy of the analyses. If the reported concentration of the spike sample differed from the action level, then the spike sample concentration was used as the action level.

Field evaluation of pH and temperature of drinking water was completed during the cold water flush and immediately following sample collection on select fixtures during the initial sampling event as a general

evaluation of water quality.

## **Sampling Activities**

Fulcrum's two-part sampling process consisted of an initial site visit the prior afternoon/evening to locate and flush each water sampling location (fixture). Sample collection occurred the following morning, after the fixture sat motionless for more than eight but no less than 18 hours, typically approximately 14 hours.

### Initial Sampling

On the initial visit, Fulcrum flushed cold water through each fixture selected for sampling for approximately one minute. Following the flush, each fixture was covered and secured within a plastic bag. The plastic bags were marked with signage indicating testing was in progress and the fixture should not be used. Fulcrum returned to the school eight to 18 hours later to collect the samples. Each sample consisted of the first draw collected into 250-mL unpreserved polyethylene bottles and was immediately placed on ice in a chilled cooler.

Samples collected from the initial sampling event were delivered under chain-of-custody to RJ Lee Group's Columbia Basin Analytical Laboratory (Ecology Lab ID: C859-16) in Pasco, Washington for analysis.

### Fixture Replacement and Flushing

Fixtures identified with elevated lead concentrations were replaced and preconditioned by running cold water continuously through the fixture for 24 hours, as outlined in WAC 246-366A-130. Following replacement and preconditioning, Fulcrum collected follow-up samples to confirm the success of fixture replacement.

Fixtures producing elevated copper concentrations were generally identified in newer District buildings and were not associated with specific fixture styles. The relationship between building construction age and fixture styles indicates elevated copper concentrations are principally associated with construction debris in the plumbing system.

All fixtures with elevated copper were flushed aggressively by running water through the fixture at high flow with the aerator removed for approximately 30 minutes to clear the plumbing of any debris potentially causing elevated copper concentrations. Following an aggressive flush, fixtures were resampled to evaluate the effectiveness at reducing copper concentrations. The District elected to install filters, install signage indicating the fixtures should be used only for handwashing, or permanently removed from service fixtures that did not respond to an aggressive flush. Filtered fixtures were resampled following filter installation to verify effectiveness of the filter.

### Remedial Sampling

Remedial sampling typically consisted of first, second, and third draw samples from the fixture locations and plumbing system in question. First draw samples were collected into 250 mL polyethylene bottles

preserved with nitric acid. The second draw water volume consists of water collected into a 250 mL unpreserved polyethylene container immediately following the first draw. No water was lost between collection of the first and second draw samples. The third draw water volume is a 1,000 mL sample collected into a one liter unpreserved polyethylene container after the fixture has been flushed for about three to five minutes.

Samples collected following remedial activities were shipped by common carrier under chain of custody to Fremont Analytical Laboratory (Ecology Lab ID: C910-16) in Seattle, Washington for analysis. Fremont was selected based on their availability to complete analysis on an expedited schedule.

## **Analytical Results**

Samples from both initial and remedial sampling events were analyzed for lead and copper in drinking water by EPA Method 200.8.

### Initial Sampling

Sample locations from the initial sampling event are presented in Figure 1 in Attachment A of this letter. A site-specific sampling and analysis plan (SSSAP) that provides a building specific summary of the location, number, and sampling frequency of water fixture locations is located in Attachment B. Initial analytical results are summarized in Table 1 located in Attachment C of this letter. Laboratory analytical results from the initial sampling event are located in Attachment D of this letter.

In addition, pH and temperature data from the initial sampling event is presented in Table 2 in Attachment C of this letter.

### Remedial Sampling

Sample locations from remedial sampling events are presented in Figure 1 in Attachment A of this letter. The remedial analytical results from this project are summarized in Table 3 located in Attachment C of this letter. Laboratory analytical results from the remedial sampling event are located in Attachment E of this letter.

## **Discussion**

### Initial Sampling

Analytical results identified one sample with a lead concentration above the EPA action level of 15 µg/L and two samples with copper concentrations above the EPA action level of 1,300 µg/L.

### Remedial Sampling

Immediately following receipt of initial sampling results, the District removed the identified fixtures from service pending remediation and further testing. To remediate elevated lead concentrations, the District

replaced all identified fixtures and two of the same style. No other fixtures of like style were identified in the building. Fulcrum returned on March 2, 2017 following fixture replacement and preconditioning to collect follow-up samples from the initially identified fixture and all of the same style.

To remediate elevated copper concentrations, the District replaced and preconditioned the identified fixtures. Fulcrum returned following fixture replacement and preconditioning, March 2, 2017, to collect follow-up samples from the fixtures.

Analytical results from remedial sampling indicated the fixture replacement and aggressive flushing were successful at reducing lead and copper concentrations below action levels for the fixtures in question.

**Recommendations**

One initial sample contained lead above the EPA action level of 15 µg/L and two initial samples contained copper above the EPA action level of 1,300 µg/L. The District replaced the identified fixture with elevated lead and all of the same style and preconditioned the fixtures for 24 hours as specified in WAC 246-366A-130. The District replaced and preconditioned the identified fixture with elevated copper. Follow-up sampling demonstrated that all lead and copper concentrations were below action levels. Following remedial sampling and review of laboratory results, Fulcrum recommended, and the District elected, to return the fixtures to service.

As all samples now report concentrations below lead and copper action levels, Fulcrum does not recommend any additional sampling at this time. However, consistent with industry practice and the intent of WAC 246-366A, Fulcrum recommends that the District complete re-sampling of the building within the next five years (before December 2021).

If you have any questions, please feel free to contact me at (509) 574-0839.

Sincerely,



Amanda Enbysk, GIT  
Environmental Geologist



Ryan K. Mathews, CIH, CHMM  
Principal



**ATTACHMENT A**

Figure 1: Sample Location Map




**LEGEND**

- KF-## - Kitchen faucet
- CF-## - Classroom faucet
- CDF-## - Classroom drinking fountain
- OF-## - Office faucet
- WC-## - Water cooler fountain
- BF-## - Bottle filler fountain
- NF-## - Nurse's faucet

- - Sample location: faucet
- - Sample location: drinking fountain at sink
- ■ - Sample location: faucet and drinking fountain at same sink
- ▼ - Sample location: water cooler fountain

-Lead (Pb) and copper (Cu) results for each sample location are below each identifier. All results reported in µg/L.

-Samples in **BOLD RED** indicate fixture locations where the initial concentrations of lead or copper were above the respective action level.

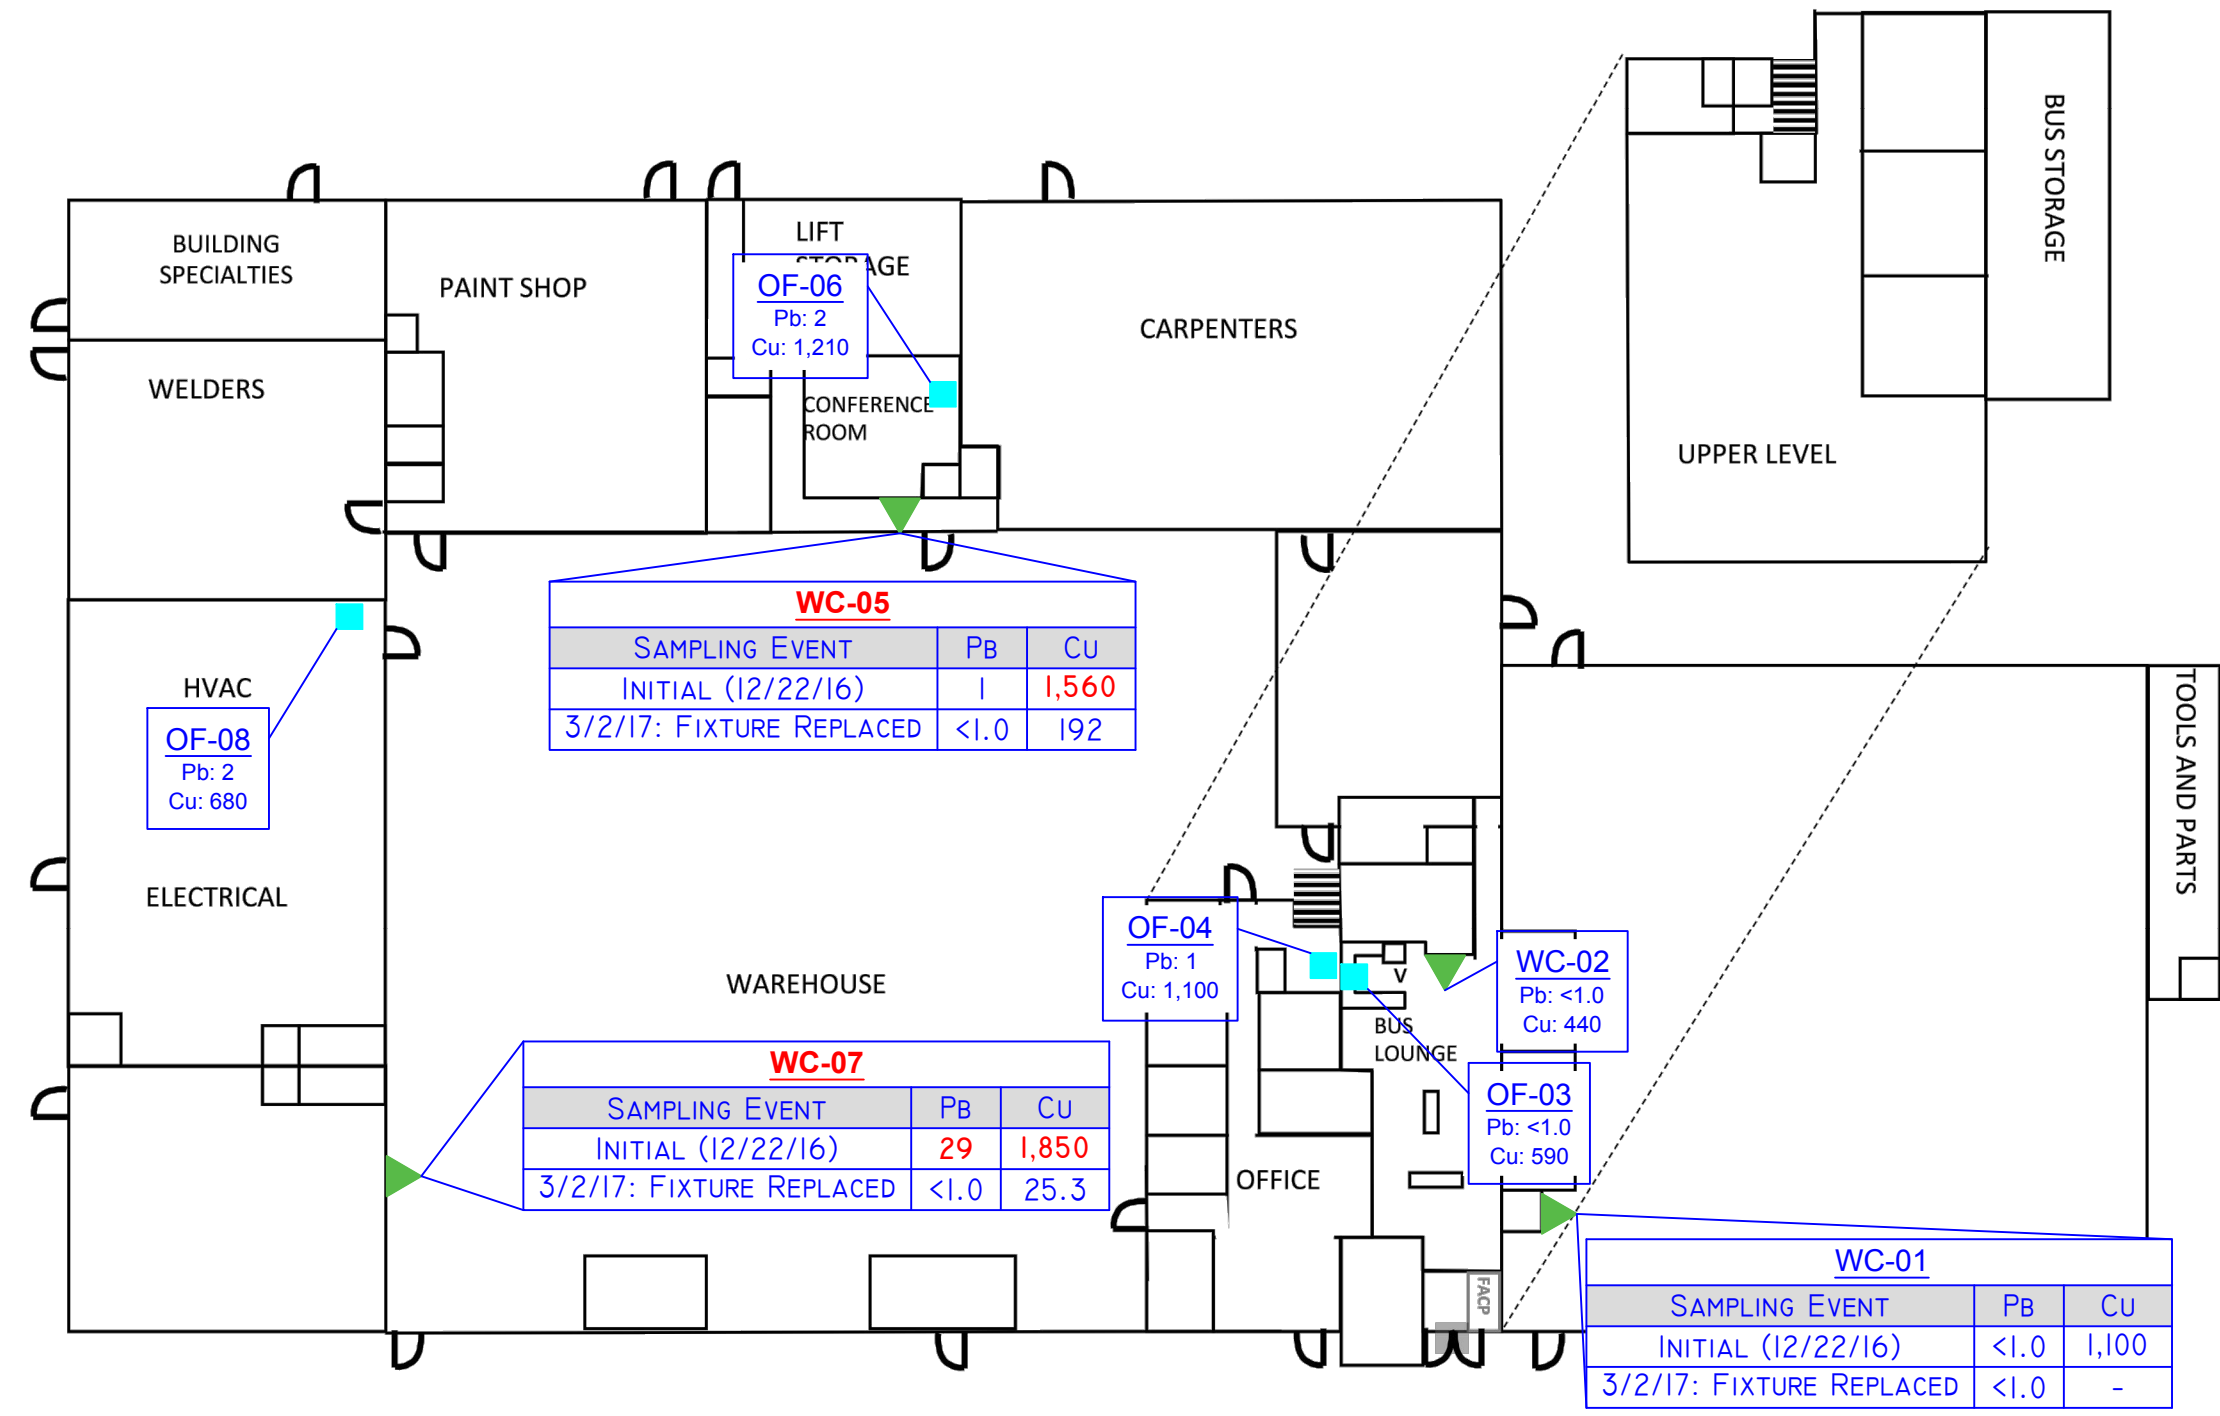

DRAWING PROVIDED BY KENNEWICK SCHOOL DISTRICT

**ATTACHMENT B**

Site-Specific Sampling and Analysis Plan





**Site-Specific Sampling and Analysis Plan**

**Kennewick School District – Winter 2016 Drinking Water Sampling**

*Note: This SSSAP has been prepared as a supplement to the project SAP/QAPP and provide a building specific summary of the location, number, and sampling frequency of water fixture locations.*

Building: MTS Building Address: 622 North Kellogg Street, Kennewick, WA

Elementary       Middle School       High School       Administration

Date of Construction: \_\_\_\_\_ Modernizations: \_\_\_\_\_

Fixture Type	Locations	Fixture Styles <sup>1</sup>	Samples	Ratio
Drinking fountain/water cooler (DF/WC)	4	2	4	100%
Kitchen Fixture (KF)	-	-	-	-
Classroom faucet, including faucets in Food Labs and Life Sciences Classrooms (CF)	-	-	-	-
Classroom drinking fountain at sink (CDF)	1	1	0	-
Nurse's Office/Health Room (NF)	-	-	-	-
Teacher's Lounges/Work Rooms (OF)	9	2	4	44%
<b>TOTALS</b>	<b>14</b>		<b>8</b>	<b>57%</b>

<sup>1</sup> Fixture styles are approximate based on sampler's observations

Lead Sampler: Amanda Enbysk Date: 12/22/2016

Sample Prefix: MTS – 122216 – P (first-draw) – \_\_\_\_\_ – 01-10  
*School Code      Date      Sample Type      Fixture Type      Sample Number*

Laboratory: R. J. Lee Group, Columbia Basin Analytical Delivery Date: December 22, 2016

Comments:

**ATTACHMENT C**

Table 1: Initial Sampling Analytical Results Summary Table

Table 2: pH and Temperature Data Summary Table

Table 3: Remedial Sampling Analytical Results Summary Table



**Table 1: Initial Sampling Analytical Results**

Sample Identification and Location	Fixture Type	Copper Results (µg/L)	Copper Results (µg/L)
MTS122216-P-WC-01: Transportation Shop	Water Cooler Fountain	<1.0	1,100
MTS122216-P-WC-02: Bus Lounge	Water Cooler Fountain	<1.0	440
MTS122216-P-OF-03: Bus Lounge	Office Faucet	<1.0	590
MTS122216-P-OF-04: Main Office Lounge	Office Faucet	1	1,100
<b>MTS122216-P-WC-05: Hallway near Conference Room</b>	<b>Water Cooler Fountain</b>	1	<b>1,560</b>
MTS122216-P-OF-06: Conference Room	Office Faucet	2	1,210
<b>MTS122216-P-WC-07: Warehouse</b>	<b>Water Cooler Fountain</b>	<b>29</b>	<b>1,850</b>
MTS122216-P-OF-08: HVAC	Office Faucet	2	680
<i>MTS122216-P-OF-09: Laboratory Blank</i>	<i>Distilled Water Blank</i>	<i>&lt;1.0</i>	<i>&lt;10</i>
<i>MTS122216-P-WC-10: Laboratory Spike</i>	<i>Lead and Copper Spike</i>	<i>15</i>	<i>1,270</i>
<b>EPA Action Level</b>		<b>15</b>	<b>1,300</b>

- 1 µg/L means microgram per liter or parts per billion (ppb).
- 2 Action levels based on the U.S. EPA's Lead and Copper Rule.  
Results in **bold** indicate concentrations above the action levels of 15 µg/L for lead and 1,300 µg/L for copper  
Results in *italics* are quality assurance spike and blank samples.

**Table 2: pH and Temperature Data Summary**

Sample Number	Fixture Type	pH Flush	pH Sample	Temperature (°C) Flush	Temperature (°C) Sample
MTS-P-KF-04	Kitchen Faucet	8.00	7.91	15.9	18.4

**Table 3: Remedial Sampling Analytical Results Summary**

Sampling Event	Sample Identification				
	WC-01	WC-05	WC-07	Laboratory Blank (-09)	Laboratory Spike (-10)
<b>Lead Results</b>					
Initial (12/22/16)	<1.0	1	<b>29</b>	<1.0	15
Fixtures Replaced (3/2/17)	<1.0	<1.0	<1.0	<1.0	16.2
<b>EPA Action Level</b>	<b>15</b>	<b>15</b>	<b>15</b>	<b>15</b>	<b>15</b>
<b>Copper Results</b>					
Initial (12-22-16)	1,100	<b>1,560</b>	<b>1,850</b>	<10	1,270
Fixtures Replaced (3/2/17)	-	192	25.3	<0.5	1,250
<b>EPA Action Level</b>	<b>1,300</b>	<b>1,300</b>	<b>1,300</b>	<b>1,300</b>	<b>1,300</b>

- 1 Results reported in micrograms per liter (µg/L) or parts per billion (ppb).
- 2 Action levels based on the U.S. EPA's Lead and Copper Rule.  
Results indicated in **bold** indicate concentrations above the action levels of 15 µg/L for lead.  
Results indicated in *italics* are quality assurance spike and blank samples.

**ATTACHMENT D**

Initial Analytical Results





RJ LeeGroup, Inc. | Columbia Basin Analytical Laboratories

2710 North 20th Avenue, Pasco WA 99301

Tel: (509) 545-4989 | Fax: (509) 544-6010

Fulcrum Environmental  
406 N. 2nd St.  
Yakima, WA 98901

### Subject: Chemical Analysis Report

Columbia Basin Analytical Laboratories received 10 sample(s) on 12/22/16 for analysis. These sample(s) have been assigned a login order number of W612111. Enclosed is the final report that consists of a summary report of the sample(s), and a copy of the chain of custody.

### General Lab Comments

The results provided in this report relate only to the items tested. Sample(s) were received in acceptable conditions unless otherwise noted in the comments above. Sample(s) have not been field blank corrected unless otherwise noted in the general set comments above. The sample(s) were prepared in accordance with EPA 200.8 and analyzed in compliance with EPA 200.8. This test report shall not be reproduced, except in full, without written approval of Columbia Basin Analytical Laboratories. Any questions, please contact our office.

Release of the data contained in the hard copy report has been authorized by the Laboratory Director or a designee as verified by the following signature. This report has been administratively reviewed by the following individual:

01/27/17

Project Coordinator II, M. Fernanda Pincheira

Date

If you have any questions please feel free to contact Fernanda Pincheira at [MPincheira@rjleegroup.com](mailto:MPincheira@rjleegroup.com).



## Laboratory Report

Amanda Enbysk  
Fulcrum Environmental  
406 N. 2nd St.  
Yakima, WA 98901

RJ Lee Group No.: W612111  
COC No.: Kennewick  
Samples Received: 12/22/16  
Analysis/Prep Date: 01/20/17  
Report Date: 01/27/17

Client Project:

Fulcrum Kennewick

**Sample Name:** MTS122216-P-WC-01 **Matrix:** Potable Water **Date Received:** 12/22/16  
**RJ Lee Grp. ID:** W612111-01 **Date Analyzed:** 01/20/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	1.10	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

**Sample Name:** MTS122216-P-WC-02 **Matrix:** Potable Water **Date Received:** 12/22/16  
**RJ Lee Grp. ID:** W612111-02 **Date Analyzed:** 01/20/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.44	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

**Sample Name:** MTS122216-P-OF-03 **Matrix:** Potable Water **Date Received:** 12/22/16  
**RJ Lee Grp. ID:** W612111-03 **Date Analyzed:** 01/20/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.59	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

**Sample Name:** MTS122216-P-OF-04 **Matrix:** Potable Water **Date Received:** 12/22/16  
**RJ Lee Grp. ID:** W612111-04 **Date Analyzed:** 01/20/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	1.10	0.01	
Lead	EPA 200.8	0.001	0.001	

**Sample Name:** MTS122216-P-WC-05 **Matrix:** Potable Water **Date Received:** 12/22/16  
**RJ Lee Grp. ID:** W612111-05 **Date Analyzed:** 01/20/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	1.56	0.01	
Lead	EPA 200.8	0.001	0.001	

Columbia Basin Analytical Laboratories | 2710 North 20th Avenue, Pasco WA 93301 | 509.545.4989

WWW.RJLEEGROUP.COM

Report Template: GenMetalReportFull\_v12.rpt

Approved: 01/27/17 13:03  
Report Time Stamp: 01/27/17 16:43



**Sample Name:** MTS122216-P-OF-06 **Matrix:** Potable Water **Date Received:** 12/22/16  
**RJ Lee Grp. ID:** W612111-06 **Date Analyzed:** 01/20/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	1.21	0.01	
Lead	EPA 200.8	0.002	0.001	

**Sample Name:** MTS122216-P-WC-07 **Matrix:** Potable Water **Date Received:** 12/22/16  
**RJ Lee Grp. ID:** W612111-07 **Date Analyzed:** 01/20/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	1.85	0.01	
Lead	EPA 200.8	0.029	0.001	

**Sample Name:** MTS122216-P-OF-08 **Matrix:** Potable Water **Date Received:** 12/22/16  
**RJ Lee Grp. ID:** W612111-08 **Date Analyzed:** 01/20/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.68	0.01	
Lead	EPA 200.8	0.002	0.001	

**Sample Name:** MTS122216-P-OF-09 **Matrix:** Potable Water **Date Received:** 12/22/16  
**RJ Lee Grp. ID:** W612111-09 **Date Analyzed:** 01/20/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	< 0.010	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

**Sample Name:** MTS122216-P-WC-10 **Matrix:** Potable Water **Date Received:** 12/22/16  
**RJ Lee Grp. ID:** W612111-10 **Date Analyzed:** 01/20/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	1.27	0.01	
Lead	EPA 200.8	0.015	0.001	






---

**Report Qualifiers:**

*A = Target Analyte media breakthrough suspect, see analytical report*

*D = Analyte analyzed in a dilution*

*E = Report concentration was above the instrument calibration range*

*J = Analyte detected below quantitation limits, concentration is estimated*

*P = Library spectrum match,  $rsd > 90\%$  w RT match*

*Q = Result out of method specific acceptance QC criteria*

*S = Spike Recovery outside accepted recovery limits*

*Z = Not ELAP accredited analyte*

*ND = Not Detected*

*B = Analyte detected in the associated blank*

*d = Data that exceeds the RSD criteria set by the SOP*

*H = Holding times for preparation or analysis exceeded*

*L = Sample condition at receipt out of compliance with method defined conditions*

*R = RPD (relative percent difference) outside accepted recovery limits*

*U = Analyte analyzed for but not detected*

*N/A = Not Applicable*

---

**Scientist II DeNomy Dage**

*These results are submitted pursuant to RJ Lee Group's current terms and conditions of sale, including the company's standard warranty and limitation of liability provisions. No responsibility or liability is assumed for the manner in which the results are used or interpreted. Unless notified in writing to return the samples covered by this report, RJ Lee Group will store the samples for a period of ninety (90) days before discarding. A shipping and handling fee will be assessed for the return of any samples. Unless otherwise noted, samples were received in an acceptable condition. This laboratory operates in accordance with ISO 17025 guidelines, and holds limited scopes of accreditation under ORELAP Lab Code 4061 AIHA-LAP, LLC Lab ID 178656 EPA ID WA01195 and WA DOE Lab ID C859. This report may not be used to claim product endorsement by any laboratory accrediting agency. The results contained in this report relate only to the items tested or to the sample(s) as received by the laboratory. Any reproduction of this document must be in full for the report to be valid. Quality control data is available upon request.*

# Request for Environmental and IH Laboratory Analytical Services

W62111

Page 1 of 1

ATTENTION TO: RYAN MATHEWS		Client Job No.: 162017	
Lab Use Only		Turnaround Request	
Project No.:		Standard: <b>Yes</b> No	
Date Logged In:		If 'No,' No. of Business Days:	
Name: Amanda Enbysk, Ryan Mathews		Sample Purpose: <b>Information X</b> Regulatory <input type="checkbox"/> Accreditation (please list below):	
Company: Fulcrum Environmental Consulting		System ID #:	
Address: 406 North 2nd Street		DOH Source #:	
City, State, Zip: Yakima, WA, 98901		Multiple Sources #:	
Phone: (509) 574-0839		Sample Purpose: A <input type="checkbox"/> B <input type="checkbox"/> Other <input type="checkbox"/>	
Fax: (509) 575-8453		Preservation: Unpres H <sub>2</sub> SO <sub>4</sub> Matrix: WW=Wastewater SW=Surface Water	
Call with Verbal Results:		4°C HCl GW=Groundwater DW=Drinking Water	
Email Results To: aenbysk@fulcrum.net, CC: rmathews@fulcrum.net		HNO <sub>3</sub> NaOH S=Soil/Sludge O=Oil	
Fax Results To:		Other Na <sub>2</sub> SO <sub>4</sub> F=Extract X=Other	
Name: Lorrie Bouillier		Container: P=Plastic G=Glass W=Wipe A=Air (filter or tube)	
Company: Fulcrum Environmental		Email: lbouillier@fulcrum.net	
Address: 406 North 2nd Street		Analysis Requested	
City, State, Zip: Yakima, WA, 98901		Pres. Upon Receipt (Y/N)	
Phone: (509) 574-0839		UNPR.	
Fax: (509) 575-8453		DW	
Special Instructions		Matrix	
Client Sample ID		Container Type	
Sample Description		pH	
Sample Date		No. Containers	
Sample Time			
Wipe Area / Air Volume			
MS122216-P-WC-01	Transportation stop	X	14.1
MS122216-P-WC-02	Griller in Bas lounge		14.1
MS122216-P-WC-03	Sink in bus lounge		13.9
MS122216-P-WC-04	Back lounge in office		14.1
MS122216-P-WC-05	Hallway outside conference Rm		14.1
MS122216-P-WC-06	Conference Room 112		14.0
MS122216-P-WC-07	warehouse		13.6
MS122216-P-WC-08	HVAC		14.3
MS122216-P-WC-09	Upstairs lounge		14.3
MS122216-P-WC-10	Upstairs hallway		14.3
Relinquished By (Signature): <i>[Signature]</i>		Date: 12/22/2016	
Relinquished By (Print Name):		Time: 1340	
Company Name:		Method of Shipment:	
Relinquished By (Signature):		Date:	
Relinquished By (Print Name):		Time:	
Company Name:		Method of Shipment:	
Received By (Signature): <i>[Signature]</i>		Date: 12/22/2016	
Received By (Print Name):		Time: 1340	
Company Name:		Method of Shipment:	

Pennsylvania - HQ  
350 Hochberg Road  
Monroeville, PA 15146  
724.325.1776 Phone  
724.733.1799 Fax

Washington  
Columbia Basin Analytical Laboratories  
2710 North 20th Avenue  
Pasco, WA 99301  
509.545.4989 Phone  
509.544.6010 Fax



**ATTACHMENT E**

Remedial Analytical Results





**Fulcrum Environmental**

Ryan Mathews  
406 N. 2nd Street  
Yakima, WA 98901

**RE: Kennewick SD Drinking Water - MTS Building**  
**Work Order Number: 1703024**

March 10, 2017

**Attention Ryan Mathews:**

Fremont Analytical, Inc. received 11 sample(s) on 3/3/2017 for the analyses presented in the following report.

***Drinking Water Metals by EPA Method 200.8***

This report consists of the following:

- Case Narrative
- Analytical Results
- Applicable Quality Control Summary Reports
- Chain of Custody

All analyses were performed consistent with the Quality Assurance program of Fremont Analytical, Inc. Please contact the laboratory if you should have any questions about the results.

Thank you for using Fremont Analytical.

Sincerely,

Chelsea Ward  
Project Manager

**CC:**  
Amanda Enbysk



Date: 03/10/2017

**CLIENT:** Fulcrum Environmental  
**Project:** Kennewick SD Drinking Water - MTS Buildi  
**Work Order:** 1703024

## Work Order Sample Summary

Lab Sample ID	Client Sample ID	Date/Time Collected	Date/Time Received
1703024-001	MTS3217-P-WC-01	03/02/2017 7:45 AM	03/03/2017 9:30 AM
1703024-002	MTS3217-S-WC-01	03/02/2017 7:45 AM	03/03/2017 9:30 AM
1703024-003	MTS3217-T-WC-01	03/02/2017 7:45 AM	03/03/2017 9:30 AM
1703024-004	MTS3217-P-WC-05	03/02/2017 7:45 AM	03/03/2017 9:30 AM
1703024-005	MTS3217-S-WC-05	03/02/2017 7:45 AM	03/03/2017 9:30 AM
1703024-006	MTS3217-T-WC-05	03/02/2017 7:45 AM	03/03/2017 9:30 AM
1703024-007	MTS3217-P-WC-07	03/02/2017 7:45 AM	03/03/2017 9:30 AM
1703024-008	MTS3217-S-WC-07	03/02/2017 7:45 AM	03/03/2017 9:30 AM
1703024-009	MTS3217-T-WC-07	03/02/2017 7:45 AM	03/03/2017 9:30 AM
1703024-010	MTS3217-P-OF-09	03/02/2017 7:45 AM	03/03/2017 9:30 AM
1703024-011	MTS3217-P-WC-10	03/02/2017 7:45 AM	03/03/2017 9:30 AM

---

**CLIENT:** Fulcrum Environmental  
**Project:** Kennewick SD Drinking Water - MTS Building

---

WorkOrder Narrative:

I. SAMPLE RECEIPT:

Samples receipt information is recorded on the attached Sample Receipt Checklist.

II. GENERAL REPORTING COMMENTS:

Results are reported on a wet weight basis unless dry-weight correction is denoted in the units field on the analytical report ("mg/kg-dry" or "ug/kg-dry").

Matrix Spike (MS) and MS Duplicate (MSD) samples are tested from an analytical batch of "like" matrix to check for possible matrix effect. The MS and MSD will provide site specific matrix data only for those samples which are spiked by the laboratory. The sample chosen for spike purposes may or may not have been a sample submitted in this sample delivery group. The validity of the analytical procedures for which data is reported in this analytical report is determined by the Laboratory Control Sample (LCS) and the Method Blank (MB). The LCS and the MB are processed with the samples and the MS/MSD to ensure method criteria are achieved throughout the entire analytical process.

III. ANALYSES AND EXCEPTIONS:

Exceptions associated with this report will be footnoted in the analytical results page(s) or the quality control summary page(s) and/or noted below.

Prep Sample Comments:

1703024-001A 209600: Prep Comments for EPA200.8, Sample 1703024-001A: Turbidity: 0.00 NTU  
1703024-004A 209601: Prep Comments for EPA200.8, Sample 1703024-004A: Turbidity: 0.00 NTU  
1703024-007A 209602: Prep Comments for EPA200.8, Sample 1703024-007A: Turbidity: 0.00 NTU  
1703024-010A 209603: Prep Comments for EPA200.8, Sample 1703024-010A: Turbidity: 0.00 NTU  
1703024-011A 209604: Prep Comments for EPA200.8, Sample 1703024-011A: Turbidity: 0.00 NTU



Qualifiers:

- \* - Flagged value is not within established control limits
- B - Analyte detected in the associated Method Blank
- D - Dilution was required
- E - Value above quantitation range
- H - Holding times for preparation or analysis exceeded
- I - Analyte with an internal standard that does not meet established acceptance criteria
- J - Analyte detected below Reporting Limit
- N - Tentatively Identified Compound (TIC)
- Q - Analyte with an initial or continuing calibration that does not meet established acceptance criteria (<20%RSD, <20% Drift or minimum RRF)
- S - Spike recovery outside accepted recovery limits
- ND - Not detected at the Reporting Limit
- R - High relative percent difference observed

Acronyms:

- %Rec - Percent Recovery
- CCB - Continued Calibration Blank
- CCV - Continued Calibration Verification
- DF - Dilution Factor
- HEM - Hexane Extractable Material
- ICV - Initial Calibration Verification
- LCS/LCSD - Laboratory Control Sample / Laboratory Control Sample Duplicate
- MB or MBLANK - Method Blank
- MDL - Method Detection Limit
- MS/MSD - Matrix Spike / Matrix Spike Duplicate
- PDS - Post Digestion Spike
- Ref Val - Reference Value
- RL - Reporting Limit
- RPD - Relative Percent Difference
- SD - Serial Dilution
- SGT - Silica Gel Treatment
- SPK - Spike
- Surr - Surrogate



**CLIENT:** Fulcrum Environmental  
**Project:** Kennewick SD Drinking Water - MTS Building

**Lab ID:** 1703024-001      **Collection Date:** 3/2/2017 7:45:00 AM  
**Client Sample ID:** MTS3217-P-WC-01      **Matrix:** Drinking Water

Analyses	Result	RL	Qual	Units	DF	Date Analyzed
----------	--------	----	------	-------	----	---------------

**Drinking Water Metals by EPA Method 200.8**

Batch ID: 16420      Analyst: TN

Lead	ND	1.00		µg/L	1	3/10/2017 12:58:40 PM
------	----	------	--	------	---	-----------------------

**Lab ID:** 1703024-004      **Collection Date:** 3/2/2017 7:45:00 AM  
**Client Sample ID:** MTS3217-P-WC-05      **Matrix:** Drinking Water

Analyses	Result	RL	Qual	Units	DF	Date Analyzed
----------	--------	----	------	-------	----	---------------

**Drinking Water Metals by EPA Method 200.8**

Batch ID: 16420      Analyst: TN

Copper	192	0.500		µg/L	1	3/10/2017 1:02:41 PM
Lead	ND	1.00		µg/L	1	3/10/2017 1:02:41 PM

**Lab ID:** 1703024-007      **Collection Date:** 3/2/2017 7:45:00 AM  
**Client Sample ID:** MTS3217-P-WC-07      **Matrix:** Drinking Water

Analyses	Result	RL	Qual	Units	DF	Date Analyzed
----------	--------	----	------	-------	----	---------------

**Drinking Water Metals by EPA Method 200.8**

Batch ID: 16420      Analyst: TN

Copper	25.3	0.500		µg/L	1	3/10/2017 1:06:46 PM
Lead	ND	1.00		µg/L	1	3/10/2017 1:06:46 PM





**CLIENT:** Fulcrum Environmental

**Project:** Kennewick SD Drinking Water - MTS Building

**Lab ID:** 1703024-010

**Collection Date:** 3/2/2017 7:45:00 AM

**Client Sample ID:** MTS3217-P-OF-09

**Matrix:** Drinking Water

Analyses	Result	RL	Qual	Units	DF	Date Analyzed
----------	--------	----	------	-------	----	---------------

**Drinking Water Metals by EPA Method 200.8**

Batch ID: 16420

Analyst: TN

Copper	ND	0.500		µg/L	1	3/10/2017 1:10:48 PM
Lead	ND	1.00		µg/L	1	3/10/2017 1:10:48 PM

**Lab ID:** 1703024-011

**Collection Date:** 3/2/2017 7:45:00 AM

**Client Sample ID:** MTS3217-P-WC-10

**Matrix:** Drinking Water

Analyses	Result	RL	Qual	Units	DF	Date Analyzed
----------	--------	----	------	-------	----	---------------

**Drinking Water Metals by EPA Method 200.8**

Batch ID: 16420

Analyst: TN

Copper	1,250	0.500		µg/L	1	3/10/2017 1:14:49 PM
Lead	16.2	1.00		µg/L	1	3/10/2017 1:14:49 PM



Date: 3/10/2017

**Work Order:** 1703024  
**CLIENT:** Fulcrum Environmental  
**Project:** Kennewick SD Drinking Water - MTS Buildi

**QC SUMMARY REPORT**  
**Drinking Water Metals by EPA Method 200.8**

Sample ID <b>MB-16420</b>	SampType: <b>MBLK</b>	Units: <b>µg/L</b>			Prep Date: <b>3/6/2017</b>	RunNo: <b>34873</b>					
Client ID: <b>MBLKW</b>	Batch ID: <b>16420</b>				Analysis Date: <b>3/10/2017</b>	SeqNo: <b>665786</b>					
Analyte	Result	RL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Copper ND 0.500  
 Lead ND 1.00

Sample ID <b>LCS-16420</b>	SampType: <b>LCS</b>	Units: <b>µg/L</b>			Prep Date: <b>3/6/2017</b>	RunNo: <b>34873</b>					
Client ID: <b>LCSW</b>	Batch ID: <b>16420</b>				Analysis Date: <b>3/10/2017</b>	SeqNo: <b>665787</b>					
Analyte	Result	RL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Copper 89.3 0.500 100.0 0 89.3 85 115  
 Lead 52.4 1.00 50.00 0 105 85 115

Sample ID <b>1703021-001ADUP</b>	SampType: <b>DUP</b>	Units: <b>µg/L</b>			Prep Date: <b>3/6/2017</b>	RunNo: <b>34873</b>					
Client ID: <b>BATCH</b>	Batch ID: <b>16420</b>				Analysis Date: <b>3/10/2017</b>	SeqNo: <b>665789</b>					
Analyte	Result	RL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Copper 16.6 0.500 18.64 11.8 30  
 Lead ND 1.00 0 30

Sample ID <b>1703021-001AMS</b>	SampType: <b>MS</b>	Units: <b>µg/L</b>			Prep Date: <b>3/6/2017</b>	RunNo: <b>34873</b>					
Client ID: <b>BATCH</b>	Batch ID: <b>16420</b>				Analysis Date: <b>3/10/2017</b>	SeqNo: <b>665790</b>					
Analyte	Result	RL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Copper 200 0.500 200.0 18.64 90.5 70 130  
 Lead 102 1.00 100.0 0.6172 101 70 130

Sample ID <b>1703021-001AMSD</b>	SampType: <b>MSD</b>	Units: <b>µg/L</b>			Prep Date: <b>3/6/2017</b>	RunNo: <b>34873</b>					
Client ID: <b>BATCH</b>	Batch ID: <b>16420</b>				Analysis Date: <b>3/10/2017</b>	SeqNo: <b>665791</b>					
Analyte	Result	RL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Copper 202 0.500 200.0 18.64 91.8 70 130 199.6 1.32 30



**Work Order:** 1703024  
**CLIENT:** Fulcrum Environmental  
**Project:** Kennewick SD Drinking Water - MTS Buildi

**QC SUMMARY REPORT**  
**Drinking Water Metals by EPA Method 200.8**

Sample ID <b>1703021-001AMSD</b>	SampType: <b>MSD</b>	Units: <b>µg/L</b>			Prep Date: <b>3/6/2017</b>	RunNo: <b>34873</b>					
Client ID: <b>BATCH</b>	Batch ID: <b>16420</b>				Analysis Date: <b>3/10/2017</b>	SeqNo: <b>665791</b>					
Analyte	Result	RL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual
Lead	103	1.00	100.0	0.6172	102	70	130	101.8	0.919	30	

Client Name: <b>FE</b>	Work Order Number: <b>1703024</b>
Logged by: <b>Erica Silva</b>	Date Received: <b>3/3/2017 9:30:00 AM</b>

**Chain of Custody**

1. Is Chain of Custody complete? Yes  No  Not Present
2. How was the sample delivered? UPS

**Log In**

3. Coolers are present? Yes  No  NA
4. Shipping container/cooler in good condition? Yes  No
5. Custody Seals present on shipping container/cooler?  
(Refer to comments for Custody Seals not intact) Yes  No  Not Required
6. Was an attempt made to cool the samples? Yes  No  NA
7. Were all items received at a temperature of >0°C to 10.0°C\* Yes  No  NA
8. Sample(s) in proper container(s)? Yes  No
9. Sufficient sample volume for indicated test(s)? Yes  No
10. Are samples properly preserved? Yes  No
11. Was preservative added to bottles? Yes  No  NA
12. Is there headspace in the VOA vials? Yes  No  HNO3 NA
13. Did all samples containers arrive in good condition(unbroken)? Yes  No
14. Does paperwork match bottle labels? Yes  No
15. Are matrices correctly identified on Chain of Custody? Yes  No
16. Is it clear what analyses were requested? Yes  No
17. Were all holding times able to be met? Yes  No

**Special Handling (if applicable)**

18. Was client notified of all discrepancies with this order? Yes  No  NA

Person Notified:	<input type="text"/>	Date:	<input type="text"/>
By Whom:	<input type="text"/>	Via:	<input type="checkbox"/> eMail <input type="checkbox"/> Phone <input type="checkbox"/> Fax <input type="checkbox"/> In Person
Regarding:	<input type="text"/>		
Client Instructions:	<input type="text"/>		

19. Additional remarks:

HNO3 added to 002A, 003A, 005A, 006A, 008A, 009A

**Item Information**

Item #	Temp °C
Cooler	2.7
Sample	1.3

\* Note: DoD/ELAP and TNI require items to be received at 4°C +/- 2°C



3600 Fremont Ave N.  
Seattle, WA 98103

Tel: 206-352-3790  
Fax: 206-352-7178

# Chain of Custody Record and Laboratory Services Agreement

Date: 3/2/2017

Laboratory Project No (Internal):

1703024

Page: 1 of 2

Client: Fulcrum Environmental Consulting

Project Name: Kennewick SD Drinking Water - MTS Building

Project No: 162017.13

Collected by: Amanda Embysk

Address: 406 North Second Street

Location: MTS Building, Kennewick, WA

City, State, Zip: Yakima, WA, 98901

Report To (PM): Ryan Mathews

Telephone: 509.574.0839

Fax: 509.575.8453

PM Email: rmathews@fulcrum.net; cc: aenbysk@fulcrum.net

\*Matrix Codes: A = Air, AQ = Aqueous, B = Bulk, O = Other, P = Product, S = Soil, SD = Sediment, SL = Solid, W = Water, DW = Drinking Water, GW = Ground Water, SW = Storm Water, WW = Waste Water

Sample Name	Sample Date	Sample Time	Sample Type (Matrix)*	Analytes													Comments			
				VOCs (EPA 8260 / 624)	GY/BTEX	BTEX	Gasoline Range Organics (GX)	Hydrocarbon Identification (GX)	Diesel/Heavy Oil Range Organics (DX)	SVOCs (EPA 8270 / 625)	PAHs (EPA 8270 - SIM)	PCBs (EPA 8082 / 608)	Metals** (EPA 6020 / 200.8)	Total (T)   Dissolved (D)	Anions (IC)***	EDB (8011)				
1 MTS 3217-P-WC-01	3-2-17	0745	DW																	X Analyze for Lead Only
2 MTS 3217-S-WC-01																				
3 MTS 3217-T-WC-01																				
4 MTS 3217-P-WC-05																				X Analyze for Lead & Copper
5 MTS 3217-S-WC-05																				
6 MTS 3217-T-WC-05																				
7 MTS 3217-P-WC-07																				X Analyze for Lead & Copper
8 MTS 3217-S-WC-07																				
9 MTS 3217-T-WC-07																				
10 MTS 3217-P-WC-09																				X Analyze for Lead & Copper

Distribution: White - Lab, Yellow - File, Pink - Originator

www.fremontanalytical.com

3600 Fremont Ave N. Tel: 206-352-3790  
 Seattle, WA 98103 Fax: 206-352-7178

## Chain of Custody Record and Laboratory Services Agreement

**Client:** Fulcrum Environmental Consulting  
**Address:** 406 North Second Street  
 City, State, Zip: Yakima, WA, 98901  
 Telephone: 509.574.0839 Fax: 509.575.8453

**Project Name:** Kennewick SD Drinking Water - MTS Building  
**Project No:** 162017.13 **Collected by:** Amanda Enbysk  
**Location:** MTS Building, Kennewick, WA  
**Report To (PM):** Ryan Mathews  
**PM Email:** rmathews@fulcrum.net; cc: aenbysk@fulcrum.net

**Date:** 3/2/2017 **Laboratory Project No (Internal):** 1703024  
**Page:** 2 of 2

Sample Name	Sample Date	Sample Time	Sample Type (Matrix)*	VOCs (EPA 8260 / 624) GX/BTEX BTEX	Gasoline Range Organics (GX)	Hydrocarbon Identification (HCID)	Diesel/Heavy Oil Range Organics (DX)	SVOCs (EPA 8270 / 625)	PAHs (EPA 8270 - SIM)	PCBs (EPA 8082 / 608)	Metals** (EPA 6020 / 200.8)	Total (T)   Dissolved (D)	Anions (IC)*** EDB (8011)	Preserved with HMB	Comments	
																MTS 3217 -P-WC-10
1	MTS 3217 -P-WC-10	3-2-17	0745	DW											Preserved with HMB	
2																Analyze for Lead & Copper
3																
4																
5																
6																
7																
8																
9																
10																

**\*\*Matrix Codes:** A = Air, AQ = Aqueous, B = Bulk, O = Other, P = Product, S = Soil, SD = Sediment, SL = Solid, W = Water, DW = Drinking Water, GW = Ground Water, SW = Storm Water, WW = Waste Water

**\*\*Metals Analysis (Circle):** MTCA-5 RCA-8 Priority Pollutants TAL Individual: Ag Al As B Ba Be Ca Cd Co Cr Cu Fe Hg K Mg Mn Mo Na Ni Pb Sb Se Sr Sn Ti Tl U V Zn

**\*\*Anions (Circle):** Nitrate Nitrite Chloride Sulfate Bromide O-Phosphate Fluoride Nitrate+Nitrite

**Sample Disposal:**  Return to Client  Disposal by Lab (Samples will be held for 30 days unless otherwise noted. A fee may be assessed if samples are retained after 30 days.)

**Turn-around times for samples received after 4:00pm will begin on the following business day.**

**I represent that I am authorized to enter into this Agreement with Fremont Analytical on behalf of the Client named above, that I have verified Client's agreement to each of the terms on the front and backside of this Agreement.**

Relinquished	Date/Time	Received	Date/Time
X	3/2/17 4:00	X	3/3/2017 0930
X	3/2/17 3:30	X	

TAT → SameDay<sup>^</sup> NextDay<sup>^</sup> 2 Day 3 Day STD

\*Please coordinate with the lab in advance

Special Remarks: See page 1