

November 3, 2017

Kennewick School District No. 17
Attn: Keith Colee, Maintenance and Operations Manager
1000 West Fourth Avenue
Kennewick, Washington, 99336

**RE: Winter 2016 Drinking Water Sampling Results
Vista Elementary School, 1701 North Young Street, Kennewick, Washington**

Dear Keith:

On Wednesday, December 21, 2016, Fulcrum Environmental Consulting, Inc. (Fulcrum) collected 38 drinking water samples for lead and copper analysis from Vista Elementary School (School) located at 1701 North Young Street in Kennewick, Washington. Initial sampling identified two fixture locations with copper concentrations above the guidance levels. Fulcrum returned to the School on February 11, 2017 to collect samples after remediation of the fixture and laboratory results found concentrations to be below guidance levels. Sampling was completed as part of a District-wide project and all analysis was completed by Washington State Department of Ecology (Ecology) accredited laboratories.

Summary

The purpose of initial sampling was to evaluate current drinking water quality conditions with respect to lead and copper as a result of the increased national and local interest related to lead in drinking water. The intent of sampling was to meet the requirements of the pending regulations set forth in Washington Administrative Code (WAC) 246-366A-130 and 246-366A-135¹. Consistent with the regulations, Fulcrum completed sampling at the rates of at least 50% of plumbing fixtures used regularly for drinking or cooking in elementary and preschools and at least 25% of drinking or cooking fixtures in middle schools, junior high schools, and high schools. In addition, Fulcrum sampled administrative facilities in the District at the same rate as elementary schools, of at least 50% of drinking and cooking fixtures.

Fulcrum completed initial sampling on December 21, 2016. Initial results identified two samples, both located in the Music Room, with copper concentrations above the Environmental Protection Agency (EPA) action level of 1,300 micrograms per liter (µg/L). Upon receipt of results, the District removed the identified fixtures from service pending remediation and further testing.

Copper is not a significant component in fixtures, but is the primary material in the plumbing system. To remediate elevated copper, the District replaced the identified fixtures and aggressively flushed the fixtures with cold water to clear the plumbing of copper construction debris. Fulcrum returned on February 11, 2017 and collected samples to evaluate the success of the remediation. The follow-up samples yielded results

¹ Washington State Department of Health, WAC 246-366A, *The Environmental Health and Safety Standards of Primary and Secondary Schools*, <http://apps.leg.wa.gov/WAC/default.aspx?cite=246-366A>, July 26, 2016

below the EPA action level, confirming the remediation was successful. Following sampling and review of laboratory results, Fulcrum recommended, and the District elected, to return the fixtures to service.

As all samples now report concentrations below lead and copper action levels, at this time Fulcrum does not recommend any additional sampling. However, consistent with industry practice and the intent of WAC 246-366A, Fulcrum recommends that the District complete re-sampling of the building within the next five years (before December 2021). Additionally, if WAC 246-366A-130 is enacted, the regulations would require testing of all remaining fixtures within two years of the effective date (July 1, 2017). See Figure 1 in Attachment A for fixture locations and laboratory results. See Figure 1 in Attachment A for fixture locations and laboratory results.

Sampling Methodology

As a portion of this project, Fulcrum prepared a Sampling and Analysis Plan (SAP) intended to satisfy future initial sampling requirements under pending regulations.

For initial evaluation purposes, Fulcrum collected “first draw” samples. This “first draw” water volume consists of 250 milliliters (mL) and is intended to represent the water quality in the fixture, tubing connecting the fixture to the building piping, and potentially a portion of the building piping. If lead and copper are present, this first-draw sample typically contains the highest lead levels and indicates high copper from the associated building piping.

For most post-remediation evaluation sampling, Fulcrum collected three-part samples consisting of the first draw, “second draw”, and “third draw” water volumes. Second and third draw samples are intended to represent the water quality of building piping and plumbing components behind the fixture and the water entering the building from the water main.

As a quality control measure, Fulcrum also included a laboratory blank of distilled water and a laboratory “spike” sample with known concentrations of lead and copper at the selected action levels for the project during all sampling events. Blank and spike sample results are included in the results tables for reference.

Blank and spike samples were used to evaluate laboratory performance. The reported lead and copper concentrations of quality assurance samples provided a metric to determine accuracy of the analyses. If the reported concentration of the spike sample differed from the action level, then the spike sample concentration was used as the action level.

Field evaluation of pH and temperature of drinking water was completed during the cold water flush and immediately following sample collection on select fixtures during the initial sampling event as a general evaluation of water quality.

Sampling Activities

Fulcrum's two-part sampling process consisted of an initial site visit the prior afternoon/evening to locate and flush each water sampling location (fixture). Sample collection occurred the following morning, after the fixture sat motionless for more than eight but no less than 18 hours, typically approximately 14 hours.

Initial Sampling

On the initial visit, Fulcrum flushed cold water through each fixture selected for sampling for approximately one minute. Following the flush, each fixture was covered and secured within a plastic bag. The plastic bags were marked with signage indicating testing was in progress and the fixture should not be used. Fulcrum returned to the school eight to 18 hours later to collect the samples. Each sample consisted of the first draw collected into 250-mL unpreserved polyethylene bottles and was immediately placed on ice in a chilled cooler.

Samples collected from the initial sampling event were delivered under chain-of-custody to RJ Lee Group's Columbia Basin Analytical Laboratory (Ecology Lab ID: C859-16) in Pasco, Washington for analysis.

Fixture Replacement and Flushing

Fixtures identified with elevated lead concentrations were replaced and preconditioned by running cold water continuously through the fixture for 24 hours, as outlined in WAC 246-366A-130. Following replacement and preconditioning, Fulcrum collected follow-up samples to confirm the success of fixture replacement.

Fixtures producing elevated copper concentrations were generally identified in newer District buildings and were not associated with specific fixture styles. The relationship between building construction age and fixture styles indicates elevated copper concentrations are principally associated with construction debris in the plumbing system.

All fixtures with elevated copper were flushed aggressively by running water through the fixture at high flow with the aerator removed for approximately 30 minutes to clear the plumbing of any debris potentially causing elevated copper concentrations. Following an aggressive flush, fixtures were resampled to evaluate the effectiveness at reducing copper concentrations. The District elected to install filters, install signage indicating the fixtures should be used only for handwashing, or permanently removed from service fixtures that did not respond to an aggressive flush. Filtered fixtures were resampled following filter installation to verify effectiveness of the filter.

Remedial Sampling

Remedial sampling typically consisted of first, second, and third draw samples from the fixture location and plumbing system in question. First draw samples were collected into 250 mL polyethylene bottles preserved with nitric acid. The second draw water volume consists of water collected into a 250 mL unpreserved polyethylene container immediately following the first draw. No water was lost between

collection of the first and second draw samples. The third draw water volume is a 1,000 mL sample collected into a one liter unpreserved polyethylene container after the fixture has been flushed for about three to five minutes.

Samples collected following remedial activities were shipped by common carrier under chain of custody to Fremont Analytical Laboratory (Ecology Lab ID: C910-16) in Seattle, Washington for analysis. Fremont was selected based on their availability to complete analysis on an expedited schedule.

Analytical Results

Samples from both initial and remedial sampling events were analyzed for lead and copper in drinking water by EPA Method 200.8.

Initial Sampling

Sample locations from the initial sampling event are presented in Figure 1 in Attachment A of this letter. A site-specific sampling and analysis plan (SSSAP) that provides a building specific summary of the location, number, and sampling frequency of water fixture locations is located in Attachment B. Initial analytical results are summarized in Table 1 located in Attachment C of this letter. Laboratory analytical results from the initial sampling event are located in Attachment D of this letter.

In addition, pH and temperature data from the initial sampling event is presented in Table 2 in Attachment C of this letter.

Remedial Sampling

Sample locations from the remedial sampling event are presented in Figure 1 in Attachment A of this letter. The remedial analytical results from this project are summarized in Table 3 located in Attachment C of this letter. Laboratory analytical results from the remedial sampling event are located in Attachment E of this letter.

Discussion

Initial Sampling

Analytical results identified two samples, both located in the Music Room, with copper concentrations above the EPA action level of 1,300 µg/L. No samples were identified with lead concentrations above the EPA action level of 15 µg/L.

Remedial Sampling

Immediately following receipt of initial sampling results, the District removed the identified fixtures from service pending remediation and further testing. To remediate elevated copper concentrations, the District

replaced the identified fixtures and completed an aggressive flush of both fixtures. Fulcrum returned on the morning following the aggressive flush, February 11, 2017, to collect follow-up samples.

Analytical results from remedial sampling indicated the fixture replacement and aggressive flush were successful at reducing copper concentrations below the action level for the fixtures in question.

Recommendations

No samples were found to contain lead concentrations above the EPA action level of 15 µg/L. A total of two initial samples contained copper above the EPA action level of 1,300 µg/L. The District replaced the fixtures and completed an aggressive flush to reduce the copper concentration of the fixtures and follow-up samples yielded results below the action level, confirming the remediation was successful. Following sampling and review of laboratory results, Fulcrum recommended, and the District elected, to return the fixtures to service.

As all samples now report concentrations below lead and copper action levels, Fulcrum does not recommend any additional sampling at this time. However, consistent with industry practice and the intent of WAC 246-366A, Fulcrum recommends that the District complete re-sampling of the building within the next five years (before December 2021). Additionally, if WAC 246-366A-130 is enacted, the regulations would require testing of all remaining fixtures within two years of the effective date (July 1, 2017).

If you have any questions, please feel free to contact me at (509) 574-0839.

Sincerely,



Amanda Enbysk, GIT
Environmental Geologist




Ryan K. Mathews, CIH, CHMM
Principal



ATTACHMENT A

Figure 1: Sample Location Map




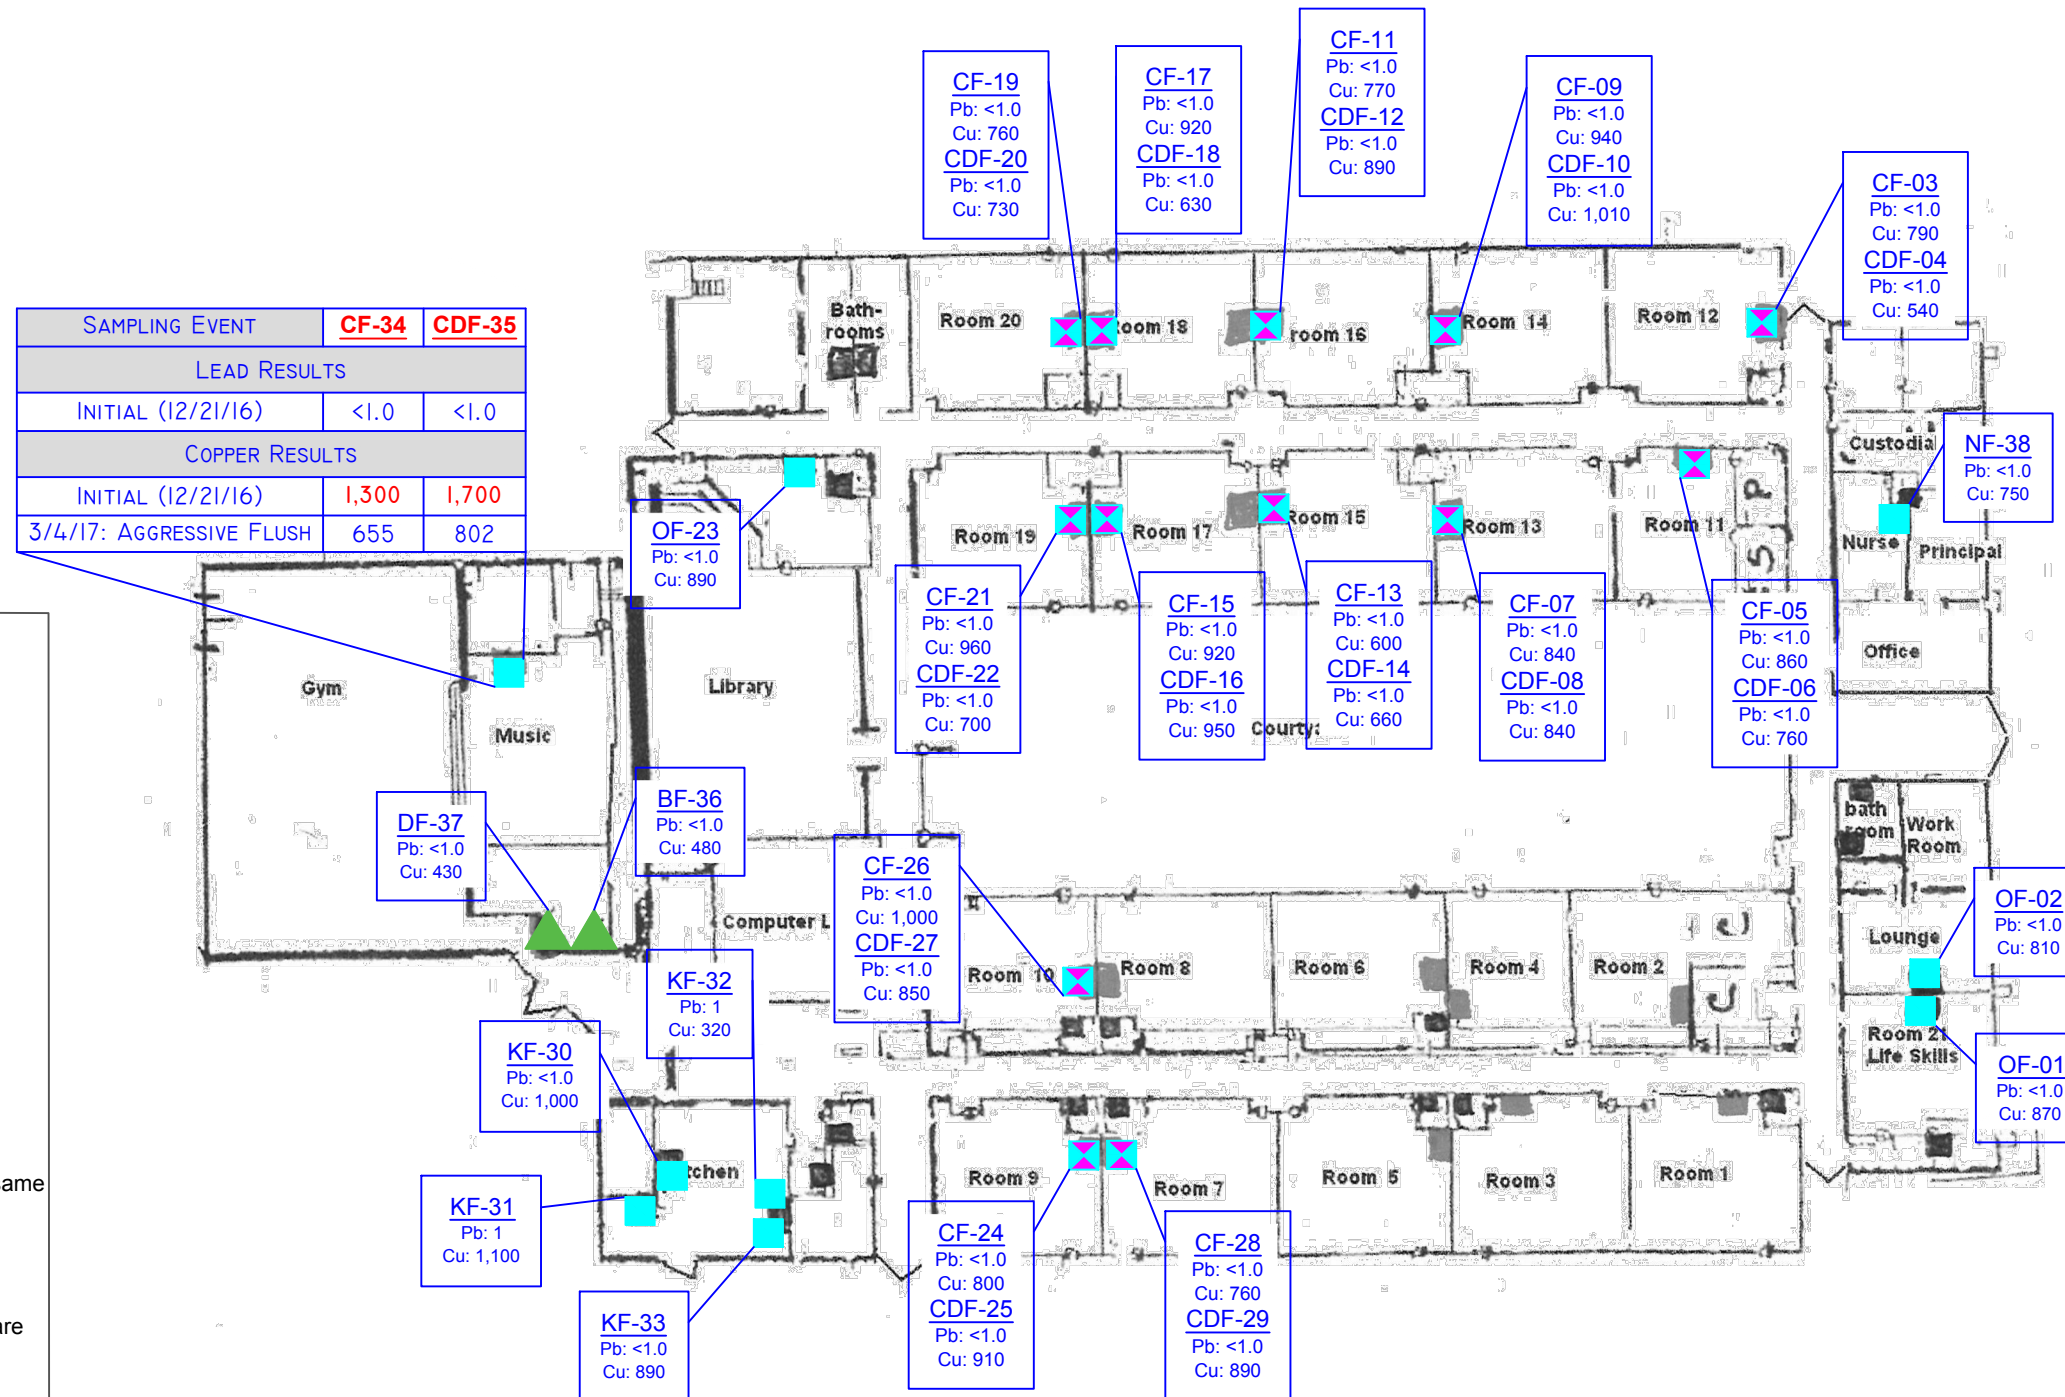

DRAWING PROVIDED BY KENNEWICK SCHOOL DISTRICT

ATTACHMENT B

Site-Specific Sampling and Analysis Plan



Site-Specific Sampling and Analysis Plan

Kennewick School District – Winter 2016 Drinking Water Sampling

Note: This SSSAP has been prepared as a supplement to the project SAP/QAPP and provide a building specific summary of the location, number, and sampling frequency of water fixture locations.

Campus/Building: Vista Elementary Address: 1701 North Young Street, Kennewick, WA

Elementary Middle School High School Administration

Date of Construction: 1961 Modernizations: 1966, 1998

Fixture Type	Locations	Fixture Styles ¹	Samples	Ratio
Drinking fountain/water cooler (DF/WC)	2	2	2	100%
Kitchen Fixture (KF)	4	4	4	100%
Classroom faucet, including faucets in Food Labs and Life Sciences Classrooms (CF)	21	2	14	67%
Classroom drinking fountain at sink (CDF)	23	1	15	65%
Nurse's Office/Health Room (NF)	1	1	1	100%
Teacher's Lounges/Work Rooms (OF)	2	2	2	100%
TOTALS	53		38	72%

¹ Fixture styles are approximate based on sampler's observations

Lead Sampler: Logan Lopez Date: 12/21/2016

Sample Prefix: VE – 122116 – P (first-draw) – 01-40
School Code Date Sample Type Fixture Type Sample Number

Laboratory: R. J. Lee Group, Columbia Basin Analytical Delivery Date: December 21, 2016

Comments:

ATTACHMENT C

Table 1: Initial Sampling Analytical Results Summary Table
Table 2: pH and Temperature Data Summary Table
Table 3: Remedial Sampling Analytical Results Summary Table




Table 1: Initial Sampling Analytical Results

Sample Identification and Location	Fixture Type	Lead Results (µg/L)	Copper Results (µg/L)
122116-VE-P-OF-01: Room 21	Office Faucet	<1.0	870
122116-VE-P-OF-02: Lounge near room 21	Office Faucet	<1.0	810
122116-VE-P-CF-03: Room 12	Classroom Faucet	<1.0	790
122116-VE-P-CDF-04: Room 12	Classroom Drinking Fountain	<1.0	540
122116-VE-P-CF-05: Room 11	Classroom Faucet	<1.0	860
122116-VE-P-CDF-06: Room 11	Classroom Drinking Fountain	<1.0	760
122116-VE-P-CF-07: Room 13	Classroom Faucet	<1.0	840
122116-VE-P-CDF-08: Room 13	Classroom Drinking Fountain	<1.0	840
122116-VE-P-CF-09: Room 14	Classroom Faucet	<1.0	940
122116-VE-P-CDF-10: Room 14	Classroom Drinking Fountain	<1.0	1,010
122116-VE-P-CDF-11: Room 16	Classroom Drinking Fountain	<1.0	770
122116-VE-P-CDF-12: Room 16	Classroom Drinking Fountain	<1.0	890
122116-VE-P-CF-13: Room 15	Classroom Faucet	<1.0	600
122116-VE-P-CDF-14: Room 15	Classroom Drinking Fountain	<1.0	660
122116-VE-P-CF-15: Room 17	Classroom Faucet	<1.0	920
122116-VE-P-CDF-16: Room 17	Classroom Drinking Fountain	<1.0	950
122116-VE-P-CF-17: Room 18	Classroom Faucet	<1.0	920
122116-VE-P-CDF-18: Room 18	Classroom Drinking Fountain	<1.0	630
122116-VE-P-CF-19: Room 20	Classroom Faucet	<1.0	760
122116-VE-P-CDF-20: Room 20	Classroom Drinking Fountain	<1.0	730
122116-VE-P-CF-21: Room 19	Classroom Faucet	<1.0	960
122116-VE-P-CDF-22: Room 19	Classroom Drinking Fountain	<1.0	700
122116-VE-P-OF-23: Library office	Office Faucet	<1.0	890
122116-VE-P-CF-24: Room 9	Classroom Faucet	<1.0	800
122116-VE-P-CDF-25: Room 9	Classroom Drinking Fountain	<1.0	910
122116-VE-P-CF-26: Room 10	Classroom Faucet	<1.0	1,000
122116-VE-P-CDF-27: Room 10	Classroom Drinking Fountain	<1.0	850
122116-VE-P-CF-28: Room 7	Classroom Faucet	<1.0	760
122116-VE-P-CDF-29: Room 7	Classroom Drinking Fountain	<1.0	890
122116-VE-P-KF-30: Kitchen, W. wall, N. fixture	Kitchen Faucet	<1.0	1,000
122116-VE-P-KF-31: Kitchen, W. wall, S. fixture	Kitchen Faucet	1	1,100
122116-VE-P-KF-32: Kitchen, E. wall, N. fixture	Kitchen Faucet	1	320
122116-VE-P-KF-33: Kitchen, E. wall, S. fixture	Kitchen Faucet	<1.0	890
122116-VE-P-CF-34: Music Room	Classroom Faucet	<1.0	1,300
122116-VE-P-CDF-35: Music Room	Classroom Drinking Faucet	<1.0	1,700
122116-VE-P-BF-36: Corridor Outside Music Room, left fixture	Bottle Filler	<1.0	480

Sample Identification and Location	Fixture Type	Lead Results (µg/L)	Copper Results (µg/L)
122116-VE-P-DF-37: Corridor Outside Music Room, right fixture	Drinking Fountain	<1.0	430
122116-VE-P-NF-38: Nurse's office	Nurse's Faucet	<1.0	750
<i>122116-VE-P-BF-39: Laboratory Blank</i>	<i>Distilled Water Blank</i>	<i><1.0</i>	<i><10</i>
<i>122116-VE-P-BF-40: Laboratory Spike</i>	<i>Lead and Copper Spike</i>	<i>16</i>	<i>1,200</i>
EPA Action Level		15	1,300

1 µg/L means microgram per liter or parts per billion (ppb).

2 Action levels based on the U.S. EPA's Lead and Copper Rule.

Results indicated in **bold** indicate concentrations above the action levels of 15 µg/L for lead and 1,300 µg/L for copper

Results indicated in *italics* are quality assurance spike and blank samples

Table 2: pH and Temperature Data Summary

Sample Number	Fixture Type	pH Flush	pH Sample	Temperature (°C) Flush	Temperature (°C) Sample
VE122116-P-OF-1: Room 21	Office Faucet	7.30	7.45	13.5	22.8
VE122116-P-CF-5: Room 11	Classroom Faucet	7.63	7.65	13.6	19.9
VE122116-P-CF-9: Room 14	Classroom Faucet	7.56	7.62	38.0	22.0
VE122116-P-CF-13: Room 15	Classroom Faucet	7.89	7.69	14.3	20.0
VE122116-P-CF-17: Room 18	Classroom Faucet	7.66	7.76	28.7	19.9
VE122116-P-CF-21: Room 19	Classroom Faucet	7.76	7.76	19.5	19.3
VE122116-P-DF-25: Room 9	Classroom Drinking Fountain	7.73	7.62	15.8	21.2
VE122116-P-CF-29: Room 7	Classroom Drinking Fountain	7.69	7.70	15.4	21.6
VE122116-P-CF-33: Kitchen, E. wall, S. fixture	Kitchen Faucet	7.76	7.64	15.4	25.3
VE122116-P-CF-37: Outside music room	Drinking Fountain	7.72	7.86	15.7	17.7

Table 3: Remedial Sampling Analytical Results

Sampling Event	Sampling Location			
	CF-34	CDF-35	Laboratory Blank (-39)	Laboratory Spike (-40)
Initial (12/21/16)	1,300	1,700	<10	1,200
Fixture Replacement and Aggressive Flush (2/11/17)	655	802	1.15	1,210
EPA Action Level	1,300	1,300	1,300	1,300

- 1 µg/L means microgram per liter or parts per billion (ppb).
- 2 Action levels based on the U.S. EPA’s Lead and Copper Rule.
 Results indicated in **bold** indicate concentrations above the action levels of 15 µg/L for lead and 1,300 µg/L for copper
 Results indicated in *italics* are quality assurance spike and blank samples.



ATTACHMENT D

Initial Analytical Results





RJ LeeGroup, Inc. | Columbia Basin Analytical Laboratories

2710 North 20th Avenue, Pasco WA 99301

Tel: (509) 545-4989 | Fax: (509) 544-6010

Fulcrum Environmental
406 N. 2nd St.
Yakima, WA 98901

Subject: Chemical Analysis Report

Columbia Basin Analytical Laboratories received 40 sample(s) on 12/21/16 for analysis. These sample(s) have been assigned a login order number of W612109. Enclosed is the final report that consists of a summary report of the sample(s), and a copy of the chain of custody.

General Lab Comments

The results provided in this report relate only to the items tested. Sample(s) were received in acceptable conditions unless otherwise noted in the comments above. Sample(s) have not been field blank corrected unless otherwise noted in the general set comments above. The sample(s) were prepared in accordance with EPA 200.8 and analyzed in compliance with EPA 200.8. This test report shall not be reproduced, except in full, without written approval of Columbia Basin Analytical Laboratories. Any questions, please contact our office.

-Samples were analyzed on January 18, 2017 and samples requiring dilutions were analyzed on January 19, 2017.

All samples were diluted 1:10.

X - Samples that exceeded the instrument calibration range were rerun at a 1:100 dilution, necessitating a 10-fold increase in the PQL.

Release of the data contained in the hard copy report has been authorized by the Laboratory Director or a designee as verified by the following signature. This report has been administratively reviewed by the following individual:

01/23/17

Project Coordinator II, M. Fernanda Pincheira

Date

If you have any questions please feel free to contact Fernanda Pincheira at MPincheira@rjleegroup.com.



Laboratory Report

Amanda Enbysk
Fulcrum Environmental
406 N. 2nd St.
Yakima, WA 98901

RJ Lee Group No.: W612109
COC No.: Kennewick
Samples Received: 12/21/16
Analysis/Prep Date: 01/18/17
Report Date: 01/23/17

Client Project:

Fulcrum Kennewick

Sample Name: 122116-VE-P-OF-01 **Matrix:** Potable Water **Date Received:** 12/21/16
RJ Lee Grp. ID: W612109-01 **Date Analyzed:** 01/18/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.87	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122116-VE-P-OF-02 **Matrix:** Potable Water **Date Received:** 12/21/16
RJ Lee Grp. ID: W612109-02 **Date Analyzed:** 01/18/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.81	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122116-VE-P-CF-03 **Matrix:** Potable Water **Date Received:** 12/21/16
RJ Lee Grp. ID: W612109-03 **Date Analyzed:** 01/18/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.79	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122116-VE-P-CDF-04 **Matrix:** Potable Water **Date Received:** 12/21/16
RJ Lee Grp. ID: W612109-04 **Date Analyzed:** 01/18/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.54	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122116-VE-P-CF-05 **Matrix:** Potable Water **Date Received:** 12/21/16
RJ Lee Grp. ID: W612109-05 **Date Analyzed:** 01/18/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.86	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Columbia Basin Analytical Laboratories | 2710 North 20th Avenue, Pasco WA 93301 | 509.545.4989

WWW.RJLEEGROUP.COM

Report Template: GenMetalReportFull_v12.rpt

Approved: 01/23/17 8:59
Report Time Stamp: 01/23/17 12:42



Sample Name: 122116-VE-P-CDF-06 **Matrix:** Potable Water **Date Received:** 12/21/16
RJ Lee Grp. ID: W612109-06 **Date Analyzed:** 01/18/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.76	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122116-VE-P-CF-07 **Matrix:** Potable Water **Date Received:** 12/21/16
RJ Lee Grp. ID: W612109-07 **Date Analyzed:** 01/18/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.84	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122116-VE-P-CDF-08 **Matrix:** Potable Water **Date Received:** 12/21/16
RJ Lee Grp. ID: W612109-08 **Date Analyzed:** 01/18/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.84	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122116-VE-P-CF-09 **Matrix:** Potable Water **Date Received:** 12/21/16
RJ Lee Grp. ID: W612109-09 **Date Analyzed:** 01/18/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.94	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122116-VE-P-CDF-10 **Matrix:** Potable Water **Date Received:** 12/21/16
RJ Lee Grp. ID: W612109-10 **Date Analyzed:** 01/18/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	1.01	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122116-VE-P-CDF-11 **Matrix:** Potable Water **Date Received:** 12/21/16
RJ Lee Grp. ID: W612109-11 **Date Analyzed:** 01/18/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.77	0.01	
Lead	EPA 200.8	< 0.0010	0.001	



Sample Name: 122116-VE-P-CDF-12 **Matrix:** Potable Water **Date Received:** 12/21/16
RJ Lee Grp. ID: W612109-12 **Date Analyzed:** 01/18/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.89	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122116-VE-P-CF-17 **Matrix:** Potable Water **Date Received:** 12/21/16
RJ Lee Grp. ID: W612109-13 **Date Analyzed:** 01/18/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.92	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122116-VE-P-CDF-18 **Matrix:** Potable Water **Date Received:** 12/21/16
RJ Lee Grp. ID: W612109-14 **Date Analyzed:** 01/18/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.63	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122116-VE-P-CF-19 **Matrix:** Potable Water **Date Received:** 12/21/16
RJ Lee Grp. ID: W612109-15 **Date Analyzed:** 01/18/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.76	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122116-VE-P-CDF-20 **Matrix:** Potable Water **Date Received:** 12/21/16
RJ Lee Grp. ID: W612109-16 **Date Analyzed:** 01/18/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.73	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122116-VE-P-CF-21 **Matrix:** Potable Water **Date Received:** 12/21/16
RJ Lee Grp. ID: W612109-17 **Date Analyzed:** 01/18/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.96	0.01	
Lead	EPA 200.8	< 0.0010	0.001	



Sample Name: 122116-VE-P-CDF-22 **Matrix:** Potable Water
RJ Lee Grp. ID: W612109-18

Date Received: 12/21/16
Date Analyzed: 01/18/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.70	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122116-VE-P-OF-23 **Matrix:** Potable Water
RJ Lee Grp. ID: W612109-19

Date Received: 12/21/16
Date Analyzed: 01/18/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.89	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122116-VE-P-CF-24 **Matrix:** Potable Water
RJ Lee Grp. ID: W612109-20

Date Received: 12/21/16
Date Analyzed: 01/18/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.80	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122116-VE-P-CDF-25 **Matrix:** Potable Water
RJ Lee Grp. ID: W612109-21

Date Received: 12/21/16
Date Analyzed: 01/18/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.91	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122116-VE-P-CF-26 **Matrix:** Potable Water
RJ Lee Grp. ID: W612109-22

Date Received: 12/21/16
Date Analyzed: 01/18/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	1.00	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122116-VE-P-CDF-27 **Matrix:** Potable Water
RJ Lee Grp. ID: W612109-23

Date Received: 12/21/16
Date Analyzed: 01/18/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.85	0.01	
Lead	EPA 200.8	< 0.0010	0.001	



Sample Name: 122116-VE-P-CF-28 **Matrix:** Potable Water **Date Received:** 12/21/16
RJ Lee Grp. ID: W612109-24 **Date Analyzed:** 01/18/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.76	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122116-VE-P-CDF-29 **Matrix:** Potable Water **Date Received:** 12/21/16
RJ Lee Grp. ID: W612109-25 **Date Analyzed:** 01/18/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.89	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122116-VE-P-KF-30 **Matrix:** Potable Water **Date Received:** 12/21/16
RJ Lee Grp. ID: W612109-26 **Date Analyzed:** 01/19/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	1.0	0.1	X
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122116-VE-P-KF-31 **Matrix:** Potable Water **Date Received:** 12/21/16
RJ Lee Grp. ID: W612109-27 **Date Analyzed:** 01/19/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	1.1	0.1	X
Lead	EPA 200.8	0.001	0.001	

Sample Name: 122116-VE-P-KF-32 **Matrix:** Potable Water **Date Received:** 12/21/16
RJ Lee Grp. ID: W612109-28 **Date Analyzed:** 01/18/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.32	0.01	
Lead	EPA 200.8	0.001	0.001	

Sample Name: 122116-VE-P-KF-33 **Matrix:** Potable Water **Date Received:** 12/21/16
RJ Lee Grp. ID: W612109-29 **Date Analyzed:** 01/18/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.89	0.01	
Lead	EPA 200.8	< 0.0010	0.001	



Sample Name: 122116-VE-P-CF-34 **Matrix:** Potable Water **Date Received:** 12/21/16
RJ Lee Grp. ID: W612109-30 **Date Analyzed:** 01/19/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	1.3	0.1	X
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122116-VE-P-CDF-35 **Matrix:** Potable Water **Date Received:** 12/21/16
RJ Lee Grp. ID: W612109-31 **Date Analyzed:** 01/19/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	1.7	0.1	X
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122116-VE-P-BF-36 **Matrix:** Potable Water **Date Received:** 12/21/16
RJ Lee Grp. ID: W612109-32 **Date Analyzed:** 01/18/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.48	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122116-VE-P-DF-37 **Matrix:** Potable Water **Date Received:** 12/21/16
RJ Lee Grp. ID: W612109-33 **Date Analyzed:** 01/18/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.43	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122116-VE-P-NF-38 **Matrix:** Potable Water **Date Received:** 12/21/16
RJ Lee Grp. ID: W612109-34 **Date Analyzed:** 01/18/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.75	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122116-VE-P-BF-39 **Matrix:** Potable Water **Date Received:** 12/21/16
RJ Lee Grp. ID: W612109-35 **Date Analyzed:** 01/18/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	< 0.010	0.01	
Lead	EPA 200.8	< 0.0010	0.001	



Sample Name: 122116-VE-P-BF-40
RJ Lee Grp. ID: W612109-36

Matrix: Potable Water

Date Received: 12/21/16

Date Analyzed: 01/19/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	1.2	0.1	X
Lead	EPA 200.8	0.016	0.001	

Sample Name: 122116-VE-P-CF-13
RJ Lee Grp. ID: W612109-37

Matrix: Potable Water

Date Received: 12/21/16

Date Analyzed: 01/18/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.60	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122116-VE-P-OF-14
RJ Lee Grp. ID: W612109-38

Matrix: Potable Water

Date Received: 12/21/16

Date Analyzed: 01/18/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.66	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122116-VE-P-CF-15
RJ Lee Grp. ID: W612109-39

Matrix: Potable Water

Date Received: 12/21/16

Date Analyzed: 01/18/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.92	0.01	
Lead	EPA 200.8	< 0.0010	0.001	

Sample Name: 122116-VE-P-CDF-16
RJ Lee Grp. ID: W612109-40

Matrix: Potable Water

Date Received: 12/21/16

Date Analyzed: 01/18/17

Analyte	Method	Result (mg/L)	PQL (mg/L)	Qualifiers
Copper	EPA 200.8	0.95	0.01	
Lead	EPA 200.8	< 0.0010	0.001	



Report Qualifiers:

A = Target Analyte media breakthrough suspect, see analytical report

D = Analyte analyzed in a dilution

E = Report concentration was above the instrument calibration range

J = Analyte detected below quantitation limits, concentration is estimated

P = Library spectrum match, $rsd > 90\%$ w RT match

Q = Result out of method specific acceptance QC criteria

S = Spike Recovery outside accepted recovery limits

Z = Not ELAP accredited analyte

ND = Not Detected

B = Analyte detected in the associated blank

d = Data that exceeds the RSD criteria set by the SOP

H = Holding times for preparation or analysis exceeded

L = Sample condition at receipt out of compliance with method defined conditions

R = RPD (relative percent difference) outside accepted recovery limits

U = Analyte analyzed for but not detected

N/A = Not Applicable

Scientist III J Grissmerson

These results are submitted pursuant to RJ Lee Group's current terms and conditions of sale, including the company's standard warranty and limitation of liability provisions. No responsibility or liability is assumed for the manner in which the results are used or interpreted. Unless notified in writing to return the samples covered by this report, RJ Lee Group will store the samples for a period of ninety (90) days before discarding. A shipping and handling fee will be assessed for the return of any samples. Unless otherwise noted, samples were received in an acceptable condition. This laboratory operates in accordance with ISO 17025 guidelines, and holds limited scopes of accreditation under ORELAP Lab Code 4061 AIHA-LAP, LLC Lab ID 178656 EPA ID WA01195 and WA DOE Lab ID C859. This report may not be used to claim product endorsement by any laboratory accrediting agency. The results contained in this report relate only to the items tested or to the sample(s) as received by the laboratory. Any reproduction of this document must be in full for the report to be valid. Quality control data is available upon request.

Request for Environmental and IH Laboratory Analytical Services

W612109

ATTENTION TO:		RYAN MATHEWS		Purchase Order No.:	162017		Client Job No.:			
Lab Use Only	Project No.:	Client No.:	Logged In By:	Standard:	Yes	No	If 'No,' No. of Business Days:	Accreditation (please list below):		
	Name: Amanda Enbyk, Ryan Mathews			Sample Purpose:	Information X Regulatory					
	Company: Fulcrum Environmental Consulting			System ID #:						
	Address: 406 North 2nd Street			DOH Source #:						
	City, State, Zip: Yakima, WA, 98901			Multiple Sources #s:						
	Phone: (509) 574-0839			Sample Purpose: A <input type="checkbox"/> B <input type="checkbox"/> Other <input type="checkbox"/>						
	Fax: (509) 575-8453			Preservation:	H ₂ SO ₄	Matrix:	WW=Wastewater	SW=Surface Water	Container:	
	Call with Verbal Results:			4 °C	HCl	GW=Groundwater	GW=Groundwater	DW=Drinking Water	P=Plastic	
	Email Results To: aenbyk@fulcrum.net, CC: rmathews@fulcrum.net			HNO ₃	NaOH	S=Soil/Sludge	O=Oil	O=Oil	G=Glass	
	Fax Results To:			Other	Na ₂ SO ₄	E=Extract	X=Other	X=Other	W=Wipe	
	Name: Lorrie Boutilier			Analysis Requested						A=Air (filter or tube)
	Company: Fulcrum Environmental									
	Address: 406 North 2nd Street									
	City, State, Zip: Yakima, WA, 98901									
	Phone: (509) 574-0839									
	Fax: (509) 575-8453									
Send Invoice To	Company: Fulcrum Environmental									
	Address: 406 North 2nd Street									
	City, State, Zip: Yakima, WA, 98901									
	Phone: (509) 574-0839									
	Fax: (509) 575-8453									
Special Instructions										
Client Sample ID	Sample Description	Sample Date	Sample Time	Wipe Area / Air Volume						
122116-VE-P-0401	Rm 21 Sink	12/21								
122116-VE-P-0402	Teacher's lounge									
122116-VE-P-0403	Rm 12 Sink									
122116-VE-P-0404	Rm 12 DF									
122116-VE-P-0405	Rm 11 Sink									
122116-VE-P-0406	Rm 11 DF									
122116-VE-P-0407	Rm 13 Sink									
122116-VE-P-0408	Rm 13 DF									
122116-VE-P-0409	Rm 14 Sink									
122116-VE-P-0410	Rm 14 DF									
122116-VE-P-0411	Rm 16 Sink									
Relinquished By (Signature):		Date: 12/21	Time: 12:30							
Relinquished By (Print Name):	Logan Lopez	Relinquished To:								
Company Name:		Method of Shipment:								
Chain of Custody	Relinquished By (Signature):	Date:	Time:							
	Relinquished By (Print Name):	Relinquished To:								
	Company Name:	Method of Shipment:								
Chain of Custody	Received By (Signature):	Date:	Time:							
	Received By (Print Name):	Relinquished To:								
	Company Name:	Method of Shipment:								
Chain of Custody	Received By (Signature):	Date:	Time:							
	Received By (Print Name):	Relinquished To:								
	Company Name:	Method of Shipment:								

Pennsylvania - HQ
350 Hochberg Road
Monroeville, PA 15146
724.325.1776 Phone
724.733.1799 Fax

Washington
Columbia Basin Analytical Laboratories
2710 North 20th Avenue
Pasco, WA 99301
509.545.4989 Phone
509.544.6010 Fax



Request for Environmental and IH Laboratory Analytical Services

W612109

ATTENTION TO: RYAN MATHEWS			Purchase Order No.:		Client Job No.:						
Project No.:			Standard: Yes No		If 'No,' No. of Business Days:						
Date Logged In:			Sample Purpose: Information X Regulatory <input type="checkbox"/> Accreditation (please list below):		162017						
Company: Fulcrum Environmental Consulting			System ID #:								
Address: 406 North 2nd Street			DOH Source #:								
City, State, Zip: Yakima, WA, 98901			Multiple Sources #:								
Phone: (509) 574-0839 Fax: (509) 575-8453			Preservation: A <input type="checkbox"/> B <input type="checkbox"/> Other <input type="checkbox"/>								
Call with Verbal Results:			Matrix: <input type="checkbox"/> W=Water <input type="checkbox"/> G=Groundwater <input type="checkbox"/> S=Soil/Sediment <input type="checkbox"/> E=Extract								
Email Results To: aenbysk@fulcrum.net, CC: rmatthews@fulcrum.net			SW=Surface Water <input type="checkbox"/> DW=Drinking Water <input type="checkbox"/> O=Oil <input type="checkbox"/> X=Other								
Fax Results To:			Container: P=Plastic <input type="checkbox"/> G=Glass <input type="checkbox"/> W=Wipe <input type="checkbox"/> A=Air (filter or tube) <input type="checkbox"/>								
Name: Lorrle Boutillier											
Company: Fulcrum Environmental Email: lboutillier@fulcrum.net											
Address: 406 North 2nd Street											
City, State, Zip: Yakima, WA, 98901											
Phone: (509) 574-0839 Fax: (509) 575-8453											
Send Invoice To			Analysis Requested								
Special Instructions											
Client Sample ID	Sample Description	Sample Date	Start	Stop	Wipe Area / Air Volume	Pres. Upon Receipt (Y/N)	Preservation	Matrix	Container Type	pH	No. Containers
122116-VE-P-CDF-102	Rm 16 DF	12/21				X	UNPR	DW			204
122116-VE-P-CDF-17	Rm 18 Sink										203
122116-VE-P-CDF-18	Rm 18 DF										19.1
122116-VE-P-CDF-19	Rm 20 Sink										19.8
122116-VE-P-CDF-20	Rm 20 CDF										201
122116-VE-P-CDF-21	Rm 19 Sink										204
122116-VE-P-CDF-22	Rm 19 DF										19.1
122116-VE-P-CDF-23	Library Faucet										19.9
122116-VE-P-CDF-24	Rm 9 Sink										19.8
122116-VE-P-CDF-25	Rm 9 DF										20.4
122116-VE-P-CDF-26	Rm 10 Sink										19.8
Relinquished By (Signature):		Date: 12/21/16	Time: 12:30		Received By (Signature):		Date: 12/21/16		Time: 12:30		
Relinquished By (Print Name):		Relinquished To:		Received By (Print Name):		Relinquished To:		Date:		Time:	
Company Name:		Method of Shipment:		Company Name:		Method of Shipment:		Date:		Time:	
Chain of Custody		Relinquished By (Signature):		Received By (Signature):		Date:		Time:			
Relinquished By (Print Name):		Relinquished To:		Received By (Print Name):		Date:		Time:			
Company Name:		Method of Shipment:		Company Name:		Method of Shipment:		Date:		Time:	

Pennsylvania - HQ
350 Hochberg Road
Monroeville, PA 15146

Washington
Columbia Basin Analytical Laboratories
2710 North 20th Avenue
Pasco, WA 99301

724.325.1776 Phone
724.733.1799 Fax

509.545.4989 Phone
509.544.6010 Fax



Request for Environmental and IH Laboratory Analytical Services

12/21/09

Page 3 of 4

ATTENTION TO: RYAN MATHEWS		Project No.:		Client No.:		Purchase Order No.:		Client Job No.:	
Lab Use Only		Date Logged In:		Logged In By:		Standard: Yes No		If 'No,' No. of Business Days:	
Report Results To		Name: Amanda Embysk, Ryan Mathews		Company: Fulcrum Environmental Consulting		Sample Purpose: Information X Regulatory <input type="checkbox"/> Accreditation (please list below):			
To		Address: 406 North 2nd Street		City, State, Zip: Yakima, WA, 98901		System ID #:			
		Phone: (509) 574-0839		Fax: (509) 575-8453		DOH Source #:			
		Call with Verbal Results:		Email Results To: aembysk@fulcrum.net, CC: rmathews@fulcrum.net		Multiple Sources #s:			
		Fax Results To:		Name: Lorrie Boutillier		Sample Purpose: <input type="checkbox"/> A <input type="checkbox"/> B <input type="checkbox"/> Other <input type="checkbox"/>			
Send Invoice To		Company: Fulcrum Environmental		Email: lboutillier@fulcrum.net		Preservation: H ₂ SO ₄ HCl NaOH Na ₂ SO ₄ Other		Matrix: WW=Wastewater GW=Groundwater S=Soil/Sludge E=Extract	
Special Instructions		Address: 406 North 2nd Street		City, State, Zip: Yakima, WA, 98901		SW=Surface Water DW=Drinking Water O=Oil X=Other		Container: P=Plastic G=Glass W=Wipe A=Air (filter or tube)	
		Phone: (509) 574-0839		Fax: (509) 575-8453		Analysis Requested			
Client Sample ID	Sample Description	Sample Date	Sample Time		Wipe Area / Air Volume	Chain of Custody	Received By (Signature)	Date	Time
			Start	Stop					
122116-VE-P-CDF-27	Rm 10 DE	12/21							
122116-VE-P-CF-28	Rm 7 SHK								
122116-VE-P-CDF-29	Rm 7 DE								
122116-VE-P-CF-30	West Kitchen								
122116-VE-P-KF-31	Hand prep								
122116-VE-P-KF-32	Veggie Riser								
122116-VE-P-KF-33	East Counter								
122116-VE-P-CF-34	Music Sink								
122116-VE-P-LDF-35	Music DE								
122116-VE-P-BF-36	DE w/BF								
122116-VE-P-DF-37	DE outside km								
Chain of Custody		Relinquished By (Signature):		Date: 12/21		Time: 12:30			
Chain of Custody		Relinquished By (Print Name): Logan Lopez		Method of Shipment:					
Chain of Custody		Relinquished By (Signature):		Date:		Time:			
Chain of Custody		Relinquished By (Print Name):		Method of Shipment:					

Pennsylvania - HQ
350 Hochberg Road
Monroeville, PA 15146
724.325.1776 Phone
724.733.1799 Fax

Washington
Columbia Basin Analytical Laboratories
2710 North 20th Avenue
Pasco, WA 99301
509.545.4989 Phone
509.544.6010 Fax



Request for Environmental and IH Laboratory Analytical Services

W612109

Page 4 of 4

ATTENTION TO: RYAN MATHEWS		Purchase Order No.:	Client Job No.:		162017
Lab Use Only	Project No.:	Date Logged In:	Client No.:	Logged In By:	
Report Results To	Name: Amanda Enbysk, Ryan Mathews	Company: Fulcrum Environmental Consulting	Address: 406 North 2nd Street	City, State, Zip: Yakima, WA, 98901	Phone: (509) 574-0839 Fax: (509) 575-8453
Send Invoice To	Name: Lorrie Boutilier	Company: Fulcrum Environmental	Address: 406 North 2nd Street	City, State, Zip: Yakima, WA, 98901	Phone: (509) 574-0839 Fax: (509) 575-8453
Special Instructions					
Chain of Custody	Relinquished By (Signature): <i>Lorrie Boutilier</i>	Date: 12/21	Time: 12:30	Relinquished To:	Method of Shipment:
Chain of Custody	Relinquished By (Print Name): <i>Lorrie Boutilier</i>	Date:	Time:	Relinquished To:	Method of Shipment:
Chain of Custody	Relinquished By (Signature):	Date:	Time:	Relinquished To:	Method of Shipment:
Chain of Custody	Relinquished By (Print Name):	Date:	Time:	Relinquished To:	Method of Shipment:

Client Sample ID	Sample Description	Sample Date	Sample Time		Wipe Area / Air Volume	Turnaround Request	Standard: Yes No	If 'No', No. of Business Days:	Sample Purpose: Information X Regulatory Accreditation (please list below):	Pres. Upon Receipt (Y/N)	Preservation	Matrix	Container Type	pH	No. Containers
			Start	Stop											
122116-VE-P-NE-38	Nurses Office 12/21														
122116-VE-P-BE-39	Boys Locker														
122116-VE-P-BE-40	Girls Locker														
122116-VE-P-CE-13	Rm 15 Sink														
122116-VE-P-DE-14	Rm 15 DF														
122116-VE-P-DE-15	Rm 17 Sink														
122116-VE-P-DE-16	Rm 17 DF														

Pennsylvania - HQ
350 Hochberg Road
Monroeville, PA 15146
724.325.1776 Phone
724.733.1799 Fax

Washington
Columbia Basin Analytical Laboratories
2710 North 20th Avenue
Pasco, WA 99301
509.545.4989 Phone
509.544.6010 Fax



ATTACHMENT E

Remedial Analytical Results





Fulcrum Environmental

Ryan Mathews
406 N. 2nd Street
Yakima, WA 98901

**RE: Kennewick School District - Vista Elementary Drinking Water Sa
Work Order Number: 1702134**

February 14, 2017

Attention Ryan Mathews:

Fremont Analytical, Inc. received 6 sample(s) on 2/13/2017 for the analyses presented in the following report.

Drinking Water Metals by EPA Method 200.8

This report consists of the following:

- Case Narrative
- Analytical Results
- Applicable Quality Control Summary Reports
- Chain of Custody

All analyses were performed consistent with the Quality Assurance program of Fremont Analytical, Inc. Please contact the laboratory if you should have any questions about the results.

Thank you for using Fremont Analytical.

Sincerely,

Chelsea Ward
Project Manager



Date: 02/14/2017

CLIENT: Fulcrum Environmental
Project: Kennewick School District - Vista Elementar
Work Order: 1702134

Work Order Sample Summary

Lab Sample ID	Client Sample ID	Date/Time Collected	Date/Time Received
1702134-001	21117-VE-P-CF-34	02/11/2017 8:50 AM	02/13/2017 9:41 AM
1702134-002	21117-VE-S-CF-34	02/11/2017 8:50 AM	02/13/2017 9:41 AM
1702134-003	21117-VE-T-CF-34	02/11/2017 8:50 AM	02/13/2017 9:41 AM
1702134-004	21117-VE-P-CDF-35	02/11/2017 8:50 AM	02/13/2017 9:41 AM
1702134-005	21117-VE-P-BF-39	02/11/2017 8:50 AM	02/13/2017 9:41 AM
1702134-006	21117-VE-P-BF-40	02/11/2017 8:50 AM	02/13/2017 9:41 AM

CLIENT: Fulcrum Environmental

Project: Kennewick School District - Vista Elementary Drinking Water Sampling

WorkOrder Narrative:

I. SAMPLE RECEIPT:

Samples receipt information is recorded on the attached Sample Receipt Checklist.

II. GENERAL REPORTING COMMENTS:

Results are reported on a wet weight basis unless dry-weight correction is denoted in the units field on the analytical report ("mg/kg-dry" or "ug/kg-dry").

Matrix Spike (MS) and MS Duplicate (MSD) samples are tested from an analytical batch of "like" matrix to check for possible matrix effect. The MS and MSD will provide site specific matrix data only for those samples which are spiked by the laboratory. The sample chosen for spike purposes may or may not have been a sample submitted in this sample delivery group. The validity of the analytical procedures for which data is reported in this analytical report is determined by the Laboratory Control Sample (LCS) and the Method Blank (MB). The LCS and the MB are processed with the samples and the MS/MSD to ensure method criteria are achieved throughout the entire analytical process.

III. ANALYSES AND EXCEPTIONS:

Exceptions associated with this report will be footnoted in the analytical results page(s) or the quality control summary page(s) and/or noted below.

Prep Sample Comments:

1702134-001A 206634: Prep Comments for EPA200.8, Sample 1702134-001A: Turbidity: 0.01 NTU

1702134-004A 206635: Prep Comments for EPA200.8, Sample 1702134-004A: Turbidity: 0.31 NTU

1702134-005A 206636: Prep Comments for EPA200.8, Sample 1702134-005A: Turbidity: 0.19 NTU

1702134-006A 206637: Prep Comments for EPA200.8, Sample 1702134-006A: Turbidity: 0.22 NTU

Qualifiers:

- * - Flagged value is not within established control limits
- B - Analyte detected in the associated Method Blank
- D - Dilution was required
- E - Value above quantitation range
- H - Holding times for preparation or analysis exceeded
- I - Analyte with an internal standard that does not meet established acceptance criteria
- J - Analyte detected below Reporting Limit
- N - Tentatively Identified Compound (TIC)
- Q - Analyte with an initial or continuing calibration that does not meet established acceptance criteria (<20%RSD, <20% Drift or minimum RRF)
- S - Spike recovery outside accepted recovery limits
- ND - Not detected at the Reporting Limit
- R - High relative percent difference observed

Acronyms:

- %Rec - Percent Recovery
- CCB - Continued Calibration Blank
- CCV - Continued Calibration Verification
- DF - Dilution Factor
- HEM - Hexane Extractable Material
- ICV - Initial Calibration Verification
- LCS/LCSD - Laboratory Control Sample / Laboratory Control Sample Duplicate
- MB or MBLANK - Method Blank
- MDL - Method Detection Limit
- MS/MSD - Matrix Spike / Matrix Spike Duplicate
- PDS - Post Digestion Spike
- Ref Val - Reference Value
- RL - Reporting Limit
- RPD - Relative Percent Difference
- SD - Serial Dilution
- SGT - Silica Gel Treatment
- SPK - Spike
- Surr - Surrogate



CLIENT: Fulcrum Environmental
Project: Kennewick School District - Vista Elementary Drinking Water Sampling

Lab ID: 1702134-001 **Collection Date:** 2/11/2017 8:50:00 AM
Client Sample ID: 21117-VE-P-CF-34 **Matrix:** Drinking Water

Analyses	Result	RL	Qual	Units	DF	Date Analyzed
----------	--------	----	------	-------	----	---------------

Drinking Water Metals by EPA Method 200.8

Batch ID: 16209 Analyst: TN

Copper	655	0.500		µg/L	1	2/13/2017 6:28:38 PM
--------	-----	-------	--	------	---	----------------------

Lab ID: 1702134-004 **Collection Date:** 2/11/2017 8:50:00 AM
Client Sample ID: 21117-VE-P-CDF-35 **Matrix:** Drinking Water

Analyses	Result	RL	Qual	Units	DF	Date Analyzed
----------	--------	----	------	-------	----	---------------

Drinking Water Metals by EPA Method 200.8

Batch ID: 16209 Analyst: TN

Copper	802	0.500		µg/L	1	2/13/2017 6:32:14 PM
--------	-----	-------	--	------	---	----------------------

Lab ID: 1702134-005 **Collection Date:** 2/11/2017 8:50:00 AM
Client Sample ID: 21117-VE-P-BF-39 **Matrix:** Drinking Water

Analyses	Result	RL	Qual	Units	DF	Date Analyzed
----------	--------	----	------	-------	----	---------------

Drinking Water Metals by EPA Method 200.8

Batch ID: 16209 Analyst: TN

Copper	1.15	0.500		µg/L	1	2/13/2017 6:35:51 PM
--------	------	-------	--	------	---	----------------------



CLIENT: Fulcrum Environmental

Project: Kennewick School District - Vista Elementary Drinking Water Sampling

Lab ID: 1702134-006

Collection Date: 2/11/2017 8:50:00 AM

Client Sample ID: 21117-VE-P-BF-40

Matrix: Drinking Water

Analyses	Result	RL	Qual	Units	DF	Date Analyzed
----------	--------	----	------	-------	----	---------------

Drinking Water Metals by EPA Method 200.8

Batch ID: 16209

Analyst: TN

Copper	1,210	0.500		µg/L	1	2/13/2017 6:46:42 PM
--------	-------	-------	--	------	---	----------------------

Work Order: 1702134
CLIENT: Fulcrum Environmental
Project: Kennewick School District - Vista Elementar

QC SUMMARY REPORT
Drinking Water Metals by EPA Method 200.8

Sample ID MB-16209	SampType: MBLK	Units: µg/L	Prep Date: 2/13/2017	RunNo: 34433							
Client ID: MBLKW	Batch ID: 16209		Analysis Date: 2/13/2017	SeqNo: 657246							
Analyte	Result	RL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Copper ND 0.500

Sample ID LCS-16209	SampType: LCS	Units: µg/L	Prep Date: 2/13/2017	RunNo: 34433							
Client ID: LCSW	Batch ID: 16209		Analysis Date: 2/13/2017	SeqNo: 657247							
Analyte	Result	RL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Copper 92.0 0.500 100.0 0 92.0 85 115

Sample ID 1702133-004ADUP	SampType: DUP	Units: µg/L	Prep Date: 2/13/2017	RunNo: 34433							
Client ID: BATCH	Batch ID: 16209		Analysis Date: 2/13/2017	SeqNo: 657249							
Analyte	Result	RL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Copper ND 0.500 0 30

Sample ID 1702133-004AMS	SampType: MS	Units: µg/L	Prep Date: 2/13/2017	RunNo: 34433							
Client ID: BATCH	Batch ID: 16209		Analysis Date: 2/13/2017	SeqNo: 657250							
Analyte	Result	RL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Copper 186 0.500 200.0 0 93.1 70 130

Sample ID 1702133-004AMSD	SampType: MSD	Units: µg/L	Prep Date: 2/13/2017	RunNo: 34433							
Client ID: BATCH	Batch ID: 16209		Analysis Date: 2/13/2017	SeqNo: 657251							
Analyte	Result	RL	SPK value	SPK Ref Val	%REC	LowLimit	HighLimit	RPD Ref Val	%RPD	RPDLimit	Qual

Copper 189 0.500 200.0 0 94.4 70 130 186.2 1.37 30

Client Name: **FE**
 Logged by: **Erica Silva**

Work Order Number: **1702134**
 Date Received: **2/13/2017 9:41:00 AM**

Chain of Custody

1. Is Chain of Custody complete? Yes No Not Present
 2. How was the sample delivered? FedEx

Log In

3. Coolers are present? Yes No NA
 4. Shipping container/cooler in good condition? Yes No
 5. Custody Seals present on shipping container/cooler?
 (Refer to comments for Custody Seals not intact) Yes No Not Required
 6. Was an attempt made to cool the samples? Yes No NA
 7. Were all items received at a temperature of >0°C to 10.0°C* Yes No NA
 8. Sample(s) in proper container(s)? Yes No
 9. Sufficient sample volume for indicated test(s)? Yes No
 10. Are samples properly preserved? Yes No
 11. Was preservative added to bottles? Yes No NA
 HNO3 to 002A, 003A
 12. Is there headspace in the VOA vials? Yes No NA
 13. Did all samples containers arrive in good condition(unbroken)? Yes No
 14. Does paperwork match bottle labels? Yes No
 15. Are matrices correctly identified on Chain of Custody? Yes No
 16. Is it clear what analyses were requested? Yes No
 17. Were all holding times able to be met? Yes No

Special Handling (if applicable)

18. Was client notified of all discrepancies with this order? Yes No NA

Person Notified:	<input type="text"/>	Date:	<input type="text"/>
By Whom:	<input type="text"/>	Via:	<input type="checkbox"/> eMail <input type="checkbox"/> Phone <input type="checkbox"/> Fax <input type="checkbox"/> In Person
Regarding:	<input type="text"/>		
Client Instructions:	<input type="text"/>		

19. Additional remarks:

Item Information

Item #	Temp °C
Cooler	7.5
Sample	1.0

* Note: DoD/ELAP and TNI require items to be received at 4°C +/- 2°C



3600 Fremont Ave N.
Seattle, WA 98103

Tel: 206-352-3790
Fax: 206-352-7178

Chain of Custody Record and Laboratory Services Agreement

Date: 2/11/2017

Laboratory Project No (Internal): 1702134

Page: 1 of 1

Client: Fulcrum Environmental Consulting
Address: 406 North Second Street
City, State, Zip: Yakima, WA 98901
Telephone: 509.574.0839 Fax: 509.545.8453

Project Name: Kennewick School District - Vista Elementary Drinking Water Sampling
Project No: 162017.12
Location: Vista Elementary, Kennewick, WA
Report To (PM): Ryan Mathews
PM Email: rmathews@efulcrum.net; cc: aenbysk@efulcrum.net

*Matrix Codes: A = Air, AQ = Aqueous, B = Bulk, O = Other, P = Product, S = Soil, SD = Sediment, SL = Solid, W = Water, DW = Drinking Water, GW = Ground Water, SW = Storm Water, WW = Waste Water

Sample Name	Sample Date	Sample Time	Sample Type (Matrix)*	VOCs (EPA 8260 / 624)	GV/BTEX	BTEX	Gasoline Range Organics (GX)	Hydrocarbon Identification (HCD)	Diesel/Heavy Oil Range Organics (DX)	SVOCs (EPA 8270 - SIM)	PAHs (EPA 8270 - SIM)	PCBs (EPA 8082 / 608)	Metals** (EPA 6020 / 200.8)	Total (T) Dissolved (D)	Anions (IC)**	EDB (8011)	Comments
21117-VE-P-CF-34	2/11/2017	0850	DW														HNO3 preserved
21117-VE-S-CF-34	2/11/2017		DW														HCD; unpreserved
21117-VE-T-CF-34	2/11/2017		DW														↓
21117-VE-P-CDF-35	2/11/2017		DW														HNO3 preserved
21117-VE-P-BF-39	2/11/2017		DW														↓
21117-VE-P-BF-40	2/11/2017		DW														↓

Metals Analysis (Circle): MTCA-5 RCRA-8 Priority Pollutants TAL Individual: Ag Al As B Ba Be Ca Cd Co Cr **Cu Fe Hg K Mg Mn Mo Na Ni Pb Sb Se Sr Sn Ti Tl U V Zn

***Anions (Circle): Nitrate Nitrite Chloride Sulfate Bromide O-Phosphate Fluoride Nitrate+Nitrite

Sample Disposal: Return to Client Disposal by Lab (Samples will be held for 30 days unless otherwise noted. A fee may be assessed if samples are retained after 30 days.)

I represent that I am authorized to enter into this Agreement with Fremont Analytical on behalf of the Client named above, that I have verified Client's agreement to each of the terms on the front and backside of this Agreement.

Relinquished Date/Time: 2/11/2017, 11:00am Received Date/Time: 2/13/17 0914

Relinquished Date/Time: Received Date/Time:

TAT → SameDay✓ NextDay✓ 2 Day 3 Day STD

*Please coordinate with the lab in advance