MEADOW HEIGHTS ELEMENTARY SCHOOL

- HVAC REPLACEMENT

2619 DOLORES DRIVE, SAN MATEO, CA 94403

SAN MATEO-FOSTER CITY SCHOOL DISTRICT

CONSTRUCTION DOCUMENTS

ANY ALTERATIONS OF EXISTING FACILITIES TO ACCOMMODATE THE INSTALLATION OF NEW

CONSTRUCTION SHALL BE RESTORED TO THEIR ORIGINAL STATE OR REPLACED WITH NEW

TEACHERS DURING SCHOOL HOURS. ANY DISRUPTION OF POWER, TELEPHONE, OR HVAC

WORK SHALL BE REVIEWED BY THE ARCHITECT PRIOR TO COMMENCEMENT OF WORK.

CONTRACTOR SHALL COORDINATE ALL WORK TO AVOID DISRUPTION OF STUDENTS OR

SYSTEMS MUST BE COORDINATED AND APPROVED BY THE DISTRICT REPRESENTATIVE

ALL EXISTING FINISHES OR MATERIALS DAMAGED OR DEMOLISHED DUE TO NEW

COMPLIANCE WITH CFC CHAPTER 33 (FIRE SAFETY DURING CONSTRUCTION AND

ALL ITEMS ARE TO BE PROVIDED AS NEW, UNLESS OTHERWISE NOTED AS (E).

DEMOLITION) AND CBC CHAPTER 33 (SAFEGUARDS DURING CONSTRUCTION) WILL BE

MATERIALS FINISHED TO MATCH EXISTING.

PRIOR TO ANY WORK COMMENCING.

DSA FILE NUMBER 41-26 **DSA APPLICATION NUMBER** 01-119554 69039-110

REVIEWED FOR SS 🗹 FLS 🗹 ACS 🗹

architects

MEADOW HEIGHTS ELEMENTARY SCHOOL - HVAC REPLACEMENT

SAN MATEO-FOSTER CITY SCHOOL DISTRICT

CONSULTANT

DSA FILE NUMBER **REVISIONS** No. Description

> **MILESTONES** 90% CD DSA SUB

BACKCHECK

TITLE SHEET

^{JOB ‡}2021005.04 SHEET#


DATE -

11/30/21

EXPIRATION DATE

C-018127

CALIFORNIA LICENSE NUMBER

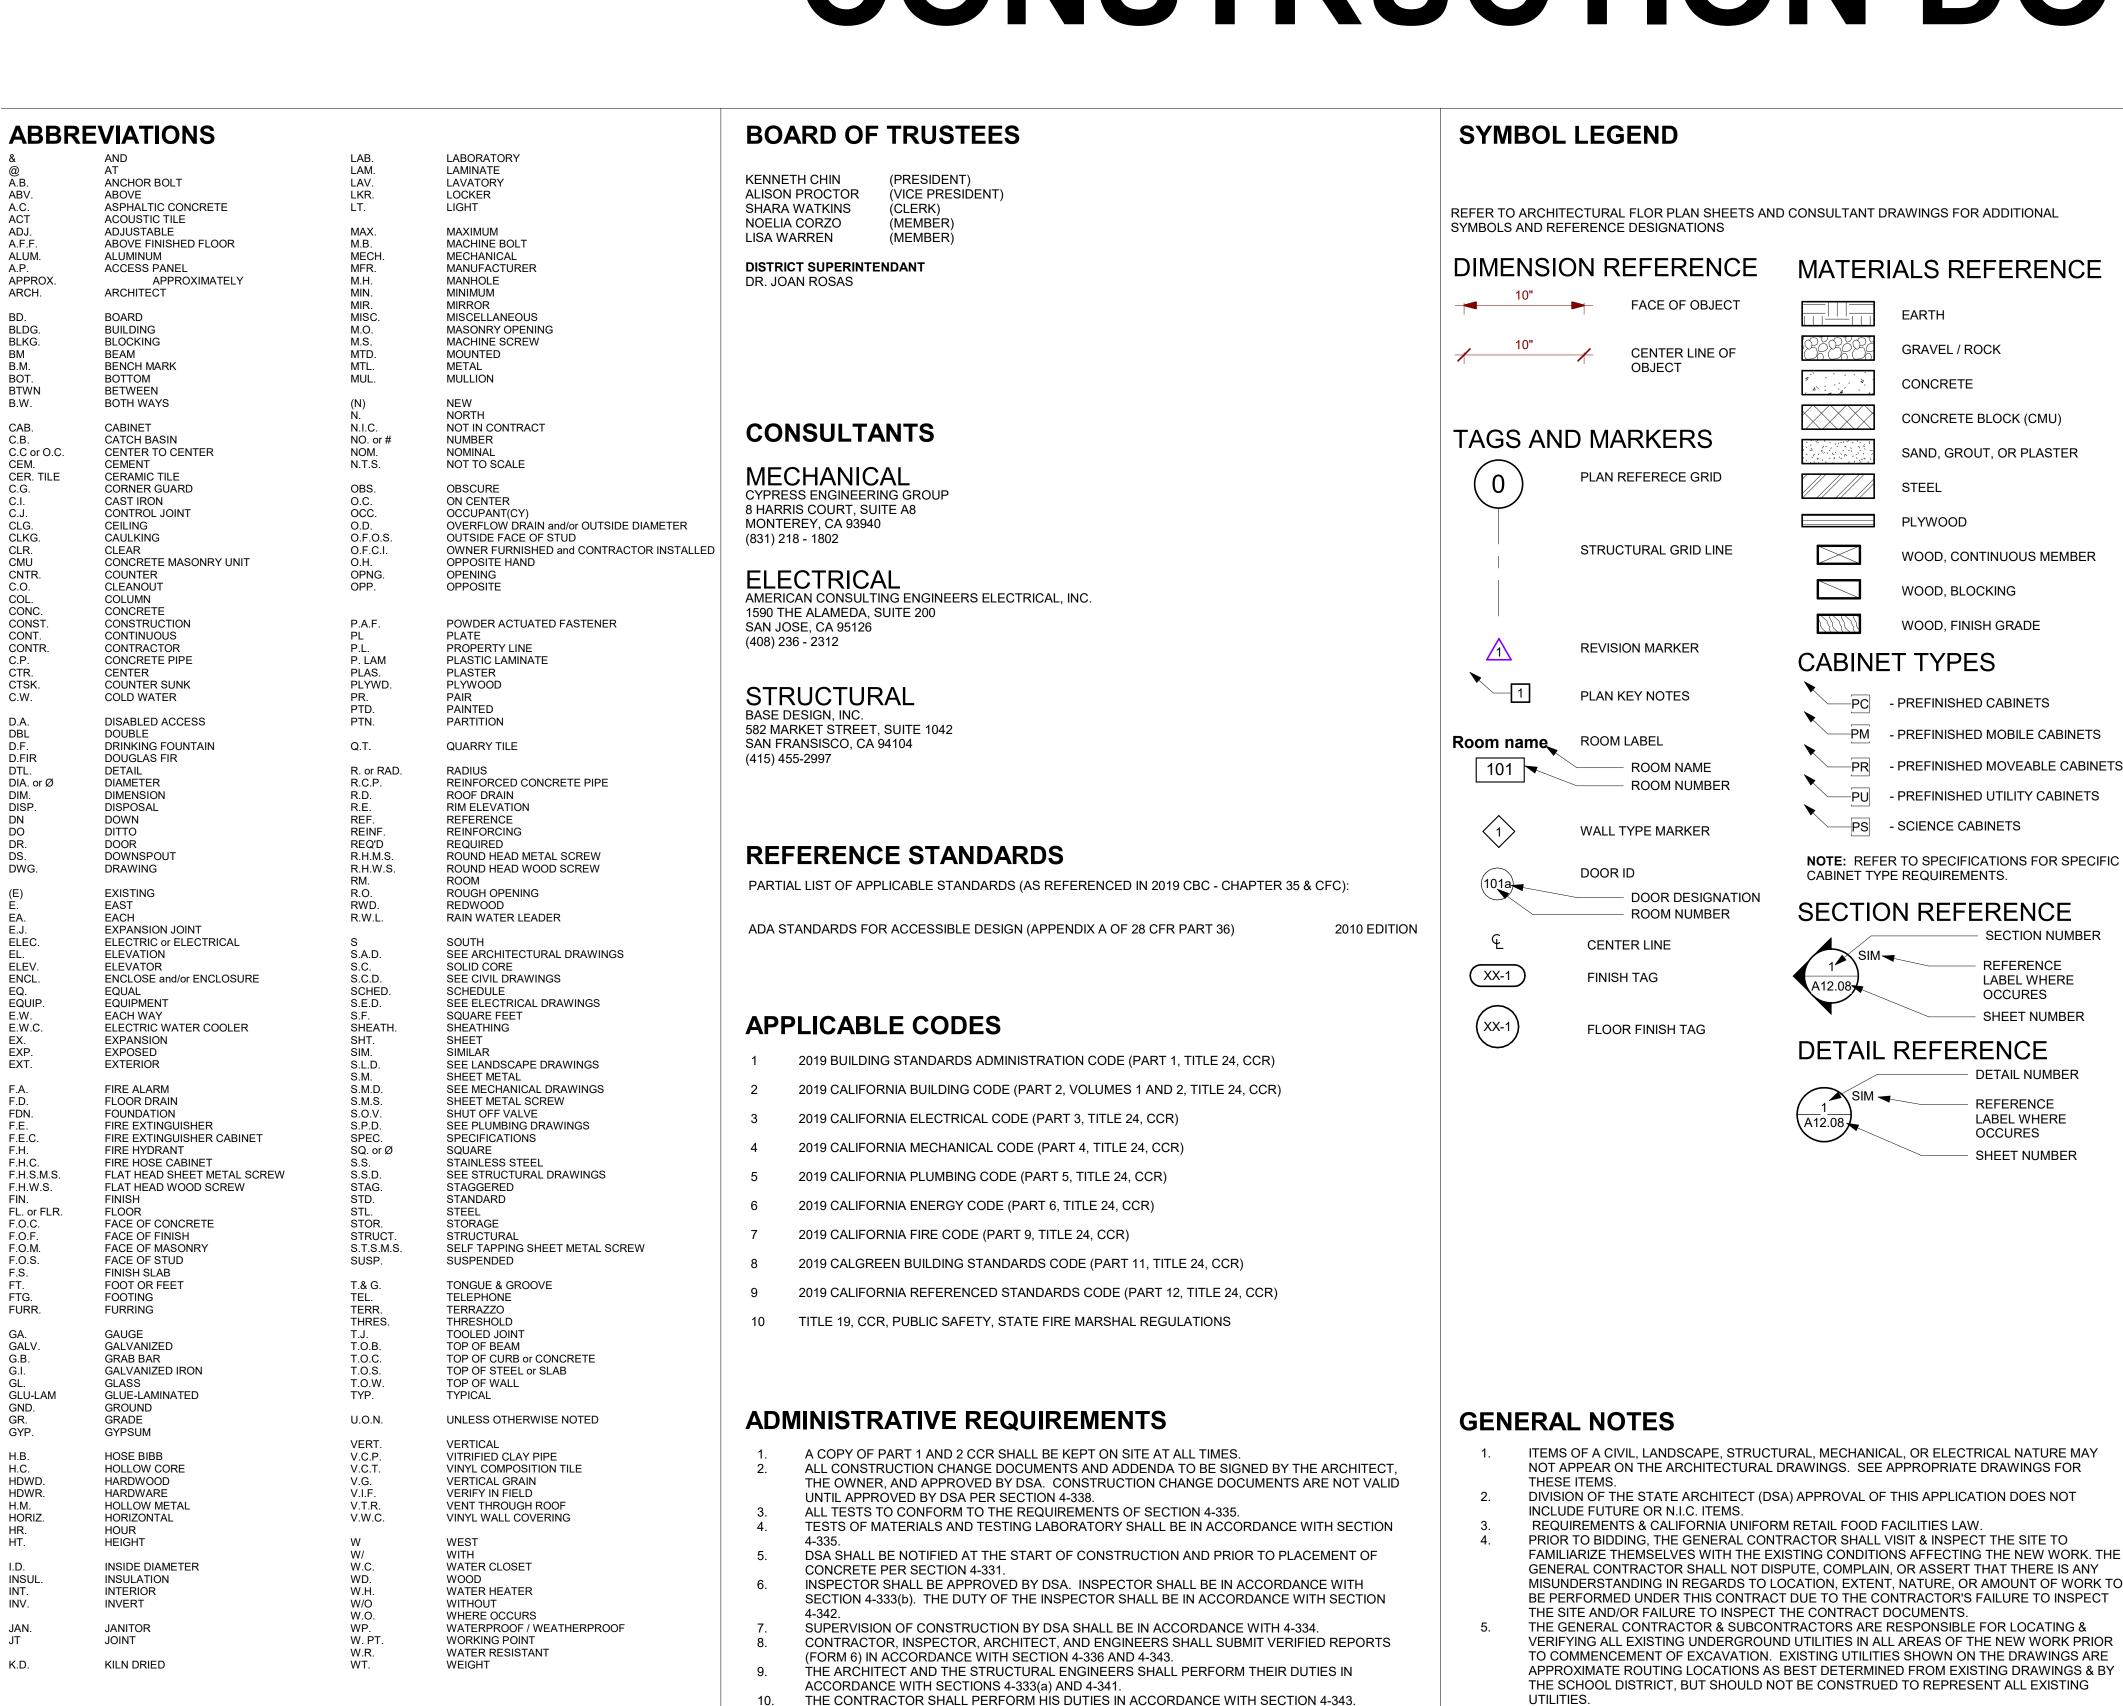

THE INTENT OF THE DRAWINGS AND SPECIFICATIONS IS THE (RE)CONSTRUCTION OF A SCHOOL

BUILDING(S) IN ACCORDANCE WITH TITLE 24, C.C.R. SHOULD ANY CONDITIONS DEVELOP NOT COVERED BY THE CONTRACT DOCUMENTS WHEREIN THE FINISHED WORK WILL NOT COMPLY

WITH SAID C.C.R. A CONSTRUCTION CHANGE DOCUMENT DETAILING AND SPECIFYING THE

CHANGES TO THE APPROVED DRAWINGS AND SPECIFICATIONS SHALL BE MADE BY AN

THE STATE ARCHITECT, AS REQUIRED BY SECTION 4-338, PART 1, TITLE 24, CCR.

CONDUCT ALL THE REQUIRED TESTS AND INSPECTIONS FOR THE PROJECT.

INSPECTOR ARE DEFINED IN SECTION 4-342, PART 1, TITLE 24, CCR.

THE WORK.

DSA IS NOT SUBJECT TO ARBITRATION.


REQUIRED WORK SHALL BE SUBMITTED AND APPROVED BY DSA BEFORE PROCEEDING WITH

ADDENDUM OR A CONSTRUCTION CHANGED DOCUMENT (CCD) APPROVED BY THE DIVISION OF

A "DSA CERTIFIED" PROJECT INSPECTOR EMPLOYED BY THE DISTRICT (OWNER) AND APPROVED BY THE DSA SHALL PROVIDE CONTINUOUS INSPECTION OF THE WORK. THE DUTIES OF THE

A DSA ACCEPTED TESTING LABORATORY DIRECTLY EMPLOYED BY THE DISTRICT (OWNER) SHALL



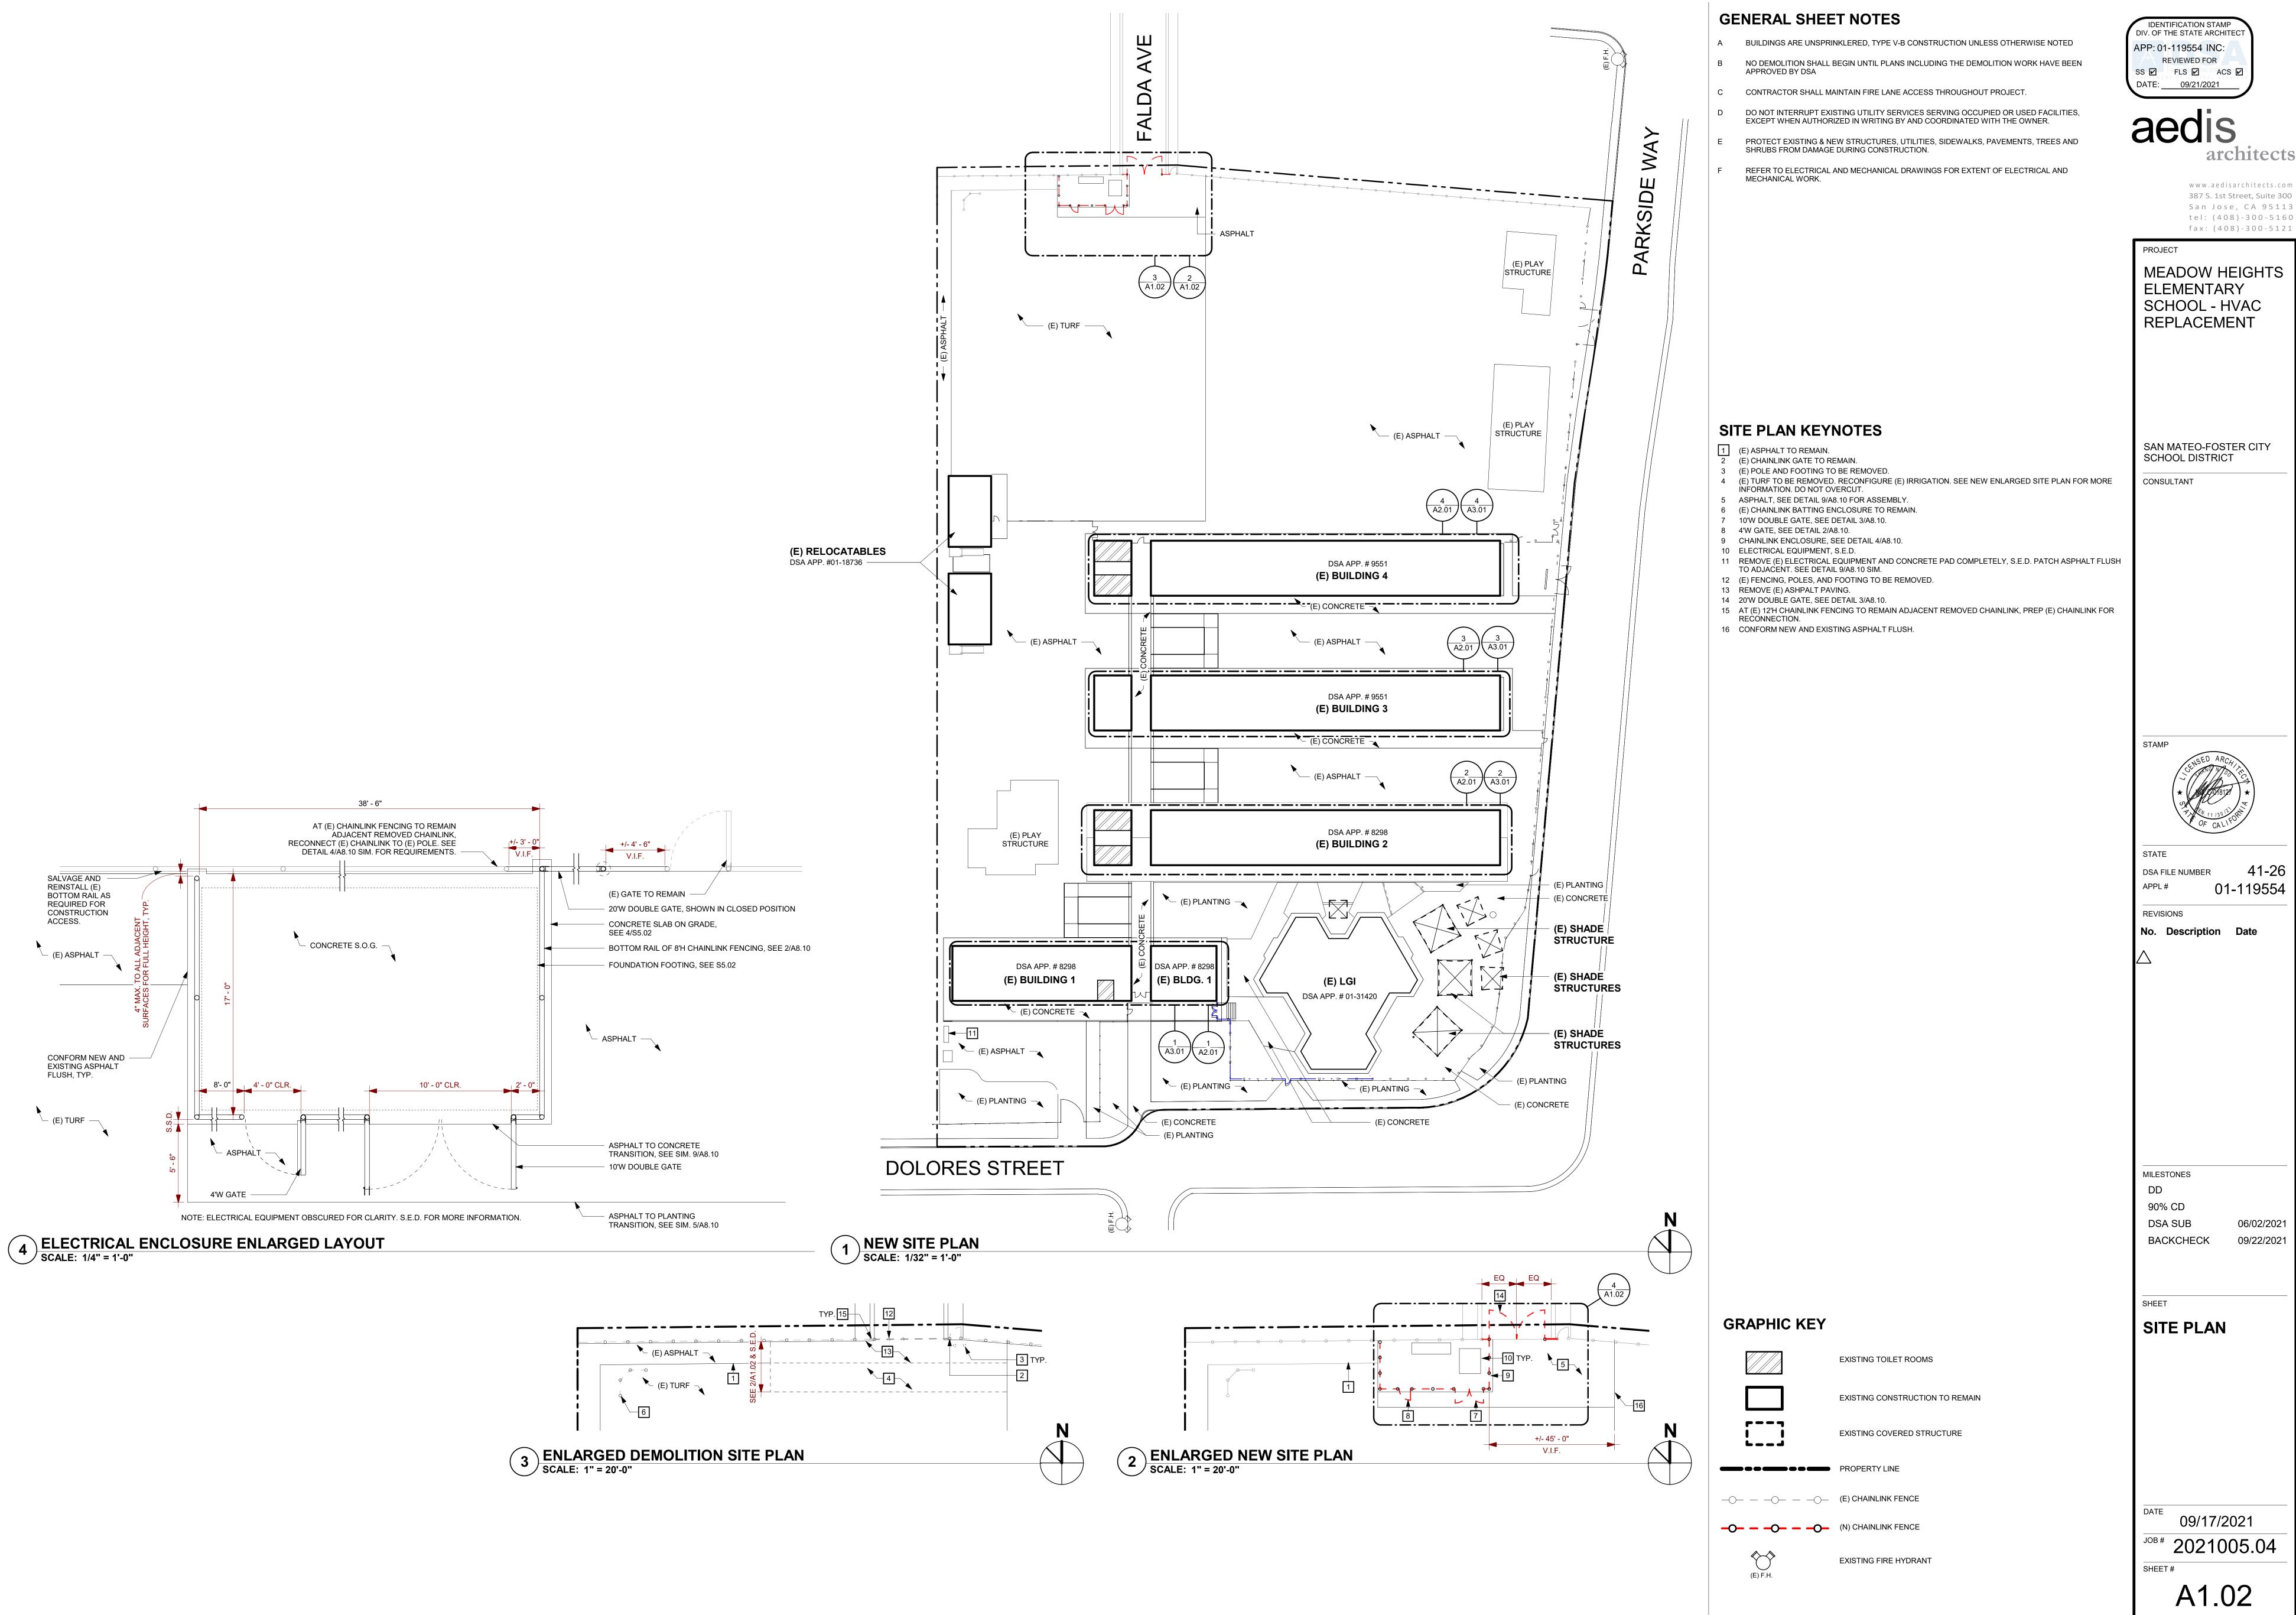

architects

San Jose, CA 95113 tel: (408)-300-5160 fax: (408)-300-5121



GENERAL SHEET NOTES

INFORMATION AND SCOPE OF WORK.

- ROOM NAMES OR NUMBERS MAY NOT BE CONSISTENT BETWEEN DEMOLITION AND NEW FLOOR
- REFER TO MECHANICAL AND ELECTRICAL DRAWINGS FOR EXTENT OF MECHANICAL AND ELECTRICAL DEMOLITION WORK.
- C VERIFY LIMITS OF DEMOLITION WITH SCOPE OF NEW WORK PRIOR TO COMMENCING WORK.
- ALL ITEMS SHOWN DASHED ARE TO BE DEMOLISHED UNLESS OTHERWISE NOTED ON PLANS.
- REMOVE ALL MISCELLANEOUS TRIM, CASEWORK, EQUIPMENT, CONDUIT, BASES, AND OTHER SURFACE MOUNTED ITEMS WHETHER SHOWN OR NOT, AS REQUIRED TO FACILITATE SCOPE OF

WORK. REMOVE AND CAP ALL OUTLETS, SWITCHES, WIRES, THERMOSTATS, ETC. TO THEIR SOURCE AS REQUIRED. SEE MECHANICAL AND ELECTRICAL DRAWINGS FOR ADDITIONAL

- REMOVE ADJACENT FINISHES AS REQUIRED TO FACILITATE SCOPE OF WORK. PATCH BACK IN
- EXISTING EQUIPMENT INDICATED TO BE RELOCATED PER NEW PLAN IS TO BE STORED AND PROTECTED DURING CONSTRUCTION.
- NO DEMOLITION SHALL BEGIN UNTIL PLANS INCLUDING THE DEMOLITION WORK HAVE BEEN APPROVED BY DSA
- DIMENSIONS FOR EXISTING BUILDING ARE APPROXIMATE. CONTRACTOR TO FIELD VERIFY PRIOR TO START OF CONSTRUCTION.

DEMOLITION FLOOR PLAN KEYNOTES

- SALVAGE (E) 4'x 8' TACK PANEL AND TURN OVER TO DISTRICT
- RECONFIGURE (E) WIREMOLD. SHORTEN CONFIGURATION TIGHT TO NEW ENCLOSURE AND
- CUT AND PREP OPENING FOR MECHANICAL WORK, S.M.D.

REMOVE (E) MECHANICAL UNIT AND METAL ENCLOSURE, S.M.D.

SALVAGE (E) CABINET AND TURN OVER TO DISTRICT

- REMOVE (E) MECHANICAL EQUIPMENT, S.M.D.
- PROVIDE END CAP. SEE NEW FLOOR PLAN FOR MORE INFORMATION.
- REMOVE PAVING AND PREP FOR NEW WORK, S.M.D.

EXISTING WALL TO REMAIN

EXISTING STOREFRONT OR WINDOW TO REMAIN

3

REMOVE (E) WINDOW GLAZING ABOVE AND PREP FOR NEW WORK. S.M.D.

IDENTIFICATION STAMP

DIV. OF THE STATE ARCHITEC

REVIEWED FOR

SS 🗹 FLS 🗹 ACS 🗹

architects

www.aedisarchitects.com

387 S. 1st Street, Suite 300

San Jose, CA 95113

tel: (408)-300-5160 fax: (408)-300-5121

MEADOW HEIGHTS

ELEMENTARY

SCHOOL - HVAC

SAN MATEO-FOSTER CITY

SCHOOL DISTRICT

CONSULTANT

REPLACEMENT

APP: 01-119554 INC:

PROJECT

STATE DSA FILE NUMBER 01-119554 APPL#

REVISIONS

No. Description Date

MILESTONES

DD 90% CD 06/02/2021


DSA SUB 09/22/202 BACKCHECK

SHEET **DEMOLITION** FLOOR PLAN -BLDGS 1,2,3, & 4


09/17/2021

JOB# 2021005.04 SHEET#

A2.01

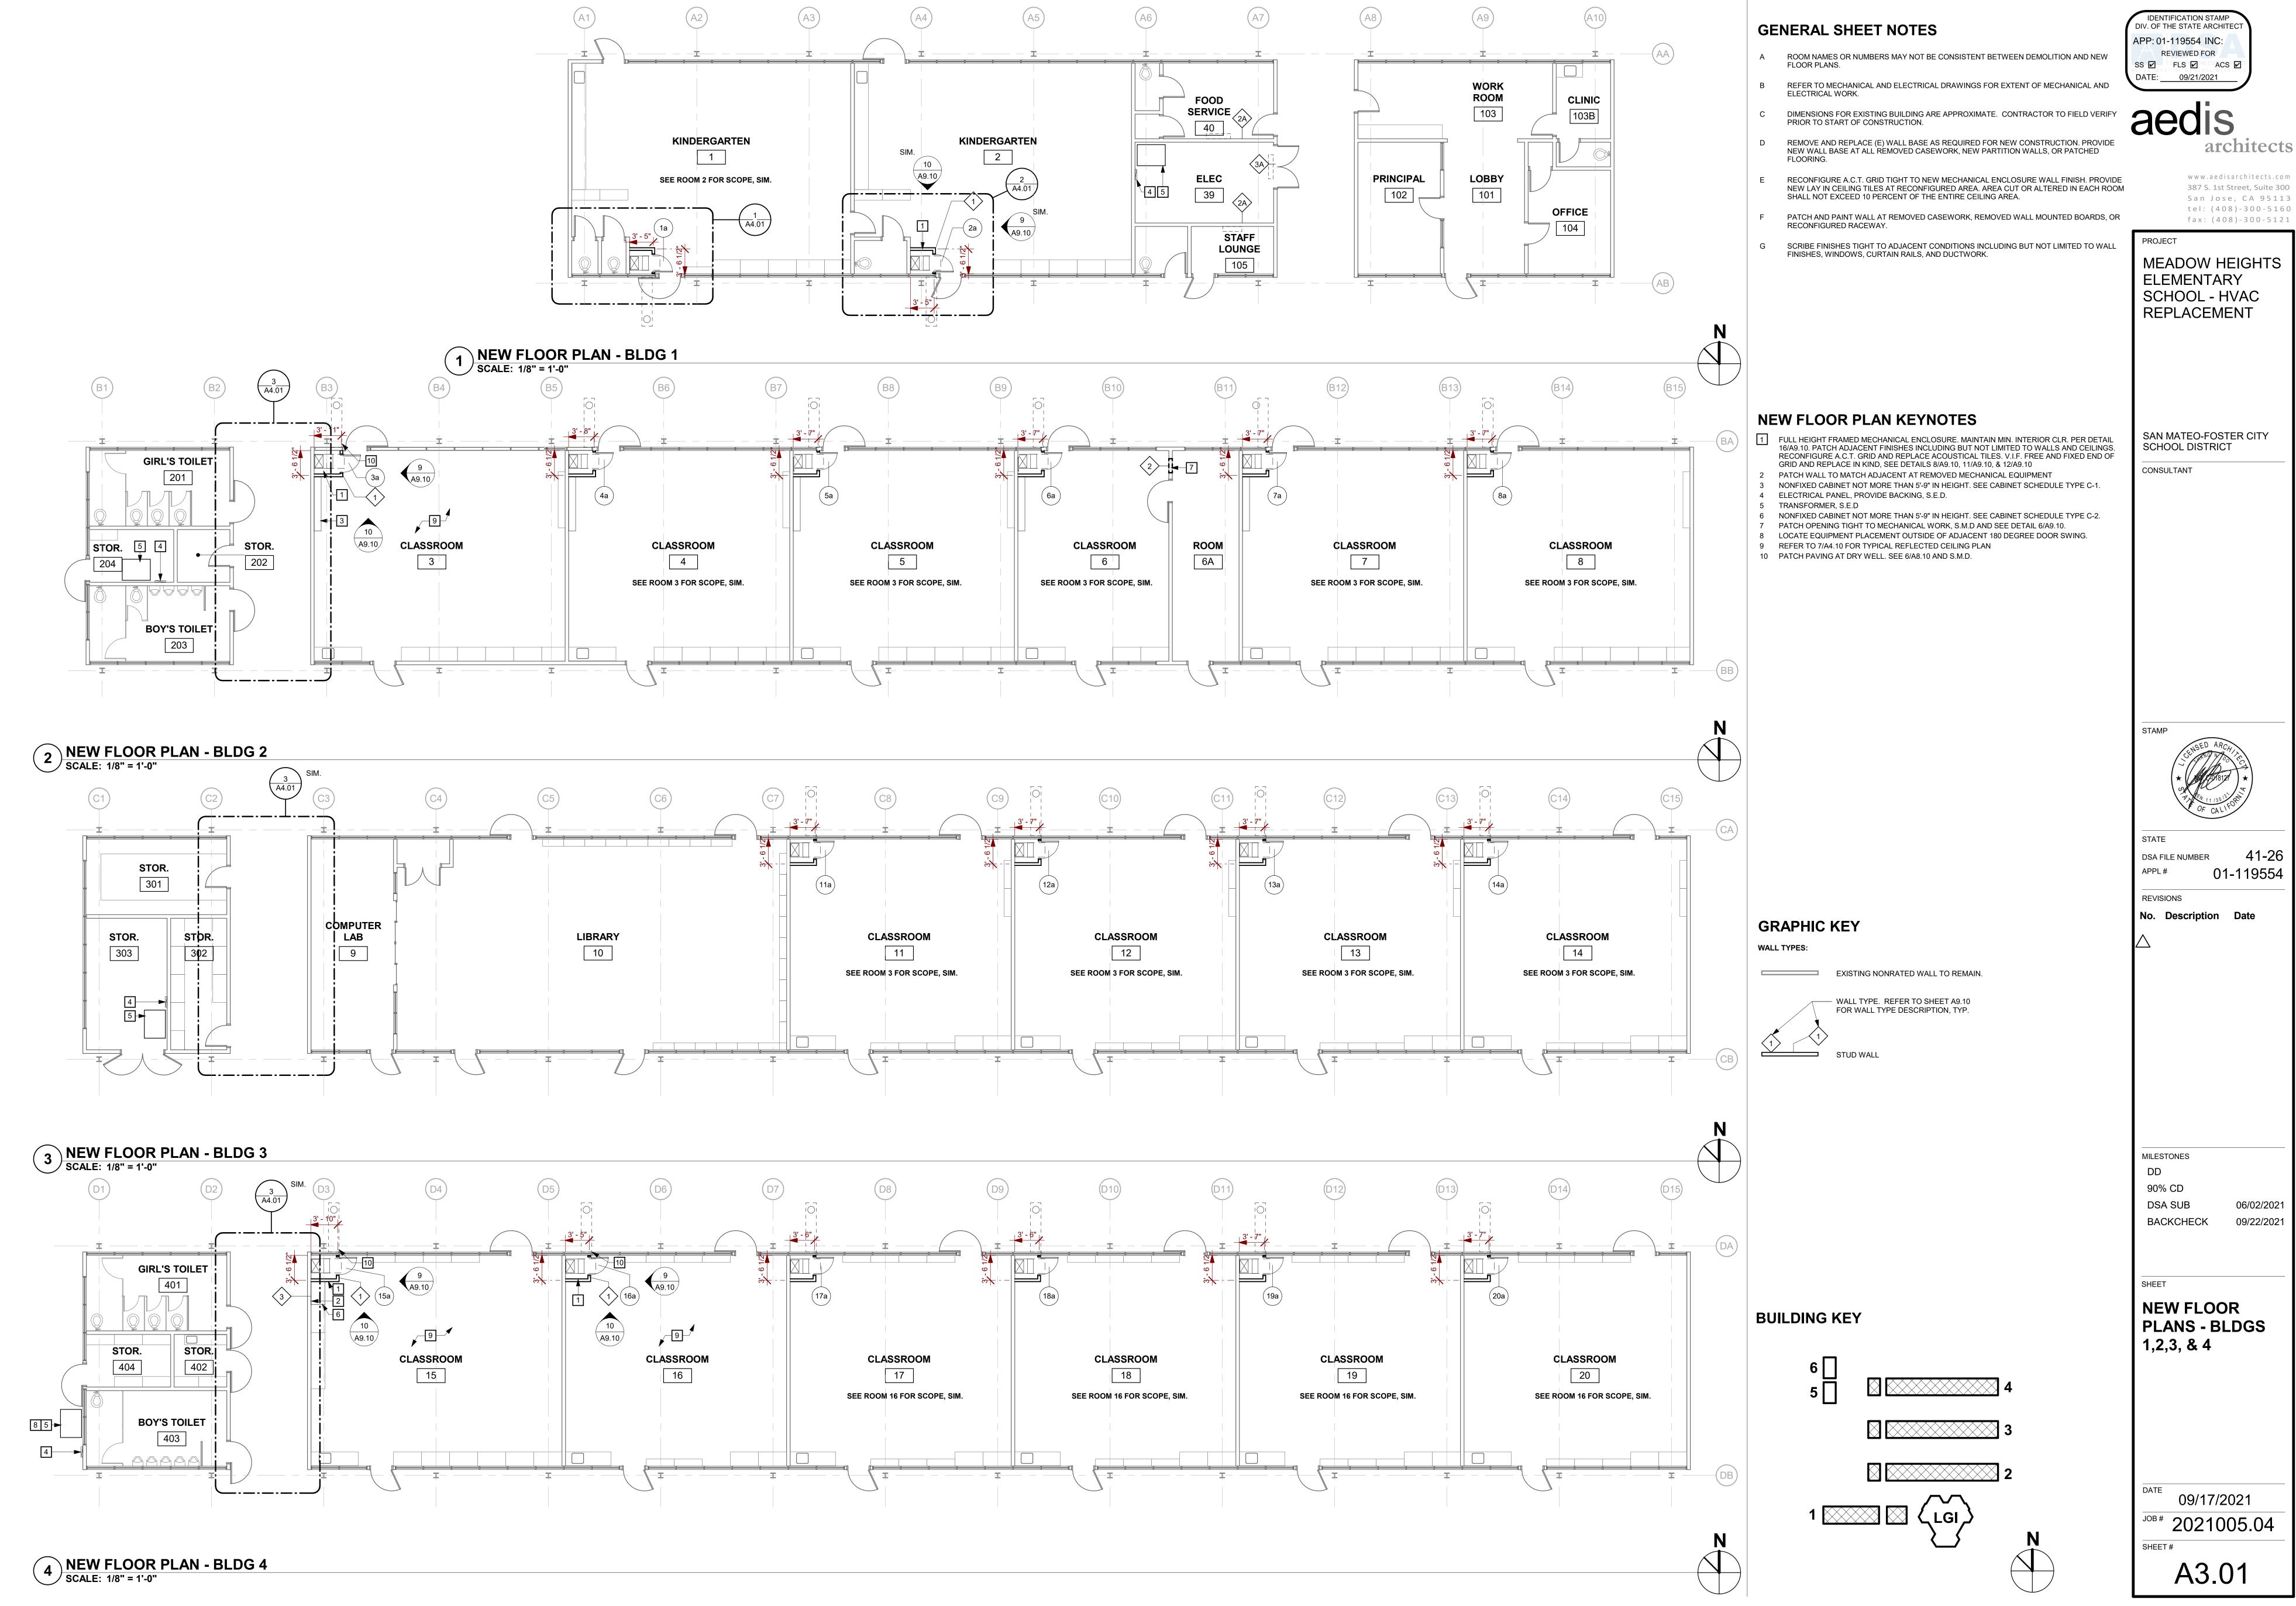

www.aedisarchitects.com 387 S. 1st Street, Suite 300 San Jose, CA 95113

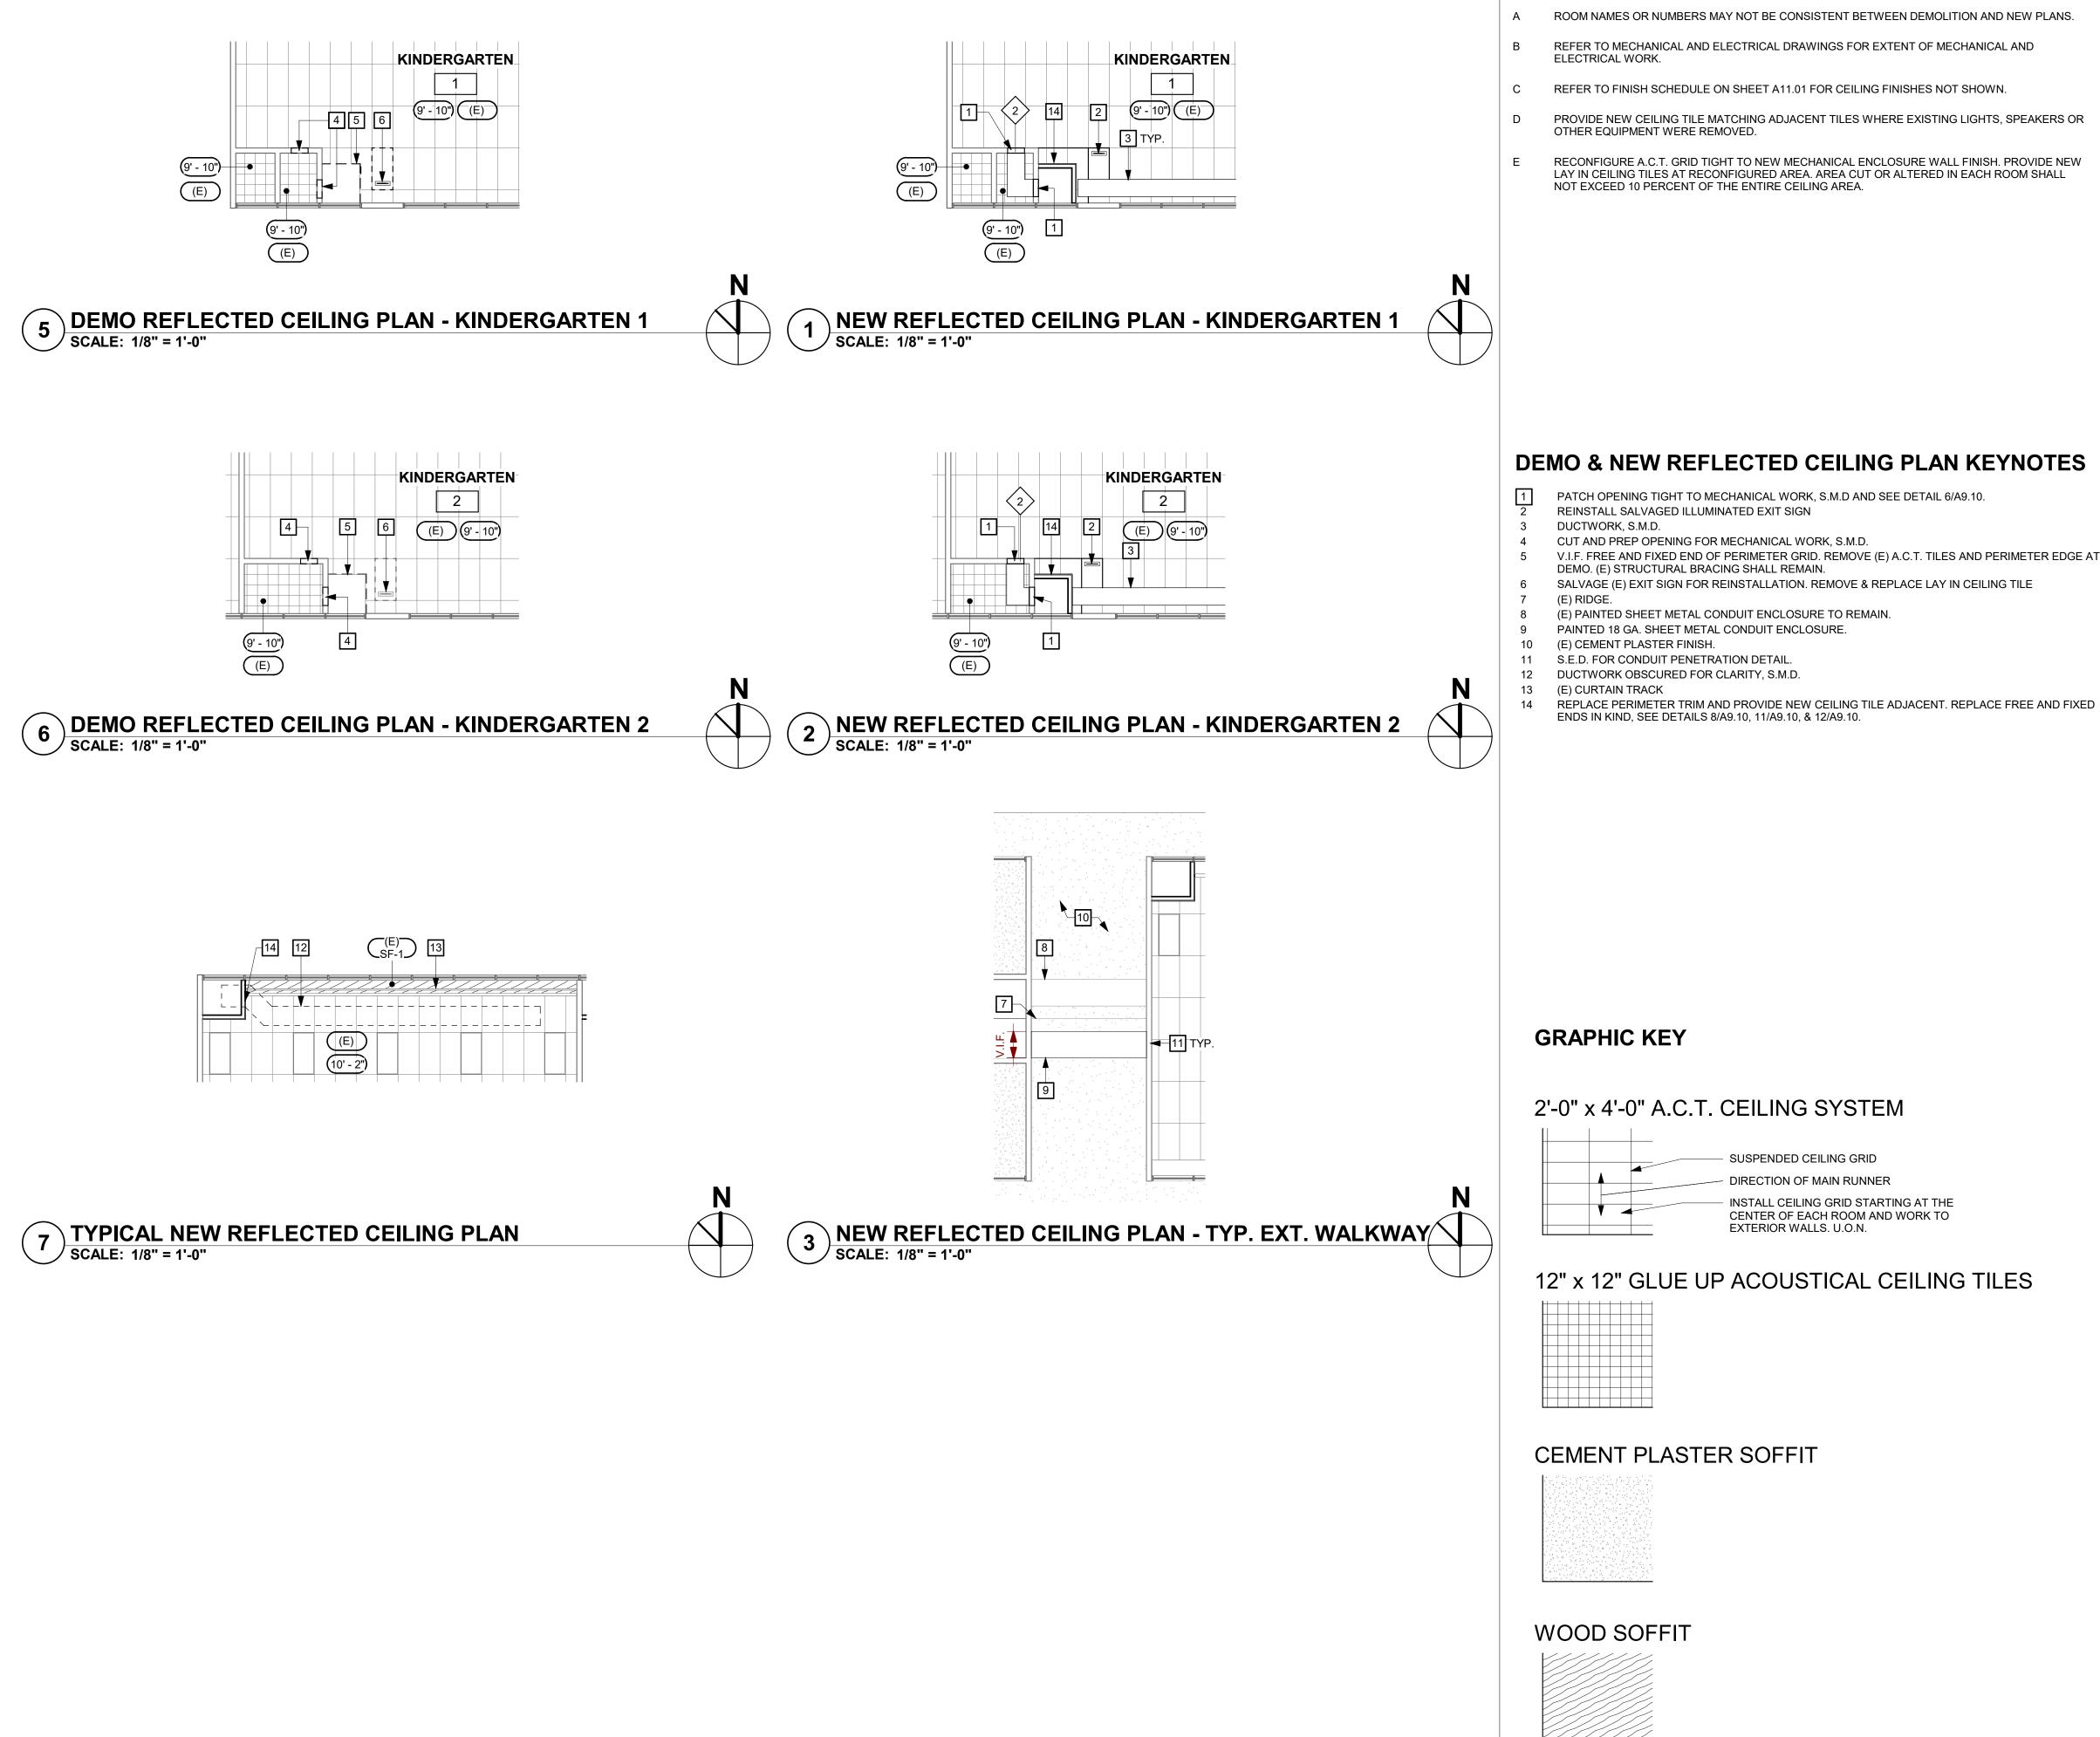

GENERAL SHEET NOTES

- A ROOM NAMES OR NUMBERS MAY NOT BE CONSISTENT BETWEEN DEMOLITION AND NEW PLANS.
- REFER TO MECHANICAL AND ELECTRICAL DRAWINGS FOR EXTENT OF MECHANICAL AND ELECTRICAL WORK.
- REFER TO FINISH SCHEDULE ON SHEET A11.01 FOR CEILING FINISHES NOT SHOWN.
- PROVIDE NEW CEILING TILE MATCHING ADJACENT TILES WHERE EXISTING LIGHTS, SPEAKERS OR OTHER EQUIPMENT WERE REMOVED.
- RECONFIGURE A.C.T. GRID TIGHT TO NEW MECHANICAL ENCLOSURE WALL FINISH. PROVIDE NEW LAY IN CEILING TILES AT RECONFIGURED AREA. AREA CUT OR ALTERED IN EACH ROOM SHALL

IDENTIFICATION STAMP

DIV. OF THE STATE ARCHITEC

REVIEWED FOR SS 🗹 FLS 🗹 ACS 🗹

APP: 01-119554 INC:

architects www.aedisarchitects.com 387 S. 1st Street, Suite 300 San Jose, CA 95113

tel: (408)-300-5160

fax: (408)-300-5121 PROJECT

MEADOW HEIGHTS ELEMENTARY SCHOOL - HVAC REPLACEMENT

SAN MATEO-FOSTER CITY

SCHOOL DISTRICT

DEMO & NEW REFLECTED CEILING PLAN KEYNOTES

1 PATCH OPENING TIGHT TO MECHANICAL WORK, S.M.D AND SEE DETAIL 6/A9.10.

- 4 CUT AND PREP OPENING FOR MECHANICAL WORK, S.M.D.
- 5 V.I.F. FREE AND FIXED END OF PERIMETER GRID. REMOVE (E) A.C.T. TILES AND PERIMETER EDGE AT DEMO. (E) STRUCTURAL BRACING SHALL REMAIN.
- 6 SALVAGE (E) EXIT SIGN FOR REINSTALLATION. REMOVE & REPLACE LAY IN CEILING TILE

SUSPENDED CEILING GRID **DIRECTION OF MAIN RUNNER**

INSTALL CEILING GRID STARTING AT THE

CENTER OF EACH ROOM AND WORK TO EXTERIOR WALLS. U.O.N.

- 8 (E) PAINTED SHEET METAL CONDUIT ENCLOSURE TO REMAIN.
- 9 PAINTED 18 GA. SHEET METAL CONDUIT ENCLOSURE.
- 11 S.E.D. FOR CONDUIT PENETRATION DETAIL.
- 12 DUCTWORK OBSCURED FOR CLARITY, S.M.D.
- 13 (E) CURTAIN TRACK

CONSULTANT

STAMP

STATE 41-26 DSA FILE NUMBER 01-119554

REVISIONS

No. Description Date

MILESTONES


DD 90% CD DSA SUB

06/02/2021 BACKCHECK

DEMOLITION & REFLECTED CEILING PLANS

^{JOB #} 2021005.04

A4.01

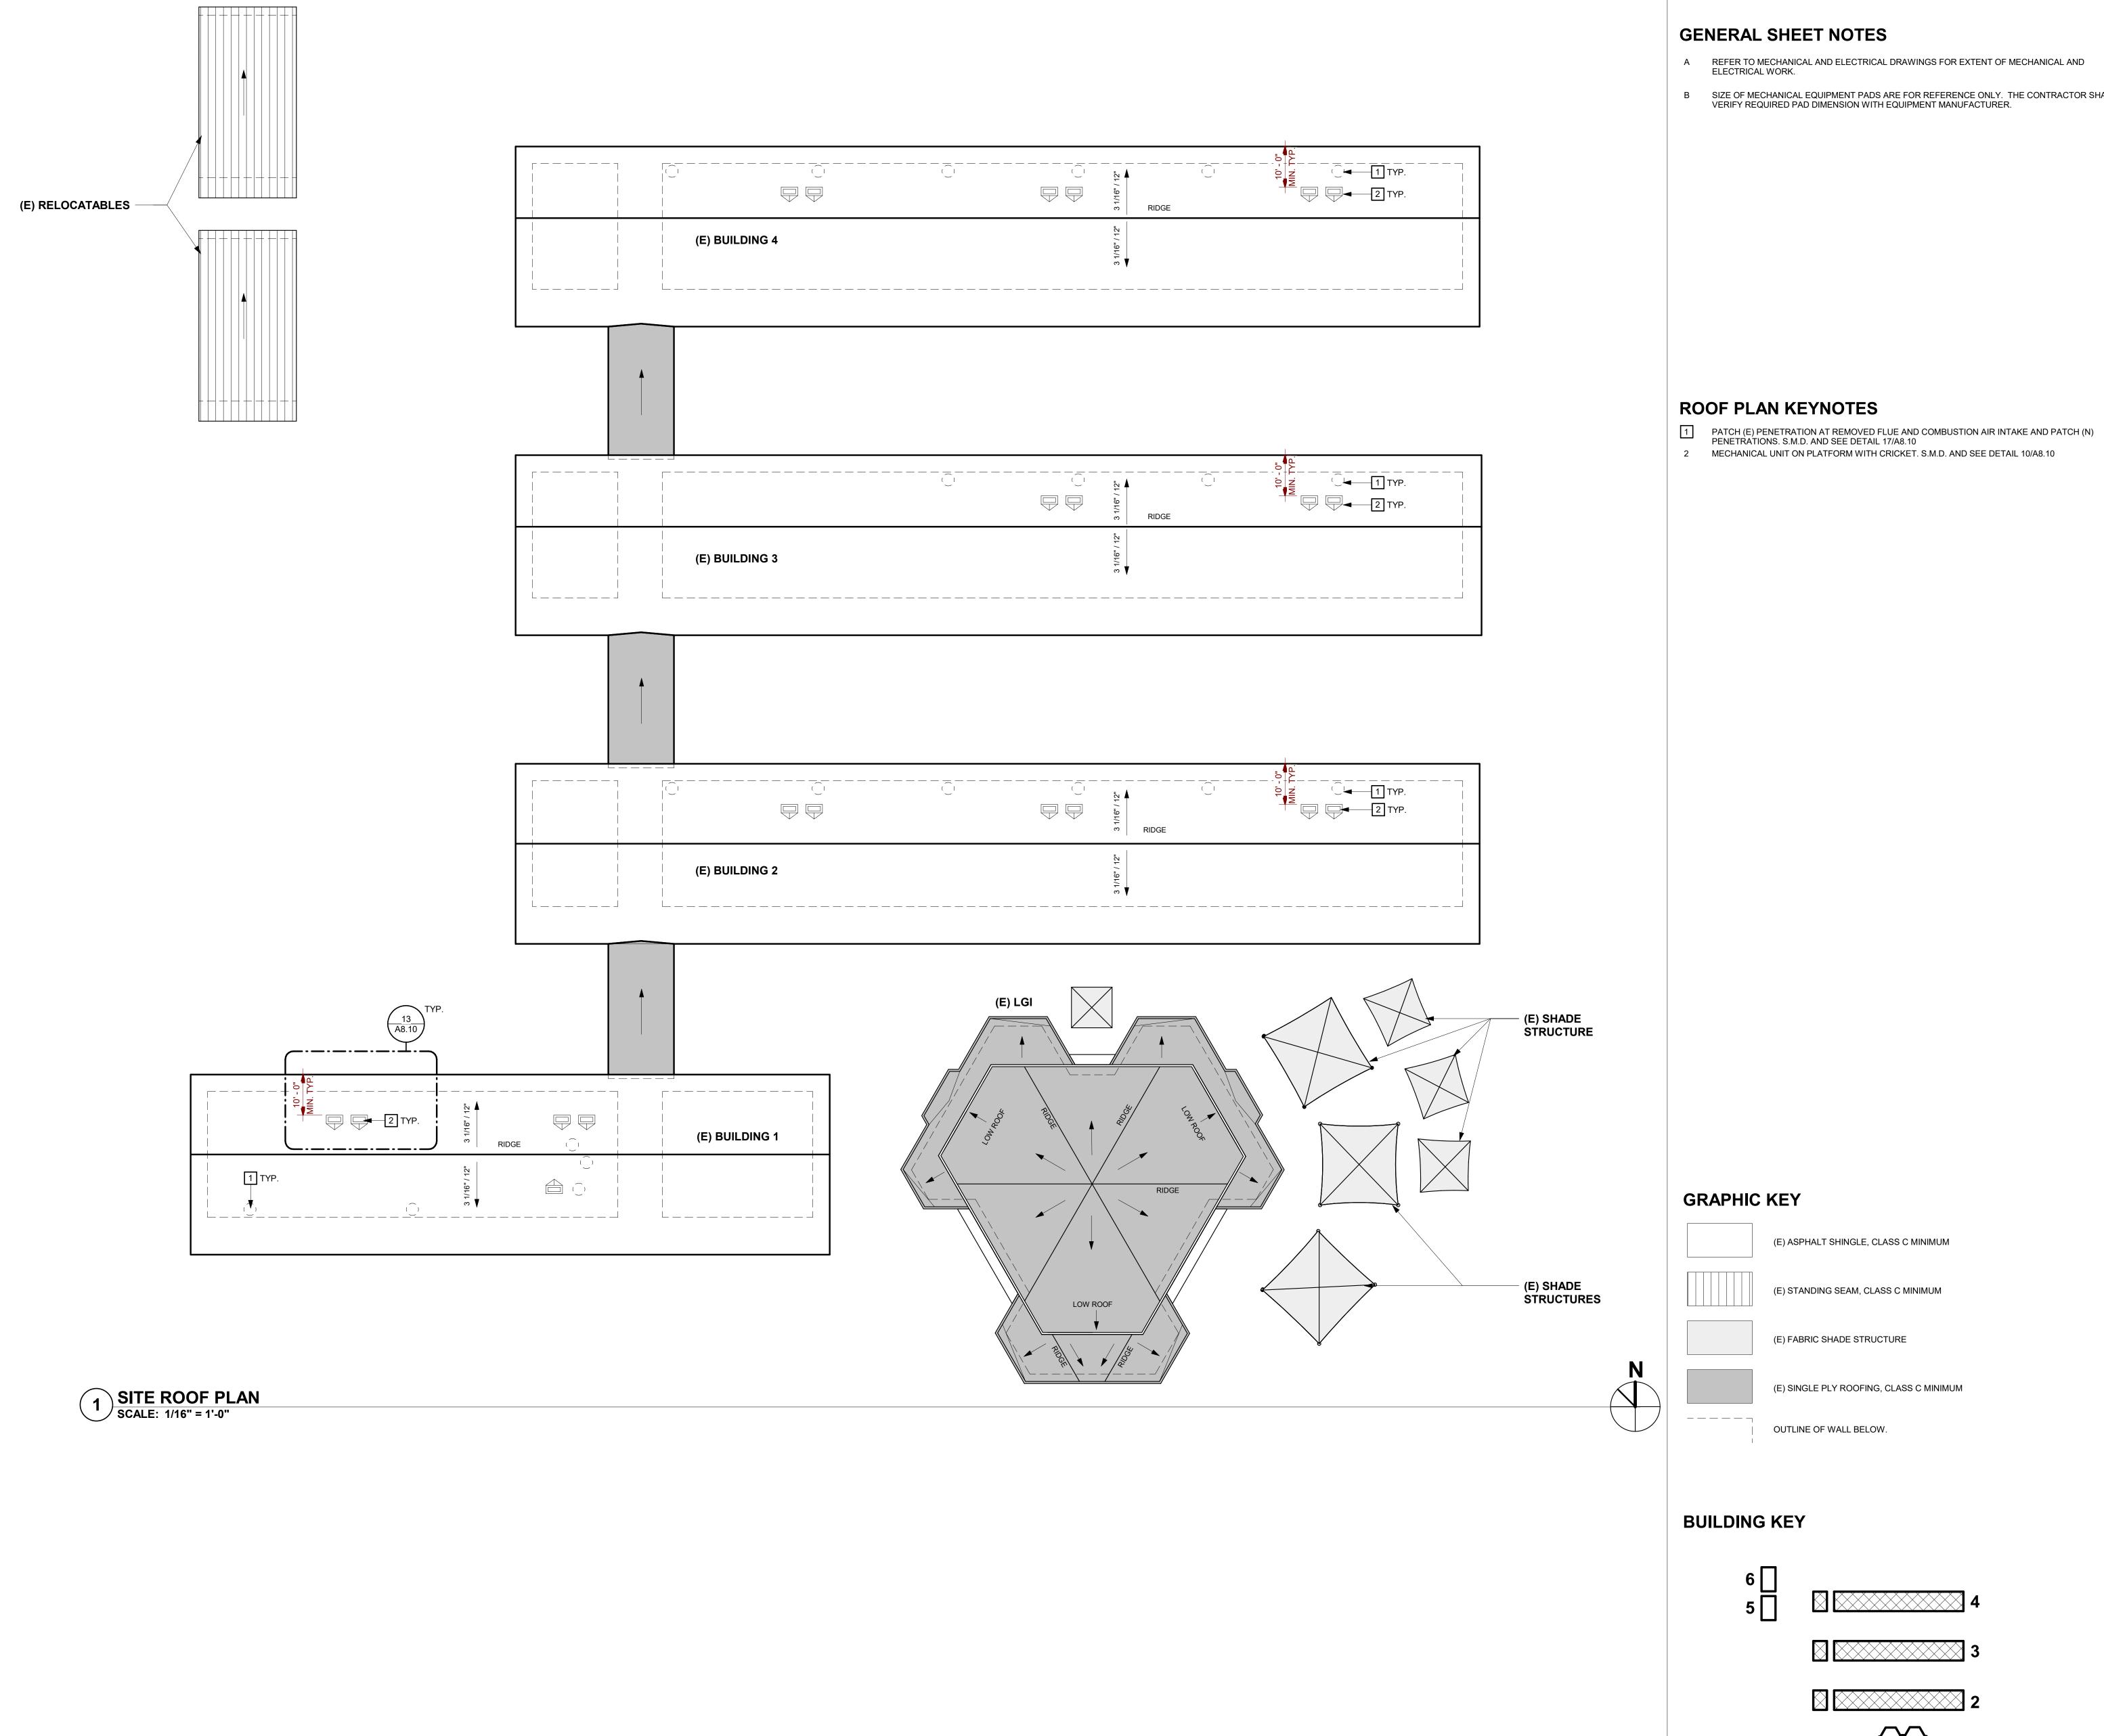

GENERAL SHEET NOTES

- A REFER TO MECHANICAL AND ELECTRICAL DRAWINGS FOR EXTENT OF MECHANICAL AND ELECTRICAL WORK.
- B SIZE OF MECHANICAL EQUIPMENT PADS ARE FOR REFERENCE ONLY. THE CONTRACTOR SHALL VERIFY REQUIRED PAD DIMENSION WITH EQUIPMENT MANUFACTURER.

IDENTIFICATION STAMP DIV. OF THE STATE ARCHITEC APP: 01-119554 INC: REVIEWED FOR SS 🗹 FLS 🗹 ACS 🗹

PROJECT

www.aedisarchitects.com 387 S. 1st Street, Suite 300 San Jose, CA 95113 tel: (408)-300-5160 fax: (408)-300-5121

MEADOW HEIGHTS ELEMENTARY SCHOOL - HVAC REPLACEMENT

SAN MATEO-FOSTER CITY SCHOOL DISTRICT

CONSULTANT

41-26 DSA FILE NUMBER APPL# 01-119554 REVISIONS

No. Description Date

MILESTONES

90% CD

DSA SUB

BACKCHECK

06/02/2021

09/22/2021

DD

GRAPHIC KEY


(E) ASPHALT SHINGLE, CLASS C MINIMUM

(E) STANDING SEAM, CLASS C MINIMUM

(E) FABRIC SHADE STRUCTURE (E) SINGLE PLY ROOFING, CLASS C MINIMUM


OUTLINE OF WALL BELOW.

BUILDING KEY

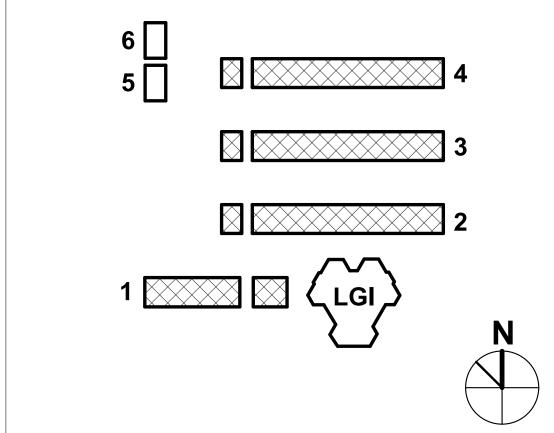


09/17/2021 ^{JOB#} 2021005.04 A5.01

SITE ROOF PLAN

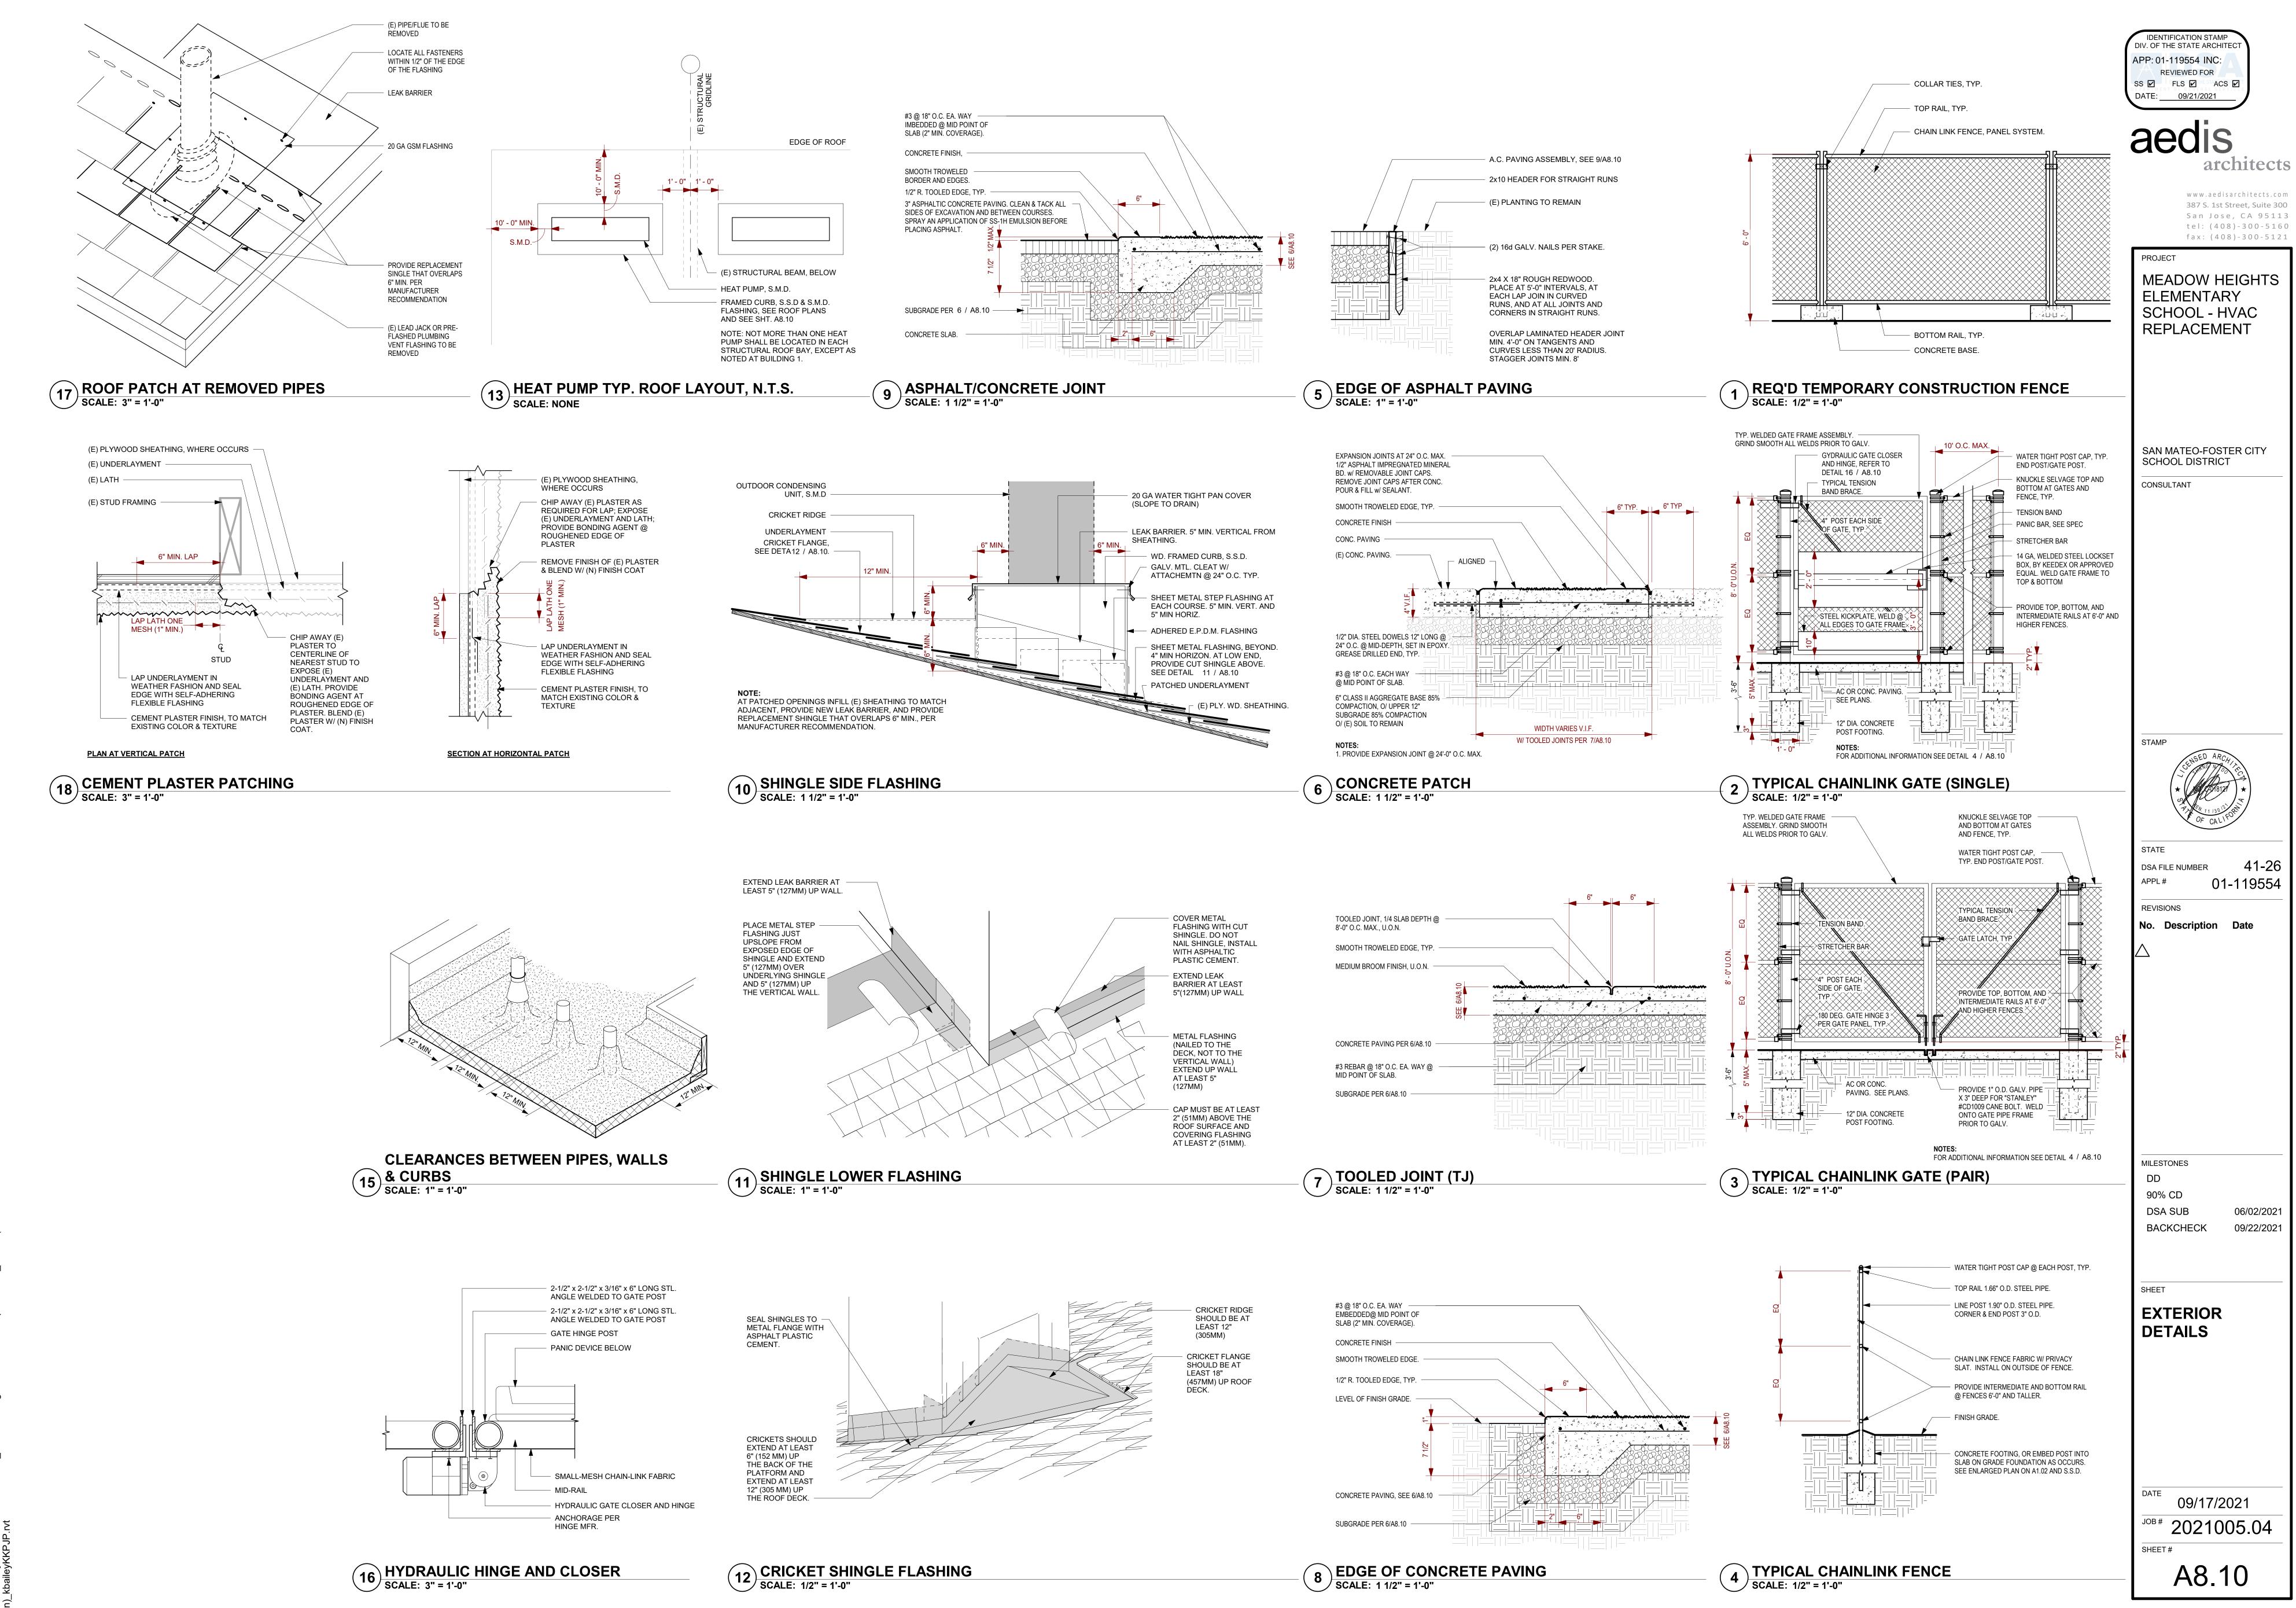

9/17/2021 12:44:54 PM C:\Users\kbailey\Documents\2021005.04_Meadow Heights ES - HVAC Replacement_Central(2019

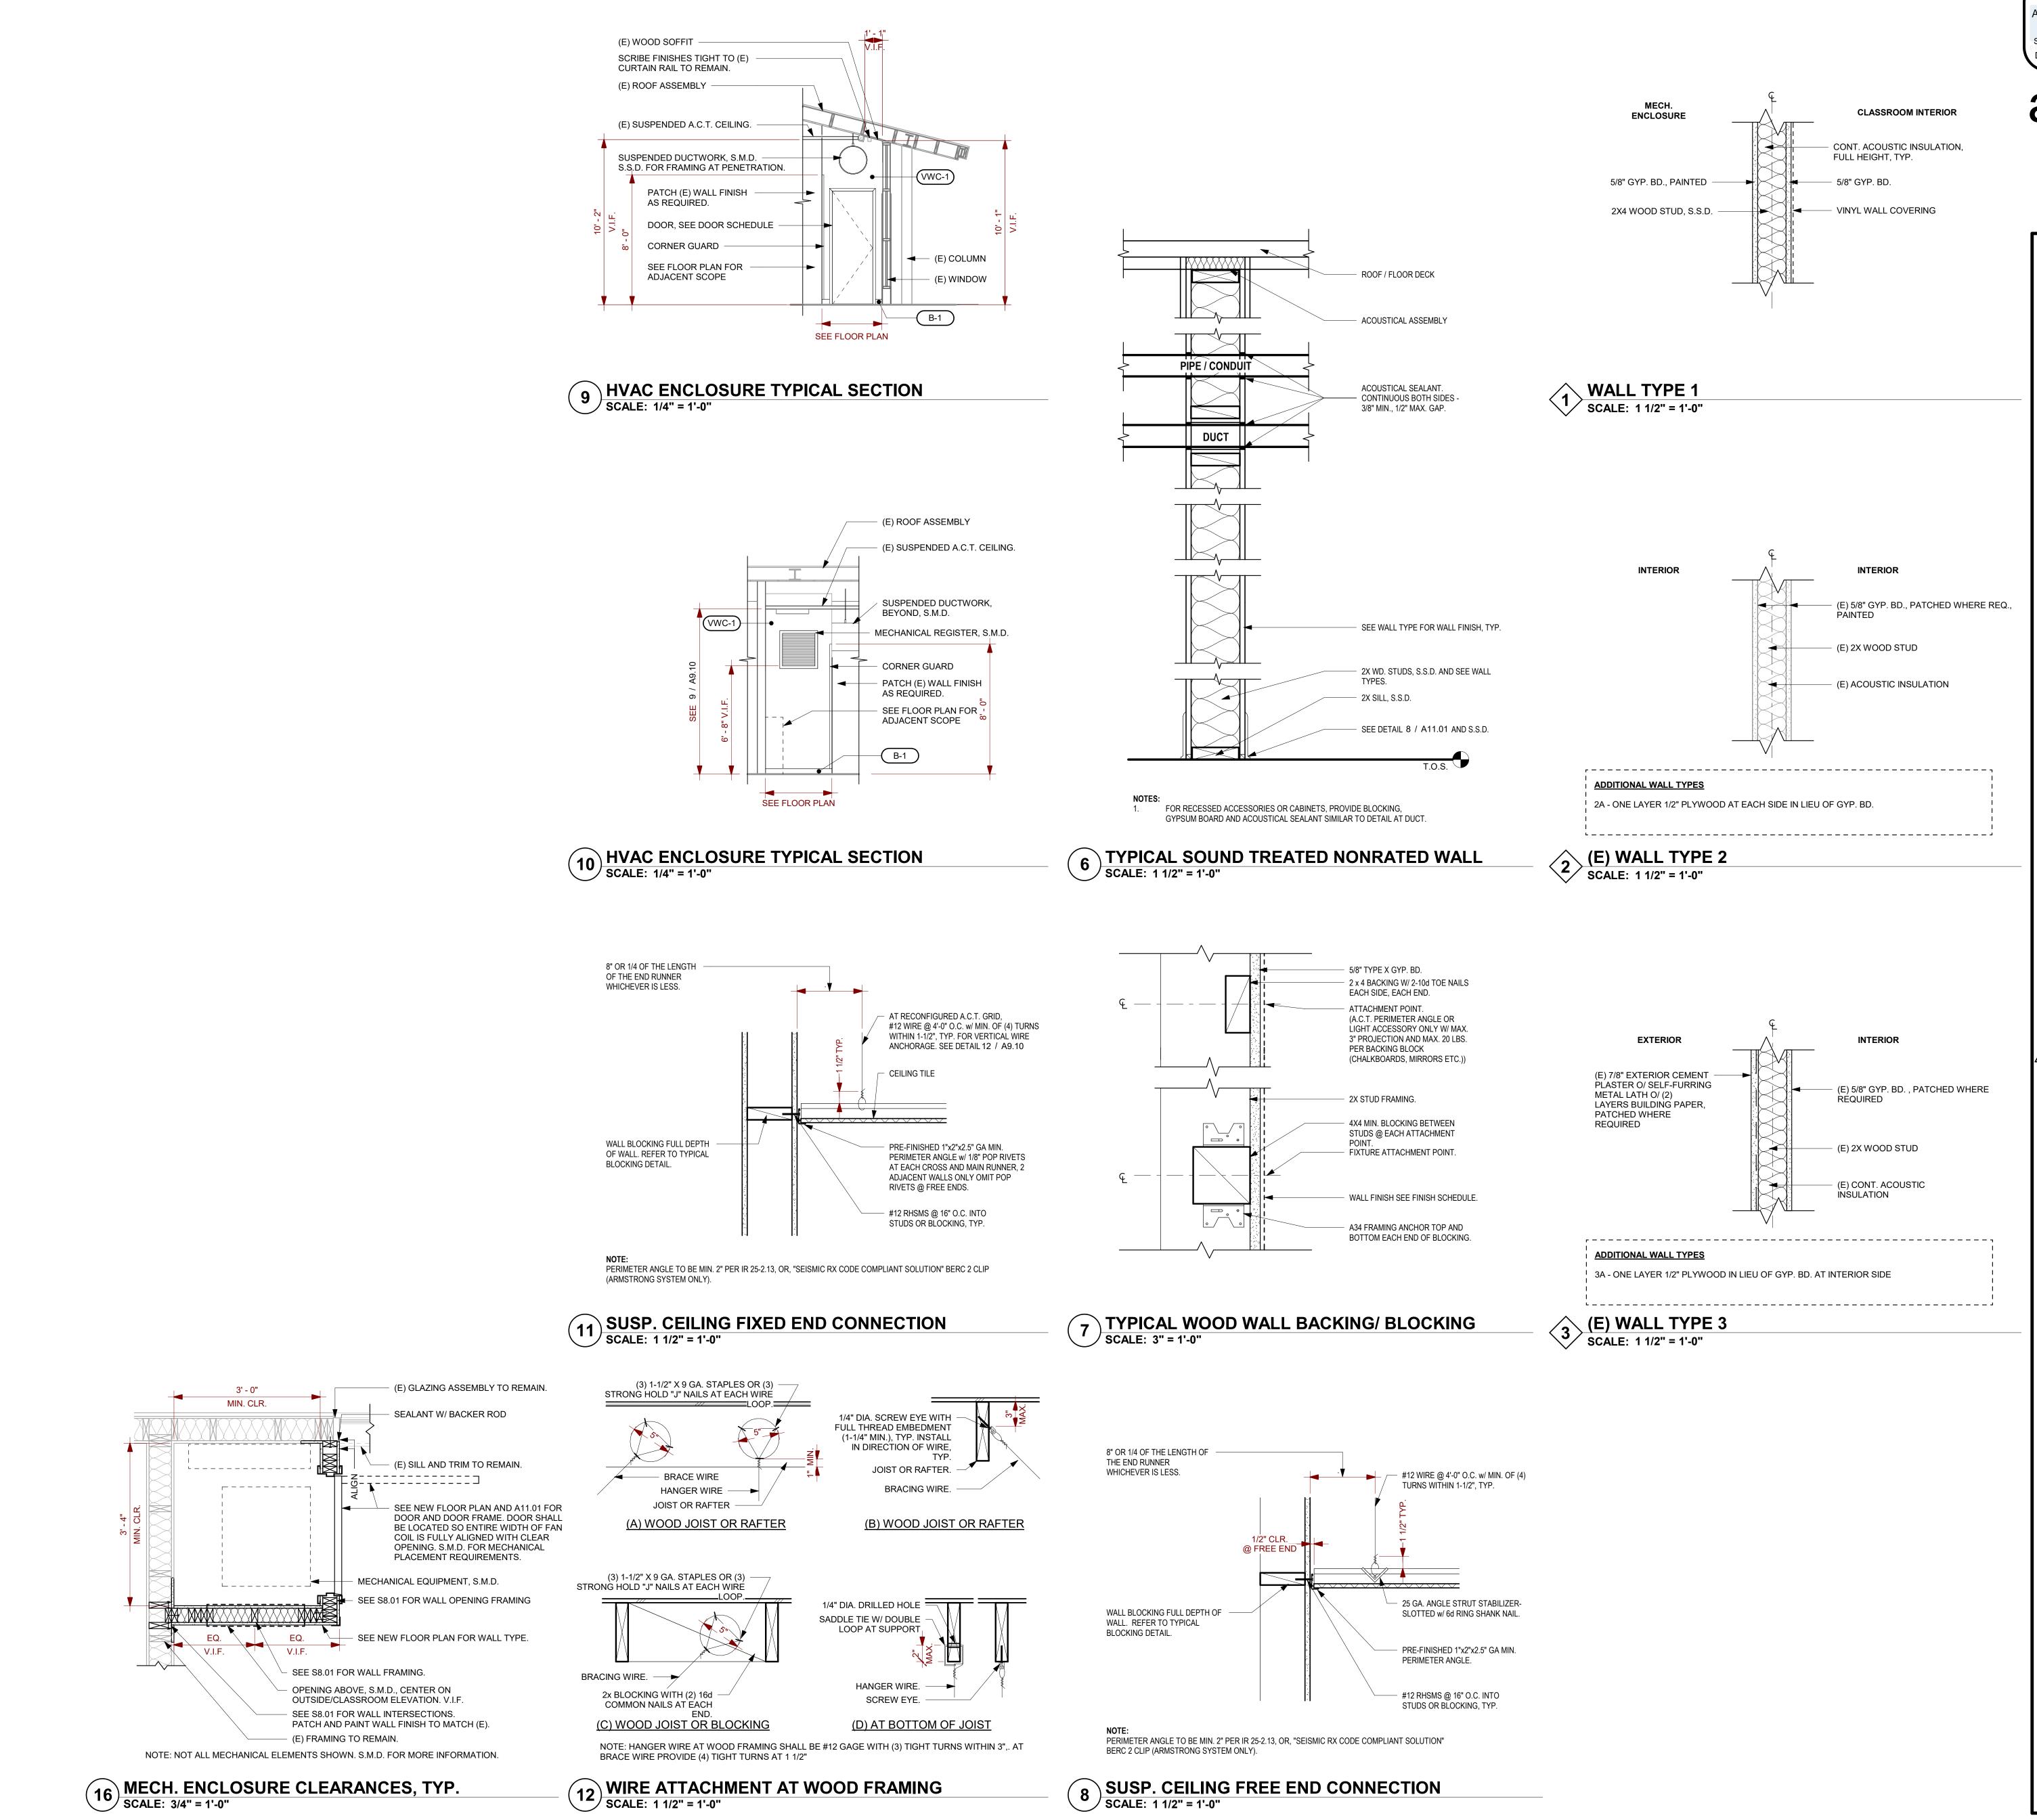

IDENTIFICATION STAMP DIV. OF THE STATE ARCHITEC APP: 01-119554 INC: REVIEWED FOR SS 🗹 FLS 🗹 ACS 🗹 DATE: 09/21/2021

architects

www.aedisarchitects.com 387 S. 1st Street, Suite 300 San Jose, CA 95113 tel: (408)-300-5160 fax: (408)-300-5121

PROJECT **MEADOW HEIGHTS ELEMENTARY** SCHOOL - HVAC REPLACEMENT

SAN MATEO-FOSTER CITY SCHOOL DISTRICT

CONSULTANT

STAMP

STATE 41-26

DSA FILE NUMBER 01-119554 APPL# REVISIONS

No. Description Date

MILESTONES DD 90% CD DSA SUB 06/02/2021

BACKCHECK

SHEET **INTERIOR**

09/22/2021

DETAILS, WALL TYPES, AND INTERIOR **ELEVATIONS**

09/17/2021 ^{JOB #} 2021005.04 SHEET#

A9.10

CABINET SCHEDULE								
CABINET	WOODWORK INSTITUTE CASEWORK DESIGN SERIES#	WIDTH	HEIGHT	DEPTH	COMMENTS			
C-1	100	7' - 4"	2' - 3"	0' - 9"				
C-2	400	3' - 4"	5' - 9"	1' - 8"				

GENERAL CABINET SCHEDULE NOTES

- 1 ALL SHELVING IS TO BE ADJUSTABLE UNLESS OTHERWISE NOTED.
- 2 VERIFY SIZING IN FIELD PER EXISTING CASEWORK SIZE AND NEW MECHANICAL ENCLOSURE SIZE.
- 3 ALL FIXTURES ARE TO BE NONFIXED FURNITURE CABINET NOT MORE THN 5' 9" IN HEIGHT PER CBC 105.2.

DOOR SCHEDULE											
	OPENIN	NG SIZE	DC	OR	FR	AME		DET	AILS		HARDWARE
DOOR ID	WIDTH	HEIGHT	TYPE	FINISH	TYPE	FINISH	HEAD	JAMB-1	JAMB-2	SILL	GROUP
1a	2' - 6"	7' - 0"	A	P-2	F1	P-3	11/A11.01	11/A11.01	11/A11.01	4/A11.01	01
2a	2' - 6"	7' - 0"	Α	P-2	F1	P-3	11/A11.01	11/A11.01	11/A11.01	4/A11.01	01
3a	2' - 6"	7' - 0"	Α	P-2	F1	P-3	11/A11.01	11/A11.01	11/A11.01	4/A11.01	01
4a	2' - 6"	7' - 0"	Α	P-2	F1	P-3	11/A11.01	11/A11.01	11/A11.01	4/A11.01	01
5a	2' - 6"	7' - 0"	Α	P-2	F1	P-3	11/A11.01	11/A11.01	11/A11.01	4/A11.01	01
6a	2' - 6"	7' - 0"	Α	P-2	F1	P-3	11/A11.01	11/A11.01	11/A11.01	4/A11.01	01
7a	2' - 6"	7' - 0"	Α	P-2	F1	P-3	11/A11.01	11/A11.01	11/A11.01	4/A11.01	01
8a	2' - 6"	7' - 0"	Α	P-2	F1	P-3	11/A11.01	11/A11.01	11/A11.01	4/A11.01	01
11a	2' - 6"	7' - 0"	Α	P-2	F1	P-3	11/A11.01	11/A11.01	11/A11.01	4/A11.01	01
12a	2' - 6"	7' - 0"	А	P-2	F1	P-3	11/A11.01	11/A11.01	11/A11.01	4/A11.01	01
13a	2' - 6"	7' - 0"	Α	P-2	F1	P-3	11/A11.01	11/A11.01	11/A11.01	4/A11.01	01
14a	2' - 6"	7' - 0"	А	P-2	F1	P-3	11/A11.01	11/A11.01	11/A11.01	4/A11.01	01
15a	2' - 6"	7' - 0"	Α	P-2	F1	P-3	11/A11.01	11/A11.01	11/A11.01	4/A11.01	01
16a	2' - 6"	7' - 0"	Α	P-2	F1	P-3	11/A11.01	11/A11.01	11/A11.01	4/A11.01	01
17a	2' - 6"	7' - 0"	Α	P-2	F1	P-3	11/A11.01	11/A11.01	11/A11.01	4/A11.01	01
18a	2' - 6"	7' - 0"	Α	P-2	F1	P-3	11/A11.01	11/A11.01	11/A11.01	4/A11.01	01
19a	2' - 6"	7' - 0"	Α	P-2	F1	P-3	11/A11.01	11/A11.01	11/A11.01	4/A11.01	01
20a	2' - 6"	7' - 0"	Α	P-2	F1	P-3	11/A11.01	11/A11.01	11/A11.01	4/A11.01	01

SEE DOOR SCHEDULE

METAL

FRAME TYPES

SCALE: 1/4" = 1'-0"

SEE DOOR SCHEDULE

WOOD

DOOR TYPES

SCALE: 1/4" = 1'-0"

					DOOK S	CHEDULE					
	OPENIN	NG SIZE	DC	OR	FRA	AME		DET	AILS		HARDWARE
DOOR ID	WIDTH	HEIGHT	TYPE	FINISH	TYPE	FINISH	HEAD	JAMB-1	JAMB-2	SILL	GROUP
1a	2' - 6"	7' - 0"	A	P-2	F1	P-3	11/A11.01	11/A11.01	11/A11.01	4/A11.01	01
2a	2' - 6"	7' - 0"	A	P-2	F1	P-3	11/A11.01	11/A11.01	11/A11.01	4/A11.01	01
3a	2' - 6"	7' - 0"	A	P-2	F1	P-3	11/A11.01	11/A11.01	11/A11.01	4/A11.01	01
4a	2' - 6"	7' - 0"	A	P-2	F1	P-3	11/A11.01	11/A11.01	11/A11.01	4/A11.01	01
5a	2' - 6"	7' - 0"	A	P-2	F1	P-3	11/A11.01	11/A11.01	11/A11.01	4/A11.01	01
6a	2' - 6"	7' - 0"	A	P-2	F1	P-3	11/A11.01	11/A11.01	11/A11.01	4/A11.01	01
7a	2' - 6"	7' - 0"	A	P-2	F1	P-3	11/A11.01	11/A11.01	11/A11.01	4/A11.01	01
8a	2' - 6"	7' - 0"	A	P-2	F1	P-3	11/A11.01	11/A11.01	11/A11.01	4/A11.01	01
11a	2' - 6"	7' - 0"	A	P-2	F1	P-3	11/A11.01	11/A11.01	11/A11.01	4/A11.01	01
12a	2' - 6"	7' - 0"		P-2	F1	P-3	11/A11.01	11/A11.01	11/A11.01 11/A11.01	4/A11.01	01
13a	2' - 6"	7'-0"	A A	P-2	F1	P-3	11/A11.01	11/A11.01	11/A11.01 11/A11.01	4/A11.01	01
13a 14a	2' - 6"	7' - 0"		P-2 P-2	F1	P-3	11/A11.01	11/A11.01	11/A11.01 11/A11.01	4/A11.01 4/A11.01	01
	2' - 6"	7 - 0"	A	P-2 P-2		P-3 P-3					
15a			A		F1		11/A11.01	11/A11.01	11/A11.01	4/A11.01	01
16a	2' - 6"	7' - 0"	A	P-2	F1	P-3	11/A11.01	11/A11.01	11/A11.01	4/A11.01	01
17a	2' - 6"	7' - 0"	A	P-2	F1	P-3	11/A11.01	11/A11.01	11/A11.01	4/A11.01	01
18a	2' - 6"	7' - 0"	Α	P-2	F1	P-3	11/A11.01	11/A11.01	11/A11.01	4/A11.01	01
19a	2' - 6"	7' - 0"	A	P-2	F1	P-3	11/A11.01	11/A11.01	11/A11.01	4/A11.01	01
20a	2' - 6"	7' - 0"	Α	P-2	F1	P-3	11/A11.01	11/A11.01	11/A11.01	4/A11.01	01

FINISH SCHEDULE ROOM **FLOOR** FLOOR FINISH FINISH NUMBER NAME **CEILING FINISH** COMMENTS WALL FINISH KINDERGARTEN (E) VSF-1 B-1 VWC-1, GB-1 (E) SF-1, ACT-1 KINDERGARTEN (E) VSF-1 VWC-1, GB-1 (E) SF-1, ACT-1 (E) VCT-1 CLASSROOM (E) SF-1, ACT-1 (E) VCT-1 VWC-1, GB-1 CLASSROOM (E) SF-1, ACT-1 CLASSROOM (E) VCT-1 VWC-1, GB-1 (E) SF-1, ACT-1 (E) CPT-2 (E) SF-1, ACT-1 CLASSROOM VWC-1, GB-1 (E) CPT-1 ROOM (E) SF-1, ACT-1 (E) SF-1, ACT-1 CLASSROOM (E) CPT-1 VWC-1, GB-1 (E) VCT-1 (E) SF-1, ACT-1 CLASSROOM VWC-1, GB-1 (E) CPT-1 COMPUTER LAB VWC-1, GB-1 (E) SF-1, ACT-1 (E) CPT-1 CLASSROOM VWC-1, GB-1 (E) SF-1, ACT-1 12 CLASSROOM (E) CPT-1 VWC-1, GB-1 (E) SF-1, ACT-1 (E) CPT-1 VWC-1, GB-1 (E) SF-1, ACT-1 CLASSROOM (E) CPT-1 CLASSROOM VWC-1, GB-1 (E) SF-1, ACT-1 (E) VCT-2 (E) SF-1, ACT-1 CLASSROOM VWC-1, GB-1 (E) VSF-1 VWC-1, GB-1 (E) SF-1, ACT-1 CLASSROOM CLASSROOM (E) CPT-1 VWC-1, GB-1 (E) SF-1, ACT-1 (E) CPT-1 VWC-1, GB-1 CLASSROOM (E) SF-1, ACT-1 19 (E) CPT-1 VWC-1, GB-1 (E) SF-1, ACT-1 CLASSROOM (E) CPT-1 CLASSROOM B-1 VWC-1, GB-1 (E) SF-1, ACT-1

GENERAL DOOR SCHEDULE NOTES

VINYL WALL COVERING

CONTRACTOR SHALL COORDINATE, PRIOR TO FABRICATION, DOOR FRAME DEPTH TO ACCEPT ALL WALL FINISHES AS DETAILED IN THE DRAWINGS.

FINISH LEGEND

VWC-1

DESCRIPTION	MFR. / BRAND	COLOR / FINISH	COMMENTS
CARPET (SHEET)			
WOOD SOFFIT			
VINYL COMPOSITION TILE			
VINYL COMPOSITION TILE			
VINYL SHEET FLOORING			
2'-0" X 4'-0" ACOUSTICAL CEILING TILES	SEE SPECS.		SEE 11/A9.10
4" RUBBER TOP SET BASE	SEE SPECS.		SEE 8/A11.01
PAINT	KELLY MOORE		
PAINT	KELLY MOORE		
PAINT	KELLY MOORE		
	CARPET (SHEET) WOOD SOFFIT VINYL COMPOSITION TILE VINYL COMPOSITION TILE VINYL SHEET FLOORING 2'-0" X 4'-0" ACOUSTICAL CEILING TILES 4" RUBBER TOP SET BASE PAINT PAINT	CARPET (SHEET) WOOD SOFFIT VINYL COMPOSITION TILE VINYL COMPOSITION TILE VINYL SHEET FLOORING 2'-0" X 4'-0" ACOUSTICAL CEILING TILES 4" RUBBER TOP SET BASE PAINT KELLY MOORE PAINT KELLY MOORE	CARPET (SHEET) WOOD SOFFIT VINYL COMPOSITION TILE VINYL COMPOSITION TILE VINYL SHEET FLOORING 2'-0" X 4'-0" ACOUSTICAL CEILING TILES 4" RUBBER TOP SET BASE PAINT RUBDET FLOORING KELLY MOORE KELLY MOORE

SEE SPECS.

GENERAL FINISH SCHEDULE NOTES


A WHERE MULTIPLE FINISHES ARE CALLED OUT, REFER TO INTERIOR ELEVATIONS FOR LOCATIONS OF INDIVIDUAL FINISHES.

PROVIDE FINISHES TO COMPLY WITH FLAME SPREAD & SMOKE DENSITY REQUIREMENTS OF CBC 803 and 804.


- PATCH FINISHES TO MATCH ADJACENT AT ALL SURFACES REMOVED TO FACILITATE CONSTRUCTION.

EXISTING FINSIHES THAT MIGHT OCCUR OUTSIDE OF THE AREA OF WORK HAVE BEEN OMITTED.


(E) FLOORING INDICATED FOR REFERENCE ONLY. NO FLOORING REPLACEMENT OR PATCH WORK IS INCLUDED IN THIS PROJECT.

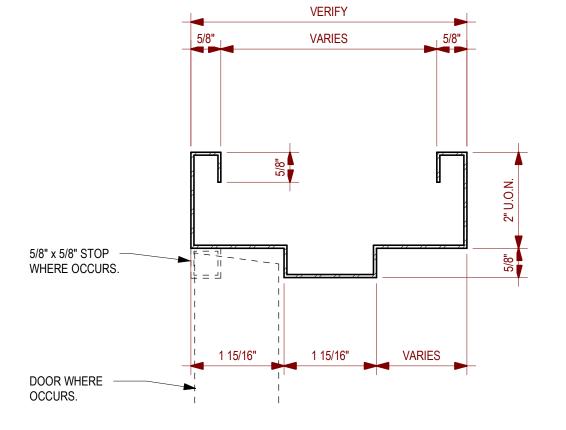


TYPICAL STEEL FRAME DOOR PROFILE SCALE: 6" = 1'-0"

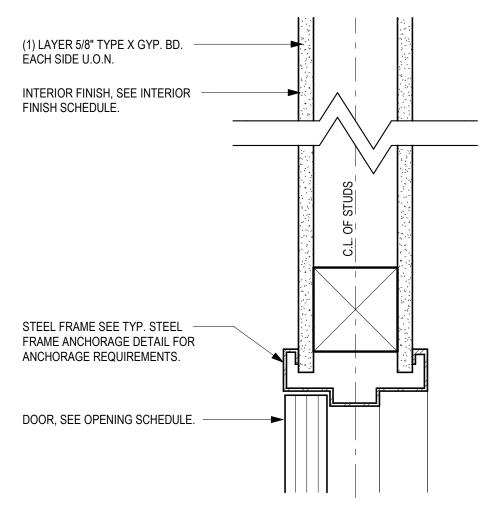


INTERIOR STEEL FRAME HEAD AND JAMB SCALE: 3" = 1'-0"

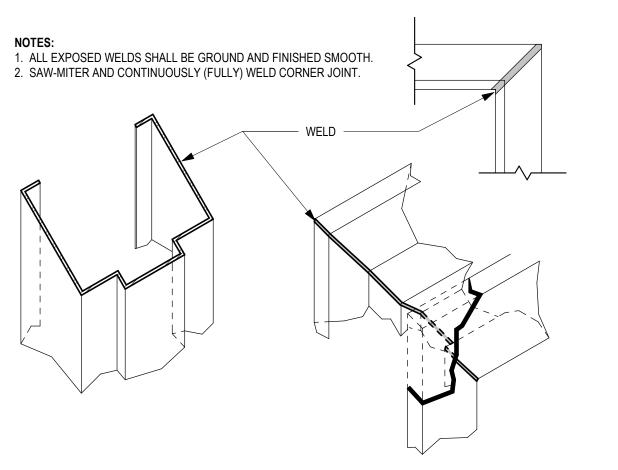


TYP. WELDING @ STEEL FRAME CORNER
SCALE: 1: 1

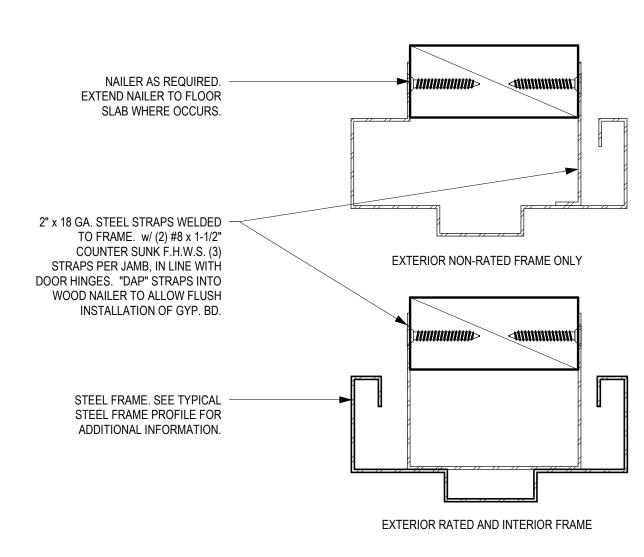

7 TYPICAL STEEL FRAME ANCHORAGE SCALE: 6" = 1'-0"

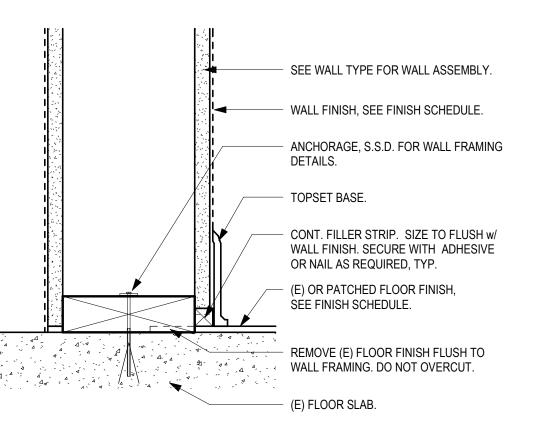

8 INTERIOR WALL BASE SCALE: 3" = 1'-0"

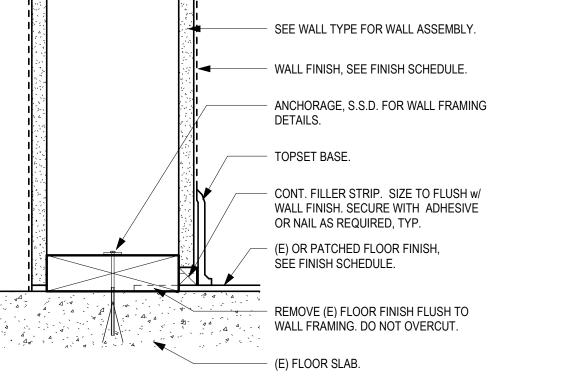

4 FLOORING TRANSITION SCALE: 6" = 1'-0"

DOOR SHOWN DASHED,

(E) FOUNDATION, SEE PLAN.

BURKE MERCER, REDUCER

#140, OR APPROVED EQUAL.

COORDINATE PRODUCT TO

RESILIENT FLOORING.

DOOR SHOWN DASHED, WHERE OCCCURS

(E) FOUNDATION, SEE PLAN.

BURKE MERCER, MONO EDGE #230, OR APPROVED EQUAL.

COMPRESS CARPET 1/4" — MAX. BELOW THRESHOLD.

VERIFIED FLOORING THICKNESS

RESILIENT FLOORING TRANSITION

WHERE OCCCURS

IDENTIFICATION STAMP DIV. OF THE STATE ARCHITEC APP: 01-119554 INC: REVIEWED FOR SS 🗹 FLS 🗹 ACS 🗹 DATE: 09/21/2021

architects

www.aedisarchitects.com 387 S. 1st Street, Suite 300 San Jose, CA 95113 tel: (408)-300-5160 fax: (408)-300-5121

PROJECT **MEADOW HEIGHTS ELEMENTARY**

SCHOOL - HVAC

REPLACEMENT

SCHOOL DISTRICT

SAN MATEO-FOSTER CITY

CONSULTANT

DSA FILE NUMBER APPL# 01-119554

REVISIONS No. Description Date

MILESTONES

DD 90% CD DSA SUB 06/02/2021 BACKCHECK 09/22/2021

FINISH SCHEDULE, SCHEDULE, **OPENING** SCHEDULE, LEGENDS, &

DETAILS

09/17/2021 JOB# 2021005.04

SHEET# A11.01 A. THE STRUCTURAL DRAWINGS AND PROJECT SPECIFICATIONS REPRESENT THE FINISHED STRUCTURE. THE MEANS, METHODS, PROCEDURES AND SEQUENCE OF CONSTRUCTION ARE THE RESPONSIBILITY OF THE CONTRACTOR. THE CONTRACTOR SHALL TAKE ALL NECESSARY PRECAUTIONS TO MAINTAIN AND ENSURE THE INTEGRITY OF THE STRUCTURE AT ALL STAGES OF CONSTRUCTION.

B. DURING THE CONSTRUCTION PERIOD, THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE SAFETY OF PERSONNEL AND PROPERTY ON AND AROUND THE JOBSITE. THE CONTRACTOR SHALL PROVIDE SHORING, BRACING, GUYS, ETC. IN ACCORDANCE WITH ALL LOCAL, STATE, AND NATIONAL STANDARDS.

C. ALL CONSTRUCTION, TESTING, AND INSPECTIONS SHALL CONFORM TO THE BUILDING CODE REFERENCED UNDER THE HEADING "BASIS OF DESIGN" BELOW.

D. STANDARDS REFERENCED IN THESE DRAWINGS SHALL BE THE LATEST EDITION, UNLESS OTHERWISE NOTED.

E. SEE DRAWINGS OTHER THAN STRUCTURAL FOR: FLOOR FINISHES; DEPRESSIONS IN FLOOR SLABS: OPENINGS IN WALLS AND FLOORS REQUIRED BY ARCHITECTURAL AND MEP FEATURES: EXTERIOR PAVING; CURBS; SLOPES; DRAINS; PADS; NON-STRUCTURAL PARTITIONS; EMBEDDED ITEMS; ETC. COORDINATE THESE ITEMS WITH THE STRUCTURAL DRAWINGS.

F. THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS AT THE JOB SITE BEFORE COMMENCING WORK AND SHALL REPORT ANY DISCREPANCIES TO THE ARCHITECT.

G. OMISSIONS OR DISCREPANCIES BETWEEN THE VARIOUS ELEMENTS OF THE CONTRACT DOCUMENTS SHALL BE BROUGHT TO THE ATTENTION OF THE ARCHITECT AND STRUCTURAL ENGINEER AND RESOLVED BEFORE PROCEEDING WITH THE WORK.

H. DO NOT SCALE THE DRAWINGS; USE WRITTEN DIMENSIONS ONLY. WHERE NO DIMENSIONS ARE PROVIDED OR WHERE DIMENSIONS PROVIDED CONFLICT WITH OTHER DRAWINGS. CONSULT THE ARCHITECT AND SEOR BEFORE PROCEEDING WITH THE WORK.

I. WHERE MEMBER LOCATIONS ARE NOT DIMENSIONED, MEMBERS SHALL BE LOCATED ON COLUMN LINES OR EQUALLY SPACED BETWEEN MEMBERS ON COLUMN LINES OR BETWEEN MEMBERS OTHERWISE LOCATED. CENTERLINES OF COLUMNS, WALLS, FRAMING MEMBERS, AND FOUNDATIONS COINCIDE WITH GRIDLINES, UNLESS OTHERWISE NOTED.

J. TYPICAL DETAILS ARE INTENDED TO APPLY TO APPLICABLE SITUATIONS, UNLESS OTHERWISE NOTED. TYPICAL DETAILS MAY NOT BE SPECIFICALLY LOCATED.

K. DETAILS SHALL BE APPLIED TO EVERY LIKE CONDITION WHETHER OR NOT THEY ARE REFERENCED IN EVERY INSTANCE. FOR CONDITIONS NOT SPECIFICALLY SHOWN, USE DETAILS SIMILAR TO THOSE PROVIDED.

I. THE CONTRACTOR SHALL VERIFY THAT CONSTRUCTION LOADS DO NOT EXCEED THE CAPACITY OF THE STRUCTURE AT THE TIME THE LOADS ARE PLACED

II. EXISTING CONSTRUCTION

A. WORK SHOWN IS NEW UNLESS OTHERWISE NOTED AS EXISTING, (E).

B. EXISTING CONSTRUCTION SHOWN IN THESE DRAWINGS WAS OBTAINED FROM AS-BUILT DRAWINGS AND INDICATED FOR REFERENCE ONLY. THE CONTRACTOR SHALL VERIFY ALL EXISTING CONDITIONS. REVIEW ALL AVAILABLE EXISTING DRAWINGS AND VERIFY DIMENSIONS PRIOR TO CONSTRUCTION. THE CONTRACTOR SHALL NOTIFY THE ARCHITECT AND SEOR OF ALL DISCREPANCIES AND EXCEPTIONS BEFORE PROCEEDING WITH THE WORK.

C. THE REMOVAL, CUTTING, DRILLING, ETC. OF EXISTING WORK SHALL BE PERFORMED WITH GREAT CARE AND SMALL TOOLS IN ORDER TO MAINTAIN THE STRUCTURAL INTEGRITY OF THE BUILDING. IF EXISTING STRUCTURAL MEMBERS NOT INDICATED FOR REMOVAL INTERFERE WITH THE NEW WORK, THE SEOR SHALL BE NOTIFIED IMMEDIATELY. APPROVAL SHALL BE OBTAINED PRIOR TO REMOVAL OF THE EXISTING MEMBERS.

D. THE CONTRACTOR SHALL SAFELY SHORE EXISTING CONSTRUCTION WHEREVER EXISTING SUPPORTS ARE REMOVED TO ALLOW INSTALLATION OF THE NEW WORK. THE EXISTING CONSTRUCTION SHALL BE CONNECTED AND/OR EMBEDDED INTO THE NEW CONSTRUCTION AS SHOWN OR SPECIFIED.

E. ALL SHORING METHODS AND SEQUENCING OF DEMOLITION SHALL BE SPECIFIED BY A LICENSED CIVIL OR STRUCTURAL ENGINEERING IN THE STATE OF CALIFORNIA TO BE RETAINED BY THE CONTRACTOR. SEE SPECIFICATIONS FOR DETAILED REQUIREMENTS.

F. THE CONTRACTOR SHALL VERIFY THE LOCATION OF EXISTING UTILITIES BEFORE BEGINNING WORK. SPECIAL CARE SHALL BE TAKEN TO PROTECT UTILITIES THAT ARE TO REMAIN IN SERVICE DURING CONSTRUCTION.

G. THE CONTRACTOR SHALL PROMPTLY REPAIR DAMAGE CAUSED DURING OPERATIONS WITH SIMILAR MATERIALS AND WORKMANSHIP.

H. THE CONTRACTOR SHALL LOCATE EXISTING REINFORCING STEEL WHERE EXISTING CONCRETE IS TO BE CUT, CORED OR SAWN. LOCATION SHALL BE DONE USING A NON-DESTRUCTIVE METHOD. DO NOT DAMAGE EXISTING REINFORCING WITHOUT NOTIFYING THE ARCHITECT AND SEOR.

III. BASIS OF DESIGN (BUILDING D)

A. THE STRUCTURAL DESIGN OF THIS PROJECT IS GOVERNED BY THE 2019 CALIFORNIA BUILDING CODE (CBC) WITH SS/DSA AMMENDMENTS.

B. RISK CATEGORY = III

D. LIVE LOADS: 1. ROOF = 20 PSF

E. WIND DESIGN DATA: 1. BASIC WIND SPEED = 100 mph (3 SECOND GUST)

2. EXPOSURE CATEGORY = C F. SEISMIC DESIGN DATA:

1. I = 1.25 2. Fa = 1.2

3. Fv = N/A4. Ss = 2.016

5. S1 = 0.833 6. SDS = 1.613

7. SD1 = N/A 8. SITE CLASS = D (DEFAULT) 9. SEISMIC DESIGN CATEGORY = D

IV. CONCRETE

A. MIXING, BATCHING, TRANSPORTING AND PLACING OF ALL CONCRETE SHALL CONFORM TO ACI 301, SPECIFICATION FOR STRUCTURAL CONCRETE FOR BUILDINGS.

B. ALL CONCRETE SHALL BE THOROUGHLY CONSOLIDATED.

C. THE SCHEDULE BELOW INDICATES THE MINIMUM CONCRETE DESIGN MIX REQUIREMENTS. SEE THE SPECIFICATIONS FOR ADDITIONAL CONCRETE PROPERTIES.

<u>TYPE</u>	LOCATION	MINIMUM 28-DAY STRENGTH	MAXIMUM WEIGHT	MAX W/C RATIO
		<u>(PSI)</u>	(PCF)	
Α	SLAB ON GRADE	3000	150	0.5

D. CONCRETE CLEAR COVER OVER MILD REINFORCING STEEL SHALL BE AS FOLLOWS, UNLESS OTHERWISE NOTED:

1. CONCRETE CAST AGAINST AND PERMANENTLY EXPOSED TO EARTH = 3" 2. CONCRETE EXPOSED TO EARTH OR WEATHER:

a. NO. 5 BARS AND SMALLER = 1-1/2" b. NO. 6 BARS AND LARGER = 2"

3. CONCRETE NOT EXPOSED TO WEATHER OR IN CONTACT WITH GROUND: a. SLABS, WALLS, JOISTS:

4. NO. 11 BARS AND SMALLER = 3/4"

5. NO. 14 BARS AND LARGER = 1-1/2" a. BEAMS. COLUMNS:

6 0

6. PRIMARY REINFORCEMENT, TIES, STIRRUPS, SPIRALS = 1-1/2"

a. SHELLS, FOLDED PLATE MEMBERS: 7. NO. 5 BARS AND SMALLER = 1/2"

8. NO. 6 BARS AND LARGER = 3/4"

E. NON-SHRINK GROUT SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 6000 PSI AT 28 DAYS.

F. CONSTRUCTION JOINTS

1. NO HORIZONTAL CONSTRUCTION JOINTS ARE PERMITTED IN BEAMS, WALLS OR SLABS UNLESS APPROVED BY THE SEOR IN WRITING. 2. ALL CONSTRUCTION JOINTS SHALL BE CONSTRUCTED IN ACCORDANCE WITH TYPICAL

CONSTRUCTION JOINT DETAILS. 3. ALL CONSTRUCTION JOINT LOCATIONS SHALL BE COORDINATED AND CONSTRUCTED IN ACCORDANCE WITH ARCHITECTURAL FINISHES AND TREATMENTS. 4. ALL SURFACES OF CONSTRUCTION JOINTS SHALL BE CLEANED TO REMOVE DUST, CHIPS

G. BATCH PLANT INSPECTION OF CONCRETE IS WAIVED IN COMPLIANCE WITH CBC SECTION 1705A.3.3.2. SEE SPECIFICATIONS FOR REQUIRED CERTIFICATION OF CEMENT AND REINFORCING, TAKING AND SAMPLING OF STRENGTH TEST, AND PROVISION OF

OR OTHER FOREIGN MATTER PRIOR TO PLACING ADJACENT CONCRETE.

V. REINFORCING STEEL

WEIGHMASTER'S BATCH TICKETS.

A. ALL REINFORCING BARS SHALL BE DEFORMED BARS CONFORMING TO THE REQUIREMENTS OF ASTM A615 AND ASTM A706 WHERE REQUIRED; ALL BARS TO BE GRADE 60 UNLESS OTHERWISE NOTED.

B. REINFORCING BARS TO BE WELDED SHALL BE ASTM A706.

C. WELDED WIRE REINFORCING SHALL BE ASTM A185.

D. WELDED BAR ANCHORS SHALL BE NELSON D2L DEFORMED BAR ANCHORS PER ICC-ES ESR-5217.

E. DETAIL REINFORCING STEEL BASED ON THE PROJECT REQUIREMENTS, ACI 318, AND ACI 315.

F. TERMINATION OF REINFORCEMENT:

1. TERMINATE ALL BARS IN LAPS, 90 DEGREE BENDS OR WITH DOWELS EPOXIED INTO EXISTING CONCRETE. 2. PROVIDE DOWELS INTO FOOTINGS BELOW AND SLABS ABOVE AT WALLS AND COLUMNS

G. WHERE A 90 DEGREE, 135 DEGREE OR 180 DEGREE HOOK IS GRAPHICALLY INDICATED. PROVIDE CORRESPONDING ACI STANDARD HOOK PER DETAIL 2&3/S5.01.

H. SPLICES

1. LAP REINFORCING STEEL AS SPECIFICALLY DETAILED ON THE DRAWINGS. SEE REBAR OFFSET AND LAP SPLICE SCHEDULE IN DETAIL 7/S5.01.

2. UNLESS OTHERWISE NOTED, ALL LAP SPLICES ARE TO BE CLASS B. 3. MECHANICAL SPLICES, IF USED AT CONTRACTOR'S OPTION, SHALL BE ICC-ES APPROVED AND CAPABLE OF DEVELOPING 125% OF THE SPECIFIED MINIMUM YIELD STRENGTH OF THE BAR IN TENSION OR COMPRESSION.

4. LOCATE LAPS IN REINFORCING STEEL AS FOLLOWS: a. TOP HORIZONTAL REINFORCEMENT IN BEAMS AND WALLS AT SUPPORTS.

OF SAME SIZE AND SPACING AS VERTICAL REINFORCEMENT.

b. BOTTOM HORIZONTAL REINFORCEMENT IN BEAMS AND WALLS AT MIDSPAN. c. VERTICAL REINFORCEMENT AT INSIDE FACE OF WALL AT SUPPORTS. d. VERTICAL REINFORCEMENT AT OUTSIDE FACE OF WALL AT MIDHEIGHT OF WALL.

VI. WOOD

A. ALL WOOD FRAMING SHALL CONFORM TO NATIONAL DESIGN SPECIFICATIONS (NDS) FOR WOOD CONSTRUCTION AND APA PDS, PLYWOOD DESIGN SPECIFICATION.

B. ALL WOOD FRAMING SHALL BE DOUGLAS FIR LARCH, UNLESS OTHERWISE NOTED, GRADE SHALL BE AS FOLLOWS:

1. WALL STUDS = NO 2 2. SILL PLATES = PRESSURE TREATED

THE ARCHITECT OR SEOR.

3. BLOCKING AND MISCELLANEOUS = NO 2 C. REJECTION OF WOOD MEMBERS: THE PROVISION IN DOC PS 20 (AS REFERENCED BY CBC 2303.1.1) WHICH PERMITS FIVE PERCENT OF THE MATERIAL TO FALL BELOW GRADE SHALL NOT BE CONSTRUED TO PERMIT BELOW-GRADE MATERIAL TO BE USED AS LOAD-CARRYING

MEMBERS WHICH HAVE BEEN DESIGNED FOR SPECIFIC ALLOWABLE STRESSES AND

FOR LOAD-CARRYING USE. WOOD MEMBERS WHICH ARE REQUIRED TO CARRY DESIGN LOADS AND WHICH THE PROJECT ARCHITECT, SEOR OR INSPECTOR JUDGE TO BE MISGRADED SHALL BE REINSPECTED BY A QUALIFIED LUMBER GRADING INSPECTOR TO VERIFY THE PROPER GRADING OF THE MATERIAL. WOOD MEMBERS WHICH HAVE PERMISSIBLE GRADE CHARACTERISTICS OR DEFECTS IN SUCH COMBINATION AS TO AFFECT THE SERVICEABILITY OF THE MEMBER SHALL BE REJECTED BY THE PROJECT INSPECTOR WITH THE CONCURRENCE OF

ACCEPTABLE SAFETY FACTORS. MATERIALS WHICH FALL BELOW GRADE SHALL BE REJECTED

D. ALL LUMBER IN CONTACT WITH CONCRETE OR CONCRETE MASONRY 0'-8" OR LESS ABOVE THE GROUND SHALL BE PRESSURE TREATED.

E. MAXIMUM MOISTURE CONTENT SHALL BE 15%AT TIME OF FRAMING FOR NEW WOOD MEMBERS ADJACENT TO EXISTING WOOD MEMBERS. ALL OTHER MEMBERS SHALL HAVE A MAXIMUM MOISTURE CONTENT OF 19% AT TIME OF FRAMING. REFER TO ARCHITECTURAL DRAWINGS, PROJECT SPECIFICATIONS AND CLADDING MANUFACTURERS' INFORMATION FOR MORE STRINGENT MOISTURE CONTENT REQUIREMENTS.

F. WOOD CONNECTORS SHALL BE AS MANUFACTURED BY SIMPSON STRONG TIE OR EQUAL PRODUCT IF APPROVED BY SEOR. SIMPSON DESIGNATIONS USED IN THESE DRAWINGS.

G. NAILS SHALL BE COMMON WIRE GAGE, UNLESS OTHERWISE NOTED AND CONFORM TO CBC TABLE 2304.10.1. USE OF MACHINE NAILING IS SUBJECT TO A SATISFACTORY JOBSITE DEMONSTRATION FOR EACH PROJECT AND THE APPROVAL OF THE PROJECT ARCHITECT STRUCTURAL ENGINEER AND DSA.

H. LAG BOLTS AND UNFINISHED MACHINE BOLTS SHALL CONFORM TO ASTM A307. PROVIDE WASHERS UNDER THE HEADS AND NUTS OF ALL BOLTS AND LAG SCREWS BEARING ON WOOD.

I. ANCHOR RODS SHALL CONFORM TO ASTM F1554 GR 36.

J. FASTENERS INSTALLED IN PRESSURE TREATED OR FIRE RETARDANT TREATED WOOD SHALL BE GALVANIZED.

K. PROVIDE LATERAL SUPPORT FOR BEAMS, JOISTS, AND RAFTERS PER CBC SECTION 2308.8.5.

VII. POST-INSTALLED ANCHORS

A. POST-INSTALLED ANCHORS INCLUDE EXPANSION ANCHORS, EPOXY ANCHORS AND REINFORCING STEEL DOWELS, SCREW ANCHORS AND POWDER-ACTUATED FASTENERS. AS DETAILED IN THE DRAWINGS.

B. DO NOT DAMAGE OR CUT EXISTING REINFORCING STEEL WHILE INSTALLING POST-INSTALLED ANCHORS. NOTIFY SEOR IF EXISTING REINFORCING STEEL INTERFERES WITH INSTALLATION OF POST-INSTALLED ANCHORS.

C. ALL MIS-DRILLED OR UNACCEPTABLE HOLES SHALL NOT BE USED AND SHALL BE GROUTED SOLID.

D. ALL POST-INSTALLED ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH APPLICABLE ICC-ES REPORT AND MANUFACTURER'S RECOMMENDATIONS.

E. PROVIDE SPECIAL INSPECTION FOR THE INSTALLATION OF ALL POST-INSTALLED ANCHORS, UNLESS OTHERWISE NOTED.

F. FIELD TEST POST-INSTALLED ANCHORS, UNLESS OTHERWISE NOTED. FIELD TESTING SHALL BE IN COMPLIANCE WITH THE FOLLOWING: 1. 10% OF POST-INSTALLED ANCHORS USED FOR SILL PLATE BOLTING SHALL BE TESTED;

100% OF ALL OTHER POST-INSTALLED ANCHORS USED FOR STRUTURAL APPLICATIONS SHALL BE TESTED. 2. 50% OF POST-INSTALLED ANCHORS USED FOR NON-STRUCTURAL APPLICATIONS SHALL BE TESTED, INCLUDING ONE HALF OF ALL ANCHORS IN EACH GROUP.

a. IF ANY ANCHOR FAILS TESTING, ALL ANCHORS OF THE SAME TYPE THAT ARE UNTESTED SHALL BE TESTED UNTIL 20 CONSECUTIVE ANCHORS PASS b. NO TESTING REQUIRED FOR POWDER-ACTUATED FASTENERS USED TO ATTACH TRACKS OF INTERIOR, NON-STRUCTURAL PARTITION WALLS WHERE THERE ARE AT LEAST THREE FASTENERS PER PIECE OF TRACK.

3. NO TESTING REQUIRED OF REINFORCING STEEL DOWELS ACROSS COLD JOINTS IN CONCRETE SLABS ON GRADE. 4. TORQUE TESTING MAY BE USED FOR TORQUE CONTROLLED POST-INSTALLED ANCHORS: TENSION TEST ALL OTHER POST-INSTALLED ANCHORS

5. TORQUE TESTING SHALL BE IN ACCORDANCE WITH CBC SECTION 1910A.5.5.2. 6. TENSION TESTING SHALL BE IN ACCORDANCE WITH CBC SECTION 1910A.5.5.1. 7. ALL FIELD TESTING SHALL BE DONE UNDER THE OBSERVATION OF THE PROJECT

8. TESTING SHALL OCCUR AT LEAST 24 HOURS AFTER THE ANCHOR HAS BEEN INSTALLED.

G. EPOXY ANCHORS AND REINFORCING STEEL DOWELS

1. FOR INSTALLATION IN CONCRETE, EPOXY SHALL BE ONE OF THE FOLLOWING: a. SET-XP PER ICC-ES ESR-2508 AS MANUFACTURED BY SIMPSON STRONG TIE b. HIT-RE 500-SD PER ICC-ES ESR-2322 AS MANUFACTURED BY HILTI, INC.

c. HY-200 MAX-SD PER ICC-ES ESR-2013 AS MANUFACTURED BY HILTI, INC. 2. FOR INSTALLATION IN FULLY-GROUTED MASONRY, EPOXY SHALL BE ONE OF THE FOLLOWING:

a. SET-HIGH STRENGTH PER ICC-ES ESR-2508 AS MANUFACTURED BY SIMPSON STRONG TIE.

b. HY-150 PER ICC-ES ESR-1967 AS MANUFACTURED BY HILTI, INC. 3. EPOXIED ANCHOR RODS SHALL BE CARBON STEEL THREADED RODS PER APPROPRIATE ICC-ES REPORT; EPOXIED REINFORCING STEEL DOWELS SHALL BE ASTM A615 GR 60 UNLESS OTHERWISE NOTED. MINIMUM ANCHOR EMBEDMENT AND TENSION TEST VALUES ARE AS FOLLOWS:

EPOXY ANCHORS IN NORMAL-WEIGHT CONCRETE (f'c = 3000 PSI MIN)									
THREADED ROD	EMPED (INI)	TENSION TEST VAL	TENSION TEST VALUE (LBS)						
DIAMETER (IN)	EMBED (IN)	HY-200 MAX-SD	HIT-RE 500-SD	SET-XP					
3/8	3	3360	3510	3620					
1/2	4	6010	6150	5690					
5/8	5	9440	9330	7640					
3/4	6	7120	12860	9770					
7/8	7	15750	13620	12250					
1	8	20670	16440	15430					
1 1/4	10	32500	22060	24100					

ANCHORS SHALL NOT BE INSTALLED INTO CONCRETE THAT IS LESS THAN 21 DAYS OLD.

H. EXPANSION ANCHORS

1. FOR INSTALLATION IN CONCRETE, EXPANSION ANCHORS SHALL BE ONE OF THE FOLLOWING:

a. STRONG BOLT 2 PER ICC-ES ESR-3037 AS MANUFACTURED BY SIMPSON STRONG TIE b. KWIK BOLT TZ2 PER ICC-ES ESR-4266 AS MANUFACTURED BY HILTI, INC. 2. USE STAINLESS STEEL AT EXTERIOR, WEATHER-EXPOSED OR DAMP LOCATIONS; CARBON STEEL EXPANSION ANCHORS MAY BE USED AT ALL OTHER LOCATION, UNLESS OTHERWISE NOTED.

3. MINIMUM ANCHOR EMBEDMENT AND TORQUE TEST VALUES ARE AS FOLLOWS:

Z2 IN NORMAL WE	IGHT CONCRETE (f'c =	= 3000 PSI MIN)
EMBED (IN)	MINIMUM HOLE	TORQUE TEST
	DEPTH (IN)	VALUE (FT-LBS)
2 5/16	2 5/8	30
2 3/8	2 5/8	50
4 1/16	4 3/4	60
5 9/16	5 3/4	125
	EMBED (IN) 2 5/16 2 3/8 4 1/16	DEPTH (IN) 2 5/16 2 5/8 2 3/8 2 1/16 4 1/16 4 3/4

STRONG BOLT 2 IN NORMAL WEIGHT CONCRETE (f'c = 3000 PSI MIN)									
ANCHOR DIAMETER	EMBED (IN)	MINIMUM HOLE	TORQUE TEST						
(IN)		DEPTH (IN)	VALUE (FT-LBS)						
3/8	1 7/8	2	30						
1/2	2 3/4	3	60						
5/8	5 3/8	5 3/8	90						
3/4	5 1/4	6	150						

4. WHERE EXPANSION ANCHORS ARE INSTALLED IN CONTACT WITH WOOD FRAMING. PROVIDE AN OVERSIZE WASHER IN ORDER TO ACHIEVE TORQUE REQUIRED BY ICC-ES REPORT. USE 1/4"x3"x3" WASHER, MINIMUM. 5. CONTRACTOR SHALL PROVIDE ANCHORS WITH SUFFICIENT TOTAL LENGTH FOR THE SPECIFIED EMBEDMENT LENGTH, THICKNESS OF FASTENED PART, WASHER

I. SCREW ANCHORS

AND NUT.

1. FOR INSTALLATION IN CONCRETE, SCREW ANCHORS SHALL BE ONE OF

THE FOLLOWING: a. TITEN HD PER ICC-ES ESR-2713 AS MANUFACTURED BY SIMPSON STRONG TIE. b. KWIK HUS-EZ PER ICC-ES ESR-3027 AS MANUFACTURED BY HILTI. INC. 2. MINIMUM ANCHOR EMBEDMENT AND TENSION TEST VALUES ARE AS FOLLOWS:

TITEN HD IN NORMAL WEIGHT CONCRETE (f'c = 3000 PSI MIN)							
ANCHOR DIAMETER	EMBED (IN)	MINIMUM HOLE	TENSION TEST				
(IN)	,	DEPTH (IN)	VALUE (FT-LBS)				
3/8	2 1/2	3	1200				
1/2	3 1/4	3 3/4	2973				
5/8	4	4 1/2	3935				
3/4	5 1/2	6	5895				

ANCHOR DIAMETER		EMBED (IN)	MINIMUM HOLE	TENSION TEST	
(IN)			DEPTH (IN)	VALUE (FT-LBS	
1	/4	2 1/2	2 7/8	1133	
3	/8	2 1/2	2 3/4	2093	
1	/2	2 1/4	2 5/8	1547	
5	/8	3 1/4	3 5/8	3049	
3	/4	4	4 3/8	4118	

J. POWDER-ACTUATED FASTENERS PAF SHALL BE ONE OF THE FOLLOWING:

a. SIMPSON STRONG TIE POWDER-ACTUATED FASTENERS PER ICC-ES ESR-2138 FOR ANCHORAGE OF METAL TO CONCRETE, MASONRY OR STEEL b. HILTI, INC. X-U PER ICC-ES ESR-2269 FOR ANCHORAGE OF METAL TO CONCRETE,

MASONRY OR STEEL c. HILTI, INC. X-CP 72 PER ICC-ES ESR-2379 FOR ANCHORAGE OF SILL PLATES TO CONCRETE d. DEWALT POWDER-ACTUATED FASTENERS PER ICC-ES ESR-2024 FOR ANCHORAGE OF

METAL TO CONCRETE, MASONRY OR STEEL AND ANCHORAGE OF WOOD SILLS TO

CONCRETE. 2. PROVIDE 0.08"x1.1"x1.1" SQUARE OR 0.08"x1.425" DIAMETER ROUND WASHER AT EACH PAF. 3. MINIMUM PAF EMBED INTO CONCRETE SHALL BE 1", UNLESS OTHERWISE NOTED. 4. MINIMUM PAF EMBED INTO STEEL SHALL BE PER MANUFACTURER.

ABBREVIATION

ABBREVIATION	DESCRIPTION	ABBREVIATION	DESCRIPTION
E)	EXISTING	LLV	LONG LEG VERTICAL
N)	NEW	LOC	LOCATION
ΛB	ANCHOR BOLT	LONG	LONGITUDINAL
ADDL	ADDITIONAL	LW	LIGHTWEIGHT
ALT	ALTERNATE	LWC	LIGHTWEIGHT CONCRETE
APPRX	APPROXIMATE	MATL	MATERIAL
AR	ANCHOR ROD	MAX	MAXIMUM
ARCH	ARCHITECT OR ARCHITECTURAL	MB	UNFINISHED MACHINE BOLT
AVG	AVERAGE	MECH	MECHANICAL
BLDG	BUILDING	MEP	MECHANICAL, ELECTRICAL, PLUMBING, FIRE PROTECTION
LKG	BLOCKING	MEZZ	MEZZANINE
SM CT	BEAM	MFR	MANUFACTURER
BOT	BOTTOM	MID	MIDDLE
RDG	BRIDGING	MIN	MINIMUM
TWN	BETWEEN	MISC	MISCELLANEOUS
IP	CAST-IN-PLACE	MTL	METAL
;J	CONTROL/CONSTRUCTION JOINT	N/A	NOT APPLICABLE
JP	COMPLETE JOINT PENETRATION	NIC	NOT IN CONTRACT
L	CENTER LINE	NO	NUMBER
ELR	CLEAR OR CLEARANCE	NOM	NOMINAL
OL	CONCRETE	NS	NEAR SIDE
ONC	CONCRETE	NTS	NOT TO SCALE
ONN	CONNECTION(S)	NW	NORMAL WEIGHT
ONST	CONSTRUCTION	NWC	NORMALWEIGHT CONCRETE
ONT TR	CONTINUOUS CENTER	OC	ON CENTER
TRD	CENTERED	OD	OUTSIDE DIAMETER
TRSK	COUNTERSINK	OF	OUTSIDE FACE
b	DIAMETER OF BOLT OR REBAR	OH	OPPOSITE HAND
BL	DOUBLE DOUBLE	OPNG(S)	OPENING(S)
EMO	DEMOLISH	OPP	OPPOSITE
ET	DETAIL	OSB	ORIENTED STRAND BOARD
)E F	DOUGLAS FIR	PAF	POWDER ACTUATED FASTENE
IA	DIAMETER	PERP	PERPENDICULAR
IIA IIAG	DIAGONAL	PL	PLATE
IM(S)	DIMENSION(S)	PLY	PLYWOOD
)L	DEAD LOAD	PSF	POUNDS PER SQUARE FOOT
WG(S)	DRAWING(S)	PSI	POUNDS PER SQUARE INCH
WL	DOWEL(S)	PSL	PARALLEL STRAND LUMBER
A	EACH	RAD	RADIUS
CC	ECCENTRICITY	REF	REFERENCE
F	EACH FACE	REINF	REINFORCE(D) (ING) OR (MENT
J	EXPANSION JOINT	REQD	REQUIRED
iL	ELEVATION	REV	REVISION
ELEC	ELECTRICAL	RWD	REDWOOD
MBED	EMBEDMENT	SAD	SEE ARCHITECTURAL DRAWING
:N	EDGE NAIL	SCD	SEE CIVIL DRAWINGS
:NGR	ENGINEER	SCHED	SCHEDULE(D)
EOS	EDGE OF SLAB	SECT	SECTION
:Q	EQUAL	SEOR	STRUCTURAL ENGINEER OF
QUIP	EQUIPMENT		RECORD
S	EACH SIDE	SF	SQUARE FOOT (FEET)
W	EACH WAY	SHT	SHEET
XP	EXPANSION	SIM	SIMILAR
XT	EXTERIOR	SLRS	SEISMIC LOAD RESISTING
F	FINISH FLOOR		SYSTEM
IN	FINISH(ED)	SMD	SEE MECHANICAL DRAWINGS
LR	FLOOR	SMS	SHEET METAL SCREW(S)
N	FIELD NAILING	SOG	SLAB ON GRADE
ND	FOUNDATION	SP SPECION	SPACE
0	FACE OF	SPEC(S)	SPECIFICATION(S)
RM'G	FRAMING	SQ	SQUARE
S	FAR SIDE	STAGG'D	STAGGERED
TG	FOOTING	STD	STANDARD
6A	GAGE, GAUGE	STIFF	STIFFENER
ALV	GALVANIZED	STL	STEEL
iB	GRADE BEAM	STR	STRUCTURE
EN	GENERAL	STRCTL	STRUCTURAL
SLB	GLUE-LAMINATED BEAM	SYMM	SYMMETRICAL
iR	GRADE	T&B	TOP AND BOTTOM
YP	GYPSUM	T&G	TONGUE AND GROOVE
D	HOLDOWN	TD	TIE DOWN
DR	HEADER	TEMP	TEMPERATURE OR TEMPORAR
GR	HANGER	THK	THICK OR THICKNESS
K	HOOK	THRD'D	THREADED
ORIZ	HORIZONTAL	TO	TOP OF
T	HEIGHT	TRANSV	TRANSVERSE
VAC	HEATING VENTING AND AIR	TYP	TYPICAL
	CONDITIONING	UON	UNLESS OTHERWISE NOTED
)	INSIDE DIAMETER	VERT	VERTICAL
=	INSIDE FACE	VIF	VERIFY IN FIELD
NFO	INFORMATION	W/	WITH
NT	INTERIOR	W/O	WITHOUT
H	JOIST HANGER	WD	WOOD
ST(S)	JOIST(S)	WF	WIDE FLANGE
Τ	JOINT	WP	WORK POINT
BS	POUNDS	WT	WEIGHT
L	LIVE LOAD	WWR	WELDED WIRE REINFORCEMEN
_	· - · · -		
- LH	LONG LEG HORIZONTAL		

IDENTIFICATION STAMP DIV. OF THE STATE ARCHITEC APP: 01-119554 INC: REVIEWED FOR SS 🗹 FLS 🗹 ACS 🗹 DATE: 09/21/2021

architects

tel: (408)-300-5160

ELEMENTARY

SCHOOL - HVAC

REPLACEMENT

fax: (408)-300-5121 PROJECT **MEADOW HEIGHTS**

www.aedisarchitects.com

387 S. 1st Street, Suite 300

San Jose, CA 95113

SAN MATEO-FOSTER CITY

CONSULTANT

Office:(415) 466-2997 www.BASEdesigninc.com

SCHOOL DISTRICT

SAN FRANCISCO, CA 94104

STATE 41-26 DSA FILE NUMBER 01-119554

REVISIONS No. Description Date

DD 90% CD DSA SUB 06/02/2021

09/22/2021


BACKCHECK

MILESTONES

ABBREVIATIONS AND GENERAL

09/17/2021 ^{JOB#}2021005.04

SHEET#

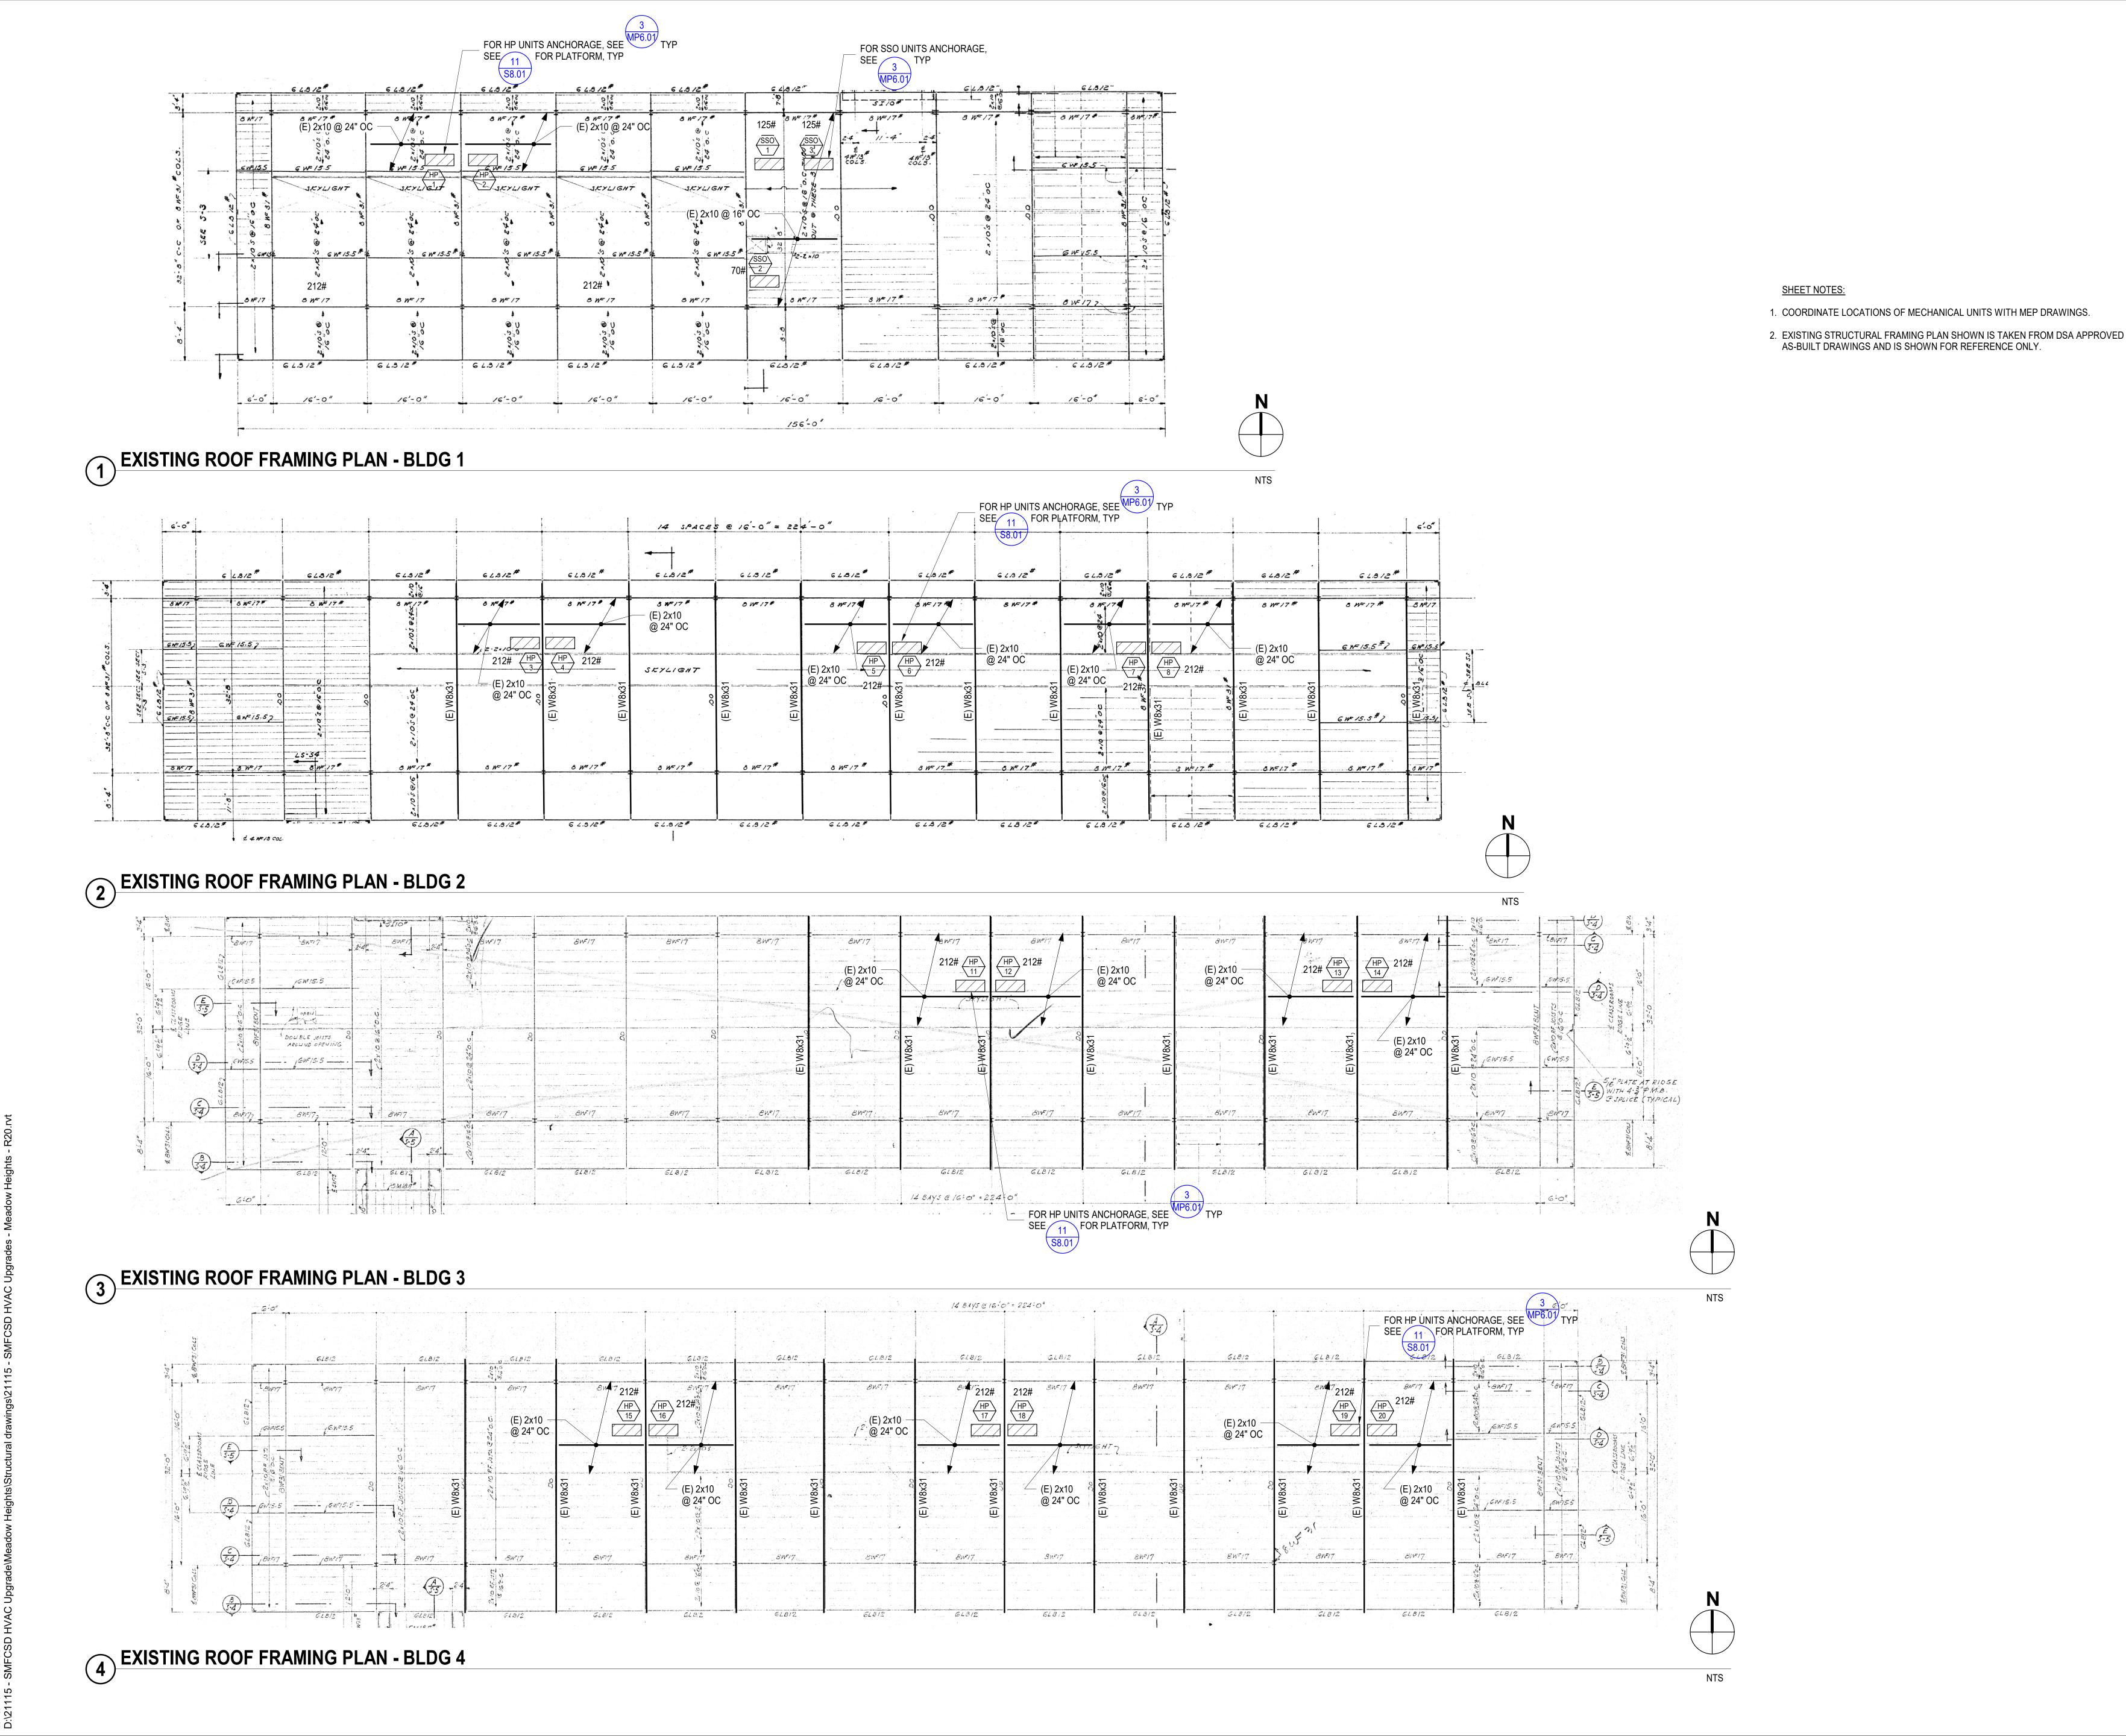

IDENTIFICATION STAMP DIV. OF THE STATE ARCHITECT

APP: 01-119554 INC:

REVIEWED FOR

SS FLS ACS D

DATE: 09/21/2021

aedis

www.aedisarchitects.com
387 S. 1st Street, Suite 300
San Jose, CA 95113
tel: (408)-300-5160
fax: (408)-300-5121

PROJECT

MEADOW HEIGHTS ELEMENTARY SCHOOL - HVAC REPLACEMENT

SAN MATEO-FOSTER CITY SCHOOL DISTRICT

CONSULTANT

BASE DESIGN 582 MARKET ST. STE. 1402 SAN FRANCISCO, CA 94104 Office:(415) 466-2997

www.BASEdesigninc.com

PROFESSIONAL PROFE

STATE

DSA FILE NUMBER 41-26

APPL # 01-119554

REVISIONS

No. Description Date

MILESTONES
DD

90% CD
DSA SUB 06/02/2021
BACKCHECK 09/22/2021

IFFT

EXISTING ROOF FRAMING PLANS -BLDGS 1, 2, 3 & 4

09/17/2021 JOB # 2021005.04

\$2.01

NICDETE STDENC			3000	DCI			
INCRETE STRENG	ETE STRENGTH		3000 PSI				
INFORCING CONF	IGURATION	ATION CA		CA	SE 2		
R SIZE	BAR LOCATION	TOP	OTHER	TOP	OTHER		
	#3	22	17	32	25		
NAD ND HT S)" S)"	#4	29	22	43	33		
SA NING OPN OFI CHE	#5	36	28	54	41		
LEN VEL VEL UEN	#6	43	33	64	50		
	#7	63	48	94	72		
	#3	28	22	42	32		
CLASS B LAP SPLICE AND SPLICE AND STRAINGHT (INCHES) LENGTH, Ld (INCHES)"	#4	37	29	56	43		
SS B SH SH SH SH	#5	47	36	70	54		
SF. SF. (IN	#6	56	43	84	64		
O	#7	81	63	122	94		

1. VALUES IN THE TABLE ARE FOR NON-EPOXY COATED GRADE 60 REINFORCING STEEL AND NORMAL WEIGHT CONCRETE.

2. CASES 1 AND 2 ARE DEPENDENT ON THE TYPE OF CONCRETE ELEMENT, CONCRETE COVER AND CENTER-TO-CENTER SPACING OD REINFORCING BARS. THEY ARE DEFINED AS:

CASE 1: BEAM AND COLUMNS: CONCRETE COVER >= db

 CENTER-TO-CENTER SPACING >= 2x db, AND - STIRRUPS OR TIES PROVIDED THROUGHTOUT Id

OTHER ELEMENTS:

CONCRETE COVER >= db AND

- CENTER-TO-CENTER SPACING >= 3x db

CASE 2: BEAM AND COLUMNS: CONCRETE COVER < db

- CENTER-TO-CENTER SPACING < 2x db OTHER ELEMENTS:

 CONCRETE COVER < db AND - CENTER-TO-CENTER SPACING < 2x db

3. TOP BARS ARE HORIZONTAL BARS WITH MORE THAN 12" OF FRESH CONCRETE BELOW. OTHER BAR INCLUDE ALL VERTICAL REINFORCING, ALL HORIZONTAL WALL REINFORCING AND HORIZONTAL REINFORCING WITH LESS THAN 12" OF RESH CONCRETE BELOW BAR.

4. PROVIDE CLASS B LAP SPLICES, U.O.N.

5. FOR LIGHTWEIGHT CONCRETE, MULTIPLY THE VALUES IN THIS TABLE BY 1.3.

6. WHERE Id IS NOT OBTAINABLE DUE TO SPACE RETRICTIONS, PROVIDE A STANDARD HOOK PER DETAIL

7. FOR EPOXY-COATED BARS, MULTIPLY THE VALUE IN THIS TABLE BY 1.5.

8. SPLICES OF HORIZONTAL REINFORCING BARS IN WALLS AND SLABS SHALL BE STAGGERED. SPLICES OF HORIZONTAL REINFORCING BARS IN WALLS AND SLABS CONTAINING TWO CURTAINS OF REINFORCEMENT SHALL NOT OCCUR IN THE SAME LOCATION; SPLICES SHALL BE OFFSET BY THE MAXIMUM OF 12 INCHES AND 12 BAR DIAMETERS.


9. SEE SHORTCRETE NOTES FOR LAP SPLICES IN SHOTCRETE WALLS.

10.MECHANICAL COUPLERS MAY BE USED IN LIEU OF LAP SPLICES. MECHANICAL COUPLERS SHALL HAVE AN APPROVED ICC REPORT AND RESIST 125% OF REINFORCING BAR YIELD STRENGTH.


11. WHERE BARS OF DIFFERENT SIZES ARE SPLICED, SPLICE LENGTH SHALL BE THE MAXIMUM OF Id OF THE LARGER BAR AND THE LAP SPLICE LENGTH OF THE SMALLER BAR.

12.LAP TOP BARS AT MIDSPAN AND BOTTOM BARS AT SUPPORT, U.O.N.


13.NON-CONTACT LAP SPLICED BARS SHALL BE SPLACED AT LEAST 1 ½" AND NO MORE THAN THE MAXIMUM OF ONE-FIFTH OF THE LAP SPLICE AND 6".

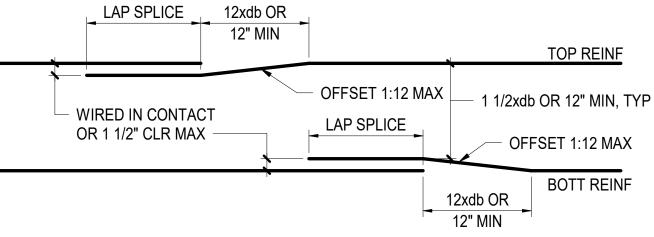


a BEAM SPLICE DETAIL

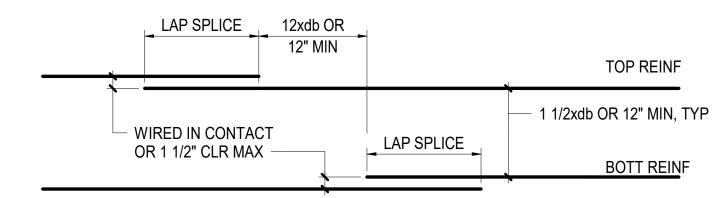


STRAGGERED WALL OR SLAB SPLICE DETAIL

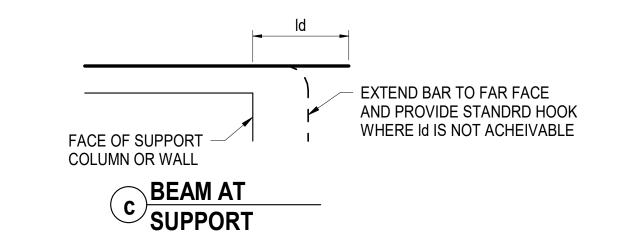



(7) LAP SPLICE + STRAIGHT BAR DEVELOPMENT LENGTHS

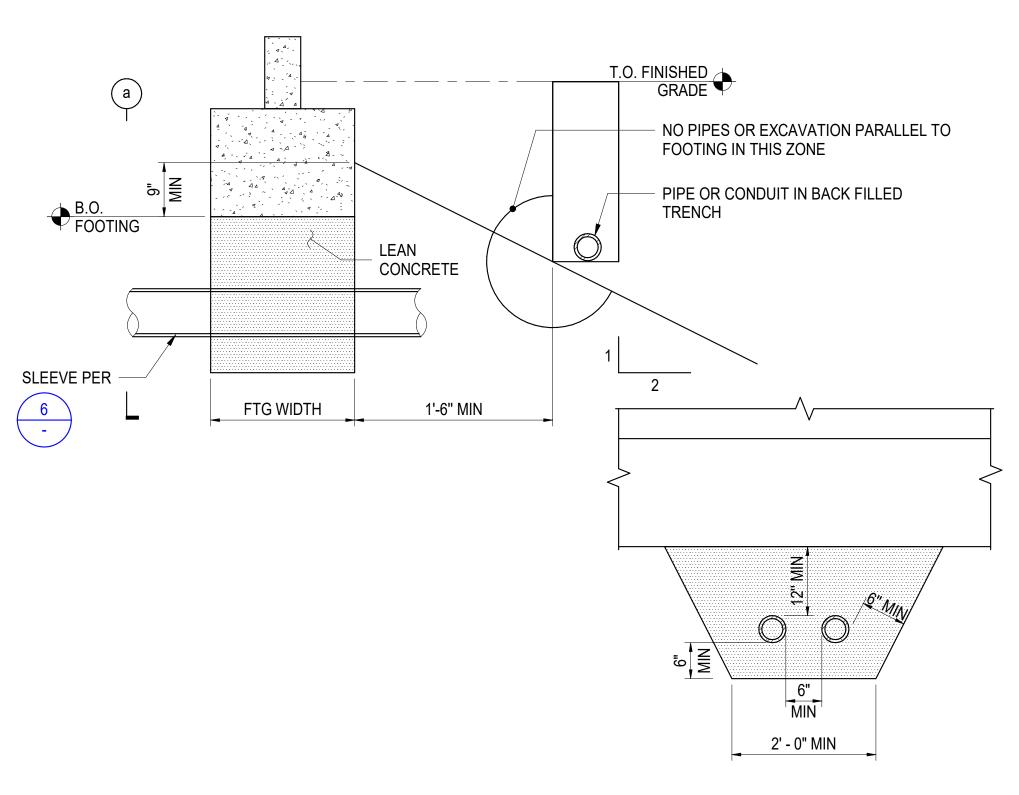



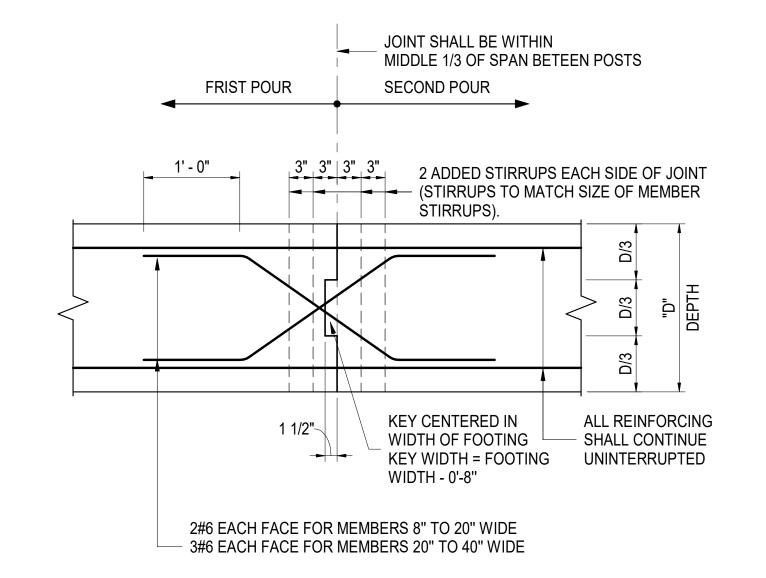

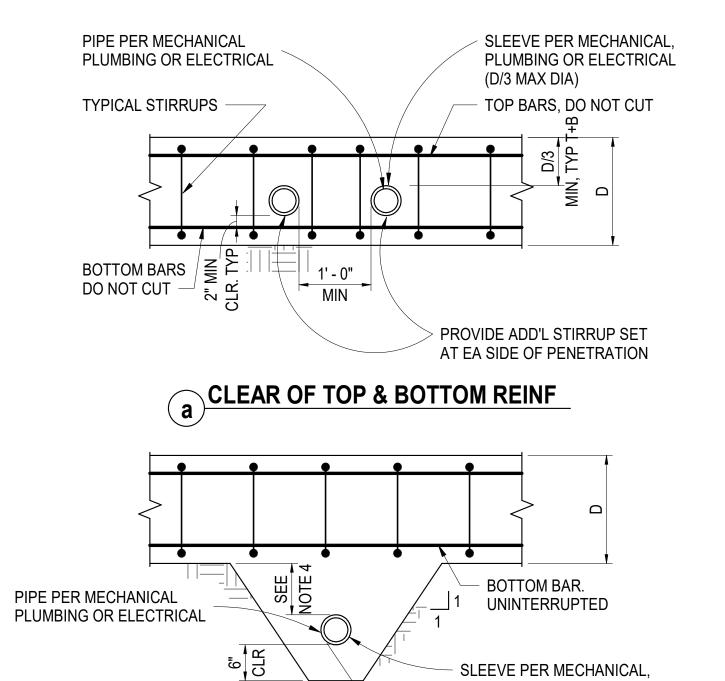

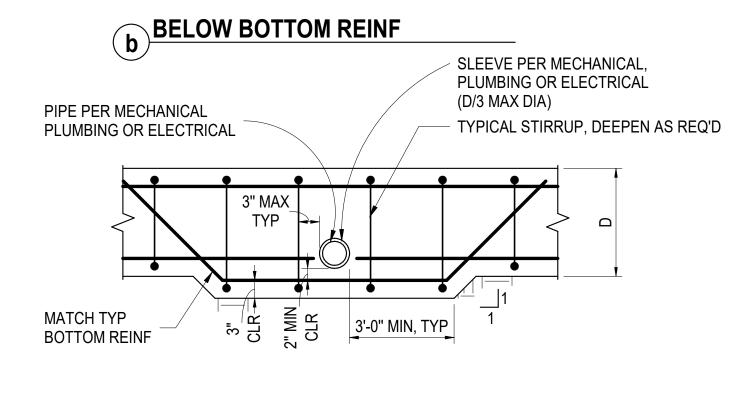

PLUMBING OR ELECTRICAL

(12" MAX DIA)


c AT BOTTOM REINF

NOTES:

NTS


- ALL PIPES AND CONDUITS SHALL CLEAR SLEEVE BY 1" ALL AROUND U.O.N. SEAL VOID BETWEEN PIPE AND SLEEVE WITH ELASTIC WATERPROOF MATERIAL, TYP.
- DETAIL APPLICABLE TO MAXIMUM 8" DIA SLEEVE. 4. NO FTG EXTENSION REQ'D FOR PIPE DEEPER THAN 12" BELOW FTG (SLEEVE STILL REQ'D).
- SEE DETAIL 8 ON THIS SHEET. WHERE PENETRATION CONFLICTS WITH REBAR TIE, OMIT TIE & PROVIDE 1 ADDITIONAL TIE
- EA SIDE OF SLEEVE. 6. IF PIPE OR CONDUIT SLEEVE IS ASTM A53 SCHEDULE 40 OR GREATER PIPE, ADDITIONAL
- STIRRUPS MAY BE ELIMINATED, SLEEVE SHALL GALVAIZED.

	HOOKED BAR DEV	ELOPMENT LENGTH,	Ldh
BAR	C	ONCRETE STRENGTI	4
SIZE	3000 PSI	4000 PSI	5000 PSI
#3	0' - 8"	0' - 7"	0' - 6"
#4	0' - 11"	0' - 9"	0' - 9"
#5	1' - 2"	1' - 0"	0' - 11"
#6	1' - 4"	1' - 2"	1' - 1"
#7	1' - 7"	1' - 5"	1' - 3"

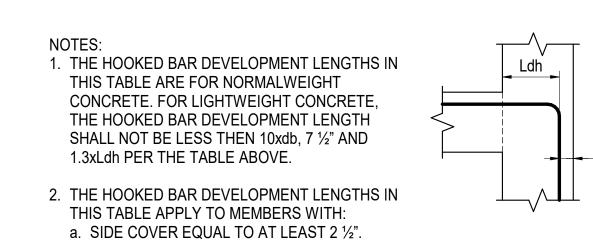



b. END COVER EQUAL TO AT LEAST 2".

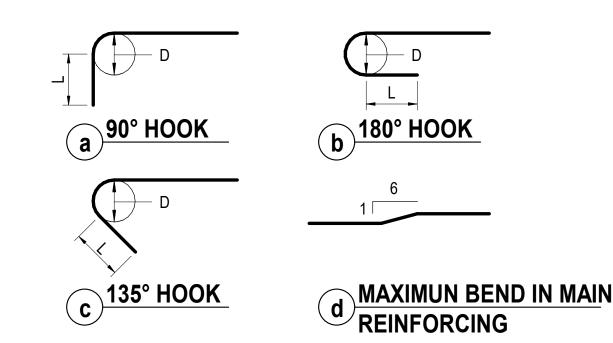

	MAIN REINFORC	ING HOOKS	
BAR SIZE	BEND DIAMETER, D (IN)	90° HOOK L (IN)	180° HOOK L (IN)
#3	2 1/4	4 1/2	2 1/2
#4	3	6	2 1/2
#5	3 3/4	7 1/2	2 1/2
#6	4 1/2	9	3
#7	5 1/4	10 1/2	3 1/2

_				
		STIRRUP + TIE REINF	ORCING HOOKS	
	BAR SIZE	BEND DIAMETER, D (IN)	90° HOOK L (IN)	180° HOOK L (IN)
	#3	1 1/2	3	3
	#4	2	3	3
	#5	2 1/2	3 3/4	3 3/4
	#6	4 1/2	9	4 1/2
	#7	5 1/4	10 1/2	5 1/4

TYPICAL BAR HOOKS

NTS

IDENTIFICATION STAMP DIV. OF THE STATE ARCHITEC APP: 01-119554 INC: REVIEWED FOR SS 🗹 FLS 🗹 ACS 🗹 DATE: 09/21/2021

www.aedisarchitects.com 387 S. 1st Street, Suite 300 San Jose, CA 95113 tel: (408)-300-5160 fax: (408)-300-5121

architects

PROJECT **MEADOW HEIGHTS ELEMENTARY** SCHOOL - HVAC REPLACEMENT

SAN MATEO-FOSTER CITY

SCHOOL DISTRICT

CONSULTANT

SAN FRANCISCO, CA 94104

Office:(415) 466-2997

www.BASEdesigninc.com

NTS

NTS

STATE 41-26 DSA FILE NUMBER 01-119554 APPL#

REVISIONS No. Description Date

MILESTONES DD


90% CD DSA SUB 06/02/2021 BACKCHECK 09/22/2021

SHEET **TYPICAL** CONCRETE **DETAILS**

09/17/2021

^{JOB#}2021005.04

NTS

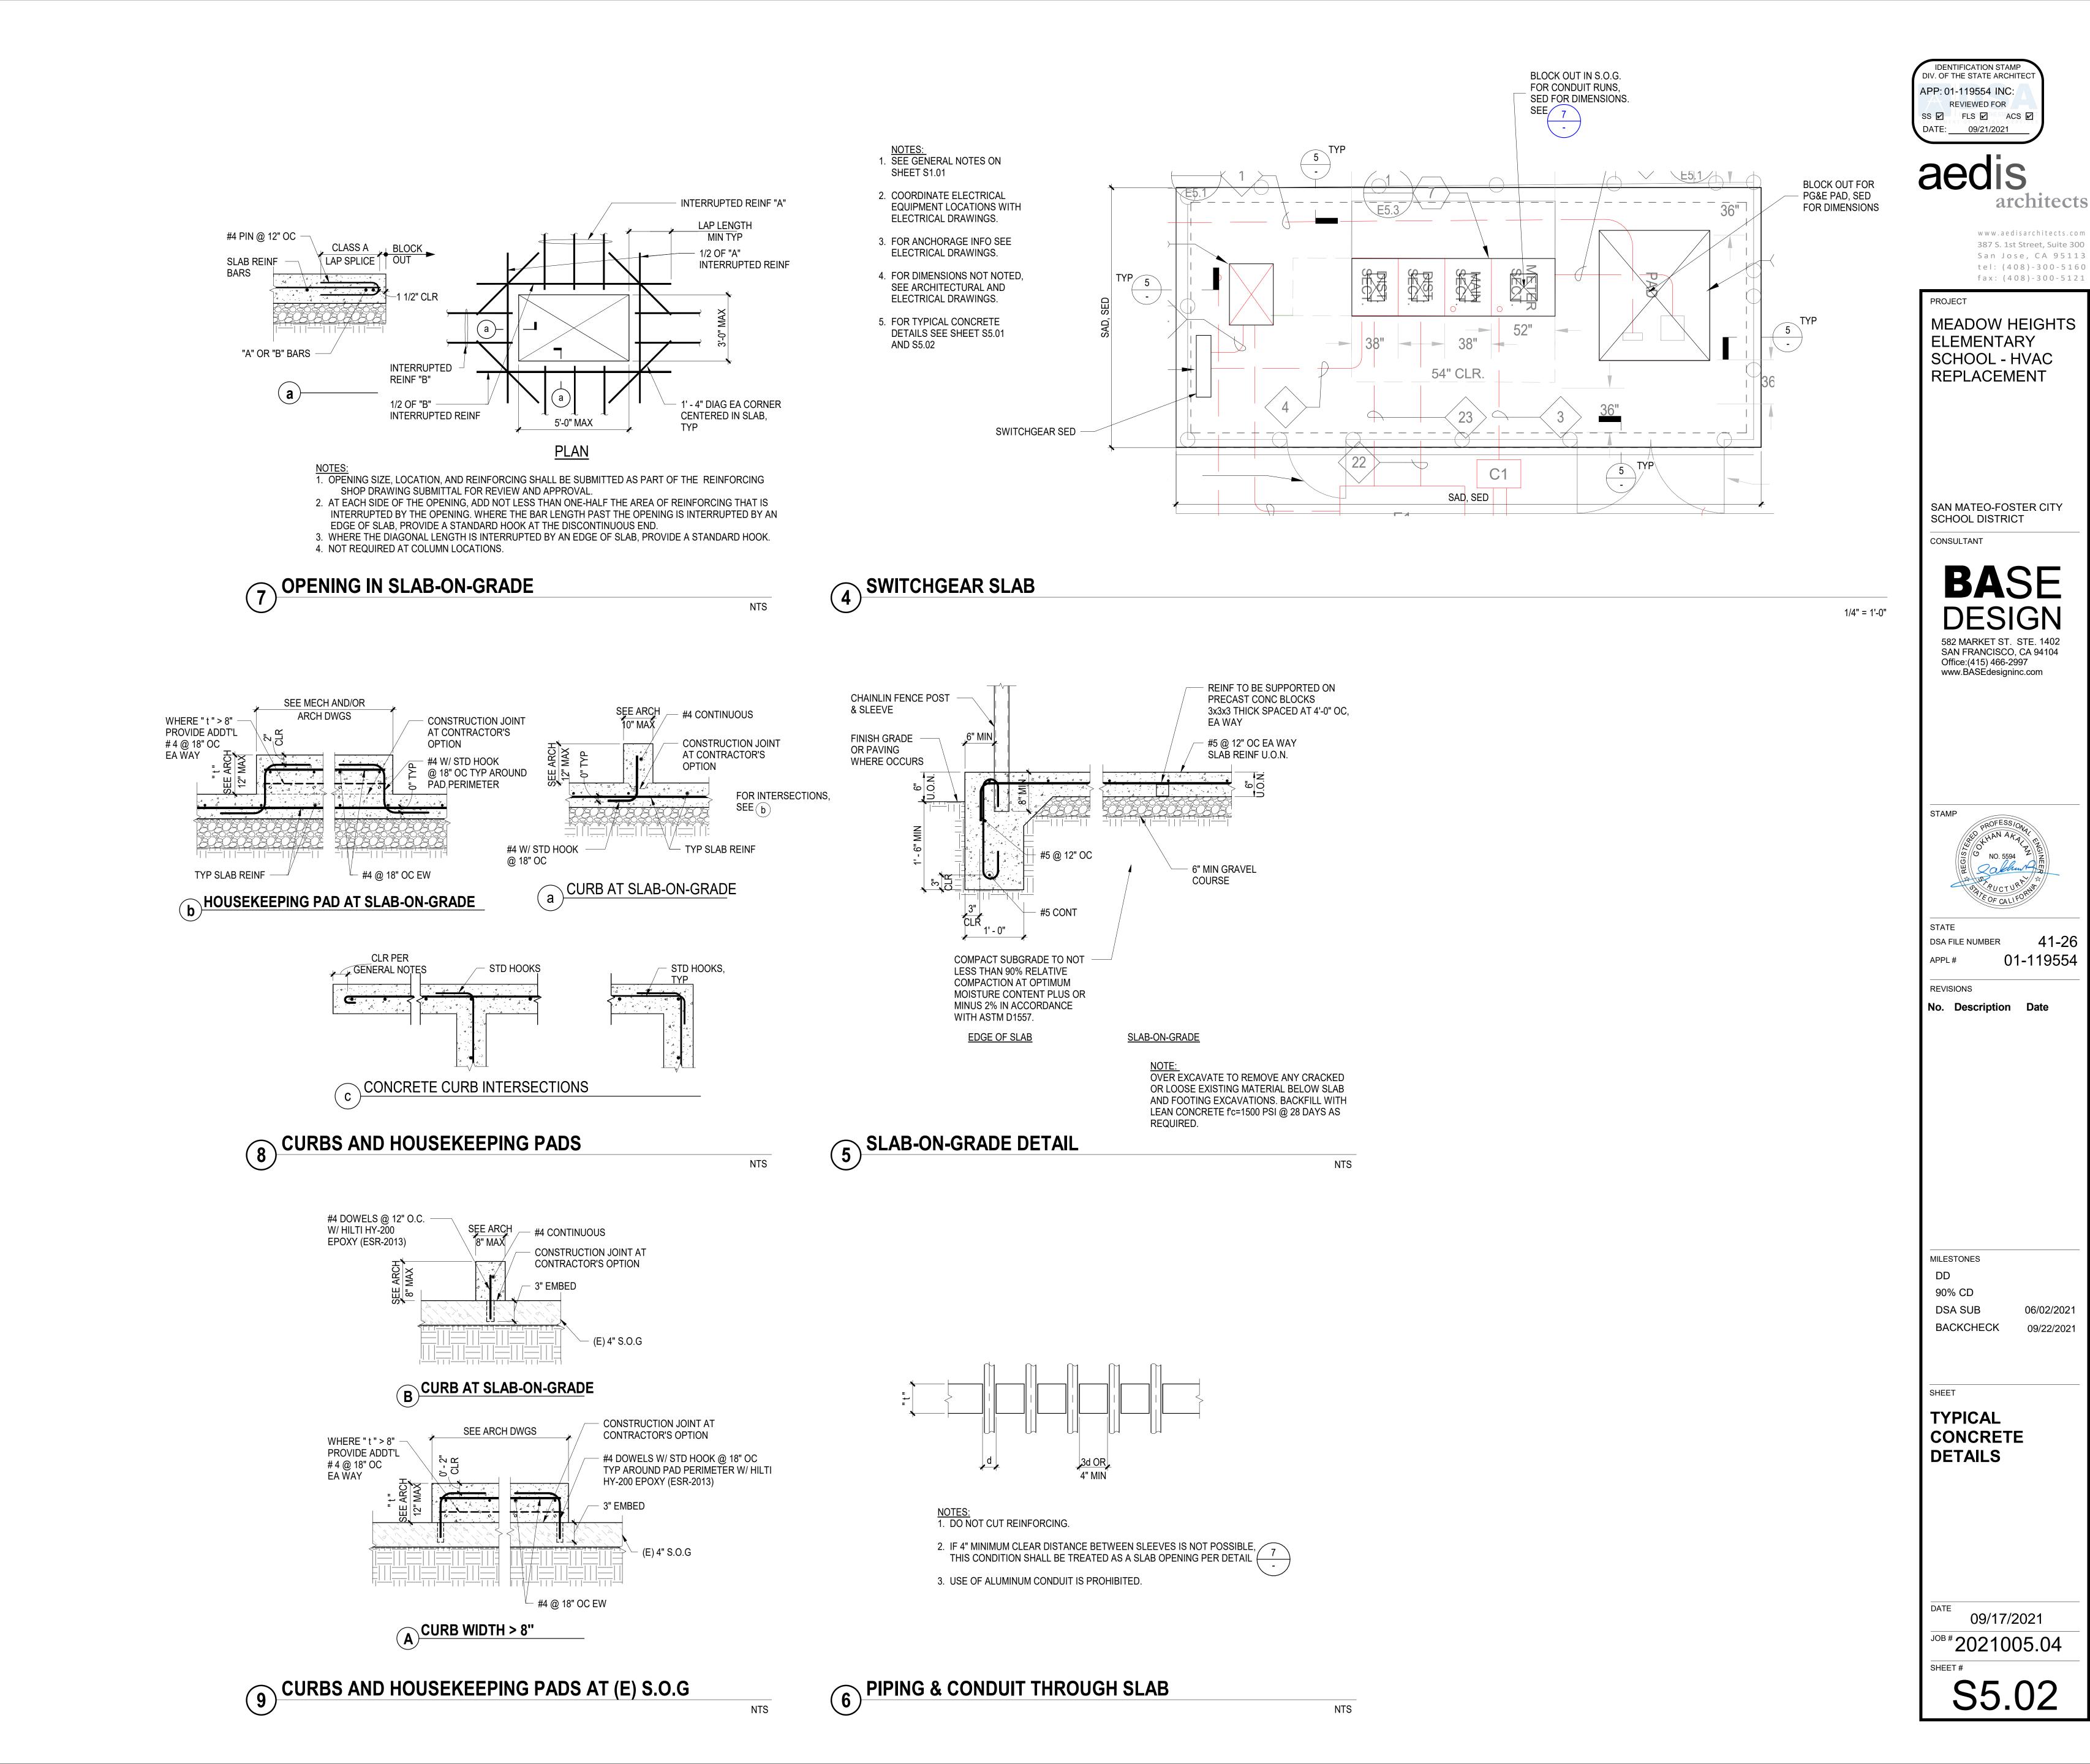

41-26

06/02/2021

09/22/2021

DESCRIPTION OF BUILDING ELEMENTS

top plate or other framing below

plate, to rafter or truss

2. Ceiling joists to top plate


Flat blocking to truss and web filler


1. Blocking between ceiling joists, rafters or trusses to

Blocking between rafters or truss not at the wall top


3. Ceiling joist not attached to parallel rafter, laps over


- a. Nails spaced at 6 inches at intermediate supports where spans are 48 inches or more. Nails for wall sheathing are permitted to be
- b. Spacing shall be 6 inches on center on the edges and 12 inches on center at intermediate supports for nonstructural applications.
- Panel supports at 16 inches (20 inches if strength axis in the long direction of the panel, unless otherwise marked). c. Where a rafter is fastened to an adjacent parallel ceiling joist in accordance with this schedule and the ceiling joist is fastened to the

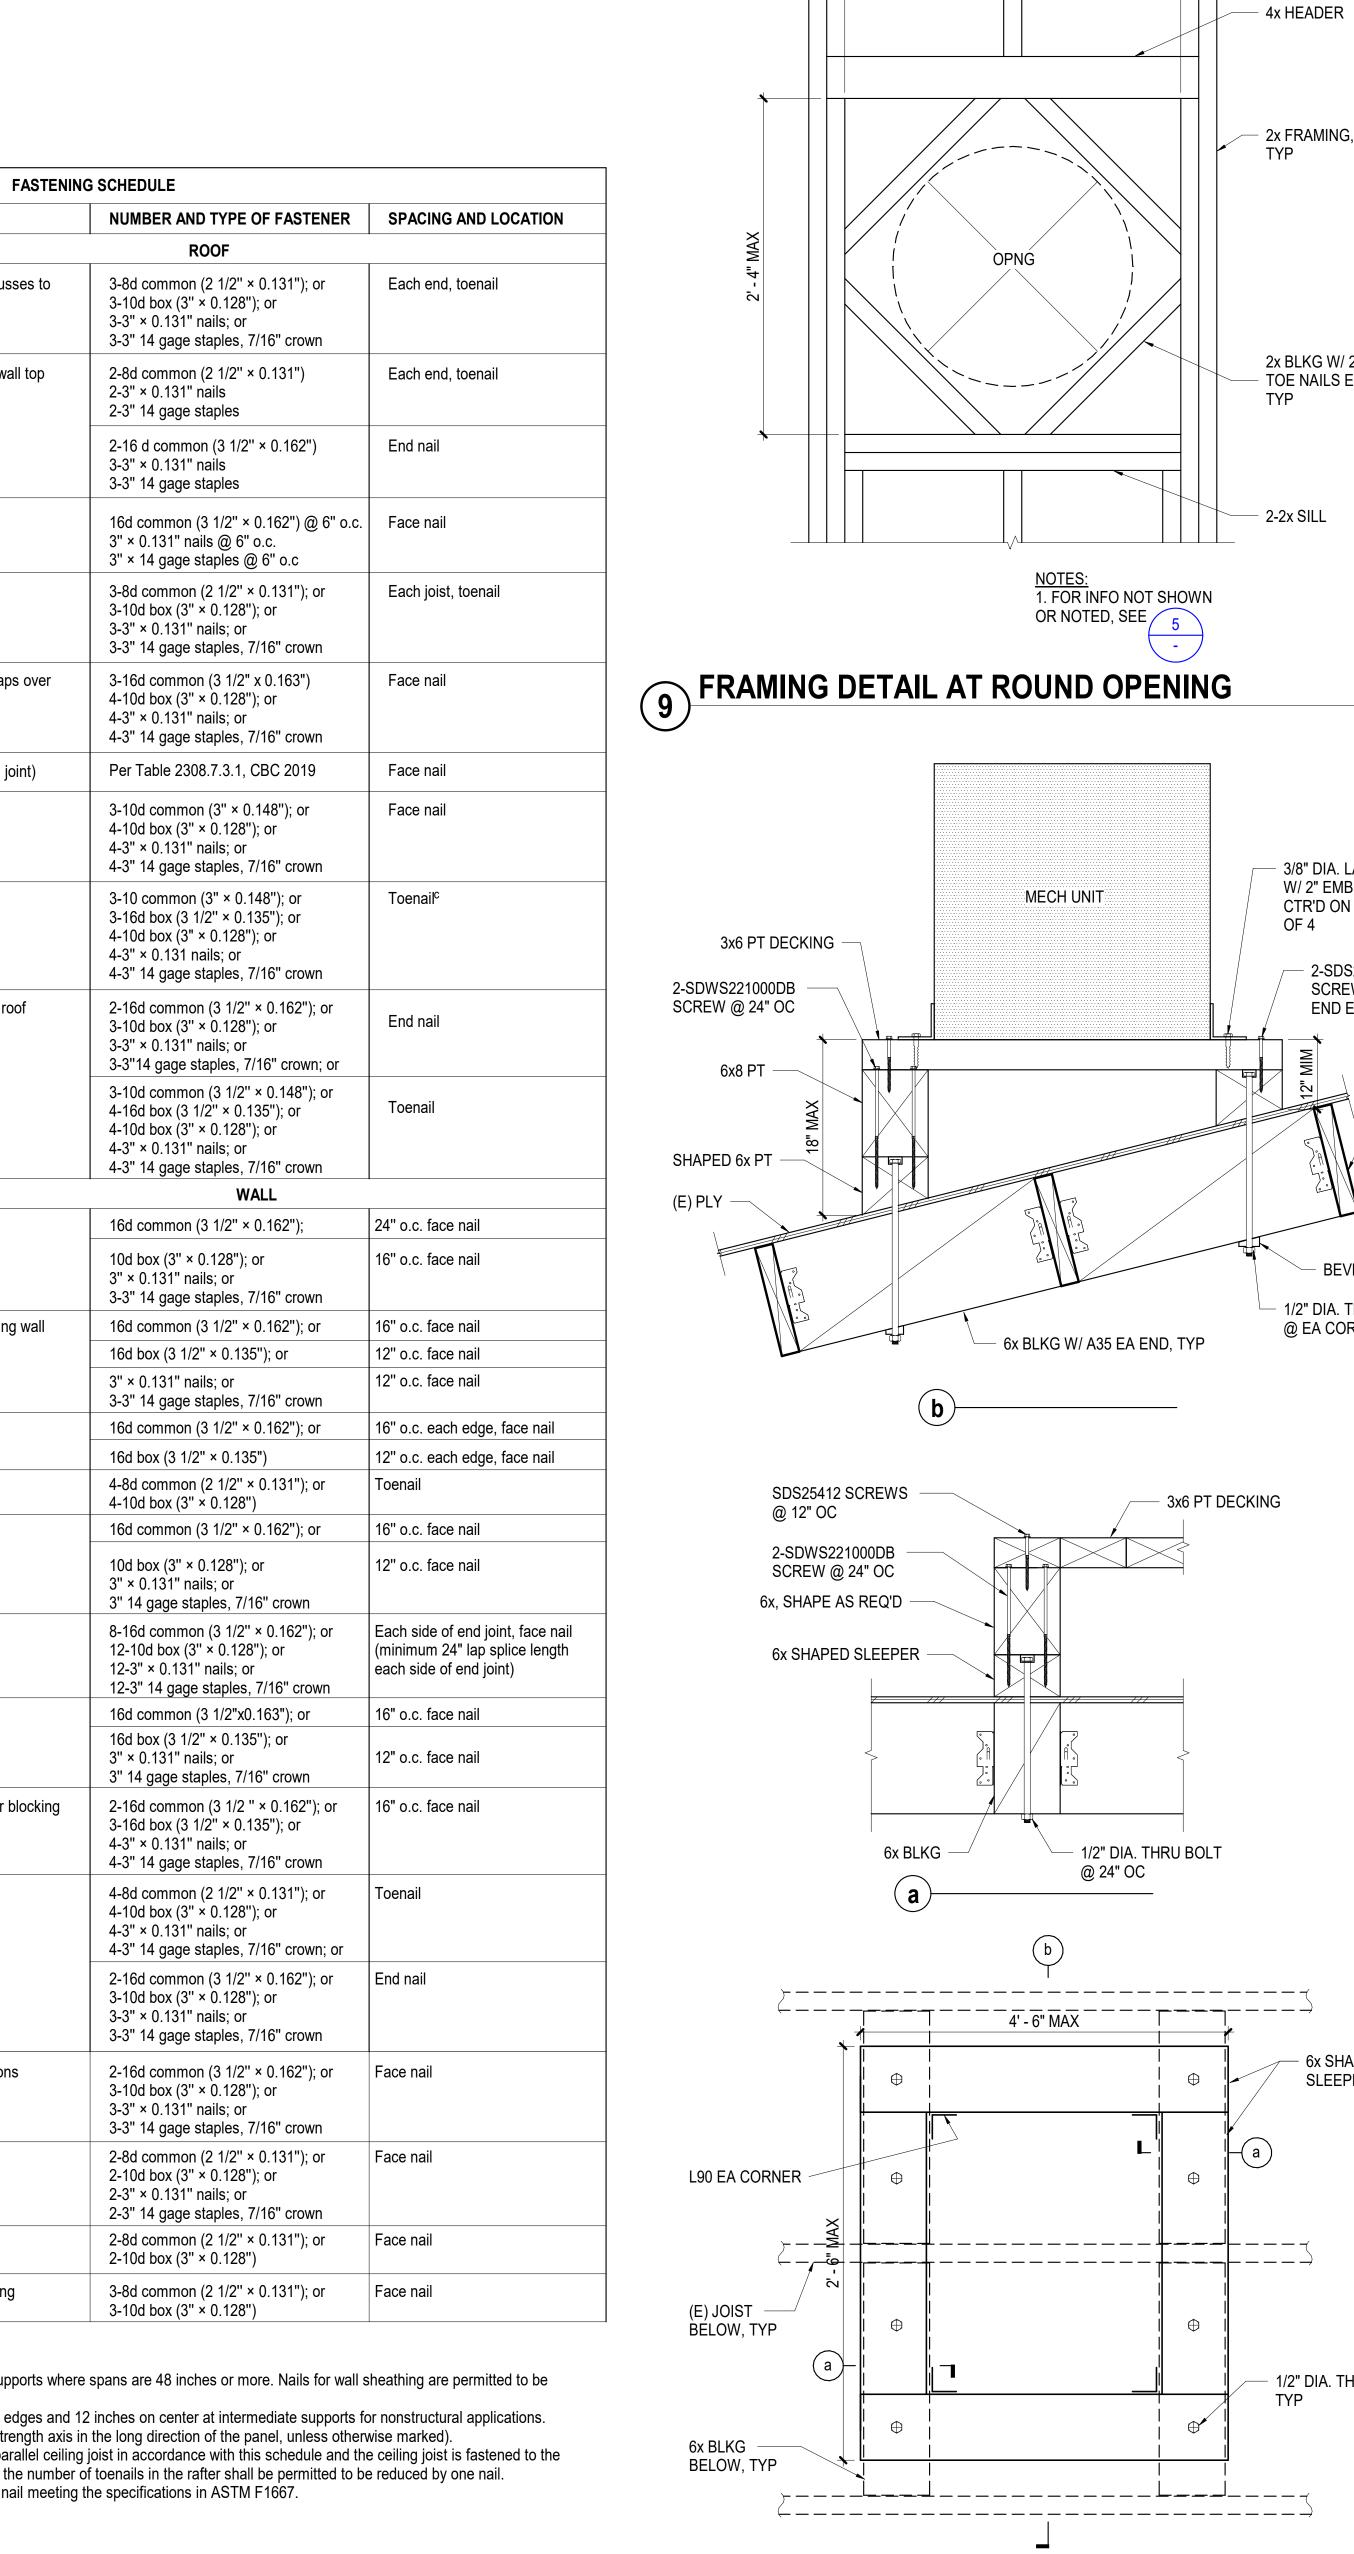


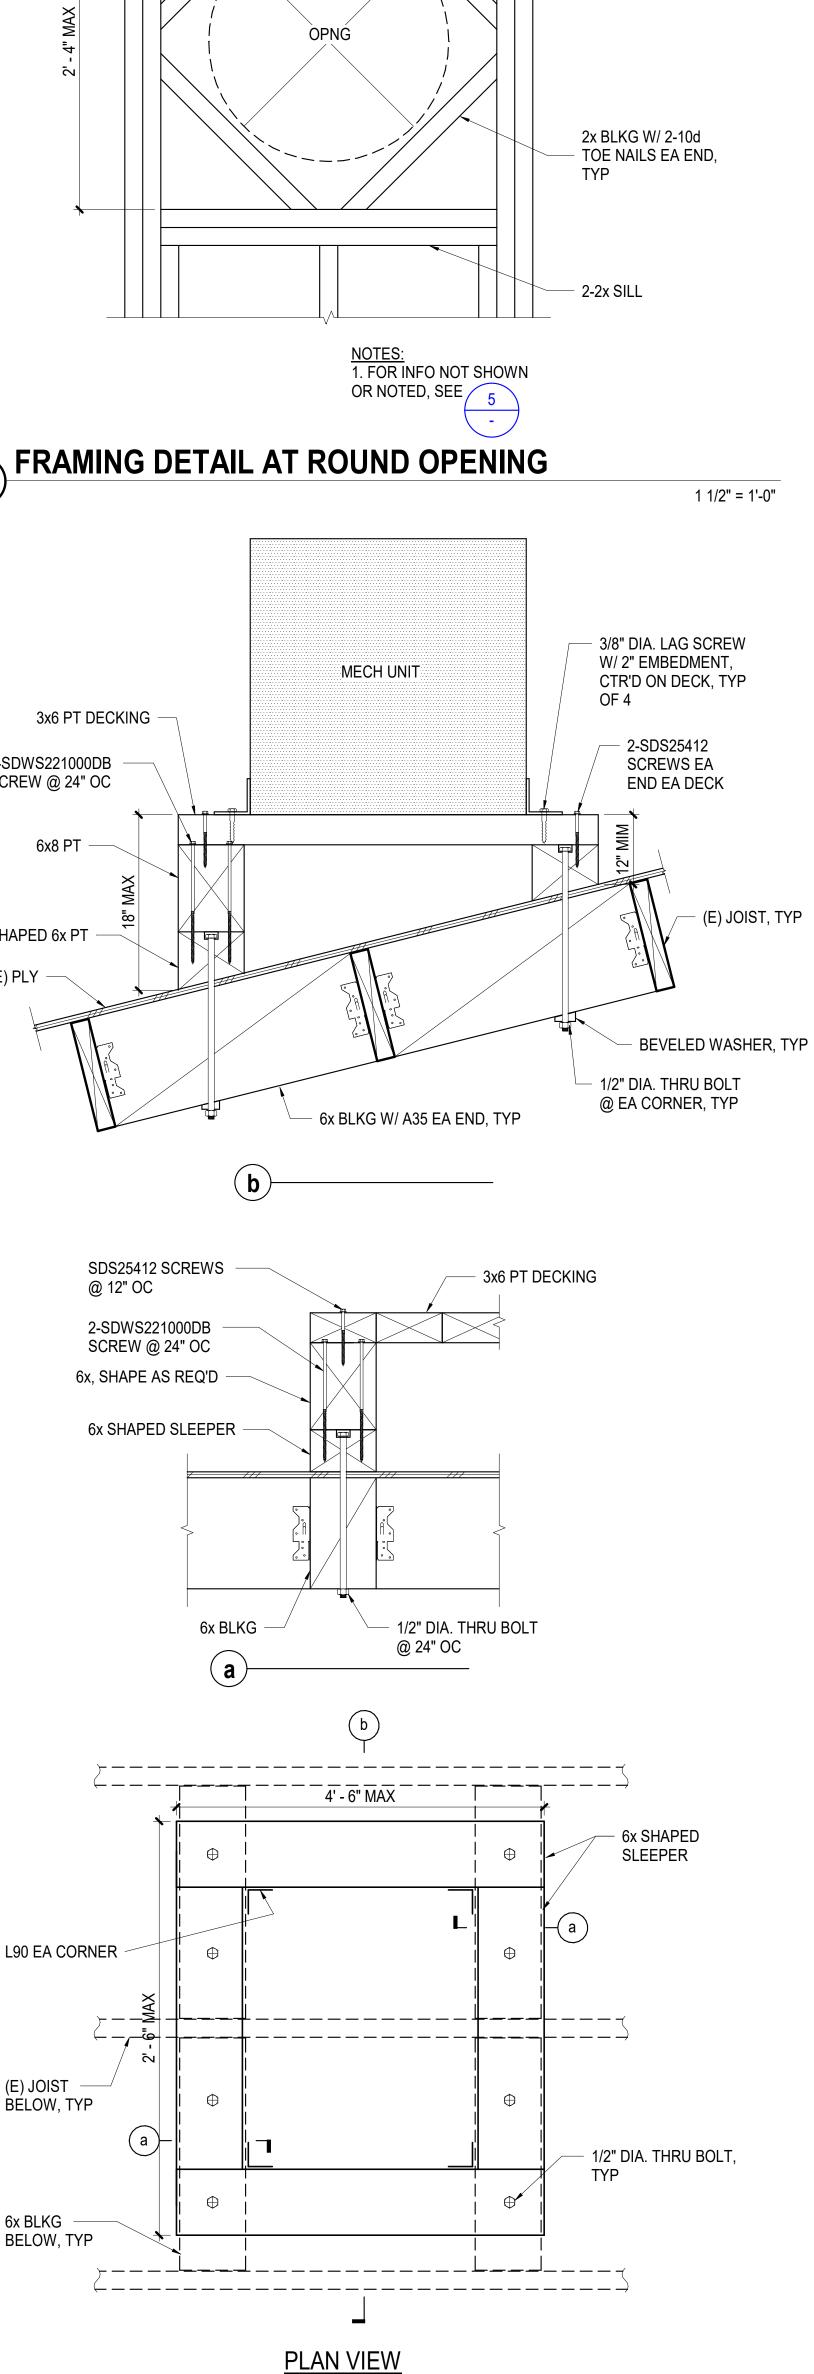


2' - 4" MAX

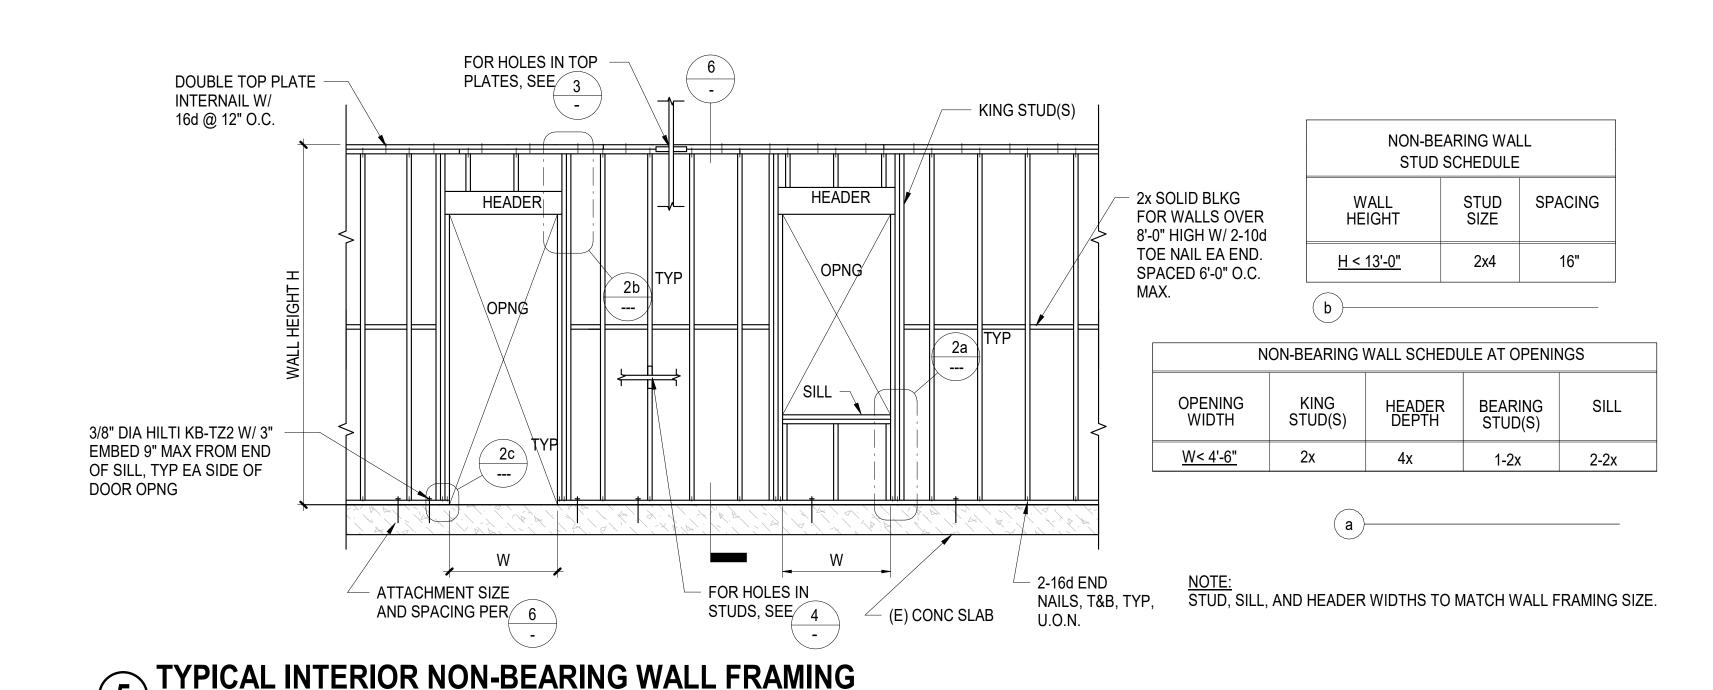

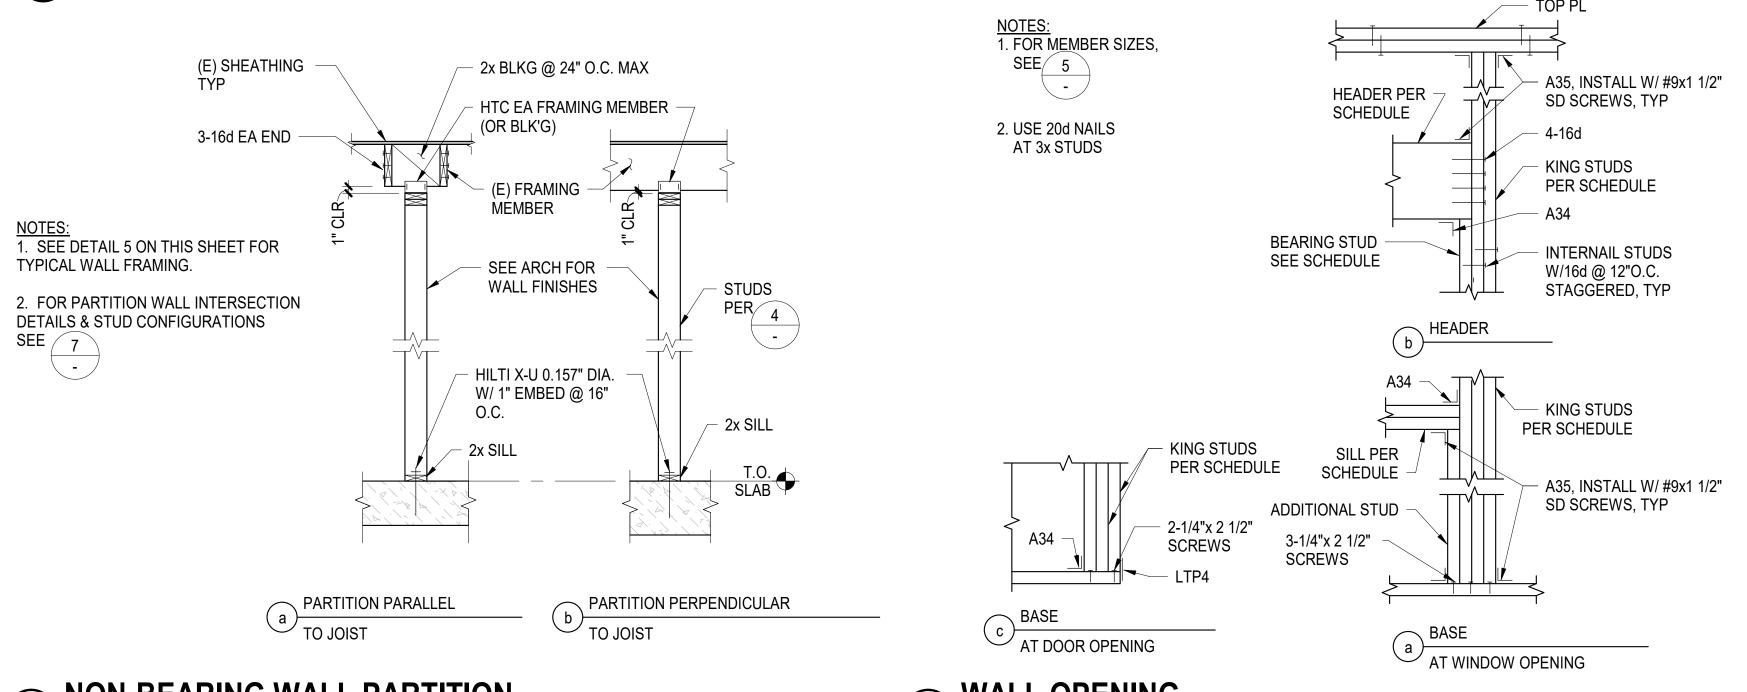

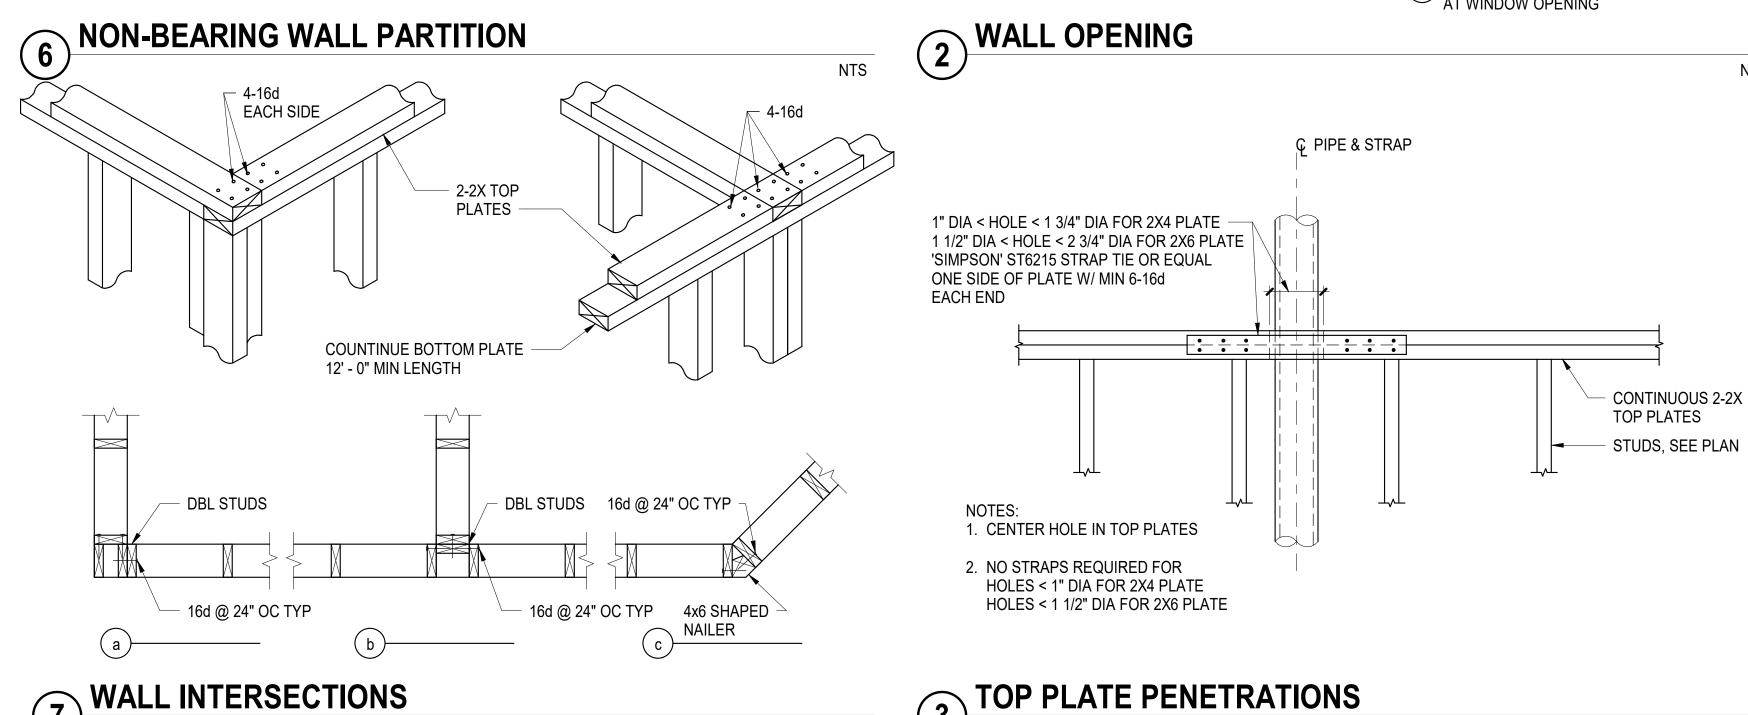

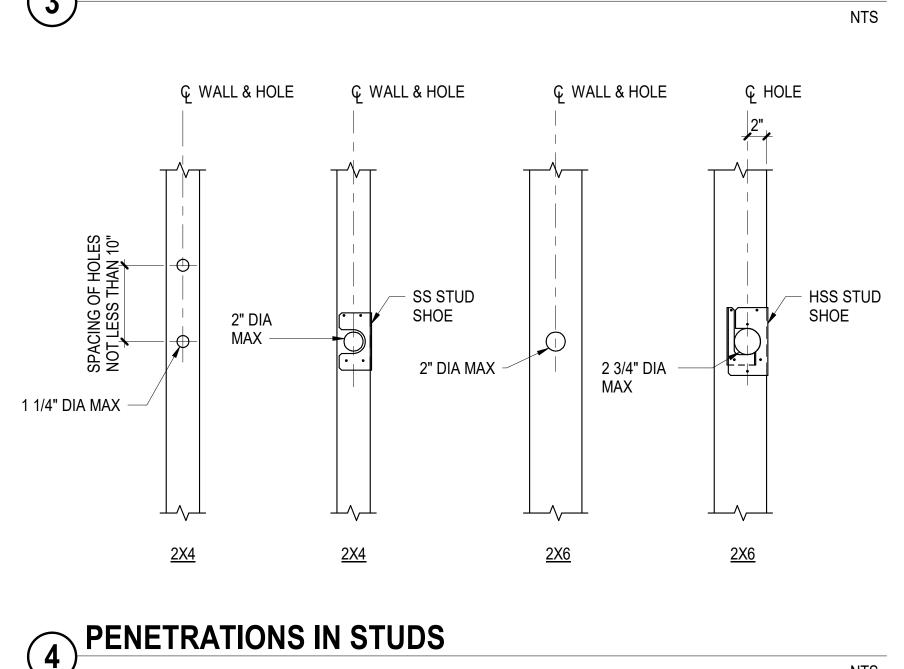

IDENTIFICATION STAMP DIV. OF THE STATE ARCHITEC APP: 01-119554 INC: REVIEWED FOR SS 🗹 FLS 🗹 ACS 🗹 DATE: 09/21/2021

architects

PROJECT

NTS

NTS

387 S. 1st Street, Suite 300 San Jose, CA 95113 tel: (408)-300-5160 fax: (408)-300-5121

MEADOW HEIGHTS ELEMENTARY SCHOOL - HVAC REPLACEMENT

SAN MATEO-FOSTER CITY SCHOOL DISTRICT

CONSULTANT

BASE **DESIGN** 582 MARKET ST. STE. 1402 SAN FRANCISCO, CA 94104

Office:(415) 466-2997 www.BASEdesigninc.com

41-26 DSA FILE NUMBER 01-119554

REVISIONS No. Description Date

MILESTONES 90% CD DSA SUB 06/02/2021

BACKCHECK

09/22/2021

FRAMING DETAILS **AND NAILING SCHEDULE**


09/17/2021 ^{JOB#}2021005.04

NTS

(12) NAILING SCHEDULE

(11) MECH UNIT PLATFORM FRAMING DETAIL

1 1/2" = 1'-0"

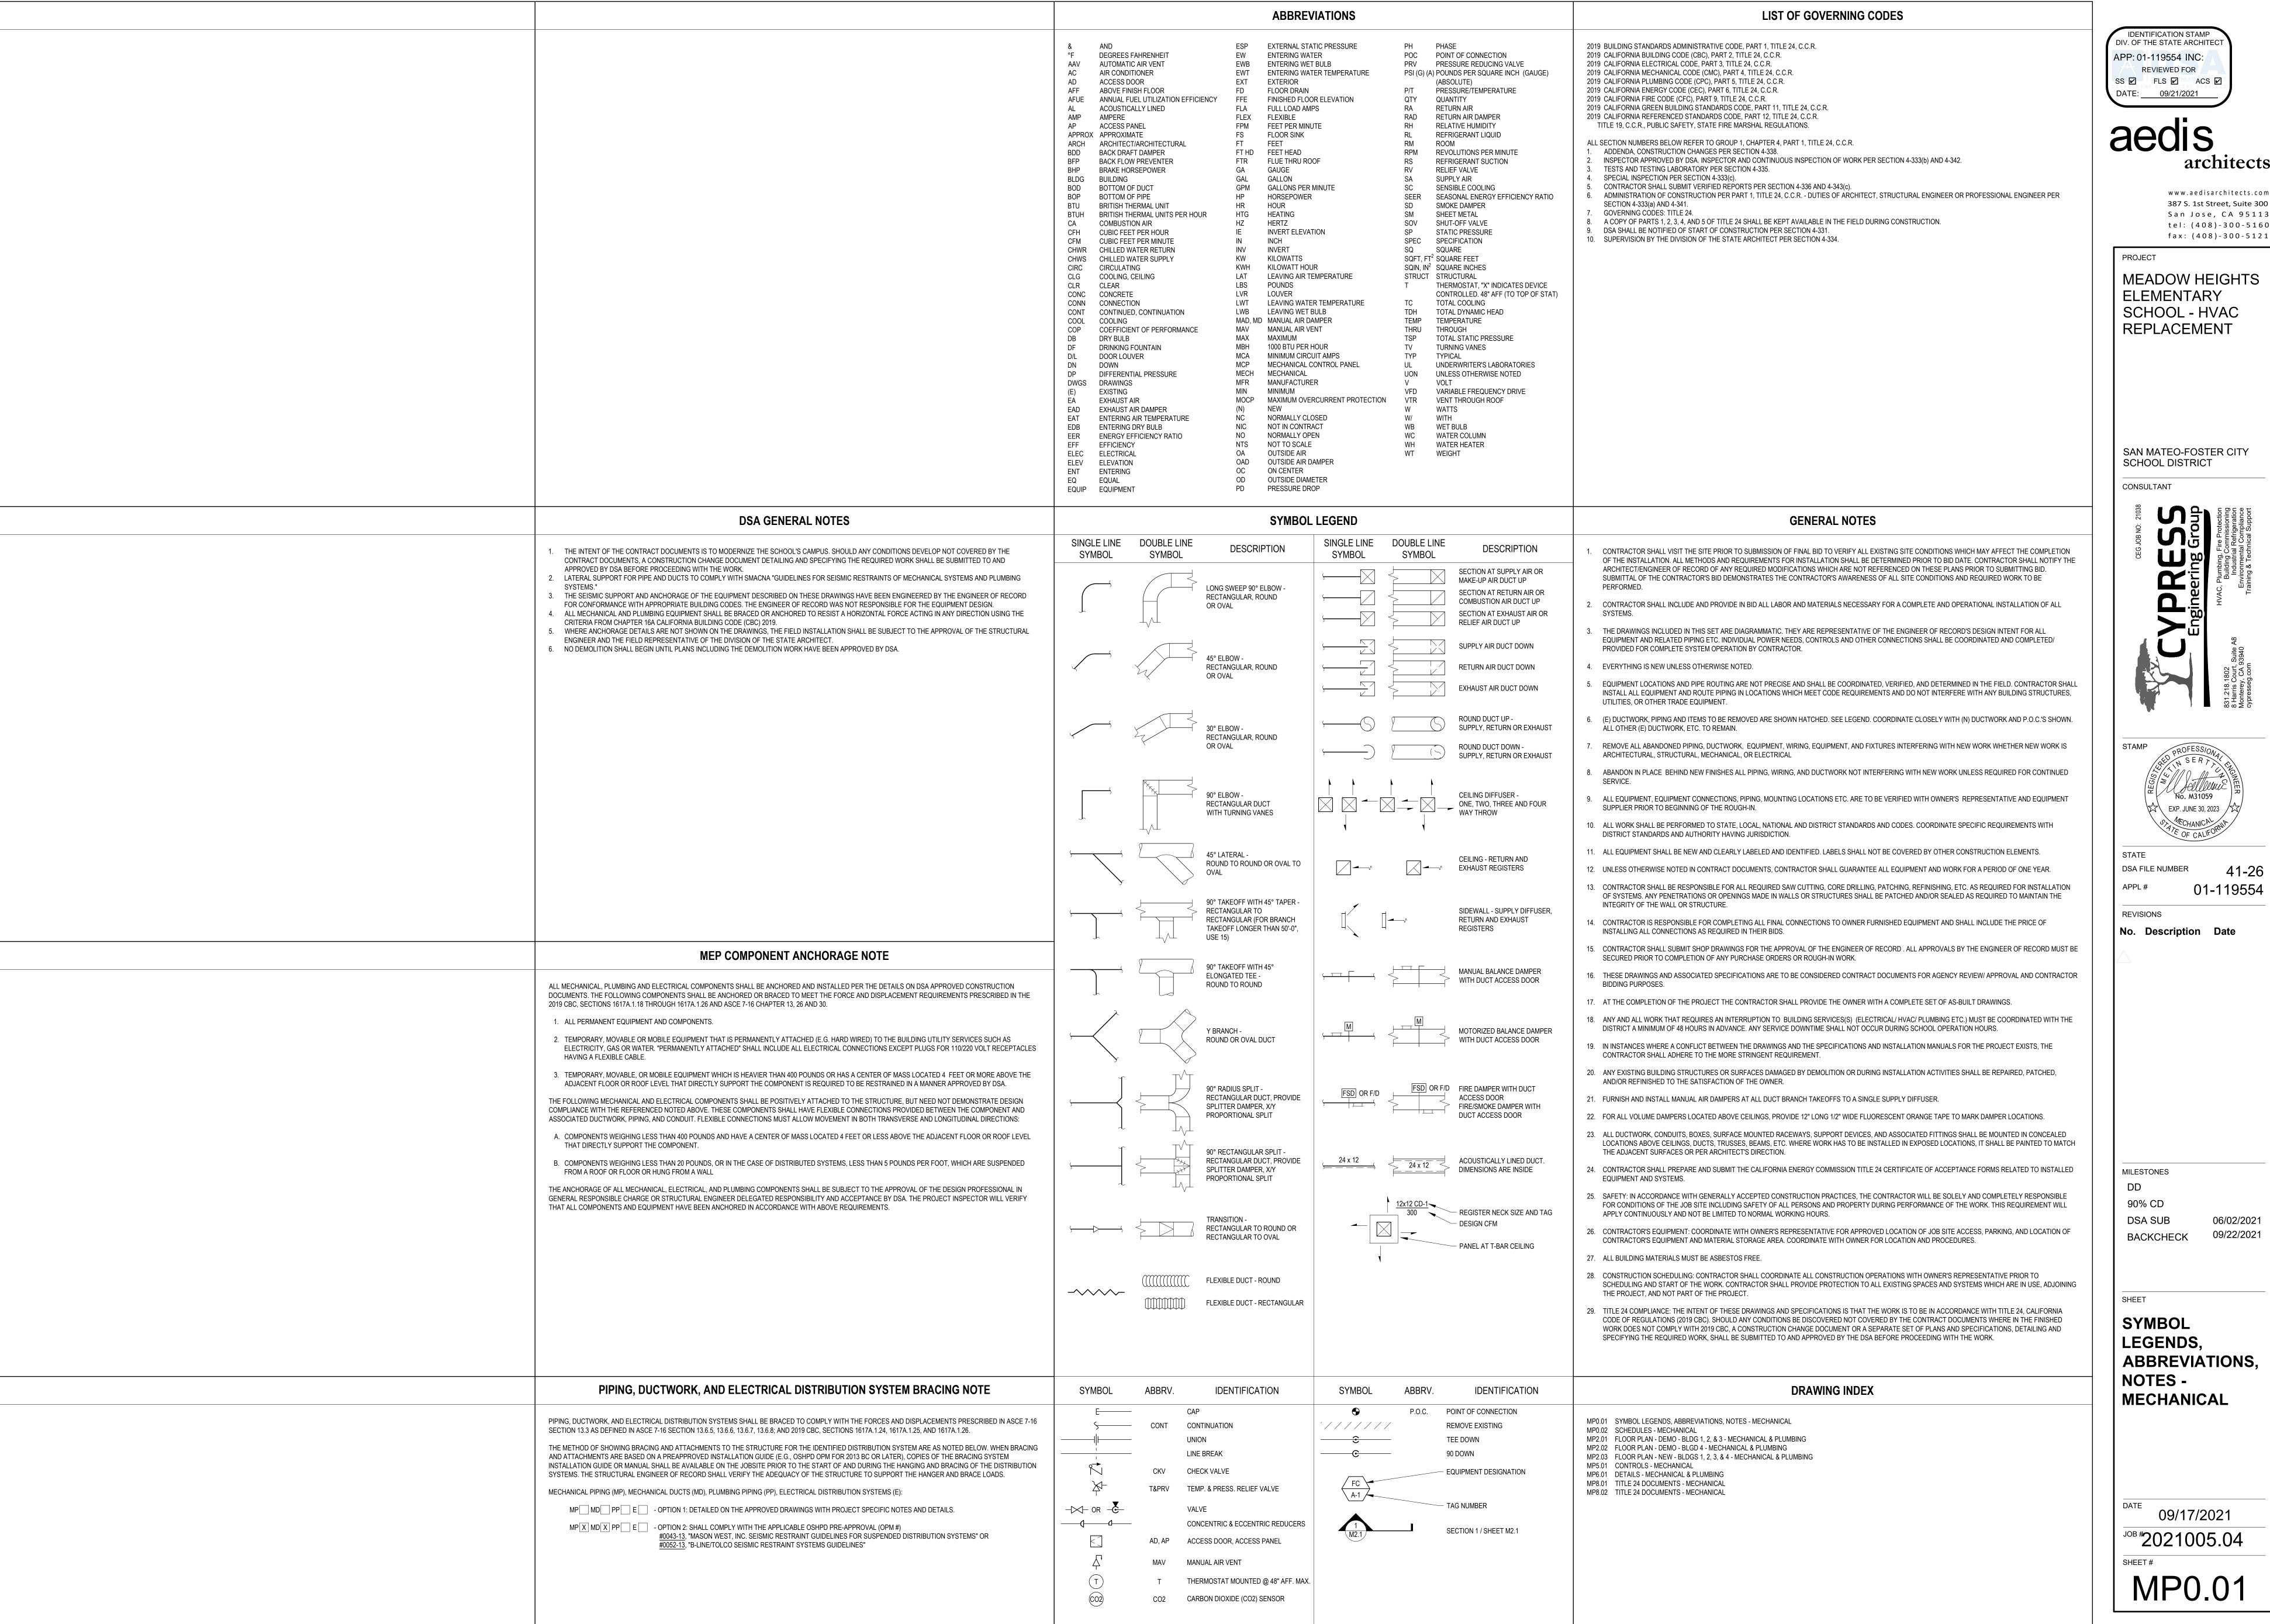

architects

387 S. 1st Street, Suite 300 San Jose, CA 95113 tel: (408)-300-5160 fax: (408)-300-5121

				SP	LIT SYSTE	M AIR CONI	DITIONER	S SCHEDI	ULE							
TAC	MANUEACTURER	MODEL	DI III DINO	LOCATION	COOLING HEATING AIRFLOW REFRIGERANT PIPING		CEED	Е	LECTRICA	AL	WEIGHT	MOUNTING	NOTEC			
TAG	MANUFACTURER	MODEL	BUILDING	LOCATION	TOTAL MBH	TOTAL MBH	CFM	LIQUID	GAS	SEER	V / PH	MCA	МОСР	LBS	DETAIL	NOTES
SSO-1	SAMSUNG	AR24TSFYBWKXCV	BUILDING 1	ROOF	22	24	-	1/4"	5/8"	18	208 / 1	20	30	125	2/MP6.01	
SSI-1	SAMSUNG	AR24TSFYBWKNCV	BUILDING I	FOOD SERVICE	22	24	657	1/4"	5/8"	_		NOTE 1	•	30	3/MP6.01	2, 3, 4, 5
SSO-2	SAMSUNG	AR09TSFYBWKXCV	DUIL DING 1	ROOF	9	11	_	1/4"	3/8"	23.5	208 / 1	12	20	70	2/MP6.01	
SSI-2	SAMSUNG	AR09TSFYBWKNCV	BUILDING 1	STAFF LOUNGE	9		371	1/4"	3/8"	_		NOTE 1	•	25	3/MP6.01	2, 3, 4, 5
SSO-3	SAMSUNG	AR24TSFYBWKXCV	DI III DING 4	ROOF	20	NOTE C	_	1/4"	5/8"	18	208 / 1	20	30	125	2/MP6.01	
SSI-3	SAMSUNG	AR24TSFYBWKNCV	BUILDING 1	ELECTRICAL ROOM	22	NOTE 6	657	1/4"	5/8"	_		NOTE 1	•	30	3/MP6.01	2, 3, 4, 5

- INDOOR UNITS ARE POWERED BY OUTDOOR UNIT.
 PROVIDE WITH WALL MOUNTING BRACKET.
 PROVIDE WITH SAMSUNG WALL MOUNTED THERMOSTAT.
- PROVIDE WITH BACNET INTERFACE CARD. SEE MP5.01 FOR CONTROLS.
 PROVIDE WITH CONDENSATE PUMP.
 LOCK OUT HEATING.

	AIR DISTRIBUTION SCHEDULE											
TAG	MANUFACTURER	MODEL NO.	DESCRIPTION	BORDER TYPE	MOUNTING DETAIL	NOTES						
HSS-1	TITUS	S300FL	HIGH SIDEWALL SUPPLY	TYPE 1	2/MP6.01	1, 2, 4						
HSR-1	TITUS	350RL	HIGH SIDEWALL RETURN	TYPE 1	12/MP6.01	2, 3						
RG-1	TITUS	30RL	RELIEF GRILLE	TYPE 1	12/MP6.01	2, 5						

- SET BLADES AT 22.5° DEFLECTION.
 PRIME AND PAINT PER ARCHITECT'S INSTRUCTIONS. REGISTER COLOR SELECTED BY ARCHITECT.
 PROVIDE WITH AIRSAN COMPACT DUCT SILENCER.
- 4. PROVIDE WITH ASD AIR SCOOP DEVICE.
- 5. CONTRACTOR TO FIELD VERIFY (E) DIMENSION PRIOR TO ORDERING.

TAG	MANUFACTURER	MODEL	BUILDING	LOCATION	COOLING TOTAL MBH	HEATING TOTAL MBH	AIRFLOW CFM			ANT PIPING GAS	SEER	HSPF	ELECTRICAL V/PH MCA MOCP	WEIGHT LBS	MOUNTING DETAIL	NOTES
FC-1	SAMSUNG	AC054KNZDCH/AA		CLASSROOM 1			1150	450	3/8"	3/4"	-	-	NOTE 8	164	1/MP6.01	2, 3, 4, 5, 6, 7
HP-1	SAMSUNG	AC054KXADCH/AA		ROOF	54	60	-	-	3/8"	3/4"	17.1	9.0	208 / 1 42 70	212	3/MP6.01	1
FC-2	SAMSUNG	AC054KNZDCH/AA	BLDG 1	CLASSROOM 2	54	00	1150	450	3/8"	3/4"	-	-	NOTE 8	164	1/MP6.01	2, 3, 4, 5, 6, 7
HP-2	SAMSUNG	AC054KXADCH/AA		ROOF	54	60	-	-	3/8"	3/4"	17.1	9.0	208 / 1 42 70	212	3/MP6.01	1
FC-3	SAMSUNG	AC054KNZDCH/AA		CLASSROOM 3	54	00	1150	450	3/8"	3/4"	-	-	NOTE 8	164	1/MP6.01	2, 3, 4, 5, 6, 7
HP-3	SAMSUNG	AC054KXADCH/AA		ROOF	54	60	-	-	3/8"	3/4"	17.1	9.0	208 / 1 42 70	212	3/MP6.01	1
FC-4	SAMSUNG	AC054KNZDCH/AA		CLASSROOM 4	54	60	1150	450	3/8"	3/4"	-	-	NOTE 8	164	1/MP6.01	2, 3, 4, 5, 6,
HP-4	SAMSUNG	AC054KXADCH/AA		ROOF	34	00	-	-	3/8"	3/4"	17.1	9.0	208 / 1 42 70	212	3/MP6.01	1
FC-5	SAMSUNG	AC054KNZDCH/AA		CLASSROOM 5	54	60	1150	450	3/8"	3/4"	-	-	NOTE 8	164	1/MP6.01	2, 3, 4, 5, 6, 7
HP-5	SAMSUNG	AC054KXADCH/AA	BLDG 2	ROOF	01		-	-	3/8"	3/4"	17.1	9.0	208 / 1 42 70	212	3/MP6.01	1
FC-6	SAMSUNG	AC054KNZDCH/AA	BESG 2	CLASSROOM 6	54	60	1150	450	3/8"	3/4"	-	-	NOTE 8	164	1/MP6.01	2, 3, 4, 5, 6, 7
HP-6	SAMSUNG	AC054KXADCH/AA		ROOF			-	-	3/8"	3/4"	17.1	9.0	208 / 1 42 70	212	3/MP6.01	1
FC-7	SAMSUNG	AC054KNZDCH/AA		CLASSROOM 7	54	60	1150	450	3/8"	3/4"	-	-	NOTE 8	164	1/MP6.01	2, 3, 4, 5, 6, 7
HP-7	SAMSUNG	AC054KXADCH/AA		ROOF			-	-	3/8"	3/4"	17.1	9.0	208 / 1 42 70	212	3/MP6.01	1
FC-8	SAMSUNG	AC054KNZDCH/AA		CLASSROOM 8	54	60	1150	450	3/8"	3/4"	-	-	NOTE 8	164	1/MP6.01	2, 3, 4, 5, 6,
HP-8	SAMSUNG	AC054KXADCH/AA		ROOF			-	-	3/8"	3/4"	17.1	9.0	208 / 1 42 70	212	3/MP6.01	1
FC-9	SAMSUNG	AC054KNZDCH/AA		CLASSROOM 9	54	60	1150	450	3/8"	3/4"	-	-	NOTE 8	164	1/MP6.01	2, 3, 4, 5, 6,
HP-9	SAMSUNG	AC054KXADCH/AA		ROOF			-	-	3/8"	3/4"	17.1	9.0	208 / 1 42 70	212	3/MP6.01	1
FC-10	SAMSUNG	AC054KNZDCH/AA		CLASSROOM 10	54	60	1150	450	3/8"	3/4"	-	-	NOTE 8	164	1/MP6.01	2, 3, 4, 5, 6,
HP-10	SAMSUNG	AC054KXADCH/AA		ROOF	- 54		-	-	3/8"	3/4"	17.1	9.0	208 / 1 42 70	212	3/MP6.01	1
FC-11	SAMSUNG	AC054KNZDCH/AA		CLASSROOM 11		60	1150	450	3/8"	3/4"	-	-	NOTE 8	164	1/MP6.01	2, 3, 4, 5, 6, 7
HP-11	SAMSUNG	AC054KXADCH/AA	BLDG 3	ROOF			-	-	3/8"	3/4"	17.1	9.0	208 / 1 42 70	212	3/MP6.01	1
FC-12	SAMSUNG	AC054KNZDCH/AA	-	CLASSROOM 12	54	60	1150	450	3/8"	3/4"	-	-	NOTE 8	164	1/MP6.01	2, 3, 4, 5, 6, 7
HP-12	SAMSUNG	AC054KXADCH/AA		ROOF			-	-	3/8"	3/4"	17.1	9.0	208 / 1 42 70	212	3/MP6.01	1
FC-13	SAMSUNG	AC054KNZDCH/AA		CLASSROOM 13	54	60	1150	450	3/8"	3/4"	-	-	NOTE 8	164	1/MP6.01	2, 3, 4, 5, 6, 7
HP-13	SAMSUNG	AC054KXADCH/AA	_	ROOF			-	-	3/8"	3/4"	17.1	9.0	208 / 1 42 70	212	3/MP6.01	1
FC-14	SAMSUNG	AC054KNZDCH/AA	-	CLASSROOM 14	54	60	1150	450	3/8"	3/4"	-	-	NOTE 8	164		2, 3, 4, 5, 6, 7
HP-14	SAMSUNG	AC054KXADCH/AA		ROOF			-	-	3/8"	3/4"	17.1	9.0	208 / 1 42 70	212	3/MP6.01	1
FC-15	SAMSUNG	AC054KNZDCH/AA		CLASSROOM 15	54	60	650	200	3/8"	5/8"	17.1	-	NOTE 8	164		2, 3, 4, 5, 6, 7
HP15	SAMSUNG	AC054KXADCH/AA	_	ROOF			1150	450	3/8"	5/8"	17.1	9.0	208 / 1 42 70	212	3/MP6.01	72450-
FC-16 HP-16	SAMSUNG SAMSUNG	AC054KNZDCH/AA AC054KXADCH/AA	-	CLASSROOM 16	54	60	1150	450	3/8"	3/4"	17.1	9.0	NOTE 8 208 / 1 42 70	164 212	1/MP6.01 3/MP6.01	2, 3, 4, 5, 6, 7
FC-17	SAMSUNG	AC054KNZDCH/AA		CLASSROOM 17			1150	450	3/8"	3/4"	17.1	9.0	NOTE 8	164		2, 3, 4, 5, 6, 7
HP-17	SAMSUNG	AC054KNZDCH/AA AC054KXADCH/AA	1	ROOF	54	60	-	450	3/8"	3/4"	17.1	9.0	208 / 1 42 70	212	3/MP6.01	1
FC-18	SAMSUNG	AC054KNZDCH/AA	BLDG 4	CLASSROOM 18			1150	450	3/8"	3/4"	-	-	NOTE 8	164		2, 3, 4, 5, 6, 7
HP-18	SAMSUNG	AC054KNZDCH/AA	-	ROOF	54	60	-	-	3/8"	3/4"	17.1	9.0	208 / 1 42 70	212	3/MP6.01	1
FC-19	SAMSUNG	AC054KNZDCH/AA	-	CLASSROOM 19			1150	450	3/8"	3/4"	-	-	NOTE 8	164	1/MP6.01	2, 3, 4, 5, 6, 7
HP-19	SAMSUNG	AC054KXADCH/AA	-	ROOF	54	60	-	-	3/8"	3/4"	17.1	9.0	208 / 1 42 70	212	3/MP6.01	1
FC-20	SAMSUNG	AC054KNZDCH/AA	-	CLASSROOM 20			1150	450	3/8"	3/4"	-	-	NOTE 8	164	1/MP6.01	2, 3, 4, 5, 6, 7
HP-20	SAMSUNG	AC054KXADCH/AA	-	ROOF	54	60			.						5.51	, -, -, -, -, -

- SPLIT SYSTEM SHALL BE ABLE TO OPERATE AT 94% HEATING CAPACITY DOWN TO 32°F OUTDOOR
 AMBIENT TEMPERATURE.
 CFM BASED ON 0.55 ESP.
 PROVIDE WITH CONDENSATE PUMP.

 PROVIDE WITH MERV-13 FILTERS WITH FILTER ACCESS PANEL.
 FAN COIL SHALL BE ADJUSTED TO OPERATE AT CONSTANT SPEED

HP-20 SAMSUNG AC054KXADCH/AA

- PROVIDE WITH SAMSUNG MIM-A60UN 24VAC THERMOSTAT ADAPTER AND 24VAC TRANSFORMER.
 PROVIDE WITH DELTA CONTROL THERMOSTAT WITH CO2 SENSOR. SEE MP5.01 FOR CONTROLS.
- 7. FAN COIL SHALL BE ADJUSTED TO OPERATE AT CONSTANT SPEED AT INDICATED CFM.

IDENTIFICATION STAMP DIV. OF THE STATE ARCHITECT APP: 01-119554 INC: REVIEWED FOR SS 🗹 FLS 🗹 ACS 🗹

architects


www.aedisarchitects.com 387 S. 1st Street, Suite 300 San Jose, CA 95113 tel: (408)-300-5160 fax: (408)-300-5121


PROJECT

MEADOW HEIGHTS ELEMENTARY SCHOOL - HVAC REPLACEMENT

SAN MATEO-FOSTER CITY SCHOOL DISTRICT

CONSULTANT

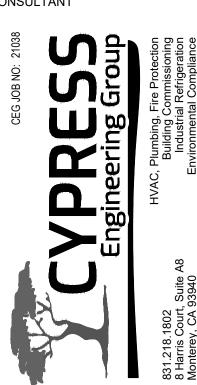



DSA FILE NUMBER 01-119554

REVISIONS

No. Description Date

MILESTONES


DD 90% CD

DSA SUB 06/02/2021 BACKCHECK


SHEET


MECHANICAL

^{JOB}#2021005.04

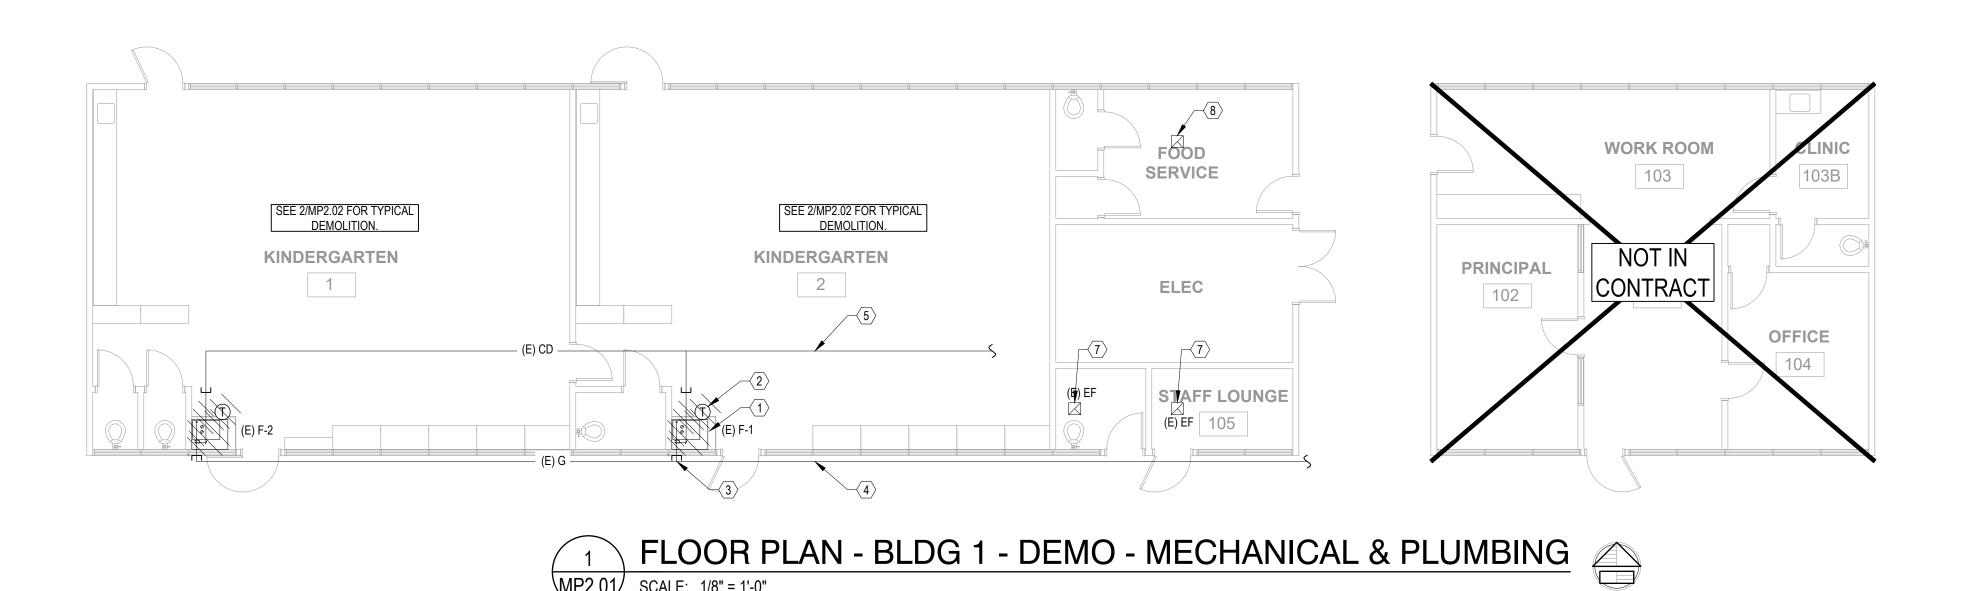

MP2.01 SCALE: 1/8" = 1'-0"

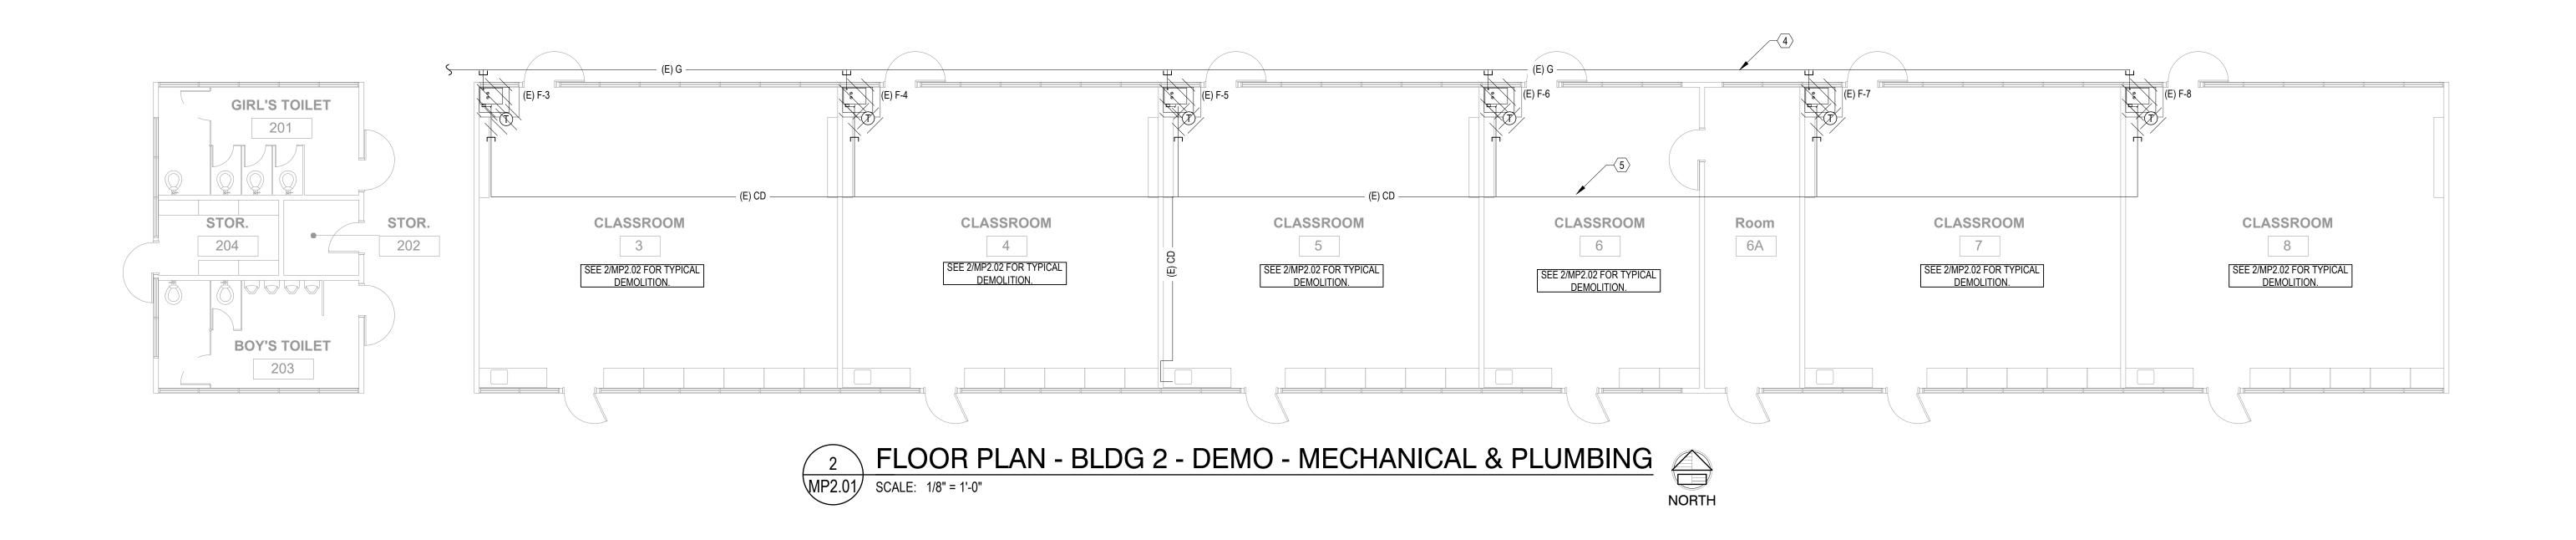

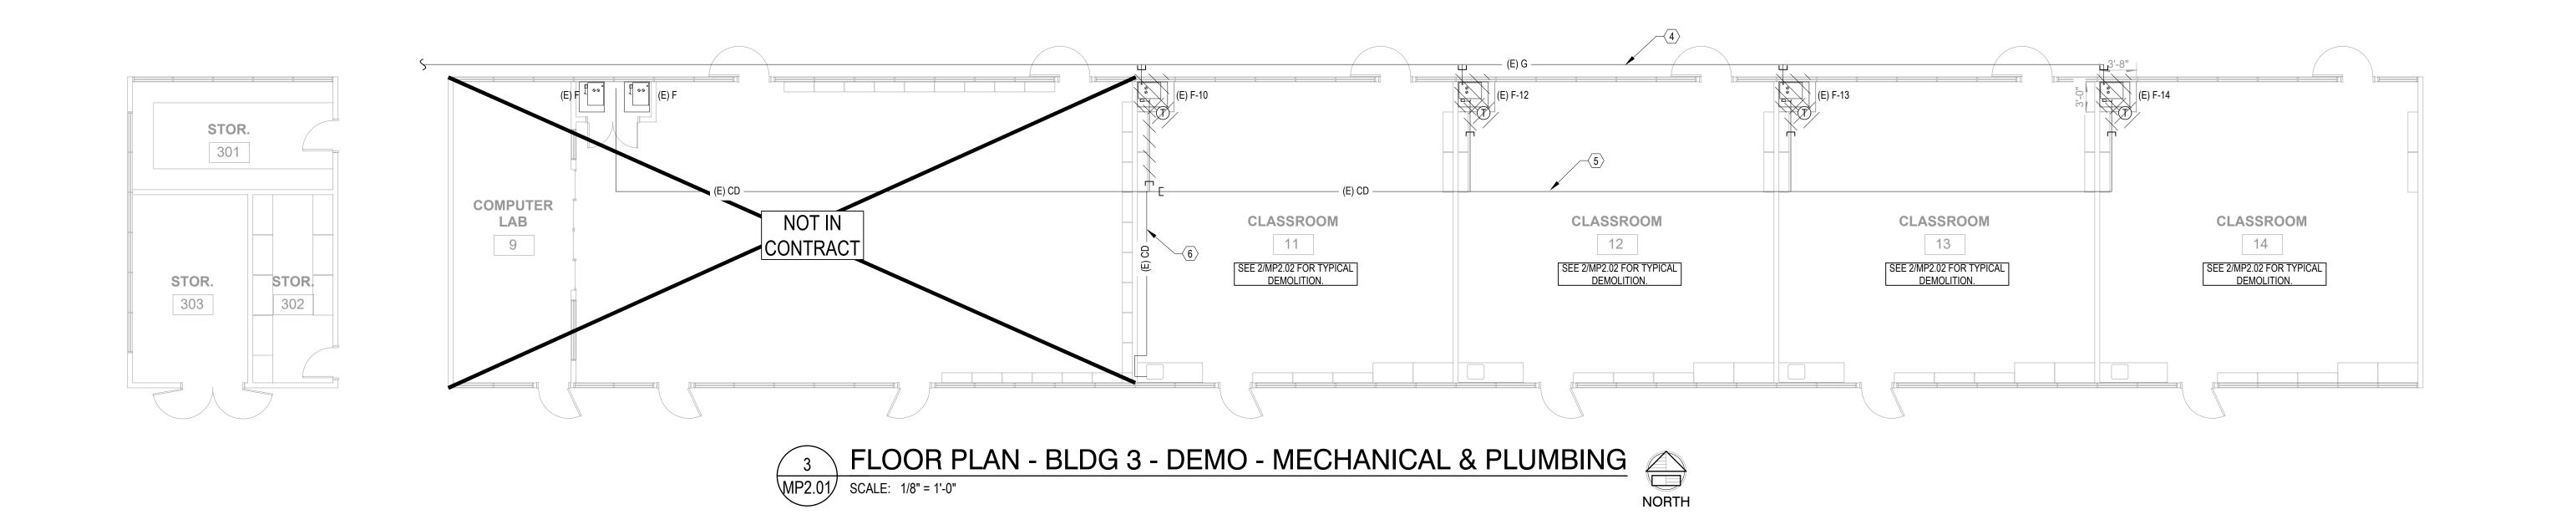

GENERAL NOTES

CONTRACTOR SHALL BE RESPONSIBLE FOR PROTECTING ALL EXISTING AND NEW BUILDING STRUCTURES, SERVICES AND OWNER'S PROPERTY DURING THE ENTIRE PERIOD OF CONSTRUCTION.

DEMOLITION SHEET NOTES

. REMOVE (E) THERMOSTAT AND WIRING BACK TO (E) FURNACE, TYP OF (14).

5. CAP AND ABANDON (E) CD ABOVE CEILING WITHIN 5' OF THE (E) FURNACE ENCLOSURE, TYP.

6. CAP (E) CD ABOVE CEILING. TEST TO ENSURE (E) CD LINE SERVING THE LIBRARY FURNACE UNITS IS STILL

4. (E) GAS MAIN TO REMAIN, TYP.

8. (E) EXHAUST GRILLE TO REMAIN.

FUNCTIONAL.

7. (E) EF TO REMAIN.

REMOVE (E) FURNACE ENCLOSURE AND FURNACE, COMPLETE. SEE 2/MP2.02 FOR TYPICAL FURNACE DEMO. TYP OF

REMOVE (E) GAS BRANCH LINE FROM FURNACE BACK TO MAIN. CAP OR PLUG (E) BRANCH LINE AT (E) GAS MAIN TEE,

COORDINATE THE LOCATIONS OF ROOF/ WALL OPENINGS, PENETRATIONS, DUCTWORK AND ALL MECHANICAL EQUIPMENT WITH RESPECT TO BUILDING STRUCTURE AND OTHER BUILDING SERVICES TO AVOID CONFLICT.

IDENTIFICATION STAMP DIV. OF THE STATE ARCHITEC APP: 01-119554 INC: REVIEWED FOR SS 🗹 FLS 🗹 ACS 🗹

architects


www.aedisarchitects.com 387 S. 1st Street, Suite 300 San Jose, CA 95113 tel: (408)-300-5160 fax: (408)-300-5121

PROJECT

MEADOW HEIGHTS ELEMENTARY SCHOOL - HVAC REPLACEMENT

SAN MATEO-FOSTER CITY SCHOOL DISTRICT

CONSULTANT



DSA FILE NUMBER 41-26 01-119554

REVISIONS

No. Description Date

MILESTONES DD 90% CD

DSA SUB 06/02/2021 09/22/2021 BACKCHECK

SHEET

BUILDING KEY


] [///// 3

FLOOR PLAN -DEMO - BLDGS 1, 2, & 3 -MECHANICAL & PLUMBING

09/17/2021 ^{JOB}*2021005.04

(E) F-16 (E) F-17 (E) F-19 **GIRL'S TOILET** STOR. CLASSROOM CLASSROOM CLASSROOM CLASSROOM CLASSROOM CLASSROOM 17 18 20 SEE 2/MP2.02 FOR TYPICAL DEMOLITION. **BOY'S TOILET** 403

1 FLOOR PLAN - BLDG 4 - DEMO - MECHANICAL & PLUMBING MP2.02 SCALE: 1/8" = 1'-0"

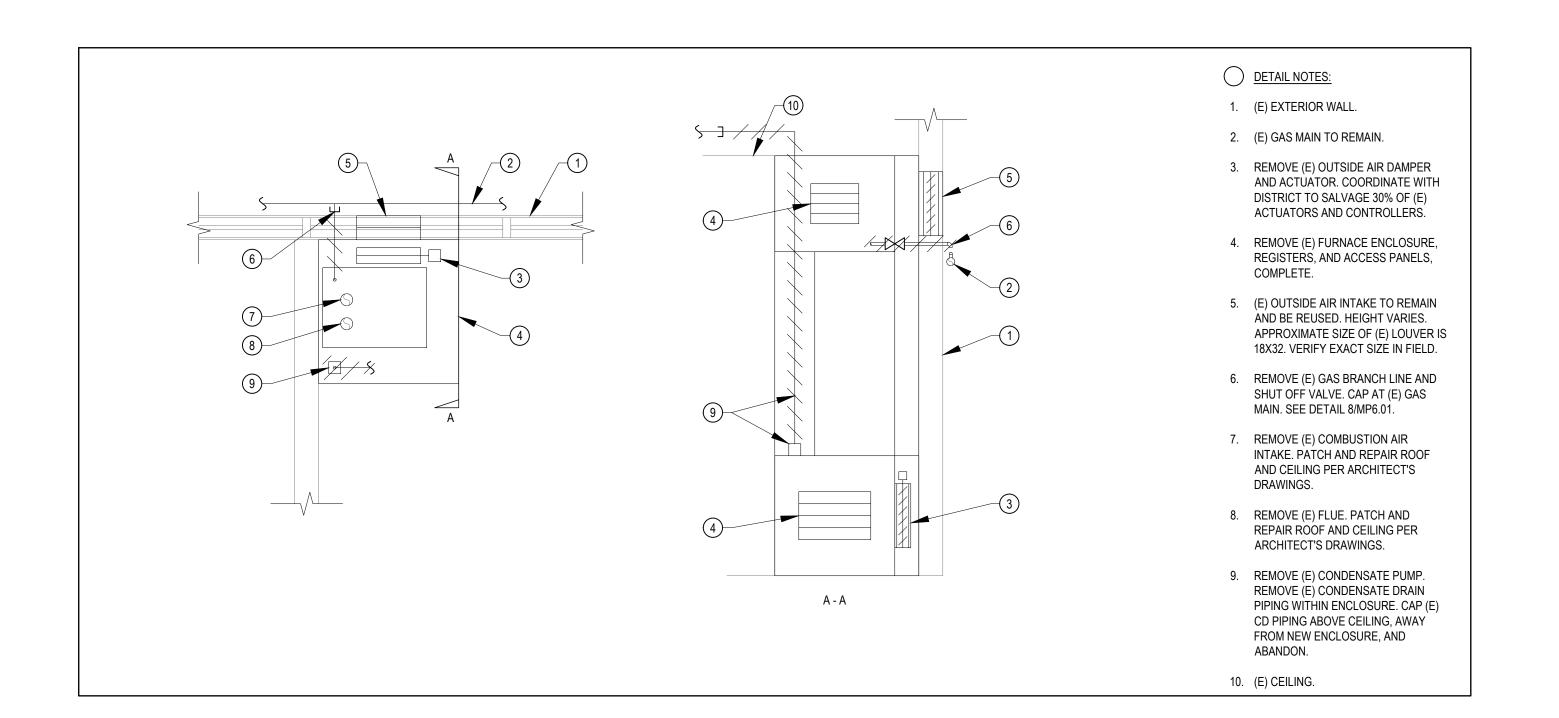

TYPICAL FURNACE - DEMO - MECHANICAL & PLUMBING
MP2.02 SCALE: NO SCALE

GENERAL NOTES

- CONTRACTOR SHALL BE RESPONSIBLE FOR PROTECTING ALL EXISTING AND NEW BUILDING STRUCTURES, SERVICES AND OWNER'S PROPERTY DURING THE ENTIRE PERIOD OF CONSTRUCTION.
- COORDINATE THE LOCATIONS OF ROOF/ WALL OPENINGS, PENETRATIONS, DUCTWORK AND ALL MECHANICAL EQUIPMENT WITH RESPECT TO BUILDING STRUCTURE AND OTHER BUILDING SERVICES TO AVOID CONFLICT.

DEMOLITION SHEET NOTES

2. REMOVE (E) THERMOSTAT AND WIRING BACK TO (E) FURNACE, TYP OF (6).

5. CAP AND ABANDON (E) CD ABOVE CEILING WITHIN 5' OF THE (E) FURNACE ENCLOSURE, TYP.

4. (E) GAS MAIN TO REMAIN, TYP.

REMOVE (E) FURNACE ENCLOSURE AND FURNACE, COMPLETE. SEE 2/MP2.02 FOR TYPICAL FURNACE DEMO. TYP OF

. REMOVE (E) GAS BRANCH LINE FROM FURNACE BACK TO MAIN. CAP OR PLUG (E) BRANCH LINE AT MAIN TEE, SEE

IDENTIFICATION STAMP DIV. OF THE STATE ARCHITECT APP: 01-119554 INC: REVIEWED FOR SS 🗹 FLS 🗹 ACS 🗹

architects


www.aedisarchitects.com 387 S. 1st Street, Suite 300 San Jose, CA 95113 tel: (408)-300-5160


fax: (408)-300-5121

PROJECT

MEADOW HEIGHTS ELEMENTARY SCHOOL - HVAC REPLACEMENT

SAN MATEO-FOSTER CITY SCHOOL DISTRICT

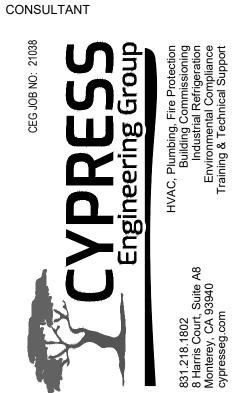



STATE 41-26 DSA FILE NUMBER 01-119554 APPL#

REVISIONS

No. Description Date

MILESTONES

90% CD DSA SUB 06/02/2021 BACKCHECK


FLOOR PLAN -


DEMO - BLDG 4 -MECHANICAL & PLUMBING

09/17/2021 ^{JOB #}2021005.04

MP2.02

BUILDING KEY



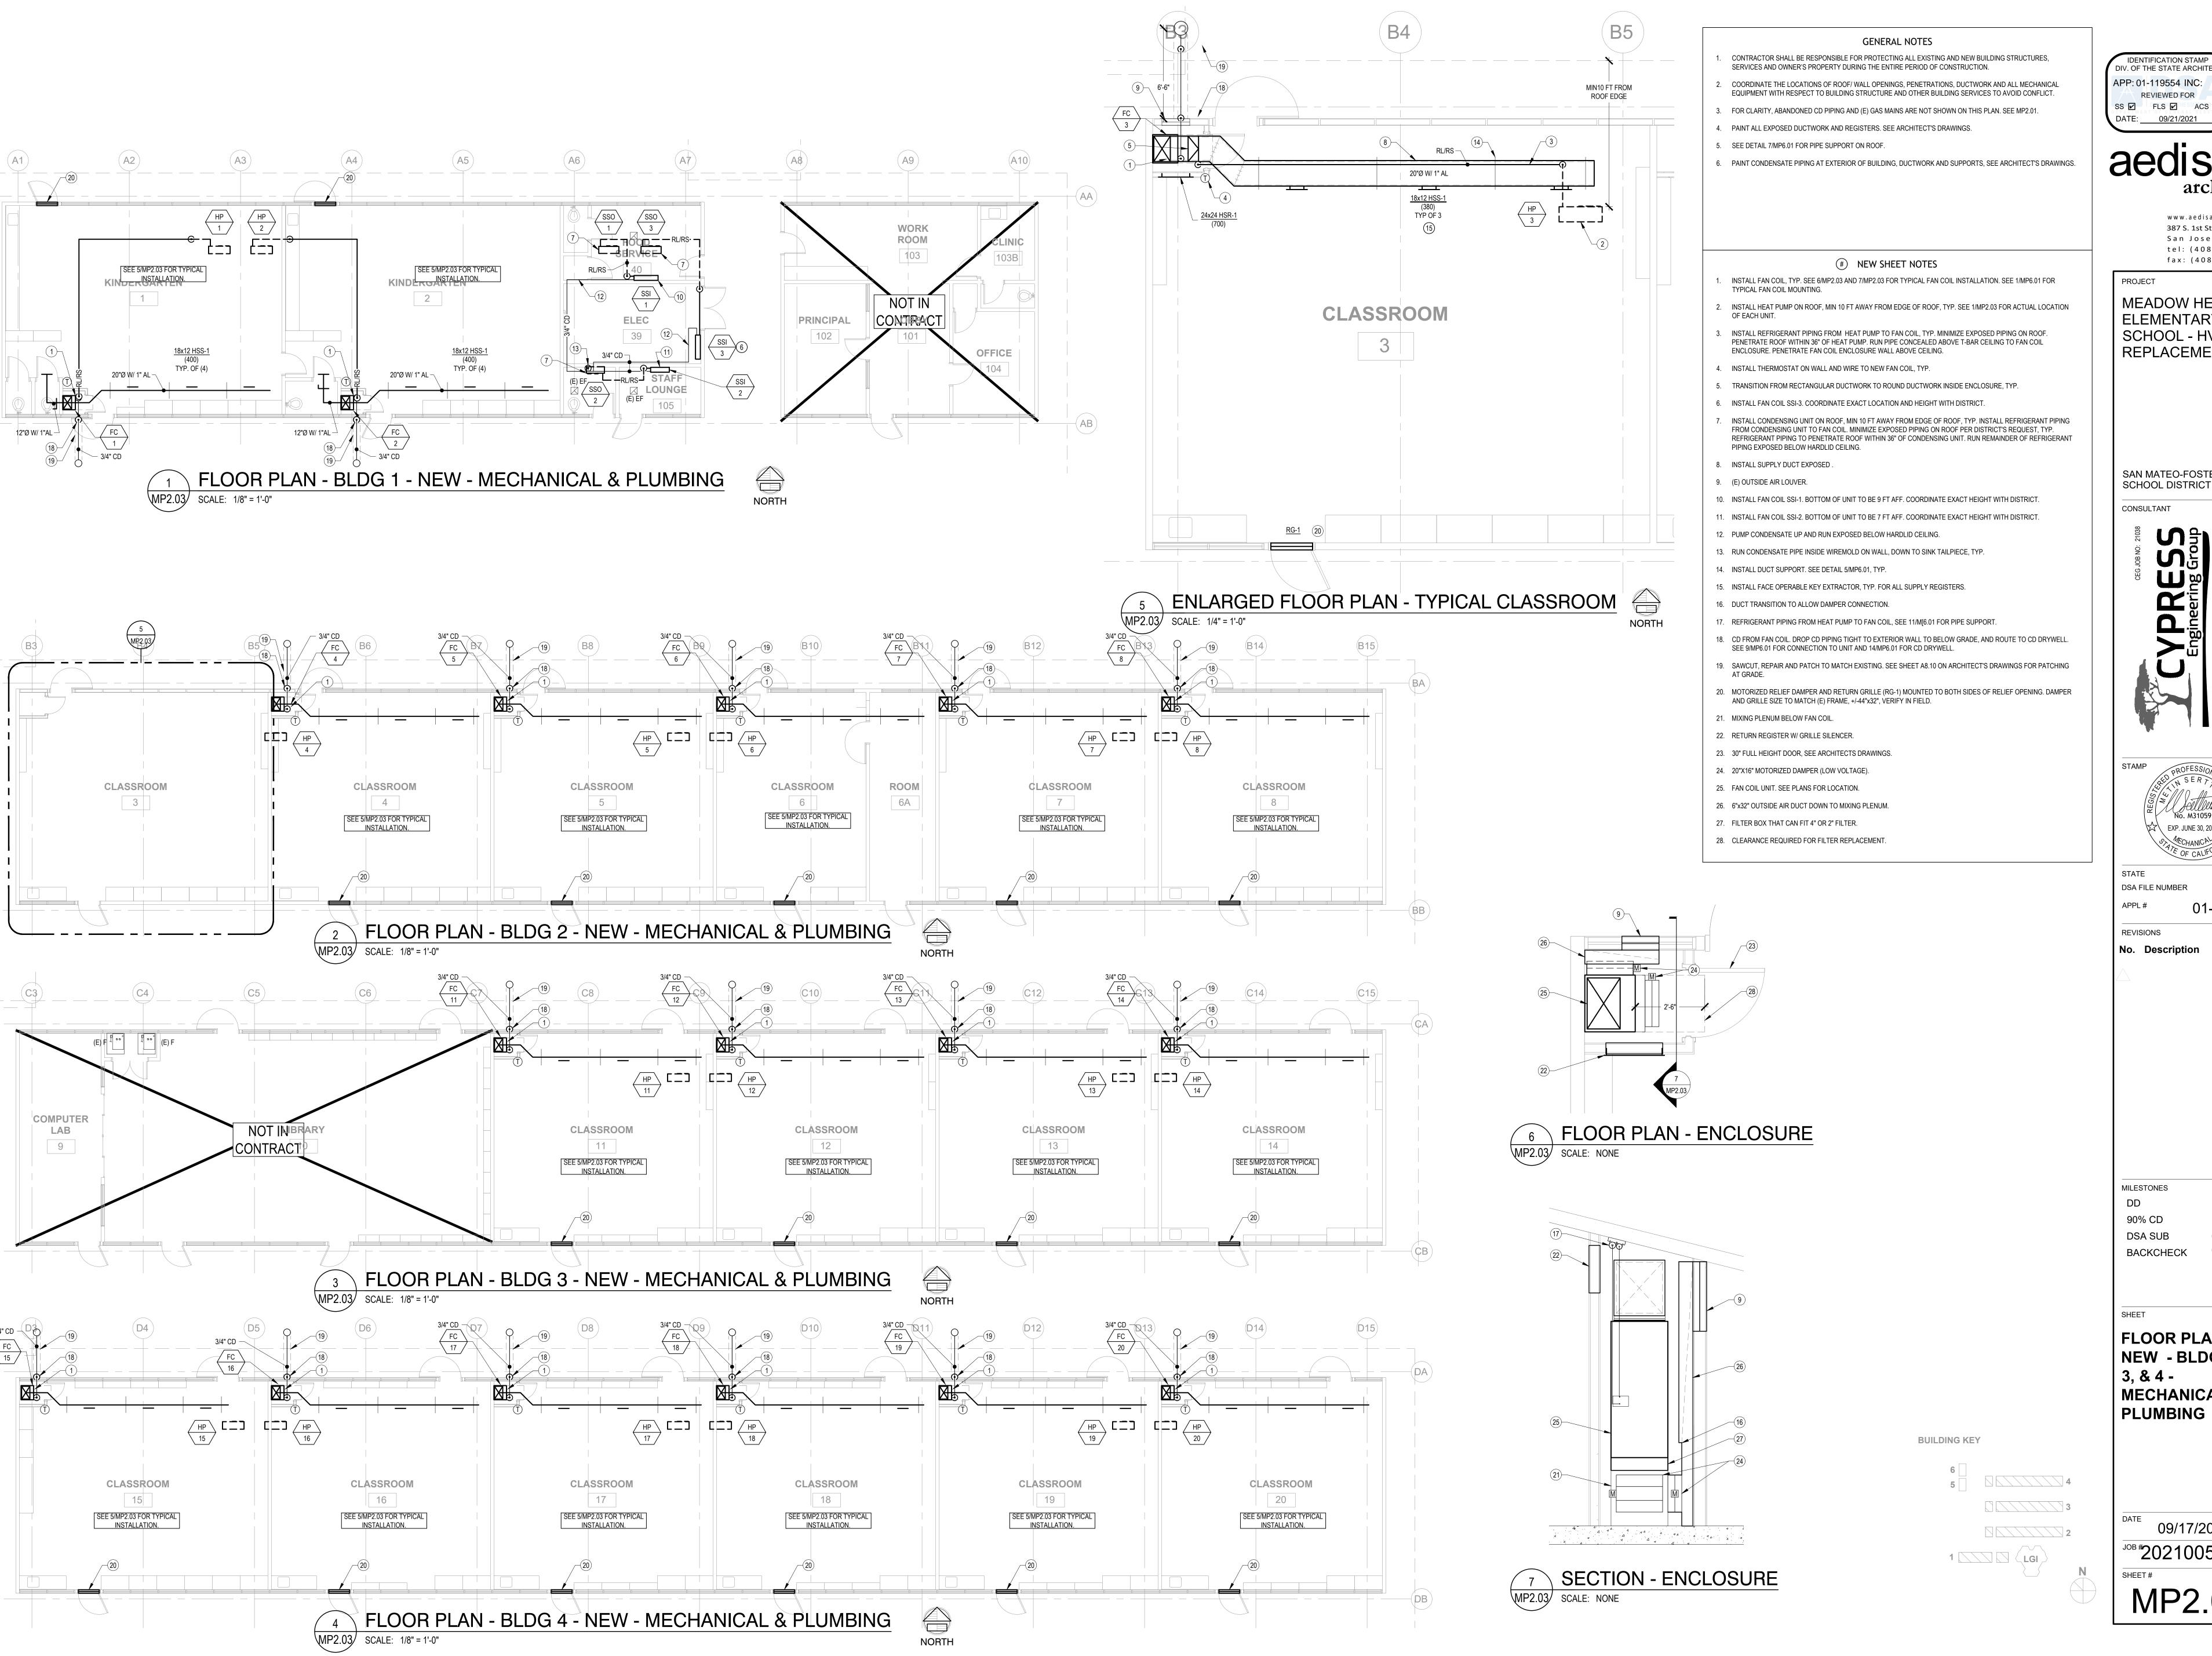

IDENTIFICATION STAMP DIV. OF THE STATE ARCHITEC APP: 01-119554 INC: REVIEWED FOR SS 🗹 FLS 🗹 ACS 🗹

architects

www.aedisarchitects.com 387 S. 1st Street, Suite 300 San Jose, CA 95113 tel: (408)-300-5160 fax: (408)-300-5121

PROJECT

MEADOW HEIGHTS ELEMENTARY SCHOOL - HVAC REPLACEMENT

SAN MATEO-FOSTER CITY

CONSULTANT

41-26 DSA FILE NUMBER 01-119554

REVISIONS

No. Description Date

DSA SUB BACKCHECK


06/02/2021


FLOOR PLAN -NEW - BLDGS 1, 2, 3, & 4 -

MECHANICAL & PLUMBING

09/17/2021 ^{JOB #}2021005.04

MP2.03

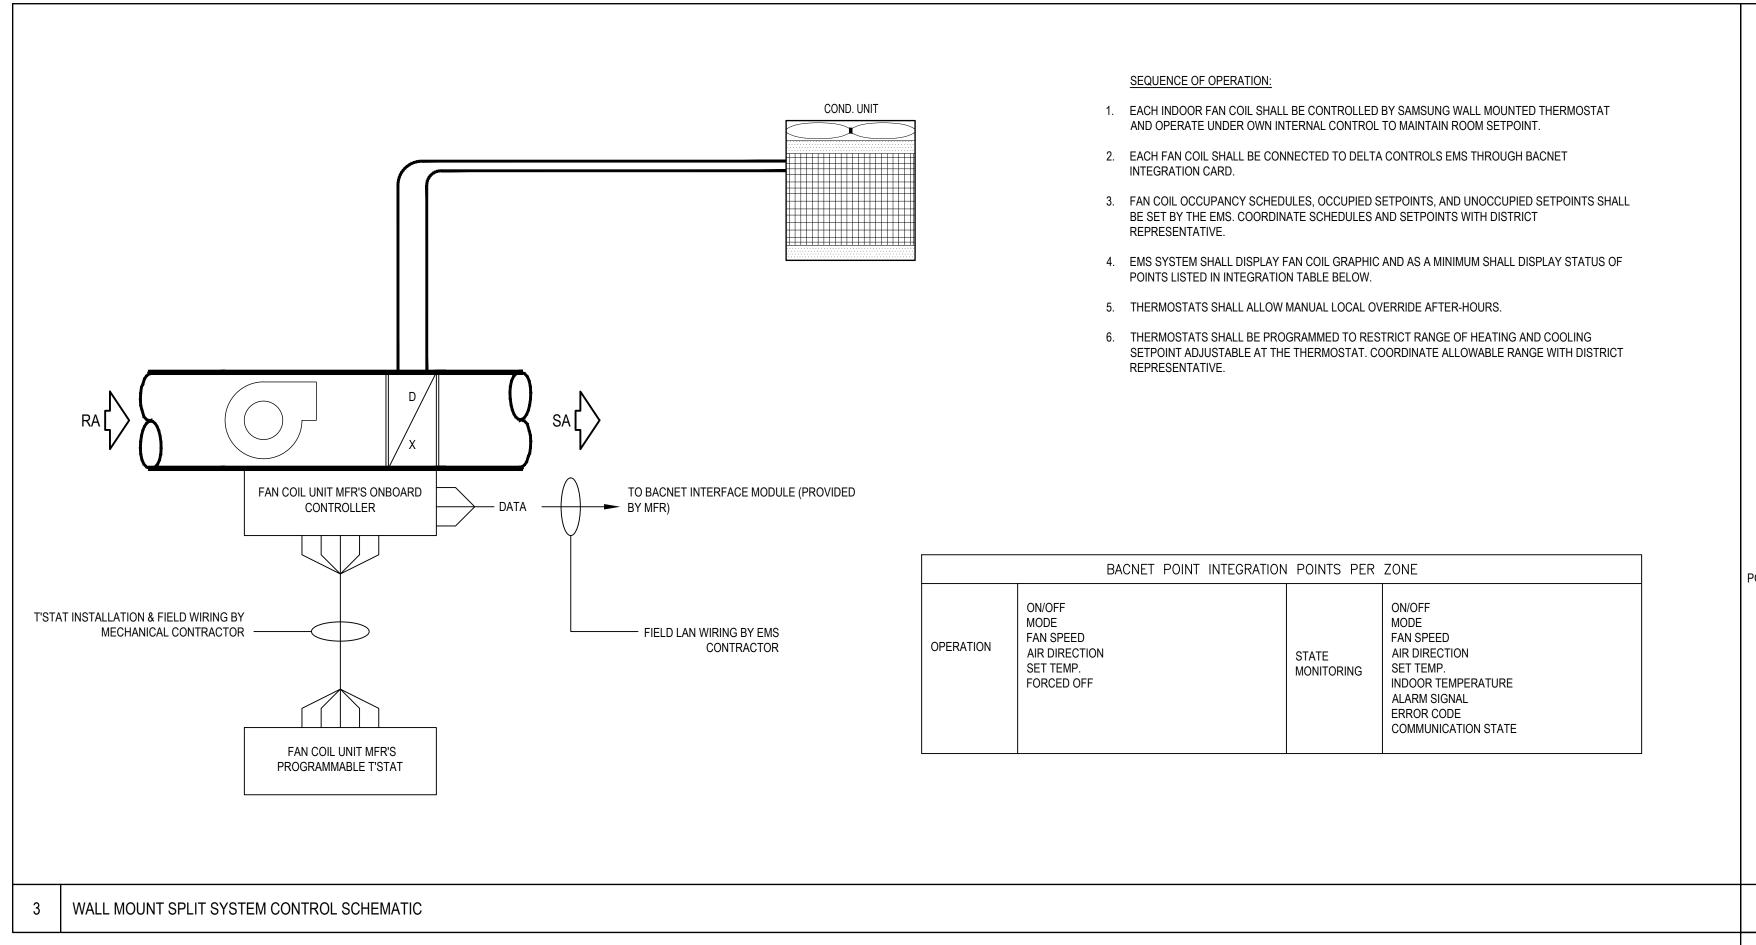

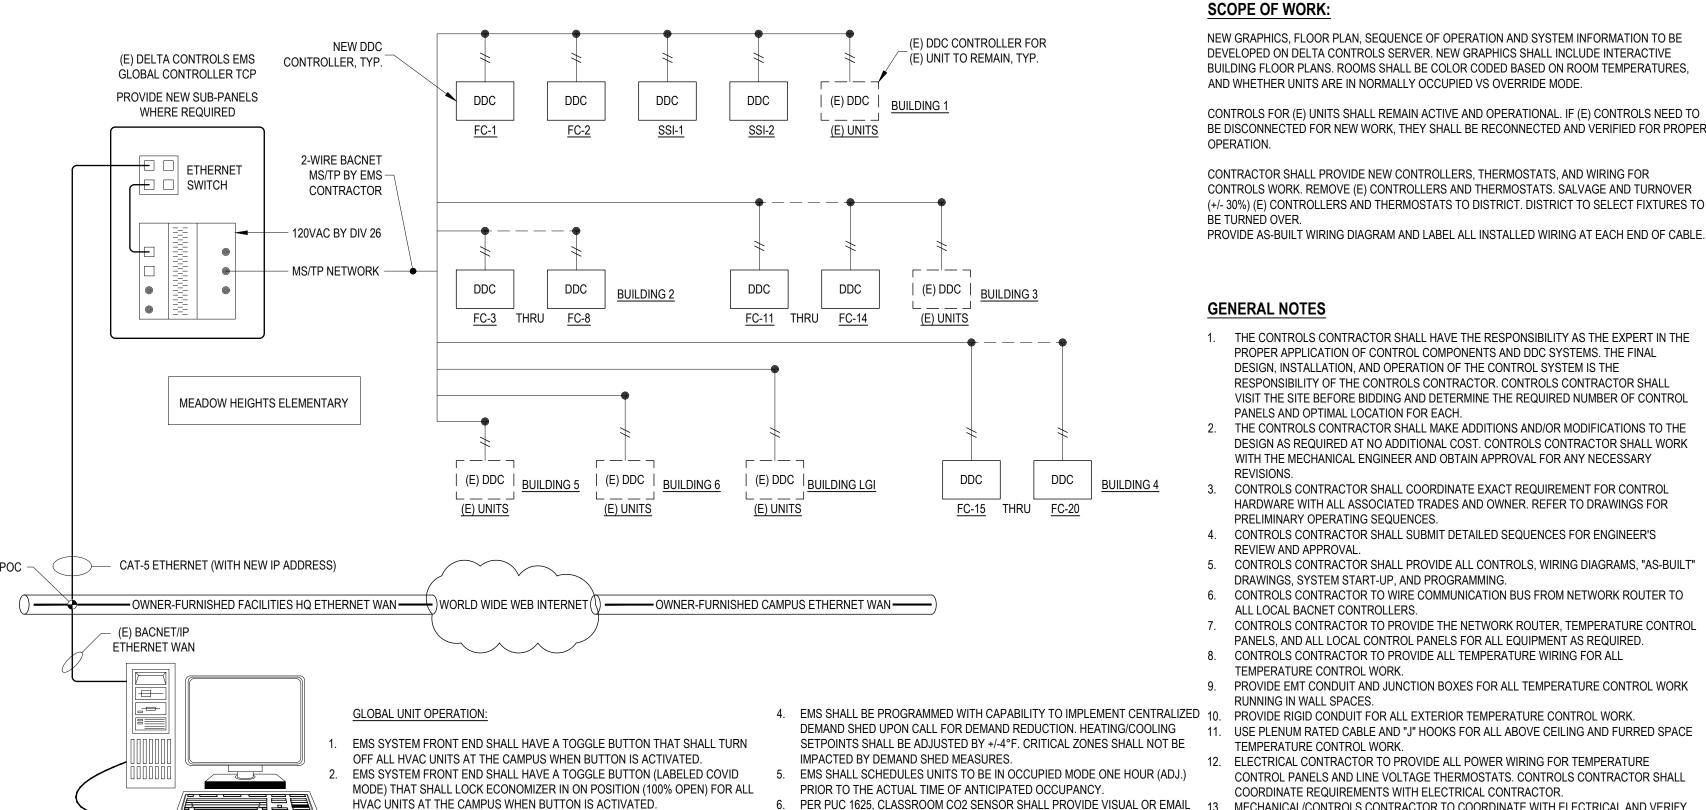

HVAC UNITS AT THE CAMPUS WHEN BUTTON IS ACTIVATED. EMS SYSTEM FRONT END SHALL HAVE A TOGGLE BUTTON (LABELED WILD FIRE NOTIFICATION IF CO2 LEVELS RISE ABOVE 1,100 PPM IN A ROOM. MODE) THAT SHALL LOCK THE OUTSIDE AIR DAMPER AT A USER ADJUSTABLE SETPOINT FOR ALL HVAC UNITS AT THE CAMPUS WHEN BUTTON IS ACTIVATED

6. PER PUC 1625, CLASSROOM CO2 SENSOR SHALL PROVIDE VISUAL OR EMAIL 13. MECHANICAL/CONTROLS CONTRACTOR TO COORDINATE WITH ELECTRICAL AND VERIFY

COOLING OPERATION

SCOPE OF WORK:

NEW GRAPHICS, FLOOR PLAN, SEQUENCE OF OPERATION AND SYSTEM INFORMATION TO BE DEVELOPED ON DELTA CONTROLS SERVER. NEW GRAPHICS SHALL INCLUDE INTERACTIVE BUILDING FLOOR PLANS. ROOMS SHALL BE COLOR CODED BASED ON ROOM TEMPERATURES, AND WHETHER UNITS ARE IN NORMALLY OCCUPIED VS OVERRIDE MODE.

CONTROLS FOR (E) UNITS SHALL REMAIN ACTIVE AND OPERATIONAL. IF (E) CONTROLS NEED TO BE DISCONNECTED FOR NEW WORK, THEY SHALL BE RECONNECTED AND VERIFIED FOR PROPER

CONTRACTOR SHALL PROVIDE NEW CONTROLLERS, THERMOSTATS, AND WIRING FOR CONTROLS WORK. REMOVE (E) CONTROLLERS AND THERMOSTATS. SALVAGE AND TURNOVER (+/- 30%) (E) CONTROLLERS AND THERMOSTATS TO DISTRICT. DISTRICT TO SELECT FIXTURES TO BE TURNED OVER.

GENERAL NOTES

- 1. THE CONTROLS CONTRACTOR SHALL HAVE THE RESPONSIBILITY AS THE EXPERT IN THE PROPER APPLICATION OF CONTROL COMPONENTS AND DDC SYSTEMS. THE FINAL DESIGN, INSTALLATION, AND OPERATION OF THE CONTROL SYSTEM IS THE RESPONSIBILITY OF THE CONTROLS CONTRACTOR. CONTROLS CONTRACTOR SHALL VISIT THE SITE BEFORE BIDDING AND DETERMINE THE REQUIRED NUMBER OF CONTROL PANELS AND OPTIMAL LOCATION FOR EACH.
- 2. THE CONTROLS CONTRACTOR SHALL MAKE ADDITIONS AND/OR MODIFICATIONS TO THE DESIGN AS REQUIRED AT NO ADDITIONAL COST. CONTROLS CONTRACTOR SHALL WORK WITH THE MECHANICAL ENGINEER AND OBTAIN APPROVAL FOR ANY NECESSARY
- CONTROLS CONTRACTOR SHALL COORDINATE EXACT REQUIREMENT FOR CONTROL HARDWARE WITH ALL ASSOCIATED TRADES AND OWNER. REFER TO DRAWINGS FOR
- PRELIMINARY OPERATING SEQUENCES. 4. CONTROLS CONTRACTOR SHALL SUBMIT DETAILED SEQUENCES FOR ENGINEER'S
- REVIEW AND APPROVAL.
- 5. CONTROLS CONTRACTOR SHALL PROVIDE ALL CONTROLS, WIRING DIAGRAMS, "AS-BUILT" DRAWINGS, SYSTEM START-UP, AND PROGRAMMING.
- ALL LOCAL BACNET CONTROLLERS. 7. CONTROLS CONTRACTOR TO PROVIDE THE NETWORK ROUTER, TEMPERATURE CONTROL PANELS, AND ALL LOCAL CONTROL PANELS FOR ALL EQUIPMENT AS REQUIRED.
- 8. CONTROLS CONTRACTOR TO PROVIDE ALL TEMPERATURE WIRING FOR ALL TEMPERATURE CONTROL WORK. 9. PROVIDE EMT CONDUIT AND JUNCTION BOXES FOR ALL TEMPERATURE CONTROL WORK
- RUNNING IN WALL SPACES.
- 11. USE PLENUM RATED CABLE AND "J" HOOKS FOR ALL ABOVE CEILING AND FURRED SPACE TEMPERATURE CONTROL WORK.
- 12. ELECTRICAL CONTRACTOR TO PROVIDE ALL POWER WIRING FOR TEMPERATURE CONTROL PANELS AND LINE VOLTAGE THERMOSTATS. CONTROLS CONTRACTOR SHALL COORDINATE REQUIREMENTS WITH ELECTRICAL CONTRACTOR.
- CIRCUITS ARE CORRECT BEFORE WIRING CONTROLS. 14. MECHANICAL/CONTROLS CONTRACTOR TO PROVIDE ALL CONTROL COMPONENTS NECESSARY TO FULFILL THE DESIGN INTENT OF THE DRAWINGS.

EMS SYSTEM ARCHITECTURE

SYSTEM) UNITARY CONTROLLER.

SEQUENCE OF OPERATION

- SYSTEM OVERVIEW A. EACH FAN COIL /HEAT PUMP UNIT UNIT WILL BE DIRECTLY CONTROLLED BY ITS OWN DEDICATED EMS (ENERGY MANAGEMENT
- B. EMS UNITARY CONTROLLER WILL BE CONNECTED TO A WALL MOUNTED ELECTRONIC THERMOSTAT. C. ELECTRONIC THERMOSTAT SHALL HAVE AN INTERFACE WHICH
- INCLUDES: 1) PUSHBUTTONS FOR WARMER/COOLER SETPOINT CONTROL; 2) VISUAL DISPLAY OF ROOM TEMPERATURE & CO2, AND 3) AFTER-HOURS OVERRIDE TIMER CONTROL, WITH USER ADJUSTABLE
- DURATION (2 HOURS MAX). THE AFTER-HOURS OVERRIDE DURATION SHALL HAVE THE ABILITY TO BE LIMITED FROM THE FRONT-END. D. EMS UNITARY CONTROLLER SHALL BE WIRED TO MANUFACTURER'S THERMOSTAT ADAPTER.
- 3. UNIT FAN OPERATION A. WHEN THE ZONE IS IN OCCUPIED MODE OR IN OVERRIDE MODE, THE FAN SHALL RUN CONTINUOUSLY
- B. DURING THE UNOCCUPIED MODE AS DETERMINED BY EMS TIME SCHEDULE, THE UNIT FAN CYCLES WITH DEMAND AND THE TEMPERATURE IS CONTROLLED BY THE UNOCCUPIED SPACE
- TEMPERATURE HEATING AND COOLING SETPOINTS. 4. MINIMUM OUTDOOR AIR VENTILATION A. DURING OCCUPIED MODE OR AFTERHOURS MODE, THE OUTSIDE AIR DAMPER SHALL BE COMMANDED BY THE EMS UNITARY CONTROLLER TO MAINTAIN A POSITION WHICH SATISFIES THE MINIMUM (DESIGN) OUTDOOR AIR VENTILATION REQUIREMENTS FOR THE ZONE. DESIGN
- OA CFM IS LISTED ON EQUIPMENT SCHEDULE. DAMPER POSITION(S) DETERMINED BY AIR BALANCING CONTRACTOR. RETURN AIR DAMPER SHALL BE ADJUSTED TO BE INVERSE OF OUTSIDE AIR DAMPER. 5. DEMAND CONTROL VENTILATION A. IF ROOM CO2 LEVELS RISE ABOVE 1000 PPM (ADJ.), THE OUTSIDE AIR

CO2 LEVELS DROP BELOW 800 PPM (ADJ.).

DAMPER SHALL BE MODULATED OPEN TO MAXIMUM POSITION UNTIL

- 6. HEATING OPERATION
- SPACE TEMPERATURE AND DETERMINES A NEED-HEATING CONTROL SIGNAL TO MAINTAIN SETPOINT. B. MECHANICAL COOLING TO BE LOCKED OUT DURING HEATING MODE.
- A. EMS UNITARY CONTROLLER SHALL BE DIRECTLY CONNECTED TO
- AMBIENT OUTSIDE AIR TEMPERATURE TO ECONOMIZER (OUTSIDE/RETURN AIR) DAMPER ACTUATOR,
- INCLUDING POSITION FEEDBACK SIGNAL. C. SEE MINIMUM OUTDOOR AIR VENTILATION FOR OUTSIDE AIR DAMPER MINIMUM CFM SETPOINT D. THE EMS UNITARY CONTROLLER SHALL CONTINUOUSLY COMPARE
- THE CURRENT OSA TEMPERATURE TO THE ESTABLISHED AIR ECONOMIZER HIGH LIMIT SHUT OFF (ECON LOCK OUT) TEMPERATURE SET POINT (ADJUSTABLE) AND RETURN AIR TEMPERATURE.
- OUT TEMP AND THE RETURN AIR TEMPERATURE, EMS UNITARY CONTROLLER SHALL USE THE OUTSIDE AIR FOR FREE COOLING. F. WHEN THE OUTDOOR AIR DAMPER IS OPEN 100% FOR MORE THAN 5 MINUTES (ADJUSTABLE) AND THE NEED-COOLING SIGNAL CONTINUES TO INCREASE OR REACHES A MAXIMUM OF 100%, MECHANICAL
- COOLING WILL BE ACTIVATED. G. THE ECONOMIZER WILL REMAIN IN USE DURING MECHANICAL COOLING AS LONG AS DISCHARGE AIR TEMPERATURE REMAINS ABOVE 55°F (ADJUSTABLE) AND CURRENT OSA TEMP IS LESS THAN
- H. WHEN OSA TEMP IS ABOVE ECON LOCK OUT TEMP OR RETURN AIR TEMP, ECONOMIZER WILL BE DEACTIVATED AND ECONOMIZER SHALL

- J. WHEN UNIT FAN IS NOT OPERATING, OUTSIDE AIR DAMPER SHALL BE COMMANDED CLOSED
- SPACE TEMPERATURE AND DETERMINES A NEED-COOLING SIGNAL. B. FREE COOLING (ECONOMIZER) WILL BE USED FIRST WHEN POSSIBLE. MECHANICAL COOLING SHALL BE ENGAGED IF SETPOINT IS UNABLE TO BE MET WITH ECONOMIZING.

A. THE CONTROLLER COMPARES THE COOLING SETPOINT WITH THE

- C. THE CONTROLLER WILL ENABLE THE COMPRESSOR(S) TO MAINTAIN THE ROOM SET POINT. D. MECHANICAL HEATING TO BE LOCKED OUT DURING COOLING MODE.
- 9. ROOM PRESSURE CONTROL A. EMS UNITARY CONTROLLER SHALL BE CONNECTED TO STATIC PRESSURE PROBE LOCATED IN EACH ROOM. CONTROLS
- CONTRACTOR SHALL INSTALL AND CONNECT PRESSURE SENSOR. B. EMS UNITARY CONTROLLER SHALL MODULATE RELIEF LOUVER OPEN TO MAINTAIN ROOM STATIC PRESSURE SETPOINT OF +0.03" WC MAXIMUM. 10.SETPOINTS
- A. OCCUPIED HOURS SETPOINTS SHALL BE 68°F TO 74°F. (USER ADJUSTABLE AT THERMOSTAT WITHIN THIS RANGE). B. UNOCCUPIED HOURS SETPOINTS SHALL BE 60°F HEATING AND 90°F COOLING. C. DEADBAND SHALL BE 2°F.
- 11.FAULT DETECTION DIAGNOSTICS A. THE EMS DDC CONTROLLER SHALL MONITOR FAULT STATUS OF THE FOLLOWING FAULT DETECTION DIAGNOSTIC CONDITIONS AND
- BROADCAST RESULTS VIA EMS NETWORK. B. UNIT NOT ECONOMIZING WHEN ENABLED - IF ECONOMIZER DAMPER ACTUATOR FEEDBACK STATUS DOES NOT MATCH THE COMMANDED ECONOMIZER SETPOINT WHEN THE ECONOMIZER IS ENABLED FOR

MORE THAN 3 MINUTES (ADJUSTABLE), AN ALARM SHALL BE

GENERATED AND BROADCAST.

- DAMPER IS OPEN BEYOND THE MIN CFM SETPOINT WHEN THE ECONOMIZER IS NOT ENABLED FOR MORE THAN 3 MINUTES
- (ADJUSTABLE), AN ALARM SHALL BE GENERATED AND BROADCAST. D. DAMPER MODULATION FAULT - IF ECONOMIZER DAMPER ACTUATOR FEEDBACK PERCENT DOES NOT MATCH THE COMMANDED ECONOMIZER DAMPER PERCENT FOR MORE THAN 3 MINUTES

(ADJUSTABLE), AN ALARM SHALL BE GENERATED AND BROADCAST.

- E. EXCESS OUTDOOR AIR IF ECONOMIZER DAMPER ACTUATOR FEEDBACK STATUS INDICATES THAT THE ECONOMIZER DAMPER IS OPEN BEYOND MIN CFM SETPOINT IN HEATING MODE, AN ALARM SHALL BE GENERATED AND BROADCAST.
- 12.MONITORING THE FOLLOWING CONDITIONS SHALL BE MONITORED AND DISPLAYED AT EMS OPERATOR WORKSTATION/GRAPHICAL USER
- INTERFACE: A. SUPPLY AIR TEMPERATURE. B. MIXED AIR TEMPERATURE.
- C. OUTSIDE AIR TEMPERATURE. D. ROOM TEMPERATURE.
- E. ROOM CO2 LEVEL. F. CURRENT MODE (HEATING/COOLING/FAN).
- G. FAN STATUS THRU CURRENT SWITCH. H. RETURN AIR DAMPER POSITION. I. OUTSIDE AIR DAMPER POSITION.
- 13.ALARMS AT A MINIMUM THE FOLLOWING ALARMS SHALL BE DISPLAYED ON THE GRAPHICAL USER INTERFACE:
- A. ROOM TEMPERATURE OUT OF BOUNDS. B. ROOM CO2 TOO HIGH. C. FAN NOT RUNNING.
- D. DAMPER POSITION DOES NOT MATCH COMMAND.

IDENTIFICATION STAMP

DIV. OF THE STATE ARCHITEC

REVIEWED FOR

SS 🗹 FLS 🗹 ACS 🗹

architects

www.aedisarchitects.com

387 S. 1st Street, Suite 300

San Jose, CA 95113

tel: (408)-300-5160

fax: (408)-300-5121

MEADOW HEIGHTS

ELEMENTARY

SCHOOL - HVAC

SAN MATEO-FOSTER CITY

SCHOOL DISTRICT

CONSULTANT

REPLACEMENT

APP: 01-119554 INC:

DATE: 09/21/2021

PROJECT

DSA FILE NUMBER

01-119554

REVISIONS

No. Description Date

MILESTONES

DD

90% CD DSA SUB BACKCHECK

06/02/2021 09/22/2021

MECHANICAL


09/17/2021


^{JOB}*2021005.04

A. THE CONTROLLER COMPARES THE HEATING SETPOINT WITH THE

- 7. ECONOMIZER CONTROL
 - DISCHARGE AIR AND RETURN AIR TEMPERATURE SENSORS. GLOBAL DDC PROGRAMMING SHALL BE USED TO BROADCAST CENTRALIZED B. EMS UNITARY CONTROLLER SHALL ALSO BE DIRECTLY CONNECTED

 - E. WHEN CURRENT OSA TEMP IS LESS THAN OR EQUAL TO ECON LOCK
 - ECON LOCK OUT TEMP AND RETURN AIR TEMP.
 - BE COMMANDED TO MINIMUM CFM SETPOINT. ECONOMIZER WILL BE COMMANDED TO MINIMUM CFM SETPOINT WHEN UNIT IS IN HEATING MODE.
 - C. UNIT ECONOMIZING WHEN DISABLED IF ECONOMIZER DAMPER ACTUATOR FEEDBACK STATUS INDICATES THAT THE ECONOMIZER

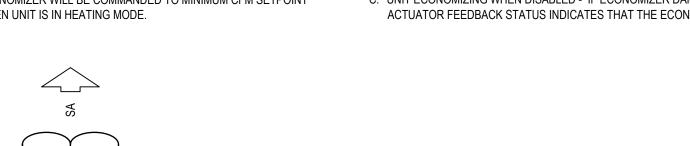


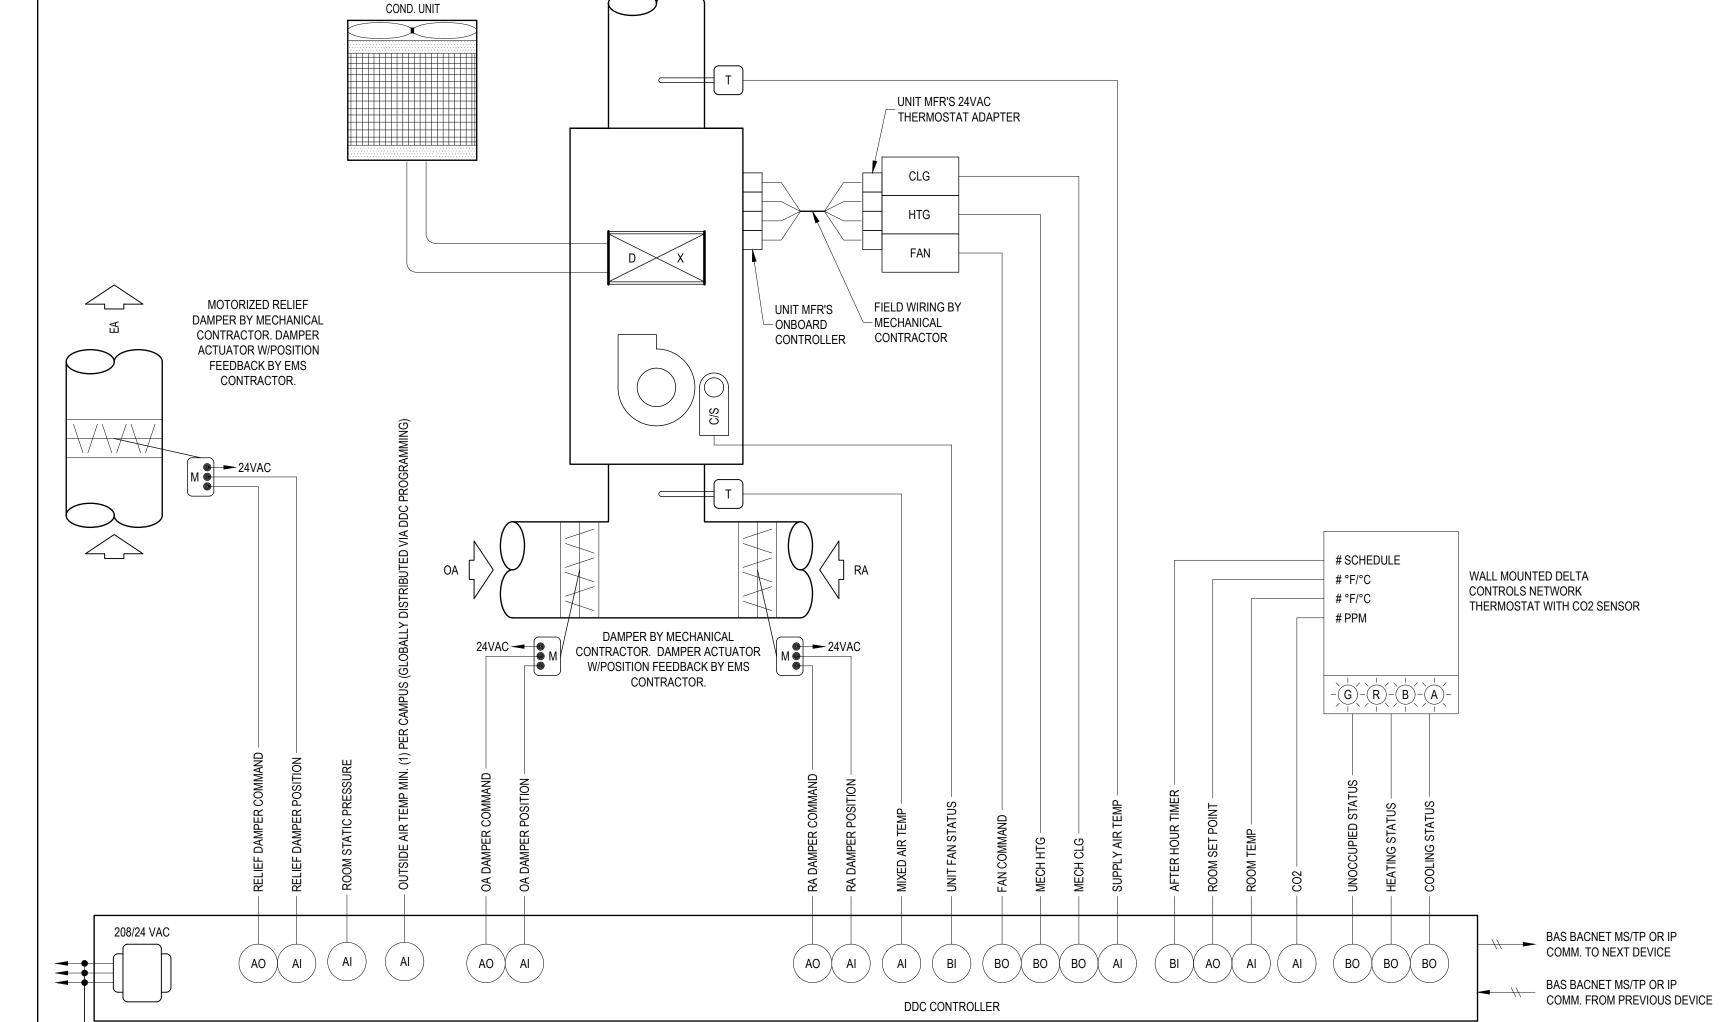

CLASSROOM SPLIT SYSTEM HEAT PUMP / FAN COIL UNIT CONTROL SCHEMATIC

208VAC FROM UNIT.

TRANSFORMER AND WIRING BY EMS CONTRACTOR

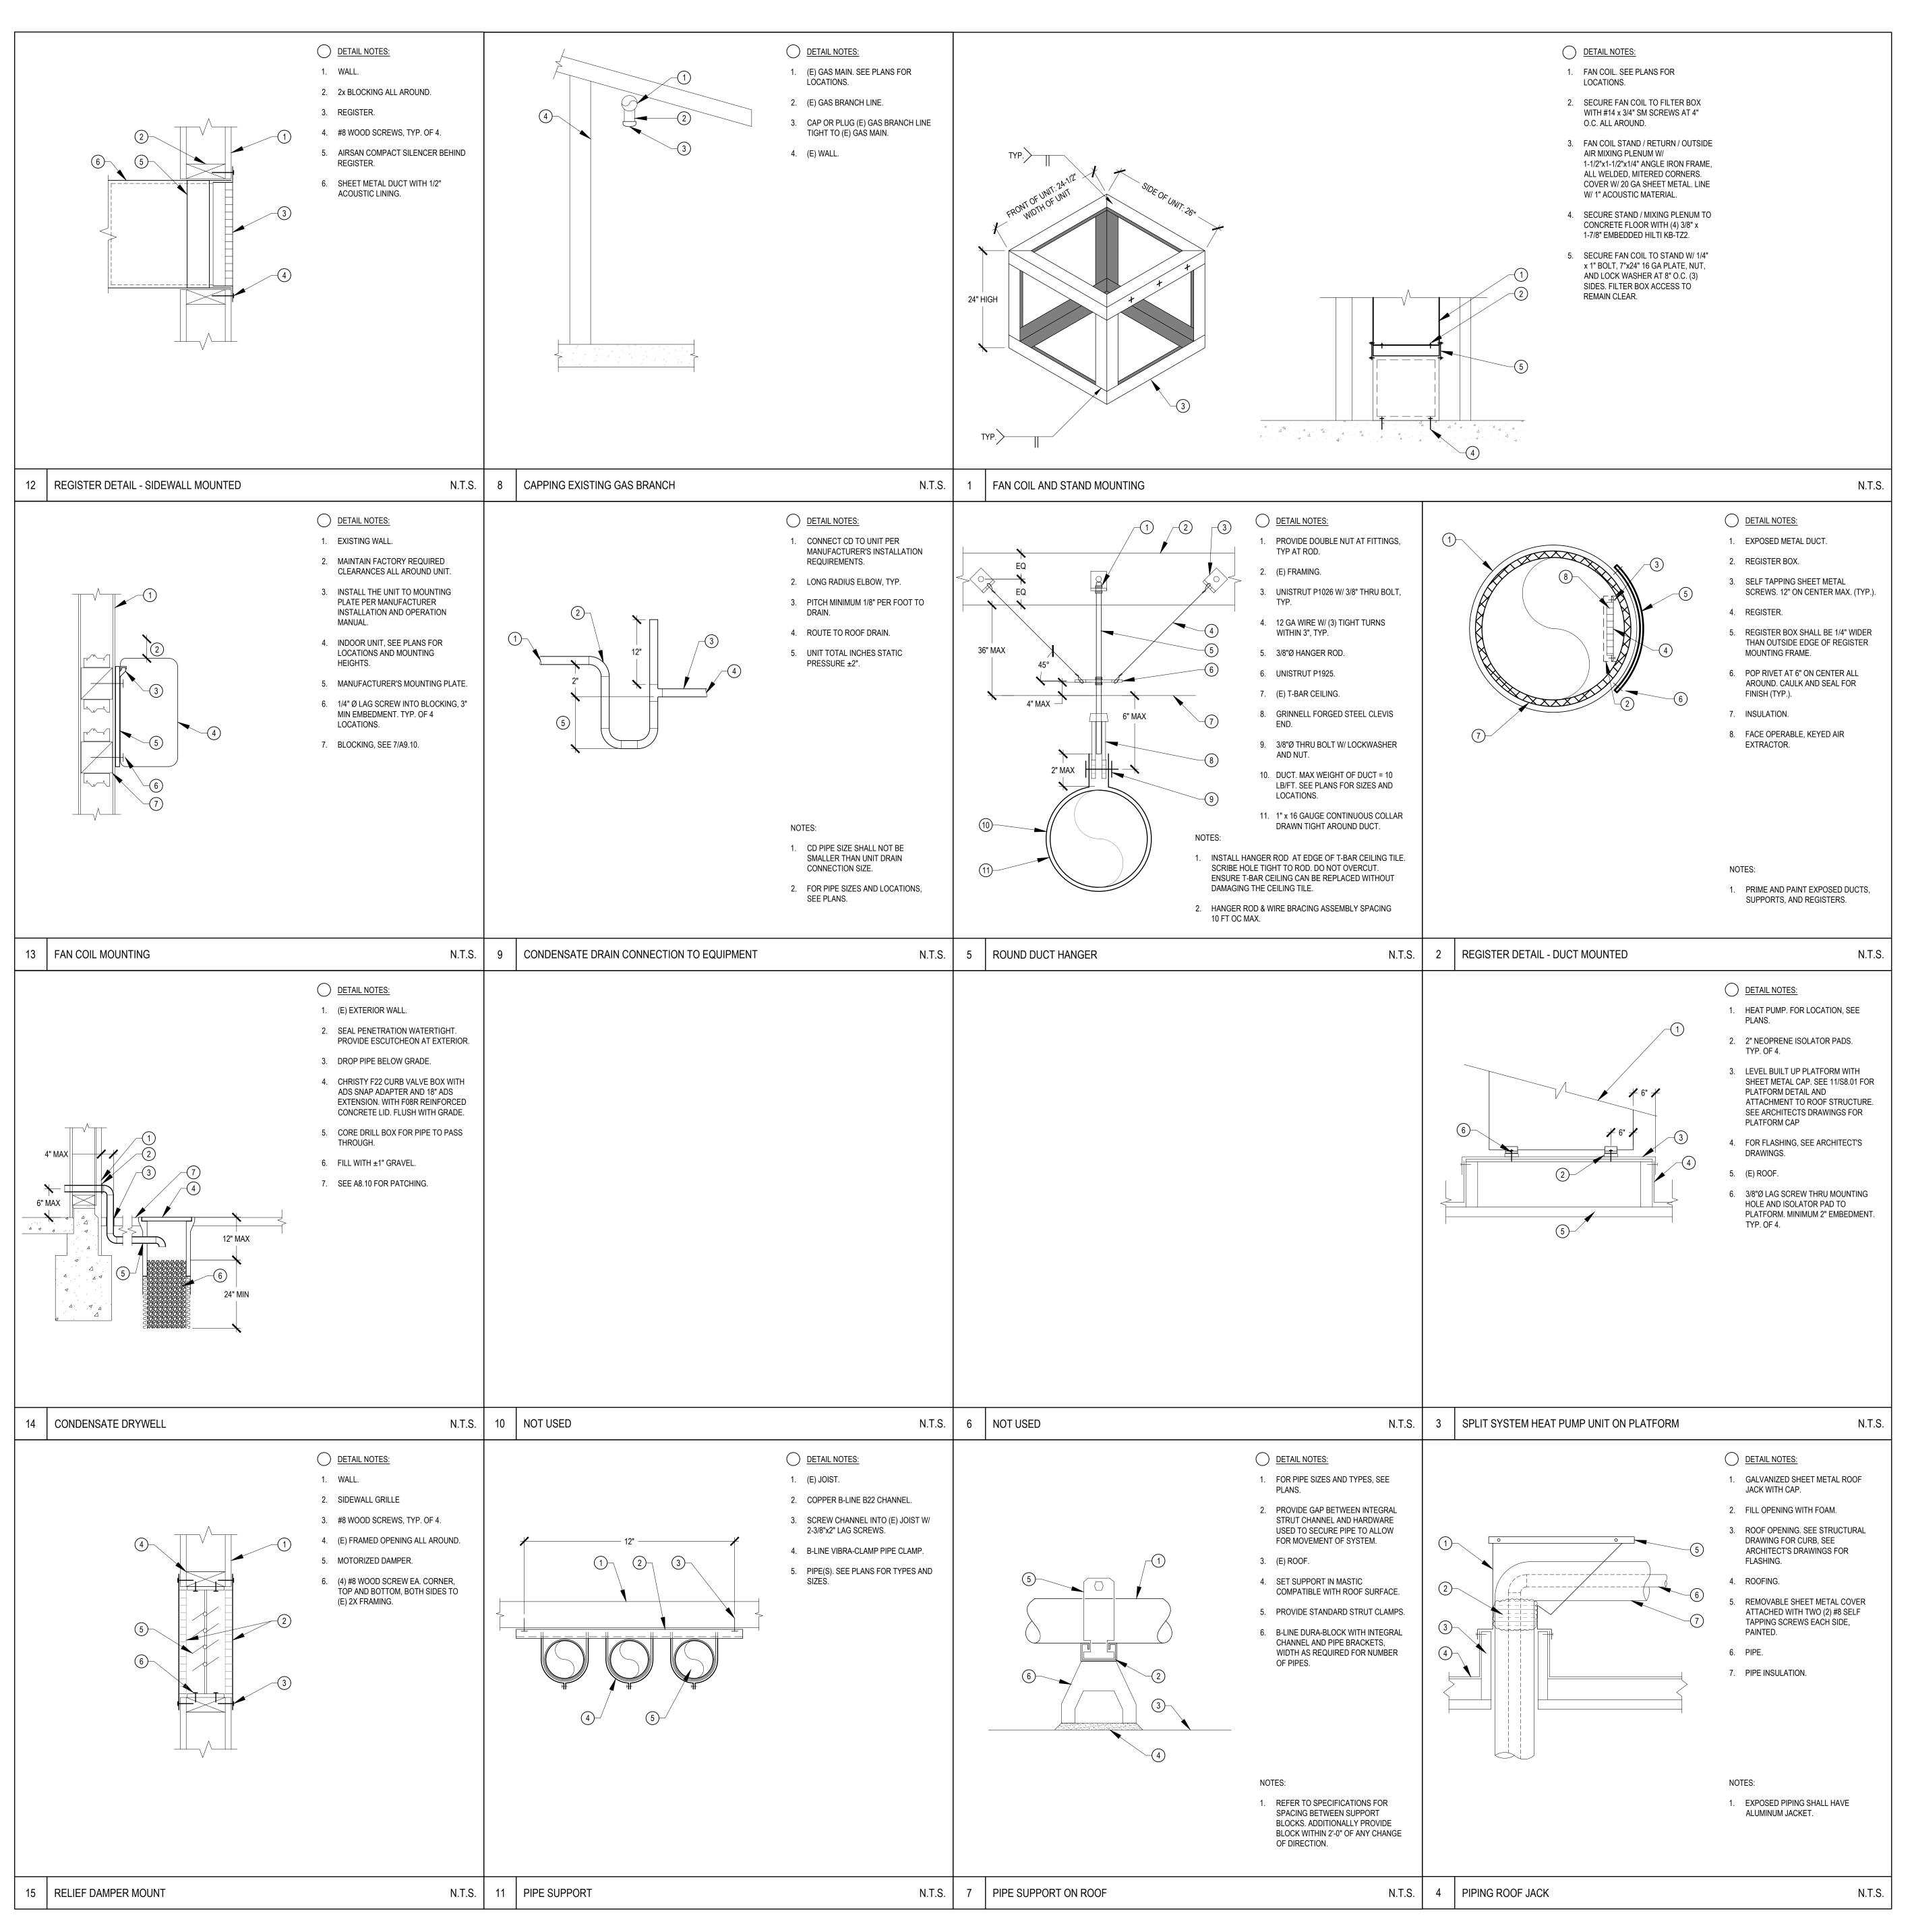

IDENTIFICATION STAMP DIV. OF THE STATE ARCHITEC APP: 01-119554 INC: REVIEWED FOR SS 🗹 FLS 🗹 ACS 🗹

architects

www.aedisarchitects.com 387 S. 1st Street, Suite 300 San Jose, CA 95113 tel: (408)-300-5160 fax: (408)-300-5121


PROJECT

MEADOW HEIGHTS **ELEMENTARY** SCHOOL - HVAC REPLACEMENT

SAN MATEO-FOSTER CITY

SCHOOL DISTRICT

CONSULTANT



STATE DSA FILE NUMBER 41-26

01-119554

REVISIONS

No. Description Date

MILESTONES

DD 90% CD DSA SUB

06/02/2021 09/22/2021 BACKCHECK

SHEET **DETAILS** -

MECHANICAL & PLUMBING

09/17/2021 ^{JOB}*2021005.04

STATE OF CALL	FORNIA				
Mechan	ical Syst	ems			
NRCC-MCH-E (Created 09/20	020)	CALIFOR	NIA ENERGY COMI	MISSION
CERTIFICAT					NRCC-MCH-E
			eport Page:		Page 7 of 11
Project Add	ress: 2619	Dolores St, San Mateo, CA 94403	ate Prepared:		2021-05-08
O. DECLAR	ATION OF	REQUIRED CERTIFICATES OF ACCEPTANCE			7
Table E. Add	ditional Ren	lections have been made based on information provided in previous tables of this documarks. These documents must be provided to the building inspector during construction /2019 compliance documents/Nonresidential Documents/NRCA/			
				Field In	spector
YES	NO	Form/Title	Systems To Be Field Verified	Pass	Fail
•	0	NRCA-MCH-02-A Outdoor Air must be submitted for all newly installed HVAC units. Note: MCH02-A can be performed in conjunction with MCH-07-A Supply Fan VFD Acceptance (if applicable) since testing activities overlap.			
•	0	NRCA-MCH-03-A Constant Volume Single Zone HVAC NOTE: This form does not automatically move to "Yes". If Constant Volume Single Zone HVAC Systems are included in the scope, permit applicant should move this form to "Yes".	one		
0	•	NRCA-MCH-04-A Air Distribution Duct Leakage			
0	•	NRCA-MCH-05-A Air Economizer Controls			
•	0	NRCA-MCH-06-A Demand Control Ventilation Systems Acceptance must be submitted for all systems required to employ demand controlled ventilation (refer to §120.1(c) can vary outside ventilation flow rates based on maintaining interior carbon dioxide (CO2) concentration setpoints.)3)		
0	•	NRCA-MCH-07-A Supply Fan Variable Flow Controls			
0	•	NRCA-MCH-08-A Valve Leakage Test			
0	•	NRCA-MCH-09-A Supply Water Temperature Reset Controls			
0	•	NRCA-MCH-10-A Hydronic System Variable Flow Controls			
0	•	NRCA-MCH-11-A Automatic Demand Shed Controls			

CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance: http://www.energy.ca.gov/title24/2019standards

CERTIFICATE	OF COM	PLIANCE		NRCC-MCH-I
Project Nam	e: Mea	dow Heights Elementary School - HVAC Replacement	Report Page:	Page 8 of 1:
Project Add	ess: 2619	9 Dolores St, San Mateo, CA 94403	Date Prepared:	2021-05-0
0	•	NRCA-MCH-12-A FDD for Packaged Direct Expansion Units		
0	•	NRCA-MCH-13-A Automatic FDD for Air Handling Units and Zone Terminal Unit Acceptance	s	
0	•	NRCA-MCH-14-A Distributed Energy Storage DX AC Systems Acceptance NOTE: This form does not automatically move to "Yes". If Distributed Energy St AC Systems are included in the scope, permit applicant should move this form t		
О	•	NRCA-MCH-15-A Thermal Energy Storage (TES) System Acceptance NOTE: This form does not automatically move to "Yes". If Chilled Water Storage Coil Internal Melt, Ice-on-Coil External Melt, Ice Harvester, Brine, Ice-Slurry, Eut Salt, Clathrate Hydrate Slurry (CHS), Cryogenic or Encapulated (Ice Ball) System included in the scope, permit applicant should move this form to "Yes".	ectic	
0	•	NRCA-MCH-16-A Supply Air Temperature Reset Controls		
0	•	NRCA-MCH-17-A Condenser Water Temperature Reset Controls		
•	0	NRCA-MCH-18 Energy Management Control Systems		
0	•	NRCA-MCH-19 Occupancy Sensor Controls		
0	•	NRCA-MCH-20 Multi-Family Ventilation		
0	•	NRCA-MCH-21 Multi-Family Envelope Leakage		

CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance: http://www.energy.ca.gov/title24/2019standards

STATE OF CALIFOR					X-10-2
Mechanic					MISSION (
NRCC-MCH-E (Cre		San and the san an		CALIFORNIA ENERGY COM	NRCC-MCH
Project Name		w Heights Elementary School - HVAC Replacement	Report Page:		Page 9 of 1
		olores St, San Mateo, CA 94403	Date Prepared:		2021-05-0
P. DECLARAT	TION OF RE	QUIRED CERTIFICATES OF VERIFICATION			7
<u>Nonresidentia</u>				Field Ir	nspector
YES	NO	Form/T	itle	Pass	Fail
0	•	NRCV-MCH-04-H Duct Leakage Test NOTE: Must be completed by a HERS Rater			
0	•	NRCV-MCH-24 Enclosure Air Leakage Worksheet NOTE: Must be completed by a HERS Rater			
0	•	NRCV-MCH-27 High-rise Residential NOTE: Must be completed by a HERS Rater			
0	6	NRCV-MCH-32 Local Mechanical Exhaust			

RCC-MCH-E (Created	Systems									CALIFORNIA ENERGY COMMISSION	
CERTIFICATE OF C										NRCC-MCH-	
roject Name:	Meadow Heights Eleme	ntary Scho	ol - HVAC Rep	olacement			Repor	t Page:		Page 4 of 1	
roject Address:	2619 Dolores St, San M	lateo, CA 9	4403		Date Prepared:					2021-05-0	
. VENTILATION	AND INDOOR AIR QU	JALITY					279				
		7.0				25	325			0.2(e)3B for all nonresidential, high-rise n need to be documented in this table.	
n lieu of this tabl	e, the required outdoor	ventilation	rates and air	flows may be s	shown on	the plans o	or the calcula	tions can be pre	esented in	a spreadsheet.	
01	Check the box	f the proje	ct is showing	ventilation cal	culations	on the pla	ns, or attachi	ng the calculati	ons inste	ad of completing this table.	
02	02 Check this box if the project includes Nonre					Motel space	es				
	Check this box							s			
03	Check the box	if the proje	ct is using nat	tural ventilatio	n in any	spaces to m	eet required	ventilation rate	es per §17	20.1(c)2.	
Ionresidential ar	nd Hotel/ Motel Ventila	tion Syster	ns			- 10			145		
	04		1	05			06			07	
									Air Filtration per §120.1(c) and §141.0(b)2 ²		
ystem Name:	HP/FC	CFM Air	Design OA Flow¹:	450		System De Transfer A	-	0	Provide	ed per §120.1(c) (NR & Hotel/Motel)	
08	09	<u> </u>	10	11	12	13	14	15		16	
,	Mecha	nical Ventil	ation Require	ed per §120.1(d	:)33		Exh. Vent. p	er §120.1(c)4			
Space Name or Item Tag	Occupancy Typ	pe ⁴	Conditioned Floor Area (ft²)	# of showerheads / toilets	# of people ⁵	Required Min OA CFM	Required Minimum CFM	Provided per Design CFM		OCV or Occupant Sensor Controls 120.1(d)3, §120.1(d)5 & §120.2(e)3 ⁶	
LID/SC	Classes I	10\				150			DCV Provided per §120.1(d)4		
HP/FC	Classroom (age 5-	10)	1,000			150		0	Occ NA: Not required space type		

STATE OF CALIFORNIA

Mechanical Systems NRCC-MCH-E (Created 09/2020)	CALIFORNIA ENERGY COMMISSION	
CERTIFICATE OF COMPLIANCE		NRCC-MCH-E
Project Name: Meadow Heights Elementary School - HVAC Replacement	Report Page:	Page 5 of 11
Project Address: 2619 Dolores St, San Mateo, CA 94403	Date Prepared:	2021-05-08

FOOTNOTES: System CFM should include both mechanical and natural ventilation for the zone/system.

CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance: http://www.energy.ca.gov/title24/2019standards

² Air filtration requirements apply to the following three system types per §120.1(c)1A: space conditioning systems utilizing ducts to supply air to occupiable space; supply-only ventilation systems providing outside air to occupiable space; supply side of balanced ventilation systems including heat recovery and energy recovery ventilation systems providing outside air to occupiable space.

³ Uniform Mechanical Code may have more stringent ventilation requirements; the most stringent code requirement takes precedence.

⁴ See Standards Tables 120.1-A and 120.1-B

September 2020

September 2020

⁵ For lecture halls with fixed seating, the expected number of occupants shall be determined in accordance with the California Building Code. ⁶ §120.2(e)3 requires systems serving rooms that are required by §130.1(c) to have lighting occupancy sensing controls to also have occupancy sensing zone controls for ventilation. Examples of spaces which require lighting occupancy sensors include offices 250ft² or smaller, multipurpose rooms less than 1,000ft², classrooms, conference rooms, restrooms, aisles and open areas in warehouses, library book stack aisles, corridors, stairwells, parking garages, and loading and unloading zones, unless excepted by §130.1(c).

This Sect	ion Does No	t Apply								
L. DISTR	IBUTION (E	DUCTWORK AND	PIPING)							
		mplete the follow kage testing.	ing tables to show compliance with man	datory pipe insulation requirements found in §120.3 an	d prescriptive requirements found in					
Duct Lea	kage Sealing	3								
		uestions below g duct system(s):	FC	Duct leakage testing triggered for these systems?	No					
11	No	The scope of the	project includes only duct systems serv	ring healthcare facilites.						
12	Yes	Duct system pro	vides conditioned air to an occupiable sp	pace for a constant volume, single zone, space-condition	ning system.					
13	No	The space condi	tioning system serves less than 5,000 ft ²	of conditioned floor area.						
14	No	The combined s	urface area of the ducts in the following	locations is more than 25% of the total surface area of	the entire duct system:					
			Outdoors							
				is a U-factor greater than the U-factor of the ceiling, or roof has fixed vents or openings to the outside/ uncor						
			In an unconditioned crawlspace							
			In other unconditioned spaces							
15	No	The scope of the	project includes extending an existing o	duct system, which is constructed, insulated or sealed v	vith asbestos.					
16	No		project includes an existing duct system that is documented to have been previously sealed as confirmed through field verification and in accordance with procedures in the Reference Nonresidential Appendix NA2.							

CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance: http://www.energy.ca.gov/title24/2019standards September 2020

Mechanical Systems		CALIFORNIA ENERGY COMMISSION
NRCC-MCH-E (Created 09/2020)		ALIFORNIA ENERGY COMMISSION
CERTIFICATE OF COMPLIANCE		NRCC-MCH
Project Name: Meadow Heights Elementary School - HVAC Replacement	Report Page:	Page 6 of 1
Project Address: 2619 Dolores St, San Mateo, CA 94403	Date Prepared:	2021-05-0
Table Continued		
17 Duct system shall be sealed in accordance with the California Me	echanical Code.	

M. COOLII	NG TOWER	S		7	
This Section	Does Not A	pply			
N. DECLAR	ATION OF	REQUIRED CERTIFICATES OF INSTALLATION			Į.
able E. Ad	ditional Rem	ctions have been made based on information provided in previous tables of narks. These documents must be provided to the building inspector during of [2019_compliance_documents/Nonresidential_Documents/NRCI/			
	NO	r	Systems To Be Field Verified	Field In	spector
VEC					
YES	NO	Form/Title	Systems to be field vermed	Pass	Fail

STATE OF CALIFORNIA **Mechanical Systems** NRCC-MCH-E (Created 09/2020) CERTIFICATE OF COMPLIANCE This document is used to demonstrate compliance for mechanical systems that are within the scope of the permit application and are demonstrating compliance using the prescriptive path outlined in §140.4, or §141.0(b)2 for alterations.

Project Name: Meadow Heights Elementary School - HVAC Replacement Project Address: 2619 Dolores St, San Mateo, CA 94403 Date Prepared: A. GENERAL INFORMATION 01 Project Location (city) 04 Total Conditioned Floor Area 02 Climate Zone 05 Total Unconditioned Floor Area 03 Occupancy Types Within Project: 06 # of Stories (Habitable Above Grade) Office (B) Retail (M) Non-refrigerated Warehouse (S) Hotel/ Motel Guest Rooms (R-1) ✓ School (E) Healthcare Facility (I) High-Rise Residential (R-2/R-3) Relocatable Class Bldg (E) ¹ FOOTNOTES: Climate zone can be determined on the California Energy Commission's website at http://www.energy.ca.gov/maps/renewable/building_climate_zones.html

B. PROJECT SCOPE Table Instructions: Include any mechanical systems that are within the scope of the permit application and are demonstrating compliance using the prescriptive path outlined in §140.4, or §141.0(b)2 for alterations. My project consists of (check all that apply) Air System(s) Wet System Components Dry System Components Heating Air System Air Economizer Cooling Air System Electric Resistance Heat Hydronic System Piping Mechanical Controls Fan Systems Cooling Towers Mechanical Controls (existing to remain, altered or Ductwork (existing to remain, altered or new) Chillers

C. COMPLIA	NCE I	RESULTS													
able Instruct	ions:	If any cell on ti	his tai	ble says "DOES	NOT	COMPLY" or "	сомі	PLIES with Exc	eptio	nal Conditions'	refe	r to Table D. fo	or guid	dance.	
01		02		03		04		05		06		07		08	09
§110.2, §140.4	AND	§140.4(k)	AND	§140.4(c), §140.4(e)	AND	System Controls §110.2, §120.2, §140.4(f)	AND	<u>§120.1</u>	AND	§140.4(d)	AND	§140.4(I)	AND	§110.2(e)2	Compliance Resul
See Table F)		(See Table G)		(See Table H)		(See Table I)		(See Table J)		(See Table K)		(See Table L)		(See Table M)	
Yes	AND	1	AND		AND	Yes	AND	Yes	AND	· ·	AND	Yes	AND		COMPLIES

CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance: http://www.energy.ca.gov/title24/2019standards/

STATE OF CALIFORNIA **Mechanical Systems** NRCC-MCH-E (Created 09/2020) CERTIFICATE OF COMPLIANCE Project Name: Meadow Heights Elementary School - HVAC Replacement Page 2 of 11 Date Prepared: Project Address: 2619 Dolores St, San Mateo, CA 94403 2021-05-08 D. EXCEPTIONAL CONDITIONS This table is auto-filled with uneditable comments because of selections made or data entered in tables throughout the form.

Selections made in Table O have been changed by the permit applicant. See Table E. Additional Remarks for permit applicant's explanation.

This table includes remarks made by the permit applicant to the Authority Having Jurisdiction.

⁴ Authority Having Jurisdiction may ask for load calculations used for compliance per §140.4(b).

Table Continued

September 2020

September 2020

F. HVAC SYSTEM SUMMARY (DRY & WET SYSTEMS) Table Instructions: Complete the following equipment schedules to show compliance with mandatory requirements found in §110.1 and §110.2(a) and prescriptive requirements found in §140.4(a), §140.4(b) and §140.4(k) or §141.0(b)2 for alterations. Dry System Equipment Sizing (includes air conditioners, condensers, heat pumps, VRF, furnaces and unit heaters) 05 06 07 08 09 10 11 Equipment Sizing per Mechanical Schedule (kBtu/h) §140.4 (a&b) Heating Output^{2,3} Cooling Output^{2,3} Load Calculations^{3,} Smallest Size Name or | Equipment Category per Equipment Type per Available¹ <u>Tables 110.2</u> Tables 110.2 & Title 20 Design (kBtu/h) Output (kBtu/h) (kBtu/h) Sensible Per Design (kBtu/h) (kBtu/h) Load Cooling (kBtu/h) Load §140.4(a) (kBtu/h) (kBtu/h) (kBtu/h) Unitary heat pumps HP/FC 54 Air cooled, split (1 phase) Yes (no elec. resistance)

¹ FOOTNOTES: Equipment shall be the smallest size, within the available options of the desired equipment line, necessary to meet the design heating and cooling loads of the

building per §140.4(a). Healthcare facilities are excepted. ² It is common practice to show rated output capacity on the equipment schedule. Sensible cooling output comes from specification sheet tables. ³ If equipment is heating only, leave cooling output and load blank. If equipment is cooling only, leave heating output and load blank.

CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance: http://www.energy.ca.gov/title24/2019standards September 2020

STATE OF CALIFORNIA Mechanical Systems CALIFORNIA ENERGY COMMISSION NRCC-MCH-E (Created 09/2020) CERTIFICATE OF COMPLIANCE NRCC-MCH-E Project Name: Meadow Heights Elementary School - HVAC Replacement Page 3 of 11 Project Address: 2619 Dolores St, San Mateo, CA 94403 2021-05-08 Dry System Equipment Efficiency (other than Package Terminal Air Conditioners (PTAC) and Package Terminal Heat Pumps (PTHP)) 04 05 06 07 08 09 Heating Mode Cooling Mode Min Efficiency Size Category Name or Rating Condition Required per Design Required per (Btu/h) Efficiency Unit Efficiency Unit Tables 110.2/ Efficiency Efficiency Tables 110.2/ Title 20 Title 20 SEER 14 17.1 HP/FC <65,000 **HSPF** 8.2

G. PUMPS This Section Does Not Apply H. FAN SYSTEMS & AIR ECONOMIZERS

SYSTEM CON	TROLS												
able Instructions: Complete the following Table to demonstrate compliance with mandatory controls in §110.2 and §120.2 and prescriptive controls in §140.4(f) and (n) or equirements in §141.0(b)2E for altered space conditioning systems.													
01	02	03	04	05	06	07	08	09					
System Name	System Zoning	Conditioned Floor Area Being Served (ft²)	Thermostats §110.2(b) & (c) ¹ , §120.2(a) or §141.0(b)2E	Shut-Off Controls §120.2(e)	Isolation Zone Controls §120.2(g)	Demand Response §110.12 and §120.2(b)	Supply Air Temp. Reset §140.4(f)	Window Interlocks pe §140.4(n)					
HP/FC	single zone	≤ 25,000 ft²	EMCS	EMCS	NA: Single Zone	EMCS	NA: Single Zone	NA: Alteration project					

FOOTNOTES: Gravity gas wall heaters, gravity floor heaters, gravity room heaters, non-central electric heaters, fireplaces or decorative gas appliances, wood stoves are not required to have setback thermostats. * NOTES: Controls with a * require a note in the space below explaining how compliance is achieved.

CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance: http://www.energy.ca.gov/title24/2019standards

EX: System 1: SA Temp Reset: Exempt because zones compliant with §140.4(d); EXCEPTION 1 to §140.4(f)

September 2020

09/17/2021

IDENTIFICATION STAMP

DIV. OF THE STATE ARCHITECT

REVIEWED FOR

SS 🗹 FLS 🗹 ACS 🗹

architects

www.aedisarchitects.com 387 S. 1st Street, Suite 300

San Jose, CA 95113

tel: (408)-300-5160

fax: (408)-300-5121

MEADOW HEIGHTS

ELEMENTARY SCHOOL - HVAC

REPLACEMENT

SAN MATEO-FOSTER CITY

SCHOOL DISTRICT

CONSULTANT

STATE

REVISIONS

MILESTONES

90% CD

SHEET

DSA SUB

BACKCHECK

TITLE 24

MECHANICAL

DSA FILE NUMBER

No. Description Date

41-26

01-119554

06/02/2021 09/22/2021

September 2020

APP: 01-119554 INC:

DATE: 09/21/2021

PROJECT

CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance: http://www.energy.ca.gov/title24/2019standards

NOTE: Must be completed by a HERS Rater

September 2020

CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance: http://www.energy.ca.gov/title24/2019standards

NRCC-MCH-E (Created 09/2020) CERTIFICATE OF COMPLIANCE				LIFORNIA ENERGY COMMISSION NRCC-MCH
Project Name: Meadow Heights Elementary School - HVAC Re	inlacement		Report Page:	Page 10 of
Project Address: 2619 Dolores St, San Mateo, CA 94403	placement		Date Prepared:	2021-05-
			Date Frepared.	2021 05
Q. MANDATORY MEASURES DOCUMENTATION LOCATION	N			
Table Instructions: Indicate where mandatory measures are docu the plan sheet or construction document location as "N/A", any o				asures that do not apply, mark
01			02	
01			Plan sheet or construction docu	iment location
Compliance with Mandatory Measures documented through MCH Mandatory Measures Note Block:	No			
03			04	
Mandatory Measure		1	Plan sheet or construction docu	iment location
Heating Equipment Efficiency per §110.1		MP0.02		
Cooling Equipment Efficiency per §110.1		MP0.02		
Furnace Standby Loss Control per §110.2(d)		NA		
Duct Insulation per §120.4		23 05 00		
Heating Hot Water Equipment Efficiency per §110.1	- 10	NA		
Cooling Chilled and Condenser Water Equipment Efficiency per	110.1	NA		
Open and Closed Circuit Cooling Towers conductivity of flow-bas	sed controls per §110.2(e)1	NA		
Open and Closed Circuit Cooling Towers Flow Meter with analog	output per §110.2(e)3	NA		
Open and Closed Circuit Cooling Towers Overflow Alarm per §11	0.2(e)4	NA		
Open and Closed Circuit Cooling Towers Efficient Drift Eliminator	rs per <u>§110.2(e)5</u>	NA		
Pipe Insulation per §120.3(b)		NA		
Combustion air shutoff, combustion air fan controls and stack de boilers per §120.9	esign and controls for	NA		
Heat Pump with Supplementary Electric Resistance Heater Conti	rols per <u>§110.2(b)</u>	NA		
The air duct and plenum system is designed per §120.4(a)-(f)		Yes		
Kitchen range hoods shall be rated for sound in accordance with 62.2	Section 7.2 of ASHRAE	NA		

CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance: http://www.energy.ca.gov/title24/2019standards

STATE OF CALIFORNIA

September 2020

Mechanical Systems NRCC-MCH-E NRCC-MCH-E (Created) CERTIFICATE OF COMPLIANCE Project Name: Meadow Heights Elementary School - HVAC Replacement Project Address: 2619 Dolores St, San Mateo, CA 94403 DOCUMENTATION AUTHOR'S DECLARATION STATEMENT 1. I certify that this Certificate of Compliance documentation is accurate and complete. Documentation Author Signature: Chahan . S. Steh Documentation Author Name: Chahan Shah Signature Date: 5/8/21 Cypress Engineering Group Company: 8 Harris Court, Suite A8 CEA/ HERS Certification Identification (if applicable): 8312181802 City/State/Zip: Monterey, CA 93940 RESPONSIBLE PERSON'S DECLARATION STATEMENT I certify the following under penalty of perjury, under the laws of the State of California: 1. The information provided on this Certificate of Compliance is true and correct. 2. I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design or system design identified on this Certificate of Compliance (responsible designer) 3. The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this

The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this
Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations.
 The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.

5. I will ensure that a completed signed copy of this Certificate of Compliance shall be made available with the building permit(s) issued for the building, and made available to the enforcement agency for all applicable inspections. I understand that a completed signed copy of this Certificate of Compliance is required to be included with the documentation the builder provides to the building owner at occupancy.

Responsible Designer Name:

Responsible Designer Signature:

Responsible Designer Name: Metin Serttunc Responsible Designer Signature:

Company: Cypress Engineering Group Date Signed: 5/8/21

Address: 8 Harris Court, Suite A8 License: M31059

City/State/Zip: Monterey, CA 93940 Phone: 8312181802

CA Building Energy Efficiency Standards - 2019 Nonresidential Compliance: http://www.energy.ca.gov/title24/2019standards

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT

APP: 01-119554 INC:

REVIEWED FOR

SS FLS ACS D

DATE: 09/21/2021

aedis


www.aedisarchitects.com 387 S. 1st Street, Suite 300 San Jose, CA 95113 tel: (408)-300-5160 fax: (408)-300-5121


PROJECT

MEADOW HEIGHTS ELEMENTARY SCHOOL - HVAC REPLACEMENT

SAN MATEO-FOSTER CITY SCHOOL DISTRICT

CONSULTANT

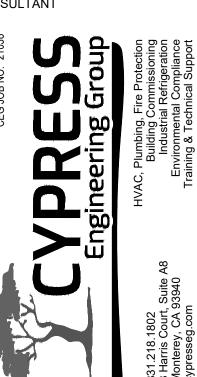



STATE

DSA FILE NUMBER 41-26

APPL # 01-119554

REVISIONS

No. Description Date

MILESTONES

90% CD DSA SUB

DSA SUB 06/02/2021 BACKCHECK 09/22/2021

SHEET

TITLE 24
DOCUMENTSMECHANICAL

DATE 09/17/2021

JOB #2021005.04

SHEET#

SYMBOL LIST:

EI.I	PLAN, DETAIL OR SECTION DESIGNATION.
201	ROOM NUMBER.
	SHEET REFERENCE SYMBOL - SEE ASSOCIATED NOTE ON SAME SHEET.
	SHEET NEI ENERGE STYDOE - SEE ASSOCIATED NOTE ON SAME SHEET.
3	FEEDER SCHEDULE SYMBOL.
(CH)	MECHANICAL EQUIPMENT TAG.
A	INDICATES FIXTURE TYPE
LUMINAI	RE SYMBOLS
	LUMINAIRE - SEE SCHEDULE.
<u> </u>	POLE MOUNTED LUMINAIRE - SEE SCHEDULE.
	POLE MOUNTED LUMINAIRE - SEE SCHEDULE.
(LUMINAIRE - SEE SCHEDULE.
0	LUMINAIRE - SEE SCHEDULE.
О	LUMINAIRE WALL MOUNTED-SEE SCHEDULE.
	EMERGENCY LUMINAIRE - PROVIDE EMERGENCY BATTERY BALLAST
EM	EMERGENCY LUMINAIRE - PROVIDE EMERGENCY BATTERY BALLAST
	EMERGENCY LUMINAIRE - PROVIDE EMERGENCY BATTERY BALLAST
	EMERGENCY LUMINAIRE - PROVIDE EMERGENCY BATTERY BALLAST
	EMERGENCY LUMINAIRE WALL MOUNTED- PROVIDE EM. BATTERY BALLAST
\otimes	EXIT LIGHT SINGLE FACE - SEE SCHEDULE.
⊗	EXIT LIGHT SINGLE FACE (WITH ARROW)- SEE SCHEDULE.
Θ	EXIT LIGHT (DOUBLE FACED WITH ARROW)- SEE SCHEDULE.
	EMERGENCY BATTERY PACK EXIT LIGHT INSTALL AS DIRECTED. _ LUMINAIRE NOMENCLATURE
TYPICAL 3a-	LUMINAIRE NOMENCLATURE
TYPICAL 3a-	_ LUMINAIRE NOMENCLATURE INDICATES SWITCHING DESIGNATION
TYPICAL 3a- SMITCH \$	LUMINAIRE NOMENCLATURE INDICATES SMITCHING DESIGNATION NDICATES CIRCUIT NUMBER SYMBOLS SINGLE POLE SMITCH, + 48" AFF TO THE TOP OF THE OUTLET BOX UON.
TYPICAL 3a-	LUMINAIRE NOMENCLATURE —— INDICATES SWITCHING DESIGNATION NDICATES CIRCUIT NUMBER SYMBOLS
TYPICAL 3a- SMITCH \$ \$a \$3	LUMINAIRE NOMENCLATURE INDICATES SWITCHING DESIGNATION IDICATES CIRCUIT NUMBER SYMBOLS SINGLE POLE SWITCH, + 48" AFF TO THE TOP OF THE OUTLET BOX UON. SINGLE POLE SWITCH, + 48" AFF TO THE TOP OF THE OUTLET BOX, a = CIRCUIT CONTROLLED. THREE WAY SWITCH + 48" AFF TO THE TOP OF THE OUTLET BOX UON.
TYPICAL 3a- SMITCH \$ \$a \$3 \$4	LUMINAIRE NOMENCLATURE INDICATES SWITCHING DESIGNATION ADICATES CIRCUIT NUMBER SYMBOLS SINGLE POLE SWITCH, + 48" AFF TO THE TOP OF THE OUTLET BOX UON. SINGLE POLE SWITCH, + 48" AFF TO THE TOP OF THE OUTLET BOX, a = CIRCUIT CONTROLLED. THREE WAY SWITCH + 48" AFF TO THE TOP OF THE OUTLET BOX UON. FOUR WAY SWITCH + 48" AFF TO THE TOP OF THE OUTLET BOX UON.
TYPICAL 3a- 3A- SMITCH \$ \$ 4 \$ a	LUMINAIRE NOMENCLATURE INDICATES SWITCHING DESIGNATION ADICATES CIRCUIT NUMBER SYMBOLS SINGLE POLE SWITCH, + 48" AFF TO THE TOP OF THE OUTLET BOX UON. SINGLE POLE SWITCH, + 48" AFF TO THE TOP OF THE OUTLET BOX, a = CIRCUIT CONTROLLED. THREE WAY SWITCH + 48" AFF TO THE TOP OF THE OUTLET BOX UON. FOUR WAY SWITCH + 48" AFF TO THE TOP OF THE OUTLET BOX UON. MOTOR RATED SWITCH
TYPICAL 3a- SMITCH \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$	LUMINAIRE NOMENCLATURE INDICATES SWITCHING DESIGNATION ADICATES CIRCUIT NUMBER SYMBOLS SINGLE POLE SWITCH, + 48" AFF TO THE TOP OF THE OUTLET BOX UON. SINGLE POLE SWITCH, + 48" AFF TO THE TOP OF THE OUTLET BOX, a = CIRCUIT CONTROLLED. THREE WAY SWITCH + 48" AFF TO THE TOP OF THE OUTLET BOX UON. FOUR WAY SWITCH + 48" AFF TO THE TOP OF THE OUTLET BOX UON.
TYPICAL 3a- 3A- SMITCH \$ \$ 4 \$ a	LUMINAIRE NOMENCLATURE INDICATES SWITCHING DESIGNATION IDICATES CIRCUIT NUMBER SYMBOLS SINGLE POLE SWITCH, + 48" AFF TO THE TOP OF THE OUTLET BOX UON. SINGLE POLE SWITCH, + 48" AFF TO THE TOP OF THE OUTLET BOX, a = CIRCUIT CONTROLLED. THREE WAY SWITCH + 48" AFF TO THE TOP OF THE OUTLET BOX UON. FOUR WAY SWITCH + 48" AFF TO THE TOP OF THE OUTLET BOX UON. MOTOR RATED SWITCH WALL MOUNTED LOW VOLTAGE "DATALINE SWITCH = 48" FROM TOP OF BOX, UON.
TYPICAL SMITCH \$ \$ a \$ 4 \$ a \$ P P	LUMINAIRE NOMENCLATURE INDICATES SWITCHING DESIGNATION ADICATES CIRCUIT NUMBER SYMBOLS SINGLE POLE SWITCH, + 48" AFF TO THE TOP OF THE OUTLET BOX UON. SINGLE POLE SWITCH, + 48" AFF TO THE TOP OF THE OUTLET BOX, a = CIRCUIT CONTROLLED. THREE WAY SWITCH + 48" AFF TO THE TOP OF THE OUTLET BOX UON. FOUR WAY SWITCH + 48" AFF TO THE TOP OF THE OUTLET BOX UON. MOTOR RATED SWITCH WALL MOUNTED LOW VOLTAGE "DATALINE SWITCH = 48" FROM TOP OF BOX, UON a = CIRCUIT CONTROLLED LIGHTING OCCUPANCY SENSOR MOTION DETECTOR POWER PACK ONE CIRCUIT WALL SWITCH WITH BUILT IN OCCUPANCY SENSOR. CONNECT
TYPICAL SWITCH \$ a \$ 4 \$ a \$ \$ 4 \$ \$ a \$ \$ \$ \$ \$ \$ \$ \$	LUMINAIRE NOMENCLATURE INDICATES SWITCHING DESIGNATION ADICATES CIRCUIT NUMBER SYMBOLS SINGLE POLE SWITCH, + 48" AFF TO THE TOP OF THE OUTLET BOX UON. SINGLE POLE SWITCH, + 48" AFF TO THE TOP OF THE OUTLET BOX, a = CIRCUIT CONTROLLED. THREE WAY SWITCH + 48" AFF TO THE TOP OF THE OUTLET BOX UON. FOUR WAY SWITCH + 48" AFF TO THE TOP OF THE OUTLET BOX UON. MOTOR RATED SWITCH WALL MOUNTED LOW VOLTAGE "DATALINE SWITCH = 48" FROM TOP OF BOX, UON a = CIRCUIT CONTROLLED LIGHTING OCCUPANCY SENSOR MOTION DETECTOR POWER PACK ONE CIRCUIT WALL SWITCH WITH BUILT IN OCCUPANCY SENSOR. CONNECT SWITCHING TO LIGHTING FIXTURES AS REQUIRED. MOUNT AT +48"AFF TO THE TOTO OF THE SWITCH BOX, UON.
TYPICAL SWITCH \$ a \$ a \$ 4 \$ a \$ \$ 4 \$ \$ a \$ \$ \$ 4 \$ \$ a \$ \$ \$ \$	INDICATES SWITCHING DESIGNATION IDICATES CIRCUIT NUMBER SYMBOLS SINGLE POLE SWITCH, + 48" AFF TO THE TOP OF THE OUTLET BOX UON. SINGLE POLE SWITCH, + 48" AFF TO THE TOP OF THE OUTLET BOX, a = CIRCUIT CONTROLLED. THREE WAY SWITCH + 48" AFF TO THE TOP OF THE OUTLET BOX UON. FOUR WAY SWITCH + 48" AFF TO THE TOP OF THE OUTLET BOX UON. MOTOR RATED SWITCH WALL MOUNTED LOW VOLTAGE "DATALINE SWITCH = 48" FROM TOP OF BOX, UON a = CIRCUIT CONTROLLED LIGHTING OCCUPANCY SENSOR MOTION DETECTOR POWER PACK ONE CIRCUIT WALL SWITCH WITH BUILT IN OCCUPANCY SENSOR. CONNECT SWITCHING TO LIGHTING FIXTURES AS REQUIRED. MOUNT AT +48"AFF TO THE TOI OF THE SWITCH BOX, UON. ACLE SYMBOLS
TYPICAL SWITCH \$ \$ a \$ \$ 4 \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$	LUMINAIRE NOMENCLATURE INDICATES SWITCHING DESIGNATION RDICATES CIRCUIT NUMBER SYMBOLS SINGLE POLE SWITCH, + 48" AFF TO THE TOP OF THE OUTLET BOX UON. SINGLE POLE SWITCH, + 48" AFF TO THE TOP OF THE OUTLET BOX, a = CIRCUIT CONTROLLED. THREE WAY SWITCH + 48" AFF TO THE TOP OF THE OUTLET BOX UON. FOUR WAY SWITCH + 48" AFF TO THE TOP OF THE OUTLET BOX UON. MOTOR RATED SWITCH WALL MOUNTED LOW VOLTAGE "DATALINE SWITCH = 48" FROM TOP OF BOX, UON a = CIRCUIT CONTROLLED LIGHTING OCCUPANCY SENSOR MOTION DETECTOR POWER PACK ONE CIRCUIT WALL SWITCH WITH BUILT IN OCCUPANCY SENSOR. CONNECT SWITCHING TO LIGHTING FIXTURES AS REQUIRED. MOUNT AT +48"AFF TO THE TOTO OF THE SWITCH BOX, UON. ACLE SYMBOLS CONVENIENCE RECEPTACLE - DUPLEX AT + 18" AFF AND NOT LESS THAN 15" FROM BOTTOM OF BOX U.O.N.
SWITCH \$ \$ a \$ 3 \$ 4 \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$	LUMINAIRE NOMENCLATURE INDICATES SWITCHING DESIGNATION IDICATES CIRCUIT NUMBER SYMBOLS SINGLE POLE SWITCH, + 48" AFF TO THE TOP OF THE OUTLET BOX UON. SINGLE POLE SWITCH, + 48" AFF TO THE TOP OF THE OUTLET BOX, a = CIRCUIT CONTROLLED. THREE WAY SWITCH + 48" AFF TO THE TOP OF THE OUTLET BOX UON. FOUR WAY SWITCH + 48" AFF TO THE TOP OF THE OUTLET BOX UON. MOTOR RATED SWITCH WALL MOUNTED LOW VOLTAGE "DATALINE SWITCH = 48" FROM TOP OF BOX, UON a = CIRCUIT CONTROLLED LIGHTING OCCUPANCY SENSOR MOTION DETECTOR POWER PACK ONE CIRCUIT WALL SWITCH WITH BUILT IN OCCUPANCY SENSOR. CONNECT SWITCHING TO LIGHTING FIXTURES AS REQUIRED. MOUNT AT +48"AFF TO THE TOTO OF THE SWITCH BOX, UON. ACLE SYMBOLS CONVENIENCE RECEPTACLE - DUPLEX AT + 18" AFF
TYPICAL SWITCH \$ \$ a \$ 3 \$ 4 \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$	INDICATES SWITCHING DESIGNATION ADICATES CIRCUIT NUMBER SYMBOLS SINGLE POLE SWITCH, + 48" AFF TO THE TOP OF THE OUTLET BOX UON. SINGLE POLE SWITCH, + 48" AFF TO THE TOP OF THE OUTLET BOX, a = CIRCUIT CONTROLLED. THREE WAY SWITCH + 48" AFF TO THE TOP OF THE OUTLET BOX UON. FOUR WAY SWITCH + 48" AFF TO THE TOP OF THE OUTLET BOX UON. MOTOR RATED SWITCH WALL MOUNTED LOW VOLTAGE "DATALINE SWITCH = 48" FROM TOP OF BOX, UON a = CIRCUIT CONTROLLED LIGHTING OCCUPANCY SENSOR MOTION DETECTOR POWER PACK ONE CIRCUIT WALL SWITCH WITH BUILT IN OCCUPANCY SENSOR. CONNECT SWITCHING TO LIGHTING FIXTURES AS REQUIRED. MOUNT AT +48"AFF TO THE TOI OF THE SWITCH BOX, UON. ACLE SYMBOLS CONVENIENCE RECEPTACLE - DUPLEX AT + 18" AFF AND NOT LESS THAN 15" FROM BOTTOM OF BOX U.O.N. GFCI CONVENIENCE RECEPTACLE - DUPLEX AT + 18" AFF
SWITCH \$ \$ a \$ 3 \$ 4 \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$	LUMINAIRE NOMENCLATURE INDICATES SWITCHING DESIGNATION IDICATES CIRCUIT NUMBER SYMBOLS SINGLE POLE SWITCH, + 48" AFF TO THE TOP OF THE OUTLET BOX UON. SINGLE POLE SWITCH, + 48" AFF TO THE TOP OF THE OUTLET BOX, a = CIRCUIT CONTROLLED. THREE WAY SWITCH + 48" AFF TO THE TOP OF THE OUTLET BOX UON. FOUR WAY SWITCH + 48" AFF TO THE TOP OF THE OUTLET BOX UON. MOTOR RATED SWITCH WALL MOUNTED LOW VOLTAGE "DATALINE SWITCH = 48" FROM TOP OF BOX, UON a = CIRCUIT CONTROLLED LIGHTING OCCUPANCY SENSOR MOTION DETECTOR POWER PACK. ONE CIRCUIT WALL SWITCH WITH BUILT IN OCCUPANCY SENSOR. CONNECT SHITCHING TO LIGHTING FIXTURES AS REQUIRED. MOUNT AT +48"AFF TO THE TOT OF THE SWITCH BOX, UON. ACLE SYMBOLS CONVENIENCE RECEPTACLE - DUPLEX AT + 18" AFF AND NOT LESS THAN 15" FROM BOTTOM OF BOX U.O.N. RECEPTACLE - DOUBLE DUPLEX AT + 18" AFF
TYPICAL SWITCH \$ \$ a \$ 3 \$ 4 \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$	INDICATES SMITCHING DESIGNATION ADICATES CIRCUIT NUMBER SYMBOLS SINGLE POLE SMITCH, + 48" AFF TO THE TOP OF THE OUTLET BOX JON. SINGLE POLE SMITCH, + 48" AFF TO THE TOP OF THE OUTLET BOX, a = CIRCUIT CONTROLLED. THREE WAY SMITCH + 48" AFF TO THE TOP OF THE OUTLET BOX JON. FOUR WAY SMITCH + 48" AFF TO THE TOP OF THE OUTLET BOX JON. MOTOR RATED SMITCH WALL MOUNTED LOW VOLTAGE "DATALINE SMITCH = 48" FROM TOP OF BOX, JON a = CIRCUIT CONTROLLED LIGHTING OCCUPANCY SENSOR MOTION DETECTOR POWER PACK ONE CIRCUIT WALL SMITCH WITH BUILT IN OCCUPANCY SENSOR. CONNECT SMITCHING TO LIGHTING FIXTURES AS REQUIRED. MOUNT AT +48"AFF TO THE TOI OF THE SMITCH BOX, JON. ACLE SYMBOLS CONVENIENCE RECEPTACLE - DUPLEX AT + 18" AFF AND NOT LESS THAN IS" FROM BOTTOM OF BOX JON. GFCI CONVENIENCE RECEPTACLE - DUPLEX AT + 18" AFF AND NOT LESS THAN IS" FROM BOTTOM OF BOX JON. RECEPTACLE - DOUBLE DUPLEX AT + 18" AFF AND NOT LESS THAN IS" FROM BOTTOM OF BOX JON. RECEPTACLE - DOUBLE DUPLEX AT + 18" AFF AND NOT LESS THAN IS" FROM BOTTOM OF BOX JON. SINGLE RECEPTACLE - NEMA 5-20R JON, AT + 18" AFF
TYPICAL SWITCH \$ \$ a \$ 3 \$ 4 \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$	LUMINAIRE NOMENCLATURE INDICATES SWITCHING DESIGNATION IDICATES CIRCUIT NUMBER SYMBOLS SINGLE POLE SWITCH, + 48" AFF TO THE TOP OF THE OUTLET BOX UON. SINGLE POLE SWITCH, + 48" AFF TO THE TOP OF THE OUTLET BOX, a = CIRCUIT CONTROLLED. THREE WAY SWITCH + 48" AFF TO THE TOP OF THE OUTLET BOX UON. FOUR WAY SWITCH + 48" AFF TO THE TOP OF THE OUTLET BOX UON. MOTOR RATED SWITCH WALL MOUNTED LOW VOLTAGE "DATALINE SWITCH =48" FROM TOP OF BOX, UON. a = CIRCUIT CONTROLLED LIGHTING OCCUPANCY SENSOR MOTION DETECTOR POWER PACK ONE CIRCUIT WALL SWITCH WITH BUILT IN OCCUPANCY SENSOR, CONNECT SWITCHING TO LIGHTING FIXTURES AS REQUIRED. MOUNT AT +48"AFF TO THE TOTOF THE SWITCH BOX, UON. GEGL CONVENIENCE RECEPTACLE - DUPLEX AT + 18" AFF AND NOT LESS THAN 15" FROM BOTTOM OF BOX U.O.N. GRECIPTACLE - DOUBLE DUPLEX AT + 18" AFF AND NOT LESS THAN 15" FROM BOTTOM OF BOX U.O.N. SINGLE RECEPTACLE - NEMA 5-20R UON, AT + 18" AFF AND NOT LESS THAN 15" FROM BOTTOM OF BOX U.O.N. SINGLE RECEPTACLE - NEMA 5-20R UON, AT + 18" AFF AND NOT LESS THAN 15" FROM BOTTOM OF BOX U.O.N. SINGLE RECEPTACLE - NEMA 5-20R UON, AT + 18" AFF AND NOT LESS THAN 15" FROM BOTTOM OF BOX U.O.N. SINGLE RECEPTACLE - NEMA 5-20R UON, AT + 18" AFF AND NOT LESS THAN 15" FROM BOTTOM OF BOX U.O.N. SINGLE RECEPTACLE - NEMA 121 - 208 VOLT, THREE PHASE, 5 WIRE, AT + 18" AFF UON AND NOT LESS THAN 15" FROM BOTTOM OF BOX U.O.N. DOUBLE DUPLEX RECEPTACLE WITH (1) CONTROLLED DUPLEX AND (1) UNCONTROLLED DUPLEX, AT +18" AFF
TYPICAL SWITCH \$ \$ a \$ 3 \$ 4 \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$	LUMINAIRE NOMENCLATURE INDICATES SWITCHING DESIGNATION DICATES CIRCUIT NUMBER SYMBOLS SINGLE POLE SWITCH, + 48" AFF TO THE TOP OF THE OUTLET BOX UON. SINGLE POLE SWITCH, + 48" AFF TO THE TOP OF THE OUTLET BOX,
TYPICAL SWITCH \$ \$ a \$ 3 \$ 4 \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$ \$	LUMINAIRE NOMENCLATURE INDICATES SWITCHING DESIGNATION DICATES CIRCUIT NUMBER SYMBOLS SINGLE POLE SWITCH, + 48" AFF TO THE TOP OF THE OUTLET BOX UON. SINGLE POLE SWITCH, + 48" AFF TO THE TOP OF THE OUTLET BOX, a = CIRCUIT CONTROLLED. THREE WAY SWITCH + 48" AFF TO THE TOP OF THE OUTLET BOX UON. FOUR WAY SWITCH + 48" AFF TO THE TOP OF THE OUTLET BOX UON. MOTOR RATED SWITCH WALL MOUNTED LOW VOLTAGE "DATALINE SWITCH = 48" FROM TOP OF BOX, UON. a = CIRCUIT CONTROLLED LIGHTING OCCUPANCY SENSOR MOTION DETECTOR POWER PACK ONE CIRCUIT WALL SWITCH WITH BUILT IN OCCUPANCY SENSOR. CONNECT SWITCHING TO LIGHTING FIXTURES AS REQUIRED. MOUNT AT +48"AFF TO THE TO! OF THE SWITCH BOX, UON. ACLE SYMBOLS CONVENIENCE RECEPTACLE - DUPLEX AT + 18" AFF AND NOT LESS THAN 15" FROM BOTTOM OF BOX U.O.N. RECEPTACLE - DOUBLE DUPLEX AT + 18" AFF AND NOT LESS THAN 15" FROM BOTTOM OF BOX U.O.N. SINGLE RECEPTACLE - NEMA 5-20R UON, AT + 18" AFF AND NOT LESS THAN 15" FROM BOTTOM OF BOX U.O.N. SINGLE RECEPTACLE - NEMA 5-20R UON, AT + 18" AFF AND NOT LESS THAN 15" FROM BOTTOM OF BOX U.O.N. SINGLE RECEPTACLE - NEMA 5-20R UON, AT + 18" AFF AND NOT LESS THAN 15" FROM BOTTOM OF BOX U.O.N. SINGLE RECEPTACLE - NEMA 121 - 208 VOLT, THREE PHASE, 5 NIRE, AT + 18" AFF UON AND NOT LESS THAN 15" FROM BOTTOM OF BOX U.O.N. DOUBLE DUPLEX RECEPTACLE WITH (1) CONTROLLED DUPLEX AND (1) UNCONTROLLED DUPLEX, AT + 18" AFF AND NOT LESS THAN 15" FROM BOTTOM OF BOX U.O.N.

POWER	DISTRIBUTION SYMBOLS
	PANELBOARD - SURFACE OR FLUSH MOUNTED.
LCP	LIGHTING CONTROL CABINET.
EM	EMERGENCY POWER INVERTER.
(JUNCTION BOX - CEILING OR WALL MOUNTED, SIZE PER CEC, TAPE AND TAG WIRES.
	MAIN SWITCHBOARD OR DISTRIBUTION PANEL.
<u>/</u> M/	MOTOR
30 _⊠ ,	RATING AS INDICATED.
60	UNFUSED DISCONNECT SWITCH - RATING AS INDICATED.
100	FUSED DISCONNECT SWITCH - SIZE FUSES PER MOTOR MANUFACTURER'S RECOMMENDATIONS. RATING AS INDICATED.
π_{\boxtimes}	MAGNETIC STARTER - NEMA SIZE INDICATED.
T	TRANSFORMER - SEE SINGLE LINE FOR REQUIREMENTS.
ø 🛓	GROUND ROD.
P	IN-GRADE ELECTRICAL PULL BOX WITH TRAFFIC RATED LID.
L	IN-GRADE LIGHTING PULL BOX WITH TRAFFIC RATED LID.
C	IN-GRADE COMMUNICATION PULL BOX WITH TRAFFIC RATED LID.
EVI	SINGLE EV CHARGER FOR BUS
EV2	DOUBLE EV CHARGER FOR CAR
POWER I	DISTRIBUTION SINGLE LINE SYMBOLS
	DRAM-OUT CIRCUIT BREAKER.
	CIRCUIT BREAKER.
	FUSED SMITCH.
₩	"PG&E" METER W/ CURRENT TRANSFORMER.
	TRANSFORMER.
———	NORMALLY OPENED, AUXILIARY CONTACT.
	NORMALLY CLOSED, AUXILIARY CONTACT.
~ °	AUTOMATIC TRANSFER SMITCH.
	EMERGENCY GENERATOR.
<u>MIRING</u> \$	CONDUIT RUN SYMBOLS CONDUIT - CONCEALED IN WALLS OR CEILING. CONDUIT - EXPOSED.
	CONDUIT - IN OR BELOW FLOOR: 3/4"MIN.
	EXISTING CONDUIT, CABLES OR DEVICE
#10	CONDUIT - HOME RUN TO PANEL, TERMINAL CABINET, ETC. RUNS MAR WITH CROSSHATCHES INDICATE NUMBER OF #12 AWG WIRES. CROSSH WITH SUBSCRIPT "G" INDICATES GREEN GROUND WIRE. SIZE CONDUIT ACCORDING TO SPECIFICATIONS AND APPLICABLE CODE. CROSSHATCHES WITH "#10" INDICATES WIRE SIZE OTHER THAN #12'S.
	FLEX CONDUIT WITH CONNECTION.
o	CONDUIT - STUB UP.
	CONDUIT - STUB DOWN. CONDUIT EMERGENCY SYSTEM.
	COLEGE ENERGIBLE

SHATCH CONDUIT EMERGENCY SYSTEM. CAPPED CONDUIT. CONDUIT CONTINUATION.

MATTSTOPP	ER DIGITAL	LIGHTING	MANAGEMENT	CONTROLS
LCP	WATTSTOPPER	LMCP24		

LCP	WATTSTOPPER LMCP24
LMRC 101	WATTSTOPPER LMRC-101
LMRC 211	WATTSTOPPER LMRC-211
LMRC 212	WATTSTOPPER LMRC-212
LMRC 213	WATTSTOPPER LMRC-213

WATTSTOPPER LMDC-100, CEILING MOUNT

WATTSTOPPER LMDW-101, + 48" AFF TO TOP OF THE BOX, UON. WATTSTOPPER LMLS-500, CEILING/WALL MOUNT

WATTSTOPPER LMSW-101, + 48" AFF TO TOP OF THE BOX, UON.

WATTSTOPPER LMSW-102, + 48" AFF TO TOP OF THE BOX, UON.

COMMUNICATIONS SYMBOLS

19" FLOOR MOUNTED DATA RACK. DATA/TEL STATION AT +18" AFF UON WITH (1) DATA OUTLET. CONNECT DATA/TEL OUTLETS OUTLETS PER THE DATA/TEL RISER DIAGRAM. STUB CONDUIT INTO AVAILABLE CEILING SPACE.

DATA/TEL STATION AT +18" AFF UON WITH (2) DATA OUTLETS. CONNECT DATA/TEL OUTLETS OUTLETS PER THE DATA/TEL RISER DIAGRAM. STUB CONDUIT INTO AVAILABLE CEILING SPACE.

MAP (2) DATA OUTLETS FOR WIRELESS ACCESS POINT EQUIPMENT TO BE MOUNTED IN CEILING CHASE.

INTERIOR SPEAKER WALL MOUNTED AT + 8'-0" AFF UON. CONNECT SPEAKER PER THE PA/CLOCK RISER DIAGRAM

DIAGRAM

FLUSH MOUNTED EXTERIOR SPEAKER AT +8'-0" AFF UON. CONNECT

CEILING MOUNTED SPEAKER. CONNECT SPEAKER PER THE PA/CLOCK RISER

COMBINATION FLUSH MOUNTED CLOCK/SPEAKER DEVICE AT +8'-0" AFF UON. CONNECT CLOCK/SPEAKER PER THE PA/CLOCK RISER DIAGRAM. PROVIDE 3"C TO ACCESSIBLE CEILING.

EXTERIOR SPEAKER PER THE PA/CLOCK RISER DIAGRAM.

HDMI DEVICE. CONNECT PER A $4\frac{11}{16}$ " EXTRA DEEP BOX WITH A 2 GANG RING THROUGH 14"C TO CEILING.

FIRE ALARM SYMBOLS

FIRE ALARM CONTROL PANEL. REMOTE POWER SUPPLY. EVAC SPEAKER AMPLIFIER. FIRE ALARM TERMINAL CABINET. REMOTE FIRE ALARM ANNUNCIATOR. SMOKE DETECTOR PULL STATION

HORN STROBE

MEP COMPONENT ANCHORAGE NOTE

ALL MECHANICAL, PLUMBING, AND ELECTRICAL COMPONENTS SHALL BE ANCHORED AND INSTALLED PER THE DETAILS ON THE DSA APPROVED CONSTRUCTION DOCUMENTS. WHERE NO DETAIL IS INDICATED, THE FOLLOWING COMPONENTS SHALL BE ANCHORED OR BRACED TO MEET THE FORCE AND DISPLACEMENT REQUIREMENTS PRESCRIBED IN THE 2016 CBC,

I. ALL PERMANENT EQUIPMENT AND COMPONENTS.

SECTIONS 1616A.1.18 THROUGH 1616A.1.26 AND ASCE 7-10 CHAPTER 13, 26 AND 30.

2. TEMPORARY OR MOVABLE EQUIPMENT THAT IS PERMANENTLY ATTACHED (e.g. HARD WIRED) TO THE BUILDING UTILITY SERVICES SUCH AS ELECTRICITY, GAS OR

3. MOVABLE EQUIPMENT WHICH IS STATIONED IN ONE PLACE FOR MORE THAN 8 HOURS AND HEAVIER THAN 400 POUNDS ARE REQUIRED TO BE ANCHORED WITH TEMPORARY ATTACHMENTS.

THE FOLLOWING MECHANICAL AND ELECTRICAL COMPONENTS SHALL BE POSITIVELY ATTACHED TO THE STRUCTURE, BUT NEED NOT BE DETAILED ON THE PLANS. THESE COMPONENTS SHALL HAVE FLEXIBLE CONNECTIONS PROVIDED BETWEEN THE COMPONENT AND ASSOCIATED DUCTWORK, PIPING, AND CONDUIT.

A. COMPONENTS WEIGHING LESS THAN 400 POUNDS AND HAVE A CENTER OF MASS LOCATED 4 FEET OR LESS ABOVE THE ADJACENT FLOOR OF ROOF LEVEL THAT

DIRECTLY SUPPORT THE COMPONENT. B. COMPONENTS WEIGHING LESS THAN 20 POUNDS, OR IN THE CASE OF DISTRIBUTED SYSTEMS, LESS THAN 5 POUNDS PER FOOT, WHICH ARE SUSPENDED FROM A ROOF OR FLOOR OR HUNG FROM A WALL.

FOR THOSE ELEMENTS THAT DO NOT REQUIRE DETAILS ON THE APPROVED DRAWINGS, THE INSTALLATION SHALL BE SUBJECT TO THE APPROVAL OF THE DESIGN PROFESSIONAL IN GENERAL RESPONSIBLE CHARGE OR STRUCTURAL ENGINEER DELEGATED RESPONSIBILITY AND THE DSA DISTRICT STRUCTURAL ENGINEER. THE PROJECT INSPECTOR WILL VERIFY THAT ALL COMPONENTS AND EQUIPMENT HAVE BEEN ANCHORED IN ACCORDANCE WITH ABOVE REQUIREMENTS.

PIPING, DUCTWORK, AND ELECTRICAL DISTRIBUTION SYSTEM BRACING NOTE PIPING, DUCTWORK, AND ELECTRICAL DISTRIBUTION SYSTEMS SHALL BE BRACED TO

COMPLY WITH THE FORCES AND DISPLACEMENTS PRESCRIBED IN ASCE 7-10 SECTION 13.3 AS DEFINED IN ASCE 7-10 SECTION 13.6.5.6, 13.6.7, 13.6.8, AND 2016 CBC, SECTIONS 1616A.I.23, 1616A.I.24, 1616A.I.25 AND 1615A.I.26.

THE METHOD OF SHOWING BRACING AND ATTACHMENTS TO THE STRUCTURE FOR THE IDENTIFIED DISTRIBUTION SYSTEM ARE AS NOTED BELOW. WHEN BRACING AND ATTACHMENTS ARE BASED ON A PREAPPROVED INSTALLATION GUIDE (E.G., SMACNA OR OSHPD OPM), COPIES OF THE BRACING SYSTEM INSTALLATION GUIDE OR MANUAL SHALL BE AVAILABLE ON THE JOBSITE PRIOR TO THE START OF AND DURING THE HANGING AND BRACING OF THE DISTRIBUTION SYSTEM. THE STRUCTURAL ENGINEER OF RECORD SHALL VERIFY THE ADEQUACY OF THE STRUCTURE TO SUPPORT THE HANGER AND BRACE LOADS.

MECHANICAL PIPING (MP), MECHANICAL DUCTS (MD), PLUMBING PIPING (PP), ELECTRICAL DISTRIBUTION SYSTEMS (E):

MP□ MD□ PP□ EX - OPTION I: DETAILED ON THE APPROVED DRAWINGS WITH PROJECT SPECIFIC NOTES AND DETAILS.

MP | MD | PP | E | - OPTION 2: SHALL COMPLY WITH THE APPLICABLE OSHPD PRE-APPROVED (OPM #) #

MP | MD | PP | - OPTION 3: SHALL COMPLY WITH THE SMACNA SEISMIC RESTRAINT MANUAL, OSHPD EDITION (2009), INCLUDING ANY ADDENDA. FASTENERS AND OTHER ATTACHMENTS NOT SPECIFICALLY IDENTIFIED IN THE SMACNA SEISMIC RESTRAINT MANUAL, OSHPD EDITION, ARE DETAILED ON THE APPROVED DRAWINGS WITH PROJECT SPECIFIC NOTES AND DETAILS. THE DETAILS SHALL ACCOUNT FOR THE APPLICABLE SEISMIC HAZARD LEVEL AND CONNECTION LEVEL FOR THE PROJECT AND

GENERAL NOTES:

AND ALL CLAIMS RESULTING FROM THIS WORK.

- THE CONTRACTOR SHALL BE LICENSED BY THE STATE OF CALIFORNIA C-10 AND SHALL COMPLY WITH ALL APPLICABLE CODES AND REGULATIONS. MATERIALS AND EQUIPMENT
- SHALL BE U.L. LISTED AND LABELED FOR THE APPLICATION. THE CONTRACTOR SHALL OBTAIN AND PAY FOR ALL PERMITS, LICENSES AND INSPECTION
- FEES REQUIRED BY THIS CONTRACT WORK. PRIOR TO SUBMITTING A BID THE CONTRACTOR SHALL VISIT THE SITE, REVIEW THE EXISTING CONDITIONS AND ALLOW FOR LABOR, MATERIAL AND COORDINATION THAT IS NECESSARY TO PROVIDE A COMPLETE INSTALLATION OF EACH SYSTEM. THE

CONTRACTOR SHALL OBTAIN AND BE FAMILIAR WITH ALL OTHER TRADES. THE

CONTRACTOR SHALL BE RESPONSIBLE FOR ALL ELECTRICAL WORK NOTED AND CALLED

- OUT ON ALL CONTRACT DOCUMENTS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATION BETWEEN OTHER TRADES ON PROJECT. 4. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE SAFETY OF PERSONS AND PROPERTY AND SHALL PROVIDE INSURANCE COVERAGE AS NECESSARY FOR LIABILITY, PERSONAL, PROPERTY DAMAGE, TO FULLY PROTECT THE OWNER, ARCHITECT AND ENGINEER FROM ANY
- 5. THE CONTRACTOR SHALL MAINTAIN RECORD DRAWINGS AT THE PROJECT SITE INDICATING ALL MODIFICATIONS TO ELECTRICAL SYSTEMS. THE CONTRACTOR SHALL AT THE CONCLUSION OF THE PROJECT PROVIDE ACCURATE "AS-BUILT" DRAWINGS. "AS-BUILT" DRAWINGS SHALL SHOW ACTUAL CHANGES TO ORIGINAL ELECTRICAL DRAWING, SHOW LOCATIONS OF PULL BOXES, CONDUIT RUNS AND MIRING CHANGES. THE CONTRACTOR SHALL PROVIDE ONE (I) HARDCOPY SET OF DOCUMENT DRAWINGS AND ONE (I) SET OF DOCUMENT DRAWINGS IN ELECTRONIC CAD FILE THAT REPRESENTS THE ACTUAL "AS-BUILTS". CAD FILES SHALL BE AUTOCAD 2000 FORMAT.
- 6. ALL MATERIALS PROVIDED TO THE PROJECT SHALL BE NEW. THE CONTRACTOR SHALL BE RESPONSIBLE TO PROVIDE AND INSTALL ALL INCIDENTAL MATERIALS REQUIRED FOR A COMPLETE INSTALLATION.
- 7. THE CONTRACTOR SHALL PROVIDE TO THE ARCHITECT A CONSTRUCTION SCHEDULE OF ELECTRICAL WORK. THE CONSTRUCTION SCHEDULE SHALL IDENTIFY ALL SIGNIFICANT MILESTONES WITH COMPLETION DATES.
- 8. THE CONTRACTOR SHALL PROVIDE ALL REQUIRED "CUTTING, PATCHING, EXCAVATION, BACKFILL AND REPAIRS" NECESSARY TO RESTORE DAMAGED SURFACES TO EQUAL OR BETTER THAN ORIGINAL CONDITIONS EXISTING AT START OF WORK. THE CONTRACTOR SHALL CONTACT "UNDERGROUND SERVICES ALERT" FOR LOCATION OF EXISTING UTILITIES PRIOR TO COMMENCEMENT OF UNDERGROUND WORK.
- 9. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PAINTING ALL EXPOSED CONDUITS AND ELECTRICAL EQUIPMENT. REFER TO ARCHITECTS PAINTING SECTION FOR REQUIREMENTS.
- 10. ALL ELECTRICAL EQUIPMENT INSTALLED OUTDOORS SHALL BE WEATHERPROOF. EXTERIOR CONDUITS RUN INTO BUILDINGS SHALL BE INSTALLED WITH FLASHING, CAULKED AND SEALED. CONDUITS FOR EXTERIOR ELECTRICAL DEVICES SHALL BE RUN INSIDE BUILDING UNLESS OTHERWISE NOTED ON DRAWINGS. ALL EXTERIOR CONDUITS SHALL BE "RSG" UNLESS OTHERWISE NOTED ON DRAWINGS.
- II. ALL CONDUITS UNLESS OTHERWISE NOTED ON DRAWINGS SHALL HAVE AS A MINIMUM: TWO (2) #12'S WITH ONE (1) #12 GROUND. "TICK" MARKS SHOWN ON CIRCUITRY ARE FOR "ROUGH" ESTIMATING ONLY. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL WIRES AND WIRE SIZES REQUIRED BY LATEST CODE.
- 12. COORDINATE ALL CONDUIT RUNS, ELECTRICAL EQUIPMENT AND PANELS WITH ALL OTHER WORK TO AVOID CONFLICTS.
- 13. SEE ARCHITECTURAL DOCUMENTS FOR EXACT PLACEMENT OF LIGHTING FIXTURES AND DEVICES. THE ELECTRICAL CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFICATION OF CEILING TYPES FROM ARCHITECTURAL DOCUMENTS AND PROVIDE AND INSTALL ALL REQUIRED FIXTURE MOUNTING HARDWARE. PROVIDE AND INSTALL U.L. LISTED FIRE STOP ENCLOSURES FOR ALL RECESSED FIXTURES IN FIRE RATED CEILINGS.
- 14. THE CONTRACTOR SHALL PROVIDE IN EVERY CONDUIT A DRAW STRING FOR USE IN FUTURE CONSTRUCTION.
- 15. POWER FEEDERS MAY NOT BE SHOWN ON THE DRAWINGS, REFER TO THE SINGLE LINE DIAGRAM FOR CONDUIT AND FEEDER INFORMATION. ALL DRAWINGS ARE DIAGRAMMATIC INDICATING LOCATION OR POSITION OF EQUIPMENT. FIELD VERIFY CONDITIONS PRIOR TO INSTALLATION OF ANY WORK.
- 16. MANUFACTURER'S RECOMMENDATIONS FOR CONDUCTOR SIZING, CIRCUIT BREAKER OR FUSE PROTECTION OF ELECTRICALLY OPERATED EQUIPMENT MAY DIFFER FROM THOSE INDICATED ON DRAWINGS. CONTRACTOR SHALL CONFIRM RATINGS PRIOR TO ORDERING EQUIPMENT. PROVIDE ELECTRICAL PROTECTION TO EQUIPMENT IN ACCORDANCE TO MANUFACTURER'S SPECIFICATIONS AND PER NATIONAL ELECTRICAL CODE REQUIREMENTS.
- 17. CONTRACTOR SHALL REVIEW EQUIPMENT REQUIREMENTS OF OTHER TRADES AND PROVIDE POWER CIRCUITS AND CONNECTIONS TO ELECTRICALLY OPERATED EQUIPMENT.
- 18. EFFECTIVELY BOND ELECTRICAL CABINETS, ENCLOSURES AND CONDUIT RACEWAYS TO CODE APPROVED GROUND AS PART OF THE CONTINUOUS GROUNDING SYSTEM.
- 19. MEASEURE THE 3-PHASE AND PHASE TO NEUTRAL SERVICE VOLTAGE FOR 208/120V PANELS PRIOR TO ENERGIZING ANY PANELS OR EQUIPMENT. AVOID ENERGIZING 208/120V PANELS PHASE TO NEUTRAL VOLTAGE ABOVE 130 VOLTS. TRANSFORMER TAP SETTING
- 20. MEASURE THE I-PHASE AND PHASE TO NEUTRAL SERVICE VOLTAGE FOR 240/120V PANELS PRIOR TO ENERGIZING ANY PANELS OR EQUIPMENT. AVOID ENERGIZING 240/120V PANELS PHASE TO NEUTRAL VOLTAGE ABOVE 130 VOLTS.
- 21. DO NOT SUBSTITUTE SPECIFIED MATERIAL OR EQUIPMENT WITHOUT FIRST OBTAINING APPROVAL FROM THE OWNER OR HIS REPRESENTATIVE.
- 22. IDENTIFY ALL ABOVE CEILING JUNCTION BOXES COVERS WITH PANEL AND CIRCUITS IN LEGIBLE PRINT USING BLACK INDELIBLE INK. ABOVE CEILING JUNCTION BOXES SHALL ALSO BE LABELED AT THE REAR INTERIOR BOX WITH AN INDELIBLE BLACK MARKER.
- 23. LABEL ALL WALL AND/OR WIREMOLD MOUNTED OUTLET DEVICES WITH PANEL CIRCUIT IDENTIFICATION WITH BOLD TYPE-PRINTED LABELING. BLACK LETTERING ON WHITE BACKGROUND PREFERRED.

24. DERATE CONDUCTORS IN RACEWAYS IN ACCORDANCE WITH NEC CODE REQUIREMENTS.

CIRCUITS PER WIREMOLD CAPACITIES.

PANEL FEEDERS TO WIREMOLDS CAN ENTER AT VARIOUS LOCATIONS TO LIMIT CONDUCTOR

	DRAWING INDEX								
SHEET NO.	SHEET TITLE								
EO.1	ELECTRICAL COVER SHEET								
E1.1	ELECTRICAL SITE PLAN								
E2.1	DEMO FLOOR PLAN - BUILDINGS I, 2, 3 & 4								
E3.1	NEW FLOOR PLAN - BUILDINGS I, 2, 3 & 4								
E4.1	DEMO SINGLE LINE DIAGRAM								
E4.2	NEW SINGLE LINE DIAGRAM								
E4.3	PANEL SCHEDULES								
E5.1	ELECTRICAL DETAILS								
E5.2	ELECTRICAL DETAILS								
E5.3	ELECTRICAL DETAILS								
E5.4	ELECTRICAL DETAILS								

ABBREVIATIONS

BLDG

CB

CD CKT

CLG

CTR

DÉT

DISTR

DMG

EQPT

FACP

(F) FIN

FL

ΚV

LTG

MCM

MECH

MTD

MTG

REQD

REQT

RM

UON

PUBLIC ADDRESS

POWER FACTOR

REQUIREMENT(S)

RIGID STEEL CONDUIT

TERMINAL CABINET

UNLESS OTHERWISE NOTED

TELEPHONE

WEATHERPROOF

TRANSFORMER

EXISTING TO BE RELOCATED

PULL BOX

REQUIRED

PHASE

PANEL

ROOM

SMITCH SWITCHBOARD

VOLT

MATT

CO

SS 🗹 FLS 🗹 ACS 🗹 DATE: 09/21/2021 AMPERE ABOVE AMP FRAME OR AMP FUSE ABOVE FINISHED FLOOR ARCHITECTURAL AMP SWITCH AMP TRIP AUTOMATIC TRANSFER SWITCH BREAKER BUILDING CONDUIT CABLE TELEVISION www.aedisarchitects.com CIRCUIT BREAKER 387 S. 1st Street, Suite 300 CANDELAS San Jose, CA 95113 CIRCUIT CENTER LINE tel: (408)-300-5160 CEILING CONDUIT ONLY CENTER PROJECT DEMOLISH DETAIL DIMENSION DISTRIBUTION DRAWING EXISTING EMERGENCY EQUIPMENT FIRE ALARM FIRE ALARM CONTROL PANEL FUTURE FINISH FL00R G, GND GROUND HEIGHT HORSEPOWER INTERCOM INTERMEDIATE DISTRIBUTION FRAME JUNCTION BOX KILOAMPERE INTERRUPTING CAPACITY KILOVOLT KILOVOLT AMPERES KILOWATT LIGHTING THOUSAND CIRCULAR MILS MAIN DISTRIBUTION FRAME MECHANICAL CONSULTANT MANHOLE MOUNTED MOUNTING NEW NORMALLY CLOSED NOT IN CONTRACT NOT IN ELECTRICAL CONTRACT NUMBER/ NORMALLY OPEN NOT TO SCALE ON CENTER POLE CIRCUIT BREAKER

fax: (408)-300-5121 **MEADOW HEIGHTS ELEMENTARY** SCHOOL - HVAC REPLACEMENT

architects

SAN MATEO-FOSTER CITY SCHOOL DISTRICT

IDENTIFICATION STAMP DIV. OF THE STATE ARCHITEC

REVIEWED FOR

APP: 01-119554 INC:



American_Consulting Engineers Electrical, Inc. 1590 The Alameda, Suite 200 San Jose, CA 95126 JOB # EK21030.00

STAMP

STATE DSA FILE NUMBER 01-119554

REVISIONS

No. Description Date

MILESTONES

90% CD DSA SUB BACKCHECK

06/02/2021

09/22/202

ELECTRICAL COVER SHEET

SHEET

09/17/2021

E0.

GENERAL NOTES:

- I. CONTRACTOR SHALL COORDINATE UNDERGROUND REQUIREMENTS WITH ALL OTHER TRADES TO AVOID CONFLICTS.
- 2. CONTRACTOR SHALL BE RESPONSIBLE FOR ANY SAW CUTTING AND REMOVAL OF EXISTING SURFACES TO FACILITATE UNDERGROUND SYSTEMS. THE CONTRACTOR SHALL PATCH AND REPAIR ALL DAMAGED AND CUT SURFACES TO MATCH ADJACENT.
- 3. CONTRACTOR TO SITE SURVEY EXISTING CONDITIONS AND LOCATIONS OF EXISTING UNDERGROUND SYSTEMS, WHERE NEW TRENCH WORK OCCURS PRIOR TO BIDDING. CONTRACTOR SHALL TAKE PROPER PRECAUTIONS TO ENSURE EXISTING UNDERGROUND SYSTEMS/CONDUIT/PIPES ARE NOT DAMAGED DURING INSTALLATION. CONTRACTOR IS RESPONSIBLE FOR ANY REPAIRS REQUIRED IN THE EVENT THE EXISTING UNDERGROUND SYSTEMS ARE DAMAGED AS A RESULT OF THE NEW ELECTRICAL TRENCH WORK.
- 4. INSTALL PG&E PRIMARY TRENCH PER I/ E5.I.
- 5. INSTALL PG & E SECONDARY TRENCH PER 3/ E5.1.
- 6. PG & TRANSFORMER PAD SHALL BE PER 2/ E5.1.
- 7. ALL ON SITE TRENCH SHALL BE INSTALLED PER 3/ E5.4.
- 8. SEE THE DEMO SINGLE LINE DIAGRAM FOR ADDITIONAL REQUIREMENTS.
- 9. SEE NEW SINGLE LINE DIAGRAM FOR FEEDER CABLE AND CONDUIT
- 10. THE CONTRACTOR SHALL MANDREL THROUGH THE ENTIRE PG&E CONDUIT SYSTEM. COORDINATE WITH PG&E FOR ADDITIONAL REQUIREMENTS AND

SHEET NOTES:


- > EXISTING PG&E POLE WITH NEW PG&E PRIMARY RISER.
- EXISTING 1600A MAIN SWITCHBOARD, CONCRETE PAD AND ALL ASSOCIATED EQUIPMENT TO BE DEMOLISHED. EXISTING FEEDER TO BUILDING LGI TO REMAIN. PROVIDE B3048 PULL BOX AS REQUIRED TO INTERCEPT THE LGI FEEDER.
- EXISTING PG&E TRANSFORMER TO BE REMOVED BY PG&E. DEMOLISH EXISTING TRANSFORMER PAD AND PATCH SURFACE TO MATCH EXISTING.
- 4 NEW PG&E TRANSFORMER PAD. REFER TO DETAIL 2/E5.I FOR ADDITIONAL REQUIREMENTS.
- 5 FUTURE PV DISCONNECT SWITCH
- > FUTURE PV DISTRIBUTION PANEL.
- NEW 2000A MAIN SWITCHBOARD. REFER TO DETAIL I/E5.I FOR
- 8 NEW TRANSFORMER 'TP' AND PAD. REFER TO DETAIL 6/E5.4 FOR ADDITIONAL REQUIREMENTS.
- PANEL 'DPP'. REFER TO DETAIL 8/E5.1 FOR ADDITIONAL REQUIREMENTS.
- NEW 400A-3P, WALL MOUNT DISCONNECT SWITCH. REFER TO DETAIL 8/E5.I FOR ADDITIONAL REQUIREMENTS.

PULLBOX SCHEDULE:

- NEW 4'-6"x8'-6" ELECTRIC / POWER PULLBOX WITH TRAFFIC RATED LID. LABEL LID 'POWER'.
- NEW B2436 ELECTRIC / POWER PULLBOX WITH TRAFFIC RATED LID. LABEL LID 'POWER'.
- NEW 3'x5' ELECTRIC / POWER PULLBOX WITH TRAFFIC RATED LID. LABEL LID 'POWER'.
- NEW B3048 ELECTRIC / POWER PULLBOX WITH TRAFFIC RATED LID. LABEL LID 'POWER'.
- NEW B2436 COMMUNICATIONS PULLBOX WITH TRAFFIC RATED LID. LABEL LID 'COMM.'.
- C2 NEW B3048 COMMUNICATIONS PULLBOX WITH TRAFFIC RATED LID. LABEL LID 'COMM.'.

CONDUIT SCHEDULE:

- $\left(\ \ \right)$ (N) (I) 4"C PG&E PRIMARY
- \langle 2 \rangle (N) (7) 5"C PG \sharp E SECONDARY (3) (N) (1) 1"C - PG#E COMMUNICATIONS
- (4) (N) (2) 3"C FUTURE PV DISTRIBUTION PANEL.
- (5) (N) (I) 2"C FUTURE PV COMMUNICATIONS
- (6) (N) (1) 1"C PG\$E COMMUNICATIONS (N) (1) 2"C - FUTURE PV COMMUNICATIONS
- (7) (N) (1) 4"C PNL 'G1'
- $\langle 8 \rangle$ (N) (4) 4"C FUTURE POWER (MU) (N) (2) $2\frac{1}{2}$ "C - FUTURE PV (MU)
- (N) (I) 4"C XFMR 'TA' (N) (I) $2\frac{1}{2}$ "C - FUTURE PV
- (N) (I) $2\frac{1}{2}$ "C XFMR 'TB' (N) (I) $2\frac{1}{2}$ "C FUTURE PV
- $\langle II \rangle$ (N) (I) 4"C XFMR 'TA' (N) (I) $2\frac{1}{2}$ "C - XFMR 'TB' (N) (2) $2\frac{1}{2}$ "C - FUTURE PV
- (12) (N) (I) $2\frac{1}{2}$ "C XFMR 'TC' (N) (I) 2^{\downarrow}_{2} "C - FUTURE PV
- (I3) (N) (I) 4"C XFMR 'TA' (N) (I) $2\frac{1}{2}$ "C - XFMR 'TB' (N) (1) $2\frac{1}{2}$ "C - XFMR 'TC' (N) (3) 2_2^1 "C - FUTURE PV
- $\langle 14 \rangle$ (N) (I) $2\frac{1}{2}$ "C XFMR 'TD' (N) (I) $2\frac{1}{2}$ "C - FUTURE PV
- (15) (N) (I) 4"C XFMR 'TA' (N) (I) $2\frac{1}{2}$ "C - XFMR 'TB' (N) (I) $2^{\bar{1}}_{2}$ "C - XFMR 'TC' (N) (I) $2\frac{1}{2}$ "C - XFMR 'TD' (N) (4) $2\frac{1}{2}$ "C - FUTURE PV
- $\langle 16 \rangle$ (N) (1) $1\frac{1}{2}$ "C XFMR 'TP' (17) (N) (1) 4"C - XFMR 'TA' (N) (I) $2\frac{1}{2}$ "C - XFMR 'TB' (N) (1) $2\frac{1}{2}$ "C - XFMR 'TC' (N) (I) $2\frac{1}{2}$ "C - XFMR 'TD' (N) (I) I_2^{\perp} "C - XFMR 'TP' (N) (4) $2\frac{1}{2}$ "C - FUTURE PV
- $\langle 18 \rangle$ (N) (I) $1\frac{1}{2}$ "C PANEL 'P6'
- $\langle 19 \rangle$ (N) (1) $\frac{1}{2}$ "C PANEL 'P7'
- $\langle 20 \rangle$ (N)(I) $2\frac{1}{2}$ "C PANEL 'DPP' $\langle 2| \rangle$ (N) (7) $2\frac{1}{2}$ "C - FUTURE PV
- (N) (I) $2\frac{1}{2}$ "C XFMR 'TB' (N) (I) $2\frac{1}{2}$ "C XFMR 'TD'
- (N) (1) 12"C XFMR 'TP' (N) (4) 4"C FUTURE MULTI-USE 23 (N) (I) 4"C - XFMR 'TA' (N) (I) 2_2^{\perp} "C - XFMR 'TC' (N) (4) 4"C - SPARE
- (N) (4) 4"C FUTURE COMMUNICATION

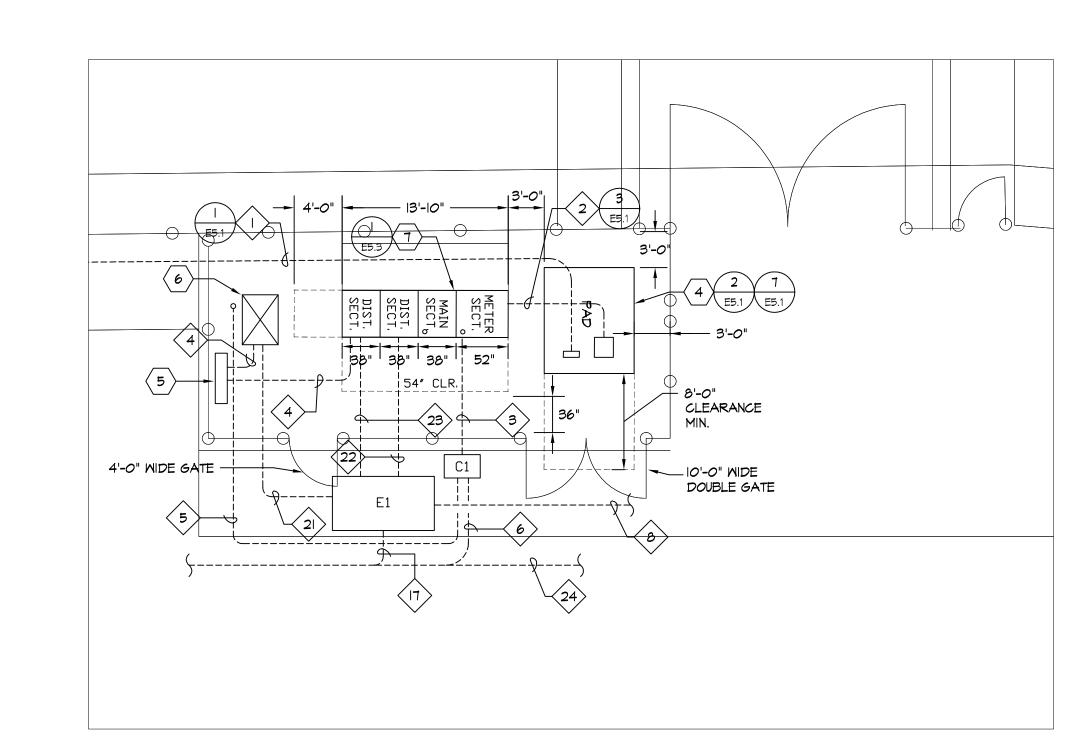

ELECTRICAL SWITCHGEAR DIMENSIONS

E1.1 SCALE: 1/8"=1'-0"

DIV. OF THE STATE ARCHITE APP: 01-119554 INC: REVIEWED FOR SS 🗹 FLS 🗹 ACS 🗹

IDENTIFICATION STAMP

architects


www.aedisarchitects.com 387 S. 1st Street, Suite 300 San Jose, CA 95113 tel: (408)-300-5160

fax: (408)-300-5121

PROJECT **MEADOW HEIGHTS**

ELEMENTARY SCHOOL - HVAC REPLACEMENT

SAN MATEO-FOSTER CITY





American Consulting Engineers Electrical, Inc. 1590 The Alameda, Suite 200 San Jose, CA 95126 JOB # EK21030.00 408/236-2312 Fax: 408/236-2316

STAMP

STATE DSA FILE NUMBER 41-26

01-119554 REVISIONS

APPL#

No. Description Date

MILESTONES DD 90% CD DSA SUB 06/02/2021

BACKCHECK

09/22/202

SHEET

ELECTRICAL SITE PLAN

09/17/2021

^{JOB#} 2021005.04

E1.1

SCALE: |"=20'-0"



DEMOLITION SHEET NOTES: EXISTING MECHANICAL UNIT TO BE DEMOLISHED. PULL EXISTING ELECTRICAL CIRCUITRY BACK TO SOURCE AND REMOVE. REMOVE ALL CONDUITS, J-BOXES AND DISCONNECT SWITCH ASSOCIATED WITH THE (2) EXISTING MECHANICAL UNIT AND CONNECTIONS TO REMAIN.

architects

IDENTIFICATION STAMP DIV. OF THE STATE ARCHITE

REVIEWED FOR SS 🗹 FLS 🗹 ACS 🗹

APP: 01-119554 INC:

www.aedisarchitects.com 387 S. 1st Street, Suite 300 San Jose, CA 95113 tel: (408)-300-5160 fax: (408)-300-5121

PROJECT **MEADOW HEIGHTS ELEMENTARY** SCHOOL - HVAC REPLACEMENT

SAN MATEO-FOSTER CITY SCHOOL DISTRICT

CONSULTANT



American Consulting Engineers Electrical, Inc.

STAMP

DSA FILE NUMBER APPL#

REVISIONS No. Description Date

MILESTONES

90% CD DSA SUB BACKCHECK

06/02/2021

SHEET


ELECTRICAL DEMO FLOOR PLANS -BLDGS 1, 2, 3 & 4

09/17/2021

JOB# 2021005.04 SHEET#

LGI


E2.1

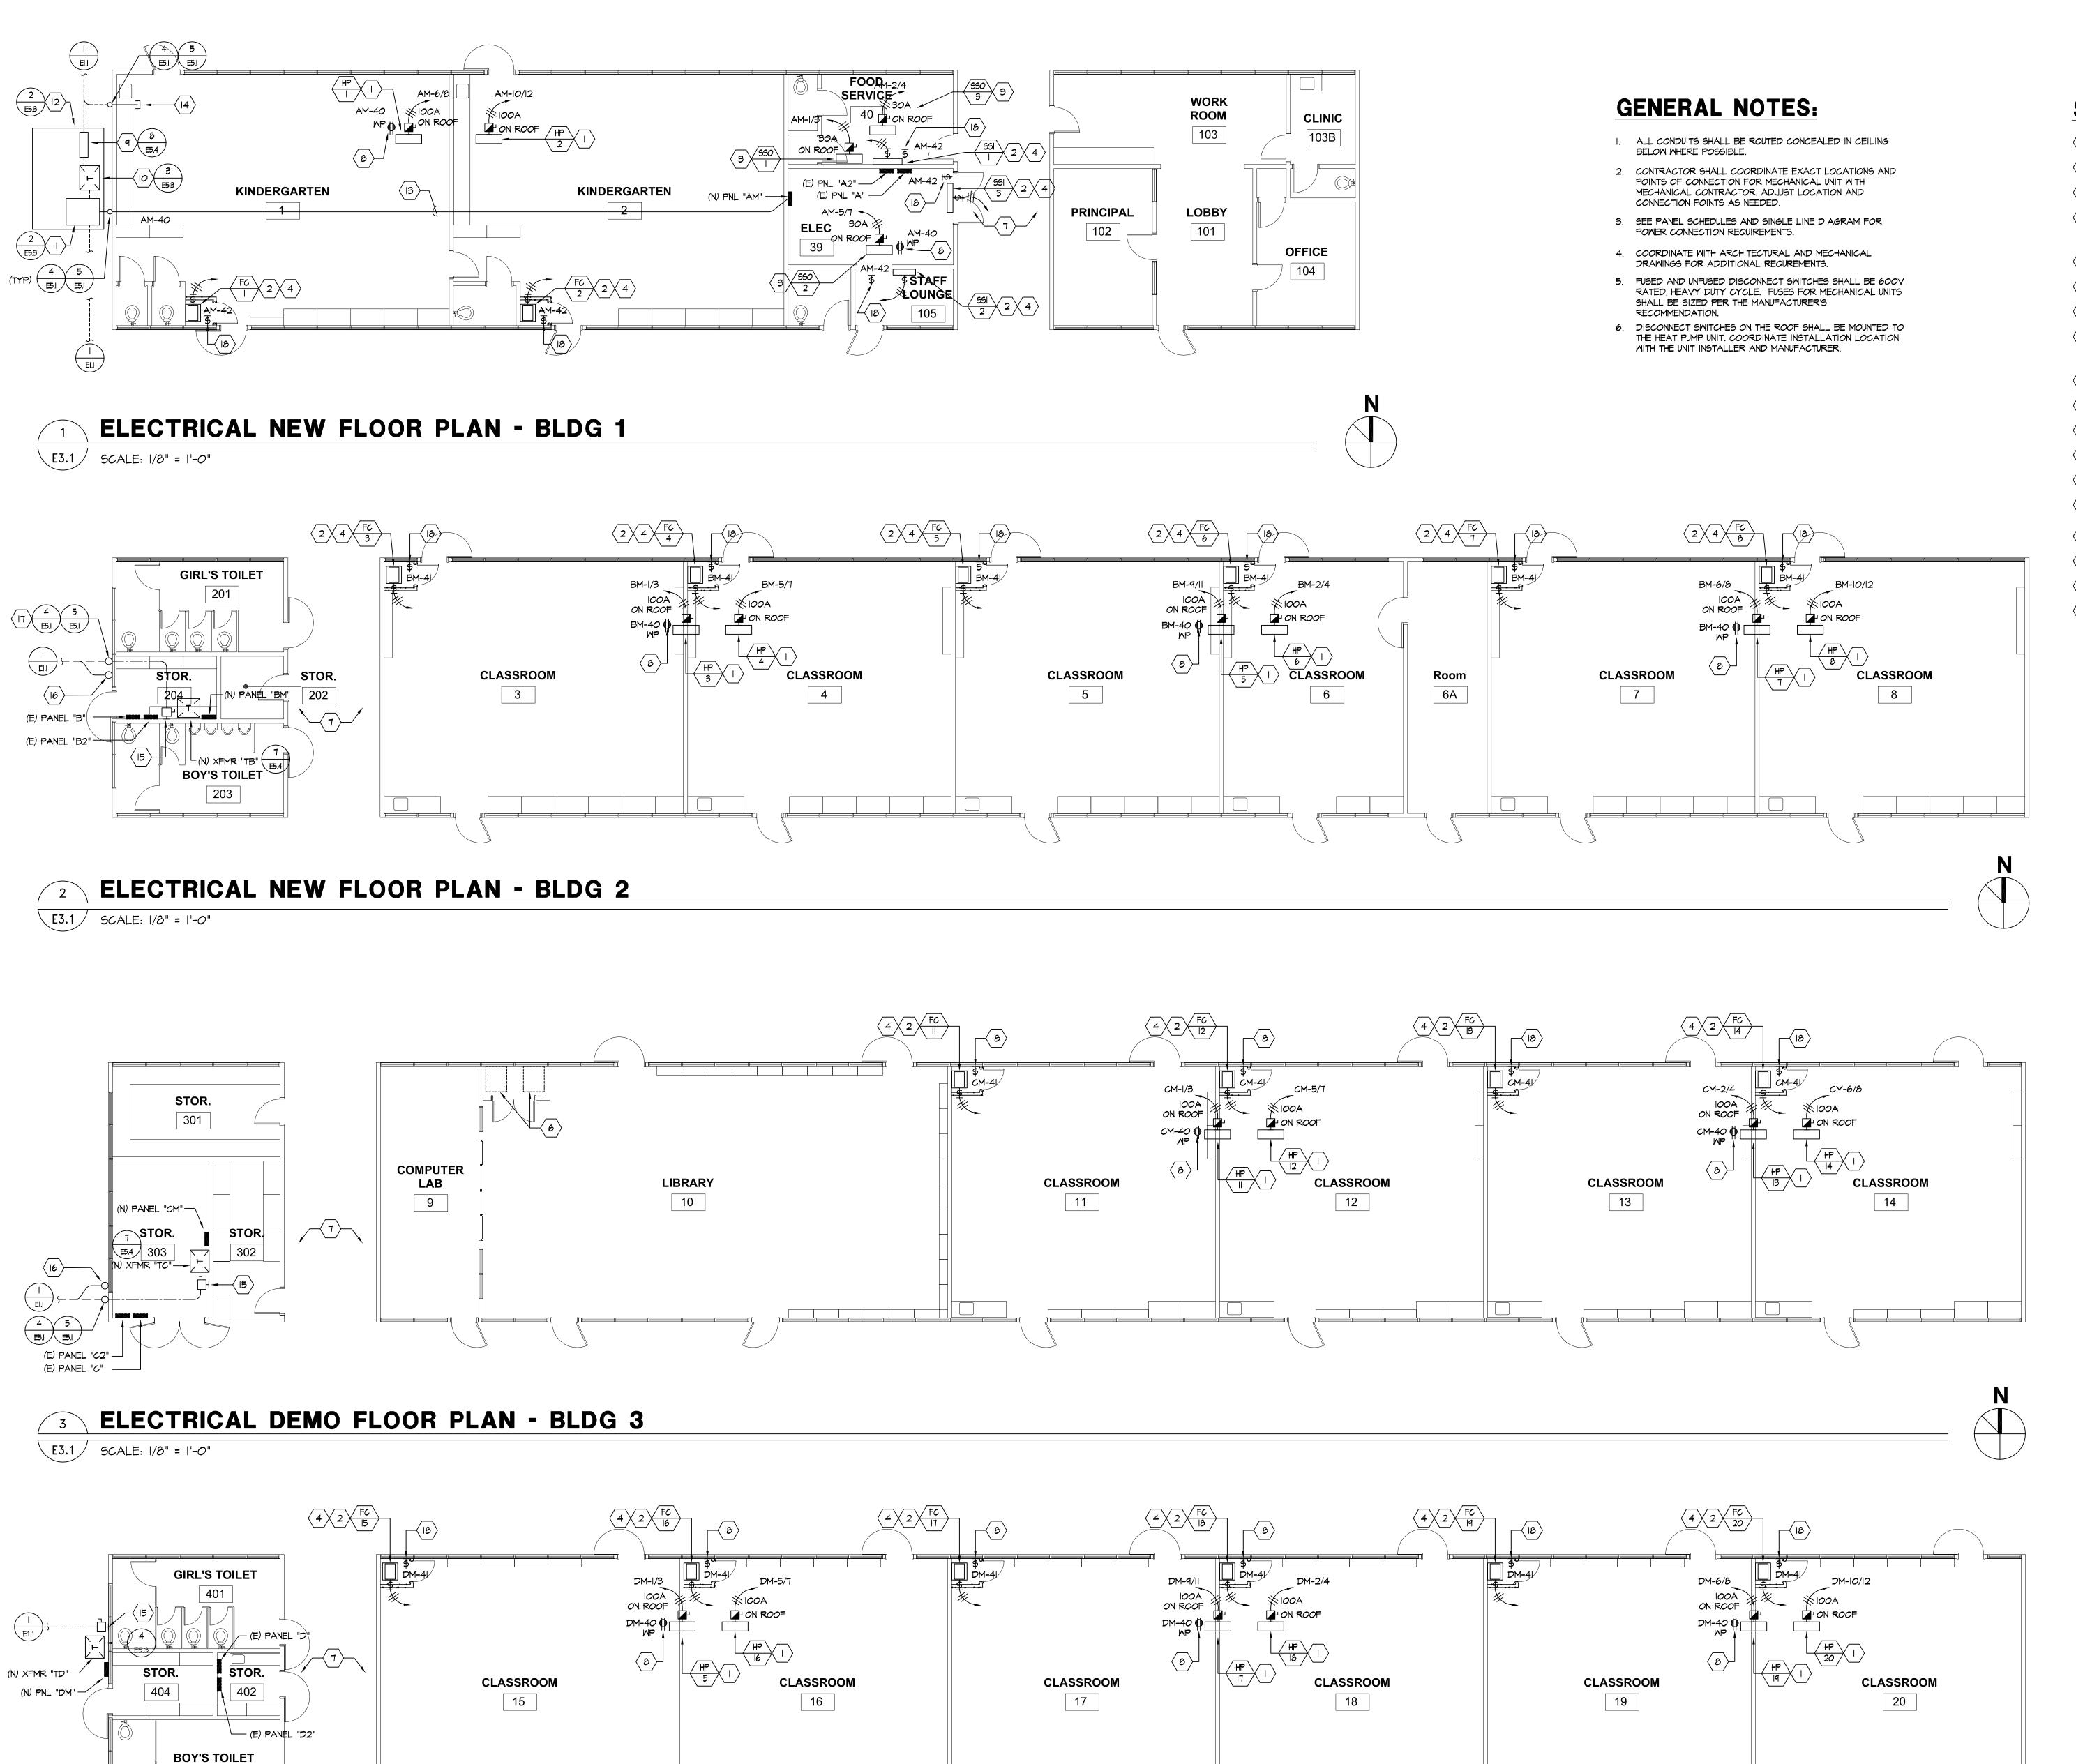


SHEET NOTES:

- \langle I \rangle NEW 100A-2P, NEMA-3R, FUSED DISCONNECT SWITCH FOR MECHANICAL UNIT.
- $\langle 2 \rangle$ NEW 30A-2P, NEMA-I, FUSED DISCONNECT SWITCH FOR MECHANICAL UNIT.
- \langle 3 \rangle NEW 30A-2P, NEMA-3R, FUSED DISCONNECT SMITCH FOR MECHANICAL UNIT.
- 4 INDOOR UNIT IS POWER BY THE OUTDOOR UNIT. ROUTE HOMERUN CIRCUIT TO ASSOCIATED OUTDOOR UNIT. REFER TO MECHANICAL SCHEDULE MPO.02 FOR ADDITIONAL REQUIREMENTS.
- \langle 5 \rangle Existing main switchboard to be converted to distribution panel.
- \langle 6 angle existing mechanical unit and connections to remain.
- $\left\langle \mathbf{7} \right\rangle$ MOUNT CONDUIT ADJACENT TO CHASE AND ROUTE ACROSS THE HALLWAY.
- 8 PROVIDE NEW WEATHERPROOF GFCI RECEPTACLE. RECEPTACLE SHALL BE MOUNTED ON A WEATHERPROOF BOX WITH WHILE-IN-USE COVER. COVER SHALL BE INTERMATIC MPIOIMXD "BOSS".
- 9 NEW 400A-3P, NEMA-3R, DISCONNECT SWITCH FOR TRANSFORMER.
- (IO) NEW TRANSFORMER 'TA'.
- \langle II angle NEW 800A-3P DISTRIBUTION PANEL 'DPA'.
- (12) STRUCTURAL CONCRETE PAD.
- (13) ROUTE CONDUIT CONCEALED IN ABOVE ACCESSIBLE CEILING SPACE.
- STUB NEW (4) 4" COMMUNICATION CONDUIT IN THE ABOVE ACCESSIBLE CEILING SPACE. PROVIDE END BUSHINGS FOR PROTECTION.
- (15) NEW 400A-3P, NEMA-I DISCONNECT SWITCH.
- (16) STUB FUTURE PV CONDUIT 18" ABOVE GRADE AND CAP.
- (17) PENETRATE CONDUIT INTO ROOM BELOW WINDOW.
- PROVIDE MOTOR RATED SMITCH AND 120V POWER FOR CONDENSATION

BUILDING KEY

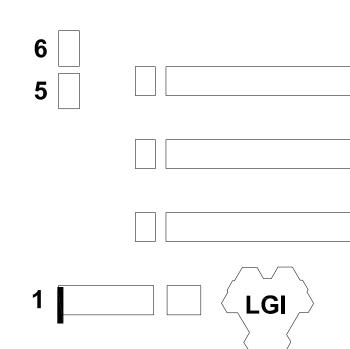



ELECTRICAL NEW FLOOR PLAN - BLDG 4

E3.1 | SCALE: |/8" = |'-0"

403

99999

IDENTIFICATION STAMP DIV. OF THE STATE ARCHITEC APP: 01-119554 INC: REVIEWED FOR SS 🗹 FLS 🗹 ACS 🗹

architects

www.aedisarchitects.com 387 S. 1st Street, Suite 300 San Jose, CA 95113

tel: (408)-300-5160 fax: (408)-300-5121

PROJECT **MEADOW HEIGHTS ELEMENTARY** SCHOOL - HVAC

REPLACEMENT

SAN MATEO-FOSTER CITY SCHOOL DISTRICT

CONSULTANT



American Consulting Engineers Electrical, Inc.

DSA FILE NUMBER

REVISIONS No. Description Date


MILESTONES

90% CD DSA SUB BACKCHECK

ELECTRICAL NEW FLOOR PLANS -BLDGS 1, 2, 3 & 4

^{JOB #} 2021005.04

E3.1

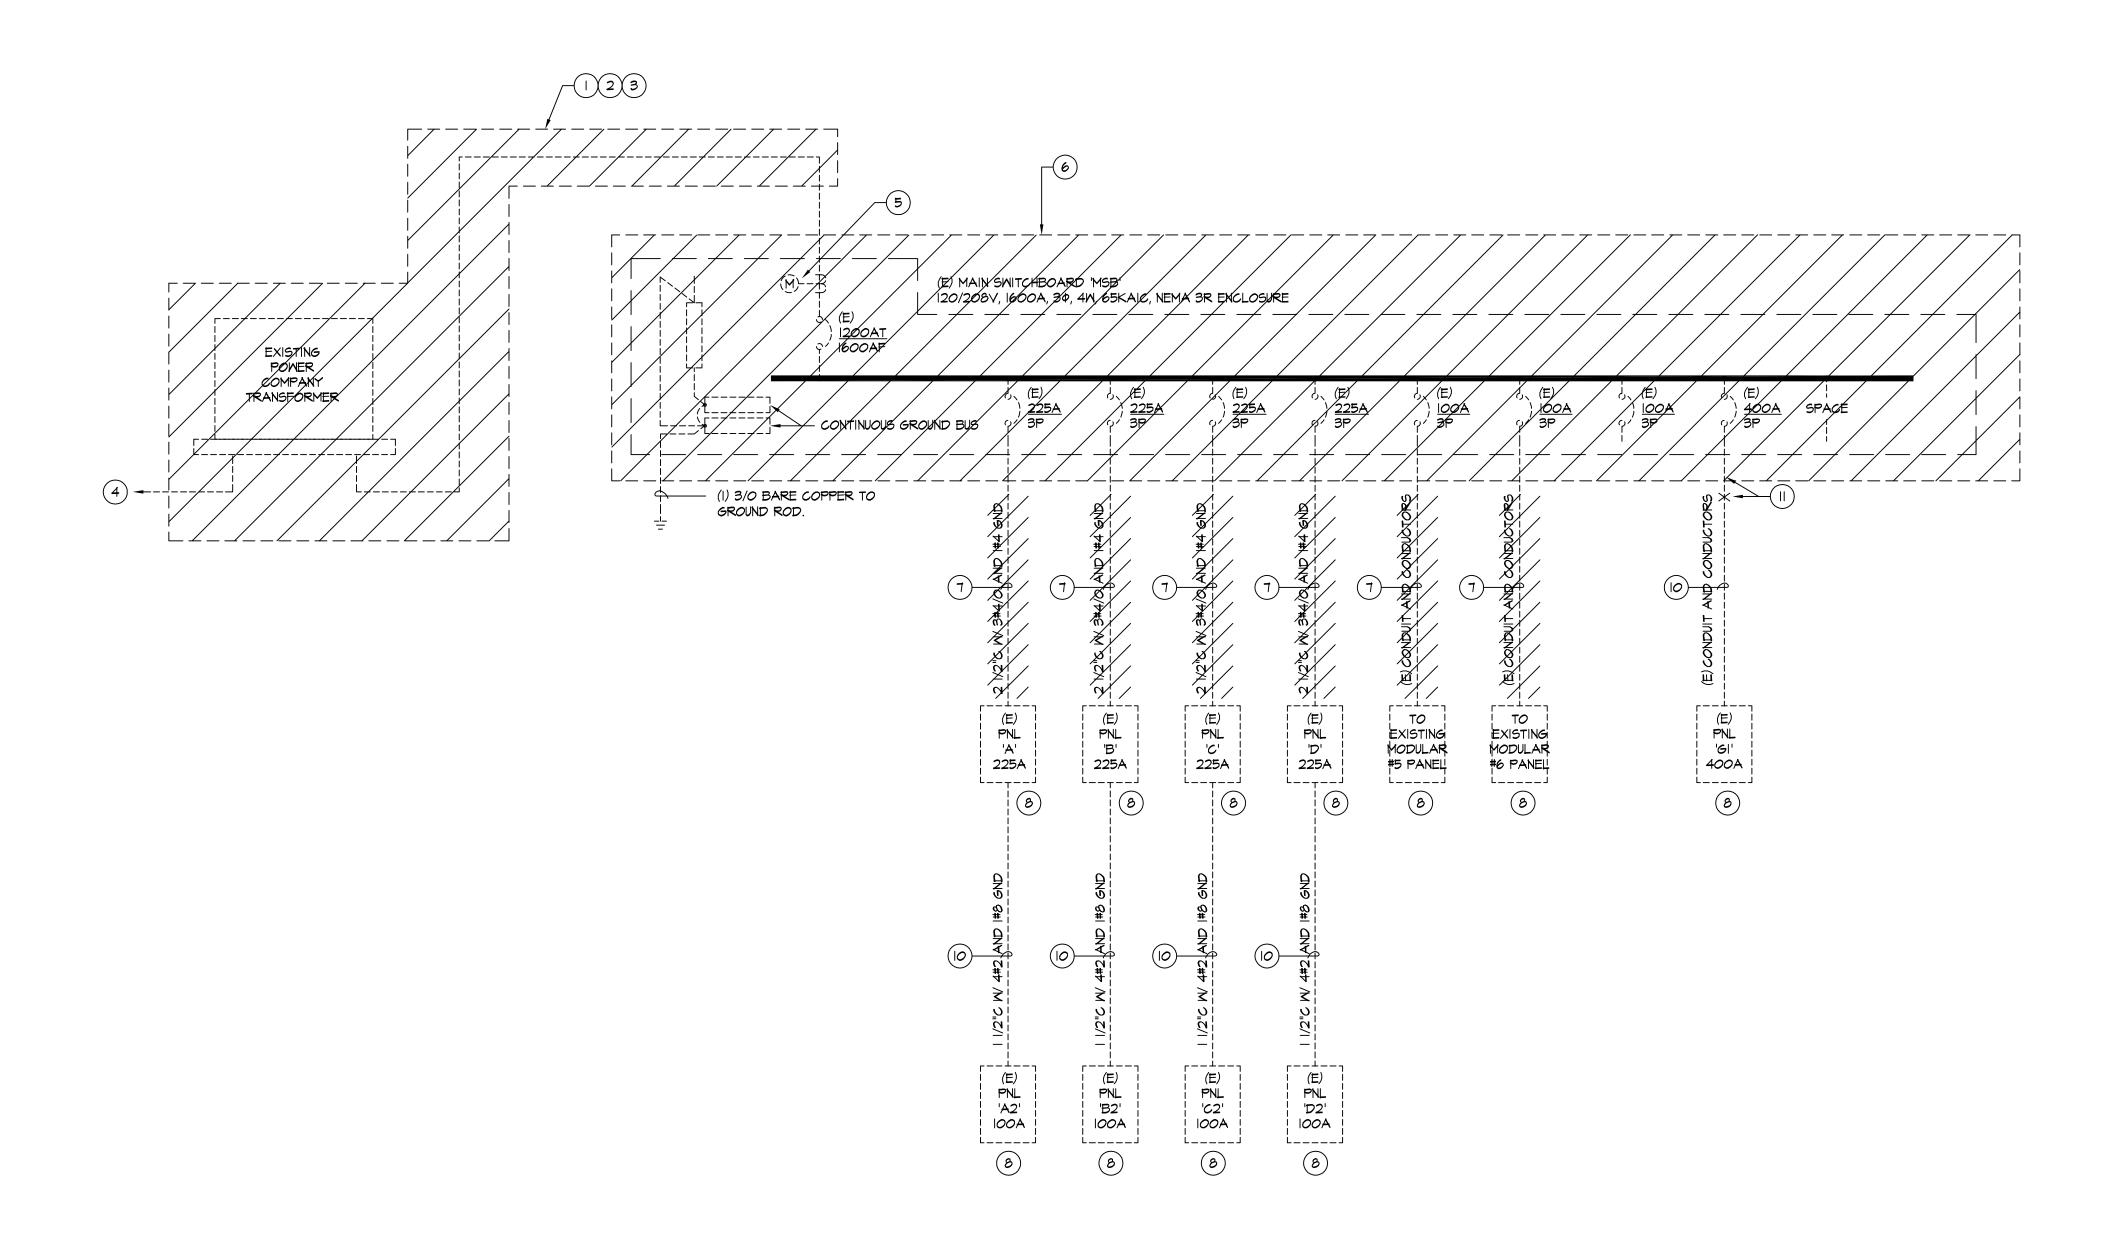

GENERAL NOTES:

- SEE ELECTRICAL SITE PLAN AND ENLARGED SWITCHGEAR PLAN FOR ADDITIONAL REQUIREMENTS.
- 2. SEE NEW SINGLE LINE DIAGRAM FOR ADDITIONAL REQUIREMENTS.
- 3. COORDINATE WITH THE PG&E UTILITY COMPANY FOR THE DISCONNECTING AND REMOVAL OF ALL ASSOCIATED EQUIPMENT AND CABLES.

DEMOLITION SHEET NOTES:

- EXISTING PG&E TRANSFORMER TO BE DISCONNECTED AND REMOVED BY PG&E. COORDINATE REMOVAL WITH PG&E.
- 2 EXISTING PG&E PRIMARY CONDUCTORS TO BE REMOVED BY PG&E. COORDINATE REMOVAL WITH PG&E.
- 3 EXISTING PG&E SECONDARY CONDUCTORS AND GROUNDING CONDUCTORS TO BE REMOVED BY PG&E. COORDINATE REMOVAL WITH PG&E.
- 4 EXISTING PG&E UTILITY POLE TO REMAIN.
- 5 EXISTING PG&E METER, CT'S AND PT'S TO BE DISCONNECTED AND REMOVED BY PG&E. COORDINATE REMOVAL WITH PG&E.
- MAIN SWITCHBOARD TO BE DEMOLISHED. COORDINATE DISCONNECTION AND REMOVAL WITH PG&E. CONTRACTOR SHALL BE RESPONSIBLE FOR THE REMOVAL AND DISPOSAL OF THE EXISTING MAIN SWITCHBOARD.
- TEXISTING FEEDERS CABLES TO BE DISCONNECTED FROM EXISTING PANEL. PULL BACK TO SOURCE AND REMOVE.
- (8) EXISTING ELECTRICAL PANEL TO REMAIN.
- 9 EXISTING DISTRIBUTION PANEL TO DISCONNECTED AND DEMOLISHED.
- (IO) EXISTING FEEDER CABLES TO REMAIN.
- EXISTING PANEL 'GI' FEEDER TO REMAIN AT LOCATION. PRESERVE AND PROTECT CABLES DURING DEMOLITION. EXISTING CABLES ARE TO BE INTERCEPTED AND AND EXTENDED AT THIS LOCATION. REFER TO NEW SINGLE LINE DIAGRAM AND ELECTRICAL SITE PLAN FOR ADDITIONAL

DEMO SINGLE LINE DIAGRAM

E4.1 NOT TO SCALE

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT

APP: 01-119554 INC:

REVIEWED FOR
SS FLS ACS D

DATE: 09/21/2021



www.aedisarchitects.com 387 S. 1st Street, Suite 300 San Jose, CA 95113 tel: (408)-300-5160 fax: (408)-300-5121

PROJECT

MEADOW HEIGHTS ELEMENTARY SCHOOL - HVAC REPLACEMENT

SAN MATEO-FOSTER CITY SCHOOL DISTRICT

CONSULTANT





American Consulting Engineers
Electrical, Inc.

1590 The Alameda, Suite 200
San Jose, CA 95126
JOB # EK21030.00

A08/236-2312
Fax: 408/236-2316

STAMP

STATE
DSA FILE NUMBER 41-26

APPL# 01-119554

REVISIONS

No. Description Date

MILESTONES
DD

90% CD

DSA SUB 06/02/2021


BACKCHECK 09/22/2021

DEMO SINGLE LINE DIAGRAM

O9/17/2

JOB# 2021005.

E4.1

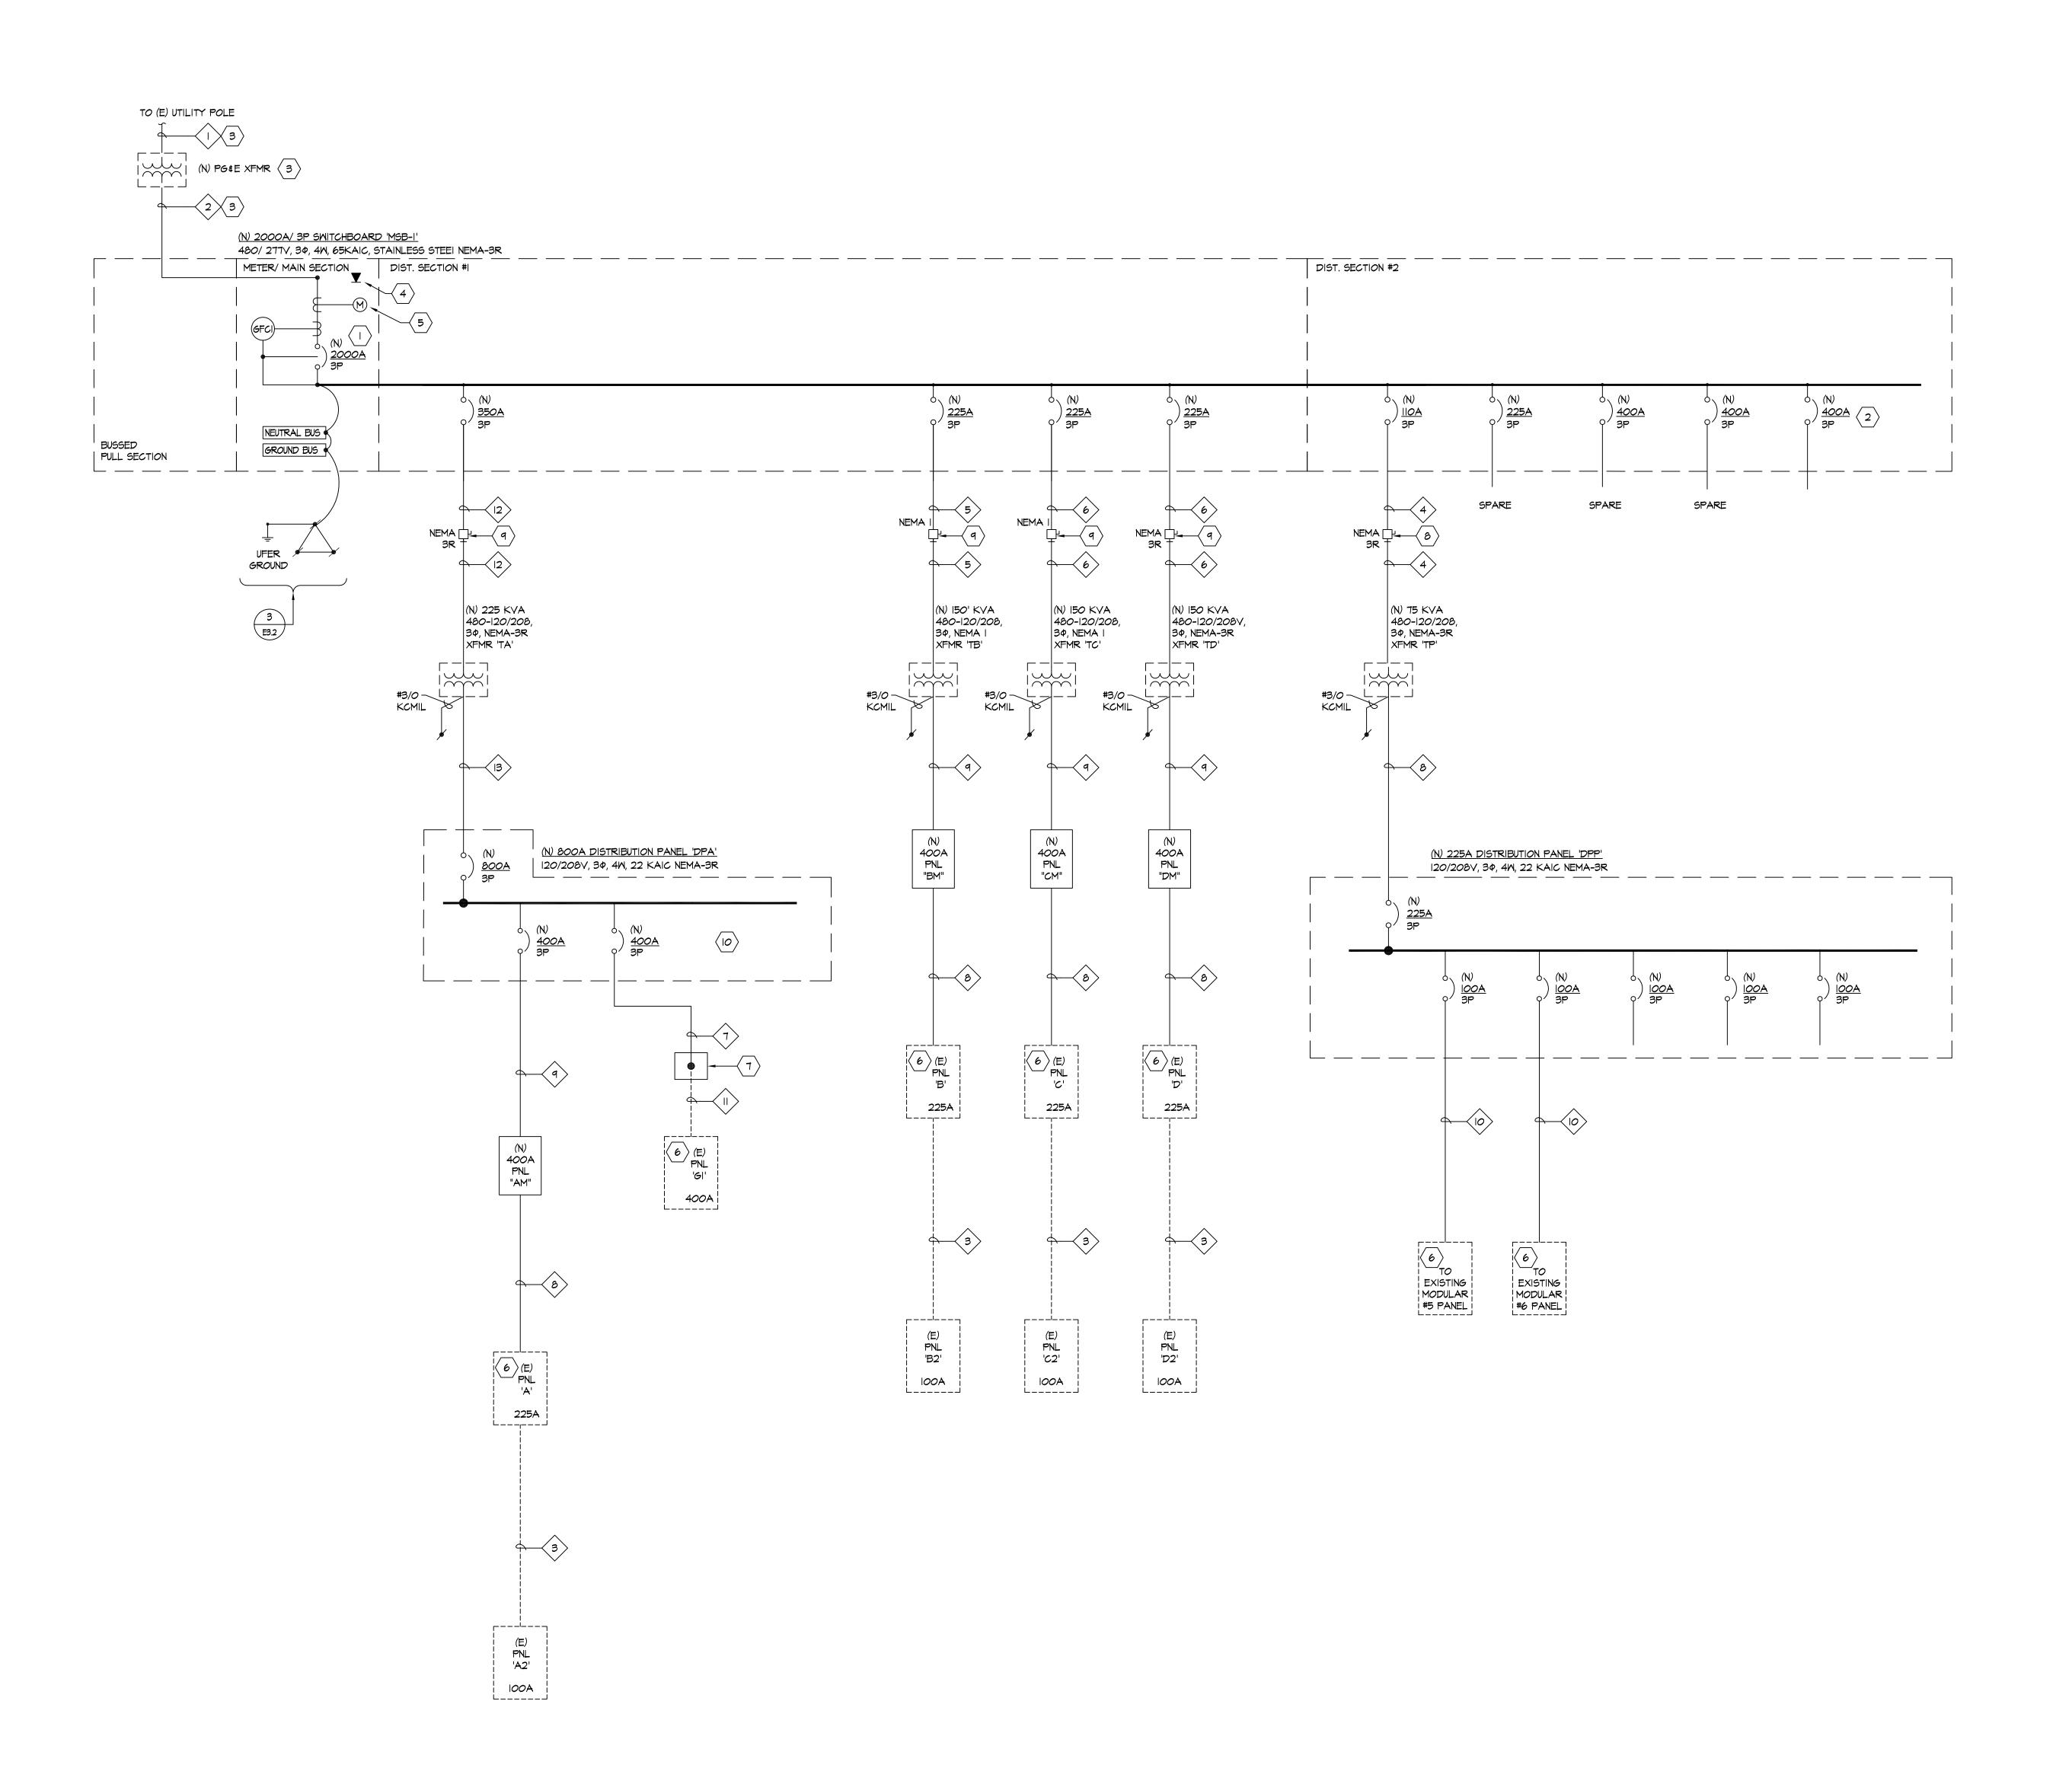

GENERAL NOTES:

- SEE DETAIL 2/E3.2 FOR GROUNDING AT SWITCHBOARD ENCLOSURE REQUIREMENTS.
- 2. SEE DETAIL 3/E3.2 FOR MAIN SWITCHBOARD GROUNDING
- 3. SEE DETAIL 5/E3.2 FOR TRANSFORMER GROUNDING REQUIREMENTS.
- 4. ALL TRANSFORMERS SHALL BE CLASS 155 INSULATION -
- COMPLETELY ENCLOSED EXCEPT FOR VENTILATION.
- 5. SEE ENLARGED SWITCHGEAR PLAN FOR ADDITIONAL REQUIREMENTS.
- 6. THE CONTRACTOR SHALL OBTAIN THE PG\$E SUBSTRUCTURE PACKAGE PRIOR TO ANY RELATED WORK. THE CONTRACTOR SHALL COORDINATE ALL PG\$E INSTALLATION REQUIREMENTS WITH PG\$E GREENBOOK AND PG\$E SUBSTRUCTURE PACKAGE.
- 7. SEE THE ENLARGED SITE DEMO SITE PLAN AND DEMO SINGLE LINE DIAGRAM FOR ADDITIONAL INFORMATION.
- PROVIDE THE REQUIRED ARC FLASH HAZARD WARNING LABEL TO MEET THE REQUIREMENTS OF CEC 110.16. SEE SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS.
- PROVIDE MAINTENANCE SWITCH FOR ARC ENERGY REDUCTION TO MEET THE REQUIREMENTS OF CEC 240.87.

SHEET NOTES:

- (I) MAIN BREAKER SHALL BE GFCI PER NEC.
- 2 PV BREAKER TO BE INSTALLED AT THE FURTHEST POINT ON THE BUS BAR.
- 3 INSTALL PER PG&E AND PG&E GREENBOOK REQUIREMENTS.
- PROVIDE TWO DEDICATED TELEPHONE LINES FROM THE MAIN SWITCHBOARD TO THE TELEPHONE MPOE PER PG & E REQUIREMENTS. MOUNT TELEPHONE OUTLETS INSIDE METER SECTION FOR THE MAIN SWITCHBOARD BEHIND THE SWITCHBOARDS DOORS. MOUNT IN NEMA-3R JUNCTION BOX.
- 5 PROVIDE PG&E METER PER PG&E REQUIREMENTS.
- 6 COORDINATE THE DISCONNECT AND REMOVAL OF THE EXISTING FEEDERS WITH THE PROJECT SCHEDULE AFTER REMOVAL OF EXISTING FEEDERS AND CONDUITS. CONTRACTOR SHALL RECONNECT PANEL WITH NEW FEEDERS AND CONDUIT AS
- NEW IN-GRADE PULL BOX AT THE EXISTING MAIN SWITCHBOARD.
 INTERCEPT EXISTING FEEDER TO PANEL 'GI' AND EXTEND AS
 SHOWN TO DISTRIBUTION PANEL 'DPA'.
- $\langle 8 \rangle$ PROVIDE 200A-3P DISCONNECT SMITCH FOR TRANSFORMER.
- 9 PROVIDE 400A-3P DISCONNECT SMITCH FOR TRANSFORMER.
- (IO) PROVIDE SPACE FOR FUTURE CIRCUIT BREAKERS.

CABLE SCHEDULE:

(N)(I) 4"C - PG&E PRIMARY.

2 (N)(7) 5"C - PG & E SECONDARY 3 (N)(E) FEEDER TO REMAIN.

4 (N)1.5"C - (N) 3#1 + (1) #6.

5 (N) 2.5"C - (N) 3#300 + (I) #5 GND.

6 (N) 2.5"C - (N) 3#4/O + (I) #4 GND.

7 (N) 4"C - (N) 4#600 + (I) #1/0 GND.

8 (N) 2.5"C - (N) 4#4/O + I#2 GND. 9 (N) 2 SETS - (N) 2"C - (N) 4#3/O + I#3 GND.

(N) 1.5"C - (N) 3#1 + 1#6.

(E) 4"C - (4) #600 + (1) #1/0 GND.

12 (N) 4"C - (N) (3) #500 + (I) #1/0 GND.

(N) 2 SETS - (N) 4"C - (N) 4#600 + I#I/O GND.

IDENTIFICATION STAMP DIV. OF THE STATE ARCHITECT

APP: 01-119554 INC:

REVIEWED FOR

SS FLS ACS D

DATE: 09/21/2021



www.aedisarchitects.com 387 S. 1st Street, Suite 300 San Jose, CA 95113 tel: (408)-300-5160 fax: (408)-300-5121

PROJECT

MEADOW HEIGHTS ELEMENTARY SCHOOL - HVAC REPLACEMENT

SAN MATEO-FOSTER CITY SCHOOL DISTRICT

CONSULTANT



American Consulting Engineers
Electrical, Inc.

1590 The Alamedo, Suite 200
San Jose, CA 95128
Fox: 408/236-2316
Fox: 408/236-2316

STAMP

STATE

DSA FILE NUMBER 41-26
APPL # 01-119554

REVISIONS

No. Description Date

Description

MILESTONES
DD

90% CD DSA SUB

DSA SUB 06/02/2021 BACKCHECK 09/22/2021

NEW SINGI

NEW SINGLE LINE DIAGRAM

DATE 09/17/2021

^{JOB#} 2021005.04

E4.2

PANEL NAME: VOLTAGE: PHASE: WIRE: TYPE: MOUNTING:	AM 208/120V 3 4 NEMA 1 SURFACE														FED FROM: XFMR 'TA' MAIN C/B: MLO BUSSING: 400 AMP MIN. AIC: 10,000 SUB-FEED C/B: 225A-3P FEED THRU LUGS: YES
	001117102		TYPE (K			СВ	СКТ	PH	CKT			TYPE (K			Land Time 2000: Man
CIRCUIT DESCRIPTION		LTG	REC	MTR	NCL	AMP/P	#		#	AMP/P	LTG	REC	MTR	NCL	CIRCUIT DESCRIPTION
N) SPLIT SYSTEM 1 - FOOD SERVICE 40	, ROOF				2.08	30A	1	Α	2	30A				2.08	(N) SPLIT SYSTEM 3 - ELECTRICAL 39, ROOF
n n n n n					2.08	2P	3	В	4	2P				2.08	и и и и и
N) SPLIT SYSTEM 2 - STAFF LOUNGE 10	5 ROOF				1.25	20A	5	С	6	70A				4 37	(N) HEAT PUMP 1, FAN COIL 1 - KINDERGARTEN 1
" " " "					1.25	2P		A	8	2P				4.37	n n n n n
PARE					1.20	20A/1P	9	В	10	70A					(N) HEAT PUMP 2, FAN COIL 2 - KINDERGARTEN 2
						20A/1P				2P				4.37	" " " "
PARE							11	C	12					4.37	
SPARE TO THE TOTAL TO THE T						20A/1P	13	Α	14	20A/1P					SPARE CONTROL OF THE PROPERTY
PARE						20A/1P	15	В	16	20A/1P					SPARE
PARE						20A/1P	17	С	18	20A/1P					SPARE
PARE						20A/1P	19	Α	20	20A/1P					SPARE
PARE						20A/1P	21	В	22	20A/1P					SPARE
PARE						20A/1P	23	С	24	20A/1P					SPARE
SPARE						20A/1P	25	Α	26	20A/1P					SPARE
SPARE						20A/1P	27	В	28	20A/1P					SPARE
SPARE						20A/1P	29	С	30	20A/1P					SPARE
SPARE						20A/1P	31	Α	32	20A/1P					SPARE
SPARE						20A/1P	33	В	34	20A/1P					SPARE
SPARE						20A/1P	35	С	36	20A/1P					SPARE
SPARE						20A/1P	37	Α	38	20A/1P					SPARE
SPARE						20A/1P	39	В	40	20A/1P		0.36			(N) GFCI REC. MOUNT ON ROOF - BLDG 1 KNDERGARTEN 1
SPARE						20A/1P	41	С	42	20A/1P			0.60		(N) MOTOR RATED SWITCH FOR COND. PUMP - BLDG 1
		0	0	0	6.7	20,011			·-		0	0.4	0.6	21.6	(-) St S
	100mm	lae			lne		1						1		liau pungs i (gonnestsp.
LOAD SUMMARY	CONNECTED KVA 0	DEMAI		IOR	DEMAN		-				ED MO	Yes/No			KVA PHASE A (CONNECTED) 9.8 KVA PHASE B (CONNECTED) 8.9
LTG) LIGHTING X 125%	_	-	1.25			0.0	1		_	FULL RAT ERIES RAT					,
REC) RECEPTS PER 220.44;	0.4		1.00			0.4	1		٥	EKIES KAI					KVA PHASE C (CONNECTED) 10.6
OKVA x 100% + REMAINDER x 50%			0.50			0.0	-		,			N			SUB FEED CONNECTED LOAD
MTR) LARGEST MOTOR X 125%	0.6	1	1.25			0.8	-			COPPER BU					TOTAL DELIAND 10/0
REMAINING MOTORS x 100%	0		1.00			0.0	1		AL	UMINUM BU	JSSING	N			TOTAL DEMAND KVA 29.4
(NCL) NON CONTINOUS LOAD x 100%	28.3	1	1.00			28.3	1								TOTAL LOAD AMPERES 81.7

PANEL NAME:	BM														FED FROM: XF	
VOLTAGE:	208/120V														MAIN C/B: ML	
PHASE:	3														BUSSING: 40	
WIRE:	4														MIN. AIC: 10	
TYPE:	NEMA 1														SUB-FEED C/B: 22	
MOUNTING:	SURFACE					СВ	L a				1				FEED THRU LUGS: YE	S
CIRCUIT DESCRIPTION			TYPE (K REC	VA) Imtr	NCL	CKT PH		CKT #	CB AMP/P			YPE (KVA)		CIRCUIT DESCRIPTION		
(N) HEAT PUMP 3, FAN COIL 3 - KINDERC	SARTEN 3					AMP/P 70A	1	Α	2	70A			x		(N) HEAT PUMP 6, FAN COIL 6 - KINDERGAR	RTEN 6
и и и и и					4.37	2P		В	4	2P	,			4.37	п п п п п	
(N) HEAT PUMP 4, FAN COIL 4 - KINDERC	SARTEN 4				4.37	70A	5	С	6	70A				4.37	(N) HEAT PUMP 7, FAN COIL 7 - KINDERGAR	RTEN 7
					4.37	2P		Α	8	2P				4.37	п п п п п	
(N) HEAT PUMP 5, FAN COIL 5 - KINDERO	GARTEN 5				4.37	70A	9	В	10	70A				4.37	(N) HEAT PUMP 8, FAN COIL 8 - KINDERGAR	RTEN 8
					4.37	2P	11	С	12	2P				4.37		
SPARE						20A/1P	13	Α	14	20A/1P					SPARE	
SPARE						20A/1P	15	В	16	20A/1P					SPARE	
SPARE						20A/1P	17	С	18	20A/1P					SPARE	
SPARE						20A/1P	19	Α	20	20A/1P					SPARE	
SPARE						20A/1P	21	В	22	20A/1P					SPARE	
SPARE						20A/1P	23	С	24	20A/1P					SPARE	
SPARE						20A/1P	25	Α	26	20A/1P					SPARE	
SPARE						20A/1P	27	В	28	20A/1P					SPARE	
SPARE						20A/1P	29	С	30	20A/1P					SPARE	
SPARE						20A/1P	31	Α	32	20A/1P					SPARE	
SPARE						20A/1P	33	В	34	20A/1P					SPARE	
SPARE						20A/1P	35	С	36	20A/1P					SPARE	
SPARE						20A/1P	37	Α	38	20A/1P					SPARE	
SPARE						20A/1P	39		40	20A/1P		0.54			(N) GFCI REC. MOUNT ON ROOF - BLDG 2	
(N) MOTOR RATED SWITCH FOR COND. I	PUMP - BLDG 2	0	0	0.72	26.2	20A/1P	41	С	42	20A/1P	0	0.54 1.1	0	26.2	" " " "	
	.					I	,									
LOAD SUMMARY		DEMAI	ND FAC	TOR	DEMAN	ID KVA	1			=		Yes/No			KVA PHASE A (CONNECTED)	17.5
(LTG) LIGHTING X 125%	0	1.25			0.0		1			FULL RA					KVA PHASE B (CONNECTED)	18.0
(REC) RECEPTS PER 220.44;	1.1		1.00		1.1				5	SERIES RA					KVA PHASE C (CONNECTED)	18.7
10KVA x 100% + REMAINDER x 50%	0		0.50			-	SPD N							SUB FEED CONNECTED LOAD		
(MTR) LARGEST MOTOR X 125%	0.7		1.25	0.9			-		COPPER BUSSING Y						TOTAL BEMAND 10/A	
+ REMAINING MOTORS x 100% 0		1	1.00	0.0 52.4			ALUMINUM BUSSING N								TOTAL DEMAND KVA	54.4

PANEL NAME: VOLTAGE: PHASE: WIRE: TYPE: MOUNTING:	CM 208/120V 3 4 NEMA 1 SURFACE														FED FROM: XFMR 'TC' MAIN C/B: MLO BUSSING: 400 AMP MIN. AIC: 10,000 SUB-FEED C/B: 225A-3P FEED THRU LUGS: YES
CIRCUIT DESCRIPTION		LOAD T	TYPE (K	VA) MTR	NCL	CB AMP/P	CKT #	PH	CKT #	CB AMP/P	LOAD T	YPE (K	VA) MTR	NCI	CIRCUIT DESCRIPTION
(N) HEAT PUMP 11, FAN COIL 11 - KINDE	FRGARTEN 11	210	INEO	101111	4.37	70A	1	А	2	70A	EIO	ILEO	IVITIC		(N) HEAT PUMP 13. FAN COIL 13 - KINDERGARTEN 13
и и и и					4.37	2P	3	В	4	2P				4.37	
(N) HEAT PUMP 12. FAN COIL 12 - KINDE	ERGARTEN 12				4.37	70A	5	С	6	70A					(N) HEAT PUMP 14, FAN COIL 14 - KINDERGARTEN 14
					4.37	2P	7	A	8	2P				4.37	п п п п
SPARE						20A/1P	9	В	10	20A/1P					SPARE
SPARE						20A/1P	11	С	12	20A/1P					SPARE
SPARE						20A/1P	13	Α	14	20A/1P					SPARE
SPARE						20A/1P	15	В	16	20A/1P					SPARE
SPARE						20A/1P	17	С	18	20A/1P					SPARE
SPARE						20A/1P	19	А	20	20A/1P					SPARE
SPARE						20A/1P	21	В	22	20A/1P					SPARE
SPARE						20A/1P	23	С	24	20A/1P					SPARE
SPARE						20A/1P	25	Α	26	20A/1P					SPARE
SPARE						20A/1P	27	В	28	20A/1P					SPARE
SPARE						20A/1P	29	С	30	20A/1P					SPARE
SPARE						20A/1P	31	Α	32	20A/1P					SPARE
SPARE						20A/1P	33	В	34	20A/1P					SPARE
SPARE						20A/1P	35	С	36	20A/1P					SPARE
SPARE						20A/1P	37	Α	38	20A/1P					SPARE
SPARE						20A/1P	39	В	40	20A/1P		0.72			(N) GFCI REC. MOUNT ON ROOF - BLDG 3
(N) MOTOR RATED SWITCH FOR COND.	PUMP - BLDG 3			0.48		20A/1P	41	С	42	20A/1P					SPARE
		0	0	0.5	17.5						0	0.7	0	17.5	
LOAD SUMMARY	CONNECTED KVA	DEMAN	ND FACT	TOR	DEMAN	ID KVA]	[Yes/No	,		KVA PHASE A (CONNECTED) 17.5
(LTG) LIGHTING X 125%	0		1.25			0.0				FULL RA					KVA PHASE B (CONNECTED) 9.5
(REC) RECEPTS PER 220.44;	0.7		1.00			0.7			S	SERIES RAT					KVA PHASE C (CONNECTED) 9.2
10KVA x 100% + REMAINDER x 50%	0		0.50			0.0						N			SUB FEED CONNECTED LOAD
(MTR) LARGEST MOTOR X 125%	0.5		1.25			0.6			(COPPER B	USSING	Υ			
+ REMAINING MOTORS x 100%	0		1.00			0.0	1		AL	UMINUM B	USSING	N			TOTAL DEMAND KVA 36.3
(NCL) NON CONTINOUS LOAD x 100%	34.9	1	1.00			34.9	1						-		TOTAL LOAD AMPERES 100.7

PANEL NAME: VOLTAGE: PHASE: WIRE: TYPE: MOUNTING:	DM 208/120V 3 4 NEMA 1 SURFACE	LOAD	TVDE (V	\/A\		CB	CKT	DU	CKT	СВ	LOAD	TVDE	(IZVA)		FED FROM: XFMR 'TD' MAIN C/B: MLO BUSSING: 500 AMP MIN. AIC: 10,000 SUB-FEED C/B: 225A-3P FEED THRU LUGS: YES	
CIRCUIT DESCRIPTION		LTG	TYPE (K REC	MTR	NCL	CB AMP/P	CKT #	PH	#	CB AMP/P	LOAD LTG		C MTR	NCL	CIRCUIT DESCRIPTION	
(N) HEAT PUMP 15, FAN COIL 15 - KINDE	RGARTEN 15				4.37	70A	1	Α	2	70A				4.37	(N) HEAT PUMP 18, FAN COIL 18 - KINDERGARTEN 1	3
					4.37	2P	3	В	4	2P				4.37	и и и и	
(N) HEAT PUMP 16, FAN COIL 16 - KINDE	RGARTEN 16				4.37	70A	5	С	6	70A				4.37	(N) HEAT PUMP 19, FAN COIL 19 - KINDERGARTEN 1	9
n					4.37	2P	7	Α	8	2P				4.37	и и и и	
(N) HEAT PUMP 17, FAN COIL 17 - KINDERGARTEN 17					4.37	70A	9	В	10	70A				4.37	(N) HEAT PUMP 20, FAN COIL 20 - KINDERGARTEN 2)
					4.37	2P	11	С	12	2P				4.37	и и и и	
SPARE						20A/1P	13	Α	14	20A/1P					SPARE	
SPARE						20A/1P	15	В	16	20A/1P					SPARE	
SPARE						20A/1P	17	С	18	20A/1P					SPARE	
SPARE						20A/1P	19	Α	20	20A/1P					SPARE	
SPARE						20A/1P	21	В	22	20A/1P					SPARE	
SPARE						20A/1P	23	С	24	20A/1P					SPARE	
SPARE						20A/1P	25	A	26	20A/1P					SPARE	
SPARE						20A/1P	27	В	28	20A/1P					SPARE	
SPARE						20A/1P	29	С	30	20A/1P					SPARE	
SPARE						20A/1P	31	A	32	20A/1P					SPARE	
SPARE						20A/1P	33	В	34	20A/1P					SPARE	
SPARE						20A/1P	35	С	36	20A/1P					SPARE	
SPARE						20A/1P	37	A	38	20A/1P					SPARE	
SPARE						20A/1P	39	В	40	20A/1P		0.5	4		(N) GFCI REC. MOUNT ON ROOF - BLDG 4	
(N) MOTOR RATED SWITCH FOR COND.	DIMP - BLDC 4			0.72		20A/1P	41	С	42	20A/1P		0.5			(N) GPG REC. MOUNT ON ROOF - BEDG 4	
N) WOTOR RATED SYVITOR FOR COND.	FOIVIF - DLDG 4	0	0	0.72	26.2	ZUATIP	41		42	ZUATIP	0	1.1		26.2		
LOAD SUMMARY	CONNECTED KVA	DEMAN	UD EACT	rop .	DEMAN	ID KV/A	1	ı				Vasi	No		N/A DHASE A (CONNECTED) 17	
LOAD SUMMARY (LTG) LIGHTING X 125%	0	DEMAND FACTOR 1.25		IOR	DEMAN	Yes/No FULL RATED AIC Y						INO		KVA PHASE A (CONNECTED) 17. KVA PHASE B (CONNECTED) 18.		
(REC) RECEPTS PER 220.44;	1.1					0.0 1.1			,9	ERIES RA					KVA PHASE C (CONNECTED) 18.	
10KVA x 100% + REMAINDER x 50%	0		0.50			0.0	1		·	0		N			SUB FEED CONNECTED LOAD	
(MTR) LARGEST MOTOR X 125%	0.7		1.25			0.9	1		(OPPER B						
+ REMAINING MOTORS x 100%	0	1.00				0.0	1			UMINUM BI					TOTAL DEMAND KVA 54.	1
(NCL) NON CONTINOUS LOAD x 100%	52.4	+	1.00			52.4		l	,	J					TOTAL LOAD AMPERES 151.	

SHEET NOTES:

PROVIDE SUBFEED CIRCUIT BREAKERS TO RE-FEED EXISTING PANELS.
SEE SINGLE LINE DIAGRAM FOR ADDITIONAL REQUIREMENTS.

IDENTIFICATION STAMP
DIV. OF THE STATE ARCHITECT

APP: 01-119554 INC:

REVIEWED FOR

SS FLS ACS D

DATE: 09/21/2021



www.aedisarchitects.com 387 S. 1st Street, Suite 300 San Jose, CA 95113 tel: (408)-300-5160 fax: (408)-300-5121

MEADOW HEIGHTS
ELEMENTARY
SCHOOL - HVAC
REPLACEMENT

SAN MATEO-FOSTER CITY SCHOOL DISTRICT

CONSULTANT





AMP

STATE
DSA FILE NUMBER 41-26
APPL # 01-119554
REVISIONS

No. Description Date

MILESTONES
DD
90% CD

DSA SUB BACKCHECK 06/02/2021

09/22/2021


SHEET

PANEL SCHEDULES

09/17/2021


JOB# 20210

E4.3

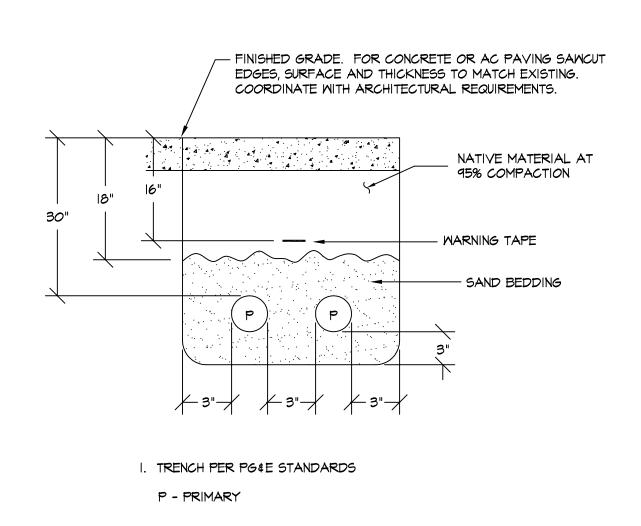

PG&E TRENCH DETAIL PRIMARY SIDE

E5.1 NOT TO SCALE

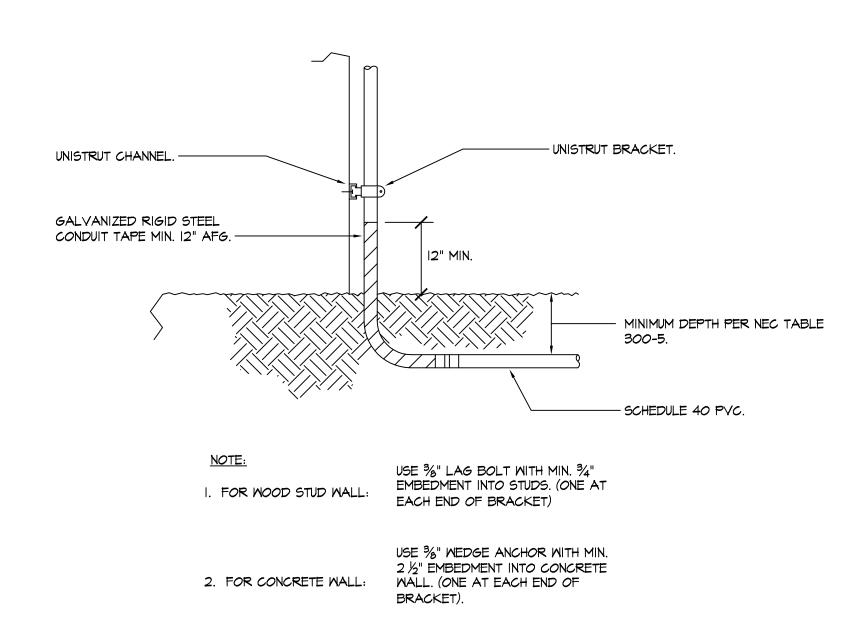


4 UNDERGROUND CONDUIT RISER DETAIL E5.1 NOT TO SCALE

SEE PG&E PAD DETAIL
FOR REQUIREMENTS

(6) HILTI SS ¾ P KB-TZ2 (ESR-4266) WITH


4½ NOMINAL EMBEDMENT INTO 4½ DEPTH HOLE.

PG&E TRANSFORMER
OUTLINE

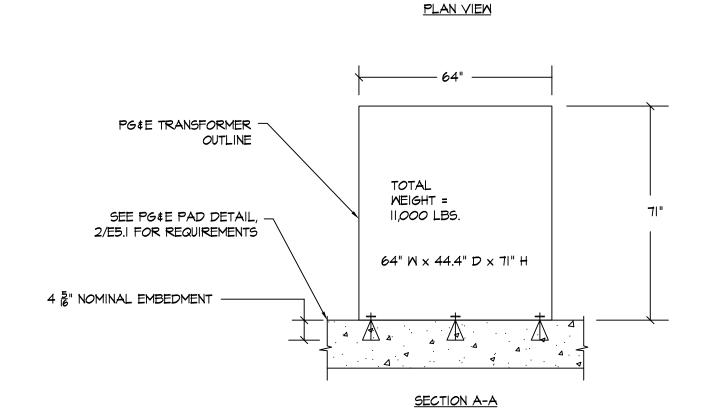

7 PG&E TRANSFORMER ANCHORAGE DETAIL


NOT TO SCALE

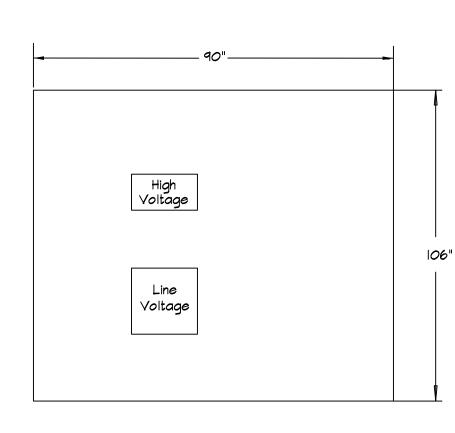

PAD SHALL BE PG&E TYPE IIE PER PG&E REQUIREMENTS.
PAD SHALL BE JENSEN PG&E 040292 OR EQUAL.


THIS PAD TO BE INSTALLED PER PG&E REQUIREMENTS AND PG&E GREEN BOOK. THIS PAD IS UNDER PG&E JURISDICTION AND PROPERTY EASEMENT.

PAD SHALL CONFORM TO ALL REQUIREMENTS OF UTILITY "PG&E."
REFER TO PG&E. CONTRACTOR DOCUMENTS FOR FINAL REQUIREMENTS
AND APPROVED VENDORS FOR "PRE-CAST" PADS.

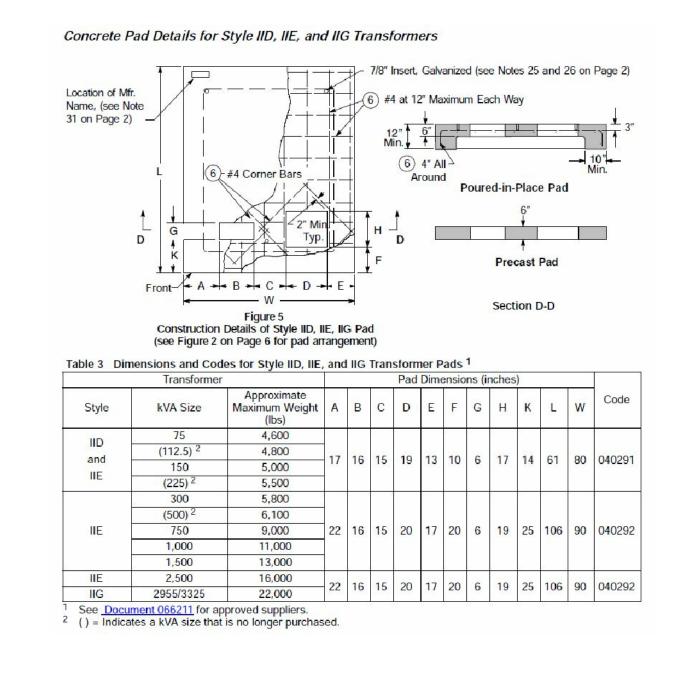


PG&E TRANSFORMER PAD DETAIL

E5.1 NOT TO SCALE

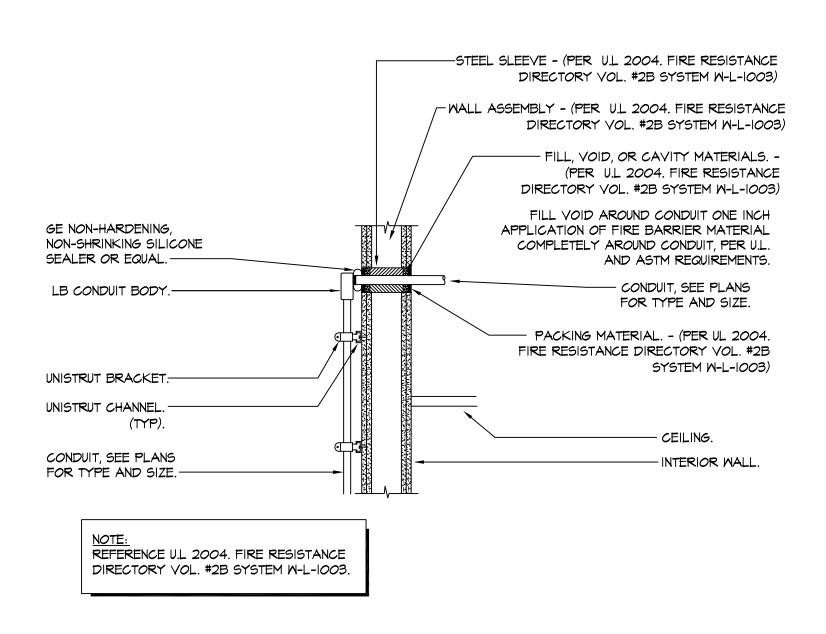

CONDUIT RISER AND WALL 5 PENETRATION - POWER

E5.1 NOT TO SCALE

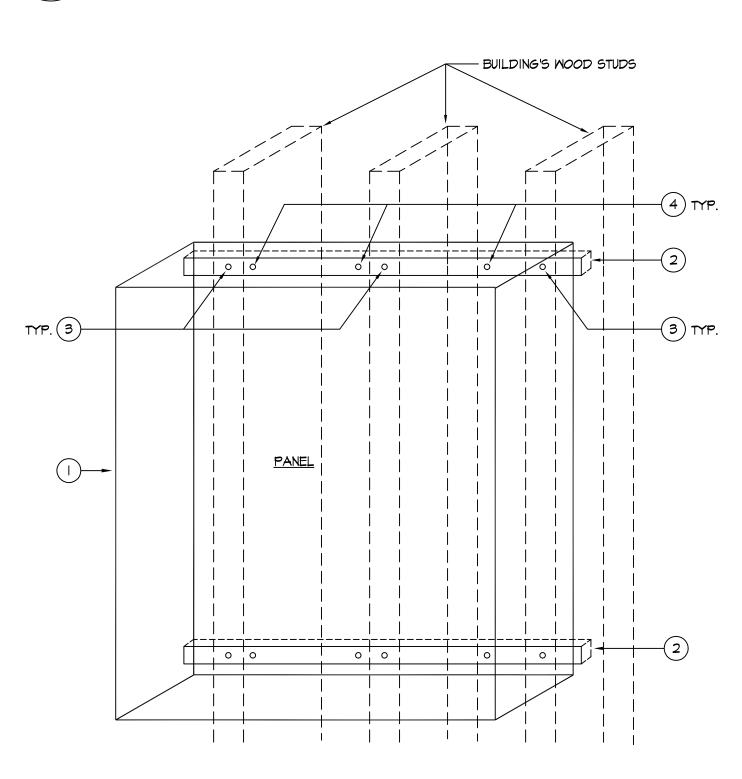


(I) NEMA-I ELECTRICAL PANEL (200 LBS).

NOT TO SCALE


- 2) UNISTRUT PIOOO MIN. 50" SPANNING OVER 3 STUDS.
- 3 %" LAG BOLT. SCREW SHALL PENETRATE MINIMUM 3". CENTER ON STUDS.
- 4) PROVIDE 3/8" HEX HEAD CAP SCREW (MIN. OF 3) WITH 3/8" CHANNEL NUT.

WALL MOUNTED PANEL INSTALLATION (100A-600A)

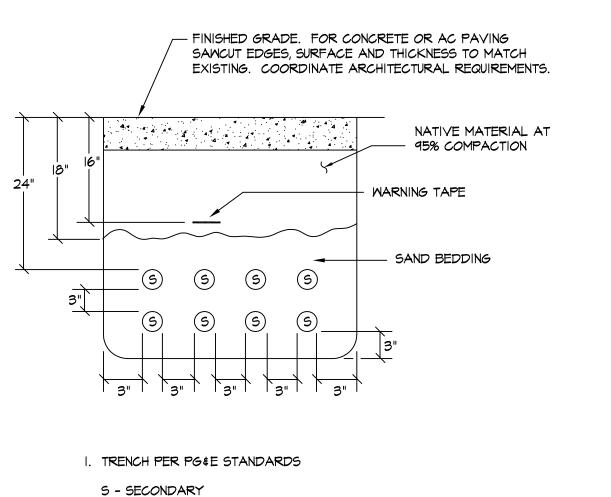


NOT TO SCALE

PG&E TRENCH DETAIL SECONDARY SIDE

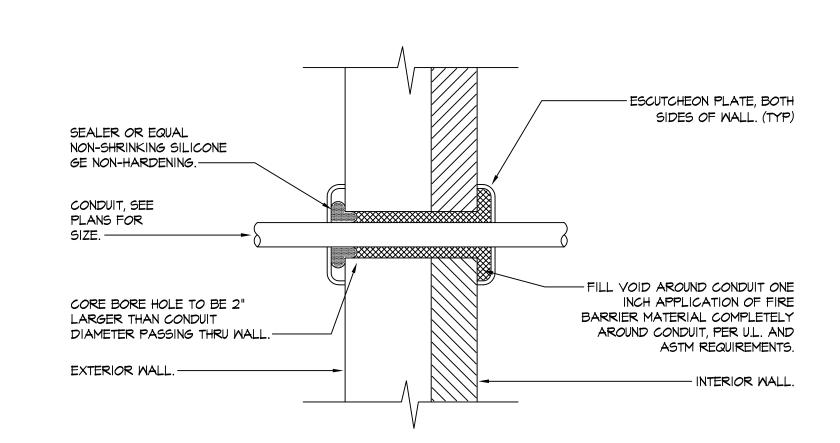

6 CONDUIT WALL PENETRATION DETAIL E5.1 NOT TO SCALE

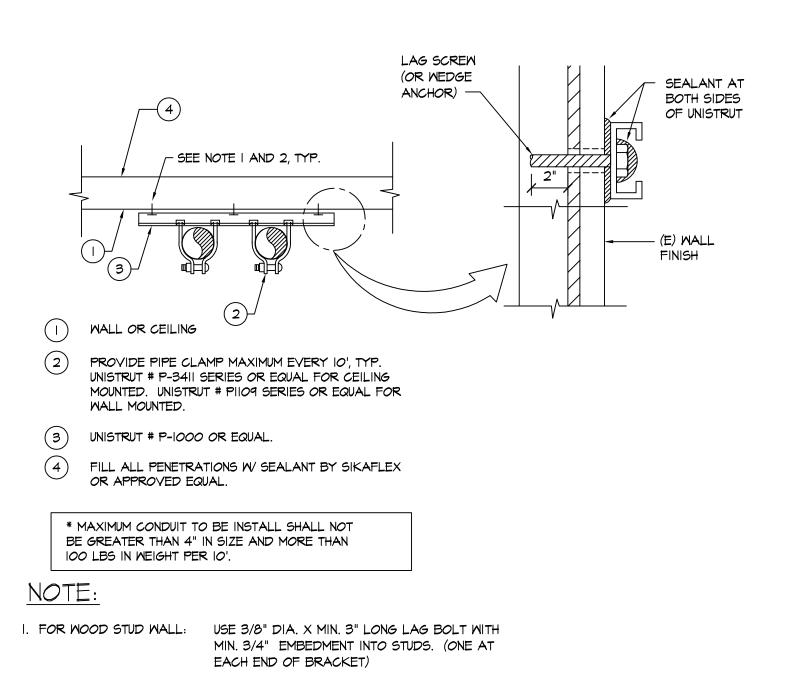

9 TYPICAL CONDUIT SUPPORT DETAIL

E5.1 SCALE: NOT TO SCALE

IDENTIFICATION STAMP DIV. OF THE STATE ARCHITECT

APP: 01-119554 INC:

REVIEWED FOR

SS FLS ACS D

DATE: 09/21/2021

architects

www.aedisarchitects.com 387 S. 1st Street, Suite 300 San Jose, CA 95113 tel: (408)-300-5160 fax: (408)-300-5121

MEADOW HEIGHTS
ELEMENTARY
SCHOOL - HVAC
REPLACEMENT

SAN MATEO-FOSTER CITY SCHOOL DISTRICT

CONSULTANT



American Consulting Engineers
Electrical, Inc.

1590 The Alameda, Suite 200
Son Jose, CA 95126
JOB # EK21030.00

408/236-2312
Fax: 408/236-2316

_____STAMP

STATE
DSA FILE NUMBER

APPL# 01-119554

REVISIONS

No. Description Date

MILESTONES

DD

90% CD

DSA SUB

06/02/2021

BACKCHECK

09/22/2021

SHEET


ELECTRICAL DETAILS

09/17/2021

JOB # 2021005.04

SHEET #


E5.1

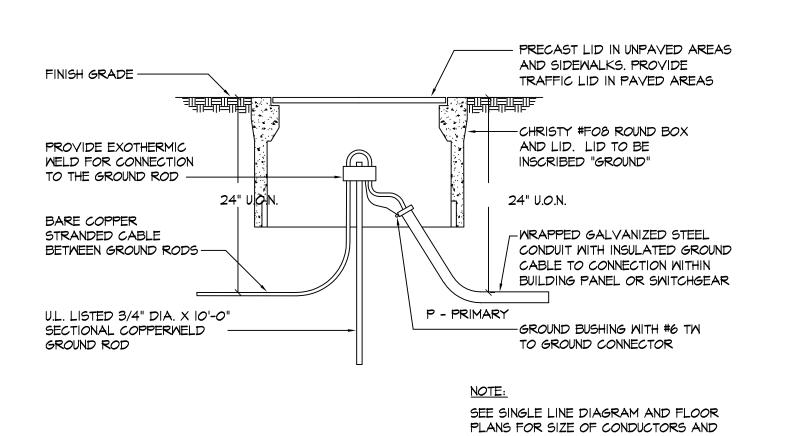

GROUND ROD INSPECTION WELL FOR MULTIPLE GROUND RODS

ARRANGEMENT OF GROUNDING SYSTEM



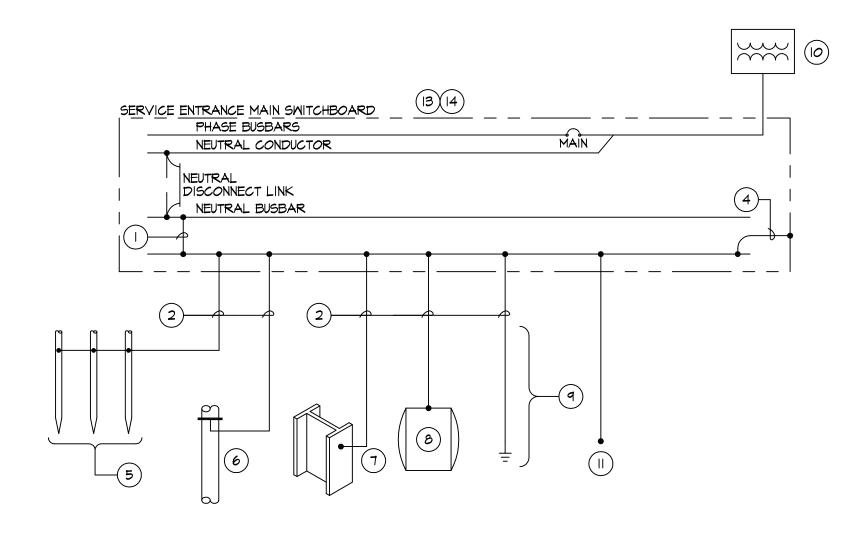

NOTES:


- THE EQUIPMENT GROUNDING CONDUCTOR SHALL BE USED FOR GROUNDING OR BONDING OF EQUIPMENT, STRUCTURES OR FRAMES REQUIRED TO BE GROUNDED OR BONDED(250.32(B)). PROVIDE ALL OF THE CONNECTIONS BELOW AND BOND TO THE EQUIPMENT GROUNDING CONDUCTOR.
- 2 GROUNDING ELECTRODE CONDUCTOR. GROUNDING ELECTRODE CONDUCTOR SHALL BE BARE OR INSULATED COPPER AND SHALL BE SIZED PER TABLE 250.66.

 3 NOT USED.
- 4 EQUIPMENT BONDING JUMPER. EQUIPMENT BONDING JUMPER SHALL BE INSULATED COPPER AND SHALL BE SIZED PER TABLE 250.122.
- PROVIDE A MINIMUM OF (3) GROUND ROD. GROUND ROD SHALL BE 10' LONG BY 3/4"
 DIAMETER COPPERCLAD. GROUNDING ELECTRODE CONDUCTOR SHALL BE BONDED TO
 THE GROUND ROD VIA EXOTHERMIC WELD. GROUND RODS SHALL BE INSTALLED IN A
 ROUND BOX. SEE DETAIL FOR BOX/INSTALLATION REQUIREMENTS.
- PROVIDE GROUNDING ELECTRODE CONDUCTOR CONNECTION TO THE NEAREST UNDERGROUND WATER PIPE IN DIRECT CONTACT WITH EARTH FOR A MINIMUM OF IO FEET. WATER PIPE SHALL BE ELECTRICALLY CONTINUOUS TO POINTS OF CONNECTION OF THE GROUNDING ELECTRODE CONDUCTOR. CONNECTION POINT SHALL NOT BE GREATER THAN 5' FROM THE POINT OF ENTRANCE OF THE UNDERGROUND WATER PIPE.
- PROVIDE GROUNDING ELECTRODE CONDUCTOR CONNECTION TO THE NEAREST METAL FRAME OR STRUCTURAL STEEL.
- 8 PROVIDE GROUNDING ELECTRODE CONDUCTOR CONNECTION TO ALL OTHER LOCAL METAL UNDERGROUND SYSTEMS OR STRUCTURES, AS REQUIRED WHEN AVAILABLE.
- METAL UNDERGROUND SYSTEMS OR STRUCTURES, AS REQUIRED WHEN AVAILABLE.

 9 PROVIDE A CONCRETE ENCASED ELECTRODE (UFER) IN AND NEAR THE BOTTOM OF THE STRUCTURAL FOOTING OR SLAB ON GRADE THAT IS IN DIRECT CONTACT WITH EARTH. THE ELECTRODE SHALL BE A MINIMUM OF 20 FEET LONG INSIDE THE PAD, FOOTING OR SLAB. THE ELECTRODE CONDUCTOR SHALL BE BARE COPPER AND SIZED PER TABLE 250.66 BUT SHALL NOT BE LESS THAN #4AWG.
- MAIN UTILITY TRANSFORMER SHALL BE GROUNDED PER THE REQUIREMENTS OF THE UTILITY COMPANY.
- | PROVIDE GROUNDING TO FENCE. SEE DETAIL 4/E5.2.
- PROVIDE GROUNDING ELECTRODE CONDUCTOR CONNECTION TO THE SECONDARY SIDE OF ALL MYE CONNECTED BUILDING TRANSFORMERS. GROUNDING ELECTRODE CONDUCTOR MAY BE CONNECTED TO THE NEAREST STRUCTURAL STEEL OR THE MAIN SERVICE GROUNDING ELECTRODE ONLY. SEE TRANSFORMER GROUNDING DETAIL FOR ADDITIONAL REQUIREMENTS.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING ALL GROUNDING AND BONDING AS REQUIRED PER THE CEC.
- (14) SEE SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS.

MAIN SERVICE GROUNDING DETAIL

E5.2 NOT TO SCALE

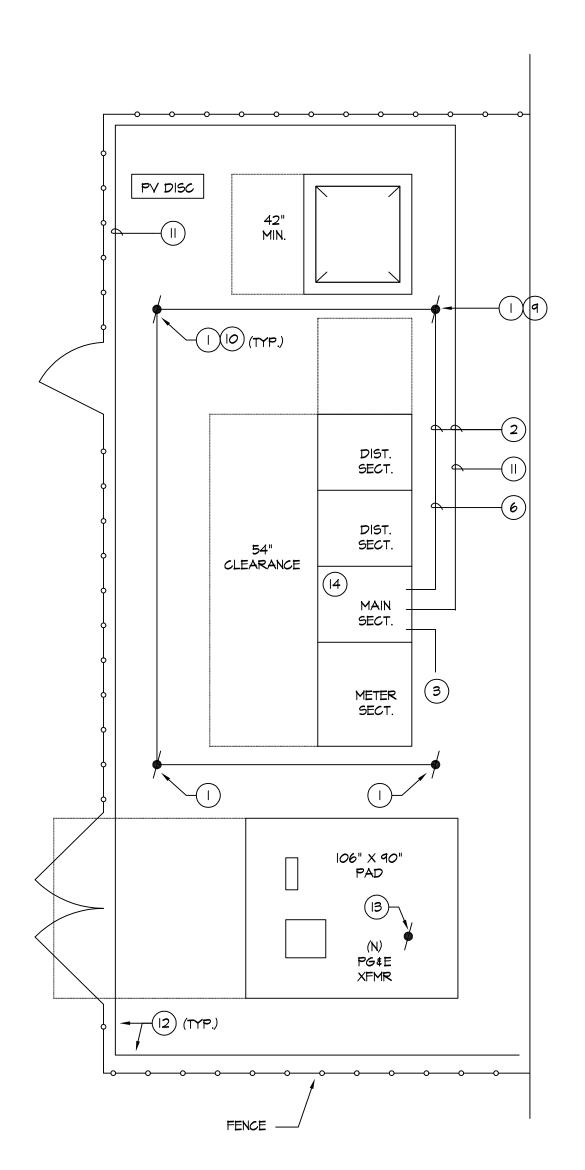

GROUNDING DETAIL NOTES:

- () GROUND ROD. SEE DETAIL 1/E3.2 FOR REQUIREMENTS.
- 2 CADWELD GROUNDING ELECTRODE CONDUCTOR TO THE REBAR.
- (3) UFER CADWELD TO REBAR +20' OF BARE COPPER ENCASED.
 (4) NOT USED.
- (5) NOT USED.
- #3/0 BARE COPPER MAIN SWITCHBOARD GROUNDING ELECTRODE CONDUCTOR. CONDUCTOR SHALL BE INSTALLED ENCASED IN THE
- #3/0 BARE COPPER TRANSFORMER GROUNDING ELECTRODE CONDUCTOR. CONDUCTOR SHALL BE INSTALLED ENCASED IN THE CONCRETE SLAB TO THE GROUND ROD AND CADWELD TO THE GROUND ROD.
- 8 NOT USED.
- 9 ALL INTERSECTIONS OF GROUNDING CONDUCTORS SHALL BE CADWELD TOGETHER.
- (IO) GROUND RODS SHALL BE INSTALLED A MINIMUM IO' APART.
- #3/0 BARE COPPER FENCE GROUNDING CONDUCTOR. CONDUCTOR SHALL BE INSTALLED ENCASED IN THE CONCRETE SLAB.
- PROVIDE T INTERSECTION AND EXTEND #3/O CONDUCTORS ABOVE THE SLAB ADJACENT TO THE FENCE POST. COORDINATE INSTALLATION WITH FENCE SLEEVES AND FENCE POST INSTALLER. T INTERSECTION SHALL BE CADWELD. SEE 3/E3.2 AND 4/E3.2 FOR ADDITIONAL INFORMATION. SEE ARCHITECTURAL DRAWINGS FOR FENCE POST QUANTITY. TYPICAL FOR ALL FENCE POSTS.
- (13) PROVIDE GROUND ROD PER PG&E GREENBOOK REQUIREMENTS.

DRY-TYPE _____

TRANSFORMER

NEAREST

GROUNDING .

ELECTRODE

SYSTEM BONDING

GROUNDING

ELECTRODE


CONDUCTOR

JUMPER

(14) SEE DETAIL 3/E3.2 FOR ADDITIONAL GROUNDING REQUIREMENTS.

GROUNDING AT SWITCHBOARD ENCLOSURE



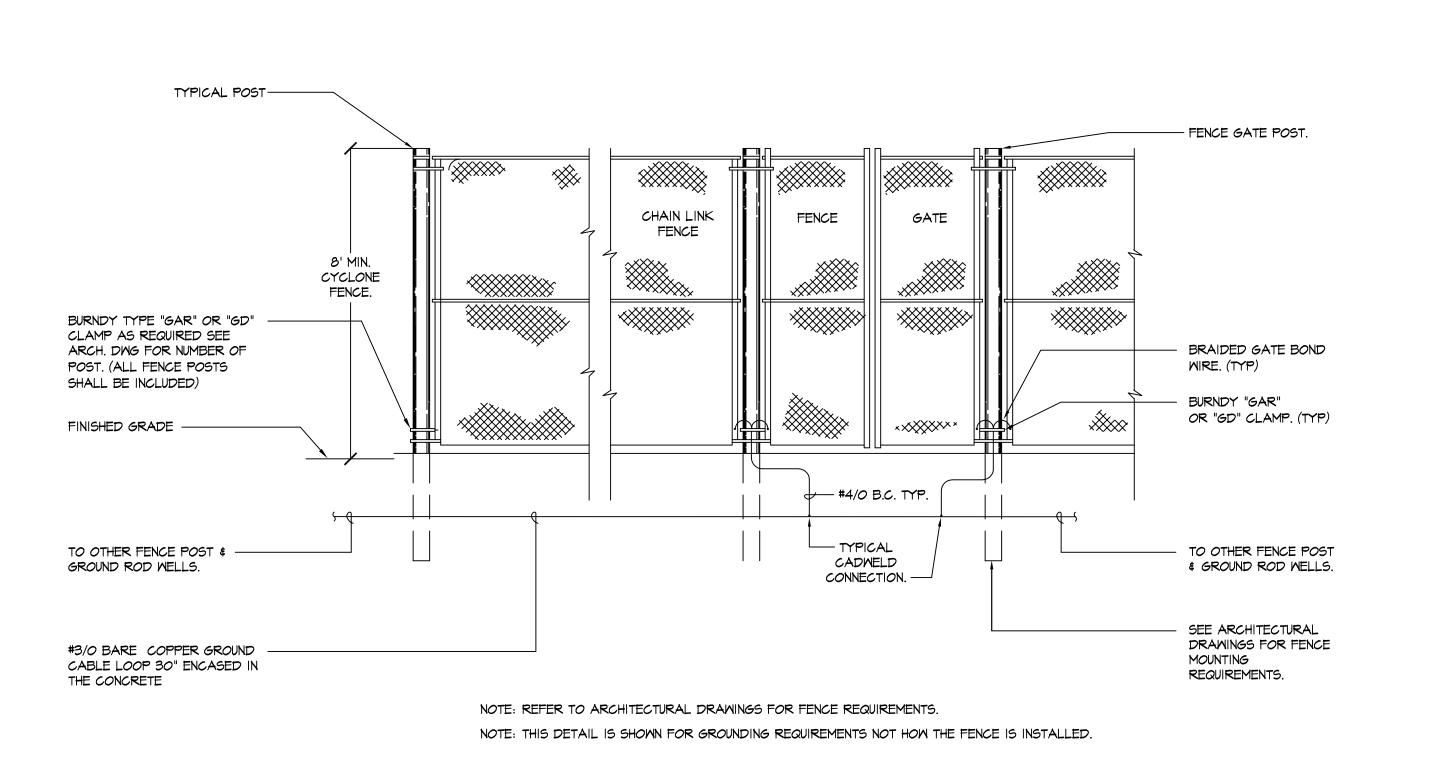



NOT TO SCALE



-EQUIPMENT GROUNDING

- ISOLATED NEUTRAL

208Y-120V

- SUPPLY-SIDE

BONDING JUMPER

CONDUCTOR



IDENTIFICATION STAMP DIV. OF THE STATE ARCHITE


REVIEWED FOR
SS FLS ACS ACS

APP: 01-119554 INC:

SAN MATEO-FOSTER CITY SCHOOL DISTRICT

SCHOOL - HVAC

REPLACEMENT







STAMP

STATE
DSA FILE NUMBER

APPL# 01-119554
REVISIONS

No. Description Date


MILESTONES
DD
90% CD

DSA SUB 06/02/2021 BACKCHECK 09/22/2021

ELECTRICAL DETAILS


09/17/2021 JOB# 2021005.04


E5.2

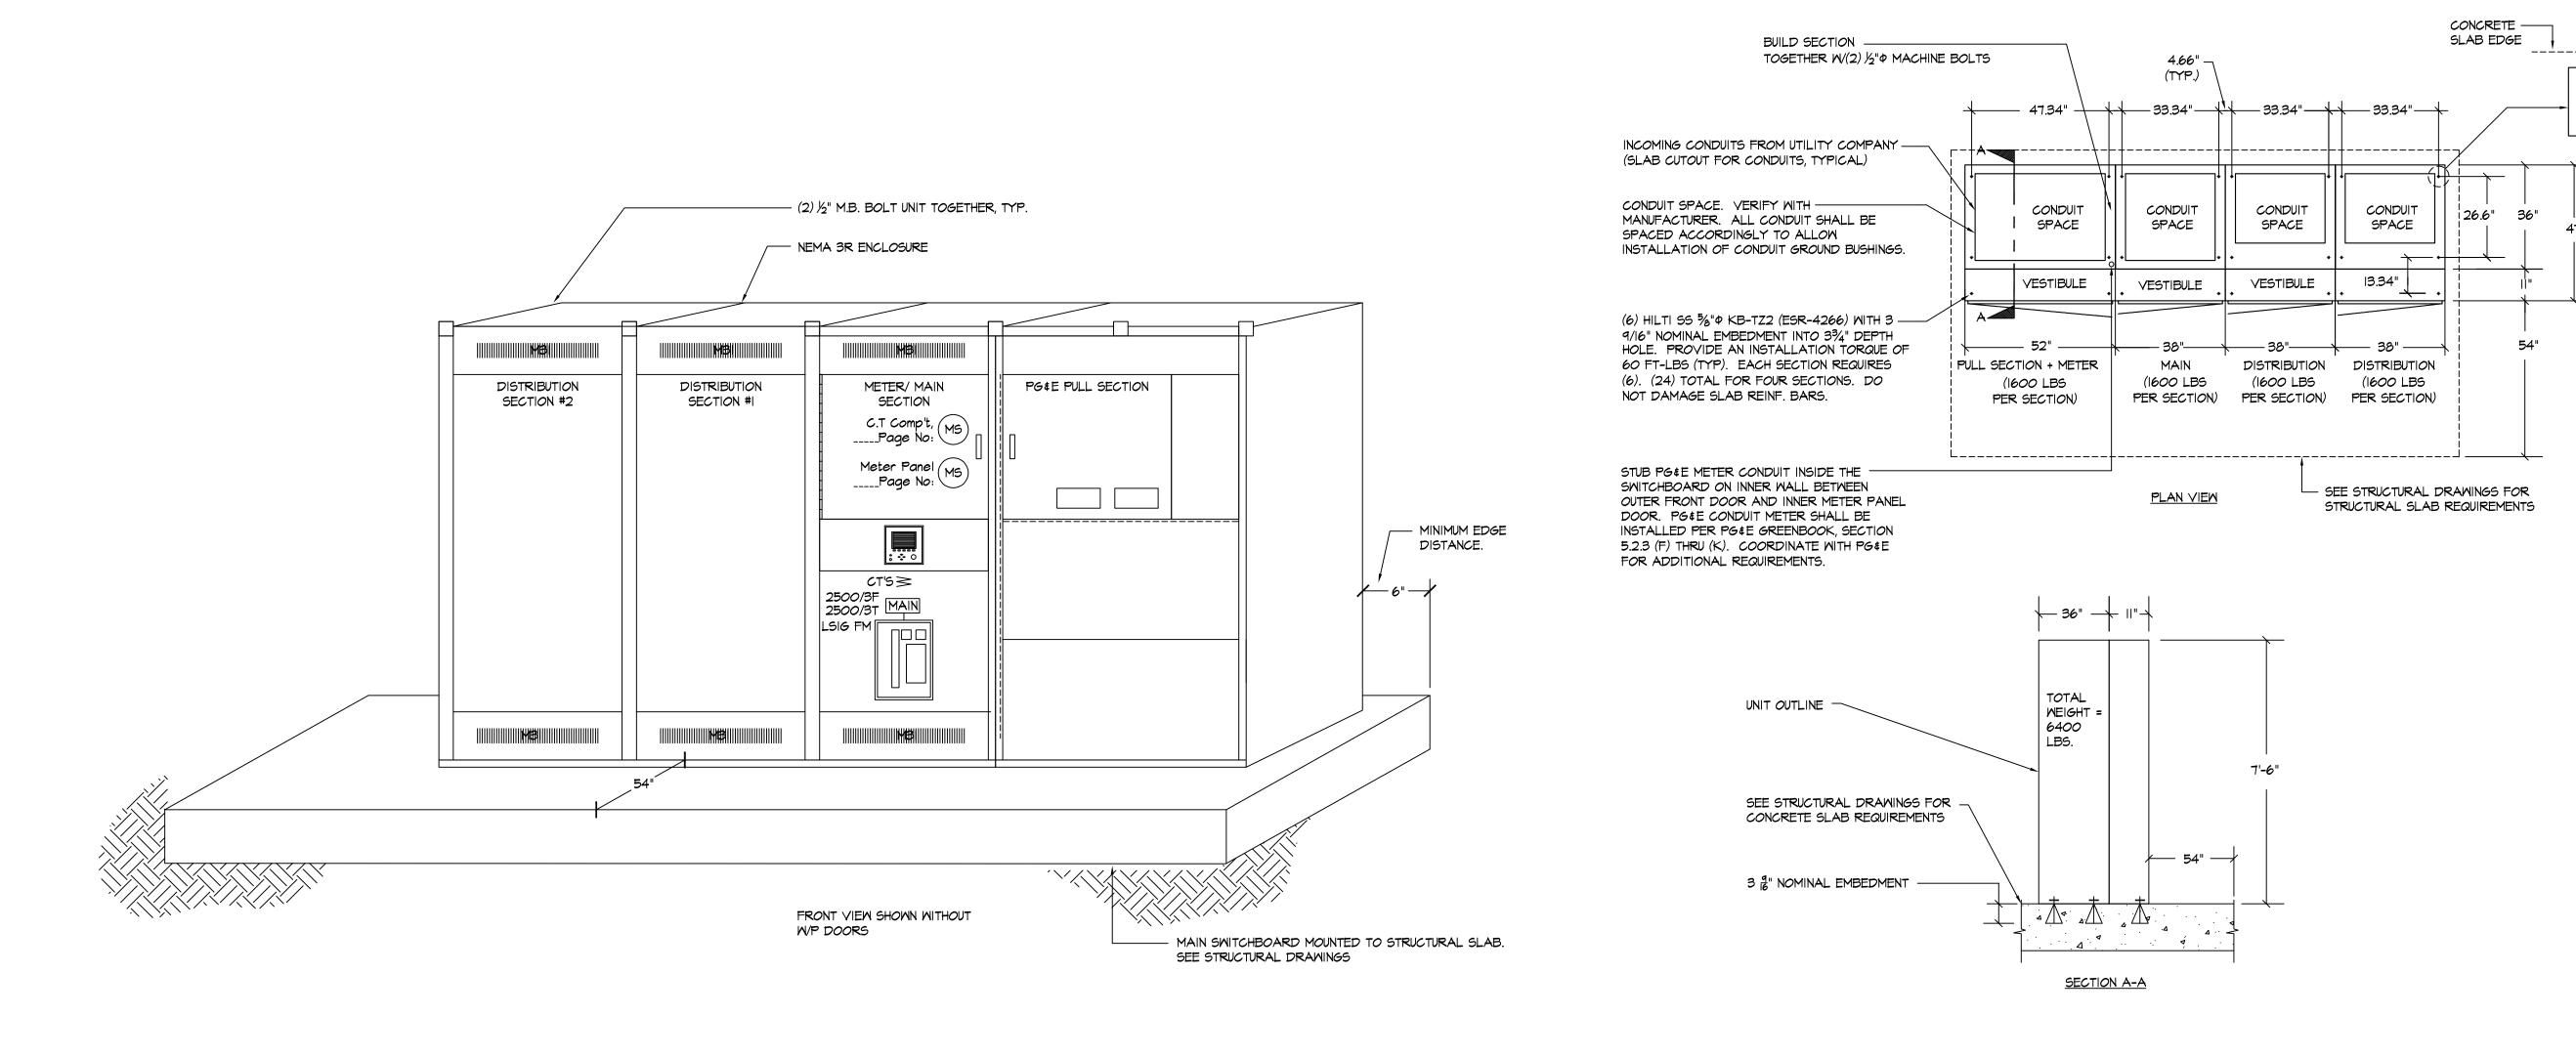


NEMA 3R MAIN SWITCHBOARD ELEVATION AND ANCHORAGE DETAIL

NOT TO SCALE

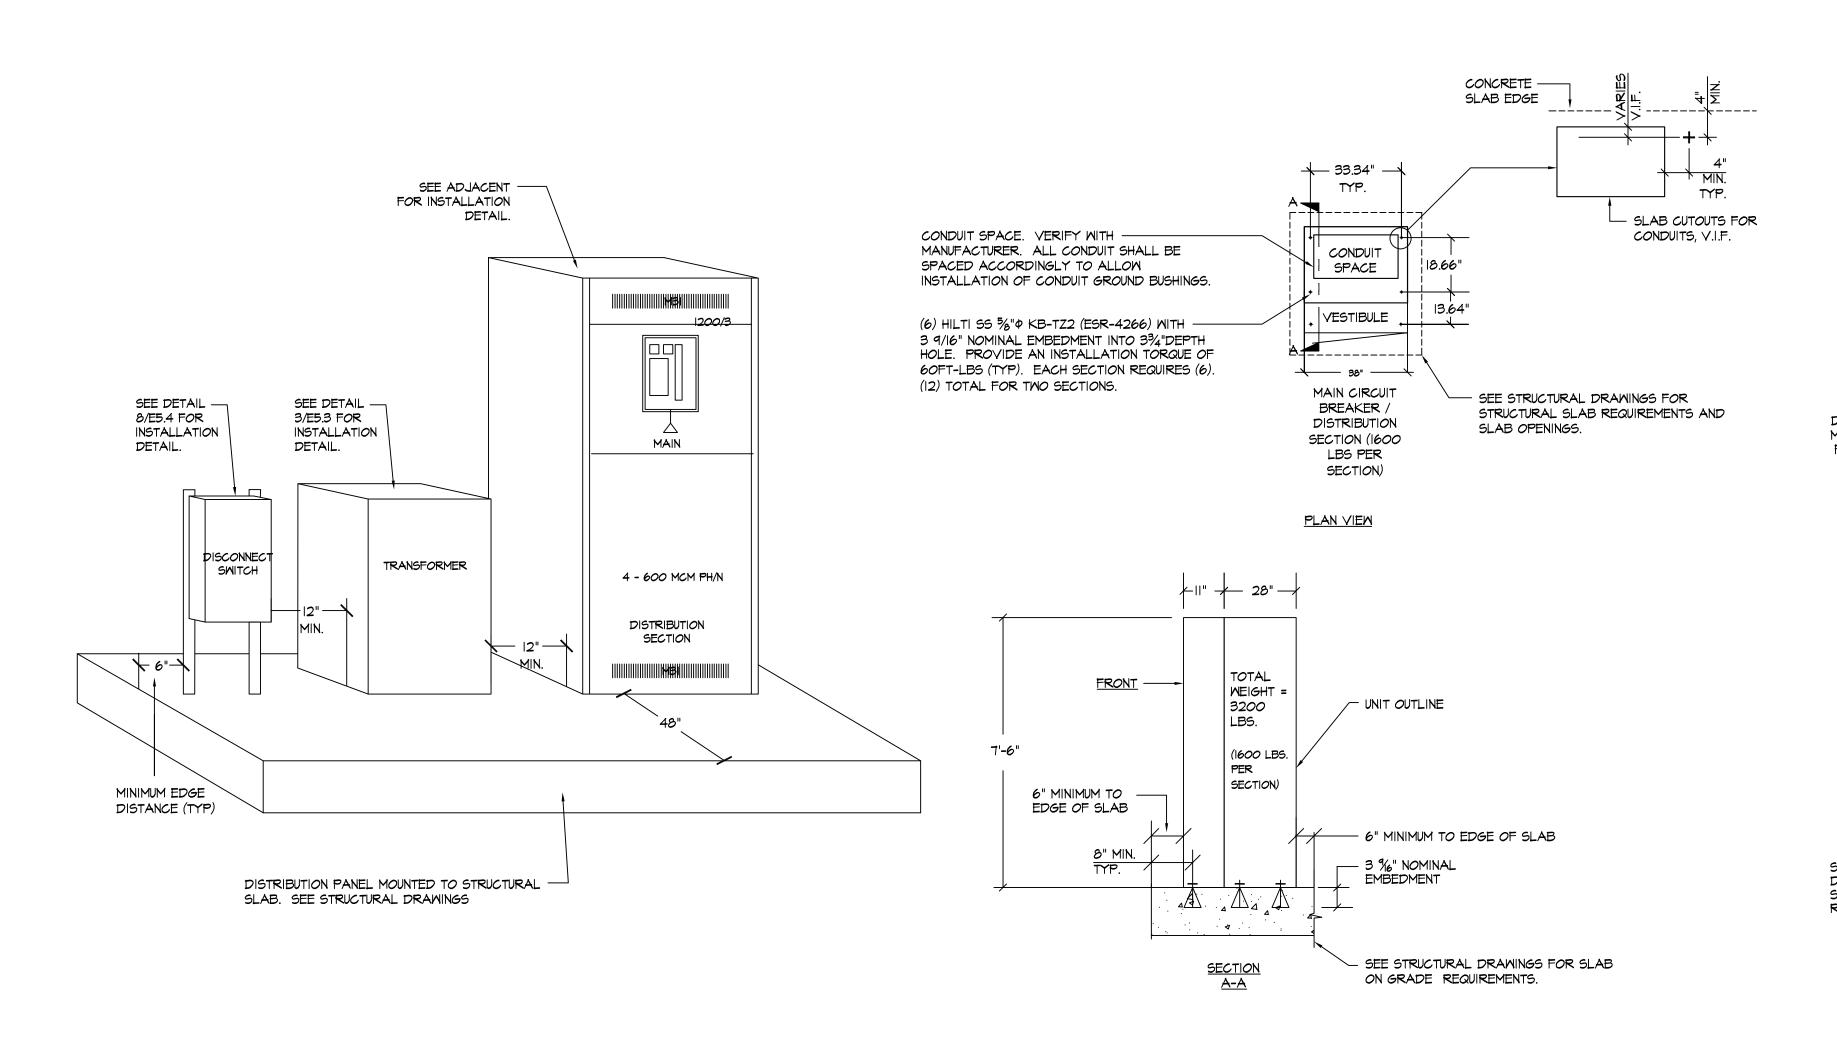

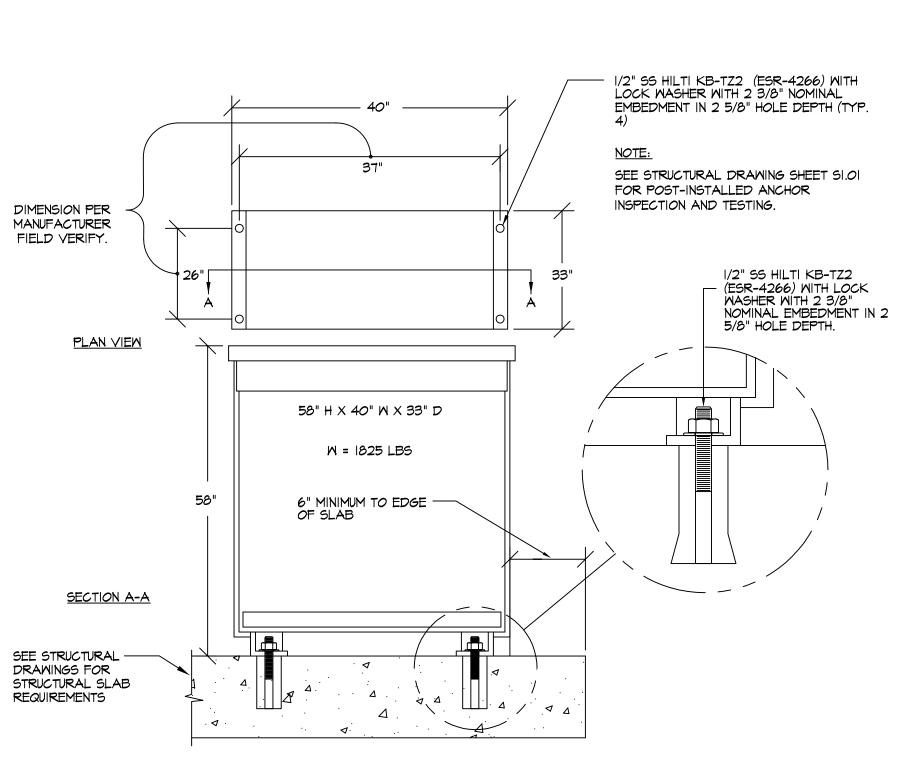

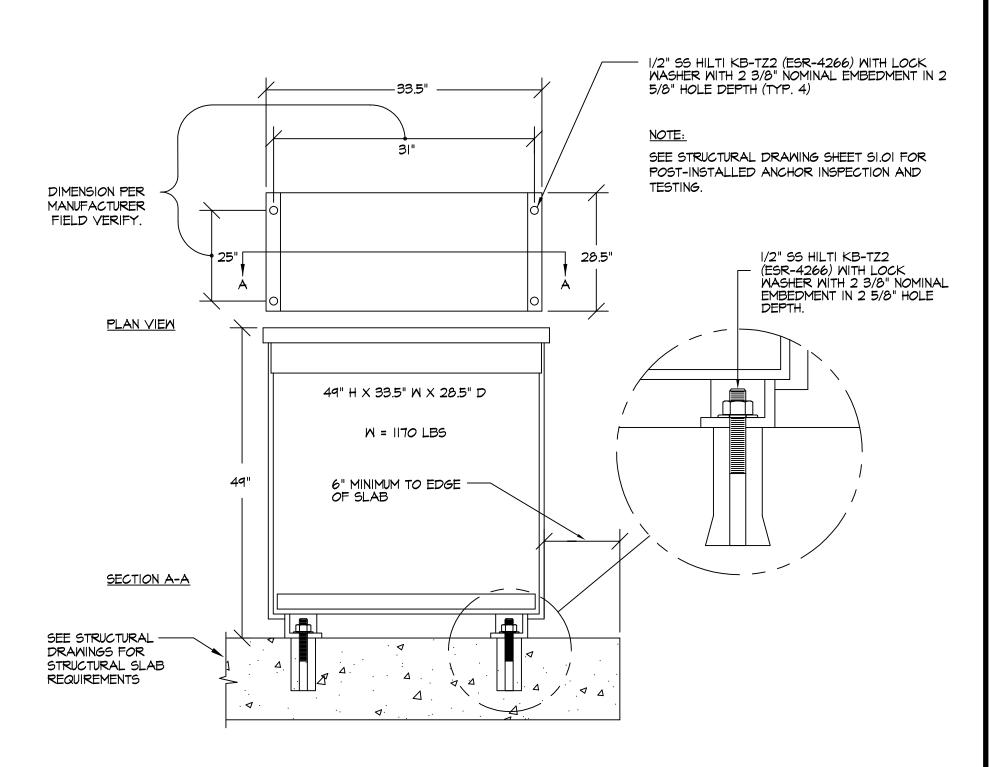

- SLAB CUTOUTS FOR

CONDUITS, V.I.F.

DISTRIBUTION TRANSFORMER INSTALLATION DETAIL (225 KVA)

NOT TO SCALE

DISTRIBUTION TRANSFORMER INSTALLATION DETAIL (150 KVA)

NOT TO SCALE

IDENTIFICATION STAMP DIV. OF THE STATE ARCHITEC APP: 01-119554 INC: REVIEWED FOR SS 🗹 FLS 🗹 ACS 🗹

architects

www.aedisarchitects.com 387 S. 1st Street, Suite 300 San Jose, CA 95113 tel: (408)-300-5160 fax: (408)-300-5121

PROJECT **MEADOW HEIGHTS ELEMENTARY** SCHOOL - HVAC REPLACEMENT

SAN MATEO-FOSTER CITY SCHOOL DISTRICT

CONSULTANT



American Consulting Engineers Electrical, Inc. 1590 The Alameda, Suite 200 San Jose, CA 95126 JOB # EK21030.00

STAMP

STATE DSA FILE NUMBER 01-119554

REVISIONS No. Description Date

MILESTONES

DD 90% CD DSA SUB 06/02/2021 BACKCHECK


ELECTRICAL DETAILS

09/17/2021 JOB# 2021005.04

E5.3

NOT TO SCALE

NEMA 3R DISTRIBUTION PANEL ELEVATION AND DISTRIBUTION PANEL ANCHORAGE DETAIL

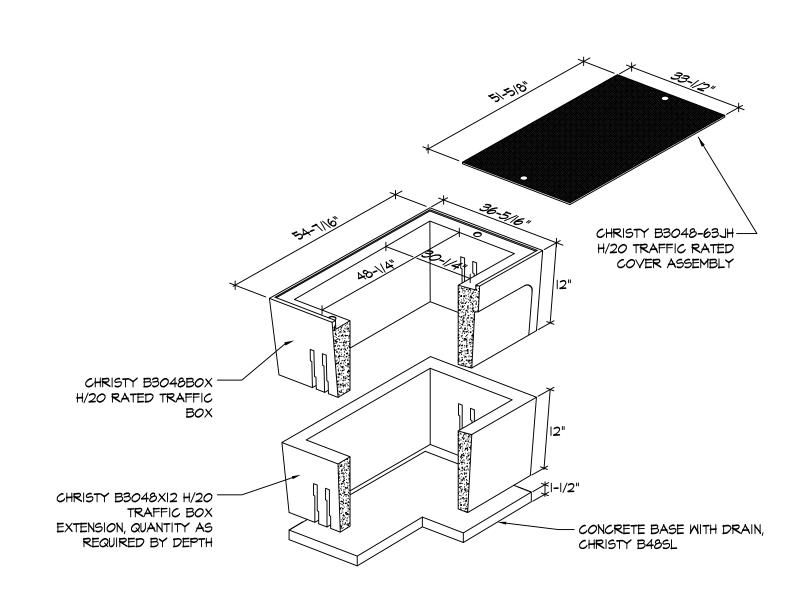


- HIGH DENSITY REINFORCED CONCRETE BOX WITH NON-SETTING SHOULDERS POSITIONED TO MAINTAIN GRADE AND FACILITATE BACK FILLING. APPROXIMATE DIMENSIONS SHOWN.
- 2. ALL CONDUITS SHALL ENTER FROM SIDES OF PULL BOX. CONTRACTOR SHALL PROVIDE PULL BOX EXTENSION AS REQUIRED. NO CONDUITS SHALL BE ALLOWED FROM THE BOTTOM
- 3. CONTRACTOR SHALL STACK CONDUITS AS REQUIRED TO MEET THE NEC CODE REQUIREMENTS.
- 4. PROVIDE BELL ENDS ON ALL CONDUIT.
- 5. ALL PENETRATIONS INTO BOXES SHALL BE SEALED WITH GROUT.
- 6. PROVIDE DRAIN IN BASE AND DRAIN ROCK.

B3048 TRAFFIC BOX DETAIL

E5.4 NOT TO SCALE

(FULL TRAFFIC COVER)

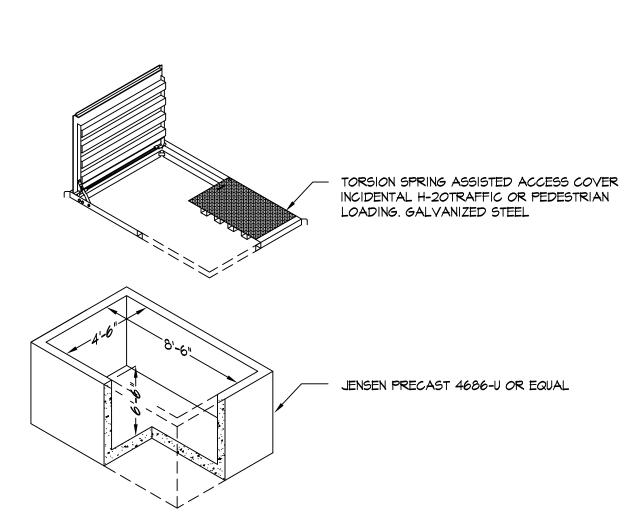

HIGH DENSITY REINFORCED CONCRETE BOX WITH NON-SETTING SHOULDERS POSITIONED TO MAINTAIN GRADE AND FACILITATE BACK FILLING. APPROXIMATE DIMENSIONS SHOWN.

4'6" x 8'6" ELECTRICAL VAULT

ALL CONDUITS SHALL ENTER FROM SIDES OF PULL BOX. NO CONDUITS SHALL BE ALLOWED FROM THE BOTTOM OF THE PULL BOX.

3. CONTRACTOR SHALL STACK CONDUITS AS REQUIRED TO MEET THE NEC CODE

- REQUIREMENTS. 4. PROVIDE BELL ENDS ON ALL CONDUIT.
- 5. ALL PENETRATIONS INTO BOXES SHALL BE SEALED WITH GROUT.
- 6. PROVIDE BASE WITH DRAIN AND DRAIN ROCK.

000 000 POWER SECTION CONDUIT SIGNAL SECTION CONDUIT NOTES: MARNING TAPE MARKED "POWER"

000

0000

CUT (E) SURFACE STRAIGHT & TRUE

> I. ALL ELECTRICAL TRENCH WORK SHALL BE THE RESPONSIBILITY OF THE ELECTRICAL CONTRACTOR.

|---6"---| 3" |---

PATCH & FINISH TO

MATCH (E) SURFACE

「(E) SURFACE

- 2. MINIMUM SPACING BETWEEN CONDUITS IS 3".
- 3. SEE SITE/FLOOR PLANS AND SPECIFICATIONS FOR CONDUIT REQUIREMENTS.
- 4. ALL UNDERGROUND CONDUITS TO BE IN CONFORMANCE WITH DETAIL 1/55.1

1/2" SS HILTI KB-TZ2 (ESR-4266) WITH LOCK WASHER WITH 2 3/8" NOMINAL EMBEDMENT IN 2

SEE STRUCTURAL DRAWING SHEET SI.OI FOR

POST-INSTALLED ANCHOR INSPECTION AND

I/2" SS HILTI KB-TZ2 (ESR-4266) WITH LOCK WASHER WITH 2 3/8" NOMINAL EMBEDMENT IN 2 5/8" HOLE DEPTH.

5/8" HOLE DEPTH (TYP. 4)

TYPICAL JOINT TRENCH & DUCT BANK DETAIL

E5.4 NOT TO SCALE

COMPACTION.

SUITABLE MATERIAL TO ACHIEVE 95%



2 > MARNING TAPE MARKED "SIGNAL"

MARNING TAPE MARKED "GAS"

(4) WARNING TAPE MARKED "WATER"

5 MARNING TAPE MARKED "SEWER"



NOTES:

TRAFFIC BOX -

CHRISTY No. B2436

B2436 TRAFFIC BOX DETAIL

I. HIGH DENSITY REINFORCED CONCRETE BOX WITH NON-SETTING SHOULDERS POSITIONED TO MAINTAIN GRADE AND FACILITATE BACK FILLING. APPROXIMATE DIMENSIONS SHOWN

2. ALL CONDUITS SHALL ENTER FROM SIDES OF PULL BOX, CONTRACTOR SHALL PROVIDE PULL BOX EXTENSION AS REQUIRED. NO CONDUITS SHALL BE ALLOWED FROM THE BOTTOM

3. CONTRACTOR SHALL STACK CONDUITS AS REQUIRED TO MEET THE NEC CODE REQUIREMENTS.

E5.4 NOT TO SCALE

4. PROVIDE BELL ENDS ON ALL CONDUIT.

6. PROVIDE DRAIN IN BASE AND DRAIN ROCK.

5. ALL PENETRATIONS INTO BOXES SHALL BE SEALED WITH GROUT.


(FULL TRAFFIC COVER)


COVER ASSEMBLY -

FULL TRAFFIC

- CONCRETE BASE WITH DRAIN,

CHRISTY B36SL

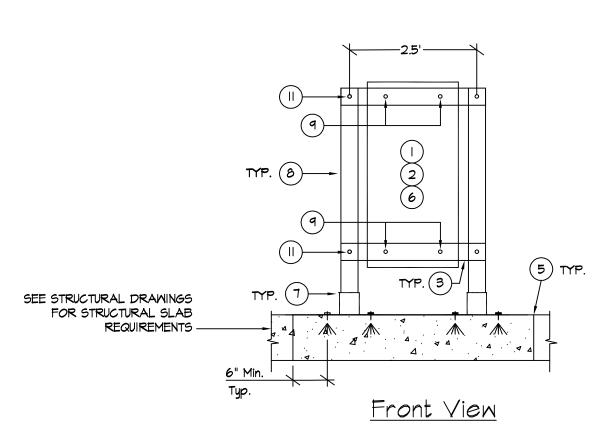

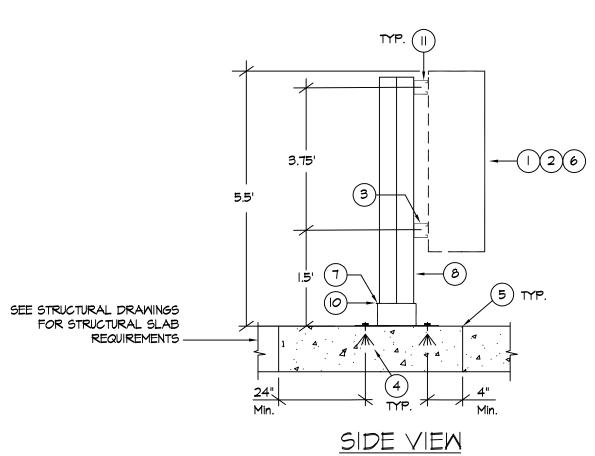


- (I) DISCONNECT (MAX WEIGHT 200 LBS).
- 2) TYPE 3R DISCONNECT.
- 3) PROVIDE UNISTRUT PIOOO MINIMUM 12 GA GALV STEEL
- $\left(4\right)$ PROVIDE STAINLESS STEEL I/2" ϕ X 2 3/8" NOMINAL EMBEDMENT HILTI KWIK BOLT TZ2 EXPANSION ANCHOR (ICC-ES-ESR 4266), IN 2-5/8" DEEP HOLE. (4) ANCHOR BOLTS PER POST BASE.
- 5 SLAB EDGE WHERE OCCURS.

NOT TO SCALE

- 6) DIMENSIONS OF DISCONNECT 29"H X 19"W X 8.5"D
- 7) PROVIDE UNISTRUT FLOOR SUPPORT P2073A SQ POST BASE.
- (8) PROVIDE DOUBLE UNISTRUT PIOOI HS MINIMUM 12 GA GALY STEEI.
- (9) PROVIDE HEX HEAD CAP SCREMS 3/8"X2" WITH HEX NUTS AND WASHERS. (4) CAP SCREWS ARE FOR ATTACHMENT OF PANEL TO REAR STRUTS.
- PROVIDE (2) 1/2" GALY BOLTS FROM P2073A SQ POST BASE INTO VERTICAL UNISTRUT P1001. PROVIDE EACH BOLT WITH P1010 NUT INSIDE
- STRUT. TYPICAL FOR BOTH P2073A SQ POST BASE.
- (II) PROVIDE I/2" ϕ GALV BOLT FASTENERS AT EACH INTERSECTION.

DISCONNECT INSTALLATION ON **UNISTRUT DETAIL**

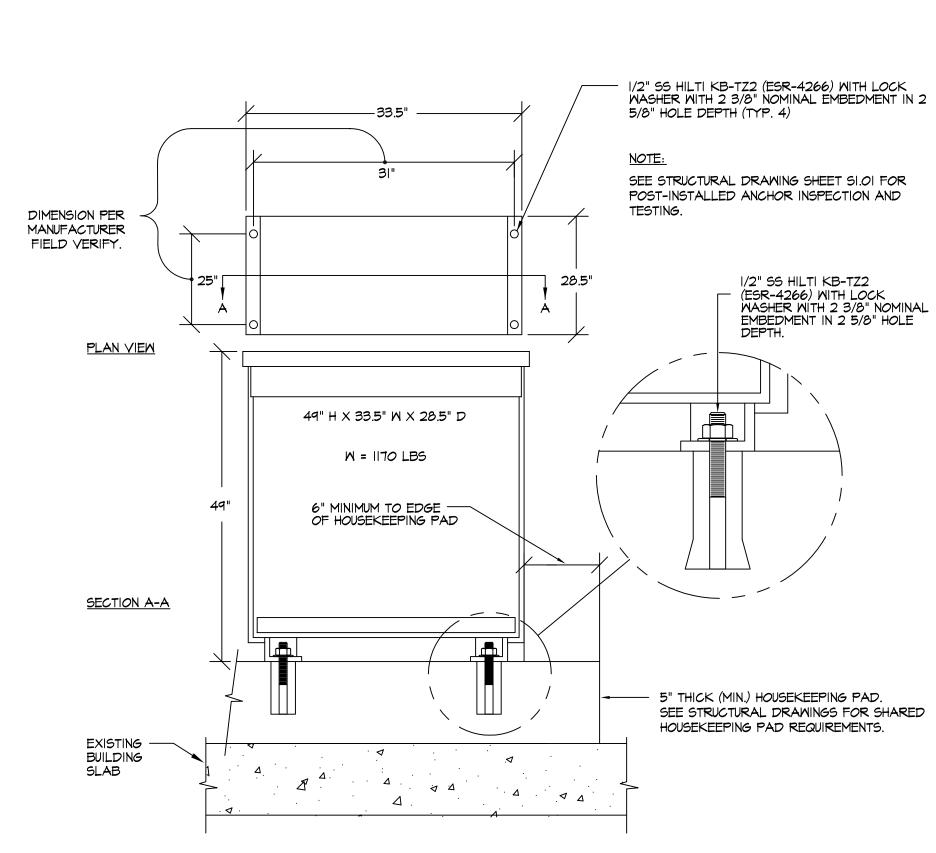


DISTRIBUTION TRANSFORMER INSTALLATION DETAIL (75 KVA)

42" H X 30" W X 23" D

6" MINIMUM TO EDGE -



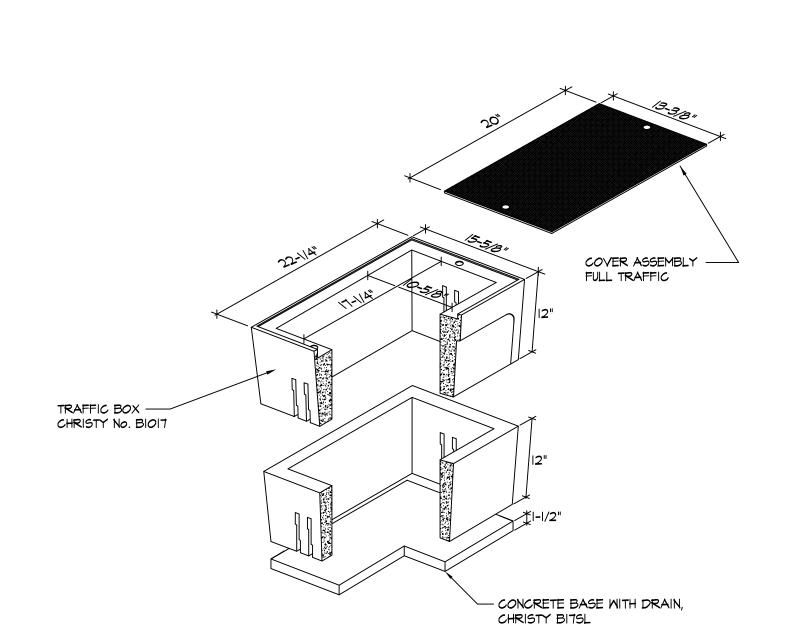

- HIGH DENSITY REINFORCED CONCRETE BOX WITH NON-SETTING SHOULDERS POSITIONED TO MAINTAIN GRADE AND FACILITATE BACK FILLING. APPROXIMATE DIMENSIONS SHOWN.
- 2. ALL CONDUITS SHALL ENTER FROM SIDES OF PULL BOX. CONTRACTOR SHALL PROVIDE PULL BOX EXTENSION AS REQUIRED. NO CONDUITS SHALL BE ALLOWED FROM THE BOTTOM OF THE
- 3. CONTRACTOR SHALL STACK CONDUITS AS REQUIRED TO MEET THE NEC CODE REQUIREMENTS.
- 4. PROVIDE BELL ENDS ON ALL CONDUIT.
- 5. ALL PENETRATIONS INTO BOXES SHALL BE SEALED WITH GROUT.
- 6. PROVIDE DRAIN IN BASE AND DRAIN ROCK.
- NOT TO SCALE



(FULL TRAFFIC COVER)

DIMENSION PER MANUFACTURER FIELD VERIFY.

<u>PLAN VIEW</u>

SECTION A-A

SEE STRUCTURAL — DRAWINGS FOR

STRUCTURAL SLAB

REQUIREMENTS

NOT TO SCALE

APP: 01-119554 INC: REVIEWED FOR SS 🗹 FLS 🗹 ACS 🗹

IDENTIFICATION STAMP DIV. OF THE STATE ARCHITEC

architects

www.aedisarchitects.com 387 S. 1st Street, Suite 300 San Jose, CA 95113 tel: (408)-300-5160

fax: (408)-300-5121 PROJECT **MEADOW HEIGHTS ELEMENTARY**

SAN MATEO-FOSTER CITY

SCHOOL - HVAC

REPLACEMENT

CONSULTANT

SCHOOL DISTRICT





STAMP

STATE

DSA FILE NUMBER 01-119554

REVISIONS No. Description Date

MILESTONES 90% CD DSA SUB BACKCHECK

SHEET **ELECTRICAL**

DETAILS

09/17/2021

^{JOB#} 2021005.04 SHEET#

E5.4