
WATER QUALITY TESTING

FOR

***ELMWOOD PARK COMMUNITY UNIT SCHOOL
DISTRICT 401
ELMWOOD ELEMENTARY***

ELMWOOD PARK, ILLINOIS

AUGUST 26, 2017

PROJECT NUMBER: 17-18289

TABLE OF CONTENTS

INTRODUCTION	1
RESULTS	1
PROFESSIONAL CERTIFICATION	1

Appendix I: Sample Locations and Sample Map

Appendix II: Laboratory Results

INTRODUCTION

Elmwood Park School District 401 implemented a proactive program of water testing at Elmwood Park Elementary school. Water sampling was conducted by Daniel Petras and Kathryn Hermann of Aires Consulting on August 26, 2017. Mr. Geoffrey J. Bacci II, P.E. designed the studied and developed this report.

All sampling methodology followed protocol required by The Lead in Drinking Water Testing Bill (LDWTB) an guidelines published by the Illinois Department of Public Health (IDPH). Detailed background information on testing requirements, methodology and lead health effects are included in the main report to the District that summarizes results and offers recommendations.

RESULTS

Field sheets identifying sample numbers and sample locations maps are included in Appendix I. Laboratory results are included in Appendix II.

All results were less than 5 parts per billion (ppb). Results ranged from non-detectable (< 2 ppb) to 2.06 ppb.

Results should at minimum be posted on the Districts website within 7 days. The sample results should be e-mailed to IDPH within 7 days

PROFESSIONAL CERTIFICATION

Aires Consulting, a division of Gallagher Bassett Services, Inc. conducted this study in the interest of **Elmwood Park School District 401** to assist in meeting environmental obligations and regulations. In this respect, we hope the results of this study are useful. *This study was not intended to include every environmental exposure that may be present at the facility; only those items specifically addressed in the report were evaluated.* If you have any questions concerning this study please let us know.


Respectfully Submitted,




Geoffrey J. Bacci, II, PE
Director Operations

Appendix I


ISBE ID	Building ID	Building Description	Sample Date	Sample Time (12 HR Clock)	Collected By	Sample ID Number	Sample Location Description	Fixture Type	Date of Last Use	Time of Last Use (12 HR Clock)	Sample Type	Sample Volume (mL)	Laboratory Name	Analytical Method	Concentration (ug/L)	Reporting Limit (ug/L)	Notes
60164010261001	01		08/26/2017	09:20 AM	Dan Petras	EEWF-1A	Across From Room 204	DF - Drinking Fountain	08/25/2017	04:00 PM	First Draw	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
60164010261001	01		08/26/2017	09:21 AM	Dan Petras	EEWF-1B	Across From Room 204	DF - Drinking Fountain	08/25/2017	04:00 PM	Flush	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
60164010261001	01		08/26/2017	09:23 AM	Dan Petras	EEWF-2A	Adjacent Room 205	WF - Water Cooler	08/25/2017	04:00 PM	First Draw	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
60164010261001	01		08/26/2017	09:24 AM	Dan Petras	EEWF-2B	Adjacent Room 205	WF - Water Cooler	08/25/2017	04:00 PM	Flush	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
60164010261001	01		08/26/2017	09:25 AM	Dan Petras	EEWF-2C	Adjacent Room 205	O - Other	08/25/2017	04:00 PM	First Draw	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
60164010261001	01		08/26/2017	09:26 AM	Dan Petras	EEWF-3A	Outside Room 214	DF - Drinking Fountain	08/25/2017	04:00 PM	First Draw	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
60164010261001	01		08/26/2017	09:27 AM	Dan Petras	EEWF-3B	Outside Room 214	DF - Drinking Fountain	08/25/2017	04:00 PM	Flush	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
60164010261001	01		08/26/2017	09:31 AM	Dan Petras	EEWF-4A	Outside Room 109	WF - Water Cooler	08/25/2017	04:00 PM	First Draw	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
60164010261001	01		08/26/2017	09:32 AM	Dan Petras	EEWF-4B	Outside Room 109	WF - Water Cooler	08/25/2017	04:00 PM	Flush	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
60164010261001	01		08/26/2017	09:33 AM	Dan Petras	EEWF-4C	Outside Room 109	O - Other	08/25/2017	04:00 PM	First Draw	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
60164010261001	01		08/26/2017	09:34 AM	Dan Petras	EES-5A	Nurse Office	S - Sink	08/25/2017	04:00 PM	First Draw	250	Prairie Analytical	EPA 200.8	2.06 ppb	2.00 ppb	
60164010261001	01		08/26/2017	09:35 AM	Dan Petras	EES-5B	Nurse Office	S - Sink	08/25/2017	04:00 PM	Flush	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
60164010261001	01		08/26/2017	09:37 AM	Dan Petras	EEWF-6A	Across From Room 111	WF - Water Cooler	08/25/2017	04:00 PM	First Draw	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
60164010261001	01		08/26/2017	09:38 AM	Dan Petras	EEWF-6B	Across From Room 111	WF - Water Cooler	08/25/2017	04:00 PM	Flush	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
60164010261001	01		08/26/2017	09:39 AM	Dan Petras	EEWF-6C	Across From Room 111	O - Other	08/25/2017	04:00 PM	First Draw	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
60164010261001	01		08/26/2017	09:45 AM	Dan Petras	EEKS-7A	West Side In The Kitchen	KS - Kitchen Sink	08/25/2017	04:00 PM	First Draw	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
60164010261001	01		08/26/2017	09:46 AM	Dan Petras	EEKS-7B	West Side In The Kitchen	KS - Kitchen Sink	08/25/2017	04:00 PM	Flush	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
60164010261001	01		08/26/2017	09:47 AM	Dan Petras	EEKS-8A	South Side In The Kitchen	KS - Kitchen Sink	08/25/2017	04:00 PM	First Draw	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
60164010261001	01		08/26/2017	09:48 AM	Dan Petras	EEKS-8B	South Side In The Kitchen	KS - Kitchen Sink	08/25/2017	04:00 PM	Flush	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
60164010261001	01		08/26/2017	09:49 AM	Dan Petras	EEKS-9A	East Side In The Kitchen	KS - Kitchen Sink	08/25/2017	04:00 PM	First Draw	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
60164010261001	01		08/26/2017	09:50 AM	Dan Petras	EEKS-9B	East Side In The Kitchen	KS - Kitchen Sink	08/25/2017	04:00 PM	Flush	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
60164010261001	01		08/26/2017	09:51 AM	Dan Petras	EELM-10	North Side In The Kitchen	IM - Ice Machine	08/25/2017	04:00 PM	First Draw	250	Prairie Analytical	EPA 200.8	ND	2.00 ppb	
60164010261001	01		08/26/2017	09:59 AM	Dan Petras	EELI-11	Pump Room	O - Other	08/25/2017	04:00 PM	Flush	250	Prairie Analytical	EPA 200.8	3.42 ppb	2.00 ppb	

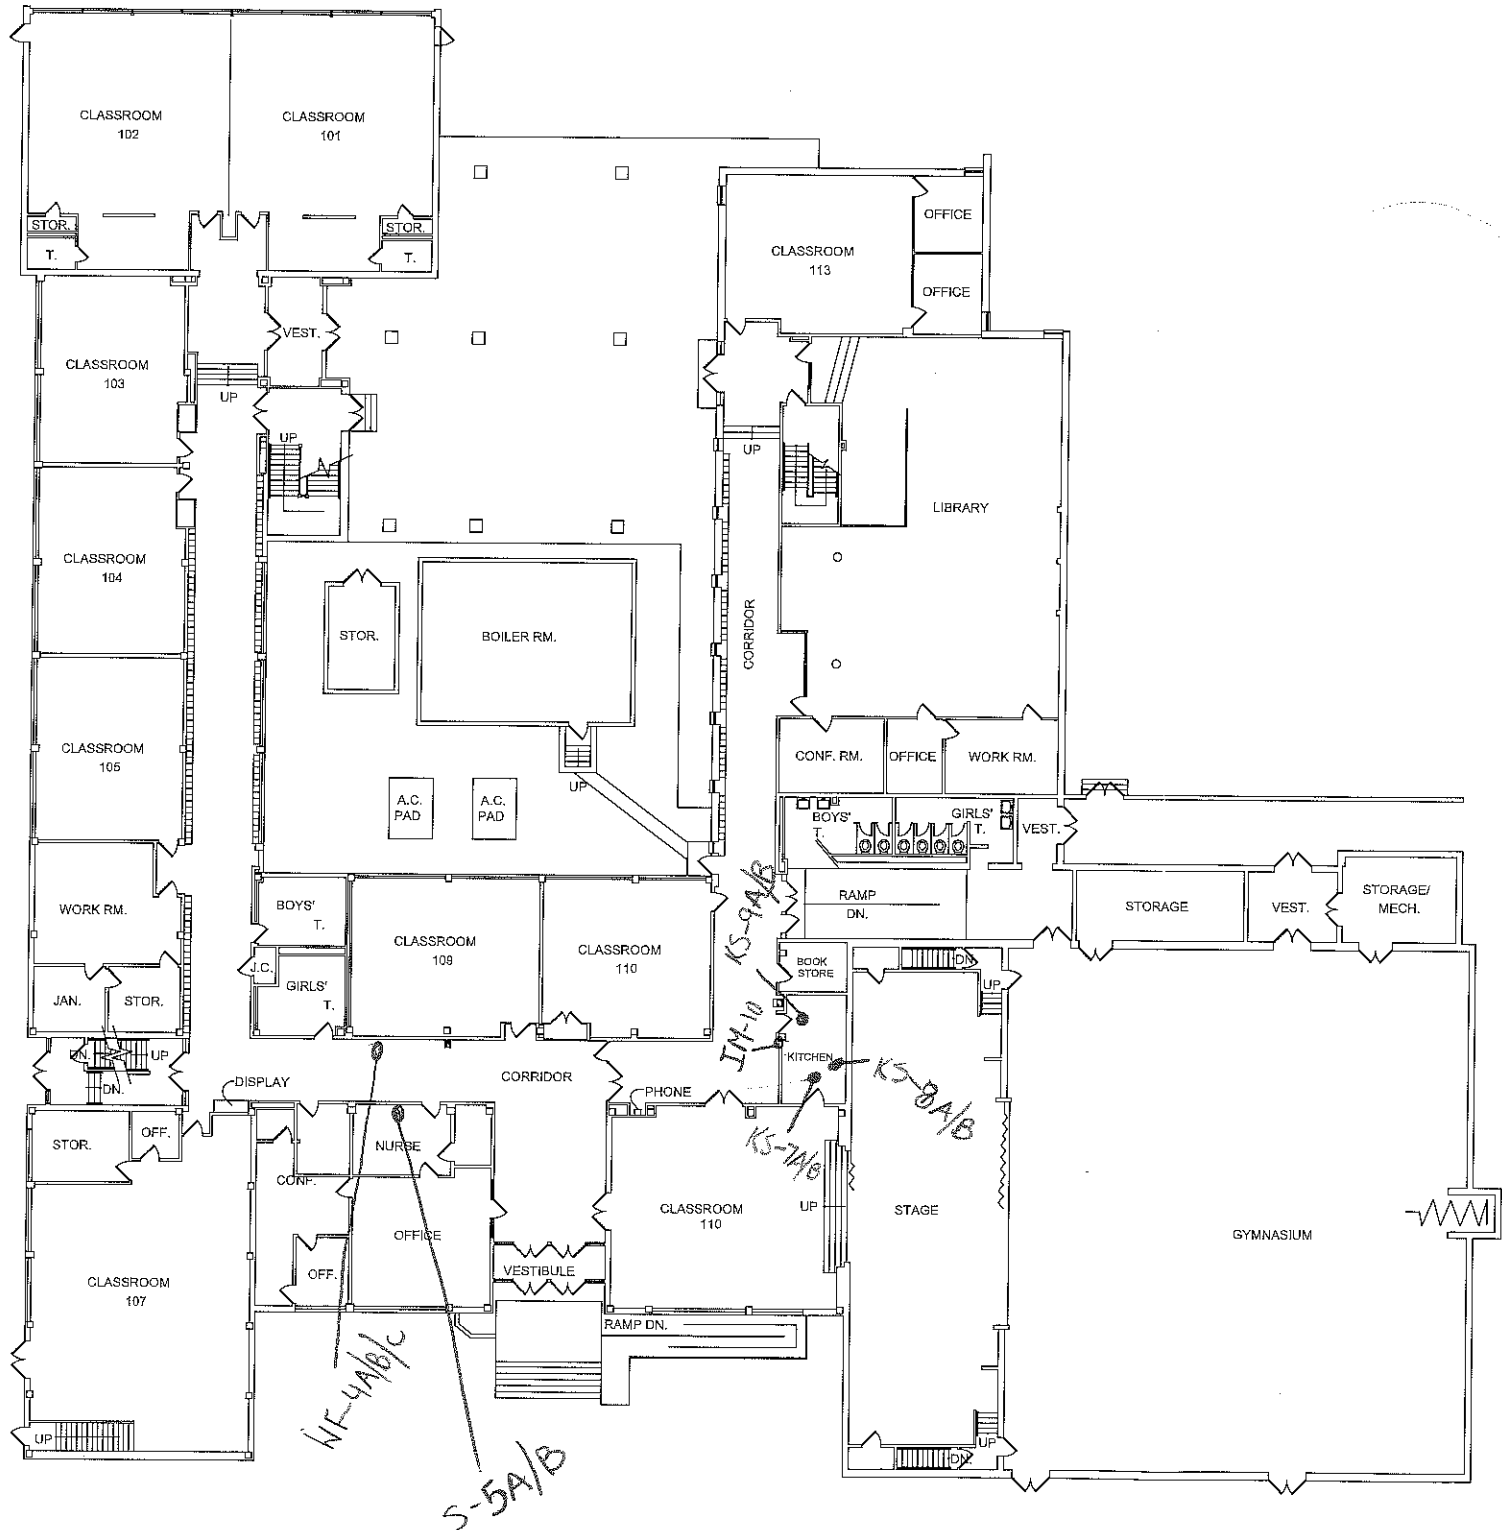


ELMWOOD ELEMENTARY SCHOOL
FIRST FLOOR PLAN

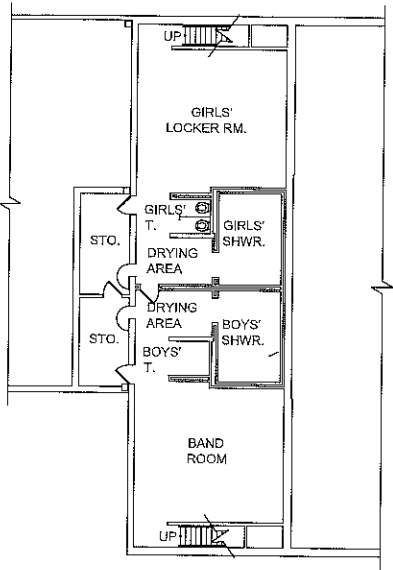

ELMWOOD ELEMENTARY SCHOOL
BASEMENT PLAN



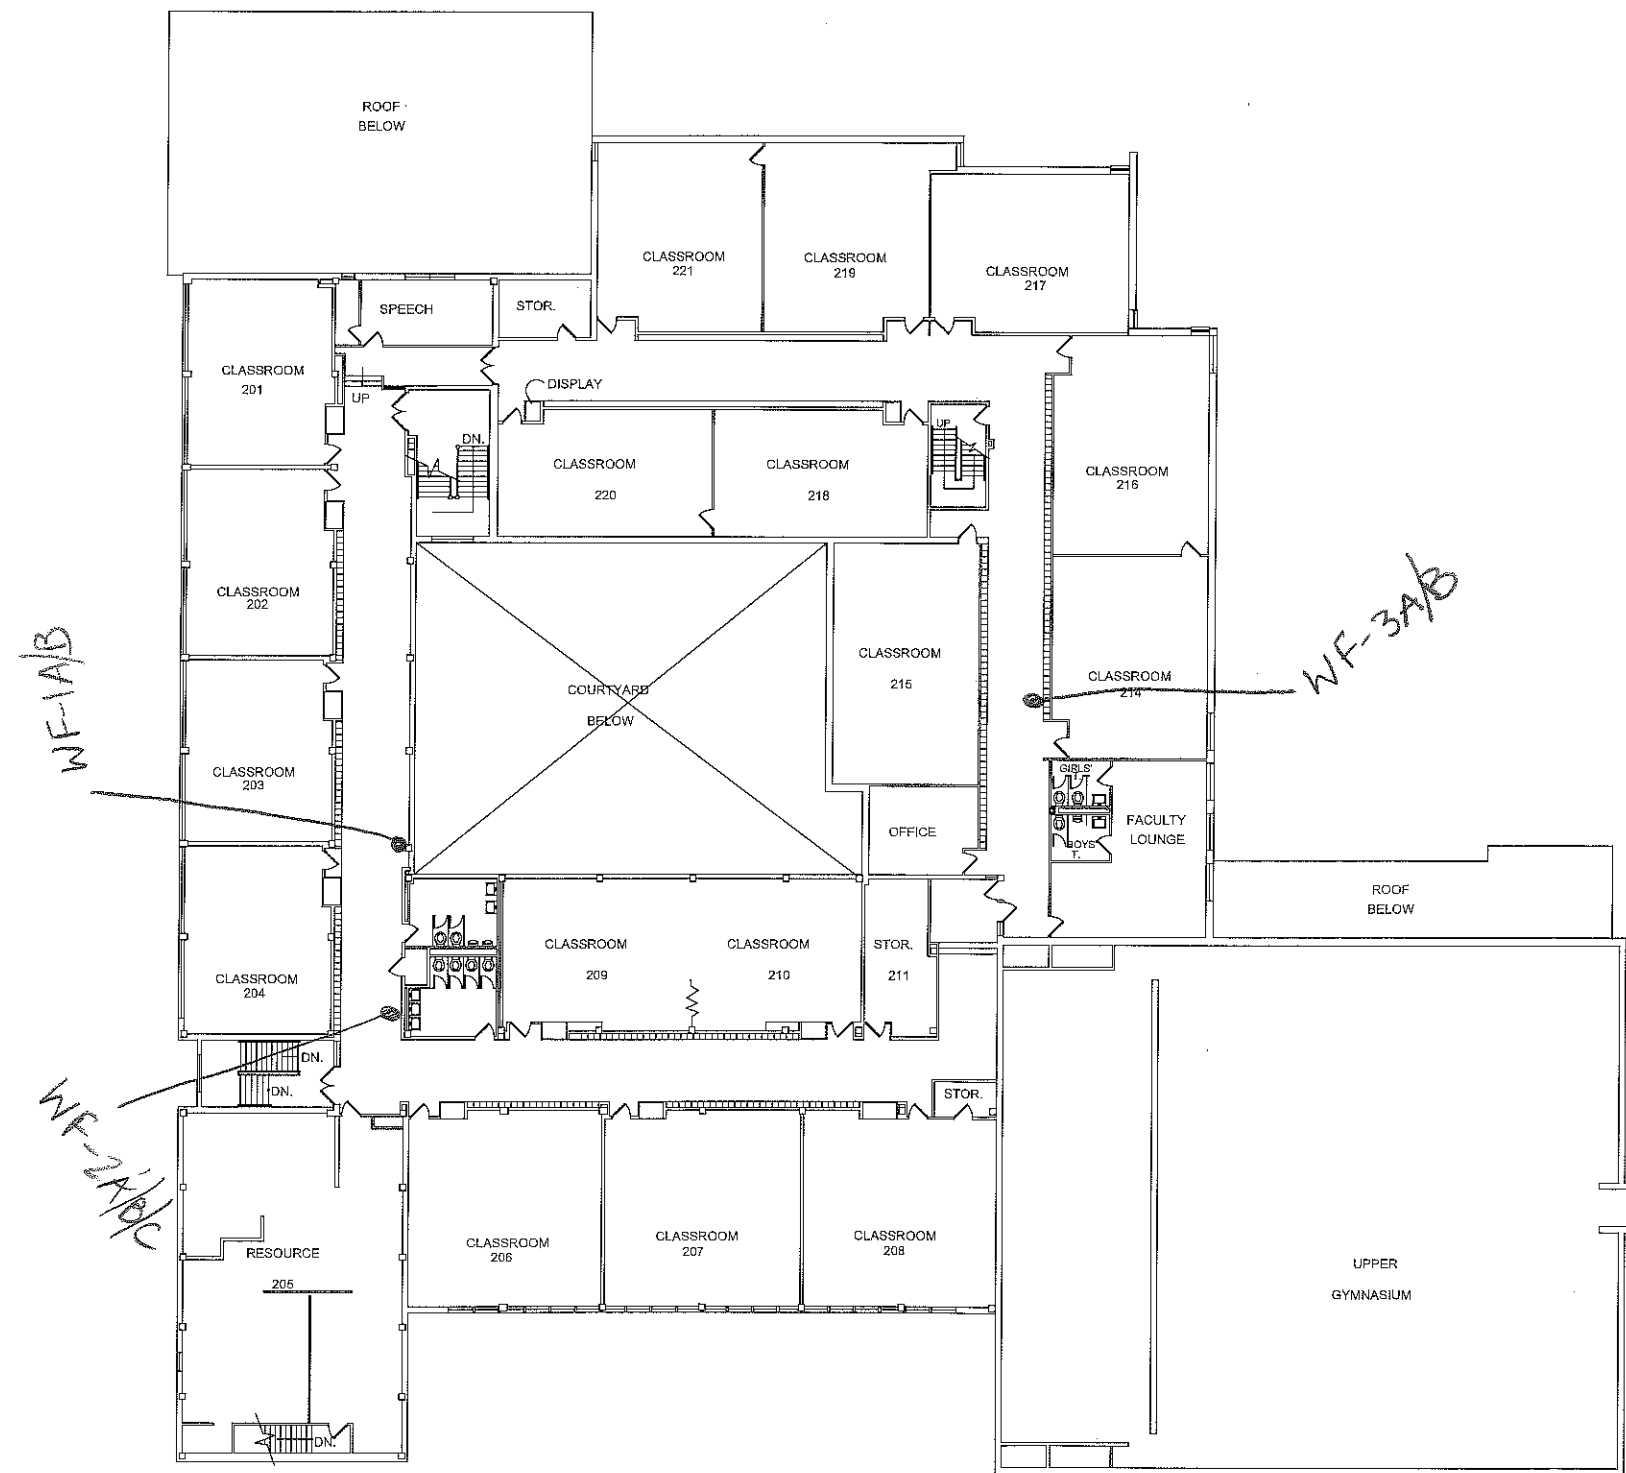

**ELMWOOD ELEMENTARY SCHOOL
SECOND FLOOR PLAN**





Thursday, September 14, 2017

Geoff Bacci II
Aires Consulting Group
1550 Hubbard Ave.
Batavia, IL 60510
TEL: (630) 879-3006
FAX: (630) 879-3014

RE: 17-18289 Elmwood Elementary School

PAS WO: 17H0721

Prairie Analytical Systems, Inc. received 23 sample(s) on 8/28/2017 for the analyses presented in the following report.

All applicable quality control procedures met method specific acceptance criteria unless otherwise noted.

This report shall not be reproduced, except in full, without the prior written consent of Prairie Analytical Systems, Inc.

If you have any questions, please feel free to contact me at (224) 253-1348.

Respectfully submitted,

A handwritten signature in black ink, appearing to read "Christina E. Pierce".

Christina E. Pierce
Project Manager

Certifications: NELAP/NELAC - IL #100323

1210 Capital Airport Drive	*	Springfield, IL 62707	*	1.217.753.1148	*	1.217.753.1152 Fax
9114 Virginia Road Suite #112	*	Lake in the Hills, IL 60156	*	1.847.651.2604	*	1.847.458.0538 Fax

Prairie Analytical Systems, Inc.

Date: 9/14/2017

LABORATORY RESULTS

Client: Aires Consulting Group
Project: 17-18289 Elmwood Elementary School
Client Sample ID: EEWf-1A
Collection Date: 8/26/17 9:20

Lab Order: 17H0721
Lab ID: 17H0721-01
Matrix: Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
Metals by ICP-MS									
*Lead	U	2.00		µg/L	1	9/11/17 11:16	9/11/17 14:57	EPA200.8	KSH

Client Sample ID: EEWf-1B
Collection Date: 8/26/17 9:21

Lab ID: 17H0721-02
Matrix: Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
Metals by ICP-MS									
*Lead	U	2.00		µg/L	1	9/11/17 11:16	9/11/17 14:57	EPA200.8	KSH

Client Sample ID: EEWf-2A
Collection Date: 8/26/17 9:23

Lab ID: 17H0721-03
Matrix: Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
Metals by ICP-MS									
*Lead	U	2.00		µg/L	1	9/11/17 11:16	9/11/17 14:57	EPA200.8	KSH

Client Sample ID: EEWf-2B
Collection Date: 8/26/17 9:24

Lab ID: 17H0721-04
Matrix: Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
Metals by ICP-MS									
*Lead	U	2.00		µg/L	1	9/11/17 11:16	9/11/17 14:57	EPA200.8	KSH

Client Sample ID: EEWf-2C
Collection Date: 8/26/17 9:25

Lab ID: 17H0721-05
Matrix: Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
Metals by ICP-MS									
*Lead	U	2.00		µg/L	1	9/11/17 11:16	9/11/17 14:57	EPA200.8	KSH

Client Sample ID: EEWf-3A
Collection Date: 8/26/17 9:26

Lab ID: 17H0721-06
Matrix: Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
Metals by ICP-MS									
*Lead	U	2.00		µg/L	1	9/11/17 11:16	9/11/17 14:57	EPA200.8	KSH

Client Sample ID: EEWf-3B
Collection Date: 8/26/17 9:27

Lab ID: 17H0721-07
Matrix: Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
Metals by ICP-MS									
*Lead	U	2.00		µg/L	1	9/11/17 11:16	9/11/17 14:57	EPA200.8	KSH

Prairie Analytical Systems, Inc.

Date: 9/14/2017

LABORATORY RESULTS

Client:	Aires Consulting Group					Lab Order:	17H0721				
Project:	17-18289 Elmwood Elementary School										
Client Sample ID:	EEWF-4A					Lab ID:	17H0721-08				
Collection Date:	8/26/17 9:31					Matrix:	Drinking Water				
Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst		
Metals by ICP-MS											
*Lead	U	2.00		µg/L	1	9/11/17 11:16	9/11/17 14:57	EPA200.8	KSH		
Client Sample ID:	EEWF-4B					Lab ID:	17H0721-09				
Collection Date:	8/26/17 9:32					Matrix:	Drinking Water				
Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst		
Metals by ICP-MS											
*Lead	U	2.00		µg/L	1	9/11/17 11:16	9/11/17 14:57	EPA200.8	KSH		
Client Sample ID:	EEWF-4C					Lab ID:	17H0721-10				
Collection Date:	8/26/17 9:33					Matrix:	Drinking Water				
Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst		
Metals by ICP-MS											
*Lead	U	2.00		µg/L	1	9/11/17 11:16	9/11/17 14:57	EPA200.8	KSH		
Client Sample ID:	EES-5A					Lab ID:	17H0721-11				
Collection Date:	8/26/17 9:34					Matrix:	Drinking Water				
Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst		
Metals by ICP-MS											
*Lead	2.06	2.00		µg/L	1	9/11/17 11:16	9/11/17 14:57	EPA200.8	KSH		
Client Sample ID:	EES-5B					Lab ID:	17H0721-12				
Collection Date:	8/26/17 9:35					Matrix:	Drinking Water				
Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst		
Metals by ICP-MS											
*Lead	U	2.00		µg/L	1	9/11/17 11:16	9/11/17 14:57	EPA200.8	KSH		
Client Sample ID:	EEWF-6A					Lab ID:	17H0721-13				
Collection Date:	8/26/17 9:37					Matrix:	Drinking Water				
Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst		
Metals by ICP-MS											
*Lead	U	2.00		µg/L	1	9/11/17 11:16	9/11/17 14:57	EPA200.8	KSH		
Client Sample ID:	EEWF-6B					Lab ID:	17H0721-14				
Collection Date:	8/26/17 9:38					Matrix:	Drinking Water				
Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst		
Metals by ICP-MS											
*Lead	U	2.00		µg/L	1	9/11/17 11:16	9/11/17 14:57	EPA200.8	KSH		

Prairie Analytical Systems, Inc.

Date: 9/14/2017

LABORATORY RESULTS

Client: Aires Consulting Group
Project: 17-18289 Elmwood Elementary School
Client Sample ID: EEWf-6B
Collection Date: 8/26/17 9:38

Lab Order: 17H0721
Lab ID: 17H0721-14
Matrix: Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
----------	--------	-------	------	-------	----	---------------	---------------	--------	---------

Client Sample ID: EEWf-6C
Collection Date: 8/26/17 9:39

Lab ID: 17H0721-15
Matrix: Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
----------	--------	-------	------	-------	----	---------------	---------------	--------	---------

Metals by ICP-MS

*Lead	U	2.00		µg/L	1	9/11/17 11:16	9/11/17 14:57	EPA200.8	KSH
-------	---	------	--	------	---	---------------	---------------	----------	-----

Client Sample ID: EEKS-7A
Collection Date: 8/26/17 9:45

Lab ID: 17H0721-16
Matrix: Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
----------	--------	-------	------	-------	----	---------------	---------------	--------	---------

Metals by ICP-MS

*Lead	U	2.00		µg/L	1	9/11/17 11:16	9/11/17 14:57	EPA200.8	KSH
-------	---	------	--	------	---	---------------	---------------	----------	-----

Client Sample ID: EEKS-7B
Collection Date: 8/26/17 9:46

Lab ID: 17H0721-17
Matrix: Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
----------	--------	-------	------	-------	----	---------------	---------------	--------	---------

Metals by ICP-MS

*Lead	U	2.00		µg/L	1	9/11/17 11:16	9/11/17 14:57	EPA200.8	KSH
-------	---	------	--	------	---	---------------	---------------	----------	-----

Client Sample ID: EEKS-8A
Collection Date: 8/26/17 9:47

Lab ID: 17H0721-18
Matrix: Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
----------	--------	-------	------	-------	----	---------------	---------------	--------	---------

Metals by ICP-MS

*Lead	U	2.00		µg/L	1	9/11/17 11:16	9/11/17 14:57	EPA200.8	KSH
-------	---	------	--	------	---	---------------	---------------	----------	-----

Client Sample ID: EEKS-8B
Collection Date: 8/26/17 9:48

Lab ID: 17H0721-19
Matrix: Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
----------	--------	-------	------	-------	----	---------------	---------------	--------	---------

Metals by ICP-MS

*Lead	U	2.00		µg/L	1	9/11/17 11:16	9/11/17 14:57	EPA200.8	KSH
-------	---	------	--	------	---	---------------	---------------	----------	-----

Client Sample ID: EEKS-9A
Collection Date: 8/26/17 9:49

Lab ID: 17H0721-20
Matrix: Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
----------	--------	-------	------	-------	----	---------------	---------------	--------	---------

Metals by ICP-MS

*Lead	U	2.00		µg/L	1	9/11/17 11:16	9/11/17 14:57	EPA200.8	KSH
-------	---	------	--	------	---	---------------	---------------	----------	-----

Prairie Analytical Systems, Inc.

Date: 9/14/2017

LABORATORY RESULTS

Client: Aires Consulting Group
Project: 17-18289 Elmwood Elementary School
Client Sample ID: EEKS-9B
Collection Date: 8/26/17 9:50

Lab Order: 17H0721
Lab ID: 17H0721-21
Matrix: Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
Metals by ICP-MS									
*Lead	U	2.00		µg/L	1	9/11/17 11:16	9/11/17 16:55	EPA200.8	KSH

Client Sample ID: EEIM-10
Collection Date: 8/26/17 9:51

Lab ID: 17H0721-22
Matrix: Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
Metals by ICP-MS									
*Lead	U	2.00		µg/L	1	9/11/17 11:16	9/11/17 16:55	EPA200.8	KSH

Client Sample ID: EEI-11
Collection Date: 8/26/17 9:59

Lab ID: 17H0721-23
Matrix: Drinking Water

Analyses	Result	Limit	Qual	Units	DF	Date Prepared	Date Analyzed	Method	Analyst
Metals by ICP-MS									
*Lead	3.42	2.00		µg/L	1	9/11/17 11:16	9/11/17 16:55	EPA200.8	KSH
Conventional Chemistry Parameters									
pH	8.04	0.0100		pH Units	1	8/26/17 9:59	8/26/17 9:59	EPA150.1	

Prairie Analytical Systems, Inc.

Date: 9/14/2017

LABORATORY RESULTS

Client: Aires Consulting Group

Project: 17-18289 Elmwood Elementary School

Lab Order: 17H0721

Metals by ICP-MS - Quality Control

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	-----------------	-------	-------------	---------------	------	-------------	-----	-----------	-------

Batch A005468 - EPA 200.8 Metals

Blank (A005468-BLK1)

Prepared & Analyzed: 09/11/201

Lead	U	2.00	µg/L
------	---	------	------

LCS (A005468-BS1)

Prepared & Analyzed: 09/11/201

Lead	447	2.00	µg/L	500.00	89	85-115
------	-----	------	------	--------	----	--------

Matrix Spike (A005468-MS1)

Source: 17H0721-01

Prepared & Analyzed: 09/11/201

Lead	514	2.00	µg/L	500.00	0.110	103	75-125
------	-----	------	------	--------	-------	-----	--------

Matrix Spike (A005468-MS2)

Source: 17H0721-11

Prepared & Analyzed: 09/11/201

Lead	485	2.00	µg/L	500.00	2.06	97	75-125
------	-----	------	------	--------	------	----	--------

Matrix Spike Dup (A005468-MSD1)

Source: 17H0721-01

Prepared & Analyzed: 09/11/201

Lead	500	2.00	µg/L	500.00	0.110	100	75-125	3	20
------	-----	------	------	--------	-------	-----	--------	---	----

Matrix Spike Dup (A005468-MSD2)

Source: 17H0721-11

Prepared & Analyzed: 09/11/201

Lead	508	2.00	µg/L	500.00	2.06	101	75-125	5	20
------	-----	------	------	--------	------	-----	--------	---	----

Batch A005469 - EPA 200.8 Metals

Blank (A005469-BLK1)

Prepared & Analyzed: 09/11/201

Lead	U	2.00	µg/L
------	---	------	------

LCS (A005469-BS1)

Prepared & Analyzed: 09/11/201

Lead	465	2.00	µg/L	500.00	93	85-115
------	-----	------	------	--------	----	--------

Matrix Spike (A005469-MS1)

Source: 17H0721-21

Prepared & Analyzed: 09/11/201

Lead	517	2.00	µg/L	500.00	0.140	103	75-125
------	-----	------	------	--------	-------	-----	--------

Prairie Analytical Systems, Inc.

Date: 9/14/2017

LABORATORY RESULTS

Client: Aires Consulting Group

Project: 17-18289 Elmwood Elementary School

Lab Order: 17H0721

Metals by ICP-MS - Quality Control

Analyte	Result	Reporting Limit	Units	Spike Level	Source Result	%REC	%REC Limits	RPD	RPD Limit	Notes
---------	--------	--------------------	-------	----------------	------------------	------	----------------	-----	--------------	-------

Batch A005469 - EPA 200.8 Metals

Matrix Spike (A005469-MS2) Source: 17H0722-08 Prepared & Analyzed: 09/11/201

Lead	529	2.00	µg/L	500.00	0.210	106	75-125			
------	-----	------	------	--------	-------	-----	--------	--	--	--

Matrix Spike Dup (A005469-MSD1) Source: 17H0721-21 Prepared & Analyzed: 09/11/201

Lead	521	2.00	µg/L	500.00	0.140	104	75-125	0.6	20	
------	-----	------	------	--------	-------	-----	--------	-----	----	--

Matrix Spike Dup (A005469-MSD2) Source: 17H0722-08 Prepared & Analyzed: 09/11/201

Lead	486	2.00	µg/L	500.00	0.210	97	75-125	9	20	
------	-----	------	------	--------	-------	----	--------	---	----	--

Prairie Analytical Systems, Inc.

Date: 9/14/2017

LABORATORY RESULTS

Client: Aires Consulting Group**Project:** 17-18289 Elmwood Elementary School**Lab Order:** 17H0721

Notes and Definitions

* NELAC certified compound.

U Analyte not detected (i.e. less than RL or MDL).

Prairie

Analytical
Systems, INCORPORATED

www.prairieanalytical.com

Analytical
Systems, INCORPORATED
www.prairieanalytical.com

[illegible]

ISBE ID: _____
Building ID: _____
Building Description: Elmwood Elementary School
Sample Collection Date: 8/26/2017
Collected by: Dan Petras

Sample Time (12 HR Clock)	Sample ID Number	Sample Location Description	Fixture Type	Date of Last Use	Time of Last Use (12 HR Clock)	Sample Type	Sample Volume (mL)	Notes
9:20 AM	✓ EEW-1A	Across from room 204	DF - Drinking Fountain	8/25/2017	4:00 PM	First Draw	250	
9:21 AM	✓ EEW-1B	Across from room 204	DF - Drinking Fountain	8/25/2017	4:00 PM	Flush	250	
9:23 AM	✓ EEW-2A	Adjacent room 205	WF - Water Cooler	8/25/2017	4:00 PM	First Draw	250	
9:24 AM	✓ EEW-2B	Adjacent room 205	WF - Water Cooler	8/25/2017	4:00 PM	Flush	250	
9:25 AM	✓ EEW-2C	Adjacent room 205	O - Other	8/25/2017	4:00 PM	First Draw	250	bottle fill
9:26 AM	✓ EEW-3A	Outside room 214	DF - Drinking Fountain	8/25/2017	4:00 PM	First Draw	250	
9:27 AM	✓ EEW-3B	Outside room 214	DF - Drinking Fountain	8/25/2017	4:00 PM	Flush	250	
9:31 AM	✓ EEW-4A	Outside room 109	WF - Water Cooler	8/25/2017	4:00 PM	First Draw	250	
9:32 AM	✓ EEW-4B	Outside room 109	WF - Water Cooler	8/25/2017	4:00 PM	Flush	250	
9:33 AM	✓ EEW-4C	Outside room 109	O - Other	8/25/2017	4:00 PM	First Draw	250	bottle fill
9:34 AM	✓ EES-5A	Nurse's office	S - Sink	8/25/2017	4:00 PM	First Draw	250	
9:35 AM	✓ EES-5B	Nurse's office	S - Sink	8/25/2017	4:00 PM	Flush	250	
9:37 AM	✓ EEW-6A	Across from room 111	WF - Water Cooler	8/25/2017	4:00 PM	First Draw	250	
9:38 AM	✓ EEW-6B	Across from room 111	WF - Water Cooler	8/25/2017	4:00 PM	Flush	250	
9:39 AM	✓ EEW-6C	Across from room 111	O - Other	8/25/2017	4:00 PM	First Draw	250	bottle fill
9:45 AM	✓ EES-7A	West side in kitchen	KS - Kitchen Sink	8/25/2017	4:00 PM	First Draw	250	
9:46 AM	✓ EES-7B	West side in kitchen	KS - Kitchen Sink	8/25/2017	4:00 PM	Flush	250	
9:47 AM	✓ EES-8A	South side in kitchen	KS - Kitchen Sink	8/25/2017	4:00 PM	First Draw	250	
9:48 AM	✓ EES-8B	South side in kitchen	KS - Kitchen Sink	8/25/2017	4:00 PM	Flush	250	
9:49 AM	✓ EES-9A	East side in kitchen	KS - Kitchen Sink	8/25/2017	4:00 PM	First Draw	250	
9:50 AM	✓ EES-9B	East side in kitchen	KS - Kitchen Sink	8/25/2017	4:00 PM	Flush	250	
9:51 AM	✓ EEIM-10	North side in kitchen	IM - Ice Machine	8/25/2017	4:00 PM	First Draw	250	

ISBE ID:

Building ID:

Building Description:

Sample Collection Date: _____

Collected by:

Elmwood Elementary School

8/26/2017

Dan Petras

[illegible]