

J.C. Broderick & Associates, Inc.

Environmental / Construction Consulting & Testing



March 26, 2021

Mr. Dennis Warsaw
Facilities Manager
Miller Place Union Free School District
7 Memorial Drive
Miller Place, New York 11764

Re: **Lead Testing in School Drinking Water**
2020 Compliance 10 NYCRR Subpart 67-4
Sampling Dates: January 26, 2021 – February 24, 2021

JCB#: **18-41685**

Dear Mr. Warsaw:

J.C. Broderick & Associates, Inc. (JCB) was retained to perform lead testing and analysis of the outlets which service the above referenced school district in accordance with 10 NYCRR Subpart 67-4 (Subpart 67-4).

The outlets servicing each of the school buildings were inventoried and assigned unique identification numbers. The use and location of each outlet was reviewed to determine its applicability for testing under Subpart 67-4.

An initial first-draw sample was collected from each applicable outlet after the minimum 8-hour stagnation period. Samples were logged into a chain of custody document and delivered to an Environmental Laboratory Approval Program (ELAP) accredited laboratory for analysis.

Results from the laboratory analysis were compared with the Action Level as defined by Subpart 67-4 of 15 parts per billion (ppb). Any outlet which exceeded this level requires a remediation action plan be implemented (i.e. removal from service, placarding for non-drinking uses). Outlets which did not exceed the action level do not require further testing or remediation.

Please see the following attachments which detail the sampling and analysis performed and remediation actions taken to date.

Attachment 1: Lead Testing Results for Applicable Outlets
Attachment 2: Laboratory Analytical Reports
Attachment 3: Laboratory Certifications

If you have any questions, or if more information is needed, please contact our office.


Sincerely,

A handwritten signature in black ink, appearing to read "Bryan Ezelius", is written over a horizontal line.

Bryan Ezelius
Project Manager
J C Broderick & Associates, Inc.

Attachment 1:

Lead Testing Results
for Applicable Outlets

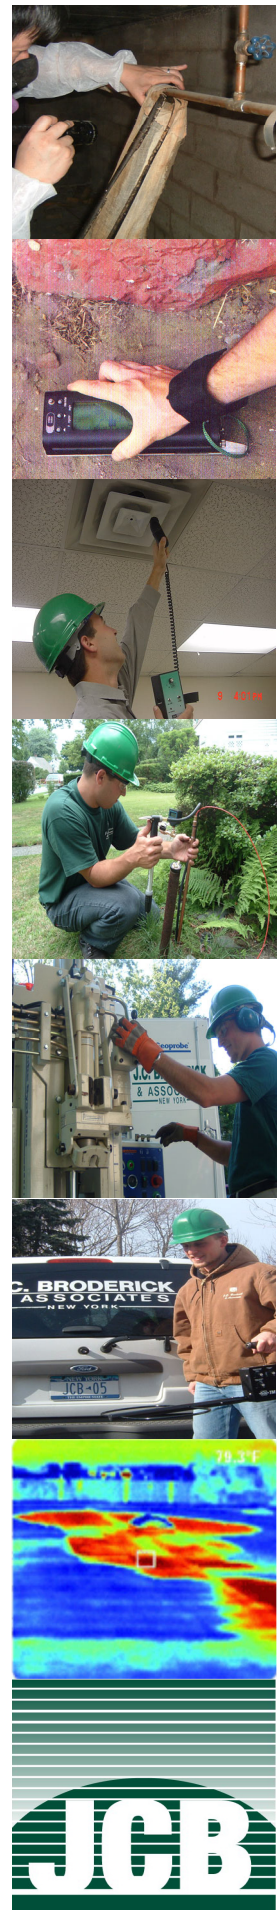

J.C. Broderick & Associates, Inc.

Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395





Laboratory Lead in Water Results

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 18-41685

Miller Place Union Free School District

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
---------------	----------	------------------	-------------	----------------------	-------------	--------------	------------------------------------

Administration Building

MILL-0668	N/A	Office Kitchen	Bottle Fill Station	Potable	2/24/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0669	N/A	Office Kitchen	Water Cooler	Potable	2/24/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0670	N/A	Office Kitchen	Water Cooler	Potable	2/24/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0671	N/A	Office Kitchen	Kitchen Faucet (Cold)	Potable	2/24/2021	<3.0 ND	Result Below Action Level Continue O&M

Andrew Muller Primary School

MILL-0425	1-01	Custodial Office	Hand Wash Only	Non-Potable	2/10/2021	1.2	Result Below Action Level Continue O&M
MILL-0426	1-01	Custodial Office	Bottle Fill Station	Potable		OOS	Testing Required Before Return to Service
MILL-0427	1-09	Kitchen	Hand Wash Only	Non-Potable	2/10/2021	5.1	Result Below Action Level Continue O&M
MILL-0428	1-09	Kitchen	Kitchen Faucet (Cold)	Potable	2/10/2021	1.2	Result Below Action Level Continue O&M
MILL-0429	1-09	Kitchen	Kitchen Faucet (Cold)	Potable	2/10/2021	7.2	Result Below Action Level Continue O&M
MILL-0430	1-09	Kitchen	Spray Nozzle	Non-Potable	2/10/2021	4.4	Result Below Action Level Continue O&M
MILL-0431	1-09	Kitchen	Kitchen Faucet (Cold)	Potable	2/10/2021	<3.0 ND	Result Below Action Level Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
MILL-0432	1-09	Kitchen	Hand Wash Only	Non-Potable	2/10/2021	1.2	Result Below Action Level Continue O&M
MILL-0433	1-09A	Kitchen Locker Rooms	Bathroom Faucet	Non-Potable	2/10/2021	59	Placarded for Non-Drinking Use Until Remediated
MILL-0434	1-09A	Kitchen Locker Rooms	Bathroom Faucet	Non-Potable	2/10/2021	12	Result Below Action Level Continue O&M
MILL-0437	1-05	Staff Bathroom	Bathroom Faucet	Non-Potable	2/10/2021	1.2	Result Below Action Level Continue O&M
MILL-0438	1-07	Staff Lounge	Bottle Fill Station	Potable	2/10/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0439	1-07	Staff Lounge	Kitchen Faucet (Cold)	Potable	2/10/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0440	1-07	Staff Lounge	Spray Nozzle	Non-Potable	2/10/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0441	1-10A	Coach's Office	Water Fountain-No Chiller	Potable		OOS	Testing Required Before Return to Service
MILL-0442	1-12	Music Room	Classroom Faucet	Non-Potable	2/10/2021	2.3	Result Below Action Level Continue O&M
MILL-0443	1-12	Music Room	Water Fountain-No Chiller	Potable	2/10/2021	1.6	Result Below Action Level Continue O&M
MILL-0444	1-08	Fount. by Music Room	Water Fountain-No Chiller	Potable	2/10/2021	2.5	Result Below Action Level Continue O&M
MILL-0445	1-13	Room 2	Classroom Faucet	Non-Potable	2/10/2021	2.4	Result Below Action Level Continue O&M
MILL-0446	1-13	Room 2	Water Fountain-No Chiller	Potable	2/10/2021	6.6	Result Below Action Level Continue O&M
MILL-0447	1-14	Room 3	Classroom Faucet	Non-Potable	2/10/2021	1.6	Result Below Action Level Continue O&M
MILL-0448	1-14	Room 3	Water Fountain-No Chiller	Potable	2/10/2021	4.4	Result Below Action Level Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
MILL-0449	1-11	Stage	Classroom Faucet	Non-Potable	2/10/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0450	1-11	Stage	Spray Nozzle	Non-Potable	2/10/2021	4.9	Result Below Action Level Continue O&M
MILL-0451	1-15	Room 4	Classroom Faucet	Non-Potable	2/10/2021	4.2	Result Below Action Level Continue O&M
MILL-0452	1-15	Room 4	Water Fountain-No Chiller	Potable	2/10/2021	5.1	Result Below Action Level Continue O&M
MILL-0453	1-16	Bathroom	Bathroom Faucet	Non-Potable	2/10/2021	11	Result Below Action Level Continue O&M
MILL-0454	1-17	Women's Bathroom	Bathroom Faucet	Non-Potable	2/10/2021	1	Result Below Action Level Continue O&M
MILL-0455	1-17	Women's Bathroom	Bathroom Faucet	Non-Potable	2/10/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0457	1-62A	Nurse's Office	Nurse's Office Sink	Non-Potable	2/10/2021	3.1	Result Below Action Level Continue O&M
MILL-0458	1-62C	Nurse's Bathroom	Bathroom Faucet	Non-Potable	2/10/2021	1.7	Result Below Action Level Continue O&M
MILL-0459	1-57	Room 5	Classroom Faucet	Non-Potable	2/10/2021	1.6	Result Below Action Level Continue O&M
MILL-0460	1-57	Room 5	Water Fountain-No Chiller	Potable		OOS	Testing Required Before Return to Service
MILL-0461	1-62	Fountain by library	Water Fountain-No Chiller	Potable	2/10/2021	2.3	Result Below Action Level Continue O&M
MILL-0462	1-46	Library	Kitchen Faucet (Cold)	Potable	2/10/2021	4.8	Result Below Action Level Continue O&M
MILL-0463	1-55	Room 6	Classroom Faucet	Non-Potable	2/10/2021	1.8	Result Below Action Level Continue O&M
MILL-0464	1-55	Room 6	Water Fountain-No Chiller	Potable	2/10/2021	6.8	Result Below Action Level Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
MILL-0465	1-54	Room 9	Classroom Faucet	Non-Potable	2/10/2021	2.6	Result Below Action Level Continue O&M
MILL-0466	1-54	Room 9	Water Fountain-No Chiller	Potable	2/10/2021	2	Result Below Action Level Continue O&M
MILL-0467	1-53	Room 10	Classroom Faucet	Non-Potable	2/10/2021	1	Result Below Action Level Continue O&M
MILL-0468	1-53	Room 10	Water Fountain-No Chiller	Potable		OOS	Testing Required Before Return to Service
MILL-0469	1-52	Room 11	Classroom Faucet	Non-Potable	2/10/2021	1	Result Below Action Level Continue O&M
MILL-0470	1-52	Room 11	Water Fountain-No Chiller	Potable		OOS	Testing Required Before Return to Service
MILL-0472	1-50	Room 12	Classroom Faucet	Non-Potable	2/10/2021	1.4	Result Below Action Level Continue O&M
MILL-0473	1-50	Room 12	Water Fountain-No Chiller	Potable	2/10/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0474	1-49	Room 12A	Classroom Faucet	Non-Potable	2/10/2021	1.3	Result Below Action Level Continue O&M
MILL-0475	1-49	Room 12A	Water Fountain-No Chiller	Potable		OOS	Testing Required Before Return to Service
MILL-0476	1-48	Room 14	Classroom Faucet	Non-Potable	2/10/2021	1.1	Result Below Action Level Continue O&M
MILL-0477	1-48	Room 14	Water Fountain-No Chiller	Potable	2/10/2021	2.3	Result Below Action Level Continue O&M
MILL-0478	1-62	Fountain by Room 15	Water Fountain-No Chiller	Potable	2/10/2021	5.3	Result Below Action Level Continue O&M
MILL-0479	1-45	Room 15	Classroom Faucet	Non-Potable	2/10/2021	15	Result Below Action Level Continue O&M
MILL-0480	1-45	Room 15	Water Fountain-No Chiller	Potable	2/10/2021	<3.0 ND	Result Below Action Level Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
MILL-0481	1-44	Room 16	Classroom Faucet	Non-Potable	2/10/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0482	1-44	Room 16	Water Fountain-No Chiller	Potable	2/10/2021	4.7	Result Below Action Level Continue O&M
MILL-0483	1-41	Room 17	Classroom Faucet	Non-Potable	2/10/2021	2.8	Result Below Action Level Continue O&M
MILL-0484	1-41	Room 17	Water Fountain-No Chiller	Potable	2/10/2021	5.0	Result Below Action Level Continue O&M
MILL-0485	1-20	Room 18	Classroom Faucet	Non-Potable	2/10/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0486	1-20	Room 18	Water Fountain-No Chiller	Potable	2/10/2021	3.3	Result Below Action Level Continue O&M
MILL-0487	1-21	Room 19	Classroom Faucet	Non-Potable	2/10/2021	1.6	Result Below Action Level Continue O&M
MILL-0488	1-21	Room 19	Water Fountain-No Chiller	Potable	2/10/2021	3.9	Result Below Action Level Continue O&M
MILL-0489	1-22	Room 20	Classroom Faucet	Non-Potable	2/10/2021	3.1	Result Below Action Level Continue O&M
MILL-0490	1-22	Room 20	Water Fountain-No Chiller	Potable	2/10/2021	1.6	Result Below Action Level Continue O&M
MILL-0491	1-40	Fountain by Room 21	Water Fountain-No Chiller	Potable	2/10/2021	1.2	Result Below Action Level Continue O&M
MILL-0492	1-23	Room 21	Classroom Faucet	Non-Potable	2/10/2021	2.2	Result Below Action Level Continue O&M
MILL-0493	1-23	Room 21	Water Fountain-No Chiller	Potable	2/10/2021	2.8	Result Below Action Level Continue O&M
MILL-0494	1-24	Room 22	Classroom Faucet	Non-Potable	2/10/2021	1.4	Result Below Action Level Continue O&M
MILL-0495	1-24	Room 22	Water Fountain-No Chiller	Potable	2/10/2021	2.2	Result Below Action Level Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
MILL-0496	1-26	Room 23	Classroom Faucet	Non-Potable	2/10/2021	2.1	Result Below Action Level Continue O&M
MILL-0497	1-26	Room 23	Water Fountain-No Chiller	Potable	2/10/2021	3.9	Result Below Action Level Continue O&M
MILL-0498	1-31	Room 25	Classroom Faucet	Non-Potable	2/10/2021	2	Result Below Action Level Continue O&M
MILL-0499	1-31	Room 25	Water Fountain-No Chiller	Potable	2/10/2021	3.8	Result Below Action Level Continue O&M
MILL-0501	1-29	Bathroom	Bathroom Faucet	Non-Potable	2/10/2021	1.2	Result Below Action Level Continue O&M
MILL-0502	1-28	Bathroom	Bathroom Faucet	Non-Potable	2/10/2021	2.3	Result Below Action Level Continue O&M
MILL-0503	1-40	Fountain by Restrooms	Water Fountain-No Chiller	Potable		OOS	Testing Required Before Return to Service
MILL-0504	1-35	Room 26	Classroom Faucet	Non-Potable	2/10/2021	1.6	Result Below Action Level Continue O&M
MILL-0505	1-35	Room 26	Water Fountain-No Chiller	Potable	2/10/2021	4.4	Result Below Action Level Continue O&M
MILL-0506	1-34	Room 31	Classroom Faucet	Non-Potable	2/10/2021	2.2	Result Below Action Level Continue O&M
MILL-0507	1-34	Room 31	Water Fountain-No Chiller	Potable		OOS	Testing Required Before Return to Service
MILL-0508	1-36	Room 27	Classroom Faucet	Non-Potable	2/10/2021	1.6	Result Below Action Level Continue O&M
MILL-0509	1-36	Room 27	Water Fountain-No Chiller	Potable	2/10/2021	2.6	Result Below Action Level Continue O&M
MILL-0510	1-37	Room 30	Classroom Faucet	Non-Potable	2/10/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0511	1-37	Room 30	Water Fountain-No Chiller	Potable	2/10/2021	3.1	Result Below Action Level Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
MILL-0512	1-38	Room 28	Classroom Faucet	Non-Potable	2/10/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0513	1-38	Room 28	Water Fountain-No Chiller	Potable	2/10/2021	2.6	Result Below Action Level Continue O&M
MILL-0514	1-39	Room 29	Classroom Faucet	Non-Potable	2/10/2021	16	Placarded for Non-Drinking Use Until Remediated
MILL-0515	1-39	Room 29	Water Fountain-No Chiller	Potable	2/10/2021	3	Result Below Action Level Continue O&M
MILL-0517	N/A	Faculty Bathroom	Bathroom Faucet	Non-Potable	2/10/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0518	N/A	Room 35	Classroom Faucet	Non-Potable	2/10/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0519	N/A	Room 35	Water Fountain-No Chiller	Potable	2/10/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0521	N/A	Room 38	Classroom Faucet	Non-Potable	2/10/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0522	N/A	Room 38	Water Fountain-No Chiller	Potable	2/10/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0524	N/A	Room 36	Classroom Faucet	Non-Potable	2/10/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0525	N/A	Room 36	Water Fountain-No Chiller	Potable	2/10/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0527	N/A	Room 37	Classroom Faucet	Non-Potable	2/10/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0528	N/A	Room 37	Water Fountain-No Chiller	Potable	2/10/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0530	N/A	Room 40	Classroom Faucet	Non-Potable	2/10/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0531	N/A	Room 40	Water Fountain-No Chiller	Potable		OOS	Testing Required Before Return to Service

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
MILL-0533	N/A	Room 39	Classroom Faucet	Non-Potable	2/10/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0534	N/A	Room 39	Water Fountain-No Chiller	Potable	2/10/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0536	1-59A2	Principal's Bathroom	Bathroom Faucet	Non-Potable	2/10/2021	1.4	Result Below Action Level Continue O&M

Laddie Decker Sound Beach School

MILL-0549	0-62	Kitchen	Hand Wash Only	Non-Potable	2/11/2021	16	Placarded for Non-Drinking Use Until Remediated
MILL-0550	0-62	Kitchen	Pasta Pot/Steam Kettle	Potable	2/11/2021	110	Removed From Service, Pending Remediation
MILL-0551	0-62	Kitchen	Kitchen Faucet (Cold)	Potable	2/11/2021	4.1	Result Below Action Level Continue O&M
MILL-0552	0-62	Kitchen	Kitchen Faucet (Cold)	Potable	2/11/2021	19	Removed From Service, Pending Remediation
MILL-0553	0-62	Kitchen	Kitchen Faucet (Cold)	Potable	2/11/2021	6.4	Result Below Action Level Continue O&M
MILL-0554	0-62	Kitchen	Hand Wash Only	Non-Potable	2/11/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0556	0-62AI	Kitchen BR	Bathroom Faucet	Non-Potable	2/11/2021	51	Placarded for Non-Drinking Use Until Remediated
MILL-0557	0-61	Faculty Dining	Kitchen Faucet (Cold)	Potable	2/11/2021	6.4	Result Below Action Level Continue O&M
MILL-0558	0-61	Faculty Dining	Spray Nozzle	Non-Potable	2/11/2021	3.8	Result Below Action Level Continue O&M
MILL-0559	0-64	Cafeteria	Bottle Fill Station	Potable	2/11/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0560	0-64	Cafeteria	Water Cooler	Potable		OOS	Testing Required Before Return to Service

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
MILL-0561	0-73A	Boiler Room BR	Bathroom Faucet	Non-Potable	2/11/2021	4.5	Result Below Action Level Continue O&M
MILL-0563	0-32	Men's Bathroom	Bathroom Faucet	Non-Potable	2/11/2021	2.5	Result Below Action Level Continue O&M
MILL-0564	0-71	Women's Bathroom	Bathroom Faucet	Non-Potable	2/11/2021	4.2	Result Below Action Level Continue O&M
MILL-0566	0-69	Boy's Bathroom	Bathroom Faucet	Non-Potable	2/11/2021	3.1	Result Below Action Level Continue O&M
MILL-0568	0-74	Outside Elevator	Bottle Fill Station	Potable	2/11/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0569	0-74	Outside Elevator	Water Cooler	Potable		OOS	Testing Required Before Return to Service
MILL-0570	0-68	Girl's Bathroom	Bathroom Faucet	Non-Potable	2/11/2021	3.5	Result Below Action Level Continue O&M
MILL-0575	1-58	Room 102	Classroom Faucet	Non-Potable	2/11/2021	3.4	Result Below Action Level Continue O&M
MILL-0576	1-59	Room 101	Classroom Faucet	Non-Potable	2/11/2021	3.2	Result Below Action Level Continue O&M
MILL-0577	1-56	Room 103	Classroom Faucet	Non-Potable	2/11/2021	4.2	Result Below Action Level Continue O&M
MILL-0578	1-57	Room 104	Classroom Faucet	Non-Potable	2/11/2021	1.1	Result Below Action Level Continue O&M
MILL-0579	1-54	Room 105	Classroom Faucet	Non-Potable	2/11/2021	2.9	Result Below Action Level Continue O&M
MILL-0580	1-55	Room 106	Classroom Faucet	Non-Potable	2/11/2021	4.1	Result Below Action Level Continue O&M
MILL-0582	1-50	Room 109	Classroom Faucet	Non-Potable	2/11/2021	5.4	Result Below Action Level Continue O&M
MILL-0583	1-51	Room 110	Classroom Faucet	Non-Potable	2/11/2021	12	Result Below Action Level Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
MILL-0584	1-48	Room 111	Classroom Faucet	Non-Potable	2/11/2021	4.7	Result Below Action Level Continue O&M
MILL-0585	1-49	Room 112	Classroom Faucet	Non-Potable	2/11/2021	3.5	Result Below Action Level Continue O&M
MILL-0586	1-46	Room 113	Classroom Faucet	Non-Potable	2/11/2021	5.6	Result Below Action Level Continue O&M
MILL-0587	1-47	Room 114	Classroom Faucet	Non-Potable	2/11/2021	11	Result Below Action Level Continue O&M
MILL-0588	1-44	Room 115	Classroom Faucet	Non-Potable	2/11/2021	5.2	Result Below Action Level Continue O&M
MILL-0589	1-45	Room 116	Classroom Faucet	Non-Potable	2/11/2021	8.9	Result Below Action Level Continue O&M
MILL-0590	N/A	Room 125	Classroom Faucet	Non-Potable	2/11/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0591	N/A	Room 125	Water Fountain-No Chiller	Potable	2/11/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0592	N/A	Room 125 Bathroom	Bathroom Faucet	Non-Potable	2/11/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0594	N/A	Room 124	Classroom Faucet	Non-Potable	2/11/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0595	N/A	Room 124	Water Fountain-No Chiller	Potable	2/11/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0596	N/A	Room 124 Bathroom	Bathroom Faucet	Non-Potable	2/11/2021	1.3	Result Below Action Level Continue O&M
MILL-0598	N/A	Room 123	Classroom Faucet	Non-Potable	2/11/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0599	N/A	Room 123	Water Fountain-No Chiller	Potable	2/11/2021	1.2	Result Below Action Level Continue O&M
MILL-0600	N/A	Room 123 Bathroom	Bathroom Faucet	Non-Potable	2/11/2021	1.7	Result Below Action Level Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
MILL-0602	N/A	Room 122	Classroom Faucet	Non-Potable	2/11/2021	1.2	Result Below Action Level Continue O&M
MILL-0603	N/A	Room 122	Water Fountain-No Chiller	Potable	2/11/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0604	N/A	Room 122 Bathroom	Bathroom Faucet	Non-Potable	2/11/2021	1.4	Result Below Action Level Continue O&M
MILL-0606	N/A	Room 121	Classroom Faucet	Non-Potable	2/11/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0607	N/A	Room 121	Water Fountain-No Chiller	Potable	2/11/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0608	N/A	Room 121 Bathroom	Bathroom Faucet	Non-Potable	2/11/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0610	N/A	Room 120	Classroom Faucet	Non-Potable	2/11/2021	1	Result Below Action Level Continue O&M
MILL-0611	N/A	Room 120	Water Fountain-No Chiller	Potable	2/11/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0612	N/A	Room 120 Bathroom	Bathroom Faucet	Non-Potable	2/11/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0614	N/A	Room 119	Classroom Faucet	Non-Potable	2/11/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0615	N/A	Room 119	Water Fountain-No Chiller	Potable	2/11/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0616	N/A	Room 119 Bathroom	Bathroom Faucet	Non-Potable	2/11/2021	1.6	Result Below Action Level Continue O&M
MILL-0618	N/A	Room 118	Classroom Faucet	Non-Potable	2/11/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0619	N/A	Room 118	Water Fountain-No Chiller	Potable	2/11/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0620	N/A	Room 118 Bathroom	Bathroom Faucet	Non-Potable	2/11/2021	<3.0 ND	Result Below Action Level Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
MILL-0623	1-41A	Nurse	Nurse's Office Sink	Non-Potable	2/11/2021	2.3	Result Below Action Level Continue O&M
MILL-0624	1-41A2	Nurse BR	Bathroom Faucet	Non-Potable	2/11/2021	1.4	Result Below Action Level Continue O&M
MILL-0625	1-40	Women's Bathroom	Bathroom Faucet	Non-Potable	2/11/2021	1.9	Result Below Action Level Continue O&M
MILL-0627	1-39	Men's Bathroom	Bathroom Faucet	Non-Potable	2/11/2021	3	Result Below Action Level Continue O&M
MILL-0629	1-35	Library	Hand Wash Only	Non-Potable	2/11/2021	23	Placarded for Non-Drinking Use Until Remediated
MILL-0630	1-42	Outside Elevator	Bottle Fill Station	Potable	2/11/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0631	1-42	Outside Elevator	Water Cooler	Potable		OOS	Testing Required Before Return to Service
MILL-0632	1-02	Room 143	Classroom Faucet	Non-Potable	2/11/2021	5.0	Result Below Action Level Continue O&M
MILL-0633	1-01	Room 144	Classroom Faucet	Non-Potable	2/11/2021	13	Result Below Action Level Continue O&M
MILL-0635	1-05	Room 140	Classroom Faucet	Non-Potable	2/11/2021	8.0	Result Below Action Level Continue O&M
MILL-0636	1-06	Room 139	Classroom Faucet	Non-Potable	2/11/2021	24	Placarded for Non-Drinking Use Until Remediated
MILL-0637	1-07	Room 138	Classroom Faucet	Non-Potable	2/11/2021	9.9	Result Below Action Level Continue O&M
MILL-0638	1-08	Room 137	Classroom Faucet	Non-Potable	2/11/2021	63	Placarded for Non-Drinking Use Until Remediated
MILL-0640	1-11	Room 147	Classroom Faucet	Non-Potable	2/11/2021	19	Placarded for Non-Drinking Use Until Remediated
MILL-0641	1-12	Room 148	Classroom Faucet	Non-Potable	2/11/2021	19	Placarded for Non-Drinking Use Until Remediated

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
MILL-0642	1-13	Room 149	Classroom Faucet	Non-Potable	2/11/2021	5.8	Result Below Action Level Continue O&M
MILL-0643	1-14	Room 150	Classroom Faucet	Non-Potable	2/11/2021	8.2	Result Below Action Level Continue O&M
MILL-0644	1-16	Room 151	Classroom Faucet	Non-Potable	2/11/2021	7.7	Result Below Action Level Continue O&M
MILL-0645	1-30A	Room 135B Kitchen	Kitchen Faucet (Cold)	Potable	2/11/2021	1.9	Result Below Action Level Continue O&M
MILL-0646	1-30B1	Principal Bathroom	Bathroom Faucet	Non-Potable	2/11/2021	21	Placarded for Non-Drinking Use Until Remediated
MILL-0647	1-17	Room 152	Classroom Faucet	Non-Potable	2/11/2021	5.6	Result Below Action Level Continue O&M
MILL-0648	1-19	Room 153	Classroom Faucet	Non-Potable	2/11/2021	20	Placarded for Non-Drinking Use Until Remediated
MILL-0649	1-18	Room 154	Classroom Faucet	Non-Potable	2/11/2021	4.2	Result Below Action Level Continue O&M
MILL-0650	1-22A	Room 156 Bathroom	Bathroom Faucet	Non-Potable	2/11/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0651	1-23A	Room 157 Bathroom	Bathroom Faucet	Non-Potable	2/11/2021	1	Result Below Action Level Continue O&M
MILL-0652	1-24A	Room 158 Bathroom	Bathroom Faucet	Non-Potable	2/11/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0653	1-25A	Room 159 Bathroom	Bathroom Faucet	Non-Potable	2/11/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0655	1-28A	Room 160 Bathroom	Bathroom Faucet	Non-Potable	2/11/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0656	1-27A	Room 161 Bathroom	Bathroom Faucet	Non-Potable	2/11/2021	2	Result Below Action Level Continue O&M

Miller Place High School

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
MILL-0001	1058A	Custodial Office BR	Bathroom Faucet	Non-Potable	2/12/2021	5.8	Result Below Action Level Continue O&M
MILL-0002	1057	Kitchen Storage	Water Cooler	Potable	2/12/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0003	1056I	Serving Area	Hand Wash Only	Non-Potable	2/12/2021	36	Placarded for Non-Drinking Use Until Remediated
MILL-0004	1056I	Serving Area	Coffe Pot	Potable	2/12/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0005	1056J	Kitchen	Hand Wash Only	Non-Potable	2/12/2021	37	Placarded for Non-Drinking Use Until Remediated
MILL-0006	1056J	Kitchen	Kitchen Faucet (Cold)	Potable	2/12/2021	1.9	Result Below Action Level Continue O&M
MILL-0007	1056J	Kitchen	Kitchen Faucet (Cold)	Potable	2/12/2021	11	Result Below Action Level Continue O&M
MILL-0008	1056J	Kitchen	Kitchen Faucet (Cold)	Potable	2/12/2021	4.0	Result Below Action Level Continue O&M
MILL-0009	1056J	Kitchen	Spray Nozzle	Non-Potable	2/12/2021	240	Placarded for Non-Drinking Use Until Remediated
MILL-0010	1056J	Kitchen	Kitchen Faucet (Cold)	Potable	2/12/2021	3.9	Result Below Action Level Continue O&M
MILL-0011	1056J	Kitchen	Ice Machine	Potable	2/12/2021	2.3	Result Below Action Level Continue O&M
MILL-0012	1056	Serving Area	Hand Wash Only	Non-Potable	2/12/2021	46	Placarded for Non-Drinking Use Until Remediated
MILL-0013	1056A	Kitchen Bathroom	Bathroom Faucet	Non-Potable	2/12/2021	7.0	Result Below Action Level Continue O&M
MILL-0015	1055	Cafeteria	Bottle Fill Station	Potable	2/12/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0016	1055	Cafeteria	Water Cooler	Potable		OOS	Testing Required Before Return to Service

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
MILL-0017	1055	Cafeteria	Bottle Fill Station	Potable	2/12/2021	1.1	Result Below Action Level Continue O&M
MILL-0018	1055	Cafeteria	Water Cooler	Potable		OOS	Testing Required Before Return to Service
MILL-0020	1068	Boy's LR	Bathroom Faucet	Non-Potable	2/12/2021	7.5	Result Below Action Level Continue O&M
MILL-0021	1068	Boy's LR	Bathroom Faucet	Non-Potable	2/12/2021	4.1	Result Below Action Level Continue O&M
MILL-0022	1068	Boy's LR	Bathroom Faucet	Non-Potable	2/12/2021	6.5	Result Below Action Level Continue O&M
MILL-0024	1068	Boy's LR	Water Fountain-No Chiller	Potable	2/12/2021	1.1	Result Below Action Level Continue O&M
MILL-0025	1068	Boy's LR	Water Fountain-No Chiller	Potable	2/12/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0028	1068B2	Coach's Office (Boys) BR	Bathroom Faucet	Non-Potable	2/12/2021	1.1	Result Below Action Level Continue O&M
MILL-0029	1073A	Coach's Offices (Girls) BR	Bathroom Faucet	Non-Potable	2/12/2021	8.9	Result Below Action Level Continue O&M
MILL-0030	1074	Girl's LR	Bathroom Faucet	Non-Potable		OOS	Testing Required Before Return to Service
MILL-0031	1074	Girl's LR	Bathroom Faucet	Non-Potable	2/12/2021	9.2	Result Below Action Level Continue O&M
MILL-0032	1074	Girl's LR	Bathroom Faucet	Non-Potable	2/12/2021	3.8	Result Below Action Level Continue O&M
MILL-0033	1074	Girl's LR	Bathroom Faucet	Non-Potable	2/12/2021	9.6	Result Below Action Level Continue O&M
MILL-0035	1074	Girl's LR	Water Fountain-No Chiller	Potable		OOS	Testing Required Before Return to Service
MILL-0036	1074	Girl's LR	Water Fountain-No Chiller	Potable	2/12/2021	<3.0 ND	Result Below Action Level Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
MILL-0039	1072A	141 Trainer Bathroom	Water Fountain-No Chiller	Potable	2/24/2021	71	Removed From Service, Pending Remediation
MILL-0041	1072A	141 Trainer Bathroom	Ice Machine	Potable	2/24/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0042	1172A1	Trainer's BR	Tempered Water Outlet	Non-Potable	2/24/2021	19	Outlet Use Determined to be Non-Applicable, Placarded for Non-Drinking Use, Continue O&M
MILL-0050	1054	Outside Auditorium	Bottle Fill Station	Potable	2/12/2021	1.9	Result Below Action Level Continue O&M
MILL-0051	1054	Outside Auditorium	Water Cooler	Potable		OOS	Testing Required Before Return to Service
MILL-0052	1044	Men's Bathroom	Bathroom Faucet	Non-Potable	2/12/2021	4.3	Result Below Action Level Continue O&M
MILL-0053	1044	Men's Bathroom	Bathroom Faucet	Non-Potable	2/12/2021	7.5	Result Below Action Level Continue O&M
MILL-0056	1045	Girl's Bathroom	Bathroom Faucet	Non-Potable	2/12/2021	5.0	Result Below Action Level Continue O&M
MILL-0057	1045	Girl's Bathroom	Bathroom Faucet	Non-Potable	2/12/2021	4.8	Result Below Action Level Continue O&M
MILL-0085	1047A	Room 162/163 ST	Hand Wash Only	Non-Potable	2/24/2021	13	Result Below Action Level Continue O&M
MILL-0086	1054	Outside Room 164	Bottle Fill Station	Potable	2/12/2021	1.3	Result Below Action Level Continue O&M
MILL-0087	1054	Outside Room 164	Water Cooler	Potable		OOS	Testing Required Before Return to Service
MILL-0107	1049B	Room 164B (Athletic OF)	Bathroom Faucet	Non-Potable	2/24/2021	28	Placarded for Non-Drinking Use Until Remediated
MILL-0108	1042	Room 131, Earth Science	Classroom Faucet	Non-Potable	2/12/2021	32	Placarded for Non-Drinking Use Until Remediated
MILL-0109	1042	Room 131, Earth Science	Classroom Faucet	Non-Potable	2/12/2021	150	Placarded for Non-Drinking Use Until Remediated

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
MILL-0110	1042	Room 131, Earth Science	Classroom Faucet	Non-Potable	2/12/2021	25	Placarded for Non-Drinking Use Until Remediated
MILL-0113	1041	Faculty Lounge	Kitchen Faucet (Cold)	Potable	2/12/2021	2.1	Result Below Action Level Continue O&M
MILL-0114	1041	Faculty Lounge	Bottled Water Dispenser	Potable	2/12/2021	1.1	Result Below Action Level Continue O&M
MILL-0115	1041	Faculty Lounge	Bottled Water Dispenser	Potable	2/12/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0116	1041	Faculty Lounge	Bottle Fill Station	Potable	2/12/2021	1.3	Result Below Action Level Continue O&M
MILL-0118	1039B	Nurse's Bathroom	Bathroom Faucet	Non-Potable	2/12/2021	77	Placarded for Non-Drinking Use Until Remediated
MILL-0119	1039A	Nurse's Bathroom	Bathroom Faucet	Non-Potable	2/12/2021	16	Placarded for Non-Drinking Use Until Remediated
MILL-0120	1034	Main Office Kitchen	Kitchen Faucet (Cold)	Potable	2/12/2021	1.2	Result Below Action Level Continue O&M
MILL-0121	1028B	Principal's Bathroom	Bathroom Faucet	Non-Potable	2/12/2021	150	Placarded for Non-Drinking Use Until Remediated
MILL-0122	1043	Fountain by Main Office	Bottle Fill Station	Potable	2/12/2021	1.1	Result Below Action Level Continue O&M
MILL-0123	1043	Fountain by Main Office	Water Cooler	Potable		OOS	Testing Required Before Return to Service
MILL-0124	1019B	Guidance Office Kitchen	Kitchen Faucet (Cold)	Potable	2/12/2021	6.8	Result Below Action Level Continue O&M
MILL-0125	1026	Main Lobby & Corridors 101-125 - Outside Guidance Office	Bottle Fill Station	Potable	2/12/2021	1.9	Result Below Action Level Continue O&M
MILL-0126	1026	Main Lobby & Corridors 101-125 - Outside Guidance Office	Water Cooler	Potable		OOS	Testing Required Before Return to Service
MILL-0127	1081	Boy's Bathroom	Bathroom Faucet	Non-Potable	2/12/2021	11	Result Below Action Level Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
MILL-0128	1081	Boy's Bathroom	Bathroom Faucet	Non-Potable	2/12/2021	2.4	Result Below Action Level Continue O&M
MILL-0131	1079	Women's Bathroom	Bathroom Faucet	Non-Potable	2/12/2021	11	Result Below Action Level Continue O&M
MILL-0132	1079	Women's Bathroom	Bathroom Faucet	Non-Potable	2/12/2021	4.2	Result Below Action Level Continue O&M
MILL-0133	1079	Women's Bathroom	Bathroom Faucet	Non-Potable	2/12/2021	5.7	Result Below Action Level Continue O&M
MILL-0144	N/A	Library Sink	Kitchen Faucet (Cold)	Potable	2/12/2021	1.6	Result Below Action Level Continue O&M
MILL-0145	1026	Fountain by bathroom	Bottle Fill Station	Potable	2/12/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0146	1026	Fountain by bathroom	Water Cooler	Potable		OOS	Testing Required Before Return to Service
MILL-0155	1012	Men's Bathroom	Bathroom Faucet	Non-Potable	2/12/2021	44	Placarded for Non-Drinking Use Until Remediated
MILL-0157	1013	Women's Bathroom	Bathroom Faucet	Non-Potable	2/12/2021	7.1	Result Below Action Level Continue O&M
MILL-0158	1013	Women's Bathroom	Bathroom Faucet	Non-Potable	2/12/2021	14	Result Below Action Level Continue O&M
MILL-0160	1026	Fountain by Room 115	Water Cooler	Potable		OOS	Testing Required Before Return to Service
MILL-0189	2026	Outside Room 211	Bottle Fill Station	Potable	2/12/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0190	2026	Outside Room 211	Water Cooler	Potable		OOS	Testing Required Before Return to Service
MILL-0229	2021	Women's Bathroom	Bathroom Faucet	Non-Potable	2/12/2021	10	Result Below Action Level Continue O&M
MILL-0230	2021	Women's Bathroom	Bathroom Faucet	Non-Potable	2/12/2021	2.1	Result Below Action Level Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
MILL-0231	2026	Outside Women's Faculty BR	Bottle Fill Station	Potable	2/12/2021	1.4	Result Below Action Level Continue O&M
MILL-0232	2026	Outside Women's Faculty BR	Water Cooler	Potable		OOS	Testing Required Before Return to Service
MILL-0263	2022	Men's Faculty Bathroom	Bathroom Faucet	Non-Potable	2/12/2021	6.7	Result Below Action Level Continue O&M
MILL-0265	2026	Outside Room 202	Bottle Fill Station	Potable	2/12/2021	1.1	Result Below Action Level Continue O&M
MILL-0266	2026	Outside Room 202	Water Cooler	Potable		OOS	Testing Required Before Return to Service

North Country Road Middle School

MILL-0286	1-01A	Room 3 Bathroom	Bathroom Faucet	Non-Potable	1/26/2021	5.0	Result Below Action Level Continue O&M
MILL-0287	1-01	Room 3	Classroom Faucet	Non-Potable	1/26/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0288	1-01	Room 3	Bottle Fill Station	Potable	1/26/2021	1.4	Result Below Action Level Continue O&M
MILL-0289	1-01	Room 3	Water Fountain-No Chiller	Potable	1/26/2021	2	Result Below Action Level Continue O&M
MILL-0290	1-04	Faculty Bathroom, Men	Bathroom Faucet	Non-Potable	1/26/2021	4.6	Result Below Action Level Continue O&M
MILL-0291	1-04	Faculty Bathroom, Men	Bathroom Faucet	Non-Potable	1/26/2021	3.7	Result Below Action Level Continue O&M
MILL-0292	1-14	Faculty Bathroom, Women	Bathroom Faucet	Non-Potable	1/26/2021	3.7	Result Below Action Level Continue O&M
MILL-0293	1-14	Faculty Bathroom, Women	Bathroom Faucet	Non-Potable	1/26/2021	1.4	Result Below Action Level Continue O&M
MILL-0294	1-17	Room 4	Classroom Faucet	Non-Potable	2/24/2021	<3.0 ND	Result Below Action Level Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
MILL-0296	1-18B	Room 6	Bathroom Faucet	Non-Potable	1/26/2021	12	Result Below Action Level Continue O&M
MILL-0297	1-60	Fountain by Room 6	Water Fountain-No Chiller	Potable		OOS	Testing Required Before Return to Service
MILL-0298	1-25	Room 8	Classroom Faucet	Non-Potable	1/26/2021	1.8	Result Below Action Level Continue O&M
MILL-0299	1-25	Room 8	Water Fountain-No Chiller	Potable		OOS	Testing Required Before Return to Service
MILL-0300	1-26	Room 10	Classroom Faucet	Non-Potable	1/26/2021	1	Result Below Action Level Continue O&M
MILL-0301	1-26	Room 10	Water Fountain-No Chiller	Potable		OOS	Testing Required Before Return to Service
MILL-0302	1-27	Room 12	Classroom Faucet	Non-Potable	1/26/2021	2.3	Result Below Action Level Continue O&M
MILL-0303	1-27	Room 12	Water Fountain-No Chiller	Potable		OOS	Testing Required Before Return to Service
MILL-0304	1-28	Room 15	Classroom Faucet	Non-Potable	1/26/2021	1.5	Result Below Action Level Continue O&M
MILL-0305	1-29	Room 13	Classroom Faucet	Non-Potable	1/26/2021	1.8	Result Below Action Level Continue O&M
MILL-0306	1-22	Boy's Bathroom	Bathroom Faucet	Non-Potable	1/26/2021	2.4	Result Below Action Level Continue O&M
MILL-0307	1-22	Boy's Bathroom	Bathroom Faucet	Non-Potable	1/26/2021	1.7	Result Below Action Level Continue O&M
MILL-0309	1-24	Girl's Bathroom	Bathroom Faucet	Non-Potable	1/26/2021	1.4	Result Below Action Level Continue O&M
MILL-0310	1-24	Girl's Bathroom	Bathroom Faucet	Non-Potable	1/26/2021	2.5	Result Below Action Level Continue O&M
MILL-0311	1-60	Fountain by Cafeteria	Bottle Fill Station	Potable	1/26/2021	1.6	Result Below Action Level Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
MILL-0312	1-60	Fountain by Cafeteria	Water Cooler	Potable		OOS	Testing Required Before Return to Service
MILL-0314	1-35	Kitchen	Hand Wash Only	Non-Potable	1/26/2021	5.2	Result Below Action Level Continue O&M
MILL-0315	1-35	Kitchen	Kitchen Faucet (Cold)	Potable	1/26/2021	2.9	Result Below Action Level Continue O&M
MILL-0316	1-35	Kitchen	Kitchen Faucet (Cold)	Potable	1/26/2021	5.4	Result Below Action Level Continue O&M
MILL-0317	1-35C	Kitchen Bathroom	Bathroom Faucet	Non-Potable	1/26/2021	3.8	Result Below Action Level Continue O&M
MILL-0318	1-58	Room 25	Classroom Faucet	Non-Potable	1/26/2021	6.2	Result Below Action Level Continue O&M
MILL-0319	1-58	Room 25	Water Fountain-No Chiller	Potable	1/26/2021	9.2	Result Below Action Level Continue O&M
MILL-0322	1-57B	Room 22 Bathroom	Bathroom Faucet	Non-Potable	1/26/2021	1.4	Result Below Action Level Continue O&M
MILL-0323	1-56	Room 20	Classroom Faucet	Non-Potable	1/26/2021	1	Result Below Action Level Continue O&M
MILL-0324	1-55	Room 23	Classroom Faucet	Non-Potable	1/26/2021	4.2	Result Below Action Level Continue O&M
MILL-0325	1-55	Room 23	Water Fountain-No Chiller	Potable		OOS	Testing Required Before Return to Service
MILL-0327	1-53	Room 21	Classroom Faucet	Non-Potable	1/26/2021	5.1	Result Below Action Level Continue O&M
MILL-0328	1-36	Room 17	Classroom Faucet	Non-Potable	1/26/2021	4.0	Result Below Action Level Continue O&M
MILL-0329	1-37	Room 18	Classroom Faucet	Non-Potable	2/24/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0330	1-37	Room 18	Water Fountain-No Chiller	Potable		OOS	Testing Required Before Return to Service

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
MILL-0331	1-38	Faculty Lounge	Classroom Faucet	Non-Potable	1/26/2021	2.7	Result Below Action Level Continue O&M
MILL-0332	1-38	Faculty Lounge	Water Fountain-No Chiller	Potable		OOS	Testing Required Before Return to Service
MILL-0333	1-38	Faculty Lounge	Bottle Fill Station	Potable	1/26/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0334	1-43GI	Principal of Bathroom	Bathroom Faucet	Non-Potable	1/26/2021	1.2	Result Below Action Level Continue O&M
MILL-0335	1-43F	Main of BR	Bathroom Faucet	Non-Potable	1/26/2021	4.2	Result Below Action Level Continue O&M
MILL-0336	1-45	Outtside Main Office	Water Fountain-No Chiller	Potable		OOS	Testing Required Before Return to Service
MILL-0337	1-44	Nurse	Nurse's Office Sink	Non-Potable	1/26/2021	1.1	Result Below Action Level Continue O&M
MILL-0338	1-44B	Nurse Bathroom	Bathroom Faucet	Non-Potable	1/26/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0339	1-46	Room 24	Classroom Faucet	Non-Potable	1/26/2021	1.4	Result Below Action Level Continue O&M
MILL-0340	1-47	Room 27	Classroom Faucet	Non-Potable	1/26/2021	1.6	Result Below Action Level Continue O&M
MILL-0341	1-48	Room 26	Classroom Faucet	Non-Potable	1/26/2021	11	Result Below Action Level Continue O&M
MILL-0342	1-48	Room 26	Water Fountain-No Chiller	Potable		OOS	Testing Required Before Return to Service
MILL-0343	1-49	Room 29	Classroom Faucet	Non-Potable	1/26/2021	9.7	Result Below Action Level Continue O&M
MILL-0344	1-50	Room 28	Classroom Faucet	Non-Potable	1/26/2021	6.3	Result Below Action Level Continue O&M
MILL-0350	N/A, New Construction	Men's Bathroom	Bathroom Faucet	Non-Potable	1/26/2021	1.6	Result Below Action Level Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
MILL-0352	N/A, New Construction	Between Bathrooms	Bottle Fill Station	Potable	1/26/2021	1.5	Result Below Action Level Continue O&M
MILL-0353	N/A, New Construction	Between Bathrooms	Water Cooler	Potable		OOS	Testing Required Before Return to Service
MILL-0354	N/A, New Construction	Women's Bathroom	Bathroom Faucet	Non-Potable	1/26/2021	1.5	Result Below Action Level Continue O&M
MILL-0356	N/A, New Construction	Library Office	Hand Wash Only	Non-Potable	1/26/2021	2	Result Below Action Level Continue O&M
MILL-0374	N/A, New Construction	Room 33	Home Economics Faucet (Cold)	Potable	1/26/2021	1.9	Result Below Action Level Continue O&M
MILL-0375	N/A, New Construction	Room 33	Home Economics Faucet (Cold)	Potable	1/26/2021	1.9	Result Below Action Level Continue O&M
MILL-0376	N/A, New Construction	Room 33	Home Economics Faucet (Cold)	Potable	1/26/2021	1.2	Result Below Action Level Continue O&M
MILL-0377	N/A, New Construction	Room 33	Home Economics Faucet (Cold)	Potable	1/26/2021	<3.0 ND	Result Below Action Level Continue O&M
MILL-0378	N/A, New Construction	Room 33	Home Economics Faucet (Cold)	Potable	1/26/2021	3.3	Result Below Action Level Continue O&M
MILL-0379	N/A, New Construction	Room 33	Home Economics Faucet (Cold)	Potable	1/26/2021	1.7	Result Below Action Level Continue O&M
MILL-0380	N/A, New Construction	Room 35	Home Economics Faucet (Cold)	Potable	1/26/2021	2.8	Result Below Action Level Continue O&M
MILL-0381	N/A, New Construction	Room 35	Home Economics Faucet (Cold)	Potable	1/26/2021	4.9	Result Below Action Level Continue O&M
MILL-0382	N/A, New Construction	Room 35	Home Economics Faucet (Cold)	Potable	1/26/2021	7.0	Result Below Action Level Continue O&M
MILL-0383	N/A, New Construction	Room 35	Home Economics Faucet (Cold)	Potable	1/26/2021	1.5	Result Below Action Level Continue O&M
MILL-0384	N/A, New Construction	Room 35	Home Economics Faucet (Cold)	Potable	1/26/2021	2.5	Result Below Action Level Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
MILL-0385	N/A, New Construction	Room 35	Home Economics Faucet (Cold)	Potable	1/26/2021	1.3	Result Below Action Level Continue O&M
MILL-0388	N/A, New Construction	Girl's Bathroom	Bathroom Faucet	Non-Potable	1/26/2021	3.4	Result Below Action Level Continue O&M
MILL-0389	N/A, New Construction	Girl's Bathroom	Bathroom Faucet	Non-Potable	1/26/2021	1.8	Result Below Action Level Continue O&M
MILL-0390	N/A, New Construction	Girl's Bathroom	Bathroom Faucet	Non-Potable	1/26/2021	1.9	Result Below Action Level Continue O&M
MILL-0392	N/A, New Construction	Between Girl's BR and CC	Bottle Fill Station	Potable	1/26/2021	1.5	Result Below Action Level Continue O&M
MILL-0393	N/A, New Construction	Between Girl's BR and CC	Water Cooler	Potable		OOS	Testing Required Before Return to Service
MILL-0395	N/A, New Construction	Boy's Bathroom	Bathroom Faucet	Non-Potable	1/26/2021	1.4	Result Below Action Level Continue O&M
MILL-0396	N/A, New Construction	Boy's Bathroom	Bathroom Faucet	Non-Potable	1/26/2021	3.1	Result Below Action Level Continue O&M
MILL-0397	N/A, New Construction	Boy's Bathroom	Bathroom Faucet	Non-Potable		OOS	Testing Required Before Return to Service
MILL-0401	N/A, New Construction	Band Room 43	Classroom Faucet	Non-Potable	1/26/2021	1.2	Result Below Action Level Continue O&M
MILL-0402	N/A, New Construction	Outside Music Suite	Bottle Fill Station	Potable	1/26/2021	1.2	Result Below Action Level Continue O&M
MILL-0403	N/A, New Construction	Outside Music Suite	Water Cooler	Potable		OOS	Testing Required Before Return to Service
MILL-0404	N/A, New Construction	Boy's Locker Room	Bathroom Faucet	Non-Potable	1/26/2021	2.6	Result Below Action Level Continue O&M
MILL-0405	N/A, New Construction	Boy's Locker Room	Bathroom Faucet	Non-Potable	1/26/2021	1.8	Result Below Action Level Continue O&M
MILL-0407	N/A, New Construction	Girl's Bathroom	Bathroom Faucet	Non-Potable	1/26/2021	1.8	Result Below Action Level Continue O&M

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
MILL-0408	N/A, New Construction	Girl's Bathroom	Bathroom Faucet	Non-Potable	1/26/2021	<3.0 ND	Result Below Action Level Continue O&M

Attachment 2:

Chain of Custody
&
Laboratory Analysis


J.C. Broderick & Associates, Inc.

Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395

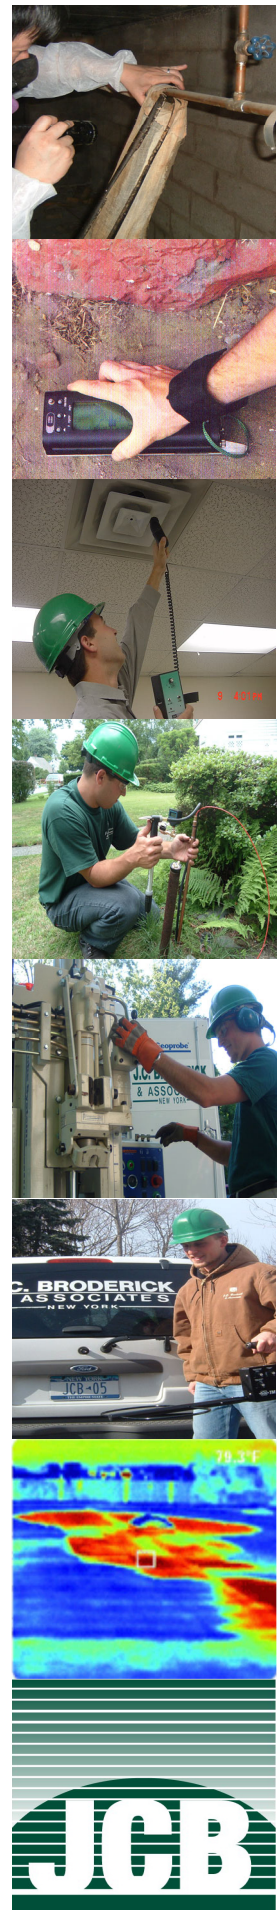



Lead in Water: Chain of Custody for

062 101871

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 18-41685

Building: North Country Road Middle School

NCRMS

Client:

Miller Place Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
MILL-0286	BR	1-01A	Room 3 Bathroom	BF	1/26/2021	5:08:00 AM
MILL-0287	CR	1-01	Room 3	CF	1/26/2021	5:05:00 AM
MILL-0288	CR	1-01	Room 3	WF	1/26/2021	5:06:00 AM
MILL-0289	CR	1-01	Room 3	DW	1/26/2021	5:07:00 AM
MILL-0290	BR	1-04	Faculty Bathroom, Men	BF	1/26/2021	5:09:00 AM
MILL-0291	BR	1-04	Faculty Bathroom, Men	BF	1/26/2021	5:10:00 AM
MILL-0292	BR	1-14	Faculty Bathroom, Women	BF	1/26/2021	5:11:00 AM
MILL-0293	BR	1-14	Faculty Bathroom, Women	BF	1/26/2021	5:12:00 AM
MILL-0294	CR	1-17	Room 4	CF	1/26/2021	5:13:00 AM
MILL-0296	BR	1-18B	Room 6	BF	1/26/2021	5:14:00 AM
MILL-0298	CR	1-25	Room 8	CF	1/26/2021	5:16:00 AM
MILL-0300	CR	1-26	Room 10	CF	1/26/2021	5:17:00 AM
MILL-0302	CR	1-27	Room 12	CF	1/26/2021	5:18:00 AM
MILL-0304	CR	1-28	Room 15	CF	1/26/2021	5:20:00 AM
MILL-0305	CR	1-29	Room 13	CF	1/26/2021	5:22:00 AM
MILL-0306	BR	1-22	Boy's Bathroom	BF	1/26/2021	5:24:00 AM
MILL-0307	BR	1-22	Boy's Bathroom	BF	1/26/2021	5:24:00 AM
MILL-0309	BR	1-24	Girl's Bathroom	BF	1/26/2021	5:25:00 AM

Building Address

191 North Country Road

Miller Place, NY 11764

P6206.5 -

A. Long 02/14/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Griffin Hayes

Samplers Signature:

JCB Project Manager:

Bryan Izels



Lead in Water: Chain of Custody for

062101871

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 18-41685
Building: North Country Road Middle School
NCRMS

Client: Miller Place Union Free School District
Retest/New Install []
Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
MILL-0310	BR	1-24	Girl's Bathroom	BF	1/26/2021	5:26:00 AM
MILL-0311	HA	1-60	Fountain by Cafeteria	WF	1/26/2021	5:27:00 AM
MILL-0314	KI	1-35	Kitchen	HW	1/26/2021	5:31:00 AM
MILL-0315	KI	1-35	Kitchen	KC	1/26/2021	5:32:00 AM
MILL-0316	KI	1-35	Kitchen	KC	1/26/2021	5:32:00 AM
MILL-0317	BR	1-35C	Kitchen Bathroom	BF	1/26/2021	5:34:00 AM
MILL-0318	CR	1-58	Room 25	CF	1/26/2021	5:36:00 AM
MILL-0319	CR	1-58	Room 25	DW	1/26/2021	5:37:00 AM
MILL-0322	BR	1-57B	Room 22 Bathroom	BF	1/26/2021	5:38:00 AM
MILL-0323	CR	1-56	Room 20	CF	1/26/2021	5:40:00 AM
MILL-0324	CR	1-55	Room 23	CF	1/26/2021	5:41:00 AM
MILL-0327	CR	1-53	Room 21	CF	1/26/2021	5:42:00 AM
MILL-0328	CR	1-36	Room 17	CF	1/26/2021	5:43:00 AM
MILL-0329	CR	1-37	Room 18	CF	1/26/2021	5:44:00 AM
MILL-0331	FL	1-38	Faculty Lounge	CF	1/26/2021	5:45:00 AM
MILL-0333	FL	1-38	Faculty Lounge	WF	1/26/2021	5:46:00 AM
MILL-0334	BR	1-43GI	Principal of Bathroom	BF	1/26/2021	5:48:00 AM
MILL-0335	BR	1-43F	Main of BR	BF	1/26/2021	5:49:00 AM

Building Address
191 North Country Road
Miller Place, NY 11764

Pb 200.5 -
A. Ljung 02/10/21

Analysis Type: ELAP 200.5 *AL*
Lab Received: *[Signature]*
Signature: *[Signature]*

Samplers Name: Griffin Hayes
Samplers Signature: [Signature]
JCB Project Manager: Bryan Ezelus



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 18-41685

Building: North Country Road Middle School

NCRMS

0621 01871

Client:

Miller Place Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
MILL-0337	NO	1-44	Nurse	NS	1/26/2021	5:51:00 AM
MILL-0338	BR	1-44B	Nurse Bathroom	BF	1/26/2021	5:52:00 AM
MILL-0339	CR	1-46	Room 24	CF	1/26/2021	5:53:00 AM
MILL-0340	CR	1-47	Room 27	CF	1/26/2021	5:55:00 AM
MILL-0341	CR	1-48	Room 26	CF	1/26/2021	5:57:00 AM
MILL-0343	CR	1-49	Room 29	CF	1/26/2021	5:59:00 AM
MILL-0344	CR	1-50	Room 28	CF	1/26/2021	6:00:00 AM
MILL-0350	BR	N/A, New Construction	Men's Bathroom	BF	1/26/2021	6:01:00 AM
MILL-0352	HA	N/A, New Construction	Between Bathrooms	WF	1/26/2021	6:03:00 AM
MILL-0354	BR	N/A, New Construction	Women's Bathroom	BF	1/26/2021	6:05:00 AM
MILL-0356	OF	N/A, New Construction	Library Office	HW	1/26/2021	6:06:00 AM
MILL-0374	HE	N/A, New Construction	Room 33	EC	1/26/2021	6:07:00 AM
MILL-0375	HE	N/A, New Construction	Room 33	EC	1/26/2021	6:07:00 AM
MILL-0376	HE	N/A, New Construction	Room 33	EC	1/26/2021	6:08:00 AM
MILL-0377	HE	N/A, New Construction	Room 33	EC	1/26/2021	6:09:00 AM
MILL-0378	HE	N/A, New Construction	Room 33	EC	1/26/2021	6:10:00 AM
MILL-0379	HE	N/A, New Construction	Room 33	EC	1/26/2021	6:10:00 AM
MILL-0380	HE	N/A, New Construction	Room 35	EC	1/26/2021	6:11:00 AM

Building Address

191 North Country Road
Miller Place, NY 11764

Pb 200.5 -
A-Lung 02/10/21

Analysis Type: ELAP 200.5

Lab Received:


Signature:

Samplers Name: Griffin Hayes

Samplers Signature:

JCB Project Manager:

Bryan Ezeling



Lead in Water: Chain of Custody for

062101871

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 18-41685

Building: North Country Road Middle School

NCRMS

Client:

Miller Place Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
MILL-0381	HE	N/A, New Construction	Room 35	EC	1/26/2021	6:12:00 AM
MILL-0382	HE	N/A, New Construction	Room 35	EC	1/26/2021	6:13:00 AM
MILL-0383	HE	N/A, New Construction	Room 35	EC	1/26/2021	6:14:00 AM
MILL-0384	HE	N/A, New Construction	Room 35	EC	1/26/2021	6:15:00 AM
MILL-0385	HE	N/A, New Construction	Room 35	EC	1/26/2021	6:15:00 AM
MILL-0388	BR	N/A, New Construction	Girl's Bathroom	BF	1/26/2021	6:16:00 AM
MILL-0389	BR	N/A, New Construction	Girl's Bathroom	BF	1/26/2021	6:16:00 AM
MILL-0390	BR	N/A, New Construction	Girl's Bathroom	BF	1/26/2021	6:17:00 AM
MILL-0392	HA	N/A, New Construction	Between Girl's BR and CC	WF	1/26/2021	6:19:00 AM
MILL-0395	BR	N/A, New Construction	Boy's Bathroom	BF	1/26/2021	6:21:00 AM
MILL-0396	BR	N/A, New Construction	Boy's Bathroom	BF	1/26/2021	6:22:00 AM
MILL-0401	CR	N/A, New Construction	Band Room 43	CF	1/26/2021	6:24:00 AM
MILL-0402	HA	N/A, New Construction	Outside Music Suite	WF	1/26/2021	6:26:00 AM
MILL-0404	LR	N/A, New Construction	Boy's Locker Room	BF	1/26/2021	6:27:00 AM
MILL-0405	LR	N/A, New Construction	Boy's Locker Room	BF	1/26/2021	6:28:00 AM
MILL-0407	LR	N/A, New Construction	Girl's Bathroom	BF	1/26/2021	6:31:00 AM
MILL-0408	LR	N/A, New Construction	Girl's Bathroom	BF	1/26/2021	6:32:00 AM

Samples Submitted 71

Building Address

191 North Country Road
Miller Place, NY 11764

Pb 200.5
A-Lung 02/10/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Griffin, Hayes

Samplers Signature:

JCB Project Manager:

Bryan Ezeke



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

**Bryan Ezelius
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788**

3/8/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 1/26/2021. The results are tabulated on the attached data pages for the following client designated project:

**#18-41685, North Country Road Middle School, Miller Place
Union Free School District, 191 North Country Road, Miller Place,
NY 11764**

The reference number for these samples is EMSL Order #062101871. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062101871

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 1/26/2021 04:59 PM
 Collected: 1/26/2021

Project: #18-41685, North Country Road Middle School, Miller Place Union Free School District, 191 North Country Road, Miller Place, NY

Analytical Results

Client Sample Description		MILL-0286	Collected:	1/26/2021	Lab ID:	062101871-0001		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.0	3.0	µg/L	2/9/2021	AM	2/10/2021	AL
Client Sample Description		MILL-0287	Collected:	1/26/2021	Lab ID:	062101871-0002		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	2/9/2021	AM	2/10/2021	AL
Client Sample Description		MILL-0288	Collected:	1/26/2021	Lab ID:	062101871-0003		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0	µg/L	2/9/2021	AM	2/10/2021	AL
		Lead MDL: 1.0µg/L						
Client Sample Description		MILL-0289	Collected:	1/26/2021	Lab ID:	062101871-0004		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0	µg/L	2/9/2021	AM	2/10/2021	AL
		Lead MDL: 1.0µg/L						
Client Sample Description		MILL-0290	Collected:	1/26/2021	Lab ID:	062101871-0005		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.6	3.0	µg/L	2/9/2021	AM	2/10/2021	AL
Client Sample Description		MILL-0291	Collected:	1/26/2021	Lab ID:	062101871-0006		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.7	3.0	µg/L	2/9/2021	AM	2/10/2021	AL
Client Sample Description		MILL-0292	Collected:	1/26/2021	Lab ID:	062101871-0007		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.7	3.0	µg/L	2/9/2021	AM	2/10/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062101871

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 1/26/2021 04:59 PM
 Collected: 1/26/2021

Project: #18-41685, North Country Road Middle School, Miller Place Union Free School District, 191 North Country Road, Miller Place, NY

Analytical Results

Client Sample Description MILL-0293 **Collected:** 1/26/2021 **Lab ID:** 062101871-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0 µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0296 **Collected:** 1/26/2021 **Lab ID:** 062101871-0010

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	12	3.0 µg/L	2/9/2021	AM	2/10/2021	AL

Client Sample Description MILL-0298 **Collected:** 1/26/2021 **Lab ID:** 062101871-0011

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0 µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0300 **Collected:** 1/26/2021 **Lab ID:** 062101871-0012

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0 µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0302 **Collected:** 1/26/2021 **Lab ID:** 062101871-0013

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.3 J	3.0 µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0304 **Collected:** 1/26/2021 **Lab ID:** 062101871-0014

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0305 **Collected:** 1/26/2021 **Lab ID:** 062101871-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0 µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062101871

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 1/26/2021 04:59 PM
 Collected: 1/26/2021

Project: #18-41685, North Country Road Middle School, Miller Place Union Free School District, 191 North Country Road, Miller Place, NY

Analytical Results

Client Sample Description		MILL-0306		Collected:	1/26/2021	Lab ID:	062101871-0016	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0	µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		MILL-0307		Collected:	1/26/2021	Lab ID:	062101871-0017	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0	µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		MILL-0309		Collected:	1/26/2021	Lab ID:	062101871-0018	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0	µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		MILL-0310		Collected:	1/26/2021	Lab ID:	062101871-0019	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0	µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		MILL-0311		Collected:	1/26/2021	Lab ID:	062101871-0020	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0	µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		MILL-0314		Collected:	1/26/2021	Lab ID:	062101871-0021	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.2	3.0	µg/L	2/9/2021	AM	2/10/2021	AL
Client Sample Description		MILL-0315		Collected:	1/26/2021	Lab ID:	062101871-0022	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.9 J	3.0	µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L								

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062101871

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 1/26/2021 04:59 PM
 Collected: 1/26/2021

Project: #18-41685, North Country Road Middle School, Miller Place Union Free School District, 191 North Country Road, Miller Place, NY

Analytical Results

Client Sample Description MILL-0316 **Collected:** 1/26/2021 **Lab ID:** 062101871-0023

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.4	3.0 µg/L	2/9/2021	AM	2/10/2021	AL

Client Sample Description MILL-0317 **Collected:** 1/26/2021 **Lab ID:** 062101871-0024

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.8	3.0 µg/L	2/9/2021	AM	2/10/2021	AL

Client Sample Description MILL-0318 **Collected:** 1/26/2021 **Lab ID:** 062101871-0025

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.2	3.0 µg/L	2/9/2021	AM	2/10/2021	AL

Client Sample Description MILL-0319 **Collected:** 1/26/2021 **Lab ID:** 062101871-0026

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.2	3.0 µg/L	2/9/2021	AM	2/10/2021	AL

Client Sample Description MILL-0322 **Collected:** 1/26/2021 **Lab ID:** 062101871-0027

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0 µg/L	2/9/2021	AM	2/10/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description MILL-0323 **Collected:** 1/26/2021 **Lab ID:** 062101871-0028

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0 µg/L	2/9/2021	AM	2/10/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description MILL-0324 **Collected:** 1/26/2021 **Lab ID:** 062101871-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.2	3.0 µg/L	2/9/2021	AM	2/10/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062101871

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 1/26/2021 04:59 PM
 Collected: 1/26/2021

Project: #18-41685, North Country Road Middle School, Miller Place Union Free School District, 191 North Country Road, Miller Place, NY

Analytical Results

Client Sample Description		MILL-0327	Collected:	1/26/2021	Lab ID:	062101871-0030		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.1	3.0	µg/L	2/9/2021	AM	2/10/2021	AL
Client Sample Description		MILL-0328	Collected:	1/26/2021	Lab ID:	062101871-0031		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.0	3.0	µg/L	2/9/2021	AM	2/10/2021	AL
Client Sample Description		MILL-0331	Collected:	1/26/2021	Lab ID:	062101871-0033		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.7 J	3.0	µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		MILL-0333	Collected:	1/26/2021	Lab ID:	062101871-0034		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	2/9/2021	AM	2/10/2021	AL
Client Sample Description		MILL-0334	Collected:	1/26/2021	Lab ID:	062101871-0035		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0	µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		MILL-0335	Collected:	1/26/2021	Lab ID:	062101871-0036		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.2	3.0	µg/L	2/9/2021	AM	2/10/2021	AL
Client Sample Description		MILL-0337	Collected:	1/26/2021	Lab ID:	062101871-0037		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0	µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L								

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062101871

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 1/26/2021 04:59 PM
 Collected: 1/26/2021

Project: #18-41685, North Country Road Middle School, Miller Place Union Free School District, 191 North Country Road, Miller Place, NY

Analytical Results

Client Sample Description MILL-0338 **Collected:** 1/26/2021 **Lab ID:** 062101871-0038

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/9/2021	AM	2/10/2021	AL

Client Sample Description MILL-0339 **Collected:** 1/26/2021 **Lab ID:** 062101871-0039

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0 µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0340 **Collected:** 1/26/2021 **Lab ID:** 062101871-0040

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0341 **Collected:** 1/26/2021 **Lab ID:** 062101871-0041

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	11	3.0 µg/L	2/9/2021	AM	2/10/2021	AL

Client Sample Description MILL-0343 **Collected:** 1/26/2021 **Lab ID:** 062101871-0042

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.7	3.0 µg/L	2/9/2021	AM	2/10/2021	AL

Client Sample Description MILL-0344 **Collected:** 1/26/2021 **Lab ID:** 062101871-0043

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.3	3.0 µg/L	2/9/2021	AM	2/10/2021	AL

Client Sample Description MILL-0350 **Collected:** 1/26/2021 **Lab ID:** 062101871-0044

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062101871

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 1/26/2021 04:59 PM
 Collected: 1/26/2021

Project: #18-41685, North Country Road Middle School, Miller Place Union Free School District, 191 North Country Road, Miller Place, NY

Analytical Results

Client Sample Description MILL-0352 **Collected:** 1/26/2021 **Lab ID:** 062101871-0045

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0354 **Collected:** 1/26/2021 **Lab ID:** 062101871-0046

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0356 **Collected:** 1/26/2021 **Lab ID:** 062101871-0047

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0 µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0374 **Collected:** 1/26/2021 **Lab ID:** 062101871-0048

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0375 **Collected:** 1/26/2021 **Lab ID:** 062101871-0049

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0376 **Collected:** 1/26/2021 **Lab ID:** 062101871-0050

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0377 **Collected:** 1/26/2021 **Lab ID:** 062101871-0051

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/9/2021	AM	2/10/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062101871

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 1/26/2021 04:59 PM
 Collected: 1/26/2021

Project: #18-41685, North Country Road Middle School, Miller Place Union Free School District, 191 North Country Road, Miller Place, NY

Analytical Results

Client Sample Description MILL-0378 **Collected:** 1/26/2021 **Lab ID:** 062101871-0052

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.3	3.0 µg/L	2/9/2021	AM	2/10/2021	AL

Client Sample Description MILL-0379 **Collected:** 1/26/2021 **Lab ID:** 062101871-0053

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0 µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0380 **Collected:** 1/26/2021 **Lab ID:** 062101871-0054

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.8 J	3.0 µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0381 **Collected:** 1/26/2021 **Lab ID:** 062101871-0055

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.9	3.0 µg/L	2/9/2021	AM	2/10/2021	AL

Client Sample Description MILL-0382 **Collected:** 1/26/2021 **Lab ID:** 062101871-0056

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.0	3.0 µg/L	2/9/2021	AM	2/10/2021	AL

Client Sample Description MILL-0383 **Collected:** 1/26/2021 **Lab ID:** 062101871-0057

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0384 **Collected:** 1/26/2021 **Lab ID:** 062101871-0058

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0 µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062101871

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 1/26/2021 04:59 PM
 Collected: 1/26/2021

Project: #18-41685, North Country Road Middle School, Miller Place Union Free School District, 191 North Country Road, Miller Place, NY

Analytical Results

Client Sample Description MILL-0385 **Collected:** 1/26/2021 **Lab ID:** 062101871-0059

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0388 **Collected:** 1/26/2021 **Lab ID:** 062101871-0060

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.4	3.0 µg/L	2/9/2021	AM	2/10/2021	AL

Client Sample Description MILL-0389 **Collected:** 1/26/2021 **Lab ID:** 062101871-0061

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0 µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0390 **Collected:** 1/26/2021 **Lab ID:** 062101871-0062

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0392 **Collected:** 1/26/2021 **Lab ID:** 062101871-0063

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0395 **Collected:** 1/26/2021 **Lab ID:** 062101871-0064

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0 µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0396 **Collected:** 1/26/2021 **Lab ID:** 062101871-0065

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.1	3.0 µg/L	2/9/2021	AM	2/10/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062101871

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 1/26/2021 04:59 PM
 Collected: 1/26/2021

Project: #18-41685, North Country Road Middle School, Miller Place Union Free School District, 191 North Country Road, Miller Place, NY

Analytical Results

Client Sample Description MILL-0401 **Collected:** 1/26/2021 **Lab ID:** 062101871-0066

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0402 **Collected:** 1/26/2021 **Lab ID:** 062101871-0067

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0404 **Collected:** 1/26/2021 **Lab ID:** 062101871-0068

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.6 J	3.0 µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0405 **Collected:** 1/26/2021 **Lab ID:** 062101871-0069

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0 µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0407 **Collected:** 1/26/2021 **Lab ID:** 062101871-0070

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0 µg/L	2/9/2021	AM	2/10/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0408 **Collected:** 1/26/2021 **Lab ID:** 062101871-0071

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/9/2021	AM	2/10/2021	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J.C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 18-41685

Building: North Country Road Middle School

NCRMS

Client:

Miller Place Union Free School District

Retest/New Install []

Turn Around: Normal-1-wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
MILL-0294	CR	1-17	Room 4	CF	2/24/2021	6:20:00 AM
MILL-0329	CR	1-37	Room 18	CF	2/24/2021	6:17:00 AM

Samples Submitted 2

21 FEB 24 PM 12:09

MILLER PLACE, NY

Building Address

191 North Country Road

Miller Place, NY 11764

Analysis Type: ELAP 200.5 @

Lab Received: Unique McKay

Signature: Um 2/24/21 12:09 PM

Samplers Name: Griffin Hayes

Samplers Signature: Griffin Hayes

JCB Project Manager: Bryan Ezellus

062103471

Pb 200.5-
A. Young 02/24/21



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

**Bryan Ezelius
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788**

3/8/2021

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 2/24/2021. The results are tabulated on the attached data pages for the following client designated project:

**North Country Road Middle School, 191 North Country Road,
Miller Place, NY 11764, Miller Place Union Free School District,
18-11685**

The reference number for these samples is EMSL Order #062103471. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062103471

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 2/24/2021 12:09 PM
Collected: 2/24/2021

Project: North Country Road Middle School, 191 North Country Road, Miller Place, NY 11764, Miller Place Union Free School District, 18-41685

Analytical Results

Client Sample Description		MILL-0294 Room 4	Collected:	2/24/2021 6:20:00 AM	Lab ID:	062103471-0001	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	2/25/2021	AM	2/26/2021 AL

Client Sample Description		MILL-0329 Room 18	Collected:	2/24/2021 6:17:00 AM	Lab ID:	062103471-0002	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	2/25/2021	AM	2/26/2021 AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

062102537

Page 1 of 6

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 18-41685
Building: Andrew Muller Primary School

Client:
Miller Place Union Free School District

Retest/New Install []
Turn Around: Normal 1 wk Rush _____

AMPS

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
MILL-0425	OF	1-01	Custodial Office	HW	2/10/2021	6:35:00 AM
MILL-0427	KI	1-09	Kitchen	HW	2/10/2021	6:36:00 AM
MILL-0428	KI	1-09	Kitchen	KC	2/10/2021	6:37:00 AM
MILL-0429	KI	1-09	Kitchen	KC	2/10/2021	6:38:00 AM
MILL-0430	KI	1-09	Kitchen	SN	2/10/2021	6:39:00 AM
MILL-0431	KI	1-09	Kitchen	KC	2/10/2021	6:39:00 AM
MILL-0432	KI	1-09	Kitchen	HW	2/10/2021	6:40:00 AM
MILL-0433	BR	1-09A	Kitchen Locker Rooms	BF	2/10/2021	6:41:00 AM
MILL-0434	BR	1-09A	Kitchen Locker Rooms	BF	2/10/2021	6:41:00 AM
MILL-0437	BR	1-05	Staff Bathroom	BF	2/10/2021	6:43:00 AM
MILL-0438	FL	1-07	Staff Lounge	WF	2/10/2021	6:45:00 AM
MILL-0439	FL	1-07	Staff Lounge	KC	2/10/2021	6:46:00 AM
MILL-0440	FL	1-07	Staff Lounge	SN	2/10/2021	6:47:00 AM
MILL-0442	CR	1-12	Music Room	CF	2/10/2021	6:49:00 AM
MILL-0443	CR	1-12	Music Room	DW	2/10/2021	6:50:00 AM
MILL-0444	HA	1-08	Fount. by Music Room	DW	2/10/2021	6:51:00 AM
MILL-0445	CR	1-13	Room 2	CF	2/10/2021	6:52:00 AM
MILL-0446	CR	1-13	Room 2	DW	2/10/2021	6:53:00 AM

Building Address

65 Lower Rocky Point Road
Miller Place, NY 11764

Pb 200.5 -

J. Long 02/23/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Griffin Hayes

Samplers Signature: [Signature]

JCB Project Manager:

Bryan Ezels

Order ID: 062102537



Lead in Water: Chain of Custody for

062102537

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 18-41685
Building: Andrew Muller Primary School

Client:

Miller Place Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

AMPS

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
MILL-0447	CR	1-14	Room 3	CF	2/10/2021	6:54:00 AM
MILL-0448	CR	1-14	Room 3	DW	2/10/2021	6:55:00 AM
MILL-0449	SP	1-11	Stage	CF	2/10/2021	6:56:00 AM
MILL-0450	SP	1-11	Stage	SN	2/10/2021	6:57:00 AM
MILL-0451	CR	1-15	Room 4	CF	2/10/2021	6:58:00 AM
MILL-0452	CR	1-15	Room 4	DW	2/10/2021	6:59:00 AM
MILL-0453	BR	1-16	Bathroom	BF	2/10/2021	7:00:00 AM
MILL-0454	BR	1-17	Women's Bathroom	BF	2/10/2021	7:01:00 AM
MILL-0455	BR	1-17	Women's Bathroom	BF	2/10/2021	7:02:00 AM
MILL-0457	NO	1-62A	Nurse's Office	NS	2/10/2021	7:03:00 AM
MILL-0458	BR	1-62C	Nurse's Bathroom	BF	2/10/2021	7:04:00 AM
MILL-0459	CR	1-57	Room 5	CF	2/10/2021	7:05:00 AM
MILL-0461	HA	1-62	Fountain by library	DW	2/10/2021	7:06:00 AM
MILL-0462	LI	1-46	Library	KC	2/10/2021	7:07:00 AM
MILL-0463	CR	1-55	Room 6	CF	2/10/2021	7:08:00 AM
MILL-0464	CR	1-55	Room 6	DW	2/10/2021	7:09:00 AM
MILL-0465	CR	1-54	Room 9	CF	2/10/2021	7:10:00 AM
MILL-0466	CR	1-54	Room 9	DW	2/10/2021	7:11:00 AM

Building Address

65 Lower Rocky Point Road
Miller Place, NY 11764

Pb200.5 -

A. J. [Signature] 02/13/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

[Signature]

Samplers Name: Griffin Hayes

Samplers Signature: *[Signature]*

JCB Project Manager: Bryan Ezelius



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 18-41685

Building: Andrew Muller Primary School

AMPS

062102537

Client:

Miller Place Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush

Page 3 of 6

Order ID: 062102537

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
MILL-0467	CR	1-53	Room 10	CF	2/10/2021	7:12:00 AM
MILL-0469	CR	1-52	Room 11	CF	2/10/2021	7:13:00 AM
MILL-0472	CR	1-50	Room 12	CF	2/10/2021	7:14:00 AM
MILL-0473	CR	1-50	Room 12	DW	2/10/2021	7:15:00 AM
MILL-0474	CR	1-49	Room 12A	CF	2/10/2021	7:16:00 AM
MILL-0476	CR	1-48	Room 14	CF	2/10/2021	7:17:00 AM
MILL-0477	CR	1-48	Room 14	DW	2/10/2021	7:18:00 AM
MILL-0478	HA	1-62	Fountain by Room 15	DW	2/10/2021	7:19:00 AM
MILL-0479	CR	1-45	Room 15	CF	2/10/2021	7:20:00 AM
MILL-0480	CR	1-45	Room 15	DW	2/10/2021	7:21:00 AM
MILL-0481	CR	1-44	Room 16	CF	2/10/2021	7:22:00 AM
MILL-0482	CR	1-44	Room 16	DW	2/10/2021	7:23:00 AM
MILL-0483	CR	1-41	Room 17	CF	2/10/2021	7:24:00 AM
MILL-0484	CR	1-41	Room 17	DW	2/10/2021	7:25:00 AM
MILL-0485	CR	1-20	Room 18	CF	2/10/2021	7:26:00 AM
MILL-0486	CR	1-20	Room 18	DW	2/10/2021	7:26:00 AM
MILL-0487	CR	1-21	Room 19	CF	2/10/2021	7:27:00 AM
MILL-0488	CR	1-21	Room 19	DW	2/10/2021	7:28:00 AM

Building Address

65 Lower Rocky Point Road

Miller Place, NY 11764

Pb200.5-

A. J. Jany 02/23/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

[Signature]

Samplers Name: Griffin Hayes

Samplers Signature:

[Signature]

JCB Project Manager: Bryan Ezelius



Lead in Water: Chain of Custody for

062102537

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 18-41685

Building: Andrew Muller Primary School

AMPS

Client:

Miller Place Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
MILL-0489	CR	1-22	Room 20	CF	2/10/2021	7:29:00 AM
MILL-0490	CR	1-22	Room 20	DW	2/10/2021	7:29:00 AM
MILL-0491	HA	1-40	Fountain by Room 21	DW	2/10/2021	7:30:00 AM
MILL-0492	CR	1-23	Room 21	CF	2/10/2021	7:31:00 AM
MILL-0493	CR	1-23	Room 21	DW	2/10/2021	7:31:00 AM
MILL-0494	CR	1-24	Room 22	CF	2/10/2021	7:32:00 AM
MILL-0495	CR	1-24	Room 22	DW	2/10/2021	7:32:00 AM
MILL-0496	CR	1-26	Room 23	CF	2/10/2021	7:33:00 AM
MILL-0497	CR	1-26	Room 23	DW	2/10/2021	7:33:00 AM
MILL-0498	CR	1-31	Room 25	CF	2/10/2021	7:34:00 AM
MILL-0499	CR	1-31	Room 25	DW	2/10/2021	7:35:00 AM
MILL-0501	BR	1-29	Bathroom	BF	2/10/2021	7:36:00 AM
MILL-0502	BR	1-28	Bathroom	BF	2/10/2021	7:36:00 AM
MILL-0504	CR	1-35	Room 26	CF	2/10/2021	7:37:00 AM
MILL-0505	CR	1-35	Room 26	DW	2/10/2021	7:37:00 AM
MILL-0506	CR	1-34	Room 31	CF	2/10/2021	7:38:00 AM
MILL-0508	CR	1-36	Room 27	CF	2/10/2021	7:39:00 AM
MILL-0509	CR	1-36	Room 27	DW	2/10/2021	7:39:00 AM

Building Address

65 Lower Rocky Point Road

Miller Place, NY 11764

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Griffin Hayes

Samplers Signature: Griffin Hayes

JCB Project Manager: Bryan Ezellus



Lead in Water: Chain of Custody for

062102537

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 18-41685

Building: Andrew Muller Primary School

AMPS

Client:

Miller Place Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
MILL-0510	CR	1-37	Room 30	CF	2/10/2021	7:40:00 AM
MILL-0511	CR	1-37	Room 30	DW	2/10/2021	7:41:00 AM
MILL-0512	CR	1-38	Room 28	CF	2/10/2021	7:42:00 AM
MILL-0513	CR	1-38	Room 28	DW	2/10/2021	7:42:00 AM
MILL-0514	CR	1-39	Room 29	CF	2/10/2021	7:43:00 AM
MILL-0515	CR	1-39	Room 29	DW	2/10/2021	7:43:00 AM
MILL-0517	BR	N/A	Faculty Bathroom	BF	2/10/2021	7:44:00 AM
MILL-0518	CR	N/A	Room 35	CF	2/10/2021	7:45:00 AM
MILL-0519	CR	N/A	Room 35	DW	2/10/2021	7:45:00 AM
MILL-0521	CR	N/A	Room 38	CF	2/10/2021	7:46:00 AM
MILL-0522	CR	N/A	Room 38	DW	2/10/2021	7:46:00 AM
MILL-0524	CR	N/A	Room 36	CF	2/10/2021	7:47:00 AM
MILL-0525	CR	N/A	Room 36	DW	2/10/2021	7:48:00 AM
MILL-0527	CR	N/A	Room 37	CF	2/10/2021	7:49:00 AM
MILL-0528	CR	N/A	Room 37	DW	2/10/2021	7:49:00 AM
MILL-0530	CR	N/A	Room 40	CF	2/10/2021	7:50:00 AM
MILL-0533	CR	N/A	Room 39	CF	2/10/2021	7:51:00 AM
MILL-0534	CR	N/A	Room 39	DW	2/10/2021	7:51:00 AM

Building Address

65 Lower Rocky Point Road

Miller Place, NY 11764

Analysis Type: ELAP 200.5

Lab Received: _____

Signature: _____

Samplers Name: Griffin HayesSamplers Signature: Sullivan HayesJCB Project Manager: Bryan EzellusPb200.5
A. J. J. / 2/12/21Griffin Hayes



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 18-41685

Building: Andrew Muller Primary School

AMPS

062102537

Client:

Miller Place Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush

Page 6 of 6

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
MILL-0536	BR	1-59A2	Principal's Bathroom	BF	2/10/2021	7:53:00 AM

Samples Submitted 91

NOTICE
MILLER PLACE, NY
21 FEB 10 PM 4:15

Building Address

65 Lower Rocky Point Road

Miller Place, NY 11764

062102537

A. Young

Analysis Type: ELAP 200.5

Lab Received:

Signature:

[Signature]

Samplers Name: Griffin Hayes

Samplers Signature: [Signature]

JCB Project Manager: Bryan Ezelegu

Order ID: 062102537



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

**Bryan Ezelius
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788**

3/8/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 2/10/2021. The results are tabulated on the attached data pages for the following client designated project:

**18-41685, Andrew Muller Primary School, Miller Place Union Free
School District, 65 Lower Rocky Point Road, Miller Place, NY
11764**

The reference number for these samples is EMSL Order #062102537. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062102537

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 2/10/2021 04:14 PM
 Collected: 2/10/2021

Project: 18-41685, Andrew Muller Primary School, Miller Place Union Free School District, 65 Lower Rocky Point Road, Miller Place, NY 11764

Analytical Results

Client Sample Description MILL-0425 **Collected:** 2/10/2021 **Lab ID:** 062102537-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	2/22/2021	OR	2/23/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0427 **Collected:** 2/10/2021 **Lab ID:** 062102537-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.1	3.0 µg/L	2/22/2021	OR	2/23/2021	AL

Client Sample Description MILL-0428 **Collected:** 2/10/2021 **Lab ID:** 062102537-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	2/22/2021	OR	2/23/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0429 **Collected:** 2/10/2021 **Lab ID:** 062102537-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.2	3.0 µg/L	2/22/2021	OR	2/23/2021	AL

Client Sample Description MILL-0430 **Collected:** 2/10/2021 **Lab ID:** 062102537-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.4	3.0 µg/L	2/22/2021	OR	2/23/2021	AL

Client Sample Description MILL-0431 **Collected:** 2/10/2021 **Lab ID:** 062102537-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/22/2021	OR	2/23/2021	AL

Client Sample Description MILL-0432 **Collected:** 2/10/2021 **Lab ID:** 062102537-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	2/22/2021	OR	2/23/2021	AL
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062102537

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 2/10/2021 04:14 PM
 Collected: 2/10/2021

Project: 18-41685, Andrew Muller Primary School, Miller Place Union Free School District, 65 Lower Rocky Point Road, Miller Place, NY 11764

Analytical Results

Client Sample Description MILL-0433 **Collected:** 2/10/2021 **Lab ID:** 062102537-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	59	3.0 µg/L	2/22/2021	OR	2/23/2021	AL

Client Sample Description MILL-0434 **Collected:** 2/10/2021 **Lab ID:** 062102537-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	12	3.0 µg/L	2/22/2021	OR	2/23/2021	AL

Client Sample Description MILL-0437 **Collected:** 2/10/2021 **Lab ID:** 062102537-0010

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	2/22/2021	OR	2/23/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description MILL-0438 **Collected:** 2/10/2021 **Lab ID:** 062102537-0011

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/22/2021	OR	2/23/2021	AL

Client Sample Description MILL-0439 **Collected:** 2/10/2021 **Lab ID:** 062102537-0012

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/22/2021	OR	2/23/2021	AL

Client Sample Description MILL-0440 **Collected:** 2/10/2021 **Lab ID:** 062102537-0013

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/22/2021	OR	2/23/2021	AL

Client Sample Description MILL-0442 **Collected:** 2/10/2021 **Lab ID:** 062102537-0014

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.3 J	3.0 µg/L	2/22/2021	OR	2/23/2021	AL

Lead MDL: 1.0µg/L

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062102537

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 2/10/2021 04:14 PM
 Collected: 2/10/2021

Project: 18-41685, Andrew Muller Primary School, Miller Place Union Free School District, 65 Lower Rocky Point Road, Miller Place, NY 11764

Analytical Results

Client Sample Description MILL-0443 **Collected:** 2/10/2021 **Lab ID:** 062102537-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	2/22/2021	OR	2/23/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0444 **Collected:** 2/10/2021 **Lab ID:** 062102537-0016

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0 µg/L	2/22/2021	OR	2/23/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0445 **Collected:** 2/10/2021 **Lab ID:** 062102537-0017

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0 µg/L	2/22/2021	OR	2/23/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0446 **Collected:** 2/10/2021 **Lab ID:** 062102537-0018

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.6	3.0 µg/L	2/22/2021	OR	2/23/2021	AL

Client Sample Description MILL-0447 **Collected:** 2/10/2021 **Lab ID:** 062102537-0019

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	2/22/2021	OR	2/23/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0448 **Collected:** 2/10/2021 **Lab ID:** 062102537-0020

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.4	3.0 µg/L	2/22/2021	OR	2/23/2021	AL

Client Sample Description MILL-0449 **Collected:** 2/10/2021 **Lab ID:** 062102537-0021

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/22/2021	OR	2/23/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062102537

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 2/10/2021 04:14 PM
 Collected: 2/10/2021

Project: 18-41685, Andrew Muller Primary School, Miller Place Union Free School District, 65 Lower Rocky Point Road, Miller Place, NY 11764

Analytical Results

Client Sample Description MILL-0450 **Collected:** 2/10/2021 **Lab ID:** 062102537-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.9	3.0 µg/L	2/22/2021	OR	2/23/2021	AL

Client Sample Description MILL-0451 **Collected:** 2/10/2021 **Lab ID:** 062102537-0023

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.2	3.0 µg/L	2/22/2021	OR	2/23/2021	AL

Client Sample Description MILL-0452 **Collected:** 2/10/2021 **Lab ID:** 062102537-0024

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.1	3.0 µg/L	2/22/2021	OR	2/23/2021	AL

Client Sample Description MILL-0453 **Collected:** 2/10/2021 **Lab ID:** 062102537-0025

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	11	3.0 µg/L	2/22/2021	OR	2/23/2021	AL

Client Sample Description MILL-0454 **Collected:** 2/10/2021 **Lab ID:** 062102537-0026

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0 µg/L	2/22/2021	OR	2/23/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description MILL-0455 **Collected:** 2/10/2021 **Lab ID:** 062102537-0027

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/22/2021	OR	2/23/2021	AL

Client Sample Description MILL-0457 **Collected:** 2/10/2021 **Lab ID:** 062102537-0028

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.1	3.0 µg/L	2/22/2021	OR	2/23/2021	AL

Client Sample Description MILL-0458 **Collected:** 2/10/2021 **Lab ID:** 062102537-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062102537

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 2/10/2021 04:14 PM
 Collected: 2/10/2021

Project: 18-41685, Andrew Muller Primary School, Miller Place Union Free School District, 65 Lower Rocky Point Road, Miller Place, NY 11764

Analytical Results

Client Sample Description MILL-0458 **Collected:** 2/10/2021 **Lab ID:** 062102537-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0 µg/L	2/22/2021	OR	2/23/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0459 **Collected:** 2/10/2021 **Lab ID:** 062102537-0030

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	2/22/2021	OR	2/23/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0461 **Collected:** 2/10/2021 **Lab ID:** 062102537-0031

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.3 J	3.0 µg/L	2/22/2021	OR	2/23/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0462 **Collected:** 2/10/2021 **Lab ID:** 062102537-0032

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.8	3.0 µg/L	2/22/2021	OR	2/23/2021	AL

Client Sample Description MILL-0463 **Collected:** 2/10/2021 **Lab ID:** 062102537-0033

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0 µg/L	2/22/2021	OR	2/23/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0464 **Collected:** 2/10/2021 **Lab ID:** 062102537-0034

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.8	3.0 µg/L	2/22/2021	OR	2/23/2021	AL

Client Sample Description MILL-0465 **Collected:** 2/10/2021 **Lab ID:** 062102537-0035

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.6 J	3.0 µg/L	2/22/2021	OR	2/23/2021	AL
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062102537

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 2/10/2021 04:14 PM
 Collected: 2/10/2021

Project: 18-41685, Andrew Muller Primary School, Miller Place Union Free School District, 65 Lower Rocky Point Road, Miller Place, NY 11764

Analytical Results

Client Sample Description MILL-0466 **Collected:** 2/10/2021 **Lab ID:** 062102537-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0 µg/L	2/22/2021	OR	2/23/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0467 **Collected:** 2/10/2021 **Lab ID:** 062102537-0037

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0 µg/L	2/22/2021	OR	2/23/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0469 **Collected:** 2/10/2021 **Lab ID:** 062102537-0038

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0 µg/L	2/22/2021	OR	2/23/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0472 **Collected:** 2/10/2021 **Lab ID:** 062102537-0039

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0 µg/L	2/22/2021	OR	2/23/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0473 **Collected:** 2/10/2021 **Lab ID:** 062102537-0040

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/22/2021	OR	2/23/2021	AL

Client Sample Description MILL-0474 **Collected:** 2/10/2021 **Lab ID:** 062102537-0041

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	2/22/2021	AM	2/23/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0476 **Collected:** 2/10/2021 **Lab ID:** 062102537-0042

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	2/22/2021	AM	2/23/2021	AL
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062102537

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 2/10/2021 04:14 PM
 Collected: 2/10/2021

Project: 18-41685, Andrew Muller Primary School, Miller Place Union Free School District, 65 Lower Rocky Point Road, Miller Place, NY 11764

Analytical Results

Client Sample Description MILL-0477 **Collected:** 2/10/2021 **Lab ID:** 062102537-0043

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.3 J	3.0 µg/L	2/22/2021	AM	2/23/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0478 **Collected:** 2/10/2021 **Lab ID:** 062102537-0044

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.3	3.0 µg/L	2/22/2021	AM	2/23/2021	AL

Client Sample Description MILL-0479 **Collected:** 2/10/2021 **Lab ID:** 062102537-0045

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	15	3.0 µg/L	2/22/2021	AM	2/23/2021	AL

Client Sample Description MILL-0480 **Collected:** 2/10/2021 **Lab ID:** 062102537-0046

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/22/2021	AM	2/23/2021	AL

Client Sample Description MILL-0481 **Collected:** 2/10/2021 **Lab ID:** 062102537-0047

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/22/2021	AM	2/23/2021	AL

Client Sample Description MILL-0482 **Collected:** 2/10/2021 **Lab ID:** 062102537-0048

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.7	3.0 µg/L	2/22/2021	AM	2/23/2021	AL

Client Sample Description MILL-0483 **Collected:** 2/10/2021 **Lab ID:** 062102537-0049

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.8 J	3.0 µg/L	2/22/2021	AM	2/23/2021	AL
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062102537

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 2/10/2021 04:14 PM
 Collected: 2/10/2021

Project: 18-41685, Andrew Muller Primary School, Miller Place Union Free School District, 65 Lower Rocky Point Road, Miller Place, NY 11764

Analytical Results

Client Sample Description MILL-0484 **Collected:** 2/10/2021 **Lab ID:** 062102537-0050

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.0	3.0 µg/L	2/22/2021	AM	2/23/2021	AL

Client Sample Description MILL-0485 **Collected:** 2/10/2021 **Lab ID:** 062102537-0051

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/22/2021	AM	2/23/2021	AL

Client Sample Description MILL-0486 **Collected:** 2/10/2021 **Lab ID:** 062102537-0052

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.3	3.0 µg/L	2/22/2021	AM	2/23/2021	AL

Client Sample Description MILL-0487 **Collected:** 2/10/2021 **Lab ID:** 062102537-0053

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	2/22/2021	AM	2/23/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description MILL-0488 **Collected:** 2/10/2021 **Lab ID:** 062102537-0054

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.9	3.0 µg/L	2/22/2021	AM	2/23/2021	AL

Client Sample Description MILL-0489 **Collected:** 2/10/2021 **Lab ID:** 062102537-0055

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.1	3.0 µg/L	2/22/2021	AM	2/23/2021	AL

Client Sample Description MILL-0490 **Collected:** 2/10/2021 **Lab ID:** 062102537-0056

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	2/22/2021	AM	2/23/2021	AL

Lead MDL: 1.0µg/L

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062102537

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 2/10/2021 04:14 PM
 Collected: 2/10/2021

Project: 18-41685, Andrew Muller Primary School, Miller Place Union Free School District, 65 Lower Rocky Point Road, Miller Place, NY 11764

Analytical Results

Client Sample Description MILL-0491 **Collected:** 2/10/2021 **Lab ID:** 062102537-0057

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	2/22/2021	AM	2/23/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0492 **Collected:** 2/10/2021 **Lab ID:** 062102537-0058

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.2 J	3.0 µg/L	2/22/2021	AM	2/23/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0493 **Collected:** 2/10/2021 **Lab ID:** 062102537-0059

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.8 J	3.0 µg/L	2/22/2021	AM	2/23/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0494 **Collected:** 2/10/2021 **Lab ID:** 062102537-0060

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0 µg/L	2/22/2021	AM	2/23/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0495 **Collected:** 2/10/2021 **Lab ID:** 062102537-0061

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.2 J	3.0 µg/L	2/22/2021	AM	2/23/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0496 **Collected:** 2/10/2021 **Lab ID:** 062102537-0062

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.1 J	3.0 µg/L	2/22/2021	AM	2/23/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0497 **Collected:** 2/10/2021 **Lab ID:** 062102537-0063

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.9	3.0 µg/L	2/22/2021	AM	2/23/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062102537

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 2/10/2021 04:14 PM
 Collected: 2/10/2021

Project: 18-41685, Andrew Muller Primary School, Miller Place Union Free School District, 65 Lower Rocky Point Road, Miller Place, NY 11764

Analytical Results

Client Sample Description MILL-0498 **Collected:** 2/10/2021 **Lab ID:** 062102537-0064

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0 µg/L	2/22/2021	AM	2/23/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0499 **Collected:** 2/10/2021 **Lab ID:** 062102537-0065

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.8	3.0 µg/L	2/22/2021	AM	2/23/2021	AL

Client Sample Description MILL-0501 **Collected:** 2/10/2021 **Lab ID:** 062102537-0066

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	2/22/2021	AM	2/23/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0502 **Collected:** 2/10/2021 **Lab ID:** 062102537-0067

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.3 J	3.0 µg/L	2/22/2021	AM	2/23/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0504 **Collected:** 2/10/2021 **Lab ID:** 062102537-0068

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	2/22/2021	AM	2/23/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0505 **Collected:** 2/10/2021 **Lab ID:** 062102537-0069

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.4	3.0 µg/L	2/22/2021	AM	2/23/2021	AL

Client Sample Description MILL-0506 **Collected:** 2/10/2021 **Lab ID:** 062102537-0070

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.2 J	3.0 µg/L	2/22/2021	AM	2/23/2021	AL
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062102537

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 2/10/2021 04:14 PM
 Collected: 2/10/2021

Project: 18-41685, Andrew Muller Primary School, Miller Place Union Free School District, 65 Lower Rocky Point Road, Miller Place, NY 11764

Analytical Results

Client Sample Description		MILL-0508		Collected:	2/10/2021	Lab ID:	062102537-0071	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0	µg/L	2/22/2021	AM	2/23/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		MILL-0509		Collected:	2/10/2021	Lab ID:	062102537-0072	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.6 J	3.0	µg/L	2/22/2021	AM	2/23/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		MILL-0510		Collected:	2/10/2021	Lab ID:	062102537-0073	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	2/22/2021	AM	2/23/2021	AL
Client Sample Description		MILL-0511		Collected:	2/10/2021	Lab ID:	062102537-0074	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.1	3.0	µg/L	2/22/2021	AM	2/23/2021	AL
Client Sample Description		MILL-0512		Collected:	2/10/2021	Lab ID:	062102537-0075	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	2/22/2021	AM	2/23/2021	AL
Client Sample Description		MILL-0513		Collected:	2/10/2021	Lab ID:	062102537-0076	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.6 J	3.0	µg/L	2/22/2021	AM	2/23/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		MILL-0514		Collected:	2/10/2021	Lab ID:	062102537-0077	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	16	3.0	µg/L	2/22/2021	AM	2/23/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062102537

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 2/10/2021 04:14 PM
 Collected: 2/10/2021

Project: 18-41685, Andrew Muller Primary School, Miller Place Union Free School District, 65 Lower Rocky Point Road, Miller Place, NY 11764

Analytical Results

Client Sample Description MILL-0515 **Collected:** 2/10/2021 **Lab ID:** 062102537-0078

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 J	3.0 µg/L	2/22/2021	AM	2/23/2021	AL

Client Sample Description MILL-0517 **Collected:** 2/10/2021 **Lab ID:** 062102537-0079

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/22/2021	AM	2/23/2021	AL

Client Sample Description MILL-0518 **Collected:** 2/10/2021 **Lab ID:** 062102537-0080

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/22/2021	AM	2/23/2021	AL

Client Sample Description MILL-0519 **Collected:** 2/10/2021 **Lab ID:** 062102537-0081

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/22/2021	OR	2/23/2021	AL

Client Sample Description MILL-0521 **Collected:** 2/10/2021 **Lab ID:** 062102537-0082

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/22/2021	OR	2/23/2021	AL

Client Sample Description MILL-0522 **Collected:** 2/10/2021 **Lab ID:** 062102537-0083

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/22/2021	OR	2/23/2021	AL

Client Sample Description MILL-0524 **Collected:** 2/10/2021 **Lab ID:** 062102537-0084

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/22/2021	OR	2/23/2021	AL

Client Sample Description MILL-0525 **Collected:** 2/10/2021 **Lab ID:** 062102537-0085

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062102537

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 2/10/2021 04:14 PM
 Collected: 2/10/2021

Project: 18-41685, Andrew Muller Primary School, Miller Place Union Free School District, 65 Lower Rocky Point Road, Miller Place, NY 11764

Analytical Results

Client Sample Description		MILL-0525	Collected:	2/10/2021	Lab ID:	062102537-0085		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	2/22/2021	OR	2/23/2021	AL
Client Sample Description		MILL-0527	Collected:	2/10/2021	Lab ID:	062102537-0086		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	2/22/2021	OR	2/23/2021	AL
Client Sample Description		MILL-0528	Collected:	2/10/2021	Lab ID:	062102537-0087		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	2/22/2021	OR	2/23/2021	AL
Client Sample Description		MILL-0530	Collected:	2/10/2021	Lab ID:	062102537-0088		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	2/22/2021	OR	2/23/2021	AL
Client Sample Description		MILL-0533	Collected:	2/10/2021	Lab ID:	062102537-0089		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	2/22/2021	OR	2/23/2021	AL
Client Sample Description		MILL-0534	Collected:	2/10/2021	Lab ID:	062102537-0090		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	2/22/2021	OR	2/23/2021	AL
Client Sample Description		MILL-0536	Collected:	2/10/2021	Lab ID:	062102537-0091		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0	µg/L	2/22/2021	OR	2/23/2021	AL
Lead MDL: 1.0µg/L								



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>

carleplacelab@emsl.com

EMSL Order:	062102537
CustomerID:	JCBR50
CustomerPO:	
ProjectID:	

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 18-41685

Building: Laddie Decker Sound Beach School

LDSBS

0621 02581

Client:

Miller Place Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Page 1 of 5

OrderID: 062102581

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
MILL-0549	KI	0-62	Kitchen	HW	2/11/2021	7:00:00 AM
MILL-0550	KI	0-62	Kitchen	PK	2/11/2021	7:01:00 AM
MILL-0551	KI	0-62	Kitchen	KC	2/11/2021	7:02:00 AM
MILL-0552	KI	0-62	Kitchen	KC	2/11/2021	7:03:00 AM
MILL-0553	KI	0-62	Kitchen	KC	2/11/2021	7:04:00 AM
MILL-0554	KI	0-62	Kitchen	HW	2/11/2021	7:05:00 AM
MILL-0556	BR	0-62AI	Kitchen BR	BF	2/11/2021	7:06:00 AM
MILL-0557	FL	0-61	Faculty Dining	KC	2/11/2021	7:07:00 AM
MILL-0558	FL	0-61	Faculty Dining	SN	2/11/2021	7:08:00 AM
MILL-0559	CA	0-64	Cafeteria	WF	2/11/2021	7:09:00 AM
MILL-0561	BR	0-73A	Boiler Room BR	BF	2/11/2021	7:10:00 AM
MILL-0563	BR	0-32	Men's Bathroom	BF	2/11/2021	7:11:00 AM
MILL-0564	BR	0-71	Women's Bathroom	BF	2/11/2021	7:12:00 AM
MILL-0566	BR	0-69	Boy's Bathroom	BF	2/11/2021	7:13:00 AM
MILL-0568	HA	0-74	Outside Elevator	WF	2/11/2021	7:14:00 AM
MILL-0570	BR	0-68	Girl's Bathroom	BF	2/11/2021	7:15:00 AM
MILL-0575	CR	1-58	Room 102	CF	2/11/2021	5:55:00 AM
MILL-0576	CR	1-59	Room 101	CF	2/11/2021	5:56:00 AM

Building Address

197 North Country Road P.O. Box 5 -

Miller Place, NY 11764

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Griffin Hayes

Samplers Signature:

JCB Project Manager:

Bryan Ezell

A. Lundy 02/25/21

CP AL
JCB



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 18-41685

Building: Laddie Decker Sound Beach School

LDSBS

062102581

Client:

Miller Place Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Page 2 of 5

Order ID: 062102581

Sample ID	Functional Space Type	AMERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
MILL-0577	CR	1-56	Room 103	CF	2/11/2021	5:57:00 AM
MILL-0578	CR	1-57	Room 104	CF	2/11/2021	5:58:00 AM
MILL-0579	CR	1-54	Room 105	CF	2/11/2021	5:59:00 AM
MILL-0580	CR	1-55	Room 106	CF	2/11/2021	6:00:00 AM
MILL-0582	CR	1-50	Room 109	CF	2/11/2021	6:01:00 AM
MILL-0583	CR	1-51	Room 110	CF	2/11/2021	6:02:00 AM
MILL-0584	CR	1-48	Room 111	CF	2/11/2021	6:03:00 AM
MILL-0585	CR	1-49	Room 112	CF	2/11/2021	6:04:00 AM
MILL-0586	CR	1-46	Room 113	CF	2/11/2021	6:05:00 AM
MILL-0587	CR	1-47	Room 114	CF	2/11/2021	6:06:00 AM
MILL-0588	CR	1-44	Room 115	CF	2/11/2021	6:07:00 AM
MILL-0589	CR	1-45	Room 116	CF	2/11/2021	6:08:00 AM
MILL-0590	CR	N/A	Room 125	CF	2/11/2021	6:09:00 AM
MILL-0591	CR	N/A	Room 125	DW	2/11/2021	6:10:00 AM
MILL-0592	BR	N/A	Room 125 Bathroom	BF	2/11/2021	6:11:00 AM
MILL-0594	CR	N/A	Room 124	CF	2/11/2021	6:12:00 AM
MILL-0595	CR	N/A	Room 124	DW	2/11/2021	6:13:00 AM
MILL-0596	BR	N/A	Room 124 Bathroom	BF	2/11/2021	6:14:00 AM

Building Address

197 North Country Road

Miller Place, NY 11764

Pb 200.5-

A. J. J. 02/25/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Griffin Hayes

Samplers Signature:

JCB Project Manager:

Bryan Ezelms

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
MILL-0598	CR	N/A	Room 123	CF	2/11/2021	6:15:00 AM
MILL-0599	CR	N/A	Room 123	DW	2/11/2021	6:16:00 AM
MILL-0600	BR	N/A	Room 123 Bathroom	BF	2/11/2021	6:17:00 AM
MILL-0602	CR	N/A	Room 122	CF	2/11/2021	6:18:00 AM
MILL-0603	CR	N/A	Room 122	DW	2/11/2021	6:19:00 AM
MILL-0604	BR	N/A	Room 122 Bathroom	BF	2/11/2021	6:20:00 AM
MILL-0606	CR	N/A	Room 121	CF	2/11/2021	6:21:00 AM
MILL-0607	CR	N/A	Room 121	DW	2/11/2021	6:22:00 AM
MILL-0608	BR	N/A	Room 121 Bathroom	BF	2/11/2021	6:23:00 AM
MILL-0610	CR	N/A	Room 120	CF	2/11/2021	6:24:00 AM
MILL-0611	CR	N/A	Room 120	DW	2/11/2021	6:25:00 AM
MILL-0612	BR	N/A	Room 120 Bathroom	BF	2/11/2021	6:26:00 AM
MILL-0614	CR	N/A	Room 119	CF	2/11/2021	6:27:00 AM
MILL-0615	CR	N/A	Room 119	DW	2/11/2021	6:28:00 AM
MILL-0616	BR	N/A	Room 119 Bathroom	BF	2/11/2021	6:28:00 AM
MILL-0618	CR	N/A	Room 118	CF	2/11/2021	6:29:00 AM
MILL-0619	CR	N/A	Room 118	DW	2/11/2021	6:30:00 AM
MILL-0620	BR	N/A	Room 118 Bathroom	BF	2/11/2021	6:31:00 AM

Building Address

197 North Country Road
Miller Place , NY 11764

Pb 700.5-

Analysis Type: ELAP 200.5**Lab Recieved:**

Signature:

Samplers Name: Griffin Hayes

Samplers Signature:

JCB Project Manager: Bryan Ezels



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 18-41685

Building: Laddie Decker Sound Beach School

LDSBS

062102581

Client:

Miller Place Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush

Page 4 of 5

Order ID: 062102581

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
MILL-0623	NO	1-41A	Nurse	NS	2/11/2021	6:32:00 AM
MILL-0624	BR	1-41A2	Nurse BR	BF	2/11/2021	6:33:00 AM
MILL-0625	BR	1-40	Women's Bathroom	BF	2/11/2021	6:34:00 AM
MILL-0627	BR	1-39	Men's Bathroom	BF	2/11/2021	6:35:00 AM
MILL-0629	LI	1-35	Library	HW	2/11/2021	6:36:00 AM
MILL-0630	HA	1-42	Outside Elevator	WF	2/11/2021	6:37:00 AM
MILL-0632	CR	1-02	Room 143	CF	2/11/2021	6:38:00 AM
MILL-0633	CR	1-01	Room 144	CF	2/11/2021	6:39:00 AM
MILL-0635	CR	1-05	Room 140	CF	2/11/2021	6:40:00 AM
MILL-0636	CR	1-06	Room 139	CF	2/11/2021	6:41:00 AM
MILL-0637	CR	1-07	Room 138	CF	2/11/2021	6:42:00 AM
MILL-0638	CR	1-08	Room 137	CF	2/11/2021	6:43:00 AM
MILL-0640	CR	1-11	Room 147	CF	2/11/2021	6:44:00 AM
MILL-0641	CR	1-12	Room 148	CF	2/11/2021	6:45:00 AM
MILL-0642	CR	1-13	Room 149	CF	2/11/2021	6:46:00 AM
MILL-0643	CR	1-14	Room 150	CF	2/11/2021	6:47:00 AM
MILL-0644	CR	1-16	Room 151	CF	2/11/2021	6:48:00 AM
MILL-0645	KI/OF	1-30A	Room 135B Kitchen	KC	2/11/2021	6:58:00 AM

Building Address

197 North Country Road

Miller Place, NY 11764

06203.5-

[Signature]

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Griffin Hayes

Samplers Signature:

JCB Project Manager:

[Signature]

Bryan Ezelus



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 18-41685

Building: Laddie Decker Sound Beach School

LDSBS

062102581

Client:

Miller Place Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Page 5 of 5

OrderID: 062102581

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
MILL-0646	BR	1-30B1	Principal Bathroom	BF	2/11/2021	6:59:00 AM
MILL-0647	CR	1-17	Room 152	CF	2/11/2021	6:49:00 AM
MILL-0648	CR	1-19	Room 153	CF	2/11/2021	6:50:00 AM
MILL-0649	CR	1-18	Room 154	CF	2/11/2021	6:51:00 AM
MILL-0650	BR	1-22A	Room 156 Bathroom	BF	2/11/2021	6:52:00 AM
MILL-0651	BR	1-23A	Room 157 Bathroom	BF	2/11/2021	6:53:00 AM
MILL-0652	BR	1-24A	Room 158 Bathroom	BF	2/11/2021	6:54:00 AM
MILL-0653	BR	1-25A	Room 159 Bathroom	BF	2/11/2021	6:55:00 AM
MILL-0655	BR	1-28A	Room 160 Bathroom	BF	2/11/2021	6:56:00 AM
MILL-0656	BR	1-27A	Room 161 Bathroom	BF	2/11/2021	6:57:00 AM

Samples Submitted 82

21 FEB 11 PM 1:50

ANALYST: JCB
MILLER PLACE, NY

Building Address

197 North Country Road

Miller Place, NY 11764

20203.5

J. J. J. 02/15/21

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Griffin Hayes

Samplers Signature:

JCB Project Manager:

Bryan Ezelus



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

**Bryan Ezelius
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788**

3/8/2021

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 2/11/2021. The results are tabulated on the attached data pages for the following client designated project:

**18-41685, Laddie Decker Sound Beach School, Miller Place
Union Free School District, 197 North Country Road, Miller Place,
NY 11764**

The reference number for these samples is EMSL Order #062102581. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062102581

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 2/11/2021 01:50 PM
 Collected: 2/11/2021

Project: 18-41685, Laddie Decker Sound Beach School, Miller Place Union Free School District, 197 North Country Road, Miller Place, NY 11764

Analytical Results

Client Sample Description		MILL-0549	Collected:	2/11/2021	Lab ID:	062102581-0001		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	16	3.0	µg/L	2/24/2021	AM	2/25/2021	AL
Client Sample Description		MILL-0550	Collected:	2/11/2021	Lab ID:	062102581-0002		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	110	3.0	µg/L	2/24/2021	AM	2/25/2021	AL
Client Sample Description		MILL-0551	Collected:	2/11/2021	Lab ID:	062102581-0003		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.1	3.0	µg/L	2/24/2021	AM	2/25/2021	AL
Client Sample Description		MILL-0552	Collected:	2/11/2021	Lab ID:	062102581-0004		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	19	3.0	µg/L	2/24/2021	AM	2/25/2021	AL
Client Sample Description		MILL-0553	Collected:	2/11/2021	Lab ID:	062102581-0005		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.4	3.0	µg/L	2/24/2021	AM	2/25/2021	AL
Client Sample Description		MILL-0554	Collected:	2/11/2021	Lab ID:	062102581-0006		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	2/24/2021	AM	2/25/2021	AL
Client Sample Description		MILL-0556	Collected:	2/11/2021	Lab ID:	062102581-0007		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	51	3.0	µg/L	2/24/2021	AM	2/25/2021	AL
Client Sample Description		MILL-0557	Collected:	2/11/2021	Lab ID:	062102581-0008		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062102581

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 2/11/2021 01:50 PM
 Collected: 2/11/2021

Project: 18-41685, Laddie Decker Sound Beach School, Miller Place Union Free School District, 197 North Country Road, Miller Place, NY 11764

Analytical Results

Client Sample Description MILL-0557 **Collected:** 2/11/2021 **Lab ID:** 062102581-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.4	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0558 **Collected:** 2/11/2021 **Lab ID:** 062102581-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.8	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0559 **Collected:** 2/11/2021 **Lab ID:** 062102581-0010

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0561 **Collected:** 2/11/2021 **Lab ID:** 062102581-0011

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.5	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0563 **Collected:** 2/11/2021 **Lab ID:** 062102581-0012

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description MILL-0564 **Collected:** 2/11/2021 **Lab ID:** 062102581-0013

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.2	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0566 **Collected:** 2/11/2021 **Lab ID:** 062102581-0014

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.1	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0568 **Collected:** 2/11/2021 **Lab ID:** 062102581-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062102581

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 2/11/2021 01:50 PM
 Collected: 2/11/2021

Project: 18-41685, Laddie Decker Sound Beach School, Miller Place Union Free School District, 197 North Country Road, Miller Place, NY 11764

Analytical Results

Client Sample Description MILL-0568 **Collected:** 2/11/2021 **Lab ID:** 062102581-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0570 **Collected:** 2/11/2021 **Lab ID:** 062102581-0016

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.5	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0575 **Collected:** 2/11/2021 **Lab ID:** 062102581-0017

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.4	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0576 **Collected:** 2/11/2021 **Lab ID:** 062102581-0018

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.2	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0577 **Collected:** 2/11/2021 **Lab ID:** 062102581-0019

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.2	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0578 **Collected:** 2/11/2021 **Lab ID:** 062102581-0020

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description MILL-0579 **Collected:** 2/11/2021 **Lab ID:** 062102581-0021

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.9 J	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Lead MDL: 1.0µg/L

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062102581

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 2/11/2021 01:50 PM
 Collected: 2/11/2021

Project: 18-41685, Laddie Decker Sound Beach School, Miller Place Union Free School District, 197 North Country Road, Miller Place, NY 11764

Analytical Results

Client Sample Description		MILL-0580		Collected:	2/11/2021	Lab ID:	062102581-0022	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.1	3.0	µg/L	2/24/2021	AM	2/25/2021	AL
Client Sample Description		MILL-0582		Collected:	2/11/2021	Lab ID:	062102581-0023	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.4	3.0	µg/L	2/24/2021	AM	2/25/2021	AL
Client Sample Description		MILL-0583		Collected:	2/11/2021	Lab ID:	062102581-0024	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	12	3.0	µg/L	2/24/2021	AM	2/25/2021	AL
Client Sample Description		MILL-0584		Collected:	2/11/2021	Lab ID:	062102581-0025	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.7	3.0	µg/L	2/24/2021	AM	2/25/2021	AL
Client Sample Description		MILL-0585		Collected:	2/11/2021	Lab ID:	062102581-0026	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.5	3.0	µg/L	2/24/2021	AM	2/25/2021	AL
Client Sample Description		MILL-0586		Collected:	2/11/2021	Lab ID:	062102581-0027	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.6	3.0	µg/L	2/24/2021	AM	2/25/2021	AL
Client Sample Description		MILL-0587		Collected:	2/11/2021	Lab ID:	062102581-0028	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	11	3.0	µg/L	2/24/2021	AM	2/25/2021	AL
Client Sample Description		MILL-0588		Collected:	2/11/2021	Lab ID:	062102581-0029	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062102581

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 2/11/2021 01:50 PM
 Collected: 2/11/2021

Project: 18-41685, Laddie Decker Sound Beach School, Miller Place Union Free School District, 197 North Country Road, Miller Place, NY 11764

Analytical Results

Client Sample Description MILL-0588 **Collected:** 2/11/2021 **Lab ID:** 062102581-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.2	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0589 **Collected:** 2/11/2021 **Lab ID:** 062102581-0030

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.9	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0590 **Collected:** 2/11/2021 **Lab ID:** 062102581-0031

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0591 **Collected:** 2/11/2021 **Lab ID:** 062102581-0032

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0592 **Collected:** 2/11/2021 **Lab ID:** 062102581-0033

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0594 **Collected:** 2/11/2021 **Lab ID:** 062102581-0034

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0595 **Collected:** 2/11/2021 **Lab ID:** 062102581-0035

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0596 **Collected:** 2/11/2021 **Lab ID:** 062102581-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062102581

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 2/11/2021 01:50 PM
 Collected: 2/11/2021

Project: 18-41685, Laddie Decker Sound Beach School, Miller Place Union Free School District, 197 North Country Road, Miller Place, NY 11764

Analytical Results

Client Sample Description MILL-0596 **Collected:** 2/11/2021 **Lab ID:** 062102581-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	2/24/2021	AM	2/25/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0598 **Collected:** 2/11/2021 **Lab ID:** 062102581-0037

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0599 **Collected:** 2/11/2021 **Lab ID:** 062102581-0038

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	2/24/2021	AM	2/25/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0600 **Collected:** 2/11/2021 **Lab ID:** 062102581-0039

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0 µg/L	2/24/2021	AM	2/25/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0602 **Collected:** 2/11/2021 **Lab ID:** 062102581-0040

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	2/24/2021	AM	2/25/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0603 **Collected:** 2/11/2021 **Lab ID:** 062102581-0041

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0604 **Collected:** 2/11/2021 **Lab ID:** 062102581-0042

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0 µg/L	2/24/2021	AM	2/25/2021	AL
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062102581

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 2/11/2021 01:50 PM
 Collected: 2/11/2021

Project: 18-41685, Laddie Decker Sound Beach School, Miller Place Union Free School District, 197 North Country Road, Miller Place, NY 11764

Analytical Results

Client Sample Description		MILL-0606		Collected:	2/11/2021	Lab ID:	062102581-0043	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	2/24/2021	AM	2/25/2021	AL
Client Sample Description		MILL-0607		Collected:	2/11/2021	Lab ID:	062102581-0044	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	2/24/2021	AM	2/25/2021	AL
Client Sample Description		MILL-0608		Collected:	2/11/2021	Lab ID:	062102581-0045	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	2/24/2021	AM	2/25/2021	AL
Client Sample Description		MILL-0610		Collected:	2/11/2021	Lab ID:	062102581-0046	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0	µg/L	2/24/2021	AM	2/25/2021	AL
Lead MDL: 1.0µg/L								
Client Sample Description		MILL-0611		Collected:	2/11/2021	Lab ID:	062102581-0047	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	2/24/2021	AM	2/25/2021	AL
Client Sample Description		MILL-0612		Collected:	2/11/2021	Lab ID:	062102581-0048	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	2/24/2021	AM	2/25/2021	AL
Client Sample Description		MILL-0614		Collected:	2/11/2021	Lab ID:	062102581-0049	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	2/24/2021	AM	2/25/2021	AL
Client Sample Description		MILL-0615		Collected:	2/11/2021	Lab ID:	062102581-0050	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062102581

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 2/11/2021 01:50 PM
 Collected: 2/11/2021

Project: 18-41685, Laddie Decker Sound Beach School, Miller Place Union Free School District, 197 North Country Road, Miller Place, NY 11764

Analytical Results

Client Sample Description MILL-0615 **Collected:** 2/11/2021 **Lab ID:** 062102581-0050

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0616 **Collected:** 2/11/2021 **Lab ID:** 062102581-0051

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description MILL-0618 **Collected:** 2/11/2021 **Lab ID:** 062102581-0052

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0619 **Collected:** 2/11/2021 **Lab ID:** 062102581-0053

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0620 **Collected:** 2/11/2021 **Lab ID:** 062102581-0054

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0623 **Collected:** 2/11/2021 **Lab ID:** 062102581-0055

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.3 J	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description MILL-0624 **Collected:** 2/11/2021 **Lab ID:** 062102581-0056

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Lead MDL: 1.0µg/L

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062102581

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 2/11/2021 01:50 PM
 Collected: 2/11/2021

Project: 18-41685, Laddie Decker Sound Beach School, Miller Place Union Free School District, 197 North Country Road, Miller Place, NY 11764

Analytical Results

Client Sample Description MILL-0625 **Collected:** 2/11/2021 **Lab ID:** 062102581-0057

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	2/24/2021	AM	2/25/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0627 **Collected:** 2/11/2021 **Lab ID:** 062102581-0058

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 J	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0629 **Collected:** 2/11/2021 **Lab ID:** 062102581-0059

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	23	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0630 **Collected:** 2/11/2021 **Lab ID:** 062102581-0060

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0632 **Collected:** 2/11/2021 **Lab ID:** 062102581-0061

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.0	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0633 **Collected:** 2/11/2021 **Lab ID:** 062102581-0062

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	13	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0635 **Collected:** 2/11/2021 **Lab ID:** 062102581-0063

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.0	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0636 **Collected:** 2/11/2021 **Lab ID:** 062102581-0064

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062102581

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 2/11/2021 01:50 PM
 Collected: 2/11/2021

Project: 18-41685, Laddie Decker Sound Beach School, Miller Place Union Free School District, 197 North Country Road, Miller Place, NY 11764

Analytical Results

Client Sample Description		MILL-0636	Collected:		2/11/2021	Lab ID:		062102581-0064
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	24	3.0	µg/L	2/24/2021	AM	2/25/2021	AL
Client Sample Description		MILL-0637	Collected:		2/11/2021	Lab ID:		062102581-0065
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.9	3.0	µg/L	2/24/2021	AM	2/25/2021	AL
Client Sample Description		MILL-0638	Collected:		2/11/2021	Lab ID:		062102581-0066
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	63	3.0	µg/L	2/24/2021	AM	2/25/2021	AL
Client Sample Description		MILL-0640	Collected:		2/11/2021	Lab ID:		062102581-0067
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	19	3.0	µg/L	2/24/2021	AM	2/25/2021	AL
Client Sample Description		MILL-0641	Collected:		2/11/2021	Lab ID:		062102581-0068
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	19	3.0	µg/L	2/24/2021	AM	2/25/2021	AL
Client Sample Description		MILL-0642	Collected:		2/11/2021	Lab ID:		062102581-0069
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.8	3.0	µg/L	2/24/2021	AM	2/25/2021	AL
Client Sample Description		MILL-0643	Collected:		2/11/2021	Lab ID:		062102581-0070
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.2	3.0	µg/L	2/24/2021	AM	2/25/2021	AL
Client Sample Description		MILL-0644	Collected:		2/11/2021	Lab ID:		062102581-0071
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062102581

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 2/11/2021 01:50 PM
 Collected: 2/11/2021

Project: 18-41685, Laddie Decker Sound Beach School, Miller Place Union Free School District, 197 North Country Road, Miller Place, NY 11764

Analytical Results

Client Sample Description MILL-0644 **Collected:** 2/11/2021 **Lab ID:** 062102581-0071

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.7	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0645 **Collected:** 2/11/2021 **Lab ID:** 062102581-0072

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description MILL-0646 **Collected:** 2/11/2021 **Lab ID:** 062102581-0073

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	21	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0647 **Collected:** 2/11/2021 **Lab ID:** 062102581-0074

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.6	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0648 **Collected:** 2/11/2021 **Lab ID:** 062102581-0075

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	20	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0649 **Collected:** 2/11/2021 **Lab ID:** 062102581-0076

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.2	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0650 **Collected:** 2/11/2021 **Lab ID:** 062102581-0077

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0651 **Collected:** 2/11/2021 **Lab ID:** 062102581-0078

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062102581

CustomerID: JC BR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 2/11/2021 01:50 PM
 Collected: 2/11/2021

Project: 18-41685, Laddie Decker Sound Beach School, Miller Place Union Free School District, 197 North Country Road, Miller Place, NY 11764

Analytical Results

Client Sample Description MILL-0651 **Collected:** 2/11/2021 **Lab ID:** 062102581-0078

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0 µg/L	2/24/2021	AM	2/25/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0652 **Collected:** 2/11/2021 **Lab ID:** 062102581-0079

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0653 **Collected:** 2/11/2021 **Lab ID:** 062102581-0080

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/24/2021	AM	2/25/2021	AL

Client Sample Description MILL-0655 **Collected:** 2/11/2021 **Lab ID:** 062102581-0081

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/23/2021	AM	2/24/2021	AL

Client Sample Description MILL-0656 **Collected:** 2/11/2021 **Lab ID:** 062102581-0082

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0 µg/L	2/23/2021	AM	2/24/2021	AL
Lead MDL: 1.0µg/L							

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 18-41685
Building: Miller Place High School
MPHS

062103502

Client: Miller Place Union Free School District
Retest/New Install []
Turn Around: Normal 1 wk Rush _____

Page 1 of 4

Order ID: 062103502

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
MILL-0001	BR	1058A	Custodial Office BR	BF	2/12/2021	5:20:00 AM
MILL-0002	ST	1057	Kitchen Storage	WC	2/12/2021	5:21:00 AM
MILL-0003	KI	1056I	Serving Area	HW	2/12/2021	5:22:00 AM
MILL-0004	KI	1056I	Serving Area	CP	2/12/2021	5:22:00 AM
MILL-0005	KI	1056J	Kitchen	HW	2/12/2021	5:23:00 AM
MILL-0006	KI	1056J	Kitchen	KC	2/12/2021	5:24:00 AM
MILL-0007	KI	1056J	Kitchen	KC	2/12/2021	5:24:00 AM
MILL-0008	KI	1056J	Kitchen	KC	2/12/2021	5:25:00 AM
MILL-0009	KI	1056J	Kitchen	SN	2/12/2021	5:26:00 AM
MILL-0010	KI	1056J	Kitchen	KC	2/12/2021	5:26:00 AM
MILL-0011	KI	1056J	Kitchen	IM	2/12/2021	5:27:00 AM
MILL-0012	KI	1056	Serving Area	HW	2/12/2021	5:28:00 AM
MILL-0013	BR	1056A	Kitchen Bathroom	BF	2/12/2021	5:29:00 AM
MILL-0015	CA	1055	Cafeteria	WF	2/12/2021	5:31:00 AM
MILL-0017	CA	1055	Cafeteria	WF	2/12/2021	5:30:00 AM
MILL-0020	LR	1068	Boy's LR	BF	2/12/2021	5:32:00 AM
MILL-0021	LR	1068	Boy's LR	BF	2/12/2021	5:32:00 AM
MILL-0022	LR	1068	Boy's LR	BF	2/12/2021	5:33:00 AM

Building Address
15 Memorial Drive
Miller Place, NY 11764

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Griffin Hayes
Samplers Signature: *[Signature]*
JCB Project Manager: Bryan Ezels



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 18-41685
Building: Miller Place High School
MPHS

062103502

Client: Miller Place Union Free School District
Retest/New Install []
Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
MILL-0024	LR	1068	Boy's LR	DW	2/12/2021	5:34:00 AM
MILL-0025	LR	1068	Boy's LR	DW	2/12/2021	5:35:00 AM
MILL-0028	BR	1068B2	Coach's Office (Boys) BR	BF	2/12/2021	5:36:00 AM
MILL-0029	BR	1073A	Coach's Offices (Girls) BR	BF	2/12/2021	5:37:00 AM
MILL-0031	LR	1074	Girl's LR	BF	2/12/2021	5:39:00 AM
MILL-0032	LR	1074	Girl's LR	BF	2/12/2021	5:39:00 AM
MILL-0033	LR	1074	Girl's LR	BF	2/12/2021	5:40:00 AM
MILL-0036	LR	1074	Girl's LR	DW	2/12/2021	5:41:00 AM
MILL-0039	OF	1072A	141 Trainer Bathroom	DW	2/24/2021	5:15:00 AM
MILL-0041	OF	1072A	141 Trainer Bathroom	IM	2/24/2021	5:16:00 AM
MILL-0042	BR	1172A1	Trainer's BR	BF	2/24/2021	5:17:00 AM
MILL-0050	HA	1054	Outside Auditorium	WF	2/12/2021	5:45:00 AM
MILL-0052	BR	1044	Men's Bathroom	BF	2/12/2021	5:47:00 AM
MILL-0053	BR	1044	Men's Bathroom	BF	2/12/2021	5:48:00 AM
MILL-0056	BR	1045	Girl's Bathroom	BF	2/12/2021	5:49:00 AM
MILL-0057	BR	1045	Girl's Bathroom	BF	2/12/2021	5:50:00 AM
MILL-0085	ST	1047A	Room 162/163 ST	HW	2/24/2021	5:22:00 AM
MILL-0086	HA	1054	Outside Room 164	WF	2/12/2021	5:52:00 AM

Building Address
15 Memorial Drive
Miller Place, NY 11764

Analysis Type: ELAP 200.5

Lab Received: *[Signature]*

Signature: *[Signature]*

Samplers Name: *Griffin Hayes*
Samplers Signature: *[Signature]*
JCB Project Manager: *Bryan Ezellms*



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 18-41685

Building: Miller Place High School

MPHS

062103502

Client:

Miller Place Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush _____

Page 3 of 4

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
MILL-0107	BR	1049B	Room 164B (Athletic OF)	BF	2/24/2021	5:24:00 AM
MILL-0108	CR	1042	Room 131, Earth Science	CF	2/12/2021	5:53:00 AM
MILL-0109	CR	1042	Room 131, Earth Science	CF	2/12/2021	5:54:00 AM
MILL-0110	CR	1042	Room 131, Earth Science	CF	2/12/2021	5:55:00 AM
MILL-0113	FL	1041	Faculty Lounge	KC	2/12/2021	5:56:00 AM
MILL-0114	FL	1041	Faculty Lounge	BW	2/12/2021	5:57:00 AM
MILL-0115	FL	1041	Faculty Lounge	BW	2/12/2021	5:58:00 AM
MILL-0116	FL	1041	Faculty Lounge	WF	2/12/2021	5:59:00 AM
MILL-0118	BR	1039B	Nurse's Bathroom	BF	2/12/2021	6:01:00 AM
MILL-0119	BR	1039A	Nurse's Bathroom	BF	2/12/2021	6:00:00 AM
MILL-0120	OF	1034	Main Office Kitchen	KC	2/12/2021	6:02:00 AM
MILL-0121	BR	1028B	Principal's Bathroom	BF	2/12/2021	6:03:00 AM
MILL-0122	HA	1043	Fountain by Main Office	WF	2/12/2021	6:04:00 AM
MILL-0124	OF	1019B	Guidance Office Kitchen	KC	2/12/2021	6:06:00 AM
MILL-0125	HA	1026	Main Lobby & Corridors 101-125 - Outside Guidance Office	WF	2/12/2021	6:07:00 AM
MILL-0127	BR	1081	Boy's Bathroom	BF	2/12/2021	6:08:00 AM
MILL-0128	BR	1081	Boy's Bathroom	BF	2/12/2021	6:09:00 AM
MILL-0131	BR	1079	Women's Bathroom	BF	2/12/2021	6:10:00 AM

Building Address

15 Memorial Drive

Miller Place, NY 11764

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name:

Samplers Signature:

JCB Project Manager:

Griffin Hayes

Sullivan Hayes

Bryan Exelias

Order ID: 062103502



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 18-41685

Building: Miller Place High School

MPHS

062103502

Client:

Miller Place Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush

Page 4 of 4

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
MILL-0132	BR	1079	Women's Bathroom	BF	2/12/2021	6:11:00 AM
MILL-0133	BR	1079	Women's Bathroom	BF	2/12/2021	6:12:00 AM
MILL-0144	LI	N/A	Library Sink	KC	2/12/2021	5:30:00 AM
MILL-0145	HA	1026	Fountain by bathroom	WF	2/12/2021	5:31:00 AM
MILL-0155	BR	1012	Men's Bathroom	BF	2/12/2021	5:38:00 AM
MILL-0157	BR	1013	Women's Bathroom	BF	2/12/2021	5:35:00 AM
MILL-0158	BR	1013	Women's Bathroom	BF	2/12/2021	5:35:00 AM
MILL-0189	HA	2026	Outside Room 211	WF	2/12/2021	5:41:00 AM
MILL-0229	BR	2021	Women's Bathroom	BF	2/12/2021	5:45:00 AM
MILL-0230	BR	2021	Women's Bathroom	BF	2/12/2021	5:46:00 AM
MILL-0231	HA	2026	Outside Women's Faculty BR	WF	2/12/2021	5:47:00 AM
MILL-0263	BR	2022	Men's Faculty Bathroom	BF	2/12/2021	5:49:00 AM
MILL-0265	HA	2026	Outside Room 202	WF	2/12/2021	5:50:00 AM

Samples Submitted 67

Building Address

15 Memorial Drive

Miller Place, NY 11764

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Griffin Hayes

Samplers Signature:

JCB Project Manager:

Bryon Ezels

21 FEB 24 PM 4:15

CARLE PLACE, NY

JCB

Order ID: 062103502



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

**Bryan Ezelius
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788**

3/8/2021

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 2/24/2021. The results are tabulated on the attached data pages for the following client designated project:

**18-41685, Miller Place High School, Miller Place Union Free
School District, 15 Memorial Drive, Miller Place, NY 11764**

The reference number for these samples is EMSL Order #062103502. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062103502

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 2/24/2021 04:44 PM
 Collected: 2/12/2021

Project: 18-41685, Miller Place High School, Miller Place Union Free School District, 15 Memorial Drive, Miller Place, NY 11764

Analytical Results

Client Sample Description MILL-0001 **Collected:** 2/12/2021 **Lab ID:** 062103502-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.8	3.0 µg/L	2/26/2021	AM	3/2/2021	AL

Client Sample Description MILL-0002 **Collected:** 2/12/2021 **Lab ID:** 062103502-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/26/2021	AM	3/2/2021	AL

Client Sample Description MILL-0003 **Collected:** 2/12/2021 **Lab ID:** 062103502-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	36	3.0 µg/L	2/26/2021	AM	3/2/2021	AL

Client Sample Description MILL-0004 **Collected:** 2/12/2021 **Lab ID:** 062103502-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/26/2021	AM	3/2/2021	AL

Client Sample Description MILL-0005 **Collected:** 2/12/2021 **Lab ID:** 062103502-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	37	3.0 µg/L	2/26/2021	AM	3/2/2021	AL

Client Sample Description MILL-0006 **Collected:** 2/12/2021 **Lab ID:** 062103502-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	2/26/2021	AM	3/2/2021	AL

Lead MDL: 1.0µg/L

Client Sample Description MILL-0007 **Collected:** 2/12/2021 **Lab ID:** 062103502-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	11	3.0 µg/L	2/26/2021	AM	3/2/2021	AL

Client Sample Description MILL-0008 **Collected:** 2/12/2021 **Lab ID:** 062103502-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062103502

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 2/24/2021 04:44 PM
 Collected: 2/12/2021

Project: 18-41685, Miller Place High School, Miller Place Union Free School District, 15 Memorial Drive, Miller Place, NY 11764

Analytical Results

Client Sample Description		MILL-0008		Collected:	2/12/2021	Lab ID:	062103502-0008	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.0	3.0	µg/L	2/26/2021	AM	3/2/2021	AL
Client Sample Description		MILL-0009		Collected:	2/12/2021	Lab ID:	062103502-0009	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	240	3.0	µg/L	2/26/2021	AM	3/2/2021	AL
Client Sample Description		MILL-0010		Collected:	2/12/2021	Lab ID:	062103502-0010	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.9	3.0	µg/L	2/26/2021	AM	3/2/2021	AL
Client Sample Description		MILL-0011		Collected:	2/12/2021	Lab ID:	062103502-0011	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.3 J	3.0	µg/L	2/26/2021	AM	3/2/2021	AL
		Lead MDL: 1.0µg/L						
Client Sample Description		MILL-0012		Collected:	2/12/2021	Lab ID:	062103502-0012	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	46	3.0	µg/L	2/26/2021	AM	3/2/2021	AL
Client Sample Description		MILL-0013		Collected:	2/12/2021	Lab ID:	062103502-0013	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.0	3.0	µg/L	2/26/2021	AM	3/2/2021	AL
Client Sample Description		MILL-0015		Collected:	2/12/2021	Lab ID:	062103502-0014	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	2/26/2021	AM	3/2/2021	AL
Client Sample Description		MILL-0017		Collected:	2/12/2021	Lab ID:	062103502-0015	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062103502

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 2/24/2021 04:44 PM
 Collected: 2/12/2021

Project: 18-41685, Miller Place High School, Miller Place Union Free School District, 15 Memorial Drive, Miller Place, NY 11764

Analytical Results

Client Sample Description MILL-0017 **Collected:** 2/12/2021 **Lab ID:** 062103502-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	2/26/2021	AM	3/2/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0020 **Collected:** 2/12/2021 **Lab ID:** 062103502-0016

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.5	3.0 µg/L	2/26/2021	AM	3/2/2021	AL

Client Sample Description MILL-0021 **Collected:** 2/12/2021 **Lab ID:** 062103502-0017

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.1	3.0 µg/L	2/26/2021	AM	3/2/2021	AL

Client Sample Description MILL-0022 **Collected:** 2/12/2021 **Lab ID:** 062103502-0018

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.5	3.0 µg/L	2/26/2021	AM	3/2/2021	AL

Client Sample Description MILL-0024 **Collected:** 2/12/2021 **Lab ID:** 062103502-0019

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	2/26/2021	AM	3/2/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0025 **Collected:** 2/12/2021 **Lab ID:** 062103502-0020

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/26/2021	AM	3/2/2021	AL

Client Sample Description MILL-0028 **Collected:** 2/12/2021 **Lab ID:** 062103502-0021

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	3/1/2021	AM	3/2/2021	AL
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062103502

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 2/24/2021 04:44 PM
 Collected: 2/12/2021

Project: 18-41685, Miller Place High School, Miller Place Union Free School District, 15 Memorial Drive, Miller Place, NY 11764

Analytical Results

Client Sample Description MILL-0029 **Collected:** 2/12/2021 **Lab ID:** 062103502-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.9	3.0 µg/L	3/1/2021	AM	3/2/2021	AL

Client Sample Description MILL-0031 **Collected:** 2/12/2021 **Lab ID:** 062103502-0023

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.2	3.0 µg/L	3/1/2021	AM	3/2/2021	AL

Client Sample Description MILL-0032 **Collected:** 2/12/2021 **Lab ID:** 062103502-0024

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.8	3.0 µg/L	3/1/2021	AM	3/2/2021	AL

Client Sample Description MILL-0033 **Collected:** 2/12/2021 **Lab ID:** 062103502-0025

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.6	3.0 µg/L	3/1/2021	AM	3/2/2021	AL

Client Sample Description MILL-0036 **Collected:** 2/12/2021 **Lab ID:** 062103502-0026

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	3/1/2021	AM	3/2/2021	AL

Client Sample Description MILL-0039 **Collected:** 2/12/2021 **Lab ID:** 062103502-0027

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	71	3.0 µg/L	3/1/2021	AM	3/2/2021	AL

Client Sample Description MILL-0041 **Collected:** 2/12/2021 **Lab ID:** 062103502-0028

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	3/1/2021	AM	3/2/2021	AL

Client Sample Description MILL-0042 **Collected:** 2/12/2021 **Lab ID:** 062103502-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062103502

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 2/24/2021 04:44 PM
 Collected: 2/12/2021

Project: 18-41685, Miller Place High School, Miller Place Union Free School District, 15 Memorial Drive, Miller Place, NY 11764

Analytical Results

Client Sample Description MILL-0042 **Collected:** 2/12/2021 **Lab ID:** 062103502-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	19	3.0 µg/L	3/1/2021	AM	3/2/2021	AL

Client Sample Description MILL-0050 **Collected:** 2/12/2021 **Lab ID:** 062103502-0030

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	3/1/2021	AM	3/2/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0052 **Collected:** 2/12/2021 **Lab ID:** 062103502-0031

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.3	3.0 µg/L	3/1/2021	AM	3/2/2021	AL

Client Sample Description MILL-0053 **Collected:** 2/12/2021 **Lab ID:** 062103502-0032

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.5	3.0 µg/L	3/1/2021	AM	3/2/2021	AL

Client Sample Description MILL-0056 **Collected:** 2/12/2021 **Lab ID:** 062103502-0033

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.0	3.0 µg/L	3/1/2021	AM	3/2/2021	AL

Client Sample Description MILL-0057 **Collected:** 2/12/2021 **Lab ID:** 062103502-0034

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.8	3.0 µg/L	3/1/2021	AM	3/2/2021	AL

Client Sample Description MILL-0085 **Collected:** 2/12/2021 **Lab ID:** 062103502-0035

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	13	3.0 µg/L	3/1/2021	AM	3/2/2021	AL

Client Sample Description MILL-0086 **Collected:** 2/12/2021 **Lab ID:** 062103502-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062103502

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 2/24/2021 04:44 PM
 Collected: 2/12/2021

Project: 18-41685, Miller Place High School, Miller Place Union Free School District, 15 Memorial Drive, Miller Place, NY 11764

Analytical Results

Client Sample Description MILL-0086 **Collected:** 2/12/2021 **Lab ID:** 062103502-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	3/1/2021	AM	3/2/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0107 **Collected:** 2/12/2021 **Lab ID:** 062103502-0037

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	28	3.0 µg/L	3/1/2021	AM	3/2/2021	AL

Client Sample Description MILL-0108 **Collected:** 2/12/2021 **Lab ID:** 062103502-0038

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	32	3.0 µg/L	3/1/2021	AM	3/2/2021	AL

Client Sample Description MILL-0109 **Collected:** 2/12/2021 **Lab ID:** 062103502-0039

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	150	3.0 µg/L	3/1/2021	AM	3/2/2021	AL

Client Sample Description MILL-0110 **Collected:** 2/12/2021 **Lab ID:** 062103502-0040

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	25	3.0 µg/L	3/1/2021	AM	3/2/2021	AL

Client Sample Description MILL-0113 **Collected:** 2/12/2021 **Lab ID:** 062103502-0041

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.1 J	3.0 µg/L	2/26/2021	AM	3/2/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0114 **Collected:** 2/12/2021 **Lab ID:** 062103502-0042

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	2/26/2021	AM	3/2/2021	AL
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062103502

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 2/24/2021 04:44 PM
 Collected: 2/12/2021

Project: 18-41685, Miller Place High School, Miller Place Union Free School District, 15 Memorial Drive, Miller Place, NY 11764

Analytical Results

Client Sample Description MILL-0115 **Collected:** 2/12/2021 **Lab ID:** 062103502-0043

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/26/2021	AM	3/2/2021	AL

Client Sample Description MILL-0116 **Collected:** 2/12/2021 **Lab ID:** 062103502-0044

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	2/26/2021	AM	3/2/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0118 **Collected:** 2/12/2021 **Lab ID:** 062103502-0045

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	77	3.0 µg/L	2/26/2021	AM	3/2/2021	AL

Client Sample Description MILL-0119 **Collected:** 2/12/2021 **Lab ID:** 062103502-0046

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	16	3.0 µg/L	2/26/2021	AM	3/2/2021	AL

Client Sample Description MILL-0120 **Collected:** 2/12/2021 **Lab ID:** 062103502-0047

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	2/26/2021	AM	3/2/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0121 **Collected:** 2/12/2021 **Lab ID:** 062103502-0048

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	150	3.0 µg/L	2/26/2021	AM	3/2/2021	AL

Client Sample Description MILL-0122 **Collected:** 2/12/2021 **Lab ID:** 062103502-0049

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	2/26/2021	AM	3/2/2021	AL
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062103502

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 2/24/2021 04:44 PM
 Collected: 2/12/2021

Project: 18-41685, Miller Place High School, Miller Place Union Free School District, 15 Memorial Drive, Miller Place, NY 11764

Analytical Results

Client Sample Description MILL-0124 **Collected:** 2/12/2021 **Lab ID:** 062103502-0050

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.8	3.0 µg/L	2/26/2021	AM	3/2/2021	AL

Client Sample Description MILL-0125 **Collected:** 2/12/2021 **Lab ID:** 062103502-0051

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	2/26/2021	AM	3/2/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0127 **Collected:** 2/12/2021 **Lab ID:** 062103502-0052

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	11	3.0 µg/L	2/26/2021	AM	3/2/2021	AL

Client Sample Description MILL-0128 **Collected:** 2/12/2021 **Lab ID:** 062103502-0053

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0 µg/L	2/26/2021	AM	3/2/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0131 **Collected:** 2/12/2021 **Lab ID:** 062103502-0054

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	11	3.0 µg/L	2/26/2021	AM	3/2/2021	AL

Client Sample Description MILL-0132 **Collected:** 2/12/2021 **Lab ID:** 062103502-0055

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.2	3.0 µg/L	2/26/2021	AM	3/2/2021	AL

Client Sample Description MILL-0133 **Collected:** 2/12/2021 **Lab ID:** 062103502-0056

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.7	3.0 µg/L	2/26/2021	AM	3/2/2021	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062103502

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 2/24/2021 04:44 PM
 Collected: 2/12/2021

Project: 18-41685, Miller Place High School, Miller Place Union Free School District, 15 Memorial Drive, Miller Place, NY 11764

Analytical Results

Client Sample Description MILL-0144 **Collected:** 2/12/2021 **Lab ID:** 062103502-0057

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	2/26/2021	AM	3/2/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0145 **Collected:** 2/12/2021 **Lab ID:** 062103502-0058

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/26/2021	AM	3/2/2021	AL

Client Sample Description MILL-0155 **Collected:** 2/12/2021 **Lab ID:** 062103502-0059

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	44	3.0 µg/L	2/26/2021	AM	3/2/2021	AL

Client Sample Description MILL-0157 **Collected:** 2/12/2021 **Lab ID:** 062103502-0060

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.1	3.0 µg/L	2/26/2021	AM	3/2/2021	AL

Client Sample Description MILL-0158 **Collected:** 2/12/2021 **Lab ID:** 062103502-0061

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	14	3.0 µg/L	2/26/2021	AM	3/2/2021	AL

Client Sample Description MILL-0189 **Collected:** 2/12/2021 **Lab ID:** 062103502-0062

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	2/26/2021	AM	3/2/2021	AL

Client Sample Description MILL-0229 **Collected:** 2/12/2021 **Lab ID:** 062103502-0063

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	10	3.0 µg/L	2/26/2021	AM	3/2/2021	AL

Client Sample Description MILL-0230 **Collected:** 2/12/2021 **Lab ID:** 062103502-0064

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062103502

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 2/24/2021 04:44 PM
 Collected: 2/12/2021

Project: 18-41685, Miller Place High School, Miller Place Union Free School District, 15 Memorial Drive, Miller Place, NY 11764

Analytical Results

Client Sample Description MILL-0230 **Collected:** 2/12/2021 **Lab ID:** 062103502-0064

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.1 J	3.0 µg/L	2/26/2021	AM	3/2/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0231 **Collected:** 2/12/2021 **Lab ID:** 062103502-0065

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0 µg/L	2/26/2021	AM	3/2/2021	AL
Lead MDL: 1.0µg/L							

Client Sample Description MILL-0263 **Collected:** 2/12/2021 **Lab ID:** 062103502-0066

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.7	3.0 µg/L	2/26/2021	AM	3/2/2021	AL

Client Sample Description MILL-0265 **Collected:** 2/12/2021 **Lab ID:** 062103502-0067

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	2/26/2021	AM	3/2/2021	AL
Lead MDL: 1.0µg/L							

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody For

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 18-41685

Building: Miller Place Administration Building

MPAB

Page 1 of 1

Client:

Miller Place Union Free School District

Turn Around: Normal (twk) Rush

Sample ID	Functional Space Type	Outlet Type	AHERA ID	Common Room Name	Sample Date	Sample Time
MILL-0668	KI	WF	N/A	Office Kitchen	2/24/2021	6:10
MILL-0669	KI	WC	N/A	Office Kitchen	2/24/2021	6:10
MILL-0670	KI	WC	N/A	Office Kitchen	2/24/2021	6:11
MILL-0671	KI	KC	N/A	Office Kitchen	2/24/2021	6:11

21 FEB 24 PM 12:09
JCB PROJECTS, INC.
MILLER PLACE, NY

Building Address:

15 Memorial Drive
Miller Place, NY 11764

Pb 200.5 - A. Leary 02/26/21

Analysis Type: ELAP 200.5 @

Lab Received: Unique. McKay

Signature: Wm 2/24/21 12:09 PM

Samplers Name: Griffin Hayes

Samplers Signature: Duke Kay

JCB Project Manager: Bryan Ezels

062103473



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

**Bryan Ezelius
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788**

3/8/2021

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 2/24/2021. The results are tabulated on the attached data pages for the following client designated project:

**Miller Place Administration Building, 15 Memorial Drive, Miller
place, NY 11764, Miller Place Union Free School District, 18-41685**

The reference number for these samples is EMSL Order #062103473. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062103473

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **Bryan Ezelius**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 2/24/2021 12:09 PM
Collected: 2/24/2021

Project: **Miller Place Administration Building, 15 Memorial Drive, Miller place, NY 11764, Miller Place Union Free School District, 18-41685**

Analytical Results

Client Sample Description		MILL-0668 Office Kitchen	Collected:	2/24/2021	Lab ID:	062103473-0001		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	2/25/2021	AM	2/26/2021	AL
Client Sample Description		MILL-0669 Office Kitchen	Collected:	2/24/2021	Lab ID:	062103473-0002		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	2/25/2021	AM	2/26/2021	AL
Client Sample Description		MILL-0670 Office Kitchen	Collected:	2/24/2021	Lab ID:	062103473-0003		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	2/25/2021	AM	2/26/2021	AL
Client Sample Description		MILL-0671 Office Kitchen	Collected:	2/24/2021	Lab ID:	062103473-0004		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	2/25/2021	AM	2/26/2021	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted

Attachment 3:

Laboratory Certifications


J.C. Broderick & Associates, Inc.

Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395

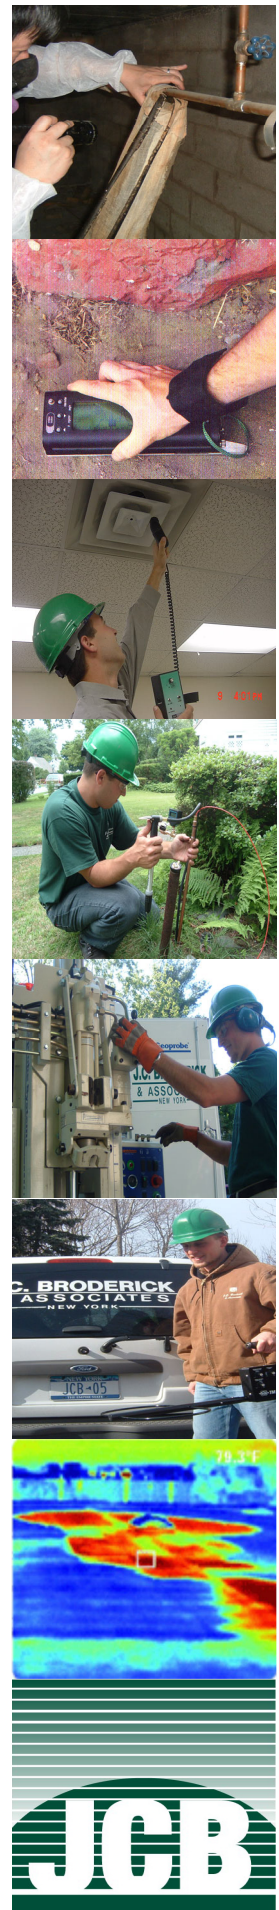

NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2021
Issued April 01, 2020

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MR. DANIEL CLARKE
EMSL ANALYTICAL, INC.
528 MINEOLA AVE.
CARLE PLACE, NY 11514

NY Lab Id No: 11469

*is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2003) for the category
ENVIRONMENTAL ANALYSES POTABLE WATER
All approved analytes are listed below:*

Bacteriology

Coliform, Total / E. coli (Qualitative)	SM 21, 23 9222A,B,C SM 20, 21-23 9223B (-04) (Colilert)
E. coli (Enumeration)	SM 21, 23 9222A,B,C
Enterococci	SM 20, 23 9230C (Budnick 1996)
Heterotrophic Plate Count	SimPlate SM 20, 21-23 9215B (-04)

Metals I

Lead, Total	EPA 200.5
-------------	-----------

Miscellaneous

Asbestos	EPA 100.2
----------	-----------

Serial No.: 61397

Property of the New York State Department of Health. Certificates are valid only at the address shown, must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.

