

Addendum #01

Date: May 26, 2023

Project: Longview School District HVAC Replacement and Indoor Air Quality Improvements

The additions, clarifications and corrections herein shall be made to the Project Manual, Drawings and Schedules for the above-referenced project, and shall be included in the scope of work and proposals to be submitted.

NOTE: References made below to the Project Manual and Drawings shall be used as a general guide only. The Bidders themselves shall determine the work affected by the Addendum items.

PROJECT MANUAL ITEMS

Item #01 Section 011000 SUMMARY

Add. #01 **REVISE:** 1.2-A.2. to read: Discovery High School: 2742 Harding St., Longview, WA 98632.

DRAWING ITEMS

ARCHITECTURAL

Item #A01 A121 – DISCOVERY HS FLOOR PLAN & ROOF PLAN

Add. #01 **REVISE:** Sheet A121 to include keynotes 7 and 8 per attached revised sheet A121.

MECHANICAL

Item #M01 M101 – DISCOVERY HIGH SCHOOL MECH DEMO PLAN

Add. #01 **ADD:** Existing portable AC unit, associated duct to be removed, return unit to owner, patch wall opening to Room 22 on the West wall south of door.

REVISE: Remove existing unit ventilator demo work from Room 5.

ADD: Demo two existing electric wall heaters in Room 5 on the south wall.

ADD: Demo existing electric wall heater in (E) Corridor on west side of building.

REVISE: Remove one existing portable AC unit and one existing unit ventilator demo work from Room 11.

ADDENDUM #01

Longview School District HVAC Replacement and Indoor Air Quality Improvements

Page No. 1

Item #M02 M401 – DISCOVERY HIGH SCHOOL MECH DEMO PLAN

Add. #01 **ADD:** General Note 5: "WHERE RG/RL IS ROUTED EXPOSED, PROVIDE W/ PVC JACKETING."

ADD: Detail reference 10/S3 to HP-1.

Attachments:

Pre-bid Site walk attendance sheet

Drawings

A121


END OF ADDENDUM #01




HVAC and IAQ Improvements 2 Pre-Bid Walk

Meeting Date: May 24, 2023
Time: 2:00 PM
Location: Discovery HS + RA LONG SCIENCE WING

[illegible]

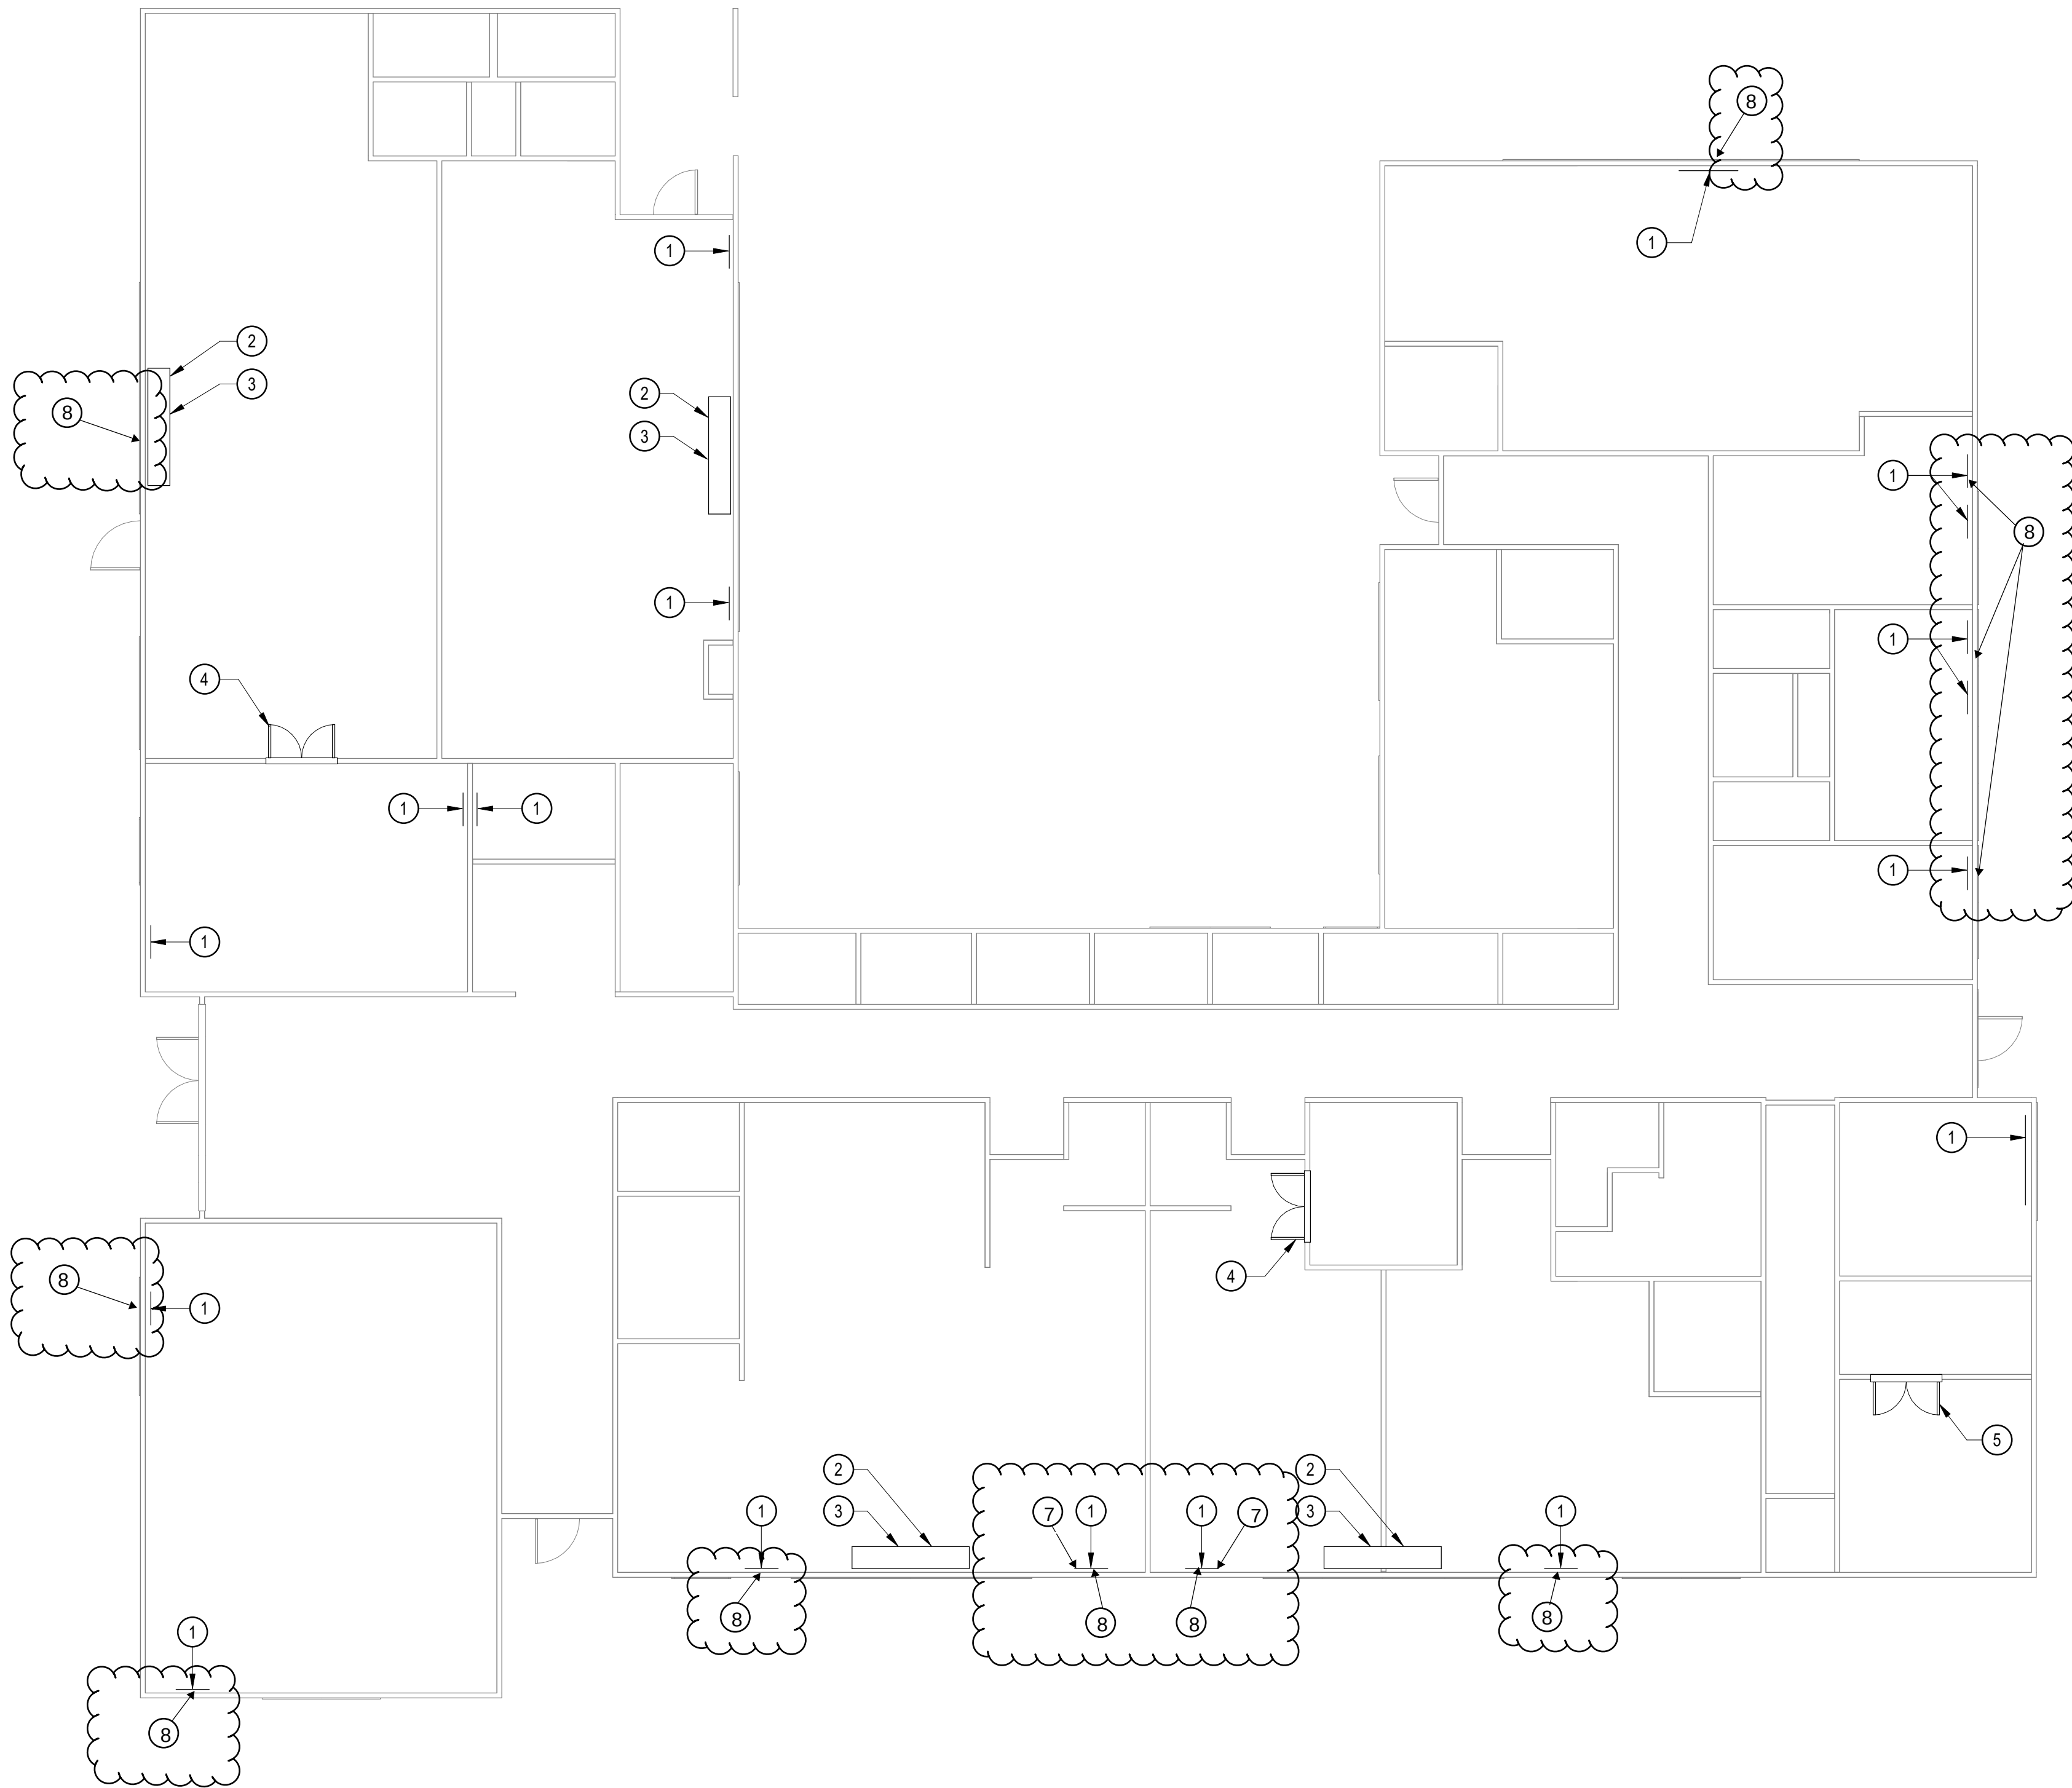

1 DISCOVERY HIGH SCHOOL FLOOR PLAN
SCALE: 1/8" = 1'-0"

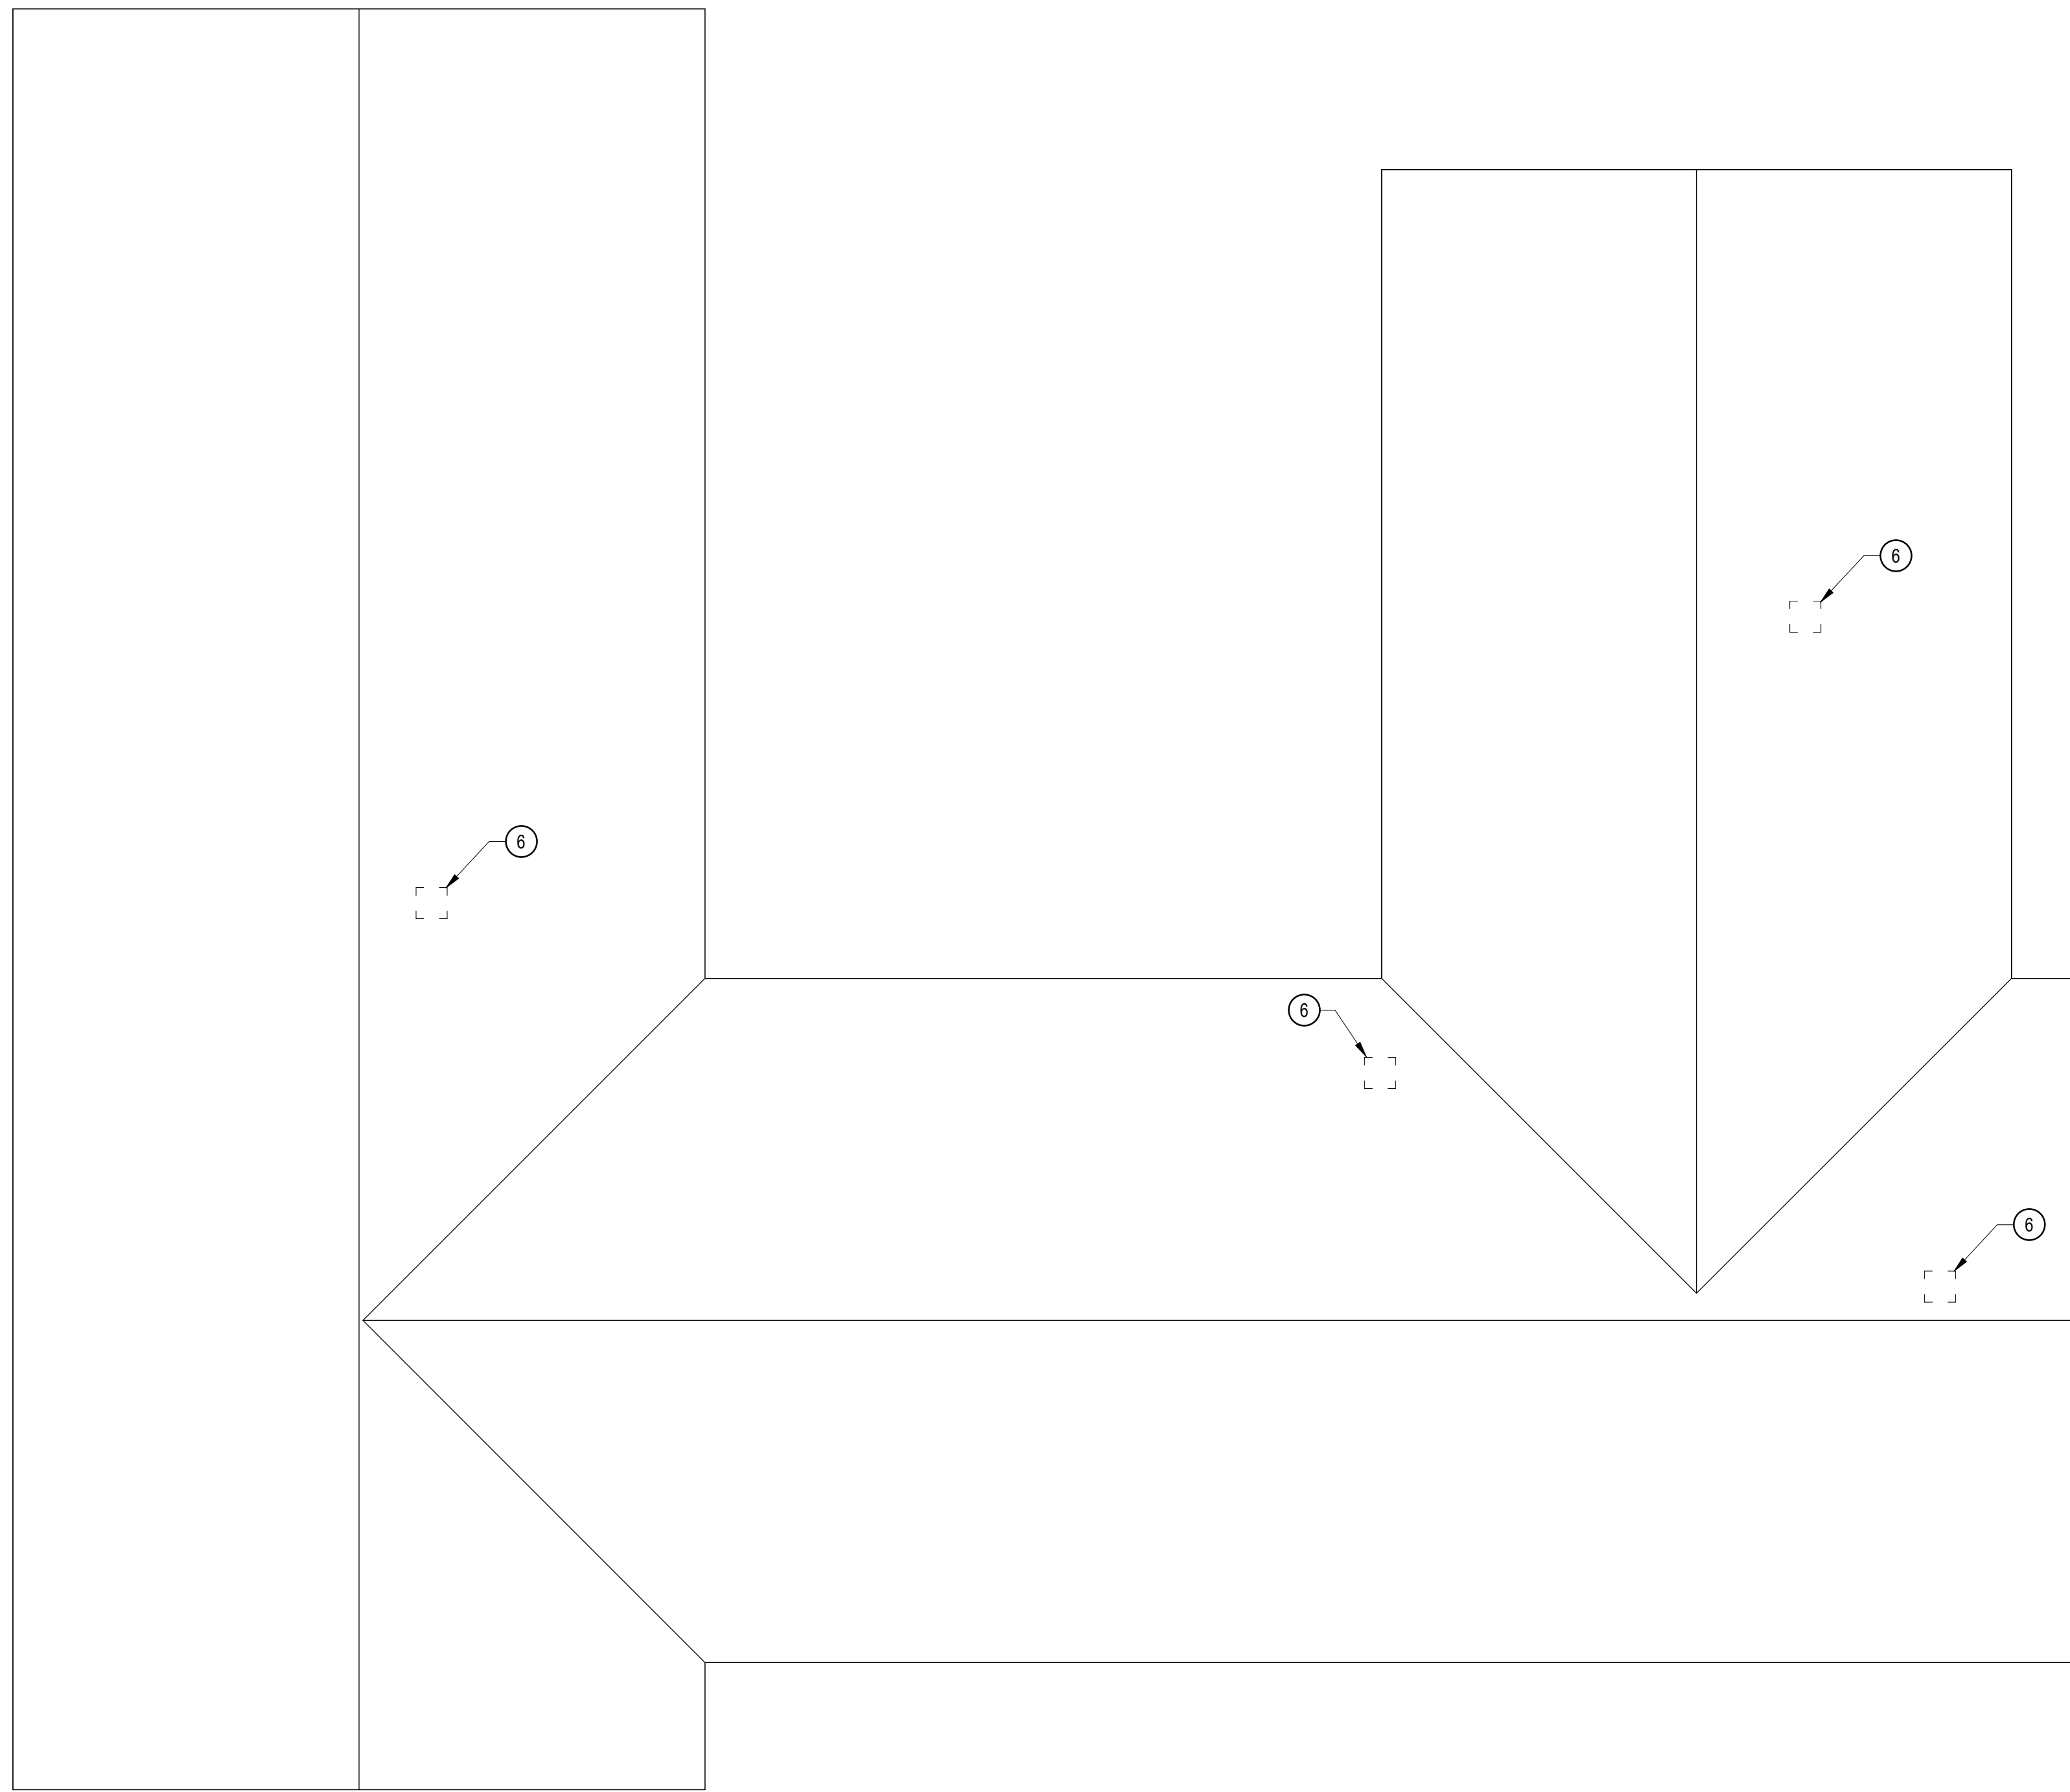

2 DISCOVERY HIGH SCHOOL ROOF PLAN
SCALE: 1/8" = 1'-0"

FLOOR PLAN KEYNOTES

- ① PATCH GWB AS REQUIRED. PAINT.
- ② PATCH GWB AS REQUIRED AT DEMOLISHED MECHANICAL UNIT. PAINT.
- ③ INSTALL RESILIENT FLOORING AS REQUIRED AT DEMOLISHED MECHANICAL UNIT
- ④ NEW 34"H X 54"W ACCESS DOOR ABOVE CEILING
- ⑤ NEW 34"H X 54"W ACCESS DOOR
- ⑥ PATCH ROOFING ASSEMBLY AS REQUIRED AT DEMOLISHED ROOF VENT
- ⑦ REPLACE TRANSPARENT PANEL AT DEMOLISHED AC UNIT
- ⑧ SHEET METAL CAP AT DEMOLISHED DUCT DIFFUSER. PAINT.

**LONGVIEW SCHOOL DISTRICT HVAC
REPLACEMENT AND INDOOR AIR QUALITY
IMPROVEMENTS**
2715 LILAC STREET
LONGVIEW, WA 98632

Date: 04/25/23
Job No.: 22220.00
Drawn By: JJB
Checked by: SW

Revisions		
#	Date	Description
3	04.25.2023	BID SET

DISCOVERY HS
FLOOR PLAN &
ROOF PLAN