

3 E102 ENLARGED ELEVATOR HOISTWAY
1/4" = 1'-0"



2 E102 ENLARGED ELEVATOR PIT
1/4" = 1'-0"

NOTE BY SYMBOL

1. RECEPTACLE FOR WATER COOLERS/DRINKING FOUNTAINS SHALL BE BELOW THE UNITS.
2. CONCEAL JUNCTION BOX BEHIND EQUIPMNT.
3. PROVIDE LIGHT (TYPE 'D' FIXTURE), SWITCH, AND GFCI SERVICE RECEPTACLE AT ELEVATOR PITHOISTWAY AREA. CONFIRM LOCATION FOR ALL ELEVATOR EQUIPMENT, DEVICES, AND CIRCUIT TERMINATIONS WITH ELEVATOR INSTALLER PRIOR TO ROUGH-IN.
4. PROVIDE INDICATED CONNECTION TO ELEVATOR TRANSFER SWITCH UNIT 'TSU' IN HOISTWAY (PROVIDED BY ELEVATOR SUPPLIER).
5. ELEVATOR MOTOR CONTROL DISCONNECT SWITCH 'JH1'. PROVIDE NONFUSED DISCONNECT (30A/3P) WITH AUXILIARY CONTACT WITHIN MACHINERY SPACE AT TOP OF ELEVATOR HOISTWAY. COORDINATE FINAL LOCATION FOR DISCONNCT WITH ELEVATOR INSTALLER.
6. PROVIDE INDICATED CONNECTION TO MAIN LINE DISCONNECT SWITCH 'JH' IN ELECTRICAL ROOM.
7. COORDINATE LOCATION OF RECIRCULATING PUMP WITH PLUMBER.

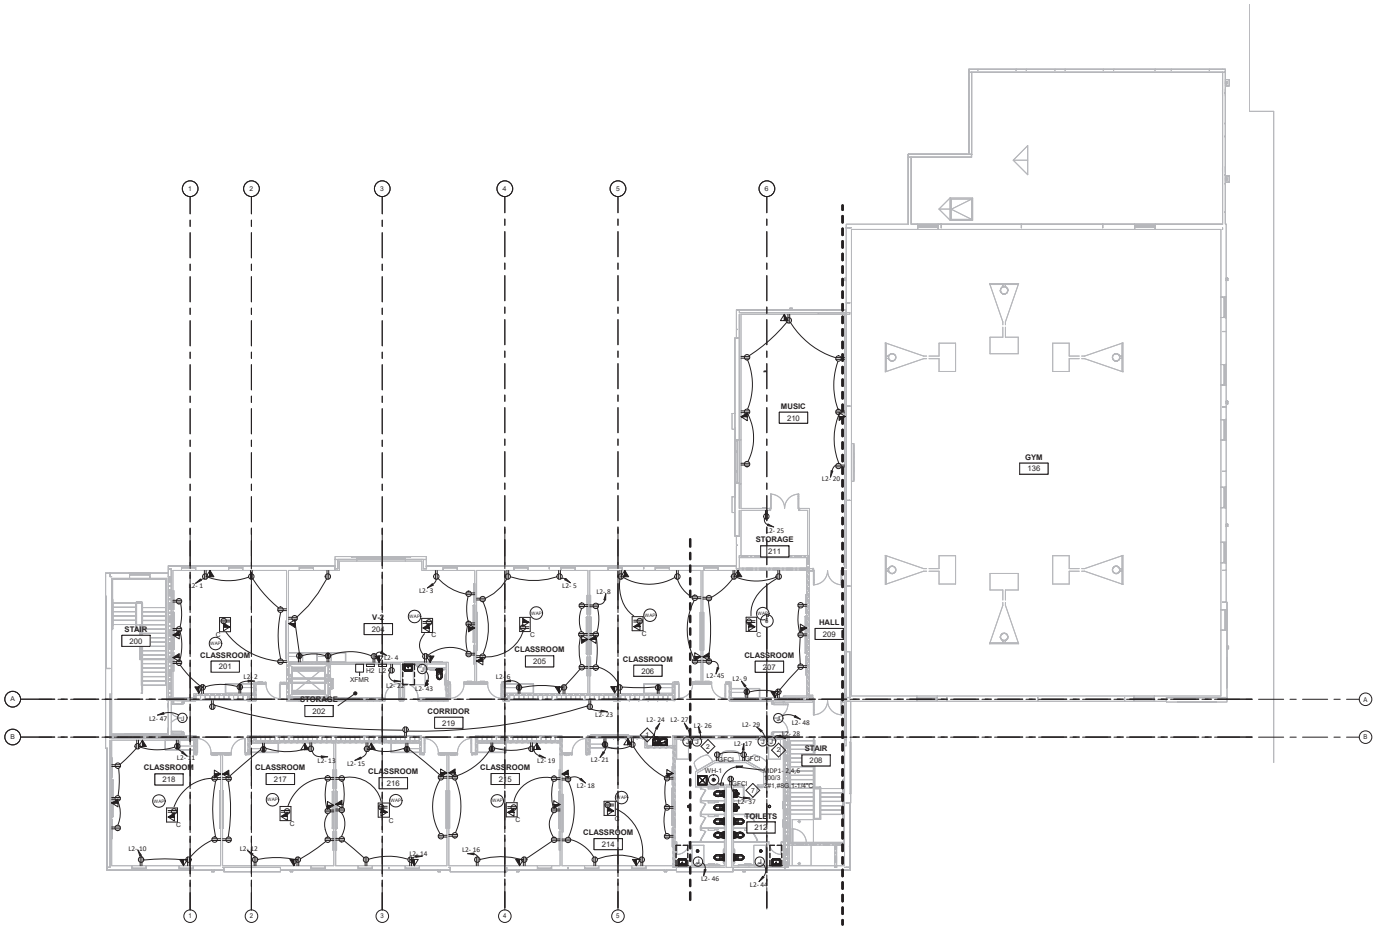

1 E102 POWER PLAN - LEVEL 2
3/32" = 1'-0"

MUSSMAN ARCHITECTS
619 N. Main Street Greenville, SC 29601
ph: 864-626-6310 email:paul@mussmanarchitects.com

James F. Turner, PE
Consulting Engineer
Suite 1 Tel:
Suite 1 Fax:

PROFESSIONAL ENGINEER JAMES F. TURNER LICENSE NO. 73441 STATE OF FLORIDA
2012-10-07

TCCA HIGH SCHOOL BUILDING

1400 SE COVE RD
STUART FLORIDA 34997

SHEET ISSUE:

NO.	DATE	DESCRIPTION	BY

PRINCIPAL IN CHARGE: Approver
PROJECT ARCHITECT: Checker
DRAWN BY: Author

SHEET TITLE:
POWER PLAN - LEVEL 2

SHEET NO. E102
PROJ. NO. 022004