KEYNOTES M201	
1	PROVIDE WALL MOUNT CO2 SENSOR IN ROOM. INTERLOCK WITH DEMAND CONTROL VENTILATION FOR RTU-1
2	ROUTE EXHAUST DUCT TO EXTERIOR WALL. TERMINATE WITH 14X12 ESU-153 LOUVER. PAINT COLOR BY ARCHITECT.
3	MOUNT AHU ABOVE DOOR.
4	UNDERCUT DOOR BY 1/2".
5	PLENUM RETURN AIR OPENING ABOVE CEILING. TERMINATE WITH WIRE MESH.
6	PROVIDE CEILING EXHAUST FAN WITH CEILING RADIATION DAMPER ACCESSORY.
7	ROUTE EXHAUST DUCT TO EXTERIOR WALL. TERMINATE WITH 8X8 ESU-153 LOUVER. PAINT COLOR BY ARCHITECT.
8	PROVIDE FIRE SMOKE DAMPER IN SUPPLY & RETURN DUCTS AT BOTTOM OF FIRE RATED CHASE.

FOR VAV DUCT INLET SIZES REFERENCE VAV SCHEDULE ON M401.

PROVIDE ALL PLENUM RETURN GRILLES WITH RETURN AIR BOOT. SEE PLAN FOR SIZE.

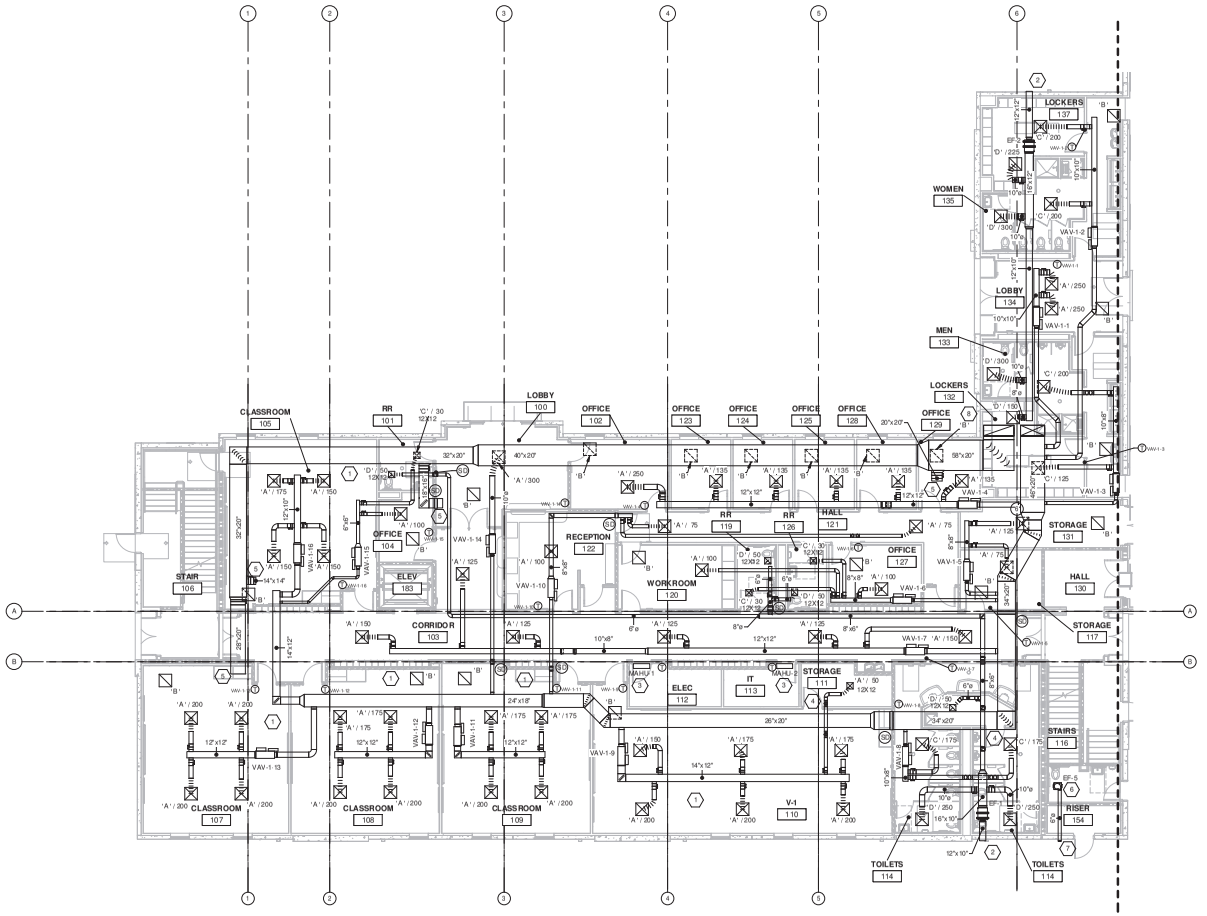

1 M201 MECHANICAL FLOOR PLAN - FIRST FLOOR WEST
1/8" = 1'-0"

MUSSMAN ARCHITECTS
610 N. Main Street Greenville, SC 29601
ph: 864-630-6330 email:paulm@mussmanarchitects.com

James F. Turner, PE
Consulting Engineer
Suite 1
Suite 1, Title
Suite 1, Title

JAMES F. TURNER LICENSE NO. 73441 STATE OF FLORIDA PROFESSIONAL ENGINEER
2022-10-07

TCCA HIGH SCHOOL BUILDING
1400 SE COVE RD
STUART FLORIDA 34997

SHEET ISSUE:
NO. DATE DESCRIPTION BY

PRINCIPAL IN CHARGE: Approver
PROJECT ARCHITECT: Checker
DRAWN BY: Author

SHEET TITLE:
MECHANICAL FLOOR PLAN - FIRST FLOOR WEST

SHEET NO. M201
PROJ. NO. 022004