


School Name: Afton-Lakeland Elementary (AL)

Date: 5/5/2023

Floor	Room Number	Location	Sample ID	Type S = Sink WC = Water Cooler BF = Bottle Filler SP = Sprayer	Lead Result (ppb)	Copper Result (ppb)
First Floor	110	Kitchen	1-AL-S (R)	S	1.12	76.7
First Floor	110	Kitchen	2-AL-S (L)	S	9.29	206
First Floor	110	Kitchen	3-AL-Kitchen-S	S	1.06	200
First Floor	110	Kitchen	4-AL-Kitchen-SP	SP	<0.5	140
First Floor	108	Cafeteria	5-AL-Cafeteria-WC	WC	<0.5	81.7
First Floor	108	Cafeteria	6-AL-Caeteria-BF	BF	<0.5	73.4
First Floor	107	Classroom	7-AL-107-S	S	<0.5	346
First Floor	105	Classroom	8-AL-105-S	S	0.68	202
First Floor	104	Classroom	9-AL-104-S	S	4.33	118
First Floor	103	Classroom	10-AL-103-S	S	4.03	131
First Floor	101	Classroom	11-AL-101-S	S	12.4	121
First Floor	102	Classroom	12-AL-102-S	S	9.46	133
First Floor	-	Hallway	13-AL-Hall-WC	WC	<0.5	9.75
First Floor	-	Hallway	14-AL-Hall-BF	BF	<0.5	10.7
First Floor	109	Classroom	15-AL-109-S	S	0.52	414
First Floor	115	Classroom	16-AL-115-S	S	<0.5	70.8
First Floor	-	Health Office	17-AL-Health-S	S	2.43	114
First Floor	-	Hallway	18-AL-Hall-WC	WC	<0.5	28.2
First Floor	-	Hallway	19-AL-Hall-BF	BF	<0.5	25.9
First Floor	116	Classroom	20-AL-116-S	S	0.93	329
First Floor	119	Classroom	21-AL-119-S	S	<0.5	109
First Floor	118	Classroom	22-AL-118-S	S	0.5	97.3
First Floor	121	Classroom	23-AL-121-S	S	0.71	164
First Floor	-	Hallway	24-AL-Hall-WC	WC	<0.5	25.4
First Floor	-	Hallway	25-AL-Hall-BF	BF	<0.5	22.7
First Floor	207	Classroom	26-AL-207-S	S	0.85	124
First Floor	206	Classroom	27-AL-206-S(L)	S	<0.5	123
First Floor	206	Classroom	28-AL-206-S (R)	S	<0.5	128
First Floor	205	Classroom	29-AL-205-S	S	<0.5	200
First Floor	204	Classroom	30-AL-204-S	S	<0.5	141
First Floor	203	Classroom	31-AL-203-S	S	0.62	119
First Floor	202	Classroom	32-AL-202-S	S	<0.5	114
First Floor	-	Lounge	33-AL-Lounge-S	S	<0.5	304
First Floor	310	Classroom	34-AL-310-S	S	<0.5	195
First Floor	-	Hallway	35-AL-Hall-WC	WC	<0.5	14.8
First Floor	-	Hallway	36-AL-Hall-BF	BF	<0.5	15.3
First Floor	307	Classroom	37-AL-307-S	S	<0.5	216
First Floor	309	Classroom	38-AL-309-S	S	1.08	193
First Floor	311	Classroom	39-AL-311-S	S	0.88	268
First Floor	313	Classroom	40-AL-313-S	S	<0.5	278
First Floor	315	Classroom	41-AL-315-S	S	<0.5	124
First Floor	314	Classroom	42-AL-314-S	S	0.86	286
First Floor	312	Classroom	43-AL-312-S	S	1.21	173



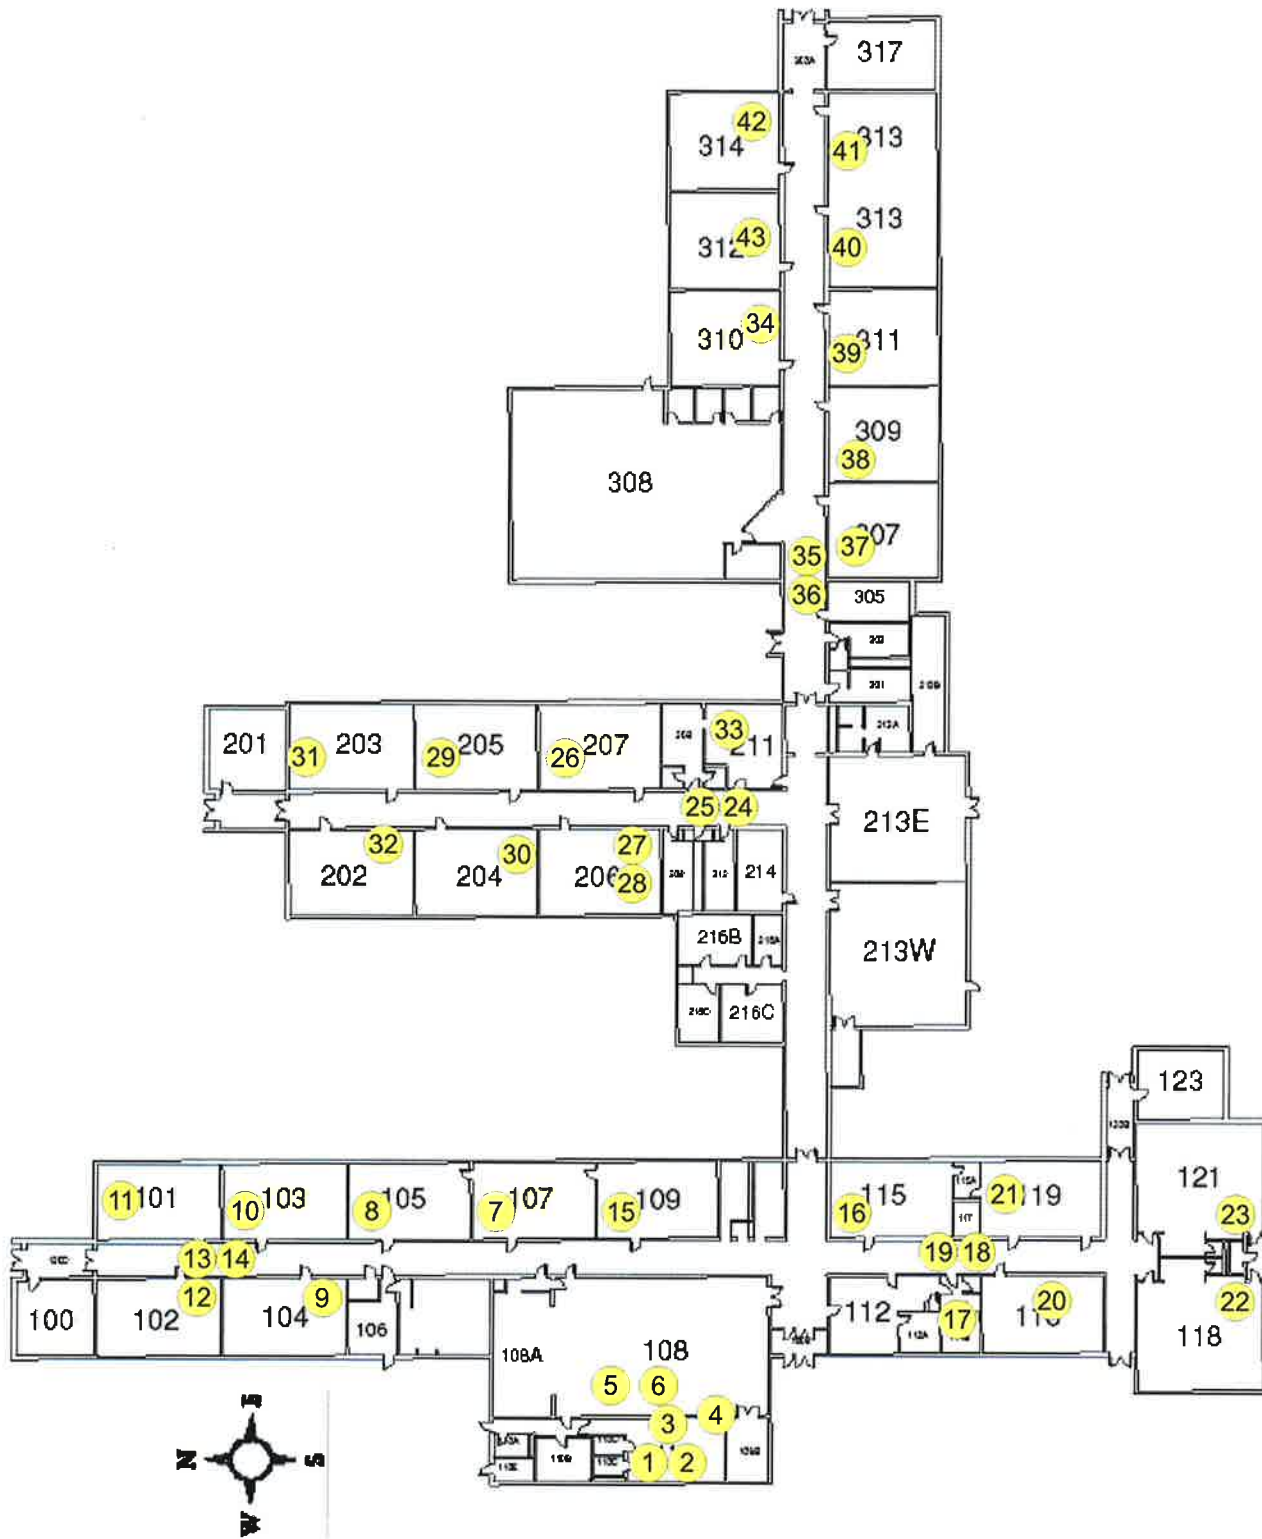

Afton-Lakeland Elementary  
Copper in Drinking Water  
Project #23072

First Draw Sampling (2023)

- Copper  $\leq$  1300
- Copper  $>$  1300