



School Name: Lily Lake Elementary (LL)


Date: 5/5/2023

Floor	Room Number	Location	Sample ID	Type DF = Drinking Fountain S = Sink WC = Water Cooler BF = Bottle Filler K=Kettle SP = Sprayer	Lead Result (ppb)	Copper Result (ppb)
First Floor	-	Kitchen	1-LL-Kit-S	S	3.21	217
First Floor	-	Kitchen	2-LL-Kit-S	S	3.67	249
First Floor	-	Kitchen	3-LL-Kit-S	S	2.41	288
First Floor	-	Kitchen	4-LL-Kit-SP	SP	4.19	257
First Floor	-	Kitchen	5-LL-Kit-SP	SP	11.7	508
First Floor	304	Nurse	6-LL-Nurse-S	S	0.67	132
First Floor	-	Office	7-LL-Office-S	S	5.51	193
First Floor	-	Hallway	8-LL-Hall Office-WC	WC	<0.5	27.3
First Floor	-	Hallway	9-LL-Hall Office-BF	BF	<0.5	28.3
First Floor	-	Staff Lounge	10-LL-Staff Lounge-S	S	0.67	218
First Floor	-	Band	11-LL-Band-S	S	554	437
First Floor	-	Hallway	12-LL-Hall 127-WC	WC	<0.5	41.2
First Floor	-	Hallway	13-LL-Hall 127-BF	BF	<0.5	40.1
First Floor	129	Classroom	14-LL-129-S	S	1.66	452
First Floor	132	Classroom	15-LL-132-S	S	2.28	277
First Floor	134	Classroom	16-LL-134-S	S	15.6	264
First Floor	136	Classroom	17-LL-136-S	S	6.04	351
First Floor	137	Classroom	18-LL-137-S	S	2.93	372
First Floor	135	Classroom	19-LL-135-S	S	22.5	177
First Floor	133	Classroom	20-LL-133-S	S	9.01	102
First Floor	131	Classroom	21-LL-131-S	S	9.43	131
First Floor	-	Hallway	22-LL-Hall 130-WC L	WC	3.37	509
First Floor	-	Hallway	23-LL-Hall 130-WC R	WC	<0.5	27.1
First Floor	-	Hallway	24-LL-Hall 130-BF	BF	<0.5	31.9
First Floor	154	Classroom	25-LL-154-S	S	8.22	138
First Floor	142	Classroom	26-LL-142-S	S	0.57	680
First Floor	144	Classroom	27-LL-144-S	S	0.5	572
First Floor	146	Classroom	28-LL-146-S	S	10.1	416
First Floor	146	Classroom	29-LL-146-DF	DF	7.03	154
First Floor	148	Classroom	30-LL-148-S	WC	6.13	266
First Floor	148	Classroom	31-LL-148-DF	DF	5.3	160
First Floor	147	Classroom	32-LL-147-S	S	8.45	322
First Floor	147	Classroom	33-LL-147-DF	DF	6.07	221
First Floor	145	Classroom	34-LL-145-S	S	10.9	366
First Floor	145	Classroom	35-LL-145-DF	DF	9.39	183
First Floor	143	Classroom	36-LL-143-S	S	9.69	282
First Floor	143	Classroom	37-LL-143-DF	DF	18.7	203
First Floor	141	Classroom	38-LL-141-S	S	8.57	284
First Floor	-	Hallway	39-LL-Hall 141-WC L	WC	0.85	142
First Floor	-	Hallway	40-LL-Hall 141-WC R	WC	<0.5	85.1
First Floor	-	Hallway	41-LL-Hall 141-BF	BF	<0.5	73.3
First Floor	150	Classroom	42-LL-150-S	S	8.85	289
First Floor	151	Classroom	43-LL-151-S	S	19.3	288
First Floor	128	Classroom	44-LL-128-S	S	2.29	550
First Floor	127	Classroom	45-LL-127-S	S	1.9	390
First Floor	126	Classroom	46-LL-126-S	S	3.06	636
First Floor	125	Classroom	47-LL-125-S	S	2.48	605
First Floor	124	Classroom	48-LL-124-S	S	2.4	490
First Floor	-	Hallway	49-LL-Locker Hall-WC L	WC	<0.5	51
First Floor	-	Hallway	50-LL-Locker Hall-WC R	WC	<0.5	55.6
First Floor	-	Hallway	51-LL-Locker Hall-BF	BF	<0.5	54.9
First Floor	200	Art	52-LL-Art 200-S	S	5.59	344
First Floor	200	Art	53-LL-Art 200-S	S	3.21	255
First Floor	200	Art	54-LL-Art 200-S	S	3.33	311
First Floor	200	Art	55-LL-Art 200-S	S	20.2	575
First Floor	200	Art	56-LL-Art 200-WC	WC	0.92	257
First Floor	206	Classroom	57-LL-206-S	S	2.54	276
First Floor	203	Classroom	58-LL-203-S	S	2.6	371
First Floor	203	Classroom	59-LL-203-WC	WC	<0.5	402
First Floor	202	Classroom	60-LL-202-S	S	2.67	500
First Floor	-	Media Office	61-LL-Media Office-S	S	6.01	468
First Floor	-	Kitchen	62-LL-Kit-K	K	110	1720
First Floor	-	Kitchen	63-LL-Kit- K SP	SP	12.7	468

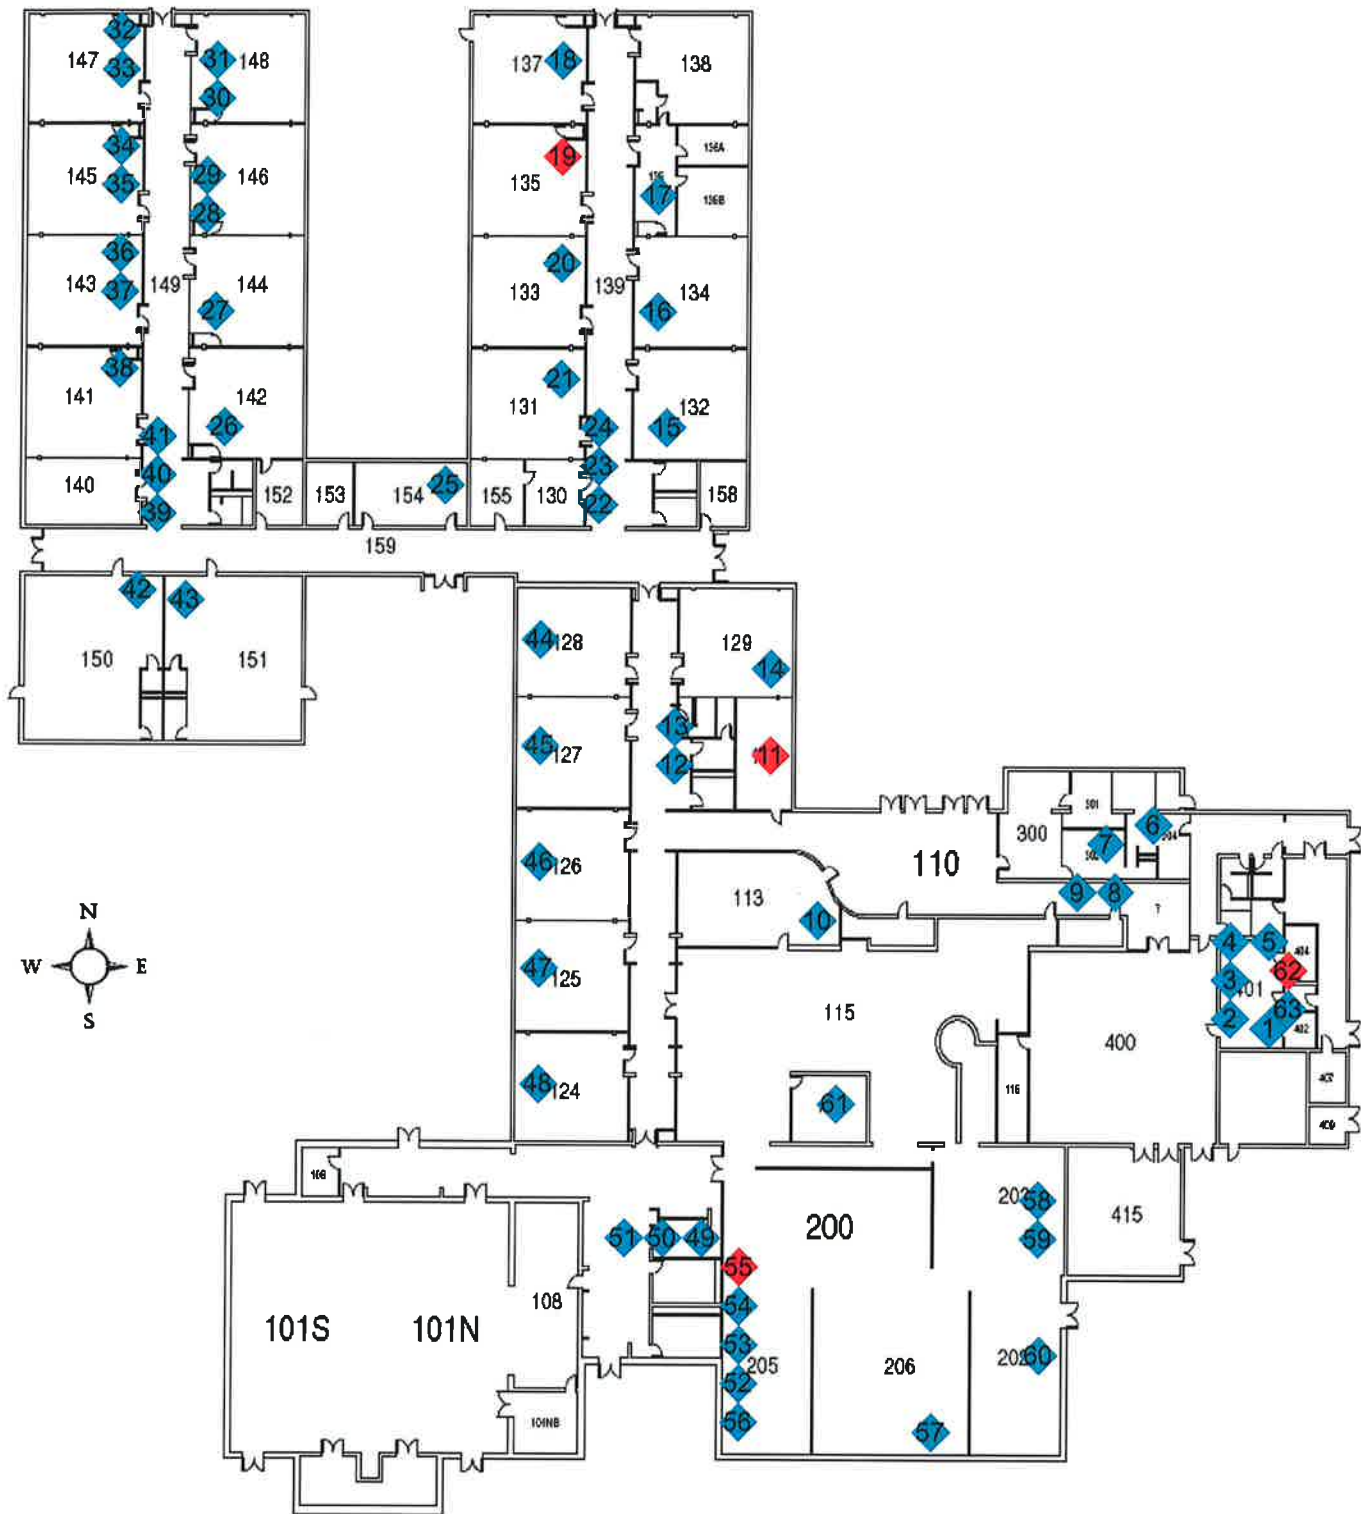

Lily Lake Elementary
Lead in Drinking Water
Project #23072

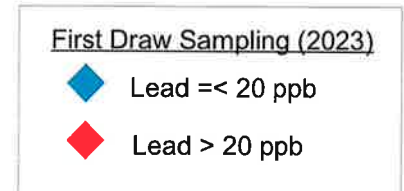

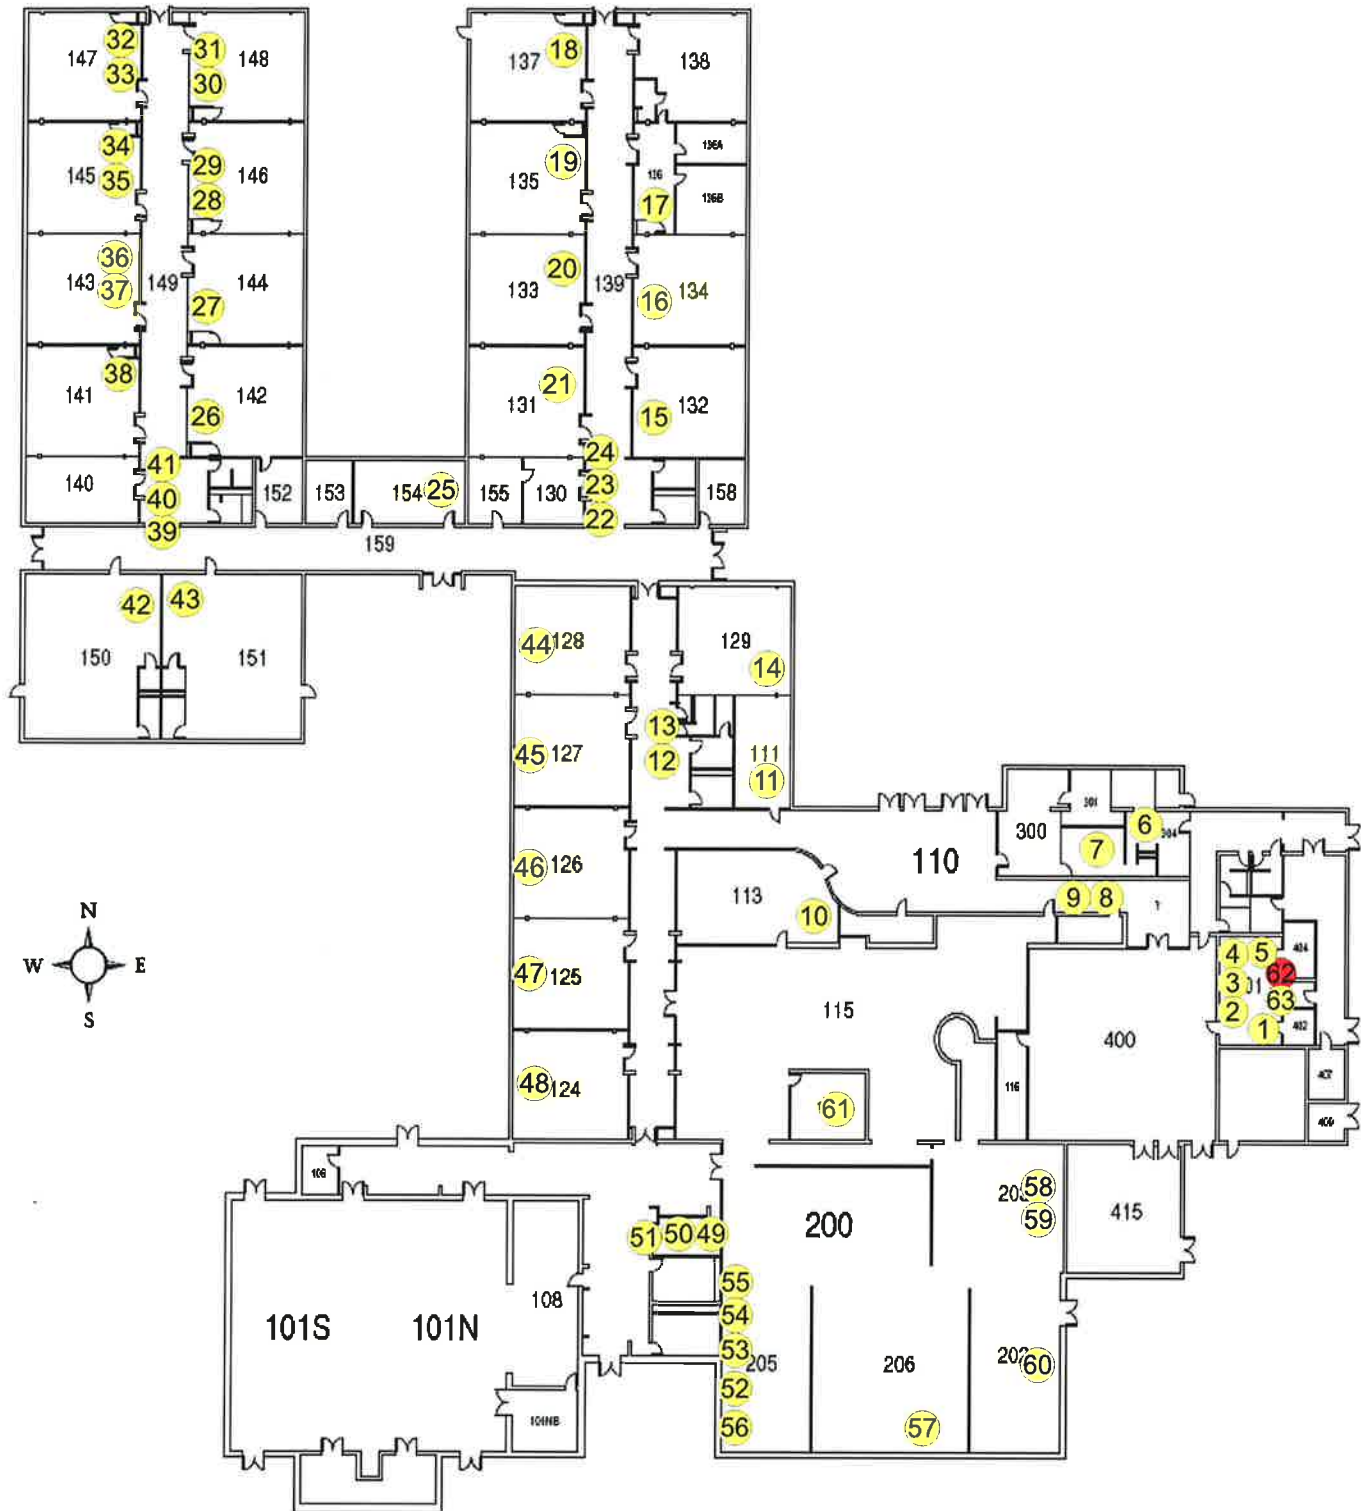

Lily Lake Elementary
Copper in Drinking Water
Project #23072

