

School Name: Brookview Elementary (BV)

Date: 5/4/2023


Floor	Room Number	Location	Sample ID	Type DF = Drinking Fountain S = Sink WC = Water Cooler BF = Bottle Filler K=Kettle SP = Sprayer	Lead Result (ppb)	Copper Result (ppb)
First Floor	410	Kitchen	1-BV-Kit-SP	SP	0.8	592
First Floor	410	Kitchen	2-BV-Kit-S	S	0.66	791
First Floor	410	Kitchen	3-BV-Kit-S	S	1.01	448
First Floor	410	Kitchen	4-BV-Kit-K	K	11.1	219
First Floor	410	Kitchen	5-BV-Kit-S	S	0.52	792
First Floor	410	Kitchen	6-BV-Kit-S	S	1.8	830
First Floor	410	Kitchen	7-BV-Kit-S	S	1.91	618
First Floor	410	Kitchen	8-BV-Kit-SP	SP	1.49	294
First Floor	420	Kitchen	9-BV-Kit-SP	SP	2.53	539
First Floor	420	Cafeteria	10-BV-CAT-WC (R)	WC	<0.5	332
First Floor	420	Cafeteria	11-BV-CAT-WC(L)	WC	<0.5	376
First Floor	420	Cafeteria	12-BV-CAT-BF	BF	<0.5	328
First Floor	112	Classroom	13-BV-112-S	S	2.6	101
First Floor	112	Classroom	14-BV-112-S	S	0.77	141
First Floor	-	Hallway	15-BV-Hall-WC(L)	WC	<0.5	445
First Floor	-	Hallway	16-BV-Hall-BF	BF	<0.5	398
First Floor	-	Hallway	17-BV-Hall-WC(R)	WC	<0.5	404
First Floor	-	Hallway	18-BV-Hall-WC(L)	WC	<0.5	440
First Floor	-	Hallway	19-BV-Hall-BF	BF	<0.5	318
First Floor	-	Hallway	20-BV-Hall-WC(R)	WC	<0.5	270
First Floor	501	Classroom	21-BV-501-S	S	<0.5	379
First Floor	501	Classroom	22-BV-501-DF	DF	<0.5	321
First Floor	503	Classroom	23-BV-503-S	S	0.71	442
First Floor	503	Classroom	24-BV-503-DF	DF	0.86	418
First Floor	505	Classroom	25-BV-505-DF	DF	0.73	398
First Floor	505	Classroom	26-BV-505-S	S	0.51	459
First Floor	507	Classroom	27-BV-507-S	S	1.4	602
First Floor	507	Classroom	28-BV-507-DF	DF	1.05	418
First Floor	508	Classroom	29-BV-508-S	S	0.98	419
First Floor	508	Classroom	30-BV-508-DF	DF	0.84	390
First Floor	506	Classroom	31-BV-506-DF	DF	1.32	453
First Floor	506	Classroom	32-BV-506-S	S	0.5	364
First Floor	504	Classroom	33-BV-504-S	S	0.69	600
First Floor	504	Classroom	34-BV-504-DF	DF	0.85	400
First Floor	502	Classroom	35-BV-502-DF	DF	1.27	476
First Floor	502	Classroom	36-BV-502-S	S	0.72	525
First Floor	-	Nurse	37-BV-Nurse-S	S	0.5	407
First Floor	117	Classroom	38-BV-117-S	S	0.52	561
First Floor	118	Classroom	39-BV-118-S	S	0.96	535
First Floor	121	Classroom	40-BV-121-S	S	0.77	461
First Floor	-	Lounge	41-BV-Lounge-S	S	0.64	517
First Floor	-	Hallway	42-BV-Hall-WC(R)	WC	<0.5	359
First Floor	-	Hallway	43-BV-Hall-WC(L)	WC	<0.5	407
First Floor	-	Hallway	44-BV-Hall-BF	BF	<0.5	393
First Floor	201	Classroom	45-BV-201-S	S	1.13	403
First Floor	303	Classroom	46-BV-303-S	S	2.14	271
First Floor	303	Classroom	47-BV-303-DF	DF	0.79	340
First Floor	305	Classroom	48-BV-305-S	S	1.37	584
First Floor	305	Classroom	49-BV-305-DF	DF	1.58	439
First Floor	306	Classroom	50-BV-306-S	S	0.77	226
First Floor	306	Classroom	51-BV-306-DF	DF	1.71	187
First Floor	304	Classroom	52-BV-304-S	S	1.25	218
First Floor	304	Classroom	53-BV-304-DF	DF	3.04	211

School Name: Brookview Elementary (BV)

Date: 5/4/2023

Floor	Room Number	Location	Sample ID	Type DF = Drinking Fountain S = Sink WC = Water Cooler BF = Bottle Filler K=Kettle SP = Sprayer	Lead Result (ppb)	Copper Result (ppb)
First Floor	302	Classroom	54-BV-302-S	S	0.74	522
First Floor	302	Classroom	55-BV-302-DF	DF	1.19	570
First Floor	-	Hallway	56-BV-Hall-WC(L)	WC	<0.5	376
First Floor	-	Hallway	57-BV-Hall-BF	BF	<0.5	412
First Floor	-	Hallway	58-BV-Hall-WC(R)	WC	<0.5	414
First Floor	201	Classroom	59-BV-201-S	S	1.46	429
First Floor	201	Classroom	60-BV-201-DF	DF	1.64	375
First Floor	203	Classroom	61-BV-203-S	S	1.59	574
First Floor	203	Classroom	62-BV-203-DF	DF	1.23	457
First Floor	205	Classroom	63-BV-205-S	S	1.48	874
First Floor	205	Classroom	64-BV-205-DF	DF	1.34	548
First Floor	210	Classroom	65-BV-210-S	S	1.99	678
First Floor	202	Classroom	66-BV-202-DF	DF	4.03	650
First Floor	202	Classroom	67-BV-202-S	S	1.54	572
First Floor	204	Classroom	68-BV-204-DF	DF	2.02	588
First Floor	204	Classroom	69-BV-204-S	S	0.9	541
First Floor	206	Classroom	70-BV-206-DF	DF	1.39	576
First Floor	206	Classroom	71-BV-206-S	S	0.98	557
First Floor	-	Hallway	72-BV-Hall-S(L)	S	2.54	52.4
First Floor	-	Hallway	73-BV-Hall-S(R)	S	1.38	34.6
First Floor	207	Classroom	74-BV-207-S	S	0.63	197
First Floor	208	Classroom	75-BV-208-S	S	0.92	282
First Floor	209	Classroom	76-BV-209-S	S	1.3	330
First Floor	210	Classroom	77-BV-210-S	S	1.26	433
First Floor	-	Hallway	78-BV-Hall-WC(L)	WC	<0.5	160
First Floor	-	Hallway	79-BV-Hall-WC(R)	WC	<0.5	258
First Floor	-	Hallway	80-BV-Hall-BF	BF	<0.5	302
First Floor	310	Classroom	81-BV-310-S	S	1.07	494
First Floor	309	Classroom	82-BV-309-S	S	0.8	393
First Floor	308	Classroom	83-BV-308-S	S	1.04	372
First Floor	307	Classroom	84-BV-307-S	S	<0.5	224
First Floor	-	Hallway	85-BV-Hall-S(L)	S	0.71	29.7
First Floor	-	Hallway	86-BV-Hall-S(R)	S	1.04	45.3

**Brookview Elementary**  
**Lead in Drinking Water**  
**Project #23072**

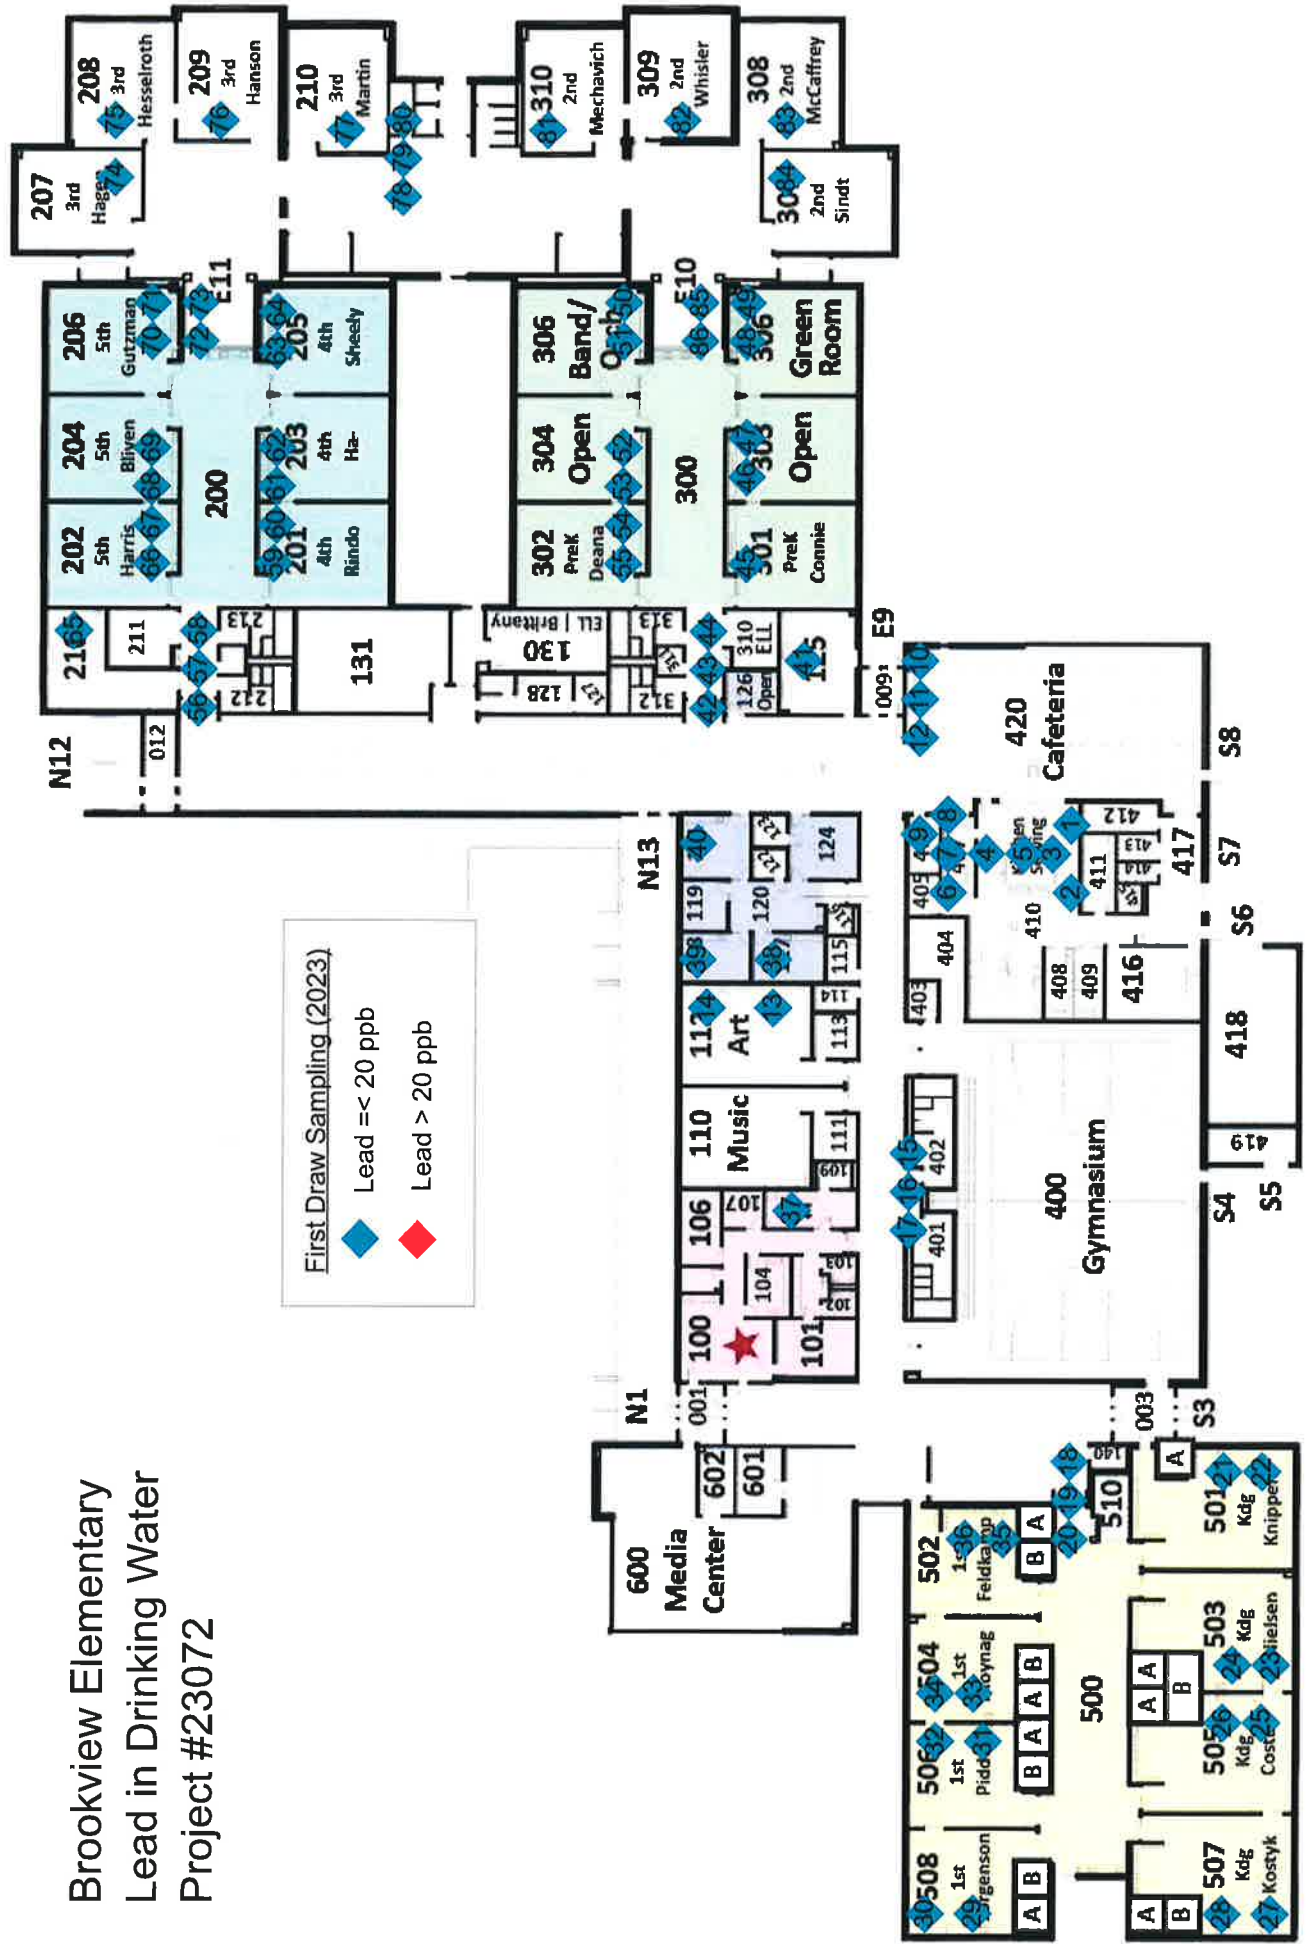

Brookview Elementary  
Copper in Drinking Water  
Project #23072

