


School Name: Anderson Elementary (AN)

Date: 5/5/2023


Floor	Room Number	Location	Sample ID	Type DF = Drinking Fountain S = Sink WC = Water Cooler BF = Bottle Filler SP = Sprayer	Lead Result (ppb)	Copper Result (ppb)
First Floor	-	Café	1-AN-Café-BF	BF	<0.5	117
First Floor	-	Café	2-AN-Café-WC	WC	<0.5	116
First Floor	-	Kitchen	3-AN-Kit.E-SP	SP	2.33	230
First Floor	-	Kitchen	4-AN-Kit NE-S	S	<0.5	243
First Floor	-	Kitchen	5-AN-Kit NE-S	S	<0.5	303
First Floor	-	Kitchen	6-AN-Kit NW-S	S	1.6	304
First Floor	-	Kitchen	7-AN-Kit NW-SP	SP	<0.5	257
First Floor	-	Hallway	8-AN-Hall 101-DF	DF	<0.5	135
First Floor	101	Classroom	9-AN-101-S	S	<0.5	174
First Floor	102	Classroom	10-AN-102-S	S	0.52	307
First Floor	104	Classroom	11-AN-104-S	S	<0.5	238
First Floor	-	Hallway	12-AN-Hall 104-BF	BF	<0.5	34.4
First Floor	-	Hallway	13-AN-Hall 104-WC	WC	<0.5	48.3
First Floor	-	Hallway	14-AN-Hall 148-WC	WC	<0.5	47.5
First Floor	148	Classroom	15-AN-148-S	S	<0.5	200
First Floor	148	Classroom	16-AN-148-DF	DF	<0.5	491
First Floor	107	Classroom	17-AN-107 W-S	S	<0.5	211
First Floor	107	Classroom	18-AN-107 N-S	S	<0.5	313
First Floor	108	Classroom	19-AN-108-S	S	<0.5	237
First Floor	109	Classroom	20-AN-109-S	S	<0.5	259
Second Floor	201	Classroom	21-AN-201-S	S	<0.5	240
Second Floor	-	Hallway	22-AN-Hall 202-WC	WC	<0.5	147
Second Floor	202	Classroom	23-AN-202-S	S	<0.5	182
Second Floor	-	Teachers Lounge	24-AN-TchLg-S	S	<0.5	278
Second Floor	203	Classroom	25-AN-203-S	S	0.71	198
Second Floor	204	Classroom	26-AN-204-S	S	<0.5	205
Second Floor	205	Classroom	27-AN-205-S	S	<0.5	194
Second Floor	206	Classroom	28-AN-206-S	S	<0.5	199
Second Floor	-	Hallway	29-AN-Hall 206-BF	BF	<0.5	52.7
Second Floor	-	Hallway	30-AN-Hall 206-WC	WC	<0.5	68
Second Floor	208	Classroom	31-AN-208-S	S	<0.5	213
Second Floor	207	Classroom	32-AN-207-S	S	0.59	233
First Floor	-	Nurse	33-AN-Nurses-S	S	<0.5	320
First Floor	107	Classroom	34-AN-107-DF	DF	<0.5	269

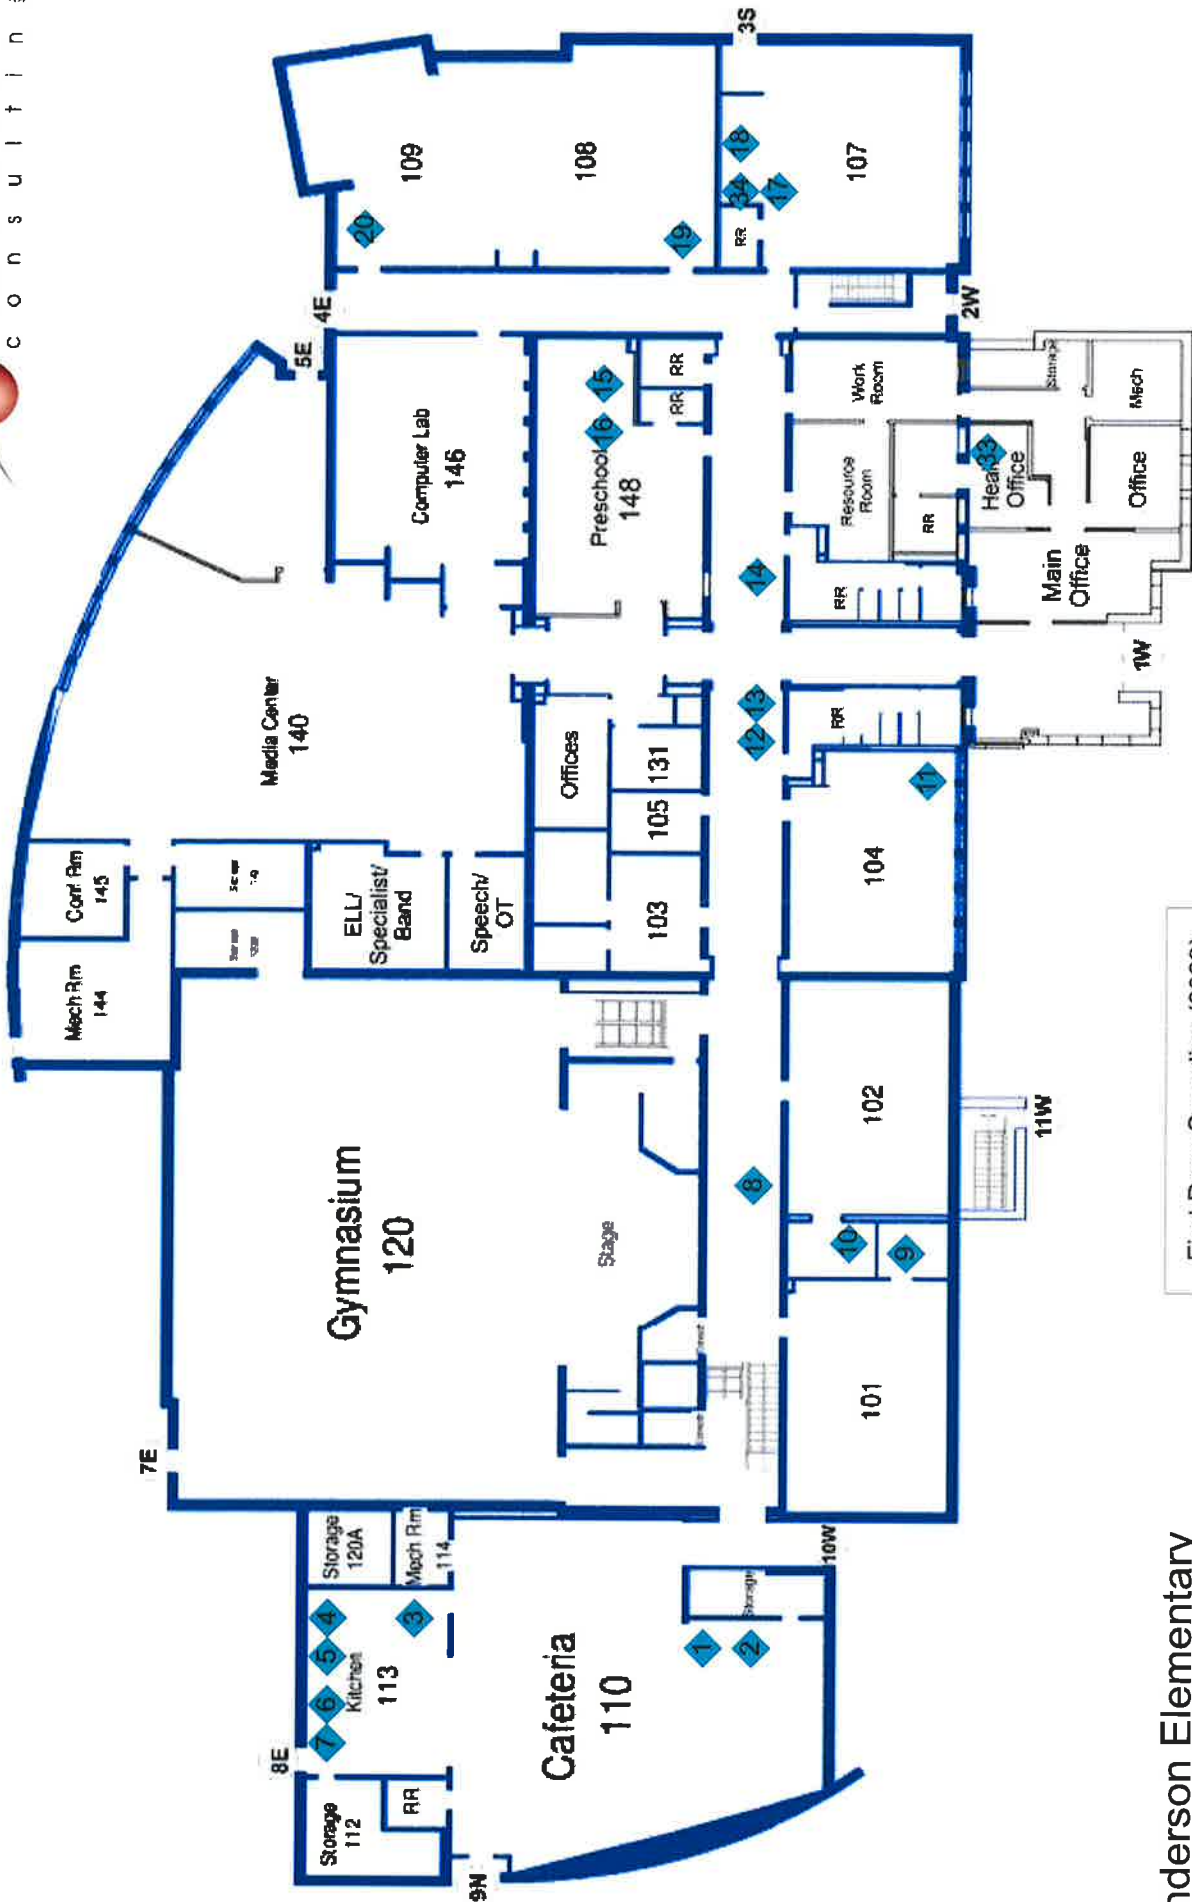

First Draw Sampling (2023)


- ◆ Lead ≤ 20 ppb
- ◆ Lead > 20 ppb

Anderson Elementary
Lead in Drinking Water
First Floor
Project #23072

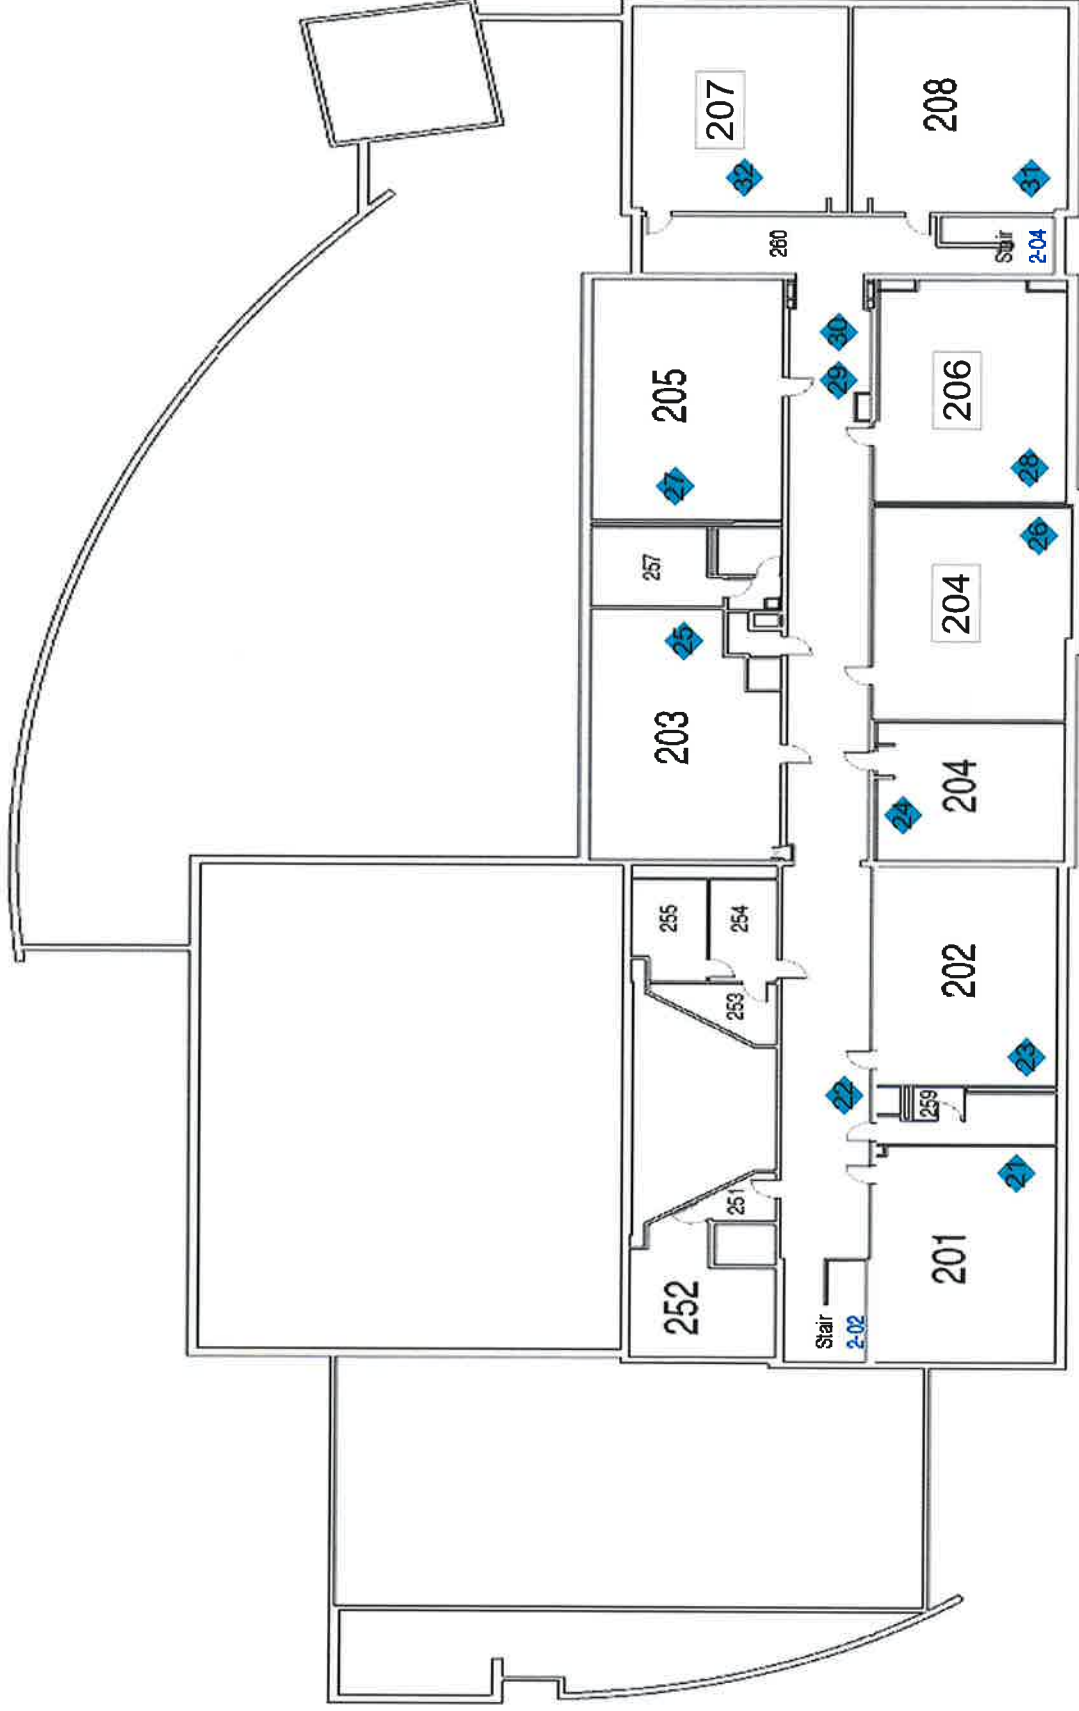


Anderson Elementary
Lead in Drinking Water
Second Floor
Project #23072

First Draw Sampling (2023)
◆ Lead ≤ 20 ppb
◆ Lead > 20 ppb

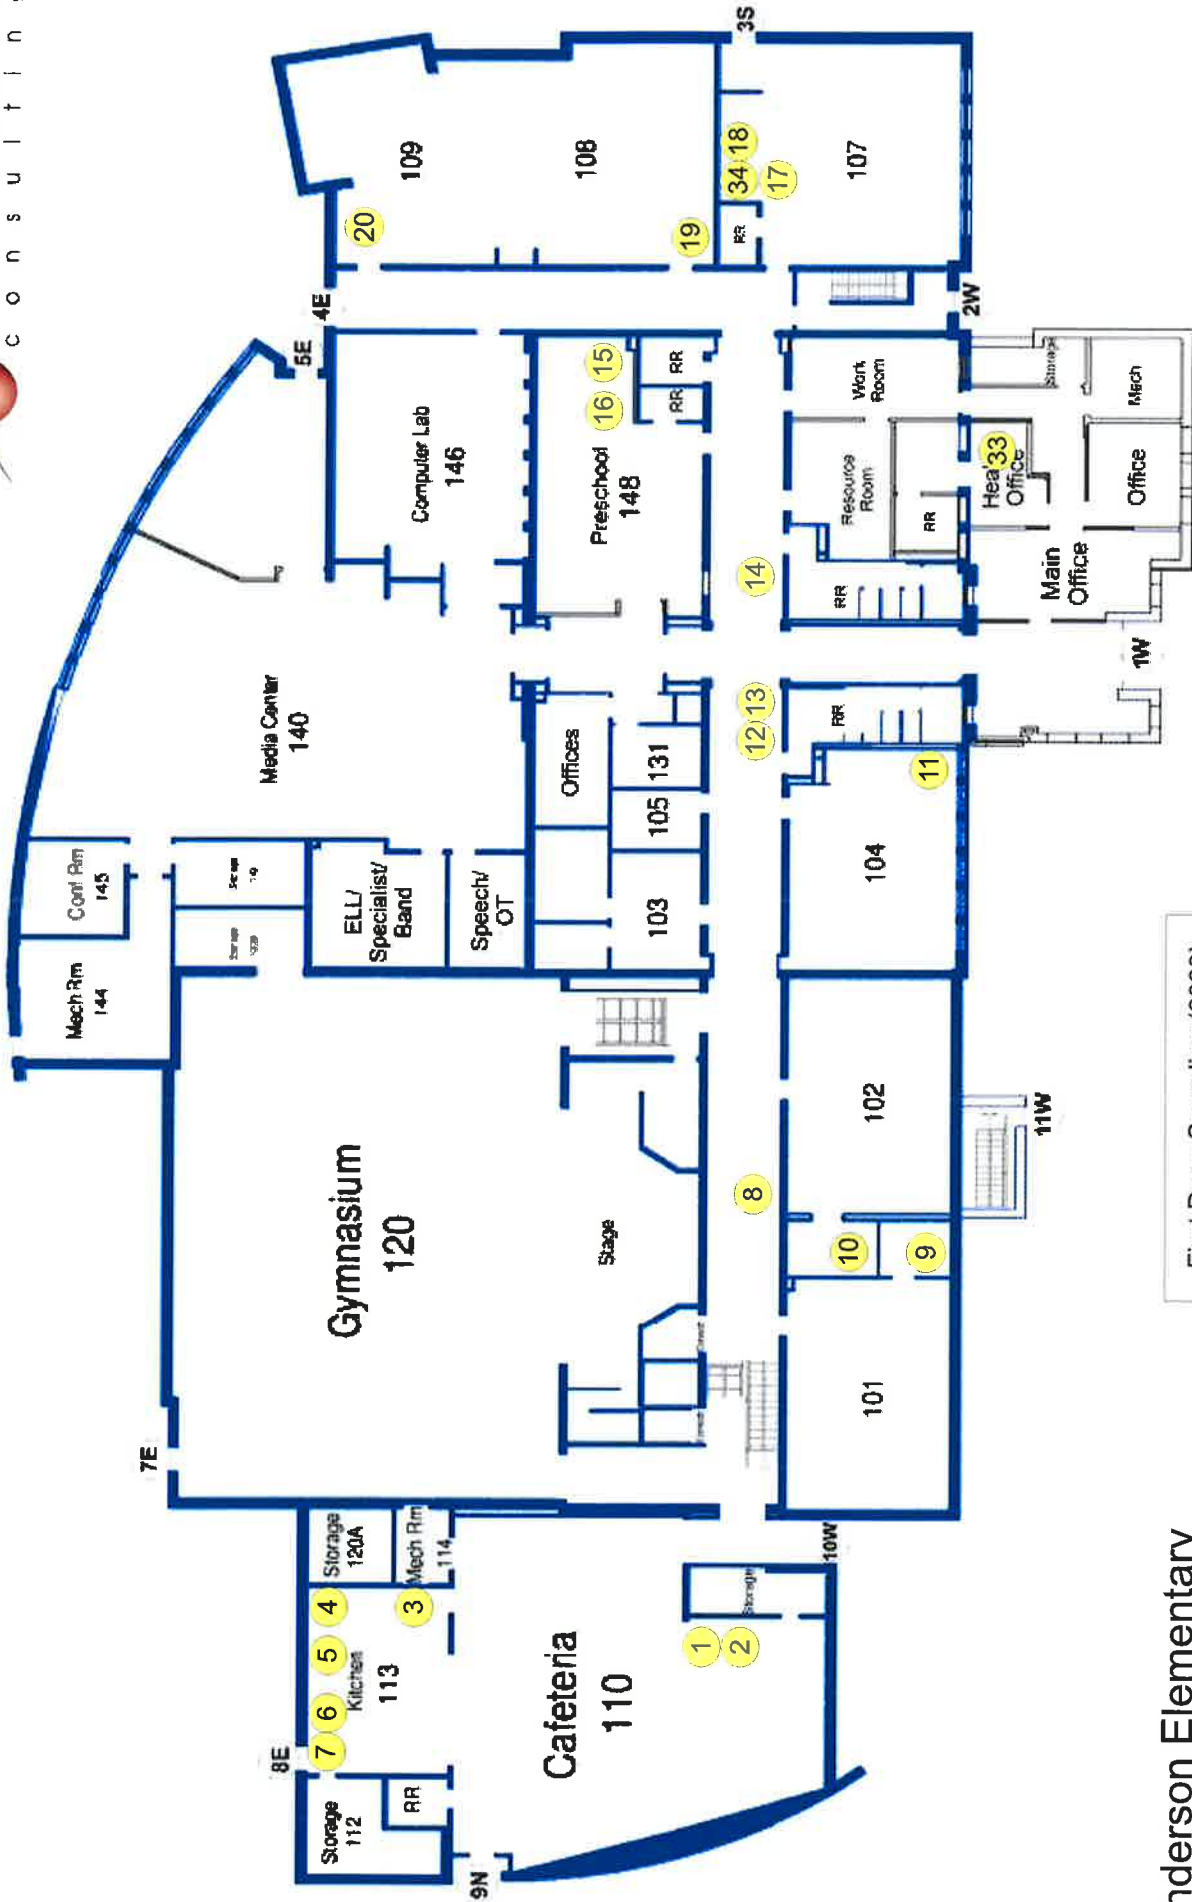

First Draw Sampling (2023)
● Copper <= 1300
● Copper > 1300

Anderson Elementary
 Copper in Drinking Water
 First Floor
 Project #23072

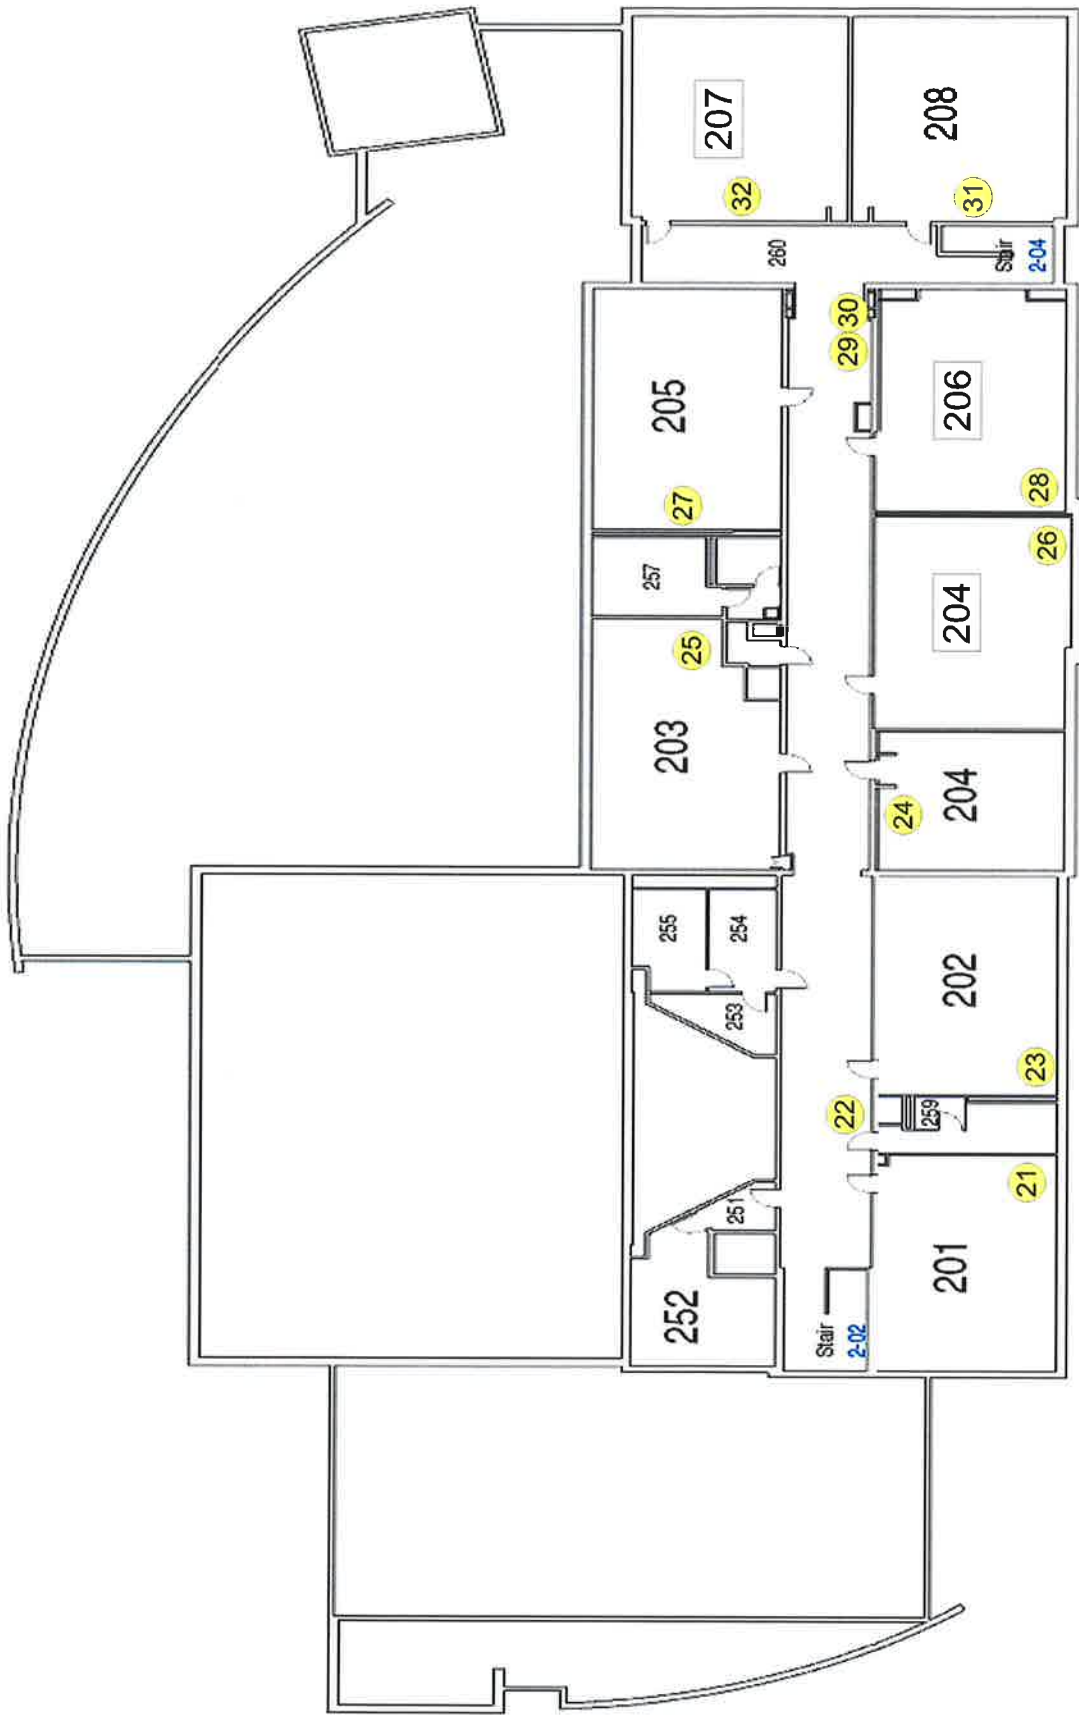

Anderson Elementary
Copper in Drinking Water
Second Floor
Project #23072

First Draw Sampling (2023)

- Copper \leq 1300
- Copper $>$ 1300