

School Name: Lake Elmo Elementary (LE)


Date: 5/4/2023

Floor	Room Number	Location	Sample ID	Type S = Sink WC = Water Cooler BF = Bottle Filler K=Kettle SP = Sprayer refrig = Refridgerator	Lead Result (ppb)	Copper Result (ppb)
First Floor	-	Hallway	1-LE-Hall by Café-BF	BF	<0.5	70.4
First Floor	-	Hallway	2-LE-Hall by Café-WC	WC	0.59	73
First Floor	-	Kitchen	3-LE-Kitchen South-S	S	1.91	287
First Floor	-	Kitchen	4-LE-Kit SE-S	S	3.41	479
First Floor	-	Kitchen	5-LE-Kit S Center-SP	SP	2.62	236
First Floor	-	Kitchen	6-LE-Kit S Center-S	S	3.54	269
First Floor	-	Kitchen	7-LE-Kit-K	K	26.9	691
First Floor	-	Dish Rm	8-LE-Dish NE-S	S	12	311
First Floor	-	Dish Rm	9-LE-Dish NW-S	S	11	317
First Floor	-	Dish RM	10-LE-Dish SW-SP	SP	4.12	201
First Floor	-	Dish Rm	11-LE-Dish SE-S	S	4.85	584
First Floor	202	Classroom	12-LE-202-S	S	5.02	359
First Floor	204	Classroom	13-LE-204-S	S	11.3	393
First Floor	206	Classroom	14-LE-206-S	S	25.1	454
First Floor	207	Classroom	15-LE-207-S	S	4.35	144
First Floor	209	Classroom	16-LE-209-S	S	4.7	179
First Floor	208	Classroom	17-LE-208-S	S	3.97	206
First Floor	211	Classroom	28-LE-211-S	S	0.61	114
First Floor	210	Classroom	19-LE-210-S	S	3.97	246
First Floor	-	Hallway	20-LE-220 Hall-BF	BF	<0.5	28.7
First Floor	-	Hallway	21-LE-220 Hall-WC	WC	<0.5	26.6
First Floor	214	Classroom	22-LE-214-S	S	2.33	404
First Floor	217	Classroom	23-LE-217-S	S	4.71	475
First Floor	219	Classroom	24-LE-219-S	S	1.55	492
First Floor	216	Classroom	25-LE-216-S	S	1.46	467
First Floor	-	Hallway	26-LE-Hall 218-WC	WC	<0.5	<0.5
First Floor	310	Media Center	27-LE-310-S	S	60.2	450
First Floor	-	Hallway	28-LE-303 Hall-BF	BF	<0.5	24.5
First Floor	-	Hallway	29-LE-303 Hall-WC	WC	<0.5	26.4
First Floor	-	Hallway	30-LE-511 Hall-BF	BF	<0.5	23.9
First Floor	-	Hallway	31-E-Hall 511-WC	WC	<0.5	25.7
First Floor	414	Classroom	32-LE-414 S-S	S	<0.5	169
First Floor	414	Classroom	33-LE-414 N-S	S	1.32	314
First Floor	415	Classroom	34-LE-415 W-S	S	2.11	391
First Floor	415	Classroom	35-LE-415-refrig	refrig	<0.5	3.45
First Floor	415	Classroom	36-LE-415 E-S	S	1.08	311
First Floor	-	Hallway	37-LE-Hall 414-BF	BF	<0.5	48.3
First Floor	-	Hallway	38-LE-Hall 414-WC	WC	<0.5	42.8
First Floor	-	Nurse	39-LE-Nurse-S	S	7.44	393
First Floor	412	Classroom	40-LE-412 N-S	S	1.11	415
First Floor	412	Classroom	41-LE-412 S-S	S	1	250
First Floor	408	Classroom	42-LE-408-S	S	6.28	866
First Floor	409	Classroom	43-LE-409-S	S	2.16	328
First Floor	511	Classroom	44-LE-511-S	S	49.7	155
First Floor	510	Classroom	45-LE-510-S	S	3.11	430
First Floor	509	Classroom	46-LE-509-S	S	35.9	680
First Floor	508	Classroom	47-LE-508-S	S	4.9	326
First Floor	507	Classroom	48-LE-507-S	S	13	122
First Floor	507	Classroom	49-LE-506-S	S	26.8	24900
First Floor	505	Classroom	50-LE-505-S	S	8.55	545
First Floor	504	Classroom	51-LE-504-S	S	3.58	582
First Floor	503	Classroom	52-LE-503-S	S	5.76	505
First Floor	502	Classroom	53-LE-502-S	S	8.45	549
First Floor	609	Classroom	54-LE-609-S	S	3.93	317
First Floor	608	Classroom	55-LE-608-S	S	17.6	368
First Floor	606	Classroom	56-LE-606-S	S	4.44	296
First Floor	604	Classroom	57-LE-604-S	S	3.15	325
First Floor	607	Classroom	58-LE-607-S	S	6.23	1090

School Name: Lake Elmo Elementary (LE)

Date: 5/4/2023



Floor	Room Number	Location	Sample ID	Type S = Sink WC = Water Cooler BF = Bottle Filler K=Kettle SP = Sprayer refrig = Refridgerator	Lead Result (ppb)	Copper Result (ppb)
First Floor	605	Classroom	59-LE-605-S	S	15.9	350
First Floor	-	Copy Rm	60-LE-Copy RM-S	S	6.26	486
First Floor	131	Classroom	61-LE-131-S	S	4.61	532
First Floor	132	Classroom	62-LE-132-S	S	6.79	755
Second Floor	231	Classroom	63-LE-231-S	S	3.35	501
Second Floor	232	Classroom	64-LE-232-S	S	2	572

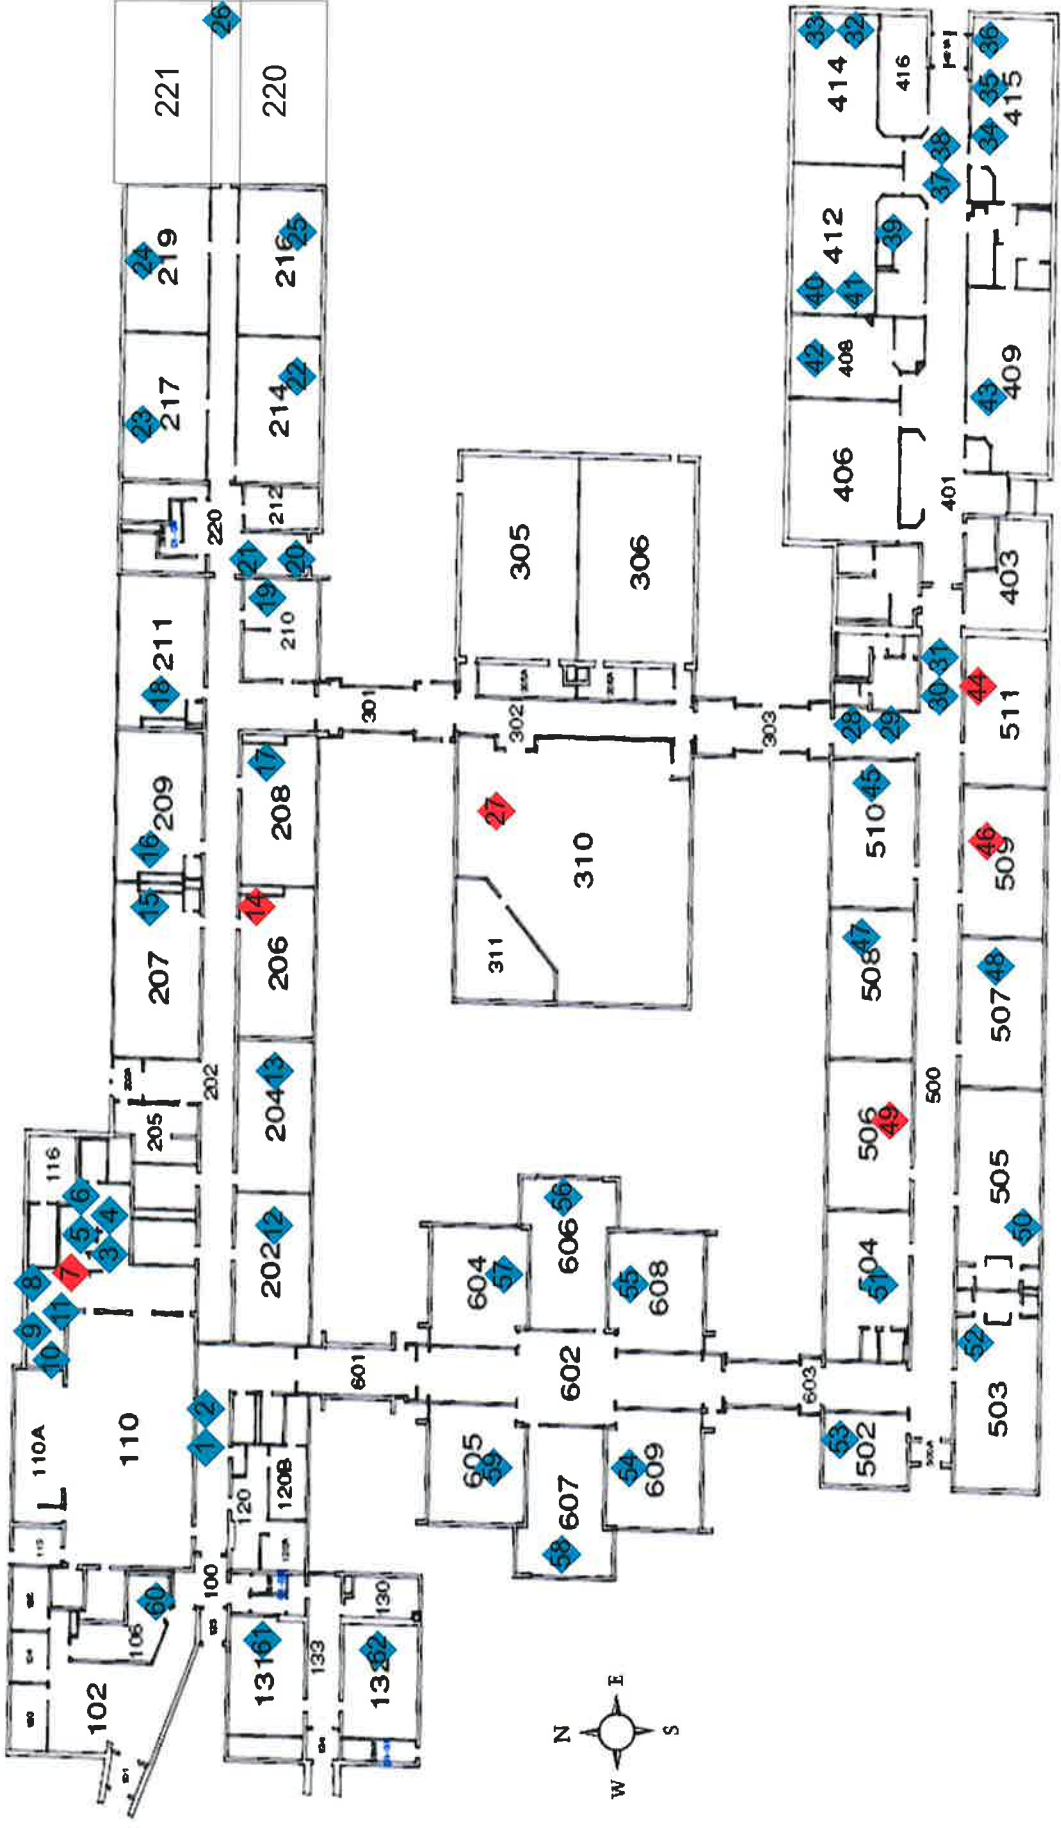

First Draw Sampling (2023)

- Blue Diamond: Lead <= 20 ppb
- Red Diamond: Lead > 20 ppb


Lake Elmo Elementary  
Lead in Drinking Water  
First Floor  
Project #23072

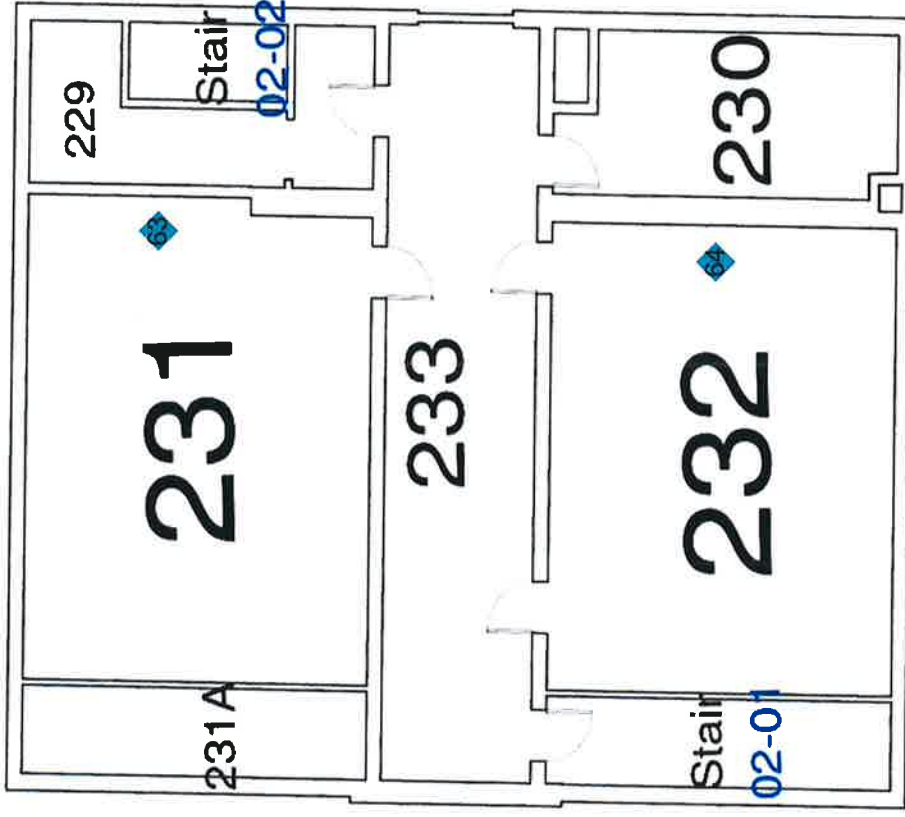

Lake Elmo Elementary  
Lead in Drinking Water  
Second Floor  
Project #23072

First Draw Sampling (2023)



- ◆ Lead  $\leq$  20 ppb
- ◆ Lead  $>$  20 ppb

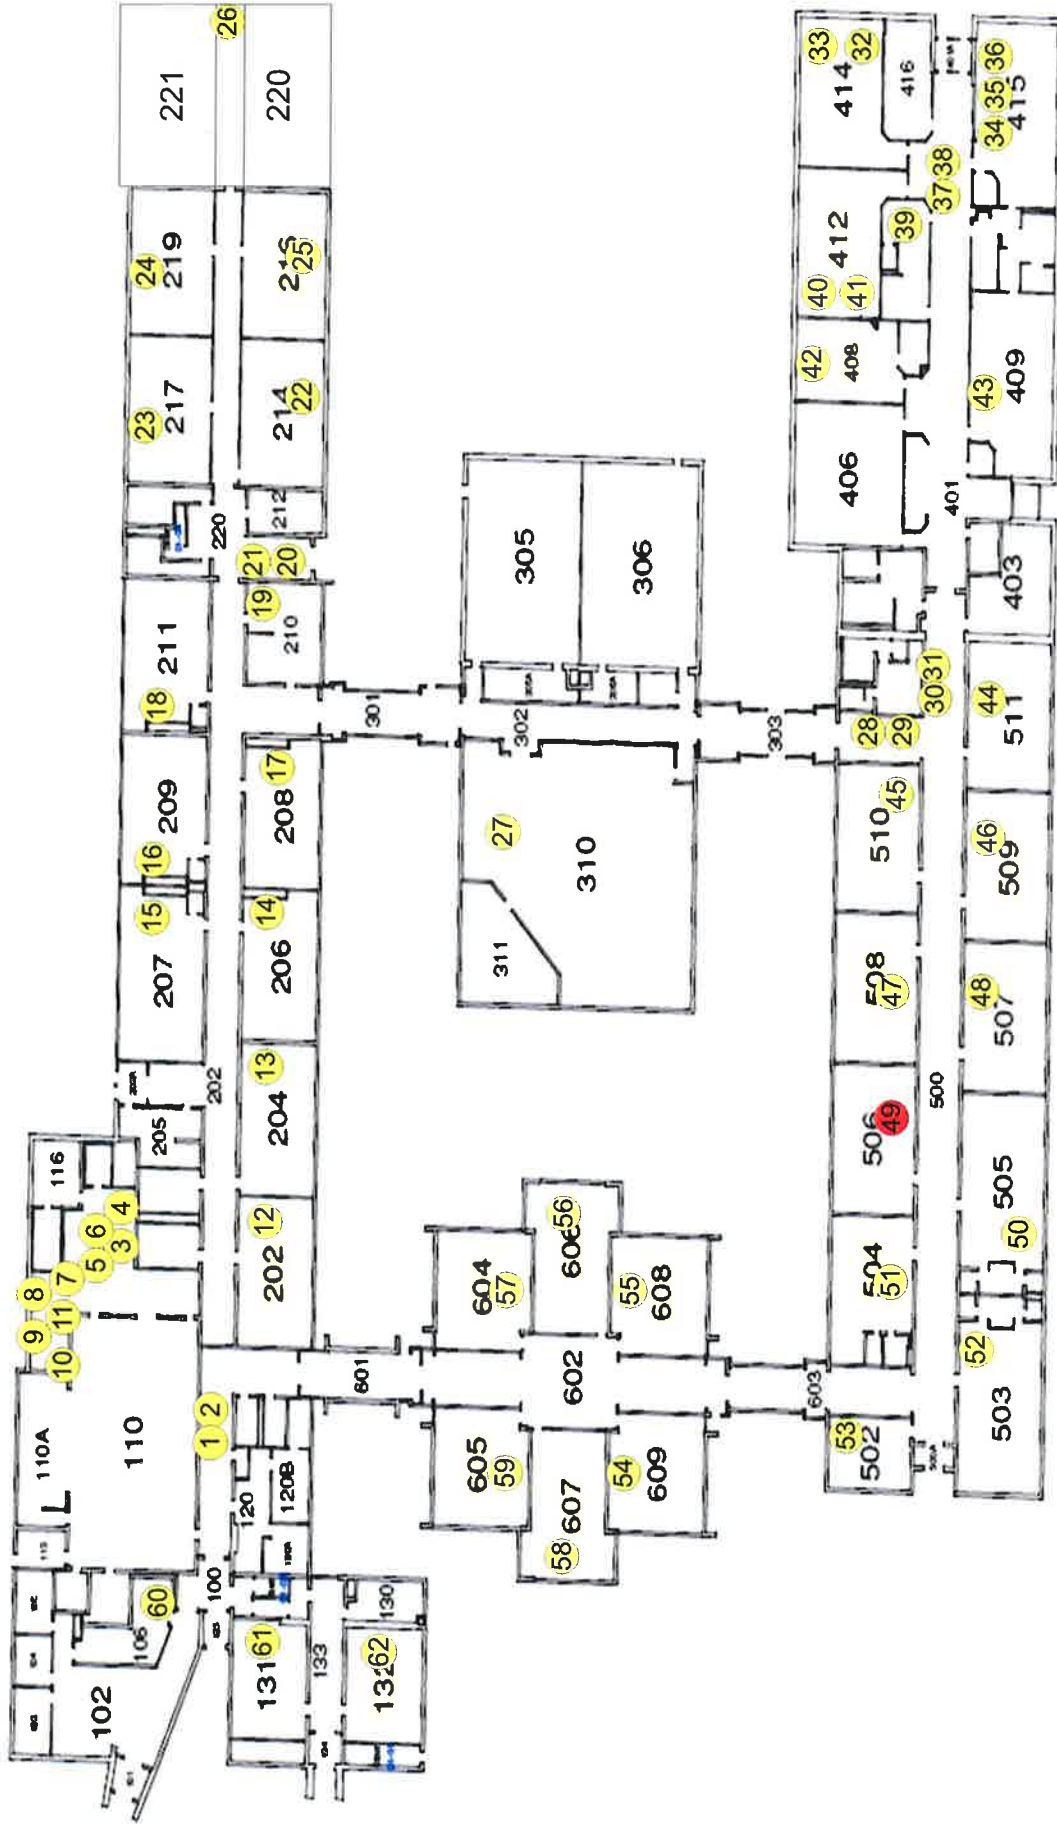

First Draw Sampling (2023)

- Copper ≤ 1300
- Copper > 1300

Lake Elmo Elementary  
Copper in Drinking Water  
First Floor  
Project #23072

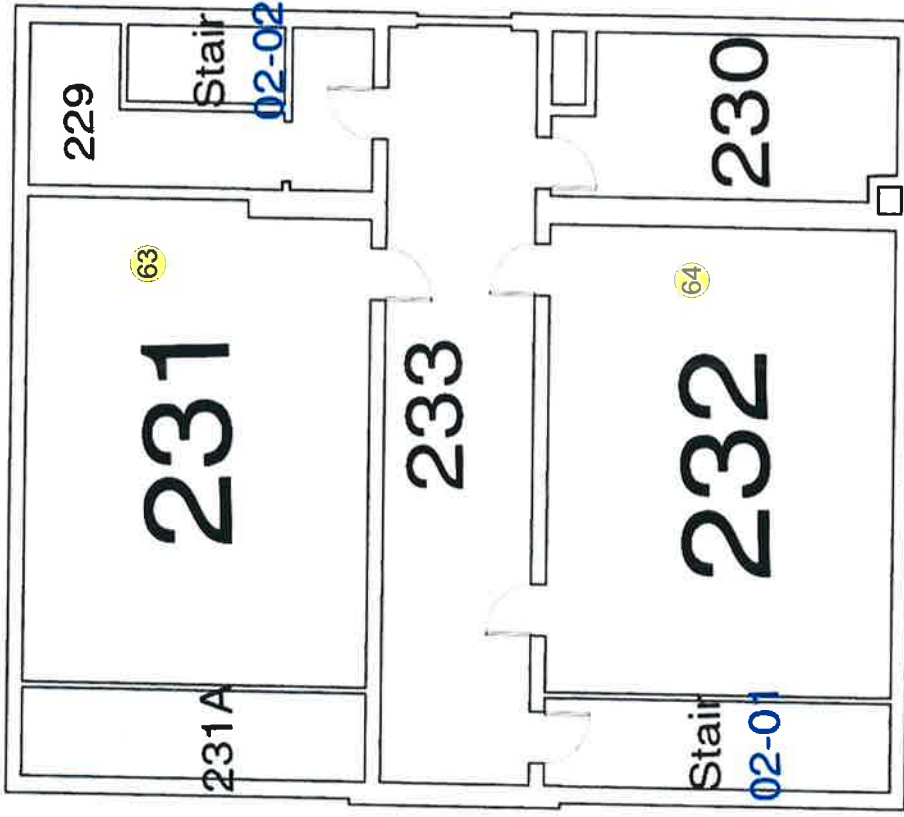

First Draw Sampling (2023)

● Copper  $\leq$  1300

● Copper  $>$  1300

Lake Elmo Elementary  
Copper in Drinking Water  
Second Floor  
Project #23072