


Samples

School Drinking Water Testing 2022

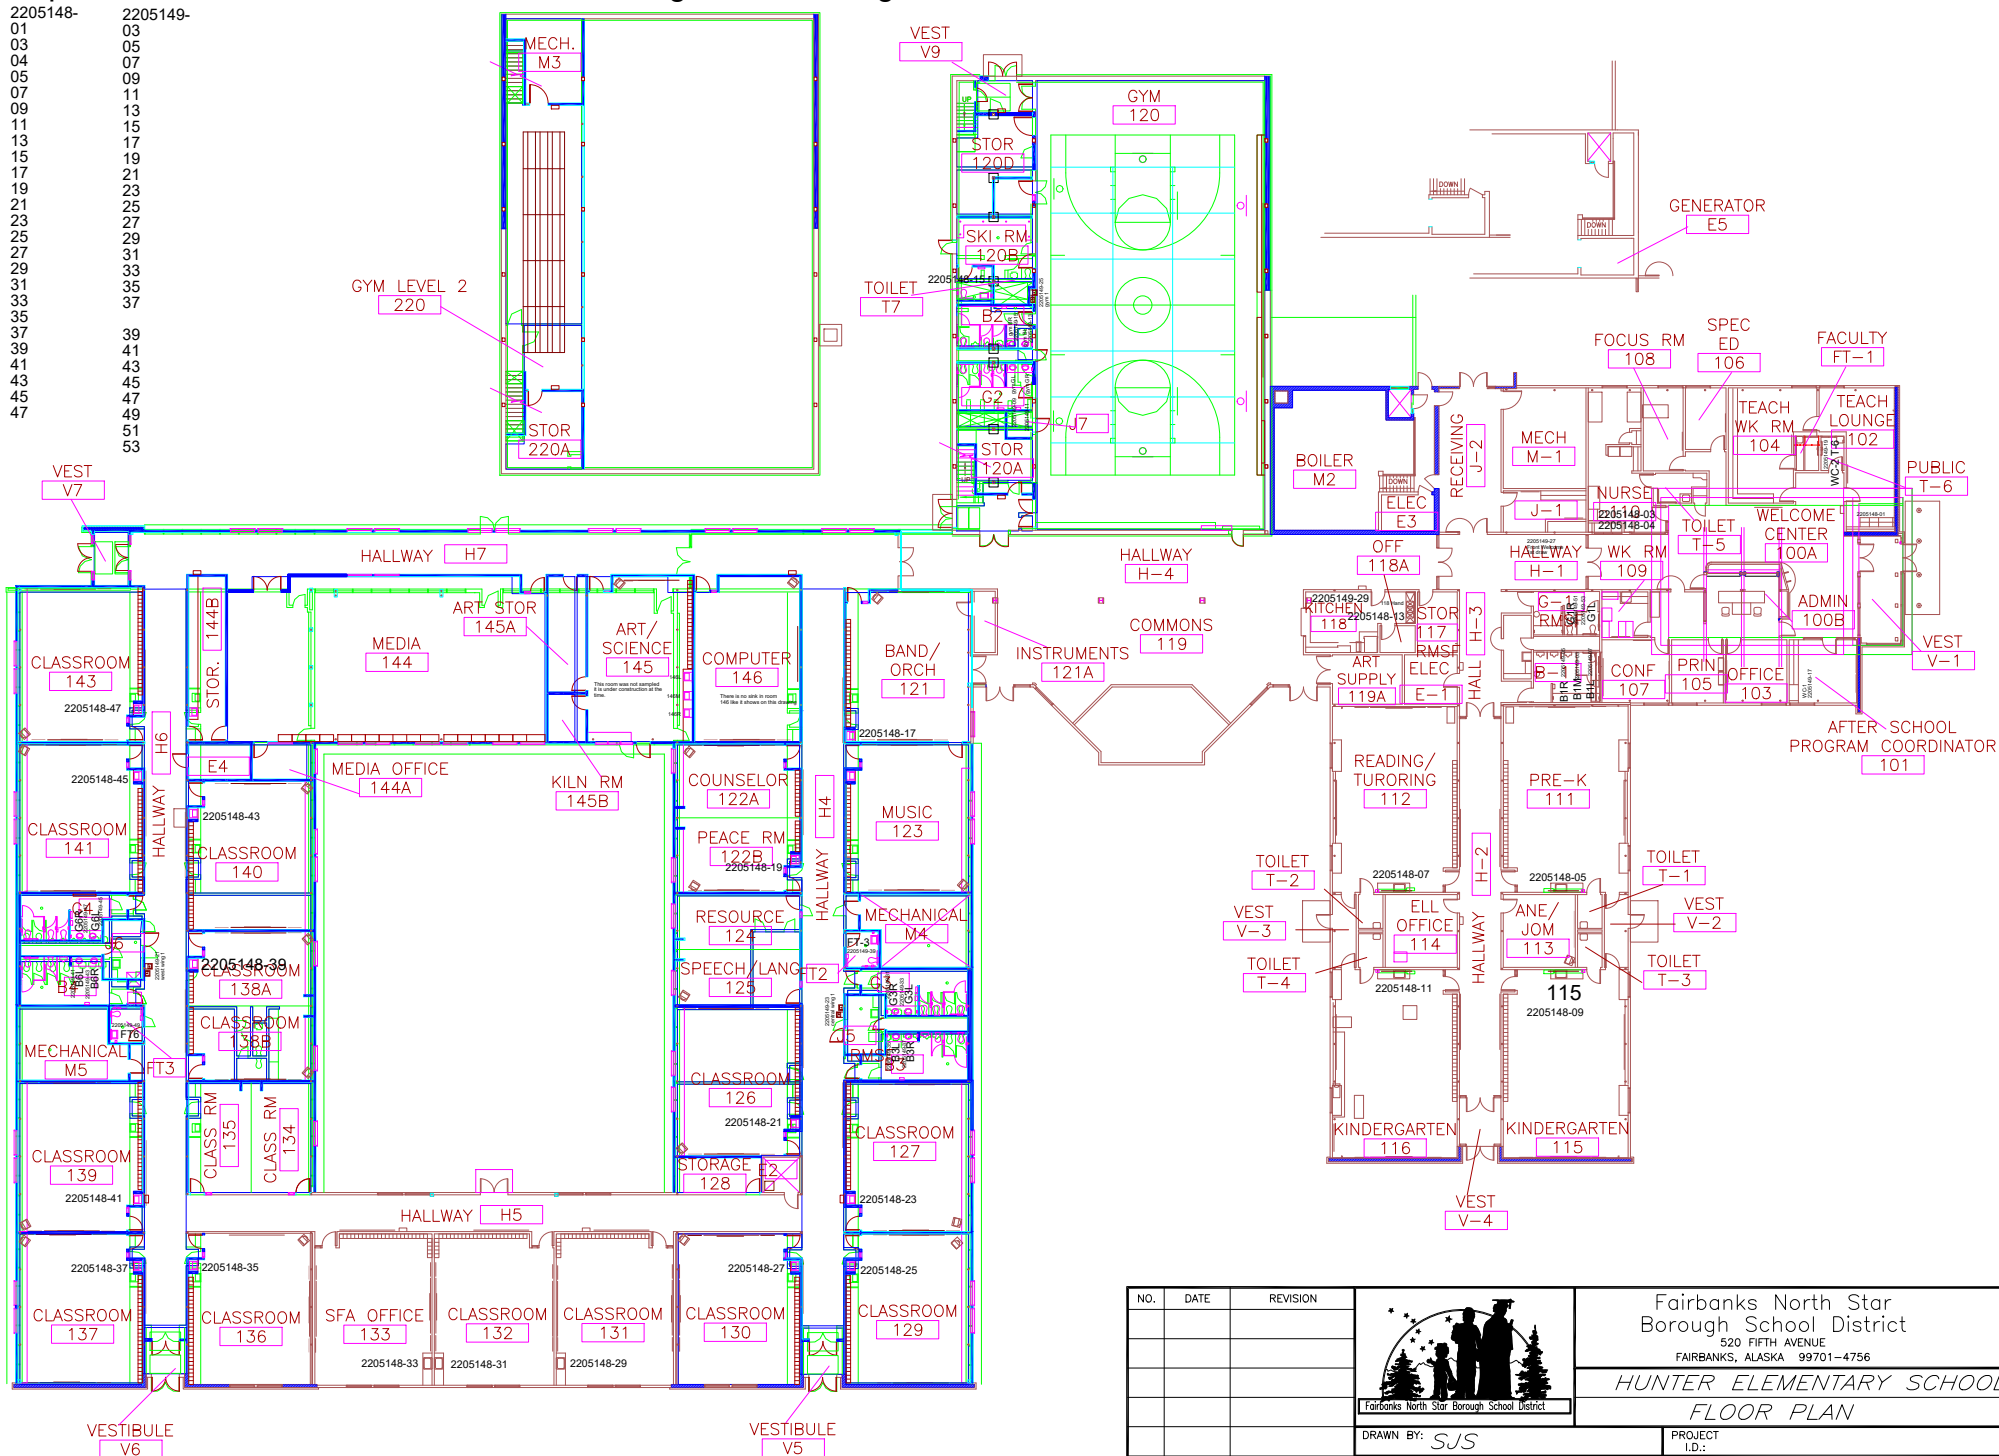

NO.	DATE	REVISION	 Fairbanks North Star Borough School District	Fairbanks North Star Borough School District		
				520 FIFTH AVENUE FAIRBANKS, ALASKA 99701-4756		
				HUNTER ELEMENTARY SCHOOL		
				FLOOR PLAN		
			DRAWN BY: <i>SJS</i>	PROJECT I.D.:		
			CHECKED BY:	DATE: <i>08/27/03</i>		
FILE NAME: <i>06FLPLAN</i>			SCALE: <i>NOT TO SCALE</i>	DRAWING NUMBER: <i>1 OF 1</i>	REV.:	