


Midwest
Environmental
Consulting, L.L.C.

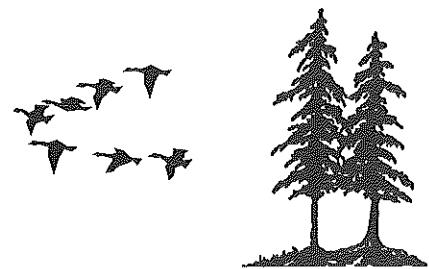

Printed on Recycled Paper

**River Front Educational Center
Saint Paul Public Schools**

Lead-Based Paint Inspection

Inspection Dates: 6/10/97, 6/11/97, 6/12/97, 6/13/97, 6/16/97

submitted to:

Saint Paul Public Schools

MEC Project # 62/0197AI

INTRODUCTION

At the request of Saint Paul Public Schools Environmental Safety Department, Midwest Environmental Consulting, L.L.C. (MEC), conducted a lead-based paint inspection at River Front Educational Center, 65 East Kellogg Blvd., St. Paul, MN. The purpose of this inspection was to identify lead-based painted, varnished, or otherwise coated building components on the interior and exterior of the school building.

The inspection protocol incorporated applicable portions of the U.S. Department of Housing and Urban Development (HUD) *Guidelines for the Evaluation and Control of Lead-based Paint Hazards in Housing* (HUD Guidelines, June 1995) and OSHA 1926.62 requirements (Lead in Construction). The HUD guidelines are formulated to guide agencies in conducting random sampling of the interiors and exteriors of dwellings and common areas in public housing. The OSHA requirement is designed to minimize worker exposure when working with material containing lead.

Confirmatory testing was conducted when inconclusive XRF results were encountered. Inconclusive refers to XRF readings less than 0.2 mg/cm² (milligrams per square centimeter). Inconclusive results were confirmed with laboratory analysis of paint chip samples (Appendix B). This report contains a list of such results.

The United States Environmental Protection Agency defines "lead-based paint" as a paint or other surface coating that contains lead equal to or in excess of 1.0 milligrams per square centimeter when analyzed by XRF or more than 0.5% by weight (5000 parts per million) by laboratory analysis of a bulk sample.

Minnesota Department of Labor and Industry (MN OSHA) adopted the EPA lead levels for the purpose of enforcing OSHA 1926.62 federal regulations. Detection of lead in dried paint film by XRF is a dependable indicator of levels of lead and is accepted by MN OSHA.

For this Saint Paul Public Schools Lead Inspection, all building components were tested on site using a Niton XL® X-ray Fluorescence Spectrum Analyzer⁽¹⁾. Building components included walls, ceilings, floors, moldings, window and door components, door surfaces, and miscellaneous features such as shelves or bookcases. Only painted or glazed surfaces or surfaces which were varnished were tested. Suspended ceilings, structural steel, and corrugated decking were not included in the inspection. Neither anodized (e.g., window sashes) nor plastic (e.g., vinyl baseboard and vinyl mini-blinds) were included in the scope of this inspection.

⁽¹⁾ This is a portable hand held machine that can analyze building components instantly for lead concentrations.

Each building was divided into unique sites based on the year of construction or renovation. Portable classrooms, playgrounds, and other detached buildings were automatically designated as a unique site. Each site was inspected independently assuming differences in painting history and construction characteristics.

SITE DESCRIPTION AND BUILDING HISTORY

According to information provided to MEC by Saint Paul Public Schools, River Front Educational Center was constructed in two phases. The first phase of 40,400 square feet dates from 1890. The second phase of 89,600 square feet is from 1959. The building was purchased from the YMCA and no other building history is available.

For the purpose of this inspection, these phases are site 1.

All room and area designations used in this report are depicted on sampling maps found in Appendix A.

XRF SAMPLE RESULTS TABLE

The results of all samples analyzed are listed in the table at the end of this section. The following is a description of the column headings:

Site	Each school is divided into sites based on their unique construction characteristics. Each site has a unique date of construction or major renovation.
Sample #	Each sample taken was given a unique number to identify the type and location of the sample. The sampling date is an integral part of the sample number.
Analysis	This defines the type of analysis which can be categorized into two types: 1) XRF: This is an on-site analysis using a hand held Niton XL® X-ray Fluorescence Spectrum Analyzer; 2) Bulk or Chip: This is a bulk sample where paint is removed from the substrate and sent to a laboratory for analysis;
Floor	This is the level of the building in which the area tested was found, example, 1 (first floor), 0 (basement), etc.

Area	This further defines the specific functional space inspected such as a classroom, exterior, playground, gym, kitchen, etc.
Room #	This is typically the actual number on the room as identified at the building.
Component	Building "components" included walls, ceilings, floors, moldings, window and door components, door surfaces, and miscellaneous features such as shelves or bookcases.
Feature	Identifies more detailed information of the component.
Condition	This describes condition of the surface, whether it is intact, cracked, peeling, or chalking.
Substrate	This refers to the material the building component is made of (wood, concrete, drywall, metal, etc.).
Result	This is the analysis results for lead. Less than 1.0 mg/cm ² or less than 0.5% by weight is considered to be non-lead and these building components are below the action levels of EPA and HUD. (All results are in mg/cm ² except where noted.)

The table of results is designed for quick information on lead concentrations of tested building components. Generally, all repetitions of a test combination within a given room or area, may be assumed to contain similar concentrations of lead to that of the tested sample. For instance, the lead concentration of a tested wooden window sash was found to be above the action level of 1.0 mg/cm² in a given classroom. The classroom has five windows, all of wood, the same color and appearing to be of the same era. It can be assumed that the remaining four wooden window sashes each contain lead above the action limit.

Other columns identify the component and the component feature tested, condition of the component, type of substrate and the result of the analytical test.

As an example, the following illustration shows that the wooden door jamb in Room 123, first floor in the 1923 building section was in good, solid condition, and had an XRF test result of 0.3 mg/cm², which is below the action level.

Illustration Only

Site	Sample #	Date	Analysis	Floor	Area	Room #	Component	Feature	Condition	Substrate	Results
1923 Bldg.	52		XRF	1	Room	123	Door	Jamb	Solid	Wood	0.3

In a similar manner, the table shows that the plaster walls in room 23, on the second floor has peeling paint with more than 1.0 mg/cm² (shaded).

ILLUSTRATION ONLY

Site	Sample #	Date	Analysis	Floor	Area	Room #	Component	Feature	Condition	Substrate	Results
1910 Bldg.	16		XRF	2	Room	23	Door	Jamb	Peeling	Wood	0.25
1910 Bldg.	17		XRF	2	Room	23	Wall	Wall	Peeling	Plaster	1.2
1910 Bldg.	18		XRF	2	Room	23	Ceiling	Peeling	Plaster		0.25
1910 Bldg.	19		XRF	2	Room	23	Wall	Baseboard	Peeling	Wood	0.002

APPLICABLE REGULATIONS


When building components test above 1.0 mg/cm² of lead by XRF or 0.5% lead by weight from laboratory analysis all employees and contractors who will be working with these components in a construction related activity must be notified. The requirements of OSHA 1926.62, Lead in Construction are enforceable. This regulation defines construction work as "work for construction, alteration and/or repair, including painting and decorating." This regulation further defines monitoring requirements to minimize employee exposure to lead during construction activities.

When work is performed on external painted building structures (i.e. flashing, fire escapes, playground equipment, handrails, etc.), regulations of the Minnesota Pollution Control Agency (MPCA) may also be applicable. For removal of lead based paint from steel structures, MN Rules 7025.0200 - 7025.0380 apply to steel materials on the exterior of a building, or on the property when levels exceed 0.5 mg/cm² based on the average of three XRF spectrum results of the sample tested, or 5,000 ppm by laboratory analysis. If it is other than a steel surface, then MPCA regulates the painted surfaces under MN Rules 7025.010 - 7025.0080, when surfaces are to be disturbed using abrasive blasting methods.

Please contact MEC directly if you have questions about any portion of this report or the lead-based paint inspection itself.


APPENDIX A

XRF TESTING DATA WITH LOCATION MAPS

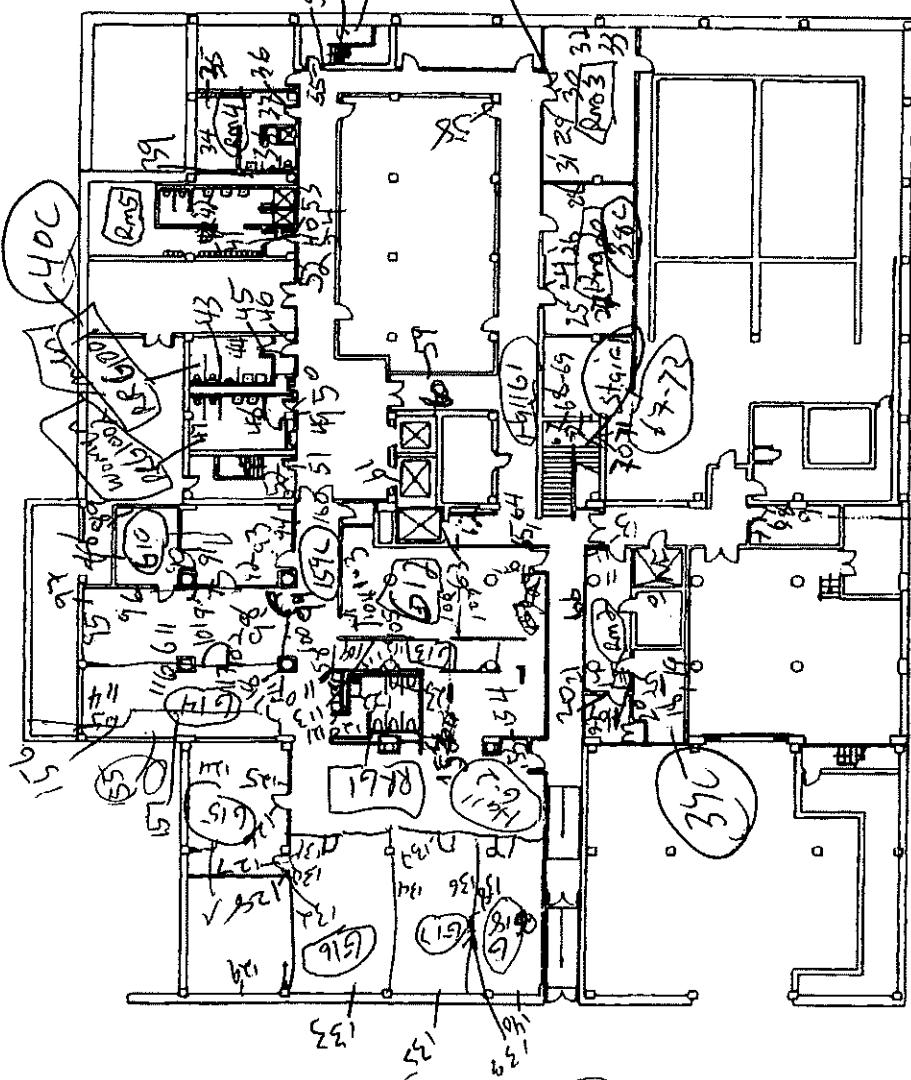

GROUND FLOOR PLAN


INDEPENDENT SCHOOL DISTRICT #625
10 COLBORNE STREET
ST PAUL, MINNESOTA 55102

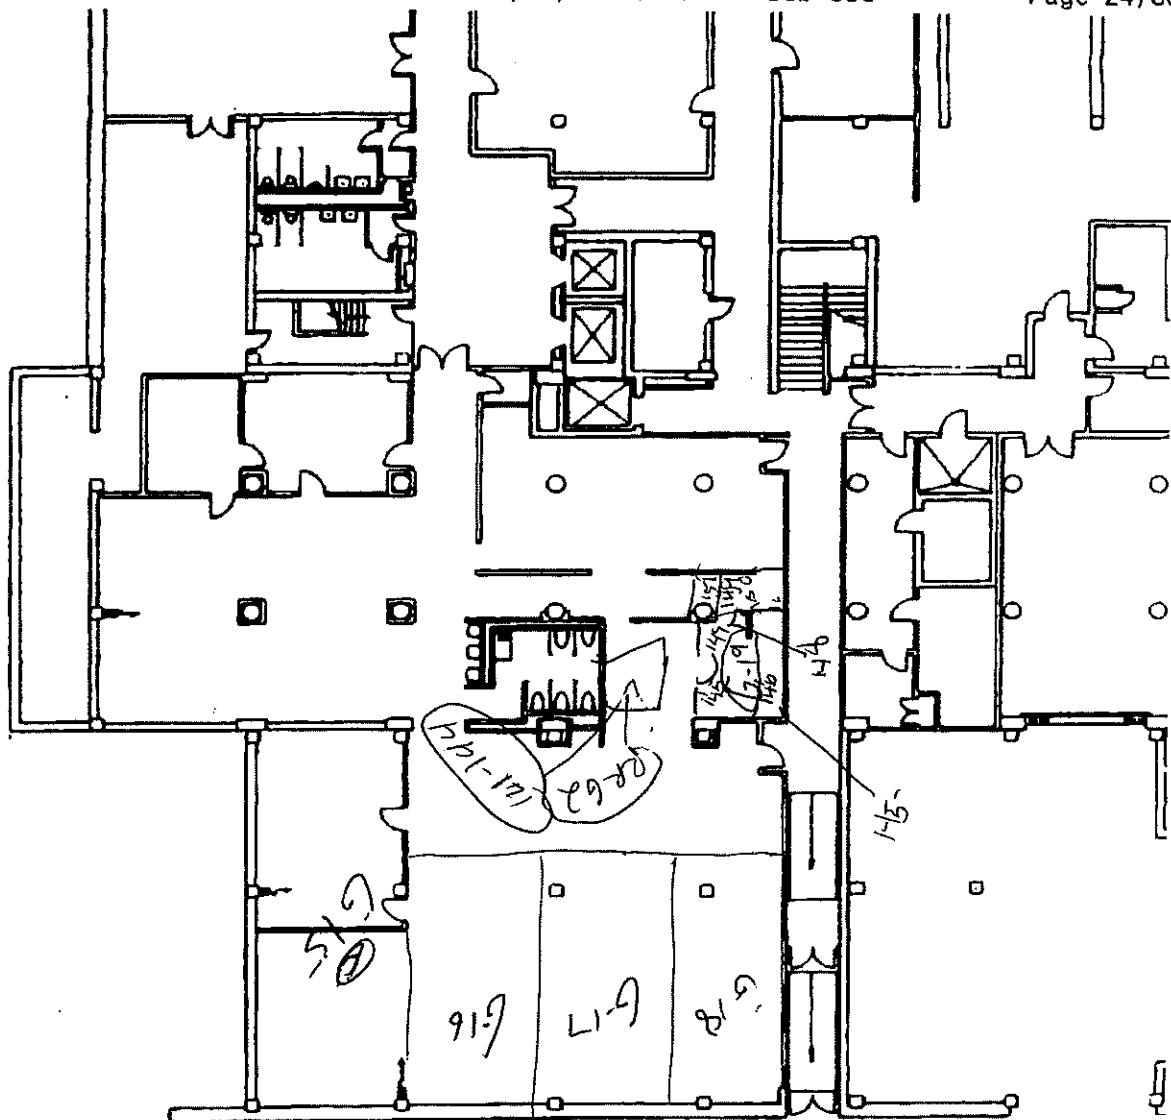

INDEPENDENT SCHOOL DISTRICT #625
300 COLBORNE STREET
ST. PAUL, MINNESOTA 55102




FIRST FLOOR PLAN




988 Job 15:33 26/09/90

Printed by: HRIVNE TSEWDIM 6126895209

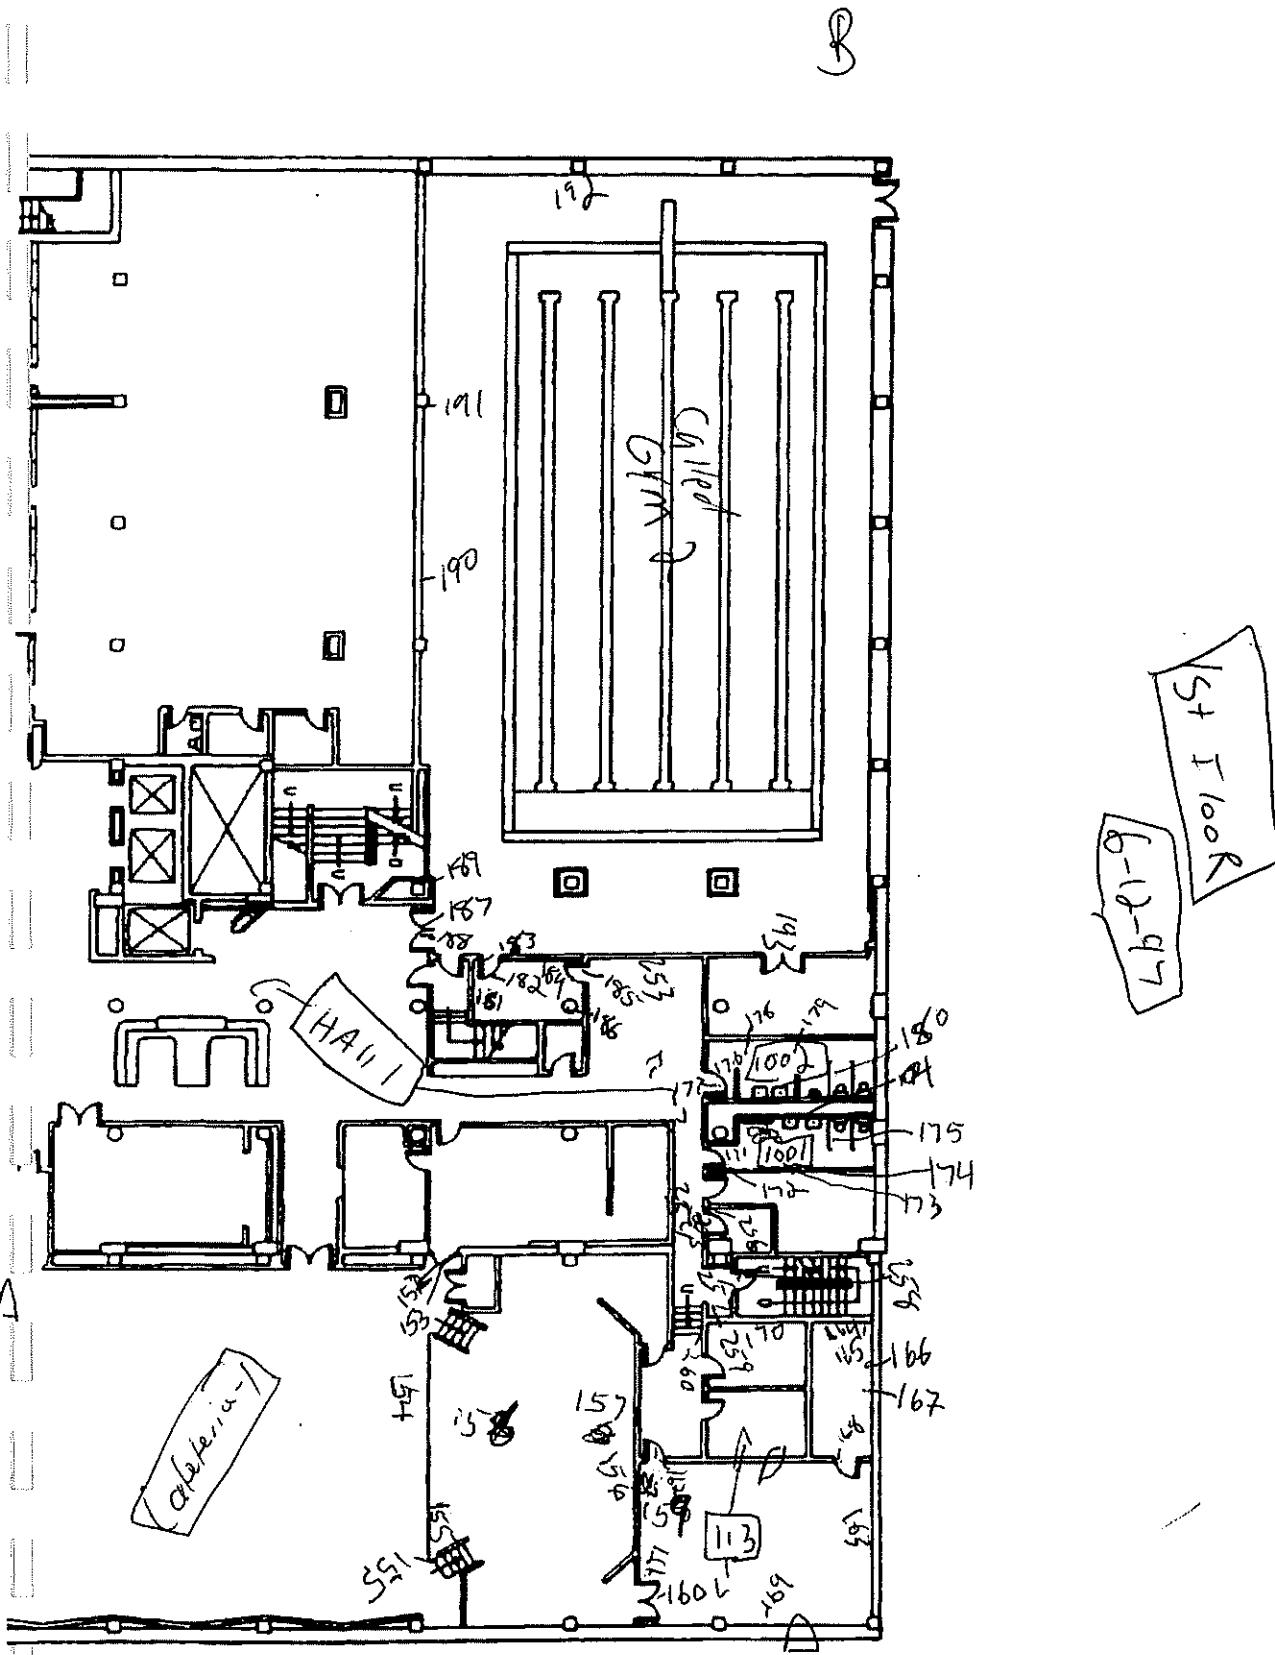


FIRST FLOOR PLAN

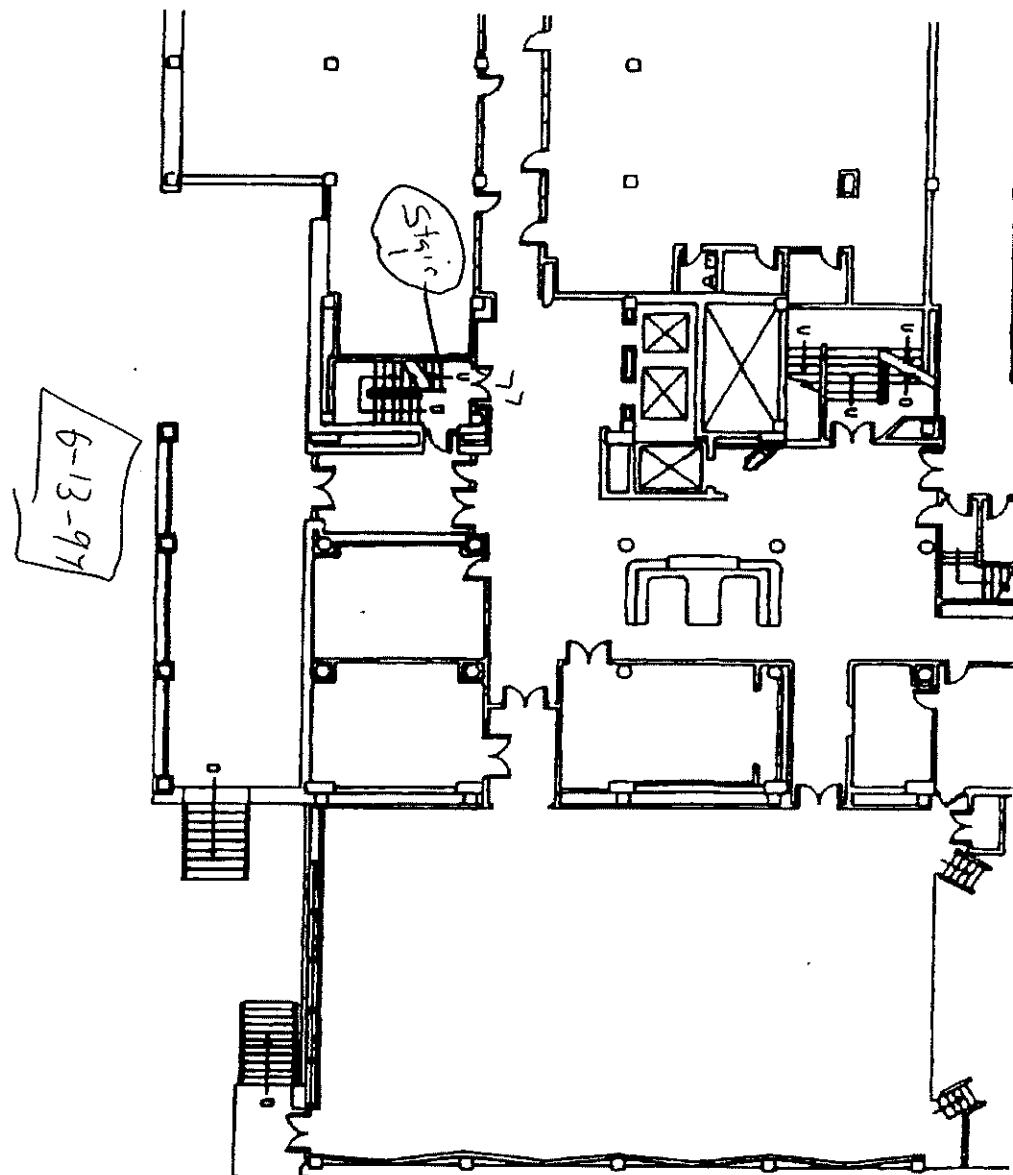

INDEPENDENT SCHOOL DISTRICT #625
360 COLBORNE STREET
ST. PAUL, MINNESOTA 55102

SATURN SCHOOL
65 E. KELLOGG BLVD.
ST. PAUL, MN 55101

1

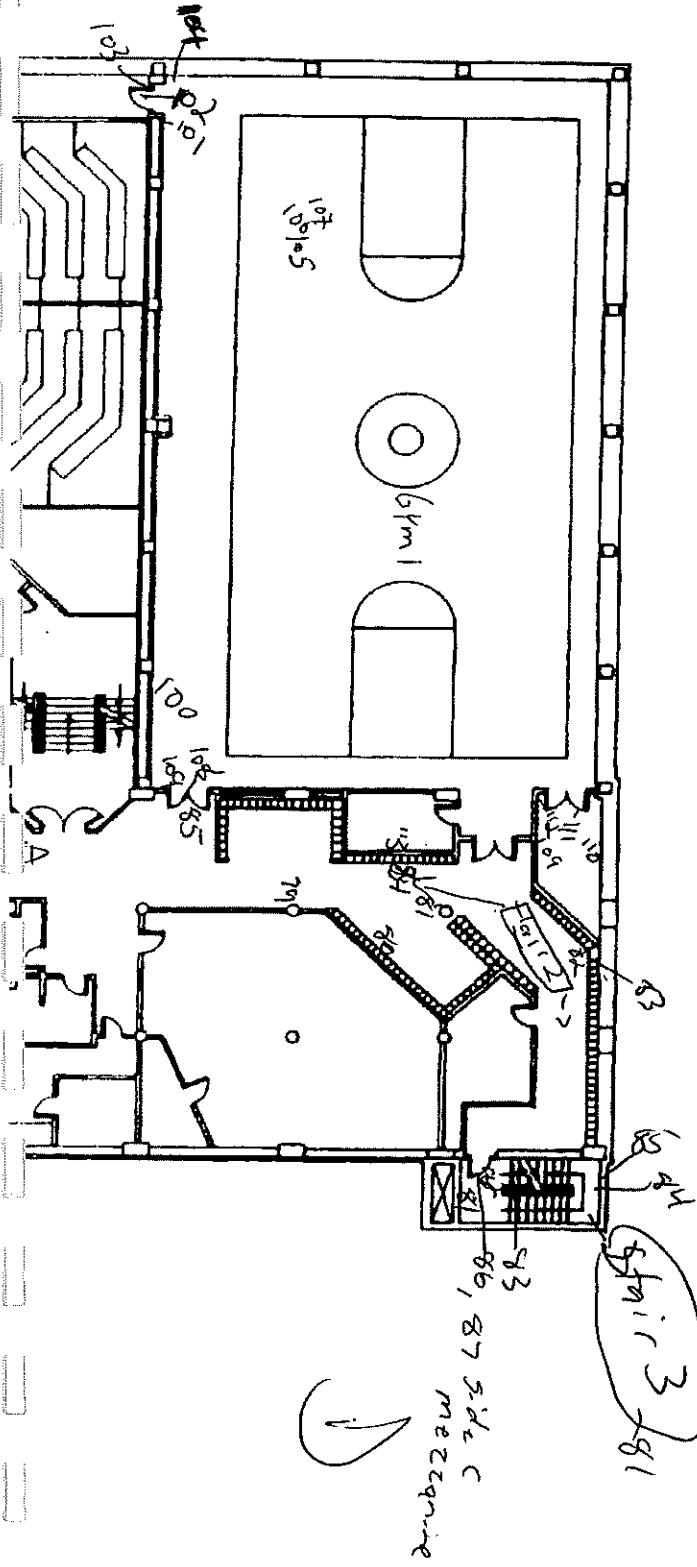

1

100%
20%

٦١-٩


3-97

15941

$$t_6 - t_1 - 9$$


4

1

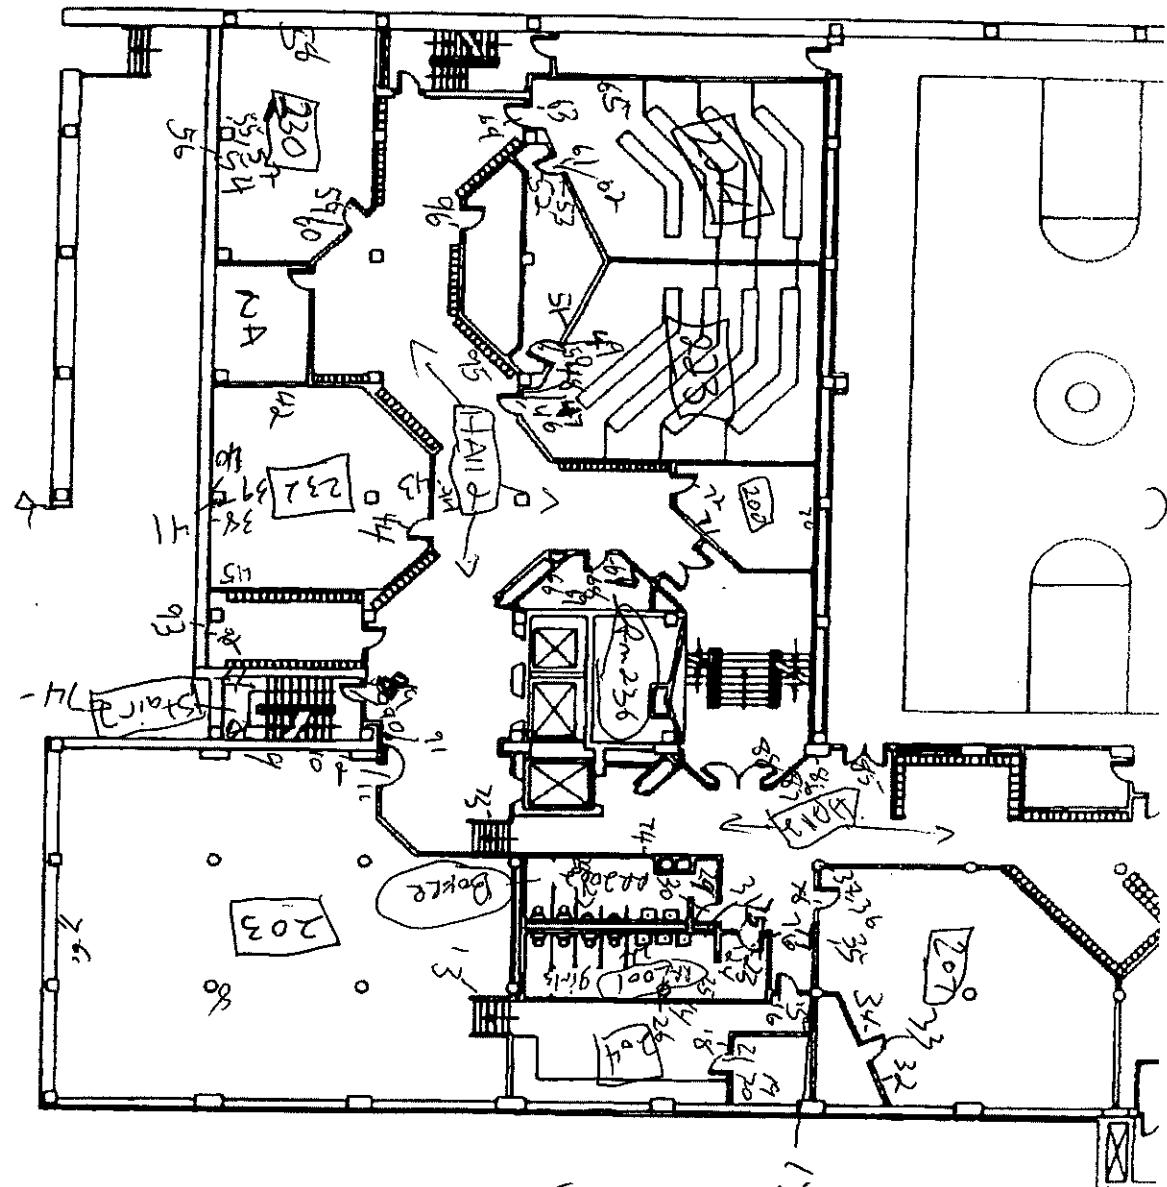

SECOND FLOOR PLAN

66-11-9

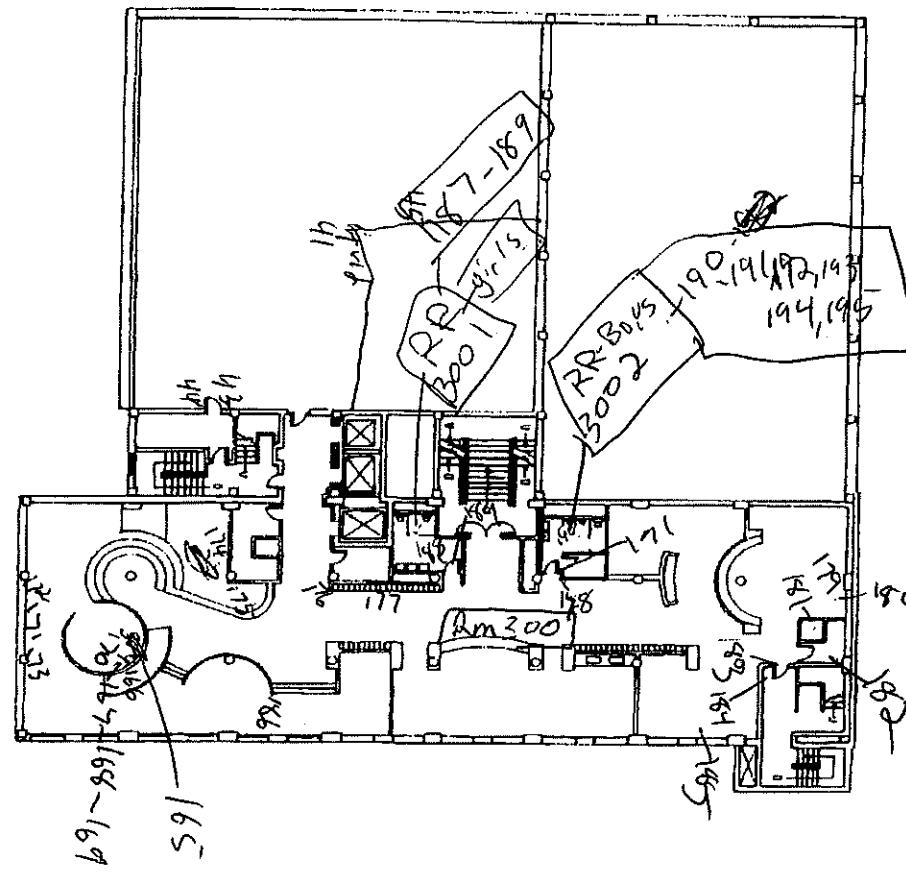


HRC FOR PAX

INDEPENDENT SCHOOL DISTRICT #625
360 COLBORNE STREET
ST. PAUL, MINNESOTA 55102

RIVERFRONT - SATURN SCHOOL
65 E. KELLOGG BLVD.
ST. PAUL, MN 55101

1991

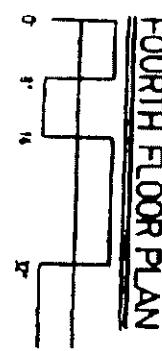

06/09/97 Job 887

Sent by: MRIVNE TSEWDMIN 6126895209


Page 13/24

A

16-11-97

B

6-11-97

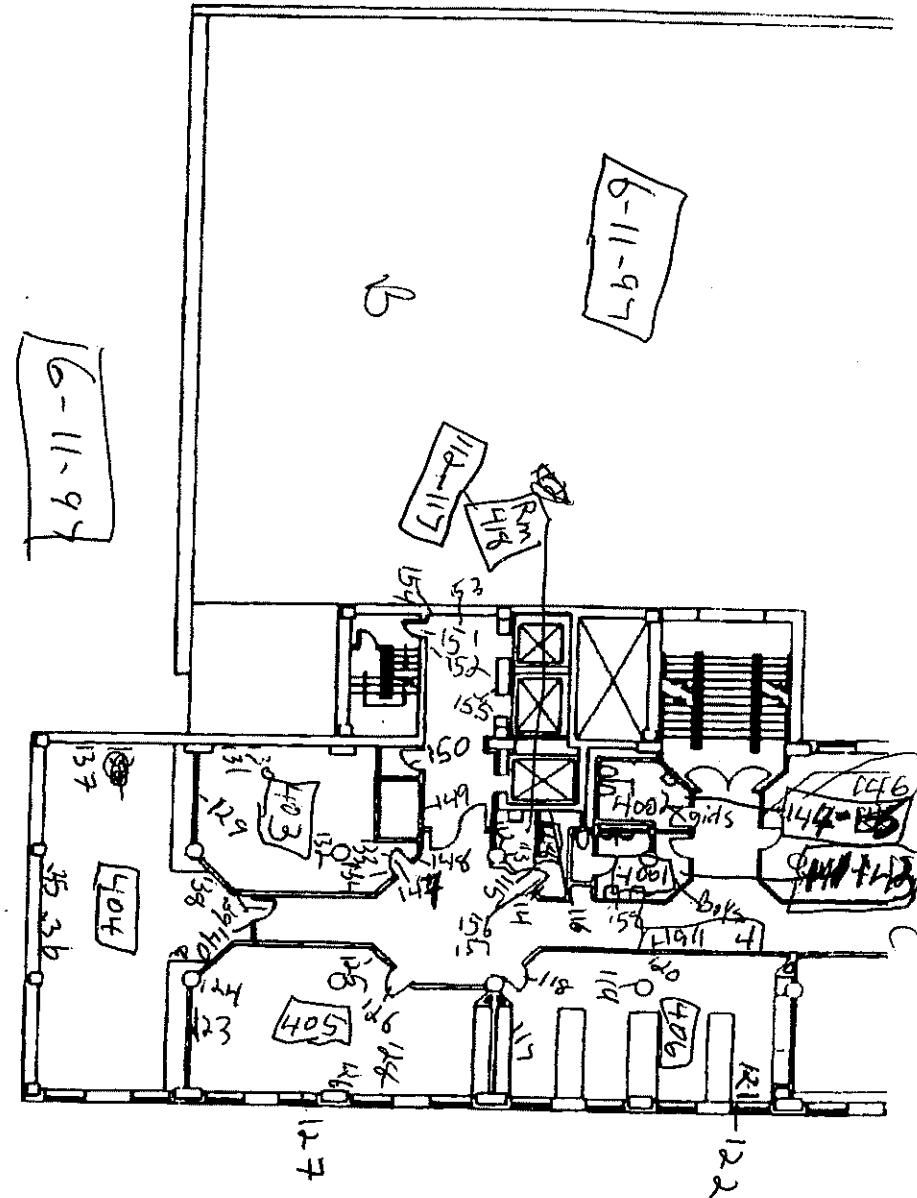

C

little Peter

tb-11-9


6-11-97


1

93 93


1

4

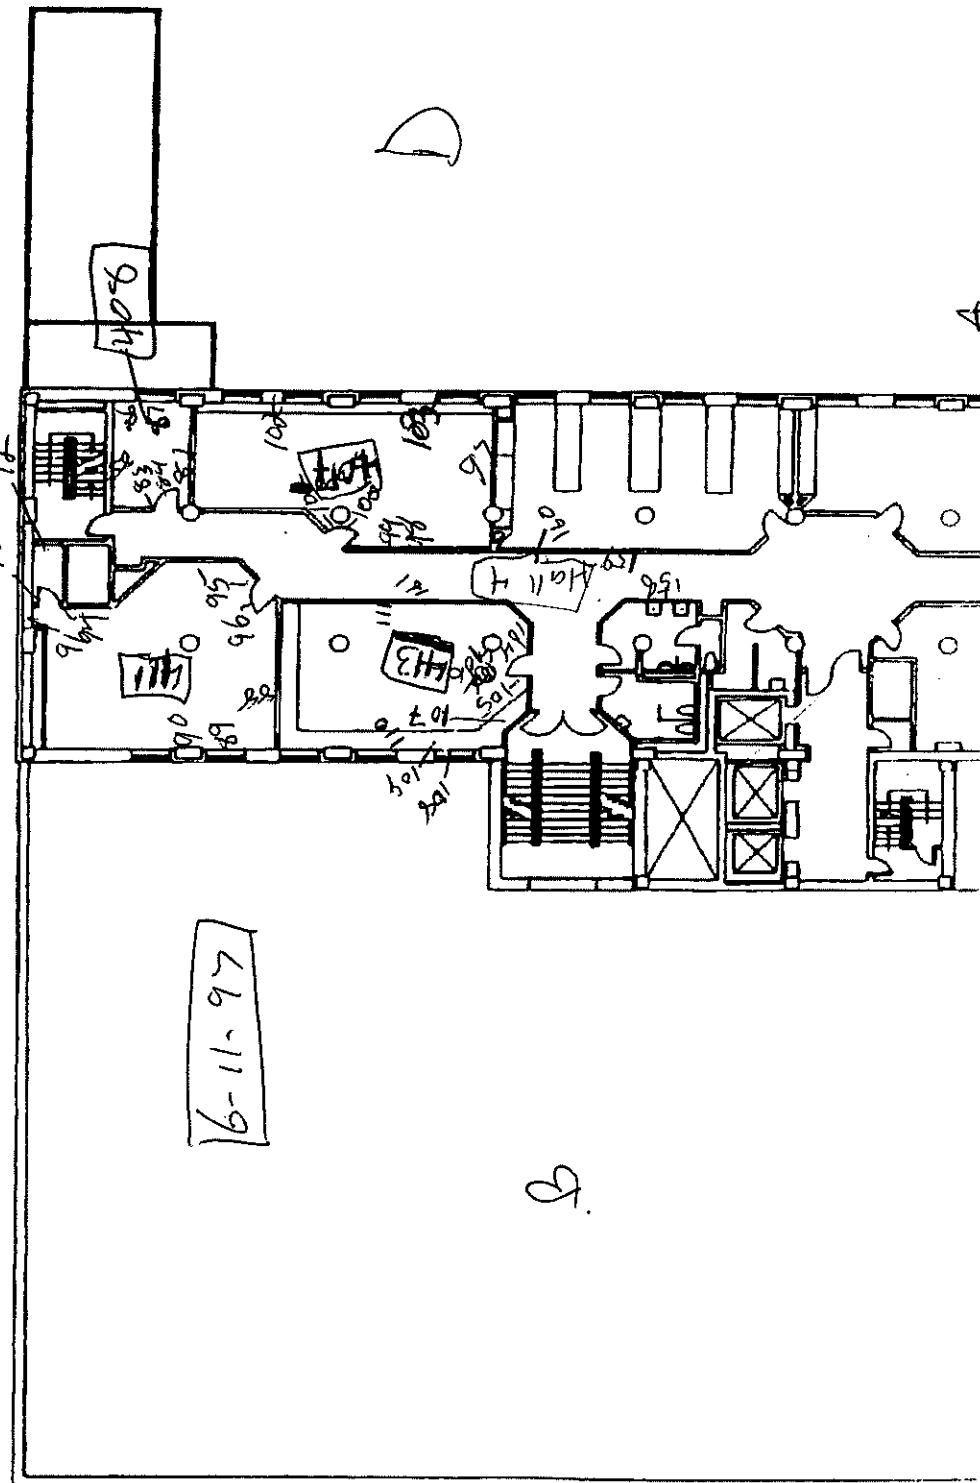

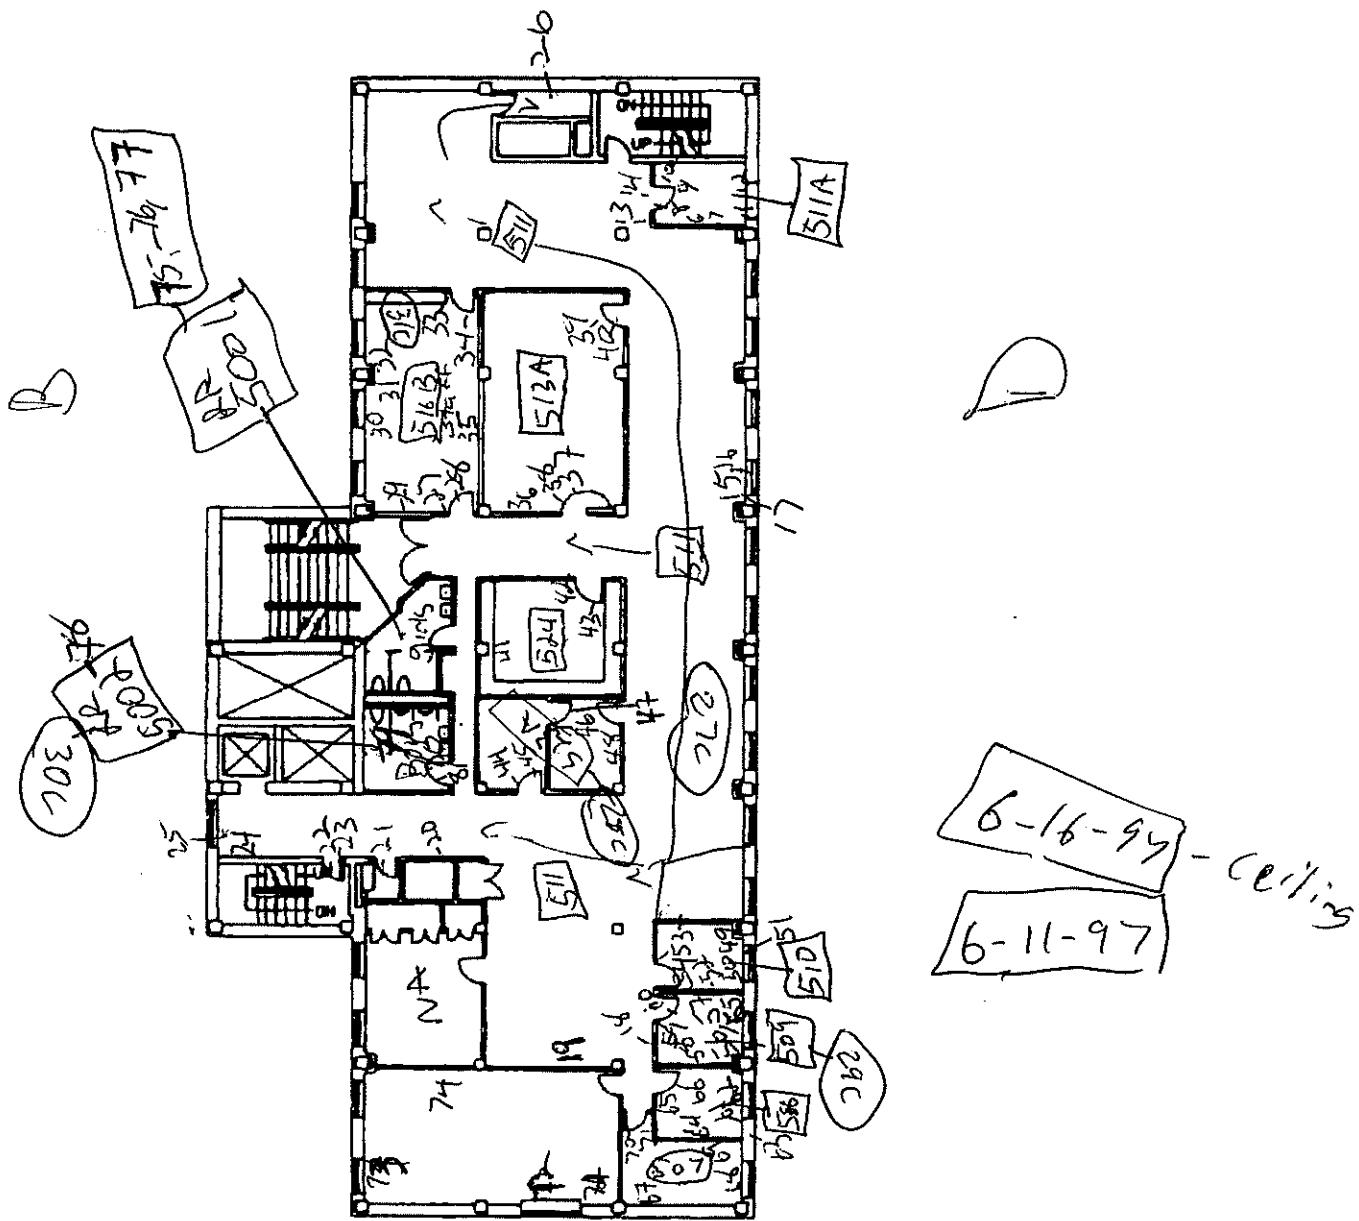


FIFTH FLOOR PLAN

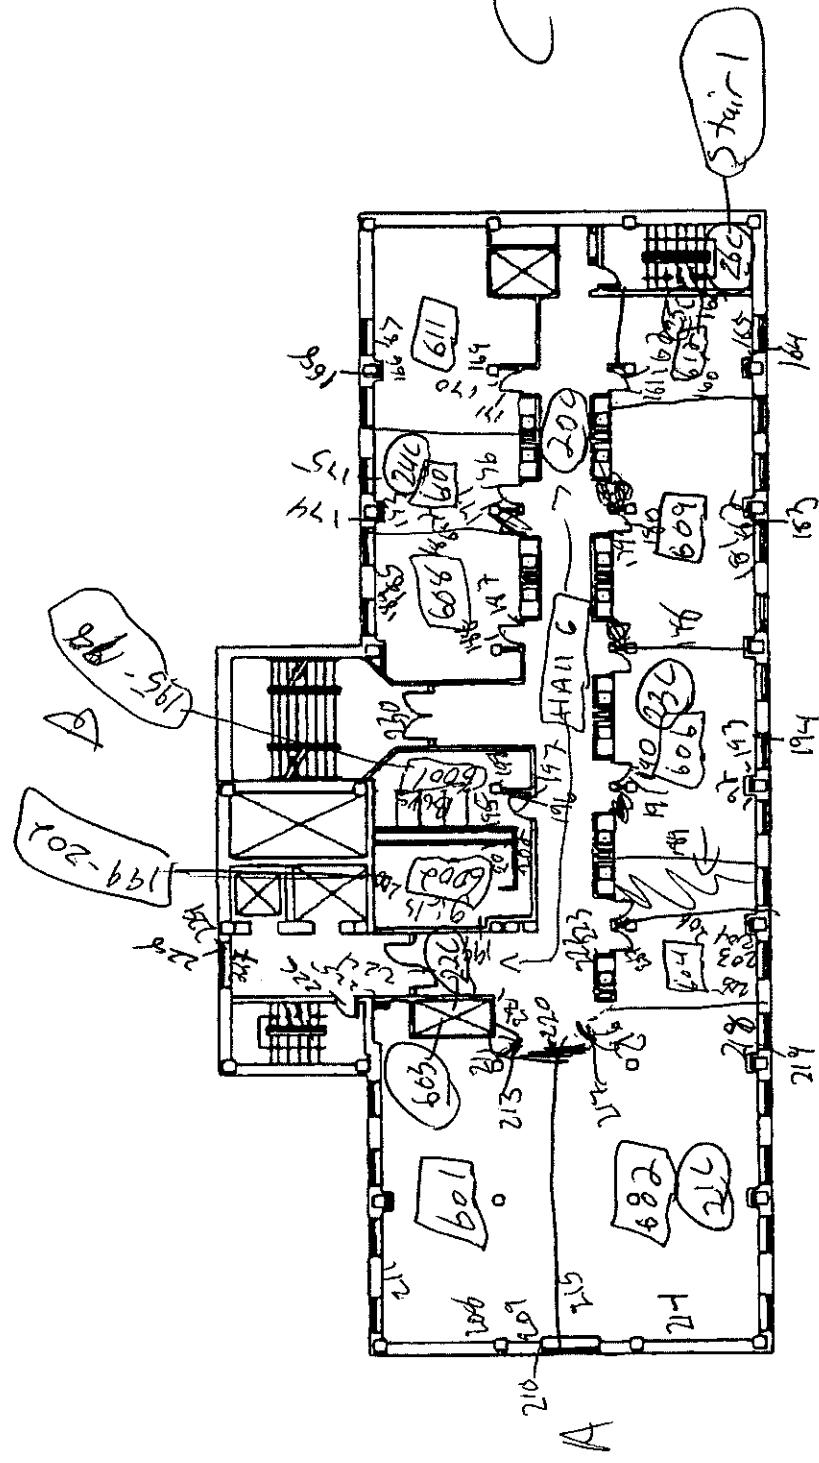

SIXTH FLOOR PLAN


sent by: MRIVNE TSEWDMN 6126895209

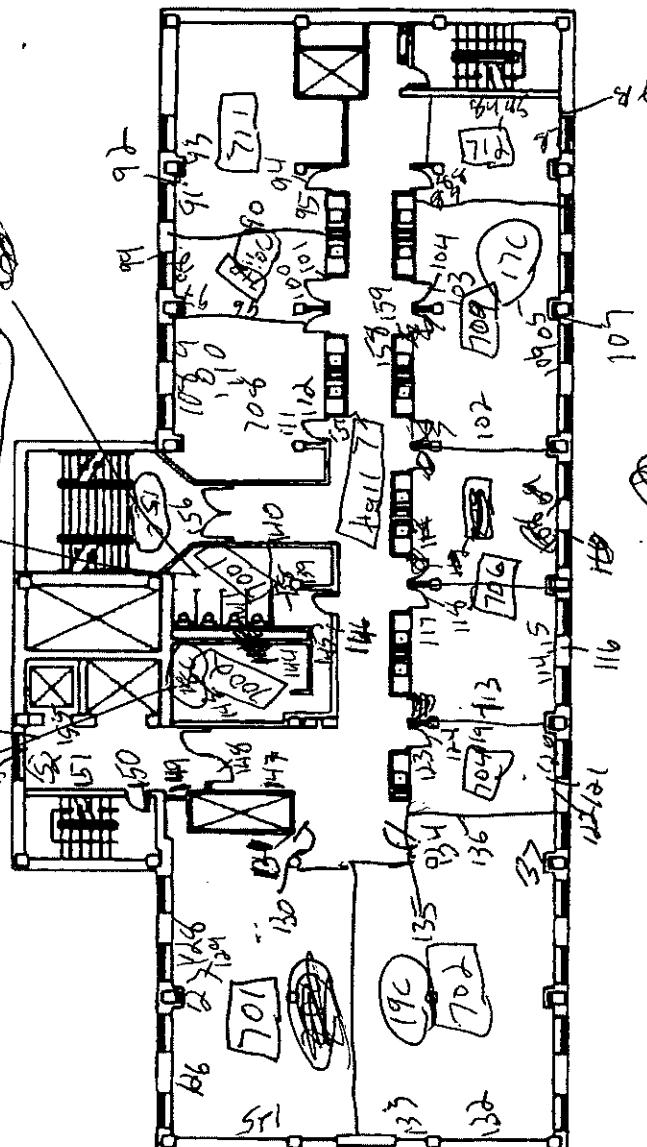

6-16-97


6-10-97

SEVENTH FLOOR PLAN




RIVERFRONT - SATURN SCHOOL
65 E. KELLOGG BLVD

INDEPENDENT SCHOOL DISTRICT • 625
360 COLBORNE STREET

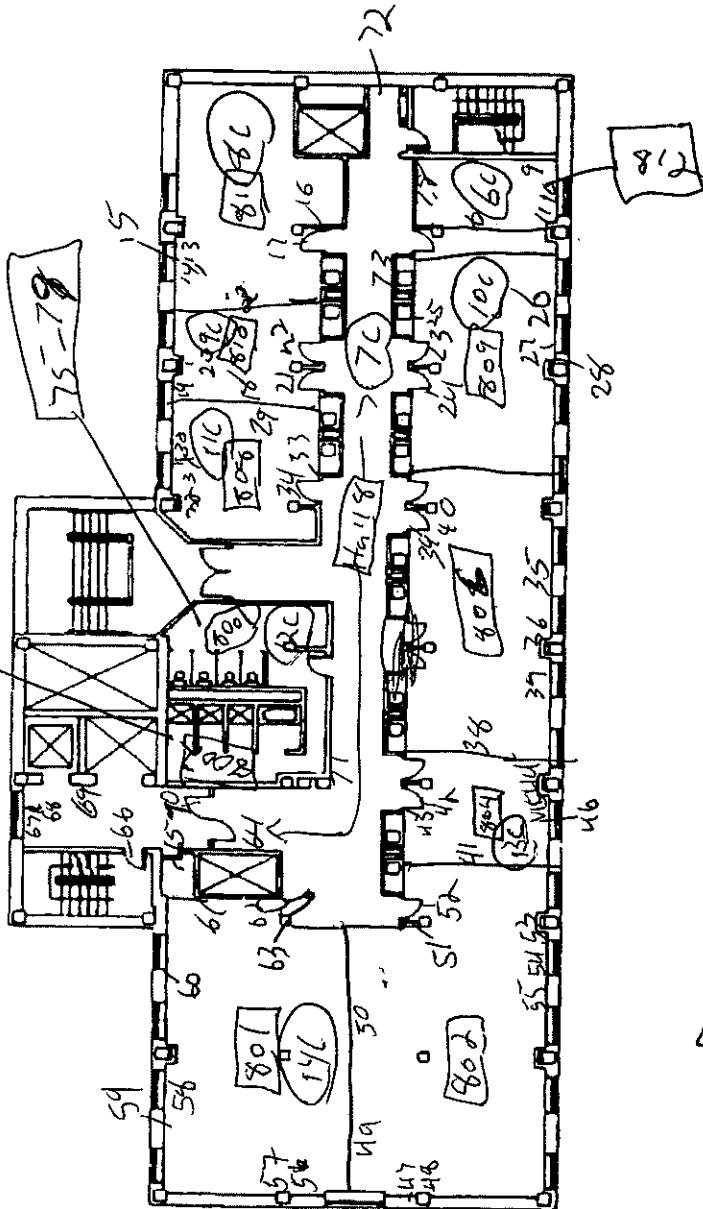


EIGHTH FLOOR PLAN



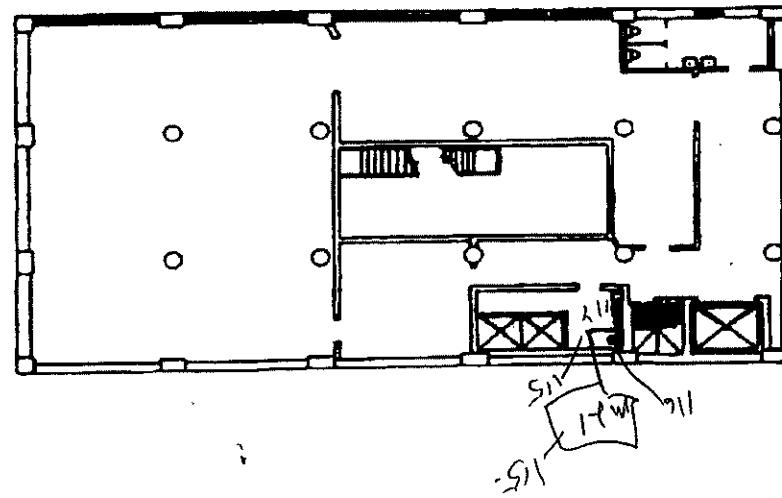

MEZZANINE

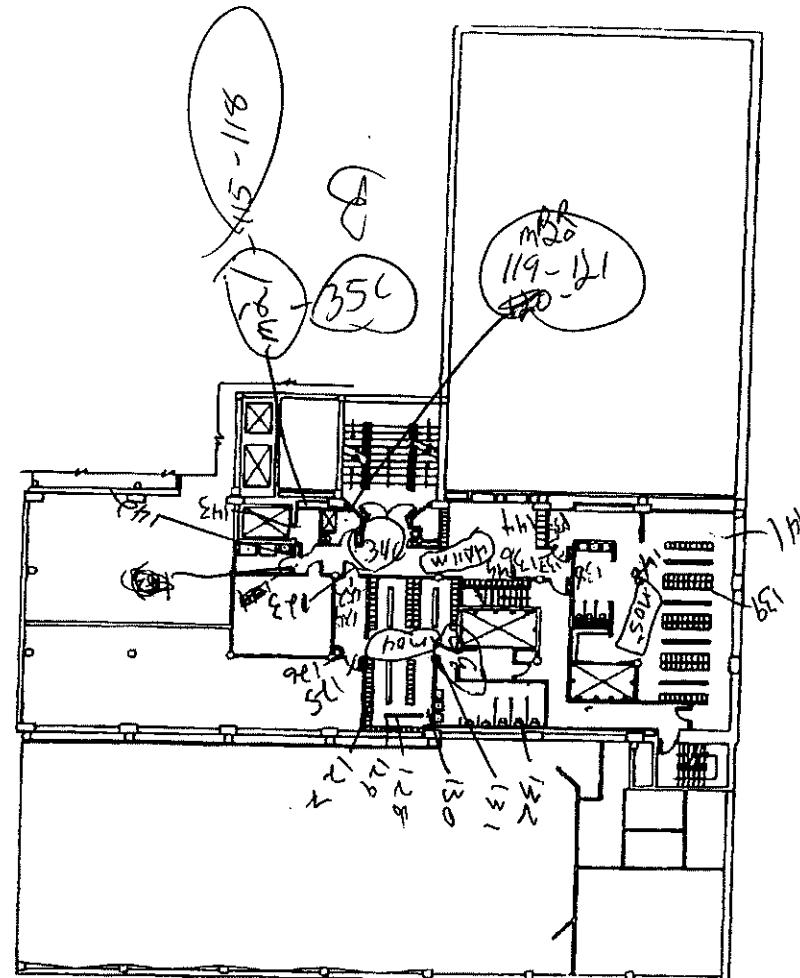

MEZZANINE PLAN

INDEPENDENT SCHOOL DISTRICT #625
360 COLBORNE STREET
ST. PAUL, MINNESOTA 55102

RIVERFRONT - SATURN SCHOOL
65 E. KELLOGG BLVD.
ST. PAUL, MN 55101

Saint Paul Public Schools
 River Front Educational Center
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
1	River Front Educational Center											
2												
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
4	1890 & 1959 Bldgs.	146	XRF	6/12/97	1	Cafeteria	1	Door	Door	Solid	Metal	0.01
5	1890 & 1959 Bldgs.	147	XRF	6/12/97	1	Cafeteria	1	Door	Casing	Solid	Metal	0.04
6	1890 & 1959 Bldgs.	148	XRF	6/12/97	1	Cafeteria	1	Door	Casing	Solid	Concrete	0.02
7	1890 & 1959 Bldgs.	149	XRF	6/12/97	1	Cafeteria	1	Door	Casing	Solid	Drywall	0
8	1890 & 1959 Bldgs.	150	XRF	6/12/97	1	Cafeteria	1	Door	Casing	Solid	Metal	0.02
9	1890 & 1959 Bldgs.	151	XRF	6/12/97	1	Cafeteria	1	Door	Door	Solid	Wood	0
10	1890 & 1959 Bldgs.	152	XRF	6/12/97	1	Cafeteria	1	Door	Casing	Peeling	Wood	0.01
11	1890 & 1959 Bldgs.	153	XRF	6/12/97	1	Cafeteria	1	Door	Door	Peeling	Wood	0.03
12	1890 & 1959 Bldgs.	154	XRF	6/12/97	1	Cafeteria	1	Wall	Wall	Solid	Plaster	0.02
13	1890 & 1959 Bldgs.	155	XRF	6/12/97	1	Cafeteria	1	Stairs	Hand rail	Solid	Metal	0
14	1890 & 1959 Bldgs.	156	XRF	6/12/97	1	Cafeteria	1	Wall	Midle Wall	Solid	Plaster	0.03
15	1890 & 1959 Bldgs.	157	XRF	6/12/97	1	Cafeteria	1	Wall	Midle Wall	Solid	Concrete	0.08
16	1890 & 1959 Bldgs.	158	XRF	6/12/97	1	Cafeteria	1	Floor		Solid	Wood	0
17	1890 & 1959 Bldgs.	203	XRF	6/12/97	1	Classroom	132	Door	Door	Solid	Wood	0
18	1890 & 1959 Bldgs.	204	XRF	6/12/97	1	Classroom	132	Door	Casing	Solid	Metal	0.03
19	1890 & 1959 Bldgs.	205	XRF	6/12/97	1	Classroom	132	Wall	Midle Wall	Solid	Drywall	0.06
20	1890 & 1959 Bldgs.	206	XRF	6/12/97	1	Classroom	132	Door	Door	Solid	Wood	0
21	1890 & 1959 Bldgs.	207	XRF	6/12/97	1	Classroom	132	Door	Casing	Solid	Metal	0
22	1890 & 1959 Bldgs.	208	XRF	6/12/97	1	Classroom	132	Wall	Midle Wall	Solid	Concrete	0
23	1890 & 1959 Bldgs.	209	XRF	6/12/97	1	Classroom	133	Wall	Midle Wall	Solid	Drywall	0
24	1890 & 1959 Bldgs.	210	XRF	6/12/97	1	Classroom	133	Door	Door	Solid	Wood	0
25	1890 & 1959 Bldgs.	211	XRF	6/12/97	1	Classroom	133	Door	Casing	Solid	Metal	0
26	1890 & 1959 Bldgs.	212	XRF	6/12/97	1	Classroom	133	Door	Door	Solid	Wood	0
27	1890 & 1959 Bldgs.	213	XRF	6/12/97	1	Classroom	133	Window	Casing	Solid	Metal	0
28	1890 & 1959 Bldgs.	214	XRF	6/12/97	1	Classroom	133		Radiator	Solid	Metal	0
29	1890 & 1959 Bldgs.	225	XRF	6/12/97	1	Classroom	134	Window	Casing	Solid	Metal	0.01
30	1890 & 1959 Bldgs.	226	XRF	6/12/97	1	Classroom	134	Door	Door	Solid	Wood	0
31	1890 & 1959 Bldgs.	227	XRF	6/12/97	1	Classroom	134	Wall	Midle Wall	Solid	Plaster	0
32	1890 & 1959 Bldgs.	228	XRF	6/12/97	1	Classroom	134	Wall	Midle Wall	Solid	Drywall	0.08
33	1890 & 1959 Bldgs.	229	XRF	6/12/97	1	Classroom	134	Wall	Midle Wall	Solid	Drywall	0
34	1890 & 1959 Bldgs.	230	XRF	6/12/97	1	Classroom	134	Door	Door	Solid	Wood	0
35	1890 & 1959 Bldgs.	231	XRF	6/12/97	1	Classroom	134	Door	Casing	Solid	Metal	0
36	1890 & 1959 Bldgs.	232	XRF	6/12/97	1	Classroom	134	Wall	Midle Wall	Solid	Concrete	0.17
37	1890 & 1959 Bldgs.	233	XRF	6/12/97	1	Classroom	134	Door	Door	Solid	Wood	0
38	1890 & 1959 Bldgs.	215	XRF	6/12/97	1	Classroom	135	Wall	Midle Wall	Solid	Drywall	0
39	1890 & 1959 Bldgs.	216	XRF	6/12/97	1	Classroom	135	Wall	Midle Wall	Solid	Drywall	0.01
40	1890 & 1959 Bldgs.	217	XRF	6/12/97	1	Classroom	135	Door	Door	Solid	Wood	0
41	1890 & 1959 Bldgs.	218	XRF	6/12/97	1	Classroom	135	Door	Door	Solid	Wood	0
42	1890 & 1959 Bldgs.	219	XRF	6/12/97	1	Classroom	135	Door	Casing	Solid	Metal	0
43	1890 & 1959 Bldgs.	220	XRF	6/12/97	1	Classroom	135	Door	Door	Solid	Metal	0.02
44	1890 & 1959 Bldgs.	221	XRF	6/12/97	1	Classroom	135	Door	Casing	Solid	Metal	0.02
45	1890 & 1959 Bldgs.	237	XRF	6/12/97	1	Classroom	136	Door	Door	Solid	Wood	0
46	1890 & 1959 Bldgs.	238	XRF	6/12/97	1	Classroom	136	Door	Casing	Solid	Metal	0
47	1890 & 1959 Bldgs.	239	XRF	6/12/97	1	Classroom	136	Wall	Midle Wall	Solid	Concrete	0
48	1890 & 1959 Bldgs.	240	XRF	6/12/97	1	Classroom	136	Wall	Wall	Solid	Metal	0
49	1890 & 1959 Bldgs.	241	XRF	6/12/97	1	Classroom	136	Wall	Midle Wall	Solid	Concrete	0
50	1890 & 1959 Bldgs.	242	XRF	6/12/97	1	Classroom	136	Wall	Wall	Solid	Drywall	0
51	1890 & 1959 Bldgs.	243	XRF	6/12/97	1	Classroom	136	Door	Door	Solid	Wood	0
52	1890 & 1959 Bldgs.	244	XRF	6/12/97	1	Classroom	136	Door	Casing	Solid	Metal	0
53	1890 & 1959 Bldgs.	70	XRF	6/12/97	2	Classroom	200	Wall	Wall	Solid	Plaster	0
54	1890 & 1959 Bldgs.	71	XRF	6/12/97	2	Classroom	200	Window	Casing	Solid	Metal	0
55	1890 & 1959 Bldgs.	72	XRF	6/12/97	2	Classroom	200	Door	Door	Solid	Wood	0
56	1890 & 1959 Bldgs.	6	XRF	6/12/97	2	Classroom	203	Wall	Wall	Solid	Plaster	0.04
57	1890 & 1959 Bldgs.	7	XRF	6/12/97	2	Classroom	203		Radiator	Solid	Metal	0.05
58	1890 & 1959 Bldgs.	8	XRF	6/12/97	2	Classroom	203	Wall	Column	Solid	Concrete	0
59	1890 & 1959 Bldgs.	9	XRF	6/12/97	2	Classroom	203	Wall	Midle Wall	Solid	Drywall	0
60	1890 & 1959 Bldgs.	10	XRF	6/12/97	2	Classroom	203	Wall	Midle Wall	Solid	Concrete	0

Saint Paul Public Schools
 River Front Educational Center
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
61	1890 & 1959 Bldgs.	11	XRF	6/12/97	2	Classroom	203	Door	Casing	Solid	Metal	0
62	1890 & 1959 Bldgs.	12	XRF	6/12/97	2	Classroom	203	Door	Door	Solid	Wood	0
63	1890 & 1959 Bldgs.	13	XRF	6/12/97	2	Classroom	203	Stairs	Hand rail	Solid	Metal	0
64	1890 & 1959 Bldgs.	32	XRF	6/12/97	2	Classroom	207	Wall	Midle Wall	Solid	Drywall	0
65	1890 & 1959 Bldgs.	33	XRF	6/12/97	2	Classroom	207	Door	Door	Solid	Wood	0
66	1890 & 1959 Bldgs.	34	XRF	6/12/97	2	Classroom	207	Door	Casing	Solid	Metal	0.07
67	1890 & 1959 Bldgs.	35	XRF	6/12/97	2	Classroom	207	Window	Casing	Solid	Metal	0.01
68	1890 & 1959 Bldgs.	36	XRF	6/12/97	2	Classroom	207	Door	Door	Solid	Wood	0
69	1890 & 1959 Bldgs.	37	XRF	6/12/97	2	Classroom	207	Wall	Column	Solid	Concrete	0.06
70	1890 & 1959 Bldgs.	46	XRF	6/12/97	2	Classroom	223	Door	Casing	Solid	Metal	0.03
71	1890 & 1959 Bldgs.	47	XRF	6/12/97	2	Classroom	223	Door	Door	Solid	Wood	0
72	1890 & 1959 Bldgs.	48	XRF	6/12/97	2	Classroom	223	Wall	Midle Wall	Solid	Drywall	0
73	1890 & 1959 Bldgs.	49	XRF	6/12/97	2	Classroom	223	Door	Casing	Solid	Metal	0.11
74	1890 & 1959 Bldgs.	50	XRF	6/12/97	2	Classroom	223	Door	Door	Solid	Wood	0
75	1890 & 1959 Bldgs.	51	XRF	6/12/97	2	Classroom	223	Door	Door	Solid	Drywall	0
76	1890 & 1959 Bldgs.	52	XRF	6/12/97	2	Classroom	223	Door	Door	Solid	Wood	0
77	1890 & 1959 Bldgs.	53	XRF	6/12/97	2	Classroom	223	Door	Casing	Solid	Metal	0.04
78	1890 & 1959 Bldgs.	61	XRF	6/12/97	2	Classroom	224	Door	Casing	Solid	Metal	0
79	1890 & 1959 Bldgs.	62	XRF	6/12/97	2	Classroom	224	Door	Door	Solid	Wood	0
80	1890 & 1959 Bldgs.	63	XRF	6/12/97	2	Classroom	224	Door	Casing	Solid	Metal	0.02
81	1890 & 1959 Bldgs.	64	XRF	6/12/97	2	Classroom	224	Door	Door	Solid	Wood	0
82	1890 & 1959 Bldgs.	65	XRF	6/12/97	2	Classroom	224	Wall	Midle Wall	Solid	Drywall	0
83	1890 & 1959 Bldgs.	54	XRF	6/12/97	2	Classroom	230		Radiator	Solid	Metal	0.14
84	1890 & 1959 Bldgs.	55	XRF	6/12/97	2	Classroom	230	Window	Header	Solid	Wood	0
85	1890 & 1959 Bldgs.	56	XRF	6/12/97	2	Classroom	230	Wall	Wall	Solid	Concrete	0.06
86	1890 & 1959 Bldgs.	57	XRF	6/12/97	2	Classroom	230	Wall	Wall	Solid	Plaster	0.15
87	1890 & 1959 Bldgs.	58	XRF	6/12/97	2	Classroom	230	Wall	Column	Solid	Drywall	0.1
88	1890 & 1959 Bldgs.	59	XRF	6/12/97	2	Classroom	230	Door	Door	Solid	Wood	0
89	1890 & 1959 Bldgs.	60	XRF	6/12/97	2	Classroom	230	Door	Casing	Solid	Metal	0
90	1890 & 1959 Bldgs.	38	XRF	6/12/97	2	Classroom	232		Radiator	Solid	Metal	0.03
91	1890 & 1959 Bldgs.	39	XRF	6/12/97	2	Classroom	232	Window	Header	Solid	Wood	0
92	1890 & 1959 Bldgs.	40	XRF	6/12/97	2	Classroom	232	Wall	Wall	Solid	Concrete	0
93	1890 & 1959 Bldgs.	41	XRF	6/12/97	2	Classroom	232	Wall	Column	Solid	Plaster	0.06
94	1890 & 1959 Bldgs.	42	XRF	6/12/97	2	Classroom	232	Wall	Midle Wall	Solid	Drywall	0
95	1890 & 1959 Bldgs.	43	XRF	6/12/97	2	Classroom	232	Window	Casing	Solid	Metal	0.02
96	1890 & 1959 Bldgs.	44	XRF	6/12/97	2	Classroom	232	Door	Door	Solid	Wood	0
97	1890 & 1959 Bldgs.	45	XRF	6/12/97	2	Classroom	232	Bookcase	Inside	Solid	Wood	0.87
98	1890 & 1959 Bldgs.	129	XRF	6/11/97	4	Classroom	403	Window	Header	Solid	Drywall	0
99	1890 & 1959 Bldgs.	130	XRF	6/11/97	4	Classroom	403	Window	Header	Solid	Wood	0
100	1890 & 1959 Bldgs.	131	XRF	6/11/97	4	Classroom	403		Radiator	Solid	Metal	0.18
101	1890 & 1959 Bldgs.	132	XRF	6/11/97	4	Classroom	403	Wall	Column	Peeling	Concrete	0.02
102	1890 & 1959 Bldgs.	133	XRF	6/11/97	4	Classroom	403	Door	Door	Peeling	Wood	0
103	1890 & 1959 Bldgs.	134	XRF	6/11/97	4	Classroom	403	Door	Casing	Solid	Metal	0
104	1890 & 1959 Bldgs.	135	XRF	6/11/97	4	Classroom	404	Wall	Wall	Solid	Drywall	0
105	1890 & 1959 Bldgs.	136	XRF	6/11/97	4	Classroom	404		Radiator	Solid	Metal	0.36
106	1890 & 1959 Bldgs.	137	XRF	6/11/97	4	Classroom	404	Window	Header	Solid	Wood	0
107	1890 & 1959 Bldgs.	138	XRF	6/11/97	4	Classroom	404	Wall	Midle Wall	Solid	Drywall	0
108	1890 & 1959 Bldgs.	139	XRF	6/11/97	4	Classroom	404	Door	Door	Solid	Wood	0
109	1890 & 1959 Bldgs.	140	XRF	6/11/97	4	Classroom	404	Door	Casing	Solid	Metal	0
110	1890 & 1959 Bldgs.	123	XRF	6/11/97	4	Classroom	405	Wall	Wall	Solid	Drywall	0
111	1890 & 1959 Bldgs.	124	XRF	6/11/97	4	Classroom	405	Wall	Midle Wall	Solid	Concrete	0.01
112	1890 & 1959 Bldgs.	125	XRF	6/11/97	4	Classroom	405	Window	Casing	Solid	Metal	0.02
113	1890 & 1959 Bldgs.	126	XRF	6/11/97	4	Classroom	405	Door	Door	Solid	Wood	0
114	1890 & 1959 Bldgs.	127	XRF	6/11/97	4	Classroom	405		Radiator	Solid	Metal	0.04
115	1890 & 1959 Bldgs.	128	XRF	6/11/97	4	Classroom	405	Window	Header	Solid	Wood	0
116	1890 & 1959 Bldgs.	117	XRF	6/11/97	4	Classroom	406	Wall	Midle Wall	Solid	Drywall	0
117	1890 & 1959 Bldgs.	118	XRF	6/11/97	4	Classroom	406	Door	Casing	Solid	Metal	0.01
118	1890 & 1959 Bldgs.	119	XRF	6/11/97	4	Classroom	406	Wall	Column	Solid	Concrete	0.18
119	1890 & 1959 Bldgs.	120	XRF	6/11/97	4	Classroom	406	Window	Casing	Solid	Metal	0

Saint Paul Public Schools
 River Front Educational Center
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
120	1890 & 1959 Bldgs.	121	XRF	6/11/97	4	Classroom	406	Radiator	Solid	Metal		0.09
121	1890 & 1959 Bldgs.	122	XRF	6/11/97	4	Classroom	406	Window	Header	Solid	Wood	0
122	1890 & 1959 Bldgs.	97	XRF	6/11/97	4	Classroom	407	Wall	Midle Wall	Solid	Drywall	0.09
123	1890 & 1959 Bldgs.	98	XRF	6/11/97	4	Classroom	407	Wall	Midle Wall	Solid	Drywall	0.01
124	1890 & 1959 Bldgs.	99	XRF	6/11/97	4	Classroom	407	Window	Casing	Solid	Metal	0
125	1890 & 1959 Bldgs.	100	XRF	6/11/97	4	Classroom	407	Door	Door	Solid	Wood	0
126	1890 & 1959 Bldgs.	101	XRF	6/11/97	4	Classroom	407	Door	Casing	Solid	Metal	0.04
127	1890 & 1959 Bldgs.	102	XRF	6/11/97	4	Classroom	407	Window	Header	Solid	Wood	0
128	1890 & 1959 Bldgs.	103	XRF	6/11/97	4	Classroom	407		Radiator	Solid	Metal	0.07
129	1890 & 1959 Bldgs.	88	XRF	6/11/97	4	Classroom	411	Wall	Midle Wall	Solid	Drywall	0
130	1890 & 1959 Bldgs.	89	XRF	6/11/97	4	Classroom	411	Window	Header	Solid	Wood	0
131	1890 & 1959 Bldgs.	90	XRF	6/11/97	4	Classroom	411		Radiator	Solid	Metal	0.07
132	1890 & 1959 Bldgs.	91	XRF	6/11/97	4	Classroom	411	Wall	Midle Wall	Solid	Concrete	0
133	1890 & 1959 Bldgs.	92	XRF	6/11/97	4	Classroom	411	Wall	Midle Wall	Solid	Concrete	0
134	1890 & 1959 Bldgs.	93	XRF	6/11/97	4	Classroom	411	Door	Door	Solid	Wood	0
135	1890 & 1959 Bldgs.	94	XRF	6/11/97	4	Classroom	411	Door	Casing	Solid	Metal	0.07
136	1890 & 1959 Bldgs.	95	XRF	6/11/97	4	Classroom	411	Door	Door	Solid	Wood	0
137	1890 & 1959 Bldgs.	96	XRF	6/11/97	4	Classroom	411	Door	Casing	Solid	Metal	0.01
138	1890 & 1959 Bldgs.	104	XRF	6/11/97	4	Classroom	413	Door	Casing	Solid	Metal	0.01
139	1890 & 1959 Bldgs.	105	XRF	6/11/97	4	Classroom	413	Door	Door	Solid	Wood	0
140	1890 & 1959 Bldgs.	106	XRF	6/11/97	4	Classroom	413	Wall	Column	Solid	Concrete	0.13
141	1890 & 1959 Bldgs.	107	XRF	6/11/97	4	Classroom	413	Wall	Midle Wall	Solid	Drywall	0
142	1890 & 1959 Bldgs.	108	XRF	6/11/97	4	Classroom	413	Door	Header	Solid	Wood	0
143	1890 & 1959 Bldgs.	109	XRF	6/11/97	4	Classroom	413		Radiator	Solid	Metal	0.05
144	1890 & 1959 Bldgs.	110	XRF	6/11/97	4	Classroom	413	Wall	Midle Wall	Solid	Concrete	0
145	1890 & 1959 Bldgs.	111	XRF	6/11/97	4	Classroom	413	Window	Casing	Solid	Metal	0
146	1890 & 1959 Bldgs.	29	XRF	6/16/97	5	Classroom	509	Ceiling		Solid	Plaster	0
147	1890 & 1959 Bldgs.	27	XRF	6/16/97	5	Classroom	511	Ceiling		Solid	Plaster	0
148	1890 & 1959 Bldgs.	27	XRF	6/11/97	5	Classroom	516	Door	Casing	Solid	Metal	0
149	1890 & 1959 Bldgs.	28	XRF	6/11/97	5	Classroom	516	Door	Door	Solid	Wood	0
150	1890 & 1959 Bldgs.	29	XRF	6/11/97	5	Classroom	516	Wall	Midle Wall	Solid	Drywall	0
151	1890 & 1959 Bldgs.	30	XRF	6/11/97	5	Classroom	516	Wall	Midle Wall	Solid	Concrete	0.1
152	1890 & 1959 Bldgs.	31	XRF	6/11/97	5	Classroom	516	Window	Header	Solid	Wood	0
153	1890 & 1959 Bldgs.	32	XRF	6/11/97	5	Classroom	516		Radiator	Solid	Metal	0.06
154	1890 & 1959 Bldgs.	33	XRF	6/11/97	5	Classroom	516	Door	Casing	Solid	Metal	0
155	1890 & 1959 Bldgs.	34	XRF	6/11/97	5	Classroom	516	Door	Door	Solid	Wood	0
156	1890 & 1959 Bldgs.	35	XRF	6/11/97	5	Classroom	516	Wall	Midle Wall	Solid	Drywall	0
157	1890 & 1959 Bldgs.	208	XRF	6/10/97	6	Classroom	601	Wall	Midle Wall	Solid	Concrete	0.11
158	1890 & 1959 Bldgs.	209	XRF	6/10/97	6	Classroom	601	Wall	Midle Wall	Solid	Drywall	0
159	1890 & 1959 Bldgs.	210	XRF	6/10/97	6	Classroom	601		Radiator	Solid	Metal	0.06
160	1890 & 1959 Bldgs.	211	XRF	6/10/97	6	Classroom	601	Window	Header	Solid	Wood	0
161	1890 & 1959 Bldgs.	212	XRF	6/10/97	6	Classroom	601	Door	Casing	Solid	Metal	0.2
162	1890 & 1959 Bldgs.	213	XRF	6/10/97	6	Classroom	601	Door	Door	Solid	Wood	0
163	1890 & 1959 Bldgs.	214	XRF	6/10/97	6	Classroom	602	Wall	Midle Wall	Solid	Concrete	0.14
164	1890 & 1959 Bldgs.	215	XRF	6/10/97	6	Classroom	602	Wall	Wall	Solid	Drywall	0
165	1890 & 1959 Bldgs.	216	XRF	6/10/97	6	Classroom	602	Door	Casing	Solid	Metal	0.16
166	1890 & 1959 Bldgs.	217	XRF	6/10/97	6	Classroom	602	Door	Door	Solid	Wood	0
167	1890 & 1959 Bldgs.	218	XRF	6/10/97	6	Classroom	602	Window	Header	Solid	Wood	0
168	1890 & 1959 Bldgs.	219	XRF	6/10/97	6	Classroom	602		Radiator	Solid	Metal	0.04
169	1890 & 1959 Bldgs.	21	XRF	6/16/97	6	Classroom	602	Ceiling		Solid	Plaster	0
170	1890 & 1959 Bldgs.	22	XRF	6/16/97	6	Classroom	603	Ceiling		Solid	Plaster	0
171	1890 & 1959 Bldgs.	189	XRF	6/10/97	6	Classroom	606	Wall	Wall	Solid	Drywall	0
172	1890 & 1959 Bldgs.	190	XRF	6/10/97	6	Classroom	606	Door	Casing	Solid	Metal	0.24
173	1890 & 1959 Bldgs.	191	XRF	6/10/97	6	Classroom	606	Door	Door	Solid	Wood	0
174	1890 & 1959 Bldgs.	192	XRF	6/10/97	6	Classroom	606	Window	Header	Solid	Wood	0
175	1890 & 1959 Bldgs.	193	XRF	6/10/97	6	Classroom	606		Radiator	Solid	Metal	0.09
176	1890 & 1959 Bldgs.	194	XRF	6/10/97	6	Classroom	606	Wall	Wall	Solid	Concrete	0.11
177	1890 & 1959 Bldgs.	23	XRF	6/16/97	6	Classroom	606	Ceiling		Solid	Plaster	0
178	1890 & 1959 Bldgs.	178	XRF	6/10/97	6	Classroom	609	Wall	Midle Wall	Solid	Drywall	0

Saint Paul Public Schools
 River Front Educational Center
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
179	1890 & 1959 Bldgs.	179	XRF	6/10/97	6	Classroom	609	Door	Casing	Solid	Metal	0.2
180	1890 & 1959 Bldgs.	180	XRF	6/10/97	6	Classroom	609	Door	Door	Solid	Wood	0
181	1890 & 1959 Bldgs.	181	XRF	6/10/97	6	Classroom	609	Window	Header	Solid	Wood	0
182	1890 & 1959 Bldgs.	182	XRF	6/10/97	6	Classroom	609		Radiator	Solid	Metal	0.13
183	1890 & 1959 Bldgs.	183	XRF	6/10/97	6	Classroom	609	Wall	Midle Wall	Solid	Concrete	0.16
184	1890 & 1959 Bldgs.	24	XRF	6/16/97	6	Classroom	610	Ceiling		Solid	Plaster	0
185	1890 & 1959 Bldgs.	166	XRF	6/10/97	6	Classroom	611	Window	Header	Solid	Wood	0
186	1890 & 1959 Bldgs.	167	XRF	6/10/97	6	Classroom	611		Radiator	Solid	Metal	0.02
187	1890 & 1959 Bldgs.	168	XRF	6/10/97	6	Classroom	611	Wall	Midle Wall	Solid	Concrete	0.15
188	1890 & 1959 Bldgs.	169	XRF	6/10/97	6	Classroom	611	Wall	Midle Wall	Solid	Drywall	0
189	1890 & 1959 Bldgs.	170	XRF	6/10/97	6	Classroom	611	Door	Casing	Solid	Metal	0.23
190	1890 & 1959 Bldgs.	171	XRF	6/10/97	6	Classroom	611	Door	Door	Solid	Wood	0
191	1890 & 1959 Bldgs.	25	XRF	6/16/97	6	Classroom	612	Ceiling		Solid	Plaster	0
192	1890 & 1959 Bldgs.	125	XRF	6/10/97	7	Classroom	701	Wall	Midle Wall	Solid	Concrete	0
193	1890 & 1959 Bldgs.	126	XRF	6/10/97	7	Classroom	701	Window	Header	Solid	Wood	0
194	1890 & 1959 Bldgs.	127	XRF	6/10/97	7	Classroom	701		Radiator	Solid	Metal	0
195	1890 & 1959 Bldgs.	128	XRF	6/10/97	7	Classroom	701	Wall	Wall	Solid	Drywall	0
196	1890 & 1959 Bldgs.	129	XRF	6/10/97	7	Classroom	701	Wall	Wall Rgstr	Solid	Metal	0
197	1890 & 1959 Bldgs.	130	XRF	6/10/97	7	Classroom	701	Door	Casing	Solid	Metal	0.2
198	1890 & 1959 Bldgs.	131	XRF	6/10/97	7	Classroom	701	Door	Door	Solid	Wood	0
199	1890 & 1959 Bldgs.	132	XRF	6/10/97	7	Classroom	702	Wall	Wall	Solid	Concrete	0.06
200	1890 & 1959 Bldgs.	133	XRF	6/10/97	7	Classroom	702		Radiator	Solid	Metal	0.1
201	1890 & 1959 Bldgs.	134	XRF	6/10/97	7	Classroom	702	Door	Door	Solid	Wood	0
202	1890 & 1959 Bldgs.	135	XRF	6/10/97	7	Classroom	702	Door	Jamb	Solid	Metal	0.28
203	1890 & 1959 Bldgs.	136	XRF	6/10/97	7	Classroom	702	Wall	Midle Wall	Solid	Drywall	0
204	1890 & 1959 Bldgs.	137	XRF	6/10/97	7	Classroom	702	Window	Header	Solid	Wood	0
205	1890 & 1959 Bldgs.	19	XRF	6/16/97	7	Classroom	702	Ceiling		Solid	Plaster	0.11
206	1890 & 1959 Bldgs.	113	XRF	6/10/97	7	Classroom	706	Wall	Wall	Solid	Drywall	0
207	1890 & 1959 Bldgs.	114	XRF	6/10/97	7	Classroom	706	Wall	Wall	Solid	Concrete	0.16
208	1890 & 1959 Bldgs.	115	XRF	6/10/97	7	Classroom	706		Radiator	Solid	Metal	0.03
209	1890 & 1959 Bldgs.	116	XRF	6/10/97	7	Classroom	706	Window	Header	Solid	Wood	0
210	1890 & 1959 Bldgs.	117	XRF	6/10/97	7	Classroom	706	Door	Casing	Solid	Metal	0.21
211	1890 & 1959 Bldgs.	118	XRF	6/10/97	7	Classroom	706	Door	Door	Solid	Wood	0
212	1890 & 1959 Bldgs.	102	XRF	6/10/97	7	Classroom	709	Wall	Wall	Solid	Drywall	0.01
213	1890 & 1959 Bldgs.	103	XRF	6/10/97	7	Classroom	709	Door	Casing	Solid	Metal	0.24
214	1890 & 1959 Bldgs.	104	XRF	6/10/97	7	Classroom	709	Door	Door	Solid	Wood	0
215	1890 & 1959 Bldgs.	105	XRF	6/10/97	7	Classroom	709		Radiator	Solid	Metal	0.04
216	1890 & 1959 Bldgs.	106	XRF	6/10/97	7	Classroom	709	Wall	Midle Wall	Solid	Concrete	0.14
217	1890 & 1959 Bldgs.	107	XRF	6/10/97	7	Classroom	709	Window	Header	Solid	Wood	0
218	1890 & 1959 Bldgs.	17	XRF	6/16/97	7	Classroom	709	Ceiling		Solid	Plaster	0.03
219	1890 & 1959 Bldgs.	16	XRF	6/16/97	7	Classroom	710	Ceiling		Solid	Plaster	0.04
220	1890 & 1959 Bldgs.	90	XRF	6/10/97	7	Classroom	711	Wall	Midle Wall	Solid	Drywall	0
221	1890 & 1959 Bldgs.	91	XRF	6/10/97	7	Classroom	711	Window	Header	Solid	Wood	0
222	1890 & 1959 Bldgs.	92	XRF	6/10/97	7	Classroom	711		Radiator	Solid	Metal	0.05
223	1890 & 1959 Bldgs.	93	XRF	6/10/97	7	Classroom	711	Wall	Midle Wall	Solid	Concrete	0.11
224	1890 & 1959 Bldgs.	94	XRF	6/10/97	7	Classroom	711	Door	Casing	Solid	Metal	0.31
225	1890 & 1959 Bldgs.	95	XRF	6/10/97	7	Classroom	711	Door	Door	Solid	Wood	0
226	1890 & 1959 Bldgs.	56	XRF	6/10/97	8	Classroom	801	Wall	Midle Wall	Solid	Plaster	0
227	1890 & 1959 Bldgs.	57	XRF	6/10/97	8	Classroom	801		Radiator	Solid	Metal	0
228	1890 & 1959 Bldgs.	58	XRF	6/10/97	8	Classroom	801	Wall	Midle Wall	Solid	Concrete	0.03
229	1890 & 1959 Bldgs.	59	XRF	6/10/97	8	Classroom	801	Window	Header	Solid	Wood	0
230	1890 & 1959 Bldgs.	60	XRF	6/10/97	8	Classroom	801		Radiator	Solid	Metal	0.05
231	1890 & 1959 Bldgs.	61	XRF	6/10/97	8	Classroom	801	Wall	Midle Wall	Solid	Drywall	0
232	1890 & 1959 Bldgs.	62	XRF	6/10/97	8	Classroom	801	Door	Door	Solid	Wood	0
233	1890 & 1959 Bldgs.	63	XRF	6/10/97	8	Classroom	801	Door	Casing	Solid	Metal	0.31
234	1890 & 1959 Bldgs.	14	XRF	6/16/97	8	Classroom	801	Ceiling		Solid	Plaster	0.01
235	1890 & 1959 Bldgs.	47	XRF	6/10/97	8	Classroom	802	Wall	Midle Wall	Solid	Plaster	0
236	1890 & 1959 Bldgs.	48	XRF	6/10/97	8	Classroom	802		Radiator	Solid	Metal	0
237	1890 & 1959 Bldgs.	49	XRF	6/10/97	8	Classroom	802	Wall	Midle Wall	Solid	Drywall	0

Saint Paul Public Schools
 River Front Educational Center
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
238	1890 & 1959 Bldgs.	50	XRF	6/10/97	8	Classroom	802	Locker	Solid	Metal		0
239	1890 & 1959 Bldgs.	51	XRF	6/10/97	8	Classroom	802	Door	Casing	Solid	Metal	0.18
240	1890 & 1959 Bldgs.	52	XRF	6/10/97	8	Classroom	802	Door	Door	Solid	Wood	0
241	1890 & 1959 Bldgs.	53	XRF	6/10/97	8	Classroom	802	Wall	Wall	Solid	Concrete	0.05
242	1890 & 1959 Bldgs.	54	XRF	6/10/97	8	Classroom	802	Window	Header	Solid	Wood	0
243	1890 & 1959 Bldgs.	55	XRF	6/10/97	8	Classroom	802		Radiator	Solid	Metal	0.1
244	1890 & 1959 Bldgs.	41	XRF	6/10/97	8	Classroom	804	Wall	Wall	Solid	Drywall	0
245	1890 & 1959 Bldgs.	42	XRF	6/10/97	8	Classroom	804	Door	Door	Solid	Wood	0
246	1890 & 1959 Bldgs.	43	XRF	6/10/97	8	Classroom	804	Door	Casing	Solid	Metal	0.19
247	1890 & 1959 Bldgs.	44	XRF	6/10/97	8	Classroom	804	Window	Header	Solid	Wood	0
248	1890 & 1959 Bldgs.	45	XRF	6/10/97	8	Classroom	804		Radiator	Solid	Metal	0.07
249	1890 & 1959 Bldgs.	46	XRF	6/10/97	8	Classroom	804	Wall	Midle Wall	Solid	Concrete	0.09
250	1890 & 1959 Bldgs.	13	XRF	6/16/97	8	Classroom	804	Ceiling		Solid	Plaster	0.01
251	1890 & 1959 Bldgs.	35	XRF	6/10/97	8	Classroom	806		Radiator	Solid	Metal	0.02
252	1890 & 1959 Bldgs.	36	XRF	6/10/97	8	Classroom	806	Window	Header	Solid	Wood	0
253	1890 & 1959 Bldgs.	37	XRF	6/10/97	8	Classroom	806	Wall	Midle Wall	Solid	Concrete	0.05
254	1890 & 1959 Bldgs.	38	XRF	6/10/97	8	Classroom	806	Wall	Wall	Solid	Drywall	0
255	1890 & 1959 Bldgs.	39	XRF	6/10/97	8	Classroom	806	Door	Casing	Solid	Metal	0.21
256	1890 & 1959 Bldgs.	40	XRF	6/10/97	8	Classroom	806	Door	Door	Solid	Wood	0
257	1890 & 1959 Bldgs.	29	XRF	6/10/97	8	Classroom	808	Wall	Midle Wall	Solid	Drywall	0
258	1890 & 1959 Bldgs.	30	XRF	6/10/97	8	Classroom	808	Window	Header	Solid	Wood	0
259	1890 & 1959 Bldgs.	31	XRF	6/10/97	8	Classroom	808		Radiator	Solid	Metal	0.09
260	1890 & 1959 Bldgs.	32	XRF	6/10/97	8	Classroom	808	Wall	Midle Wall	Solid	Concrete	0.06
261	1890 & 1959 Bldgs.	33	XRF	6/10/97	8	Classroom	808	Door	Casing	Solid	Metal	0.25
262	1890 & 1959 Bldgs.	34	XRF	6/10/97	8	Classroom	808	Door	Door	Solid	Wood	0
263	1890 & 1959 Bldgs.	23	XRF	6/10/97	8	Classroom	809	Door	Door	Solid	Wood	0
264	1890 & 1959 Bldgs.	24	XRF	6/10/97	8	Classroom	809	Door	Casing	Solid	Metal	0
265	1890 & 1959 Bldgs.	25	XRF	6/10/97	8	Classroom	809	Wall	Midle Wall	Solid	Drywall	0
266	1890 & 1959 Bldgs.	26	XRF	6/10/97	8	Classroom	809	Wall	Midle Wall	Solid	Concrete	0
267	1890 & 1959 Bldgs.	27	XRF	6/10/97	8	Classroom	809	Window	Header	Solid	Wood	0
268	1890 & 1959 Bldgs.	28	XRF	6/10/97	8	Classroom	809		Radiator	Solid	Metal	0.08
269	1890 & 1959 Bldgs.	12	XRF	6/10/97	8	Classroom	811	Wall	Midle Wall	Solid	Drywall	0
270	1890 & 1959 Bldgs.	13	XRF	6/10/97	8	Classroom	811	Wall	Midle Wall	Solid	Concrete	0.1
271	1890 & 1959 Bldgs.	14	XRF	6/10/97	8	Classroom	811		Radiator	Solid	Metal	0.08
272	1890 & 1959 Bldgs.	15	XRF	6/10/97	8	Classroom	811	Window	Header	Solid	Wood	0
273	1890 & 1959 Bldgs.	16	XRF	6/10/97	8	Classroom	811	Door	Casing	Solid	Metal	0.29
274	1890 & 1959 Bldgs.	17	XRF	6/10/97	8	Classroom	811	Door	Door	Solid	Wood	0
275	1890 & 1959 Bldgs.	31	XRF	6/16/97	5	Classroom	516A	Ceiling		Solid	Plaster	0
276	1890 & 1959 Bldgs.	28	XRF	6/16/97	5	Classroom	523A	Ceiling		Solid	Plaster	0
277	1890 & 1959 Bldgs.	100	XRF	6/12/97	2	Gym	1	Wall	Wall	Solid	Wood	0
278	1890 & 1959 Bldgs.	101	XRF	6/12/97	2	Gym	1	Wall	Midle Wall	Solid	Concrete	0.06
279	1890 & 1959 Bldgs.	102	XRF	6/12/97	2	Gym	1	Door	Door	Solid	Metal	0
280	1890 & 1959 Bldgs.	103	XRF	6/12/97	2	Gym	1	Door	Casing	Solid	Metal	0.04
281	1890 & 1959 Bldgs.	104	XRF	6/12/97	2	Gym	1	Wall	Midle Wall	Solid	Concrete	0.1
282	1890 & 1959 Bldgs.	105	XRF	6/12/97	2	Gym	1	Floor		Solid	Wood	0
283	1890 & 1959 Bldgs.	106	XRF	6/12/97	2	Gym	1	Floor		Solid	Wood	0
284	1890 & 1959 Bldgs.	107	XRF	6/12/97	2	Gym	1	Floor		Solid	Wood	0
285	1890 & 1959 Bldgs.	108	XRF	6/12/97	2	Gym	1	Door	Door	Solid	Wood	0
286	1890 & 1959 Bldgs.	109	XRF	6/12/97	2	Gym	1	Door	Casing	Solid	Metal	0.1
287	1890 & 1959 Bldgs.	110	XRF	6/12/97	2	Gym	1	Wall	Midle Wall	Solid	Drywall	0
288	1890 & 1959 Bldgs.	111	XRF	6/12/97	2	Gym	1	Wall	Midle Wall	Solid	Concrete	0
289	1890 & 1959 Bldgs.	112	XRF	6/12/97	2	Gym	1	Door	Door	Solid	Wood	0
290	1890 & 1959 Bldgs.	113	XRF	6/12/97	2	Gym	1	Door	Casing	Solid	Metal	0.04
291	1890 & 1959 Bldgs.	114	XRF	6/12/97	2	Gym	1	Wall	Midle Wall	Solid	Drywall	0
292	1890 & 1959 Bldgs.	140	XRF	6/12/97	0	Hall	0	Wall	Midle Wall	Solid	Concrete	0.07
293	1890 & 1959 Bldgs.	141	XRF	6/12/97	0	Hall	0	Door	Casing	Solid	Metal	0.02
294	1890 & 1959 Bldgs.	142	XRF	6/12/97	0	Hall	0	Door	Door	Solid	Wood	0.02
295	1890 & 1959 Bldgs.	143	XRF	6/12/97	0	Hall	0	Door	Door	Solid	Metal	0.04
296	1890 & 1959 Bldgs.	144	XRF	6/12/97	0	Hall	0		Locker	Solid	Metal	0

Saint Paul Public Schools
 River Front Educational Center
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
297	1890 & 1959 Bldgs.	145	XRF	6/12/97	0	Hall	0	Locker	Solid	Concrete		0.02
298	1890 & 1959 Bldgs.	245	XRF	6/12/97	1	Hall	1	Door	Door	Solid	Metal	0
299	1890 & 1959 Bldgs.	246	XRF	6/12/97	1	Hall	1	Door	Casing	Solid	Metal	0.04
300	1890 & 1959 Bldgs.	247	XRF	6/12/97	1	Hall	1	Door	Door	Solid	Wood	0
301	1890 & 1959 Bldgs.	248	XRF	6/12/97	1	Hall	1	Door	Casing	Solid	Metal	0
302	1890 & 1959 Bldgs.	249	XRF	6/12/97	1	Hall	1	Wall	Midle Wall	Solid	Drywall	0
303	1890 & 1959 Bldgs.	250	XRF	6/12/97	1	Hall	1	Wall	Midle Wall	Solid	Concrete	0.02
304	1890 & 1959 Bldgs.	251	XRF	6/12/97	1	Hall	1	Wall	Midle Wall	Solid	Concrete	0.14
305	1890 & 1959 Bldgs.	252	XRF	6/12/97	1	Hall	1	Door	Door	Solid	Wood	0
306	1890 & 1959 Bldgs.	253	XRF	6/12/97	1	Hall	1	Window	Casing	Solid	Metal	0.08
307	1890 & 1959 Bldgs.	254	XRF	6/12/97	1	Hall	1	Wall	Wall	Solid	Concrete	0
308	1890 & 1959 Bldgs.	255	XRF	6/12/97	1	Hall	1	Door	Casing	Solid	Metal	0.02
309	1890 & 1959 Bldgs.	256	XRF	6/12/97	1	Hall	1	Door	Door	Solid	Wood	0
310	1890 & 1959 Bldgs.	257	XRF	6/12/97	1	Hall	1	Door	Casing	Solid	Metal	0.01
311	1890 & 1959 Bldgs.	258	XRF	6/12/97	1	Hall	1	Door	Door	Solid	Metal	0
312	1890 & 1959 Bldgs.	259	XRF	6/12/97	1	Hall	1	Vent	Midle Wall	Solid	Metal	0
313	1890 & 1959 Bldgs.	260	XRF	6/12/97	1	Hall	1	Stairs	Hand rail	Solid	Wood	0
314	1890 & 1959 Bldgs.	51	XRF	6/13/97	0	Hall	1	Door	Door	Solid	Metal	0
315	1890 & 1959 Bldgs.	52	XRF	6/13/97	0	Hall	1	Door	Casing	Solid	Metal	0.05
316	1890 & 1959 Bldgs.	53	XRF	6/13/97	0	Hall	1	Wall	Midle Wall	Solid	Concrete	0
317	1890 & 1959 Bldgs.	54	XRF	6/13/97	0	Hall	1	Door	Door	Solid	Wood	0.2
318	1890 & 1959 Bldgs.	55	XRF	6/13/97	0	Hall	1	Door	Door	Solid	Metal	0
319	1890 & 1959 Bldgs.	56	XRF	6/13/97	0	Hall	1	Door	Casing	Solid	Metal	0.1
320	1890 & 1959 Bldgs.	57	XRF	6/13/97	0	Hall	1	Door	Door	Solid	Wood	0.33
321	1890 & 1959 Bldgs.	58	XRF	6/13/97	0	Hall	1	Door	Door	Solid	Metal	0
322	1890 & 1959 Bldgs.	59	XRF	6/13/97	0	Hall	1	Elec Panel	Solid	Metal		0.31
323	1890 & 1959 Bldgs.	60	XRF	6/13/97	0	Hall	1	Wall	Midle Wall	Solid	Concrete	0.03
324	1890 & 1959 Bldgs.	61	XRF	6/13/97	0	Hall	1	Door	Door	Solid	Metal	0.05
325	1890 & 1959 Bldgs.	62	XRF	6/13/97	0	Hall	1	Wall	Midle Wall	Solid	Concrete	0
326	1890 & 1959 Bldgs.	63	XRF	6/13/97	0	Hall	1	Door	Door	Solid	Metal	0.03
327	1890 & 1959 Bldgs.	64	XRF	6/13/97	0	Hall	1	Door	Door	Solid	Metal	0.09
328	1890 & 1959 Bldgs.	65	XRF	6/13/97	0	Hall	1	Wall	Midle Wall	Solid	Plaster	0
329	1890 & 1959 Bldgs.	66	XRF	6/13/97	0	Hall	1	Wall	Midle Wall	Solid	Drywall	0
330	1890 & 1959 Bldgs.	67	XRF	6/13/97	1	Hall	1	Wall	Midle Wall	Solid	Concrete	0
331	1890 & 1959 Bldgs.	68	XRF	6/13/97	1	Hall	1	Stairs	Hand rail	Solid	Metal	0.03
332	1890 & 1959 Bldgs.	69	XRF	6/13/97	1	Hall	1	Stairs	Baseboard	Solid	Metal	0
333	1890 & 1959 Bldgs.	70	XRF	6/13/97	1	Hall	1	Stairs	Wall	Solid	Drywall	0
334	1890 & 1959 Bldgs.	71	XRF	6/13/97	1	Hall	1	Stairs	Stringer	Solid	Metal	0
335	1890 & 1959 Bldgs.	72	XRF	6/13/97	1	Hall	1	Ceiling		Solid	Drywall	0
336	1890 & 1959 Bldgs.	73	XRF	6/13/97	1	Hall	1	Door	Door	Solid	Metal	0.13
337	1890 & 1959 Bldgs.	34	XRF	6/16/97	1	Hall	1	Ceiling		Solid	Plaster	0
338	1890 & 1959 Bldgs.	35	XRF	6/16/97	1	Hall	1	Ceiling		Solid	Concrete	0.1
339	1890 & 1959 Bldgs.	36	XRF	6/16/97	1	Hall	1	Ceiling		Solid	Concrete	0
340	1890 & 1959 Bldgs.	73	XRF	6/12/97	2	Hall	2	Stairs	Hand rail	Solid	Metal	0
341	1890 & 1959 Bldgs.	74	XRF	6/12/97	2	Hall	2	Wall	Midle Wall	Solid	Concrete	0.04
342	1890 & 1959 Bldgs.	75	XRF	6/12/97	2	Hall	2	Door	Casing	Solid	Metal	0.03
343	1890 & 1959 Bldgs.	76	XRF	6/12/97	2	Hall	2	Door	Door	Solid	Wood	0
344	1890 & 1959 Bldgs.	77	XRF	6/12/97	2	Hall	2	Window	Casing	Solid	Metal	0.01
345	1890 & 1959 Bldgs.	78	XRF	6/12/97	2	Hall	2	Door	Door	Solid	Wood	0
346	1890 & 1959 Bldgs.	79	XRF	6/12/97	2	Hall	2	Wall	Midle Wall	Solid	Concrete	0.11
347	1890 & 1959 Bldgs.	80	XRF	6/12/97	2	Hall	2		Locker	Solid	Metal	0.01
348	1890 & 1959 Bldgs.	81	XRF	6/12/97	2	Hall	2	Wall	Midle Wall	Solid	Concrete	0
349	1890 & 1959 Bldgs.	82	XRF	6/12/97	2	Hall	2		Locker	Solid	Metal	0
350	1890 & 1959 Bldgs.	83	XRF	6/12/97	2	Hall	2	Wall	Wall	Solid	Plaster	0
351	1890 & 1959 Bldgs.	84	XRF	6/12/97	2	Hall	2		Locker	Solid	Metal	0.01
352	1890 & 1959 Bldgs.	85	XRF	6/12/97	2	Hall	2	Door	Door	Solid	Wood	0
353	1890 & 1959 Bldgs.	86	XRF	6/12/97	2	Hall	2	Wall	Midle Wall	Solid	Concrete	0.05
354	1890 & 1959 Bldgs.	87	XRF	6/12/97	2	Hall	2	Wall	Midle Wall	Solid	Concrete	0.23
355	1890 & 1959 Bldgs.	88	XRF	6/12/97	2	Hall	2	Door	Door	Solid	Metal	0.18

Saint Paul Public Schools
 River Front Educational Center
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
356	1890 & 1959 Bldgs.	89	XRF	6/12/97	2	Hall	2	Door	Casing	Solid	Metal	0.07
357	1890 & 1959 Bldgs.	90	XRF	6/12/97	2	Hall	2	Door	Door	Solid	Metal	0
358	1890 & 1959 Bldgs.	91	XRF	6/12/97	2	Hall	2	Wall	Midle Wall	Solid	Concrte	0.05
359	1890 & 1959 Bldgs.	92	XRF	6/12/97	2	Hall	2	Radiator	Solid	Metal		0.03
360	1890 & 1959 Bldgs.	93	XRF	6/12/97	2	Hall	2	Window	Header	Solid	Wood	0
361	1890 & 1959 Bldgs.	94	XRF	6/12/97	2	Hall	2	Window	Casing	Solid	Metal	0.02
362	1890 & 1959 Bldgs.	95	XRF	6/12/97	2	Hall	2	Locker	Solid	Metal		0
363	1890 & 1959 Bldgs.	96	XRF	6/12/97	2	Hall	2	Door	Door	Solid	Wood	0
364	1890 & 1959 Bldgs.	152	XRF	6/13/97	1	Hall	2	Wall	Midle Wall	Solid	Drywall	0
365	1890 & 1959 Bldgs.	153	XRF	6/13/97	1	Hall	2	Door	Door	Solid	Wood	0
366	1890 & 1959 Bldgs.	154	XRF	6/13/97	1	Hall	2	Window	Casing	Solid	Metal	0
367	1890 & 1959 Bldgs.	155	XRF	6/13/97	1	Hall	2	Stairs	Hand rail	Solid	Metal	0
368	1890 & 1959 Bldgs.	156	XRF	6/13/97	1	Hall	2	Stairs	Baseboard	Solid	Metal	0.01
369	1890 & 1959 Bldgs.	157	XRF	6/13/97	1	Hall	2	Wall	Midle Wall	Solid	Concrte	0.04
370	1890 & 1959 Bldgs.	158	XRF	6/13/97	1	Hall	2	Wall	Wall	Solid	Concrte	0.02
371	1890 & 1959 Bldgs.	159	XRF	6/13/97	1	Hall	2	Ceiling		Solid	Plaster	0
372	1890 & 1959 Bldgs.	160	XRF	6/13/97	1	Hall	2	Door	Door	Solid	Metal	0
373	1890 & 1959 Bldgs.	15	XRF	6/16/97	7	Hall	2	Ceiling		Solid	Plaster	0
374	1890 & 1959 Bldgs.	32	XRF	6/16/97	2	Hall	2	Ceiling		Solid	Plaster	0.03
375	1890 & 1959 Bldgs.	33	XRF	6/16/97	2	Hall	2	Ceiling		Solid	Plaster	0.14
376	1890 & 1959 Bldgs.	147	XRF	6/11/97	4	Hall	4	Door	Door	Solid	Wood	0
377	1890 & 1959 Bldgs.	148	XRF	6/11/97	4	Hall	4	Door	Casing	Solid	Metal	0
378	1890 & 1959 Bldgs.	149	XRF	6/11/97	4	Hall	4	Wall	Midle Wall	Solid	Drywall	0
379	1890 & 1959 Bldgs.	150	XRF	6/11/97	4	Hall	4	Door	Door	Solid	Wood	0
380	1890 & 1959 Bldgs.	151	XRF	6/11/97	4	Hall	4	Door	Casing	Solid	Metal	0.07
381	1890 & 1959 Bldgs.	152	XRF	6/11/97	4	Hall	4	Door	Door	Solid	Metal	0
382	1890 & 1959 Bldgs.	153	XRF	6/11/97	4	Hall	4	Radiator	Solid	Metal		0.07
383	1890 & 1959 Bldgs.	154	XRF	6/11/97	4	Hall	4	Window	Header	Solid	Wood	0
384	1890 & 1959 Bldgs.	155	XRF	6/11/97	4	Hall	4	Wall	Midle Wall	Solid	Concrte	0.07
385	1890 & 1959 Bldgs.	156	XRF	6/11/97	4	Hall	4	Door	Door	Solid	Wood	0
386	1890 & 1959 Bldgs.	157	XRF	6/11/97	4	Hall	4	Door	Casing	Solid	Metal	0.03
387	1890 & 1959 Bldgs.	158	XRF	6/11/97	4	Hall	4	Wall	Midle Wall	Solid	Drywall	0
388	1890 & 1959 Bldgs.	159	XRF	6/11/97	4	Hall	4	Wall	Midle Wall	Solid	Drywall	0
389	1890 & 1959 Bldgs.	160	XRF	6/11/97	4	Hall	4	Window	Casing	Solid	Metal	0
390	1890 & 1959 Bldgs.	161	XRF	6/11/97	4	Hall	4	Wall	Midle Wall	Solid	Drywall	0
391	1890 & 1959 Bldgs.	220	XRF	6/10/97	6	Hall	6	Wall	Midle Wall	Solid	Drywall	0
392	1890 & 1959 Bldgs.	221	XRF	6/10/97	6	Hall	6	Door	Door	Solid	Wood	0
393	1890 & 1959 Bldgs.	222	XRF	6/10/97	6	Hall	6		Locker	Solid	Metal	0
394	1890 & 1959 Bldgs.	223	XRF	6/10/97	6	Hall	6		Locker	Solid	Metal	0
395	1890 & 1959 Bldgs.	224	XRF	6/10/97	6	Hall	6	Door	Door	Solid	Metal	0.18
396	1890 & 1959 Bldgs.	225	XRF	6/10/97	6	Hall	6	Door	Casing	Solid	Metal	0.04
397	1890 & 1959 Bldgs.	226	XRF	6/10/97	6	Hall	6	Door	Door	Solid	Metal	0
398	1890 & 1959 Bldgs.	227	XRF	6/10/97	6	Hall	6	Window	Header	Solid	Wood	0
399	1890 & 1959 Bldgs.	228	XRF	6/10/97	6	Hall	6		Radiator	Solid	Metal	0.03
400	1890 & 1959 Bldgs.	229	XRF	6/10/97	6	Hall	6	Door	Door	Solid	Metal	0.09
401	1890 & 1959 Bldgs.	230	XRF	6/10/97	6	Hall	6	Door	Door	Solid	Metal	0.13
402	1890 & 1959 Bldgs.	20	XRF	6/16/97	6	Hall	6	Ceiling		Solid	Plaster	0
403	1890 & 1959 Bldgs.	147	XRF	6/10/97	7	Hall	7	Wall	Midle Wall	Solid	Drywall	0
404	1890 & 1959 Bldgs.	148	XRF	6/10/97	7	Hall	7	Door	Door	Solid	Metal	0.23
405	1890 & 1959 Bldgs.	149	XRF	6/10/97	7	Hall	7	Door	Door	Solid	Wood	0
406	1890 & 1959 Bldgs.	150	XRF	6/10/97	7	Hall	7	Door	Door	Solid	Metal	0
407	1890 & 1959 Bldgs.	151	XRF	6/10/97	7	Hall	7	Wall	Midle Wall	Solid	Concrte	0.13
408	1890 & 1959 Bldgs.	152	XRF	6/10/97	7	Hall	7	Window	Stool	Solid	Concrte	0.05
409	1890 & 1959 Bldgs.	153	XRF	6/10/97	7	Hall	7	Window	Header	Solid	Wood	0
410	1890 & 1959 Bldgs.	154	XRF	6/10/97	7	Hall	7		Radiator	Solid	Metal	0.14
411	1890 & 1959 Bldgs.	155	XRF	6/10/97	7	Hall	7	Door	Door	Solid	Metal	0.05
412	1890 & 1959 Bldgs.	156	XRF	6/10/97	7	Hall	7	Door	Door	Solid	Metal	0.18
413	1890 & 1959 Bldgs.	157	XRF	6/10/97	7	Hall	7	Door	Casing	Solid	Metal	0.34
414	1890 & 1959 Bldgs.	158	XRF	6/10/97	7	Hall	7		Locker	Solid	Metal	0

Saint Paul Public Schools
 River Front Educational Center
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
415	1890 & 1959 Bldgs.	159	XRF	6/10/97	7	Hall	7	Locker	Solid	Metal		0
416	1890 & 1959 Bldgs.	64	XRF	6/10/97	8	Hall	8	Wall	Midle Wall	Solid	Drywall	0
417	1890 & 1959 Bldgs.	65	XRF	6/10/97	8	Hall	8	Door	Door	Solid	Wood	0
418	1890 & 1959 Bldgs.	66	XRF	6/10/97	8	Hall	8	Door	Door	Solid	Metal	0
419	1890 & 1959 Bldgs.	67	XRF	6/10/97	8	Hall	8	Window	Header	Solid	Wood	0
420	1890 & 1959 Bldgs.	68	XRF	6/10/97	8	Hall	8	Radiator	Solid	Metal		0.14
421	1890 & 1959 Bldgs.	69	XRF	6/10/97	8	Hall	8	Wall	Midle Wall	Solid	Plaster	0
422	1890 & 1959 Bldgs.	70	XRF	6/10/97	8	Hall	8	Door	Door	Solid	Metal	0.06
423	1890 & 1959 Bldgs.	71	XRF	6/10/97	8	Hall	8	Door	Casing	Solid	Metal	0
424	1890 & 1959 Bldgs.	72	XRF	6/10/97	8	Hall	8	Wall	Wall	Solid	Concrte	0.19
425	1890 & 1959 Bldgs.	73	XRF	6/10/97	8	Hall	8	Locker	Solid	Metal		0
426	1890 & 1959 Bldgs.	74	XRF	6/10/97	8	Hall	8	Locker	Solid	Metal		0
427	1890 & 1959 Bldgs.	7	XRF	6/16/97	8	Hall	8	Ceiling		Solid	Plaster	0
428	1890 & 1959 Bldgs.	88	XRF	6/13/97	0	Other	10	Wall	Midle Wall	Solid	Concrte	0
429	1890 & 1959 Bldgs.	89	XRF	6/13/97	0	Other	10	Wall	Midle Wall	Solid	Concrte	0
430	1890 & 1959 Bldgs.	90	XRF	6/13/97	0	Other	10	Door	Door	Solid	Wood	0.19
431	1890 & 1959 Bldgs.	91	XRF	6/13/97	0	Other	10	Door	Casing	Solid	Metal	0.01
432	1890 & 1959 Bldgs.	92	XRF	6/13/97	0	Other	10	Door	Casing	Solid	Drywall	0
433	1890 & 1959 Bldgs.	93	XRF	6/13/97	0	Other	10	Door	Door	Solid	Wood	0.33
434	1890 & 1959 Bldgs.	94	XRF	6/13/97	0	Other	10	Door	Casing	Solid	Metal	0.05
435	1890 & 1959 Bldgs.	41	XRF	6/16/97	1	Outside	1	Wall	Midle Wall	Solid	Concrte	0
436	1890 & 1959 Bldgs.	42	XRF	6/16/97	1	Outside	1	Ext Wall	Dripboard	Solid	Metal	0.32
437	1890 & 1959 Bldgs.	43	XRF	6/16/97	1	Outside	1	Door	Door	Solid	Metal	0.03
438	1890 & 1959 Bldgs.	44	XRF	6/16/97	1	Outside	1	Door	Jamb	Solid	Metal	0.02
439	1890 & 1959 Bldgs.	45	XRF	6/16/97	1	Outside	1	Ext Wall	Downspout	Solid	Metal	0.43
440	1890 & 1959 Bldgs.	46	XRF	6/16/97	1	Outside	1	Wall	Column	Peeling	Metal	1.03
441	1890 & 1959 Bldgs.	47	XRF	6/16/97	1	Outside	1	Fence		Peeling	Metal	0.19
442	1890 & 1959 Bldgs.	48	XRF	6/16/97	1	Outside	1	Door	Door	Solid	Metal	1.14
443	1890 & 1959 Bldgs.	120	XRF	6/13/97	0	Restroom	1	Door	Casing	Solid	Metal	0.03
444	1890 & 1959 Bldgs.	121	XRF	6/13/97	0	Restroom	1	Door	Door	Solid	Wood	0
445	1890 & 1959 Bldgs.	122	XRF	6/13/97	0	Restroom	1	Door	Bthrm Stll	Solid	Metal	1.92
446	1890 & 1959 Bldgs.	123	XRF	6/13/97	0	Restroom	1	Wall	Midle Wall	Solid	Concrte	0
447	1890 & 1959 Bldgs.	141	XRF	6/13/97	0	Restroom	2	Wall	Midle Wall	Solid	Concrte	0.01
448	1890 & 1959 Bldgs.	142	XRF	6/13/97	0	Restroom	2	Wall	Bthrm Stll	Solid	Metal	1.9
449	1890 & 1959 Bldgs.	143	XRF	6/13/97	0	Restroom	2	Door	Door	Solid	Wood	0
450	1890 & 1959 Bldgs.	144	XRF	6/13/97	0	Restroom	2	Door	Casing	Solid	Metal	0
451	1890 & 1959 Bldgs.	119	XRF	6/12/97	0	Restroom	20	Wall	Wall	Solid	Drywall	0
452	1890 & 1959 Bldgs.	120	XRF	6/12/97	0	Restroom	20	Door	Casing	Solid	Metal	0
453	1890 & 1959 Bldgs.	121	XRF	6/12/97	0	Restroom	20	Door	Door	Solid	Wood	0
454	1890 & 1959 Bldgs.	171	XRF	6/12/97	1	Restroom	1001	Door	Casing	Solid	Metal	0.11
455	1890 & 1959 Bldgs.	172	XRF	6/12/97	1	Restroom	1001	Door	Door	Solid	Wood	0
456	1890 & 1959 Bldgs.	173	XRF	6/12/97	1	Restroom	1001	Wall	Midle Wall	Solid	Concrte	0.01
457	1890 & 1959 Bldgs.	174	XRF	6/12/97	1	Restroom	1001		Radiator	Solid	Metal	0.01
458	1890 & 1959 Bldgs.	175	XRF	6/12/97	1	Restroom	1001	Wall	Bthrm Stll	Solid	Metal	0.04
459	1890 & 1959 Bldgs.	43	XRF	6/13/97	0	Restroom	1001	Wall	Bthrm Stll	Solid	Metal	0.01
460	1890 & 1959 Bldgs.	44	XRF	6/13/97	0	Restroom	1001	Wall	Wall	Solid	Concrte	0.03
461	1890 & 1959 Bldgs.	45	XRF	6/13/97	0	Restroom	1001	Door	Door	Solid	Wood	0.24
462	1890 & 1959 Bldgs.	46	XRF	6/13/97	0	Restroom	1001	Door	Casing	Solid	Metal	0.04
463	1890 & 1959 Bldgs.	40	XRF	6/16/97	1	Restroom	1001	Ceiling		Solid	Concrte	0
464	1890 & 1959 Bldgs.	176	XRF	6/12/97	1	Restroom	1002	Door	Door	Solid	Wood	0
465	1890 & 1959 Bldgs.	177	XRF	6/12/97	1	Restroom	1002	Door	Casing	Solid	Metal	0.07
466	1890 & 1959 Bldgs.	178	XRF	6/12/97	1	Restroom	1002	Wall	Midle Wall	Solid	Concrte	0.02
467	1890 & 1959 Bldgs.	179	XRF	6/12/97	1	Restroom	1002		Radiator	Solid	Metal	0.05
468	1890 & 1959 Bldgs.	180	XRF	6/12/97	1	Restroom	1002	Wall	Bthrm Stll	Solid	Metal	0.11
469	1890 & 1959 Bldgs.	47	XRF	6/13/97	0	Restroom	1002	Wall	Midle Wall	Solid	Concrte	0.01
470	1890 & 1959 Bldgs.	48	XRF	6/13/97	0	Restroom	1002	Wall	Bthrm Stll	Solid	Metal	0.09
471	1890 & 1959 Bldgs.	49	XRF	6/13/97	0	Restroom	1002	Door	Casing	Solid	Metal	0.04
472	1890 & 1959 Bldgs.	50	XRF	6/13/97	0	Restroom	1002	Door	Door	Solid	Wood	0.48
473	1890 & 1959 Bldgs.	222	XRF	6/12/97	1	Restroom	1003	Door	Casing	Solid	Metal	0

Saint Paul Public Schools
 River Front Educational Center
 Lead-Based Paint Inspection

3	A	B	C	D	E	F	G	H	I	J	K	L
	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
474	1890 & 1959 Bldgs.	223	XRF	6/12/97	1	Restroom	1003	Door	Door	Solid	Wood	0
475	1890 & 1959 Bldgs.	224	XRF	6/12/97	1	Restroom	1003	Wall	Midle Wall	Solid	Drywall	0
476	1890 & 1959 Bldgs.	234	XRF	6/12/97	1	Restroom	1004	Door	Door	Solid	Wood	0
477	1890 & 1959 Bldgs.	235	XRF	6/12/97	1	Restroom	1004	Door	Casing	Solid	Metal	0
478	1890 & 1959 Bldgs.	236	XRF	6/12/97	1	Restroom	1004	Wall	Midle Wall	Solid	Drywall	0.02
479	1890 & 1959 Bldgs.	22	XRF	6/12/97	2	Restroom	2001	Wall	Bthrm Stll	Solid	Metal	0.1
480	1890 & 1959 Bldgs.	23	XRF	6/12/97	2	Restroom	2001	Door	Casing	Solid	Metal	0.03
481	1890 & 1959 Bldgs.	24	XRF	6/12/97	2	Restroom	2001	Door	Door	Solid	Wood	0.03
482	1890 & 1959 Bldgs.	25	XRF	6/12/97	2	Restroom	2001	Wall	Midle Wall	Solid	Concrete	0
483	1890 & 1959 Bldgs.	26	XRF	6/12/97	2	Restroom	2001	Wall	Column	Solid	Concrete	0.29
484	1890 & 1959 Bldgs.	27	XRF	6/12/97	2	Restroom	2002	Wall	Bthrm Stll	Solid	Metal	0.05
485	1890 & 1959 Bldgs.	28	XRF	6/12/97	2	Restroom	2002	Wall	Midle Wall	Solid	Concrete	0.01
486	1890 & 1959 Bldgs.	29	XRF	6/12/97	2	Restroom	2002	Door	Casing	Solid	Metal	0.02
487	1890 & 1959 Bldgs.	30	XRF	6/12/97	2	Restroom	2002	Door	Door	Solid	Wood	0
488	1890 & 1959 Bldgs.	31	XRF	6/12/97	2	Restroom	2002	Wall	Midle Wall	Solid	Drywall	0
489	1890 & 1959 Bldgs.	187	XRF	6/11/97	3	Restroom	3001	Wall	Bthrm Stll	Solid	Metal	0.02
490	1890 & 1959 Bldgs.	188	XRF	6/11/97	3	Restroom	3001	Door	Casing	Solid	Metal	0.03
491	1890 & 1959 Bldgs.	189	XRF	6/11/97	3	Restroom	3001	Door	Door	Solid	Wood	0
492	1890 & 1959 Bldgs.	190	XRF	6/11/97	3	Restroom	3002	Wall	Bthrm Stll	Solid	Metal	0.05
493	1890 & 1959 Bldgs.	191	XRF	6/11/97	3	Restroom	3002	Door	Door	Solid	Wood	0
494	1890 & 1959 Bldgs.	192	XRF	6/11/97	3	Restroom	3002	Door	Casing	Solid	Metal	0
495	1890 & 1959 Bldgs.	193	XRF	6/11/97	3	Restroom	3002	Door	Casing	Solid	Metal	0.06
496	1890 & 1959 Bldgs.	194	XRF	6/11/97	3	Restroom	3002	Door	Door	Solid	Wood	0
497	1890 & 1959 Bldgs.	195	XRF	6/11/97	3	Restroom	3002	Wall	Midle Wall	Solid	Drywall	0
498	1890 & 1959 Bldgs.	141	XRF	6/11/97	4	Restroom	4001	Wall	Bthrm Stll	Solid	Metal	0
499	1890 & 1959 Bldgs.	142	XRF	6/11/97	4	Restroom	4001	Door	Door	Solid	Wood	0
500	1890 & 1959 Bldgs.	143	XRF	6/11/97	4	Restroom	4001	Door	Casing	Solid	Metal	0
501	1890 & 1959 Bldgs.	144	XRF	6/11/97	4	Restroom	4002	Door	Stall Door	Solid	Metal	0.02
502	1890 & 1959 Bldgs.	145	XRF	6/11/97	4	Restroom	4002	Door	Casing	Solid	Metal	0
503	1890 & 1959 Bldgs.	146	XRF	6/11/97	4	Restroom	4002	Door	Door	Solid	Wood	0
504	1890 & 1959 Bldgs.	75	XRF	6/11/97	5	Restroom	5001	Wall	Bthrm Stll	Solid	Metal	0.03
505	1890 & 1959 Bldgs.	76	XRF	6/11/97	5	Restroom	5001	Door	Door	Solid	Wood	0
506	1890 & 1959 Bldgs.	77	XRF	6/11/97	5	Restroom	5001	Door	Casing	Solid	Metal	0
507	1890 & 1959 Bldgs.	78	XRF	6/11/97	5	Restroom	5002	Wall	Midle Wall	Solid	Concrete	0.02
508	1890 & 1959 Bldgs.	79	XRF	6/11/97	5	Restroom	5002	Door	Stall Door	Solid	Metal	0.06
509	1890 & 1959 Bldgs.	80	XRF	6/11/97	5	Restroom	5002	Door	Door	Solid	Wood	0
510	1890 & 1959 Bldgs.	81	XRF	6/11/97	5	Restroom	5002	Door	Casing	Solid	Metal	0
511	1890 & 1959 Bldgs.	30	XRF	6/16/97	5	Restroom	5002	Ceiling		Solid	Plaster	0.03
512	1890 & 1959 Bldgs.	195	XRF	6/10/97	6	Restroom	6001	Wall	Midle Wall	Solid	Concrete	0
513	1890 & 1959 Bldgs.	196	XRF	6/10/97	6	Restroom	6001	Door	Casing	Solid	Metal	0
514	1890 & 1959 Bldgs.	197	XRF	6/10/97	6	Restroom	6001	Door	Door	Solid	Wood	0
515	1890 & 1959 Bldgs.	198	XRF	6/10/97	6	Restroom	6001	Wall	Wall	Solid	Drywall	0
516	1890 & 1959 Bldgs.	199	XRF	6/10/97	6	Restroom	6002	Wall	Wall	Solid	Drywall	0
517	1890 & 1959 Bldgs.	200	XRF	6/10/97	6	Restroom	6002	Wall	Midle Wall	Solid	Concrete	0
518	1890 & 1959 Bldgs.	201	XRF	6/10/97	6	Restroom	6002	Door	Casing	Solid	Metal	0.02
519	1890 & 1959 Bldgs.	202	XRF	6/10/97	6	Restroom	6002	Door	Door	Solid	Wood	0
520	1890 & 1959 Bldgs.	138	XRF	6/10/97	7	Restroom	7001	Door	Casing	Solid	Metal	0.01
521	1890 & 1959 Bldgs.	139	XRF	6/10/97	7	Restroom	7001	Wall	Midle Wall	Solid	Drywall	0
522	1890 & 1959 Bldgs.	140	XRF	6/10/97	7	Restroom	7001	Door	Door	Solid	Wood	0
523	1890 & 1959 Bldgs.	141	XRF	6/10/97	7	Restroom	7001	Wall	Midle Wall	Solid	Concrete	0
524	1890 & 1959 Bldgs.	142	XRF	6/10/97	7	Restroom	7001	Wall	Wall Rgstr	Solid	Metal	0
525	1890 & 1959 Bldgs.	143	XRF	6/10/97	7	Restroom	7002	Wall	Midle Wall	Solid	Drywall	0
526	1890 & 1959 Bldgs.	144	XRF	6/10/97	7	Restroom	7002	Wall	Midle Wall	Solid	Concrete	0
527	1890 & 1959 Bldgs.	145	XRF	6/10/97	7	Restroom	7002	Door	Casing	Solid	Metal	0.01
528	1890 & 1959 Bldgs.	146	XRF	6/10/97	7	Restroom	7002	Door	Door	Solid	Wood	0
529	1890 & 1959 Bldgs.	18	XRF	6/16/97	7	Restroom	7002	Ceiling		Solid	Plaster	0.06
530	1890 & 1959 Bldgs.	75	XRF	6/10/97	8	Restroom	8001	Door	Casing	Solid	Metal	0
531	1890 & 1959 Bldgs.	76	XRF	6/10/97	8	Restroom	8001	Door	Door	Solid	Wood	0
532	1890 & 1959 Bldgs.	77	XRF	6/10/97	8	Restroom	8001	Wall	Midle Wall	Solid	Concrete	0

Saint Paul Public Schools
 River Front Educational Center
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
533	1890 & 1959 Bldgs.	78	XRF	6/10/97	8	Restroom	8001	Wall	Bthrm Stll	Solid	Metal	0
534	1890 & 1959 Bldgs.	79	XRF	6/10/97	8	Restroom	8001	Wall	Wall	Solid	Drywall	0
535	1890 & 1959 Bldgs.	12	XRF	6/16/97	8	Restroom	8001	Ceiling		Solid	Plaster	0.07
536	1890 & 1959 Bldgs.	80	XRF	6/10/97	8	Restroom	8002	Wall	Midle Wall	Solid	Drywall	0
537	1890 & 1959 Bldgs.	81	XRF	6/10/97	8	Restroom	8002	Wall	Midle Wall	Solid	Concrete	0
538	1890 & 1959 Bldgs.	82	XRF	6/10/97	8	Restroom	8002	Door	Casing	Solid	Metal	0.01
539	1890 & 1959 Bldgs.	83	XRF	6/10/97	8	Restroom	8002	Door	Door	Solid	Wood	0
540	1890 & 1959 Bldgs.	6	XRF	6/13/97	0	Room	1	Window	Casing	Solid	Metal	0.02
541	1890 & 1959 Bldgs.	7	XRF	6/13/97	0	Room	1	Wall	Wall	Solid	Concrete	0.03
542	1890 & 1959 Bldgs.	8	XRF	6/13/97	0	Room	1	Door	Door	Solid	Metal	0.01
543	1890 & 1959 Bldgs.	9	XRF	6/13/97	0	Room	1	Wall	Midle Wall	Solid	Concrete	0.02
544	1890 & 1959 Bldgs.	10	XRF	6/13/97	0	Room	2	Wall	Midle Wall	Solid	Metal	0
545	1890 & 1959 Bldgs.	11	XRF	6/13/97	0	Room	2	Wall	Column	Peeling	Plaster	0
546	1890 & 1959 Bldgs.	12	XRF	6/13/97	0	Room	2	Door	Casing	Peeling	Metal	0.05
547	1890 & 1959 Bldgs.	13	XRF	6/13/97	0	Room	2	Wall	Midle Wall	Solid	Drywall	0
548	1890 & 1959 Bldgs.	14	XRF	6/13/97	0	Room	2	Door	Casing	Solid	Metal	0.04
549	1890 & 1959 Bldgs.	15	XRF	6/13/97	0	Room	2	Door	Casing	Solid	Metal	0.03
550	1890 & 1959 Bldgs.	16	XRF	6/13/97	0	Room	2	Door	Door	Solid	Wood	0.14
551	1890 & 1959 Bldgs.	17	XRF	6/13/97	0	Room	2	Door	Door	Solid	Wood	0.17
552	1890 & 1959 Bldgs.	18	XRF	6/13/97	0	Room	2	Wall	Midle Wall	Solid	Concrete	0.04
553	1890 & 1959 Bldgs.	19	XRF	6/13/97	0	Room	2	Wall	Midle Wall	Solid	Concrete	0.07
554	1890 & 1959 Bldgs.	20	XRF	6/13/97	0	Room	2	Wall	Midle Wall	Solid	Plaster	0.02
555	1890 & 1959 Bldgs.	21	XRF	6/13/97	0	Room	2	Door	Door	Solid	Wood	0.15
556	1890 & 1959 Bldgs.	22	XRF	6/13/97	0	Room	2	Door	Casing	Solid	Metal	0
557	1890 & 1959 Bldgs.	23	XRF	6/13/97	0	Room	2	Wall	Midle Wall	Solid	Plaster	0.01
558	1890 & 1959 Bldgs.	37	XRF	6/16/97	1	Room	2	Ceiling		Solid	Plaster	0.06
559	1890 & 1959 Bldgs.	29	XRF	6/13/97	0	Room	3	Door	Casing	Solid	Metal	0.04
560	1890 & 1959 Bldgs.	30	XRF	6/13/97	0	Room	3	Door	Door	Solid	Wood	0.22
561	1890 & 1959 Bldgs.	31	XRF	6/13/97	0	Room	3	Wall	Midle Wall	Solid	Concrete	0.01
562	1890 & 1959 Bldgs.	32	XRF	6/13/97	0	Room	3	Wall	Midle Wall	Solid	Concrete	0.13
563	1890 & 1959 Bldgs.	33	XRF	6/13/97	0	Room	3	Wall	Midle Wall	Solid	Concrete	0.06
564	1890 & 1959 Bldgs.	122	XRF	6/12/97	0	Room	4	Door	Door	Solid	Wood	0
565	1890 & 1959 Bldgs.	123	XRF	6/12/97	0	Room	4	Door	Casing	Solid	Metal	0.02
566	1890 & 1959 Bldgs.	124	XRF	6/12/97	0	Room	4	Wall	Midle Wall	Solid	Concrete	0
567	1890 & 1959 Bldgs.	125	XRF	6/12/97	0	Room	4	Door	Door	Solid	Metal	0.03
568	1890 & 1959 Bldgs.	126	XRF	6/12/97	0	Room	4	Door	Casing	Solid	Metal	0.03
569	1890 & 1959 Bldgs.	127	XRF	6/12/97	0	Room	4		Locker	Solid	Metal	0
570	1890 & 1959 Bldgs.	128	XRF	6/12/97	0	Room	4		Locker	Solid	Wood	0
571	1890 & 1959 Bldgs.	129	XRF	6/12/97	0	Room	4		Locker	Solid	Metal	0.02
572	1890 & 1959 Bldgs.	130	XRF	6/12/97	0	Room	4	Wall	Wall	Solid	Concrete	0
573	1890 & 1959 Bldgs.	131	XRF	6/12/97	0	Room	4	Wall	Wall	Solid	Concrete	0.04
574	1890 & 1959 Bldgs.	132	XRF	6/12/97	0	Room	4	Wall	Bthrm Stll	Solid	Metal	0.1
575	1890 & 1959 Bldgs.	34	XRF	6/13/97	0	Room	4	Wall	Midle Wall	Solid	Concrete	0.13
576	1890 & 1959 Bldgs.	35	XRF	6/13/97	0	Room	4	Wall	Midle Wall	Solid	Concrete	0.16
577	1890 & 1959 Bldgs.	36	XRF	6/13/97	0	Room	4	Door	Casing	Solid	Metal	0.04
578	1890 & 1959 Bldgs.	37	XRF	6/13/97	0	Room	4	Door	Door	Solid	Wood	0.16
579	1890 & 1959 Bldgs.	38	XRF	6/13/97	0	Room	4	Wall	Bthrm Stll	Solid	Metal	0.24
580	1890 & 1959 Bldgs.	39	XRF	6/13/97	0	Room	4	Wall	Midle Wall	Solid	Concrete	0
581	1890 & 1959 Bldgs.	39	XRF	6/16/97	1	Room	4	Ceiling		Solid	Concrete	0.01
582	1890 & 1959 Bldgs.	133	XRF	6/12/97	0	Room	5	Wall	Wall	Solid	Concrete	0
583	1890 & 1959 Bldgs.	134	XRF	6/12/97	0	Room	5	Door	Casing	Solid	Metal	0
584	1890 & 1959 Bldgs.	135	XRF	6/12/97	0	Room	5	Door	Door	Solid	Wood	0
585	1890 & 1959 Bldgs.	136	XRF	6/12/97	0	Room	5	Door	Stall Door	Solid	Metal	0
586	1890 & 1959 Bldgs.	137	XRF	6/12/97	0	Room	5		Locker	Solid	Metal	0
587	1890 & 1959 Bldgs.	138	XRF	6/12/97	0	Room	5		Locker	Peeling	Concrete	0.04
588	1890 & 1959 Bldgs.	139	XRF	6/12/97	0	Room	5		Radiator	Solid	Metal	0.04
589	1890 & 1959 Bldgs.	40	XRF	6/13/97	0	Room	5	Door	Casing	Solid	Metal	0.03
590	1890 & 1959 Bldgs.	41	XRF	6/13/97	0	Room	5	Door	Door	Solid	Wood	0.29
591	1890 & 1959 Bldgs.	42	XRF	6/13/97	0	Room	5	Wall	Midle Wall	Solid	Concrete	0.11

Saint Paul Public Schools
 River Front Educational Center
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
592	1890 & 1959 Bldgs.	95	XRF	6/13/97	0	Room	11	Door	Casing	Solid	Metal	0.06
593	1890 & 1959 Bldgs.	96	XRF	6/13/97	0	Room	11	Wall	Midle Wall	Solid	Concrete	0.01
594	1890 & 1959 Bldgs.	97	XRF	6/13/97	0	Room	11	Radiator	Solid	Metal	0.02	
595	1890 & 1959 Bldgs.	98	XRF	6/13/97	0	Room	11	Wall	Solid	Drywall	0	
596	1890 & 1959 Bldgs.	99	XRF	6/13/97	0	Room	11	Door	Door	Solid	Wood	0
597	1890 & 1959 Bldgs.	100	XRF	6/13/97	0	Room	11	Door	Casing	Solid	Metal	0.03
598	1890 & 1959 Bldgs.	101	XRF	6/13/97	0	Room	11	Door	Door	Solid	Wood	0
599	1890 & 1959 Bldgs.	102	XRF	6/13/97	0	Room	11	Door	Casing	Solid	Metal	0
600	1890 & 1959 Bldgs.	103	XRF	6/13/97	0	Room	12	Wall	Midle Wall	Solid	Drywall	0.01
601	1890 & 1959 Bldgs.	104	XRF	6/13/97	0	Room	12	Door	Casing	Solid	Metal	0.04
602	1890 & 1959 Bldgs.	105	XRF	6/13/97	0	Room	12	Door	Door	Solid	Wood	0
603	1890 & 1959 Bldgs.	106	XRF	6/13/97	0	Room	12	Door	Casing	Solid	Metal	0
604	1890 & 1959 Bldgs.	107	XRF	6/13/97	0	Room	12	Door	Door	Solid	Wood	0
605	1890 & 1959 Bldgs.	108	XRF	6/13/97	0	Room	13	Wall	Midle Wall	Solid	Drywall	0
606	1890 & 1959 Bldgs.	109	XRF	6/13/97	0	Room	13	Door	Casing	Solid	Metal	0.05
607	1890 & 1959 Bldgs.	110	XRF	6/13/97	0	Room	13	Wall	Midle Wall	Solid	Concrete	0
608	1890 & 1959 Bldgs.	111	XRF	6/13/97	0	Room	13	Wall	Midle Wall	Solid	Concrete	0.01
609	1890 & 1959 Bldgs.	112	XRF	6/13/97	0	Room	13	Window	Casing	Solid	Metal	0.14
610	1890 & 1959 Bldgs.	113	XRF	6/13/97	0	Room	13	Door	Door	Solid	Wood	0
611	1890 & 1959 Bldgs.	114	XRF	6/13/97	0	Room	14	Wall	Midle Wall	Solid	Drywall	0
612	1890 & 1959 Bldgs.	115	XRF	6/13/97	0	Room	14	Wall	Radiator	Solid	Metal	0.38
613	1890 & 1959 Bldgs.	116	XRF	6/13/97	0	Room	14	Wall	Midle Wall	Solid	Concrete	0.02
614	1890 & 1959 Bldgs.	117	XRF	6/13/97	0	Room	14	Door	Casing	Solid	Metal	0
615	1890 & 1959 Bldgs.	118	XRF	6/13/97	0	Room	14	Door	Casing	Solid	Metal	0
616	1890 & 1959 Bldgs.	119	XRF	6/13/97	0	Room	14	Door	Door	Solid	Wood	0
617	1890 & 1959 Bldgs.	124	XRF	6/13/97	0	Room	15	Wall	Midle Wall	Solid	Concrete	0.14
618	1890 & 1959 Bldgs.	125	XRF	6/13/97	0	Room	15	Door	Casing	Solid	Metal	0
619	1890 & 1959 Bldgs.	126	XRF	6/13/97	0	Room	15	Door	Door	Solid	Wood	0
620	1890 & 1959 Bldgs.	127	XRF	6/13/97	0	Room	15	Door	Door	Solid	Wood	0
621	1890 & 1959 Bldgs.	128	XRF	6/13/97	0	Room	15	Door	Casing	Solid	Metal	0
622	1890 & 1959 Bldgs.	129	XRF	6/13/97	0	Room	15		Radiator	Solid	Metal	0.2
623	1890 & 1959 Bldgs.	130	XRF	6/13/97	0	Room	16	Wall	Midle Wall	Solid	Drywall	0
624	1890 & 1959 Bldgs.	131	XRF	6/13/97	0	Room	16	Door	Casing	Solid	Metal	0
625	1890 & 1959 Bldgs.	132	XRF	6/13/97	0	Room	16	Door	Door	Solid	Wood	0
626	1890 & 1959 Bldgs.	133	XRF	6/13/97	0	Room	16		Radiator	Solid	Metal	0.27
627	1890 & 1959 Bldgs.	134	XRF	6/13/97	0	Room	17	Wall	Midle Wall	Solid	Drywall	0
628	1890 & 1959 Bldgs.	135	XRF	6/13/97	0	Room	17		Radiator	Solid	Metal	0.31
629	1890 & 1959 Bldgs.	136	XRF	6/13/97	0	Room	17	Door	Door	Solid	Wood	0
630	1890 & 1959 Bldgs.	137	XRF	6/13/97	0	Room	17	Door	Casing	Solid	Metal	0
631	1890 & 1959 Bldgs.	138	XRF	6/13/97	0	Room	18	Wall	Midle Wall	Solid	Drywall	0
632	1890 & 1959 Bldgs.	139	XRF	6/13/97	0	Room	18	Door	Casing	Solid	Metal	0.05
633	1890 & 1959 Bldgs.	140	XRF	6/13/97	0	Room	18		Radiator	Solid	Metal	0.29
634	1890 & 1959 Bldgs.	145	XRF	6/13/97	1	Room	19	Wall	Midle Wall	Solid	Drywall	0
635	1890 & 1959 Bldgs.	146	XRF	6/13/97	1	Room	19	Window	Casing	Solid	Metal	0.01
636	1890 & 1959 Bldgs.	147	XRF	6/13/97	1	Room	19	Door	Door	Solid	Wood	0
637	1890 & 1959 Bldgs.	148	XRF	6/13/97	1	Room	19	Door	Casing	Solid	Metal	0.01
638	1890 & 1959 Bldgs.	149	XRF	6/13/97	1	Room	19	Door	Door	Solid	Wood	0
639	1890 & 1959 Bldgs.	150	XRF	6/13/97	1	Room	19	Door	Casing	Solid	Metal	0.04
640	1890 & 1959 Bldgs.	151	XRF	6/13/97	1	Room	19	Wall	Midle Wall	Solid	Concrete	0.02
641	1890 & 1959 Bldgs.	24	XRF	6/13/97	0	Room	20	Door	Casing	Solid	Metal	0.03
642	1890 & 1959 Bldgs.	25	XRF	6/13/97	0	Room	20	Door	Door	Solid	Wood	0.32
643	1890 & 1959 Bldgs.	26	XRF	6/13/97	0	Room	20	Wall	Midle Wall	Solid	Concrete	0.04
644	1890 & 1959 Bldgs.	27	XRF	6/13/97	0	Room	20	Wall	Column	Solid	Concrete	0.14
645	1890 & 1959 Bldgs.	28	XRF	6/13/97	0	Room	20	Wall	Midle Wall	Solid	Concrete	0.14
646	1890 & 1959 Bldgs.	38	XRF	6/16/97	1	Room	20	Ceiling		Solid	Concrete	0.03
647	1890 & 1959 Bldgs.	115	XRF	6/12/97	0	Room	21	Wall	Midle Wall	Solid	Concrete	0.03
648	1890 & 1959 Bldgs.	116	XRF	6/12/97	0	Room	21	Wall	Column	Solid	Concrete	0.08
649	1890 & 1959 Bldgs.	117	XRF	6/12/97	0	Room	21	Door	Casing	Solid	Metal	0.04
650	1890 & 1959 Bldgs.	118	XRF	6/12/97	0	Room	21	Door	Door	Solid	Wood	0

Saint Paul Public Schools
 River Front Educational Center
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
651	1890 & 1959 Bldgs.	198	XRF	6/12/97	1	Room	104	Wall	Midle Wall	Solid	Concrete	0.29
652	1890 & 1959 Bldgs.	199	XRF	6/12/97	1	Room	104		Radiator	Solid	Metal	0.03
653	1890 & 1959 Bldgs.	200	XRF	6/12/97	1	Room	104	Window	Casing	Solid	Metal	0.03
654	1890 & 1959 Bldgs.	201	XRF	6/12/97	1	Room	104	Door	Door	Solid	Wood	0
655	1890 & 1959 Bldgs.	202	XRF	6/12/97	1	Room	104	Wall	Midle Wall	Solid	Drywall	0
656	1890 & 1959 Bldgs.	194	XRF	6/12/97	1	Room	108	Wall	Midle Wall	Solid	Concrete	0
657	1890 & 1959 Bldgs.	195	XRF	6/12/97	1	Room	108	Door	Casing	Solid	Wood	0
658	1890 & 1959 Bldgs.	196	XRF	6/12/97	1	Room	108	Door	Door	Solid	Wood	0
659	1890 & 1959 Bldgs.	197	XRF	6/12/97	1	Room	108	Wall	Midle Wall	Solid	Wood	0
660	1890 & 1959 Bldgs.	159	XRF	6/12/97	1	Room	113	Wall	Midle Wall	Solid	Drywall	0
661	1890 & 1959 Bldgs.	160	XRF	6/12/97	1	Room	113	Door	Door	Solid	Wood	0.19
662	1890 & 1959 Bldgs.	161	XRF	6/12/97	1	Room	113	Door	Casing	Solid	Metal	0.02
663	1890 & 1959 Bldgs.	162	XRF	6/12/97	1	Room	113		Radiator	Solid	Metal	0.06
664	1890 & 1959 Bldgs.	163	XRF	6/12/97	1	Room	113			Solid	Metal	0.03
665	1890 & 1959 Bldgs.	164	XRF	6/12/97	1	Room	113	Wall	Midle Wall	Solid	Concrete	0.64
666	1890 & 1959 Bldgs.	165	XRF	6/12/97	1	Room	113	Wall	Midle Wall	Solid	Concrete	0.57
667	1890 & 1959 Bldgs.	166	XRF	6/12/97	1	Room	113		Radiator	Solid	Metal	0.52
668	1890 & 1959 Bldgs.	167	XRF	6/12/97	1	Room	113	Wall	Midle Wall	Solid	Drywall	0
669	1890 & 1959 Bldgs.	168	XRF	6/12/97	1	Room	113	Door	Casing	Solid	Metal	0
670	1890 & 1959 Bldgs.	169	XRF	6/12/97	1	Room	113	Door	Casing	Solid	Concrete	0.09
671	1890 & 1959 Bldgs.	170	XRF	6/12/97	1	Room	113	Wall	Midle Wall	Solid	Concrete	0.03
672	1890 & 1959 Bldgs.	181	XRF	6/12/97	1	Room	129	Wall	Wall	Solid	Concrete	0.04
673	1890 & 1959 Bldgs.	182	XRF	6/12/97	1	Room	129	Door	Door	Solid	Metal	0.03
674	1890 & 1959 Bldgs.	183	XRF	6/12/97	1	Room	129	Door	Casing	Solid	Metal	0.05
675	1890 & 1959 Bldgs.	184	XRF	6/12/97	1	Room	129	Door	Door	Solid	Wood	0.03
676	1890 & 1959 Bldgs.	185	XRF	6/12/97	1	Room	129	Door	Casing	Solid	Metal	0.02
677	1890 & 1959 Bldgs.	186	XRF	6/12/97	1	Room	129		Casing	Cracked	Concrete	0.11
678	1890 & 1959 Bldgs.	187	XRF	6/12/97	1	Room	129	Door	Casing	Cracked	Metal	0.06
679	1890 & 1959 Bldgs.	188	XRF	6/12/97	1	Room	129	Door	Door	Solid	Metal	0
680	1890 & 1959 Bldgs.	189	XRF	6/12/97	1	Room	129	Wall	Midle Wall	Solid	Drywall	0
681	1890 & 1959 Bldgs.	190	XRF	6/12/97	1	Room	129	Wall	Midle Wall	Solid	Concrete	0
682	1890 & 1959 Bldgs.	191	XRF	6/12/97	1	Room	129	Wall	Midle Wall	Peeling	Concrete	0
683	1890 & 1959 Bldgs.	192	XRF	6/12/97	1	Room	129	Wall	Midle Wall	Peeling	Tile	2.92
684	1890 & 1959 Bldgs.	193	XRF	6/12/97	1	Room	129	Door	Door	Peeling	Wood	0.04
685	1890 & 1959 Bldgs.	14	XRF	6/12/97	2	Room	204	Wall	Midle Wall	Solid	Concrete	0.03
686	1890 & 1959 Bldgs.	15	XRF	6/12/97	2	Room	204	Door	Door	Solid	Wood	0
687	1890 & 1959 Bldgs.	16	XRF	6/12/97	2	Room	204	Door	Casing	Solid	Metal	0.02
688	1890 & 1959 Bldgs.	17	XRF	6/12/97	2	Room	204	Wall	Column	Solid	Concrete	0
689	1890 & 1959 Bldgs.	18	XRF	6/12/97	2	Room	204	Wall	Midle Wall	Solid	Drywall	0
690	1890 & 1959 Bldgs.	19	XRF	6/12/97	2	Room	204	Wall	Midle Wall	Solid	Plaster	0
691	1890 & 1959 Bldgs.	20	XRF	6/12/97	2	Room	204	Door	Casing	Solid	Metal	0.02
692	1890 & 1959 Bldgs.	21	XRF	6/12/97	2	Room	204	Door	Door	Solid	Wood	0
693	1890 & 1959 Bldgs.	66	XRF	6/12/97	2	Room	236	Wall	Midle Wall	Solid	Drywall	0
694	1890 & 1959 Bldgs.	67	XRF	6/12/97	2	Room	236	Door	Casing	Solid	Metal	0.02
695	1890 & 1959 Bldgs.	68	XRF	6/12/97	2	Room	236	Door	Door	Solid	Wood	0
696	1890 & 1959 Bldgs.	69	XRF	6/12/97	2	Room	236	Wall	Midle Wall	Solid	Concrete	0
697	1890 & 1959 Bldgs.	165	XRF	6/11/97	3	Room	300	Wall	Crown Mol	Solid	Wood	0
698	1890 & 1959 Bldgs.	166	XRF	6/11/97	3	Room	300	Wall	Crown Mol	Solid	Wood	0
699	1890 & 1959 Bldgs.	167	XRF	6/11/97	3	Room	300	Wall	Crown Mol	Solid	Wood	0
700	1890 & 1959 Bldgs.	168	XRF	6/11/97	3	Room	300	Wall	Crown Mol	Solid	Wood	0.01
701	1890 & 1959 Bldgs.	169	XRF	6/11/97	3	Room	300	Wall	Crown Mol	Solid	Wood	0.05
702	1890 & 1959 Bldgs.	170	XRF	6/11/97	3	Room	300	Wall	Column	Solid	Concrete	0
703	1890 & 1959 Bldgs.	171	XRF	6/11/97	3	Room	300	Wall	Wall	Solid	Plaster	0
704	1890 & 1959 Bldgs.	172	XRF	6/11/97	3	Room	300	Fence		Solid	Metal	0
705	1890 & 1959 Bldgs.	173	XRF	6/11/97	3	Room	300	Stairs	Hand rail	Solid	Metal	0.01
706	1890 & 1959 Bldgs.	174	XRF	6/11/97	3	Room	300	Wall	Midle Wall	Solid	Drywall	0
707	1890 & 1959 Bldgs.	175	XRF	6/11/97	3	Room	300	Wall	Midle Wall	Solid	Drywall	0
708	1890 & 1959 Bldgs.	176	XRF	6/11/97	3	Room	300	Door	Door	Solid	Metal	0.05
709	1890 & 1959 Bldgs.	177	XRF	6/11/97	3	Room	300		Locker	Solid	Metal	0.01

Saint Paul Public Schools
 River Front Educational Center
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
710	1890 & 1959 Bldgs.	178	XRF	6/11/97	3	Room	300	Door	Casing	Solid	Metal	0.03
711	1890 & 1959 Bldgs.	179	XRF	6/11/97	3	Room	300	Wall	Midle Wall	Solid	Concrete	0
712	1890 & 1959 Bldgs.	180	XRF	6/11/97	3	Room	300	Wall	Wall	Solid	Metal	0.06
713	1890 & 1959 Bldgs.	181	XRF	6/11/97	3	Room	300	Wall	Midle Wall	Solid	Drywall	0
714	1890 & 1959 Bldgs.	182	XRF	6/11/97	3	Room	300	Wall	Wall	Solid	Concrete	0
715	1890 & 1959 Bldgs.	183	XRF	6/11/97	3	Room	300	Door	Door	Solid	Metal	0.02
716	1890 & 1959 Bldgs.	184	XRF	6/11/97	3	Room	300	Door	Casing	Solid	Metal	0.05
717	1890 & 1959 Bldgs.	185	XRF	6/11/97	3	Room	300	Window	Header	Solid	Wood	0
718	1890 & 1959 Bldgs.	186	XRF	6/11/97	3	Room	300		Radiator	Solid	Metal	0.04
719	1890 & 1959 Bldgs.	82	XRF	6/11/97	4	Room	408	Wall	Midle Wall	Solid	Drywall	0
720	1890 & 1959 Bldgs.	83	XRF	6/11/97	4	Room	408	Door	Casing	Solid	Metal	0
721	1890 & 1959 Bldgs.	84	XRF	6/11/97	4	Room	408	Door	Door	Solid	Wood	0
722	1890 & 1959 Bldgs.	85	XRF	6/11/97	4	Room	408	Wall	Wall	Solid	Concrete	0
723	1890 & 1959 Bldgs.	86	XRF	6/11/97	4	Room	408	Window	Header	Solid	Wood	0
724	1890 & 1959 Bldgs.	87	XRF	6/11/97	4	Room	408		Radiator	Solid	Metal	0.16
725	1890 & 1959 Bldgs.	112	XRF	6/11/97	4	Room	418	Wall	Midle Wall	Solid	Drywall	0
726	1890 & 1959 Bldgs.	113	XRF	6/11/97	4	Room	418	Wall	Midle Wall	Solid	Concrete	0.04
727	1890 & 1959 Bldgs.	114	XRF	6/11/97	4	Room	418	Door	Casing	Solid	Metal	0.02
728	1890 & 1959 Bldgs.	115	XRF	6/11/97	4	Room	418	Door	Door	Solid	Wood	0
729	1890 & 1959 Bldgs.	116	XRF	6/11/97	4	Room	418	Wall	Midle Wall	Solid	Concrete	0
730	1890 & 1959 Bldgs.	71	XRF	6/11/97	5	Room	506	Wall	Wall	Solid	Concrete	0.07
731	1890 & 1959 Bldgs.	72	XRF	6/11/97	5	Room	506		Radiator	Solid	Metal	0.04
732	1890 & 1959 Bldgs.	73	XRF	6/11/97	5	Room	506	Window	Header	Solid	Wood	0
733	1890 & 1959 Bldgs.	74	XRF	6/11/97	5	Room	506	Wall	Midle Wall	Solid	Drywall	0
734	1890 & 1959 Bldgs.	67	XRF	6/11/97	5	Room	507	Wall	Midle Wall	Solid	Concrete	0.07
735	1890 & 1959 Bldgs.	68	XRF	6/11/97	5	Room	507	Window	Header	Solid	Wood	0
736	1890 & 1959 Bldgs.	69	XRF	6/11/97	5	Room	507	Wall	Midle Wall	Solid	Drywall	0
737	1890 & 1959 Bldgs.	70	XRF	6/11/97	5	Room	507	Door	Casing	Solid	Metal	0.01
738	1890 & 1959 Bldgs.	61	XRF	6/11/97	5	Room	508	Wall	Midle Wall	Solid	Concrete	0.09
739	1890 & 1959 Bldgs.	62	XRF	6/11/97	5	Room	508	Window	Header	Solid	Wood	0
740	1890 & 1959 Bldgs.	63	XRF	6/11/97	5	Room	508		Radiator	Solid	Metal	0.1
741	1890 & 1959 Bldgs.	64	XRF	6/11/97	5	Room	508	Wall	Midle Wall	Solid	Drywall	0.06
742	1890 & 1959 Bldgs.	65	XRF	6/11/97	5	Room	508	Door	Casing	Solid	Metal	0
743	1890 & 1959 Bldgs.	66	XRF	6/11/97	5	Room	508	Door	Door	Solid	Wood	0
744	1890 & 1959 Bldgs.	55	XRF	6/11/97	5	Room	509	Wall	Midle Wall	Solid	Concrete	0.02
745	1890 & 1959 Bldgs.	56	XRF	6/11/97	5	Room	509		Radiator	Solid	Metal	0.11
746	1890 & 1959 Bldgs.	57	XRF	6/11/97	5	Room	509	Window	Header	Solid	Wood	0
747	1890 & 1959 Bldgs.	58	XRF	6/11/97	5	Room	509	Wall	Midle Wall	Solid	Drywall	0
748	1890 & 1959 Bldgs.	59	XRF	6/11/97	5	Room	509	Door	Casing	Solid	Metal	0
749	1890 & 1959 Bldgs.	60	XRF	6/11/97	5	Room	509	Door	Door	Solid	Wood	0
750	1890 & 1959 Bldgs.	49	XRF	6/11/97	5	Room	510	Wall	Midle Wall	Solid	Concrete	0
751	1890 & 1959 Bldgs.	50	XRF	6/11/97	5	Room	510		Radiator	Solid	Metal	0.1
752	1890 & 1959 Bldgs.	51	XRF	6/11/97	5	Room	510	Window	Header	Solid	Wood	0
753	1890 & 1959 Bldgs.	52	XRF	6/11/97	5	Room	510	Wall	Midle Wall	Solid	Drywall	0.01
754	1890 & 1959 Bldgs.	53	XRF	6/11/97	5	Room	510	Door	Casing	Solid	Metal	0
755	1890 & 1959 Bldgs.	54	XRF	6/11/97	5	Room	510	Door	Door	Solid	Wood	0
756	1890 & 1959 Bldgs.	16	XRF	6/11/97	5	Room	511		Radiator	Solid	Metal	0.06
757	1890 & 1959 Bldgs.	17	XRF	6/11/97	5	Room	511	Window	Header	Solid	Wood	0
758	1890 & 1959 Bldgs.	18	XRF	6/11/97	5	Room	511	Wall	Wall	Solid	Drywall	0.02
759	1890 & 1959 Bldgs.	19	XRF	6/11/97	5	Room	511	Wall	Wall	Solid	Drywall	0
760	1890 & 1959 Bldgs.	20	XRF	6/11/97	5	Room	511	Door	Door	Solid	Metal	0.19
761	1890 & 1959 Bldgs.	21	XRF	6/11/97	5	Room	511	Door	Door	Solid	Wood	0
762	1890 & 1959 Bldgs.	22	XRF	6/11/97	5	Room	511	Door	Casing	Solid	Metal	0.06
763	1890 & 1959 Bldgs.	23	XRF	6/11/97	5	Room	511	Door	Door	Solid	Metal	0
764	1890 & 1959 Bldgs.	24	XRF	6/11/97	5	Room	511	Wall	Midle Wall	Solid	Concrete	0.07
765	1890 & 1959 Bldgs.	25	XRF	6/11/97	5	Room	511		Radiator	Solid	Metal	0.18
766	1890 & 1959 Bldgs.	26	XRF	6/11/97	5	Room	511	Wall	Midle Wall	Solid	Concrete	0.01
767	1890 & 1959 Bldgs.	36	XRF	6/11/97	5	Room	513	Wall	Midle Wall	Solid	Drywall	0
768	1890 & 1959 Bldgs.	37	XRF	6/11/97	5	Room	513	Door	Door	Solid	Wood	0

Saint Paul Public Schools
 River Front Educational Center
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
769	1890 & 1959 Bldgs.	38	XRF	6/11/97	5	Room	513	Door	Casing	Solid	Metal	0
770	1890 & 1959 Bldgs.	39	XRF	6/11/97	5	Room	513	Door	Casing	Solid	Metal	0
771	1890 & 1959 Bldgs.	40	XRF	6/11/97	5	Room	513	Door	Door	Solid	Wood	0
772	1890 & 1959 Bldgs.	44	XRF	6/11/97	5	Room	523	Door	Casing	Solid	Metal	0
773	1890 & 1959 Bldgs.	45	XRF	6/11/97	5	Room	523	Door	Door	Solid	Wood	0
774	1890 & 1959 Bldgs.	46	XRF	6/11/97	5	Room	523	Door	Casing	Solid	Metal	0
775	1890 & 1959 Bldgs.	47	XRF	6/11/97	5	Room	523	Door	Door	Solid	Wood	0
776	1890 & 1959 Bldgs.	48	XRF	6/11/97	5	Room	523	Wall	Midle Wall	Solid	Drywall	0
777	1890 & 1959 Bldgs.	41	XRF	6/11/97	5	Room	524	Wall	Midle Wall	Solid	Drywall	0
778	1890 & 1959 Bldgs.	42	XRF	6/11/97	5	Room	524	Door	Casing	Solid	Metal	0
779	1890 & 1959 Bldgs.	43	XRF	6/11/97	5	Room	524	Door	Door	Solid	Wood	0
780	1890 & 1959 Bldgs.	203	XRF	6/10/97	6	Room	604	Window	Header	Solid	Wood	0
781	1890 & 1959 Bldgs.	204	XRF	6/10/97	6	Room	604		Radiator	Solid	Metal	0.08
782	1890 & 1959 Bldgs.	205	XRF	6/10/97	6	Room	604	Wall	Midle Wall	Solid	Concrete	0.11
783	1890 & 1959 Bldgs.	206	XRF	6/10/97	6	Room	604	Wall	Wall	Solid	Drywall	0
784	1890 & 1959 Bldgs.	207	XRF	6/10/97	6	Room	604	Door	Casing	Solid	Metal	0.3
785	1890 & 1959 Bldgs.	184	XRF	6/10/97	6	Room	608	Window	Header	Solid	Wood	0
786	1890 & 1959 Bldgs.	185	XRF	6/10/97	6	Room	608		Radiator	Solid	Metal	0.05
787	1890 & 1959 Bldgs.	186	XRF	6/10/97	6	Room	608	Wall	Wall	Solid	Drywall	0
788	1890 & 1959 Bldgs.	187	XRF	6/10/97	6	Room	608	Door	Door	Solid	Wood	0
789	1890 & 1959 Bldgs.	188	XRF	6/10/97	6	Room	608	Door	Casing	Solid	Metal	0.27
790	1890 & 1959 Bldgs.	172	XRF	6/10/97	6	Room	610	Wall	Midle Wall	Solid	Drywall	0
791	1890 & 1959 Bldgs.	173	XRF	6/10/97	6	Room	610	Window	Header	Solid	Wood	0
792	1890 & 1959 Bldgs.	174	XRF	6/10/97	6	Room	610	Wall	Midle Wall	Solid	Concrete	0.14
793	1890 & 1959 Bldgs.	175	XRF	6/10/97	6	Room	610	Window	Header	Solid	Wood	0
794	1890 & 1959 Bldgs.	176	XRF	6/10/97	6	Room	610	Door	Casing	Solid	Metal	0.21
795	1890 & 1959 Bldgs.	177	XRF	6/10/97	6	Room	610	Door	Door	Solid	Wood	0
796	1890 & 1959 Bldgs.	160	XRF	6/10/97	6	Room	612	Wall	Midle Wall	Solid	Drywall	0
797	1890 & 1959 Bldgs.	161	XRF	6/10/97	6	Room	612	Door	Door	Solid	Wood	0
798	1890 & 1959 Bldgs.	162	XRF	6/10/97	6	Room	612	Door	Casing	Solid	Metal	0
799	1890 & 1959 Bldgs.	163	XRF	6/10/97	6	Room	612	Wall	Wall	Solid	Concrete	0.07
800	1890 & 1959 Bldgs.	164	XRF	6/10/97	6	Room	612		Radiator	Solid	Metal	0.1
801	1890 & 1959 Bldgs.	165	XRF	6/10/97	6	Room	612	Window	Header	Solid	Wood	0
802	1890 & 1959 Bldgs.	119	XRF	6/10/97	7	Room	704	Wall	Wall	Solid	Drywall	0
803	1890 & 1959 Bldgs.	120	XRF	6/10/97	7	Room	704	Wall	Midle Wall	Solid	Concrete	0.1
804	1890 & 1959 Bldgs.	121	XRF	6/10/97	7	Room	704	Window	Header	Solid	Wood	0
805	1890 & 1959 Bldgs.	122	XRF	6/10/97	7	Room	704		Radiator	Solid	Metal	0.06
806	1890 & 1959 Bldgs.	123	XRF	6/10/97	7	Room	704	Door	Door	Solid	Wood	0
807	1890 & 1959 Bldgs.	124	XRF	6/10/97	7	Room	704	Door	Casing	Solid	Metal	0.22
808	1890 & 1959 Bldgs.	108	XRF	6/10/97	7	Room	708	Wall	Midle Wall	Solid	Concrete	0.17
809	1890 & 1959 Bldgs.	109	XRF	6/10/97	7	Room	708		Radiator	Solid	Metal	0.1
810	1890 & 1959 Bldgs.	110	XRF	6/10/97	7	Room	708	Window	Header	Solid	Wood	0
811	1890 & 1959 Bldgs.	111	XRF	6/10/97	7	Room	708	Door	Casing	Solid	Metal	0.14
812	1890 & 1959 Bldgs.	112	XRF	6/10/97	7	Room	708	Door	Door	Solid	Wood	0
813	1890 & 1959 Bldgs.	96	XRF	6/10/97	7	Room	710	Wall	Midle Wall	Solid	Drywall	0
814	1890 & 1959 Bldgs.	97	XRF	6/10/97	7	Room	710	Wall	Wall	Solid	Concrete	0.12
815	1890 & 1959 Bldgs.	98	XRF	6/10/97	7	Room	710	Window	Header	Solid	Wood	0
816	1890 & 1959 Bldgs.	99	XRF	6/10/97	7	Room	710		Radiator	Solid	Metal	0.06
817	1890 & 1959 Bldgs.	100	XRF	6/10/97	7	Room	710	Door	Casing	Solid	Metal	0.17
818	1890 & 1959 Bldgs.	101	XRF	6/10/97	7	Room	710	Door	Door	Solid	Wood	0
819	1890 & 1959 Bldgs.	84	XRF	6/10/97	7	Room	712	Wall	Midle Wall	Solid	Drywall	0
820	1890 & 1959 Bldgs.	85	XRF	6/10/97	7	Room	712	Wall	Midle Wall	Solid	Concrete	0.19
821	1890 & 1959 Bldgs.	86	XRF	6/10/97	7	Room	712	Window	Header	Solid	Wood	0
822	1890 & 1959 Bldgs.	87	XRF	6/10/97	7	Room	712		Radiator	Solid	Metal	0.04
823	1890 & 1959 Bldgs.	88	XRF	6/10/97	7	Room	712	Door	Casing	Solid	Metal	0.03
824	1890 & 1959 Bldgs.	89	XRF	6/10/97	7	Room	712	Door	Door	Solid	Wood	0
825	1890 & 1959 Bldgs.	10	XRF	6/16/97	8	Room	804	Ceiling		Solid	Plaster	0.08
826	1890 & 1959 Bldgs.	11	XRF	6/16/97	8	Room	808	Ceiling		Solid	Plaster	0.01
827	1890 & 1959 Bldgs.	18	XRF	6/10/97	8	Room	810	Wall	Midle Wall	Solid	Drywall	0

Saint Paul Public Schools
 River Front Educational Center
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
828	1890 & 1959 Bldgs.	19	XRF	6/10/97	8	Room	810	Wall	Midle Wall	Solid	Concrete	0.04
829	1890 & 1959 Bldgs.	20	XRF	6/10/97	8	Room	810		Radiator	Solid	Metal	0.04
830	1890 & 1959 Bldgs.	21	XRF	6/10/97	8	Room	810	Window	Header	Solid	Wood	0
831	1890 & 1959 Bldgs.	22	XRF	6/10/97	8	Room	810	Door	Door	Solid	Wood	0
832	1890 & 1959 Bldgs.	9	XRF	6/16/97	8	Room	810	Ceiling		Solid	Plaster	0.01
833	1890 & 1959 Bldgs.	8	XRF	6/16/97	8	Room	811	Ceiling		Solid	Plaster	0.09
834	1890 & 1959 Bldgs.	6	XRF	6/10/97	8	Room	812	Wall	Midle Wall	Solid	Plaster	0
835	1890 & 1959 Bldgs.	7	XRF	6/10/97	8	Room	812	Door	Casing	Solid	Metal	0.04
836	1890 & 1959 Bldgs.	8	XRF	6/10/97	8	Room	812	Door	Door	Solid	Wood	0
837	1890 & 1959 Bldgs.	9	XRF	6/10/97	8	Room	812	Wall	Midle Wall	Solid	Concrete	0.05
838	1890 & 1959 Bldgs.	10	XRF	6/10/97	8	Room	812		Radiator	Solid	Metal	0.08
839	1890 & 1959 Bldgs.	11	XRF	6/10/97	8	Room	812	Window	Header	Solid	Wood	0
840	1890 & 1959 Bldgs.	6	XRF	6/16/97	8	Room	812	Ceiling		Solid	Plaster	0.02
841	1890 & 1959 Bldgs.	6	XRF	6/11/97	5	Room	511A	Wall	Midle Wall	Solid	Wood	0
842	1890 & 1959 Bldgs.	7	XRF	6/11/97	5	Room	511A	Wall	Midle Wall	Solid	Drywall	0
843	1890 & 1959 Bldgs.	8	XRF	6/11/97	5	Room	511A	Door	Casing	Solid	Metal	0
844	1890 & 1959 Bldgs.	9	XRF	6/11/97	5	Room	511A	Door	Door	Solid	Wood	0
845	1890 & 1959 Bldgs.	10	XRF	6/11/97	5	Room	511A	Wall	Midle Wall	Solid	Concrete	0.09
846	1890 & 1959 Bldgs.	11	XRF	6/11/97	5	Room	511A		Radiator	Solid	Metal	0.07
847	1890 & 1959 Bldgs.	12	XRF	6/11/97	5	Room	511A	Window	Header	Solid	Wood	0
848	1890 & 1959 Bldgs.	13	XRF	6/11/97	5	Room	511A	Door	Casing	Solid	Metal	0
849	1890 & 1959 Bldgs.	14	XRF	6/11/97	5	Room	511A	Door	Door	Solid	Wood	0
850	1890 & 1959 Bldgs.	15	XRF	6/11/97	5	Room	511A	Wall	Midle Wall	Solid	Concrete	0.14
851	1890 & 1959 Bldgs.	26	XRF	6/16/97	6	Stairwell	1	Ceiling		Solid	Plaster	0.03
852	1890 & 1959 Bldgs.	74	XRF	6/13/97	1	Stairwell	2	Door	Door	Solid	Metal	0
853	1890 & 1959 Bldgs.	75	XRF	6/13/97	1	Stairwell	2	Door	Casing	Solid	Metal	0.03
854	1890 & 1959 Bldgs.	76	XRF	6/13/97	1	Stairwell	2	Stairs	Hand rail	Solid	Metal	0
855	1890 & 1959 Bldgs.	77	XRF	6/13/97	1	Stairwell	2	Stairs	Wall	Solid	Concrete	0.06
856	1890 & 1959 Bldgs.	78	XRF	6/13/97	1	Stairwell	2	Stairs	Baseboard	Solid	Metal	0.02
857	1890 & 1959 Bldgs.	79	XRF	6/13/97	1	Stairwell	2	Stairs	Wall	Solid	Wood	0
858	1890 & 1959 Bldgs.	80	XRF	6/13/97	1	Stairwell	2	Ceiling		Solid	Plaster	0
859	1890 & 1959 Bldgs.	81	XRF	6/13/97	1	Stairwell	3	Wall	Midle Wall	Solid	Concrete	0.07
860	1890 & 1959 Bldgs.	82	XRF	6/13/97	1	Stairwell	3	Door	Door	Solid	Wood	0.01
861	1890 & 1959 Bldgs.	83	XRF	6/13/97	1	Stairwell	3	Stairs	Hand rail	Solid	Metal	0
862	1890 & 1959 Bldgs.	84	XRF	6/13/97	1	Stairwell	3		Radiator	Solid	Metal	0
863	1890 & 1959 Bldgs.	85	XRF	6/13/97	1	Stairwell	3	Stairs	Wall	Solid	Wood	0.08
864	1890 & 1959 Bldgs.	86	XRF	6/13/97	1	Stairwell	3	Door	Casing	Solid	Metal	0
865	1890 & 1959 Bldgs.	87	XRF	6/13/97	1	Stairwell	3	Wall	Midle Wall	Solid	Drywall	0

APPENDIX B

LABORATORY SAMPLE ANALYSIS DATA

LABORATORY ANALYSIS REPORT**DATE:** August 8, 1997**PAGE:**

1 Of 1

CLIENT: Midwest Environmental Cons.
5385 401st Ave. NW
Dalbo, MN 55017**PROJECT NO.:** 072397-200888
COLLECTION DATE: 7/13/97
COLLECTED BY: Client
RECEIVED DATE: 7/23/97
PROJECT DESCRP.: 62/0197AI**CONTACT:** Richard Cox

<u>SAMPLE #</u>	<u>DESCP.</u>	<u>MDL</u>	<u>LEAD</u> (6010A)	<u>ANALYSIS</u>
			<u>RESULTS</u>	
L974835-1	PC-1	34	3700	8/08/97
L974835-2	PC-2	49	ND	8/08/97
L974835-3	PC-3	27	560	8/08/97
L974835-4	PC-4	27	1100	8/08/97
L974835-5	PC-5	17	520	8/08/97
L974835-6	PC-6	15	330	8/08/97
L974835-7	PC-7	22	9900	8/08/97
L974835-8	PC-8	26	2200	8/08/97
L974835-9	PC-9	31	6500	8/08/97


ND means Not Detected or below reported MDL

MDL means Method Detection Limit

mg/kg means Milligrams Per Kilogram which is equivalent to Parts Per Million (ppm)

This report has been reviewed by me for technical accuracy and completeness. The analyses were performed using EPA or other approved methodologies and the results were reported on an "as received" basis unless otherwise noted. Organic soil analyses were reported on a dry weight basis. The results reported relate only to the items tested. Please contact me if you have any questions or comments regarding this report. Spectrum Labs, Inc. appreciates the opportunity to provide this analytical service for you.

Report Submitted By,

Thomas L. Halverson
Laboratory ManagerTLH:wmc
mec220-1

As a mutual protection, all reports are submitted in confidentiality and may not be reproduced except in full without written authorization.



A member of The Marmon Group of Companies



Midwest Environmental Consulting, L.L.C.
5385 401st Ave. NW, Dalbo, MN 55017

5385 401st Ave. NW, Dalbo, MN 55017
612-689-3612/612-757-5541/FAX-612-689-5209
Client Address

Client Address _____
Contact Richard Cox

CHAIN OF CUSTODY RECORD

CHINON CUSTOM RE
Project Number 62-0197 ALT

Project Number 842011-11
Client St Paul Public Schools

Client _____
Project _____

Phone/Fax

Sample ID	Sample Description	Collection Date/Time	Matrix (Vol./Area)	Analysis Requested
PC-1	Side B white metal Radiator	6-13-97	~ 1 in ²	Pb in ppm
PC-2	Side B blue metal Radiator	6-13-97	~ 1 in ²	Pb in ppm
PC-3	Side C white metal Radiator	6-13-97	~ 1 in ²	Pb in ppm
PC-4	Side D gray metal Radiator	6-13-97	~ 1 in ²	Pb in ppm
PC-5	Side B blue radiator	6-13-97	~ 1 in ²	Pb in ppm
PC-6	Side B blue metal Radiator	6-13-97	~ 1 in ²	Pb in ppm
PC-7	Side A blue metal Radiator	6-13-97	~ 1 in ²	Pb in ppm
PC-8	Side A tan metal Radiator	6-13-97	~ 1 in ²	Pb in ppm
PC-9	Side A outside door metal frame	6-16-97	~ 1 in ²	Pb in ppm

Sampled By SG Date: 9/26/13 Time: 10:15 AM

Received By: _____ Date: _____ Time: _____

Received By Lab: B. B. Date: 7/23 Time: 1:51

Notes:
PC = Paint Chip

Disposition of Samples

APPENDIX C

INSPECTOR

Bob Hargrove
MDH Lead Inspector # 416