


Midwest  
Environmental  
Consulting, L.L.C.

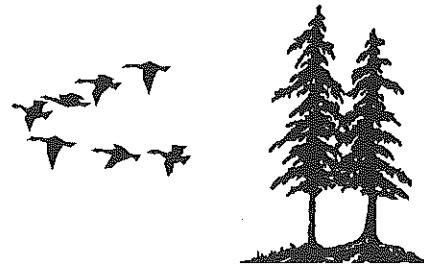

 Printed on Recycled Paper

**Galtier Magnet  
Saint Paul Public Schools**

**Lead-Based Paint Inspection**

**Inspection Dates: 8/4/97, 8/5/97, 8/19/97, 8/25/97, 9/4/97**

**submitted to:**

**Saint Paul Public Schools**

**MEC Project # 62/0197AJ**

## INTRODUCTION

At the request of Saint Paul Public Schools Environmental Safety Department, Midwest Environmental Consulting, L.L.C. (MEC), conducted a lead-based paint inspection at Galtier Magnet, 1317 Charles Ave., St. Paul, MN. The purpose of this inspection was to identify lead-based painted, varnished, or otherwise coated building components on the interior and exterior of the school building.

The inspection protocol incorporated applicable portions of the U.S. Department of Housing and Urban Development (HUD) *Guidelines for the Evaluation and Control of Lead-based Paint Hazards in Housing* (HUD Guidelines, June 1995) and OSHA 1926.62 requirements (Lead in Construction). The HUD guidelines are formulated to guide agencies in conducting random sampling of the interiors and exteriors of dwellings and common areas in public housing. The OSHA requirement is designed to minimize worker exposure when working with material containing lead.

Confirmatory testing was conducted when inconclusive XRF results were encountered. Inconclusive refers to XRF readings less than 0.2 mg/cm<sup>2</sup> (milligrams per square centimeter). Inconclusive results were confirmed with laboratory analysis of paint chip samples (Appendix B). This report contains a list of such results.

The United States Environmental Protection Agency defines "lead-based paint" as a paint or other surface coating that contains lead equal to or in excess of 1.0 milligrams per square centimeter when analyzed by XRF or more than 0.5% by weight (5000 parts per million) by laboratory analysis of a bulk sample.

Minnesota Department of Labor and Industry (MN OSHA) adopted the EPA lead levels for the purpose of enforcing OSHA 1926.62 federal regulations. Detection of lead in dried paint film by XRF is a dependable indicator of levels of lead and is accepted by MN OSHA.

For this Saint Paul Public Schools Lead Inspection, all building components were tested on site using a Niton XL® X-ray Fluorescence Spectrum Analyzer<sup>(1)</sup>. Building components included walls, ceilings, floors, moldings, window and door components, door surfaces, and miscellaneous features such as shelves or bookcases. Only painted or glazed surfaces or surfaces which were varnished were tested. Suspended ceilings, structural steel, and corrugated decking were not included in the inspection. Neither anodized (e.g., window sashes) nor plastic (e.g., vinyl baseboard and vinyl mini-blinds) were included in the scope of this inspection.

---

<sup>(1)</sup> This is a portable hand held machine that can analyze building components instantly for lead concentrations.

Each building was divided into unique sites based on the year of construction or renovation. Portable classrooms, playgrounds, and other detached buildings were automatically designated as a unique site. Each site was inspected independently assuming differences in painting history and construction characteristics.

## SITE DESCRIPTION AND BUILDING HISTORY

According to information provided to MEC by Saint Paul Public Schools, Galtier Magnet was constructed in essentially one phase. This phase (site 1) is a 71,500 square-foot section that dates from 1974.

All room and area designations used in this report are depicted on sampling maps found in Appendix A.

## XRF SAMPLE RESULTS TABLE

The results of all samples analyzed are listed in the table at the end of this section. The following is a description of the column headings:

<b>Site</b>	Each school is divided into sites based on their unique construction characteristics. Each site has a unique date of construction or major renovation.
<b>Sample #</b>	Each sample taken was given a unique number to identify the type and location of the sample. The sampling date is an integral part of the sample number.
<b>Analysis</b>	This defines the type of analysis which can be categorized into two types:  1) XRF: This is an on-site analysis using a hand held Niton XL® X-ray Fluorescence Spectrum Analyzer; 2) Bulk or Chip: This is a bulk sample where paint is removed from the substrate and sent to a laboratory for analysis;
<b>Floor</b>	This is the level of the building in which the area tested was found, example, 1 (first floor), 0 (basement), etc.
<b>Area</b>	This further defines the specific functional space inspected such as a classroom, exterior, playground, gym, kitchen, etc.

<b>Room #</b>	This is typically the actual number on the room as identified at the building.
<b>Component</b>	Building "components" included walls, ceilings, floors, moldings, window and door components, door surfaces, and miscellaneous features such as shelves or bookcases.
<b>Feature</b>	Identifies more detailed information of the component.
<b>Condition</b>	This describes condition of the surface, whether it is intact, cracked, peeling, or chalking.
<b>Substrate</b>	This refers to the material the building component is made of (wood, concrete, drywall, metal, etc.).
<b>Result</b>	This is the analysis results for lead. Less than 1.0 mg/cm <sup>2</sup> or less than 0.5% by weight is considered to be non-lead and these building components are below the action levels of EPA and HUD. (All results are in mg/cm <sup>2</sup> except where noted.)

The table of results is designed for quick information on lead concentrations of tested building components. Generally, all repetitions of a test combination within a given room or area, may be assumed to contain similar concentrations of lead to that of the tested sample. For instance, the lead concentration of a tested wooden window sash was found to be above the action level of 1.0 mg/cm<sup>2</sup> in a given classroom. The classroom has five windows, all of wood, the same color and appearing to be of the same era. It can be assumed that the remaining four wooden window sashes each contain lead above the action limit.

Other columns identify the component and the component feature tested, condition of the component, type of substrate and the result of the analytical test.

As an example, the following illustration shows that the wooden door jamb in Room 123, first floor in the 1923 building section was in good, solid condition, and had an XRF test result of 0.3 mg/cm<sup>2</sup>, which is below the action level.

#### Illustration Only

Site	Sample #	Date	Analysis	Floor	Area	Room #	Component	Feature	Condition	Substrate	Results
1923 Bldg.	52		XRF	1	Room	123	Door	Jamb	Solid	Wood	0.3

In a similar manner, the table shows that the plaster walls in room 23, on the second floor has peeling paint with more than 1.0 mg/cm<sup>2</sup> (shaded).

**ILLUSTRATION ONLY**

Site	Sample #	Date	Analysis	Floor	Area	Room #	Component	Feature	Condition	Substrate	Results
1910 Bldg.	16		XRF	2	Room	23	Door	Jamb	Peeling	Wood	0.25
1910 Bldg.	17		XRF	2	Room	23	Wall	Wall	Peeling	Plaster	1.2
1910 Bldg.	18		XRF	2	Room	23	Ceiling	Peeling	Plaster		0.25
1910 Bldg.	19		XRF	2	Room	23	Wall	Baseboard	Peeling	Wood	0.002

**APPLICABLE REGULATIONS**


When building components test above 1.0 mg/cm<sup>2</sup> of lead by XRF or 0.5% lead by weight from laboratory analysis all employees and contractors who will be working with these components in a construction related activity must be notified. The requirements of OSHA 1926.62, Lead in Construction are enforceable. This regulation defines construction work as "work for construction, alteration and/or repair, including painting and decorating." This regulation further defines monitoring requirements to minimize employee exposure to lead during construction activities.

When work is performed on external painted building structures (i.e. flashing, fire escapes, playground equipment, handrails, etc.), regulations of the Minnesota Pollution Control Agency (MPCA) may also be applicable. For removal of lead based paint from steel structures, MN Rules 7025.0200 - 7025.0380 apply to steel materials on the exterior of a building, or on the property when levels exceed 0.5 mg/cm<sup>2</sup> based on the average of three XRF spectrum results of the sample tested, or 5,000 ppm by laboratory analysis. If it is other than a steel surface, then MPCA regulates the painted surfaces under MN Rules 7025.010 - 7025.0080, when surfaces are to be disturbed using abrasive blasting methods.

Please contact MEC directly if you have questions about any portion of this report or the lead-based paint inspection itself.

# **APPENDIX A**

## **XRF TESTING DATA WITH LOCATION MAPS**

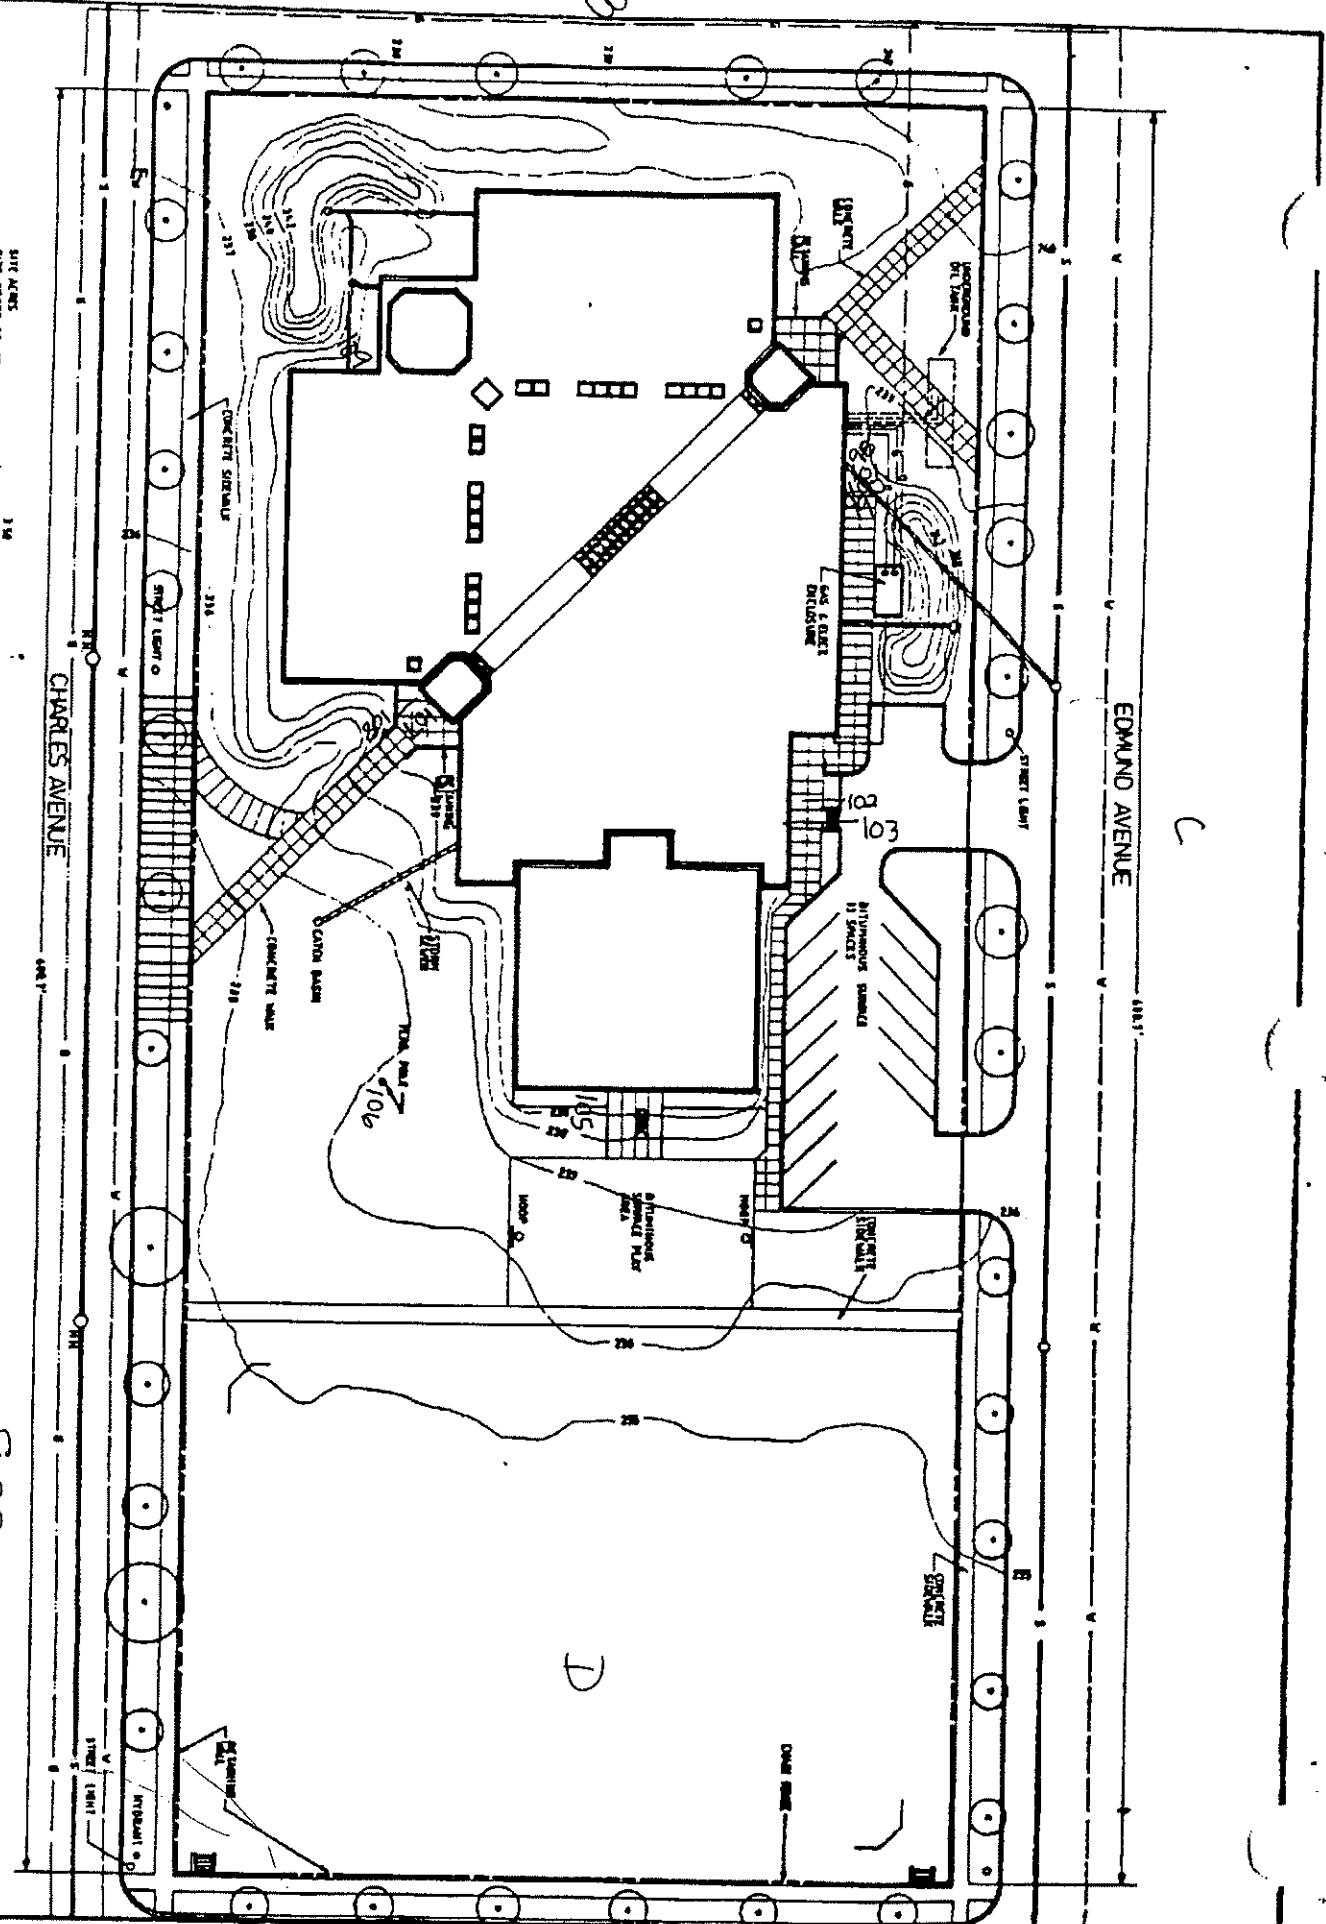


INDEPENDENT SCHOOL DIST. #625  
360 COLBORNE STREET  
ST. PAUL, MINNESOTA 55102

GALTIER ELEMENTARY SCHOOL  
1327 CHARLES AVENUE  
ST. PAUL, MINNESOTA

CONSTRUCTED: 1974

4

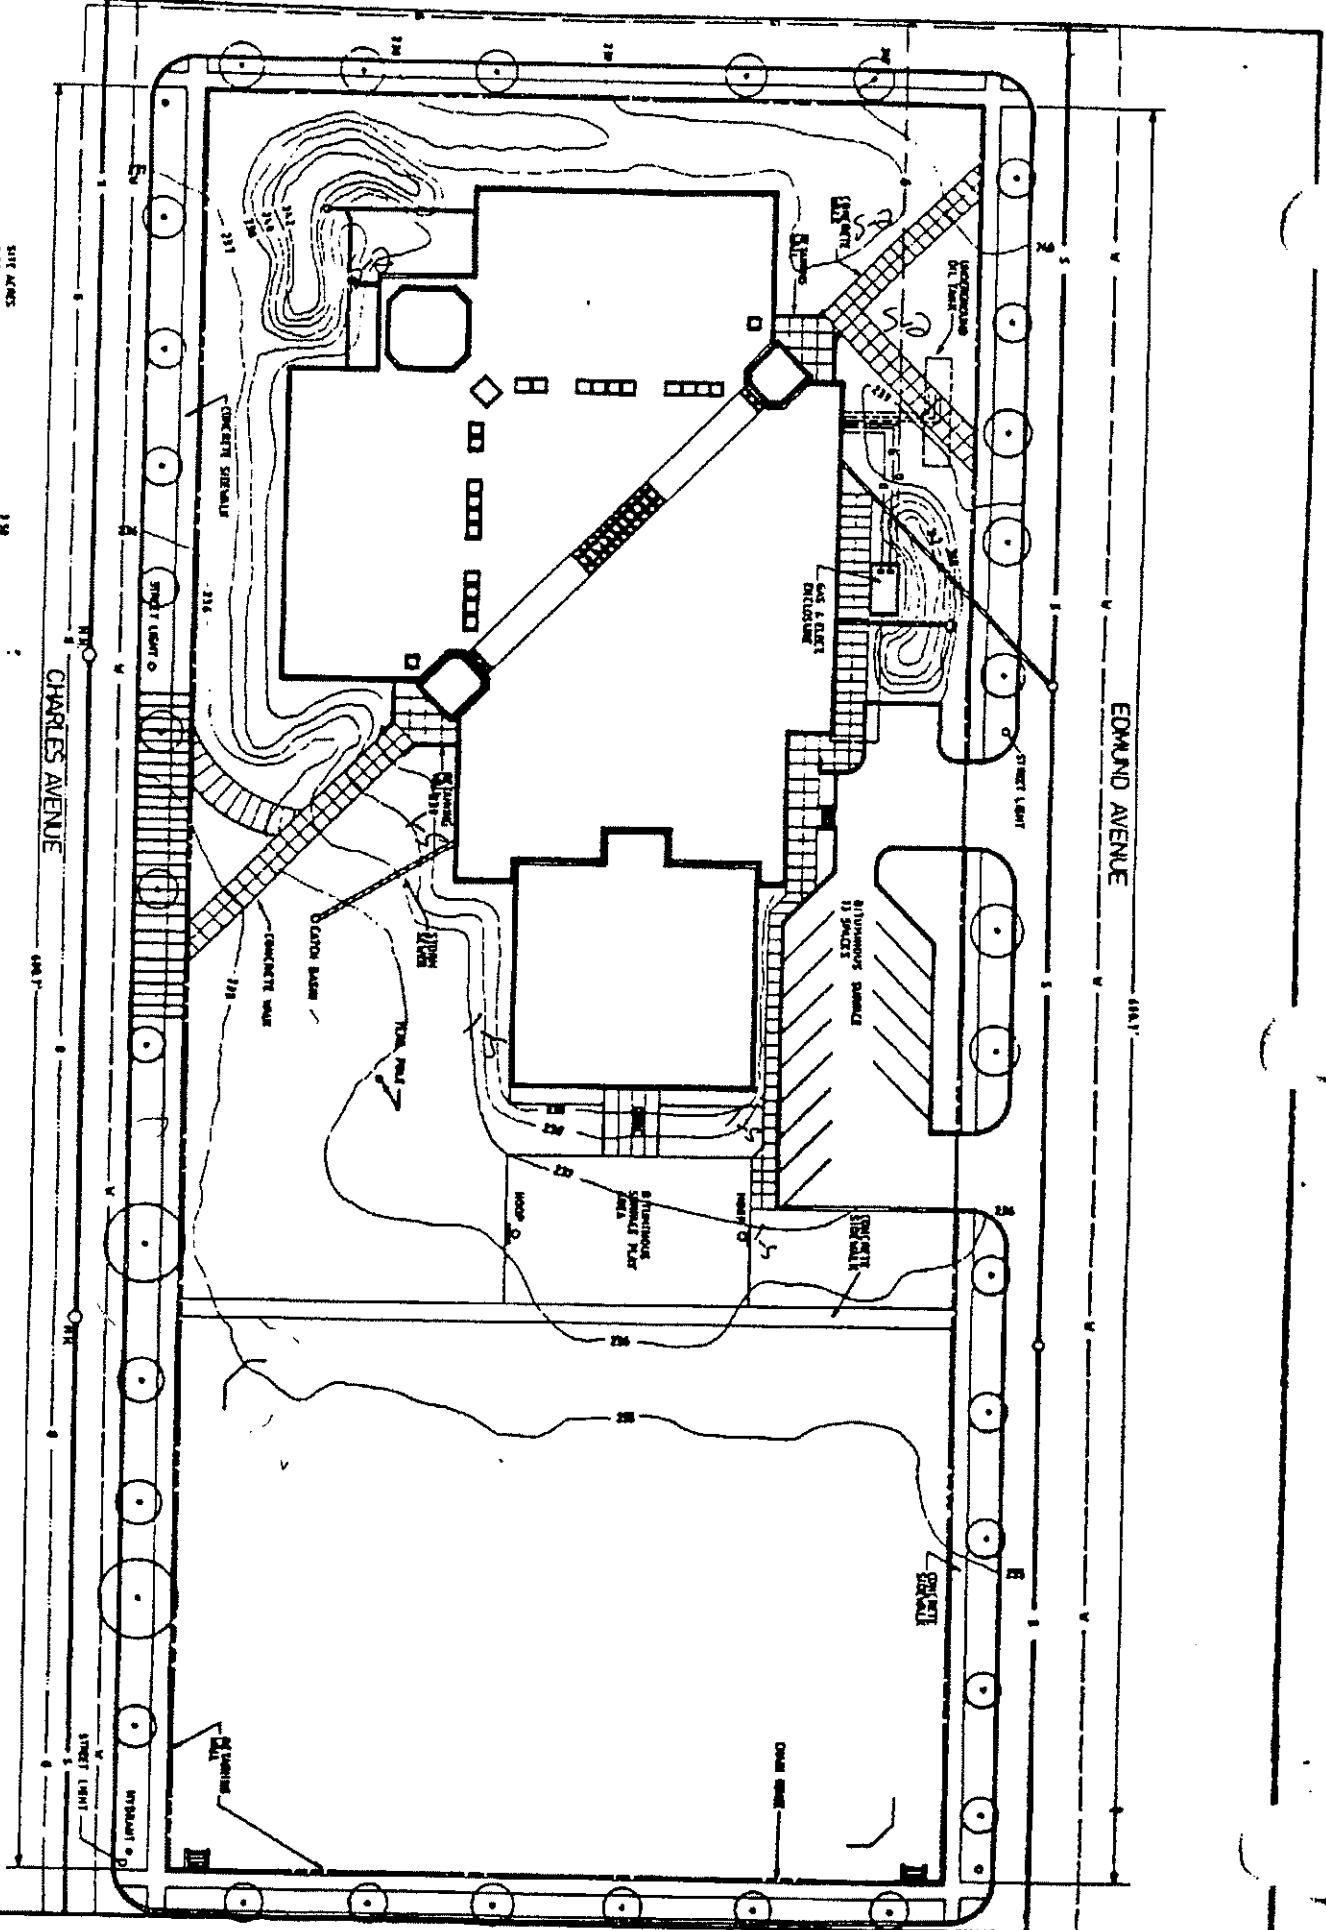

CHARLES AVENUE

EDMUND AVENUE

ON

ON

STREET LAMP

STREET LAMP

HYDRANT

HYDRANT

DRIVEWAY

DRIVEWAY

WATER

WATER

SEWER

SEWER

POWER

POWER

TELEPHONE

TELEPHONE

WINDSHIELD WIPER

WINDSHIELD WIPER

WATER

WATER

SEWER

SEWER

POWER

POWER

TELEPHONE

TELEPHONE

WINDSHIELD WIPER

WINDSHIELD WIPER

WATER

WATER

SEWER

SEWER

POWER

POWER

TELEPHONE

TELEPHONE

WINDSHIELD WIPER

WINDSHIELD WIPER

WATER

WATER

SEWER

SEWER

POWER

POWER

TELEPHONE

TELEPHONE

WINDSHIELD WIPER

WINDSHIELD WIPER

WATER

WATER

SEWER

SEWER

POWER

POWER

TELEPHONE

TELEPHONE

WINDSHIELD WIPER

WINDSHIELD WIPER

WATER

WATER

SEWER

SEWER

POWER

POWER

TELEPHONE

TELEPHONE

WINDSHIELD WIPER

WINDSHIELD WIPER

WATER

WATER

SEWER

SEWER

POWER

POWER

TELEPHONE

TELEPHONE

WINDSHIELD WIPER

WINDSHIELD WIPER

WATER

WATER

SEWER

SEWER

POWER

POWER

TELEPHONE

TELEPHONE

WINDSHIELD WIPER

WINDSHIELD WIPER

WATER

WATER

SEWER

SEWER

POWER

POWER

TELEPHONE

TELEPHONE

WINDSHIELD WIPER

WINDSHIELD WIPER

WATER

WATER

SEWER


SEWER

POWER

POWER

TELEPHONE

TE

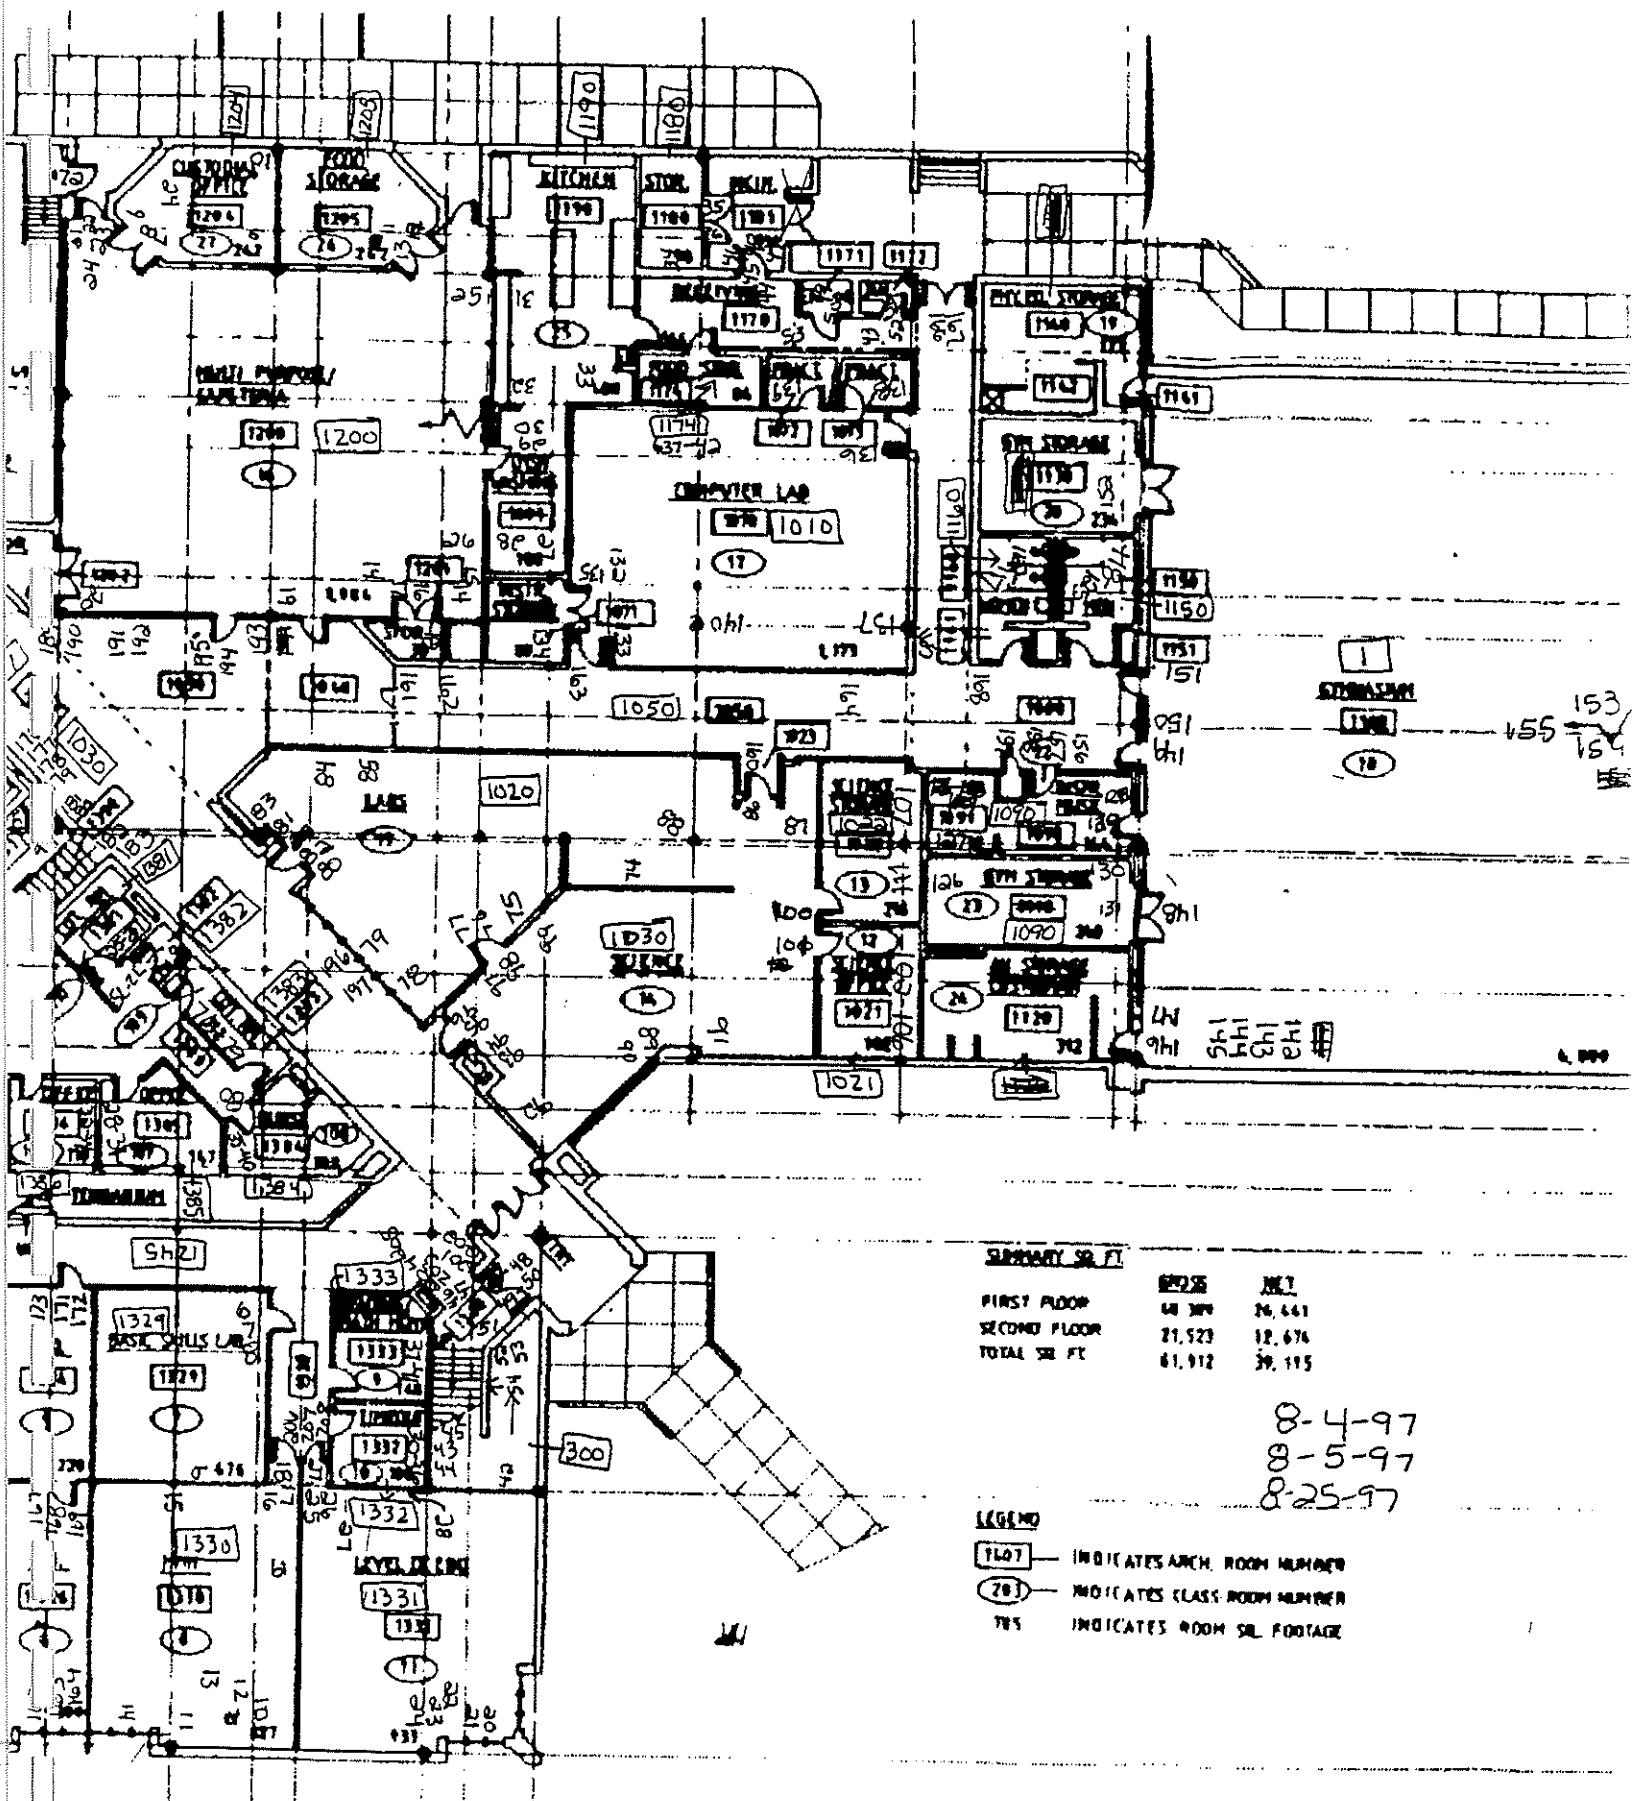

#### SUMMARY SQ. FT.

FIRST FLOOR  
SECOND FLOOR  
TOTAL SQ. FT.


1325	NET
44,394	26,641
21,523	12,674
<b>61,912</b>	<b>39,315</b>

8-4-97  
8-5-97  
8-25-97


#### LEGEND

- [FLOT] INDICATES ARCH. ROOM NUMBERS
- [ZOT] INDICATES CLASS ROOM NUMBER
- [TFS] INDICATES ROOM SFL FOOTAGE

FIRST FLOOR PLAN

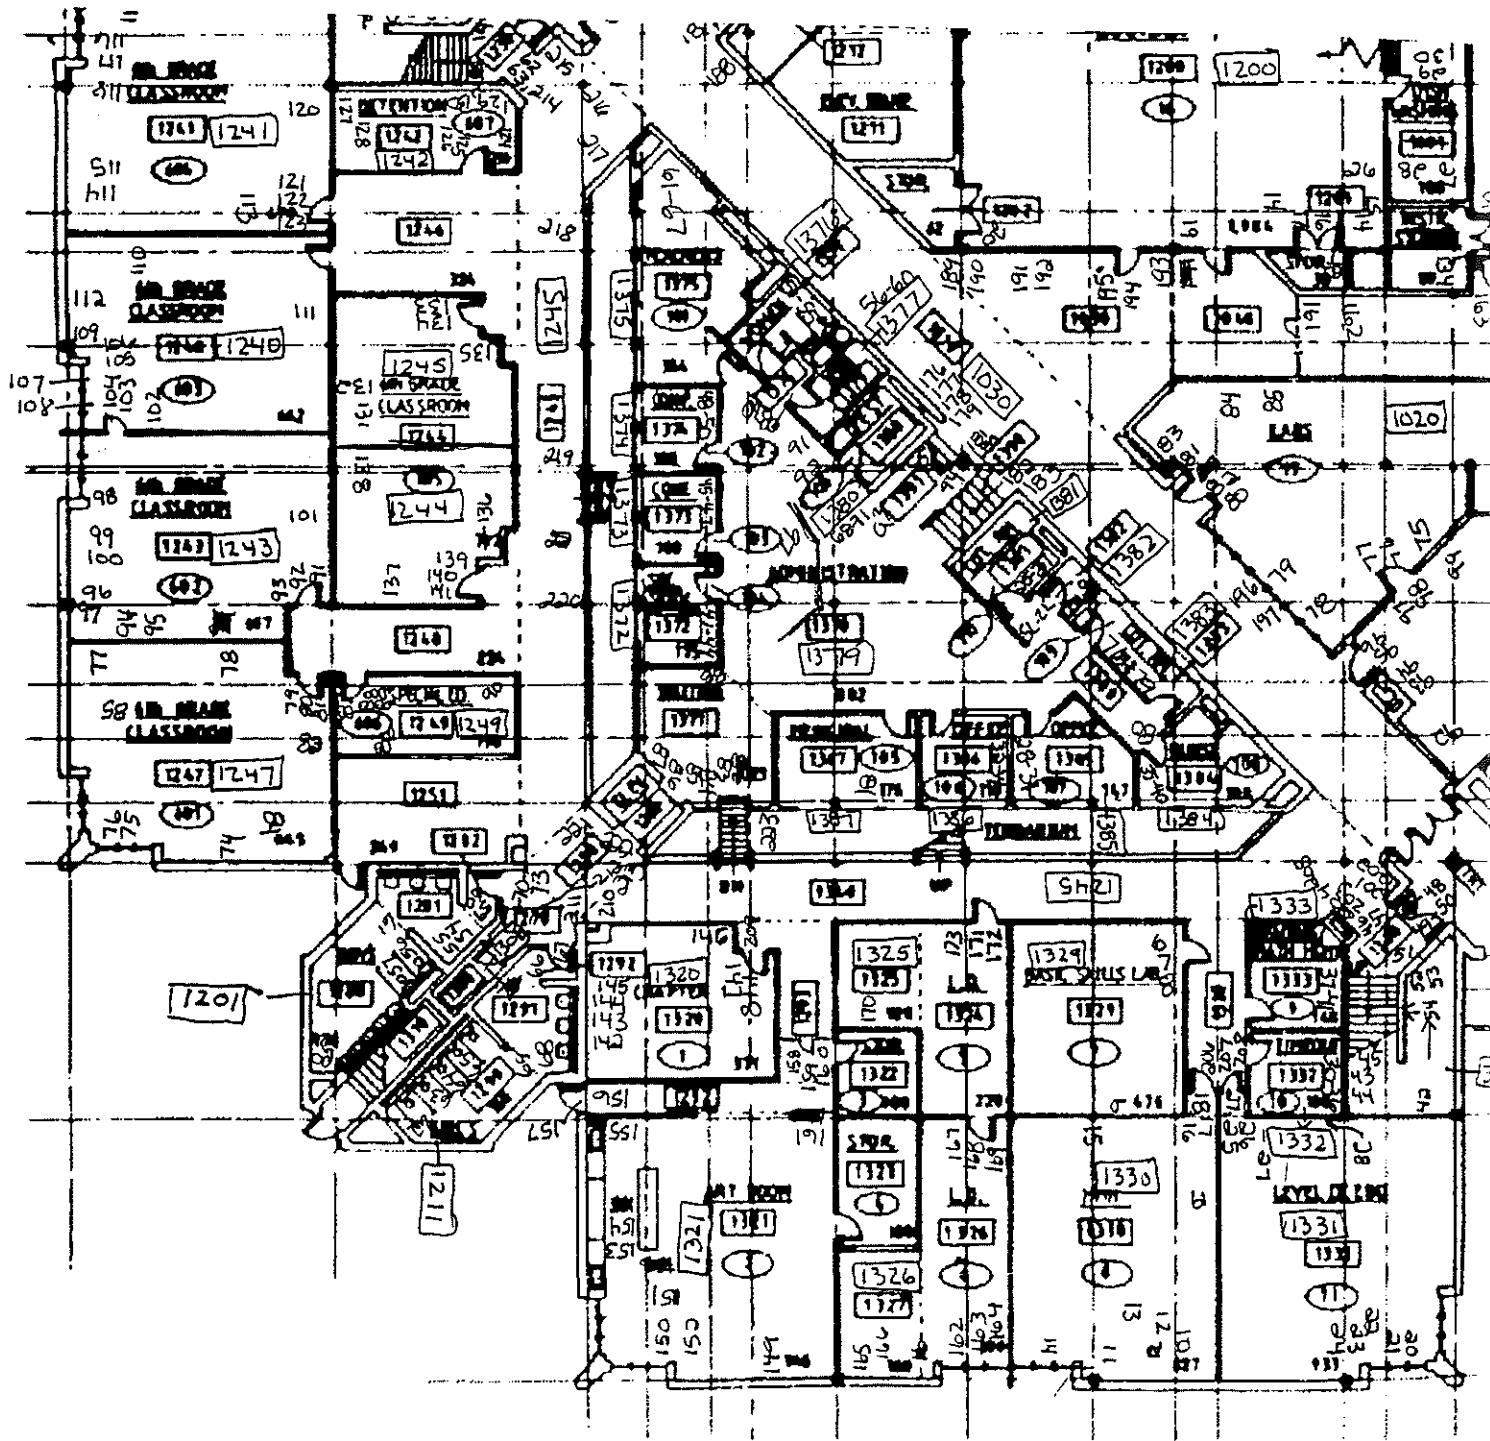

A

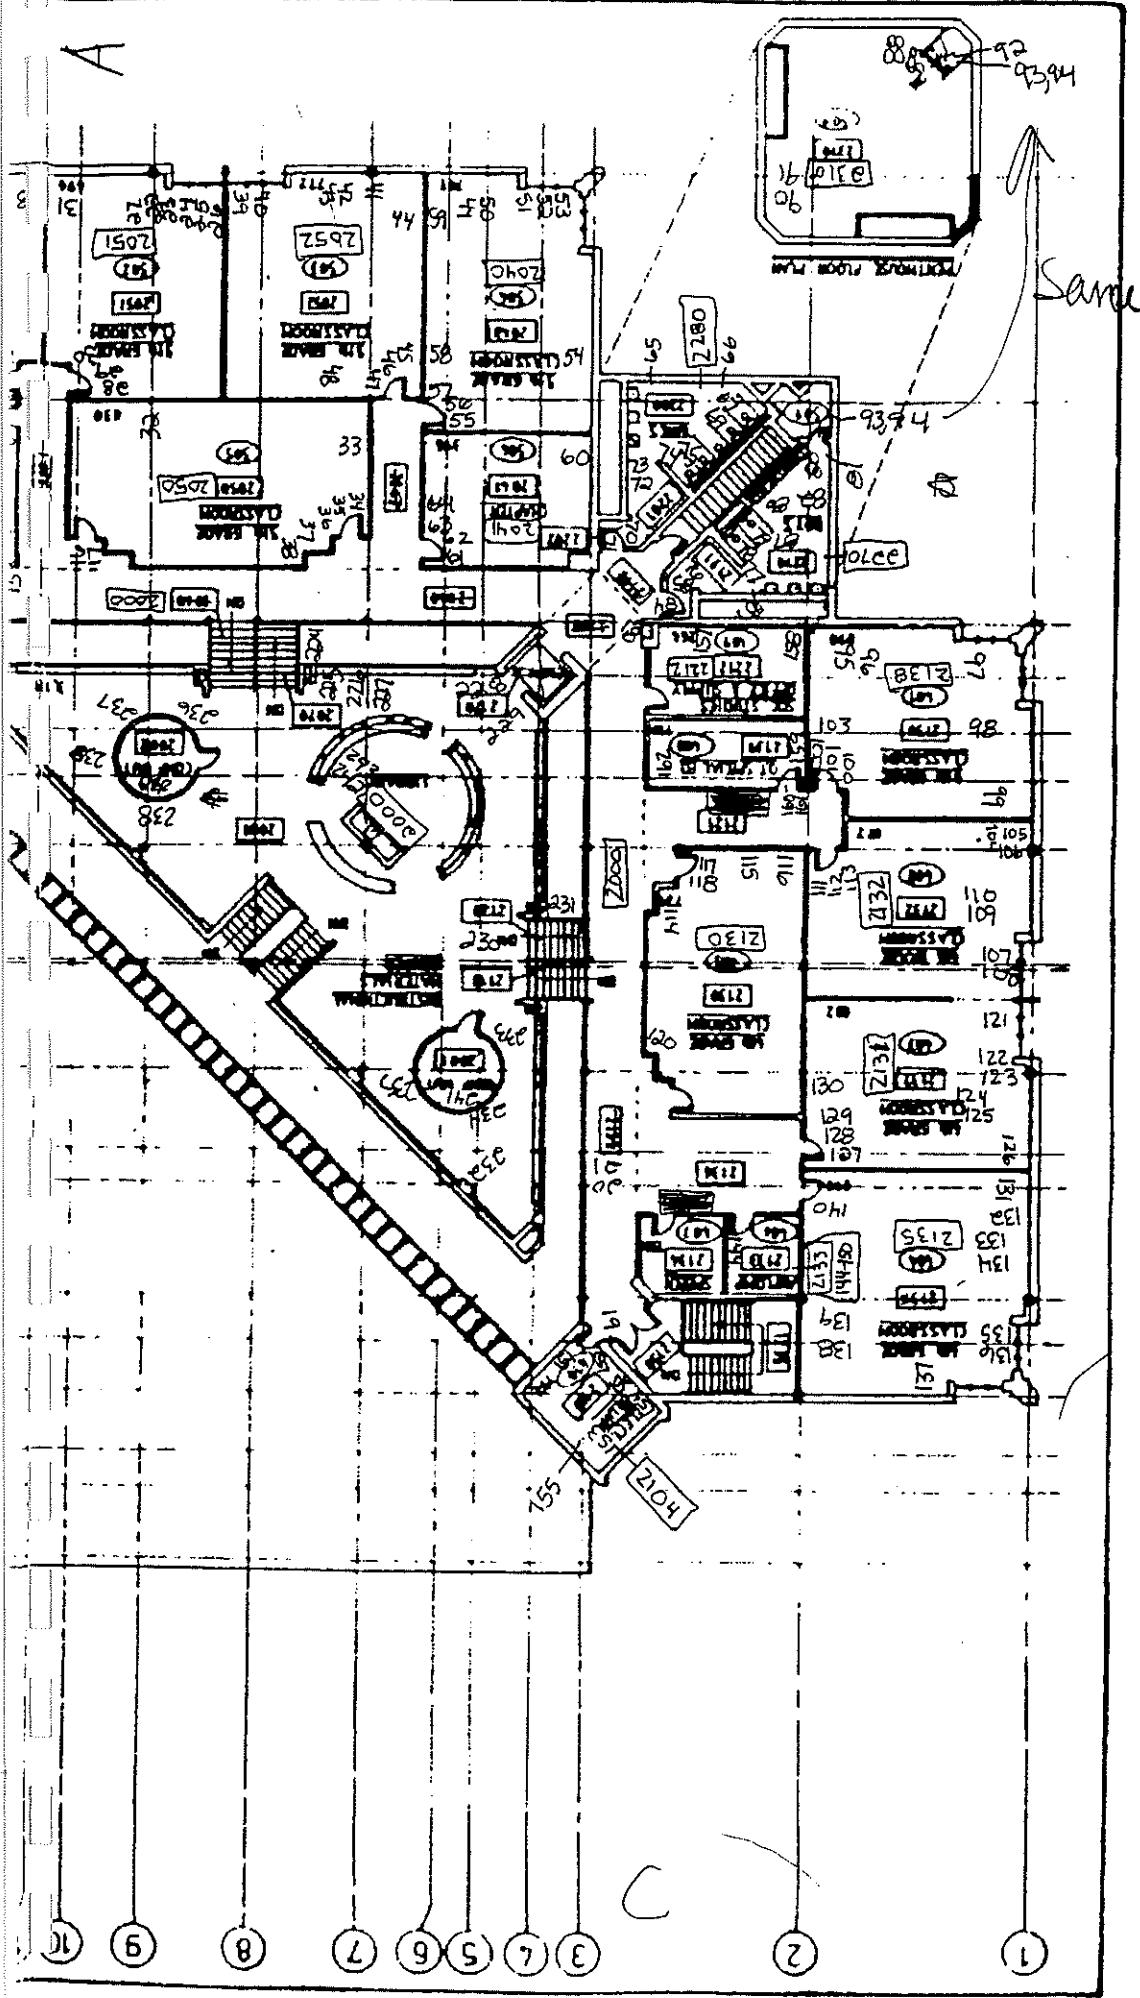

Sample

B

3 4  
3

CONSTRUCTED 1974

GALTIER ELEMENTARY SCHOOL  
1327 CHARLES AVENUE  
ST PAUL, MINNESOTA

INDEPENDENT SCHOOL DIST 625  
360 COLBORNE STREET  
ST PAUL, MINNESOTA 55102


8-25-97


8-19-97

8-5-97

(A)

SECOND FLOOR PLAN

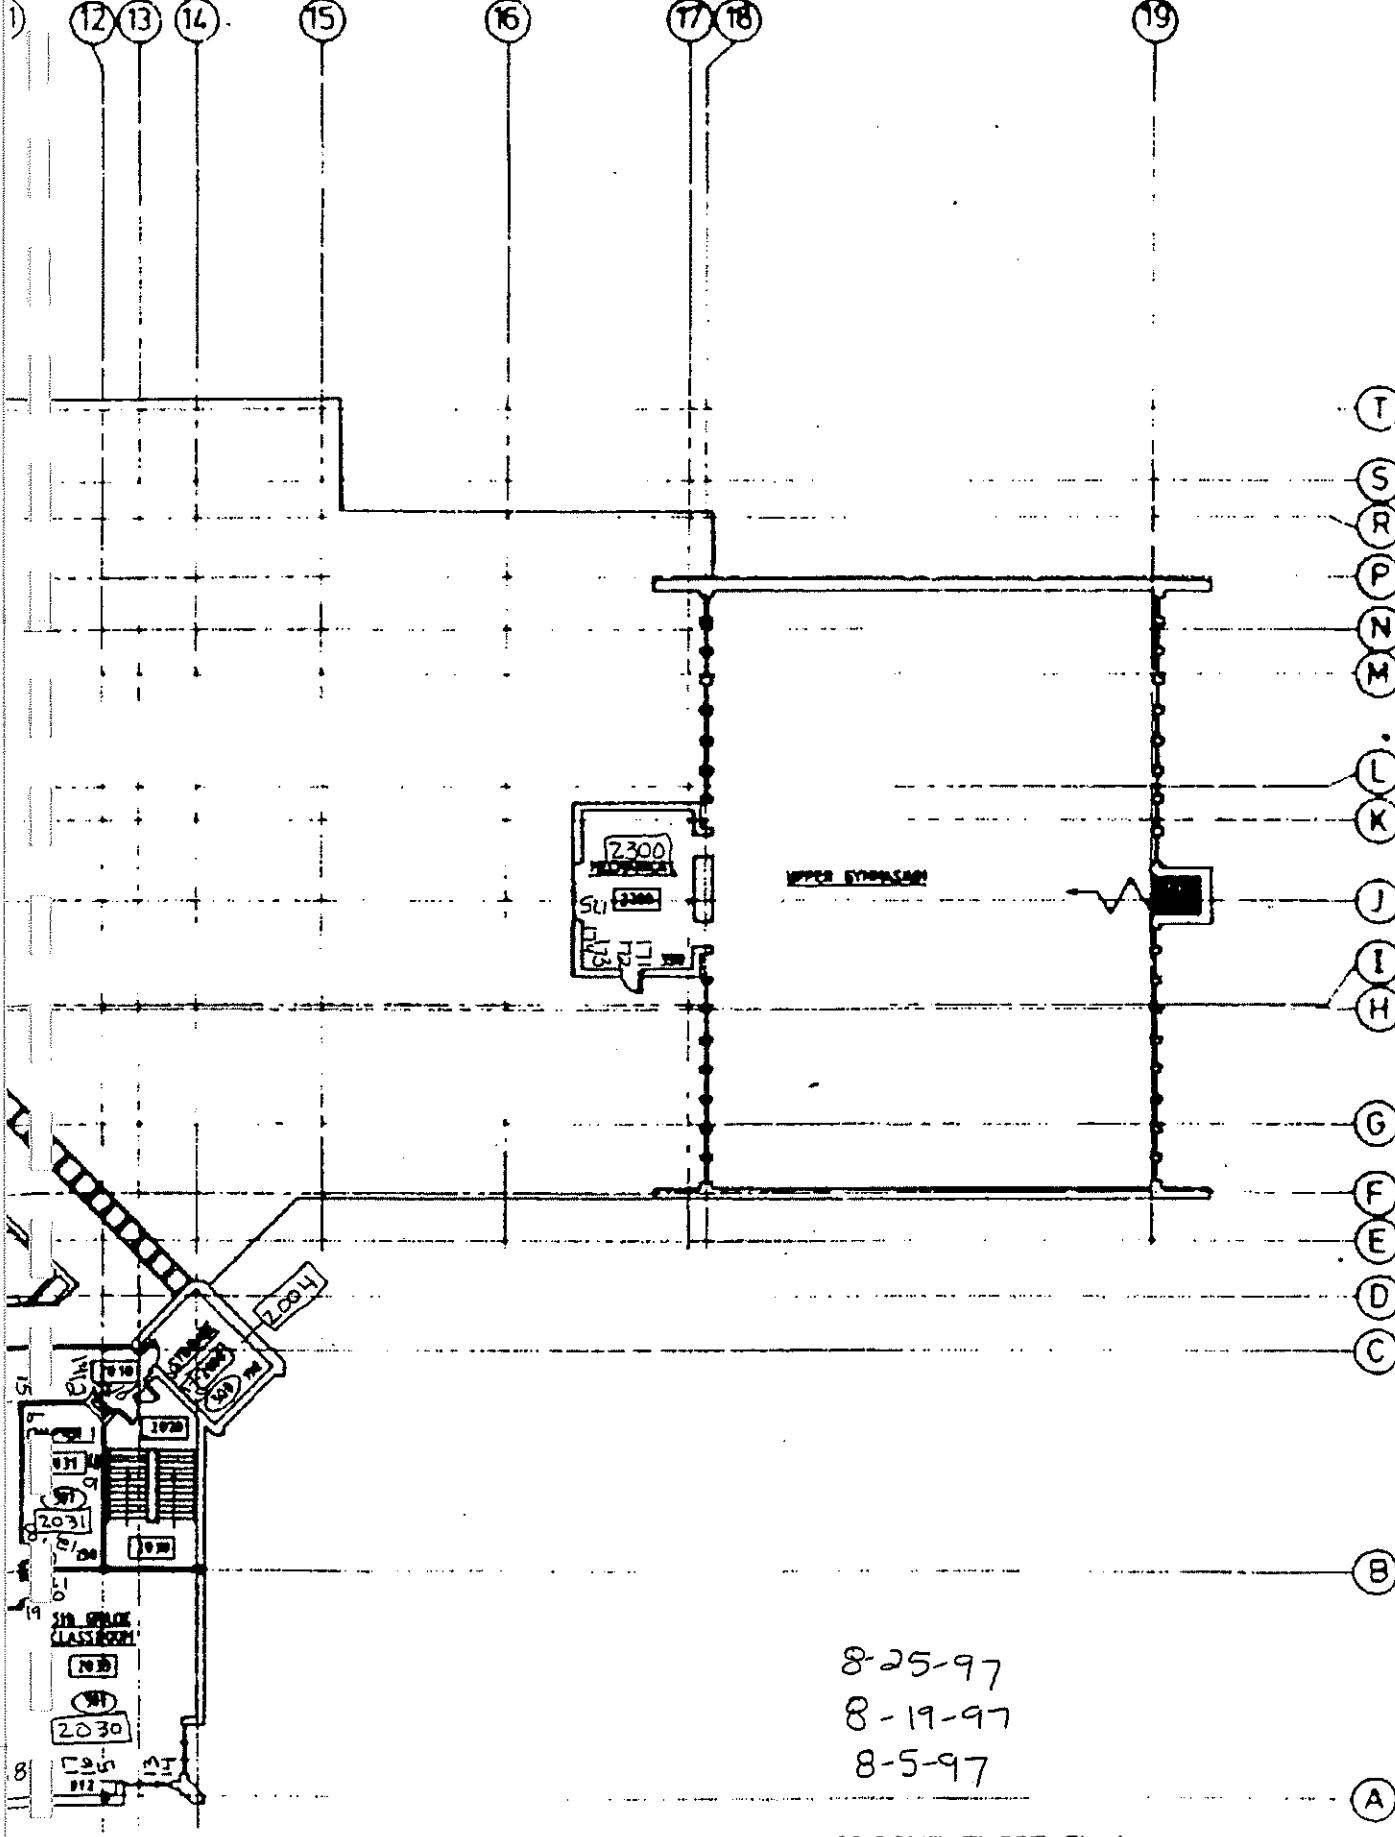

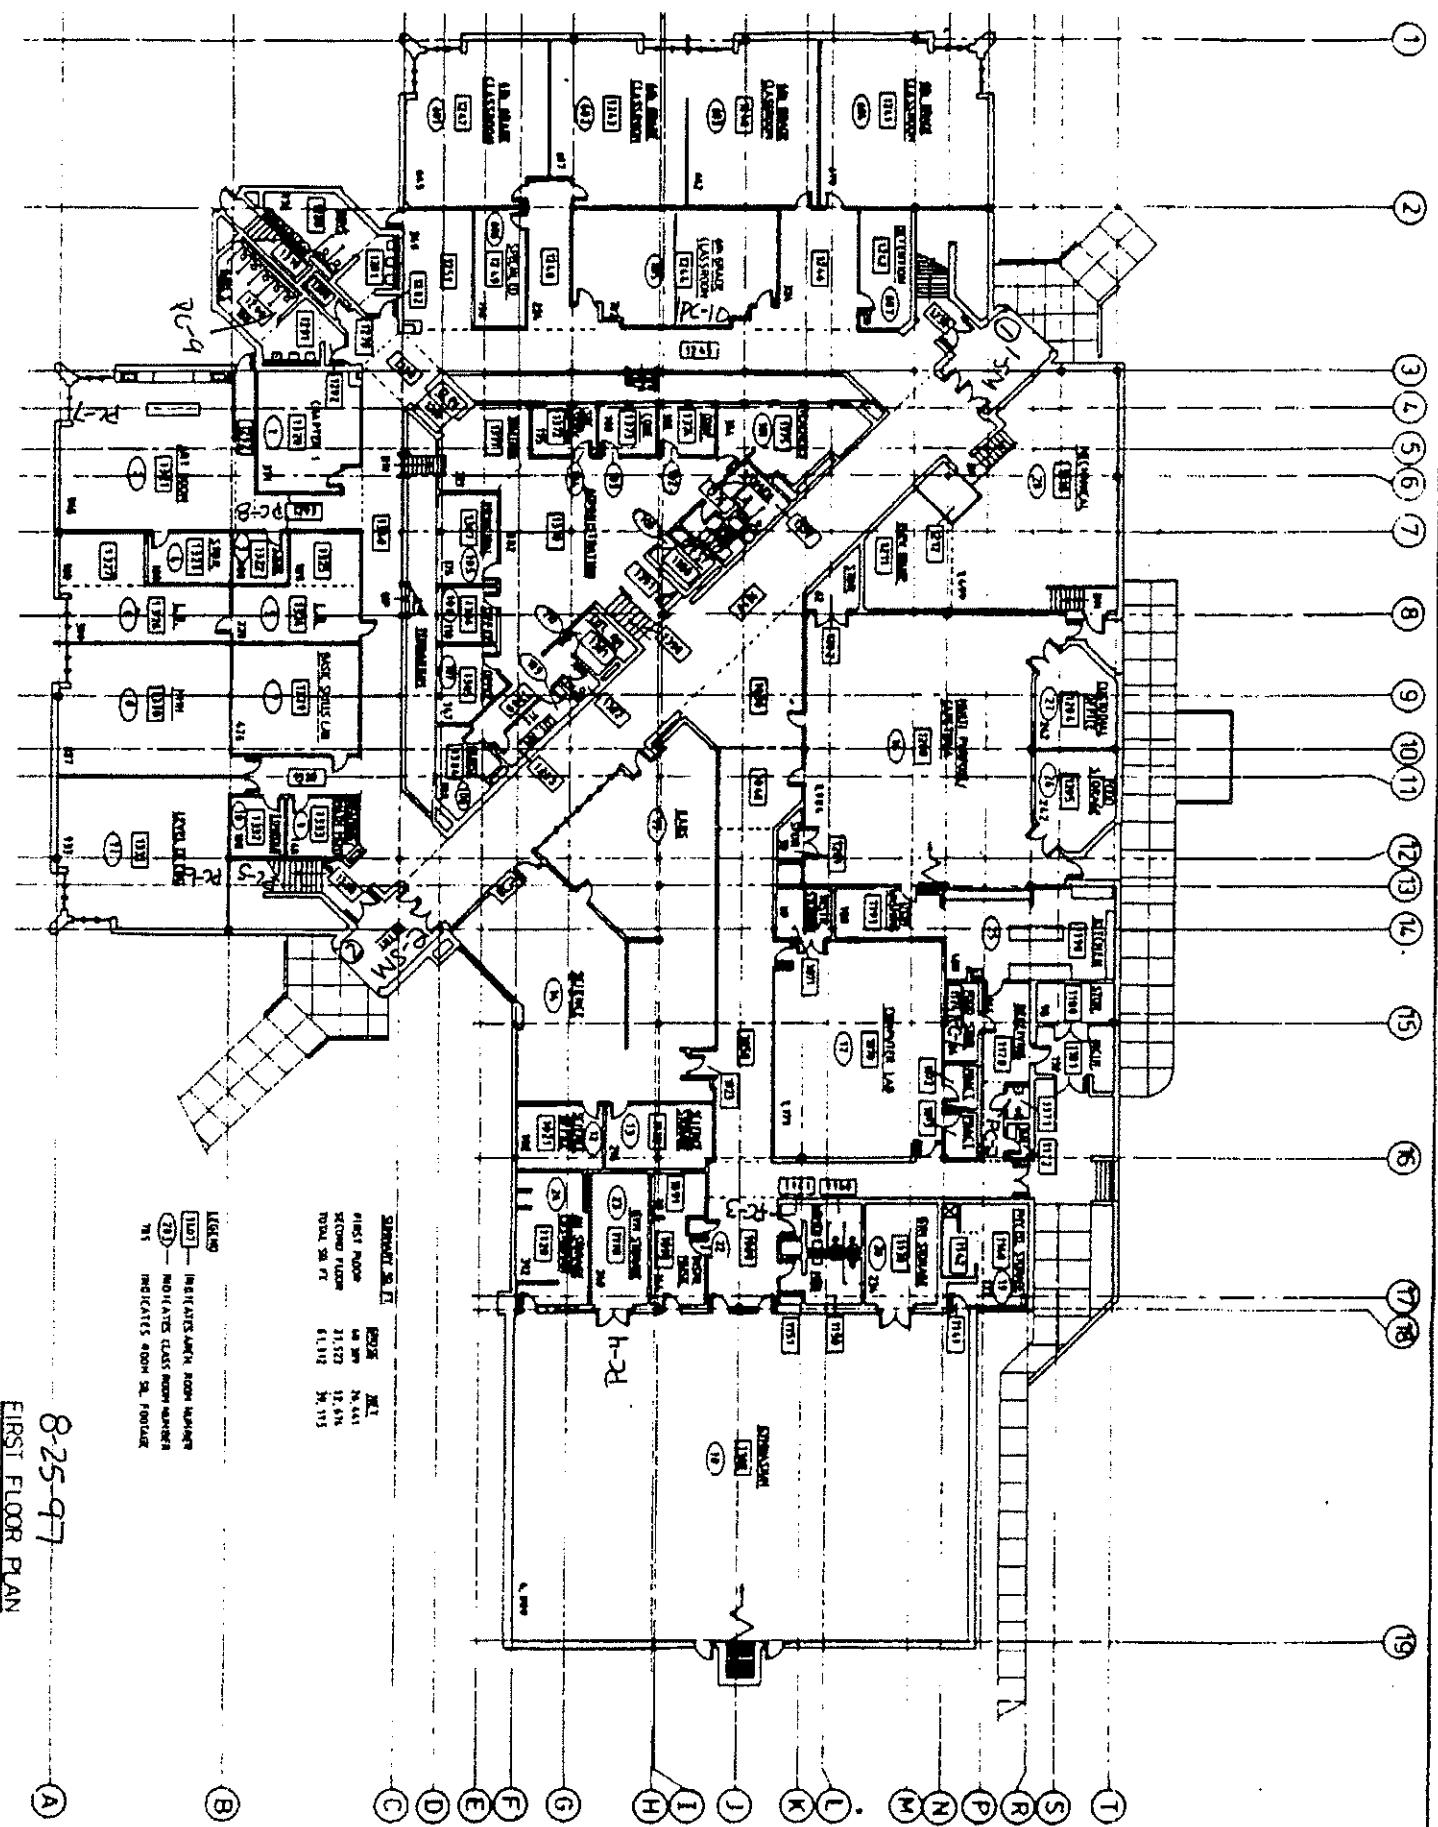


INDEPENDENT SCHOOL DIST #25  
360 COLBORNE STREET  
ST. PAUL, MINNESOTA 55102

GALTIER ELEMENTARY SCHOOL  
1327 CHARLES AVENUE  
ST. PAUL, MINNESOTA

CONSTRUCTED 1974

2 4

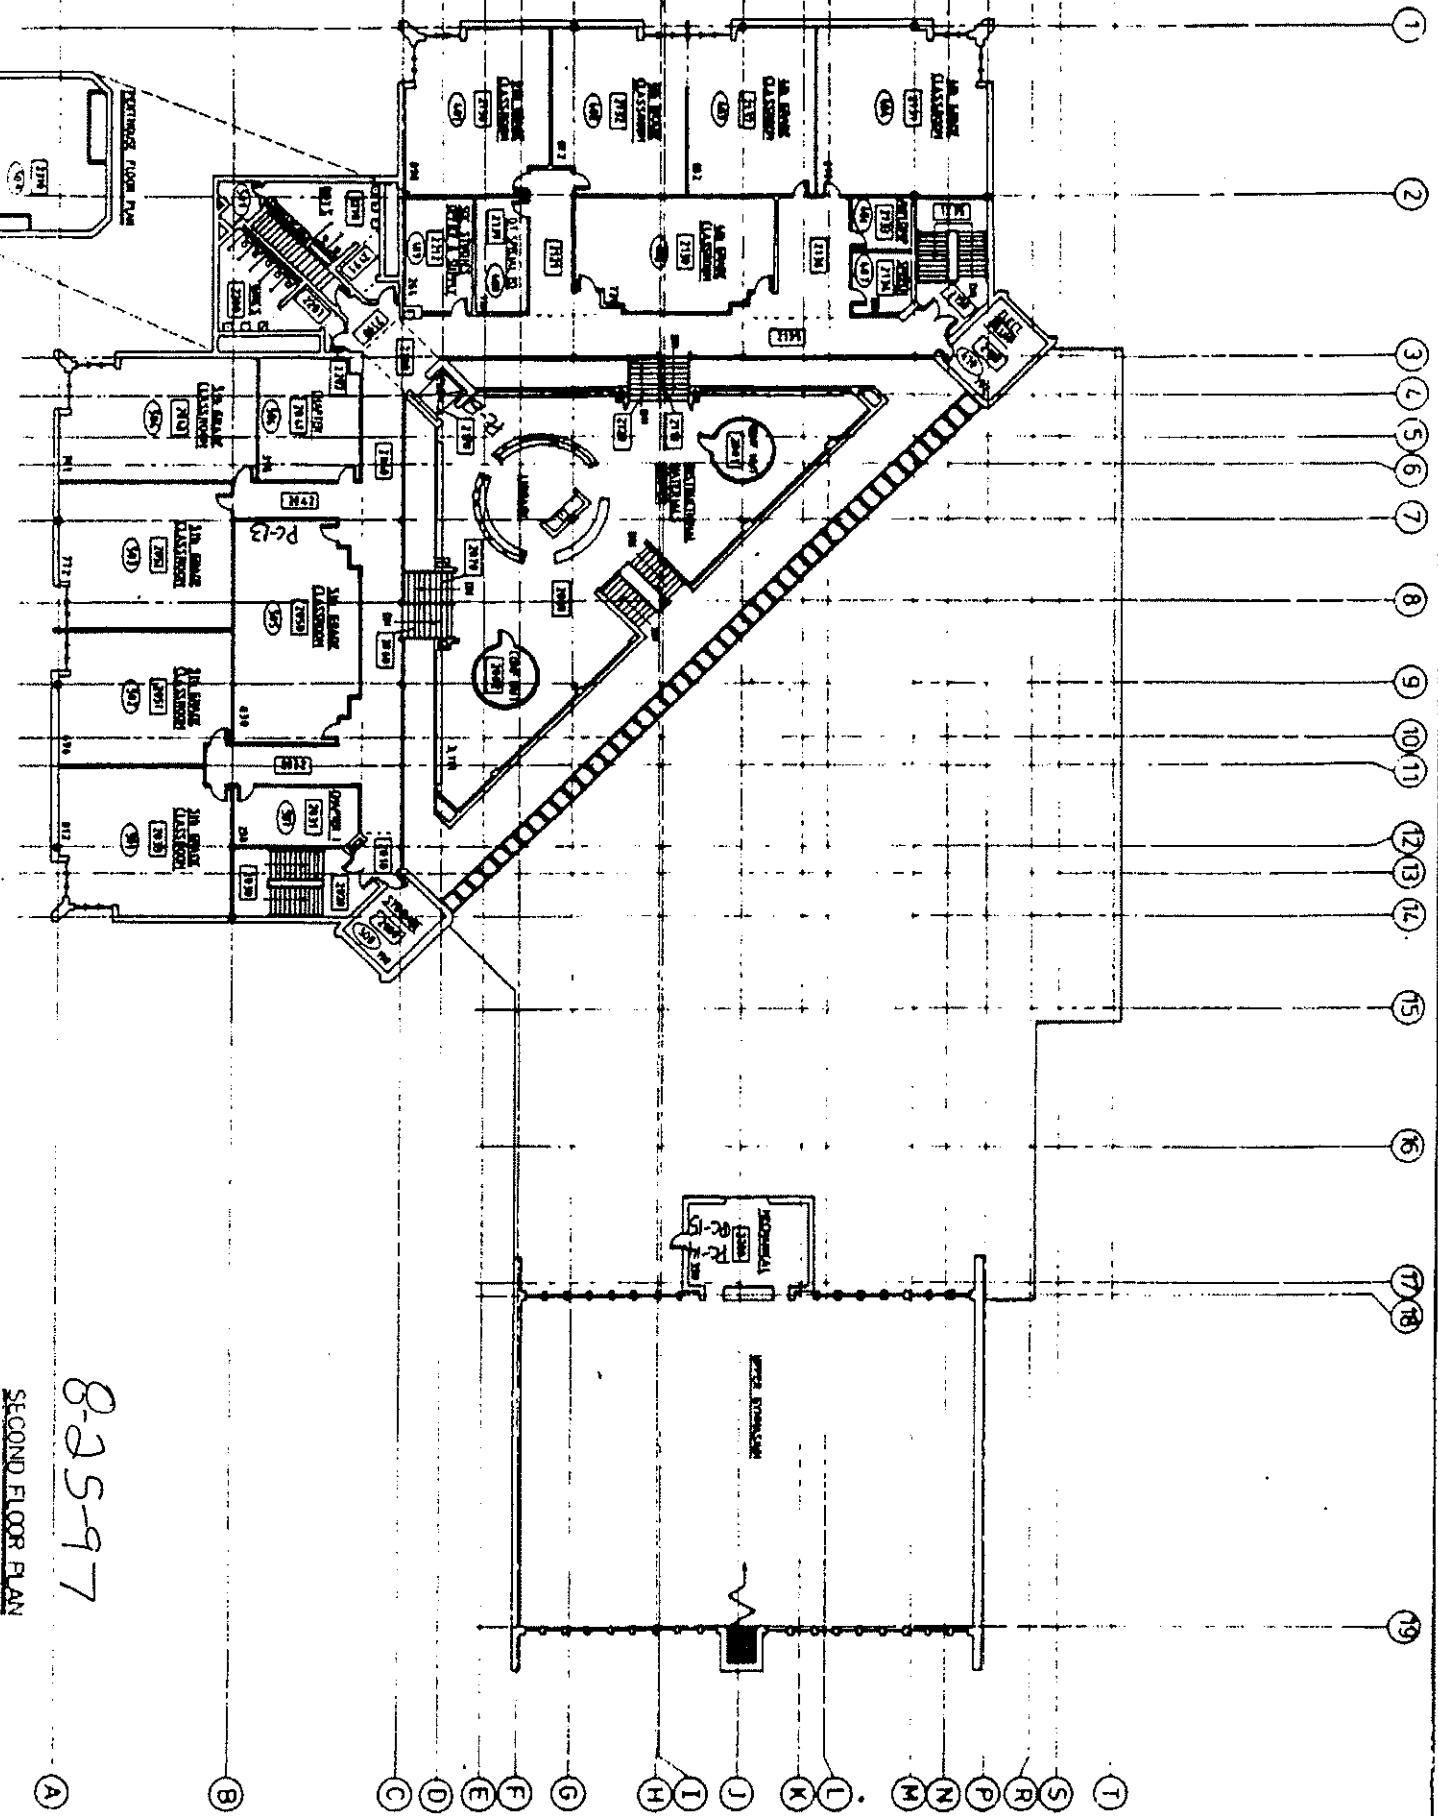


INDEPENDENT SCHOOL DIST #625  
360 COLBORNE STREET  
ST. PAUL, MINNESOTA 55102

GALTIER ELEMENTARY SCHOOL  
1327 CHARLES AVENUE  
ST. PAUL, MINNESOTA

CONSTRUCTED: 1974

NET  
3  
4

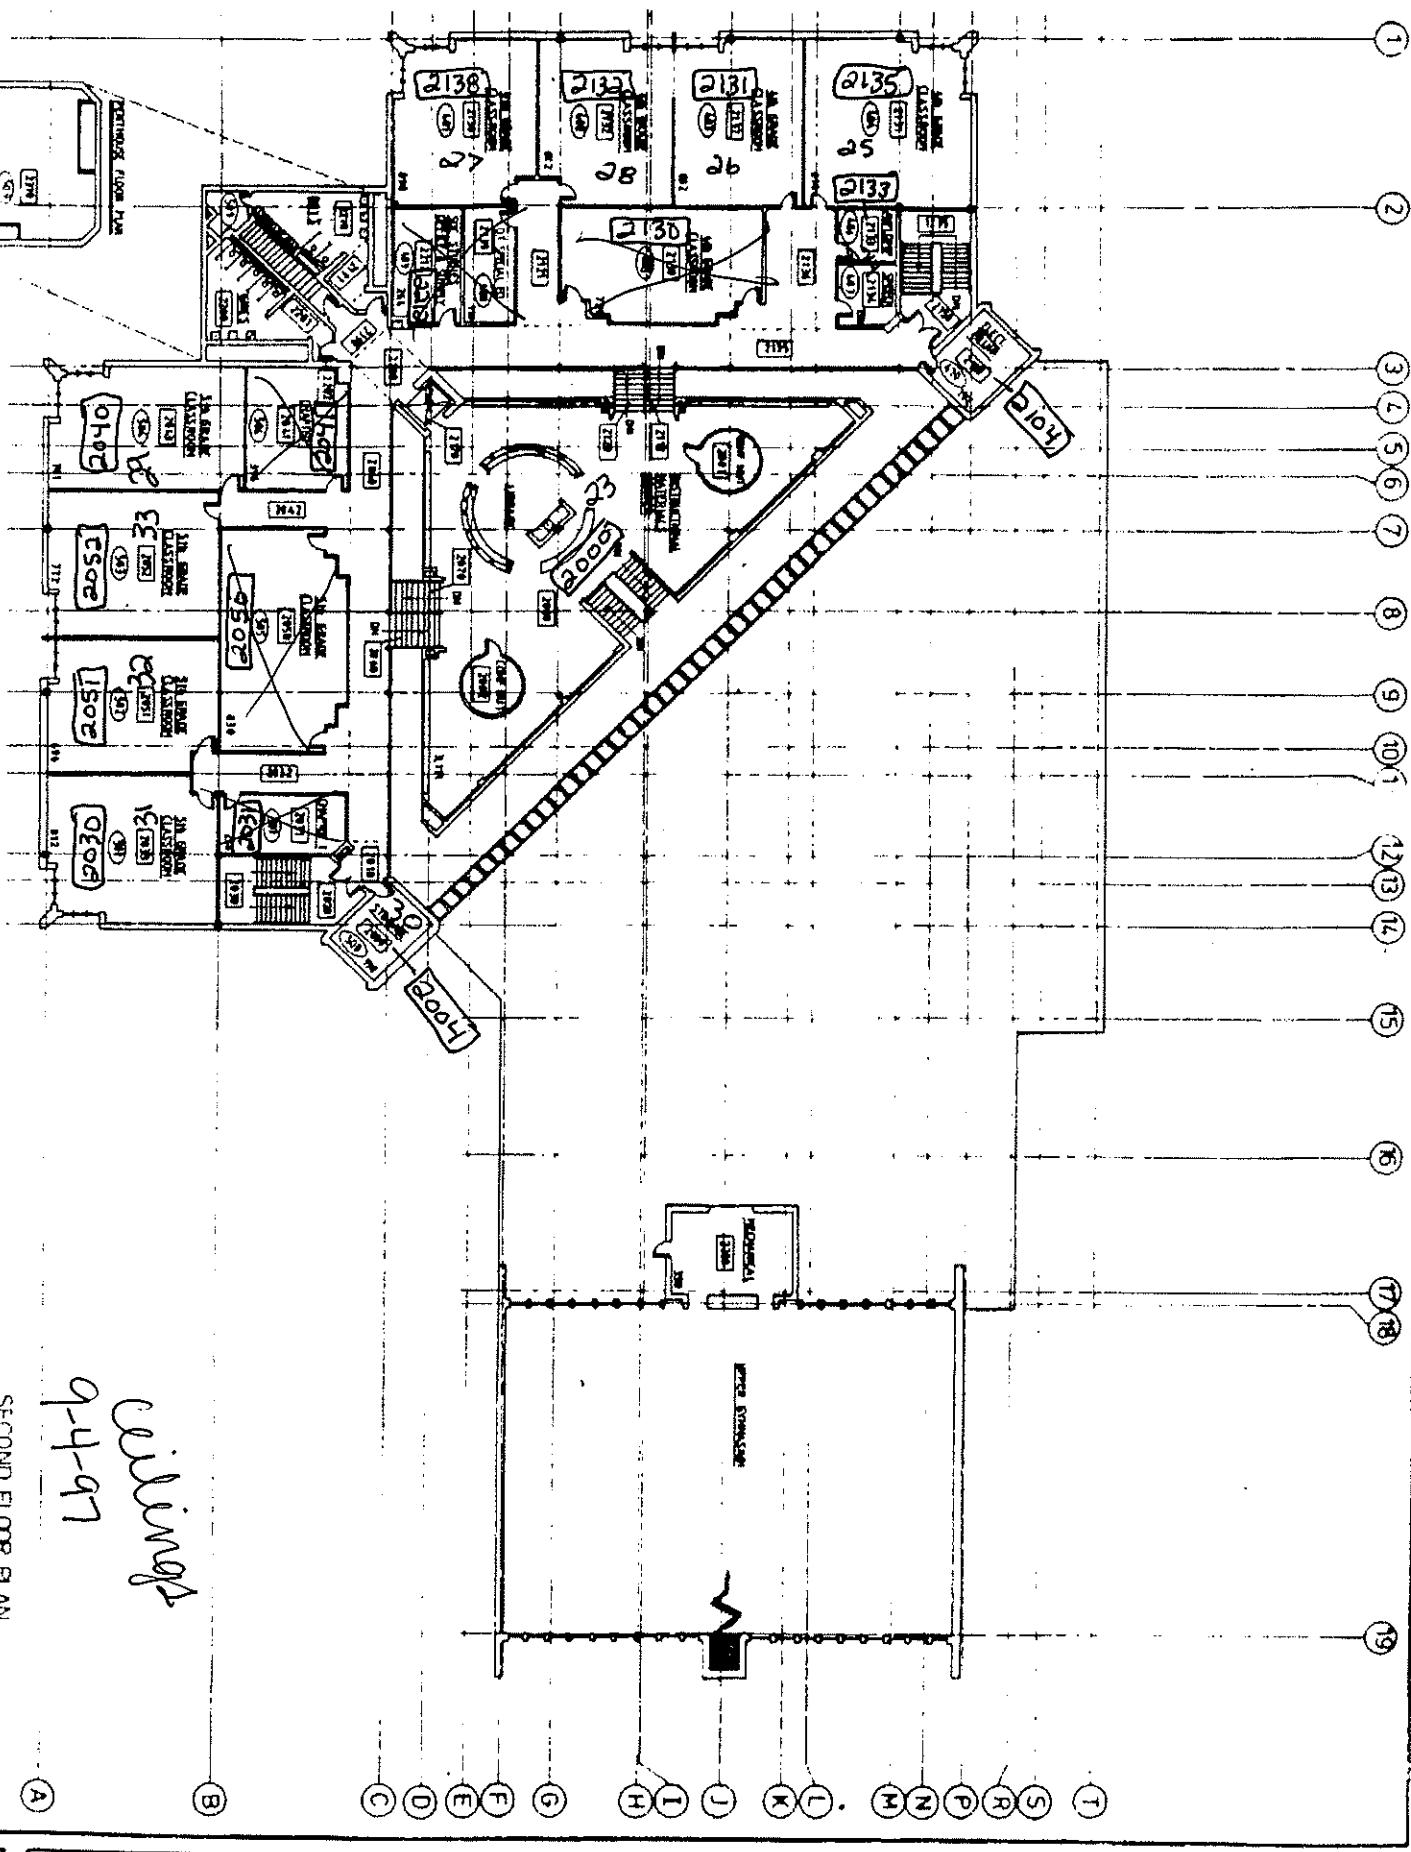

SECOND FLOOR PLAN


Willing

INDEPENDENT SCHOOL DIST #625  
360 COLBORNE STREET  
ST. PAUL, MINNESOTA 55102

GALTIER ELEMENTARY SCHOOL  
1327 CHARLES AVENUE  
ST PAUL, MINNESOTA

CONSTRUCTED: 1974

4

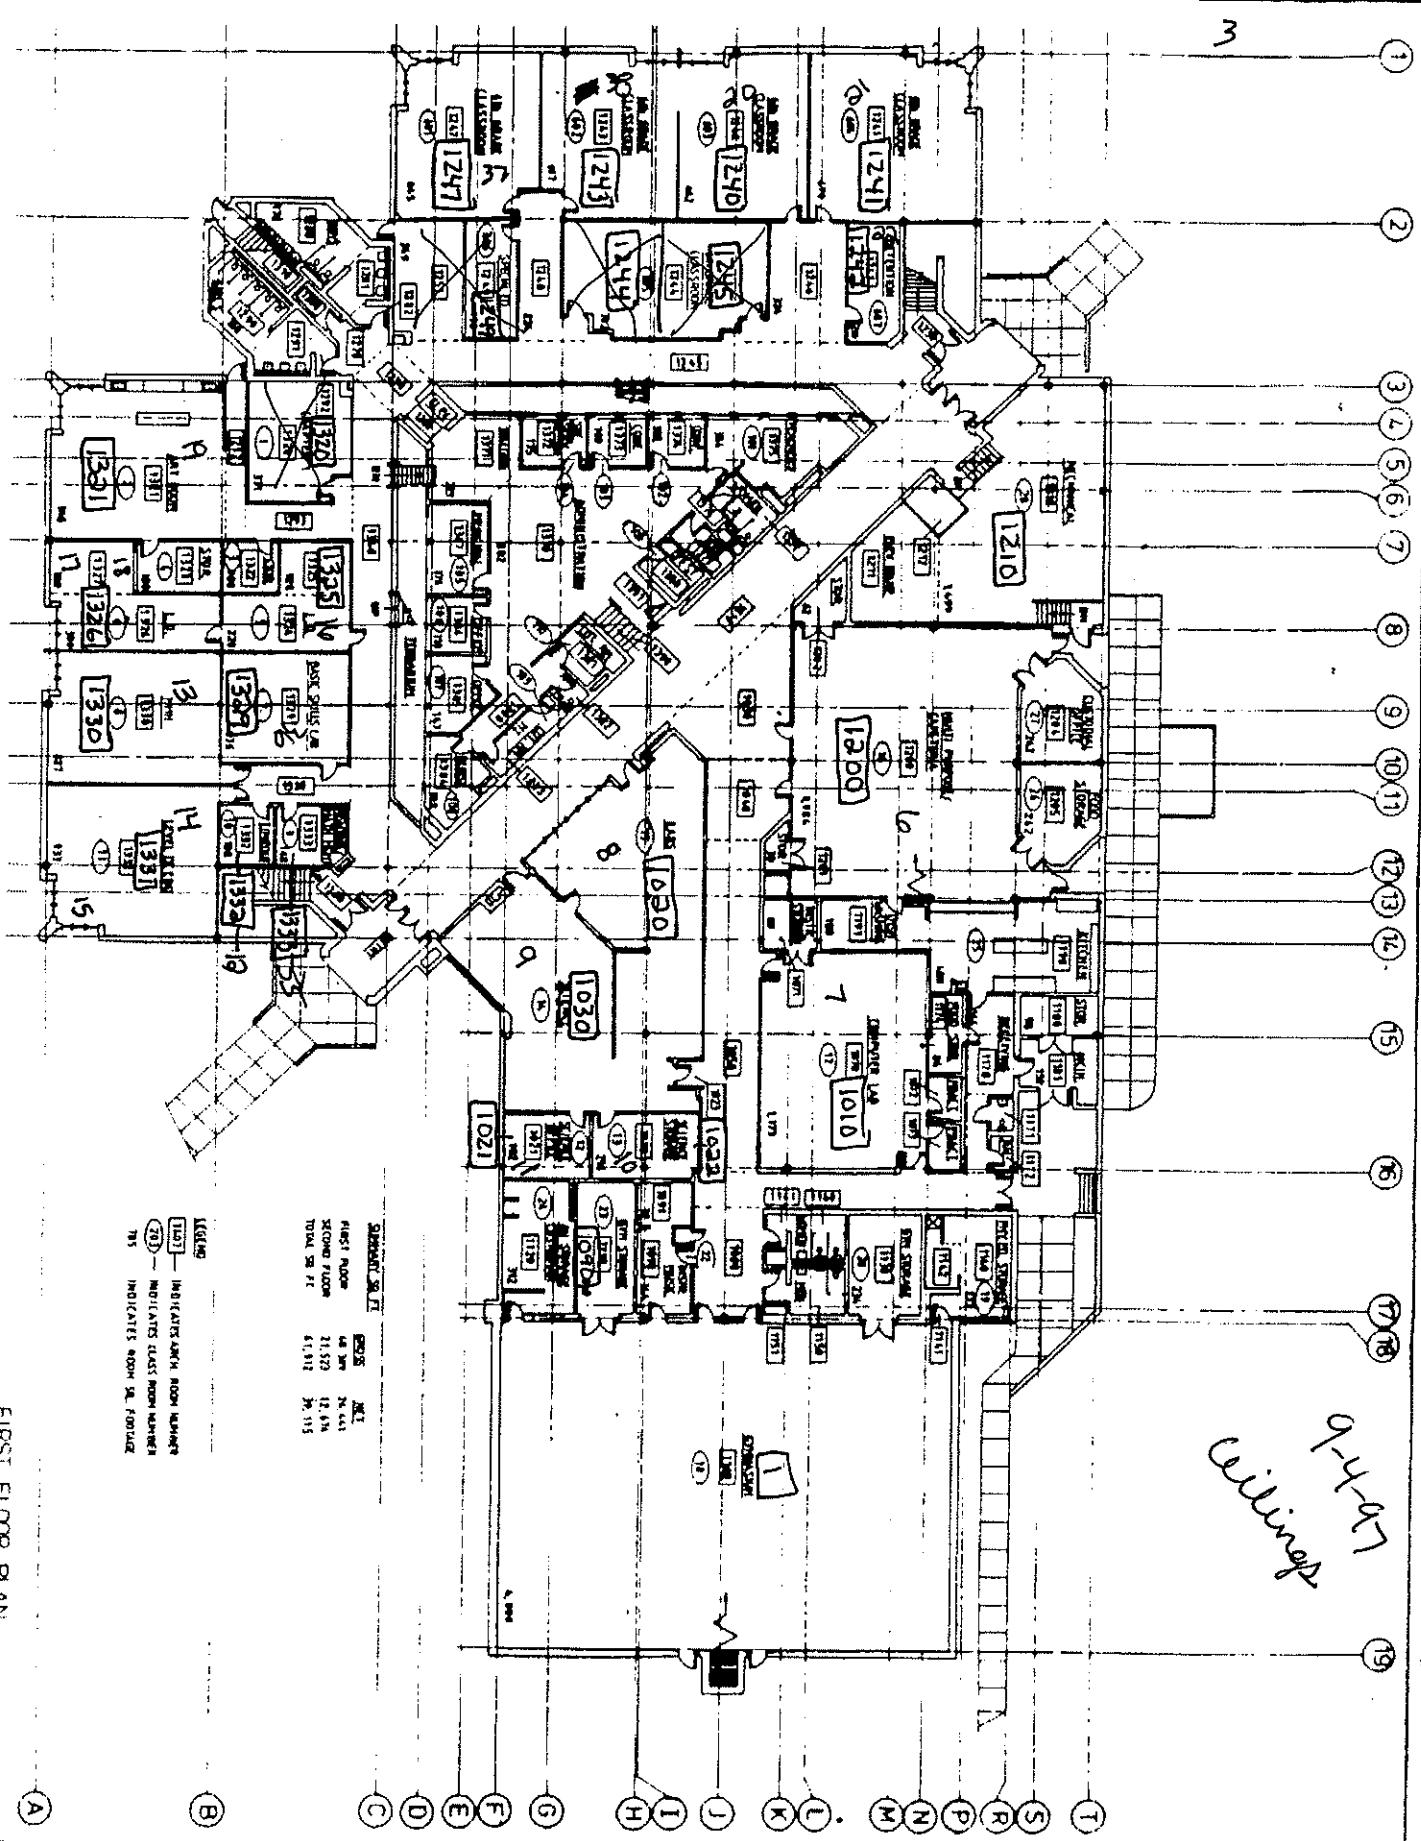

EBS FLOOR PLAN

INDEPENDENT SCHOOL DIST 62  
360 COLBORNE STREET  
ST. PAUL, MINNESOTA \$102

GALTIER ELEMENTARY SCHOOL  
1327 CHARLES AVENUE  
ST. PAUL, MINNESOTA

CONSTRUCTED 1974

2  
4

Saint Paul Public Schools  
 Galtier Magnet Elementary School  
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
1	Galtier Magnet Elementary											
2												
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Componen	Feature	Condition	Substrate	Result
4	1974 Bldg	14	XRF	8/4/97	1	Cafeteria	1200	Wall	Midle Wall	Solid	Concrete	0
5	1974 Bldg	15	XRF	8/4/97	1	Cafeteria	1200	Wall	Wall Rgstr	Solid	Metal	0
6	1974 Bldg	16	XRF	8/4/97	1	Cafeteria	1200	Door	Door	Solid	Wood	0
7	1974 Bldg	17	XRF	8/4/97	1	Cafeteria	1200	Door	Casing	Solid	Metal	0
8	1974 Bldg	18	XRF	8/4/97	1	Cafeteria	1200	Door	Door	Solid	Metal	0
9	1974 Bldg	19	XRF	8/4/97	1	Cafeteria	1200	Wall	Midle Wall	Solid	Drywall	0
10	1974 Bldg	20	XRF	8/4/97	1	Cafeteria	1200	Wall	Column	Solid	Concrete	0
11	1974 Bldg	21	XRF	8/4/97	1	Cafeteria	1200	Wall	Midle Wall	Solid	Concrete	0
12	1974 Bldg	22	XRF	8/4/97	1	Cafeteria	1200	Door	Door	Solid	Metal	0
13	1974 Bldg	23	XRF	8/4/97	1	Cafeteria	1200	Door	Casing	Solid	Metal	0
14	1974 Bldg	24	XRF	8/4/97	1	Cafeteria	1200	Wall	Wall	Solid	Drywall	0
15	1974 Bldg	25	XRF	8/4/97	1	Cafeteria	1200	Wall	Midle Wall	Solid	Drywall	1.13
16	1974 Bldg	26	XRF	8/4/97	1	Cafeteria	1200	Wall	Midle Wall	Solid	Concrete	0.01
17	1974 Bldg	6	XRF	9/4/97	1	Cafeteria	1200	Ceiling		Chalking	Drywall	0.05
18	1974 Bldg	132	XRF	8/5/97	1	Classroom	1010	Wall	Midle Wall	Solid	Concrete	0
19	1974 Bldg	133	XRF	8/5/97	1	Classroom	1010	Door	Door	Solid	Wood	0
20	1974 Bldg	134	XRF	8/5/97	1	Classroom	1010	Door	Casing	Solid	Metal	0
21	1974 Bldg	135	XRF	8/5/97	1	Classroom	1010	Wall	Transom	Solid	Wood	0
22	1974 Bldg	136	XRF	8/5/97	1	Classroom	1010	Wall	Wall Rgstr	Solid	Metal	0
23	1974 Bldg	137	XRF	8/5/97	1	Classroom	1010	Window	Casing	Solid	Metal	0
24	1974 Bldg	138	XRF	8/5/97	1	Classroom	1010	Wall	Column	Solid	Concrete	0.01
25	1974 Bldg	139	XRF	8/5/97	1	Classroom	1010	Wall	Wall	Solid	Concrete	0
26	1974 Bldg	140	XRF	8/5/97	1	Classroom	1010	Wall	Wall	Solid	Concrete	0.01
27	1974 Bldg	141	XRF	8/5/97	1	Classroom	1010	Wall	Column	Solid	Concrete	0
28	1974 Bldg	7	XRF	9/4/97	1	Classroom	1010	Ceiling		Chalking	Drywall	0.01
29	1974 Bldg	74	XRF	8/5/97	1	Classroom	1020	Wall	Midle Wall	Solid	Drywall	0.02
30	1974 Bldg	75	XRF	8/5/97	1	Classroom	1020	Wall	Midle Wall	Solid	Drywall	0
31	1974 Bldg	76	XRF	8/5/97	1	Classroom	1020	Door	Door	Solid	Wood	0
32	1974 Bldg	77	XRF	8/5/97	1	Classroom	1020	Door	Casing	Solid	Metal	0.29
33	1974 Bldg	78	XRF	8/5/97	1	Classroom	1020	Window	Casing	Solid	Metal	0.01
34	1974 Bldg	79	XRF	8/5/97	1	Classroom	1020	Wall	Wall	Solid	Concrete	0
35	1974 Bldg	80	XRF	8/5/97	1	Classroom	1020	Wall	Wall	Solid	Concrete	0.04
36	1974 Bldg	81	XRF	8/5/97	1	Classroom	1020	Wall	Column	Solid	Concrete	0
37	1974 Bldg	82	XRF	8/5/97	1	Classroom	1020	Door	Casing	Solid	Metal	0
38	1974 Bldg	83	XRF	8/5/97	1	Classroom	1020	Wall	Wall Rgstr	Solid	Metal	0.04
39	1974 Bldg	84	XRF	8/5/97	1	Classroom	1020	Cabinet	Door	Solid	Wood	0
40	1974 Bldg	85	XRF	8/5/97	1	Classroom	1020	Cabinet	Shelf	Solid	Wood	0
41	1974 Bldg	86	XRF	8/5/97	1	Classroom	1020	Window	Casing	Solid	Metal	0
42	1974 Bldg	87	XRF	8/5/97	1	Classroom	1020	Wall	Wall Rgstr	Solid	Metal	0.01
43	1974 Bldg	88	XRF	8/5/97	1	Classroom	1020		Column	Solid	Concrete	0
44	1974 Bldg	8	XRF	9/4/97	1	Classroom	1020	Ceiling		Chalking	Drywall	0
45	1974 Bldg	11	XRF	9/4/97	1	Classroom	1021	Ceiling		Chalking	Drywall	0.01
46	1974 Bldg	10	XRF	9/4/97	1	Classroom	1022	Ceiling		Chalking	Drywall	0
47	1974 Bldg	89	XRF	8/5/97	1	Classroom	1030	Wall	Midle Wall	Solid	Concrete	0.03
48	1974 Bldg	90	XRF	8/5/97	1	Classroom	1030		Radiator	Solid	Metal	0.02
49	1974 Bldg	91	XRF	8/5/97	1	Classroom	1030	Bookcase	Shelf	Solid	Wood	0.01
50	1974 Bldg	92	XRF	8/5/97	1	Classroom	1030	Wall	Midle Wall	Solid	Concrete	0
51	1974 Bldg	93	XRF	8/5/97	1	Classroom	1030	Wall	Wall Rgstr	Solid	Metal	0
52	1974 Bldg	94	XRF	8/5/97	1	Classroom	1030	Wall	Column	Solid	Concrete	0.02
53	1974 Bldg	95	XRF	8/5/97	1	Classroom	1030	Door	Door	Solid	Wood	0
54	1974 Bldg	96	XRF	8/5/97	1	Classroom	1030	Door	Casing	Solid	Metal	0
55	1974 Bldg	97	XRF	8/5/97	1	Classroom	1030	Door	Jamb	Solid	Metal	0.3
56	1974 Bldg	98	XRF	8/5/97	1	Classroom	1030	Door	Jamb	Solid	Metal	0.24
57	1974 Bldg	99	XRF	8/5/97	1	Classroom	1030	Wall	Midle Wall	Solid	Drywall	0
58	1974 Bldg	100	XRF	8/5/97	1	Classroom	1030	Door	Casing	Solid	Metal	0
59	1974 Bldg	101	XRF	8/5/97	1	Classroom	1030	Door	Casing	Solid	Metal	0
60	1974 Bldg	9	XRF	9/4/97	1	Classroom	1030	Ceiling		Chalking	Drywall	0

Saint Paul Public Schools  
 Galtier Magnet Elementary School  
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Componen	Feature	Condition	Substrate	Result
61	1974 Bldg	126	XRF	8/5/97	1	Classroom	1090	Wall	Midle Wall	Solid	Concrete	0.01
62	1974 Bldg	127	XRF	8/5/97	1	Classroom	1090	Cabinet	Door	Solid	Wood	0
63	1974 Bldg	128	XRF	8/5/97	1	Classroom	1090	Door	Door	Solid	Wood	0
64	1974 Bldg	129	XRF	8/5/97	1	Classroom	1090	Door	Casing	Solid	Metal	0.01
65	1974 Bldg	130	XRF	8/5/97	1	Classroom	1090	Wall	Column	Solid	Concrete	0
66	1974 Bldg	131	XRF	8/5/97	1	Classroom	1090	Wall	Column	Solid	Drywall	0
67	1974 Bldg	102	XRF	8/4/97	1	Classroom	1240	Wall	Midle Wall	Solid	Drywall	0.1
68	1974 Bldg	103	XRF	8/4/97	1	Classroom	1240	Door	Door	Solid	Wood	0
69	1974 Bldg	104	XRF	8/4/97	1	Classroom	1240	Door	Casing	Solid	Metal	0.01
70	1974 Bldg	105	XRF	8/4/97	1	Classroom	1240	Wall	Wall	Solid	Drywall	0.05
71	1974 Bldg	106	XRF	8/4/97	1	Classroom	1240	Wall	Wall Rgstr	Solid	Metal	0.01
72	1974 Bldg	107	XRF	8/4/97	1	Classroom	1240	Window	Header	Solid	Wood	0
73	1974 Bldg	108	XRF	8/4/97	1	Classroom	1240		Radiator	Solid	Metal	0.05
74	1974 Bldg	109	XRF	8/4/97	1	Classroom	1240	Wall	Column	Solid	Concrete	0
75	1974 Bldg	110	XRF	8/4/97	1	Classroom	1240	Bookcase	Shelf	Solid	Metal	0.01
76	1974 Bldg	111	XRF	8/4/97	1	Classroom	1240	Coat	Rack	Solid	Metal	0.01
77	1974 Bldg	112	XRF	8/4/97	1	Classroom	1240	Wall	Midle Wall	Solid	Concrete	0
78	1974 Bldg	20	XRF	9/4/97	1	Classroom	1240	Ceiling		Chalking	Drywall	0.01
79	1974 Bldg	113	XRF	8/4/97	1	Classroom	1241	Wall	Midle Wall	Solid	Drywall	0
80	1974 Bldg	114	XRF	8/4/97	1	Classroom	1241	Wall	Midle Wall	Solid	Concrete	0.01
81	1974 Bldg	115	XRF	8/4/97	1	Classroom	1241	Wall	Column	Solid	Concrete	0
82	1974 Bldg	116	XRF	8/4/97	1	Classroom	1241	Wall	Radiator	Solid	Metal	0.02
83	1974 Bldg	117	XRF	8/4/97	1	Classroom	1241	Wall	Wall	Solid	Drywall	0
84	1974 Bldg	118	XRF	8/4/97	1	Classroom	1241	Wall	Wall Rgstr	Chalking	Metal	0.04
85	1974 Bldg	119	XRF	8/4/97	1	Classroom	1241	Door	Header	Chalking	Wood	0
86	1974 Bldg	120	XRF	8/4/97	1	Classroom	1241	Coat	Rack	Solid	Metal	0.03
87	1974 Bldg	121	XRF	8/4/97	1	Classroom	1241	Door	Door	Solid	Wood	0
88	1974 Bldg	122	XRF	8/4/97	1	Classroom	1241	Door	Casing	Solid	Metal	0.01
89	1974 Bldg	123	XRF	8/4/97	1	Classroom	1241	Window	Casing	Solid	Metal	0.05
90	1974 Bldg	21	XRF	9/4/97	1	Classroom	1241	Ceiling		Chalking	Drywall	0.04
91	1974 Bldg	124	XRF	8/4/97	1	Classroom	1242	Door	Door	Solid	Wood	0
92	1974 Bldg	125	XRF	8/4/97	1	Classroom	1242	Window	Casing	Solid	Metal	0.04
93	1974 Bldg	126	XRF	8/4/97	1	Classroom	1242	Door	Casing	Solid	Metal	0
94	1974 Bldg	127	XRF	8/4/97	1	Classroom	1242	Wall	Column	Solid	Concrete	0
95	1974 Bldg	128	XRF	8/4/97	1	Classroom	1242	Wall	Midle Wall	Solid	Concrete	0
96	1974 Bldg	129	XRF	8/4/97	1	Classroom	1242	Wall	Wall	Solid	Drywall	0
97	1974 Bldg	130	XRF	8/4/97	1	Classroom	1242	Wall	Wall Rgstr	Solid	Metal	0
98	1974 Bldg	97	XRF	8/4/97	1	Classroom	1243	Wall	Column	Solid	Concrete	0.01
99	1974 Bldg	98	XRF	8/4/97	1	Classroom	1243		Radiator	Solid	Metal	0.03
100	1974 Bldg	99	XRF	8/4/97	1	Classroom	1243	Wall	Wall	Solid	Drywall	0.02
101	1974 Bldg	100	XRF	8/4/97	1	Classroom	1243	Wall	Wall Rgstr	Solid	Metal	0
102	1974 Bldg	101	XRF	8/4/97	1	Classroom	1243	Coat	Rack	Solid	Metal	0.01
103	1974 Bldg	38	XRF	9/4/97	1	Classroom	1243	Ceiling		Chalking	Drywall	0.02
104	1974 Bldg	74	XRF	8/4/97	1	Classroom	1247	Wall	Wall	Solid	Concrete	0.04
105	1974 Bldg	75	XRF	8/4/97	1	Classroom	1247		Radiator	Solid	Metal	0.12
106	1974 Bldg	76	XRF	8/4/97	1	Classroom	1247	Window	Header	Solid	Wood	0
107	1974 Bldg	77	XRF	8/4/97	1	Classroom	1247	Wall	Midle Wall	Solid	Drywall	0.03
108	1974 Bldg	78	XRF	8/4/97	1	Classroom	1247	Wall	Wall	Solid	Drywall	0.04
109	1974 Bldg	79	XRF	8/4/97	1	Classroom	1247	Door	Door	Solid	Wood	0
110	1974 Bldg	80	XRF	8/4/97	1	Classroom	1247	Door	Casing	Solid	Metal	0
111	1974 Bldg	81	XRF	8/4/97	1	Classroom	1247	Window	Casing	Solid	Metal	0.02
112	1974 Bldg	82	XRF	8/4/97	1	Classroom	1247	Coat	Rack	Solid	Metal	0.01
113	1974 Bldg	83	XRF	8/4/97	1	Classroom	1247	Coat	Rack	Solid	Metal	0.01
114	1974 Bldg	84	XRF	8/4/97	1	Classroom	1247	Wall	Wall	Solid	Drywall	0
115	1974 Bldg	85	XRF	8/4/97	1	Classroom	1247	Wall	Wall Rgstr	Solid	Metal	0.01
116	1974 Bldg	37	XRF	9/4/97	1	Classroom	1247	Ceiling		Chalking	Drywall	0.11
117	1974 Bldg	142	XRF	8/4/97	1	Classroom	1320	Wall	Wall	Solid	Concrete	0.05
118	1974 Bldg	143	XRF	8/4/97	1	Classroom	1320	Wall	Wall	Solid	Concrete	0
119	1974 Bldg	144	XRF	8/4/97	1	Classroom	1320	Cabinet	Door	Solid	Wood	0

Saint Paul Public Schools  
 Galtier Magnet Elementary School  
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Componen	Feature	Condition	Substrate	Result
120	1974 Bldg	145	XRF	8/4/97	1	Classroom	1320	Cabinet	Shelf	Solid	Wood	0
121	1974 Bldg	146	XRF	8/4/97	1	Classroom	1320	Window	Casing	Solid	Metal	0
122	1974 Bldg	147	XRF	8/4/97	1	Classroom	1320	Door	Door	Solid	Wood	0
123	1974 Bldg	148	XRF	8/4/97	1	Classroom	1320	Window	Casing	Solid	Metal	0.01
124	1974 Bldg	149	XRF	8/4/97	1	Classroom	1321	Wall	Wall	Solid	Concrete	0
125	1974 Bldg	150	XRF	8/4/97	1	Classroom	1321		Radiator	Solid	Metal	0.1
126	1974 Bldg	151	XRF	8/4/97	1	Classroom	1321	Wall	Wall	Solid	Drywall	0.03
127	1974 Bldg	152	XRF	8/4/97	1	Classroom	1321	Wall	Wall Rgstr	Solid	Metal	0
128	1974 Bldg	153	XRF	8/4/97	1	Classroom	1321	Cabinet	Door	Solid	Wood	0
129	1974 Bldg	154	XRF	8/4/97	1	Classroom	1321	Cabinet	Shelf	Solid	Wood	0
130	1974 Bldg	155	XRF	8/4/97	1	Classroom	1321	Wall	Column	Solid	Concrete	0
131	1974 Bldg	156	XRF	8/4/97	1	Classroom	1321	Door	Door	Solid	Metal	0
132	1974 Bldg	157	XRF	8/4/97	1	Classroom	1321	Door	Jamb	Solid	Metal	0
133	1974 Bldg	158	XRF	8/4/97	1	Classroom	1321	Door	Door	Solid	Wood	0
134	1974 Bldg	159	XRF	8/4/97	1	Classroom	1321	Window	Casing	Solid	Metal	0
135	1974 Bldg	160	XRF	8/4/97	1	Classroom	1321	Door	Casing	Solid	Metal	0.06
136	1974 Bldg	161	XRF	8/4/97	1	Classroom	1321	Wall	Column	Solid	Concrete	0.01
137	1974 Bldg	19	XRF	9/4/97	1	Classroom	1321	Ceiling		Chalking	Drywall	0.04
138	1974 Bldg	170	XRF	8/4/97	1	Classroom	1325	Bookcase	Shelf	Solid	Wood	0.59
139	1974 Bldg	171	XRF	8/4/97	1	Classroom	1325	Door	Door	Solid	Wood	0
140	1974 Bldg	172	XRF	8/4/97	1	Classroom	1325	Door	Casing	Solid	Metal	0
141	1974 Bldg	173	XRF	8/4/97	1	Classroom	1325	Window	Casing	Solid	Metal	0
142	1974 Bldg	16	XRF	9/4/97	1	Classroom	1325	Ceiling		Chalking	Drywall	0.02
143	1974 Bldg	162	XRF	8/4/97	1	Classroom	1326		Radiator	Solid	Metal	0.08
144	1974 Bldg	163	XRF	8/4/97	1	Classroom	1326	Window	Header	Solid	Wood	0
145	1974 Bldg	164	XRF	8/4/97	1	Classroom	1326	Wall	Wall	Solid	Concrete	0.08
146	1974 Bldg	165	XRF	8/4/97	1	Classroom	1326	Wall	Column	Solid	Concrete	0.09
147	1974 Bldg	166	XRF	8/4/97	1	Classroom	1326	Wall	Wall	Solid	Drywall	0
148	1974 Bldg	167	XRF	8/4/97	1	Classroom	1326	Wall	Wall Rgstr	Solid	Metal	0
149	1974 Bldg	168	XRF	8/4/97	1	Classroom	1326	Door	Door	Solid	Wood	0
150	1974 Bldg	169	XRF	8/4/97	1	Classroom	1326	Window	Casing	Solid	Metal	0
151	1974 Bldg	17	XRF	9/4/97	1	Classroom	1326	Ceiling		Chalking	Drywall	0.15
152	1974 Bldg	18	XRF	9/4/97	1	Classroom	1326	Cabinet		Solid	Wood	3.43
153	1974 Bldg	10	XRF	8/5/97	1	Classroom	1330	Wall	Wall	Solid	Concrete	0
154	1974 Bldg	11	XRF	8/5/97	1	Classroom	1330	Wall	Column	Solid	Concrete	0
155	1974 Bldg	12	XRF	8/5/97	1	Classroom	1330	Wall	Wall	Solid	Drywall	0.01
156	1974 Bldg	13	XRF	8/5/97	1	Classroom	1330	Wall	Wall Rgstr	Solid	Metal	0
157	1974 Bldg	14	XRF	8/5/97	1	Classroom	1330		Radiator	Solid	Metal	0.13
158	1974 Bldg	15	XRF	8/5/97	1	Classroom	1330	Wall	Column	Solid	Concrete	0
159	1974 Bldg	16	XRF	8/5/97	1	Classroom	1330	Door	Door	Solid	Wood	0
160	1974 Bldg	17	XRF	8/5/97	1	Classroom	1330	Door	Casing	Solid	Metal	0
161	1974 Bldg	18	XRF	8/5/97	1	Classroom	1330	Window	Casing	Solid	Metal	0
162	1974 Bldg	19	XRF	8/5/97	1	Classroom	1330	Coat	Rack	Solid	Metal	0.02
163	1974 Bldg	13	XRF	9/4/97	1	Classroom	1330	Ceiling		Chalking	Drywall	0.04
164	1974 Bldg	20	XRF	8/5/97	1	Classroom	1331		Radiator	Solid	Metal	0.22
165	1974 Bldg	21	XRF	8/5/97	1	Classroom	1331	Wall	Wall	Solid	Drywall	0.08
166	1974 Bldg	22	XRF	8/5/97	1	Classroom	1331	Wall	Wall Rgstr	Solid	Metal	0
167	1974 Bldg	23	XRF	8/5/97	1	Classroom	1331	Wall	Midle Wall	Solid	Concrete	0.02
168	1974 Bldg	24	XRF	8/5/97	1	Classroom	1331	Wall	Column	Solid	Concrete	0.01
169	1974 Bldg	25	XRF	8/5/97	1	Classroom	1331	Door	Door	Solid	Wood	0
170	1974 Bldg	26	XRF	8/5/97	1	Classroom	1331	Window	Casing	Solid	Metal	0
171	1974 Bldg	27	XRF	8/5/97	1	Classroom	1331	Door	Casing	Solid	Metal	0
172	1974 Bldg	28	XRF	8/5/97	1	Classroom	1331	Wall	Midle Wall	Solid	Wood	0.05
173	1974 Bldg	29	XRF	8/5/97	1	Classroom	1331	Coat	Rack	Solid	Metal	0.01
174	1974 Bldg	14	XRF	9/4/97	1	Classroom	1331	Ceiling		Chalking	Drywall	0.02
175	1974 Bldg	15	XRF	9/4/97	1	Classroom	1331		Radiator	Solid	Metal	0.01
176	1974 Bldg	12	XRF	9/4/97	1	Classroom	1332	Ceiling		Chalking	Drywall	0.01
177	1974 Bldg	14	XRF	8/19/97	2	Classroom	2030	Wall	Wall	Solid	Concrete	0
178	1974 Bldg	15	XRF	8/19/97	2	Classroom	2030	Wall	Wall	Solid	Concrete	0

Saint Paul Public Schools  
 Galtier Magnet Elementary School  
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Componen	Feature	Condition	Substrate	Result
179	1974 Bldg	16	XRF	8/19/97	2	Classroom	2030	Wall	Wall	Solid	Drywall	0.01
180	1974 Bldg	17	XRF	8/19/97	2	Classroom	2030	Wall	Wall Rgstr	Solid	Metal	0
181	1974 Bldg	18	XRF	8/19/97	2	Classroom	2030	Wall	Wall Rgstr	Peeling	Metal	0
182	1974 Bldg	19	XRF	8/19/97	2	Classroom	2030	Door	Door	Solid	Wood	0
183	1974 Bldg	20	XRF	8/19/97	2	Classroom	2030	Window	Casing	Solid	Metal	0.02
184	1974 Bldg	21	XRF	8/19/97	2	Classroom	2030	Door	Casing	Solid	Metal	0
185	1974 Bldg	31	XRF	9/4/97	2	Classroom	2030	Ceiling		Chalking	Drywall	0.1
186	1974 Bldg	49	XRF	8/19/97	2	Classroom	2040	Wall	Wall	Solid	Drywall	0
187	1974 Bldg	50	XRF	8/19/97	2	Classroom	2040	Wall	Wall Rgstr	Solid	Metal	0
188	1974 Bldg	51	XRF	8/19/97	2	Classroom	2040	Wall	Wall	Solid	Concrete	0
189	1974 Bldg	52	XRF	8/19/97	2	Classroom	2040		Radiator	Solid	Metal	0.03
190	1974 Bldg	53	XRF	8/19/97	2	Classroom	2040	Window	Header	Solid	Wood	0
191	1974 Bldg	54	XRF	8/19/97	2	Classroom	2040	Wall	Column	Solid	Concrete	0.01
192	1974 Bldg	55	XRF	8/19/97	2	Classroom	2040	Door	Door	Solid	Wood	0
193	1974 Bldg	56	XRF	8/19/97	2	Classroom	2040	Window	Casing	Solid	Metal	0.01
194	1974 Bldg	57	XRF	8/19/97	2	Classroom	2040	Door Wind	Casing	Solid	Metal	0
195	1974 Bldg	58	XRF	8/19/97	2	Classroom	2040	Coat	Rack	Solid	Metal	0.02
196	1974 Bldg	59	XRF	8/19/97	2	Classroom	2040	Wall	Wall Rgstr	Solid	Metal	0
197	1974 Bldg	29	XRF	9/4/97	2	Classroom	2040	Ceiling		Chalking	Drywall	0.07
198	1974 Bldg	60	XRF	8/19/97	2	Classroom	2041	Wall	Midle Wall	Solid	Concrete	0.03
199	1974 Bldg	61	XRF	8/19/97	2	Classroom	2041	Door	Door	Solid	Wood	0
200	1974 Bldg	62	XRF	8/19/97	2	Classroom	2041	Window	Casing	Solid	Metal	0.02
201	1974 Bldg	63	XRF	8/19/97	2	Classroom	2041	Door	Casing	Solid	Metal	0
202	1974 Bldg	64	XRF	8/19/97	2	Classroom	2041	Window	Stool	Solid	Metal	0
203	1974 Bldg	22	XRF	8/19/97	2	Classroom	2051	Door	Column	Solid	Concrete	0
204	1974 Bldg	23	XRF	8/19/97	2	Classroom	2051	Wall	Midle Wall	Solid	Concrete	0
205	1974 Bldg	24	XRF	8/19/97	2	Classroom	2051		Radiator	Solid	Metal	0.18
206	1974 Bldg	25	XRF	8/19/97	2	Classroom	2051	Wall	Wall	Solid	Drywall	0.05
207	1974 Bldg	26	XRF	8/19/97	2	Classroom	2051	Wall	Wall Rgstr	Solid	Metal	0.02
208	1974 Bldg	27	XRF	8/19/97	2	Classroom	2051	Wall	Wall	Solid	Drywall	0.01
209	1974 Bldg	28	XRF	8/19/97	2	Classroom	2051	Door	Door	Solid	Wood	0
210	1974 Bldg	29	XRF	8/19/97	2	Classroom	2051	Window	Casing	Solid	Metal	0.01
211	1974 Bldg	30	XRF	8/19/97	2	Classroom	2051	Door	Casing	Solid	Metal	0
212	1974 Bldg	31	XRF	8/19/97	2	Classroom	2051	Wall	Wall Rgstr	Solid	Metal	0
213	1974 Bldg	32	XRF	8/19/97	2	Classroom	2051	Wall	Midle Wall	Solid	Concrete	0.09
214	1974 Bldg	33	XRF	8/19/97	2	Classroom	2051	Coat	Rack	Solid	Metal	0.07
215	1974 Bldg	34	XRF	8/19/97	2	Classroom	2051	Door	Door	Solid	Wood	0
216	1974 Bldg	35	XRF	8/19/97	2	Classroom	2051	Window	Casing	Solid	Metal	0.02
217	1974 Bldg	36	XRF	8/19/97	2	Classroom	2051	Door	Casing	Solid	Metal	0.01
218	1974 Bldg	37	XRF	8/19/97	2	Classroom	2051	Window	Stool	Solid	Metal	0
219	1974 Bldg	38	XRF	8/19/97	2	Classroom	2051	Wall	Wall Rgstr	Solid	Metal	0
220	1974 Bldg	32	XRF	9/4/97	2	Classroom	2051	Ceiling		Chalking	Drywall	0.03
221	1974 Bldg	39	XRF	8/19/97	2	Classroom	2052	Wall	Wall Rgstr	Solid	Metal	0.23
222	1974 Bldg	40	XRF	8/19/97	2	Classroom	2052	Wall	Wall	Solid	Concrete	0.09
223	1974 Bldg	41	XRF	8/19/97	2	Classroom	2052	Wall	Column	Solid	Concrete	0
224	1974 Bldg	42	XRF	8/19/97	2	Classroom	2052	Wall	Wall	Solid	Drywall	0.01
225	1974 Bldg	43	XRF	8/19/97	2	Classroom	2052	Wall	Wall Rgstr	Solid	Metal	0
226	1974 Bldg	44	XRF	8/19/97	2	Classroom	2052	Wall	Wall Rgstr	Solid	Metal	0
227	1974 Bldg	45	XRF	8/19/97	2	Classroom	2052	Door	Door	Solid	Wood	0
228	1974 Bldg	46	XRF	8/19/97	2	Classroom	2052	Window	Casing	Solid	Metal	0.01
229	1974 Bldg	47	XRF	8/19/97	2	Classroom	2052	Door	Casing	Solid	Metal	0
230	1974 Bldg	48	XRF	8/19/97	2	Classroom	2052	Coat	Rack	Solid	Metal	0
231	1974 Bldg	33	XRF	9/4/97	2	Classroom	2052	Ceiling		Chalking	Drywall	0.08
232	1974 Bldg	157	XRF	8/19/97	2	Classroom	2112	Wall	Wall	Solid	Concrete	0.01
233	1974 Bldg	158	XRF	8/19/97	2	Classroom	2112	Wall	Column	Solid	Concrete	0
234	1974 Bldg	121	XRF	8/19/97	2	Classroom	2131		Radiator	Solid	Metal	0.07
235	1974 Bldg	122	XRF	8/19/97	2	Classroom	2131	Wall	Midle Wall	Solid	Concrete	0
236	1974 Bldg	123	XRF	8/19/97	2	Classroom	2131	Wall	Column	Solid	Concrete	0
237	1974 Bldg	124	XRF	8/19/97	2	Classroom	2131	Wall	Wall	Solid	Drywall	0.01

Saint Paul Public Schools  
 Galtier Magnet Elementary School  
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Componen	Feature	Condition	Substrate	Result
238	1974 Bldg	125	XRF	8/19/97	2	Classroom	2131	Wall	Wall Rgstr	Solid	Metal	0
239	1974 Bldg	126	XRF	8/19/97	2	Classroom	2131	Wall	Wall Rgstr	Solid	Metal	0
240	1974 Bldg	127	XRF	8/19/97	2	Classroom	2131	Door	Door	Solid	Wood	0.02
241	1974 Bldg	128	XRF	8/19/97	2	Classroom	2131	Window	Casing	Solid	Metal	0.03
242	1974 Bldg	129	XRF	8/19/97	2	Classroom	2131	Door	Casing	Solid	Metal	0
243	1974 Bldg	130	XRF	8/19/97	2	Classroom	2131	Coat	Rack	Solid	Metal	0.03
244	1974 Bldg	26	XRF	9/4/97	2	Classroom	2131	Ceiling		Chalking	Drywall	0.07
245	1974 Bldg	104	XRF	8/19/97	2	Classroom	2132	Wall	Wall Rgstr	Solid	Metal	0.05
246	1974 Bldg	105	XRF	8/19/97	2	Classroom	2132	Wall	Midle Wall	Solid	Concrte	0
247	1974 Bldg	106	XRF	8/19/97	2	Classroom	2132	Wall	Midle Wall	Solid	Concrte	0.02
248	1974 Bldg	107	XRF	8/19/97	2	Classroom	2132		Radiator	Solid	Metal	0.03
249	1974 Bldg	108	XRF	8/19/97	2	Classroom	2132	Window	Header	Solid	Wood	0
250	1974 Bldg	109	XRF	8/19/97	2	Classroom	2132	Wall	Wall	Solid	Drywall	0.03
251	1974 Bldg	110	XRF	8/19/97	2	Classroom	2132	Wall	Wall Rgstr	Solid	Metal	0
252	1974 Bldg	111	XRF	8/19/97	2	Classroom	2132	Door	Door	Solid	Wood	0
253	1974 Bldg	112	XRF	8/19/97	2	Classroom	2132	Window	Casing	Solid	Metal	0.02
254	1974 Bldg	113	XRF	8/19/97	2	Classroom	2132	Door	Jamb	Solid	Metal	0
255	1974 Bldg	114	XRF	8/19/97	2	Classroom	2132	Window	Stool	Solid	Metal	0
256	1974 Bldg	115	XRF	8/19/97	2	Classroom	2132	Coat	Rack	Solid	Metal	0.01
257	1974 Bldg	116	XRF	8/19/97	2	Classroom	2132	Wall	Column	Solid	Concrte	0.02
258	1974 Bldg	117	XRF	8/19/97	2	Classroom	2132	Door	Door	Solid	Wood	0
259	1974 Bldg	118	XRF	8/19/97	2	Classroom	2132	Window	Casing	Solid	Metal	0.02
260	1974 Bldg	119	XRF	8/19/97	2	Classroom	2132	Door	Casing	Solid	Metal	0
261	1974 Bldg	120	XRF	8/19/97	2	Classroom	2132	Wall	Wall Rgstr	Solid	Metal	0.01
262	1974 Bldg	28	XRF	9/4/97	2	Classroom	2132	Ceiling		Chalking	Drywall	0.1
263	1974 Bldg	131	XRF	8/19/97	2	Classroom	2135	Wall	Wall Rgstr	Solid	Metal	0.01
264	1974 Bldg	132	XRF	8/19/97	2	Classroom	2135	Cabinet	Door	Solid	Wood	0
265	1974 Bldg	133	XRF	8/19/97	2	Classroom	2135	Wall	Wall	Solid	Drywall	0
266	1974 Bldg	134	XRF	8/19/97	2	Classroom	2135	Wall	Wall Rgstr	Solid	Metal	0
267	1974 Bldg	135	XRF	8/19/97	2	Classroom	2135		Radiator	Solid	Metal	0.06
268	1974 Bldg	136	XRF	8/19/97	2	Classroom	2135	Window	Header	Solid	Wood	0
269	1974 Bldg	137	XRF	8/19/97	2	Classroom	2135	Wall	Wall	Solid	Concrte	0
270	1974 Bldg	138	XRF	8/19/97	2	Classroom	2135	Wall	Column	Solid	Concrte	0
271	1974 Bldg	139	XRF	8/19/97	2	Classroom	2135	Coat	Rack	Solid	Metal	0.01
272	1974 Bldg	140	XRF	8/19/97	2	Classroom	2135	Door	Door	Solid	Wood	0
273	1974 Bldg	141	XRF	8/19/97	2	Classroom	2135	Window	Casing	Solid	Metal	0.02
274	1974 Bldg	142	XRF	8/19/97	2	Classroom	2135	Door	Casing	Solid	Metal	0
275	1974 Bldg	143	XRF	8/19/97	2	Classroom	2135	Ceiling		Solid	Concrte	0.07
276	1974 Bldg	25	XRF	9/4/97	2	Classroom	2135	Ceiling		Chalking	Drywall	0.05
277	1974 Bldg	27	XRF	9/4/97	2	Classroom	2138	Ceiling		Chalking	Drywall	0
278	1974 Bldg	159	XRF	8/19/97	2	Classroom	2212	Door	Door	Solid	Wood	0
279	1974 Bldg	160	XRF	8/19/97	2	Classroom	2212	Window	Casing	Solid	Metal	0
280	1974 Bldg	161	XRF	8/19/97	2	Classroom	2212	Door	Casing	Solid	Metal	0
281	1974 Bldg	162	XRF	8/19/97	2	Classroom	2212	Window	Stool	Solid	Metal	0
282	1974 Bldg	163	XRF	8/19/97	2	Classroom	2212	Window	Stool	Solid	Metal	0
283	1974 Bldg	164	XRF	8/19/97	2	Classroom	2212	Door	Jamb	Solid	Metal	0
284	1974 Bldg	13	XRF	8/19/97	2	Classroom	20302		Radiator	Solid	Metal	0.01
285	1974 Bldg	142	XRF	8/5/97	1	Gym	1	Wall	Wall	Solid	Concrte	0
286	1974 Bldg	143	XRF	8/5/97	1	Gym	1	Wall	Wall	Solid	Concrte	0
287	1974 Bldg	144	XRF	8/5/97	1	Gym	1	Wall	Wall	Solid	Concrte	0.01
288	1974 Bldg	145	XRF	8/5/97	1	Gym	1	Wall	Wall Rgstr	Solid	Metal	0
289	1974 Bldg	146	XRF	8/5/97	1	Gym	1	Door	Door	Solid	Metal	0.01
290	1974 Bldg	147	XRF	8/5/97	1	Gym	1	Door	Casing	Solid	Metal	0.01
291	1974 Bldg	148	XRF	8/5/97	1	Gym	1	Door	Door	Solid	Metal	0.48
292	1974 Bldg	149	XRF	8/5/97	1	Gym	1	Door	Door	Solid	Wood	0
293	1974 Bldg	150	XRF	8/5/97	1	Gym	1	Wall	Midle Wall	Solid	Drywall	0.03
294	1974 Bldg	151	XRF	8/5/97	1	Gym	1	Wall	Midle Wall	Peeling	Metal	0
295	1974 Bldg	152	XRF	8/5/97	1	Gym	1	Wall	Midle Wall	Solid	Concrte	0
296	1974 Bldg	153	XRF	8/5/97	1	Gym	1	Door	Door	Solid	Metal	0

Saint Paul Public Schools  
 Galtier Magnet Elementary School  
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Componen	Feature	Condition	Substrate	Result
297	1974 Bldg	154	XRF	8/5/97	1	Gym	1	Door	Jamb	Solid	Metal	0
298	1974 Bldg	155	XRF	8/5/97	1	Gym	1	Wall	Midle Wall	Solid	Drywall	0.65
299	1974 Bldg	176	XRF	8/5/97	1	Hall	1030	Wall	Midle Wall	Solid	Concrete	0
300	1974 Bldg	177	XRF	8/5/97	1	Hall	1030	Wall	Midle Wall	Solid	Concrete	0.07
301	1974 Bldg	178	XRF	8/5/97	1	Hall	1030	Wall	Midle Wall	Solid	Concrete	0.11
302	1974 Bldg	179	XRF	8/5/97	1	Hall	1030	Wall	Midle Wall	Solid	Concrete	0.04
303	1974 Bldg	180	XRF	8/5/97	1	Hall	1030	Wall	Column	Solid	Concrete	0.04
304	1974 Bldg	181	XRF	8/5/97	1	Hall	1030	Wall	Column	Solid	Concrete	0
305	1974 Bldg	182	XRF	8/5/97	1	Hall	1030	Stairs	Hand rail	Solid	Wood	0
306	1974 Bldg	183	XRF	8/5/97	1	Hall	1030	Stairs	Baluster	Solid	Metal	0.03
307	1974 Bldg	184	XRF	8/5/97	1	Hall	1030	Door	Door	Solid	Metal	0.01
308	1974 Bldg	185	XRF	8/5/97	1	Hall	1030	Door	Casing	Solid	Metal	0
309	1974 Bldg	186	XRF	8/5/97	1	Hall	1030		Radiator	Solid	Metal	0
310	1974 Bldg	187	XRF	8/5/97	1	Hall	1030	Door	Door	Solid	Metal	0
311	1974 Bldg	188	XRF	8/5/97	1	Hall	1030	Wall	Midle Wall	Solid	Concrete	0
312	1974 Bldg	189	XRF	8/5/97	1	Hall	1030	Wall	Midle Wall	Solid	Concrete	0.01
313	1974 Bldg	190	XRF	8/5/97	1	Hall	1030	Wall	Column	Solid	Concrete	0
314	1974 Bldg	191	XRF	8/5/97	1	Hall	1030	Wall	Midle Wall	Solid	Concrete	0
315	1974 Bldg	192	XRF	8/5/97	1	Hall	1030	Wall	Midle Wall	Solid	Concrete	0.07
316	1974 Bldg	193	XRF	8/5/97	1	Hall	1030	Wall	Midle Wall	Solid	Wood	0
317	1974 Bldg	194	XRF	8/5/97	1	Hall	1030	Door	Door	Solid	Wood	0
318	1974 Bldg	195	XRF	8/5/97	1	Hall	1030	Window	Casing	Solid	Metal	0
319	1974 Bldg	196	XRF	8/5/97	1	Hall	1030	Window	Casing	Solid	Metal	0.01
320	1974 Bldg	197	XRF	8/5/97	1	Hall	1030	Window	Stool	Solid	Metal	0
321	1974 Bldg	156	XRF	8/5/97	1	Hall	1050	Wall	Midle Wall	Solid	Concrete	0
322	1974 Bldg	157	XRF	8/5/97	1	Hall	1050	Door	Door	Solid	Wood	0
323	1974 Bldg	158	XRF	8/5/97	1	Hall	1050	Door	Casing	Solid	Metal	0.03
324	1974 Bldg	159	XRF	8/5/97	1	Hall	1050	Door	Door	Solid	Wood	0
325	1974 Bldg	160	XRF	8/5/97	1	Hall	1050	Door	Door	Solid	Concrete	0.02
326	1974 Bldg	161	XRF	8/5/97	1	Hall	1050		Elec Pane	Solid	Metal	0
327	1974 Bldg	162	XRF	8/5/97	1	Hall	1050	Wall	Wall Rgstr	Solid	Metal	0
328	1974 Bldg	163	XRF	8/5/97	1	Hall	1050	Wall	Midle Wall	Solid	Concrete	0
329	1974 Bldg	164	XRF	8/5/97	1	Hall	1050	Wall	Midle Wall	Solid	Concrete	0
330	1974 Bldg	165	XRF	8/5/97	1	Hall	1050	Wall	Column	Solid	Concrete	0
331	1974 Bldg	166	XRF	8/5/97	1	Hall	1050	Door	Door	Solid	Metal	0
332	1974 Bldg	167	XRF	8/5/97	1	Hall	1050	Door	Jamb	Solid	Metal	0
333	1974 Bldg	168	XRF	8/5/97	1	Hall	1050	Wall	Mural	Solid	Concrete	0.01
334	1974 Bldg	169	XRF	8/5/97	1	Hall	1050	Wall	Midle Wall	Solid	Wood	0.03
335	1974 Bldg	170	XRF	8/5/97	1	Hall	1050	Wall	Wall	Solid	Drywall	0.01
336	1974 Bldg	43	XRF	8/4/97	1	Hall	1170	Wall	Midle Wall	Solid	Concrete	0.01
337	1974 Bldg	44	XRF	8/4/97	1	Hall	1170	Door	Door	Solid	Wood	0
338	1974 Bldg	45	XRF	8/4/97	1	Hall	1170	Door	Casing	Solid	Wood	0
339	1974 Bldg	46	XRF	8/4/97	1	Hall	1170	Door	Door	Solid	Metal	0.02
340	1974 Bldg	47	XRF	8/4/97	1	Hall	1170	Door	Jamb	Solid	Metal	0
341	1974 Bldg	48	XRF	8/4/97	1	Hall	1170	Door	Header	Solid	Metal	0.01
342	1974 Bldg	49	XRF	8/4/97	1	Hall	1170		Radiator	Solid	Metal	0.08
343	1974 Bldg	50	XRF	8/4/97	1	Hall	1170	Wall	Midle Wall	Solid	Concrete	0
344	1974 Bldg	51	XRF	8/4/97	1	Hall	1170		Radiator	Solid	Metal	0.08
345	1974 Bldg	52	XRF	8/4/97	1	Hall	1170	Door	Door	Solid	Metal	0
346	1974 Bldg	53	XRF	8/4/97	1	Hall	1170		Ceiling	Solid	Drywall	0.28
347	1974 Bldg	201	XRF	8/5/97	1	Hall	1245	Wall	Midle Wall	Comply	Metal	0.02
348	1974 Bldg	202	XRF	8/5/97	1	Hall	1245	Door	Door	Solid	Metal	0.01
349	1974 Bldg	203	XRF	8/5/97	1	Hall	1245	Door	Door	Solid	Metal	0.01
350	1974 Bldg	204	XRF	8/5/97	1	Hall	1245	Door	Casing	Solid	Metal	0.01
351	1974 Bldg	205	XRF	8/5/97	1	Hall	1245		Elec Pane	Solid	Metal	0.01
352	1974 Bldg	206	XRF	8/5/97	1	Hall	1245	Door	Door	Solid	Wood	0
353	1974 Bldg	207	XRF	8/5/97	1	Hall	1245	Door	Casing	Solid	Metal	0
354	1974 Bldg	208	XRF	8/5/97	1	Hall	1245	Window	Casing	Solid	Metal	0
355	1974 Bldg	209	XRF	8/5/97	1	Hall	1245	Window	Stool	Solid	Metal	0

Saint Paul Public Schools  
 Galtier Magnet Elementary School  
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Componen	Feature	Condition	Substrate	Result
356	1974 Bldg	210	XRF	8/5/97	1	Hall	1245	Wall	Wall	Solid	Wood	0
357	1974 Bldg	211	XRF	8/5/97	1	Hall	1245	Wall	Midle Wall	Solid	Concrete	0.01
358	1974 Bldg	212	XRF	8/5/97	1	Hall	1245	Door	Door	Solid	Metal	0
359	1974 Bldg	213	XRF	8/5/97	1	Hall	1245	Door	Casing	Solid	Metal	0
360	1974 Bldg	214	XRF	8/5/97	1	Hall	1245	Door	Door	Solid	Metal	0.01
361	1974 Bldg	215	XRF	8/5/97	1	Hall	1245	Wall	Midle Wall	Solid	Concrete	0.02
362	1974 Bldg	216	XRF	8/5/97	1	Hall	1245	Wall	Wall	Solid	Drywall	0
363	1974 Bldg	217	XRF	8/5/97	1	Hall	1245	Wall	Midle Wall	Solid	Concrete	0.05
364	1974 Bldg	218	XRF	8/5/97	1	Hall	1245	Stairs	Rail cap	Solid	Wood	0
365	1974 Bldg	219	XRF	8/5/97	1	Hall	1245	Stairs	Baluster	Solid	Metal	0
366	1974 Bldg	220	XRF	8/5/97	1	Hall	1245	Wall	Column	Solid	Concrete	0
367	1974 Bldg	221	XRF	8/5/97	1	Hall	1245	Door	Door	Solid	Metal	0.11
368	1974 Bldg	222	XRF	8/5/97	1	Hall	1245	Door	Casing	Solid	Metal	0.1
369	1974 Bldg	223	XRF	8/5/97	1	Hall	1245	Door	Casing	Solid	Concrete	0.07
370	1974 Bldg	11	XRF	8/25/97	2	Hall	2000	Door	Door	Solid	Metal	0
371	1974 Bldg	12	XRF	8/25/97	2	Hall	2000	Door	Jamb	Solid	Metal	0
372	1974 Bldg	13	XRF	8/25/97	2	Hall	2000	Wall	Midle Wall	Solid	Concrete	0
373	1974 Bldg	14	XRF	8/25/97	2	Hall	2000	Wall	Midle Wall	Solid	Concrete	0
374	1974 Bldg	15	XRF	8/25/97	2	Hall	2000		Elec Pane	Solid	Metal	0
375	1974 Bldg	16	XRF	8/25/97	2	Hall	2000	Window	Stool	Solid	Metal	0
376	1974 Bldg	17	XRF	8/25/97	2	Hall	2000	Door	Door	Solid	Wood	0
377	1974 Bldg	18	XRF	8/25/97	2	Hall	2000	Window	Casing	Solid	Metal	0.04
378	1974 Bldg	19	XRF	8/25/97	2	Hall	2000	Wall	Midle Wall	Solid	Concrete	0
379	1974 Bldg	20	XRF	8/25/97	2	Hall	2000	Wall	Midle Wall	Solid	Concrete	0
380	1974 Bldg	21	XRF	8/25/97	2	Hall	2000	Wall	Column	Solid	Concrete	0.01
381	1974 Bldg	22	XRF	8/25/97	2	Hall	2000	Wall	Cap	Solid	Wood	0
382	1974 Bldg	23	XRF	8/25/97	2	Hall	2000	Door	Door	Solid	Metal	0.11
383	1974 Bldg	24	XRF	8/25/97	2	Hall	2000	Door	Casing	Solid	Metal	0.08
384	1974 Bldg	27	XRF	8/4/97	1	Kitchen	1190	Wall	Midle Wall	Solid	Concrete	0
385	1974 Bldg	28	XRF	8/4/97	1	Kitchen	1190	Wall	Wall Rgstr	Solid	Metal	0.01
386	1974 Bldg	29	XRF	8/4/97	1	Kitchen	1190	Door	Door	Solid	Wood	0
387	1974 Bldg	30	XRF	8/4/97	1	Kitchen	1190	Door	Casing	Solid	Metal	0
388	1974 Bldg	31	XRF	8/4/97	1	Kitchen	1190	Wall	Midle Wall	Solid	Wood	1.09
389	1974 Bldg	32	XRF	8/4/97	1	Kitchen	1190	Wall	Column	Solid	Concrete	0.01
390	1974 Bldg	33	XRF	8/4/97	1	Kitchen	1190		Elec Pane	Solid	Metal	0
391	1974 Bldg	224	XRF	8/5/97	2	Library	2000	Wall	Wall	Solid	Concrete	0
392	1974 Bldg	225	XRF	8/5/97	2	Library	2000	Wall	Wall	Solid	Concrete	0
393	1974 Bldg	226	XRF	8/5/97	2	Library	2000	Wall	Cap	Solid	Wood	0
394	1974 Bldg	227	XRF	8/5/97	2	Library	2000	Bookcase	Shelf	Solid	Metal	0
395	1974 Bldg	228	XRF	8/5/97	2	Library	2000	Door	Door	Solid	Metal	0.09
396	1974 Bldg	229	XRF	8/5/97	2	Library	2000	Door	Casing	Solid	Metal	0.11
397	1974 Bldg	230	XRF	8/5/97	2	Library	2000	Stairs	Baluster	Solid	Metal	0.03
398	1974 Bldg	231	XRF	8/5/97	2	Library	2000	Wall	Wall	Solid	Concrete	0.07
399	1974 Bldg	232	XRF	8/5/97	2	Library	2000	Wall	Column	Solid	Concrete	0.01
400	1974 Bldg	23	XRF	9/4/97	2	Library	2000	Ceiling		Chalking	Drywall	0
401	1974 Bldg	233	XRF	8/5/97	2	Library/Gazee	2000	Wall	Midle Wall	Solid	Wood	1.13
402	1974 Bldg	234	XRF	8/5/97	2	Library/Gazee	2000	Wall	Midle Wall	Solid	Wood	0
403	1974 Bldg	235	XRF	8/5/97	2	Library/Gazee	2000	Wall	Midle Wall	Solid		0
404	1974 Bldg	236	XRF	8/5/97	2	Library/Gazee	2000	Wall	Midle Wall	Solid		0
405	1974 Bldg	237	XRF	8/5/97	2	Library/Gazee	2000	Wall	Midle Wall	Solid		0
406	1974 Bldg	238	XRF	8/5/97	2	Library/Gazee	2000	Wall	Midle Wall	Solid		0
407	1974 Bldg	239	XRF	8/5/97	2	Library/Gazee	2000	Wall	Midle Wall	Solid		1.06
408	1974 Bldg	240	XRF	8/5/97	2	Library/Gazee	2000	Wall	Midle Wall	Solid	Drywall	0
409	1974 Bldg	241	XRF	8/5/97	2	Library/Gazee	2000	Wall	Midle Wall	Solid		0
410	1974 Bldg	242	XRF	8/5/97	2	Library/Gazee	2000	Cabinet	Door	Solid	Wood	0
411	1974 Bldg	243	XRF	8/5/97	2	Library/Gazee	2000	Cabinet	Shelf	Solid	Wood	0
412	1974 Bldg	244	XRF	8/5/97	2	Library/Gazee	2000	Wall	Wall	Solid	Drywall	0.45
413	1974 Bldg	62	XRF	8/25/97	1	Lounge	1375	Door	Door	Solid	Wood	0.02
414	1974 Bldg	63	XRF	8/25/97	1	Lounge	1375	Wall	Midle Wall	Solid	Concrete	0.06

Saint Paul Public Schools  
 Galtier Magnet Elementary School  
 Lead-Based Paint Inspection

A	B	C	D	E	F	G	H	I	J	K	L	
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Componen	Feature	Condition	Substrate	Result
415	1974 Bldg	64	XRF	8/25/97	1	Lounge	1375	Window	Casing	Solid	Metal	0.01
416	1974 Bldg	65	XRF	8/25/97	1	Lounge	1375	Wall	Column	Solid	Concrete	0.08
417	1974 Bldg	66	XRF	8/25/97	1	Lounge	1375	Wall	Midle Wall	Solid	Concrete	0.01
418	1974 Bldg	67	XRF	8/25/97	1	Lounge	1375	Wall	Column	Solid	Concrete	0
419	1974 Bldg	68	XRF	8/25/97	1	Lounge	1375	Cabinet	Door	Solid	Wood	0
420	1974 Bldg	81	XRF	8/25/97	1	Main	1379	Door	Door	Solid	Wood	0
421	1974 Bldg	82	XRF	8/25/97	1	Main	1379	Wall	Column	Solid	Concrete	0
422	1974 Bldg	83	XRF	8/25/97	1	Main	1379	Stairs	Baluster	Solid	Metal	0
423	1974 Bldg	84	XRF	8/25/97	1	Main	1379	Stairs	Rail cap	Solid	Wood	0
424	1974 Bldg	85	XRF	8/25/97	1	Main	1379	Stairs	Rail cap	Solid	Wood	0
425	1974 Bldg	86	XRF	8/25/97	1	Main	1379	Door	Door	Solid	Metal	0.14
426	1974 Bldg	87	XRF	8/25/97	1	Main	1379	Door	Casing	Solid	Metal	0.12
427	1974 Bldg	88	XRF	8/25/97	1	Main	1379	Wall	Midle Wall	Solid	Concrete	0
428	1974 Bldg	89	XRF	8/25/97	1	Main	1379	Wall	Midle Wall	Solid	Concrete	0
429	1974 Bldg	90	XRF	8/25/97	1	Main	1379		Elec Pane	Solid	Metal	0.01
430	1974 Bldg	91	XRF	8/25/97	1	Main	1379	Wall	Box	Solid	Wood	0
431	1974 Bldg	92	XRF	8/25/97	1	Main	1379	Door	Casing	Solid	Metal	0.03
432	1974 Bldg	93	XRF	8/25/97	1	Main	1379	Wall	Midle Wall	Solid	Concrete	0
433	1974 Bldg	94	XRF	8/25/97	1	Main	1379	Wall	Column	Solid	Concrete	0
434	1974 Bldg	95	XRF	8/25/97	1	Main	1379	Wall	Wall Rgstr	Solid	Metal	0
435	1974 Bldg	96	XRF	8/25/97	1	Main	1379	Wall	Wall	Solid	Drywall	0
436	1974 Bldg	97	XRF	8/25/97	1	Main	1379	Wall	Wall	Solid	Wood	0
437	1974 Bldg	98	XRF	8/25/97	1	Outside	0	Wall	Wall Rgstr	Solid	Metal	0.02
438	1974 Bldg	99	XRF	8/25/97	1	Outside	0	Door	Door	Solid	Metal	0.02
439	1974 Bldg	100	XRF	8/25/97	1	Outside	0	Door	Casing	Solid	Metal	0
440	1974 Bldg	101	XRF	8/25/97	1	Outside	0	Door	Door	Solid	Metal	0.01
441	1974 Bldg	102	XRF	8/25/97	1	Outside	0	Stairs	Hand rail	Solid	Metal	0.01
442	1974 Bldg	103	XRF	8/25/97	1	Outside	0	Door	Door	Solid	Metal	0
443	1974 Bldg	104	XRF	8/25/97	1	Outside	0	Door	Casing	Solid	Metal	0
444	1974 Bldg	105	XRF	8/25/97	1	Outside	0	Door	Door	Solid	Metal	0.01
445	1974 Bldg	106	XRF	8/25/97	1	Outside	0	Flag	Pole	Solid	Metal	4.33
446	1974 Bldg	107	XRF	8/25/97	1	Outside	0	Door	Door	Solid	Metal	0
447	1974 Bldg	108	XRF	8/25/97	1	Outside	0	Door	Casing	Solid	Metal	0.01
448	1974 Bldg	109	XRF	8/25/97	1	Outside	0	Door	Door	Solid	Metal	0
449	1974 Bldg	118	XRF	8/5/97	1	Restroom	1150	Door	Door	Solid	Wood	0
450	1974 Bldg	119	XRF	8/5/97	1	Restroom	1150	Door	Casing	Solid	Metal	0.02
451	1974 Bldg	120	XRF	8/5/97	1	Restroom	1150	Wall	Wall Rgstr	Solid	Metal	0
452	1974 Bldg	121	XRF	8/5/97	1	Restroom	1150	Wall	Midle Wall	Solid	Concrete	0
453	1974 Bldg	122	XRF	8/5/97	1	Restroom	1150	Wall	Midle Wall	Solid	Concrete	0
454	1974 Bldg	123	XRF	8/5/97	1	Restroom	1150	Wall	Bthrm Stll	Solid	Metal	0.02
455	1974 Bldg	124	XRF	8/5/97	1	Restroom	1150	Wall	Column	Solid	Concrete	0.01
456	1974 Bldg	125	XRF	8/5/97	1	Restroom	1150	Ceiling		Solid	Plaster	0.15
457	1974 Bldg	112	XRF	8/5/97	1	Restroom	1160	Door	Door	Solid	Wood	0
458	1974 Bldg	113	XRF	8/5/97	1	Restroom	1160	Door	Casing	Solid	Metal	0
459	1974 Bldg	114	XRF	8/5/97	1	Restroom	1160	Wall	Wall Rgstr	Solid	Metal	0
460	1974 Bldg	115	XRF	8/5/97	1	Restroom	1160	Wall	Midle Wall	Solid	Concrete	0
461	1974 Bldg	116	XRF	8/5/97	1	Restroom	1160	Wall	Stall Door	Solid	Metal	0.04
462	1974 Bldg	117	XRF	8/5/97	1	Restroom	1160	Ceiling		Solid	Plaster	0.11
463	1974 Bldg	54	XRF	8/4/97	1	Restroom	1201	Wall	Midle Wall	Solid	Concrete	0.01
464	1974 Bldg	55	XRF	8/4/97	1	Restroom	1201	Wall	Midle Wall	Solid	Concrete	0.03
465	1974 Bldg	56	XRF	8/4/97	1	Restroom	1201		Stall Door	Solid	Metal	0.05
466	1974 Bldg	57	XRF	8/4/97	1	Restroom	1201	Wall	Bthrm Stll	Solid	Metal	0.01
467	1974 Bldg	58	XRF	8/4/97	1	Restroom	1201		Radiator	Solid	Metal	0
468	1974 Bldg	59	XRF	8/4/97	1	Restroom	1201	Door	Door	Solid	Wood	0
469	1974 Bldg	60	XRF	8/4/97	1	Restroom	1201	Door	Casing	Solid	Metal	0
470	1974 Bldg	61	XRF	8/4/97	1	Restroom	1201	Ceiling		Solid	Drywall	0.3
471	1974 Bldg	62	XRF	8/4/97	1	Restroom	1211		Radiator	Solid	Metal	0
472	1974 Bldg	63	XRF	8/4/97	1	Restroom	1211	Wall	Wall	Solid	Concrete	0
473	1974 Bldg	64	XRF	8/4/97	1	Restroom	1211		Bthrm Stll	Solid	Metal	0.09

Saint Paul Public Schools  
 Galtier Magnet Elementary School  
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Componen	Feature	Condition	Substrate	Result
474	1974 Bldg	65	XRF	8/4/97	1	Restroom	1211		Stall Door	Solid	Metal	0.06
475	1974 Bldg	66	XRF	8/4/97	1	Restroom	1211	Door	Door	Solid	Wood	0
476	1974 Bldg	67	XRF	8/4/97	1	Restroom	1211	Door	Casing	Solid	Metal	0
477	1974 Bldg	68	XRF	8/4/97	1	Restroom	1211	Wall	Midle Wall	Solid	Concrete	0.01
478	1974 Bldg	69	XRF	8/4/97	1	Restroom	1211	Ceiling		Solid	Drywall	0.15
479	1974 Bldg	52	XRF	8/25/97	1	Restroom	1376	Wall	Midle Wall	Solid	Concrete	0.02
480	1974 Bldg	53	XRF	8/25/97	1	Restroom	1376	Wall	Stall Door	Solid	Metal	0
481	1974 Bldg	54	XRF	8/25/97	1	Restroom	1376	Door	Door	Solid	Wood	0
482	1974 Bldg	55	XRF	8/25/97	1	Restroom	1376	Door	Casing	Solid	Metal	0
483	1974 Bldg	56	XRF	8/25/97	1	Restroom	1376	Ceiling	Wall	Solid	Drywall	0.11
484	1974 Bldg	57	XRF	8/25/97	1	Restroom	1377	Wall	Midle Wall	Solid	Concrete	0.09
485	1974 Bldg	58	XRF	8/25/97	1	Restroom	1377	Door	Door	Solid	Wood	0
486	1974 Bldg	59	XRF	8/25/97	1	Restroom	1377	Door	Bthrm Stll	Solid	Metal	0.04
487	1974 Bldg	60	XRF	8/25/97	1	Restroom	1377	Door	Casing	Solid	Metal	0
488	1974 Bldg	61	XRF	8/25/97	1	Restroom	1377	Ceiling		Solid	Drywall	0.17
489	1974 Bldg	73	XRF	8/25/97	1	Restroom	1382	Wall	Midle Wall	Solid	Concrete	0
490	1974 Bldg	74	XRF	8/25/97	1	Restroom	1382	Door	Door	Solid	Wood	0
491	1974 Bldg	75	XRF	8/25/97	1	Restroom	1382	Door	Casing	Solid	Metal	0
492	1974 Bldg	76	XRF	8/25/97	1	Restroom	1382	Ceiling	Wall	Solid	Drywall	0.09
493	1974 Bldg	76	XRF	8/19/97	2	Restroom	2270	Wall	Midle Wall	Solid	Concrete	0
494	1974 Bldg	77	XRF	8/19/97	2	Restroom	2270	Wall	Wall	Solid	Concrete	0
495	1974 Bldg	78	XRF	8/19/97	2	Restroom	2270	Wall	Bthrm Stll	Solid	Metal	0.04
496	1974 Bldg	79	XRF	8/19/97	2	Restroom	2270	Wall	Bthrm Stll	Solid	Metal	0.07
497	1974 Bldg	80	XRF	8/19/97	2	Restroom	2270	Door	Door	Solid	Metal	0
498	1974 Bldg	81	XRF	8/19/97	2	Restroom	2270	Door	Jamb	Solid	Metal	0
499	1974 Bldg	82	XRF	8/19/97	2	Restroom	2270		Radiator	Solid	Metal	0
500	1974 Bldg	83	XRF	8/19/97	2	Restroom	2270	Door	Door	Solid	Metal	0
501	1974 Bldg	84	XRF	8/19/97	2	Restroom	2270	Door	Door	Solid	Wood	0
502	1974 Bldg	85	XRF	8/19/97	2	Restroom	2270	Door	Door	Solid	Metal	0
503	1974 Bldg	86	XRF	8/19/97	2	Restroom	2270	Ceiling		Solid	Drywall	0.28
504	1974 Bldg	87	XRF	8/19/97	2	Restroom	2270	Ceiling	Diffuser	Solid	Metal	0.06
505	1974 Bldg	65	XRF	8/19/97	2	Restroom	2280	Wall	Midle Wall	Solid	Concrete	0.06
506	1974 Bldg	66	XRF	8/19/97	2	Restroom	2280		Radiator	Solid	Metal	0
507	1974 Bldg	67	XRF	8/19/97	2	Restroom	2280	Wall	Stall Door	Solid	Metal	0.04
508	1974 Bldg	68	XRF	8/19/97	2	Restroom	2280	Wall	Bthrm Stll	Solid	Metal	0.07
509	1974 Bldg	69	XRF	8/19/97	2	Restroom	2280	Wall	Bthrm Stll	Solid	Metal	0.06
510	1974 Bldg	70	XRF	8/19/97	2	Restroom	2280	Door	Door	Solid	Wood	0
511	1974 Bldg	71	XRF	8/19/97	2	Restroom	2280	Door	Casing	Solid	Metal	0
512	1974 Bldg	72	XRF	8/19/97	2	Restroom	2280	Wall	Midle Wall	Solid	Concrete	0.05
513	1974 Bldg	73	XRF	8/19/97	2	Restroom	2280	Door	Door	Solid	Metal	0.01
514	1974 Bldg	74	XRF	8/19/97	2	Restroom	2280	Ceiling		Solid	Drywall	0.14
515	1974 Bldg	75	XRF	8/19/97	2	Restroom	2280	Ceiling	Diffuser	Solid	Metal	0
516	1974 Bldg	102	XRF	8/5/97	1	Room	1021	Door	Casing	Solid	Concrete	0.01
517	1974 Bldg	103	XRF	8/5/97	1	Room	1021	Wall	Column	Solid	Concrete	0
518	1974 Bldg	104	XRF	8/5/97	1	Room	1021		Radiator	Solid	Metal	0
519	1974 Bldg	105	XRF	8/5/97	1	Room	1021	Door	Casing	Solid	Metal	0.01
520	1974 Bldg	106	XRF	8/5/97	1	Room	1021	Door	Door	Solid	Wood	0
521	1974 Bldg	107	XRF	8/5/97	1	Room	1022	Wall	Midle Wall	Solid	Concrete	0
522	1974 Bldg	108	XRF	8/5/97	1	Room	1022	Door	Door	Solid	Wood	0
523	1974 Bldg	109	XRF	8/5/97	1	Room	1022	Door	Casing	Solid	Metal	0.02
524	1974 Bldg	110	XRF	8/5/97	1	Room	1022	Wall	Column	Solid	Concrete	0
525	1974 Bldg	111	XRF	8/5/97	1	Room	1022	Bookcase	Shelf	Solid	Wood	0
526	1974 Bldg	37	XRF	8/4/97	1	Room	1174	Wall	Midle Wall	Solid	Concrete	0
527	1974 Bldg	38	XRF	8/4/97	1	Room	1174	Wall	Midle Wall	Cracked	Concrete	0.01
528	1974 Bldg	39	XRF	8/4/97	1	Room	1174	Door	Door	Solid	Wood	0
529	1974 Bldg	40	XRF	8/4/97	1	Room	1174	Door	Casing	Solid	Metal	0
530	1974 Bldg	41	XRF	8/4/97	1	Room	1174	Ceiling		Solid	Drywall	0.2
531	1974 Bldg	42	XRF	8/4/97	1	Room	1174	Ceiling	Hatch	Solid	Metal	0
532	1974 Bldg	34	XRF	8/4/97	1	Room	1180	Wall	Midle Wall	Solid	Concrete	0.01

Saint Paul Public Schools  
 Galtier Magnet Elementary School  
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Componen	Feature	Condition	Substrate	Result
533	1974 Bldg	35	XRF	8/4/97	1	Room	1180	Door	Door	Solid	Metal	0
534	1974 Bldg	36	XRF	8/4/97	1	Room	1180	Door	Casing	Solid	Metal	0
535	1974 Bldg	6	XRF	8/4/97	1	Room	1204	Wall	Midle Wall	Solid	Concrete	0
536	1974 Bldg	7	XRF	8/4/97	1	Room	1204	Door	Door	Solid	Wood	0
537	1974 Bldg	8	XRF	8/4/97	1	Room	1204	Door	Casing	Solid	Metal	0
538	1974 Bldg	9	XRF	8/4/97	1	Room	1204		Locker	Solid	Metal	0.86
539	1974 Bldg	10	XRF	8/4/97	1	Room	1204	Wall	Column	Solid	Concrete	0
540	1974 Bldg	25	XRF	8/25/97	1	Room	1204	Ceiling	Wall	Solid	Concrete	0
541	1974 Bldg	11	XRF	8/4/97	1	Room	1205	Wall	Midle Wall	Solid	Concrete	0.02
542	1974 Bldg	12	XRF	8/4/97	1	Room	1205	Door	Door	Solid	Wood	0
543	1974 Bldg	13	XRF	8/4/97	1	Room	1205	Door	Casing	Solid	Metal	0
544	1974 Bldg	64	XRF	8/5/97	1	Room	1210	Door	Door	Solid	Metal	0
545	1974 Bldg	65	XRF	8/5/97	1	Room	1210	Door	Casing	Solid	Metal	0
546	1974 Bldg	66	XRF	8/5/97	1	Room	1210	Wall	Midle Wall	Solid	Concrete	0.01
547	1974 Bldg	67	XRF	8/5/97	1	Room	1210	Stairs	Hand rail	Solid	Metal	0.02
548	1974 Bldg	68	XRF	8/5/97	1	Room	1210	Door	Rosette	Solid	Metal	0
549	1974 Bldg	69	XRF	8/5/97	1	Room	1210	Door	Casing	Solid	Metal	0
550	1974 Bldg	70	XRF	8/5/97	1	Room	1210	Wall	Column	Solid	Concrete	0
551	1974 Bldg	71	XRF	8/5/97	1	Room	1210	Wall	Transom	Solid	Wood	0.03
552	1974 Bldg	72	XRF	8/5/97	1	Room	1210	Door	Door	Solid	Metal	0
553	1974 Bldg	73	XRF	8/5/97	1	Room	1210	Door	Casing	Solid	Metal	0
554	1974 Bldg	22	XRF	9/4/97	1	Room	1242	Ceiling		Chalking	Drywall	0.02
555	1974 Bldg	136	XRF	8/4/97	1	Room	1244	Window	Casing	Solid	Metal	0
556	1974 Bldg	137	XRF	8/4/97	1	Room	1244	Wall	Column	Solid	Concrete	0.02
557	1974 Bldg	138	XRF	8/4/97	1	Room	1244	Wall	Midle Wall	Solid	Drywall	0
558	1974 Bldg	139	XRF	8/4/97	1	Room	1244	Door	Door	Solid	Wood	0
559	1974 Bldg	140	XRF	8/4/97	1	Room	1244	Window	Casing	Solid	Metal	0.03
560	1974 Bldg	141	XRF	8/4/97	1	Room	1244	Door	Casing	Solid	Metal	0
561	1974 Bldg	131	XRF	8/4/97	1	Room	1245	Wall	Midle Wall	Solid	Drywall	0.02
562	1974 Bldg	132	XRF	8/4/97	1	Room	1245		Column	Solid	Concrete	0
563	1974 Bldg	133	XRF	8/4/97	1	Room	1245	Door	Door	Solid	Wood	0.03
564	1974 Bldg	134	XRF	8/4/97	1	Room	1245	Window	Casing	Solid	Metal	0.03
565	1974 Bldg	135	XRF	8/4/97	1	Room	1245	Window	Casing	Solid	Metal	0
566	1974 Bldg	86	XRF	8/4/97	1	Room	1249	Wall	Midle Wall	Solid	Drywall	0.15
567	1974 Bldg	87	XRF	8/4/97	1	Room	1249	Door	Door	Solid	Wood	0
568	1974 Bldg	88	XRF	8/4/97	1	Room	1249	Door	Casing	Solid	Metal	0
569	1974 Bldg	89	XRF	8/4/97	1	Room	1249	Window	Casing	Solid	Metal	0.02
570	1974 Bldg	90	XRF	8/4/97	1	Room	1249	Window	Casing	Solid	Metal	0
571	1974 Bldg	91	XRF	8/4/97	1	Room	1249	Door	Door	Solid	Metal	0
572	1974 Bldg	92	XRF	8/4/97	1	Room	1249	Door	Casing	Solid	Metal	0
573	1974 Bldg	93	XRF	8/4/97	1	Room	1249	Window	Casing	Solid	Metal	0.02
574	1974 Bldg	94	XRF	8/4/97	1	Room	1249	Wall	Midle Wall	Solid	Drywall	0
575	1974 Bldg	95	XRF	8/4/97	1	Room	1249	Wall	Midle Wall	Solid	Drywall	0
576	1974 Bldg	96	XRF	8/4/97	1	Room	1249	Wall	Midle Wall	Solid	Concrete	0.04
577	1974 Bldg	70	XRF	8/4/97	1	Room	1301	Wall	Midle Wall	Solid	Concrete	0.01
578	1974 Bldg	71	XRF	8/4/97	1	Room	1301	Wall	Column	Solid	Concrete	0
579	1974 Bldg	72	XRF	8/4/97	1	Room	1301	Door	Door	Solid	Metal	0.01
580	1974 Bldg	73	XRF	8/4/97	1	Room	1301	Door	Jamb	Solid	Metal	0
581	1974 Bldg	6	XRF	8/5/97	1	Room	1329	Door	Door	Solid	Wood	0
582	1974 Bldg	7	XRF	8/5/97	1	Room	1329	Door	Casing	Solid	Metal	0
583	1974 Bldg	8	XRF	8/5/97	1	Room	1329	Window	Casing	Solid	Metal	0
584	1974 Bldg	9	XRF	8/5/97	1	Room	1329	Wall	Column	Solid	Concrete	0
585	1974 Bldg	36	XRF	9/4/97	1	Room	1329	Ceiling		Chalking	Drywall	0.07
586	1974 Bldg	30	XRF	8/5/97	1	Room	1332	Wall	Midle Wall	Solid	Wood	0
587	1974 Bldg	31	XRF	8/5/97	1	Room	1332	Door	Door	Solid	Wood	0
588	1974 Bldg	32	XRF	8/5/97	1	Room	1332	Door	Door	Solid	Wood	0
589	1974 Bldg	33	XRF	8/5/97	1	Room	1332	Window	Casing	Solid	Metal	0.05
590	1974 Bldg	34	XRF	8/5/97	1	Room	1332	Door	Jamb	Solid	Metal	0
591	1974 Bldg	35	XRF	8/5/97	1	Room	1332	Wall	Wall	Solid	Concrete	0.01

Saint Paul Public Schools  
 Galtier Magnet Elementary School  
 Lead-Based Paint Inspection

A	B	C	D	E	F	G	H	I	J	K	L	
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Componen	Feature	Condition	Substrate	Result
592	1974 Bldg	36	XRF	8/5/97	1	Room	1332	Wall	Midle Wall	Solid	Concrete	0.01
593	1974 Bldg	37	XRF	8/5/97	1	Room	1333	Bookcase	Shelf	Solid	Wood	2.51
594	1974 Bldg	38	XRF	8/5/97	1	Room	1333	Door	Door	Solid	Wood	0
595	1974 Bldg	39	XRF	8/5/97	1	Room	1333	Window	Casing	Solid	Metal	0
596	1974 Bldg	40	XRF	8/5/97	1	Room	1333	Door	Casing	Solid	Metal	0
597	1974 Bldg	41	XRF	8/5/97	1	Room	1333	Wall	Midle Wall	Solid	Concrete	0
598	1974 Bldg	35	XRF	9/4/97	1	Room	1333	Ceiling		Chalking	Drywall	0.13
599	1974 Bldg	42	XRF	8/25/97	1	Room	1372	Wall	Midle Wall	Solid	Concrete	0
600	1974 Bldg	43	XRF	8/25/97	1	Room	1372	Window	Casing	Solid	Metal	0.01
601	1974 Bldg	44	XRF	8/25/97	1	Room	1372	Wall	Column	Solid	Concrete	0.01
602	1974 Bldg	45	XRF	8/25/97	1	Room	1372	Door	Door	Solid	Wood	0
603	1974 Bldg	46	XRF	8/25/97	1	Room	1373	Window	Casing	Solid	Metal	0
604	1974 Bldg	47	XRF	8/25/97	1	Room	1373	Wall	Midle Wall	Solid	Concrete	0
605	1974 Bldg	48	XRF	8/25/97	1	Room	1373	Door	Door	Solid	Wood	0
606	1974 Bldg	49	XRF	8/25/97	1	Room	1374	Wall	Midle Wall	Solid	Concrete	0
607	1974 Bldg	50	XRF	8/25/97	1	Room	1374	Window	Casing	Solid	Metal	0
608	1974 Bldg	51	XRF	8/25/97	1	Room	1374	Door	Door	Solid	Wood	0
609	1974 Bldg	69	XRF	8/25/97	1	Room	1380	Door	Door	Solid	Wood	0.02
610	1974 Bldg	70	XRF	8/25/97	1	Room	1380	Window	Casing	Solid	Metal	0
611	1974 Bldg	71	XRF	8/25/97	1	Room	1380	Cabinet	Door	Solid	Wood	0
612	1974 Bldg	72	XRF	8/25/97	1	Room	1380	Wall	Midle Wall	Solid	Concrete	0.02
613	1974 Bldg	26	XRF	8/25/97	1	Room	1381	Wall	Midle Wall	Solid	Concrete	0.03
614	1974 Bldg	27	XRF	8/25/97	1	Room	1381	Door	Door	Solid	Wood	0
615	1974 Bldg	28	XRF	8/25/97	1	Room	1381	Door	Casing	Solid	Metal	0.07
616	1974 Bldg	77	XRF	8/25/97	1	Room	1383	Wall	Midle Wall	Solid	Concrete	0
617	1974 Bldg	78	XRF	8/25/97	1	Room	1383	Door	Door	Solid	Wood	0
618	1974 Bldg	79	XRF	8/25/97	1	Room	1383	Wall	Column	Solid	Concrete	0
619	1974 Bldg	80	XRF	8/25/97	1	Room	1383	Cabinet	Door	Solid	Wood	0
620	1974 Bldg	36	XRF	8/25/97	1	Room	1384	Wall	Midle Wall	Solid	Concrete	0
621	1974 Bldg	37	XRF	8/25/97	1	Room	1384	Window	Casing	Solid	Metal	0.01
622	1974 Bldg	38	XRF	8/25/97	1	Room	1384	Cabinet	Door	Solid	Wood	0
623	1974 Bldg	39	XRF	8/25/97	1	Room	1384	Door	Door	Solid	Metal	0
624	1974 Bldg	40	XRF	8/25/97	1	Room	1384	Wall	Column	Solid	Concrete	0.01
625	1974 Bldg	41	XRF	8/25/97	1	Room	1384	Door	Door	Solid	Wood	0
626	1974 Bldg	29	XRF	8/25/97	1	Room	1385	Wall	Midle Wall	Solid	Concrete	0
627	1974 Bldg	30	XRF	8/25/97	1	Room	1385	Window	Stool	Solid	Metal	0
628	1974 Bldg	31	XRF	8/25/97	1	Room	1385	Wall	Column	Solid	Concrete	0
629	1974 Bldg	32	XRF	8/25/97	1	Room	1385	Door	Door	Solid	Wood	0
630	1974 Bldg	33	XRF	8/25/97	1	Room	1386	Wall	Midle Wall	Solid	Concrete	0
631	1974 Bldg	34	XRF	8/25/97	1	Room	1386	Window	Casing	Solid	Metal	0
632	1974 Bldg	35	XRF	8/25/97	1	Room	1386	Door	Door	Solid	Wood	0
633	1974 Bldg	7	XRF	8/25/97	2	Room	2004	Wall	Midle Wall	Solid	Concrete	0
634	1974 Bldg	8	XRF	8/25/97	2	Room	2004	Door	Door	Solid	Wood	0
635	1974 Bldg	9	XRF	8/25/97	2	Room	2004	Door	Casing	Solid	Metal	0.02
636	1974 Bldg	10	XRF	8/25/97	2	Room	2004	Floor		Solid	Concrete	0
637	1974 Bldg	30	XRF	9/4/97	2	Room	2004	Ceiling		Chalking	Drywall	0
638	1974 Bldg	6	XRF	8/19/97	2	Room	2031	Door	Door	Solid	Wood	0
639	1974 Bldg	7	XRF	8/19/97	2	Room	2031	Window	Casing	Solid	Metal	0.04
640	1974 Bldg	8	XRF	8/19/97	2	Room	2031	Door	Casing	Solid	Metal	0
641	1974 Bldg	9	XRF	8/19/97	2	Room	2031	Window	Stool	Solid	Metal	0
642	1974 Bldg	10	XRF	8/19/97	2	Room	2031	Wall	Wall	Solid	Concrete	0
643	1974 Bldg	11	XRF	8/19/97	2	Room	2031	Wall	Wall	Solid	Concrete	0.03
644	1974 Bldg	12	XRF	8/19/97	2	Room	2031	Wall	Column	Solid	Concrete	0
645	1974 Bldg	151	XRF	8/19/97	2	Room	2104	Door	Door	Solid	Wood	0
646	1974 Bldg	152	XRF	8/19/97	2	Room	2104	Door	Casing	Solid	Metal	0
647	1974 Bldg	153	XRF	8/19/97	2	Room	2104	Wall	Transom	Solid	Wood	0
648	1974 Bldg	154	XRF	8/19/97	2	Room	2104	Wall	Wall	Solid	Concrete	0.02
649	1974 Bldg	155	XRF	8/19/97	2	Room	2104	Wall	Transom	Solid	Wood	0
650	1974 Bldg	156	XRF	8/19/97	2	Room	2104		Radiator	Solid	Metal	0

Saint Paul Public Schools  
 Galtier Magnet Elementary School  
 Lead-Based Paint Inspection

3	A	B	C	D	E	F	G	H	I	J	K	L
Site	Sample #	Analysis	Date	Floor	Area	Room#	Compon	Feature	Condition	Substrate	Result	
651	1974 Bldg	34 XRF	9/4/97	2	Room	2104	Ceiling		Chalking	Drywall	0	
652	1974 Bldg	144 XRF	8/19/97	2	Room	2133	Door	Door	Solid	Wood	0	
653	1974 Bldg	145 XRF	8/19/97	2	Room	2133	Door	Casing	Solid	Metal	0	
654	1974 Bldg	146 XRF	8/19/97	2	Room	2133	Wall	Column	Solid	Concrete	0	
655	1974 Bldg	147 XRF	8/19/97	2	Room	2133	Wall	Column	Solid	Concrete	0.01	
656	1974 Bldg	148 XRF	8/19/97	2	Room	2133	Wall	Midle Wall	Solid	Concrete	0	
657	1974 Bldg	149 XRF	8/19/97	2	Room	2133	Wall	Wall	Solid	Drywall	0.01	
658	1974 Bldg	150 XRF	8/19/97	2	Room	2133	Wall	Wall Rgstr	Solid	Metal	0	
659	1974 Bldg	24 XRF	9/4/97	2	Room	2133	Ceiling		Chalking	Drywall	0.09	
660	1974 Bldg	95 XRF	8/19/97	2	Room	2138	Wall	Wall	Solid	Concrete	0.01	
661	1974 Bldg	96 XRF	8/19/97	2	Room	2138	Wall	Wall	Solid	Drywall	0	
662	1974 Bldg	97 XRF	8/19/97	2	Room	2138	Radiator	Solid	Metal	0.22		
663	1974 Bldg	98 XRF	8/19/97	2	Room	2138	Wall	Wall Rgstr	Solid	Metal	0	
664	1974 Bldg	99 XRF	8/19/97	2	Room	2138	Wall	Wall Rgstr	Solid	Metal	0	
665	1974 Bldg	100 XRF	8/19/97	2	Room	2138	Door	Door	Solid	Wood	0	
666	1974 Bldg	101 XRF	8/19/97	2	Room	2138	Window	Casing	Solid	Metal	0.02	
667	1974 Bldg	102 XRF	8/19/97	2	Room	2138	Door	Jamb	Solid	Metal	0	
668	1974 Bldg	103 XRF	8/19/97	2	Room	2138	Coat	Rack	Solid	Metal	0.01	
669	1974 Bldg	171 XRF	8/5/97	2	Room	2300	Door	Door	Solid	Metal	0	
670	1974 Bldg	172 XRF	8/5/97	2	Room	2300	Door	Casing	Solid	Metal	0	
671	1974 Bldg	173 XRF	8/5/97	2	Room	2300	Wall	Midle Wall	Solid	Concrete	0.07	
672	1974 Bldg	174 XRF	8/5/97	2	Room	2300	Stairs	Hand rail	Solid	Metal	0.13	
673	1974 Bldg	175 XRF	8/5/97	2	Room	2300	Wall	Transom	Solid	Wood	0	
674	1974 Bldg	88 XRF	8/19/97	2	Room	2310	Wall	Midle Wall	Solid	Concrete	0	
675	1974 Bldg	89 XRF	8/19/97	2	Room	2310	Stairs	Hand rail	Solid	Metal	0	
676	1974 Bldg	90 XRF	8/19/97	2	Room	2310	Door	Door	Solid	Metal	0	
677	1974 Bldg	91 XRF	8/19/97	2	Room	2310	Door	Casing	Solid	Metal	0	
678	1974 Bldg	92 XRF	8/19/97	2	Room	2310	Stairs	Hand rail	Solid	Metal	0.02	
679	1974 Bldg	93 XRF	8/19/97	2	Room	2310	Door	Door	Solid	Metal	0.04	
680	1974 Bldg	94 XRF	8/19/97	2	Room	2310	Door	Jamb	Solid	Metal	0	
681	1974 Bldg	55 XRF	8/5/97	2	Stairwell	200	Wall	Midle Wall	Solid	Concrete	0.01	
682	1974 Bldg	56 XRF	8/5/97	2	Stairwell	200	Wall	Wall	Solid	Concrete	0.02	
683	1974 Bldg	57 XRF	8/5/97	2	Stairwell	200	Stairs	Hand rail	Solid	Metal	0.01	
684	1974 Bldg	58 XRF	8/5/97	2	Stairwell	200	Door	Door	Solid	Metal	0	
685	1974 Bldg	59 XRF	8/5/97	2	Stairwell	200	Door	Jamb	Solid	Metal	0	
686	1974 Bldg	60 XRF	8/5/97	2	Stairwell	200	Stairs	Rail cap	Solid	Wood	0	
687	1974 Bldg	61 XRF	8/5/97	1	Stairwell	200	Radiator	Solid	Metal	0		
688	1974 Bldg	62 XRF	8/5/97	1	Stairwell	200	Door	Door	Solid	Metal	0.16	
689	1974 Bldg	63 XRF	8/5/97	1	Stairwell	200	Door	Casing	Solid	Metal	0	
690	1974 Bldg	42 XRF	8/5/97	1	Stairwell	300	Wall	Midle Wall	Solid	Concrete	0.05	
691	1974 Bldg	43 XRF	8/5/97	1	Stairwell	300	Wall	Wall	Solid	Concrete	0.05	
692	1974 Bldg	44 XRF	8/5/97	1	Stairwell	300	Wall	Wall	Solid	Concrete	0.02	
693	1974 Bldg	45 XRF	8/5/97	1	Stairwell	300	Stairs	Hand rail	Solid	Metal	0.07	
694	1974 Bldg	46 XRF	8/5/97	1	Stairwell	300	Door	Casing	Solid	Metal	0	
695	1974 Bldg	47 XRF	8/5/97	1	Stairwell	300	Door	Door	Solid	Metal	0.14	
696	1974 Bldg	48 XRF	8/5/97	1	Stairwell	300	Door	Door	Solid	Metal	0.01	
697	1974 Bldg	49 XRF	8/5/97	1	Stairwell	300	Door	Jamb	Solid	Metal	0.01	
698	1974 Bldg	50 XRF	8/5/97	1	Stairwell	300	Door	Casing	Solid	Metal	0	
699	1974 Bldg	51 XRF	8/5/97	1	Stairwell	300	Radiator	Solid	Metal	0		
700	1974 Bldg	52 XRF	8/5/97	2	Stairwell	300	Door	Door	Solid	Metal	0	
701	1974 Bldg	53 XRF	8/5/97	2	Stairwell	300	Door	Jamb	Solid	Metal	0	
702	1974 Bldg	54 XRF	8/5/97	2	Stairwell	300	Stairs	Rail cap	Solid	Wood	0	

## **APPENDIX B**

### **LABORATORY SAMPLE ANALYSIS DATA**

**LABORATORY ANALYSIS REPORT****DATE:** September 10, 1997**PAGE:**

1 Of 1

**CLIENT:** Midwest Environmental Cons.  
38894 Llama St.  
Dalbo, MN 55017**PROJECT NO.:** 082697-200888  
**COLLECTION DATE:** 8/25/97  
**COLLECTED BY:** Client  
**RECEIVED DATE:** 8/26/97  
**PROJECT DESCRIPT.:** 62/0197AJ**CONTACT:** Richard Cox

<u>SAMPLE #</u>	<u>DESCP.</u>	<u>MDL</u>	<u>LEAD</u> (6010A)	<u>ANALYSIS</u>	<u>DATE</u>
			<u>RESULTS</u>		
L975849-1	PC-1	25	ND		9/09/97
L975849-2	PC-2	36	71		9/09/97
L975849-3	PC-3	36	ND		9/09/97
L975849-4	PC-4	57	1800		9/09/97
L975849-5	PC-5	42	180		9/09/97
L975849-6	PC-6	15	ND		9/09/97
L975849-7	PC-7	49	ND		9/09/97
L975849-8	PC-8	49	ND		9/09/97
L975849-9	PC-9	39	5800		9/09/97
L975849-10	PC-10	21	ND		9/09/97
L975849-11	PC-11	22	ND		9/09/97
L975849-12	PC-12	49	17,000		9/09/97
L975849-13	PC-13	54	170		9/09/97
L975849-14	PC-14	29	ND		9/09/97
L975849-15	PC-15	28	13,000		9/09/97


ND means Not Detected or below reported MDL

MDL means Method Detection Limit

mg/kg means Milligrams Per Kilogram which is equivalent to Parts Per Million (ppm)

This report has been reviewed by me for technical accuracy and completeness. The analyses were performed using EPA or other approved methodologies and the results were reported on an "as received" basis unless otherwise noted. The results reported relate only to the items tested. Please contact me if you have any questions or comments regarding this report. Spectrum Labs, Inc. appreciates the opportunity to provide this analytical service for you.


Report Submitted By,

  
Thomas L. Halverson  
Laboratory ManagerTLH:wmc  
mec253-1

As a mutual protection, all reports are submitted in confidentiality and may not be reproduced except in full without written authorization.



A member of The Marmon Group of Companies

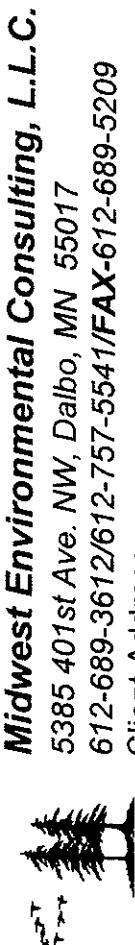

### *Midwest Environmental Consulting, L.L.C.*

5385 401st Ave. NW, Dalbo, MN 55017

612-689-3612/612-757-5541/FAX-612-689-5209

Client Address \_\_\_\_\_

Contact Ronald Cox

### **CHAIN OF CUSTODY RECORD**

Project Number 62-0117-A1

Client St Paul Public

Project Gilte, Magnit

Phone/Fax \_\_\_\_\_

Sample ID	Sample Description	Collection Date/Time	Matrix (Vol/Area)	Analysis Requested
PC-1	Bin 1174 Paint Chip (# 41 C, 8-4-97)	12:35pm 8-25-97	1-2 inches <sup>2</sup>	Ppm / Pb
PC-2	Hall (Bin) 31170 - Paint Chip (# 49 C, 8-4-97)	12:40pm 8-25-97	"	"
PC-3	Bath 1160 - Paint Chip (# 117 #0, 8-5-97)	12:45pm 8-25-97	"	"
PC-4	Oym 1 - Paint Chip (# 148, B, 8-5-97)	12:47pm 8-25-97	"	"
PC-5	Stair 300 - Paint Chip (# 45, B, 8-5-97)	12:50pm 8-25-97	"	"
PC-6	Rm 1331 - Paint Chip (# 23 A, 8-5-97)	12:55pm 8-25-97	"	"
PC-7	Rm 1321 - Paint Chip (# 150, A, 8-4-97)	12:58pm 8-25-97	"	"
PC-8	Rm 1321 - Paint Chip (# 160, C, 8-4-97)	1:00pm 8-25-97	"	"
PC-9	Bath 1211 - Paint Chip (# 64, B, 8-4-97)	1:05pm 8-25-97	"	"
PC-10	Rm 1240 - Paint Chip (# 131, A, 8-4-97)	1:10pm 8-25-97	"	"
PC-11	Rm 1240 - Paint Chip (# 105, B, 8-4-97)	1:13pm 8-25-97	"	"
PC-12	MIC 2000 - Paint Chip (# 239, A, 8-5-97)	1:18pm 8-25-97	"	"
PC-13	Rm 2050 - Paint Chip (# 131, B, 8-4-97)	1:20pm 8-25-97	"	"
PC-14	Rm 2300 - Paint Chip (# 172, A, 8-5-97)	1:30pm 8-25-97	"	"

Sampled By: Bill Sloan Date: 8-25-97 Time: 1:30 pm

Delivered By: K. ShalChin Date: 8-26-97 Time: 8:35 pm

Received By: \_\_\_\_\_ Date: \_\_\_\_\_ Time: \_\_\_\_\_

Delivered By: \_\_\_\_\_ Date: \_\_\_\_\_ Time: \_\_\_\_\_

Received By Lab: Nicole D. Boeke Date: 8/26/01 Time: 8:35am

Disposition of Samples \_\_\_\_\_

Notes:



*Midwest Environmental Consulting, L.L.C.*

5385 401st Ave. NW Dalbo. MN 55017

6612-688-3612/612-757-5541/EX-612 689 5208

8/2009-38/Z/2012/334/FAX-6/Z-0089-3209

**Client Address** \_\_\_\_\_

**CHAIN OF CUSTODY RECORD**

Project Number 102-01517-A.

Client List Page

Client \_\_\_\_\_ Date \_\_\_\_\_

### Project Galileo Project

Phone/Fax

卷之三

Sample ID	Sample Description	Collector
S-12345	Soil sample from field A	John Doe

Sampled BY: Bill Sugg Date: 8/25/07 Time: 1:35pm Delivered BY: Hillie G. Clark Date: 8/26/07 Time: 8:35am

Received By: \_\_\_\_\_ Date: \_\_\_\_\_ Time: \_\_\_\_\_ Delivered By: \_\_\_\_\_ Date: \_\_\_\_\_ Time: \_\_\_\_\_

Date: \_\_\_\_\_ Date: \_\_\_\_\_  
Received by: \_\_\_\_\_ Received by: \_\_\_\_\_

Received By Lau, Alvin - Date 2/20/2007 Time 0 - Scan - Disposition of Samples

## **APPENDIX C INSPECTORS**

**William Sloan  
MDH Lead Inspector # 476**