


Midwest  
Environmental  
Consulting, L.L.C.

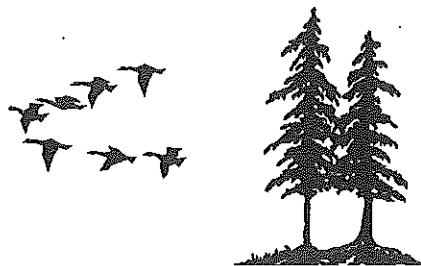

Printed on Recycled Paper

**Cleveland Quality Middle School  
Saint Paul Public Schools**

**Lead-Based Paint Inspection**

**Inspection Dates: 6/25/97, 6/26/97, 7/7/97, 7/8/97, 7/9/97**

**submitted to:**

**Saint Paul Public Schools**

**MEC Project # 62/0197AN**

## INTRODUCTION

At the request of Saint Paul Public Schools Environmental Safety Department, Midwest Environmental Consulting, L.L.C. (MEC), conducted a lead-based paint inspection at Cleveland Quality Middle School, 1000 Walsh Street, St. Paul, MN. The purpose of this inspection was to identify lead-based painted, varnished, or otherwise coated building components on the interior and exterior of the school building.

The inspection protocol incorporated applicable portions of the U.S. Department of Housing and Urban Development (HUD) *Guidelines for the Evaluation and Control of Lead-based Paint Hazards in Housing* (HUD Guidelines, June 1995) and OSHA 1926.62 requirements (Lead in Construction). The HUD guidelines are formulated to guide agencies in conducting random sampling of the interiors and exteriors of dwellings and common areas in public housing. The OSHA requirement is designed to minimize worker exposure when working with material containing lead.

Confirmatory testing was conducted when inconclusive XRF results were encountered. Inconclusive refers to XRF readings less than 0.2 mg/cm<sup>2</sup> (milligrams per square centimeter). Inconclusive results were confirmed with laboratory analysis of paint chip samples (Appendix B). This report contains a list of such results.

The United States Environmental Protection Agency defines "lead-based paint" as a paint or other surface coating that contains lead equal to or in excess of 1.0 milligrams per square centimeter when analyzed by XRF or more than 0.5% by weight (5000 parts per million) by laboratory analysis of a bulk sample.

Minnesota Department of Labor and Industry (MN OSHA) adopted the EPA lead levels for the purpose of enforcing OSHA 1926.62 federal regulations. Detection of lead in dried paint film by XRF is a dependable indicator of levels of lead and is accepted by MN OSHA.

For this Saint Paul Public Schools Lead Inspection, all building components were tested on site using a Niton XL® X-ray Fluorescence Spectrum Analyzer<sup>(1)</sup>. Building components included walls, ceilings, floors, moldings, window and door components, door surfaces, and miscellaneous features such as shelves or bookcases. Only painted or glazed surfaces or surfaces which were varnished were tested. Suspended ceilings, structural steel, and corrugated decking were not included in the inspection. Neither anodized (e.g., window sashes) nor plastic (e.g., vinyl baseboard and vinyl mini-blinds) were included in the scope of this inspection.

---

<sup>(1)</sup> This is a portable hand held machine that can analyze building components instantly for lead concentrations.

Each building was divided into unique sites based on the year of construction or renovation. Portable classrooms, playgrounds, and other detached buildings were automatically designated as a unique site. Each site was inspected independently assuming differences in painting history and construction characteristics.

## SITE DESCRIPTION AND BUILDING HISTORY

According to information provided to MEC by Saint Paul Public Schools, Cleveland Quality Middle School was constructed in essentially three phases. The initial phase includes the 12,512 square-foot older section of the building and dates from 1924. The second phase is a 55,116 square foot addition dating from 1937. The third phase is a 35,583 square foot addition from 1965.

The 1924 phase and 1937 phase are considered to be site 1 because differentiating between the phases was not possible.

All room and area designations used in this report are depicted on sampling maps found in Appendix A.

## XRF SAMPLE RESULTS TABLE

The results of all samples analyzed are listed in the table at the end of this section. The following is a description of the column headings:

<b>Site</b>	Each school is divided into sites based on their unique construction characteristics. Each site has a unique date of construction or major renovation.
<b>Sample #</b>	Each sample taken was given a unique number to identify the type and location of the sample. The sampling date is an integral part of the sample number.
<b>Analysis</b>	This defines the type of analysis which can be categorized into two types:  1) XRF: This is an on-site analysis using a hand held Niton XL® X-ray Fluorescence Spectrum Analyzer; 2) Bulk or Chip: This is a bulk sample where paint is removed from the substrate and sent to a laboratory for analysis;
<b>Floor</b>	This is the level of the building in which the area tested was found, example, 1 (first floor), 0 (basement), etc.

<b>Area</b>	This further defines the specific functional space inspected such as a classroom, exterior, playground, gym, kitchen, etc.
<b>Room #</b>	This is typically the actual number on the room as identified at the building.
<b>Component</b>	Building "components" included walls, ceilings, floors, moldings, window and door components, door surfaces, and miscellaneous features such as shelves or bookcases.
<b>Feature</b>	Identifies more detailed information of the component.
<b>Condition</b>	This describes condition of the surface, whether it is intact, cracked, peeling, or chalking.
<b>Substrate</b>	This refers to the material the building component is made of (wood, concrete, drywall, metal, etc.).
<b>Result</b>	This is the analysis results for lead. Less than 1.0 mg/cm <sup>2</sup> or less than 0.5% by weight is considered to be non-lead and these building components are below the action levels of EPA and HUD. (All results are in mg/cm <sup>2</sup> except where noted.)

The table of results is designed for quick information on lead concentrations of tested building components. Generally, all repetitions of a test combination within a given room or area, may be assumed to contain similar concentrations of lead to that of the tested sample. For instance, the lead concentration of a tested wooden window sash was found to be above the action level of 1.0 mg/cm<sup>2</sup> in a given classroom. The classroom has five windows, all of wood, the same color and appearing to be of the same era. It can be assumed that the remaining four wooden window sashes each contain lead above the action limit.

Other columns identify the component and the component feature tested, condition of the component, type of substrate and the result of the analytical test.

As an example, the following illustration shows that the wooden door jamb in Room 123, first floor in the 1923 building section was in good, solid condition, and had an XRF test result of 0.3 mg/cm<sup>2</sup>, which is below the action level.

#### Illustration Only

Site	Sample #	Date	Analysis	Floor	Area	Room #	Component	Feature	Condition	Substrate	Results
1923 Bldg.	52		XRF	1	Room	123	Door	Jamb	Solid	Wood	0.3

In a similar manner, the table shows that the plaster walls in room 23, on the second floor has peeling paint with more than 1.0 mg/cm<sup>2</sup> (shaded).

#### ILLUSTRATION ONLY

Site	Sample #	Date	Analysis	Floor	Area	Room #	Component	Feature	Condition	Substrate	Results
1910 Bldg.	16		XRF	2	Room	23	Door	Jamb	Peeling	Wood	0.25
1910 Bldg.	17		XRF	2	Room	23	Wall	Wall	Peeling	Plaster	1.2
1910 Bldg.	18		XRF	2	Room	23		Ceiling	Peeling	Plaster	0.25
1910 Bldg.	19		XRF	2	Room	23	Wall	Baseboard	Peeling	Wood	0.002

#### APPLICABLE REGULATIONS

When building components test above 1.0 mg/cm<sup>2</sup> of lead by XRF or 0.5% lead by weight from laboratory analysis all employees and contractors who will be working with these components in a construction related activity must be notified. The requirements of OSHA 1926.62, Lead in Construction are enforceable. This regulation defines construction work as "work for construction, alteration and/or repair, including painting and decorating." This regulation further defines monitoring requirements to minimize employee exposure to lead during construction activities.

When work is performed on external painted building structures (i.e. flashing, fire escapes, playground equipment, handrails, etc.), regulations of the Minnesota Pollution Control Agency (MPCA) may also be applicable. For removal of lead based paint from steel structures, MN Rules 7025.0200 - 7025.0380 apply to steel materials on the exterior of a building, or on the property when levels exceed 0.5 mg/cm<sup>2</sup> based on the average of three XRF spectrum results of the sample tested, or 5,000 ppm by laboratory analysis. If it is other than a steel surface, then MPCA regulates the painted surfaces under MN Rules 7025.010 - 7025.0080, when surfaces are to be disturbed using abrasive blasting methods.


Please contact MEC directly if you have questions about any portion of this report or the lead-based paint inspection itself.

**APPENDIX A**


**XRF TESTING DATA**

**WITH**

**LOCATION MAPS**

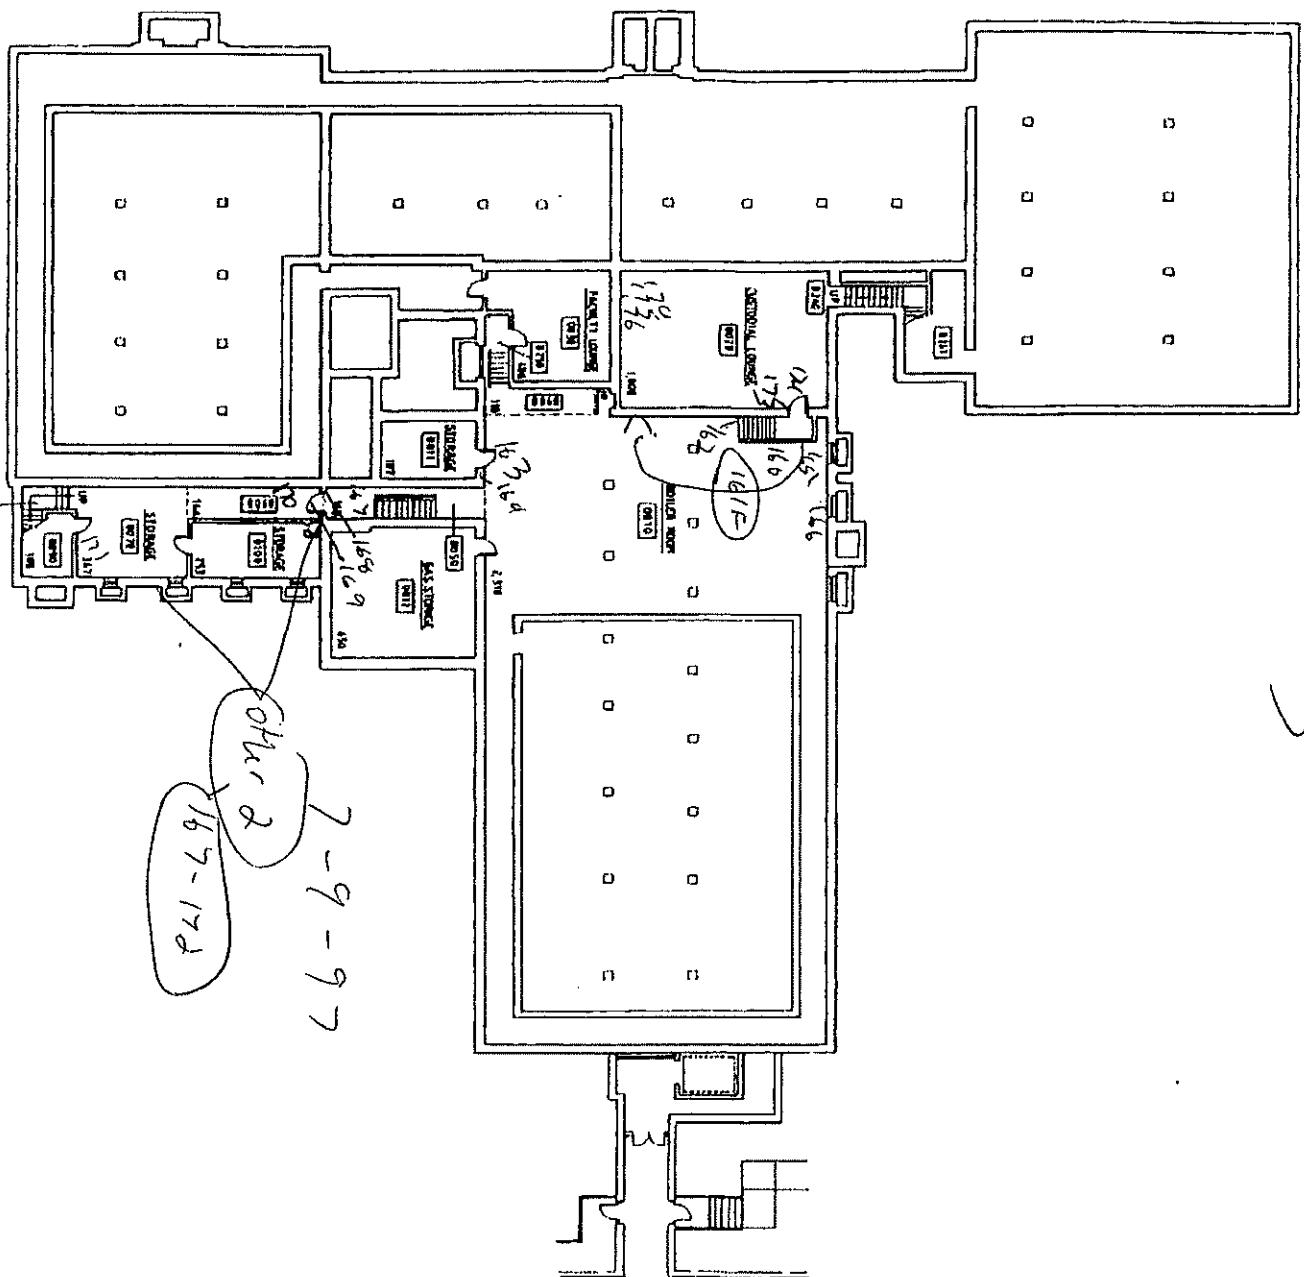

BASMENT PLAN




INDEPENDANT SCHOOL DIST #625  
380 COLBORNE STREET  
ST. PAUL, MN 55102

CLEVELAND JUNIOR HIGH  
1000 WALSH STREET  
ST. PAUL, MINNESOTA 55106

CONSTRUCTED 1936, 1965

SHEET  
4  
of  
9

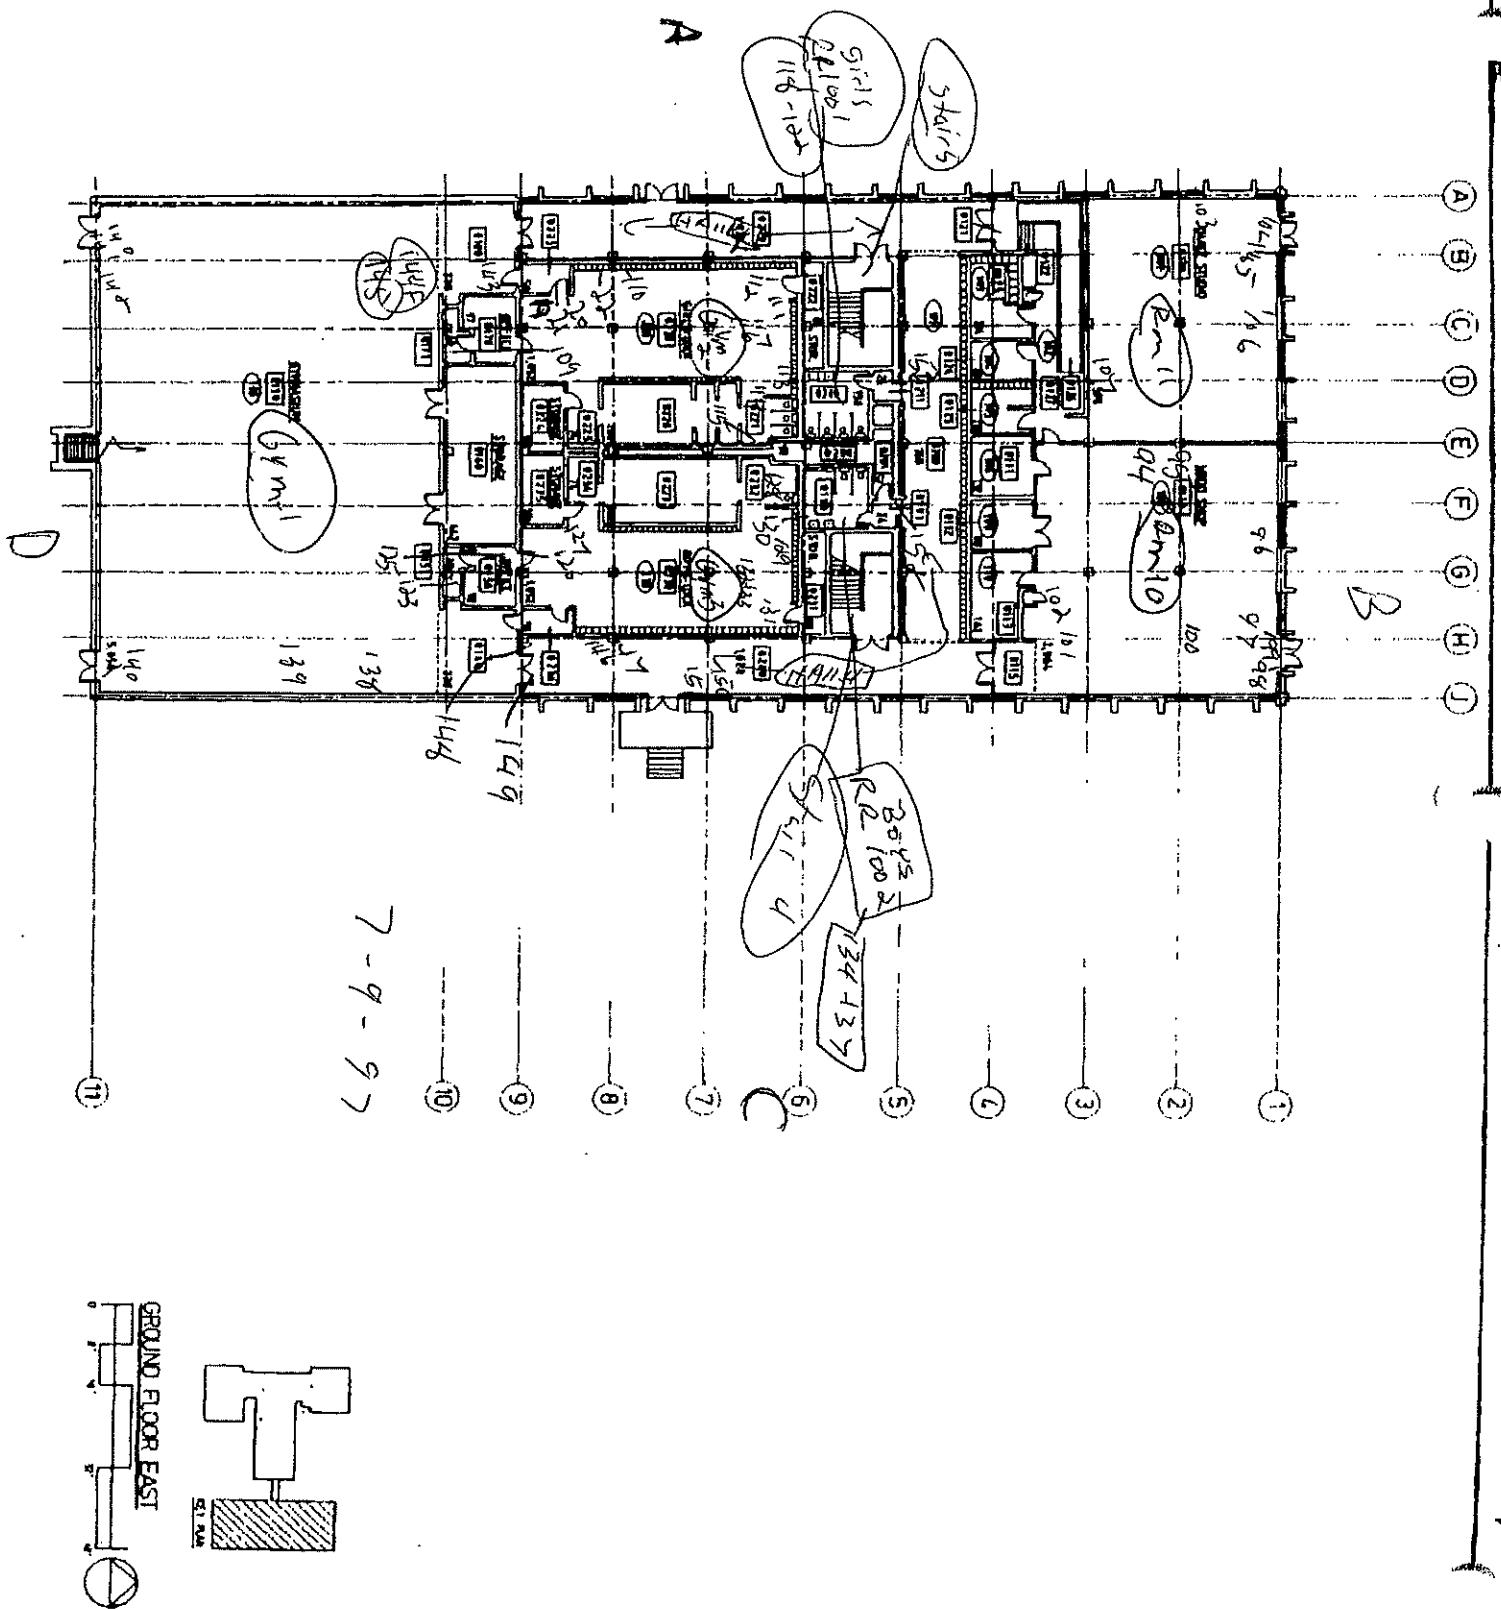


INDEPENDENT SCHOOL DIST. #625  
360 COLBORNE STREET  
ST. PAUL, MINNESOTA 55102

CLEVELAND JUNIOR HIGH  
1000 WALSH STREET  
ST. PAUL, MINNESOTA 55106

CONSTRUCTED: 1936, 1965

29

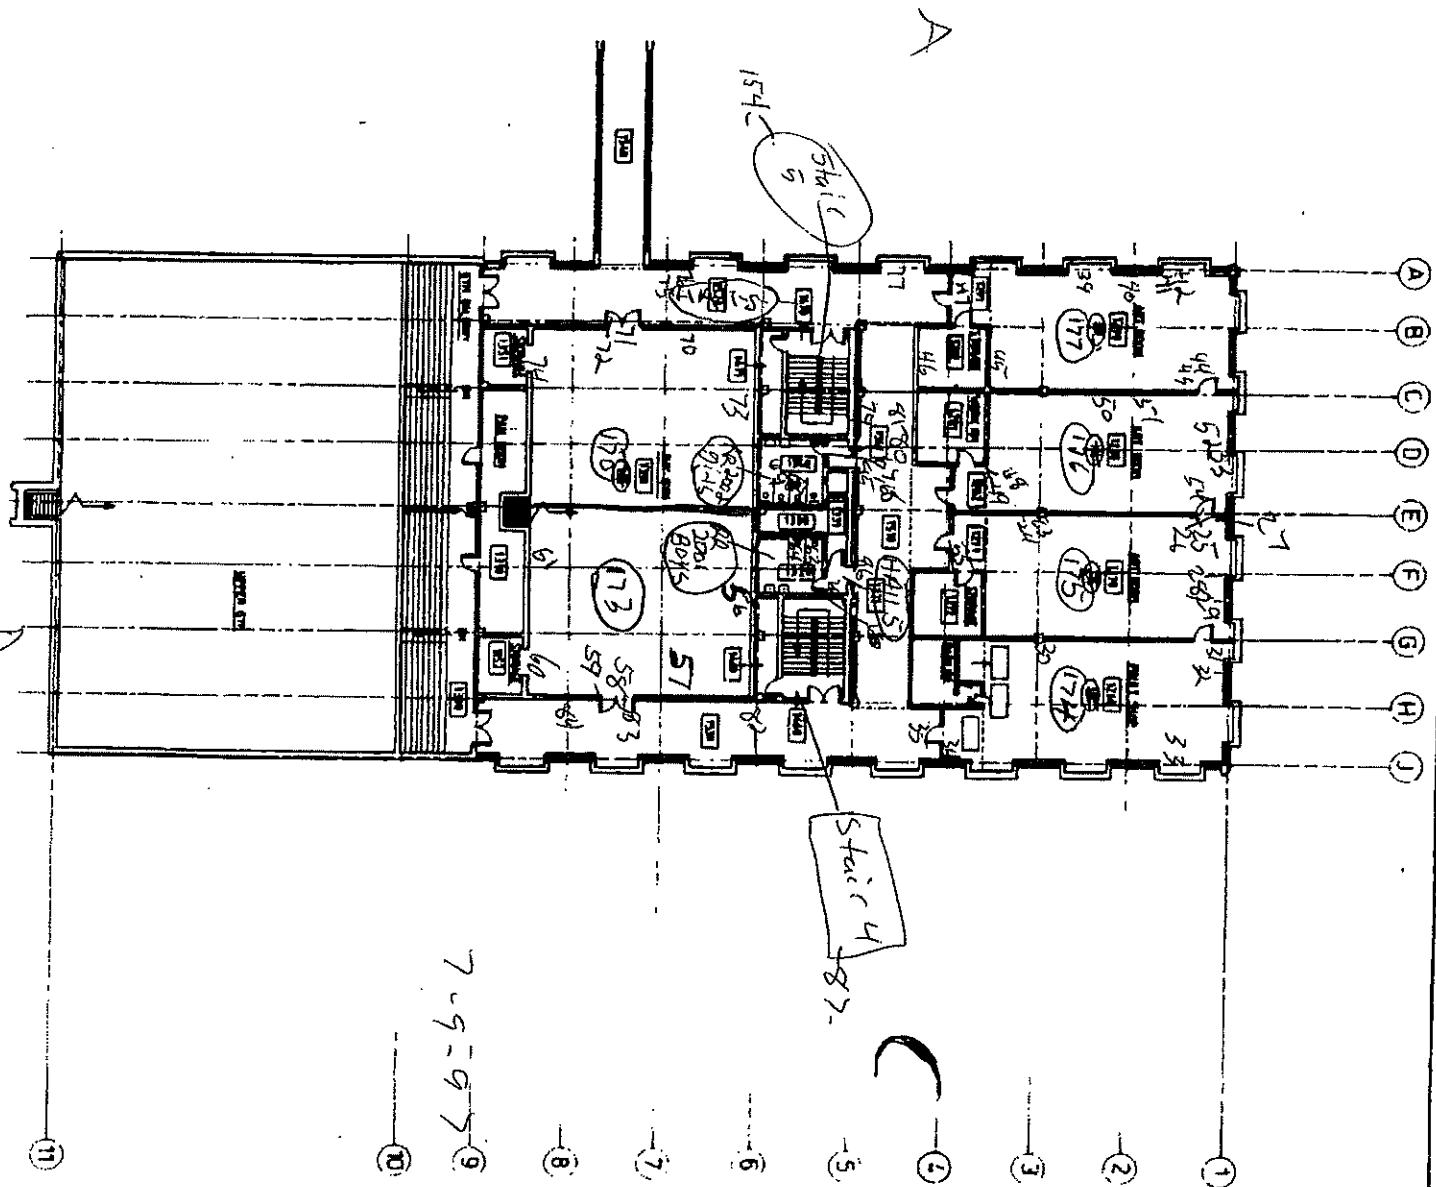


INDEPENDENT SCHOOL DIST #625  
360 COLEBORNE STREET  
ST. PAUL, MINNESOTA 55102

CLEVELAND JUNIOR HIGH  
1000 WALSH STREET  
ST. PAUL, MINNESOTA 55106

CONSTRUCTED: 1936, 1965

3  
6

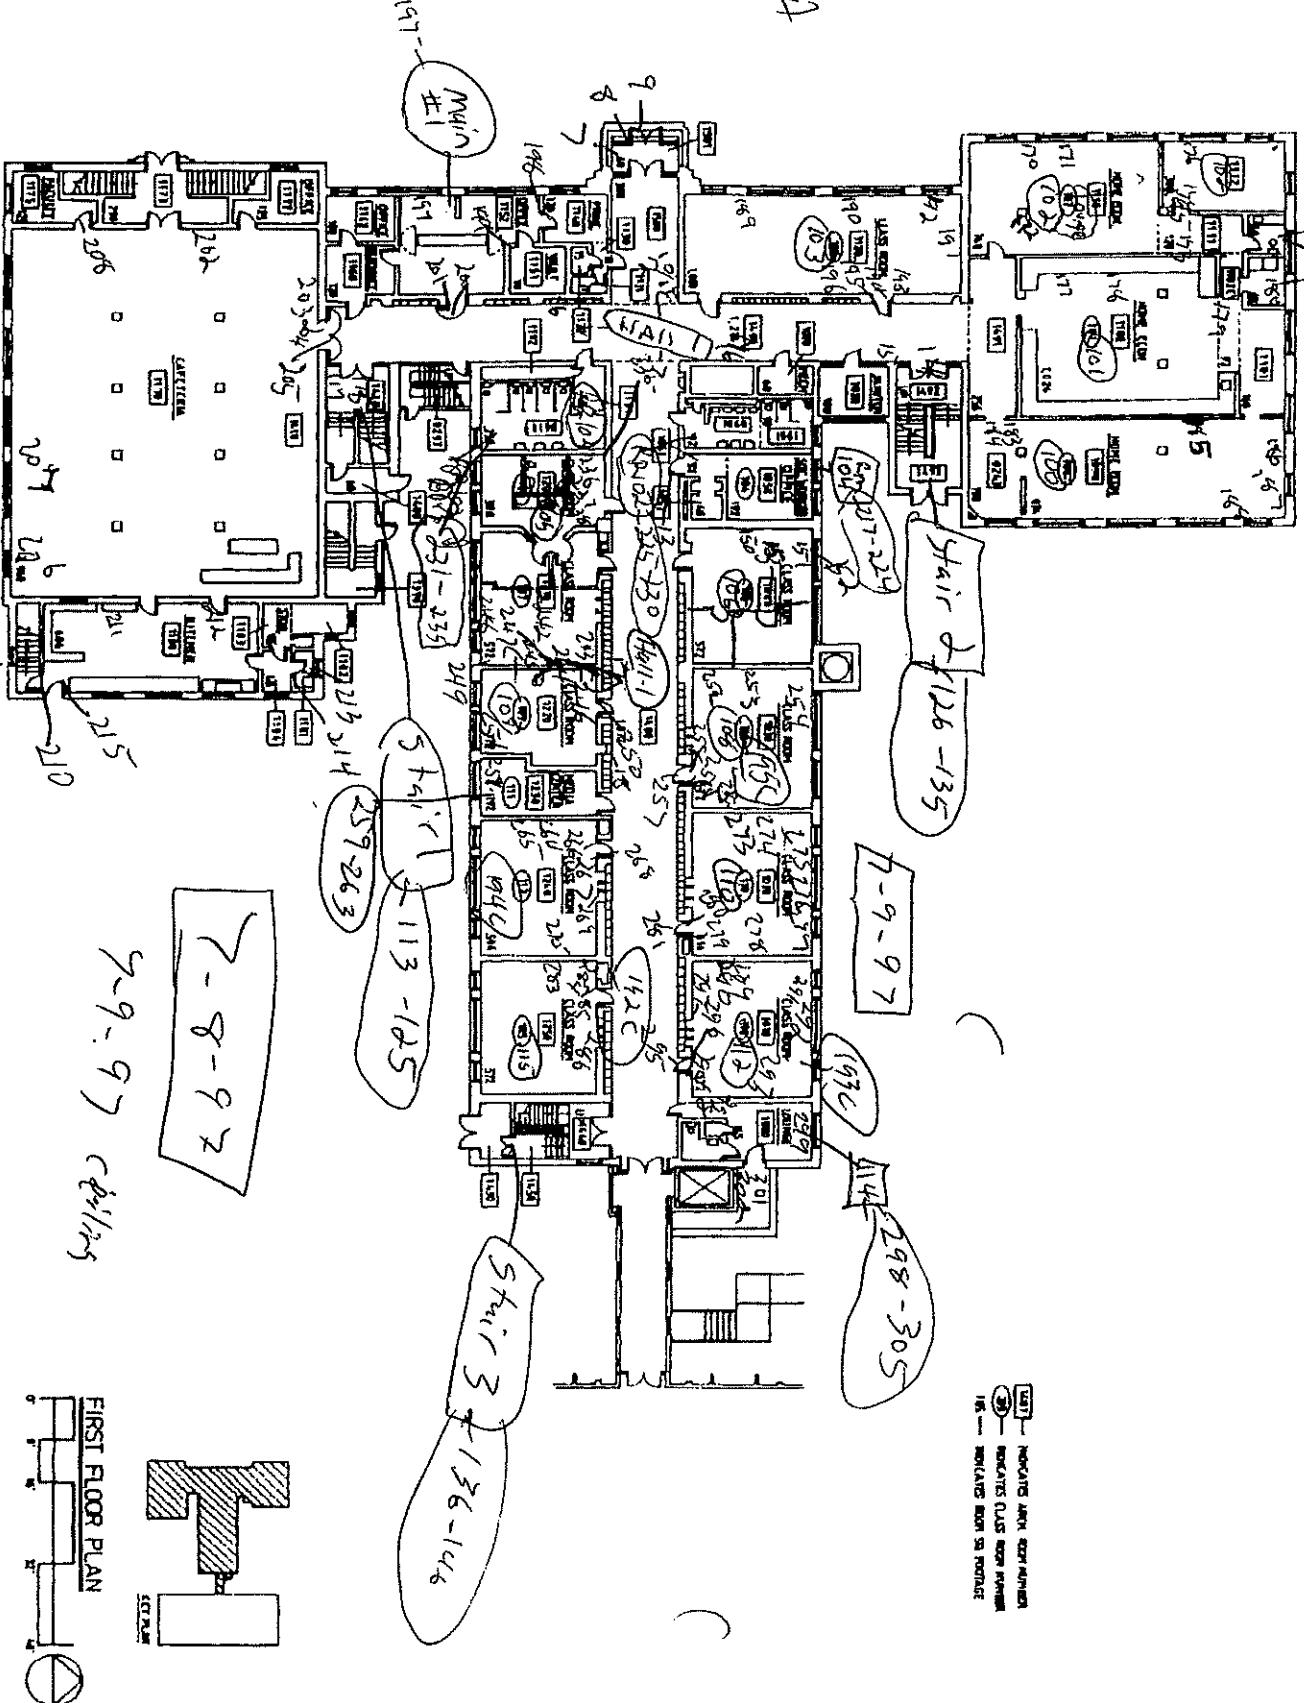


INDEPENDANT SCHOOL DIST. #825  
360 COLBORNE STREET  
ST. PAUL, MN 55102

CLEVELAND JUNIOR HIGH  
1000 WALSH STREET  
ST. PAUL, MINNESOTA 55106

CONSTRUCTED 1936, 1965

SHEET  
5 OF  
9

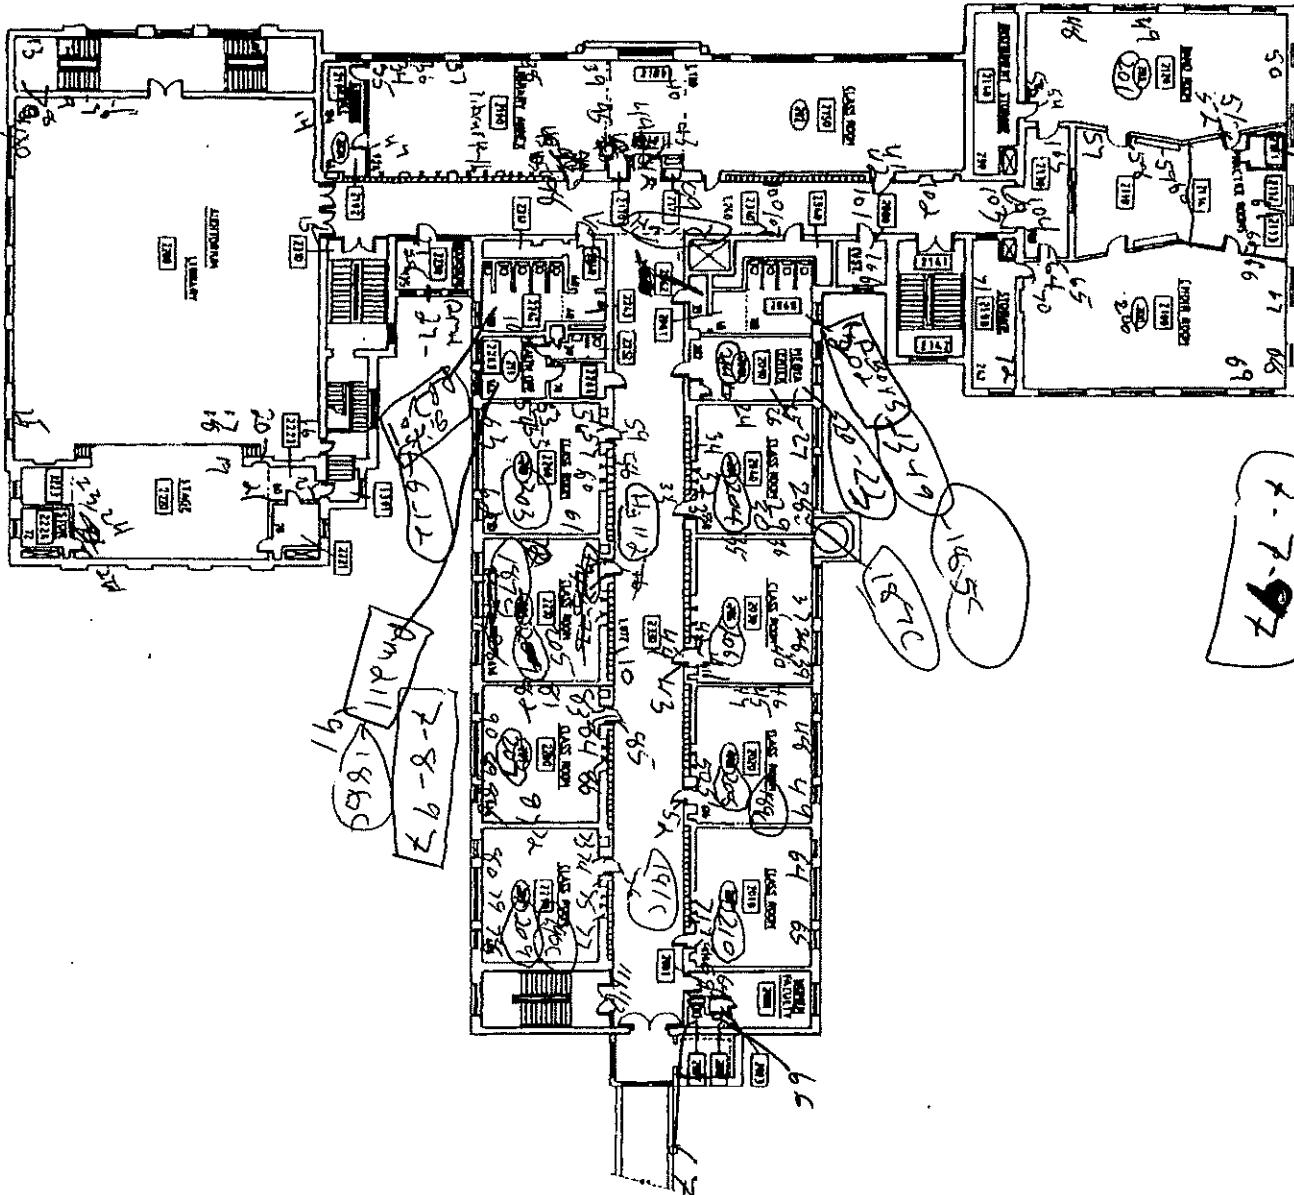


INDEPENDANT SCHOOL DIST. #625  
360 COLBORNE STREET  
ST. PAUL, MN 55102

CLEVELAND JUNIOR HIGH  
1000 WALSH STREET  
ST. PAUL MINNESOTA 55106

**CONSTRUCTED 1936-1965**

SHEET  
6 OF  
9

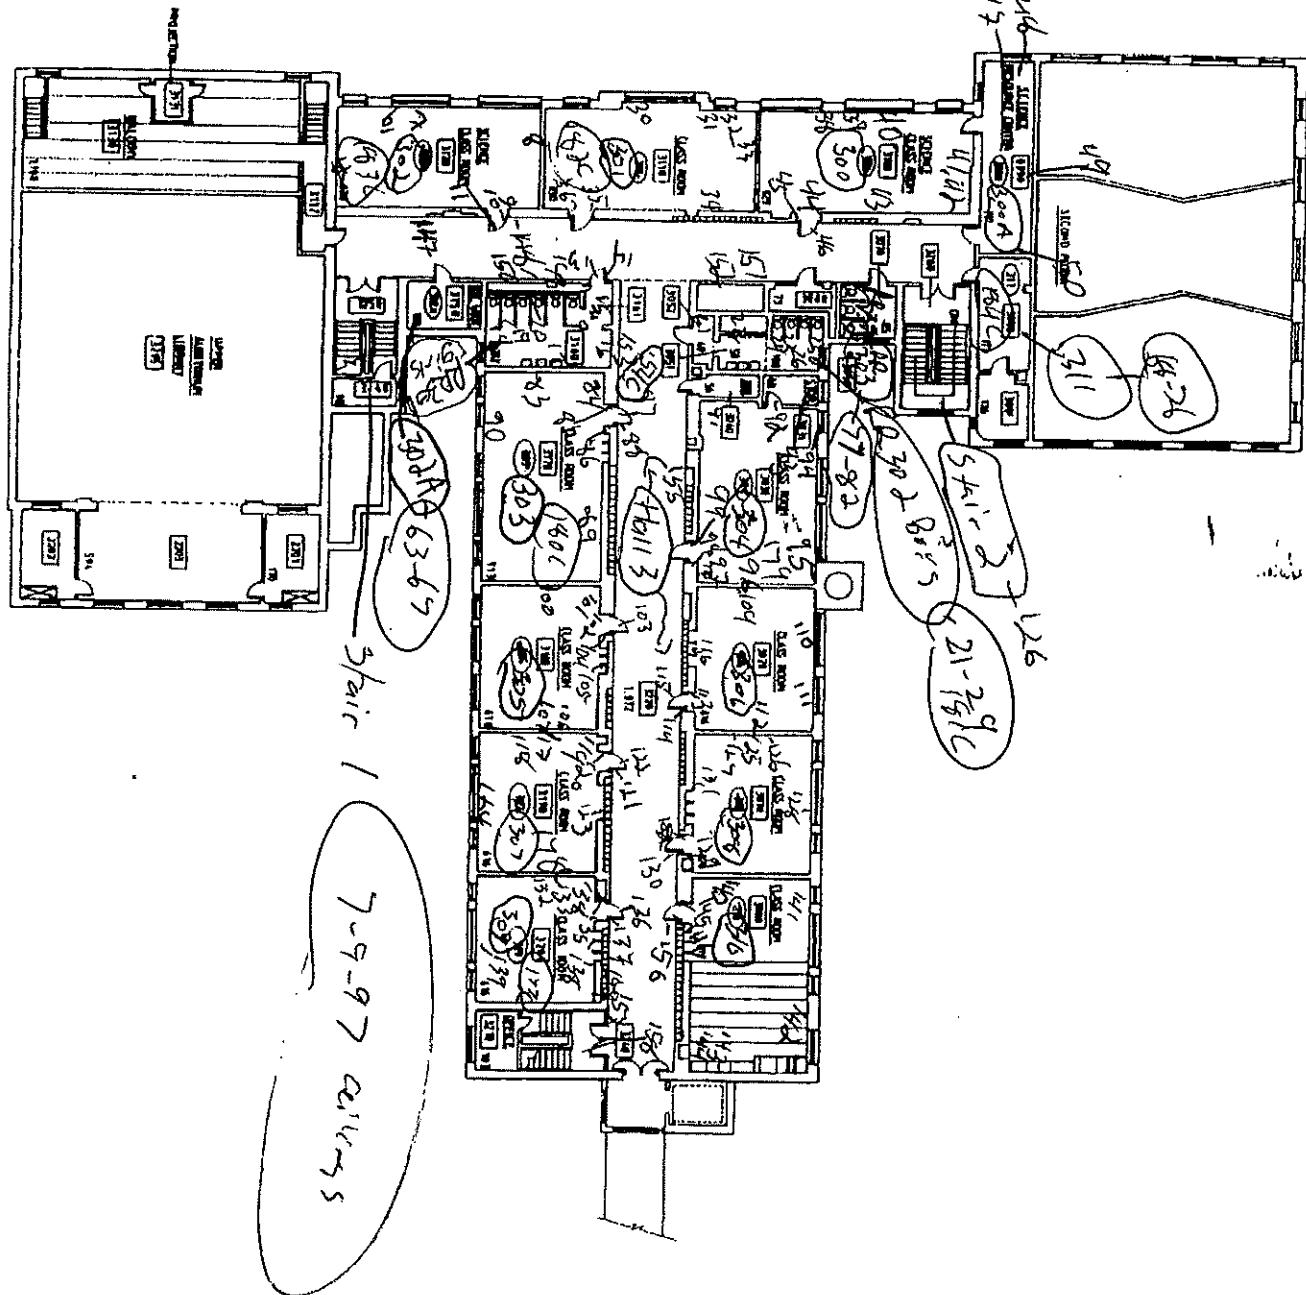


**107** INDICATES AN IN-STORE PURCHASE  
108 INDICATES CLASS NEW NUMBER  
109 INDICATES ROOM OR PURCHASE

INDEPENDANT SCHOOL DIST #625  
360 COLBORNE STREET  
ST. PAUL, MN 55102

CLEVELAND JUNIOR HIGH  
1000 WALSH STREET  
ST. PAUL, MINNESOTA 55106

CONSTRUCTED 1935, 1965

BRIEF  
7 OF  
9

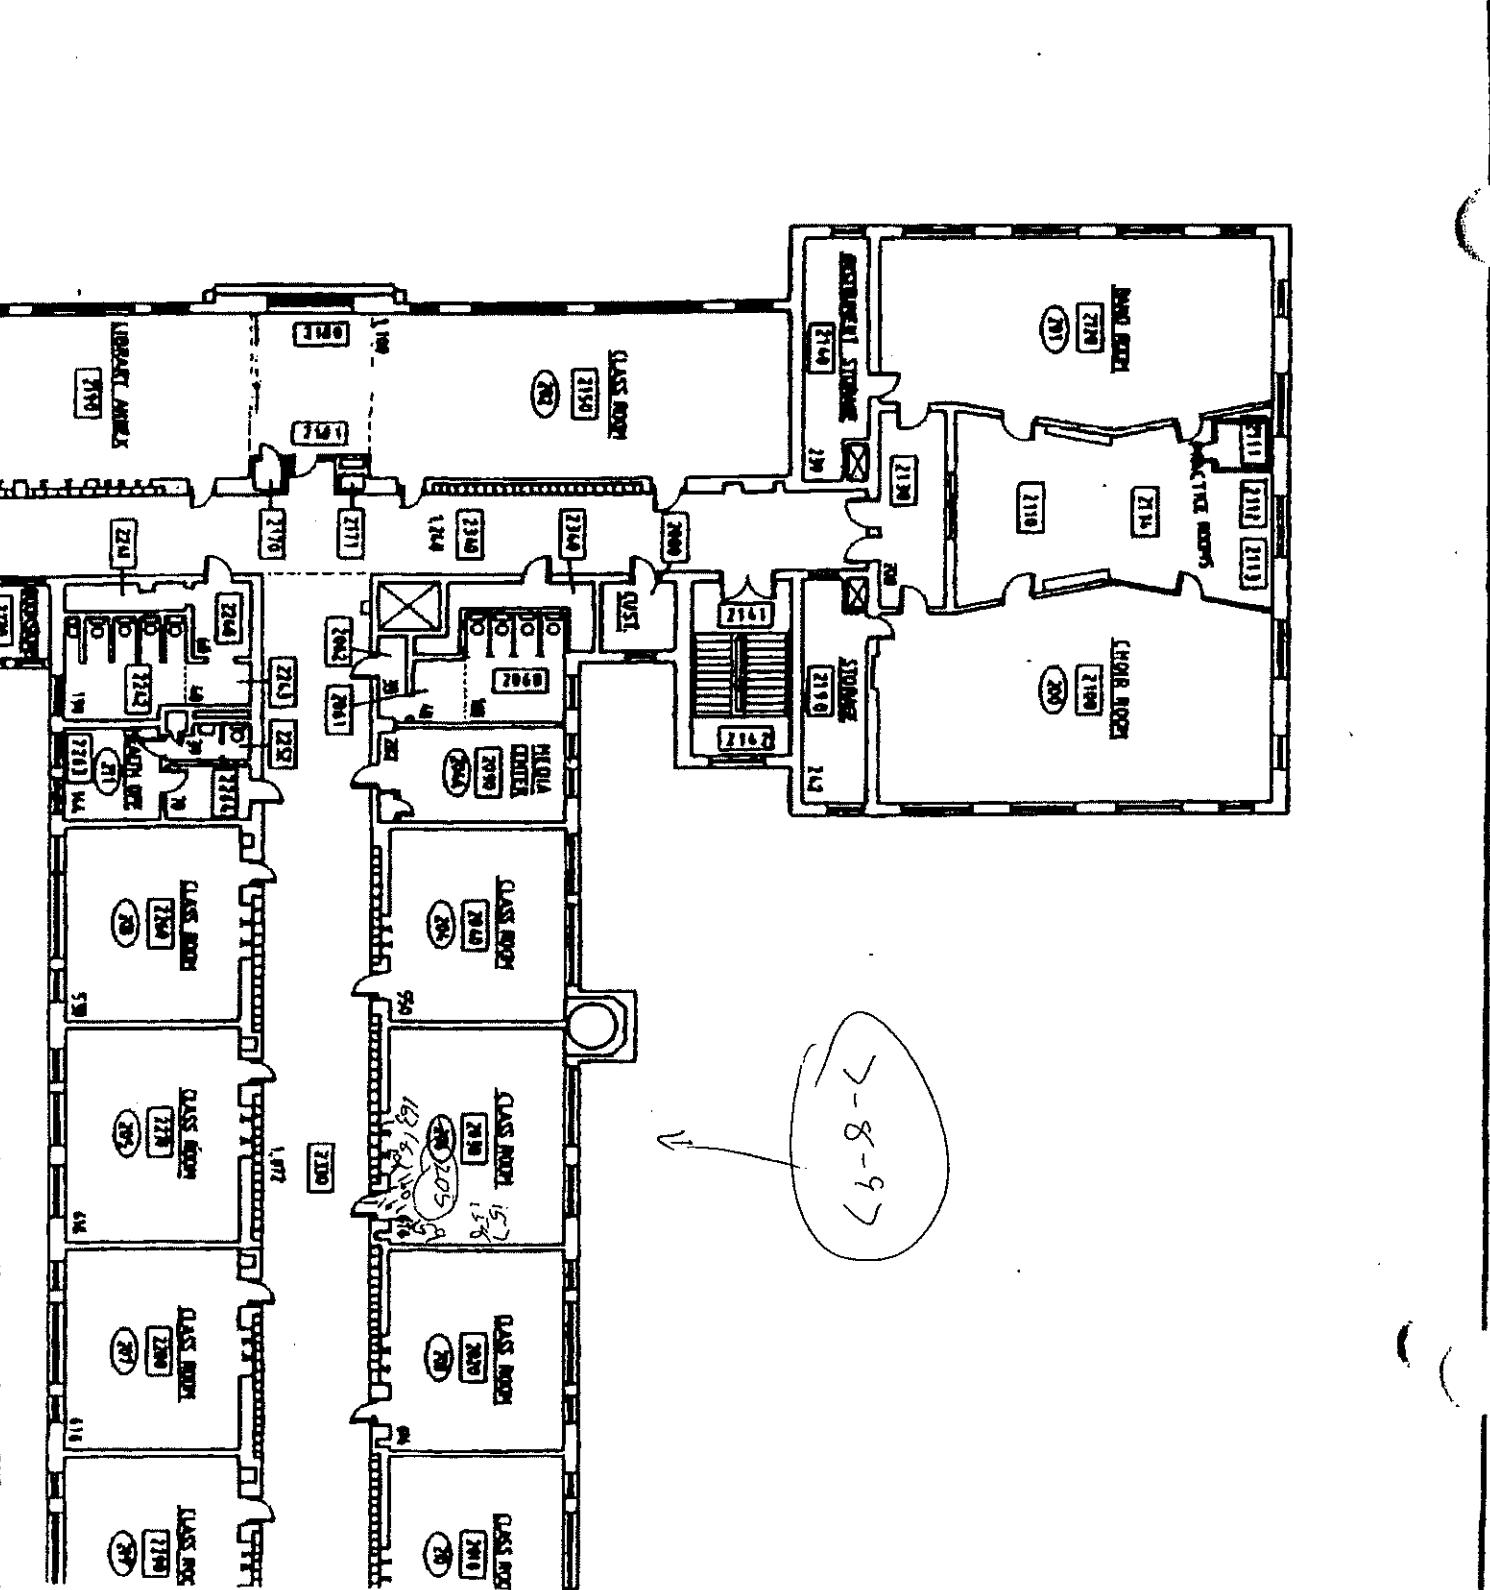

Saint Paul Public Schools  
 Cleveland Quality Middle School  
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
1	Cleveland Quality Middle School											
2												
3	Site	Sample#	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
4	1924 & 1937 Bldg.	6	XRF	7/7/97	2	Auditorium	1	Wall	Midle Wall	Solid	Drywall	0.8
5	1924 & 1937 Bldg.	7	XRF	7/7/97	2	Auditorium	1	Wall	Wall	Solid	Concrete	0
6	1924 & 1937 Bldg.	8	XRF	7/7/97	2	Auditorium	1	Door	Casing	Solid	Metal	0.01
7	1924 & 1937 Bldg.	9	XRF	7/7/97	2	Auditorium	1	Ceiling	Balcony	Solid	Metal	0.02
8	1924 & 1937 Bldg.	10	XRF	7/7/97	2	Auditorium	1	Wall	Wall	Solid	Plaster	0.01
9	1924 & 1937 Bldg.	11	XRF	7/7/97	2	Auditorium	1	Wall	Wall	Solid	Plaster	0
10	1924 & 1937 Bldg.	12	XRF	7/7/97	2	Auditorium	1	Wall	Wall	Solid	Metal	0.06
11	1924 & 1937 Bldg.	13	XRF	7/7/97	2	Auditorium	1	Wall	Wall	Solid	Plaster	0.06
12	1924 & 1937 Bldg.	14	XRF	7/7/97	2	Auditorium	1	Wall	Chair rail	Solid	Wood	0.02
13	1924 & 1937 Bldg.	15	XRF	7/7/97	2	Auditorium	1	Door	Door	Solid	Metal	0.14
14	1924 & 1937 Bldg.	16	XRF	7/7/97	2	Auditorium	1	Door	Door	Solid	Wood	0.07
15	1924 & 1937 Bldg.	17	XRF	7/7/97	2	Auditorium	1	Wall	Wall	Solid	Plaster	0.67
16	1924 & 1937 Bldg.	18	XRF	7/7/97	2	Auditorium	1	Wall	Wall Rgstr	Solid	Metal	0.52
17	1924 & 1937 Bldg.	19	XRF	7/7/97	2	Auditorium	1	Floor		Solid	Wood	0
18	1924 & 1937 Bldg.	20	XRF	7/7/97	2	Auditorium	1	Wall	Midle Wall	Solid	Plaster	0.03
19	1924 & 1937 Bldg.	21	XRF	7/7/97	2	Auditorium	1	Wall	Wall	Peeling	Plaster	0
20	1924 & 1937 Bldg.	22	XRF	7/7/97	2	Auditorium	1	Stairs	Hand rail	Solid	Metal	0
21	1924 & 1937 Bldg.	23	XRF	7/7/97	2	Auditorium	1	Door	Casing	Solid	Wood	0
22	1924 & 1937 Bldg.	24	XRF	7/7/97	2	Auditorium	1	Door	Door	Solid	Wood	0
23	1924 & 1937 Bldg.	25	XRF	7/7/97	2	Auditorium	1		Radiator	Solid	Metal	0.3
24	1924 & 1937 Bldg.	26	XRF	7/7/97	2	Auditorium	1	Wall	Baseboard	Solid	Metal	0.48
25	1924 & 1937 Bldg.	202	XRF	7/8/97	1	Cafeteria	1	Wall	Midle Wall	Solid	Plaster	0.11
26	1924 & 1937 Bldg.	203	XRF	7/8/97	1	Cafeteria	1	Wall	Wall	Solid	Plaster	0.54
27	1924 & 1937 Bldg.	204	XRF	7/8/97	1	Cafeteria	1	Door	Casing	Solid	Metal	0.2
28	1924 & 1937 Bldg.	205	XRF	7/8/97	1	Cafeteria	1	Door	Door	Solid	Metal	0.18
29	1924 & 1937 Bldg.	206	XRF	7/8/97	1	Cafeteria	1		Radiator	Solid	Metal	0.44
30	1924 & 1937 Bldg.	207	XRF	7/8/97	1	Cafeteria	1		Radiator	Solid	Metal	1.01
31	1924 & 1937 Bldg.	208	XRF	7/8/97	1	Cafeteria	1	Door	Door	Solid	Wood	0.02
32	1924 & 1937 Bldg.	209	XRF	7/8/97	1	Cafeteria	1	Wall	Baseboard	Solid	Metal	0.4
33	1924 & 1937 Bldg.	183	XRF	7/8/97	1	Classroom	100	Door	Door	Solid	Wood	0.01
34	1924 & 1937 Bldg.	184	XRF	7/8/97	1	Classroom	100	Door	Casing	Solid	Metal	0.32
35	1924 & 1937 Bldg.	185	XRF	7/8/97	1	Classroom	100		Locker	Solid	Metal	0
36	1924 & 1937 Bldg.	186	XRF	7/8/97	1	Classroom	100	Wall	Midle Wall	Solid	Plaster	0.02
37	1924 & 1937 Bldg.	187	XRF	7/8/97	1	Classroom	100	Window	Apron	Solid	Tile	0.04
38	1924 & 1937 Bldg.	188	XRF	7/8/97	1	Classroom	100		Radiator	Solid	Metal	0
39	1924 & 1937 Bldg.	177	XRF	7/8/97	1	Classroom	101	Wall	Midle Wall	Solid	Plaster	0.01
40	1924 & 1937 Bldg.	178	XRF	7/8/97	1	Classroom	101	Cabinet	Door	Solid	Wood	0
41	1924 & 1937 Bldg.	179	XRF	7/8/97	1	Classroom	101	Door	Casing	Solid	Metal	0.12
42	1924 & 1937 Bldg.	180	XRF	7/8/97	1	Classroom	101		Radiator	Solid	Metal	0
43	1924 & 1937 Bldg.	181	XRF	7/8/97	1	Classroom	101	Wall	Midle Wall	Solid	Drywall	0
44	1924 & 1937 Bldg.	182	XRF	7/8/97	1	Classroom	101		Radiator	Solid	Metal	0
45	1924 & 1937 Bldg.	252	XRF	7/8/97	1	Classroom	108	Wall	Midle Wall	Solid	Plaster	0
46	1924 & 1937 Bldg.	253	XRF	7/8/97	1	Classroom	108	Chalkboard	Rail	Solid	Wood	0.31
47	1924 & 1937 Bldg.	254	XRF	7/8/97	1	Classroom	108		Radiator	Solid	Metal	0
48	1924 & 1937 Bldg.	255	XRF	7/8/97	1	Classroom	108	Wall	Baseboard	Solid	Metal	0.8
49	1924 & 1937 Bldg.	256	XRF	7/8/97	1	Classroom	108	Wall	Midle Wall	Solid	Plaster	0.08
50	1924 & 1937 Bldg.	257	XRF	7/8/97	1	Classroom	108	Door	Door	Solid	Wood	0.11
51	1924 & 1937 Bldg.	258	XRF	7/8/97	1	Classroom	108	Door	Casing	Solid	Wood	0.02
52	1924 & 1937 Bldg.	242	XRF	7/8/97	1	Classroom	109	Chalkboard	Rail	Solid	Wood	0.19
53	1924 & 1937 Bldg.	243	XRF	7/8/97	1	Classroom	109	Cabinet	Door	Solid	Wood	0.01
54	1924 & 1937 Bldg.	244	XRF	7/8/97	1	Classroom	109	Door	Casing	Solid	Metal	0.03
55	1924 & 1937 Bldg.	245	XRF	7/8/97	1	Classroom	109	Door	Door	Solid	Wood	0
56	1924 & 1937 Bldg.	246	XRF	7/8/97	1	Classroom	109	Door	Casing	Solid	Wood	0
57	1924 & 1937 Bldg.	247	XRF	7/8/97	1	Classroom	109	Wall	Midle Wall	Solid	Drywall	0
58	1924 & 1937 Bldg.	248	XRF	7/8/97	1	Classroom	109		Radiator	Solid	Metal	0.76
59	1924 & 1937 Bldg.	249	XRF	7/8/97	1	Classroom	109	Wall	Baseboard	Solid	Metal	0.84
60	1924 & 1937 Bldg.	250	XRF	7/8/97	1	Classroom	109	Wall	Midle Wall	Solid	Plaster	0.06

Saint Paul Public Schools  
 Cleveland Quality Middle School  
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample#	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
61	1924 & 1937 Bldg.	251	XRF	7/8/97	1	Classroom	109	Radiator	Solid	Metal	0.44	
62	1924 & 1937 Bldg.	273	XRF	7/8/97	1	Classroom	110	Wall	Midle Wall	Solid	Plaster	0
63	1924 & 1937 Bldg.	274	XRF	7/8/97	1	Classroom	110	Chalkboard	Rail	Solid	Wood	0.02
64	1924 & 1937 Bldg.	275	XRF	7/8/97	1	Classroom	110		Radiator	Solid	Metal	0.55
65	1924 & 1937 Bldg.	276	XRF	7/8/97	1	Classroom	110		Radiator	Solid	Metal	0.78
66	1924 & 1937 Bldg.	277	XRF	7/8/97	1	Classroom	110	Wall	Baseboard	Solid	Metal	0.76
67	1924 & 1937 Bldg.	278	XRF	7/8/97	1	Classroom	110	Chalkboard	Rail	Solid	Wood	0.19
68	1924 & 1937 Bldg.	279	XRF	7/8/97	1	Classroom	110	Wall	Midle Wall	Solid	Plaster	0.54
69	1924 & 1937 Bldg.	280	XRF	7/8/97	1	Classroom	110	Door	Casing	Solid	Wood	0.01
70	1924 & 1937 Bldg.	281	XRF	7/8/97	1	Classroom	110	Door	Door	Solid	Wood	0.3
71	1924 & 1937 Bldg.	282	XRF	7/8/97	1	Classroom	110	Cabinet	Door	Solid	Wood	0
72	1924 & 1937 Bldg.	289	XRF	7/8/97	1	Classroom	112	Wall	Wall	Solid	Plaster	0.35
73	1924 & 1937 Bldg.	290	XRF	7/8/97	1	Classroom	112	Chalkboard	Rail	Solid	Wood	0.09
74	1924 & 1937 Bldg.	291	XRF	7/8/97	1	Classroom	112		Radiator	Solid	Metal	0.65
75	1924 & 1937 Bldg.	292	XRF	7/8/97	1	Classroom	112		Radiator	Solid	Metal	0.72
76	1924 & 1937 Bldg.	293	XRF	7/8/97	1	Classroom	112	Wall	Baseboard	Solid	Metal	0.63
77	1924 & 1937 Bldg.	294	XRF	7/8/97	1	Classroom	112	Door	Door	Solid	Wood	0.17
78	1924 & 1937 Bldg.	295	XRF	7/8/97	1	Classroom	112	Door	Casing	Solid	Wood	0.02
79	1924 & 1937 Bldg.	296	XRF	7/8/97	1	Classroom	112	Wall	Midle Wall	Solid	Plaster	0.03
80	1924 & 1937 Bldg.	297	XRF	7/8/97	1	Classroom	112	Cabinet	Door	Solid	Wood	0.01
81	1924 & 1937 Bldg.	264	XRF	7/8/97	1	Classroom	113	Wall	Wall	Solid	Plaster	0.67
82	1924 & 1937 Bldg.	265	XRF	7/8/97	1	Classroom	113	Wall	Baseboard	Solid	Metal	0.86
83	1924 & 1937 Bldg.	266	XRF	7/8/97	1	Classroom	113	Wall	Midle Wall	Solid	Plaster	0.05
84	1924 & 1937 Bldg.	267	XRF	7/8/97	1	Classroom	113	Door	Casing	Solid	Wood	0
85	1924 & 1937 Bldg.	268	XRF	7/8/97	1	Classroom	113	Door	Door	Solid	Wood	0.02
86	1924 & 1937 Bldg.	269	XRF	7/8/97	1	Classroom	113	Cabinet	Door	Solid	Wood	0.01
87	1924 & 1937 Bldg.	270	XRF	7/8/97	1	Classroom	113	Chalkboard	Rail	Solid	Wood	0.55
88	1924 & 1937 Bldg.	271	XRF	7/8/97	1	Classroom	113		Radiator	Solid	Metal	0.42
89	1924 & 1937 Bldg.	272	XRF	7/8/97	1	Classroom	113		Radiator	Solid	Metal	1.45
90	1924 & 1937 Bldg.	64	XRF	7/7/97	2	Classroom	200	Door	Door	Solid	Wood	0
91	1924 & 1937 Bldg.	65	XRF	7/7/97	2	Classroom	200	Door	Casing	Solid	Metal	0.27
92	1924 & 1937 Bldg.	66	XRF	7/7/97	2	Classroom	200	Wall	Midle Wall	Solid	Plaster	0.11
93	1924 & 1937 Bldg.	67	XRF	7/7/97	2	Classroom	200	Wall	Midle Wall	Solid	Plaster	0.18
94	1924 & 1937 Bldg.	68	XRF	7/7/97	2	Classroom	200		Radiator	Solid	Metal	0.03
95	1924 & 1937 Bldg.	69	XRF	7/7/97	2	Classroom	200		Radiator	Solid	Metal	0.03
96	1924 & 1937 Bldg.	70	XRF	7/7/97	2	Classroom	200	Door	Door	Solid	Wood	0.18
97	1924 & 1937 Bldg.	71	XRF	7/7/97	2	Classroom	200	Wall	Baseboard	Solid	Wood	0.02
98	1924 & 1937 Bldg.	72	XRF	7/7/97	2	Classroom	200		Radiator	Peeling	Metal	0
99	1924 & 1937 Bldg.	48	XRF	7/7/97	2	Classroom	201		Radiator	Solid	Metal	0.01
100	1924 & 1937 Bldg.	49	XRF	7/7/97	2	Classroom	201	Wall	Midle Wall	Solid	Plaster	0.12
101	1924 & 1937 Bldg.	50	XRF	7/7/97	2	Classroom	201	Wall	Midle Wall	Solid	Plaster	0.19
102	1924 & 1937 Bldg.	51	XRF	7/7/97	2	Classroom	201	Door	Casing	Solid	Metal	0.25
103	1924 & 1937 Bldg.	52	XRF	7/7/97	2	Classroom	201	Door	Door	Solid	Wood	0
104	1924 & 1937 Bldg.	53	XRF	7/7/97	2	Classroom	201	Door	Door	Solid	Wood	0.14
105	1924 & 1937 Bldg.	54	XRF	7/7/97	2	Classroom	201	Door	Casing	Solid	Wood	0.11
106	1924 & 1937 Bldg.	53	XRF	7/8/97	2	Classroom	203	Chalkboard	Rail	Solid	Wood	0.18
107	1924 & 1937 Bldg.	54	XRF	7/8/97	2	Classroom	203	Wall	Wall	Solid	Plaster	0.6
108	1924 & 1937 Bldg.	55	XRF	7/8/97	2	Classroom	203	Wall	Baseboard	Solid	Metal	0.73
109	1924 & 1937 Bldg.	56	XRF	7/8/97	2	Classroom	203	Wall	Midle Wall	Solid	Plaster	0.18
110	1924 & 1937 Bldg.	57	XRF	7/8/97	2	Classroom	203	Wall	Midle Wall	Solid	Plaster	0.34
111	1924 & 1937 Bldg.	58	XRF	7/8/97	2	Classroom	203	Door	Casing	Solid	Wood	0.02
112	1924 & 1937 Bldg.	59	XRF	7/8/97	2	Classroom	203	Door	Door	Solid	Wood	0.02
113	1924 & 1937 Bldg.	60	XRF	7/8/97	2	Classroom	203	Cabinet	Door	Solid	Wood	0
114	1924 & 1937 Bldg.	61	XRF	7/8/97	2	Classroom	203	Wall	Baseboard	Solid	Metal	0.81
115	1924 & 1937 Bldg.	62	XRF	7/8/97	2	Classroom	203	Wall	Radiator	Solid	Metal	0.18
116	1924 & 1937 Bldg.	63	XRF	7/8/97	2	Classroom	203	Wall	Radiator	Solid	Metal	1.1
117	1924 & 1937 Bldg.	24	XRF	7/8/97	2	Classroom	204	Chalkboard	Rail	Solid	Wood	0
118	1924 & 1937 Bldg.	25	XRF	7/8/97	2	Classroom	204	Door	Casing	Solid	Metal	0.15
119	1924 & 1937 Bldg.	26	XRF	7/8/97	2	Classroom	204	Door	Door	Solid	Wood	0

Saint Paul Public Schools  
 Cleveland Quality Middle School  
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample#	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
120	1924 & 1937 Bldg.	27	XRF	7/8/97	2	Classroom	204		Radiator	Solid	Metal	0.36
121	1924 & 1937 Bldg.	28	XRF	7/8/97	2	Classroom	204		Radiator	Solid	Metal	0.98
122	1924 & 1937 Bldg.	29	XRF	7/8/97	2	Classroom	204	Wall	Baseboard	Solid	Metal	0.28
123	1924 & 1937 Bldg.	30	XRF	7/8/97	2	Classroom	204	Wall	Wall	Solid	Plaster	0.28
124	1924 & 1937 Bldg.	31	XRF	7/8/97	2	Classroom	204	Wall	Midle Wall	Solid	Plaster	0.01
125	1924 & 1937 Bldg.	32	XRF	7/8/97	2	Classroom	204	Door	Casing	Solid	Wood	0
126	1924 & 1937 Bldg.	33	XRF	7/8/97	2	Classroom	204	Door	Door	Solid	Wood	0.03
127	1924 & 1937 Bldg.	34	XRF	7/8/97	2	Classroom	204	Cabinet	Door	Solid	Wood	0.02
128	1924 & 1937 Bldg.	157	XRF	7/8/97	2	Classroom	205	Wall	Wall	Solid	Plaster	0.45
129	1924 & 1937 Bldg.	158	XRF	7/8/97	2	Classroom	205	Chalkboard	Rail	Solid	Wood	0.05
130	1924 & 1937 Bldg.	159	XRF	7/8/97	2	Classroom	205	Wall	Midle Wall	Solid	Plaster	0.09
131	1924 & 1937 Bldg.	160	XRF	7/8/97	2	Classroom	205	Door	Casing	Solid	Wood	0
132	1924 & 1937 Bldg.	161	XRF	7/8/97	2	Classroom	205	Door	Door	Solid	Wood	0.02
133	1924 & 1937 Bldg.	162	XRF	7/8/97	2	Classroom	205	Wall	Baseboard	Solid	Metal	0.48
134	1924 & 1937 Bldg.	163	XRF	7/8/97	2	Classroom	205	Cabinet	Door	Solid	Wood	0
135	1924 & 1937 Bldg.	164	XRF	7/8/97	2	Classroom	205		Radiator	Solid	Metal	0.14
136	1924 & 1937 Bldg.	165	XRF	7/8/97	2	Classroom	205		Radiator	Solid	Metal	0.95
137	1924 & 1937 Bldg.	35	XRF	7/8/97	2	Classroom	206	Chalkboard	Rall	Solid	Wood	0
138	1924 & 1937 Bldg.	36	XRF	7/8/97	2	Classroom	206	Cabinet	Door	Solid	Wood	0
139	1924 & 1937 Bldg.	37	XRF	7/8/97	2	Classroom	206		Radiator	Solid	Metal	0.99
140	1924 & 1937 Bldg.	38	XRF	7/8/97	2	Classroom	206	Wall	Wall	Solid	Plaster	0
141	1924 & 1937 Bldg.	39	XRF	7/8/97	2	Classroom	206		Radiator	Solid	Metal	0.18
142	1924 & 1937 Bldg.	40	XRF	7/8/97	2	Classroom	206	Radiator	Pipe	Peeling	Metal	0.1
143	1924 & 1937 Bldg.	41	XRF	7/8/97	2	Classroom	206	Wall	Midle Wall	Solid	Plaster	0.01
144	1924 & 1937 Bldg.	42	XRF	7/8/97	2	Classroom	206	Wall	Baseboard	Solid	Metal	0.99
145	1924 & 1937 Bldg.	43	XRF	7/8/97	2	Classroom	206	Door	Casing	Solid	Wood	0
146	1924 & 1937 Bldg.	44	XRF	7/8/97	2	Classroom	206	Door	Door	Solid	Wood	0.02
147	1924 & 1937 Bldg.	81	XRF	7/8/97	2	Classroom	207	Wall	Wall	Solid	Plaster	0.41
148	1924 & 1937 Bldg.	82	XRF	7/8/97	2	Classroom	207	Wall	Baseboard	Solid	Metal	1.06
149	1924 & 1937 Bldg.	83	XRF	7/8/97	2	Classroom	207	Wall	Midle Wall	Solid	Plaster	0.01
150	1924 & 1937 Bldg.	84	XRF	7/8/97	2	Classroom	207	Door	Door	Solid	Wood	0.02
151	1924 & 1937 Bldg.	85	XRF	7/8/97	2	Classroom	207	Door	Casing	Solid	Wood	0
152	1924 & 1937 Bldg.	86	XRF	7/8/97	2	Classroom	207	Cabinet	Door	Solid	Wood	0.02
153	1924 & 1937 Bldg.	87	XRF	7/8/97	2	Classroom	207	Bulletin	Board	Solid	Wood	0.11
154	1924 & 1937 Bldg.	88	XRF	7/8/97	2	Classroom	207	Wall	Midle Wall	Peeling	Plaster	0.13
155	1924 & 1937 Bldg.	89	XRF	7/8/97	2	Classroom	207		Radiator	Solid	Metal	0.25
156	1924 & 1937 Bldg.	90	XRF	7/8/97	2	Classroom	207		Radiator	Solid	Metal	0.81
157	1924 & 1937 Bldg.	45	XRF	7/8/97	2	Classroom	208	Bulletin	Board	Solid	Wood	0
158	1924 & 1937 Bldg.	46	XRF	7/8/97	2	Classroom	208	Wall	Wall	Solid	Plaster	0.57
159	1924 & 1937 Bldg.	47	XRF	7/8/97	2	Classroom	208	Wall	Baseboard	Solid	Metal	1.01
160	1924 & 1937 Bldg.	48	XRF	7/8/97	2	Classroom	208		Radiator	Solid	Metal	0.32
161	1924 & 1937 Bldg.	49	XRF	7/8/97	2	Classroom	208		Radiator	Solid	Metal	1.02
162	1924 & 1937 Bldg.	50	XRF	7/8/97	2	Classroom	208	Wall	Midle Wall	Solid	Plaster	0.56
163	1924 & 1937 Bldg.	51	XRF	7/8/97	2	Classroom	208	Door	Casing	Solid	Wood	0
164	1924 & 1937 Bldg.	52	XRF	7/8/97	2	Classroom	208	Door	Door	Solid	Wood	0.02
165	1924 & 1937 Bldg.	72	XRF	7/8/97	2	Classroom	209	Chalkboard	Rail	Solid	Wood	0.04
166	1924 & 1937 Bldg.	73	XRF	7/8/97	2	Classroom	209	Wall	Midle Wall	Solid	Plaster	0.08
167	1924 & 1937 Bldg.	74	XRF	7/8/97	2	Classroom	209	Wall	Midle Wall	Solid	Plaster	0.2
168	1924 & 1937 Bldg.	75	XRF	7/8/97	2	Classroom	209	Door	Casing	Solid	Wood	0.01
169	1924 & 1937 Bldg.	76	XRF	7/8/97	2	Classroom	209	Door	Door	Solid	Wood	0.03
170	1924 & 1937 Bldg.	77	XRF	7/8/97	2	Classroom	209	Cabinet	Door	Solid	Wood	0.01
171	1924 & 1937 Bldg.	78	XRF	7/8/97	2	Classroom	209		Radiator	Solid	Metal	0.41
172	1924 & 1937 Bldg.	79	XRF	7/8/97	2	Classroom	209		Radiator	Solid	Metal	0.84
173	1924 & 1937 Bldg.	80	XRF	7/8/97	2	Classroom	209	Wall	Baseboard	Solid	Metal	0.56
174	1924 & 1937 Bldg.	64	XRF	7/8/97	2	Classroom	210	Wall	Radiator	Solid	Metal	0.14
175	1924 & 1937 Bldg.	65	XRF	7/8/97	2	Classroom	210	Wall	Wall	Peeling	Plaster	0.03
176	1924 & 1937 Bldg.	66	XRF	7/8/97	2	Classroom	210		Radiator	Solid	Metal	0.33
177	1924 & 1937 Bldg.	67	XRF	7/8/97	2	Classroom	210	Wall	Midle Wall	Solid	Plaster	0.1
178	1924 & 1937 Bldg.	68	XRF	7/8/97	2	Classroom	210	Door	Casing	Solid	Wood	0

Saint Paul Public Schools  
 Cleveland Quality Middle School  
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample#	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
179	1924 & 1937 Bldg.	69	XRF	7/8/97	2	Classroom	210	Door	Door	Solid	Wood	0.02
180	1924 & 1937 Bldg.	70	XRF	7/8/97	2	Classroom	210	Wall	Midle Wall	Solid	Plaster	0.07
181	1924 & 1937 Bldg.	71	XRF	7/8/97	2	Classroom	210	Chalkboard	Rail	Solid	Wood	0.01
182	1924 & 1937 Bldg.	91	XRF	7/8/97	2	Classroom	211	Wall	Midle Wall	Solid	Plaster	0.17
183	1924 & 1937 Bldg.	92	XRF	7/8/97	2	Classroom	211	Cabinet	Outside	Solid	Wood	0.01
184	1924 & 1937 Bldg.	93	XRF	7/8/97	2	Classroom	211	Door	Casing	Cracked	Wood	0.02
185	1924 & 1937 Bldg.	94	XRF	7/8/97	2	Classroom	211	Door	Door	Solid	Wood	0
186	1924 & 1937 Bldg.	95	XRF	7/8/97	2	Classroom	211	Wall	Wall	Solid	Plaster	0.01
187	1924 & 1937 Bldg.	96	XRF	7/8/97	2	Classroom	211	Wall	Baseboard	Solid	Metal	0.46
188	1924 & 1937 Bldg.	97	XRF	7/8/97	2	Classroom	211		Radiator	Solid	Metal	0.43
189	1924 & 1937 Bldg.	57	XRF	7/7/97	2	Classroom	253	Wall	Midle Wall	Solid	Plaster	0.05
190	1924 & 1937 Bldg.	58	XRF	7/7/97	2	Classroom	253	Door	Casing	Solid	Metal	0.17
191	1924 & 1937 Bldg.	59	XRF	7/7/97	2	Classroom	253	Cabinet	Door	Solid	Wood	0
192	1924 & 1937 Bldg.	60	XRF	7/7/97	2	Classroom	253	Cabinet	Door	Solid	Wood	0.02
193	1924 & 1937 Bldg.	61	XRF	7/7/97	2	Classroom	253	Wall	Wall	Solid	Plaster	0.2
194	1924 & 1937 Bldg.	62	XRF	7/7/97	2	Classroom	253	Door	Casing	Solid	Metal	0.19
195	1924 & 1937 Bldg.	63	XRF	7/7/97	2	Classroom	253	Door	Door	Solid	Wood	0
196	1924 & 1937 Bldg.	38	XRF	6/25/97	3	Classroom	300	Bulletin	Board	Solid	Wood	0.02
197	1924 & 1937 Bldg.	39	XRF	6/25/97	3	Classroom	300		Radiator	Solid	Metal	0
198	1924 & 1937 Bldg.	40	XRF	6/25/97	3	Classroom	300	Wall	Baseboard	Peeling	Wood	0.39
199	1924 & 1937 Bldg.	41	XRF	6/25/97	3	Classroom	300	Wall	Baseboard	Solid	Wood	0.01
200	1924 & 1937 Bldg.	42	XRF	6/25/97	3	Classroom	300	Cabinet	Door	Solid	Wood	0.1
201	1924 & 1937 Bldg.	43	XRF	6/25/97	3	Classroom	300	Wall	Midle Wall	Peeling	Plaster	0.05
202	1924 & 1937 Bldg.	44	XRF	6/25/97	3	Classroom	300	Wall	Midle Wall	Solid	Plaster	0.2
203	1924 & 1937 Bldg.	45	XRF	6/25/97	3	Classroom	300	Door	Casing	Solid	Wood	0.02
204	1924 & 1937 Bldg.	46	XRF	6/25/97	3	Classroom	300	Door	Door	Solid	Wood	0.04
205	1924 & 1937 Bldg.	30	XRF	6/25/97	3	Classroom	301		Radiator	Solid	Metal	0
206	1924 & 1937 Bldg.	31	XRF	6/25/97	3	Classroom	301	Wall	Baseboard	Solid	Wood	0.01
207	1924 & 1937 Bldg.	32	XRF	6/25/97	3	Classroom	301	Wall	Wall	Peeling	Plaster	0
208	1924 & 1937 Bldg.	33	XRF	6/25/97	3	Classroom	301	Wall	Baseboard	Solid	Wood	0
209	1924 & 1937 Bldg.	34	XRF	6/25/97	3	Classroom	301	Cabinet	Door	Solid	Wood	0
210	1924 & 1937 Bldg.	35	XRF	6/25/97	3	Classroom	301	Wall	Midle Wall	Solid	Plaster	0.04
211	1924 & 1937 Bldg.	36	XRF	6/25/97	3	Classroom	301	Door	Casing	Solid	Wood	0.01
212	1924 & 1937 Bldg.	37	XRF	6/25/97	3	Classroom	301	Wall	Baseboard	Solid	Wood	0.33
213	1924 & 1937 Bldg.	6	XRF	6/25/97	3	Classroom	302	Wall	Wall	Peeling	Plaster	0.12
214	1924 & 1937 Bldg.	7	XRF	6/25/97	3	Classroom	302		Radiator	Solid	Metal	0.34
215	1924 & 1937 Bldg.	8	XRF	6/25/97	3	Classroom	302	Wall	Baseboard	Solid	Wood	0.49
216	1924 & 1937 Bldg.	9	XRF	6/25/97	3	Classroom	302	Wall	Midle Wall	Solid	Plaster	0.02
217	1924 & 1937 Bldg.	10	XRF	6/25/97	3	Classroom	302	Door	Casing	Solid	Wood	0.01
218	1924 & 1937 Bldg.	11	XRF	6/25/97	3	Classroom	302	Door	Door	Solid	Wood	0.03
219	1924 & 1937 Bldg.	12	XRF	6/25/97	3	Classroom	302	Cabinet	Door	Solid	Wood	0
220	1924 & 1937 Bldg.	83	XRF	6/26/97	3	Classroom	303	Chalkboard	Rail	Solid	Wood	0.01
221	1924 & 1937 Bldg.	84	XRF	6/26/97	3	Classroom	303	Wall	Wall	Solid	Plaster	0.39
222	1924 & 1937 Bldg.	85	XRF	6/26/97	3	Classroom	303	Wall	Midle Wall	Solid	Plaster	0.1
223	1924 & 1937 Bldg.	86	XRF	6/26/97	3	Classroom	303	Door	Casing	Solid	Wood	0.02
224	1924 & 1937 Bldg.	87	XRF	6/26/97	3	Classroom	303	Door	Door	Solid	Wood	0.02
225	1924 & 1937 Bldg.	88	XRF	6/26/97	3	Classroom	303	Door	Door	Solid	Wood	0
226	1924 & 1937 Bldg.	89	XRF	6/26/97	3	Classroom	303	Cabinet	Door	Solid	Wood	0.01
227	1924 & 1937 Bldg.	90	XRF	6/26/97	3	Classroom	303		Radiator	Solid	Metal	0.09
228	1924 & 1937 Bldg.	91	XRF	6/26/97	3	Classroom	304	Cabinet	Door	Solid	Wood	0
229	1924 & 1937 Bldg.	92	XRF	6/26/97	3	Classroom	304	Door	Casing	Solid	Wood	0.01
230	1924 & 1937 Bldg.	93	XRF	6/26/97	3	Classroom	304	Wall	Baseboard	Solid	Metal	0.52
231	1924 & 1937 Bldg.	94	XRF	6/26/97	3	Classroom	304		Radiator	Solid	Metal	0.3
232	1924 & 1937 Bldg.	95	XRF	6/26/97	3	Classroom	304	Wall	Wall	Solid	Plaster	0
233	1924 & 1937 Bldg.	96	XRF	6/26/97	3	Classroom	304	Chalkboard	Rail	Solid	Wood	0
234	1924 & 1937 Bldg.	97	XRF	6/26/97	3	Classroom	304	Wall	Wall	Solid	Plaster	0.21
235	1924 & 1937 Bldg.	98	XRF	6/26/97	3	Classroom	304	Wall	Midle Wall	Solid	Plaster	0.39
236	1924 & 1937 Bldg.	99	XRF	6/26/97	3	Classroom	304	Door	Door	Solid	Wood	0.01
237	1924 & 1937 Bldg.	100	XRF	6/26/97	3	Classroom	305	Chalkboard	Rail	Solid	Wood	0.01

Saint Paul Public Schools  
 Cleveland Quality Middle School  
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample#	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
238	1924 & 1937 Bldg.	101	XRF	6/26/97	3	Classroom	305	Wall	Wall	Solid	Plaster	0.36
239	1924 & 1937 Bldg.	102	XRF	6/26/97	3	Classroom	305	Wall	Midle Wall	Peeling	Plaster	0.07
240	1924 & 1937 Bldg.	103	XRF	6/26/97	3	Classroom	305	Door	Door	Solid	Wood	0.02
241	1924 & 1937 Bldg.	104	XRF	6/26/97	3	Classroom	305	Door	Casing	Solid	Wood	0
242	1924 & 1937 Bldg.	105	XRF	6/26/97	3	Classroom	305	Cabinet	Door	Solid	Wood	0.02
243	1924 & 1937 Bldg.	106	XRF	6/26/97	3	Classroom	305	Wall	Baseboard	Solid	Metal	0.37
244	1924 & 1937 Bldg.	107	XRF	6/26/97	3	Classroom	305	Chalkboard	Rail	Peeling	Wood	0.02
245	1924 & 1937 Bldg.	108	XRF	6/26/97	3	Classroom	305		Radiator	Solid	Metal	0.98
246	1924 & 1937 Bldg.	109	XRF	6/26/97	3	Classroom	306	Chalkboard	Rail	Solid	Wood	0
247	1924 & 1937 Bldg.	110	XRF	6/26/97	3	Classroom	306		Radiator	Solid	Metal	1.06
248	1924 & 1937 Bldg.	111	XRF	6/26/97	3	Classroom	306	Wall	Midle Wall	Solid	Plaster	0.14
249	1924 & 1937 Bldg.	112	XRF	6/26/97	3	Classroom	306	Wall	Baseboard	Peeling	Metal	0.66
250	1924 & 1937 Bldg.	113	XRF	6/26/97	3	Classroom	306	Wall	Midle Wall	Solid	Plaster	0.01
251	1924 & 1937 Bldg.	114	XRF	6/26/97	3	Classroom	306	Door	Casing	Solid	Wood	0.01
252	1924 & 1937 Bldg.	115	XRF	6/26/97	3	Classroom	306	Door	Door	Solid	Wood	0.02
253	1924 & 1937 Bldg.	116	XRF	6/26/97	3	Classroom	306	Cabinet	Door	Solid	Wood	0.02
254	1924 & 1937 Bldg.	117	XRF	6/26/97	3	Classroom	307	Chalkboard	Rail	Solid	Wood	0.01
255	1924 & 1937 Bldg.	118	XRF	6/26/97	3	Classroom	307	Wall	Baseboard	Solid	Metal	0.5
256	1924 & 1937 Bldg.	119	XRF	6/26/97	3	Classroom	307	Wall	Wall	Solid	Plaster	0.24
257	1924 & 1937 Bldg.	120	XRF	6/26/97	3	Classroom	307	Wall	Midle Wall	Solid	Plaster	0.05
258	1924 & 1937 Bldg.	121	XRF	6/26/97	3	Classroom	307	Door	Door	Solid	Wood	0.02
259	1924 & 1937 Bldg.	122	XRF	6/26/97	3	Classroom	307	Door	Casing	Solid	Wood	0.01
260	1924 & 1937 Bldg.	123	XRF	6/26/97	3	Classroom	307	Cabinet	Door	Solid	Wood	0.02
261	1924 & 1937 Bldg.	124	XRF	6/26/97	3	Classroom	307		Radiator	Solid	Metal	0.95
262	1924 & 1937 Bldg.	125	XRF	6/26/97	3	Classroom	308	Chalkboard	Rail	Solid	Wood	0.01
263	1924 & 1937 Bldg.	126	XRF	6/26/97	3	Classroom	308	Wall	Wall	Solid	Plaster	0.4
264	1924 & 1937 Bldg.	127	XRF	6/26/97	3	Classroom	308	Wall	Baseboard	Solid	Metal	0.36
265	1924 & 1937 Bldg.	128	XRF	6/26/97	3	Classroom	308		Radiator	Solid	Metal	0.91
266	1924 & 1937 Bldg.	129	XRF	6/26/97	3	Classroom	308	Wall	Midle Wall	Solid	Plaster	0.04
267	1924 & 1937 Bldg.	130	XRF	6/26/97	3	Classroom	308	Door	Door	Solid	Wood	0.02
268	1924 & 1937 Bldg.	131	XRF	6/26/97	3	Classroom	308	Cabinet	Door	Solid	Wood	0.02
269	1924 & 1937 Bldg.	132	XRF	6/26/97	3	Classroom	309	Chalkboard	Rail	Solid	Wood	0.26
270	1924 & 1937 Bldg.	133	XRF	6/26/97	3	Classroom	309	Wall	Wall	Solid	Plaster	0.58
271	1924 & 1937 Bldg.	134	XRF	6/26/97	3	Classroom	309	Wall	Baseboard	Solid	Metal	0.26
272	1924 & 1937 Bldg.	135	XRF	6/26/97	3	Classroom	309	Wall	Midle Wall	Solid	Plaster	0.31
273	1924 & 1937 Bldg.	136	XRF	6/26/97	3	Classroom	309	Door	Door	Solid	Wood	0.02
274	1924 & 1937 Bldg.	137	XRF	6/26/97	3	Classroom	309	Door	Casing	Solid	Wood	0.01
275	1924 & 1937 Bldg.	138	XRF	6/26/97	3	Classroom	309	Cabinet	Door	Solid	Wood	0.01
276	1924 & 1937 Bldg.	139	XRF	6/26/97	3	Classroom	309		Radiator	Solid	Metal	0.9
277	1924 & 1937 Bldg.	140	XRF	6/26/97	3	Classroom	310	Chalkboard	Rail	Solid	Wood	0.12
278	1924 & 1937 Bldg.	141	XRF	6/26/97	3	Classroom	310		Radiator	Solid	Metal	0.9
279	1924 & 1937 Bldg.	142	XRF	6/26/97	3	Classroom	310	Wall	Baseboard	Solid	Metal	0.52
280	1924 & 1937 Bldg.	143	XRF	6/26/97	3	Classroom	310	Cabinet	Door	Solid	Wood	0.01
281	1924 & 1937 Bldg.	144	XRF	6/26/97	3	Classroom	310	Wall	Wall	Solid	Plaster	0.02
282	1924 & 1937 Bldg.	145	XRF	6/26/97	3	Classroom	310	Door	Door	Solid	Wood	0.01
283	1924 & 1937 Bldg.	146	XRF	6/26/97	3	Classroom	310	Door	Casing	Solid	Wood	0.02
284	1924 & 1937 Bldg.	19	XRF	7/9/97	1	Gym	2	Wall	Wall	Solid	Concrete	0
285	1924 & 1937 Bldg.	20	XRF	7/9/97	1	Gym	2	Door	Door	Solid	Wood	0
286	1924 & 1937 Bldg.	21	XRF	7/9/97	1	Gym	2	Door	Casing	Solid	Metal	0.18
287	1924 & 1937 Bldg.	22	XRF	7/9/97	1	Gym	2		Locker	Solid	Metal	0
288	1924 & 1937 Bldg.	6	XRF	7/9/97	1	Hall	1		Locker	Solid	Metal	0.19
289	1924 & 1937 Bldg.	7	XRF	7/9/97	1	Hall	1		Radiator	Peeling	Metal	0.01
290	1924 & 1937 Bldg.	8	XRF	7/9/97	1	Hall	1	Window	Casing	Solid	Metal	0.02
291	1924 & 1937 Bldg.	9	XRF	7/9/97	1	Hall	1	Door	Door	Solid	Metal	0.27
292	1924 & 1937 Bldg.	10	XRF	7/9/97	1	Hall	1	Wall	Mural	Solid	Plaster	0.02
293	1924 & 1937 Bldg.	11	XRF	7/9/97	1	Hall	1	Wall	Wall	Solid	Plaster	0.08
294	1924 & 1937 Bldg.	12	XRF	7/9/97	1	Hall	1	Crown Moldi	Wall	Solid	Wood	0.05
295	1924 & 1937 Bldg.	13	XRF	7/9/97	1	Hall	1	Door	Door	Solid	Wood	0.07
296	1924 & 1937 Bldg.	14	XRF	7/9/97	1	Hall	1	Door	Door	Solid	Wood	0.07

Saint Paul Public Schools  
 Cleveland Quality Middle School  
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample#	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
297	1924 & 1937 Bldg.	15	XRF	7/9/97	1	Hall	1	Wall	Chair rail	Solid	Wood	0.03
298	1924 & 1937 Bldg.	16	XRF	7/9/97	1	Hall	1	Elec Panel	Solid	Metal	0.01	
299	1924 & 1937 Bldg.	17	XRF	7/9/97	1	Hall	1	Door	Casing	Solid	Metal	0.05
300	1924 & 1937 Bldg.	18	XRF	7/9/97	1	Hall	1	Cabinet	Door	Solid	Metal	0.21
301	1924 & 1937 Bldg.	98	XRF	7/8/97	2	Hall	2	Wall	Midle Wall	Solid	Plaster	0.04
302	1924 & 1937 Bldg.	99	XRF	7/8/97	2	Hall	2	Wall	Chair rail	Solid	Wood	0.02
303	1924 & 1937 Bldg.	100	XRF	7/8/97	2	Hall	2		Locker	Solid	Metal	0.17
304	1924 & 1937 Bldg.	101	XRF	7/8/97	2	Hall	2	Door	Door	Solid	Wood	0
305	1924 & 1937 Bldg.	102	XRF	7/8/97	2	Hall	2		Elec Panel	Solid	Wood	0.01
306	1924 & 1937 Bldg.	103	XRF	7/8/97	2	Hall	2	Door	Door	Solid	Wood	0.14
307	1924 & 1937 Bldg.	104	XRF	7/8/97	2	Hall	2	Door	Casing	Solid	Wood	0.1
308	1924 & 1937 Bldg.	105	XRF	7/8/97	2	Hall	2	Wall	Midle Wall	Solid	Plaster	0.01
309	1924 & 1937 Bldg.	106	XRF	7/8/97	2	Hall	2		Radiator	Peeling	Metal	0.02
310	1924 & 1937 Bldg.	107	XRF	7/8/97	2	Hall	2		Elec Panel	Solid	Metal	0.01
311	1924 & 1937 Bldg.	108	XRF	7/8/97	2	Hall	2	Wall	Mural	Solid	Plaster	0.26
312	1924 & 1937 Bldg.	109	XRF	7/8/97	2	Hall	2	Wall	Mural	Solid	Metal	0.33
313	1924 & 1937 Bldg.	110	XRF	7/8/97	2	Hall	2	Cabinet	Outside	Solid	Metal	0.33
314	1924 & 1937 Bldg.	111	XRF	7/8/97	2	Hall	2	Door	Casing	Solid	Metal	0
315	1924 & 1937 Bldg.	112	XRF	7/8/97	2	Hall	2	Door	Door	Solid	Metal	0
316	1924 & 1937 Bldg.	147	XRF	6/26/97	3	Hall	3	Wall	Wall	Solid	Wood	0.02
317	1924 & 1937 Bldg.	148	XRF	6/26/97	3	Hall	3	Door	Casing	Solid	Wood	0.01
318	1924 & 1937 Bldg.	149	XRF	6/26/97	3	Hall	3	Wall	Mural	Solid	Plaster	0.58
319	1924 & 1937 Bldg.	150	XRF	6/26/97	3	Hall	3	Wall	Mural	Solid	Plaster	0.39
320	1924 & 1937 Bldg.	151	XRF	6/26/97	3	Hall	3	Wall	Chair rail	Solid	Wood	0.05
321	1924 & 1937 Bldg.	152	XRF	6/26/97	3	Hall	3		Elec Panel	Solid	Metal	0.01
322	1924 & 1937 Bldg.	153	XRF	6/26/97	3	Hall	3	Wall	Wall	Solid	Plaster	0.3
323	1924 & 1937 Bldg.	154	XRF	6/26/97	3	Hall	3		Ceiling	Solid	Plaster	0
324	1924 & 1937 Bldg.	155	XRF	6/26/97	3	Hall	3		Locker	Solid	Metal	0.21
325	1924 & 1937 Bldg.	156	XRF	6/26/97	3	Hall	3	Door	Door	Solid	Wood	0.02
326	1924 & 1937 Bldg.	157	XRF	6/26/97	3	Hall	3	Door	Casing	Solid	Metal	0
327	1924 & 1937 Bldg.	158	XRF	6/26/97	3	Hall	3	Door	Door	Solid	Metal	0
328	1924 & 1937 Bldg.	159	XRF	6/26/97	3	Hall	3	Wall	Mural	Solid	Plaster	0
329	1924 & 1937 Bldg.	160	XRF	6/26/97	3	Hall	3	Wall	Mural	Solid	Drywall	0
330	1924 & 1937 Bldg.	210	XRF	7/8/97	1	Kitchen	1	Wall	Midle Wall	Solid	Plaster	0
331	1924 & 1937 Bldg.	211	XRF	7/8/97	1	Kitchen	1	Wall	Midle Wall	Solid	Metal	0.07
332	1924 & 1937 Bldg.	212	XRF	7/8/97	1	Kitchen	1	Door	Door	Solid	Metal	0.06
333	1924 & 1937 Bldg.	213	XRF	7/8/97	1	Kitchen	1		Radiator	Solid	Metal	0.51
334	1924 & 1937 Bldg.	214	XRF	7/8/97	1	Kitchen	1	Door	Casing	Solid	Metal	0.36
335	1924 & 1937 Bldg.	215	XRF	7/8/97	1	Kitchen	1	Door	Door	Solid	Wood	0.28
336	1924 & 1937 Bldg.	216	XRF	7/8/97	1	Kitchen	1	Door	Casing	Solid	Wood	0.17
337	1924 & 1937 Bldg.	34	XRF	7/7/97	2	Library	1	Wall	Wall	Peeling	Plaster	0
338	1924 & 1937 Bldg.	35	XRF	7/7/97	2	Library	1	Radiator	Pipe	Peeling	Metal	0.08
339	1924 & 1937 Bldg.	36	XRF	7/7/97	2	Library	1		Radiator	Peeling	Metal	0.3
340	1924 & 1937 Bldg.	37	XRF	7/7/97	2	Library	1		Radiator	Solid	Metal	0.51
341	1924 & 1937 Bldg.	38	XRF	7/7/97	2	Library	1		Radiator	Solid	Metal	0.01
342	1924 & 1937 Bldg.	39	XRF	7/7/97	2	Library	1		Univent	Solid	Metal	0
343	1924 & 1937 Bldg.	40	XRF	7/7/97	2	Library	1	Wall	Baseboard	Solid	Wood	0
344	1924 & 1937 Bldg.	41	XRF	7/7/97	2	Library	1	Door	Door	Solid	Wood	0
345	1924 & 1937 Bldg.	42	XRF	7/7/97	2	Library	1	Door	Casing	Solid	Wood	0.02
346	1924 & 1937 Bldg.	43	XRF	7/7/97	2	Library	1	Door	Casing	Solid	Metal	0
347	1924 & 1937 Bldg.	44	XRF	7/7/97	2	Library	1	Door	Door	Solid	Wood	0
348	1924 & 1937 Bldg.	45	XRF	7/7/97	2	Library	1	Door	Casing	Solid	Metal	0
349	1924 & 1937 Bldg.	46	XRF	7/7/97	2	Library	1	Bookcase	Shelf	Solid	Wood	0.12
350	1924 & 1937 Bldg.	47	XRF	7/7/97	2	Library	1	Door	Door	Solid	Wood	0.02
351	1924 & 1937 Bldg.	170	XRF	7/8/97	1	Lounge	102	Wall	Midle Wall	Solid	Plaster	0.21
352	1924 & 1937 Bldg.	171	XRF	7/8/97	1	Lounge	102		Radiator	Solid	Metal	0
353	1924 & 1937 Bldg.	172	XRF	7/8/97	1	Lounge	102		Column	Solid	Plaster	0.7
354	1924 & 1937 Bldg.	173	XRF	7/8/97	1	Lounge	102	Cabinet	Door	Solid	Wood	0
355	1924 & 1937 Bldg.	174	XRF	7/8/97	1	Lounge	102	Door	Door	Solid	Wood	0

Saint Paul Public Schools  
 Cleveland Quality Middle School  
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample#	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
356	1924 & 1937 Bldg.	175	XRF	7/8/97	1	Lounge	102	Door	Casing	Solid	Metal	0
357	1924 & 1937 Bldg.	176	XRF	7/8/97	1	Lounge	102	Radiator	Solid	Metal	0	
358	1924 & 1937 Bldg.	197	XRF	7/8/97	1	Main	1	Radiator	Solid	Metal	0.03	
359	1924 & 1937 Bldg.	198	XRF	7/8/97	1	Main	1	Door	Casing	Solid	Wood	0.02
360	1924 & 1937 Bldg.	199	XRF	7/8/97	1	Main	1	Wall	Middle Wall	Solid	Plaster	0.02
361	1924 & 1937 Bldg.	200	XRF	7/8/97	1	Main	1	Door	Door	Solid	Wood	0.03
362	1924 & 1937 Bldg.	201	XRF	7/8/97	1	Main	1	Door	Casing	Solid	Wood	0.01
363	1924 & 1937 Bldg.	27	XRF	7/7/97	2	Other	1	Door	Door	Solid	Wood	0
364	1924 & 1937 Bldg.	28	XRF	7/7/97	2	Other	1	Door	Casing	Solid	Wood	0.01
365	1924 & 1937 Bldg.	29	XRF	7/7/97	2	Other	1	Window	Panel	Solid	Wood	0
366	1924 & 1937 Bldg.	30	XRF	7/7/97	2	Other	1	Wall	Middle Wall	Solid	Plaster	0.03
367	1924 & 1937 Bldg.	31	XRF	7/7/97	2	Other	1	Wall	Baseboard	Solid	Metal	0.44
368	1924 & 1937 Bldg.	32	XRF	7/7/97	2	Other	1	Cabinet	Outside	Solid	Wood	0.03
369	1924 & 1937 Bldg.	33	XRF	7/7/97	2	Other	1		Radiator	Solid	Metal	0.38
370	1924 & 1937 Bldg.	166	XRF	7/8/97	1	Restroom	101	Wall	Middle Wall	Solid	Plaster	0.03
371	1924 & 1937 Bldg.	167	XRF	7/8/97	1	Restroom	101		Radiator	Solid	Metal	0.01
372	1924 & 1937 Bldg.	168	XRF	7/8/97	1	Restroom	101	Door	Door	Solid	Wood	0
373	1924 & 1937 Bldg.	169	XRF	7/8/97	1	Restroom	101	Door	Casing	Solid	Metal	0.18
374	1924 & 1937 Bldg.	225	XRF	7/8/97	1	Restroom	102	Door	Door	Solid	Wood	0.13
375	1924 & 1937 Bldg.	226	XRF	7/8/97	1	Restroom	102	Wall	Chair rail	Solid	Wood	0.48
376	1924 & 1937 Bldg.	227	XRF	7/8/97	1	Restroom	102		Radiator	Solid	Metal	0.16
377	1924 & 1937 Bldg.	228	XRF	7/8/97	1	Restroom	102	Wall	Middle Wall	Solid	Plaster	0.06
378	1924 & 1937 Bldg.	229	XRF	7/8/97	1	Restroom	102	Door	Casing	Solid	Wood	0.07
379	1924 & 1937 Bldg.	230	XRF	7/8/97	1	Restroom	102	Door	Door	Solid	Wood	0.09
380	1924 & 1937 Bldg.	231	XRF	7/8/97	1	Restroom	103	Wall	Middle Wall	Solid	Plaster	0.13
381	1924 & 1937 Bldg.	232	XRF	7/8/97	1	Restroom	103	Door	Casing	Cracked	Wood	0.03
382	1924 & 1937 Bldg.	233	XRF	7/8/97	1	Restroom	103	Door	Door	Solid	Wood	0.05
383	1924 & 1937 Bldg.	234	XRF	7/8/97	1	Restroom	103	Wall	Chair rail	Solid	Wood	0
384	1924 & 1937 Bldg.	235	XRF	7/8/97	1	Restroom	103		Radiator	Solid	Metal	0.31
385	1924 & 1937 Bldg.	6	XRF	7/8/97	2	Restroom	201	Door	Door	Solid	Wood	0.03
386	1924 & 1937 Bldg.	7	XRF	7/8/97	2	Restroom	201	Door	Casing	Solid	Wood	0
387	1924 & 1937 Bldg.	8	XRF	7/8/97	2	Restroom	201	Wall	Middle Wall	Solid	Plaster	0.2
388	1924 & 1937 Bldg.	9	XRF	7/8/97	2	Restroom	201	Wall	Chair rail	Solid	Wood	0
389	1924 & 1937 Bldg.	10	XRF	7/8/97	2	Restroom	201	Wall	Wall	Solid	Drywall	0.06
390	1924 & 1937 Bldg.	11	XRF	7/8/97	2	Restroom	201		Radiator	Solid	Metal	0.21
391	1924 & 1937 Bldg.	12	XRF	7/8/97	2	Restroom	201	Wall	Stall Door	Solid	Wood	0.01
392	1924 & 1937 Bldg.	13	XRF	7/8/97	2	Restroom	202	Wall	Middle Wall	Solid	Plaster	0.4
393	1924 & 1937 Bldg.	14	XRF	7/8/97	2	Restroom	202		Elec Panel	Solid	Wood	0
394	1924 & 1937 Bldg.	15	XRF	7/8/97	2	Restroom	202	Wall	Stall Door	Solid	Wood	0
395	1924 & 1937 Bldg.	16	XRF	7/8/97	2	Restroom	202		Radiator	Solid	Metal	0.03
396	1924 & 1937 Bldg.	17	XRF	7/8/97	2	Restroom	202	Wall	Middle Wall	Solid	Plaster	0.06
397	1924 & 1937 Bldg.	18	XRF	7/8/97	2	Restroom	202	Door	Casing	Peeling	Wood	0.02
398	1924 & 1937 Bldg.	19	XRF	7/8/97	2	Restroom	202	Door	Door	Peeling	Wood	0.02
399	1924 & 1937 Bldg.	13	XRF	6/25/97	3	Restroom	301	Door	Door	Solid	Wood	0.02
400	1924 & 1937 Bldg.	14	XRF	6/25/97	3	Restroom	301	Door	Casing	Solid	Wood	0.01
401	1924 & 1937 Bldg.	15	XRF	6/25/97	3	Restroom	301	Wall	Middle Wall	Solid	Plaster	0.1
402	1924 & 1937 Bldg.	16	XRF	6/25/97	3	Restroom	301	Shelf	Middle Wall	Solid	Wood	0
403	1924 & 1937 Bldg.	17	XRF	6/25/97	3	Restroom	301	Wall	Wall	Solid	Drywall	0.18
404	1924 & 1937 Bldg.	18	XRF	6/25/97	3	Restroom	301		Radiator	Solid	Metal	0.28
405	1924 & 1937 Bldg.	19	XRF	6/25/97	3	Restroom	301	Wall	Stall Door	Solid	Wood	0.03
406	1924 & 1937 Bldg.	20	XRF	6/25/97	3	Restroom	301	Wall	Diffuser	Solid	Metal	0
407	1924 & 1937 Bldg.	21	XRF	6/25/97	3	Restroom	302	Wall	Middle Wall	Solid	Plaster	0.8
408	1924 & 1937 Bldg.	22	XRF	6/25/97	3	Restroom	302	Wall	Middle Wall	Solid	Plaster	0.06
409	1924 & 1937 Bldg.	23	XRF	6/25/97	3	Restroom	302	Wall	Stall Door	Solid	Wood	0
410	1924 & 1937 Bldg.	24	XRF	6/25/97	3	Restroom	302	Stall Support	Stall Door	Solid	Metal	0.29
411	1924 & 1937 Bldg.	25	XRF	6/25/97	3	Restroom	302		Radiator	Solid	Metal	0.02
412	1924 & 1937 Bldg.	26	XRF	6/25/97	3	Restroom	302	Wall	Middle Wall	Solid	Drywall	0.25
413	1924 & 1937 Bldg.	27	XRF	6/25/97	3	Restroom	302	Mirror Frame	Middle Wall	Solid	Wood	0
414	1924 & 1937 Bldg.	28	XRF	6/25/97	3	Restroom	302	Door	Door	Solid	Wood	0.03

Saint Paul Public Schools  
 Cleveland Quality Middle School  
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample#	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
415	1924 & 1937 Bldg.	29	XRF	6/25/97	3	Restroom	302	Door	Casing	Solid	Wood	0.02
416	1924 & 1937 Bldg.	77	XRF	6/26/97	3	Restroom	303	Door	Door	Solid	Wood	0.05
417	1924 & 1937 Bldg.	78	XRF	6/26/97	3	Restroom	303	Door	Casing	Solid	Wood	0.05
418	1924 & 1937 Bldg.	79	XRF	6/26/97	3	Restroom	303	Wall	Midle Wall	Solid	Plaster	0.02
419	1924 & 1937 Bldg.	80	XRF	6/26/97	3	Restroom	303		Radiator	Peeling	Metal	0.02
420	1924 & 1937 Bldg.	81	XRF	6/26/97	3	Restroom	303	Wall	Midle Wall	Solid	Plaster	2.99
421	1924 & 1937 Bldg.	82	XRF	6/26/97	3	Restroom	303	Wall	Stall Door	Solid	Wood	0.01
422	1924 & 1937 Bldg.	189	XRF	7/8/97	1	Room	103		Radiator	Solid	Metal	2.75
423	1924 & 1937 Bldg.	190	XRF	7/8/97	1	Room	103	Wall	Midle Wall	Solid	Plaster	0
424	1924 & 1937 Bldg.	191	XRF	7/8/97	1	Room	103	Wall	Midle Wall	Solid	Plaster	0.06
425	1924 & 1937 Bldg.	192	XRF	7/8/97	1	Room	103	Radiator	Pipe	Peeling	Metal	0.28
426	1924 & 1937 Bldg.	193	XRF	7/8/97	1	Room	103	Wall	Baseboard	Solid	Wood	0.12
427	1924 & 1937 Bldg.	194	XRF	7/8/97	1	Room	103	Door	Casing	Solid	Wood	0.03
428	1924 & 1937 Bldg.	195	XRF	7/8/97	1	Room	103	Door	Door	Solid	Wood	0.02
429	1924 & 1937 Bldg.	196	XRF	7/8/97	1	Room	103	Chalkboard	Rail	Solid	Wood	0.1
430	1924 & 1937 Bldg.	217	XRF	7/8/97	1	Room	104	Wall	Midle Wall	Solid	Plaster	0.08
431	1924 & 1937 Bldg.	218	XRF	7/8/97	1	Room	104		Radiator	Peeling	Metal	0.64
432	1924 & 1937 Bldg.	219	XRF	7/8/97	1	Room	104	Wall	Baseboard	Solid	Wood	0.1
433	1924 & 1937 Bldg.	220	XRF	7/8/97	1	Room	104	Chalkboard	Rail	Solid	Wood	0.21
434	1924 & 1937 Bldg.	221	XRF	7/8/97	1	Room	104	Door	Casing	Solid	Wood	0.1
435	1924 & 1937 Bldg.	222	XRF	7/8/97	1	Room	104	Door	Door	Solid	Wood	0.01
436	1924 & 1937 Bldg.	223	XRF	7/8/97	1	Room	104	Door	Casing	Solid	Metal	0.22
437	1924 & 1937 Bldg.	224	XRF	7/8/97	1	Room	104	Door	Casing	Solid	Wood	0.16
438	1924 & 1937 Bldg.	236	XRF	7/8/97	1	Room	105	Wall	Midle Wall	Solid	Plaster	0.17
439	1924 & 1937 Bldg.	237	XRF	7/8/97	1	Room	105	Wall	Midle Wall	Solid	Drywall	0.1
440	1924 & 1937 Bldg.	238	XRF	7/8/97	1	Room	105	Door	Casing	Solid	Metal	0
441	1924 & 1937 Bldg.	239	XRF	7/8/97	1	Room	105	Door	Door	Solid	Wood	0.02
442	1924 & 1937 Bldg.	240	XRF	7/8/97	1	Room	105	Door	Casing	Solid	Wood	0
443	1924 & 1937 Bldg.	241	XRF	7/8/97	1	Room	105		Radiator	Solid	Metal	0.65
444	1924 & 1937 Bldg.	150	XRF	7/8/97	1	Room	106	Wall	Midle Wall	Solid	Plaster	0.16
445	1924 & 1937 Bldg.	151	XRF	7/8/97	1	Room	106		Radiator	Solid	Metal	0.39
446	1924 & 1937 Bldg.	152	XRF	7/8/97	1	Room	106	Wall	Baseboard	Solid	Metal	0.36
447	1924 & 1937 Bldg.	153	XRF	7/8/97	1	Room	106	Wall	Midle Wall	Solid	Drywall	0
448	1924 & 1937 Bldg.	154	XRF	7/8/97	1	Room	106		Radiator	Solid	Metal	1.43
449	1924 & 1937 Bldg.	155	XRF	7/8/97	1	Room	106	Door	Casing	Solid	Wood	0.01
450	1924 & 1937 Bldg.	156	XRF	7/8/97	1	Room	106	Door	Door	Solid	Wood	0.1
451	1924 & 1937 Bldg.	259	XRF	7/8/97	1	Room	111	Wall	Midle Wall	Solid	Plaster	0.07
452	1924 & 1937 Bldg.	260	XRF	7/8/97	1	Room	111	Wall	Midle Wall	Solid	Plaster	0.09
453	1924 & 1937 Bldg.	261	XRF	7/8/97	1	Room	111	Door	Casing	Solid	Metal	0.2
454	1924 & 1937 Bldg.	262	XRF	7/8/97	1	Room	111	Door	Door	Solid	Wood	0
455	1924 & 1937 Bldg.	263	XRF	7/8/97	1	Room	111		Radiator	Solid	Metal	0
456	1924 & 1937 Bldg.	298	XRF	7/8/97	1	Room	114	Wall	Midle Wall	Solid	Plaster	0.29
457	1924 & 1937 Bldg.	299	XRF	7/8/97	1	Room	114		Radiator	Solid	Metal	0.25
458	1924 & 1937 Bldg.	300	XRF	7/8/97	1	Room	114	Door	Door	Solid	Metal	0
459	1924 & 1937 Bldg.	301	XRF	7/8/97	1	Room	114	Wall	Midle Wall	Solid	Concrete	0
460	1924 & 1937 Bldg.	302	XRF	7/8/97	1	Room	114	Wall	Midle Wall	Solid	Concrete	0.01
461	1924 & 1937 Bldg.	303	XRF	7/8/97	1	Room	114	Door	Casing	Solid	Wood	0.03
462	1924 & 1937 Bldg.	304	XRF	7/8/97	1	Room	114	Door	Door	Solid	Wood	0.2
463	1924 & 1937 Bldg.	305	XRF	7/8/97	1	Room	114	Floor		Peeling	Concrete	0
464	1924 & 1937 Bldg.	283	XRF	7/8/97	1	Room	115	Chalkboard	Rail	Solid	Wood	0.28
465	1924 & 1937 Bldg.	284	XRF	7/8/97	1	Room	115	Wall	Midle Wall	Solid	Plaster	0.09
466	1924 & 1937 Bldg.	285	XRF	7/8/97	1	Room	115	Wall	Midle Wall	Solid	Plaster	0.15
467	1924 & 1937 Bldg.	286	XRF	7/8/97	1	Room	115	Cabinet	Door	Solid	Wood	0.22
468	1924 & 1937 Bldg.	287	XRF	7/8/97	1	Room	115		Radiator	Solid	Metal	0.22
469	1924 & 1937 Bldg.	288	XRF	7/8/97	1	Room	115		Radiator	Solid	Metal	0.72
470	1924 & 1937 Bldg.	20	XRF	7/8/97	2	Room	214	Wall	Midle Wall	Solid	Plaster	0.13
471	1924 & 1937 Bldg.	21	XRF	7/8/97	2	Room	214	Wall	Baseboard	Solid	Wood	0
472	1924 & 1937 Bldg.	22	XRF	7/8/97	2	Room	214	Door	Casing	Solid	Wood	0.01
473	1924 & 1937 Bldg.	23	XRF	7/8/97	2	Room	214	Door	Door	Solid	Wood	0.02

Saint Paul Public Schools  
 Cleveland Quality Middle School  
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample#	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
474	1924 & 1937 Bldg.	55	XRF	7/7/97	2	Room	255	Door	Casing	Solid	Metal	0.18
475	1924 & 1937 Bldg.	56	XRF	7/7/97	2	Room	255	Wall	Midle Wall	Solid	Metal	0
476	1924 & 1937 Bldg.	47	XRF	6/25/97	3	Room	300		Radiator	Solid	Metal	2.58
477	1924 & 1937 Bldg.	48	XRF	6/25/97	3	Room	300	Wall	Wall	Peeling	Plaster	0.13
478	1924 & 1937 Bldg.	49	XRF	6/25/97	3	Room	300	Wall	Midle Wall	Solid	Plaster	0
479	1924 & 1937 Bldg.	50	XRF	6/25/97	3	Room	300	Cabinet	Door	Solid	Wood	0
480	1924 & 1937 Bldg.	51	XRF	6/25/97	3	Room	300	Door	Casing	Solid	Wood	0.01
481	1924 & 1937 Bldg.	52	XRF	6/25/97	3	Room	300	Door	Door	Solid	Wood	0.03
482	1924 & 1937 Bldg.	63	XRF	6/26/97	3	Room	302	Door	Door	Solid	Wood	0.02
483	1924 & 1937 Bldg.	64	XRF	6/26/97	3	Room	302	Door	Casing	Solid	Wood	0.01
484	1924 & 1937 Bldg.	65	XRF	6/26/97	3	Room	302	Wall	Midle Wall	Solid	Plaster	0.2
485	1924 & 1937 Bldg.	66	XRF	6/26/97	3	Room	302		Radiator	Solid	Metal	0.46
486	1924 & 1937 Bldg.	67	XRF	6/26/97	3	Room	302	Wall	Baseboard	Solid	Metal	0.4
487	1924 & 1937 Bldg.	68	XRF	6/26/97	3	Room	311	Wall	Midle Wall	Solid	Plaster	0.05
488	1924 & 1937 Bldg.	69	XRF	6/26/97	3	Room	311	Wall	Baseboard	Solid	Wood	0.01
489	1924 & 1937 Bldg.	70	XRF	6/26/97	3	Room	311	Door	Casing	Solid	Metal	0.1
490	1924 & 1937 Bldg.	71	XRF	6/26/97	3	Room	311		Radiator	Peeling	Metal	4.23
491	1924 & 1937 Bldg.	72	XRF	6/26/97	3	Room	311	Wall	Baseboard	Solid	Wood	0.04
492	1924 & 1937 Bldg.	73	XRF	6/26/97	3	Room	311	Bookcase	Shelf	Solid	Wood	0
493	1924 & 1937 Bldg.	74	XRF	6/26/97	3	Room	311	Wall	Wall	Peeling	Plaster	2.46
494	1924 & 1937 Bldg.	75	XRF	6/26/97	3	Room	311	Door	Door	Solid	Wood	0.03
495	1924 & 1937 Bldg.	76	XRF	6/26/97	3	Room	311	Door	Casing	Solid	Wood	0.04
496	1924 & 1937 Bldg.	113	XRF	7/8/97	1	Stairwell	1		Radiator	Solid	Metal	0.47
497	1924 & 1937 Bldg.	114	XRF	7/8/97	1	Stairwell	1	Ceiling		Solid	Plaster	0.09
498	1924 & 1937 Bldg.	115	XRF	7/8/97	1	Stairwell	1	Door	Door	Solid	Metal	0
499	1924 & 1937 Bldg.	116	XRF	7/8/97	1	Stairwell	1	Door	Door	Solid	Wood	0.11
500	1924 & 1937 Bldg.	117	XRF	7/8/97	1	Stairwell	1	Door	Casing	Solid	Metal	0
501	1924 & 1937 Bldg.	118	XRF	7/8/97	1	Stairwell	1	Door	Door	Solid	Metal	0
502	1924 & 1937 Bldg.	119	XRF	7/8/97	1	Stairwell	1	Stairs	Newal post	Solid	Plaster	0.15
503	1924 & 1937 Bldg.	120	XRF	7/8/97	1	Stairwell	1	Wall	Chair rail	Solid	Wood	0.32
504	1924 & 1937 Bldg.	121	XRF	7/8/97	1	Stairwell	1	Stairs	Wall	Solid	Plaster	0.06
505	1924 & 1937 Bldg.	122	XRF	7/8/97	1	Stairwell	1	Stairs	Hand rail	Solid	Wood	0.02
506	1924 & 1937 Bldg.	123	XRF	7/8/97	1	Stairwell	1		Radiator	Peeling	Metal	0.62
507	1924 & 1937 Bldg.	124	XRF	7/8/97	1	Stairwell	1	Door	Door	Solid	Wood	0.02
508	1924 & 1937 Bldg.	125	XRF	7/8/97	1	Stairwell	1	Wall	Wall	Solid	Plaster	0.72
509	1924 & 1937 Bldg.	126	XRF	7/8/97	1	Stairwell	2	Ladder		Solid	Metal	0
510	1924 & 1937 Bldg.	127	XRF	7/8/97	1	Stairwell	2	Door	Casing	Solid	Wood	0.28
511	1924 & 1937 Bldg.	128	XRF	7/8/97	1	Stairwell	2	Door	Door	Solid	Wood	0.23
512	1924 & 1937 Bldg.	129	XRF	7/8/97	1	Stairwell	2	Wall	Chair rail	Solid	Wood	0.02
513	1924 & 1937 Bldg.	130	XRF	7/8/97	1	Stairwell	2	Stairs	Hand rail	Solid	Wood	0.18
514	1924 & 1937 Bldg.	131	XRF	7/8/97	1	Stairwell	2	Stairs	Rail cap	Solid	Plaster	0.28
515	1924 & 1937 Bldg.	132	XRF	7/8/97	1	Stairwell	2		Radiator	Peeling	Metal	0.07
516	1924 & 1937 Bldg.	133	XRF	7/8/97	1	Stairwell	2	Stairs	Wall	Solid	Plaster	0.18
517	1924 & 1937 Bldg.	134	XRF	7/8/97	1	Stairwell	2	Door	Door	Solid	Metal	0.01
518	1924 & 1937 Bldg.	135	XRF	7/8/97	1	Stairwell	2	Ceiling		Solid	Plaster	0.16
519	1924 & 1937 Bldg.	136	XRF	7/8/97	1	Stairwell	3		Radiator	Solid	Metal	0.14
520	1924 & 1937 Bldg.	137	XRF	7/8/97	1	Stairwell	3	Door	Casing	Cracked	Wood	0.01
521	1924 & 1937 Bldg.	138	XRF	7/8/97	1	Stairwell	3	Door	Door	Solid	Wood	0.76
522	1924 & 1937 Bldg.	139	XRF	7/8/97	1	Stairwell	3	Wall	Chair rail	Solid	Wood	0.01
523	1924 & 1937 Bldg.	140	XRF	7/8/97	1	Stairwell	3	Ceiling		Solid	Plaster	0
524	1924 & 1937 Bldg.	141	XRF	7/8/97	1	Stairwell	3	Stairs	Hand rail	Solid	Wood	0.02
525	1924 & 1937 Bldg.	142	XRF	7/8/97	1	Stairwell	3	Stairs	Newal post	Solid	Plaster	0.09
526	1924 & 1937 Bldg.	143	XRF	7/8/97	1	Stairwell	3		Radiator	Solid	Metal	0.3
527	1924 & 1937 Bldg.	144	XRF	7/8/97	1	Stairwell	3	Bulletin	Board	Solid	Wood	0.01
528	1924 & 1937 Bldg.	145	XRF	7/8/97	1	Stairwell	3	Wall	Wall	Solid	Plaster	0.14
529	1924 & 1937 Bldg.	146	XRF	7/8/97	1	Stairwell	3	Wall	Wall	Solid	Plaster	0.07
530	1965 Bldg.	195	XRF	7/9/97	1	Classroom	108	Ceiling		Solid	Plaster	0.08
531	1965 Bldg.	193	XRF	7/9/97	1	Classroom	112	Ceiling		Solid	Plaster	0.05
532	1965 Bldg.	194	XRF	7/9/97	1	Classroom	113	Ceiling		Solid	Plaster	0

Saint Paul Public Schools  
 Cleveland Quality Middle School  
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample#	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
533	1965 Bldg.	30	XRF	7/9/97	1	Classroom	174	Wall	Midle Wall	Solid	Concrte	0.03
534	1965 Bldg.	31	XRF	7/9/97	1	Classroom	174	Wall	Wall	Solid	Wood	0.63
535	1965 Bldg.	32	XRF	7/9/97	1	Classroom	174		Radiator	Solid	Metal	0
536	1965 Bldg.	33	XRF	7/9/97	1	Classroom	174	Cabinet	Door	Solid	Wood	0
537	1965 Bldg.	34	XRF	7/9/97	1	Classroom	174	Wall	Midle Wall	Solid	Wood	0
538	1965 Bldg.	35	XRF	7/9/97	1	Classroom	174	Door	Casing	Solid	Metal	0.22
539	1965 Bldg.	23	XRF	7/9/97	1	Classroom	175	Wall	Midle Wall	Solid	Concrte	0.03
540	1965 Bldg.	24	XRF	7/9/97	1	Classroom	175	Wall	Wall	Solid	Concrte	0.09
541	1965 Bldg.	25	XRF	7/9/97	1	Classroom	175	Door	Door	Solid	Wood	0
542	1965 Bldg.	26	XRF	7/9/97	1	Classroom	175	Door	Casing	Solid	Metal	0.24
543	1965 Bldg.	27	XRF	7/9/97	1	Classroom	175	Window	Panel	Solid	Wood	0
544	1965 Bldg.	28	XRF	7/9/97	1	Classroom	175	Cabinet	Door	Solid	Wood	0
545	1965 Bldg.	29	XRF	7/9/97	1	Classroom	175		Radiator	Solid	Metal	0
546	1965 Bldg.	48	XRF	7/9/97	1	Classroom	176	Wall	Midle Wall	Solid	Concrte	0.03
547	1965 Bldg.	49	XRF	7/9/97	1	Classroom	176	Wall	Wall	Solid	Concrte	0.22
548	1965 Bldg.	50	XRF	7/9/97	1	Classroom	176	Bookcase	Shelf	Solid	Wood	0
549	1965 Bldg.	51	XRF	7/9/97	1	Classroom	176	Wall	Midle Wall	Solid	Concrte	0.31
550	1965 Bldg.	52	XRF	7/9/97	1	Classroom	176		Radiator	Solid	Metal	0
551	1965 Bldg.	53	XRF	7/9/97	1	Classroom	176	Cabinet	Door	Solid	Wood	0
552	1965 Bldg.	54	XRF	7/9/97	1	Classroom	176	Wall	Midle Wall	Solid	Wood	0
553	1965 Bldg.	55	XRF	7/9/97	1	Classroom	176	Door	Casing	Solid	Metal	0.28
554	1965 Bldg.	39	XRF	7/9/97	1	Classroom	177		Radiator	Solid	Metal	0
555	1965 Bldg.	40	XRF	7/9/97	1	Classroom	177	Cabinet	Outside	Solid	Wood	0
556	1965 Bldg.	41	XRF	7/9/97	1	Classroom	177	Wall	Midle Wall	Solid	Concrte	0.02
557	1965 Bldg.	42	XRF	7/9/97	1	Classroom	177	Wall	Wall	Solid	Plaster	0.02
558	1965 Bldg.	43	XRF	7/9/97	1	Classroom	177	Wall	Midle Wall	Solid	Wood	0
559	1965 Bldg.	44	XRF	7/9/97	1	Classroom	177	Door	Door	Solid	Wood	0
560	1965 Bldg.	45	XRF	7/9/97	1	Classroom	177	Wall	Midle Wall	Solid	Concrte	0.27
561	1965 Bldg.	46	XRF	7/9/97	1	Classroom	177	Wall	Midle Wall	Solid	Concrte	0.01
562	1965 Bldg.	47	XRF	7/9/97	1	Classroom	177	Door	Casing	Solid	Metal	0.24
563	1965 Bldg.	187	XRF	7/9/97	1	Classroom	204	Ceiling		Solid	Plaster	0.02
564	1965 Bldg.	188	XRF	7/9/97	1	Classroom	205	Ceiling		Solid	Plaster	0.05
565	1965 Bldg.	189	XRF	7/9/97	1	Classroom	208	Ceiling		Solid	Plaster	0.01
566	1965 Bldg.	190	XRF	7/9/97	1	Classroom	209	Ceiling		Peeling	Plaster	0
567	1965 Bldg.	182	XRF	7/9/97	1	Classroom	301	Ceiling		Solid	Plaster	0.02
568	1965 Bldg.	183	XRF	7/9/97	1	Classroom	302	Ceiling		Solid	Plaster	0.04
569	1965 Bldg.	180	XRF	7/9/97	1	Classroom	303	Ceiling		Solid	Plaster	0.03
570	1965 Bldg.	179	XRF	7/9/97	1	Classroom	304	Ceiling		Solid	Plaster	0
571	1965 Bldg.	178	XRF	7/9/97	1	Classroom	307	Ceiling		Solid	Plaster	0
572	1965 Bldg.	177	XRF	7/9/97	1	Classroom	309	Ceiling		Solid	Plaster	0
573	1965 Bldg.	184	XRF	7/9/97	1	Classroom	311	Ceiling		Solid	Plaster	0.72
574	1965 Bldg.	138	XRF	7/9/97	1	Gym	1	Wall	Wall	Solid	Concrte	0
575	1965 Bldg.	139	XRF	7/9/97	1	Gym	1	Wall	Wall	Solid	Concrte	0.02
576	1965 Bldg.	140	XRF	7/9/97	1	Gym	1	Door	Door	Solid	Metal	0.32
577	1965 Bldg.	141	XRF	7/9/97	1	Gym	1	Door	Casing	Solid	Metal	0.24
578	1965 Bldg.	142	XRF	7/9/97	1	Gym	1	Wall	Midle Wall	Solid	Concrte	0
579	1965 Bldg.	143	XRF	7/9/97	1	Gym	1	Door	Door	Solid	Wood	0
580	1965 Bldg.	144	XRF	7/9/97	1	Gym	1	Floor		Solid	Wood	0.03
581	1965 Bldg.	145	XRF	7/9/97	1	Gym	1	Floor		Solid	Wood	2.38
582	1965 Bldg.	109	XRF	7/9/97	1	Gym	2	Ceiling		Solid	Concrte	0
583	1965 Bldg.	110	XRF	7/9/97	1	Gym	2		Locker	Solid	Metal	0
584	1965 Bldg.	111	XRF	7/9/97	1	Gym	2	Wall	Wall	Solid	Plaster	0.04
585	1965 Bldg.	112	XRF	7/9/97	1	Gym	2	Door	Door	Solid	Wood	0
586	1965 Bldg.	113	XRF	7/9/97	1	Gym	2	Door	Door	Solid	Metal	0.22
587	1965 Bldg.	114	XRF	7/9/97	1	Gym	2	Door	Bthrm Stll	Solid	Metal	0
588	1965 Bldg.	115	XRF	7/9/97	1	Gym	2	Paper Towel Dispencer	Solid	Metal	0	
589	1965 Bldg.	116	XRF	7/9/97	1	Gym	2	Bench		Solid	Wood	0
590	1965 Bldg.	117	XRF	7/9/97	1	Gym	2	Bench		Solid	Wood	0.61
591	1965 Bldg.	123	XRF	7/9/97	1	Gym	3	Ceiling		Solid	Concrte	0

Saint Paul Public Schools  
 Cleveland Quality Middle School  
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample#	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
592	1965 Bldg.	124	XRF	7/9/97	1	Gym	3	Wall	Midle Wall	Solid	Concrete	0.02
593	1965 Bldg.	125	XRF	7/9/97	1	Gym	3	Door	Casing	Solid	Metal	0.15
594	1965 Bldg.	126	XRF	7/9/97	1	Gym	3	Door	Door	Solid	Wood	0
595	1965 Bldg.	127	XRF	7/9/97	1	Gym	3	Wall	Wall	Solid	Concrete	0
596	1965 Bldg.	128	XRF	7/9/97	1	Gym	3	Wall	Bthrm Stll	Solid	Metal	0
597	1965 Bldg.	129	XRF	7/9/97	1	Gym	3		Locker	Solid	Metal	0.01
598	1965 Bldg.	130	XRF	7/9/97	1	Gym	3	Door	Door	Solid	Metal	0.2
599	1965 Bldg.	131	XRF	7/9/97	1	Gym	3	Wall	Wall	Solid	Plaster	0.04
600	1965 Bldg.	132	XRF	7/9/97	1	Gym	3	Bench		Solid	non-wood	0
601	1965 Bldg.	133	XRF	7/9/97	1	Gym	3	Bench		Solid	non-wood	0.67
602	1965 Bldg.	192	XRF	7/9/97	1	Hall	1	Ceiling		Solid	Plaster	0
603	1965 Bldg.	191	XRF	7/9/97	1	Hall	2	Ceiling		Solid	Plaster	0
604	1965 Bldg.	146	XRF	7/9/97	1	Hall	4		Locker	Solid	Metal	0
605	1965 Bldg.	147	XRF	7/9/97	1	Hall	4	Wall	Wall	Solid	Plaster	0.02
606	1965 Bldg.	148	XRF	7/9/97	1	Hall	4	Wall	Midle Wall	Solid	Concrete	0
607	1965 Bldg.	149	XRF	7/9/97	1	Hall	4	Door	Door	Solid	Metal	0.35
608	1965 Bldg.	150	XRF	7/9/97	1	Hall	4		Radiator	Solid	Metal	0
609	1965 Bldg.	151	XRF	7/9/97	1	Hall	4	Wall	Midle Wall	Solid	Concrete	0.02
610	1965 Bldg.	152	XRF	7/9/97	1	Hall	4	Door	Door	Solid	Wood	0
611	1965 Bldg.	153	XRF	7/9/97	1	Hall	4	Wall	Midle Wall	Solid	Concrete	0
612	1965 Bldg.	75	XRF	7/9/97	1	Hall	5	Wall	Wall	Solid	Plaster	0.02
613	1965 Bldg.	76	XRF	7/9/97	1	Hall	5		Radiator	Solid	Metal	0
614	1965 Bldg.	77	XRF	7/9/97	1	Hall	5	Cabinet	Outside	Solid	Wood	0
615	1965 Bldg.	78	XRF	7/9/97	1	Hall	5	Wall	Midle Wall	Solid	Wood	0
616	1965 Bldg.	79	XRF	7/9/97	1	Hall	5		Locker	Solid	Metal	0
617	1965 Bldg.	80	XRF	7/9/97	1	Hall	5	Wall	Mural	Solid	Concrete	0.01
618	1965 Bldg.	81	XRF	7/9/97	1	Hall	5	Wall	Mural	Solid	Concrete	0.02
619	1965 Bldg.	82	XRF	7/9/97	1	Hall	5	Wall	Midle Wall	Solid	Concrete	0.01
620	1965 Bldg.	83	XRF	7/9/97	1	Hall	5	Door	Door	Solid	Wood	0
621	1965 Bldg.	84	XRF	7/9/97	1	Hall	5	Wall	Midle Wall	Solid	Concrete	0
622	1965 Bldg.	85	XRF	7/9/97	1	Hall	5	Wall	Midle Wall	Solid	Concrete	0.02
623	1965 Bldg.	86	XRF	7/9/97	1	Hall	5	Wall	Midle Wall	Solid	Concrete	0.01
624	1965 Bldg.	160	XRF	7/9/97	1	Other	0	Wall	Wall	Peeling	Plaster	0.18
625	1965 Bldg.	161	XRF	7/9/97	1	Other	0	Floor		Solid	Concrete	0.01
626	1965 Bldg.	162	XRF	7/9/97	1	Other	0	Stairs	Hand rail	Solid	Metal	0.04
627	1965 Bldg.	163	XRF	7/9/97	1	Other	0	Door	Door	Peeling	Metal	0.35
628	1965 Bldg.	164	XRF	7/9/97	1	Other	0	Door	Casing	Peeling	Metal	1.06
629	1965 Bldg.	165	XRF	7/9/97	1	Other	0	Door	Bthrm Stll	Solid	Metal	0.13
630	1965 Bldg.	166	XRF	7/9/97	1	Other	0	Wall	Wall	Peeling	Concrete	0.06
631	1965 Bldg.	173	XRF	7/9/97	1	Other	0	Door	Casing	Solid	Metal	0.69
632	1965 Bldg.	174	XRF	7/9/97	1	Other	0	Door	Door	Solid	Metal	0.07
633	1965 Bldg.	175	XRF	7/9/97	1	Other	0	Wall	Wall	Solid	Concrete	0.02
634	1965 Bldg.	176	XRF	7/9/97	1	Other	0	Wall	Wall	Solid	Concrete	0
635	1965 Bldg.	167	XRF	7/9/97	1	Other	2	Wall	Midle Wall	Solid	Concrete	0.1
636	1965 Bldg.	168	XRF	7/9/97	1	Other	2	Door	Casing	Solid	Metal	0.42
637	1965 Bldg.	169	XRF	7/9/97	1	Other	2	Door	Door	Solid	Wood	0.06
638	1965 Bldg.	170	XRF	7/9/97	1	Other	2	Pipe		Peeling	Metal	0.51
639	1965 Bldg.	171	XRF	7/9/97	1	Other	2	Chute		Solid	Metal	0.36
640	1965 Bldg.	172	XRF	7/9/97	1	Other	2	Stairs	Hand rail	Solid	Metal	0.13
641	1965 Bldg.	185	XRF	7/9/97	1	Restroom	202	Ceiling		Solid	Plaster	0.05
642	1965 Bldg.	181	XRF	7/9/97	1	Restroom	302	Ceiling		Solid	Plaster	0.17
643	1965 Bldg.	118	XRF	7/9/97	1	Restroom	1001	Wall	Wall	Solid	Concrete	0
644	1965 Bldg.	119	XRF	7/9/97	1	Restroom	1001	Door	Door	Solid	Wood	0
645	1965 Bldg.	120	XRF	7/9/97	1	Restroom	1001	Door	Casing	Solid	Metal	0.29
646	1965 Bldg.	121	XRF	7/9/97	1	Restroom	1001	Door	Bthrm Stll	Solid	Metal	0
647	1965 Bldg.	122	XRF	7/9/97	1	Restroom	1001	Door	Door	Solid	Metal	0.17
648	1965 Bldg.	134	XRF	7/9/97	1	Restroom	1002	Door	Door	Solid	Wood	0
649	1965 Bldg.	135	XRF	7/9/97	1	Restroom	1002	Door	Casing	Solid	Metal	0.14
650	1965 Bldg.	136	XRF	7/9/97	1	Restroom	1002	Wall	Midle Wall	Solid	Concrete	0

Saint Paul Public Schools  
 Cleveland Quality Middle School  
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample#	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
651	1965 Bldg.	137	XRF	7/9/97	1	Restroom	1002	Door	Door	Solid	Metal	0.19
652	1965 Bldg.	63	XRF	7/9/97	1	Restroom	2001	Wall	Stall Door	Solid	Metal	0.05
653	1965 Bldg.	64	XRF	7/9/97	1	Restroom	2001	Wall	Stall Door	Solid	Metal	0.16
654	1965 Bldg.	65	XRF	7/9/97	1	Restroom	2001	Door	Casing	Solid	Metal	0.14
655	1965 Bldg.	66	XRF	7/9/97	1	Restroom	2001	Door	Door	Solid	Wood	0
656	1965 Bldg.	67	XRF	7/9/97	1	Restroom	2002	Door	Casing	Solid	Metal	0.18
657	1965 Bldg.	68	XRF	7/9/97	1	Restroom	2002	Door	Door	Solid	Wood	0
658	1965 Bldg.	69	XRF	7/9/97	1	Restroom	2002	Door	Bthrm Stll	Solid	Metal	0
659	1965 Bldg.	94	XRF	7/9/97	1	Room	10	Wall	Midle Wall	Solid	Concrete	0
660	1965 Bldg.	95	XRF	7/9/97	1	Room	10	Wall	Midle Wall	Solid	Concrete	0.01
661	1965 Bldg.	96	XRF	7/9/97	1	Room	10	Wall	Midle Wall	Solid	Concrete	0
662	1965 Bldg.	97	XRF	7/9/97	1	Room	10	Wall	Midle Wall	Solid	Metal	0.27
663	1965 Bldg.	98	XRF	7/9/97	1	Room	10	Door	Casing	Solid	Metal	0.21
664	1965 Bldg.	99	XRF	7/9/97	1	Room	10	Door	Door	Solid	Metal	0.26
665	1965 Bldg.	100	XRF	7/9/97	1	Room	10		Locker	Solid	Metal	0.05
666	1965 Bldg.	101	XRF	7/9/97	1	Room	10	Stairs	Newal post	Solid	Metal	0.08
667	1965 Bldg.	102	XRF	7/9/97	1	Room	10	Door	Door	Solid	Wood	0
668	1965 Bldg.	103	XRF	7/9/97	1	Room	11	Wall	Wall	Solid	Concrete	0
669	1965 Bldg.	104	XRF	7/9/97	1	Room	11	Door	Door	Solid	Metal	0.28
670	1965 Bldg.	105	XRF	7/9/97	1	Room	11	Door	Casing	Solid	Metal	0.27
671	1965 Bldg.	106	XRF	7/9/97	1	Room	11	Wall	Midle Wall	Solid	Metal	0.29
672	1965 Bldg.	107	XRF	7/9/97	1	Room	11	Door	Door	Solid	Wood	0.04
673	1965 Bldg.	108	XRF	7/9/97	1	Room	11	Stairs	Hand rail	Solid	Metal	0
674	1965 Bldg.	70	XRF	7/9/97	1	Room	170	Wall	Midle Wall	Solid	Concrete	0
675	1965 Bldg.	71	XRF	7/9/97	1	Room	170	Door	Door	Solid	Wood	0
676	1965 Bldg.	72	XRF	7/9/97	1	Room	170	Door	Casing	Solid	Metal	0.26
677	1965 Bldg.	73	XRF	7/9/97	1	Room	170	Wall	Wall	Solid	Concrete	0
678	1965 Bldg.	74	XRF	7/9/97	1	Room	170	Door	Door	Solid	Wood	0
679	1965 Bldg.	56	XRF	7/9/97	1	Room	173	Wall	Midle Wall	Solid	Concrete	0
680	1965 Bldg.	57	XRF	7/9/97	1	Room	173	Wall	Midle Wall	Solid	Concrete	0
681	1965 Bldg.	58	XRF	7/9/97	1	Room	173	Door	Door	Solid	Wood	0
682	1965 Bldg.	59	XRF	7/9/97	1	Room	173	Door	Casing	Solid	Metal	0.47
683	1965 Bldg.	60	XRF	7/9/97	1	Room	173	Door	Door	Solid	Wood	0
684	1965 Bldg.	61	XRF	7/9/97	1	Room	173	Wall	Mural	Solid	Concrete	0
685	1965 Bldg.	62	XRF	7/9/97	1	Room	173	Wall	Mural	Solid	Concrete	0
686	1965 Bldg.	186	XRF	7/9/97	1	Room	211	Ceiling		Solid	Plaster	0
687	1965 Bldg.	87	XRF	7/9/97	1	Stairwell	4	Door	Door	Solid	Metal	0.64
688	1965 Bldg.	88	XRF	7/9/97	1	Stairwell	4	Door	Casing	Solid	Metal	0.29
689	1965 Bldg.	89	XRF	7/9/97	1	Stairwell	4	Wall	Mural	Solid	Concrete	0
690	1965 Bldg.	90	XRF	7/9/97	1	Stairwell	4	Wall	Mural	Solid	Metal	0.07
691	1965 Bldg.	91	XRF	7/9/97	1	Stairwell	4	Wall	Midle Wall	Solid	Concrete	0
692	1965 Bldg.	92	XRF	7/9/97	1	Stairwell	4	Stairs	Hand rail	Solid	Wood	0
693	1965 Bldg.	93	XRF	7/9/97	1	Stairwell	4		Elec Panel	Solid	Metal	0
694	1965 Bldg.	154	XRF	7/9/97	1	Stairwell	5	Wall	Midle Wall	Solid	Concrete	0
695	1965 Bldg.	155	XRF	7/9/97	1	Stairwell	5		Elec Panel	Solid	Metal	0
696	1965 Bldg.	156	XRF	7/9/97	1	Stairwell	5	Wall	Mural	Solid	Concrete	0
697	1965 Bldg.	157	XRF	7/9/97	1	Stairwell	5	Wall	Midle Wall	Solid	Concrete	0
698	1965 Bldg.	158	XRF	7/9/97	1	Stairwell	5	Door	Casing	Solid	Metal	0.24
699	1965 Bldg.	159	XRF	7/9/97	1	Stairwell	5	Door	Door	Solid	Metal	0.76

**APPENDIX B**

**LABORATORY SAMPLE ANALYSIS DATA**

**LABORATORY ANALYSIS REPORT****DATE:** August 8, 1997**PAGE:** 1 Of 1**CLIENT:** Midwest Environmental Cons.  
5385 401st Ave. NW  
Duluth, MN 55017**PROJECT NO.:** 072397-200888  
**COLLECTION DATE:** 7/15/97  
**COLLECTED BY:** Client  
**RECEIVED DATE:** 7/23/97  
**PROJECT DESCRIPT.:** 62/0197AN**CONTACT:** Richard Cox

<u>SAMPLE #</u>	<u>DESCP.</u>	<u>MDL</u>	<i>LEAD</i> (6010A)	<u>ANALYSIS</u>
			<u>RESULTS</u>	
L974830-1	PC-1	21	ND	8/08/97
L974830-2	PC-2	20	75	8/08/97
L974830-3	PC-3	16	4200	8/08/97
L974830-4	PC-4	35	71	8/08/97
L974830-5	PC-5	25	12,000	8/08/97

*ND means Not Detected or below reported MDL**MDL means Method Detection Limit**mg/kg means Milligrams Per Kilogram which is equivalent to Parts Per Million (ppm)*

This report has been reviewed by me for technical accuracy and completeness. The analyses were performed using EPA or other approved methodologies and the results were reported on an "as received" basis unless otherwise noted. Organic soil analyses were reported on a dry weight basis. The results reported relate only to the items tested. Please contact me if you have any questions or comments regarding this report. Spectrum Labs, Inc. appreciates the opportunity to provide this analytical service for you.

Report Submitted By,

Thomas L. Halverson  
Laboratory ManagerTLH:wmc  
mec220-2*As a mutual protection, all reports are submitted in confidentiality and may not be reproduced except in full without written authorization.*

A member of The Marmon Group of Companies



**Midwest Environmental Consulting, L.L.C.**  
53385 401st Ave. NW, Dalbo, MN 55017  
612-689-3612/612-757-5541/FAX-612-689-5209

**CHAIN OF CUSTODY RECORD**

3303 40 St Ave. NW, Duluth, MN 55017  
612-689-3612/612-757-5541/FAX-612-689-5200

Client Address : 123 Main Street, Anytown, USA 00000

Author Address

Contact

Project

Project Number 62-0192 An  
Client - St. Paul Public

Schrift: / 153/11  
Project

Project \_\_\_\_\_

Project

Project Number 62-0192 An  
Client St. Paul's

Draught

Frigg's secret

Project

Sampled By: John Doe Date: 9/27/15 Time: \_\_\_\_\_ Delivered By: John Doe Date: 9/27/15 Time: 11:44 hrs

Received By: \_\_\_\_\_ Date: \_\_\_\_\_ Time: \_\_\_\_\_ Received By: \_\_\_\_\_ Date: \_\_\_\_\_ Time: \_\_\_\_\_

Received by Lab: 11/13 Date: 11/13 Time: 14 Disposition of Samples \_\_\_\_\_

## **APPENDIX C INSPECTORS**

**Bob Hargrove  
MDH Lead Inspector # 416**