


Midwest
Environmental
Consulting, L.L.C.

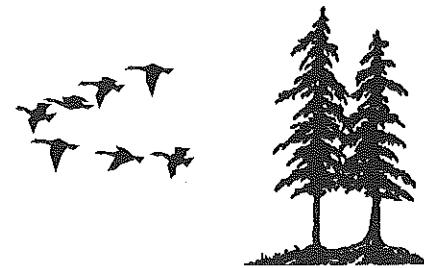

Printed on Recycled Paper

**Groveland Park Elementary
Saint Paul Public Schools**

Lead-Based Paint Inspection

Inspection Dates: 4/2/97, 4/3/97, 4/9/97, 4/11/97, 4/12/97

submitted to:

Saint Paul Public Schools

MEC Project # 62/0197U

INTRODUCTION

At the request of Saint Paul Public Schools Environmental Safety Department, Midwest Environmental Consulting, L.L.C. (MEC), conducted a lead-based paint inspection at Groveland Park Elementary, 2045 St. Clair St., St. Paul, MN. The purpose of this inspection was to identify lead-based painted, varnished, or otherwise coated building components on the interior and exterior of the school building.

The inspection protocol incorporated applicable portions of the U.S. Department of Housing and Urban Development (HUD) *Guidelines for the Evaluation and Control of Lead-based Paint Hazards in Housing* (HUD Guidelines, June 1995) and OSHA 1926.62 requirements (Lead in Construction). The HUD guidelines are formulated to guide agencies in conducting random sampling of the interiors and exteriors of dwellings and common areas in public housing. The OSHA requirement is designed to minimize worker exposure when working with material containing lead.

Confirmatory testing was conducted when inconclusive XRF results were encountered. Inconclusive refers to XRF readings less than 0.2 mg/cm² (milligrams per square centimeter). Inconclusive results were confirmed with laboratory analysis of paint chip samples (Appendix B). This report contains a list of such results.

The United States Environmental Protection Agency defines "lead-based paint" as a paint or other surface coating that contains lead equal to or in excess of 1.0 milligrams per square centimeter when analyzed by XRF or more than 0.5% by weight (5000 parts per million) by laboratory analysis of a bulk sample.

Minnesota Department of Labor and Industry (MN OSHA) adopted the EPA lead levels for the purpose of enforcing OSHA 1926.62 federal regulations. Detection of lead in dried paint film by XRF is a dependable indicator of levels of lead and is accepted by MN OSHA.

For this Saint Paul Public Schools Lead Inspection, all building components were tested on site using a Niton XL® X-ray Fluorescence Spectrum Analyzer⁽¹⁾. Building components included walls, ceilings, floors, moldings, window and door components, door surfaces, and miscellaneous features such as shelves or bookcases. Only painted or glazed surfaces or surfaces which were varnished were tested. Suspended ceilings, structural steel, and corrugated decking were not included in the inspection. Neither anodized (e.g., window sashes) nor plastic (e.g., vinyl baseboard and vinyl mini-blinds) were included in the scope of this inspection.

⁽¹⁾ This is a portable hand held machine that can analyze building components instantly for lead concentrations.

Each building was divided into unique sites based on the year of construction or renovation. Portable classrooms, playgrounds, and other detached buildings were automatically designated as a unique site. Each site was inspected independently assuming differences in painting history and construction characteristics.

SITE DESCRIPTION AND BUILDING HISTORY

According to information provided to MEC by Saint Paul Public Schools, Groveland Park Elementary was constructed in essentially four phases. The initial phase includes the 25,010 square-foot older section of the building and dates from 1921. A second phase of 13,353 square feet dates from 1924. A 9,071 square foot addition was added in 1931 and is considered to be the third phase. The fourth phase is a 5,545 square foot addition built in 1978. There are also two portable classrooms located on the east side of the building.

All room and area designations used in this report are depicted on sampling maps found in Appendix A.

XRF SAMPLE RESULTS TABLE

The results of all samples analyzed are listed in the table at the end of this section. The following is a description of the column headings:

Site	Each school is divided into sites based on their unique construction characteristics. Each site has a unique date of construction or major renovation.
Sample #	Each sample taken was given a unique number to identify the type and location of the sample. The sampling date is an integral part of the sample number.
Analysis	This defines the type of analysis which can be categorized into two types: 1) XRF: This is an on-site analysis using a hand held Niton XL® X-ray Fluorescence Spectrum Analyzer; 2) Bulk or Chip: This is a bulk sample where paint is removed from the substrate and sent to a laboratory for analysis;
Floor	This is the level of the building in which the area tested was found, example, 1 (first floor), 0 (basement), etc.

Area	This further defines the specific functional space inspected such as a classroom, exterior, playground, gym, kitchen, etc.
Room #	This is typically the actual number on the room as identified at the building.
Component	Building "components" included walls, ceilings, floors, moldings, window and door components, door surfaces, and miscellaneous features such as shelves or bookcases.
Feature	Identifies more detailed information of the component.
Condition	This describes condition of the surface, whether it is intact, cracked, peeling, or chalking.
Substrate	This refers to the material the building component is made of (wood, concrete, drywall, metal, etc.).
Result	This is the analysis results for lead. Less than 1.0 mg/cm ² or less than 0.5% by weight is considered to be non-lead and these building components are below the action levels of EPA and HUD. (All results are in mg/cm ² except where noted.)

The table of results is designed for quick information on lead concentrations of tested building components. Generally, all repetitions of a test combination within a given room or area, may be assumed to contain similar concentrations of lead to that of the tested sample. For instance, the lead concentration of a tested wooden window sash was found to be above the action level of 1.0 mg/cm² in a given classroom. The classroom has five windows, all of wood, the same color and appearing to be of the same era. It can be assumed that the remaining four wooden window sashes each contain lead above the action limit.

Other columns identify the component and the component feature tested, condition of the component, type of substrate and the result of the analytical test.

As an example, the following illustration shows that the wooden door jamb in Room 123, first floor in the 1923 building section was in good, solid condition, and had an XRF test result of 0.3 mg/cm², which is below the action level.

Illustration Only

Site	Sample #	Date	Analysis	Floor	Area	Room #	Component	Feature	Condition	Substrate	Results
1923 Bldg.	52		XRF	1	Room	123	Door	Jamb	Solid	Wood	0.3

In a similar manner, the table shows that the plaster walls in room 23, on the second floor has peeling paint with more than 1.0 mg/cm² (shaded).

ILLUSTRATION ONLY

Site	Sample #	Date	Analysis	Floor	Area	Room #	Component	Feature	Condition	Substrate	Results
1910 Bldg.	16		XRF	2	Room	23	Door	Jamb	Peeling	Wood	0.25
1910 Bldg.	17		XRF	2	Room	23	Wall	Wall	Peeling	Plaster	1.2
1910 Bldg.	18		XRF	2	Room	23	Ceiling	Peeling	Plaster		0.25
1910 Bldg.	19		XRF	2	Room	23	Wall	Baseboard	Peeling	Wood	0.002

APPLICABLE REGULATIONS


When building components test above 1.0 mg/cm² of lead by XRF or 0.5% lead by weight from laboratory analysis all employees and contractors who will be working with these components in a construction related activity must be notified. The requirements of OSHA 1926.62, Lead in Construction are enforceable. This regulation defines construction work as "work for construction, alteration and/or repair, including painting and decorating." This regulation further defines monitoring requirements to minimize employee exposure to lead during construction activities.


When work is performed on external painted building structures (i.e. flashing, fire escapes, playground equipment, handrails, etc.), regulations of the Minnesota Pollution Control Agency (MPCA) may also be applicable. For removal of lead based paint from steel structures, MN Rules 7025.0200 - 7025.0380 apply to steel materials on the exterior of a building, or on the property when levels exceed 0.5 mg/cm² based on the average of three XRF spectrum results of the sample tested, or 5,000 ppm by laboratory analysis. If it is other than a steel surface, then MPCA regulates the painted surfaces under MN Rules 7025.010 - 7025.0080, when surfaces are to be disturbed using abrasive blasting methods.


Please contact MEC directly if you have questions about any portion of this report or the lead-based paint inspection itself.



APPENDIX A


XRF TESTING DATA WITH LOCATION MAPS

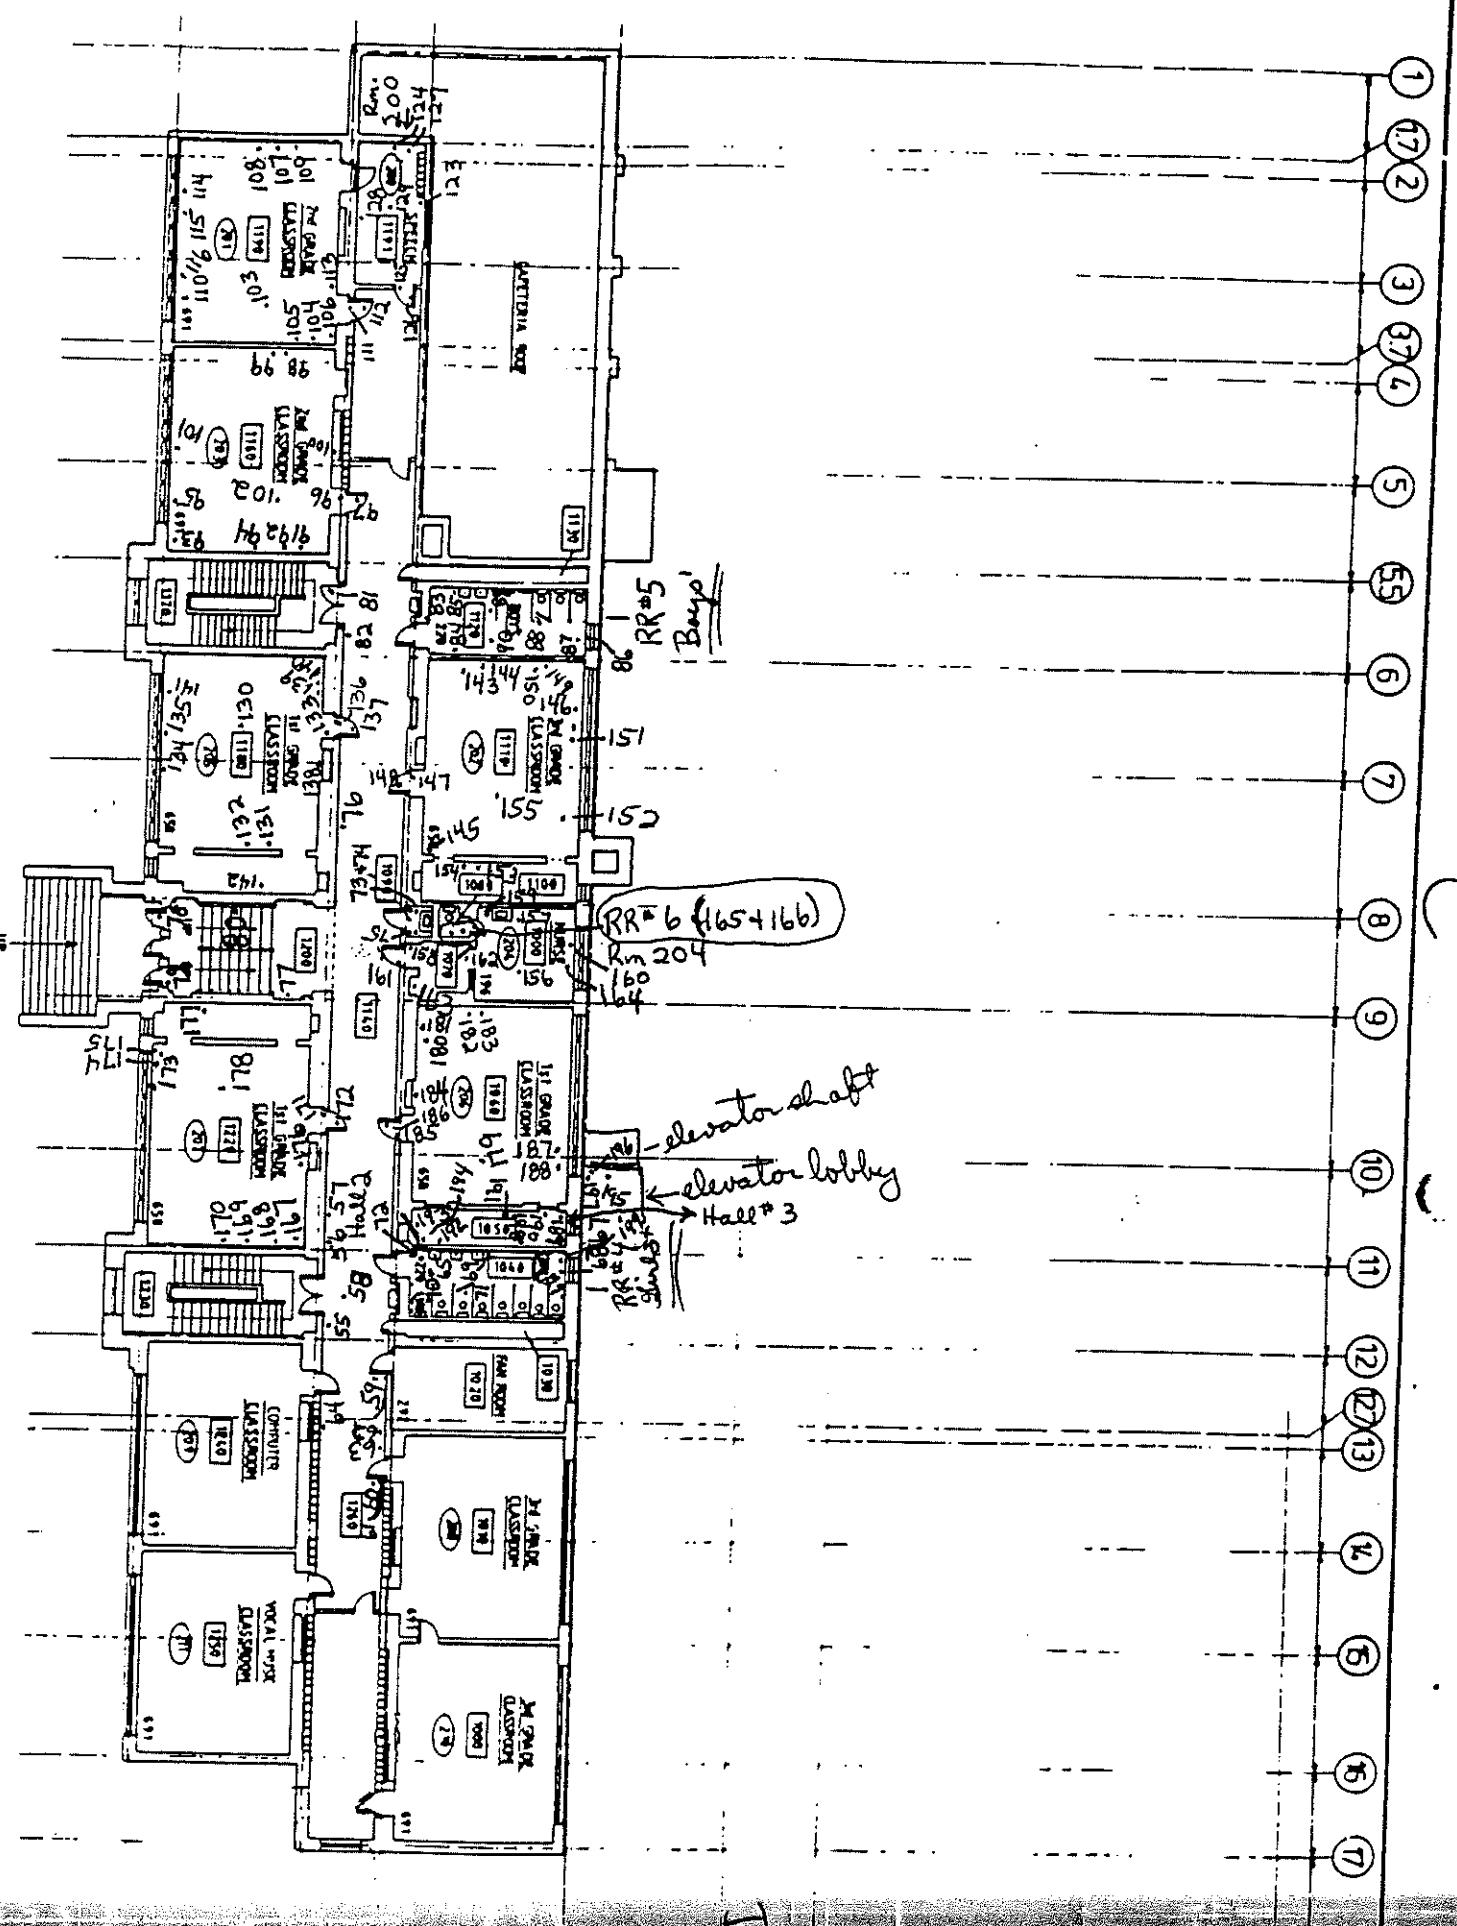


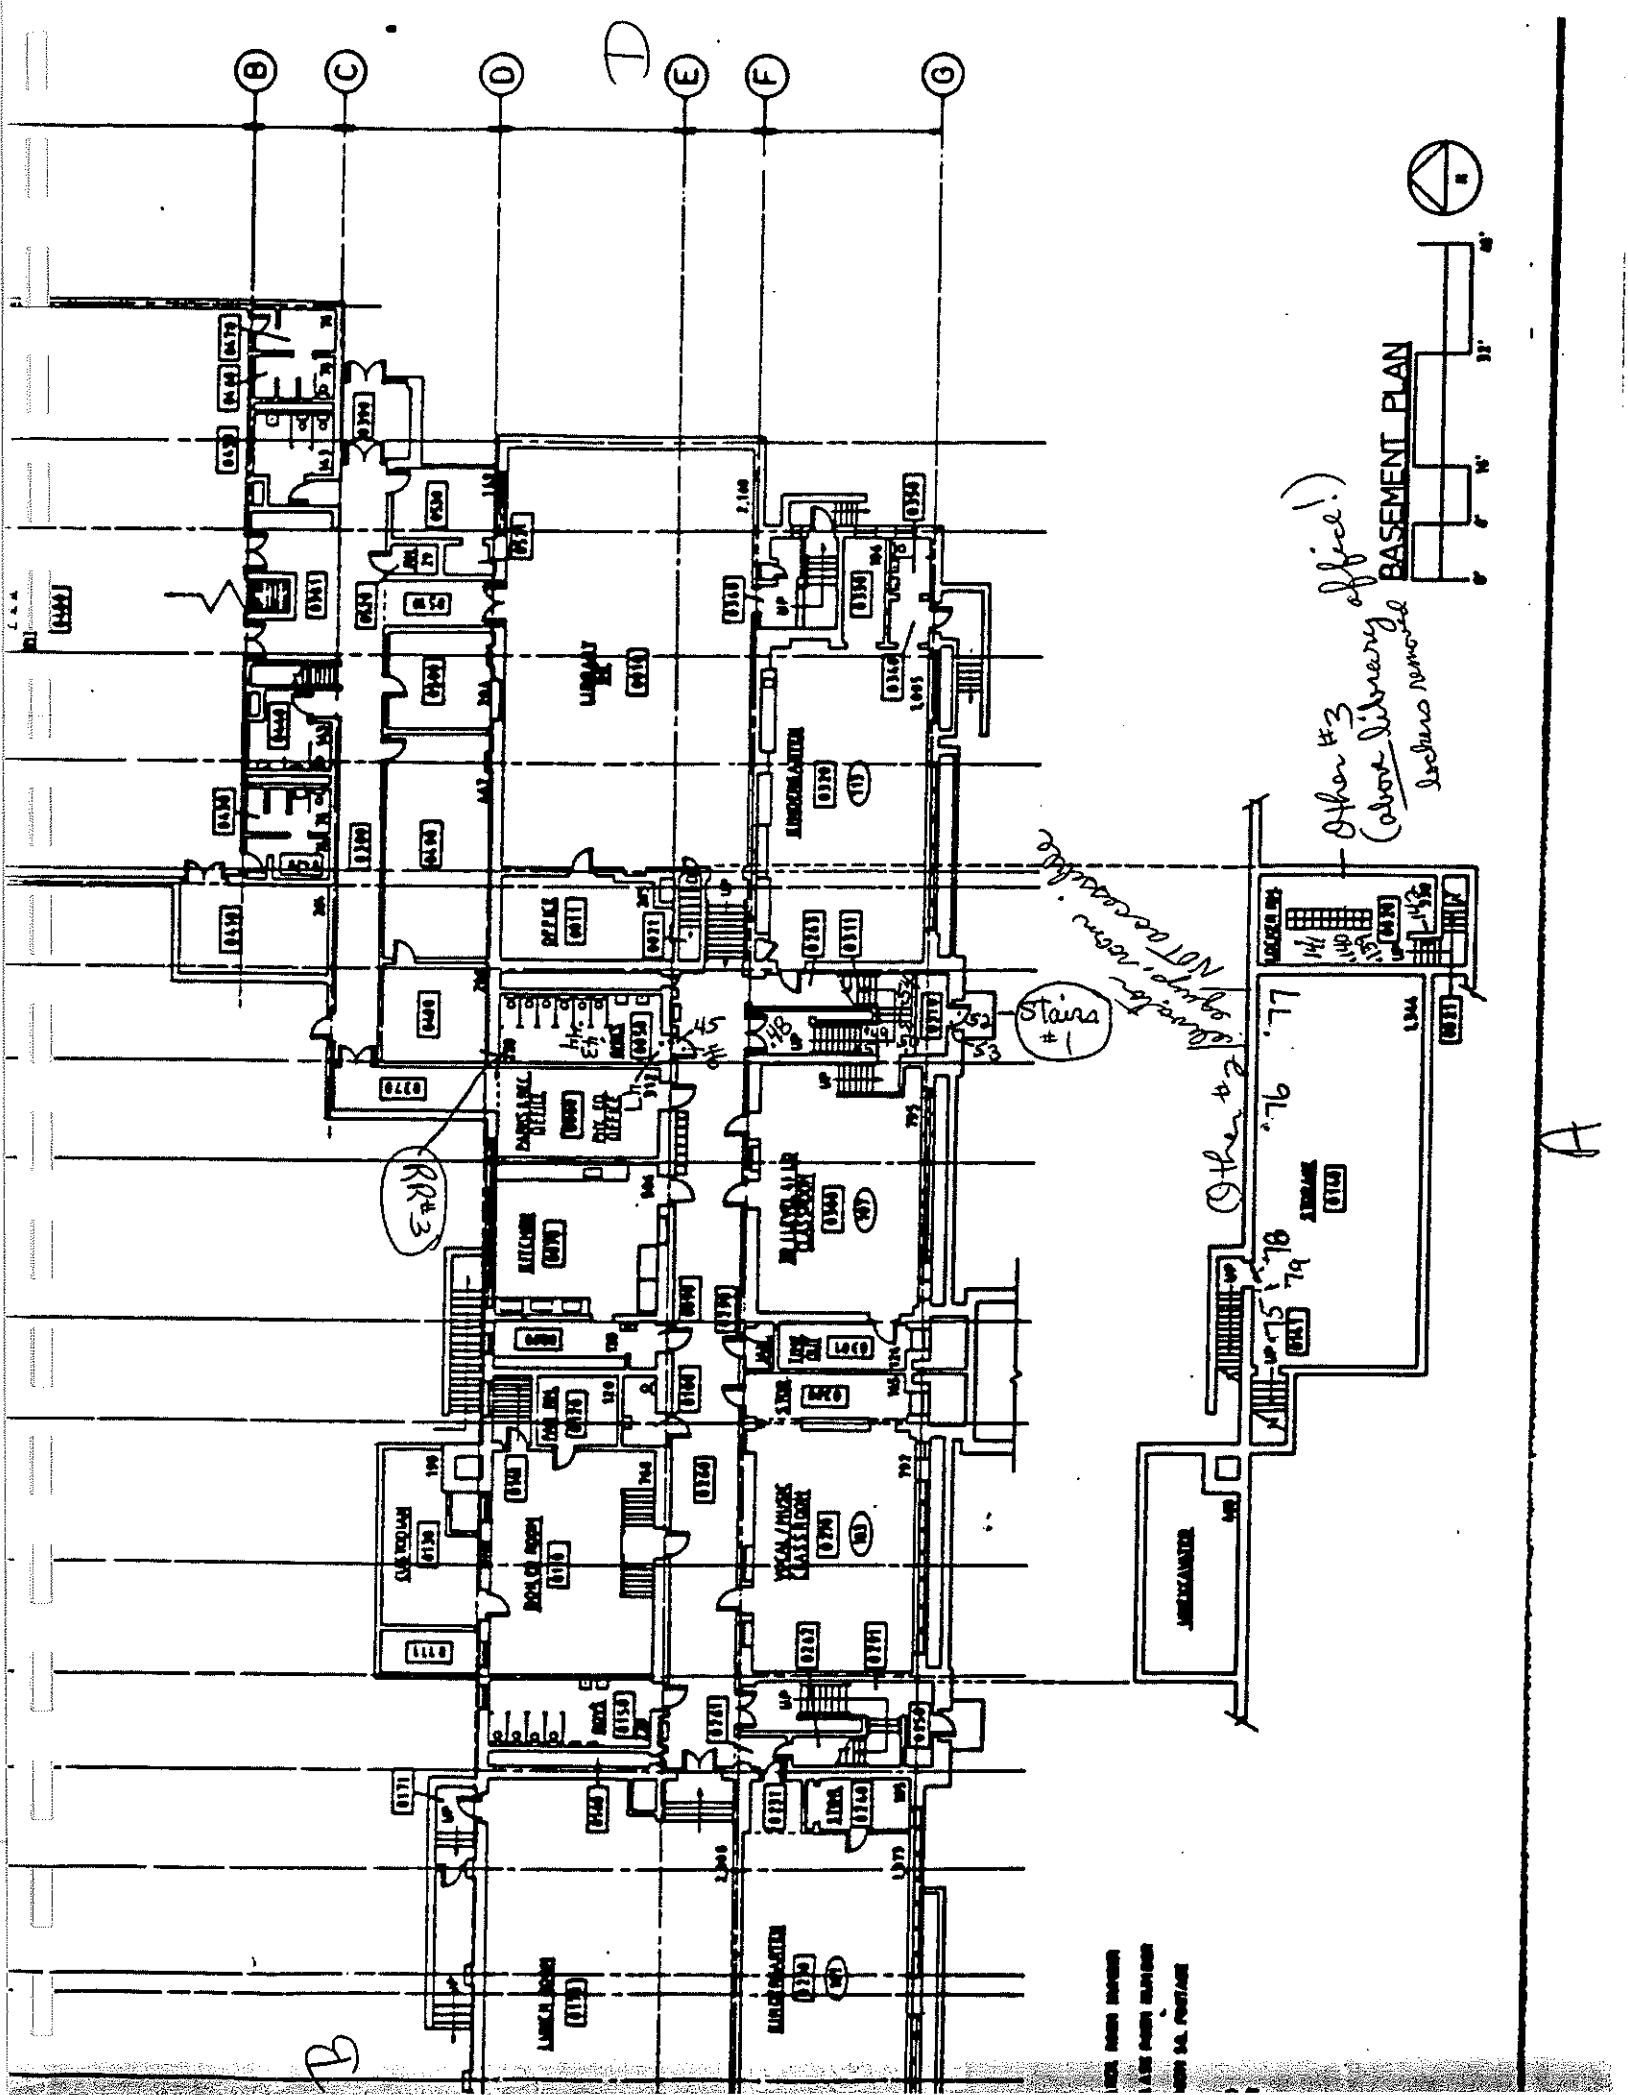

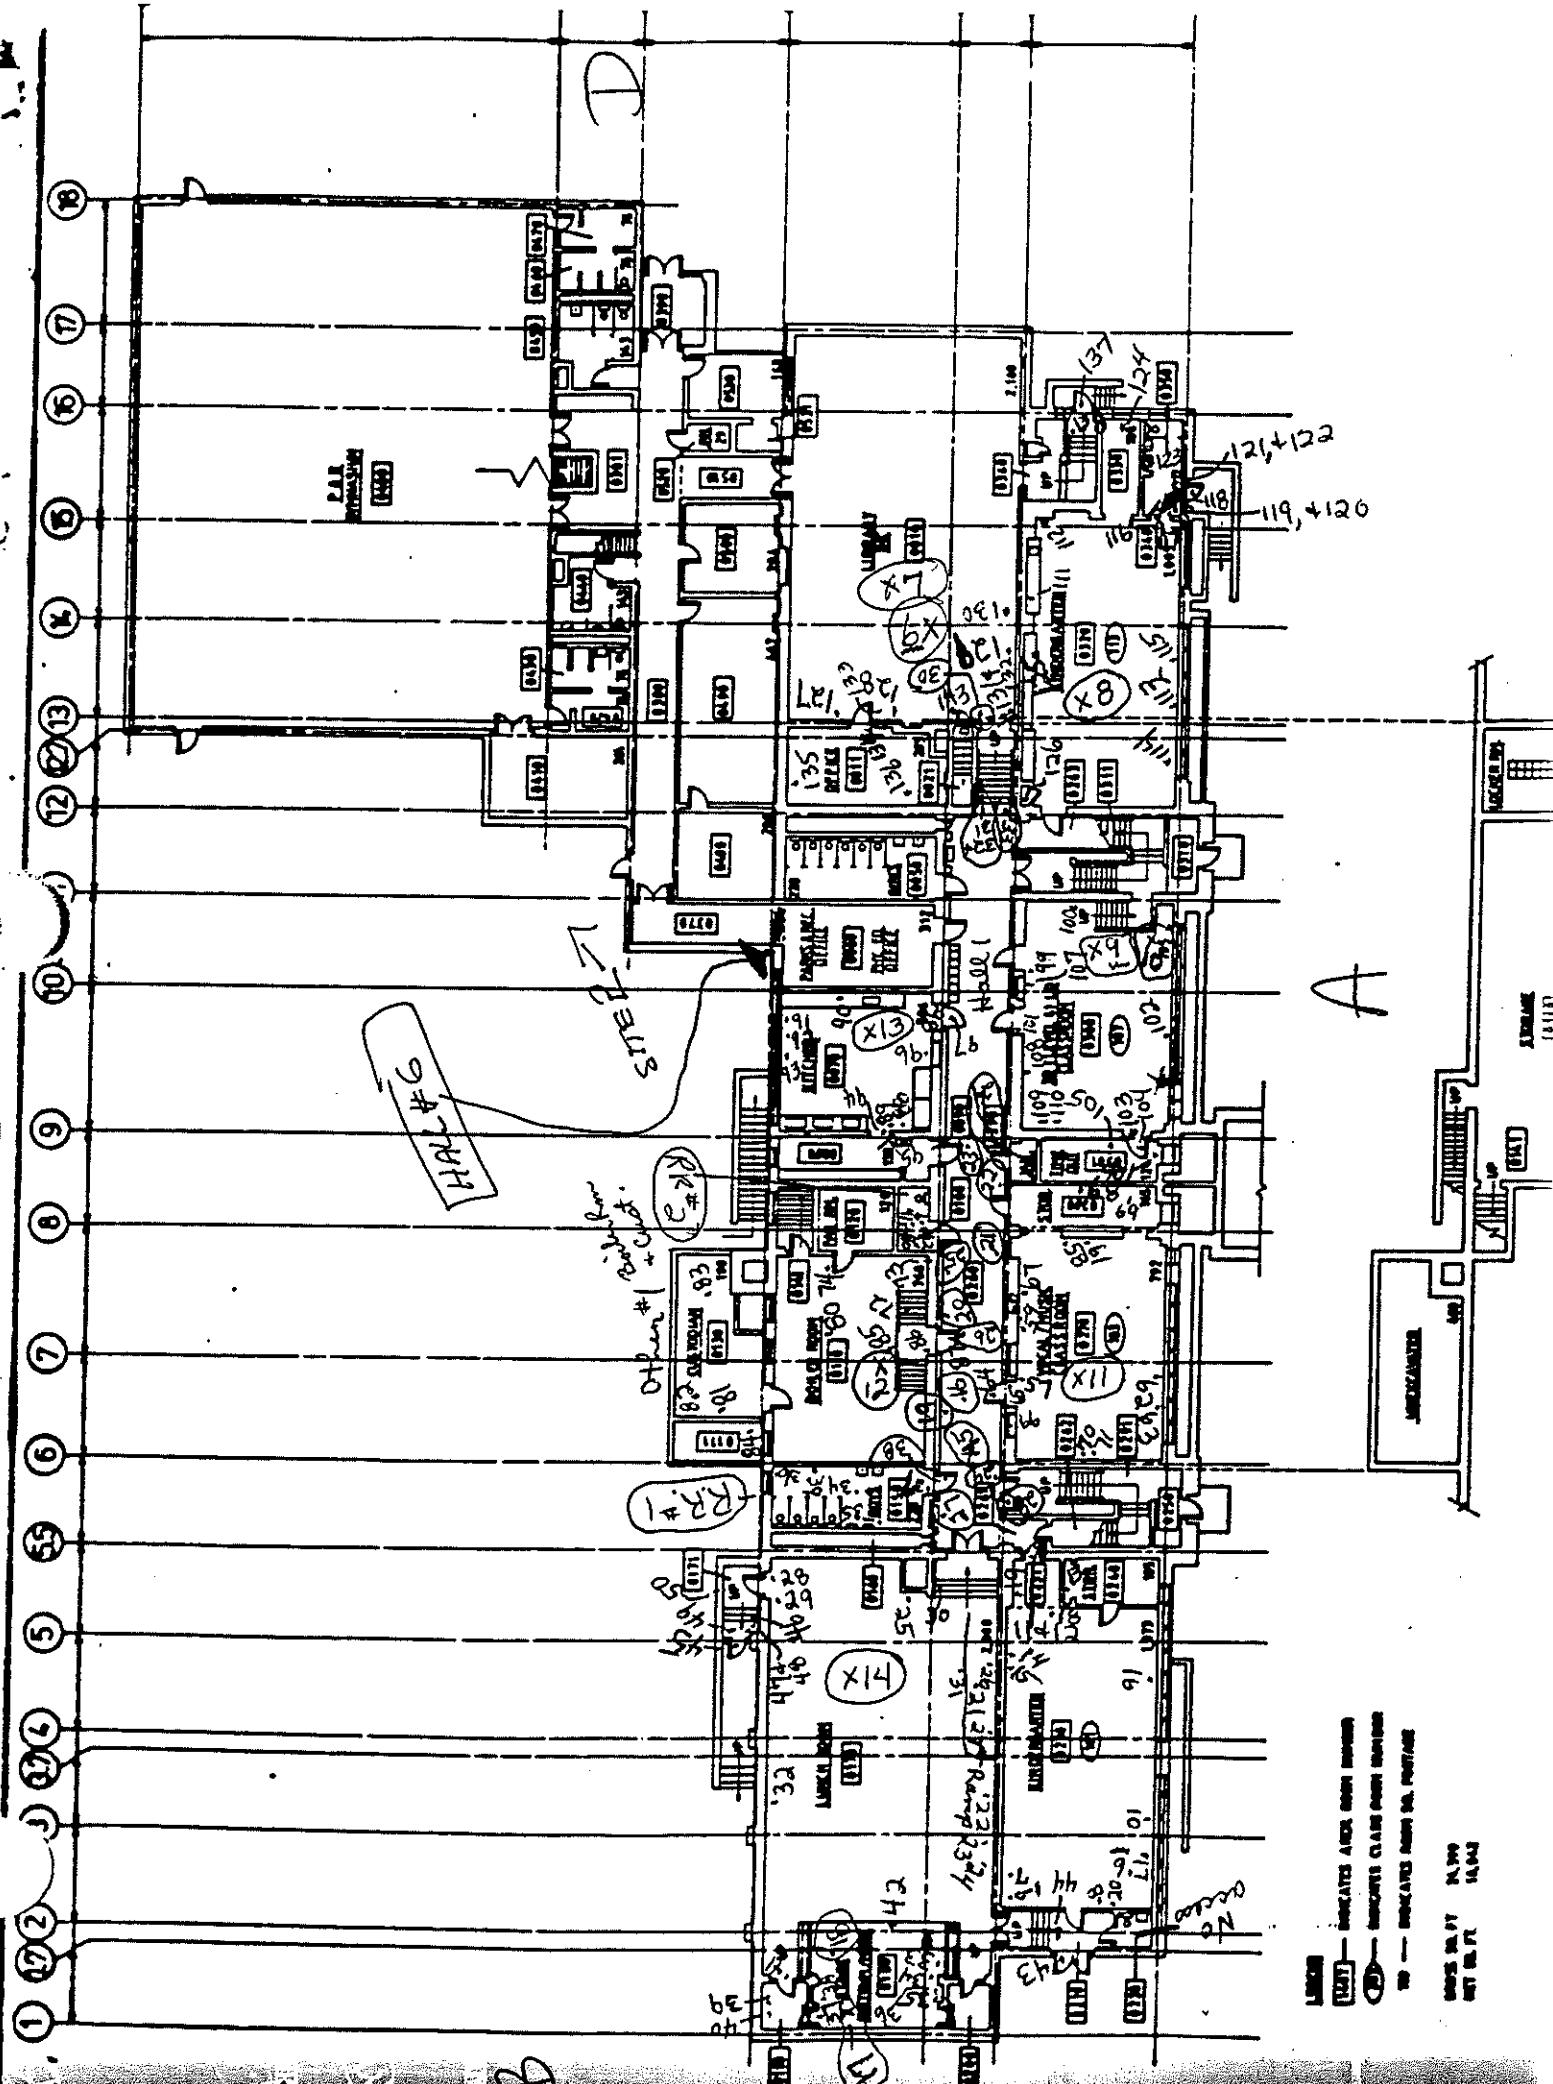

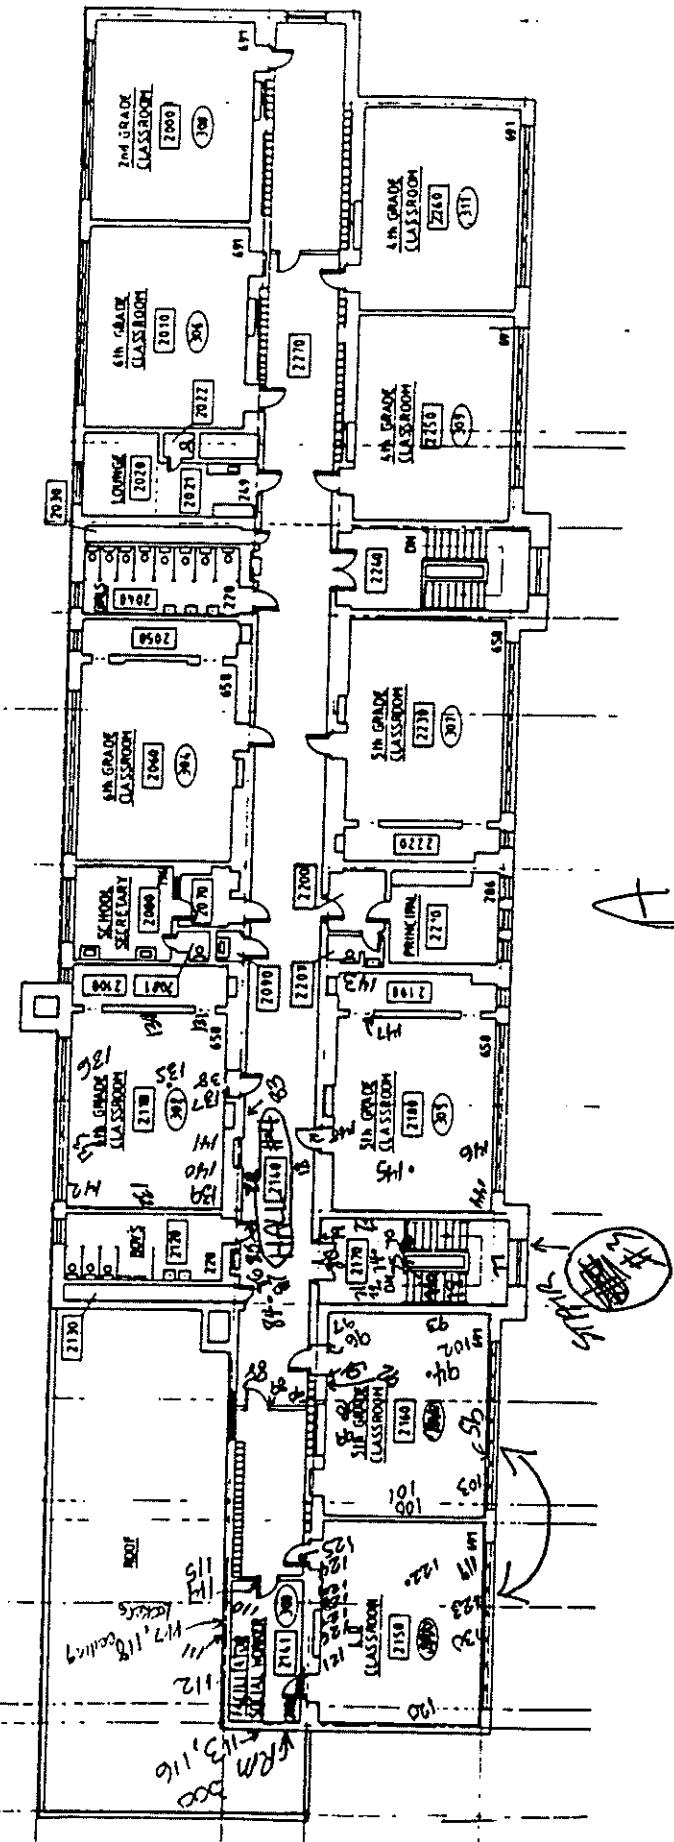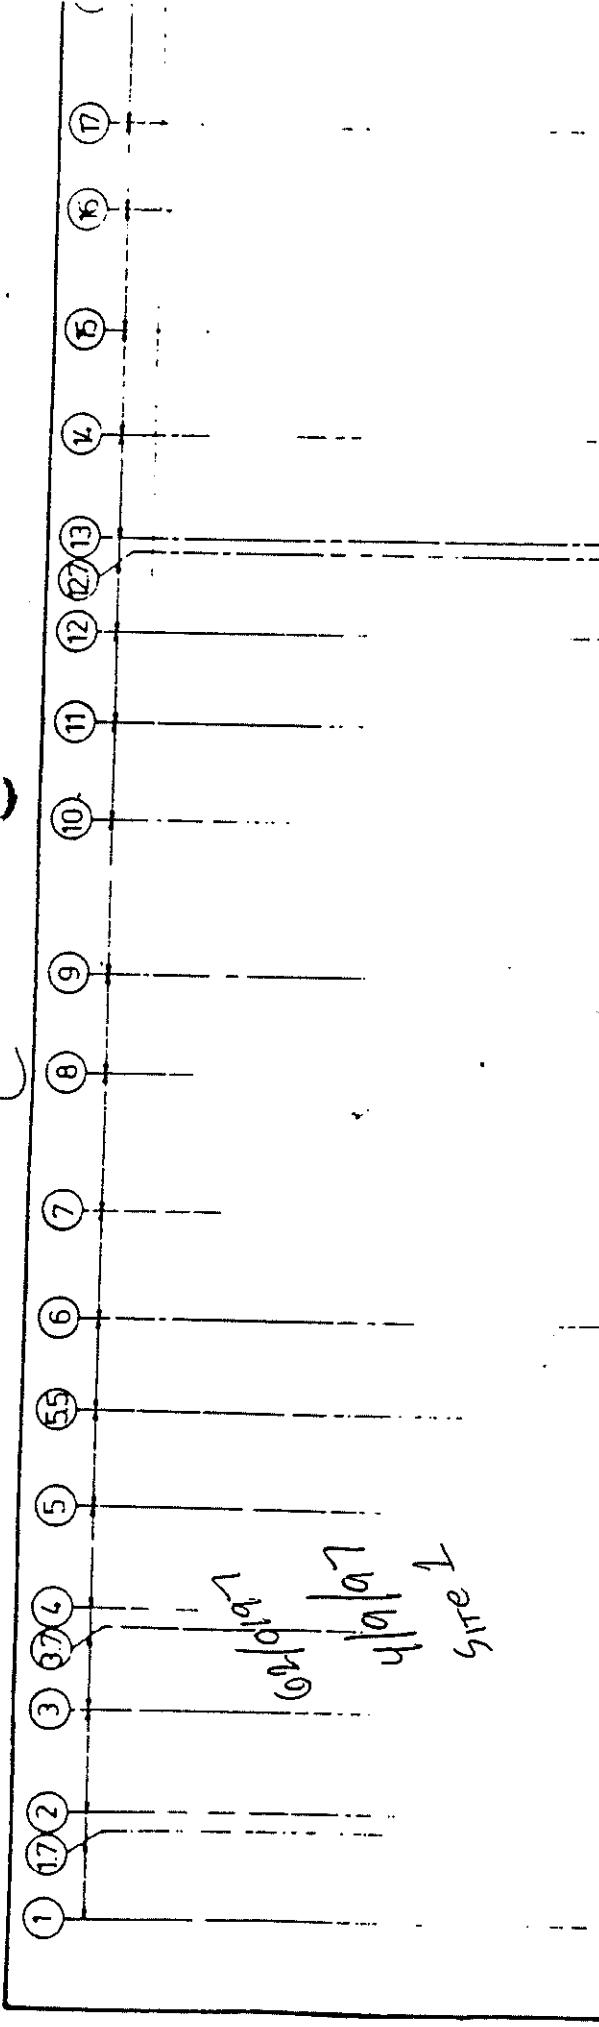

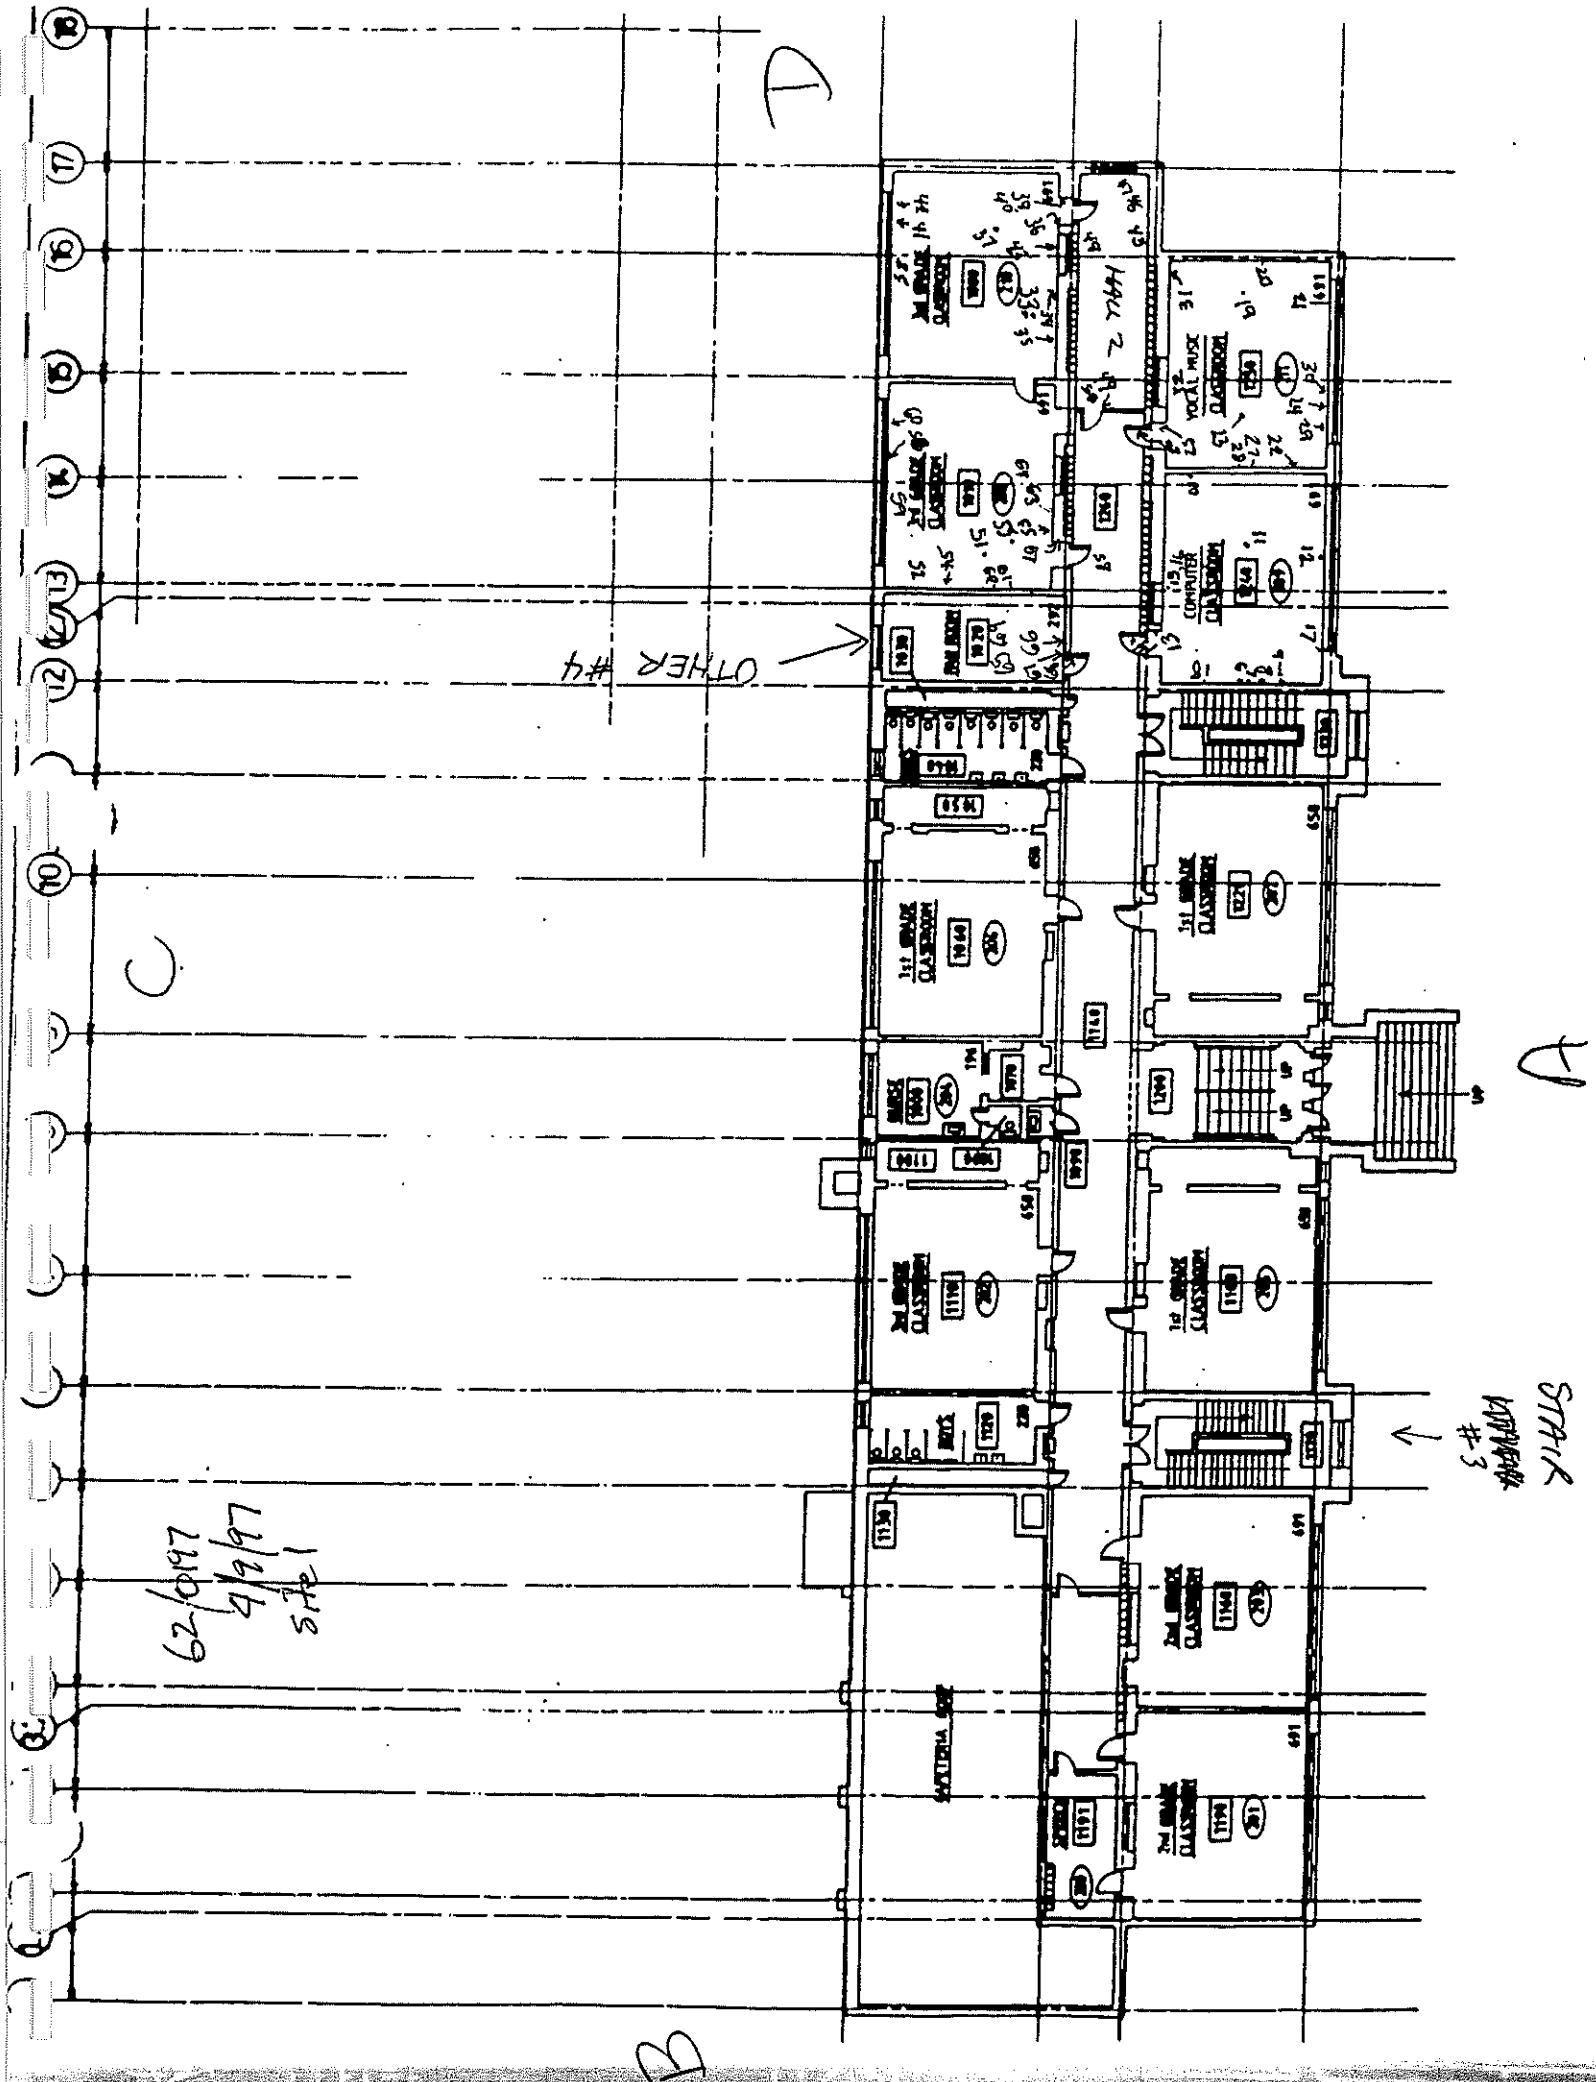

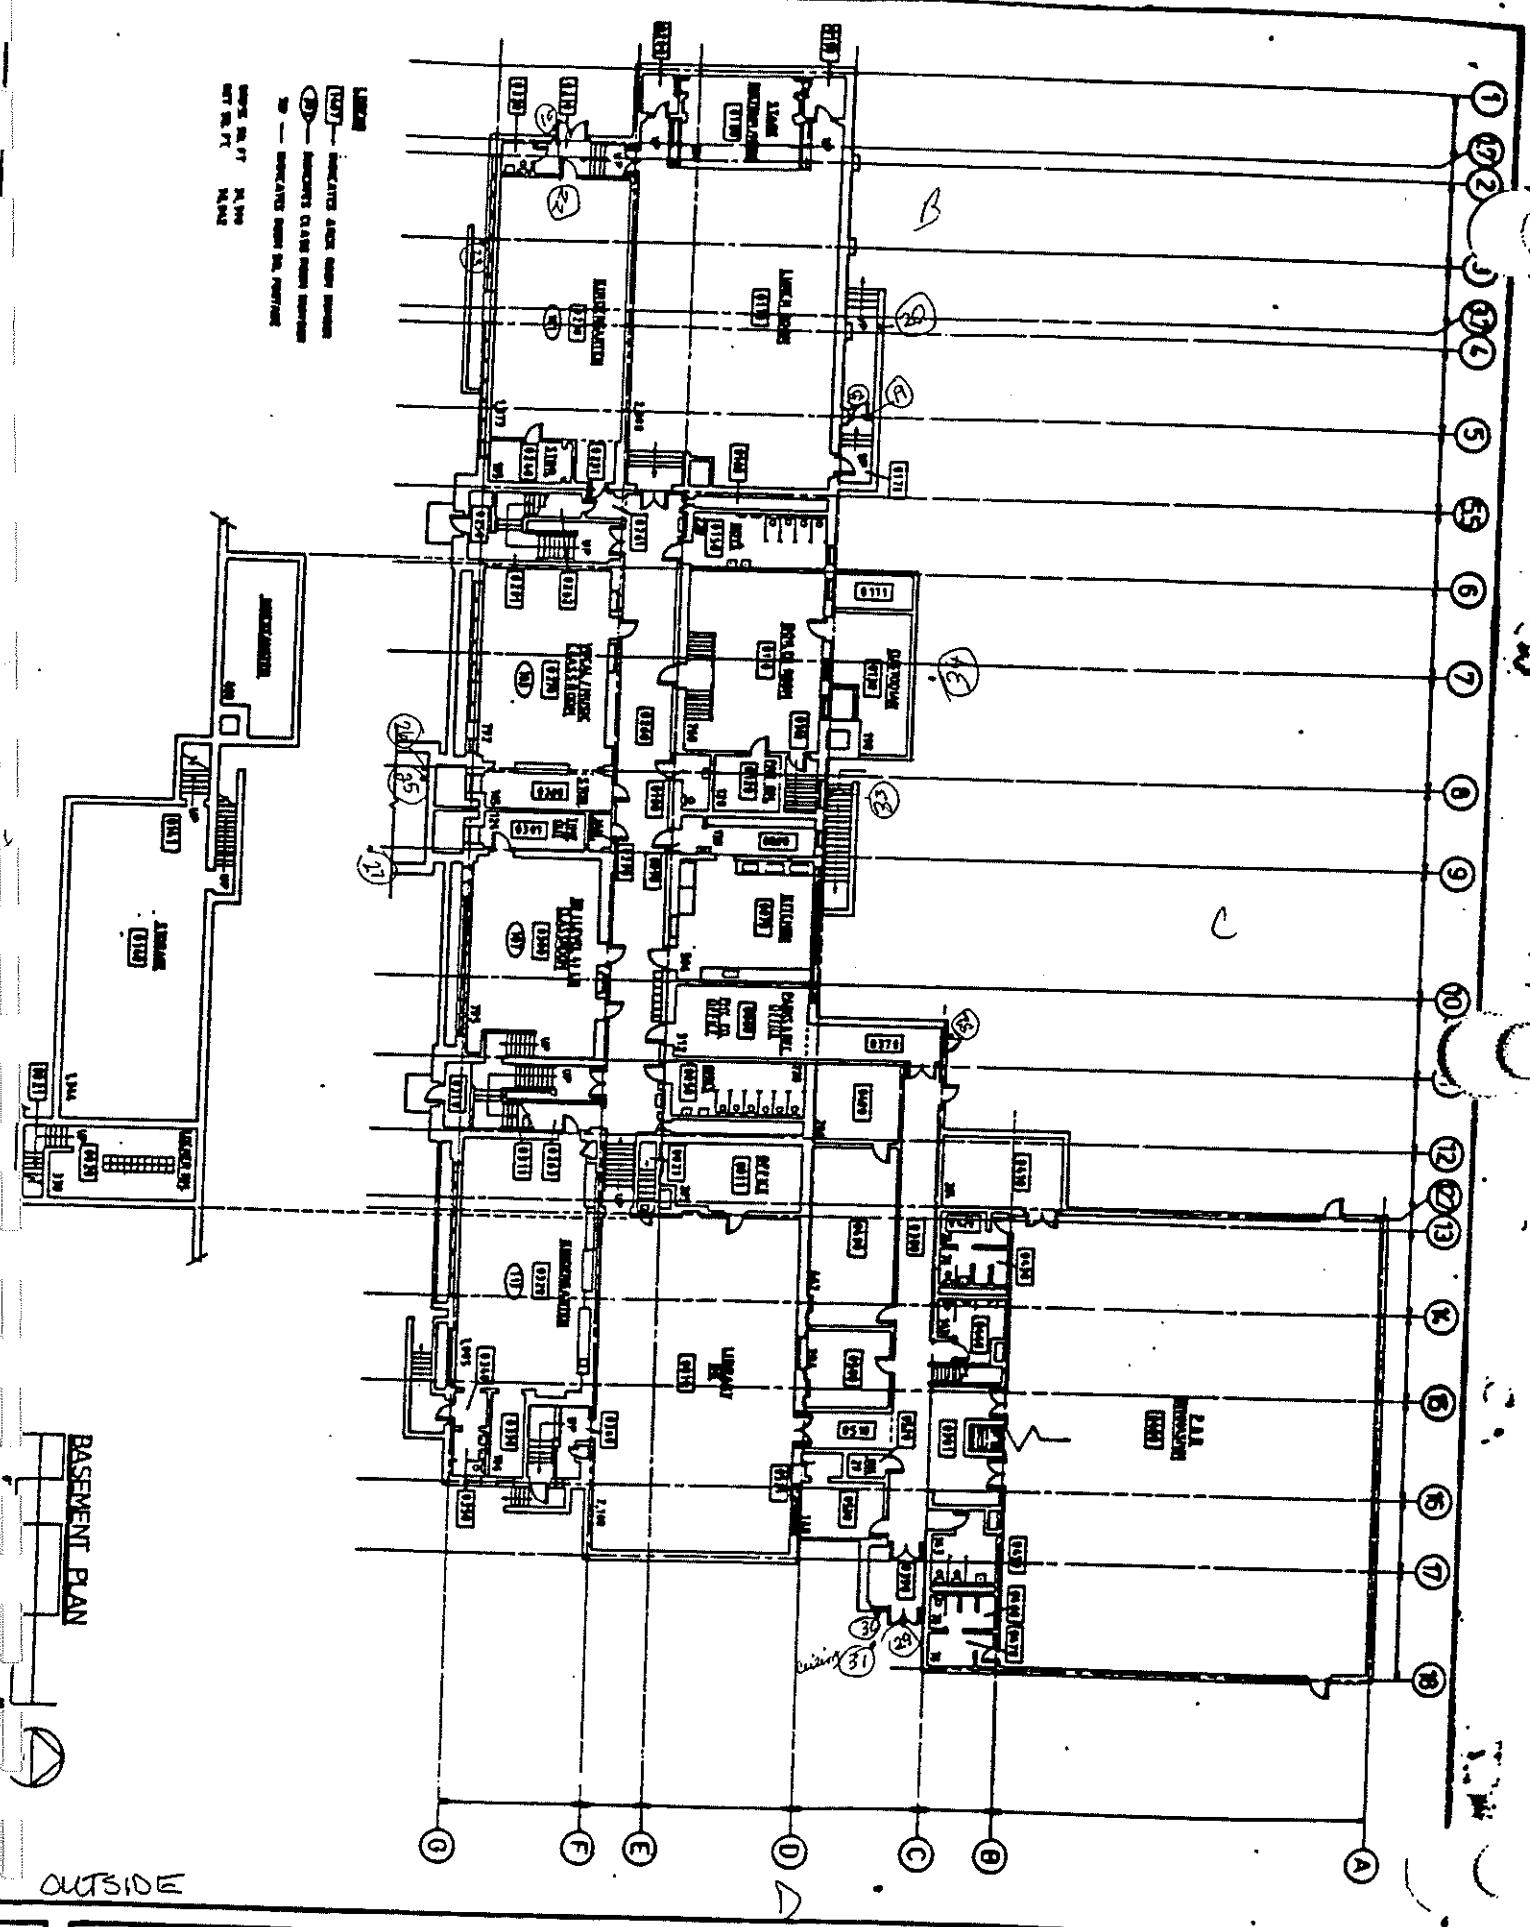

INDEPENDENT SCHOOL DIST. #23
300 COLBORNE STREET
ST. PAUL, MINNESOTA 55102

GROVELAND PARK ELEM. SCHOOL
2045 ST. CLAIR AVE.
ST. PAUL, MINNESOTA

CONSTRUCTED: 1921, 24, 31, 78

2
5

GROVELAND PARK EBL
2045 ST CLAIR AVE
ST PAUL MINNESOTA

CONSTRUCTED: 1921, 24, 31, 78


5
2

This architectural floor plan shows a detailed layout of rooms and hallways. The plan includes various rooms labeled such as '681', 'Ceiling N/A', 'Gym Room 4', 'RR#1', 'RR#2', 'RR#3', 'RR#4', 'Kitchen', 'HALL', 'CLOSET', and 'STAIR'. Numerous handwritten labels and numbers are overlaid on the plan, particularly in the central and lower-left areas. These labels include:

- RR#1
- RR#2
- RR#3
- RR#4
- #208 WALL
- #209 Ceiling
- #210 *
- #211 DOOR
- #212 WALL
- #213 Ceiling
- #214 *
- #215 DR. JAM
- 681
- Ceiling N/A
- Gym Room 4
- RR#1
- RR#2
- RR#3
- RR#4
- Kitchen
- HALL
- CLOSET
- STAIR
- 191 (green)
- 190 (yellow)
- 191
- 192
- 193
- 194
- 195
- 196
- 197
- 198
- 199
- 200
- 201
- 202
- 203
- 204
- 205
- 206
- 207
- 208
- 209
- 210
- 211
- 212
- 213
- 214
- 215
- 216
- 217
- 218
- 219
- 220
- 221
- 222
- 223
- 224
- 225
- 226
- 227
- 228
- 229
- 230
- 231
- 232
- 233
- 234
- 235
- 236
- 237
- 238
- 239
- 240
- 241
- 242
- 243
- 244
- 245
- 246
- 247
- 248
- 249
- 250
- 251
- 252
- 253
- 254
- 255
- 256
- 257
- 258
- 259
- 260
- 261
- 262
- 263
- 264
- 265
- 266
- 267
- 268
- 269
- 270
- 271
- 272
- 273
- 274
- 275
- 276
- 277
- 278
- 279
- 280
- 281
- 282
- 283
- 284
- 285
- 286
- 287
- 288
- 289
- 290
- 291
- 292
- 293
- 294
- 295
- 296
- 297
- 298
- 299
- 300
- 301
- 302
- 303
- 304
- 305
- 306
- 307
- 308
- 309
- 310
- 311
- 312
- 313
- 314
- 315
- 316
- 317
- 318
- 319
- 320
- 321
- 322
- 323
- 324
- 325
- 326
- 327
- 328
- 329
- 330
- 331
- 332
- 333
- 334
- 335
- 336
- 337
- 338
- 339
- 340
- 341
- 342
- 343
- 344
- 345
- 346
- 347
- 348
- 349
- 350
- 351
- 352
- 353
- 354
- 355
- 356
- 357
- 358
- 359
- 360
- 361
- 362
- 363
- 364
- 365
- 366
- 367
- 368
- 369
- 370
- 371
- 372
- 373
- 374
- 375
- 376
- 377
- 378
- 379
- 380
- 381
- 382
- 383
- 384
- 385
- 386
- 387
- 388
- 389
- 390
- 391
- 392
- 393
- 394
- 395
- 396
- 397
- 398
- 399
- 400
- 401
- 402
- 403
- 404
- 405
- 406
- 407
- 408
- 409
- 410
- 411
- 412
- 413
- 414
- 415
- 416
- 417
- 418
- 419
- 420
- 421
- 422
- 423
- 424
- 425
- 426
- 427
- 428
- 429
- 430
- 431
- 432
- 433
- 434
- 435
- 436
- 437
- 438
- 439
- 440
- 441
- 442
- 443
- 444
- 445
- 446
- 447
- 448
- 449
- 450
- 451
- 452
- 453
- 454
- 455
- 456
- 457
- 458
- 459
- 460
- 461
- 462
- 463
- 464
- 465
- 466
- 467
- 468
- 469
- 470
- 471
- 472
- 473
- 474
- 475
- 476
- 477
- 478
- 479
- 480
- 481
- 482
- 483
- 484
- 485
- 486
- 487
- 488
- 489
- 490
- 491
- 492
- 493
- 494
- 495
- 496
- 497
- 498
- 499
- 500
- 501
- 502
- 503
- 504
- 505
- 506
- 507
- 508
- 509
- 510
- 511
- 512
- 513
- 514
- 515
- 516
- 517
- 518
- 519
- 520
- 521
- 522
- 523
- 524
- 525
- 526
- 527
- 528
- 529
- 530
- 531
- 532
- 533
- 534
- 535
- 536
- 537
- 538
- 539
- 540
- 541
- 542
- 543
- 544
- 545
- 546
- 547
- 548
- 549
- 550
- 551
- 552
- 553
- 554
- 555
- 556
- 557
- 558
- 559
- 560
- 561
- 562
- 563
- 564
- 565
- 566
- 567
- 568
- 569
- 570
- 571
- 572
- 573
- 574
- 575
- 576
- 577
- 578
- 579
- 580
- 581
- 582
- 583
- 584
- 585
- 586
- 587
- 588
- 589
- 590
- 591
- 592
- 593
- 594
- 595
- 596
- 597
- 598
- 599
- 600
- 601
- 602
- 603
- 604
- 605
- 606
- 607
- 608
- 609
- 610
- 611
- 612
- 613
- 614
- 615
- 616
- 617
- 618
- 619
- 620
- 621
- 622
- 623
- 624
- 625
- 626
- 627
- 628
- 629
- 630
- 631
- 632
- 633
- 634
- 635
- 636
- 637
- 638
- 639
- 640
- 641
- 642
- 643
- 644
- 645
- 646
- 647
- 648
- 649
- 650
- 651
- 652
- 653
- 654
- 655
- 656
- 657
- 658
- 659
- 660
- 661
- 662
- 663
- 664
- 665
- 666
- 667
- 668
- 669
- 670
- 671
- 672
- 673
- 674
- 675
- 676
- 677
- 678
- 679
- 680
- 681
- 682
- 683
- 684
- 685
- 686
- 687
- 688
- 689
- 690
- 691
- 692
- 693
- 694
- 695
- 696
- 697
- 698
- 699
- 700
- 701
- 702
- 703
- 704
- 705
- 706
- 707
- 708
- 709
- 710
- 711
- 712
- 713
- 714
- 715
- 716
- 717
- 718
- 719
- 720
- 721
- 722
- 723
- 724
- 725
- 726
- 727
- 728
- 729
- 730
- 731
- 732
- 733
- 734
- 735
- 736
- 737
- 738
- 739
- 740
- 741
- 742
- 743
- 744
- 745
- 746
- 747
- 748
- 749
- 750
- 751
- 752
- 753
- 754
- 755
- 756
- 757
- 758
- 759
- 760
- 761
- 762
- 763
- 764
- 765
- 766
- 767
- 768
- 769
- 770
- 771
- 772
- 773
- 774
- 775
- 776
- 777
- 778
- 779
- 780
- 781
- 782
- 783
- 784
- 785
- 786
- 787
- 788
- 789
- 790
- 791
- 792
- 793
- 794
- 795
- 796
- 797
- 798
- 799
- 800
- 801
- 802
- 803
- 804
- 805
- 806
- 807
- 808
- 809
- 810
- 811
- 812
- 813
- 814
- 815
- 816
- 817
- 818
- 819
- 820
- 821
- 822
- 823
- 824
- 825
- 826
- 827
- 828
- 829
- 830
- 831
- 832
- 833
- 834
- 835
- 836
- 837
- 838
- 839
- 840
- 841
- 842
- 843
- 844
- 845
- 846
- 847
- 848
- 849
- 850
- 851
- 852
- 853
- 854
- 855
- 856
- 857
- 858
- 859
- 860
- 861
- 862
- 863
- 864
- 865
- 866
- 867
- 868
- 869
- 870
- 871
- 872
- 873
- 874
- 875
- 876
- 877
- 878
- 879
- 880
- 881
- 882
- 883
- 884
- 885
- 886
- 887
- 888
- 889
- 890
- 891
- 892
- 893
- 894
- 895
- 896
- 897
- 898
- 899
- 900
- 901
- 902
- 903
- 904
- 905
- 906
- 907
- 908
- 909
- 910
- 911
- 912
- 913
- 914
- 915
- 916
- 917
- 918
- 919
- 920
- 921
- 922
- 923
- 924
- 925
- 926
- 927
- 928
- 929
- 930
- 931
- 932
- 933
- 934
- 935
- 936
- 937
- 938
- 939
- 940
- 941
- 942
- 943
- 944
- 945
- 946
- 947
- 948
- 949
- 950
- 951
- 952
- 953
- 954
- 955
- 956
- 957
- 958
- 959
- 960
- 961
- 962
- 963
- 964
- 965
- 966
- 967
- 968
- 969
- 970
- 971
- 972
- 973
- 974
- 975
- 976
- 977
- 978
- 979
- 980
- 981
- 982
- 983
- 984
- 985
- 986
- 987
- 988
- 989
- 990
- 991
- 992
- 993
- 994
- 995
- 996
- 997
- 998
- 999

**LOCATE AND REPAIR
RESCUE CLASS POINT SOURCE
LOCATE POINT SOURCE**



SECOND FLOOR PLAN

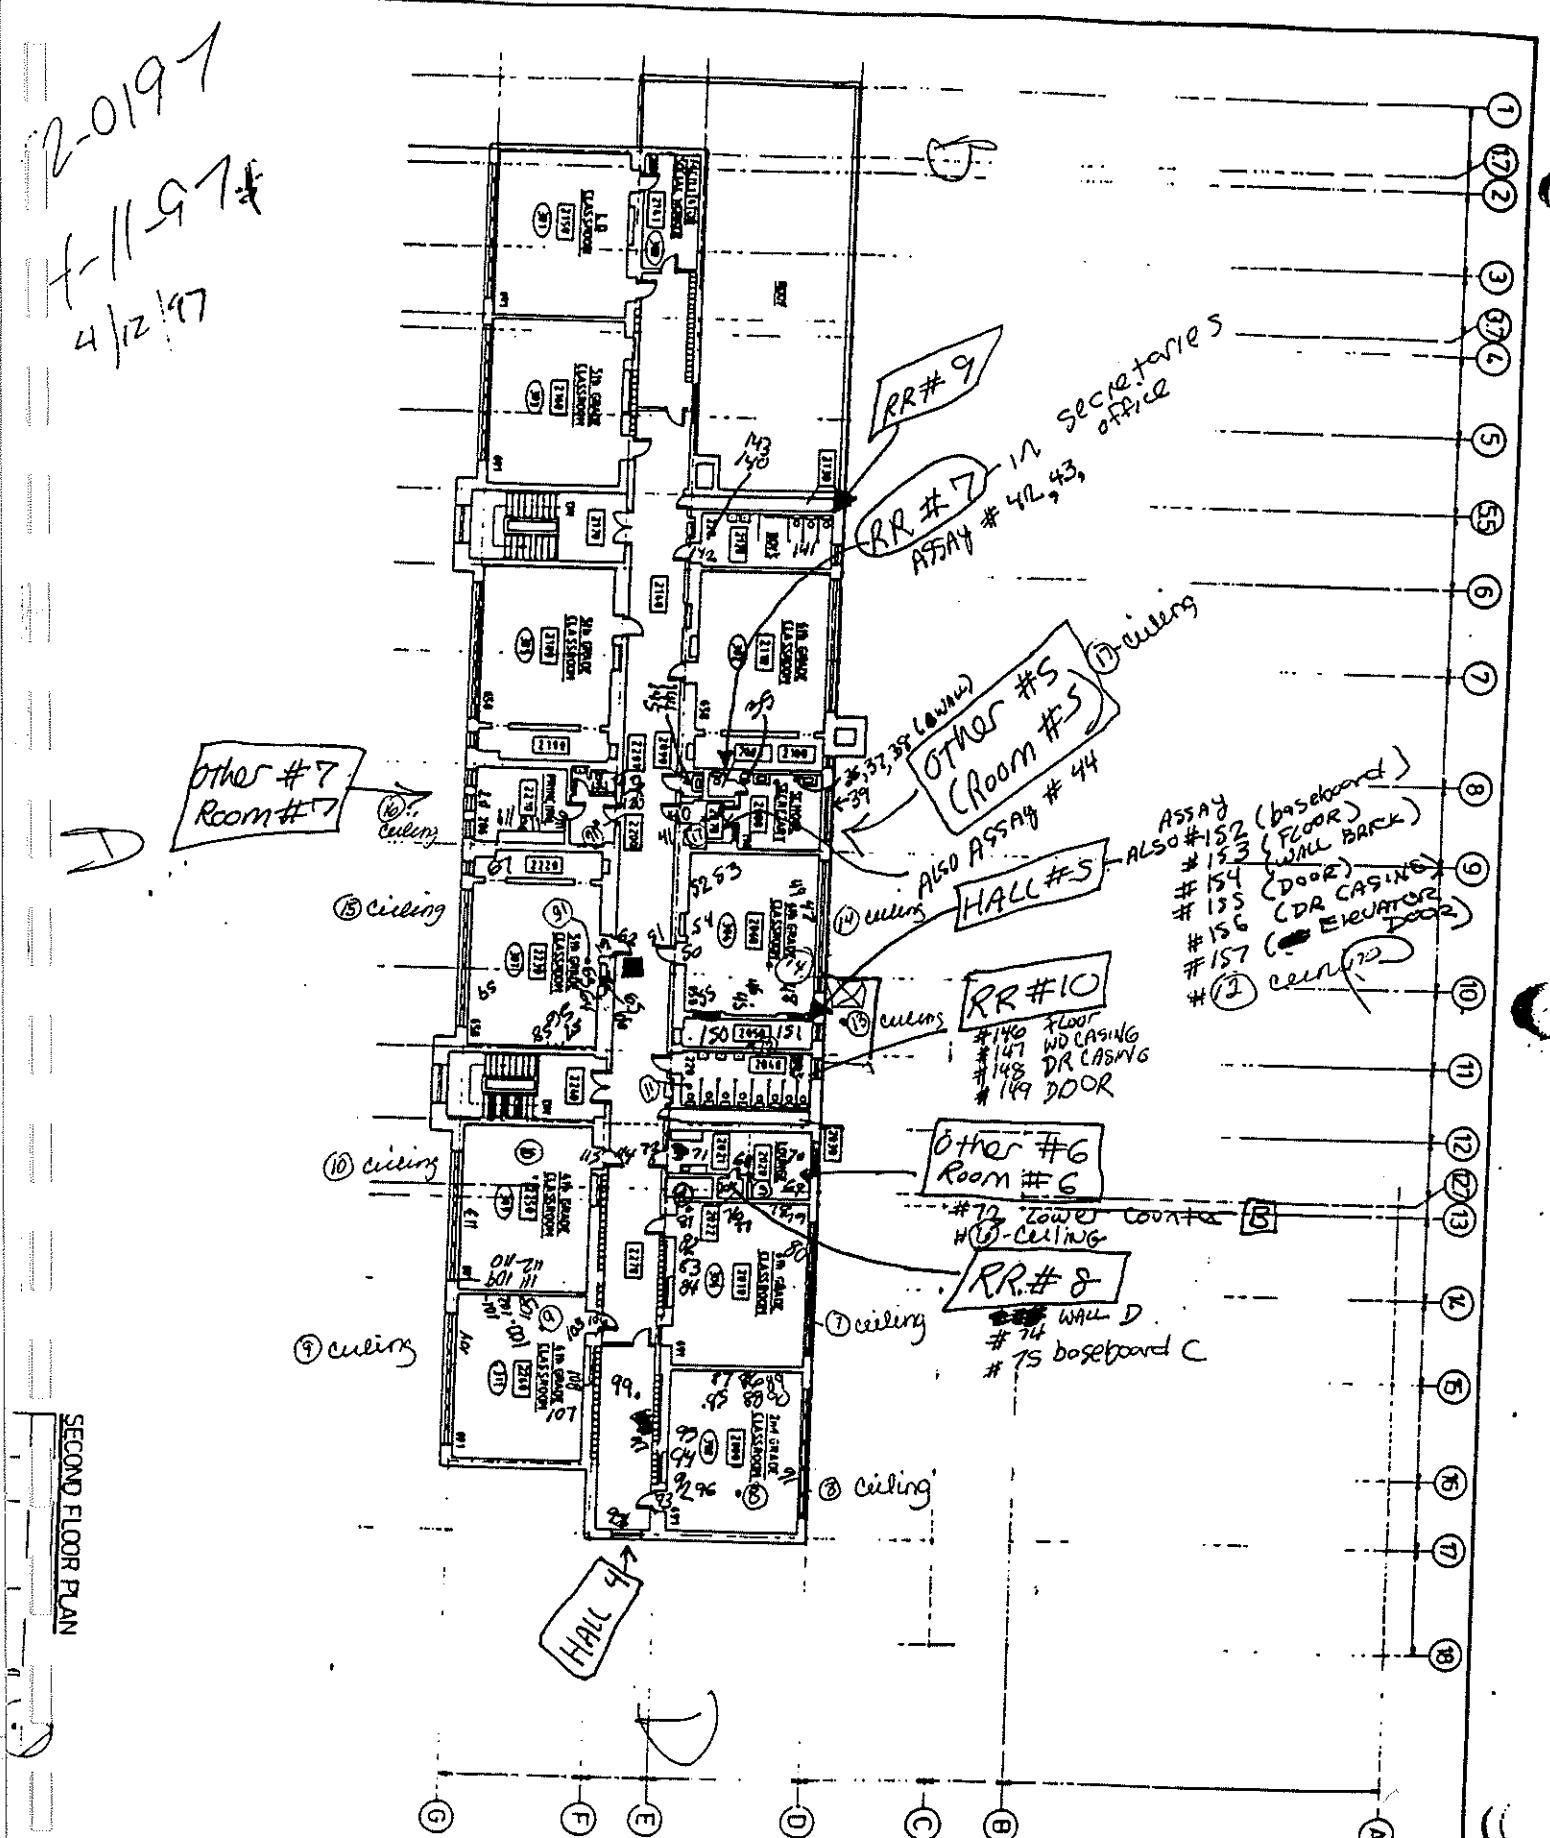

CLEVELAND AVENUE

ST CLAIR AVENUE


SITE ACTS	4.62
GROSS SA, PT.	116.00
NETTIE SA, PT.	116.00
NETTIE SA, PT.	116.00
PLAY SA, PT.	116.00
CROSS GROSS SA, PT.	31.00
SITE SURVAK UN, PT.	91.50
PUBLIC SURVAK UN, PT.	91.50
STEELE UN, PT.	1.50
HOTEL UN, PT.	1.50
SITE PLATES	0
BONKERSUN TENTS	27
ROCKWOOD SA, PT.	38
POWER DOWNSUN SA, PT.	10,120
YACHT	11.00

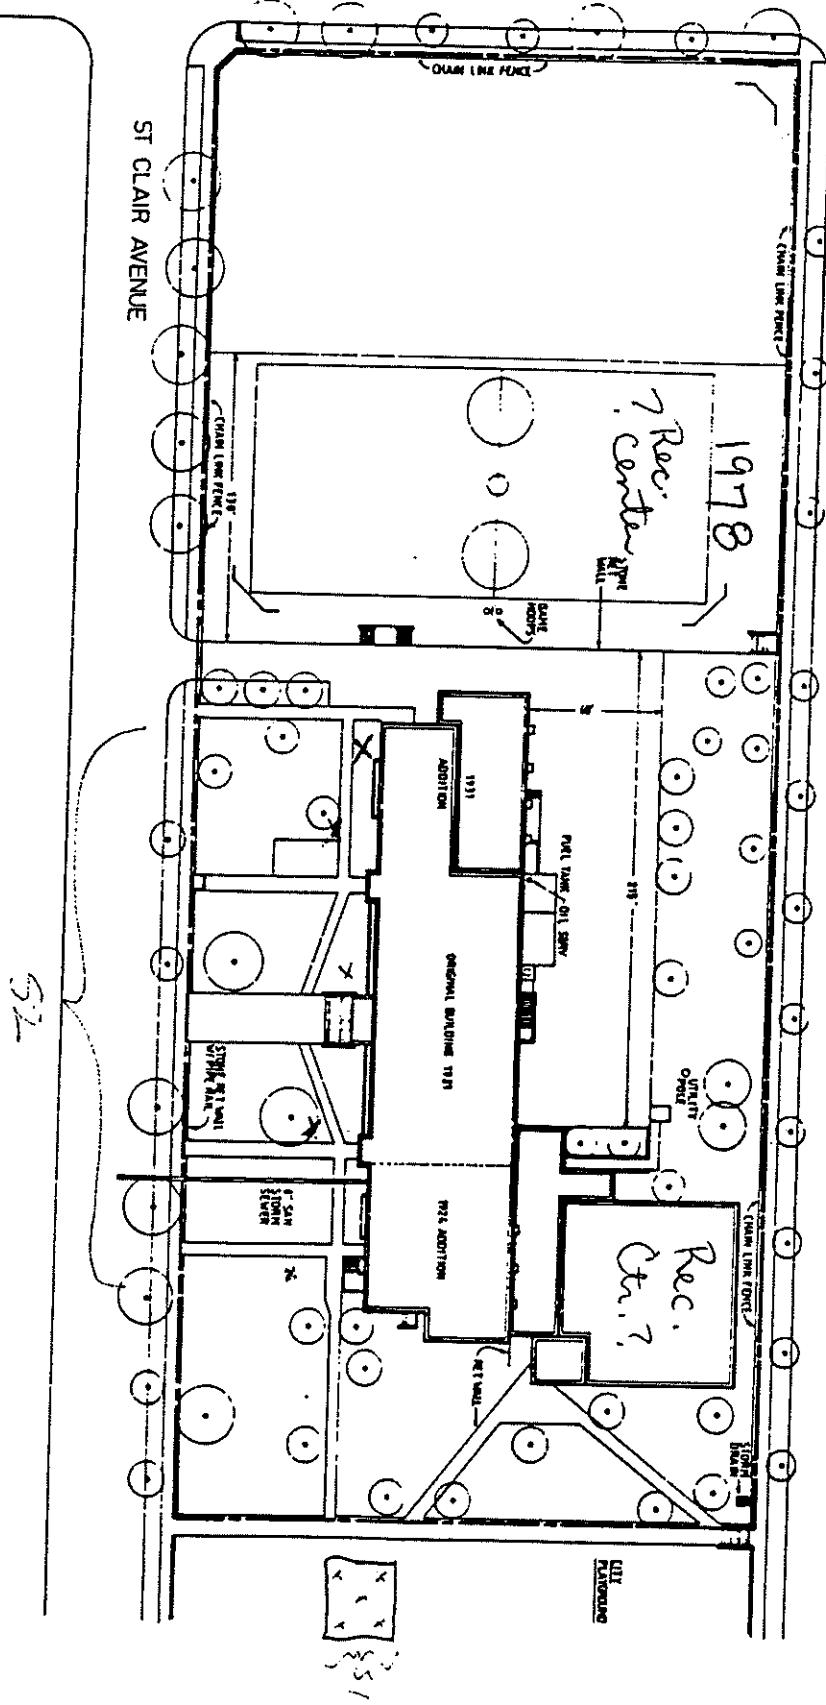


INDEPENDENT SCHOOL DIST #625
360 COLBORNE STREET
ST PAUL, MINNESOTA 55102

GROVELAND PARK ELEM. SCHOOL
2045 ST. CLAIR AVE.
ST. PAUL, MINNESOTA

CONSTRUCTED 1921, 24, 31, 78

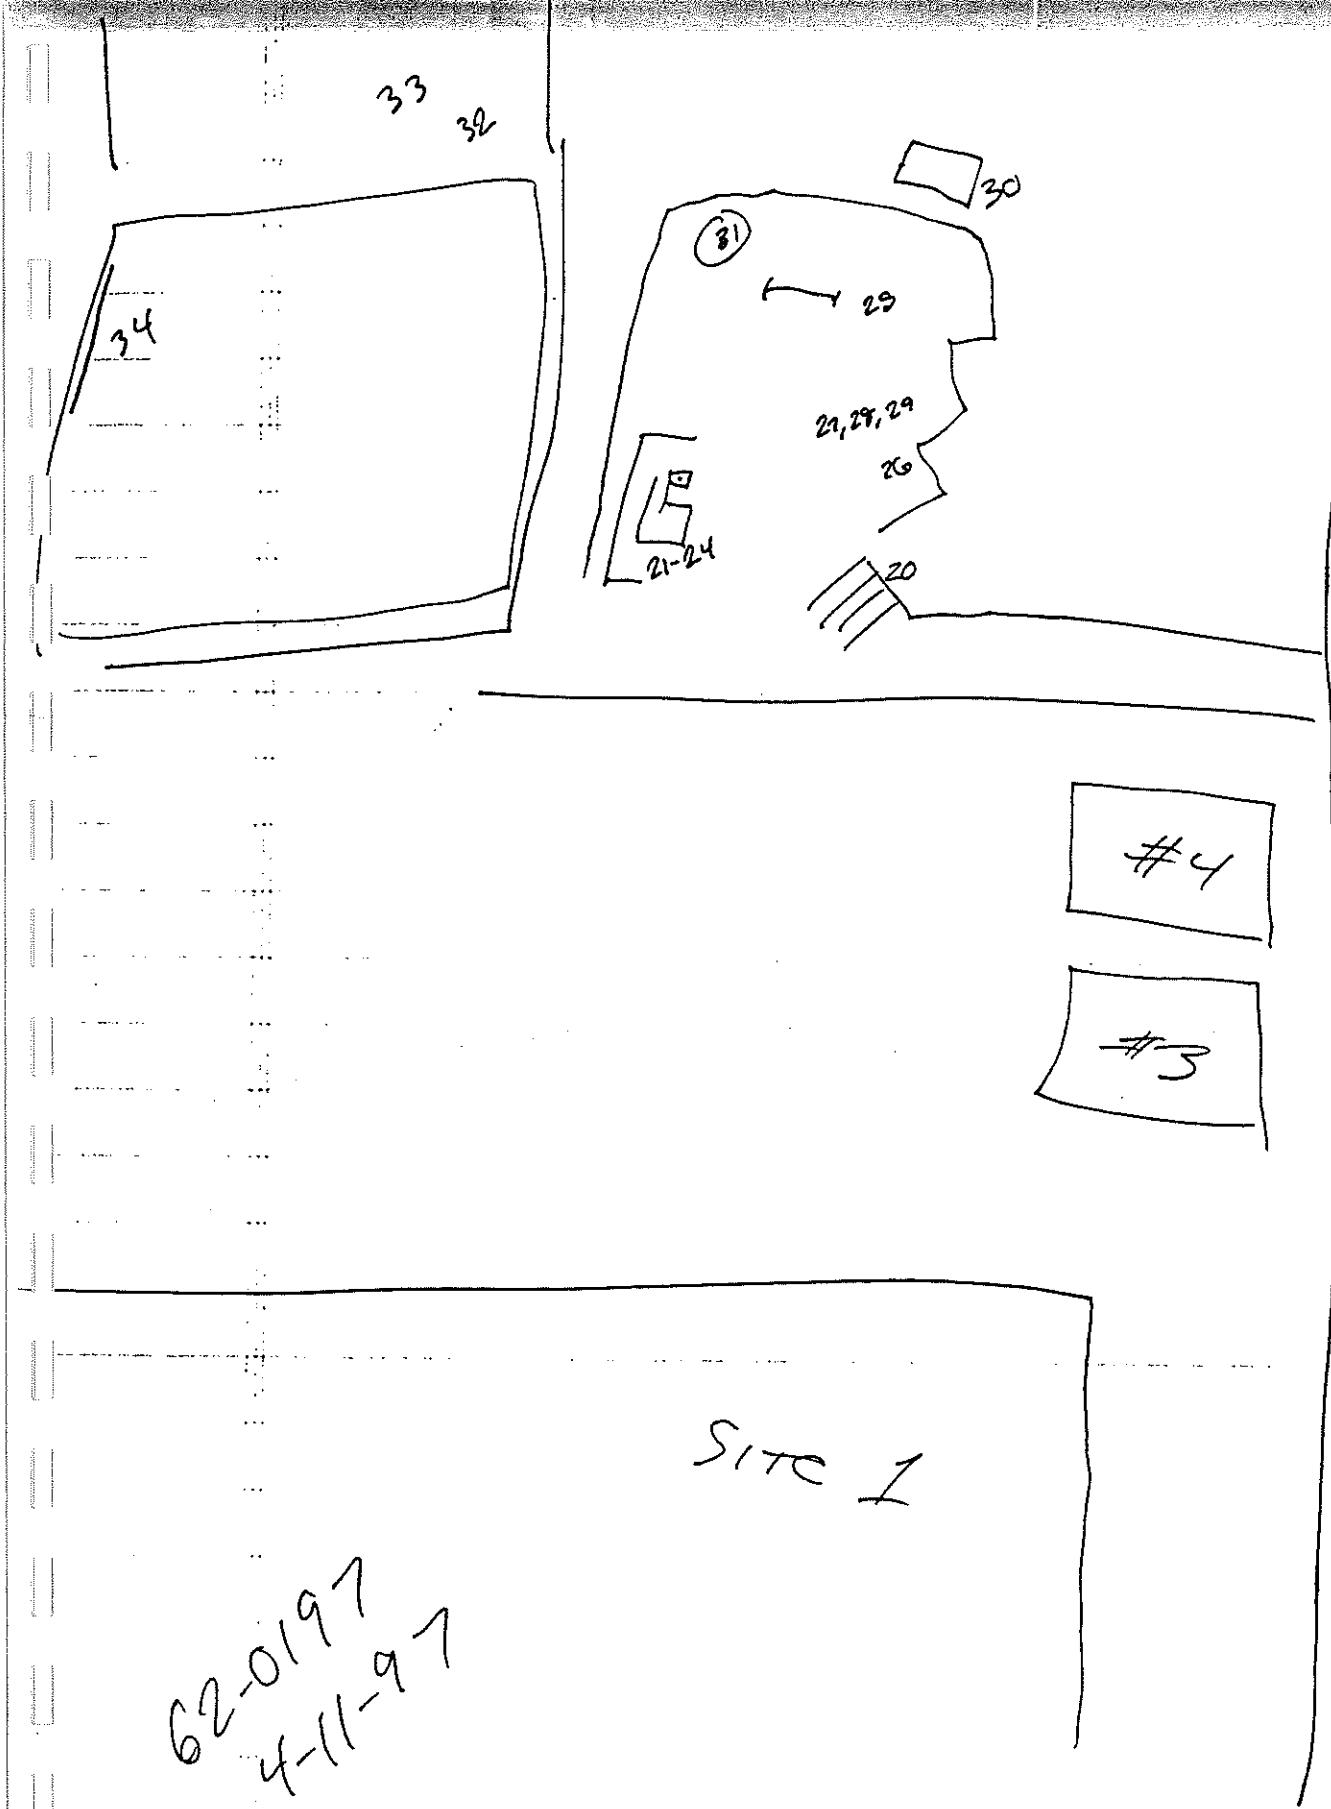


N

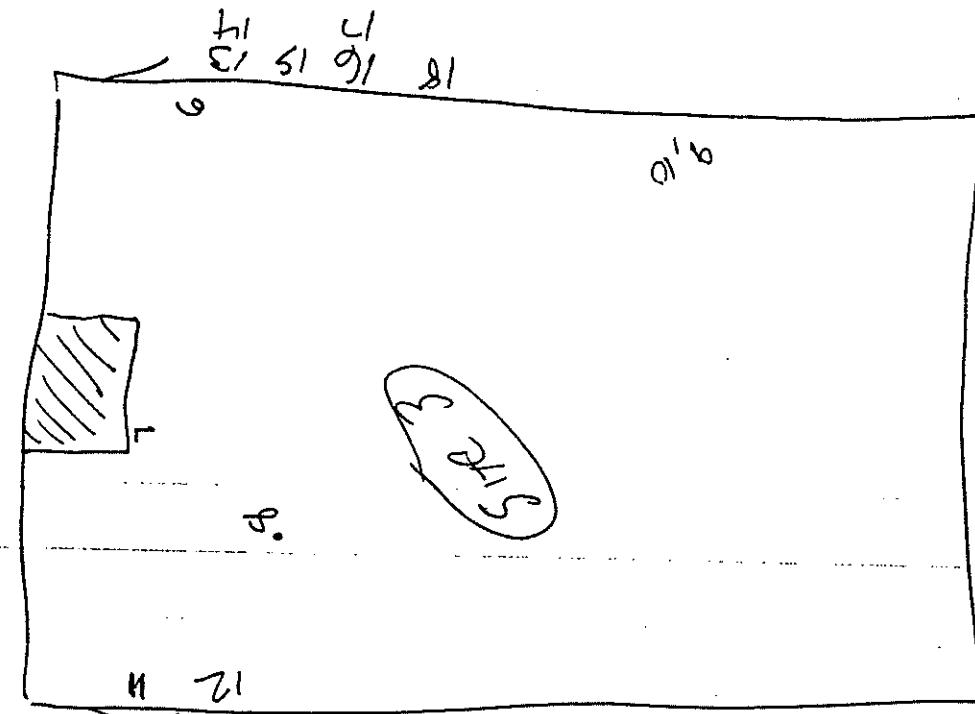

Portable #1

H

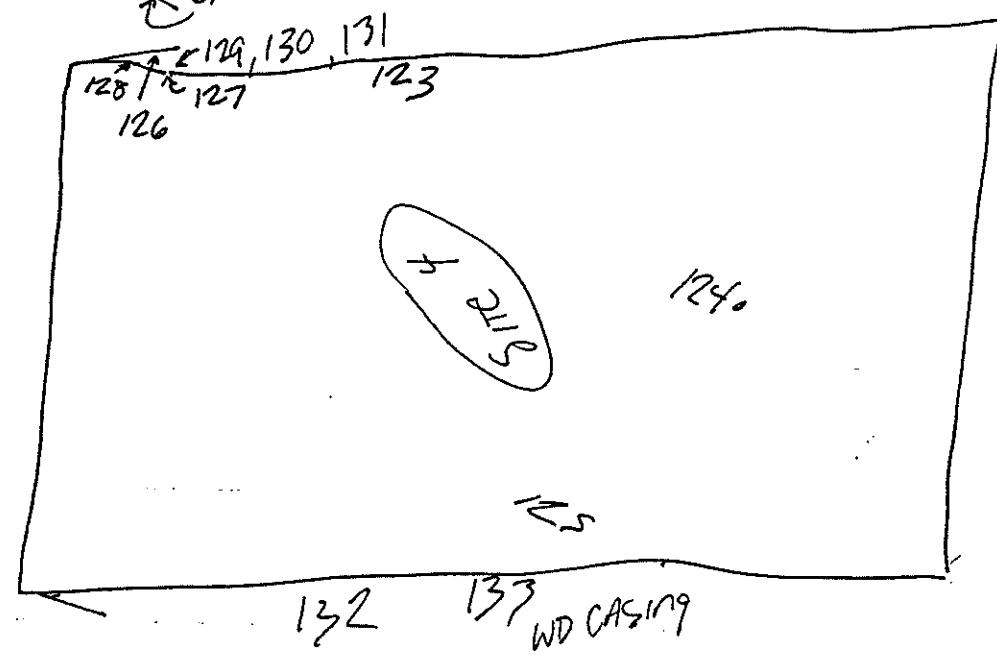

Portable #2

G2, ORG
X-11-a

D

B

Saint Paul Public Schools
 Groveland Park Elementary School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
1	Groveland Park Elementary School											
2												
3	Site	No	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	PbL
4	1912, 1924, 1931 bldg.	12	XRF	4/3/97	1	Arcade	1	Ceiling		Solid	Concrete	0.03
5	1912, 1924, 1931 bldg.	14	XRF	4/3/97	1	Auditoriu	0	Ceiling		Solid	Plaster	0.63
6	1912, 1924, 1931 bldg.	21	XRF	4/2/97	1	Auditoriu	1	Floor		Solid	Concrete	0.02
7	1912, 1924, 1931 bldg.	22	XRF	4/2/97	1	Auditoriu	1	Wall	Baseboar	Peeling	Metal	0.22
8	1912, 1924, 1931 bldg.	23	XRF	4/2/97	1	Auditoriu	1	Wall	Wall	Solid	Plaster	0.07
9	1912, 1924, 1931 bldg.	24	XRF	4/2/97	1	Auditoriu	1	Wall	Chair rail	Solid	Metal	0.39
10	1912, 1924, 1931 bldg.	25	XRF	4/2/97	1	Auditoriu	1	Wall	Wall	Solid	Plaster	0.55
11	1912, 1924, 1931 bldg.	26	XRF	4/2/97	1	Auditoriu	1	Wall	Mural	Solid	Plaster	0.13
12	1912, 1924, 1931 bldg.	27	XRF	4/2/97	1	Auditoriu	1	Stairs	Hand rail	Solid	Metal	0.01
13	1912, 1924, 1931 bldg.	28	XRF	4/2/97	1	Auditoriu	1	Stairs	Door	Solid	Wood	0.05
14	1912, 1924, 1931 bldg.	29	XRF	4/2/97	1	Auditoriu	1	Door	Casing	Solid	Wood	0.05
15	1912, 1924, 1931 bldg.	30	XRF	4/2/97	1	Auditoriu	1	Stairs	Baseboar	Peeling	Wood	0.02
16	1912, 1924, 1931 bldg.	31	XRF	4/2/97	1	Auditoriu	1	Stairs	Stringer	Solid	Concrete	0.06
17	1912, 1924, 1931 bldg.	32	XRF	4/2/97	1	Auditoriu	1	Stairs	Radiator	Peeling	Metal	0.33
18	1912, 1924, 1931 bldg.	42	XRF	4/11/97	3	Bath	7	Wall	Midle Wall	Solid	Plaster	0.14
19	1912, 1924, 1931 bldg.	43	XRF	4/11/97	3	Bath	7	Floor		Solid	Concrete	0.38
20	1912, 1924, 1931 bldg.	44	XRF	4/11/97	3	Bath	7	Cabinet	Door	Solid	Wood	0.02
21	1912, 1924, 1931 bldg.	74	XRF	4/11/97	3	Bath	8	Closet	Wall	Solid	Plaster	1.06
22	1912, 1924, 1931 bldg.	75	XRF	4/11/97	3	Bath	8	Closet	Baseboar	Solid	Concrete	0.53
23	1912, 1924, 1931 bldg.	121	XRF	4/11/97	3	Bath	9	Closet	Floor	Peeling	Concrete	0.19
24	1912, 1924, 1931 bldg.	122	XRF	4/11/97	3	Bath	9	Closet	Wall	Solid	Plaster	0.18
25	1912, 1924, 1931 bldg.	140	XRF	4/11/97	1	Bath	9	Floor		Solid	Concrete	0
26	1912, 1924, 1931 bldg.	141	XRF	4/11/97	3	Bath	9	Window	Casing	Solid	Wood	0.1
27	1912, 1924, 1931 bldg.	142	XRF	4/11/97	3	Bath	9	Door	Door	Solid	Wood	0.03
28	1912, 1924, 1931 bldg.	143	XRF	4/11/97	3	Bath	9	Door	Jamb	Solid	Wood	0.04
29	1912, 1924, 1931 bldg.	146	XRF	4/11/97	3	Bath	10	Floor		Solid	Concrete	0.09
30	1912, 1924, 1931 bldg.	147	XRF	4/11/97	3	Bath	10	Door	Jamb	Solid	Wood	0.06
31	1912, 1924, 1931 bldg.	148	XRF	4/11/97	3	Bath	10	Door	Jamb	Solid	Wood	0.03
32	1912, 1924, 1931 bldg.	149	XRF	4/11/97	3	Bath	10	Door	Door	Solid	Wood	0.02
33	1912, 1924, 1931 bldg.	6	XRF	4/2/97	1	Classroo	101	Floor		Solid	Wood	0
34	1912, 1924, 1931 bldg.	7	XRF	4/2/97	1	Classroo	101	Wall	Baseboar	Solid	Metal	0.68
35	1912, 1924, 1931 bldg.	8	XRF	4/2/97	1	Classroo	101	Wall	Wall	Solid	Plaster	0.57
36	1912, 1924, 1931 bldg.	9	XRF	4/2/97	1	Classroo	101	Wall	Wall	Solid	Plaster	0.18
37	1912, 1924, 1931 bldg.	10	XRF	4/2/97	1	Classroo	101	Window	Casing	Solid	Wood	0.08
38	1912, 1924, 1931 bldg.	11	XRF	4/2/97	1	Classroo	101	Door	Door	Solid	Wood	0.04
39	1912, 1924, 1931 bldg.	12	XRF	4/2/97	1	Classroo	101	Door	Jamb	Solid	Wood	0.05
40	1912, 1924, 1931 bldg.	13	XRF	4/2/97	1	Classroo	101	Cabinet	Door	Solid	Wood	0.03
41	1912, 1924, 1931 bldg.	14	XRF	4/2/97	1	Classroo	101	Chalkboard	Ledge	Solid	Wood	0.06
42	1912, 1924, 1931 bldg.	15	XRF	4/2/97	1	Classroo	101	Chalkboard	Sash	Cracked	Wood	0.25
43	1912, 1924, 1931 bldg.	16	XRF	4/2/97	1	Classroo	101	Univent	Door	Solid	Metal	0.13
44	1912, 1924, 1931 bldg.	17	XRF	4/2/97	1	Classroo	101		Radiator	Cracked	Metal	0.64
45	1912, 1924, 1931 bldg.	18	XRF	4/2/97	1	Classroo	101	Ceiling		Solid	Plaster	0.29
46	1912, 1924, 1931 bldg.	19	XRF	4/2/97	1	Classroo	101	Bench		Solid	Wood	0
47	1912, 1924, 1931 bldg.	20	XRF	4/2/97	1	Classroo	101	Cabinet	Door	Solid	Wood	0
48	1912, 1924, 1931 bldg.	57	XRF	4/2/97	1	Classroo	103	Wall	Baseboar	Solid	Wood	0.05
49	1912, 1924, 1931 bldg.	58	XRF	4/2/97	1	Classroo	103	Floor		Solid	Wood	0
50	1912, 1924, 1931 bldg.	59	XRF	4/2/97	1	Classroo	103	Wall	Wall	Solid	Plaster	5.09
51	1912, 1924, 1931 bldg.	60	XRF	4/2/97	1	Classroo	103	Wall	Chair rail	Solid	Wood	0.41
52	1912, 1924, 1931 bldg.	61	XRF	4/2/97	1	Classroo	103	Wall	Wall	Solid	Plaster	0.33
53	1912, 1924, 1931 bldg.	62	XRF	4/2/97	1	Classroo	103	Window	Casing	Solid	Wood	0.08
54	1912, 1924, 1931 bldg.	63	XRF	4/2/97	1	Classroo	103	Window	Stool	Solid	Concrete	0.03
55	1912, 1924, 1931 bldg.	64	XRF	4/2/97	1	Classroo	103	Door	Door	Solid	Wood	0.08
56	1912, 1924, 1931 bldg.	65	XRF	4/2/97	1	Classroo	103	Door	Jamb	Solid	Wood	0.05
57	1912, 1924, 1931 bldg.	66	XRF	4/2/97	1	Classroo	103	Cabinet	Inside	Solid	Wood	0.1
58	1912, 1924, 1931 bldg.	67	XRF	4/2/97	1	Classroo	103	Cabinet	Door	Solid	Wood	0
59	1912, 1924, 1931 bldg.	68	XRF	4/2/97	1	Classroo	103	Closet	Wall	Solid	Concrete	0.14
60	1912, 1924, 1931 bldg.	69	XRF	4/2/97	1	Classroo	103	Ceiling		Solid	Concrete	0.03
61	1912, 1924, 1931 bldg.	70	XRF	4/2/97	1	Classroo	103	Chalkboard	Ledge	Solid	Wood	0.08
62	1912, 1924, 1931 bldg.	71	XRF	4/2/97	1	Classroo	103	Chalkboard	Sash	Solid	Wood	0.03
63	1912, 1924, 1931 bldg.	11	XRF	4/3/97	1	Classroo	103	Ceiling		Solid	Plaster	0.08
64	1912, 1924, 1931 bldg.	99	XRF	4/2/97	1	Classroo	107	Wall	Baseboar	Solid	Wood	0.05

Saint Paul Public Schools
 Groveland Park Elementary School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	No	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	PbL
65	1912, 1924, 1931 bldg.	100	XRF	4/2/97	1	Classroo	107	Wall	Wall	Solid	Plaster	4.5
66	1912, 1924, 1931 bldg.	101	XRF	4/2/97	1	Classroo	107	Wall	Wall	Solid	Plaster	5.09
67	1912, 1924, 1931 bldg.	102	XRF	4/2/97	1	Classroo	107	Window	Casing	Solid	Wood	0.12
68	1912, 1924, 1931 bldg.	103	XRF	4/2/97	1	Classroo	107	Door	Jamb	Solid	Wood	0.05
69	1912, 1924, 1931 bldg.	104	XRF	4/2/97	1	Classroo	107	Door	Door	Solid	Wood	0.09
70	1912, 1924, 1931 bldg.	105	XRF	4/2/97	1	Classroo	107	Closet	Wall	Solid	Plaster	5.09
71	1912, 1924, 1931 bldg.	106	XRF	4/2/97	1	Classroo	107	Ceiling		Solid	Plaster	0.09
72	1912, 1924, 1931 bldg.	107	XRF	4/2/97	1	Classroo	107	Cabinet	Door	Solid	Wood	0.03
73	1912, 1924, 1931 bldg.	108	XRF	4/2/97	1	Classroo	107	Cabnet	Outside	Solid	Wood	0
74	1912, 1924, 1931 bldg.	109	XRF	4/2/97	1	Classroo	107	Chalkboard	Ledge	Solid	Wood	0
75	1912, 1924, 1931 bldg.	110	XRF	4/2/97	1	Classroo	107	Chalkboard	Sash	Solid	Wood	0
76	1912, 1924, 1931 bldg.	9	XRF	4/3/97	1	Classroo	107	Ceiling		Solid	Plaster	0.16
77	1912, 1924, 1931 bldg.	10	XRF	4/3/97	1	Classroo	107	Ceiling	Radiator	Solid	Metal	0.53
78	1912, 1924, 1931 bldg.	111	XRF	4/2/97	1	Classroo	113	Wall	Wall	Solid	Plaster	5.09
79	1912, 1924, 1931 bldg.	112	XRF	4/2/97	1	Classroo	113	Wall	Wall	Solid	Plaster	3.14
80	1912, 1924, 1931 bldg.	113	XRF	4/2/97	1	Classroo	113	Window	Casing	Solid	Wood	0.04
81	1912, 1924, 1931 bldg.	114	XRF	4/2/97	1	Classroo	113	Window	Radiator	Peeling	Metal	5.09
82	1912, 1924, 1931 bldg.	115	XRF	4/2/97	1	Classroo	113	Panel	Radiator	Solid	Wood	0
83	1912, 1924, 1931 bldg.	116	XRF	4/2/97	1	Classroo	113	Door	Casing	Solid	Wood	0.04
84	1912, 1924, 1931 bldg.	117	XRF	4/2/97	1	Classroo	113	Door	Door	Solid	Wood	0.01
85	1912, 1924, 1931 bldg.	118	XRF	4/2/97	1	Classroo	113	Door	Door	Solid	Wood	0.52
86	1912, 1924, 1931 bldg.	119	XRF	4/2/97	1	Classroo	113	Wall	Wall	Solid	Concrete	3.66
87	1912, 1924, 1931 bldg.	120	XRF	4/2/97	1	Classroo	113	Wall	Chair rail	Solid	Wood	0.04
88	1912, 1924, 1931 bldg.	121	XRF	4/2/97	1	Classroo	113	Wall	Wall	Solid	Plaster	0.26
89	1912, 1924, 1931 bldg.	122	XRF	4/2/97	1	Classroo	113	Wall	Baseboar	Solid	Concrete	0.49
90	1912, 1924, 1931 bldg.	123	XRF	4/2/97	1	Classroo	113	Wall	Wall	Solid	Tile	5.09
91	1912, 1924, 1931 bldg.	124	XRF	4/2/97	1	Classroo	113	Pipe		Peeling	Metal	0
92	1912, 1924, 1931 bldg.	125	XRF	4/2/97	1	Classroo	113	Bookcase	Shelf	Solid	Wood	0.11
93	1912, 1924, 1931 bldg.	126	XRF	4/2/97	1	Classroo	113	Closet	Wall	Solid	Plaster	5.09
94	1912, 1924, 1931 bldg.	8	XRF	4/3/97	1	Classroo	113	Ceiling		Solid	Plaster	0.05
95	1912, 1924, 1931 bldg.	103	XRF	4/3/97	2	Classroo	201	Ceiling		Solid	Plaster	0.25
96	1912, 1924, 1931 bldg.	104	XRF	4/3/97	2	Classroo	201	Floor		Solid	Wood	0
97	1912, 1924, 1931 bldg.	105	XRF	4/3/97	2	Classroo	201	Wall	Baseboar	Solid	Metal	1.15
98	1912, 1924, 1931 bldg.	106	XRF	4/3/97	2	Classroo	201	Wall	Wall	Solid	Plaster	0.01
99	1912, 1924, 1931 bldg.	107	XRF	4/3/97	2	Classroo	201	Wall	Wall	Solid	Stucco	0.08
100	1912, 1924, 1931 bldg.	108	XRF	4/3/97	2	Classroo	201	Chalk Board	Ledge	Peeling	Wood	0.09
101	1912, 1924, 1931 bldg.	109	XRF	4/3/97	2	Classroo	201	Chalk Board	Sash	Solid	Wood	0.05
102	1912, 1924, 1931 bldg.	110	XRF	4/3/97	2	Classroo	201	Window	Casing	Solid	Wood	0.08
103	1912, 1924, 1931 bldg.	111	XRF	4/3/97	2	Classroo	201	Door	Jamb	Solid	Wood	0.04
104	1912, 1924, 1931 bldg.	112	XRF	4/3/97	2	Classroo	201	Door	Door	Solid	Wood	0.04
105	1912, 1924, 1931 bldg.	113	XRF	4/3/97	2	Classroo	201	Cabinet	Door	Solid	Wood	0.03
106	1912, 1924, 1931 bldg.	114	XRF	4/3/97	2	Classroo	201	Panel	Radiator	Solid	Wood	0
107	1912, 1924, 1931 bldg.	115	XRF	4/3/97	2	Classroo	201		Radiator	Solid	Metal	0.09
108	1912, 1924, 1931 bldg.	116	XRF	4/3/97	2	Classroo	201	Univent		Solid	Metal	1.09
109	1912, 1924, 1931 bldg.	143	XRF	4/3/97	2	Classroo	202	Floor		Solid	Wood	0.01
110	1912, 1924, 1931 bldg.	144	XRF	4/3/97	2	Classroo	202	Wall	Baseboar	Solid	Wood	0.06
111	1912, 1924, 1931 bldg.	145	XRF	4/3/97	2	Classroo	202	Wall	Wall	Solid	Plaster	5.09
112	1912, 1924, 1931 bldg.	146	XRF	4/3/97	2	Classroo	202	Window	Casing	Solid	Wood	0.14
113	1912, 1924, 1931 bldg.	147	XRF	4/3/97	2	Classroo	202	Door	Jamb	Solid	Wood	0.05
114	1912, 1924, 1931 bldg.	148	XRF	4/3/97	2	Classroo	202	Door	Door	Solid	Wood	0.03
115	1912, 1924, 1931 bldg.	149	XRF	4/3/97	2	Classroo	202	Chalk Board	Ledge	Solid	Wood	0.02
116	1912, 1924, 1931 bldg.	150	XRF	4/3/97	2	Classroo	202	Chalk Board	Sash	Solid	Wood	0.07
117	1912, 1924, 1931 bldg.	151	XRF	4/3/97	2	Classroo	202		Radiator	Peeling	Metal	5.09
118	1912, 1924, 1931 bldg.	152	XRF	4/3/97	2	Classroo	202	Panel	Radiator	Solid	Wood	0
119	1912, 1924, 1931 bldg.	153	XRF	4/3/97	2	Classroo	202	Coat Rack		Solid	Wood	0
120	1912, 1924, 1931 bldg.	154	XRF	4/3/97	2	Classroo	202	Closet	Wall	Solid	Plaster	5.09
121	1912, 1924, 1931 bldg.	155	XRF	4/3/97	2	Classroo	202	Ceiling		Solid	Plaster	0.69
122	1912, 1924, 1931 bldg.	91	XRF	4/3/97	2	Classroo	203	Floor		Solid	Wood	0
123	1912, 1924, 1931 bldg.	92	XRF	4/3/97	2	Classroo	203	Wall	Baseboar	Solid	Metal	0.72
124	1912, 1924, 1931 bldg.	93	XRF	4/3/97	2	Classroo	203	Wall	Wall	Solid	Plaster	0.69
125	1912, 1924, 1931 bldg.	94	XRF	4/3/97	2	Classroo	203	Wall	Wall	Solid	Plaster	0.2
126	1912, 1924, 1931 bldg.	95	XRF	4/3/97	2	Classroo	203	Window	Casing	Solid	Wood	0.06
127	1912, 1924, 1931 bldg.	96	XRF	4/3/97	2	Classroo	203	Door	Jamb	Solid	Metal	0.01

Saint Paul Public Schools
 Groveland Park Elementary School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	No	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Pbl
128	1912, 1924, 1931 bldg.	97	XRF	4/3/97	2	Classroo	203	Door	Door	Solid	Wood	0
129	1912, 1924, 1931 bldg.	98	XRF	4/3/97	2	Classroo	203	Chalk Board	Ledge	Solid	Wood	0.12
130	1912, 1924, 1931 bldg.	99	XRF	4/3/97	2	Classroo	203	Chalk Board	Sash	Solid	Wood	0.02
131	1912, 1924, 1931 bldg.	100	XRF	4/3/97	2	Classroo	203	Cabinet	Shelf	Solid	Wood	0.02
132	1912, 1924, 1931 bldg.	101	XRF	4/3/97	2	Classroo	203	Cabinet	Radiator	Solid	Metal	0.03
133	1912, 1924, 1931 bldg.	102	XRF	4/3/97	2	Classroo	203	Ceiling		Solid	Plaster	0.23
134	1912, 1924, 1931 bldg.	130	XRF	4/3/97	2	Classroo	205	Ceiling		Solid	Plaster	0.75
135	1912, 1924, 1931 bldg.	131	XRF	4/3/97	2	Classroo	205	Floor		Solid	Wood	0
136	1912, 1924, 1931 bldg.	132	XRF	4/3/97	2	Classroo	205	Wall	Baseboar	Solid	Wood	0.03
137	1912, 1924, 1931 bldg.	133	XRF	4/3/97	2	Classroo	205	Wall	Wall	Solid	Plaster	5.09
138	1912, 1924, 1931 bldg.	134	XRF	4/3/97	2	Classroo	205	Window	Casing	Solid	Wood	0.06
139	1912, 1924, 1931 bldg.	135	XRF	4/3/97	2	Classroo	205	Window	Casing	Solid	Wood	0.2
140	1912, 1924, 1931 bldg.	136	XRF	4/3/97	2	Classroo	205	Door	Casing	Solid	Wood	0.06
141	1912, 1924, 1931 bldg.	137	XRF	4/3/97	2	Classroo	205	Door	Door	Solid	Wood	0.03
142	1912, 1924, 1931 bldg.	138	XRF	4/3/97	2	Classroo	205	Cabinet	Door	Solid	Wood	0.04
143	1912, 1924, 1931 bldg.	139	XRF	4/3/97	2	Classroo	205	Chalk Board	Ledge	Solid	Wood	0.04
144	1912, 1924, 1931 bldg.	140	XRF	4/3/97	2	Classroo	205	Chalk Board	Sash	Solid	Wood	0.06
145	1912, 1924, 1931 bldg.	141	XRF	4/3/97	2	Classroo	205		Radiator	Solid	Metal	5.09
146	1912, 1924, 1931 bldg.	142	XRF	4/3/97	2	Classroo	205	Closet	Wall	Solid	Plaster	0.98
147	1912, 1924, 1931 bldg.	179	XRF	4/3/97	2	Classroo	206	Ceiling		Solid	Plaster	0.47
148	1912, 1924, 1931 bldg.	180	XRF	4/3/97	2	Classroo	206	Floor		Solid	Wood	0
149	1912, 1924, 1931 bldg.	181	XRF	4/3/97	2	Classroo	206	Wall	Baseboar	Solid	Wood	0.02
150	1912, 1924, 1931 bldg.	182	XRF	4/3/97	2	Classroo	206	Chalk Board	Ledge	Peeling	Wood	0.05
151	1912, 1924, 1931 bldg.	183	XRF	4/3/97	2	Classroo	206	Chalk Board	Sash	Solid	Wood	0.03
152	1912, 1924, 1931 bldg.	184	XRF	4/3/97	2	Classroo	206	Bookcase	Shelf	Solid	Wood	0.02
153	1912, 1924, 1931 bldg.	185	XRF	4/3/97	2	Classroo	206	Door	Jamb	Solid	Wood	0.03
154	1912, 1924, 1931 bldg.	186	XRF	4/3/97	2	Classroo	206	Door	Door	Solid	Wood	0.01
155	1912, 1924, 1931 bldg.	187	XRF	4/3/97	2	Classroo	206	Window	Casing	Solid	Wood	0.08
156	1912, 1924, 1931 bldg.	188	XRF	4/3/97	2	Classroo	206	Panel	Radiator	Solid	Wood	0
157	1912, 1924, 1931 bldg.	167	XRF	4/3/97	2	Classroo	207	Floor		Solid	Wood	0.01
158	1912, 1924, 1931 bldg.	168	XRF	4/3/97	2	Classroo	207	Wall	Baseboar	Solid	Wood	0.02
159	1912, 1924, 1931 bldg.	169	XRF	4/3/97	2	Classroo	207	Chalk Board	Ledge	Peeling	Wood	0.04
160	1912, 1924, 1931 bldg.	170	XRF	4/3/97	2	Classroo	207	Chalk Board	Sash	Solid	Wood	0.03
161	1912, 1924, 1931 bldg.	171	XRF	4/3/97	2	Classroo	207	Door	Jamb	Solid	Wood	0.02
162	1912, 1924, 1931 bldg.	172	XRF	4/3/97	2	Classroo	207	Door	Door	Solid	Wood	0.02
163	1912, 1924, 1931 bldg.	173	XRF	4/3/97	2	Classroo	207	Window	Casing	Solid	Wood	0.22
164	1912, 1924, 1931 bldg.	174	XRF	4/3/97	2	Classroo	207	Window	Radiator	Solid	Metal	4.42
165	1912, 1924, 1931 bldg.	175	XRF	4/3/97	2	Classroo	207	Panel	Radiator	Solid	Wood	0
166	1912, 1924, 1931 bldg.	176	XRF	4/3/97	2	Classroo	207	Cabinet	Outside	Solid	Wood	0.03
167	1912, 1924, 1931 bldg.	177	XRF	4/3/97	2	Classroo	207	Closet	Wall	Solid	Plaster	2.75
168	1912, 1924, 1931 bldg.	178	XRF	4/3/97	2	Classroo	207	Ceiling		Solid	Plaster	0.91
169	1912, 1924, 1931 bldg.	51	XRF	4/9/97	2	Classroo	208	Floor		Solid	Wood	0.01
170	1912, 1924, 1931 bldg.	52	XRF	4/9/97	2	Classroo	208	Wall	Baseboar	Solid	Wood	0.05
171	1912, 1924, 1931 bldg.	53	XRF	4/9/97	2	Classroo	208	Wall	Wall	Solid	Plaster	0.14
172	1912, 1924, 1931 bldg.	54	XRF	4/9/97	2	Classroo	208	Wall	Wall	Solid	Plaster	0.28
173	1912, 1924, 1931 bldg.	55	XRF	4/9/97	2	Classroo	208	Ceiling		Solid	Plaster	0.31
174	1912, 1924, 1931 bldg.	56	XRF	4/9/97	2	Classroo	208	Window	Casing	Solid	Wood	0.09
175	1912, 1924, 1931 bldg.	57	XRF	4/9/97	2	Classroo	208	Door	Casing	Solid	Metal	0.01
176	1912, 1924, 1931 bldg.	58	XRF	4/9/97	2	Classroo	208	Door	Door	Solid	Wood	0
177	1912, 1924, 1931 bldg.	59	XRF	4/9/97	2	Classroo	208		Radiator	Cracked	Metal	4.16
178	1912, 1924, 1931 bldg.	60	XRF	4/9/97	2	Classroo	208	Panel	Radiator	Solid	Wood	0.02
179	1912, 1924, 1931 bldg.	61	XRF	4/9/97	2	Classroo	208	Chalk Board	Ledge	Solid	Wood	0.07
180	1912, 1924, 1931 bldg.	62	XRF	4/9/97	2	Classroo	208	Chalk Board	Sash	Solid	Wood	0.05
181	1912, 1924, 1931 bldg.	63	XRF	4/9/97	2	Classroo	208	Cabinet	Door	Solid	Wood	0.03
182	1912, 1924, 1931 bldg.	64	XRF	4/9/97	2	Classroo	208	Cabinet	Floor	Solid	Wood	0.02
183	1912, 1924, 1931 bldg.	6	XRF	4/9/97	1	Classroo	209	Wall	Baseboar	Solid	Wood	0.15
184	1912, 1924, 1931 bldg.	7	XRF	4/9/97	1	Classroo	209	Wall	Wall	Solid	Plaster	5.09
185	1912, 1924, 1931 bldg.	8	XRF	4/9/97	1	Classroo	209	Chalk Board	Ledge	Solid	Wood	0.07
186	1912, 1924, 1931 bldg.	9	XRF	4/9/97	1	Classroo	209	Chalk Board	Sash	Solid	Wood	0.04
187	1912, 1924, 1931 bldg.	10	XRF	4/9/97	1	Classroo	209	Wall	Wall	Solid	Plaster	0.89
188	1912, 1924, 1931 bldg.	11	XRF	4/9/97	1	Classroo	209	Ceiling		Solid	Plaster	0.38
189	1912, 1924, 1931 bldg.	12	XRF	4/9/97	1	Classroo	209	Window	Casing	Solid	Wood	0.17
190	1912, 1924, 1931 bldg.	13	XRF	4/9/97	1	Classroo	209	Door	Casing	Solid	Wood	0.04

Saint Paul Public Schools
 Groveland Park Elementary School
 Lead-Based Paint Inspection

3	A	B	C	D	E	F	G	H	I	J	K	L
	Site	No	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	PbL
191	1912, 1924, 1931 bldg.	14	XRF	4/9/97	1	Classroo	209	Door	Door	Solid	Wood	0.04
192	1912, 1924, 1931 bldg.	15	XRF	4/9/97	1	Classroo	209	Cabinet	Inside	Solid	Wood	0.06
193	1912, 1924, 1931 bldg.	16	XRF	4/9/97	1	Classroo	209	Cabinet	Door	Solid	Wood	0.03
194	1912, 1924, 1931 bldg.	17	XRF	4/9/97	1	Classroo	209	Cabinet	Radiator	Solid	Metal	5.09
195	1912, 1924, 1931 bldg.	18	XRF	4/9/97	1	Classroo	209	Tack Board		Solid	Wood	1.43
196	1912, 1924, 1931 bldg.	33	XRF	4/9/97	2	Classroo	210	Floor		Solid	Wood	0
197	1912, 1924, 1931 bldg.	34	XRF	4/9/97	2	Classroo	210	Wall	Baseboar	Solid	Wood	0.06
198	1912, 1924, 1931 bldg.	35	XRF	4/9/97	2	Classroo	210	Wall	Wall	Solid	Plaster	0.01
199	1912, 1924, 1931 bldg.	36	XRF	4/9/97	2	Classroo	210	Wall	Midle Wall	Solid	Plaster	3.73
200	1912, 1924, 1931 bldg.	37	XRF	4/9/97	2	Classroo	210	Ceiling		Solid	Plaster	0.17
201	1912, 1924, 1931 bldg.	38	XRF	4/9/97	2	Classroo	210	Window	Casing	Solid	Wood	0.17
202	1912, 1924, 1931 bldg.	39	XRF	4/9/97	2	Classroo	210	Door	Casing	Solid	Metal	0.03
203	1912, 1924, 1931 bldg.	40	XRF	4/9/97	2	Classroo	210	Door	Door	Solid	Wood	0.05
204	1912, 1924, 1931 bldg.	41	XRF	4/9/97	2	Classroo	210	Panel	Radiator	Solid	Wood	0
205	1912, 1924, 1931 bldg.	42	XRF	4/9/97	2	Classroo	210		Radiator	Cracked	Metal	5.09
206	1912, 1924, 1931 bldg.	43	XRF	4/9/97	2	Classroo	210	Cabinet	Outside	Solid	Wood	0.05
207	1912, 1924, 1931 bldg.	44	XRF	4/9/97	2	Classroo	210	Cabinet	Shelf	Solid	Wood	0.04
208	1912, 1924, 1931 bldg.	19	XRF	4/9/97	2	Classroo	211	Floor		Solid	Wood	0
209	1912, 1924, 1931 bldg.	20	XRF	4/9/97	2	Classroo	211	Wall	Baseboar	Solid	Wood	0.02
210	1912, 1924, 1931 bldg.	21	XRF	4/9/97	2	Classroo	211	Wall	Wall	Solid	Plaster	5.09
211	1912, 1924, 1931 bldg.	22	XRF	4/9/97	2	Classroo	211	Wall	Wall	Solid	Plaster	0.84
212	1912, 1924, 1931 bldg.	23	XRF	4/9/97	2	Classroo	211	Ceiling		Solid	Plaster	0.76
213	1912, 1924, 1931 bldg.	24	XRF	4/9/97	2	Classroo	211	Window	Casing	Solid	Wood	0.04
214	1912, 1924, 1931 bldg.	25	XRF	4/9/97	2	Classroo	211	Door	Casing	Solid	Wood	0.03
215	1912, 1924, 1931 bldg.	26	XRF	4/9/97	2	Classroo	211	Door	Door	Solid	Wood	0.04
216	1912, 1924, 1931 bldg.	27	XRF	4/9/97	2	Classroo	211	Chalk Board	Ledge	Solid	Wood	0.08
217	1912, 1924, 1931 bldg.	28	XRF	4/9/97	2	Classroo	211	Chalk Board	Sash	Solid	Wood	0.07
218	1912, 1924, 1931 bldg.	29	XRF	4/9/97	2	Classroo	211	Panel	Radiator	Solid	Wood	0.02
219	1912, 1924, 1931 bldg.	30	XRF	4/9/97	2	Classroo	211		Radiator	Peeling	Metal	5.09
220	1912, 1924, 1931 bldg.	31	XRF	4/9/97	2	Classroo	211	Duct		Peeling	Metal	4.27
221	1912, 1924, 1931 bldg.	32	XRF	4/9/97	2	Classroo	211	Cabinet	Door	Solid	Wood	0.03
222	1912, 1924, 1931 bldg.	110	XRF	4/9/97	3	Classroo	300	Wall	Wall	Solid	Plaster	0.07
223	1912, 1924, 1931 bldg.	111	XRF	4/9/97	3	Classroo	300	Wall	Chair rail	Solid	Wood	0.11
224	1912, 1924, 1931 bldg.	112	XRF	4/9/97	3	Classroo	300	Wall	Wall	Solid	Plaster	0.1
225	1912, 1924, 1931 bldg.	113	XRF	4/9/97	3	Classroo	300	Window	Casing	Solid	Wood	0.05
226	1912, 1924, 1931 bldg.	114	XRF	4/9/97	3	Classroo	300	Door	Casing	Solid	Wood	0.03
227	1912, 1924, 1931 bldg.	115	XRF	4/9/97	3	Classroo	300	Door	Door	Solid	Wood	0.03
228	1912, 1924, 1931 bldg.	116	XRF	4/9/97	3	Classroo	300	Door	Radiator	Solid	Metal	0.07
229	1912, 1924, 1931 bldg.	117	XRF	4/9/97	3	Classroo	300	Door	Locker	Solid	Metal	0.23
230	1912, 1924, 1931 bldg.	118	XRF	4/9/97	3	Classroo	300	Ceiling		Solid	Plaster	0.02
231	1912, 1924, 1931 bldg.	91	XRF	4/9/97	3	Classroo	301	Wall	Baseboar	Solid	Metal	1.22
232	1912, 1924, 1931 bldg.	92	XRF	4/9/97	3	Classroo	301	Wall	Wall	Solid	Plaster	0.06
233	1912, 1924, 1931 bldg.	93	XRF	4/9/97	3	Classroo	301	Wall	Wall	Solid	Drywall	0
234	1912, 1924, 1931 bldg.	94	XRF	4/9/97	3	Classroo	301	Ceiling		Solid	Plaster	0.64
235	1912, 1924, 1931 bldg.	95	XRF	4/9/97	3	Classroo	301	Window	Casing	Solid	Wood	0.11
236	1912, 1924, 1931 bldg.	96	XRF	4/9/97	3	Classroo	301	Door	Casing	Solid	Wood	0.05
237	1912, 1924, 1931 bldg.	97	XRF	4/9/97	3	Classroo	301	Door	Door	Solid	Wood	0.06
238	1912, 1924, 1931 bldg.	98	XRF	4/9/97	3	Classroo	301	Cabinet	Door	Solid	Wood	0.07
239	1912, 1924, 1931 bldg.	99	XRF	4/9/97	3	Classroo	301	Cabinet	Outside	Solid	Wood	0.03
240	1912, 1924, 1931 bldg.	100	XRF	4/9/97	3	Classroo	301	Chalk Board	Ledge	Solid	Wood	0.14
241	1912, 1924, 1931 bldg.	101	XRF	4/9/97	3	Classroo	301	Chalk Board	Sash	Solid	Wood	0.02
242	1912, 1924, 1931 bldg.	102	XRF	4/9/97	3	Classroo	301	Univent		Cracked	Metal	0.63
243	1912, 1924, 1931 bldg.	103	XRF	4/9/97	3	Classroo	301		Radiator	Cracked	Metal	0.53
244	1912, 1924, 1931 bldg.	131	XRF	4/9/97	3	Classroo	302	Floor		Solid	Wood	0
245	1912, 1924, 1931 bldg.	132	XRF	4/9/97	3	Classroo	302	Wall	Baseboar	Solid	Wood	0.06
246	1912, 1924, 1931 bldg.	133	XRF	4/9/97	3	Classroo	302	Wall	Wall	Solid	Plaster	0.05
247	1912, 1924, 1931 bldg.	134	XRF	4/9/97	3	Classroo	302	Wall	Wall	Solid	Plaster	0.47
248	1912, 1924, 1931 bldg.	135	XRF	4/9/97	3	Classroo	302	Ceiling		Solid	Plaster	1.01
249	1912, 1924, 1931 bldg.	136	XRF	4/9/97	3	Classroo	302	Window	Casing	Solid	Wood	0.17
250	1912, 1924, 1931 bldg.	137	XRF	4/9/97	3	Classroo	302	Door	Jamb	Solid	Wood	0.05
251	1912, 1924, 1931 bldg.	138	XRF	4/9/97	3	Classroo	302	Door	Door	Solid	Wood	0.04
252	1912, 1924, 1931 bldg.	139	XRF	4/9/97	3	Classroo	302	Chalk Board	Ledge	Solid	Wood	0.14
253	1912, 1924, 1931 bldg.	140	XRF	4/9/97	3	Classroo	302	Chalk Board	Sash	Solid	Wood	0.03

Saint Paul Public Schools
 Groveland Park Elementary School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	No	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	PbL
254	1912, 1924, 1931 bldg.	141	XRF	4/9/97	3	Classroo	302	Cabinet	Door	Solid	Wood	0.04
255	1912, 1924, 1931 bldg.	142	XRF	4/9/97	3	Classroo	302	Cabinet	Radiator	Cracked	Metal	2.34
256	1912, 1924, 1931 bldg.	119	XRF	4/9/97	3	Classroo	303	Wall	Wall	Solid	Plaster	0.99
257	1912, 1924, 1931 bldg.	120	XRF	4/9/97	3	Classroo	303	Wall	Wall	Solid	Drywall	0
258	1912, 1924, 1931 bldg.	121	XRF	4/9/97	3	Classroo	303	Wall	Baseboar	Solid	Metal	1.11
259	1912, 1924, 1931 bldg.	122	XRF	4/9/97	3	Classroo	303	Ceiling		Solid	Plaster	0.41
260	1912, 1924, 1931 bldg.	123	XRF	4/9/97	3	Classroo	303	Window	Casing	Solid	Wood	0.08
261	1912, 1924, 1931 bldg.	124	XRF	4/9/97	3	Classroo	303	Door	Jamb	Solid	Metal	0.11
262	1912, 1924, 1931 bldg.	125	XRF	4/9/97	3	Classroo	303	Door	Door	Solid	Wood	0
263	1912, 1924, 1931 bldg.	126	XRF	4/9/97	3	Classroo	303	Chalk Board	Ledge	Solid	Wood	0.07
264	1912, 1924, 1931 bldg.	127	XRF	4/9/97	3	Classroo	303	Chalk Board	Sash	Solid	Wood	0.07
265	1912, 1924, 1931 bldg.	128	XRF	4/9/97	3	Classroo	303	Cabinet	Door	Solid	Wood	0.04
266	1912, 1924, 1931 bldg.	129	XRF	4/9/97	3	Classroo	303	Cabinet	Inside	Solid	Wood	0.05
267	1912, 1924, 1931 bldg.	130	XRF	4/9/97	3	Classroo	303	Cabinet	Radiator	Peeling	Metal	0.76
268	1912, 1924, 1931 bldg.	143	XRF	4/9/97	3	Classroo	305	Floor		Solid	Wood	0
269	1912, 1924, 1931 bldg.	144	XRF	4/9/97	3	Classroo	305	Wall	Baseboar	Solid	Wood	0.02
270	1912, 1924, 1931 bldg.	145	XRF	4/9/97	3	Classroo	305	Ceiling		Solid	Plaster	1.04
271	1912, 1924, 1931 bldg.	146	XRF	4/9/97	3	Classroo	305	Window	Casing	Solid	Wood	0.08
272	1912, 1924, 1931 bldg.	147	XRF	4/9/97	3	Classroo	305	Door	Jamb	Solid	Wood	0.02
273	1912, 1924, 1931 bldg.	148	XRF	4/9/97	3	Classroo	305	Door	Door	Solid	Wood	0.04
274	1912, 1924, 1931 bldg.	149	XRF	4/9/97	3	Classroo	305	Chalk Board	Ledge	Solid	Wood	0.08
275	1912, 1924, 1931 bldg.	150	XRF	4/9/97	3	Classroo	305	Chalk Board	Sash	Solid	Wood	0
276	1912, 1924, 1931 bldg.	151	XRF	4/9/97	3	Classroo	305	Cabinet	Door	Solid	Wood	0.04
277	1912, 1924, 1931 bldg.	152	XRF	4/9/97	3	Classroo	305	Cabinet	Shelf	Solid	Wood	0.01
278	1912, 1924, 1931 bldg.	45	XRF	4/9/97	2	Hall	0	Wall	Wall	Solid	Plaster	2.07
279	1912, 1924, 1931 bldg.	46	XRF	4/9/97	2	Hall	0	Door	Crown mo	Solid	Wood	0.08
280	1912, 1924, 1931 bldg.	47	XRF	4/9/97	2	Hall	0	Ceiling		Solid	Plaster	0.01
281	1912, 1924, 1931 bldg.	48	XRF	4/9/97	2	Hall	0		Locker	Solid	Metal	0.93
282	1912, 1924, 1931 bldg.	49	XRF	4/9/97	2	Hall	0	Door	Door	Solid	Wood	0
283	1912, 1924, 1931 bldg.	50	XRF	4/9/97	2	Hall	0	Door	Jamb	Solid	Metal	0.01
284	1912, 1924, 1931 bldg.	15	XRF	4/3/97	1	Hall	1	Ceiling		Solid	Plaster	0.01
285	1912, 1924, 1931 bldg.	16	XRF	4/3/97	1	Hall	1	Ceiling		Solid	Metal	1.87
286	1912, 1924, 1931 bldg.	19	XRF	4/3/97	1	Hall	1	Wall	Wall	Solid	Plaster	0.16
287	1912, 1924, 1931 bldg.	20	XRF	4/3/97	1	Hall	1	Wall	Chair rail	Solid	Wood	0.08
288	1912, 1924, 1931 bldg.	21	XRF	4/3/97	1	Hall	1	Wall	Wall	Solid	Tile	2.58
289	1912, 1924, 1931 bldg.	22	XRF	4/3/97	1	Hall	1	Wall	Baseboar	Peeling	Concrete	0.07
290	1912, 1924, 1931 bldg.	23	XRF	4/3/97	1	Hall	1	Door	Door	Solid	Wood	0.07
291	1912, 1924, 1931 bldg.	24	XRF	4/3/97	1	Hall	1	Door	Jamb	Solid	Wood	0.05
292	1912, 1924, 1931 bldg.	25	XRF	4/3/97	1	Hall	1	Wall	Wall Rgstr	Solid	Metal	0
293	1912, 1924, 1931 bldg.	26	XRF	4/3/97	1	Hall	1	Door	Door	Solid	Metal	5.09
294	1912, 1924, 1931 bldg.	27	XRF	4/3/97	1	Hall	1	Wall	Wall	Solid	Tile	0.2
295	1912, 1924, 1931 bldg.	28	XRF	4/3/97	1	Hall	1	Door	Door	Solid	Metal	5.09
296	1912, 1924, 1931 bldg.	29	XRF	4/3/97	1	Hall	1	Door	Jamb	Solid	Metal	5.09
297	1912, 1924, 1931 bldg.	30	XRF	4/3/97	1	Hall	1	Door	Door	Solid	Wood	0.03
298	1912, 1924, 1931 bldg.	31	XRF	4/3/97	1	Hall	1	Stairs	Tread	Solid	Concrete	0.02
299	1912, 1924, 1931 bldg.	32	XRF	4/3/97	1	Hall	1	Stairs	Hand rail	Solid	Wood	0.01
300	1912, 1924, 1931 bldg.	33	XRF	4/3/97	1	Hall	1	Cabinet	Door	Solid	Wood	0.08
301	1912, 1924, 1931 bldg.	56	XRF	4/3/97	2	Hall	2	Wall	Wall	Solid	Tile	2.51
302	1912, 1924, 1931 bldg.	57	XRF	4/3/97	2	Hall	2	Wall	Chair rail	Solid	Wood	0.05
303	1912, 1924, 1931 bldg.	58	XRF	4/3/97	2	Hall	2	Ceiling		Solid	Plaster	0.04
304	1912, 1924, 1931 bldg.	59	XRF	4/3/97	2	Hall	2	Door	Door	Solid	Metal	1.71
305	1912, 1924, 1931 bldg.	60	XRF	4/3/97	2	Hall	2	Door	Door	Solid	Wood	0
306	1912, 1924, 1931 bldg.	61	XRF	4/3/97	2	Hall	2	Door	Casing	Solid	Metal	0.01
307	1912, 1924, 1931 bldg.	62	XRF	4/3/97	2	Hall	2	Wall	Wall	Solid	Metal	0.99
308	1912, 1924, 1931 bldg.	63	XRF	4/3/97	2	Hall	2	Wall	Wall	Solid	Plaster	0.07
309	1912, 1924, 1931 bldg.	64	XRF	4/3/97	2	Hall	2	Wall	Locker	Solid	Metal	0.91
310	1912, 1924, 1931 bldg.	73	XRF	4/3/97	2	Hall	2	Closet	Peeling	Concrete	0.01	
311	1912, 1924, 1931 bldg.	74	XRF	4/3/97	2	Hall	2	Closet	Wall	Solid	Plaster	5.09
312	1912, 1924, 1931 bldg.	75	XRF	4/3/97	2	Hall	2	Closet	Shelf	Solid	Wood	3.94
313	1912, 1924, 1931 bldg.	76	XRF	4/3/97	2	Hall	2	Bulletin Board	Sash	Solid	Wood	0.01
314	1912, 1924, 1931 bldg.	77	XRF	4/3/97	2	Hall	2		Radiator	Solid	Metal	0.15
315	1912, 1924, 1931 bldg.	78	XRF	4/3/97	2	Hall	2	Door	Door	Solid	Wood	0.04
316	1912, 1924, 1931 bldg.	79	XRF	4/3/97	2	Hall	2	Door	Jamb	Solid	Wood	0.02

Saint Paul Public Schools
 Groveland Park Elementary School
 Lead-Based Paint Inspection

3	A	B	C	D	E	F	G	H	I	J	K	L
	Site	No	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	PbL
317	1912, 1924, 1931 bldg.	80	XRF	4/3/97	2	Hall	2	Stairs	Hand rail	Peeling	Metal	0.04
318	1912, 1924, 1931 bldg.	81	XRF	4/3/97	2	Hall	2	Door	Door	Solid	Metal	5.09
319	1912, 1924, 1931 bldg.	82	XRF	4/3/97	2	Hall	2	Door	Jamb	Solid	Metal	5.09
320	1912, 1924, 1931 bldg.	189	XRF	4/3/97	2	Hall	3	Wall	Wall	Solid	Drywall	0
321	1912, 1924, 1931 bldg.	190	XRF	4/3/97	2	Hall	3	Wall	Wall	Solid	Concrete	0.01
322	1912, 1924, 1931 bldg.	191	XRF	4/3/97	2	Hall	3	Wall	Wall	Solid	Plaster	5.09
323	1912, 1924, 1931 bldg.	192	XRF	4/3/97	2	Hall	3	Wall	Baseboard	Solid	Wood	0.03
324	1912, 1924, 1931 bldg.	193	XRF	4/3/97	2	Hall	3	Door	Door	Solid	Wood	0
325	1912, 1924, 1931 bldg.	194	XRF	4/3/97	2	Hall	3	Door	Jamb	Solid	Metal	0
326	1912, 1924, 1931 bldg.	195	XRF	4/3/97	2	Hall	3	Door	Door	Solid	Metal	0
327	1912, 1924, 1931 bldg.	196	XRF	4/3/97	2	Hall	3	Door	Jamb	Solid	Metal	0.01
328	1912, 1924, 1931 bldg.	197	XRF	4/3/97	2	Hall	3	Window	Panel	Solid	Wood	0
329	1912, 1924, 1931 bldg.	198	XRF	4/3/97	2	Hall	3	Ceiling		Solid	Plaster	0.39
330	1912, 1924, 1931 bldg.	199	XRF	4/3/97	2	Hall	3	Ceiling		Solid	Plaster	0
331	1912, 1924, 1931 bldg.	81	XRF	4/9/97	3	Hall	4	Wall	Wall	Solid	Plaster	5.09
332	1912, 1924, 1931 bldg.	82	XRF	4/9/97	3	Hall	4	Wall	Chair rail	Solid	Wood	0.04
333	1912, 1924, 1931 bldg.	83	XRF	4/9/97	3	Hall	4	Wall	Wall	Solid	Plaster	0.09
334	1912, 1924, 1931 bldg.	84	XRF	4/9/97	3	Hall	4	Ceiling		Solid	Plaster	0
335	1912, 1924, 1931 bldg.	85	XRF	4/9/97	3	Hall	4	Door	Door	Solid	Wood	0.04
336	1912, 1924, 1931 bldg.	86	XRF	4/9/97	3	Hall	4	Door	Jamb	Solid	Wood	0.03
337	1912, 1924, 1931 bldg.	87	XRF	4/9/97	3	Hall	4	Wall	Midle Wall	Solid	Tile	0.02
338	1912, 1924, 1931 bldg.	88	XRF	4/9/97	3	Hall	4	Door	Door	Solid	Wood	0.01
339	1912, 1924, 1931 bldg.	89	XRF	4/9/97	3	Hall	4	Door	Jamb	Solid	Metal	0
340	1912, 1924, 1931 bldg.	90	XRF	4/9/97	3	Hall	4	Door	Locker	Solid	Metal	0.48
341	1912, 1924, 1931 bldg.	97	XRF	4/11/97	3	Hall	4	Wall	Chair rail	Solid	Wood	0.01
342	1912, 1924, 1931 bldg.	98	XRF	4/11/97	3	Hall	4	Window	Casing	Solid	Wood	0.01
343	1912, 1924, 1931 bldg.	99	XRF	4/11/97	3	Hall	4	Ceiling		Solid	Plaster	0.01
344	1912, 1924, 1931 bldg.	144	XRF	4/11/97	3	Hall	4	Closet	Wall	Solid	Plaster	0.34
345	1912, 1924, 1931 bldg.	145	XRF	4/11/97	3	Hall	4	Closet		Peeling	Concrete	0.08
346	1912, 1924, 1931 bldg.	150	XRF	4/11/97	3	Hall	5	Wall	Wall	Solid	Plaster	3.33
347	1912, 1924, 1931 bldg.	151	XRF	4/11/97	3	Hall	5	Wall	Midle Wall	Solid	Drywall	0
348	1912, 1924, 1931 bldg.	152	XRF	4/11/97	3	Hall	5	Wall	Baseboard	Solid	Wood	0.02
349	1912, 1924, 1931 bldg.	153	XRF	4/11/97	3	Hall	5	Floor		Solid	Wood	0
350	1912, 1924, 1931 bldg.	154	XRF	4/11/97	3	Hall	5	Wall	Wall	Solid	Concrete	0.01
351	1912, 1924, 1931 bldg.	155	XRF	4/11/97	3	Hall	5	Door	Door	Solid	Wood	0
352	1912, 1924, 1931 bldg.	156	XRF	4/11/97	3	Hall	5	Door	Jamb	Solid	Metal	0
353	1912, 1924, 1931 bldg.	157	XRF	4/11/97	3	Hall	5	Door	Door	Solid	Metal	0.01
354	1912, 1924, 1931 bldg.	12	XRF	4/12/97	3	Hall	5	Ceiling		Solid	Plaster	0.45
355	1912, 1924, 1931 bldg.	158	XRF	4/11/97	3	Hall	6	Wall	Wall	Solid	Plaster	0.02
356	1912, 1924, 1931 bldg.	159	XRF	4/11/97	3	Hall	6	Wall	Midle Wall	Solid	Concrete	0.01
357	1912, 1924, 1931 bldg.	160	XRF	4/11/97	3	Hall	6	Floor		Solid	Wood	0
358	1912, 1924, 1931 bldg.	161	XRF	4/11/97	3	Hall	6	Closet	Wall	Solid	Drywall	0.01
359	1912, 1924, 1931 bldg.	162	XRF	4/11/97	3	Hall	6	Closet	Wall	Solid	Plaster	0
360	1912, 1924, 1931 bldg.	163	XRF	4/11/97	3	Hall	6	Door	Door	Solid	Metal	0.02
361	1912, 1924, 1931 bldg.	164	XRF	4/11/97	3	Hall	6	Door	Jamb	Solid	Wood	0
362	1912, 1924, 1931 bldg.	88	XRF	4/2/97	1	Kitchen	0	Wall	Baseboard	Solid	Wood	0.06
363	1912, 1924, 1931 bldg.	89	XRF	4/2/97	1	Kitchen	0	Wall	Wall	Peeling	Plaster	0.04
364	1912, 1924, 1931 bldg.	90	XRF	4/2/97	1	Kitchen	0	Wall	Wall	Solid	Plaster	0.02
365	1912, 1924, 1931 bldg.	91	XRF	4/2/97	1	Kitchen	0	Wall	Wall	Peeling	Plaster	0
366	1912, 1924, 1931 bldg.	92	XRF	4/2/97	1	Kitchen	0	Wall	Wall	Solid	Concrete	0
367	1912, 1924, 1931 bldg.	93	XRF	4/2/97	1	Kitchen	0	Window	Casing	Solid	Wood	0.15
368	1912, 1924, 1931 bldg.	94	XRF	4/2/97	1	Kitchen	0	Door	Casing	Solid	Wood	0.07
369	1912, 1924, 1931 bldg.	95	XRF	4/2/97	1	Kitchen	0	Closet	Wall	Solid	Plaster	3.36
370	1912, 1924, 1931 bldg.	96	XRF	4/2/97	1	Kitchen	0	Cabinet	Door	Solid	Wood	0.03
371	1912, 1924, 1931 bldg.	97	XRF	4/2/97	1	Kitchen	0	Door	Door	Solid	Wood	0.12
372	1912, 1924, 1931 bldg.	98	XRF	4/2/97	1	Kitchen	0	Wall	Midle Wall	Solid	Plaster	5.09
373	1912, 1924, 1931 bldg.	13	XRF	4/3/97	1	Kitchen	0	Ceiling		Solid	Plaster	0.16
374	1912, 1924, 1931 bldg.	127	XRF	4/2/97	1	Library	0	Wall	Baseboard	Solid	Wood	0.04
375	1912, 1924, 1931 bldg.	128	XRF	4/2/97	1	Library	0	Wall	Wall	Solid	Plaster	0.03
376	1912, 1924, 1931 bldg.	129	XRF	4/2/97	1	Library	0	Wall	Wall	Solid	Plaster	2.77
377	1912, 1924, 1931 bldg.	130	XRF	4/2/97	1	Library	0	Wall	Wall	Solid	Plaster	2.67
378	1912, 1924, 1931 bldg.	131	XRF	4/2/97	1	Library	0	Door	Door	Cracked	Wood	0.08
379	1912, 1924, 1931 bldg.	132	XRF	4/2/97	1	Library	0	Door	Jamb	Solid	Wood	0.18

Saint Paul Public Schools
 Groveland Park Elementary School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	No	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	PbL
380	1912, 1924, 1931 bldg.	133	XRF	4/2/97	1	Library	0	Door	Door	Solid	Metal	0
381	1912, 1924, 1931 bldg.	134	XRF	4/2/97	1	Library	0	Door	Casing	Solid	Metal	0.03
382	1912, 1924, 1931 bldg.	135	XRF	4/2/97	1	Library	0	Closet	Wall	Solid	Concrete	0
383	1912, 1924, 1931 bldg.	136	XRF	4/2/97	1	Library	0	Ceiling		Solid	Plaster	0.17
384	1912, 1924, 1931 bldg.	137	XRF	4/2/97	1	Library	0	Door	Door	Solid	Wood	0.37
385	1912, 1924, 1931 bldg.	138	XRF	4/2/97	1	Library	0	Stairs	Rail cap	Solid	Wood	0
386	1912, 1924, 1931 bldg.	6	XRF	4/3/97	1	Library	0	Ceiling		Solid	Concrete	1.3
387	1912, 1924, 1931 bldg.	7	XRF	4/3/97	1	Library	0	Ceiling		Solid	Wood	0.08
388	1912, 1924, 1931 bldg.	40	XRF	4/2/97	1	Lunch Rm	1		Radiator	Peeling	Metal	0.8
389	1912, 1924, 1931 bldg.	41	XRF	4/2/97	1	Lunch Rm	1	Closet	Casing	Solid	Wood	0.03
390	1912, 1924, 1931 bldg.	42	XRF	4/2/97	1	Lunch Rm	1	Wall	Wall Rgstr	Solid	Metal	0.13
391	1912, 1924, 1931 bldg.	43	XRF	4/2/97	1	Lunch Rm	1	Door	Door	Solid	Wood	0.07
392	1912, 1924, 1931 bldg.	44	XRF	4/2/97	1	Lunch Rm	1	Stairs	Hand rail	Solid	Wood	0
393	1912, 1924, 1931 bldg.	45	XRF	4/2/97	1	Lunch Rm	1	Door	Door	Solid	Metal	0.34
394	1912, 1924, 1931 bldg.	46	XRF	4/2/97	1	Lunch Rm	1	Wall	Baseboard	Peeling	Concrete	0.27
395	1912, 1924, 1931 bldg.	47	XRF	4/2/97	1	Lunch Rm	1	Wall	Wall	Cracked	Plaster	0.84
396	1912, 1924, 1931 bldg.	48	XRF	4/2/97	1	Lunch Rm	1	Wall	Wall	Solid	Plaster	0.55
397	1912, 1924, 1931 bldg.	49	XRF	4/2/97	1	Lunch Rm	1	Ceiling		Cracked	Plaster	0.13
398	1912, 1924, 1931 bldg.	50	XRF	4/2/97	1	Lunch Rm	1	Window	Casing	Peeling	Wood	0.03
399	1912, 1924, 1931 bldg.	72	XRF	4/2/97	1	Other	1	Floor		Peeling	Concrete	5.09
400	1912, 1924, 1931 bldg.	73	XRF	4/2/97	1	Other	1	Wall	Wall	Solid	Concrete	0.05
401	1912, 1924, 1931 bldg.	74	XRF	4/2/97	1	Other	1	Door	Door	Solid	Metal	0.74
402	1912, 1924, 1931 bldg.	80	XRF	4/2/97	1	Other	1	Floor		Solid	Concrete	0
403	1912, 1924, 1931 bldg.	81	XRF	4/2/97	1	Other	1	Closet	Wall	Peeling	Concrete	0.01
404	1912, 1924, 1931 bldg.	82	XRF	4/2/97	1	Other	1	Ceiling		Peeling	Concrete	0.05
405	1912, 1924, 1931 bldg.	83	XRF	4/2/97	1	Other	1	Floor		Peeling	Concrete	0.04
406	1912, 1924, 1931 bldg.	84	XRF	4/2/97	1	Other	1	Closet	Wall	Solid	Concrete	0
407	1912, 1924, 1931 bldg.	85	XRF	4/2/97	1	Other	1	Stairs	Hand rail	Peeling	Metal	0.08
408	1912, 1924, 1931 bldg.	86	XRF	4/2/97	1	Other	1	Door	Jamb	Peeling	Wood	5.09
409	1912, 1924, 1931 bldg.	87	XRF	4/2/97	1	Other	1	Door	Door	Peeling	Metal	5.09
410	1912, 1924, 1931 bldg.	75	XRF	4/2/97	1	Other	2	Floor		Peeling	Concrete	0.05
411	1912, 1924, 1931 bldg.	76	XRF	4/2/97	1	Other	2	Wall	Wall	Peeling	Concrete	0.01
412	1912, 1924, 1931 bldg.	77	XRF	4/2/97	1	Other	2	Door	Door	Solid	Metal	0.02
413	1912, 1924, 1931 bldg.	78	XRF	4/2/97	1	Other	2	Door	Door	Cracked	Wood	5.09
414	1912, 1924, 1931 bldg.	79	XRF	4/2/97	1	Other	2	Door	Jamb	Solid	Wood	5.09
415	1912, 1924, 1931 bldg.	139	XRF	4/2/97	1	Other	3	Floor		Solid	Concrete	0.01
416	1912, 1924, 1931 bldg.	140	XRF	4/2/97	1	Other	3	Wall	Wall	Solid	Plaster	3.68
417	1912, 1924, 1931 bldg.	141	XRF	4/2/97	1	Other	3	Ceiling		Solid	Plaster	0.58
418	1912, 1924, 1931 bldg.	142	XRF	4/2/97	1	Other	3	Stairs	Hand rail	Solid	Wood	0.15
419	1912, 1924, 1931 bldg.	143	XRF	4/2/97	1	Other	3	Door	Door	Solid	Wood	0.11
420	1912, 1924, 1931 bldg.	65	XRF	4/9/97	2	Other	4	Wall	Wall	Solid	Concrete	0.09
421	1912, 1924, 1931 bldg.	66	XRF	4/9/97	2	Other	4	Ceiling		Peeling	Tile	0.19
422	1912, 1924, 1931 bldg.	67	XRF	4/9/97	2	Other	4	Door	Jamb	Solid	Metal	0.42
423	1912, 1924, 1931 bldg.	68	XRF	4/9/97	2	Other	4	Door	Door	Solid	Metal	0.63
424	1912, 1924, 1931 bldg.	69	XRF	4/9/97	2	Other	4	Duct		Peeling	Metal	0.13
425	1912, 1924, 1931 bldg.	20	XRF	4/11/97	1	Outside	0	Stairs	Hand rail	Solid	Metal	0.02
426	1912, 1924, 1931 bldg.	21	XRF	4/11/97	1	Outside	0	Wall	Wall	Cracked	Concrete	0
427	1912, 1924, 1931 bldg.	22	XRF	4/11/97	1	Outside	0	Wall	Wall	Cracked	Concrete	2.52
428	1912, 1924, 1931 bldg.	23	XRF	4/11/97	1	Outside	0	Wall	Wall	Cracked	Concrete	0
429	1912, 1924, 1931 bldg.	24	XRF	4/11/97	1	Outside	0	Wall	Wall	Cracked	Concrete	0
430	1912, 1924, 1931 bldg.	30	XRF	4/11/97	1	Outside	0	Picnic Table		Peeling	Metal	0.17
431	1912, 1924, 1931 bldg.	18	XRF	4/12/97	3	Outside	0	Door	Door	Peeling	Wood	2.62
432	1912, 1924, 1931 bldg.	19	XRF	4/12/97	3	Outside	0	Door	Jamb	Peeling	Wood	5.09
433	1912, 1924, 1931 bldg.	20	XRF	4/12/97	3	Outside	0	Stairs	Hand rail	Peeling	Metal	5.09
434	1912, 1924, 1931 bldg.	21	XRF	4/12/97	3	Outside	0	Door	Door	Peeling	Wood	0.01
435	1912, 1924, 1931 bldg.	22	XRF	4/12/97	3	Outside	0	Door	Header	Cracked	Wood	5.09
436	1912, 1924, 1931 bldg.	23	XRF	4/12/97	3	Outside	0	Window	Sill	Peeling	Metal	0.08
437	1912, 1924, 1931 bldg.	24	XRF	4/12/97	3	Outside	0	Flag Pole		Peeling	Metal	0.01
438	1912, 1924, 1931 bldg.	25	XRF	4/12/97	3	Outside	0	Door	Door	Peeling	Wood	3.98
439	1912, 1924, 1931 bldg.	26	XRF	4/12/97	3	Outside	0	Door	Jamb	Cracked	Wood	5.09
440	1912, 1924, 1931 bldg.	27	XRF	4/12/97	3	Outside	0	Stairs	Hand rail	Solid	Metal	0.08
441	1912, 1924, 1931 bldg.	33	XRF	4/12/97	3	Porch	0	Intake	Screen	Solid	Metal	0
442	1912, 1924, 1931 bldg.	34	XRF	4/12/97	3	Porch	0		Door	Peeling	Concrete	0.07

Saint Paul Public Schools
 Groveland Park Elementary School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	No	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	PbL
443	1912, 1924, 1931 bldg.	34	XRF	4/3/97	1	Restroom	1	Floor		Solid	Concrete	0.02
444	1912, 1924, 1931 bldg.	35	XRF	4/3/97	1	Restroom	1	Wall	Wall	Solid	Plaster	0.49
445	1912, 1924, 1931 bldg.	36	XRF	4/3/97	1	Restroom	1	Window	Casing	Solid	Wood	0.16
446	1912, 1924, 1931 bldg.	37	XRF	4/3/97	1	Restroom	1	Door	Header	Solid	Wood	0.09
447	1912, 1924, 1931 bldg.	38	XRF	4/3/97	1	Restroom	1	Door	Door	Solid	Wood	0.01
448	1912, 1924, 1931 bldg.	39	XRF	4/3/97	1	Restroom	1	Ceiling		Solid	Plaster	0.01
449	1912, 1924, 1931 bldg.	40	XRF	4/3/97	1	Restroom	1	Wall	Wall	Solid	Plaster	0.32
450	1912, 1924, 1931 bldg.	41	XRF	4/3/97	1	Restroom	1	Ceiling		Solid	Plaster	0.23
451	1912, 1924, 1931 bldg.	42	XRF	4/3/97	1	Restroom	1	Ceiling	Bthrm Stnl	Solid	Metal	0.09
452	1912, 1924, 1931 bldg.	43	XRF	4/3/97	1	Restroom	3	Floor		Peeling	Concrete	0.01
453	1912, 1924, 1931 bldg.	44	XRF	4/3/97	1	Restroom	3	Wall	Stall Door	Solid	Wood	0.02
454	1912, 1924, 1931 bldg.	45	XRF	4/3/97	1	Restroom	3	Door	Jamb	Solid	Wood	0.05
455	1912, 1924, 1931 bldg.	46	XRF	4/3/97	1	Restroom	3	Door	Door	Solid	Wood	0.06
456	1912, 1924, 1931 bldg.	47	XRF	4/3/97	1	Restroom	3	Ceiling	Door	Solid	Plaster	0.03
457	1912, 1924, 1931 bldg.	65	XRF	4/3/97	2	Restroom	4	Floor		Peeling	Concrete	0.01
458	1912, 1924, 1931 bldg.	66	XRF	4/3/97	2	Restroom	4	Floor	Radiator	Solid	Metal	4.04
459	1912, 1924, 1931 bldg.	67	XRF	4/3/97	2	Restroom	4	Window	Casing	Solid	Wood	0.08
460	1912, 1924, 1931 bldg.	68	XRF	4/3/97	2	Restroom	4	Window	Stool	Solid	Concrete	0.01
461	1912, 1924, 1931 bldg.	69	XRF	4/3/97	2	Restroom	4	Wall	Wall	Solid	Plaster	0.11
462	1912, 1924, 1931 bldg.	70	XRF	4/3/97	2	Restroom	4	Wall	Wall	Solid	Plaster	0.04
463	1912, 1924, 1931 bldg.	71	XRF	4/3/97	2	Restroom	4	Wall	Stall Door	Solid	Wood	0.02
464	1912, 1924, 1931 bldg.	72	XRF	4/3/97	2	Restroom	4	Ceiling		Solid	Plaster	0.08
465	1912, 1924, 1931 bldg.	83	XRF	4/3/97	2	Restroom	5	Floor		Cracked	Concrete	0.01
466	1912, 1924, 1931 bldg.	84	XRF	4/3/97	2	Restroom	5	Wall	Wall	Solid	Plaster	5.09
467	1912, 1924, 1931 bldg.	85	XRF	4/3/97	2	Restroom	5	Wall	Wall	Solid	Plaster	0.2
468	1912, 1924, 1931 bldg.	86	XRF	4/3/97	2	Restroom	5	Window	Casing	Solid	Wood	0.1
469	1912, 1924, 1931 bldg.	87	XRF	4/3/97	2	Restroom	5	Window	Radiator	Peeling	Metal	5.09
470	1912, 1924, 1931 bldg.	88	XRF	4/3/97	2	Restroom	5		Stall Door	Peeling	Wood	0.01
471	1912, 1924, 1931 bldg.	89	XRF	4/3/97	2	Restroom	5		Bathroom	Solid	Metal	0.22
472	1912, 1924, 1931 bldg.	90	XRF	4/3/97	2	Restroom	5	Ceiling		Solid	Plaster	0.01
473	1912, 1924, 1931 bldg.	165	XRF	4/3/97	2	Restroom	6	Floor		Peeling	Concrete	0.01
474	1912, 1924, 1931 bldg.	166	XRF	4/3/97	2	Restroom	6	Wall	Baseboard	Solid	Wood	0.1
475	1912, 1924, 1931 bldg.	35	XRF	4/11/97	3	Room	5	Wall	Baseboard	Solid	Wood	0.03
476	1912, 1924, 1931 bldg.	36	XRF	4/11/97	3	Room	5	Wall	Wall	Solid	Plaster	5.09
477	1912, 1924, 1931 bldg.	37	XRF	4/11/97	3	Room	5	Wall	Chair rail	Solid	Wood	0.08
478	1912, 1924, 1931 bldg.	38	XRF	4/11/97	3	Room	5	Wall	Wall	Solid	Plaster	0.21
479	1912, 1924, 1931 bldg.	39	XRF	4/11/97	3	Room	5	Window	Casing	Solid	Wood	0.1
480	1912, 1924, 1931 bldg.	40	XRF	4/11/97	3	Room	5	Door	Jamb	Solid	Wood	0.04
481	1912, 1924, 1931 bldg.	41	XRF	4/11/97	3	Room	5	Door	Door	Solid	Wood	0.03
482	1912, 1924, 1931 bldg.	17	XRF	4/12/97	3	Room	5	Ceiling		Solid	Plaster	0.07
483	1912, 1924, 1931 bldg.	68	XRF	4/11/97	3	Room	6	Wall	Baseboard	Solid	Wood	0.06
484	1912, 1924, 1931 bldg.	69	XRF	4/11/97	3	Room	6	Wall	Chair rail	Solid	Wood	0.08
485	1912, 1924, 1931 bldg.	70	XRF	4/11/97	3	Room	6	Window	Casing	Solid	Wood	0.07
486	1912, 1924, 1931 bldg.	71	XRF	4/11/97	3	Room	6	Door	Casing	Solid	Wood	0.05
487	1912, 1924, 1931 bldg.	72	XRF	4/11/97	3	Room	6	Door	Door	Solid	Wood	0.03
488	1912, 1924, 1931 bldg.	73	XRF	4/11/97	3	Room	6	Cabinet	Door	Solid	Wood	0.01
489	1912, 1924, 1931 bldg.	6	XRF	4/12/97	3	Room	6	Ceiling		Solid	Plaster	0
490	1912, 1924, 1931 bldg.	116	XRF	4/11/97	3	Room	7	Wall	Baseboard	Solid	Wood	0.03
491	1912, 1924, 1931 bldg.	117	XRF	4/11/97	3	Room	7	Window	Stops	Solid	Wood	0.18
492	1912, 1924, 1931 bldg.	118	XRF	4/11/97	3	Room	7	Door	Jamb	Solid	Wood	0.03
493	1912, 1924, 1931 bldg.	119	XRF	4/11/97	3	Room	7	Cabinet	Door	Solid	Wood	0
494	1912, 1924, 1931 bldg.	120	XRF	4/11/97	3	Room	7	Door	Door	Solid	Wood	0.02
495	1912, 1924, 1931 bldg.	16	XRF	4/12/97	3	Room	7	Ceiling		Solid	Plaster	0.1
496	1912, 1924, 1931 bldg.	11	XRF	4/12/97	3	Room	10	Ceiling		Peeling	Plaster	0.08
497	1912, 1924, 1931 bldg.	123	XRF	4/3/97	2	Room	200	Wall	Wall	Solid	Plaster	0.51
498	1912, 1924, 1931 bldg.	124	XRF	4/3/97	2	Room	200	Wall	Wall	Solid	Wood	0.06
499	1912, 1924, 1931 bldg.	125	XRF	4/3/97	2	Room	200	Door	Casing	Solid	Wood	0.09
500	1912, 1924, 1931 bldg.	126	XRF	4/3/97	2	Room	200	Door	Door	Solid	Wood	0
501	1912, 1924, 1931 bldg.	127	XRF	4/3/97	2	Room	200	Door	Radiator	Cracked	Metal	0.6
502	1912, 1924, 1931 bldg.	128	XRF	4/3/97	2	Room	200	Door	Locker	Solid	Metal	0.45
503	1912, 1924, 1931 bldg.	129	XRF	4/3/97	2	Room	200	Ceiling		Solid	Plaster	0
504	1912, 1924, 1931 bldg.	156	XRF	4/3/97	2	Room	204	Ceiling		Solid	Plaster	0.05
505	1912, 1924, 1931 bldg.	157	XRF	4/3/97	2	Room	204	Floor		Solid	Wood	0

Saint Paul Public Schools
 Groveland Park Elementary School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	No	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	PbL
506	1912, 1924, 1931 bldg.	158	XRF	4/3/97	2	Room	204	Wall	Baseboard	Solid	Wood	0.04
507	1912, 1924, 1931 bldg.	159	XRF	4/3/97	2	Room	204	Wall	Chair rail	Solid	Metal	0.09
508	1912, 1924, 1931 bldg.	160	XRF	4/3/97	2	Room	204	Window	Casing	Solid	Wood	0.05
509	1912, 1924, 1931 bldg.	161	XRF	4/3/97	2	Room	204	Door	Jamb	Solid	Wood	0.02
510	1912, 1924, 1931 bldg.	162	XRF	4/3/97	2	Room	204	Door	Door	Solid	Wood	0.02
511	1912, 1924, 1931 bldg.	163	XRF	4/3/97	2	Room	204	Cabinet	Door	Solid	Wood	0.03
512	1912, 1924, 1931 bldg.	164	XRF	4/3/97	2	Room	204	Cabinet	Radiator	Peeling	Metal	3.2
513	1912, 1924, 1931 bldg.	45	XRF	4/11/97	3	Room	304	Floor		Solid	Wood	0
514	1912, 1924, 1931 bldg.	46	XRF	4/11/97	3	Room	304	Wall	Baseboard	Solid	Wood	0.01
515	1912, 1924, 1931 bldg.	47	XRF	4/11/97	3	Room	304	Wall	Wall	Solid	Plaster	5.09
516	1912, 1924, 1931 bldg.	48	XRF	4/11/97	3	Room	304	Wall	Wall	Solid	Plaster	0.28
517	1912, 1924, 1931 bldg.	49	XRF	4/11/97	3	Room	304	Window	Casing	Solid	Wood	0.14
518	1912, 1924, 1931 bldg.	50	XRF	4/11/97	3	Room	304	Door	Jamb	Solid	Wood	0.04
519	1912, 1924, 1931 bldg.	51	XRF	4/11/97	3	Room	304	Door	Door	Solid	Wood	0.03
520	1912, 1924, 1931 bldg.	52	XRF	4/11/97	3	Room	304	Chalk Board	Ledge	Peeling	Wood	0.1
521	1912, 1924, 1931 bldg.	53	XRF	4/11/97	3	Room	304	Chalk Board	Sash	Solid	Wood	0.02
522	1912, 1924, 1931 bldg.	54	XRF	4/11/97	3	Room	304	Cabinet	Inside	Solid	Wood	0.01
523	1912, 1924, 1931 bldg.	55	XRF	4/11/97	3	Room	304	Cabinet	Shelf	Solid	Wood	0
524	1912, 1924, 1931 bldg.	56	XRF	4/11/97	3	Room	304	Cabinet	Inside	Solid	Wood	0
525	1912, 1924, 1931 bldg.	14	XRF	4/12/97	3	Room	304	Ceiling		Solid	Plaster	0.02
526	1912, 1924, 1931 bldg.	76	XRF	4/11/97	3	Room	306	Floor		Solid	Wood	0
527	1912, 1924, 1931 bldg.	77	XRF	4/11/97	3	Room	306	Wall	Baseboard	Solid	Wood	0.01
528	1912, 1924, 1931 bldg.	78	XRF	4/11/97	3	Room	306	Chalk Board	Ledge	Solid	Wood	0.12
529	1912, 1924, 1931 bldg.	79	XRF	4/11/97	3	Room	306	Chalk Board	Sash	Solid	Wood	0.04
530	1912, 1924, 1931 bldg.	80	XRF	4/11/97	3	Room	306	Window	Casing	Solid	Wood	0.12
531	1912, 1924, 1931 bldg.	81	XRF	4/11/97	3	Room	306	Door	Casing	Solid	Metal	0.12
532	1912, 1924, 1931 bldg.	82	XRF	4/11/97	3	Room	306	Door	Door	Solid	Wood	0
533	1912, 1924, 1931 bldg.	83	XRF	4/11/97	3	Room	306	Cabinet	Door	Solid	Wood	0.02
534	1912, 1924, 1931 bldg.	84	XRF	4/11/97	3	Room	306	Cabinet	Floor	Solid	Wood	0.02
535	1912, 1924, 1931 bldg.	7	XRF	4/12/97	3	Room	306	Ceiling		Solid	Plaster	0.27
536	1912, 1924, 1931 bldg.	57	XRF	4/11/97	3	Room	307	Floor		Solid	Wood	0
537	1912, 1924, 1931 bldg.	58	XRF	4/11/97	3	Room	307	Wall	Baseboard	Solid	Wood	0.01
538	1912, 1924, 1931 bldg.	59	XRF	4/11/97	3	Room	307	Wall	Wall	Solid	Plaster	5.09
539	1912, 1924, 1931 bldg.	60	XRF	4/11/97	3	Room	307	Window	Casing	Solid	Wood	0.36
540	1912, 1924, 1931 bldg.	61	XRF	4/11/97	3	Room	307	Door	Header	Solid	Wood	0.03
541	1912, 1924, 1931 bldg.	62	XRF	4/11/97	3	Room	307	Door	Door	Solid	Wood	0.08
542	1912, 1924, 1931 bldg.	63	XRF	4/11/97	3	Room	307	Chalk Board	Ledge	Solid	Wood	0.04
543	1912, 1924, 1931 bldg.	64	XRF	4/11/97	3	Room	307	Chalk Board	Sash	Solid	Wood	0.01
544	1912, 1924, 1931 bldg.	65	XRF	4/11/97	3	Room	307	Cabinet	Door	Solid	Wood	0.04
545	1912, 1924, 1931 bldg.	66	XRF	4/11/97	3	Room	307	Cabinet	Shelf	Solid	Wood	0.03
546	1912, 1924, 1931 bldg.	67	XRF	4/11/97	3	Room	307	Closet	Wall	Solid	Plaster	5.09
547	1912, 1924, 1931 bldg.	15	XRF	4/12/97	3	Room	307	Ceiling		Solid		0.63
548	1912, 1924, 1931 bldg.	85	XRF	4/11/97	3	Room	308	Floor		Solid	Wood	0
549	1912, 1924, 1931 bldg.	86	XRF	4/11/97	3	Room	308	Wall	Baseboard	Solid	Metal	0.09
550	1912, 1924, 1931 bldg.	87	XRF	4/11/97	3	Room	308	Wall	Baseboard	Solid	Wood	0.02
551	1912, 1924, 1931 bldg.	88	XRF	4/11/97	3	Room	308	Chalk Board	Ledge	Solid	Wood	0.02
552	1912, 1924, 1931 bldg.	89	XRF	4/11/97	3	Room	308	Chalk Board	Sash	Solid	Wood	0.03
553	1912, 1924, 1931 bldg.	90	XRF	4/11/97	3	Room	308	Tack Board		Solid	Wood	0.1
554	1912, 1924, 1931 bldg.	91	XRF	4/11/97	3	Room	308	Window	Stops	Solid	Wood	0.17
555	1912, 1924, 1931 bldg.	92	XRF	4/11/97	3	Room	308	Door	Jamb	Solid	Wood	0.03
556	1912, 1924, 1931 bldg.	93	XRF	4/11/97	3	Room	308	Door	Door	Solid	Wood	0.02
557	1912, 1924, 1931 bldg.	94	XRF	4/11/97	3	Room	308	Cabinet	Door	Solid	Wood	0.06
558	1912, 1924, 1931 bldg.	95	XRF	4/11/97	3	Room	308	Cabinet	Shelf	Solid	Wood	0.06
559	1912, 1924, 1931 bldg.	96	XRF	4/11/97	3	Room	308	Tack Board		Solid	Wood	0.61
560	1912, 1924, 1931 bldg.	8	XRF	4/12/97	3	Room	308	Ceiling		Solid	Plaster	1.25
561	1912, 1924, 1931 bldg.	109	XRF	4/11/97	3	Room	309	Floor		Solid	Wood	0
562	1912, 1924, 1931 bldg.	110	XRF	4/11/97	3	Room	309	Wall	Baseboard	Solid	Wood	0.01
563	1912, 1924, 1931 bldg.	111	XRF	4/11/97	3	Room	309	Unlisted	Baseboard	Solid	Wood	0.04
564	1912, 1924, 1931 bldg.	112	XRF	4/11/97	3	Room	309	Chalk Board	Ledge	Solid	Wood	0.05
565	1912, 1924, 1931 bldg.	113	XRF	4/11/97	3	Room	309	Chalk Board	Sash	Solid	Wood	0.04
566	1912, 1924, 1931 bldg.	114	XRF	4/11/97	3	Room	309	Door	Jamb	Solid	Wood	0.02
567	1912, 1924, 1931 bldg.	115	XRF	4/11/97	3	Room	309	Door	Door	Solid	Wood	0.03
568	1912, 1924, 1931 bldg.	10	XRF	4/12/97	3	Room	309	Ceiling		Cracked	Plaster	0.23

Saint Paul Public Schools
 Groveland Park Elementary School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	No	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	PbL
569	1912, 1924, 1931 bldg.	100	XRF	4/11/97	3	Room	311	Floor		Solid	Wood	0
570	1912, 1924, 1931 bldg.	101	XRF	4/11/97	3	Room	311	Wall	Baseboard	Solid	Wood	0
571	1912, 1924, 1931 bldg.	102	XRF	4/11/97	3	Room	311	Chalk Board	Ledge	Solid	Wood	0.06
572	1912, 1924, 1931 bldg.	103	XRF	4/11/97	3	Room	311	Chalk Board	Sash	Solid	Wood	0.03
573	1912, 1924, 1931 bldg.	104	XRF	4/11/97	3	Room	311	Window	Casing	Solid	Wood	0.08
574	1912, 1924, 1931 bldg.	105	XRF	4/11/97	3	Room	311	Door	Door	Solid	Wood	0.05
575	1912, 1924, 1931 bldg.	106	XRF	4/11/97	3	Room	311	Door	Jamb	Solid	Wood	0.01
576	1912, 1924, 1931 bldg.	107	XRF	4/11/97	3	Room	311	Cabinet	Door	Solid	Wood	0.02
577	1912, 1924, 1931 bldg.	108	XRF	4/11/97	3	Room	311	Cabinet	Shelf	Solid	Wood	0.03
578	1912, 1924, 1931 bldg.	9	XRF	4/12/97	3	Room	311	Ceiling		Solid	Plaster	1.21
579	1912, 1924, 1931 bldg.	33	XRF	4/2/97	1	Stage	0	Floor		Solid	Wood	0
580	1912, 1924, 1931 bldg.	34	XRF	4/2/97	1	Stage	0	Wall	Wall	Solid	Plaster	0.16
581	1912, 1924, 1931 bldg.	35	XRF	4/2/97	1	Stage	0	Wall	Baseboard	Peeling	Metal	5.09
582	1912, 1924, 1931 bldg.	36	XRF	4/2/97	1	Stage	0	Wall	Wall	Cracked	Plaster	5.09
583	1912, 1924, 1931 bldg.	37	XRF	4/2/97	1	Stage	0	Door	Door	Solid	Wood	0.05
584	1912, 1924, 1931 bldg.	38	XRF	4/2/97	1	Stage	0	Door	Jamb	Solid	Wood	0.05
585	1912, 1924, 1931 bldg.	39	XRF	4/2/97	1	Stage	0	Closet	Wall	Cracked	Plaster	0.08
586	1912, 1924, 1931 bldg.	17	XRF	4/3/97	1	Stage	0	Ceiling		Peeling	Plaster	0.35
587	1912, 1924, 1931 bldg.	18	XRF	4/3/97	1	Stage	0	Ceiling		Peeling	Plaster	0.52
588	1912, 1924, 1931 bldg.	48	XRF	4/3/97	1	Stairwell	1	Ceiling		Solid	Plaster	0.03
589	1912, 1924, 1931 bldg.	49	XRF	4/3/97	1	Stairwell	1	Wall	Baseboard	Peeling	Concrete	0.07
590	1912, 1924, 1931 bldg.	50	XRF	4/3/97	1	Stairwell	1	Wall	Chair rail	Solid	Wood	0.04
591	1912, 1924, 1931 bldg.	51	XRF	4/3/97	1	Stairwell	1	Stairs	Hand rail	Peeling	Metal	0.05
592	1912, 1924, 1931 bldg.	52	XRF	4/3/97	1	Stairwell	1	Door	Door	Solid	Wood	0.52
593	1912, 1924, 1931 bldg.	53	XRF	4/3/97	1	Stairwell	1	Door	Jamb	Solid	Wood	0.63
594	1912, 1924, 1931 bldg.	54	XRF	4/3/97	1	Stairwell	1	Stairs	Hand rail	Solid	Concrete	4.45
595	1912, 1924, 1931 bldg.	55	XRF	4/3/97	2	Stairwell	1	Stairs	Hand rail	Solid		5.09
596	1912, 1924, 1931 bldg.	70	XRF	4/9/97	3	Stairwell	3	Wall	Baseboard	Solid	Concrete	0.08
597	1912, 1924, 1931 bldg.	71	XRF	4/9/97	3	Stairwell	3	Wall	Wall	Solid	Tile	2.5
598	1912, 1924, 1931 bldg.	72	XRF	4/9/97	3	Stairwell	3	Wall	Chair rail	Solid	Wood	0.02
599	1912, 1924, 1931 bldg.	73	XRF	4/9/97	3	Stairwell	3	Wall	Wall	Solid	Plaster	0.15
600	1912, 1924, 1931 bldg.	74	XRF	4/9/97	3	Stairwell	3	Ceiling		Solid	Plaster	0.05
601	1912, 1924, 1931 bldg.	75	XRF	4/9/97	3	Stairwell	3	Stairs	Rail cap	Solid	Concrete	5.09
602	1912, 1924, 1931 bldg.	76	XRF	4/9/97	3	Stairwell	3	Stairs	Hand rail	Solid	Metal	0.01
603	1912, 1924, 1931 bldg.	77	XRF	4/9/97	3	Stairwell	3	Window	Casing	Solid	Wood	0.07
604	1912, 1924, 1931 bldg.	78	XRF	4/9/97	3	Stairwell	3	Stairs	Riser	Solid	Concrete	0.04
605	1912, 1924, 1931 bldg.	79	XRF	4/9/97	3	Stairwell	3	Door	Jamb	Peeling	Metal	5.09
606	1912, 1924, 1931 bldg.	80	XRF	4/9/97	3	Stairwell	3	Door	Door	Peeling	Metal	5.09
607	1978 bldg.	199	XRF	4/11/97	3	Bath	1	Wall	Midle Wall	Solid	Concrete	0
608	1978 bldg.	200	XRF	4/11/97	3	Bath	1	Ceiling		Solid	Stucco	0
609	1978 bldg.	201	XRF	4/11/97	3	Bath	1	Stall	Wall	Solid	Metal	1.49
610	1978 bldg.	202	XRF	4/11/97	3	Bath	1	Door	Door	Solid	Metal	0.01
611	1978 bldg.	203	XRF	4/11/97	3	Bath	2	Wall	Midle Wall	Solid	Concrete	0
612	1978 bldg.	204	XRF	4/11/97	3	Bath	2	Ceiling		Solid	Stucco	0
613	1978 bldg.	205	XRF	4/11/97	3	Bath	2	Stall	Wall	Solid	Metal	1.37
614	1978 bldg.	206	XRF	4/11/97	3	Bath	2	Door	Casing	Solid	Metal	0.03
615	1978 bldg.	208	XRF	4/11/97	3	Bath	3	Wall	Wall	Solid	Concrete	0
616	1978 bldg.	209	XRF	4/11/97	3	Bath	3	Ceiling		Solid	Plaster	0
617	1978 bldg.	210	XRF	4/11/97	3	Bath	3	Stall	Wall	Solid	Metal	1.07
618	1978 bldg.	211	XRF	4/11/97	3	Bath	3	Door	Door	Solid	Metal	0
619	1978 bldg.	212	XRF	4/11/97	3	Bath	4	Wall	Wall	Solid	Concrete	0
620	1978 bldg.	213	XRF	4/11/97	3	Bath	4	Ceiling		Solid	Plaster	0
621	1978 bldg.	214	XRF	4/11/97	3	Bath	4	Stall	Wall	Solid	Metal	1.73
622	1978 bldg.	215	XRF	4/11/97	3	Bath	4	Door	Jamb	Solid	Metal	0.04
623	1978 bldg.	13	XRF	4/12/97	3	Hall	5	Ceiling		Solid	Drywall	0
624	1978 bldg.	165	XRF	4/11/97	3	Hall	6	Wall	Midle Wall	Solid	Concrete	0
625	1978 bldg.	166	XRF	4/11/97	3	Hall	6	Door	Door	Solid	Metal	0.02
626	1978 bldg.	167	XRF	4/11/97	3	Hall	6	Door	Jamb	Solid	Metal	0.19
627	1978 bldg.	168	XRF	4/11/97	3	Hall	6	Wall	Wall	Solid	Concrete	0.01
628	1978 bldg.	169	XRF	4/11/97	3	Hall	6	Stairs	Hand rail	Solid	Metal	0.1
629	1978 bldg.	170	XRF	4/11/97	3	Hall	6	Wall	Wall	Solid	Concrete	0
630	1978 bldg.	171	XRF	4/11/97	3	Hall	6	Door	Door	Solid	Metal	0.06
631	1978 bldg.	172	XRF	4/11/97	3	Hall	6	Window	Casing	Solid	Metal	0

Saint Paul Public Schools
 Groveland Park Elementary School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	No	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	PbL
632	1978 bldg.	216	XRF	4/11/97	3	Hall	6	Stairs	Hand rail	Solid	Metal	0.28
633	1978 bldg.	178	XRF	4/11/97	3	Kitchen	1	Wall	Wall	Solid	Concrte	0
634	1978 bldg.	179	XRF	4/11/97	3	Kitchen	1	Wall	Midle Wall	Solid	Plaster	0.26
635	1978 bldg.	180	XRF	4/11/97	3	Kitchen	1	Ceiling		Solid	Plaster	0
636	1978 bldg.	181	XRF	4/11/97	3	Kitchen	1	Door	Casing	Solid	Metal	0
637	1978 bldg.	182	XRF	4/11/97	3	Kitchen	1	Door	Door	Solid	Metal	0
638	1978 bldg.	29	XRF	4/12/97	3	Outside	0	Door	Door	Solid	Metal	0.01
639	1978 bldg.	30	XRF	4/12/97	3	Outside	0	Window	Sash	Solid	Metal	0
640	1978 bldg.	31	XRF	4/12/97	3	Porch	0	Porch	Ceiling	Solid	Stucco	0
641	1978 bldg.	32	XRF	4/12/97	3	Porch	0	Door	Door	Solid	Metal	0
642	1978 bldg.	173	XRF	4/11/97	3	Room	1	Wall	Wall	Solid	Concrte	0
643	1978 bldg.	174	XRF	4/11/97	3	Room	1	Wall	Wall	Solid	Drywall	0.09
644	1978 bldg.	175	XRF	4/11/97	3	Room	1	Window	Casing	Solid	Metal	0
645	1978 bldg.	176	XRF	4/11/97	3	Room	1	Door	Door	Solid	Metal	0.02
646	1978 bldg.	177	XRF	4/11/97	3	Room	1	Door	Jamb	Solid	Metal	0.03
647	1978 bldg.	183	XRF	4/11/97	3	Room	2	Wall	Midle Wall	Solid	Concrte	0
648	1978 bldg.	184	XRF	4/11/97	3	Room	2	Wall	Midle Wall	Solid	Plaster	0.12
649	1978 bldg.	185	XRF	4/11/97	3	Room	2	Wall	Midle Wall	Solid	Concrte	0
650	1978 bldg.	186	XRF	4/11/97	3	Room	2	Door	Door	Solid	Metal	0
651	1978 bldg.	187	XRF	4/11/97	3	Room	2	Door	Casing	Solid	Metal	0.01
652	1978 bldg.	188	XRF	4/11/97	3	Room	2	Closet	Wall	Solid	Concre	0
653	1978 bldg.	189	XRF	4/11/97	3	Room	4	Wall	Wall	Solid	Concre	0
654	1978 bldg.	190	XRF	4/11/97	3	Room	4	Wall	Midle Wall	Solid	Concre	0
655	1978 bldg.	191	XRF	4/11/97	3	Room	4	Wall	Midle Wall	Solid	Concre	0.03
656	1978 bldg.	192	XRF	4/11/97	3	Room	4	Door	Door	Solid	Metal	0
657	1978 bldg.	193	XRF	4/11/97	3	Room	4	Door	Casing	Solid	Metal	0
658	1978 bldg.	194	XRF	4/11/97	3	Room	4	Wall	Partition	Solid	Wood	0
659	1978 bldg.	195	XRF	4/11/97	3	Room	4	Door	Door	Solid	Metal	0
660	1978 bldg.	196	XRF	4/11/97	3	Room	4	Door	Jamb	Solid	Metal	0.01
661	1978 bldg.	197	XRF	4/11/97	3	Room	4	Bookcase	Shelf	Solid	Wood	0
662	1978 bldg.	198	XRF	4/11/97	3	Room	4	Ceiling		Solid	Drywall	0
663	1978 bldg.	207	XRF	4/11/97	3	Room	4	Bleachers		Solid	Wood	0

APPENDIX B

LABORATORY SAMPLE ANALYSIS DATA

LABORATORY ANALYSIS REPORT**DATE:** May 23, 1997**PAGE:**

1 Of 2

CLIENT: Midwest Environmental Cons.
5385 401st Ave. NW
Dalbo, MN 55017**PROJECT NO.:** 050997-200888
COLLECTION DATE: 4/12/97
COLLECTED BY: Client
RECEIVED DATE: 5/09/97
PROJECT DESCRIPT.: 62/0197U**CONTACT:** Greg Myers/Richard Cox

<u>SAMPLE #</u>	<u>DESCP.</u>	<u>MDL</u>	LEAD (6010A)	<u>ANALYSIS</u>	<u>DATE</u>
			<u>RESULTS</u>		
L972781-1	4/2/97 10	25	5200		5/23/97
L972781-2	4/2/97 11	24	2400		5/23/97
L972781-3	4/2/97 12	23	4900		5/23/97
L972781-4	4/2/97 73	17	80		5/23/97
L972781-5	4/2/97 99	26	6500		5/23/97
L972781-6	4/2/97 109	160	710		5/23/97
L972781-7	4/2/97 110	43	1200		5/23/97
L972781-8	4/2/97 134	14	530		5/23/97
L972781-9	4/3/97 80	17	2700		5/23/97
L972781-10	4/9/97 15	29	2900		5/23/97
L972781-11	4/9/97 70	14	980		5/23/97
L972781-12	4/9/97 82	27	2700		5/23/97
L972781-13	4/11/97 90	19	1000		5/23/97
L972781-14	4/11/97 128	22	2300		5/23/97
L972781-15	4/11/97 215	24	110		5/23/97
L972781-16	4/12/97 12	25	2000		5/23/97

*ND means Not Detected or below reported MDL**MDL means Method Detection Limit**mg/kg means Milligrams Per Kilogram which is equivalent to Parts Per Million (ppm)*



301 West County Road E2 • St. Paul, MN 55112
(612) 633-0101 • FAX (612) 633-1402

LABORATORY ANALYSIS REPORT

DATE: May 23, 1997

PAGE:

2 Of 2

CLIENT: Midwest Environmental Cons.
5385 401st Ave. NW
Dalbo, MN 55017

PROJECT NO.: 050997-200888
COLLECTION DATE: 4/12/97
COLLECTED BY: Client
RECEIVED DATE: 5/09/97
PROJECT DESCRIPT.: 62/0197U

CONTACT: Greg Myers/Richard Cox

This report has been reviewed by me for technical accuracy and completeness. The analyses were performed using EPA or other approved methodologies and the results were reported on an "as received" basis unless otherwise noted. Organic soil analyses were reported on a dry weight basis. The results reported relate only to the items tested. Please contact me if you have any questions or comments regarding this report. Spectrum Labs, Inc. appreciates the opportunity to provide this analytical service for you.

Report Submitted By,


Thomas L. Halverson
Laboratory Manager

TLH:wmc
mec143-1

As a mutual protection, all reports are submitted in confidentiality and may not be reproduced except in full without written authorization.



A member of The Marmon Group of Companies

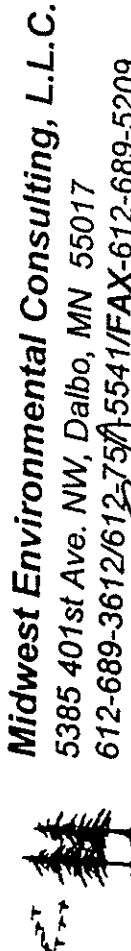

5385 401st Ave. NW, Duluth, MN 55017
612-689-3612/612-751-5541/FAX-612-689-5209

Client Address _____
Contact Richard Cox

CHAIN OF CUSTODY RECORD

Project Number 62/0976

Client _____

Project Careland - paint
Phone/Fax _____

Sample ID	Sample Description	Collection Date/Time	Matrix (Vol/Area)	Analysis Requested
78-1 4/29-10	Stch, Flr 1, Paint off white vinyl wall.	4/19/97	2 1/2 PB	Paint
2 4/29-11	" " wd door handle.	4/20/97	2 1/2 PB	
3 4/29-12	Stch, Flr 1, Flr 10, wd clear jams	4/20/97	2 1/2 PB	
4 4/29-73	" " Proofer, Boiler Bay, white concrete wall	4/20/97	2 1/2 PB	
5 " -99	" " Flm 107, wd baseboard mould 4/20/97	2 1/2 PB	" "	
6 -109	" " " wd chalkboard ledge vanity	2 1/2 PB	" "	
7 " -110	" " " " each	" "	" "	
8 " -134	" " library, metal office desk jamb	" "	" "	
9 4/3/97-80	Flr 2, hall 2, metal/black hardware	" "	" "	
10 4/9/97-15	" " Flm 209, wd closet wall vanish "	" "	" "	
11 " -70	Flm 003, Stch 03 concrete basement D grey	" "	" "	
12 " -82	" " Hall 4 wd chair rail C vanish	" "	" "	
13 4/11/97-90	" " Flm 305 Pacific Zinc Tack board (B) off white	" "	" "	
14 -128	Stch 4, wd Door Threshold. (B) vanish.	" "	" "	

Sampled By: Rich Cox Date: 4/20/97 Time: _____
Received By: _____ Date: _____ Time: _____
Received By Lab: Alioncy Date: 5/19/97 Time: 3:30
Notes: _____

Delivered By: _____ Date: 5/19/97 Time: _____
Delivered By: _____ Date: _____ Time: _____
Disposition of Samples _____



Midwest Environmental Consulting, L.L.C.
5385 401st Ave. NW, Dalbo, MN 55017
612-689-3612/612-757-5541/FAX-612-689-5209
Client Address _____
Contact John and Lori

CHAIN OF CUSTODY RECORD

3383 401st Avé. NW, Duluth, MN 55017
612-689-3612/612-757-5541/FAX-612-689-5209

Client Address ✓

Contact Richard G.

Sample ID

Project Number 6210972 Client 123456789

Client
Project

Phone/Fax

11

Project Number 6210972
Client 123456789

Client
Project

Phone/Fax

11

Sample ID	Sample Description	Collection Date/Time	Matrix (Vol./Area)	Analysis Requested
4/197-215	Site 2, floor 1, PB #4 metal detector box	4/12/97 2:12 PM	cc	Pb
4/197-12	Site 1, floor 5, plastic cups white			

Sampled By:

Received Sept. 1

Received By: _____ Date: _____ Time: _____

Received By Lab. J. H. Lang Date: 5/9/97 Time: 3:30

Delivered By: Karen Date: 5/7/17 Time: _____

Delivered By: _____ Date: / / Time: _____

Diagnosis of Cancer

Disposition of Samples

Notes:

APPENDIX C INSPECTORS

**Richard T. Cox
MDH Lead Inspector # 166**