


Midwest
Environmental
Consulting, L.L.C.

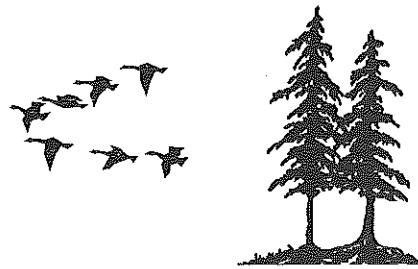

Printed on Recycled Paper

**Hazel Park Middle School Academy
Saint Paul Public Schools**

Lead-Based Paint Inspection

**Inspection Dates: 2/10/97, 2/11/97, 2/17/97, 2/18/97,
2/21/97, 2/22/97, 2/23/97**

submitted to:

Saint Paul Public Schools

MEC Project # 62/0197H

INTRODUCTION

At the request of Saint Paul Public Schools Environmental Safety Department, Midwest Environmental Consulting, L.L.C. (MEC), conducted a lead-based paint inspection at Hazel Park Middle School Academy, 1140 White Bear Ave., St. Paul, MN. The purpose of this inspection was to identify lead-based painted, varnished, or otherwise coated building components on the interior and exterior of the school building.

The inspection protocol incorporated applicable portions of the U.S. Department of Housing and Urban Development (HUD) *Guidelines for the Evaluation and Control of Lead-based Paint Hazards in Housing* (HUD Guidelines, June 1995) and OSHA 1926.62 requirements (Lead in Construction). The HUD guidelines are formulated to guide agencies in conducting random sampling of the interiors and exteriors of dwellings and common areas in public housing. The OSHA requirement is designed to minimize worker exposure when working with material containing lead.

Confirmatory testing was conducted when inconclusive XRF results were encountered. Inconclusive refers to XRF readings less than 0.2 mg/cm² (milligrams per square centimeter). Inconclusive results were confirmed with laboratory analysis of paint chip samples (Appendix B). This report contains a list of such results.

The United States Environmental Protection Agency defines "lead-based paint" as a paint or other surface coating that contains lead equal to or in excess of 1.0 milligrams per square centimeter when analyzed by XRF or more than 0.5% by weight (5000 parts per million) by laboratory analysis of a bulk sample.

Minnesota Department of Labor and Industry (MN OSHA) adopted the EPA lead levels for the purpose of enforcing OSHA 1926.62 federal regulations. Detection of lead in dried paint film by XRF is a dependable indicator of levels of lead and is accepted by MN OSHA.

For this Saint Paul Public Schools Lead Inspection, all building components were tested on site using a Niton XL® X-ray Fluorescence Spectrum Analyzer⁽¹⁾. Building components included walls, ceilings, floors, moldings, window and door components, door surfaces, and miscellaneous features such as shelves or bookcases. Only painted or glazed surfaces or surfaces which were varnished were tested. Suspended ceilings, structural steel, and corrugated decking were not included in the inspection. Neither anodized (e.g., window sashes) nor plastic (e.g., vinyl baseboard and vinyl mini-blinds) were included in the scope of this inspection.

⁽¹⁾ This is a portable hand held machine that can analyze building components instantly for lead concentrations.

Each building was divided into unique sites based on the year of construction or renovation. Portable classrooms, playgrounds, and other detached buildings were automatically designated as a unique site. Each site was inspected independently assuming differences in painting history and construction characteristics.

SITE DESCRIPTION AND BUILDING HISTORY

According to information provided to MEC by Saint Paul Public Schools, Hazel Park Middle School Academy was constructed in essentially one phase. This phase (site 1) includes the 94,440 square-foot section of the building and dates from 1956. There is also a portable classroom at this location. This labeled as site 2 for the purpose of this inspection.

All room and area designations used in this report are depicted on sampling maps found in Appendix A.

XRF SAMPLE RESULTS TABLE

The results of all samples analyzed are listed in the table at the end of this section. The following is a description of the column headings:

Site	Each school is divided into sites based on their unique construction characteristics. Each site has a unique date of construction or major renovation.
Sample #	Each sample taken was given a unique number to identify the type and location of the sample. The sampling date is an integral part of the sample number.
Analysis	This defines the type of analysis which can be categorized into two types: 1) XRF: This is an on-site analysis using a hand held Niton XL® X-ray Fluorescence Spectrum Analyzer; 2) Bulk or Chip: This is a bulk sample where paint is removed from the substrate and sent to a laboratory for analysis;
Floor	This is the level of the building in which the area tested was found, example, 1 (first floor), 0 (basement), etc.
Area	This further defines the specific functional space inspected such as a classroom, exterior, playground, gym, kitchen, etc.

Room #	This is typically the actual number on the room as identified at the building.
Component	Building "components" included walls, ceilings, floors, moldings, window and door components, door surfaces, and miscellaneous features such as shelves or bookcases.
Feature	Identifies more detailed information of the component.
Condition	This describes condition of the surface, whether it is intact, cracked, peeling, or chalking.
Substrate	This refers to the material the building component is made of (wood, concrete, drywall, metal, etc.).
Result	This is the analysis results for lead. Less than 1.0 mg/cm ² or less than 0.5% by weight is considered to be non-lead and these building components are below the action levels of EPA and HUD. (All results are in mg/cm ² except where noted.)

The table of results is designed for quick information on lead concentrations of tested building components. Generally, all repetitions of a test combination within a given room or area, may be assumed to contain similar concentrations of lead to that of the tested sample. For instance, the lead concentration of a tested wooden window sash was found to be above the action level of 1.0 mg/cm² in a given classroom. The classroom has five windows, all of wood, the same color and appearing to be of the same era. It can be assumed that the remaining four wooden window sashes each contain lead above the action limit.

Other columns identify the component and the component feature tested, condition of the component, type of substrate and the result of the analytical test.

As an example, the following illustration shows that the wooden door jamb in Room 123, first floor in the 1923 building section was in good, solid condition, and had an XRF test result of 0.3 mg/cm², which is below the action level.

Illustration Only

Site	Sample #	Date	Analysis	Floor	Area	Room #	Component	Feature	Condition	Substrate	Results
1923 Bldg.	52		XRF	1	Room	123	Door	Jamb	Solid	Wood	0.3

In a similar manner, the table shows that the plaster walls in room 23, on the second floor has peeling paint with more than 1.0 mg/cm² (shaded).

ILLUSTRATION ONLY

Site	Sample #	Date	Analysis	Floor	Area	Room #	Component	Feature	Condition	Substrate	Results
1910 Bldg.	16		XRF	2	Room	23	Door	Jamb	Peeling	Wood	0.25
1910 Bldg.	17		XRF	2	Room	23	Wall	Wall	Peeling	Plaster	1.2
1910 Bldg.	18		XRF	2	Room	23	Ceiling	Peeling	Plaster		0.25
1910 Bldg.	19		XRF	2	Room	23	Wall	Baseboard	Peeling	Wood	0.002

APPLICABLE REGULATIONS

When building components test above 1.0 mg/cm² of lead by XRF or 0.5% lead by weight from laboratory analysis all employees and contractors who will be working with these components in a construction related activity must be notified. The requirements of OSHA 1926.62, Lead in Construction are enforceable. This regulation defines construction work as "work for construction, alteration and/or repair, including painting and decorating." This regulation further defines monitoring requirements to minimize employee exposure to lead during construction activities.

When work is performed on external painted building structures (i.e. flashing, fire escapes, playground equipment, handrails, etc.), regulations of the Minnesota Pollution Control Agency (MPCA) may also be applicable. For removal of lead based paint from steel structures, MN Rules 7025.0200 - 7025.0380 apply to steel materials on the exterior of a building, or on the property when levels exceed 0.5 mg/cm² based on the average of three XRF spectrum results of the sample tested, or 5,000 ppm by laboratory analysis. If it is other than a steel surface, then MPCA regulates the painted surfaces under MN Rules 7025.010 - 7025.0080, when surfaces are to be disturbed using abrasive blasting methods.

Please contact MEC directly if you have questions about any portion of this report or the lead-based paint inspection itself.

APPENDIX A

**XRF TESTING DATA
WITH
LOCATION MAPS**

Saint Paul Public Schools
 Hazel Park Academy
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L		
1	Hazel Park Academy													
2														
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result		
4	1956 Bldg	44	XRF	2/11/97	1	Bath	1	Wall	Wall	Solid	Plaster	0.12		
5	1956 Bldg	45	XRF	2/11/97	1	Bath	1	Wall	Wall	Solid	Tile	0.5		
6	1956 Bldg	46	XRF	2/11/97	1	Bath	1		Diffuser	Solid	Metal	0.07		
7	1956 Bldg	47	XRF	2/11/97	1	Bath	1	Ceiling		Cracked	Plaster	0.14		
8	1956 Bldg	66	XRF	2/11/97	1	Bath	2	Wall	Wall	Solid	Plaster	0.18		
9	1956 Bldg	67	XRF	2/11/97	1	Bath	2	Wall	Baseboard	Solid	Tile	0.17		
10	1956 Bldg	68	XRF	2/11/97	1	Bath	2	Door	Door	Solid	Wood	0		
11	1956 Bldg	69	XRF	2/11/97	1	Bath	2	Door	Casing	Solid	Metal	0.23		
12	1956 Bldg	70	XRF	2/11/97	1	Bath	2		Diffuser	Solid	Metal	0.05		
13	1956 Bldg	71	XRF	2/11/97	1	Bath	2	Ceiling		Solid	Plaster	0.04		
14	1956 Bldg	77	XRF	2/11/97	1	Bath	3	Wall	Wall	Solid	Plaster	0.05		
15	1956 Bldg	78	XRF	2/11/97	1	Bath	3	Door	Door	Solid	Wood	0		
16	1956 Bldg	79	XRF	2/11/97	1	Bath	3	Door	Casing	Solid	Metal	0.11		
17	1956 Bldg	80	XRF	2/11/97	1	Bath	3	Wall	Baseboard	Solid	Tile	0.18		
18	1956 Bldg	81	XRF	2/11/97	1	Bath	3		Diffuser	Solid	Metal	0.01		
19	1956 Bldg	82	XRF	2/11/97	1	Bath	3	Ceiling		Cracked	Plaster	0.07		
20	1956 Bldg	83	XRF	2/11/97	1	Bath	4	Wall	Wall	Solid	Plaster	0.19		
21	1956 Bldg	84	XRF	2/11/97	1	Bath	4	Wall	Wall	Solid	Tile	0.4		
22	1956 Bldg	85	XRF	2/11/97	1	Bath	4	Hatch		Solid	Metal	0.11		
23	1956 Bldg	86	XRF	2/11/97	1	Bath	4	Partition		Solid	Metal	0		
24	1956 Bldg	87	XRF	2/11/97	1	Bath	4		Diffuser	Solid	Metal	0.03		
25	1956 Bldg	88	XRF	2/11/97	1	Bath	4	Ceiling		Cracked	Plaster	0.07		
26	1956 Bldg	89	XRF	2/11/97	1	Bath	5	Wall	Wall	Solid	Plaster	0.07		
27	1956 Bldg	90	XRF	2/11/97	1	Bath	5	Wall	Wall	Solid	Tile	0.17		
28	1956 Bldg	91	XRF	2/11/97	1	Bath	5	Partition	Wall	Solid	Metal	0		
29	1956 Bldg	92	XRF	2/11/97	1	Bath	5	Partition	Wall	Solid	Metal	0.01		
30	1956 Bldg	93	XRF	2/11/97	1	Bath	5		Diffuser	Solid	Metal	0.02		
31	1956 Bldg	94	XRF	2/11/97	1	Bath	5	Ceiling		Cracked	Plaster	0.06		
32	1956 Bldg	53	XRF	2/17/97	1	Bath	6	Wall	Wall	Solid	Plaster	0.3		
33	1956 Bldg	54	XRF	2/17/97	1	Bath	6	Wall	Wall	Solid	Tile	3.34		
34	1956 Bldg	55	XRF	2/17/97	1	Bath	6	Ceiling		Solid	Plaster	0.01		
35	1956 Bldg	56	XRF	2/17/97	1	Bath	6	Ceiling		Diffuser	Solid	Plaster	0.02	
36	1956 Bldg	57	XRF	2/17/97	1	Bath	6	Floor		Solid	Tile	0.18		
37	1956 Bldg	134	XRF	2/17/97	1	Bath	7	Wall	Wall	Solid	Plaster	0.08		
38	1956 Bldg	135	XRF	2/17/97	1	Bath	7	Wall	Wall	Solid	Plaster	0.01		
39	1956 Bldg	136	XRF	2/17/97	1	Bath	7	Wall	Wall	Solid	Metal	0.02		
40	1956 Bldg	137	XRF	2/17/97	1	Bath	7	Ceiling		Cracked	Plaster	0.04		
41	1956 Bldg	1	XRF	2/18/97	1	Bath	8	Partition		Solid	Metal	0.05		
42	1956 Bldg	2	XRF	2/18/97	1	Bath	8	Hatch		Solid	Metal	0		
43	1956 Bldg	3	XRF	2/18/97	1	Bath	8	Ceiling		Diffuser	Solid	Metal	0.02	
44	1956 Bldg	4	XRF	2/18/97	1	Bath	8	Ceiling			Cracked	Plaster	0.05	
45	1956 Bldg	5	XRF	2/18/97	1	Bath	8	Wall			Cracked	Tile	2.89	
46	1956 Bldg	6	XRF	2/18/97	1	Bath	8	Partition			Solid	Metal	0.04	
47	1956 Bldg	7	XRF	2/18/97	1	Bath	8	Hatch			Solid	Metal	0.06	
48	1956 Bldg	8	XRF	2/18/97	1	Bath	8	Ceiling			Hatch	Solid	0.02	
49	1956 Bldg	9	XRF	2/18/97	1	Bath	8	Wall			Solid	Drywall	0	
50	1956 Bldg	56	XRF	2/18/97	1	Bath	10	Wall	Wall		Cracked	Tile	2.9	
51	1956 Bldg	57	XRF	2/18/97	1	Bath	10	Ceiling			Diffuser	Solid	0.01	
52	1956 Bldg	58	XRF	2/18/97	1	Bath	10	Ceiling			Solid	Plaster	0.35	
53	1956 Bldg	177	XRF	2/21/97	1	Bath	12	Wall	Wall		Solid	Tile	1.99	
54	1956 Bldg	178	XRF	2/21/97	1	Bath	12	Wall	Wall		Solid	Drywall	0	
55	1956 Bldg	179	XRF	2/21/97	1	Bath	12	Hatch			Solid	Metal	0	
56	1956 Bldg	180	XRF	2/21/97	1	Bath	12	Hatch			Solid	Metal	0.05	
57	1956 Bldg	181	XRF	2/21/97	1	Bath	12	Wall			Middle Wall	Solid	Wood	
58	1956 Bldg	182	XRF	2/21/97	1	Bath	12	Partition			Solid	Metal	0.44	
59	1956 Bldg	183	XRF	2/21/97	1	Bath	12	Ceiling			Register	Solid	Metal	0.03
60	1956 Bldg	185	XRF	2/21/97	1	Bath	12	Ceiling			Hatch	Solid	Metal	0.03

Saint Paul Public Schools
 Hazel Park Academy
 Lead-Based Paint Inspection

3	A	B	C	D	E	F	G	H	I	J	K	L
	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
61	1956 Bldg	186	XRF	2/21/97	1	Bath	12	Ceiling		Solid	Plaster	0.15
62	1956 Bldg	296	XRF	2/22/97	2	Bath	13	Wall	Wall	Solid	Tile	2.7
63	1956 Bldg	297	XRF	2/22/97	2	Bath	13	Partition		Solid	Metal	0.04
64	1956 Bldg	298	XRF	2/22/97	2	Bath	13	Sink Base		Solid	Metal	0.38
65	1956 Bldg	299	XRF	2/22/97	2	Bath	13	Ceiling	Diffuser	Solid	Metal	0.02
66	1956 Bldg	300	XRF	2/22/97	2	Bath	13	Ceiling		Solid	Plaster	0.01
67	1956 Bldg	301	XRF	2/22/97	2	Bath	14	Wall	Wall	Solid	Tile	2.77
68	1956 Bldg	302	XRF	2/22/97	2	Bath	14	Hatch		Solid	Metal	0.02
69	1956 Bldg	303	XRF	2/22/97	2	Bath	14	Sink Base		Solid	Metal	0.8
70	1956 Bldg	304	XRF	2/22/97	2	Bath	14	Ceiling	Diffuser	Solid	Metal	0.02
71	1956 Bldg	305	XRF	2/22/97	2	Bath	14	Ceiling		Solid	Plaster	0.03
72	1956 Bldg	70	XRF	2/23/97	2	Bath	15	Wall	Wall	Solid	Tile	3.53
73	1956 Bldg	71	XRF	2/23/97	2	Bath	15	Sink Base		Solid	Metal	0.41
74	1956 Bldg	72	XRF	2/23/97	2	Bath	15	Partition		Solid	Metal	0.02
75	1956 Bldg	73	XRF	2/23/97	2	Bath	15	Ceiling	Diffuser	Solid	Metal	0.04
76	1956 Bldg	74	XRF	2/23/97	2	Bath	15	Hatch		Solid	Metal	0.02
77	1956 Bldg	75	XRF	2/23/97	2	Bath	15	Ceiling		Cracked	Plaster	0.14
78	1956 Bldg	76	XRF	2/23/97	2	Bath	15	Wall	Wall	Solid	Tile	3.02
79	1956 Bldg	77	XRF	2/23/97	2	Bath	16	Sink Base		Solid	Metal	0.65
80	1956 Bldg	78	XRF	2/23/97	2	Bath	16	Hatch		Solid	Metal	0.02
81	1956 Bldg	79	XRF	2/23/97	2	Bath	16	Partition		Solid	Metal	0.58
82	1956 Bldg	80	XRF	2/23/97	2	Bath	16	Ceiling	Diffuser	Solid	Metal	0.02
83	1956 Bldg	81	XRF	2/23/97	2	Bath	16	Ceiling		Cracked	Plaster	0.25
84	1956 Bldg	172	XRF	2/21/97	1	Bath	11B	Wall	Wall	Solid	Tile	2.41
85	1956 Bldg	173	XRF	2/21/97	1	Bath	11B	Partition		Solid	Metal	0.07
86	1956 Bldg	174	XRF	2/21/97	1	Bath	11B	Ceiling	Register	Solid	Metal	0.02
87	1956 Bldg	175	XRF	2/21/97	1	Bath	11B	Ceiling	Hatch	Solid	Metal	0
88	1956 Bldg	176	XRF	2/21/97	1	Bath	11B	Ceiling		Solid	Plaster	0.06
89	1956 Bldg	49	XRF	2/11/97	1	Hall	1	Wall	Wall	Solid	Tile	3.01
90	1956 Bldg	50	XRF	2/11/97	1	Hall	1	Wall	Wall	Solid	Tile	3.39
91	1956 Bldg	51	XRF	2/11/97	1	Hall	1	Wall	Middle Wall	Solid	Tile	0.17
92	1956 Bldg	52	XRF	2/11/97	1	Hall	1	Door	Door	Solid	Metal	0.13
93	1956 Bldg	53	XRF	2/11/97	1	Hall	1	Door	Casing	Solid	Metal	0.06
94	1956 Bldg	54	XRF	2/11/97	1	Hall	1	Door	Door	Solid	Wood	0
95	1956 Bldg	55	XRF	2/11/97	1	Hall	1	Door	Door	Solid	Metal	0
96	1956 Bldg	56	XRF	2/11/97	1	Hall	1	Door	Door	Solid	Wood	0
97	1956 Bldg	57	XRF	2/11/97	1	Hall	1		Radiator	Solid	Metal	0.02
98	1956 Bldg	58	XRF	2/11/97	1	Hall	1	Pole		Peeling	Metal	0.02
99	1956 Bldg	59	XRF	2/11/97	1	Hall	1	Window	Casing	Solid	Wood	0.02
100	1956 Bldg	60	XRF	2/11/97	1	Hall	1	Door	Vent	Solid	Metal	0.42
101	1956 Bldg	61	XRF	2/11/97	1	Hall	1	Hatch		Solid	Metal	0
102	1956 Bldg	149	XRF	2/11/97	1	Hall	2	Wall	Wall	Solid	Tile	0.08
103	1956 Bldg	150	XRF	2/11/97	1	Hall	2	Door	Door	Solid	Metal	0.01
104	1956 Bldg	151	XRF	2/11/97	1	Hall	2	Door	Casing	Solid	Metal	0.1
105	1956 Bldg	152	XRF	2/11/97	1	Hall	2	Ceiling		Solid	Plaster	0.01
106	1956 Bldg	144	XRF	2/17/97	1	Hall	3	Wall	Wall	Solid	Plaster	0.12
107	1956 Bldg	145	XRF	2/17/97	1	Hall	3	Wall	Wall	Solid	Tile	3.39
108	1956 Bldg	146	XRF	2/17/97	1	Hall	3	Wall	Wall	Solid	Tile	2.53
109	1956 Bldg	147	XRF	2/17/97	1	Hall	3	Wall	Wall	Solid	Plaster	0.17
110	1956 Bldg	148	XRF	2/17/97	1	Hall	3	Wall	Wall	Solid	Plaster	0.03
111	1956 Bldg	149	XRF	2/17/97	1	Hall	3	Door	Door	Solid	Wood	0
112	1956 Bldg	150	XRF	2/17/97	1	Hall	3	Door	Casing	Solid	Metal	0.06
113	1956 Bldg	151	XRF	2/17/97	1	Hall	3	Door	Door	Solid	Metal	0.12
114	1956 Bldg	152	XRF	2/17/97	1	Hall	3	Door	Casing	Solid	Metal	0.04
115	1956 Bldg	153	XRF	2/17/97	1	Hall	3	Door	Closer	Solid	Metal	0
116	1956 Bldg	154	XRF	2/17/97	1	Hall	3	Door	Door	Solid	Metal	0
117	1956 Bldg	155	XRF	2/17/97	1	Hall	3	Door	Casing	Solid	Metal	0
118	1956 Bldg	156	XRF	2/17/97	1	Hall	3		Radiator	Solid	Metal	0.17
119	1956 Bldg	157	XRF	2/17/97	1	Hall	3	Locker		Solid	Metal	0

Saint Paul Public Schools
 Hazel Park Academy
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
120	1956 Bldg	158	XRF	2/17/97	1	Hall	3	Bookcase	Shelf	Solid	Wood	0
121	1956 Bldg	159	XRF	2/17/97	1	Hall	3	Door	Elevator D	Solid	Metal	0
122	1956 Bldg	160	XRF	2/17/97	1	Hall	3	Door	Casing	Solid	Metal	0.01
123	1956 Bldg	161	XRF	2/17/97	1	Hall	3	Hatch		Solid	Metal	0
124	1956 Bldg	162	XRF	2/17/97	1	Hall	3	Door	Door	Solid	Metal	0.11
125	1956 Bldg	163	XRF	2/17/97	1	Hall	3	Door	Casing	Solid	Metal	0.22
126	1956 Bldg	164	XRF	2/17/97	1	Hall	3		Radiator	Solid	Metal	0
127	1956 Bldg	165	XRF	2/17/97	1	Hall	3	Wall	Midle Wall	Solid	Metal	0.58
128	1956 Bldg	166	XRF	2/17/97	1	Hall	3	Ceiling	Hatch	Solid	Metal	0
129	1956 Bldg	167	XRF	2/17/97	1	Hall	3	Ceiling		Solid	Drywall	0.05
130	1956 Bldg	168	XRF	2/17/97	1	Hall	3	Wall	Wall	Solid	Wood	0
131	1956 Bldg	199	XRF	2/21/97	2	Hall	4	Wall	Wall	Solid	Tile	2.52
132	1956 Bldg	200	XRF	2/21/97	2	Hall	4	Wall	Wall	Solid	Tile	2.94
133	1956 Bldg	201	XRF	2/21/97	2	Hall	4	Wall	Wall	Solid	Plaster	0.94
134	1956 Bldg	202	XRF	2/21/97	2	Hall	4	Cabinet	Outside	Solid	Wood	0
135	1956 Bldg	203	XRF	2/21/97	2	Hall	4	Cabinet	Shelf	Solid	Wood	0
136	1956 Bldg	204	XRF	2/21/97	2	Hall	4	Cabinet	Inside	Solid	Wood	0
137	1956 Bldg	205	XRF	2/21/97	2	Hall	4	Door	Door	Solid	Wood	0
138	1956 Bldg	206	XRF	2/21/97	2	Hall	4	Door	Casing	Solid	Metal	0.12
139	1956 Bldg	207	XRF	2/21/97	2	Hall	4	Door	Door	Solid	Metal	0
140	1956 Bldg	208	XRF	2/21/97	2	Hall	4	Door	Casing	Solid	Metal	0.01
141	1956 Bldg	209	XRF	2/21/97	2	Hall	4	Door	Door	Solid	Metal	0.03
142	1956 Bldg	210	XRF	2/21/97	2	Hall	4	Door	Casing	Solid	Metal	0.02
143	1956 Bldg	211	XRF	2/21/97	2	Hall	4	Wall	Wall Rgstr	Solid	Metal	0
144	1956 Bldg	212	XRF	2/21/97	2	Hall	4	Lockers		Solid	Metal	0.04
145	1956 Bldg	213	XRF	2/21/97	2	Hall	4		Radiator	Solid	Metal	0.57
146	1956 Bldg	214	XRF	2/21/97	2	Hall	4		Radiator	Solid	Metal	0.09
147	1956 Bldg	215	XRF	2/21/97	2	Hall	4	Ceiling		Solid	Drywall	0
148	1956 Bldg	216	XRF	2/21/97	2	Hall	4	Soffit		Solid	Wood	0
149	1956 Bldg	217	XRF	2/21/97	2	Hall	4	Ceiling	Register	Solid	Metal	0.01
150	1956 Bldg	218	XRF	2/21/97	2	Hall	4	Ceiling	Hatch	Solid	Metal	0.04
151	1956 Bldg	125	XRF	2/23/97	1	Outside	0	Ext Wall	Trim	Solid	Metal	0.11
152	1956 Bldg	126	XRF	2/23/97	1	Outside	0	Column	Corner brd	Solid	Concrete	0.08
153	1956 Bldg	127	XRF	2/23/97	1	Outside	0	Ext Wall	Siding	Solid	Concrete	0.13
154	1956 Bldg	129	XRF	2/23/97	1	Outside	0	Door	Door	Solid	Metal	0.1
155	1956 Bldg	130	XRF	2/23/97	1	Outside	0	Door	Jamb	Solid	Metal	0.04
156	1956 Bldg	131	XRF	2/23/97	1	Outside	0	Window	Panel	Solid	Wood	0.23
157	1956 Bldg	132	XRF	2/23/97	1	Outside	0	Window	Panel	Solid	Metal	0.01
158	1956 Bldg	133	XRF	2/23/97	1	Outside	0	Door	Door	Solid	Metal	0.15
159	1956 Bldg	134	XRF	2/23/97	1	Outside	0	Door	Jamb	Solid	Metal	0.03
160	1956 Bldg	135	XRF	2/23/97	1	Outside	0	Pole	Jamb	Solid	Metal	1.31
161	1956 Bldg	136	XRF	2/23/97	1	Outside	0	Ceiling	Overhang	Solid	Metal	1.86
162	1956 Bldg	137	XRF	2/23/97	1	Outside	0	Stairs	Hand rail	Solid	Metal	0.01
163	1956 Bldg	120	XRF	2/23/97	2	Room	0	Soffit		Solid	Plaster	0
164	1956 Bldg	121	XRF	2/23/97	2	Room	0	Door	Door	Solid	Metal	0.38
165	1956 Bldg	122	XRF	2/23/97	2	Room	0	Door	Casing	Solid	Metal	0.27
166	1956 Bldg	123	XRF	2/23/97	2	Room	0	Wall	Wall	Solid	Tile	0.87
167	1956 Bldg	124	XRF	2/23/97	2	Room	0	Column		Solid	Concrete	0.03
168	1956 Bldg	6	XRF	2/10/97	1	Room	1	Wall	Wall	Solid	Plaster	0.08
169	1956 Bldg	7	XRF	2/10/97	1	Room	1	Wall	Wall	Cracked	Drywall	0.08
170	1956 Bldg	8	XRF	2/10/97	1	Room	1	Door	Door	Solid	Wood	0.02
171	1956 Bldg	9	XRF	2/10/97	1	Room	1	Door	Casing	Solid	Metal	0.07
172	1956 Bldg	10	XRF	2/10/97	1	Room	1	Blinds		Solid	Vinyl	0.89
173	1956 Bldg	11	XRF	2/10/97	1	Room	1	Window	Panel	Solid	Wood	0
174	1956 Bldg	12	XRF	2/10/97	1	Room	1		Radiator	Solid	Metal	0.17
175	1956 Bldg	13	XRF	2/10/97	1	Room	1	Pole		Solid	Metal	0.04
176	1956 Bldg	14	XRF	2/10/97	1	Room	1	Window	Casing	Solid	Wood	0
177	1956 Bldg	15	XRF	2/10/97	1	Room	1	Window		Solid	Metal	0.01
178	1956 Bldg	16	XRF	2/10/97	1	Room	1		Elec Pane	Solid	Metal	0

Saint Paul Public Schools
 Hazel Park Academy
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
179	1956 Bldg	17	XRF	2/10/97	1	Room	1	Ceiling	Hatch	Solid	Metal	0.01
180	1956 Bldg	18	XRF	2/10/97	1	Room	1	Ceiling	Hatch	Solid	Metal	0
181	1956 Bldg	48	XRF	2/11/97	1	Room	1		Elec Pane	Solid	Metal	0.04
182	1956 Bldg	99	XRF	2/11/97	1	Room	2	Wall	Wall	Solid	Tile	0.06
183	1956 Bldg	100	XRF	2/11/97	1	Room	2	Wall	Wall	Solid	Plaster	0.42
184	1956 Bldg	101	XRF	2/11/97	1	Room	2	Door	Door	Solid	Metal	3.12
185	1956 Bldg	102	XRF	2/11/97	1	Room	2	Door	Casing	Solid	Metal	0.02
186	1956 Bldg	103	XRF	2/11/97	1	Room	2	Stairs	Hand rail	Peeling	Metal	0.04
187	1956 Bldg	104	XRF	2/11/97	1	Room	2	Stairs	Tread	Peeling	Metal	0.01
188	1956 Bldg	105	XRF	2/11/97	1	Room	2		Elec Pane	Solid	Metal	0.02
189	1956 Bldg	106	XRF	2/11/97	1	Room	2		Elec Pane	Solid	Concrete	0.01
190	1956 Bldg	107	XRF	2/11/97	1	Room	3	Wall	Wall	Cracked	Plaster	0.11
191	1956 Bldg	108	XRF	2/11/97	1	Room	3	Door	Door	Solid	Metal	3.15
192	1956 Bldg	109	XRF	2/11/97	1	Room	3	Door	Casing	Solid	Metal	0.07
193	1956 Bldg	110	XRF	2/11/97	1	Room	3		Radiator	Solid	Metal	0.23
194	1956 Bldg	111	XRF	2/11/97	1	Room	3	Diffuser		Solid	Metal	0.04
195	1956 Bldg	112	XRF	2/11/97	1	Room	3	Fan		Solid	Metal	0.01
196	1956 Bldg	113	XRF	2/11/97	1	Room	4	Wall	Wall	Solid	Tile	0.18
197	1956 Bldg	114	XRF	2/11/97	1	Room	4	Wall	Wall	Solid	Plaster	0.33
198	1956 Bldg	115	XRF	2/11/97	1	Room	4	Door	Door	Solid	Metal	0.11
199	1956 Bldg	116	XRF	2/11/97	1	Room	4	Door	Casing	Solid	Metal	0.02
200	1956 Bldg	117	XRF	2/11/97	1	Room	5	Stairs	Hand rail	Solid	Metal	0.03
201	1956 Bldg	118	XRF	2/11/97	1	Room	5	Door	Door	Solid	Metal	0.12
202	1956 Bldg	119	XRF	2/11/97	1	Room	5	Door	Casing	Solid	Metal	0.01
203	1956 Bldg	120	XRF	2/11/97	1	Room	6	Door	Door	Cracked	Wood	0.01
204	1956 Bldg	121	XRF	2/11/97	1	Room	6	Door	Casing	Solid	Metal	0.02
205	1956 Bldg	122	XRF	2/11/97	1	Room	6	Hatch		Solid	Wood	0
206	1956 Bldg	123	XRF	2/11/97	1	Room	7	Wall	Wall	Solid	Plaster	0.2
207	1956 Bldg	124	XRF	2/11/97	1	Room	7	Wall	Midle Wall	Solid	Plaster	0.07
208	1956 Bldg	125	XRF	2/11/97	1	Room	7	Wall	Wall	Solid	Plaster	0.11
209	1956 Bldg	126	XRF	2/11/97	1	Room	7	Wall	Wall	Solid	Wood	0
210	1956 Bldg	127	XRF	2/11/97	1	Room	7	Wall	Wall	Solid	Tile	0.02
211	1956 Bldg	128	XRF	2/11/97	1	Room	7	Door	Door	Solid	Metal	0
212	1956 Bldg	129	XRF	2/11/97	1	Room	7	Door	Casing	Solid	Metal	0.11
213	1956 Bldg	130	XRF	2/11/97	1	Room	7	Door	Door	Solid	Metal	0.09
214	1956 Bldg	131	XRF	2/11/97	1	Room	7	Door	Casing	Solid	Metal	0.06
215	1956 Bldg	133	XRF	2/11/97	1	Room	7	Wall	Register	Solid	Metal	1.13
216	1956 Bldg	134	XRF	2/11/97	1	Room	7	Chair Leg		Solid	Metal	0.64
217	1956 Bldg	135	XRF	2/11/97	1	Room	7	Chair		Solid	Wood	0.06
218	1956 Bldg	136	XRF	2/11/97	1	Room	7	Arm Rest		Solid	Wood	0
219	1956 Bldg	137	XRF	2/11/97	1	Room	7	Floor		Solid	Wood	0
220	1956 Bldg	138	XRF	2/11/97	1	Room	7	Wall	Wall	Solid	Wood	0
221	1956 Bldg	139	XRF	2/11/97	1	Room	7	Stairs	Hand rail	Solid	Metal	0.04
222	1956 Bldg	140	XRF	2/11/97	1	Room	7	Wall	Register	Solid	Metal	0.01
223	1956 Bldg	141	XRF	2/11/97	1	Room	7	Ceiling	Diffuser	Solid	Concrete	0.03
224	1956 Bldg	142	XRF	2/11/97	1	Room	7		Diffuser	Solid	Metal	0.07
225	1956 Bldg	143	XRF	2/11/97	1	Room	7	Wall	Wall	Solid	Wood	0
226	1956 Bldg	144	XRF	2/11/97	1	Room	8	Wall	Wall	Solid	Concrete	0.11
227	1956 Bldg	145	XRF	2/11/97	1	Room	8	Wall	Wall	Solid	Tile	0.15
228	1956 Bldg	146	XRF	2/11/97	1	Room	8	Wall	Wall	Solid	Wood	0.02
229	1956 Bldg	147	XRF	2/11/97	1	Room	8	Door	Door	Solid	Wood	0
230	1956 Bldg	148	XRF	2/11/97	1	Room	8	Door	Casing	Solid	Metal	0.09
231	1956 Bldg	153	XRF	2/11/97	1	Room	9	Wall	Wall	Solid	Concrete	0.16
232	1956 Bldg	154	XRF	2/11/97	1	Room	9	Wall	Wall	Solid	Tile	0.11
233	1956 Bldg	155	XRF	2/11/97	1	Room	9		Radiator	Solid	Metal	0.21
234	1956 Bldg	156	XRF	2/11/97	1	Room	9	Door	Jamb	Solid	Metal	0.03
235	1956 Bldg	157	XRF	2/11/97	1	Room	9	Ceiling		Peeling	Plaster	0.04
236	1956 Bldg	183	XRF	2/11/97	1	Room	10	Wall	Wall	Solid	Tile	4.09
237	1956 Bldg	184	XRF	2/11/97	1	Room	10	Door	Door	Solid	Wood	0.01

Saint Paul Public Schools
 Hazel Park Academy
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
238	1956 Bldg	185	XRF	2/11/97	1	Room	10	Door	Casing	Solid	Metal	0.06
239	1956 Bldg	186	XRF	2/11/97	1	Room	10	Partition		Solid	Plastic	0
240	1956 Bldg	187	XRF	2/11/97	1	Room	10	Bench	Casing	Solid	Wood	0.01
241	1956 Bldg	188	XRF	2/11/97	1	Room	10	Locker	Casing	Solid	Metal	0.11
242	1956 Bldg	189	XRF	2/11/97	1	Room	10	Cabinet	Shelf	Solid	Metal	0
243	1956 Bldg	190	XRF	2/11/97	1	Room	10		Radiator	Solid	Metal	0.01
244	1956 Bldg	191	XRF	2/11/97	1	Room	10	Ceiling		Solid	Plaster	0.01
245	1956 Bldg	192	XRF	2/11/97	1	Room	10		Diffuser	Solid	Metal	0.02
246	1956 Bldg	193	XRF	2/11/97	1	Room	10	Bulletin	Board	Solid	Wood	0.13
247	1956 Bldg	194	XRF	2/11/97	1	Room	10	Hatch		Solid	Metal	0
248	1956 Bldg	195	XRF	2/11/97	1	Room	10	Bulletin	Board	Solid	Wood	0
249	1956 Bldg	196	XRF	2/11/97	1	Room	10	Wall	Wall	Solid	Tile	1.89
250	1956 Bldg	197	XRF	2/11/97	1	Room	10	Wall	Midle Wall	Solid	Tile	1.35
251	1956 Bldg	198	XRF	2/11/97	1	Room	10	Partition		Solid	Metal	0.02
252	1956 Bldg	199	XRF	2/11/97	1	Room	11	Wall	Wall	Cracked	Plaster	0.08
253	1956 Bldg	200	XRF	2/11/97	1	Room	11	Bookcase	Shelf	Solid	Wood	0.01
254	1956 Bldg	201	XRF	2/11/97	1	Room	11	Ceiling		Solid	Plaster	0.05
255	1956 Bldg	202	XRF	2/11/97	1	Room	12	Wall	Wall	Solid	Plaster	0.02
256	1956 Bldg	203	XRF	2/11/97	1	Room	12	Ceiling		Solid	Plaster	0.04
257	1956 Bldg	204	XRF	2/11/97	1	Room	12	Hatch		Solid	Metal	0.04
258	1956 Bldg	205	XRF	2/11/97	1	Room	12	Hatch		Solid	Metal	0.03
259	1956 Bldg	206	XRF	2/11/97	1	Room	12		Diffuser	Solid	Metal	0.04
260	1956 Bldg	207	XRF	2/11/97	1	Room	12		Elec Pane	Solid	Metal	0.09
261	1956 Bldg	208	XRF	2/11/97	1	Room	12		Elec Pane	Solid	Wood	1.24
262	1956 Bldg	6	XRF	2/17/97	11	Room	13	Wall	Wall	Cracked	Concrete	0.03
263	1956 Bldg	7	XRF	2/17/97	11	Room	13	Door	Door	Solid	Wood	0.01
264	1956 Bldg	8	XRF	2/17/97	11	Room	13	Door	Casing	Cracked	Metal	0.08
265	1956 Bldg	9	XRF	2/17/97	11	Room	13	Ceiling		Solid	Plaster	0.11
266	1956 Bldg	10	XRF	2/17/97	11	Room	13		Diffuser	Solid	Metal	0.01
267	1956 Bldg	11	XRF	2/17/97	11	Room	13	Ladder		Solid	Metal	0.04
268	1956 Bldg	12	XRF	2/17/97	11	Room	13	Coat Rack		Solid	Wood	0
269	1956 Bldg	13	XRF	2/17/97	11	Room	13	Hatch		Solid	Metal	0.02
270	1956 Bldg	14	XRF	2/17/97	1	Room	14	Wall	Wall	Solid	Tile	3.63
271	1956 Bldg	15	XRF	2/17/97	1	Room	14	Door	Door	Solid	Wood	0
272	1956 Bldg	16	XRF	2/17/97	1	Room	14	Door	Vent	Solid	Metal	0.02
273	1956 Bldg	17	XRF	2/17/97	1	Room	14	Ceiling		Solid	Plaster	0
274	1956 Bldg	18	XRF	2/17/97	1	Room	14	Door	Casing	Solid	Metal	0.14
275	1956 Bldg	19	XRF	2/17/97	1	Room	14	Wall	Wall	Solid	Drywall	0.02
276	1956 Bldg	20	XRF	2/17/97	1	Room	14	Partition		Solid	Drywall	0
277	1956 Bldg	21	XRF	2/17/97	1	Room	14	Ceiling		Solid	Metal	0.03
278	1956 Bldg	22	XRF	2/17/97	1	Room	14	Bench		Solid	Wood	0
279	1956 Bldg	23	XRF	2/17/97	1	Room	14	Post		Solid	Metal	0.69
280	1956 Bldg	24	XRF	2/17/97	1	Room	14	Locker		Solid	Metal	0
281	1956 Bldg	25	XRF	2/17/97	1	Room	14	Ceiling	Hatch	Solid	Metal	0
282	1956 Bldg	26	XRF	2/17/97	1	Room	14	Ceiling	Diffuser	Solid	Metal	0.02
283	1956 Bldg	27	XRF	2/17/97	1	Room	15	Wall	Wall	Solid	Tile	3.5
284	1956 Bldg	28	XRF	2/17/97	1	Room	15	Wall	Midle Wall	Solid	Tile	3.27
285	1956 Bldg	29	XRF	2/17/97	1	Room	15	Door	Door	Solid	Wood	0
286	1956 Bldg	30	XRF	2/17/97	1	Room	15	Door	Door	Solid	Metal	0.03
287	1956 Bldg	31	XRF	2/17/97	1	Room	15	Door	Casing	Solid	Metal	0.11
288	1956 Bldg	33	XRF	2/17/97	1	Room	15	Ceiling		Cracked	Plaster	0.01
289	1956 Bldg	34	XRF	2/17/97	1	Room	15	Ceiling	Diffuser	Cracked	Metal	0.01
290	1956 Bldg	35	XRF	2/17/97	1	Room	15		Diffuser	Solid	Metal	0.02
291	1956 Bldg	36	XRF	2/17/97	1	Room	15	Locker		Solid	Metal	0.01
292	1956 Bldg	37	XRF	2/17/97	1	Room	15	Locker	Shelf	Solid	Metal	0
293	1956 Bldg	38	XRF	2/17/97	1	Room	16	Wall	Wall	Solid	Tile	1.87
294	1956 Bldg	39	XRF	2/17/97	1	Room	16	Wall	Midle Wall	Solid	Tile	1.35
295	1956 Bldg	40	XRF	2/17/97	1	Room	16	Ceiling		Solid	Plaster	0.01
296	1956 Bldg	41	XRF	2/17/97	1	Room	16	Ceiling	Radiator	Solid	Metal	0.01

Saint Paul Public Schools
 Hazel Park Academy
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
297	1956 Bldg	42	XRF	2/17/97	1	Room	16	Partition		Solid	Plastic	0
298	1956 Bldg	43	XRF	2/17/97	1	Room	17	Wall	Wall	Solid	Plaster	0.01
299	1956 Bldg	44	XRF	2/17/97	1	Room	17	Door	Door	Solid	Wood	0
300	1956 Bldg	45	XRF	2/17/97	1	Room	17	Door	Casing	Solid	Metal	0.06
301	1956 Bldg	46	XRF	2/17/97	1	Room	17	Door	Closer	Solid	Metal	0.02
302	1956 Bldg	47	XRF	2/17/97	1	Room	17		Elec Pane	Solid	Metal	0.09
303	1956 Bldg	48	XRF	2/17/97	1	Room	17	Wire Tray		Solid	Metal	0.02
304	1956 Bldg	49	XRF	2/17/97	1	Room	17	Ceiling		Solid	Plaster	0.02
305	1956 Bldg	50	XRF	2/17/97	1	Room	17	Ceiling	Diffuser	Solid	Metal	0.01
306	1956 Bldg	51	XRF	2/17/97	1	Room	17	Closet	Wall	Solid	Plaster	0.04
307	1956 Bldg	52	XRF	2/17/97	1	Room	17	Ceiling		Solid	Plaster	0.03
308	1956 Bldg	90	XRF	2/17/97	1	Room	18	Wall	Wall	Solid	Concrete	0.22
309	1956 Bldg	91	XRF	2/17/97	1	Room	18	Bookcase	Shelf	Solid	Wood	0
310	1956 Bldg	92	XRF	2/17/97	1	Room	18	Ceiling		Cracked	Plaster	0.06
311	1956 Bldg	93	XRF	2/17/97	1	Room	18	Hatch		Cracked	Metal	0.07
312	1956 Bldg	94	XRF	2/17/97	1	Room	19	Wall	Wall	Cracked	Plaster	1.32
313	1956 Bldg	95	XRF	2/17/97	1	Room	19	Wall	Wall	Cracked	Wood	0.02
314	1956 Bldg	96	XRF	2/17/97	1	Room	19	Wall	Wall	Solid	Tile	2.7
315	1956 Bldg	97	XRF	2/17/97	1	Room	19	Wall	Wall	Solid	Wood	0.01
316	1956 Bldg	98	XRF	2/17/97	1	Room	19	Pole		Solid	Metal	0.02
317	1956 Bldg	99	XRF	2/17/97	1	Room	19		Radiator	Solid	Metal	0
318	1956 Bldg	100	XRF	2/17/97	1	Room	19	Paneling		Solid	Wood	0.01
319	1956 Bldg	101	XRF	2/17/97	1	Room	19	Chalkboard		Solid	Wood	0.02
320	1956 Bldg	102	XRF	2/17/97	1	Room	19	Wall	Wall	Solid	Wood	0.01
321	1956 Bldg	103	XRF	2/17/97	1	Room	19	Wall	Wall	Solid	Plaster	0.09
322	1956 Bldg	104	XRF	2/17/97	1	Room	19	Wall	Wall Rgstr	Solid	Metal	0.01
323	1956 Bldg	106	XRF	2/17/97	1	Room	20	Wall	Wall	Solid	Wood	0
324	1956 Bldg	107	XRF	2/17/97	1	Room	20	Door	Door	Solid	Wood	0
325	1956 Bldg	108	XRF	2/17/97	1	Room	20	Window	Casing	Solid	Wood	0
326	1956 Bldg	109	XRF	2/17/97	1	Room	20	Door	Casing	Solid	Wood	0
327	1956 Bldg	110	XRF	2/17/97	1	Room	20	Ceiling	Register	Solid	Wood	0.03
328	1956 Bldg	111	XRF	2/17/97	1	Room	20	Ceiling	Diffuser	Solid	Wood	0
329	1956 Bldg	112	XRF	2/17/97	1	Room	20	Ceiling	Speaker C	Solid	Metal	0
330	1956 Bldg	113	XRF	2/17/97	1	Room	21	Wall	Wall	Solid	Tile	0.38
331	1956 Bldg	114	XRF	2/17/97	1	Room	21	Wall	Wall	Solid	Tile	2.72
332	1956 Bldg	115	XRF	2/17/97	1	Room	21	Ceiling	Speaker C	Solid	Metal	0.01
333	1956 Bldg	117	XRF	2/17/97	1	Room	22	Wall	Wall	Solid	Tile	3.11
334	1956 Bldg	118	XRF	2/17/97	1	Room	22	Door	Door	Solid	Wood	0
335	1956 Bldg	119	XRF	2/17/97	1	Room	22	Door	Casing	Solid	Metal	0.09
336	1956 Bldg	120	XRF	2/17/97	1	Room	22	Door	Door	Solid	Wood	0
337	1956 Bldg	121	XRF	2/17/97	1	Room	22		Radiator	Solid	Metal	0.17
338	1956 Bldg	122	XRF	2/17/97	1	Room	22	Wall	Wall Rgstr	Solid	Metal	0.01
339	1956 Bldg	123	XRF	2/17/97	1	Room	22	Ceiling	Diffuser	Solid	Metal	0.01
340	1956 Bldg	124	XRF	2/17/97	1	Room	22	Ceiling	Speaker C	Solid	Metal	0
341	1956 Bldg	125	XRF	2/17/97	1	Room	22	Ceiling	Diffuser	Solid	Metal	0.01
342	1956 Bldg	126	XRF	2/17/97	1	Room	22	Ceiling	Hatch	Solid	Metal	0
343	1956 Bldg	127	XRF	2/17/97	1	Room	24	Wall	Wall	Solid	Plaster	0.01
344	1956 Bldg	128	XRF	2/17/97	1	Room	24	Door	Door	Solid	Wood	0
345	1956 Bldg	129	XRF	2/17/97	1	Room	24	Door	Casing	Solid	Metal	0.08
346	1956 Bldg	130	XRF	2/17/97	1	Room	24		Radiator	Solid	Metal	0.04
347	1956 Bldg	131	XRF	2/17/97	1	Room	24	Locker		Solid	Metal	0.05
348	1956 Bldg	132	XRF	2/17/97	1	Room	24	Ceiling		Solid	Plaster	0.09
349	1956 Bldg	133	XRF	2/17/97	1	Room	24	Ceiling	Diffuser	Solid	Metal	0.05
350	1956 Bldg	138	XRF	2/17/97	1	Room	25	Wall	Wall	Cracked	Tile	3.38
351	1956 Bldg	139	XRF	2/17/97	1	Room	26	Wall	Wall	Solid	Concrete	0.08
352	1956 Bldg	140	XRF	2/17/97	1	Room	26	Wall	Wall	Solid	Concrete	0.19
353	1956 Bldg	141	XRF	2/17/97	1	Room	26	Door	Casing	Solid	Metal	0.02
354	1956 Bldg	142	XRF	2/17/97	1	Room	26	Ceiling		Solid	Plaster	0.11
355	1956 Bldg	143	XRF	2/17/97	1	Room	26	Ceiling	Diffuser	Solid	Metal	0

Saint Paul Public Schools
 Hazel Park Academy
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
356	1956 Bldg	170	XRF	2/17/97	1	Room	27	Wall	Wall		Concrete	0.07
357	1956 Bldg	171	XRF	2/17/97	1	Room	27	Wall	Wall	Solid	Wood	0
358	1956 Bldg	172	XRF	2/17/97	1	Room	27	Ceiling		Solid	Plaster	0.04
359	1956 Bldg	173	XRF	2/17/97	1	Room	27	Ceiling	Diffuser	Solid	Metal	0.03
360	1956 Bldg	174	XRF	2/17/97	1	Room	28	Wall	Wall	Solid	Concrete	0.08
361	1956 Bldg	175	XRF	2/17/97	1	Room	28	Wall	Wall	Solid	Concrete	0.12
362	1956 Bldg	176	XRF	2/17/97	1	Room	28	Door	Door	Solid	Metal	0.09
363	1956 Bldg	177	XRF	2/17/97	1	Room	28	Door	Header	Solid	Metal	0.07
364	1956 Bldg	178	XRF	2/17/97	1	Room	28	Door	Casing	Solid	Metal	0.02
365	1956 Bldg	179	XRF	2/17/97	1	Room	28	Wall	Wall	Solid	Concrete	0.28
366	1956 Bldg	180	XRF	2/17/97	1	Room	28	Floor		Solid	Concrete	0.05
367	1956 Bldg	181	XRF	2/17/97	1	Room	28	Stairs	Hand rail	Solid	Metal	0.01
368	1956 Bldg	182	XRF	2/17/97	1	Room	28	Stairs	Stringer	Solid	Metal	0.03
369	1956 Bldg	183	XRF	2/17/97	1	Room	28	Wall	Wall	Solid	Drywall	0
370	1956 Bldg	184	XRF	2/17/97	1	Room	28	Door	Door	Solid	Metal	0
371	1956 Bldg	185	XRF	2/17/97	1	Room	28	Door	Casing	Solid	Metal	0.01
372	1956 Bldg	186	XRF	2/17/97	1	Room	28		Elec Pane	Solid	Metal	0
373	1956 Bldg	187	XRF	2/17/97	1	Room	28		Elec Pane	Solid	Metal	0.01
374	1956 Bldg	188	XRF	2/17/97	1	Room	28		Elec Pane	Solid	Metal	0.05
375	1956 Bldg	189	XRF	2/17/97	1	Room	28		Elec Pane	Solid	Metal	0.06
376	1956 Bldg	190	XRF	2/17/97	1	Room	28	Bookcase	Shelf	Solid	Wood	0.01
377	1956 Bldg	191	XRF	2/17/97	1	Room	28	Door	Door	Solid	Metal	4.64
378	1956 Bldg	192	XRF	2/17/97	1	Room	28	Door	Door	Solid	Wood	0.04
379	1956 Bldg	193	XRF	2/17/97	1	Room	29	Wall	Wall	Solid	Drywall	0
380	1956 Bldg	194	XRF	2/17/97	1	Room	29	Wall	Wall	Solid	Concrete	0.23
381	1956 Bldg	195	XRF	2/17/97	1	Room	29	Ceiling		Solid	Drywall	0
382	1956 Bldg	60	XRF	2/18/97	1	Room	29	Wall	Wall	Cracked	Plaster	0.16
383	1956 Bldg	61	XRF	2/18/97	1	Room	29	Ceiling		Solid	Drywall	0.19
384	1956 Bldg	91	XRF	2/21/97	1	Room	30	Wall	Wall	Solid	Tile	3.14
385	1956 Bldg	92	XRF	2/21/97	1	Room	30	Door	Door	Solid	Wood	0
386	1956 Bldg	93	XRF	2/21/97	1	Room	30	Door	Casing	Solid	Metal	0.08
387	1956 Bldg	94	XRF	2/21/97	1	Room	30	Bookcase	Shelf	Solid	Wood	0
388	1956 Bldg	95	XRF	2/21/97	1	Room	30	Ceiling	Diffuser	Solid	Metal	0.05
389	1956 Bldg	96	XRF	2/21/97	1	Room	30	Ceiling		Solid	Plaster	0.16
390	1956 Bldg	97	XRF	2/21/97	1	Room	31	Wall	Wall	Solid	Plaster	0.15
391	1956 Bldg	98	XRF	2/21/97	1	Room	31		Elec Pane	Solid	Metal	0.07
392	1956 Bldg	99	XRF	2/21/97	1	Room	31	Ceiling		Cracked	Plaster	0.31
393	1956 Bldg	136	XRF	2/21/97	1	Room	32	Wall	Wall	Solid	Plaster	0.14
394	1956 Bldg	137	XRF	2/21/97	1	Room	32	Wall	Wall	Solid	Tile	2.9
395	1956 Bldg	138	XRF	2/21/97	1	Room	32	Wall	Midle Wall	Solid	Drywall	0.01
396	1956 Bldg	139	XRF	2/21/97	1	Room	32	Door	Door	Peeling	Metal	0.21
397	1956 Bldg	140	XRF	2/21/97	1	Room	32	Door	Casing	Peeling	Metal	0.08
398	1956 Bldg	141	XRF	2/21/97	1	Room	32	Wall	Wall	Solid	Wood	0.01
399	1956 Bldg	142	XRF	2/21/97	1	Room	32	Wall	Baseboar	Solid	Wood	0
400	1956 Bldg	143	XRF	2/21/97	1	Room	32		Radiator	Solid	Metal	0
401	1956 Bldg	144	XRF	2/21/97	1	Room	32		Elec Pane	Solid	Metal	0.01
402	1956 Bldg	145	XRF	2/21/97	1	Room	32	Wire Tray		Solid	Metal	0.02
403	1956 Bldg	146	XRF	2/21/97	1	Room	32	Wall	Wall Rgstr	Solid	Metal	0.04
404	1956 Bldg	147	XRF	2/21/97	1	Room	32	Floor		Solid	Wood	0.03
405	1956 Bldg	219	XRF	2/21/97	2	Room	33	Wall	Wall	Solid	Concrete	0.07
406	1956 Bldg	220	XRF	2/21/97	2	Room	33	Wall	Wall	Solid	Wood	0
407	1956 Bldg	221	XRF	2/21/97	2	Room	33	Ceiling	Register	Solid	Metal	0.01
408	1956 Bldg	222	XRF	2/21/97	2	Room	33	Ceiling		Solid	Plaster	0.05
409	1956 Bldg	256	XRF	2/22/97	2	Room	34	Wall	Wall	Solid	Plaster	0.05
410	1956 Bldg	257	XRF	2/22/97	2	Room	34	Wall	Wall	Solid	Wood	0.01
411	1956 Bldg	258	XRF	2/22/97	2	Room	34	Wall	Wall	Solid	Wood	0.07
412	1956 Bldg	259	XRF	2/22/97	2	Room	34		Radiator	Solid	Metal	0.01
413	1956 Bldg	260	XRF	2/22/97	2	Room	34	Air Conditioni	Panel	Solid	Metal	0.12
414	1956 Bldg	261	XRF	2/22/97	2	Room	34	Ceiling	Register	Solid	Metal	0.04

Saint Paul Public Schools
 Hazel Park Academy
 Lead-Based Paint Inspection

A	B	C	D	E	F	G	H	I	J	K	L	
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
415	1956 Bldg	262	XRF	2/22/97	2	Room	34	Hatch		Solid	Metal	0.06
416	1956 Bldg	263	XRF	2/22/97	2	Room	35	Wall	Wall	Solid	Plaster	0.01
417	1956 Bldg	264	XRF	2/22/97	2	Room	35	Wall	Wall	Solid	Wood	0
418	1956 Bldg	265	XRF	2/22/97	2	Room	35	Wall	Radiator	Solid	Metal	0.06
419	1956 Bldg	266	XRF	2/22/97	2	Room	35	Hatch		Solid	Metal	0.02
420	1956 Bldg	267	XRF	2/22/97	2	Room	35	Ceiling	Diffuser	Solid	Metal	0.02
421	1956 Bldg	314	XRF	2/22/97	2	Room	36	Wall	Wall	Solid	Plaster	0.18
422	1956 Bldg	315	XRF	2/22/97	2	Room	36	Wall	Wall	Solid	Wood	0.05
423	1956 Bldg	316	XRF	2/22/97	2	Room	36	Wall	Wall	Solid	Wood	0.01
424	1956 Bldg	317	XRF	2/22/97	2	Room	36		Radiator	Solid	Metal	0.01
425	1956 Bldg	318	XRF	2/22/97	2	Room	36	Door	Door	Solid	Wood	0.01
426	1956 Bldg	319	XRF	2/22/97	2	Room	36	Hatch		Solid	Metal	0.03
427	1956 Bldg	320	XRF	2/22/97	2	Room	36	Ceiling	Hatch	Solid	Metal	0.17
428	1956 Bldg	321	XRF	2/22/97	2	Room	37	Wall	Wall	Solid	Wood	0.03
429	1956 Bldg	322	XRF	2/22/97	2	Room	37	Wall	Wall	Solid	Wood	0.08
430	1956 Bldg	323	XRF	2/22/97	2	Room	37	Wall	Wall	Solid	Tile	2.42
431	1956 Bldg	324	XRF	2/22/97	2	Room	37	Wall	Wall	Solid	Wood	0
432	1956 Bldg	325	XRF	2/22/97	2	Room	37	Wall	Wall	Solid	Wood	0
433	1956 Bldg	326	XRF	2/22/97	2	Room	37	Wall	Wall	Solid	Plaster	0.03
434	1956 Bldg	327	XRF	2/22/97	2	Room	37		Radiator	Solid	Metal	0.01
435	1956 Bldg	328	XRF	2/22/97	2	Room	37	Wall	Wall Rgstr	Solid	Metal	0.04
436	1956 Bldg	329	XRF	2/22/97	2	Room	37	Sound Barrier		Solid	Metal	0
437	1956 Bldg	330	XRF	2/22/97	2	Room	37	Wire Tray		Solid	Metal	0
438	1956 Bldg	331	XRF	2/22/97	2	Room	37	Ceiling		Solid	Plaster	0.15
439	1956 Bldg	332	XRF	2/22/97	2	Room	37	Door	Casing	Solid	Metal	0.11
440	1956 Bldg	360	XRF	2/22/97	2	Room	38	Wall	Wall	Cracked	Plaster	0.01
441	1956 Bldg	361	XRF	2/22/97	2	Room	38	Ceiling		Solid	Drywall	0.21
442	1956 Bldg	374	XRF	2/22/97	2	Room	39	Wall	Wall	Solid	Plaster	0.07
443	1956 Bldg	375	XRF	2/22/97	2	Room	39	Wall	Wall	Solid	Plaster	0.06
444	1956 Bldg	376	XRF	2/22/97	2	Room	39	Wall	Wall	Solid	Wood	0
445	1956 Bldg	377	XRF	2/22/97	2	Room	39	Bookcase	Shelf	Solid	Wood	0.01
446	1956 Bldg	378	XRF	2/22/97	2	Room	39	Bookcase	Shelf	Solid	Wood	0
447	1956 Bldg	379	XRF	2/22/97	2	Room	39	Door	Door	Solid	Wood	0.01
448	1956 Bldg	380	XRF	2/22/97	2	Room	39	Door	Casing	Solid	Metal	0.11
449	1956 Bldg	381	XRF	2/22/97	2	Room	39	Window	Casing	Solid	Metal	0.07
450	1956 Bldg	382	XRF	2/22/97	2	Room	39		Radiator	Solid	Metal	0.12
451	1956 Bldg	383	XRF	2/22/97	2	Room	39	Bookcase	Shelf	Solid	Wood	0
452	1956 Bldg	384	XRF	2/22/97	2	Room	39	Bulletin	Board	Solid	Wood	0.01
453	1956 Bldg	385	XRF	2/22/97	2	Room	39	Wall	Wall Rgstr	Solid	Metal	0.01
454	1956 Bldg	386	XRF	2/22/97	2	Room	39	Sound Barrier		Solid	Metal	0
455	1956 Bldg	387	XRF	2/22/97	2	Room	39	Wire Tray		Solid	Metal	0
456	1956 Bldg	388	XRF	2/22/97	2	Room	39	Ceiling		Solid	Plaster	0.18
457	1956 Bldg	389	XRF	2/22/97	2	Room	40	Ceiling		Solid	Plaster	0.4
458	1956 Bldg	390	XRF	2/22/97	2	Room	40	Wall	Wall	Solid	Plaster	0.35
459	1956 Bldg	391	XRF	2/22/97	2	Room	40	Wall	Wall	Solid	Wood	0.01
460	1956 Bldg	392	XRF	2/22/97	2	Room	40	Bookcase	Shelf	Solid	Wood	0
461	1956 Bldg	393	XRF	2/22/97	2	Room	40		Radiator	Solid	Metal	0.03
462	1956 Bldg	394	XRF	2/22/97	2	Room	40	Bookcase	Shelf	Solid	Wood	0
463	1956 Bldg	395	XRF	2/22/97	2	Room	41	Wall	Wall	Solid	Plaster	0.36
464	1956 Bldg	396	XRF	2/22/97	2	Room	41	Ceiling	Diffuser	Solid	Metal	0.03
465	1956 Bldg	397	XRF	2/22/97	2	Room	41	Ceiling		Cracked	Plaster	0.42
466	1956 Bldg	12	XRF	2/23/97	2	Room	41	Wall	Wall	Solid	Plaster	0.36
467	1956 Bldg	13	XRF	2/23/97	2	Room	41	Wall	Elec Pane	Solid	Metal	0.1
468	1956 Bldg	14	XRF	2/23/97	2	Room	41	Wall	Diffuser	Solid	Metal	0.03
469	1956 Bldg	15	XRF	2/23/97	2	Room	41	Ceiling		Cracked	Plaster	0.39
470	1956 Bldg	16	XRF	2/23/97	2	Room	41	Bookcase	Shelf	Solid	Wood	0
471	1956 Bldg	19	XRF	2/10/97	1	Room	77	Wall	Wall	Solid	Plaster	0.11
472	1956 Bldg	20	XRF	2/10/97	1	Room	77	Door	Door	Solid	Wood	0.01
473	1956 Bldg	21	XRF	2/10/97	1	Room	77	Door	Jamb	Solid	Metal	0.06

Saint Paul Public Schools
 Hazel Park Academy
 Lead-Based Paint Inspection

A	B	C	D	E	F	G	H	I	J	K	L	
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
474	1956 Bldg	22	XRF	2/10/97	1	Room	77	Radiator	Solid	Metal		0.03
475	1956 Bldg	23	XRF	2/10/97	1	Room	77	Wall	Register	Solid	Metal	0.01
476	1956 Bldg	24	XRF	2/10/97	1	Room	77	Hatch		Solid	Metal	0.05
477	1956 Bldg	25	XRF	2/10/97	1	Room	77	Wall	Wall	Solid	Plaster	0.07
478	1956 Bldg	26	XRF	2/10/97	1	Room	78	Wall	Wall	Solid	Plaster	0.14
479	1956 Bldg	27	XRF	2/10/97	1	Room	78	Wall	Wall	Solid	Plaster	0.09
480	1956 Bldg	28	XRF	2/10/97	1	Room	78		Radiator	Solid	Metal	0.02
481	1956 Bldg	29	XRF	2/10/97	1	Room	78	Ceiling		Solid	Plaster	0.2
482	1956 Bldg	30	XRF	2/10/97	1	Room	78	Ceiling	Hatch	Solid	Metal	0.01
483	1956 Bldg	31	XRF	2/10/97	1	Room	79	Wall	Wall	Solid	Plaster	0.13
484	1956 Bldg	32	XRF	2/10/97	1	Room	79	Wall	Baseboar	Cracked	Wood	0
485	1956 Bldg	33	XRF	2/10/97	1	Room	79	Blinds		Cracked	Vinyl	0.62
486	1956 Bldg	34	XRF	2/10/97	1	Room	79		Radiator	Cracked	Metal	0.02
487	1956 Bldg	35	XRF	2/10/97	1	Room	79	Wall	Radiator	Cracked	Metal	0.02
488	1956 Bldg	37	XRF	2/10/97	1	Room	79	Ceiling	Hatch	Solid	Metal	0.01
489	1956 Bldg	38	XRF	2/10/97	1	Room	79	Closet	Wall	Solid	Plaster	0.26
490	1956 Bldg	39	XRF	2/10/97	1	Room	79	Closet	Shelf	Solid	Wood	0
491	1956 Bldg	6	XRF	2/11/97	1	Room	80	Wall	Wall	Cracked	Plaster	0.08
492	1956 Bldg	7	XRF	2/11/97	1	Room	80	Wall	Wall	Cracked	Plaster	0.24
493	1956 Bldg	8	XRF	2/11/97	1	Room	80	Wall	Wall	Cracked	Plaster	0.15
494	1956 Bldg	9	XRF	2/11/97	1	Room	80	Ceiling		Cracked	Plaster	0.2
495	1956 Bldg	10	XRF	2/11/97	1	Room	80	Coat Rackf		Solid	Metal	0.02
496	1956 Bldg	11	XRF	2/11/97	1	Room	80		Diffuser	Solid	Metal	0.01
497	1956 Bldg	12	XRF	2/11/97	1	Room	81	Wall	Wall	Solid	Plaster	0.07
498	1956 Bldg	13	XRF	2/11/97	1	Room	81	Wall	Wall	Solid	Wood	0.01
499	1956 Bldg	14	XRF	2/11/97	1	Room	81		Radiator	Solid	Metal	0.32
500	1956 Bldg	15	XRF	2/11/97	1	Room	82	Wall	Wall	Solid	Plaster	0.08
501	1956 Bldg	16	XRF	2/11/97	1	Room	82	Wall	Midle Wall	Solid	Plaster	0.16
502	1956 Bldg	17	XRF	2/11/97	1	Room	83	Wall	Wall	Solid	Plaster	0.11
503	1956 Bldg	18	XRF	2/11/97	1	Room	83		Radiator	Solid	Metal	0.19
504	1956 Bldg	19	XRF	2/11/97	1	Room	83	Pole		Solid	Metal	0
505	1956 Bldg	20	XRF	2/11/97	1	Room	83	Wall	Baseboar	Solid	Wood	0
506	1956 Bldg	21	XRF	2/11/97	1	Room	84	Wall	Wall	Peeling	Plaster	0.02
507	1956 Bldg	22	XRF	2/11/97	1	Room	84		Elec Pane	Solid	Metal	0
508	1956 Bldg	23	XRF	2/11/97	1	Room	85	Wall	Wall	Solid	Plaster	0.1
509	1956 Bldg	24	XRF	2/11/97	1	Room	85		Radiator	Solid	Metal	0.13
510	1956 Bldg	25	XRF	2/11/97	1	Room	85	Window	Casing	Solid	Metal	0.02
511	1956 Bldg	26	XRF	2/11/97	1	Room	86	Wall	Wall	Cracked	Plaster	0.01
512	1956 Bldg	27	XRF	2/11/97	1	Room	87	Wall	Wall	Solid	Plaster	0.26
513	1956 Bldg	28	XRF	2/11/97	1	Room	87	Window	Casing	Solid	Metal	0.02
514	1956 Bldg	29	XRF	2/11/97	1	Room	87		Radiator	Solid	Metal	0.15
515	1956 Bldg	30	XRF	2/11/97	1	Room	88	Wall	Wall	Solid	Plaster	0.21
516	1956 Bldg	31	XRF	2/11/97	1	Room	88	Window	Casing	Solid	Metal	0.02
517	1956 Bldg	32	XRF	2/11/97	1	Room	88		Radiator	Solid	Metal	0.52
518	1956 Bldg	33	XRF	2/11/97	1	Room	88	Pole		Solid	Metal	0
519	1956 Bldg	34	XRF	2/11/97	1	Room	88	Hatch		Solid	Metal	0
520	1956 Bldg	35	XRF	2/11/97	1	Room	89	Wall	Wall	Solid	Plaster	0.15
521	1956 Bldg	36	XRF	2/11/97	1	Room	89	Door	Door	Solid	Wood	0
522	1956 Bldg	37	XRF	2/11/97	1	Room	89		Radiator	Solid	Metal	0.24
523	1956 Bldg	38	XRF	2/11/97	1	Room	89	Cabinet	Door	Solid	Wood	0
524	1956 Bldg	39	XRF	2/11/97	1	Room	90	Wall	Wall	Solid	Plaster	0
525	1956 Bldg	40	XRF	2/11/97	1	Room	91	Wall	Wall	Solid	Plaster	0.01
526	1956 Bldg	41	XRF	2/11/97	1	Room	92	Wall	Wall	Solid	Plaster	0.15
527	1956 Bldg	42	XRF	2/11/97	1	Room	92		Radiator	Solid	Metal	0.18
528	1956 Bldg	43	XRF	2/11/97	1	Room	92	Hatch		Solid	Metal	0
529	1956 Bldg	62	XRF	2/11/97	1	Room	93	Wall	Wall	Solid	Plaster	0.16
530	1956 Bldg	63	XRF	2/11/97	1	Room	93	Door	Door	Solid	Wood	0
531	1956 Bldg	64	XRF	2/11/97	1	Room	93		Radiator	Solid	Metal	0.19
532	1956 Bldg	65	XRF	2/11/97	1	Room	93	Chalkboard		Solid	Wood	0.01

Saint Paul Public Schools
 Hazel Park Academy
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
533	1956 Bldg	72	XRF	2/11/97	1	Room	94	Wall	Wall	Solid	Plaster	0.29
534	1956 Bldg	73	XRF	2/11/97	1	Room	94	Door	Door	Solid	Wood	0
535	1956 Bldg	74	XRF	2/11/97	1	Room	94	Door	Casing	Solid	Metal	0.01
536	1956 Bldg	75	XRF	2/11/97	1	Room	94		Radiator	Solid	Metal	0.22
537	1956 Bldg	76	XRF	2/11/97	1	Room	94		Diffuser	Solid	Metal	0
538	1956 Bldg	96	XRF	2/11/97	1	Room	95	Wall	Wall	Solid	Plaster	0.11
539	1956 Bldg	97	XRF	2/11/97	1	Room	95		Radiator	Solid	Metal	0.12
540	1956 Bldg	98	XRF	2/11/97	1	Room	95	Hatch		Solid	Metal	0.02
541	1956 Bldg	158	XRF	2/11/97	1	Room	96	Wall	Wall	Solid	Concrete	0.02
542	1956 Bldg	159	XRF	2/11/97	1	Room	96	Wall	Wall	Solid	Tile	2.81
543	1956 Bldg	160	XRF	2/11/97	1	Room	96	Wall	Wall	Solid	Concrete	0.01
544	1956 Bldg	161	XRF	2/11/97	1	Room	96	Wall	Wall	Solid	Concrete	0.01
545	1956 Bldg	162	XRF	2/11/97	1	Room	96	Door	Door	Solid	Wood	0
546	1956 Bldg	163	XRF	2/11/97	1	Room	96	Door	Casing	Solid	Metal	0.09
547	1956 Bldg	164	XRF	2/11/97	1	Room	96	Door	Door	Solid	Wood	0
548	1956 Bldg	165	XRF	2/11/97	1	Room	96	Door	Door	Solid	Wood	1.16
549	1956 Bldg	166	XRF	2/11/97	1	Room	96	Door	Casing	Solid	Wood	0
550	1956 Bldg	167	XRF	2/11/97	1	Room	96	Bulletin	Board	Solid	Wood	0
551	1956 Bldg	168	XRF	2/11/97	1	Room	96	Bulletin	Board	Solid	Wood	0.06
552	1956 Bldg	169	XRF	2/11/97	1	Room	96	Door	Vent	Solid	Metal	0.04
553	1956 Bldg	170	XRF	2/11/97	1	Room	96	Wall	Baseboar	Solid	Metal	0.07
554	1956 Bldg	171	XRF	2/11/97	1	Room	96	Floor		Solid	Wood	0
555	1956 Bldg	172	XRF	2/11/97	1	Room	96	Floor		Solid	Wood	0.21
556	1956 Bldg	173	XRF	2/11/97	1	Room	96	Floor		Solid	Wood	0
557	1956 Bldg	174	XRF	2/11/97	1	Room	96	Floor		Solid	Wood	0.8
558	1956 Bldg	175	XRF	2/11/97	1	Room	96	Floor		Solid	Wood	0
559	1956 Bldg	176	XRF	2/11/97	1	Room	96	Cable Box		Solid	Metal	0.11
560	1956 Bldg	177	XRF	2/11/97	1	Room	96	Back Board		Solid	Metal	0.02
561	1956 Bldg	178	XRF	2/11/97	1	Room	96	Back Board		Solid	Metal	0
562	1956 Bldg	180	XRF	2/11/97	1	Room	96	Rim		Solid	Metal	0.12
563	1956 Bldg	181	XRF	2/11/97	1	Room	96	Support		Solid	Metal	0
564	1956 Bldg	182	XRF	2/11/97	1	Room	96	Wall	Wall	Solid	Wood	0
565	1956 Bldg	58	XRF	2/17/97	1	Room	98	Wall	Wall	Solid	Concrete	0.05
566	1956 Bldg	59	XRF	2/17/97	1	Room	98	Wall	Midle Wall	Solid	Tile	2.91
567	1956 Bldg	60	XRF	2/17/97	1	Room	98	Wall	Baseboar	Solid	Metal	0.02
568	1956 Bldg	61	XRF	2/17/97	1	Room	98	Door	Door	Solid	Wood	0
569	1956 Bldg	62	XRF	2/17/97	1	Room	98	Door	Vent	Solid	Metal	0.02
570	1956 Bldg	63	XRF	2/17/97	1	Room	98	Door	Casing	Solid	Metal	0.09
571	1956 Bldg	64	XRF	2/17/97	1	Room	98	Chalkboard		Solid	Wood	0
572	1956 Bldg	65	XRF	2/17/97	1	Room	98	Wall	Register	Solid	Metal	0
573	1956 Bldg	66	XRF	2/17/97	1	Room	98	Wall	Wall Rgstr	Solid	Metal	0.01
574	1956 Bldg	67	XRF	2/17/97	1	Room	98	Ceiling		Solid	Plaster	0.04
575	1956 Bldg	68	XRF	2/17/97	1	Room	98	Floor		Solid	Wood	0.01
576	1956 Bldg	69	XRF	2/17/97	1	Room	98	Floor	Stripe	Solid	Wood	0.15
577	1956 Bldg	70	XRF	2/17/97	1	Room	98	Floor	Stripe	Solid	Wood	0.19
578	1956 Bldg	71	XRF	2/17/97	1	Room	98	Floor	Stripe	Solid	Wood	0.54
579	1956 Bldg	72	XRF	2/17/97	1	Room	98	Floor	Stripe	Solid	Wood	0.86
580	1956 Bldg	73	XRF	2/17/97	1	Room	98	Climbing Bar		Solid	Metal	0.03
581	1956 Bldg	74	XRF	2/17/97	1	Room	98	Vertical Jump	Board	Solid	Wood	0.08
582	1956 Bldg	75	XRF	2/17/97	1	Room	99	Wall	Wall	Solid	Concrete	0.08
583	1956 Bldg	76	XRF	2/17/97	1	Room	99	Wall	Wall	Solid	Tile	2.65
584	1956 Bldg	77	XRF	2/17/97	1	Room	99	Wall	Baseboar	Solid	Metal	0.02
585	1956 Bldg	78	XRF	2/17/97	1	Room	99	Door	Door	Solid	Wood	0
586	1956 Bldg	79	XRF	2/17/97	1	Room	99	Door	Casing	Solid	Metal	0.08
587	1956 Bldg	80	XRF	2/17/97	1	Room	99	Wall	Register	Solid	Metal	0
588	1956 Bldg	81	XRF	2/17/97	1	Room	99	Chalkboard		Solid	Wood	0.01
589	1956 Bldg	82	XRF	2/17/97	1	Room	99	Wall	Register	Solid	Metal	0.01
590	1956 Bldg	83	XRF	2/17/97	1	Room	99	Ceiling		Solid	Plaster	0.04
591	1956 Bldg	84	XRF	2/17/97	1	Room	99	Vertical Jump	Board	Solid	Wood	0.09

Saint Paul Public Schools
 Hazel Park Academy
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
592	1956 Bldg	85	XRF	2/17/97	1	Room	99	Climbing Bar		Solid	Metal	0.09
593	1956 Bldg	86	XRF	2/17/97	1	Room	99	Floor		Solid	Wood	0.02
594	1956 Bldg	87	XRF	2/17/97	1	Room	99	Floor	Stripe	Solid	Wood	0.1
595	1956 Bldg	88	XRF	2/17/97	1	Room	99	Floor	Stripe	Solid	Wood	0.55
596	1956 Bldg	89	XRF	2/17/97	1	Room	99	Floor	Stripe	Solid	Wood	0
597	1956 Bldg	196	XRF	2/17/97	1	Room	100	Wall	Wall	Solid	Plaster	0.13
598	1956 Bldg	197	XRF	2/17/97	1	Room	100	Window	Casing	Solid	Wood	0
599	1956 Bldg	198	XRF	2/17/97	1	Room	100	I Beam		Solid	Metal	0.01
600	1956 Bldg	199	XRF	2/17/97	1	Room	100	Chalkboard		Solid	Wood	0.01
601	1956 Bldg	200	XRF	2/17/97	1	Room	100	Ceiling	Diffuser	Solid	Metal	0.06
602	1956 Bldg	201	XRF	2/17/97	1	Room	100	Ceiling	Diffuser	Solid	Metal	0.01
603	1956 Bldg	202	XRF	2/17/97	1	Room	101	Wall	Wall	Solid	Plaster	0.16
604	1956 Bldg	203	XRF	2/17/97	1	Room	101	Wall	Wall	Solid	Plaster	0.21
605	1956 Bldg	204	XRF	2/17/97	1	Room	101	Wall	Wall	Solid	Plaster	0.27
606	1956 Bldg	205	XRF	2/17/97	1	Room	101		Radiator	Solid	Metal	0.03
607	1956 Bldg	206	XRF	2/17/97	1	Room	101	Bookcase	Shelf	Solid	Wood	0.31
608	1956 Bldg	207	XRF	2/17/97	1	Room	101	Bulletin	Board	Solid	Wood	0.01
609	1956 Bldg	208	XRF	2/17/97	1	Room	101	Bulletin	Board	Solid	Wood	0
610	1956 Bldg	209	XRF	2/17/97	1	Room	101	Cabinet	Door	Solid	Wood	0.01
611	1956 Bldg	210	XRF	2/17/97	1	Room	101	Cabinet	Drawer	Solid	Wood	0
612	1956 Bldg	211	XRF	2/17/97	1	Room	101	Wall	Wall Rgstr	Solid	Metal	0.03
613	1956 Bldg	212	XRF	2/17/97	1	Room	101	Sound Barrier		Solid	Metal	0
614	1956 Bldg	213	XRF	2/17/97	1	Room	101	Wire Tray		Solid	Metal	0
615	1956 Bldg	214	XRF	2/17/97	1	Room	101	Ceiling		Solid	Plaster	0.22
616	1956 Bldg	215	XRF	2/17/97	1	Room	102	Wall	Wall	Solid	Plaster	0.11
617	1956 Bldg	216	XRF	2/17/97	1	Room	102		Radiator	Solid	Metal	0.02
618	1956 Bldg	217	XRF	2/17/97	1	Room	102	Bookcase	Shelf	Solid	Wood	0
619	1956 Bldg	218	XRF	2/17/97	1	Room	102	Chalkboard		Solid	Wood	0.01
620	1956 Bldg	219	XRF	2/17/97	1	Room	102	Wall	Wall Rgstr	Solid	Wood	0
621	1956 Bldg	220	XRF	2/17/97	1	Room	102	Sound Barrier		Solid	Metal	0
622	1956 Bldg	221	XRF	2/17/97	1	Room	102	Wire Tray		Solid	Metal	0
623	1956 Bldg	222	XRF	2/17/97	1	Room	102	Ceiling		Cracked	Plaster	0.11
624	1956 Bldg	223	XRF	2/17/97	1	Room	102	Door	Casing	Cracked	Wood	0
625	1956 Bldg	224	XRF	2/17/97	1	Room	102	Window	Casing	Cracked	Wood	0
626	1956 Bldg	6	XRF	2/18/97	1	Room	103	Wall	Wall	Solid	Plaster	0.01
627	1956 Bldg	7	XRF	2/18/97	1	Room	103	Wall	Wall	Solid	Plaster	0.11
628	1956 Bldg	8	XRF	2/18/97	1	Room	103		Radiator	Solid	Metal	0.02
629	1956 Bldg	9	XRF	2/18/97	1	Room	103	Bookcase	Shelf	Solid	Wood	0
630	1956 Bldg	10	XRF	2/18/97	1	Room	103	Bulletin	Board	Solid	Wood	0
631	1956 Bldg	11	XRF	2/18/97	1	Room	103	Cabinet	Door	Solid	Wood	0
632	1956 Bldg	12	XRF	2/18/97	1	Room	103	Bulletin	Board	Solid	Wood	0
633	1956 Bldg	13	XRF	2/18/97	1	Room	103	Wall	Wall Rgstr	Solid	Metal	0
634	1956 Bldg	14	XRF	2/18/97	1	Room	103	Sound Barrier		Solid	Metal	0
635	1956 Bldg	15	XRF	2/18/97	1	Room	103	Wire Tray		Solid	Metal	0
636	1956 Bldg	16	XRF	2/18/97	1	Room	103	Ceiling		Solid	Plaster	0.13
637	1956 Bldg	17	XRF	2/18/97	1	Room	104	Wall	Wall	Solid	Plaster	0.14
638	1956 Bldg	18	XRF	2/18/97	1	Room	104	Wall	Wall	Solid	Plaster	0.13
639	1956 Bldg	19	XRF	2/18/97	1	Room	104	Wall	Wall	Solid	Plaster	0.13
640	1956 Bldg	20	XRF	2/18/97	1	Room	104	Wall	Wall	Solid	Plaster	0.13
641	1956 Bldg	21	XRF	2/18/97	1	Room	104	Wall	Wall	Solid	Plaster	0.12
642	1956 Bldg	22	XRF	2/18/97	1	Room	104	Wall	Wall	Solid	Wood	0.01
643	1956 Bldg	23	XRF	2/18/97	1	Room	104	Door	Door	Solid	Wood	0.01
644	1956 Bldg	24	XRF	2/18/97	1	Room	104	Door	Casing	Solid	Metal	0.06
645	1956 Bldg	25	XRF	2/18/97	1	Room	104		Radiator	Solid	Metal	0
646	1956 Bldg	10	XRF	2/18/97	1	Room	105	Wall	Wall	Solid	Plaster	0.18
647	1956 Bldg	11	XRF	2/18/97	1	Room	105	Wall	Wall	Solid	Plaster	0.1
648	1956 Bldg	12	XRF	2/18/97	1	Room	105		Radiator	Solid	Metal	0.02
649	1956 Bldg	13	XRF	2/18/97	1	Room	105	Wall	Wall	Solid	Wood	0.02
650	1956 Bldg	14	XRF	2/18/97	1	Room	105	Bookcase	Shelf	Solid	Wood	0

Saint Paul Public Schools
 Hazel Park Academy
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L	
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result	
651	1956 Bldg	15	XRF	2/18/97	1	Room	105	Bulletin Board	Solid	Wood	0		
652	1956 Bldg	16	XRF	2/18/97	1	Room	105	Cabinet Door	Solid	Wood	0		
653	1956 Bldg	17	XRF	2/18/97	1	Room	105	Wall Wall Rgstr	Solid	Metal	0.01		
654	1956 Bldg	18	XRF	2/18/97	1	Room	105	Sound Barrier	Solid	Metal	0.01		
655	1956 Bldg	19	XRF	2/18/97	1	Room	105	Wire Tray	Solid	Metal	0.01		
656	1956 Bldg	20	XRF	2/18/97	1	Room	105	Ceiling	Solid	Plaster	0.09		
657	1956 Bldg	21	XRF	2/18/97	1	Room	106	Wall	Wall	Cracked	Plaster	0.08	
658	1956 Bldg	22	XRF	2/18/97	1	Room	106	Wall	Wall	Cracked	Plaster	0.08	
659	1956 Bldg	23	XRF	2/18/97	1	Room	106	Wall	Wall	Solid	Wood	0.01	
660	1956 Bldg	24	XRF	2/18/97	1	Room	106		Radiator	Solid	Metal	0.02	
661	1956 Bldg	25	XRF	2/18/97	1	Room	106	Door	Door	Solid	Wood	0.01	
662	1956 Bldg	26	XRF	2/18/97	1	Room	106	Door	Casing	Solid	Metal	0.12	
663	1956 Bldg	27	XRF	2/18/97	1	Room	106	Cabinet	Door	Solid	Wood	0	
664	1956 Bldg	28	XRF	2/18/97	1	Room	106	Bulletin Board	Solid	Wood	0		
665	1956 Bldg	29	XRF	2/18/97	1	Room	106	Bulletin Board	Solid	Wood	0		
666	1956 Bldg	30	XRF	2/18/97	1	Room	106	Wall	Wall Rgstr	Solid	Metal	0.06	
667	1956 Bldg	31	XRF	2/18/97	1	Room	106	Sound Barrier	Solid	Metal	0		
668	1956 Bldg	32	XRF	2/18/97	1	Room	106	Wire Tray	Solid	Metal	0		
669	1956 Bldg	33	XRF	2/18/97	1	Room	106	Ceiling		Cracked	Plaster	0.02	
670	1956 Bldg	34	XRF	2/18/97	1	Room	107	Wall	Wall	Solid	Plaster	0.12	
671	1956 Bldg	35	XRF	2/18/97	1	Room	107	Wall	Wall	Solid	Plaster	0.2	
672	1956 Bldg	36	XRF	2/18/97	1	Room	107	Wall	Wall	Solid	Wood	0.05	
673	1956 Bldg	37	XRF	2/18/97	1	Room	107	Bookcase	Shelf	Solid	Wood	0	
674	1956 Bldg	38	XRF	2/18/97	1	Room	107	Chalkboard		Solid	Wood	0	
675	1956 Bldg	39	XRF	2/18/97	1	Room	107	Wall	Wall Rgstr	Solid	Metal	0.01	
676	1956 Bldg	40	XRF	2/18/97	1	Room	107	Sound Barrier		Solid	Metal	0	
677	1956 Bldg	41	XRF	2/18/97	1	Room	107	Wire Tray		Solid	Metal	0	
678	1956 Bldg	42	XRF	2/18/97	1	Room	107	Ceiling		Solid	Plaster	0.04	
679	1956 Bldg	43	XRF	2/18/97	1	Room	108	Wall	Wall	Cracked	Plaster	0.06	
680	1956 Bldg	44	XRF	2/18/97	1	Room	108	Wall	Wall	Cracked	Plaster	0.09	
681	1956 Bldg	45	XRF	2/18/97	1	Room	108	Wall	Wall	Solid	Wood	0.04	
682	1956 Bldg	46	XRF	2/18/97	1	Room	108	Wall	Midle Wall	Cracked	Plaster	0.16	
683	1956 Bldg	47	XRF	2/18/97	1	Room	108		Radiator	Solid	Metal	0.01	
684	1956 Bldg	48	XRF	2/18/97	1	Room	108	Bookcase	Shelf	Solid	Wood	0	
685	1956 Bldg	49	XRF	2/18/97	1	Room	108	Door	Door	Solid	Wood	0	
686	1956 Bldg	50	XRF	2/18/97	1	Room	108	Door	Casing	Solid	Metal	0.14	
687	1956 Bldg	51	XRF	2/18/97	1	Room	108	Chalkboard		Solid	Wood	0	
688	1956 Bldg	52	XRF	2/18/97	1	Room	108	Wall	Wall Rgstr	Solid	Metal	0.03	
689	1956 Bldg	53	XRF	2/18/97	1	Room	108	Sound Barrier		Solid	Metal	0	
690	1956 Bldg	54	XRF	2/18/97	1	Room	108	Wire Tray		Solid	Metal	0	
691	1956 Bldg	55	XRF	2/18/97	1	Room	108	Ceiling		Cracked	Plaster	0.14	
692	1956 Bldg	62	XRF	2/18/97	1	Room	109	Wall	Wall	Solid	Plaster	0.22	
693	1956 Bldg	63	XRF	2/18/97	1	Room	109	Wall	Wall	Solid	Plaster	0.14	
694	1956 Bldg	64	XRF	2/18/97	1	Room	109	Wall	Wall	Solid	Wood	0	
695	1956 Bldg	65	XRF	2/18/97	1	Room	109		Radiator	Solid	Metal	0.06	
696	1956 Bldg	66	XRF	2/18/97	1	Room	109	Bookcase	Shelf	Solid	Wood	0	
697	1956 Bldg	67	XRF	2/18/97	1	Room	109	Chalkboard		Solid	Wood	0	
698	1956 Bldg	68	XRF	2/18/97	1	Room	109	Wall	Wall Rgstr	Solid	Metal	0	
699	1956 Bldg	69	XRF	2/18/97	1	Room	109	Sound Barrier		Solid	Metal	0	
700	1956 Bldg	70	XRF	2/18/97	1	Room	109	Wire Tray		Solid	Metal	0	
701	1956 Bldg	71	XRF	2/18/97	1	Room	109	Ceiling		Solid	Plaster	0.06	
702	1956 Bldg	6	XRF	2/21/97	1	Room	110	Wall	Wall	Solid	Plaster	0.11	
703	1956 Bldg	7	XRF	2/21/97	1	Room	110	Wall	Wall	Solid	Plaster	0.12	
704	1956 Bldg	8	XRF	2/21/97	1	Room	110		Radiator	Solid	Metal	0.02	
705	1956 Bldg	9	XRF	2/21/97	1	Room	110	Wall	Wall	Peeling	Wood	0.02	
706	1956 Bldg	10	XRF	2/21/97	1	Room	110	Door	Door	Solid	Wood	0.01	
707	1956 Bldg	11	XRF	2/21/97	1	Room	110	Door	Casing	Solid	Metal	0.06	
708	1956 Bldg	12	XRF	2/21/97	1	Room	110	Cabinet	Door	Solid	Wood	0	
709	1956 Bldg	13	XRF	2/21/97	1	Room	110	Cabinet	Outside	Solid	Wood	0	

Saint Paul Public Schools
 Hazel Park Academy
 Lead-Based Paint Inspection

A	B	C	D	E	F	G	H	I	J	K	L	
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
710	1956 Bldg	14	XRF	2/21/97	1	Room	110	Cabinet	Door	Solid	Wood	0
711	1956 Bldg	15	XRF	2/21/97	1	Room	110	Chalkboard		Solid	Wood	0
712	1956 Bldg	16	XRF	2/21/97	1	Room	110	Bulletin	Board	Solid	Wood	0
713	1956 Bldg	17	XRF	2/21/97	1	Room	110	Wall	Wall	Solid	Drywall	0.09
714	1956 Bldg	18	XRF	2/21/97	1	Room	110	Wall	Wall Rgstr	Solid	Metal	0.03
715	1956 Bldg	19	XRF	2/21/97	1	Room	110	Sound Barrier		Solid	Metal	0.03
716	1956 Bldg	20	XRF	2/21/97	1	Room	110	Wire Tray		Solid	Metal	0
717	1956 Bldg	21	XRF	2/21/97	1	Room	110	Ceiling		Solid	Plaster	0.1
718	1956 Bldg	22	XRF	2/21/97	1	Room	111	Wall	Wall	Solid	Plaster	0.14
719	1956 Bldg	23	XRF	2/21/97	1	Room	111	Wall	Wall	Solid	Plaster	0.21
720	1956 Bldg	24	XRF	2/21/97	1	Room	111	Wall	Wall	Solid	Wood	0.01
721	1956 Bldg	25	XRF	2/21/97	1	Room	111	Bookcase	Shelf	Solid	Wood	0
722	1956 Bldg	26	XRF	2/21/97	1	Room	111	Cabinet	Door	Solid	Wood	0
723	1956 Bldg	27	XRF	2/21/97	1	Room	111		Radiator	Solid	Metal	0.02
724	1956 Bldg	28	XRF	2/21/97	1	Room	111	Bulletin	Board	Solid	Wood	0
725	1956 Bldg	29	XRF	2/21/97	1	Room	111	Bulletin	Board	Solid	Wood	0
726	1956 Bldg	30	XRF	2/21/97	1	Room	111	Shelff	Bracket	Solid	Metal	0
727	1956 Bldg	31	XRF	2/21/97	1	Room	111	Sound Barrier		Solid	Metal	0
728	1956 Bldg	32	XRF	2/21/97	1	Room	111	Wire Tray		Solid	Metal	0
729	1956 Bldg	33	XRF	2/21/97	1	Room	111	Ceiling		Solid	Plaster	0.06
730	1956 Bldg	34	XRF	2/21/97	1	Room	112	Wall	Wall	Solid	Plaster	0.17
731	1956 Bldg	35	XRF	2/21/97	1	Room	112	Wall	Wall	Solid	Plaster	0.09
732	1956 Bldg	36	XRF	2/21/97	1	Room	112	Wall	Wall	Solid	Tile	2.5
733	1956 Bldg	37	XRF	2/21/97	1	Room	112	Wall	Wall	Solid	Wood	0.02
734	1956 Bldg	38	XRF	2/21/97	1	Room	112		Radiator	Solid	Metal	0.02
735	1956 Bldg	39	XRF	2/21/97	1	Room	112	Cabinet	Door	Cracked	Wood	0.01
736	1956 Bldg	40	XRF	2/21/97	1	Room	112	Door	Door	Solid	Wood	0
737	1956 Bldg	41	XRF	2/21/97	1	Room	112	Door	Casing	Solid	Metal	0.1
738	1956 Bldg	42	XRF	2/21/97	1	Room	112	Elec Pane	Solid	Metal	0	
739	1956 Bldg	43	XRF	2/21/97	1	Room	112	Ceiling	Hatch	Solid	Wood	0
740	1956 Bldg	44	XRF	2/21/97	1	Room	112	Wall	Wall Rgstr	Solid	Metal	0.03
741	1956 Bldg	45	XRF	2/21/97	1	Room	112	Floor		Cracked	Wood	0
742	1956 Bldg	46	XRF	2/21/97	1	Room	112	Wall	Baseboar	Cracked	Wood	0
743	1956 Bldg	47	XRF	2/21/97	1	Room	112	Hatch	Wall	Cracked	Metal	0.04
744	1956 Bldg	49	XRF	2/21/97	1	Room	113	Wall	Wall	Solid	Plaster	0.3
745	1956 Bldg	50	XRF	2/21/97	1	Room	113	Wall	Wall	Solid	Plaster	0.12
746	1956 Bldg	51	XRF	2/21/97	1	Room	113	Wall	Wall	Solid	Wood	0.03
747	1956 Bldg	52	XRF	2/21/97	1	Room	113		Radiator	Solid	Metal	0.02
748	1956 Bldg	53	XRF	2/21/97	1	Room	113	Bookcase	Shelf	Solid	Wood	0
749	1956 Bldg	54	XRF	2/21/97	1	Room	113	Bulletin	Board	Solid	Wood	0.01
750	1956 Bldg	55	XRF	2/21/97	1	Room	113	Bulletin	Board	Solid	Wood	0
751	1956 Bldg	56	XRF	2/21/97	1	Room	113	Wall	Wall Rgstr	Solid	Metal	0
752	1956 Bldg	57	XRF	2/21/97	1	Room	113	Sound Barrier		Solid	Metal	0
753	1956 Bldg	58	XRF	2/21/97	1	Room	113	Wire Tray		Solid	Metal	0
754	1956 Bldg	59	XRF	2/21/97	1	Room	113	Ceiling		Solid	Plaster	0.01
755	1956 Bldg	60	XRF	2/21/97	1	Room	114	Wall	Wall	Solid	Plaster	0.15
756	1956 Bldg	61	XRF	2/21/97	1	Room	114	Wall	Wall	Solid	Plaster	0.06
757	1956 Bldg	62	XRF	2/21/97	1	Room	114	Cabinet	Door	Solid	Wood	0
758	1956 Bldg	63	XRF	2/21/97	1	Room	114	Bulletin	Board	Solid	Wood	0
759	1956 Bldg	64	XRF	2/21/97	1	Room	114	Bulletin	Board	Solid	Wood	0
760	1956 Bldg	65	XRF	2/21/97	1	Room	114	Ceiling	Diffuser	Solid	Metal	0.01
761	1956 Bldg	66	XRF	2/21/97	1	Room	114	Hatch		Solid	Metal	0.03
762	1956 Bldg	67	XRF	2/21/97	1	Room	114	Ceiling		Solid	Plaster	0.13
763	1956 Bldg	68	XRF	2/21/97	1	Room	115	Wall	Wall	Solid	Plaster	0.08
764	1956 Bldg	69	XRF	2/21/97	1	Room	115	Wall	Wall	Solid	Plaster	0.06
765	1956 Bldg	70	XRF	2/21/97	1	Room	115	Wall	Wall	Solid	Wood	0.01
766	1956 Bldg	71	XRF	2/21/97	1	Room	115		Radiator	Solid	Metal	0.02
767	1956 Bldg	72	XRF	2/21/97	1	Room	115	Bookcase	Shelf	Solid	Wood	0
768	1956 Bldg	73	XRF	2/21/97	1	Room	115	Bulletin	Board	Solid	Wood	0.01

Saint Paul Public Schools
 Hazel Park Academy
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
769	1956 Bldg	74	XRF	2/21/97	1	Room	115	Bulletin	Board	Solid	Wood	0
770	1956 Bldg	75	XRF	2/21/97	1	Room	115	Wall	Wall Rgstr	Solid	Metal	0.04
771	1956 Bldg	76	XRF	2/21/97	1	Room	115	Sound Barrier		Solid	Metal	0
772	1956 Bldg	77	XRF	2/21/97	1	Room	115	Wire Tray		Solid	Metal	0
773	1956 Bldg	78	XRF	2/21/97	1	Room	115	Ceiling		Solid	Plaster	0.03
774	1956 Bldg	79	XRF	2/21/97	1	Room	116	Wall	Wall	Solid	Plaster	0.1
775	1956 Bldg	80	XRF	2/21/97	1	Room	116	Wall	Wall	Solid	Tile	2.45
776	1956 Bldg	81	XRF	2/21/97	1	Room	116	Wall	Wall	Solid	Wood	0.02
777	1956 Bldg	82	XRF	2/21/97	1	Room	116	Door	Door	Solid	Wood	0
778	1956 Bldg	83	XRF	2/21/97	1	Room	116	Door	Casing	Solid	Metal	0.06
779	1956 Bldg	84	XRF	2/21/97	1	Room	116		Radiator	Solid	Metal	0.04
780	1956 Bldg	85	XRF	2/21/97	1	Room	116	Wall	Baseboar	Solid	Wood	0.09
781	1956 Bldg	87	XRF	2/21/97	1	Room	116	Floor		Solid	Wood	0
782	1956 Bldg	88	XRF	2/21/97	1	Room	116	Bulletin	Board	Solid	Wood	0.01
783	1956 Bldg	89	XRF	2/21/97	1	Room	116	Bulletin	Board	Solid	Wood	0
784	1956 Bldg	90	XRF	2/21/97	1	Room	116	Wall	Wall Rgstr	Solid	Metal	0.05
785	1956 Bldg	125	XRF	2/21/97	1	Room	118	Wall	Wall	Solid	Plaster	0.03
786	1956 Bldg	126	XRF	2/21/97	1	Room	118	Wall	Wall	Solid	Tile	1.91
787	1956 Bldg	127	XRF	2/21/97	1	Room	118	Wall	Wall	Solid	Wood	0.02
788	1956 Bldg	128	XRF	2/21/97	1	Room	118	Door	Door	Cracked	Wood	0.01
789	1956 Bldg	129	XRF	2/21/97	1	Room	118	Door	Casing	Cracked	Metal	0.06
790	1956 Bldg	130	XRF	2/21/97	1	Room	118	Wire Tray		Cracked	Metal	0.01
791	1956 Bldg	131	XRF	2/21/97	1	Room	118	Hatch		Cracked	Metal	0.02
792	1956 Bldg	132	XRF	2/21/97	1	Room	118	Window	Casing	Cracked	Metal	0.01
793	1956 Bldg	133	XRF	2/21/97	1	Room	118	Bulletin	Board	Cracked	Wood	0
794	1956 Bldg	134	XRF	2/21/97	1	Room	118	Bulletin	Board	Cracked	Wood	0
795	1956 Bldg	135	XRF	2/21/97	1	Room	118	Wall	Wall Rgstr	Solid	Metal	0.03
796	1956 Bldg	187	XRF	2/21/97	1	Room	121	Wall	Wall	Solid	Plaster	0.06
797	1956 Bldg	188	XRF	2/21/97	1	Room	121	Wall	Wall	Solid	Wood	0
798	1956 Bldg	189	XRF	2/21/97	1	Room	121		Radiator	Solid	Metal	0.02
799	1956 Bldg	190	XRF	2/21/97	1	Room	121	Bookcase	Inside	Solid	Wood	0
800	1956 Bldg	191	XRF	2/21/97	1	Room	121	Bulletin	Board	Solid	Wood	0
801	1956 Bldg	192	XRF	2/21/97	1	Room	121	Bulletin	Board	Solid	Wood	0
802	1956 Bldg	193	XRF	2/21/97	1	Room	121	Bulletin	Board	Solid	Wood	0
803	1956 Bldg	194	XRF	2/21/97	1	Room	121	Wall	Register	Solid	Metal	0
804	1956 Bldg	195	XRF	2/21/97	1	Room	121	Sound Barrier		Solid	Metal	0.1
805	1956 Bldg	196	XRF	2/21/97	1	Room	121	Wire Tray		Solid	Metal	0
806	1956 Bldg	197	XRF	2/21/97	1	Room	121	Ceiling		Solid	Plaster	0.02
807	1956 Bldg	234	XRF	2/22/97	2	Room	200	Wall	Wall	Solid	Wood	0.01
808	1956 Bldg	235	XRF	2/22/97	2	Room	200	Wall	Wall	Solid	Tile	2.82
809	1956 Bldg	236	XRF	2/22/97	2	Room	200	Wall	Wall	Solid	Wood	0.08
810	1956 Bldg	237	XRF	2/22/97	2	Room	200	Wall	Wall	Solid	Plaster	0.11
811	1956 Bldg	238	XRF	2/22/97	2	Room	200	Wall	Wall	Solid	Wood	0
812	1956 Bldg	239	XRF	2/22/97	2	Room	200	Door	Door	Solid	Wood	0.01
813	1956 Bldg	240	XRF	2/22/97	2	Room	200	Door	Casing	Solid	Metal	0.08
814	1956 Bldg	242	XRF	2/22/97	2	Room	200		Radiator	Solid	Metal	0.01
815	1956 Bldg	243	XRF	2/22/97	2	Room	200	Chalkboard		Solid	Wood	0
816	1956 Bldg	244	XRF	2/22/97	2	Room	200	Bulletin	Board	Solid	Wood	1.84
817	1956 Bldg	245	XRF	2/22/97	2	Room	200	Wall	Wall Rgstr	Solid	Metal	0.04
818	1956 Bldg	246	XRF	2/22/97	2	Room	200	Sound Barrier		Solid	Metal	0
819	1956 Bldg	247	XRF	2/22/97	2	Room	200	Wire Tray		Solid	Metal	0
820	1956 Bldg	248	XRF	2/22/97	2	Room	200	Ceiling		Solid	Plaster	0.18
821	1956 Bldg	268	XRF	2/22/97	2	Room	201	Wall	Wall	Solid	Plaster	0.41
822	1956 Bldg	269	XRF	2/22/97	2	Room	201	Wall	Wall	Solid	Plaster	0.35
823	1956 Bldg	270	XRF	2/22/97	2	Room	201	Wall	Wall	Solid	Wood	0
824	1956 Bldg	271	XRF	2/22/97	2	Room	201	Bookcase	Shelf	Solid	Wood	0
825	1956 Bldg	272	XRF	2/22/97	2	Room	201		Radiator	Solid	Metal	0.13
826	1956 Bldg	273	XRF	2/22/97	2	Room	201	Chalkboard		Solid	Wood	0
827	1956 Bldg	274	XRF	2/22/97	2	Room	201	Bulletin	Board	Solid	Wood	0

Saint Paul Public Schools
 Hazel Park Academy
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
828	1956 Bldg	275	XRF	2/22/97	2	Room	201	Pole		Solid	Metal	0.05
829	1956 Bldg	276	XRF	2/22/97	2	Room	201	Wall	Wall Rgstr	Solid	Metal	0.01
830	1956 Bldg	277	XRF	2/22/97	2	Room	201	Sound Barrier		Solid	Metal	0
831	1956 Bldg	278	XRF	2/22/97	2	Room	201	Wire Tray		Solid	Metal	0
832	1956 Bldg	279	XRF	2/22/97	2	Room	201	Ceiling		Solid	Plaster	0.1
833	1956 Bldg	280	XRF	2/22/97	2	Room	201	Cabinet	Door	Solid	Wood	0
834	1956 Bldg	249	XRF	2/22/97	2	Room	202	Wall	Wall	Solid	Plaster	0.01
835	1956 Bldg	250	XRF	2/22/97	2	Room	202	Wall	Wall	Solid	Plaster	0.03
836	1956 Bldg	251	XRF	2/22/97	2	Room	202	Chalkboard		Solid	Wood	0.01
837	1956 Bldg	252	XRF	2/22/97	2	Room	202	Bulletin	Board	Solid	Wood	0
838	1956 Bldg	253	XRF	2/22/97	2	Room	202	Wall	Wall Rgstr	Solid	Metal	0.01
839	1956 Bldg	254	XRF	2/22/97	2	Room	202	Wall	Diffuser	Solid	Metal	0.15
840	1956 Bldg	255	XRF	2/22/97	2	Room	202	Wall	Diffuser	Solid	Metal	0
841	1956 Bldg	281	XRF	2/22/97	2	Room	203	Wall	Wall	Solid	Plaster	0.26
842	1956 Bldg	282	XRF	2/22/97	2	Room	203	Wall	Wall	Solid	Plaster	0.1
843	1956 Bldg	283	XRF	2/22/97	2	Room	203	Wall	Wall	Solid	Wood	0.01
844	1956 Bldg	284	XRF	2/22/97	2	Room	203	Bookcase	Shelf	Solid	Wood	0
845	1956 Bldg	285	XRF	2/22/97	2	Room	203		Radiator	Solid	Metal	0.05
846	1956 Bldg	286	XRF	2/22/97	2	Room	203	Bulletin	Board	Solid	Wood	0.11
847	1956 Bldg	287	XRF	2/22/97	2	Room	203	Bulletin	Board	Solid	Wood	0
848	1956 Bldg	288	XRF	2/22/97	2	Room	203	Cabinet	Door	Solid	Wood	0
849	1956 Bldg	289	XRF	2/22/97	2	Room	203	Pole		Solid	Metal	0.06
850	1956 Bldg	290	XRF	2/22/97	2	Room	203	Wall	Wall Rgstr	Solid	Metal	0.03
851	1956 Bldg	291	XRF	2/22/97	2	Room	203	Sound Barrier		Solid	Metal	0
852	1956 Bldg	292	XRF	2/22/97	2	Room	203	Wire Tray		Solid	Metal	0.02
853	1956 Bldg	293	XRF	2/22/97	2	Room	203	Ceiling	Register	Solid	Metal	0
854	1956 Bldg	294	XRF	2/22/97	2	Room	203	Ceiling		Solid	Plaster	0.02
855	1956 Bldg	306	XRF	2/22/97	2	Room	204	Wall	Wall	Solid	Plaster	0.04
856	1956 Bldg	307	XRF	2/22/97	2	Room	204	Wall	Wall	Solid	Plaster	0
857	1956 Bldg	308	XRF	2/22/97	2	Room	204	Door	Door	Solid	Wood	0
858	1956 Bldg	309	XRF	2/22/97	2	Room	204	Door	Casing	Solid	Wood	0.07
859	1956 Bldg	310	XRF	2/22/97	2	Room	204	Wall	Wall	Solid	Drywall	0.03
860	1956 Bldg	311	XRF	2/22/97	2	Room	204	Wall	Chair rail	Solid	Wood	0
861	1956 Bldg	312	XRF	2/22/97	2	Room	204	Wall	Wall Rgstr	Solid	Metal	0.01
862	1956 Bldg	313	XRF	2/22/97	2	Room	204	Door	Casing	Solid	Metal	0.08
863	1956 Bldg	333	XRF	2/22/97	2	Room	205	Wall	Wall	Solid	Plaster	0.18
864	1956 Bldg	334	XRF	2/22/97	2	Room	205	Wall	Wall	Solid	Plaster	0.19
865	1956 Bldg	335	XRF	2/22/97	2	Room	205	Wall	Wall	Solid	Wood	0.01
866	1956 Bldg	336	XRF	2/22/97	2	Room	205	Bookcase	Shelf	Solid	Wood	0
867	1956 Bldg	337	XRF	2/22/97	2	Room	205		Radiator	Solid	Metal	0.04
868	1956 Bldg	338	XRF	2/22/97	2	Room	205	Bulletin	Board	Solid	Wood	0
869	1956 Bldg	339	XRF	2/22/97	2	Room	205	Bulletin	Board	Solid	Wood	0
870	1956 Bldg	340	XRF	2/22/97	2	Room	205	Cabinet	Door	Solid	Wood	0
871	1956 Bldg	341	XRF	2/22/97	2	Room	205	Wall	Wall Rgstr	Solid	Metal	0.01
872	1956 Bldg	342	XRF	2/22/97	2	Room	205	Sound Barrier		Solid	Metal	0
873	1956 Bldg	343	XRF	2/22/97	2	Room	205	Wire Tray		Solid	Metal	0
874	1956 Bldg	344	XRF	2/22/97	2	Room	205	Ceiling		Solid	Plaster	0.07
875	1956 Bldg	345	XRF	2/22/97	2	Room	205	Pole		Solid	Metal	0.04
876	1956 Bldg	346	XRF	2/22/97	2	Room	207	Wall	Wall	Solid	Plaster	0.1
877	1956 Bldg	347	XRF	2/22/97	2	Room	207	Wall	Wall	Solid	Plaster	0.09
878	1956 Bldg	348	XRF	2/22/97	2	Room	207	Wall	Wall	Solid	Wood	0.34
879	1956 Bldg	349	XRF	2/22/97	2	Room	207	Bookcase	Shelf	Solid	Wood	0
880	1956 Bldg	350	XRF	2/22/97	2	Room	207		Radiator	Solid	Metal	0.05
881	1956 Bldg	351	XRF	2/22/97	2	Room	207	Bulletin	Board	Solid	Wood	0.01
882	1956 Bldg	352	XRF	2/22/97	2	Room	207	Bulletin	Board	Solid	Wood	0
883	1956 Bldg	353	XRF	2/22/97	2	Room	207	Pole		Solid	Metal	0.04
884	1956 Bldg	354	XRF	2/22/97	2	Room	207	Cabinet	Door	Solid	Wood	0
885	1956 Bldg	355	XRF	2/22/97	2	Room	207	Wall	Wall Rgstr	Solid	Metal	0.02
886	1956 Bldg	356	XRF	2/22/97	2	Room	207	Sound Barrier		Solid	Metal	0

Saint Paul Public Schools
 Hazel Park Academy
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
887	1956 Bldg	357	XRF	2/22/97	2	Room	207	Wire Tray		Solid	Metal	0
888	1956 Bldg	358	XRF	2/22/97	2	Room	207	Ceiling		Solid	Plaster	0.01
889	1956 Bldg	362	XRF	2/22/97	2	Room	209	Wall	Wall	Solid	Plaster	0.07
890	1956 Bldg	363	XRF	2/22/97	2	Room	209	Wall	Wall	Solid	Wood	0.03
891	1956 Bldg	364	XRF	2/22/97	2	Room	209	Bookcase	Shelf	Solid	Wood	0
892	1956 Bldg	365	XRF	2/22/97	2	Room	209		Radiator	Solid	Metal	0.24
893	1956 Bldg	366	XRF	2/22/97	2	Room	209	Bulletin	Board	Solid	Wood	0
894	1956 Bldg	367	XRF	2/22/97	2	Room	209	Bulletin	Board	Solid	Wood	0.01
895	1956 Bldg	368	XRF	2/22/97	2	Room	209	Pole		Solid	Metal	0.06
896	1956 Bldg	369	XRF	2/22/97	2	Room	209	Cabinet	Door	Solid	Wood	0
897	1956 Bldg	370	XRF	2/22/97	2	Room	209	Wall	Wall Rgstr	Solid	Metal	0.02
898	1956 Bldg	371	XRF	2/22/97	2	Room	209	Sound Barrier		Solid	Metal	0
899	1956 Bldg	372	XRF	2/22/97	2	Room	209	Wire Tray		Solid	Metal	0
900	1956 Bldg	373	XRF	2/22/97	2	Room	209	Ceiling		Cracked	Plaster	0.11
901	1956 Bldg	398	XRF	2/22/97	2	Room	210	Wall	Wall	Solid	Plaster	0.11
902	1956 Bldg	399	XRF	2/22/97	2	Room	210	Bulletin	Board	Solid	Wood	0.01
903	1956 Bldg	400	XRF	2/22/97	2	Room	210	Cabinet	Door	Solid	Metal	0
904	1956 Bldg	401	XRF	2/22/97	2	Room	210	Cabinet	Door	Solid	Wood	0
905	1956 Bldg	402	XRF	2/22/97	2	Room	210	Wall	Diffuser	Solid	Metal	0
906	1956 Bldg	403	XRF	2/22/97	2	Room	211	Wall	Wall	Solid	Plaster	0.02
907	1956 Bldg	404	XRF	2/22/97	2	Room	211	Wall	Wall	Solid	Plaster	0.03
908	1956 Bldg	405	XRF	2/22/97	2	Room	211	Wall	Wall	Solid	Wood	0.03
909	1956 Bldg	406	XRF	2/22/97	2	Room	211	Bookcase	Shelf	Solid	Wood	0
910	1956 Bldg	407	XRF	2/22/97	2	Room	211		Radiator	Solid	Metal	0.01
911	1956 Bldg	408	XRF	2/22/97	2	Room	211		Radiator	Solid	Metal	0.26
912	1956 Bldg	409	XRF	2/22/97	2	Room	211	Bulletin	Board	Solid	Wood	0
913	1956 Bldg	410	XRF	2/22/97	2	Room	211	Bulletin	Board	Solid	Wood	0
914	1956 Bldg	411	XRF	2/22/97	2	Room	211	Cabinet	Door	Solid	Wood	0.01
915	1956 Bldg	412	XRF	2/22/97	2	Room	211	Wall	Wall Rgstr	Solid	Metal	0.03
916	1956 Bldg	413	XRF	2/22/97	2	Room	211	Sound Barrier		Solid	Metal	0
917	1956 Bldg	414	XRF	2/22/97	2	Room	211	Wire Tray		Solid	Metal	0.01
918	1956 Bldg	415	XRF	2/22/97	2	Room	211	Ceiling		Cracked	Plaster	0.02
919	1956 Bldg	416	XRF	2/22/97	2	Room	211	Bracket		Solid	Metal	0.02
920	1956 Bldg	418	XRF	2/22/97	2	Room	212	Wall	Wall	Solid	Plaster	0.24
921	1956 Bldg	419	XRF	2/22/97	2	Room	212	Wall	Wall	Solid	Plaster	0.2
922	1956 Bldg	420	XRF	2/22/97	2	Room	212	Wall	Wall	Solid	Wood	0
923	1956 Bldg	421	XRF	2/22/97	2	Room	212	Bookcase	Inside	Solid	Wood	0
924	1956 Bldg	422	XRF	2/22/97	2	Room	212		Radiator	Solid	Metal	0.04
925	1956 Bldg	423	XRF	2/22/97	2	Room	212	Ceiling	Diffuser	Solid	Metal	0.07
926	1956 Bldg	424	XRF	2/22/97	2	Room	212	Ceiling		Solid	Wood	0.01
927	1956 Bldg	425	XRF	2/22/97	2	Room	213	Wall	Wall	Solid	Plaster	0
928	1956 Bldg	426	XRF	2/22/97	2	Room	213	Wall	Wall	Solid	Plaster	0
929	1956 Bldg	427	XRF	2/22/97	2	Room	213	Wall	Wall	Solid	Wood	0.01
930	1956 Bldg	428	XRF	2/22/97	2	Room	213	Bookcase	Shelf	Solid	Wood	0
931	1956 Bldg	429	XRF	2/22/97	2	Room	213		Radiator	Solid	Metal	0.02
932	1956 Bldg	430	XRF	2/22/97	2	Room	213	Bulletin	Board	Solid	Wood	0
933	1956 Bldg	431	XRF	2/22/97	2	Room	213	Bulletin	Board	Solid	Wood	0
934	1956 Bldg	432	XRF	2/22/97	2	Room	213	Bulletin	Board	Solid	Wood	0
935	1956 Bldg	433	XRF	2/22/97	2	Room	213	Wall	Wall Rgstr	Solid	Metal	0
936	1956 Bldg	434	XRF	2/22/97	2	Room	213	Cabinet	Door	Solid	Wood	0
937	1956 Bldg	435	XRF	2/22/97	2	Room	213	Sound Barrier		Solid	Metal	0
938	1956 Bldg	436	XRF	2/22/97	2	Room	213	Wire Tray		Solid	Metal	0
939	1956 Bldg	437	XRF	2/22/97	2	Room	213	Ceiling		Solid	Plaster	0.15
940	1956 Bldg	438	XRF	2/22/97	2	Room	214	Wall	Wall	Solid	Plaster	0.21
941	1956 Bldg	439	XRF	2/22/97	2	Room	214	Wall	Wall	Solid	Plaster	0.18
942	1956 Bldg	440	XRF	2/22/97	2	Room	214	Wall	Wall	Solid	Wood	0.01
943	1956 Bldg	441	XRF	2/22/97	2	Room	214	Bookcase	Shelf	Solid	Wood	0
944	1956 Bldg	442	XRF	2/22/97	2	Room	214	Door	Door	Solid	Wood	0.01
945	1956 Bldg	443	XRF	2/22/97	2	Room	214	Door	Casing	Solid	Metal	0.07

Saint Paul Public Schools
 Hazel Park Academy
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
946	1956 Bldg	444	XRF	2/22/97	2	Room	214		Radiator	Solid	Metal	0.13
947	1956 Bldg	445	XRF	2/22/97	2	Room	214	Bulletin	Board	Solid	Wood	0
948	1956 Bldg	446	XRF	2/22/97	2	Room	214	Bulletin	Board	Solid	Wood	0
949	1956 Bldg	447	XRF	2/22/97	2	Room	214	Cabinet	Door	Solid	Wood	0.01
950	1956 Bldg	448	XRF	2/22/97	2	Room	214	Wall	Wall Rgstr	Solid	Metal	0
951	1956 Bldg	449	XRF	2/22/97	2	Room	214	Sound Barrier		Solid	Metal	0
952	1956 Bldg	450	XRF	2/22/97	2	Room	214	Wire Tray		Solid	Metal	0.01
953	1956 Bldg	451	XRF	2/22/97	2	Room	214	Ceiling		Cracked	Plaster	0.05
954	1956 Bldg	452	XRF	2/22/97	2	Room	215	Wall	Wall	Solid	Plaster	0.13
955	1956 Bldg	453	XRF	2/22/97	2	Room	215	Wall	Wall	Solid	Plaster	0.03
956	1956 Bldg	454	XRF	2/22/97	2	Room	215	Wall	Wall	Solid	Wood	0.02
957	1956 Bldg	455	XRF	2/22/97	2	Room	215	Bookcase	Shelf	Solid	Wood	0
958	1956 Bldg	456	XRF	2/22/97	2	Room	215		Radiator	Solid	Metal	0.04
959	1956 Bldg	457	XRF	2/22/97	2	Room	215	Bulletin	Board	Solid	Wood	0
960	1956 Bldg	458	XRF	2/22/97	2	Room	215	Bulletin	Board	Solid	Wood	0
961	1956 Bldg	459	XRF	2/22/97	2	Room	215	Cabinet	Door	Solid	Wood	0
962	1956 Bldg	460	XRF	2/22/97	2	Room	215	Wall	Wall Rgstr	Solid	Metal	0.02
963	1956 Bldg	461	XRF	2/22/97	2	Room	215	Sound Barrier		Solid	Metal	0.02
964	1956 Bldg	462	XRF	2/22/97	2	Room	215	Wire Tray		Solid	Metal	0
965	1956 Bldg	463	XRF	2/22/97	2	Room	215	Ceiling		Solid	Plaster	0.05
966	1956 Bldg	6	XRF	2/23/97	2	Room	216	Wall	Wall	Cracked	Plaster	0.15
967	1956 Bldg	7	XRF	2/23/97	2	Room	216	Wall	Wall	Solid	Wood	0
968	1956 Bldg	8	XRF	2/23/97	2	Room	216	Bulletin	Board	Solid	Wood	0
969	1956 Bldg	9	XRF	2/23/97	2	Room	216	Bookcase	Shelf	Solid	Wood	0
970	1956 Bldg	10	XRF	2/23/97	2	Room	216	Cabinet	Door	Solid	Wood	0
971	1956 Bldg	11	XRF	2/23/97	2	Room	216	Wire Tray		Solid	Metal	0.03
972	1956 Bldg	17	XRF	2/23/97	2	Room	217	Wall	Wall	Solid	Plaster	0.04
973	1956 Bldg	18	XRF	2/23/97	2	Room	217	Wall	Wall	Solid	Plaster	0.08
974	1956 Bldg	19	XRF	2/23/97	2	Room	217	Wall	Wall	Solid	Wood	0.02
975	1956 Bldg	20	XRF	2/23/97	2	Room	217	Bookcase	Shelf	Solid	Wood	0
976	1956 Bldg	21	XRF	2/23/97	2	Room	217		Radiator	Solid	Metal	0.02
977	1956 Bldg	22	XRF	2/23/97	2	Room	217	Bulletin	Board	Solid	Wood	0
978	1956 Bldg	23	XRF	2/23/97	2	Room	217	Bulletin	Board	Solid	Wood	0
979	1956 Bldg	24	XRF	2/23/97	2	Room	217	Cabinet	Door	Solid	Wood	0
980	1956 Bldg	25	XRF	2/23/97	2	Room	217	Wall	Wall Rgstr	Solid	Metal	0
981	1956 Bldg	26	XRF	2/23/97	2	Room	217	Sound Barrier		Solid	Metal	0
982	1956 Bldg	27	XRF	2/23/97	2	Room	217	Wire Tray		Solid	Metal	0
983	1956 Bldg	28	XRF	2/23/97	2	Room	217	Ceiling		Solid	Plaster	0.03
984	1956 Bldg	29	XRF	2/23/97	2	Room	218	Wall	Wall	Solid	Plaster	0.13
985	1956 Bldg	30	XRF	2/23/97	2	Room	218	Wall	Wall	Solid	Plaster	0.08
986	1956 Bldg	31	XRF	2/23/97	2	Room	218	Wall	Wall	Solid	Wood	0
987	1956 Bldg	32	XRF	2/23/97	2	Room	218	Bookcase	Shelf	Solid	Wood	0
988	1956 Bldg	33	XRF	2/23/97	2	Room	218		Radiator	Solid	Metal	0
989	1956 Bldg	34	XRF	2/23/97	2	Room	218	Door	Door	Solid	Wood	0.01
990	1956 Bldg	35	XRF	2/23/97	2	Room	218	Door	Casing	Solid	Metal	0.07
991	1956 Bldg	36	XRF	2/23/97	2	Room	218	Bulletin	Board	Solid	Wood	0.51
992	1956 Bldg	37	XRF	2/23/97	2	Room	218	Bulletin	Board	Solid	Wood	0
993	1956 Bldg	38	XRF	2/23/97	2	Room	218	Cabinet	Door	Solid	Wood	0.01
994	1956 Bldg	39	XRF	2/23/97	2	Room	218	Wall	Wall Rgstr	Solid	Metal	0
995	1956 Bldg	40	XRF	2/23/97	2	Room	218	Sound Barrier		Solid	Metal	0
996	1956 Bldg	41	XRF	2/23/97	2	Room	218	Wire Tray		Solid	Metal	0
997	1956 Bldg	42	XRF	2/23/97	2	Room	218	Ceiling		Solid	Plaster	0.03
998	1956 Bldg	43	XRF	2/23/97	2	Room	219	Wall	Wall	Solid	Plaster	0.09
999	1956 Bldg	44	XRF	2/23/97	2	Room	219	Wall	Wall	Solid	Plaster	0.05
1000	1956 Bldg	45	XRF	2/23/97	2	Room	219	Wall	Wall	Solid	Wood	0
1001	1956 Bldg	46	XRF	2/23/97	2	Room	219	Bookcase	Shelf	Solid	Wood	0
1002	1956 Bldg	47	XRF	2/23/97	2	Room	219		Radiator	Solid	Metal	0.01
1003	1956 Bldg	48	XRF	2/23/97	2	Room	219	Bulletin	Board	Solid	Wood	0.01
1004	1956 Bldg	49	XRF	2/23/97	2	Room	219	Bulletin	Board	Solid	Wood	0

Saint Paul Public Schools
 Hazel Park Academy
 Lead-Based Paint Inspection


	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
1005	1956 Bldg	50	XRF	2/23/97	2	Room	219	Cabinet	Door	Solid	Wood	0
1006	1956 Bldg	51	XRF	2/23/97	2	Room	219	Wall	Wall Rgstr	Solid	Metal	0.02
1007	1956 Bldg	52	XRF	2/23/97	2	Room	219	Sound Barrier		Solid	Metal	0
1008	1956 Bldg	53	XRF	2/23/97	2	Room	219	Wire Tray		Solid	Metal	0
1009	1956 Bldg	54	XRF	2/23/97	2	Room	219	Ceiling		Solid	Plaster	0.06
1010	1956 Bldg	55	XRF	2/23/97	2	Room	219		Elec Pane	Solid	Metal	0
1011	1956 Bldg	56	XRF	2/23/97	2	Room	220	Wall	Wall	Solid	Plaster	0.08
1012	1956 Bldg	57	XRF	2/23/97	2	Room	220	Wall	Wall	Solid	Plaster	0.08
1013	1956 Bldg	58	XRF	2/23/97	2	Room	220	Wall	Wall	Solid	Wood	0.01
1014	1956 Bldg	59	XRF	2/23/97	2	Room	220	Bookcase	Shelf	Solid	Wood	0
1015	1956 Bldg	60	XRF	2/23/97	2	Room	220		Radiator	Solid	Metal	0.12
1016	1956 Bldg	61	XRF	2/23/97	2	Room	220	Door	Door	Solid	Wood	0
1017	1956 Bldg	62	XRF	2/23/97	2	Room	220	Door	Casing	Solid	Metal	0.05
1018	1956 Bldg	63	XRF	2/23/97	2	Room	220	Bulletin	Board	Solid	Wood	0
1019	1956 Bldg	64	XRF	2/23/97	2	Room	220	Bulletin	Board	Solid	Wood	0.01
1020	1956 Bldg	65	XRF	2/23/97	2	Room	220	Cabinet	Door	Solid	Wood	0.01
1021	1956 Bldg	66	XRF	2/23/97	2	Room	220	Wall	Wall Rgstr	Solid	Metal	0.01
1022	1956 Bldg	67	XRF	2/23/97	2	Room	220	Sound Barrier		Solid	Metal	0
1023	1956 Bldg	68	XRF	2/23/97	2	Room	220	Wire Tray		Solid	Metal	0
1024	1956 Bldg	69	XRF	2/23/97	2	Room	220	Ceiling		Cracked	Plaster	0.12
1025	1956 Bldg	82	XRF	2/23/97	2	Room	221	Wall	Wall	Solid	Plaster	0.09
1026	1956 Bldg	83	XRF	2/23/97	2	Room	221	Wall	Wall	Solid	Plaster	0.12
1027	1956 Bldg	84	XRF	2/23/97	2	Room	221	Wall	Wall	Solid	Wood	0.01
1028	1956 Bldg	85	XRF	2/23/97	2	Room	221	Bookcase	Shelf	Solid	Wood	0
1029	1956 Bldg	86	XRF	2/23/97	2	Room	221		Radiator	Solid	Metal	0.22
1030	1956 Bldg	87	XRF	2/23/97	2	Room	221	Bulletin	Board	Solid	Wood	0
1031	1956 Bldg	88	XRF	2/23/97	2	Room	221	Bulletin	Board	Solid	Wood	0
1032	1956 Bldg	89	XRF	2/23/97	2	Room	221	Cabinet	Door	Solid	Wood	0
1033	1956 Bldg	90	XRF	2/23/97	2	Room	221	Wall	Wall Rgstr	Solid	Metal	0
1034	1956 Bldg	91	XRF	2/23/97	2	Room	221	Sound Barrier		Solid	Metal	0
1035	1956 Bldg	92	XRF	2/23/97	2	Room	221	Wire Tray		Solid	Metal	0
1036	1956 Bldg	93	XRF	2/23/97	2	Room	221	Ceiling		Cracked	Plaster	0.03
1037	1956 Bldg	95	XRF	2/23/97	2	Room	222	Wall	Wall	Solid	Plaster	0.05
1038	1956 Bldg	96	XRF	2/23/97	2	Room	222	Wall	Wall	Solid	Wood	0.02
1039	1956 Bldg	97	XRF	2/23/97	2	Room	222	Bookcase	Shelf	Solid	Wood	0
1040	1956 Bldg	98	XRF	2/23/97	2	Room	222		Radiator	Solid	Metal	0.04
1041	1956 Bldg	99	XRF	2/23/97	2	Room	222	Bulletin	Board	Solid	Wood	0
1042	1956 Bldg	100	XRF	2/23/97	2	Room	222	Bulletin	Board	Solid	Wood	0
1043	1956 Bldg	101	XRF	2/23/97	2	Room	222	Wall	Wall Rgstr	Solid	Metal	0.02
1044	1956 Bldg	102	XRF	2/23/97	2	Room	222	Cabinet	Door	Solid	Wood	0
1045	1956 Bldg	103	XRF	2/23/97	2	Room	222	Sound Barrier		Solid	Metal	0
1046	1956 Bldg	104	XRF	2/23/97	2	Room	222	Wire Tray		Solid	Metal	0
1047	1956 Bldg	105	XRF	2/23/97	2	Room	222	Ceiling		Solid	Plaster	0.03
1048	1956 Bldg	100	XRF	2/21/97	1	Room	117A	Wall	Wall	Cracked	Plaster	0.04
1049	1956 Bldg	101	XRF	2/21/97	1	Room	117A	Wall	Wall	Cracked	Plaster	0.03
1050	1956 Bldg	102	XRF	2/21/97	1	Room	117A	Wall	Wall	Solid	Wood	0.01
1051	1956 Bldg	103	XRF	2/21/97	1	Room	117A		Radiator	Solid	Metal	0.01
1052	1956 Bldg	104	XRF	2/21/97	1	Room	117A	Bookcase	Shelf	Solid	Wood	0
1053	1956 Bldg	105	XRF	2/21/97	1	Room	117A	Bulletin	Board	Solid	Wood	0
1054	1956 Bldg	106	XRF	2/21/97	1	Room	117A	Bulletin	Board	Solid	Wood	0
1055	1956 Bldg	107	XRF	2/21/97	1	Room	117A	Wall	Wall Rgstr	Solid	Metal	0.03
1056	1956 Bldg	108	XRF	2/21/97	1	Room	117A	Sound Barrier		Solid	Metal	0
1057	1956 Bldg	109	XRF	2/21/97	1	Room	117A	Wire Tray		Solid	Metal	0
1058	1956 Bldg	110	XRF	2/21/97	1	Room	117A	Ceiling		Solid	Plaster	0.1
1059	1956 Bldg	111	XRF	2/21/97	1	Room	117B	Wall	Wall	Solid	Plaster	0.02
1060	1956 Bldg	112	XRF	2/21/97	1	Room	117B	Wall	Wall	Solid	Plaster	0.01
1061	1956 Bldg	113	XRF	2/21/97	1	Room	117B	Wall	Wall	Solid	Wood	0.01
1062	1956 Bldg	114	XRF	2/21/97	1	Room	117B		Radiator	Solid	Metal	0.01
1063	1956 Bldg	115	XRF	2/21/97	1	Room	117B	Bookcase	Shelf	Solid	Wood	0


Saint Paul Public Schools
 Hazel Park Academy
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
1064	1956 Bldg	116	XRF	2/21/97	1	Room	117B	Door	Door	Solid	Wood	0
1065	1956 Bldg	117	XRF	2/21/97	1	Room	117B	Door	Casing	Solid	Metal	0.01
1066	1956 Bldg	118	XRF	2/21/97	1	Room	117B	Wall	Wall Rgstr	Solid	Metal	0.01
1067	1956 Bldg	119	XRF	2/21/97	1	Room	117B	Sound Barrier		Solid	Metal	0
1068	1956 Bldg	120	XRF	2/21/97	1	Room	117B	Wire Tray		Solid	Metal	0
1069	1956 Bldg	121	XRF	2/21/97	1	Room	117B	Ceiling		Solid	Plaster	0.3
1070	1956 Bldg	122	XRF	2/21/97	1	Room	117B	Bulletin	Board	Solid	Wood	0
1071	1956 Bldg	123	XRF	2/21/97	1	Room	117B	Bulletin	Board	Solid	Wood	0
1072	1956 Bldg	148	XRF	2/21/97	1	Room	119A	Wall	Wall	Solid	Plaster	0.02
1073	1956 Bldg	149	XRF	2/21/97	1	Room	119A	Wall	Wall	Solid	Plaster	0.02
1074	1956 Bldg	150	XRF	2/21/97	1	Room	119A	Wall	Wall	Solid	Wood	0.07
1075	1956 Bldg	151	XRF	2/21/97	1	Room	119A		Radiator	Solid	Metal	0.02
1076	1956 Bldg	153	XRF	2/21/97	1	Room	119A	Bookcase	Shelf	Solid	Wood	0
1077	1956 Bldg	154	XRF	2/21/97	1	Room	119A	Bulletin	Board	Solid	Wood	0
1078	1956 Bldg	155	XRF	2/21/97	1	Room	119A	Bulletin	Board	Solid	Wood	0
1079	1956 Bldg	156	XRF	2/21/97	1	Room	119A	Wall	Wall Rgstr	Solid	Metal	0.01
1080	1956 Bldg	157	XRF	2/21/97	1	Room	119A	Sound Barrier		Solid	Metal	0
1081	1956 Bldg	158	XRF	2/21/97	1	Room	119A	Wire Tray		Solid	Metal	0.01
1082	1956 Bldg	159	XRF	2/21/97	1	Room	119A	Ceiling		Solid	Plaster	0.03
1083	1956 Bldg	160	XRF	2/21/97	1	Room	119B	Wall	Wall	Solid	Plaster	0.02
1084	1956 Bldg	161	XRF	2/21/97	1	Room	119B	Wall	Wall	Solid	Plaster	0.02
1085	1956 Bldg	162	XRF	2/21/97	1	Room	119B	Wall	Wall	Solid	Wood	0.03
1086	1956 Bldg	163	XRF	2/21/97	1	Room	119B		Radiator	Solid	Metal	0.03
1087	1956 Bldg	164	XRF	2/21/97	1	Room	119B	Bookcase	Shelf	Solid	Wood	0
1088	1956 Bldg	165	XRF	2/21/97	1	Room	119B	Bookcase	Shelf	Solid	Wood	0
1089	1956 Bldg	166	XRF	2/21/97	1	Room	119B	Bulletin	Board	Solid	Wood	0
1090	1956 Bldg	167	XRF	2/21/97	1	Room	119B	Bulletin	Board	Solid	Wood	0
1091	1956 Bldg	168	XRF	2/21/97	1	Room	119B	Wall	Wall Rgstr	Solid	Metal	0
1092	1956 Bldg	169	XRF	2/21/97	1	Room	119B	Sound Barrier		Solid	Metal	0.01
1093	1956 Bldg	170	XRF	2/21/97	1	Room	119B	Wire Tray		Solid	Metal	0
1094	1956 Bldg	171	XRF	2/21/97	1	Room	119B	Ceiling		Solid	Plaster	0
1095	1956 Bldg	106	XRF	2/23/97	2	Stairwell	1	Wall	Wall	Solid	Tile	2.85
1096	1956 Bldg	107	XRF	2/23/97	2	Stairwell	1	Wall	Wall	Solid	Plaster	0.06
1097	1956 Bldg	108	XRF	2/23/97	2	Stairwell	1	Panel		Solid	Wood	0.15
1098	1956 Bldg	109	XRF	2/23/97	2	Stairwell	1	Stairs	Hand rail	Solid	Metal	0
1099	1956 Bldg	110	XRF	2/23/97	2	Stairwell	1	Stairs	Hand rail	Solid	Wood	0
1100	1956 Bldg	111	XRF	2/23/97	2	Stairwell	1		Radiator	Solid	Metal	0
1101	1956 Bldg	112	XRF	2/23/97	2	Stairwell	1	Wall	Midle Wall	Cracked	Plaster	0.93
1102	1956 Bldg	113	XRF	2/23/97	2	Stairwell	1	Stairs	Stringer	Solid	Concrete	0.03
1103	1956 Bldg	114	XRF	2/23/97	2	Stairwell	1	Ceiling	Hatch	Solid	Metal	0
1104	1956 Bldg	115	XRF	2/23/97	2	Stairwell	2	Wall	Wall	Solid	Tile	3.26
1105	1956 Bldg	116	XRF	2/23/97	2	Stairwell	2	Wall	Wall	Solid	Plaster	0.05
1106	1956 Bldg	117	XRF	2/23/97	2	Stairwell	2	Stairs	Hand rail	Solid	Metal	0
1107	1956 Bldg	118	XRF	2/23/97	2	Stairwell	3	Stairs	Hand rail	Solid	Wood	0

Hazel Park Academy Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
1	Hazel Park Academy											
2	All Sites											
3												
4												
5	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
6	Portable	138	XRF	2/23/97	1	Room	1	Wall	Wall	Solid	Drywall	0
7	Portable	139	XRF	2/23/97	1	Room	1	Door	Door	Solid	Metal	0
8	Portable	140	XRF	2/23/97	1	Room	1	Door	Casing	Solid	Wood	0
9	Portable	141	XRF	2/23/97	1	Room	1	Door	Jamb	Solid	Wood	0
10	Portable	142	XRF	2/23/97	1	Room	1	Window	Sash	Solid	Wood	0
11	Portable	143	XRF	2/23/97	1	Room	1	Window	Casing	Solid	Wood	0
12	Portable	144	XRF	2/23/97	1	Room	1	Radiator	Solid	Metal	0.01	
13	Portable	145	XRF	2/23/97	1	Room	1	Wall	Wall Rgstr	Solid	Metal	0
14	Portable	146	XRF	2/23/97	1	Room	1	Elec Panel	Solid	Metal	0.01	
15	Portable	147	XRF	2/23/97	1	Room	1	Door	Door	Solid	Metal	0
16	Portable	148	XRF	2/23/97	1	Room	1	Door	Jamb	Peeling	Wood	0
17	Portable	149	XRF	2/23/97	1	Outside	1	Ext Wall	Siding	Peeling	Wood	0
18	Portable	150	XRF	2/23/97	1	Outside	1	Ext Wall	Skirt	Peeling	Wood	0.02
19	Portable	151	XRF	2/23/97	1	Outside	1	Ext Wall	Dripboard	Peeling	Wood	0.03
20	Portable	152	XRF	2/23/97	1	Outside	1	Window	Sill	Peeling	Wood	0
21	Portable	153	XRF	2/23/97	1	Outside	1	Stairs	Rail cap	Peeling	Wood	0.04
22	Portable	154	XRF	2/23/97	1	Outside	1	Stairs	Hand rail	Peeling	Metal	0

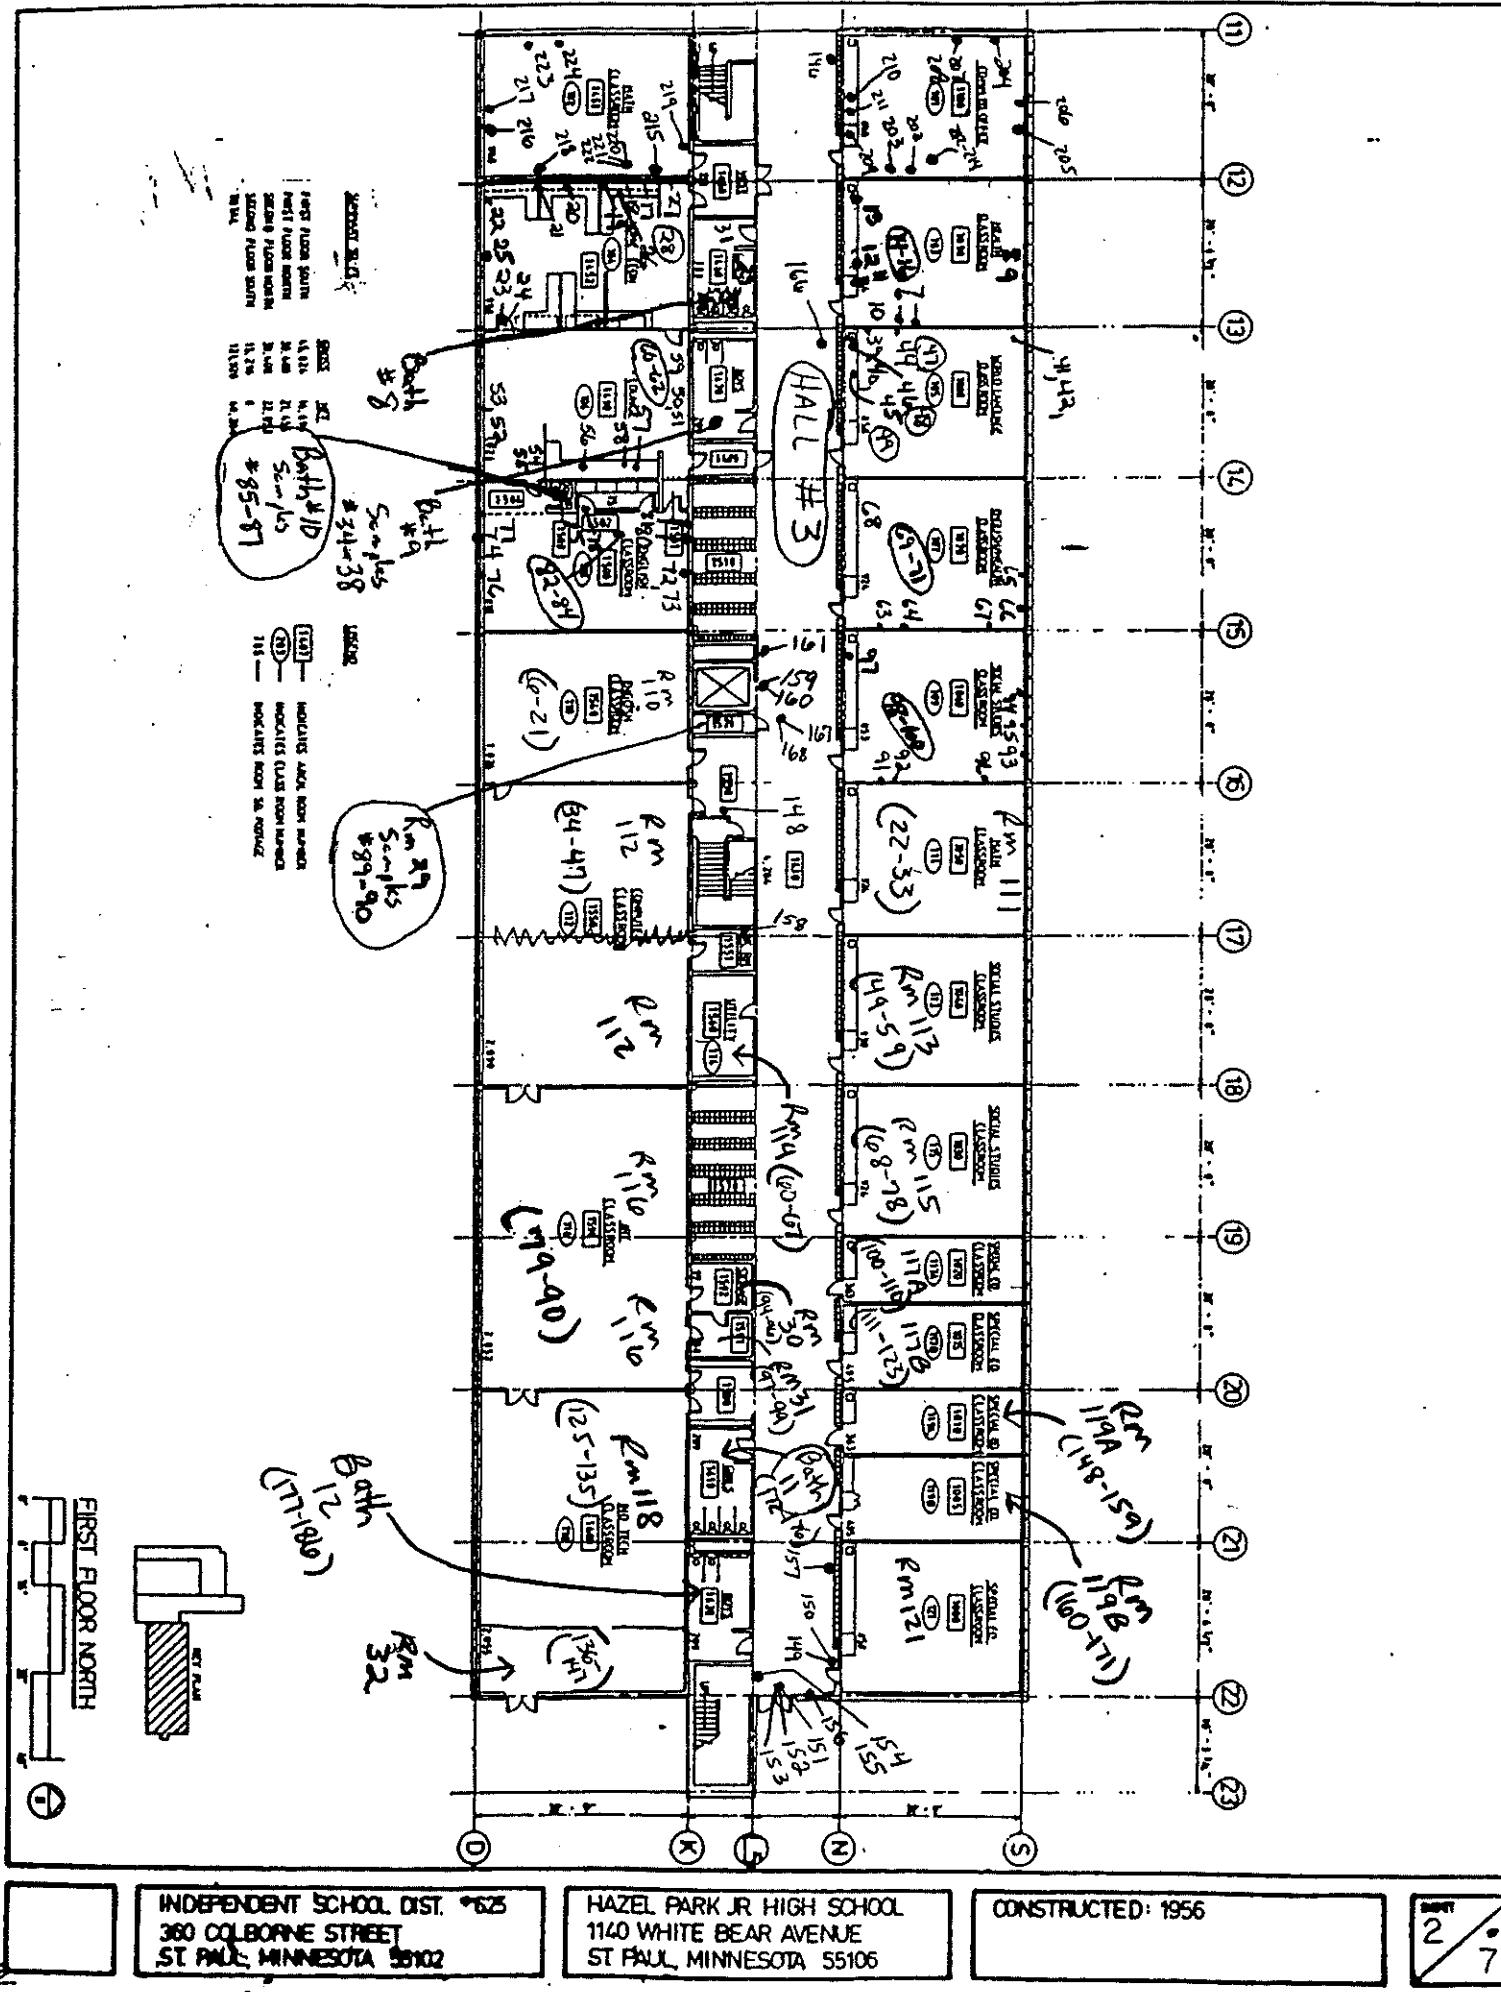

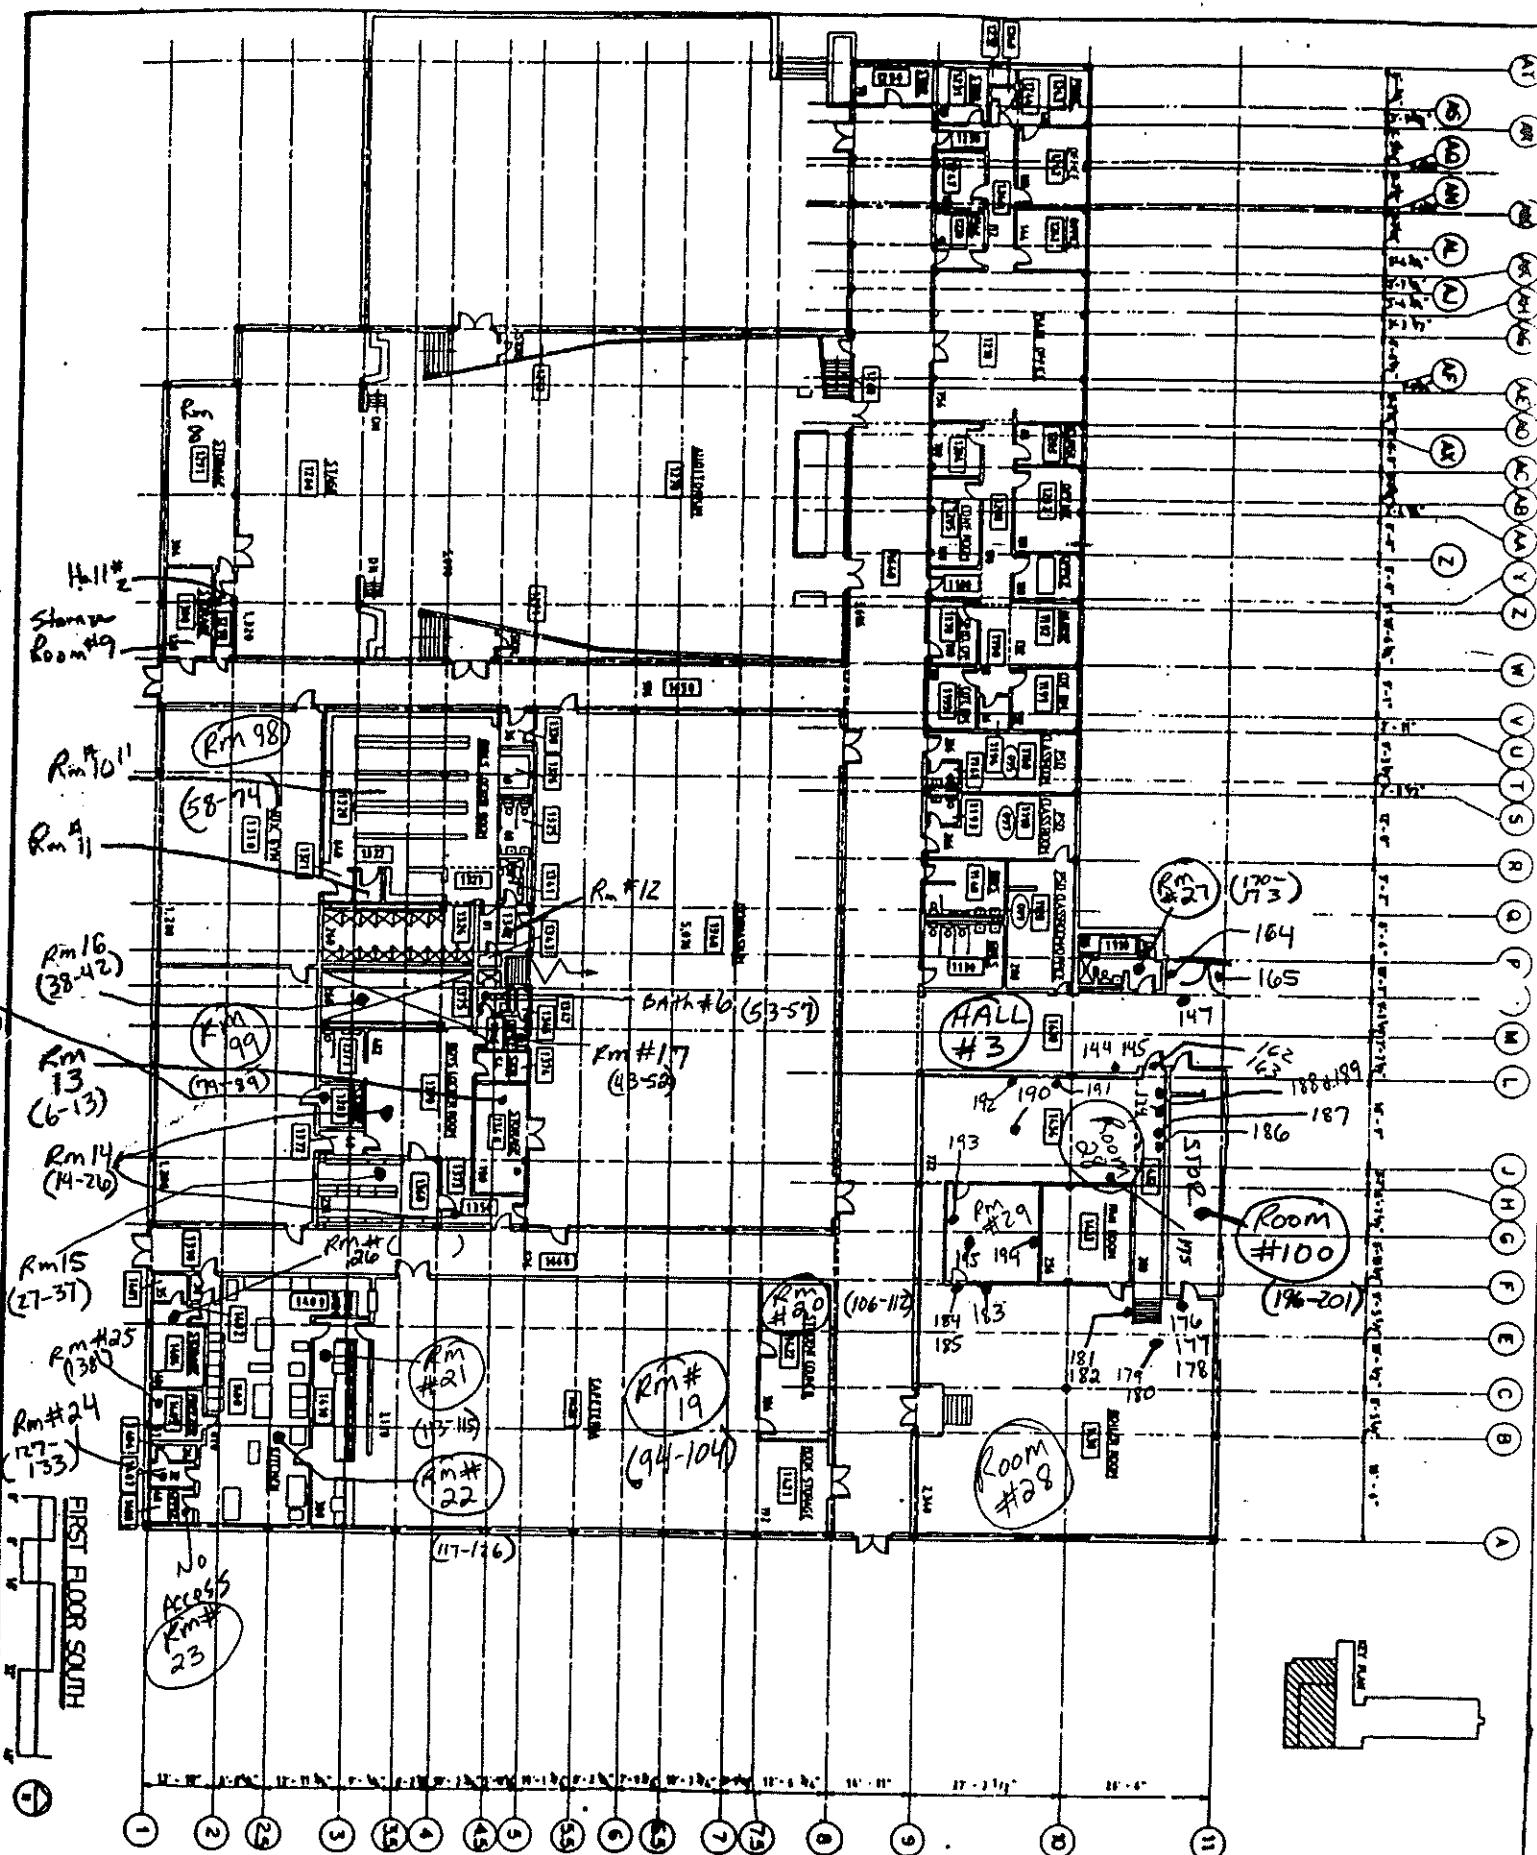





INDEPENDENT SCHOOL DIST. #625
360 COLBORNE STREET
ST. PAUL, MINNESOTA 55102

HAZEL PARK JR. HIGH SCHOOL
1140 WHITE BEAR AVENUE
ST. PAUL, MINNESOTA 55106



CONSTRUCTED: 1956

47



1st floor

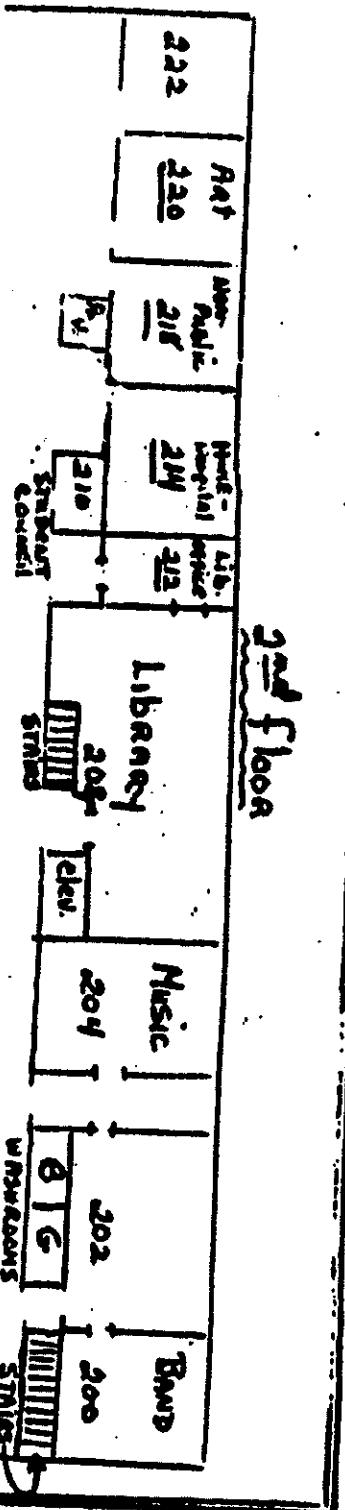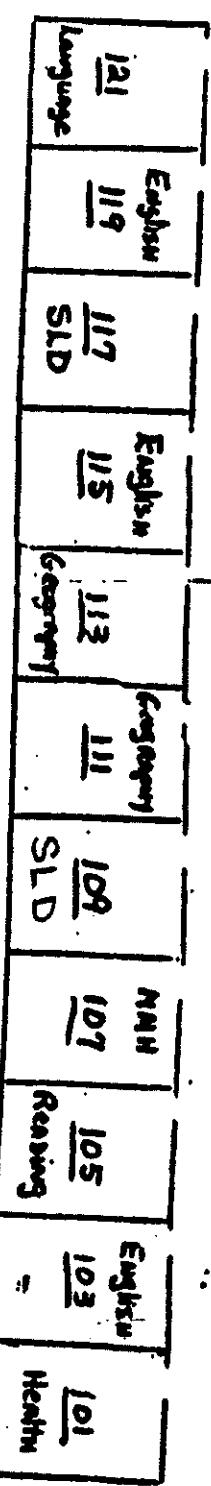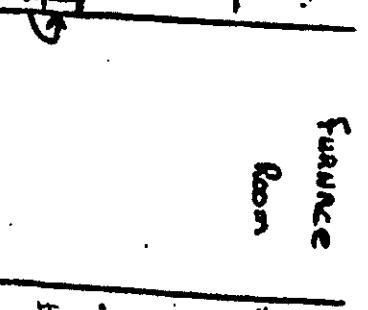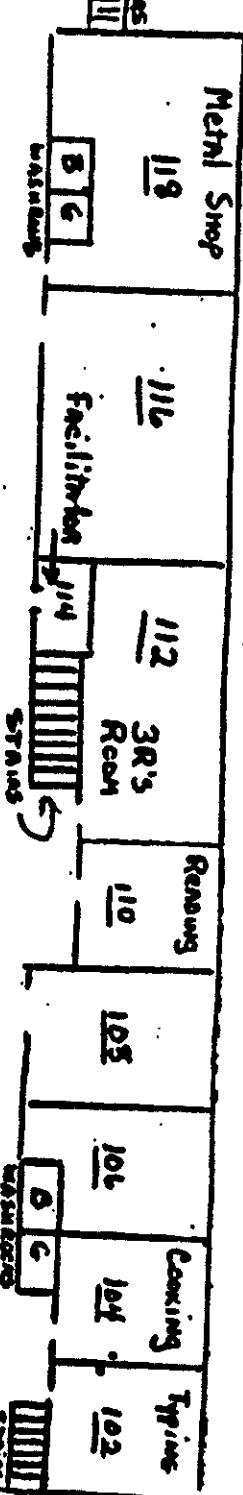

2nd floor

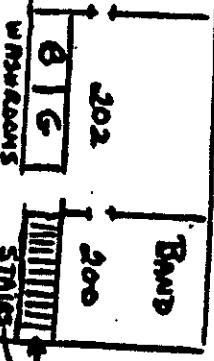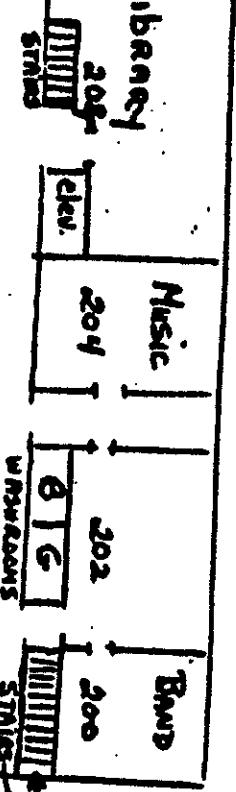

Rm #1

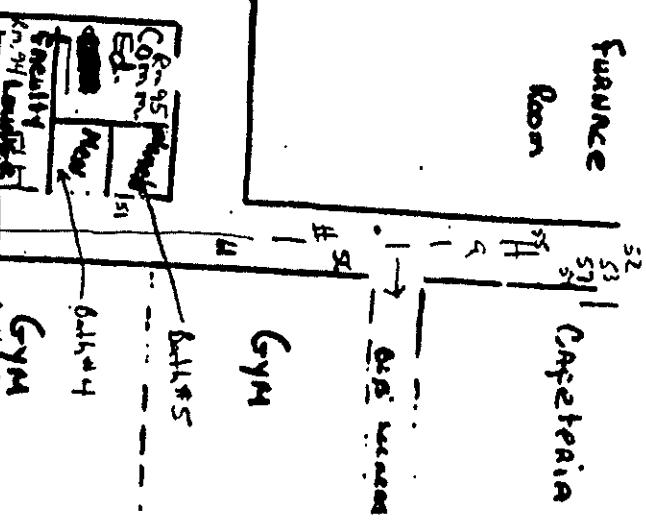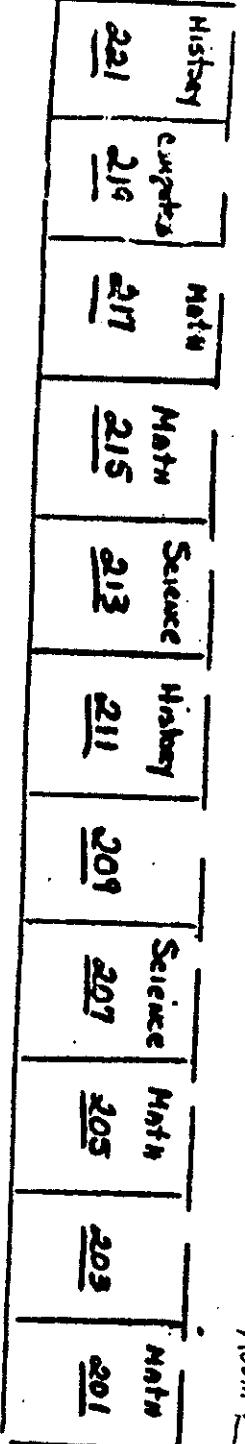

Jaget Park Jr. High Floor Plan


N S

Room #1

393-401
388-392
370-371

Front
Door

Expt

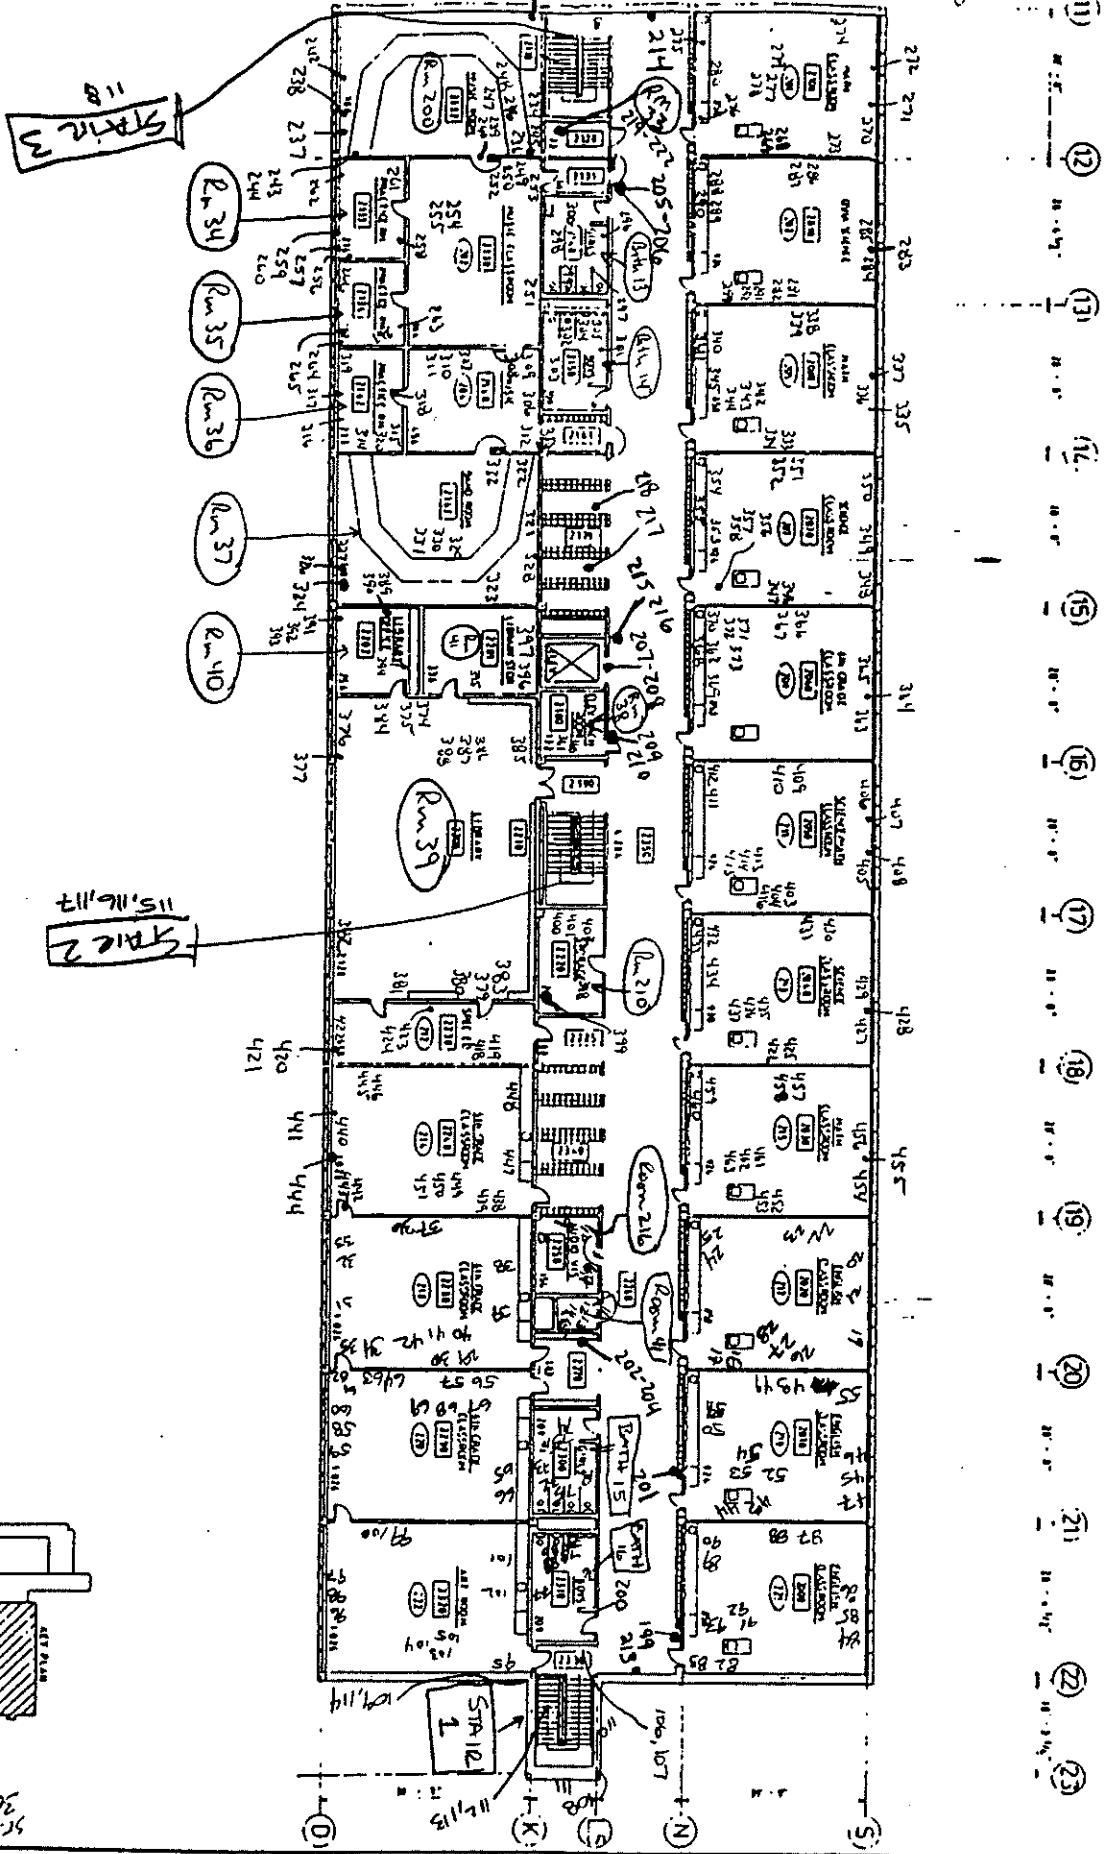

INDEPENDENT SCHOOL DIST #625
360 COLBORNE STREET
ST PAUL, MINNESOTA 55102

HAZEL PARK JR HIGH SCHOOL
1140 WHITE BEAR AVENUE
ST PAUL, MINNESOTA 55106

CONSTRUCTED 1956

3rd
7

APPENDIX B

LABORATORY SAMPLE ANALYSIS DATA

LABORATORY ANALYSIS REPORT**DATE:** May 1, 1997**PAGE:**

1 Of 3

CLIENT: Midwest Environmental Cons.
5385 401st Ave. NW
Dalbo, MN 55017**PROJECT NO.:** 040997-200888
COLLECTION DATE: 3/18/97
COLLECTED BY: Client
RECEIVED DATE: 4/09/97
PROJECT DESCRIPT.: 62/0197H**CONTACT:** Richard Cox/Greg Myers

<u>SAMPLE #</u>	<u>DESCP.</u>	<u>MDL</u>	<i>LEAD</i> (6010A)	<u>ANALYSIS</u>
			<u>RESULTS</u>	
			<u>Units=mg/kg</u>	
L972016-1	2-10-97 368	50	ND	4/28/97
L972016-2	2-10-97 370	80	200	4/28/97
L972016-3	2-10-97 371	34	4800	4/28/97
L972016-4	2-10-97 387	21	460	4/28/97
L972016-5	2-10-97 389	21	140	4/28/97
L972016-6	2-11-97 8	26	540	4/28/97
L972016-7	2-11-97 24	34	490	4/28/97
L972016-8	2-11-97 46	30	600	4/28/97
L972016-9	2-11-97 47	35	300	4/28/97
L972016-10	2-11-97 52	27	3400	4/28/97
L972016-11	2-11-97 85	34	3900	4/28/97
L972016-12	2-11-97 89	28	820	4/28/97
L972016-13	2-11-97 115	39	1500	4/28/97
L972016-14	2-11-97 124	41	ND	4/28/97
L972016-15	2-11-97 125	41	51	4/28/97
L972016-16	2-11-97 129	35	1400	4/28/97
L972016-17	2-11-97 144	26	ND	4/28/97
L972016-18	2-11-97 151	48	4000	4/28/97
L972016-19	2-11-97 168	39	ND	4/28/97
L972016-20	2-11-97 170	49	1600	4/28/97
L972016-21	2-11-97 176	54	6600	4/28/97
L972016-22	2-11-97 187	22	2700	4/28/97
L972016-23	2-11-97 198	34	1000	4/28/97
L972016-24	2-11-97 207	21	430	4/28/97
L972016-25	2-17-97 47	16	1000	4/28/97
L972016-26	2-17-97 69	35	8000	4/28/97
L972016-27	2-17-97 74	42	7200	4/28/97
L972016-28	2-17-97 85	28	2900	4/28/97

ND means Not Detected or below reported MDL**MDL** means Method Detection Limit**mg/kg** means Milligrams Per Kilogram which is equivalent to Parts Per Million (ppm)

As a mutual protection, all reports are submitted in confidentiality and may not be reproduced except in full without written authorization.



A member of The Marmon Group of Companies

LABORATORY ANALYSIS REPORT**DATE:** May 1, 1997**PAGE:** 2 Of 3**CLIENT:** Midwest Environmental Cons.
5385 401st Ave. NW
Dalbo, MN 55017**PROJECT NO.:** 040997-200888
COLLECTION DATE: 3/18/97
COLLECTED BY: Client
RECEIVED DATE: 4/09/97
PROJECT DESCRIPT.: 62/0197H**CONTACT:** Richard Cox/Greg Myers

SAMPLE #	DESCP.	MDL	LEAD <i>(6010A)</i>	ANALYSIS
			RESULTS	
			Units=mg/kg	DATE
L972016-29	2-17-97 89	41	70	4/28/97
L972016-30	2-17-97 93	25	1600	4/28/97
L972016-31	2-17-97 162	34	1400	4/28/97
L972016-32	2-17-97 175	39	ND	4/29/97
L972016-33	2-17-97 177	19	390	4/29/97
L972016-34	2-17-97 179	34	ND	4/30/97
L972016-35	2-17-97 196	37	400	4/30/97
L972016-36	2-17-97 204	24	94	4/30/97
L972016-37	2-18-97 18	20	180	4/30/97
L972016-38	2-18-97 19	19	200	4/30/97
L972016-39	2-18-97 20	17	240	4/30/97
L972016-40	2-18-97 21	28	170	4/30/97
L972016-41	2-18-97 36	26	2400	4/30/97
L972016-42	2-18-97 59	21	270	4/30/97
L972016-43	2-18-97 94	21	3100	4/30/97
L972016-44	2-21-97 17	31	ND	4/30/97
L972016-45	2-21-97 61	28	350	4/30/97
L972016-46	2-21-97 93	29	4700	4/30/97
L972016-47	2-21-97 98	31	2700	4/30/97
L972016-48	2-21-97 150	23	280	4/30/97
L972016-49	2-21-97 173	22	3300	4/30/97
L972016-50	2-21-97 214	20	6000	4/30/97
L972016-51	2-22-97 236	33	320	4/30/97
L972016-52	2-22-97 260	40	240	4/30/97
L972016-53	2-22-97 286	41	390	4/30/97
L972016-54	2-22-97 289	21	2200	4/30/97
L972016-55	2-22-97 322	38	54	4/30/97
L972016-56	2-23-97 108	21	60	4/30/97

ND means Not Detected or below reported MDL**MDL** means Method Detection Limit**mg/kg** means Milligrams Per Kilogram which is equivalent to Parts Per Million (ppm)

As a mutual protection, all reports are submitted in confidentiality and may not be reproduced except in full without written authorization.



A member of The Marmur Group of Companies

LABORATORY ANALYSIS REPORT

DATE: May 1, 1997 **PAGE:** 3 Of 3

CLIENT: Midwest Environmental Cons.
5385 401st Ave. NW
Dalbo, MN 55017 **PROJECT NO.:** 040997-200888
COLLECTION DATE: 3/18/97
COLLECTED BY: Client
RECEIVED DATE: 4/09/97
PROJECT DESCRIPT.: 62/0197H

CONTACT: Richard Cox/Greg Myers

<u>SAMPLE #</u>	<u>DESCP.</u>	<u>MDL</u>	<u>LEAD</u> (6010A)	<u>ANALYSIS</u>
			<u>RESULTS</u>	
<u>Units=mg/kg</u>	<u>DATE</u>			
L972016-57	2-23-97 125	35	6200	4/30/97
L972016-58	2-23-97 126	22	300	4/30/97
L972016-59	2-23-97 127	15	19	4/30/97
L972016-60	2-23-97 129	38	1600	4/30/97
L972016-61	2-23-97 133	23	3100	4/30/97

ND means Not Detected or below reported MDL

MDL means Method Detection Limit

mg/kg means Milligrams Per Kilogram which is equivalent to Parts Per Million (ppm)

This report has been reviewed by me for technical accuracy and completeness. The analyses were performed using EPA or other approved methodologies and the results were reported on an "as received" basis unless otherwise noted. Organic soil analyses were reported on a dry weight basis. The results reported relate only to the items tested. Please contact me if you have any questions or comments regarding this report. Spectrum Labs, Inc. appreciates the opportunity to provide this analytical service for you.

Report Submitted By,


Thomas L. Halverson
Laboratory Manager

TLH:wmc
mec121-2

As a mutual protection, all reports are submitted in confidentiality and may not be reproduced except in full without written authorization.



A member of The Marmon Group of Companies


Midwest Environmental Consulting, L.L.C.
 5385 401st Ave. NW, Dalbo, MN 55017
 612-689-3612/612-757-5541/FAX-612-689-5209
 Client Address _____
 Contact _____

CHAIN OF CUSTODY RECORD

Project Number 62/0197 4
 Client St. Paul School District
 Project Hazel Park Academy
 Phone/Fax _____

Sample ID	Room/side	Sample Description	Color	Collection Date/Time	Matrix (Vol./Area)	Analysis Requested
20101 62/0197-#369	2/A	Upperwall plaster	white	3-18-97 4:00		Pb % w/w. or ppm
2 #370	1/A	Door V.	Varnish	3-18-97 4:10		
3 #371	1/A	Door Casing	bark	3-18-97 4:14		
4 #387	7/C	Upper wall plaster	Beige	3-18-97 4:19		
5 #389	78/A	Upper wall plaster	gray	3-18-97 4:25		
6 62/0197-#8	80/C	Lower wall plaster	green	3-18-97 4:28		
7 #24	83/B	Radiator	white	3-18-97 4:33		
8 #46	Bath 1/	Ceiling diffuser	white	3-18-97 4:39		
9 #47	Bath 1/	Plaster ceiling	white	3-18-97 4:42		
10 #52	Hall 1/c	Door metal	Blue	3-18-97 4:47		
11 #85	Bath 4/c	Metal Hatch	Green	3-18-97 4:53		
12 #89	Bath 5/c	Upper wall plaster	light blue	3-18-97 4:56		
13 #115	4/c	Metal Door	Gray	3-18-97 5:03		
14 #124	7/A	Middle wall plaster	blue	3-18-97 5:09		↙

Sampled By: Mark PFL Date: 3-18-97 Time: 4:06-5:09 Delivered By: Greg Myers Date: 4/19/97 Time: 12:10P
 Received By: _____ Date: _____ Time: _____
 Received By Lab: Mark Date: 4/19/97 Time: 12:08

Disposition of Samples _____
 Notes: Report in ppm

Midwest Environmental Consulting, L.L.C.
 5385 401st Ave. NW, Dalbo, MN 55017
 612-689-3612/612-757-5541/FAX-612-689-5209
 Client Address _____
 Contact _____



CHAIN OF CUSTODY RECORD

Project Number 6-2/0197-H
 Client St. Paul School District
 Project Hazel Park Academy
 Phone/Fax _____

Sample ID	Room / Side	Sample Description	Color	Collection Date/Time	Matrix (Vol./Area)	Analysis Requested
62/0197-H #125	7/A	Lower wall plaster	Red	3-18-97 5:12		Pb 7% Hg. or PPM
#129	7/D	Door Casing metal	White	3-18-97 5:15		
#144	8/D	Upper wall concrete	white	3-18-97 5:20		
#151	Hall 2/B	Door Casing	Blue	3-18-97 5:24		
#168	9e/D	Bulletin Board	Blue	3-18-97 5:28		
#170	9e/D	metal baseboard	Gold	3-18-97 5:30		
#176	9e/D	cable motorbox	Black	3-18-97 5:33		
#187	10/	Metal Cockers	Blue	3-18-97 5:37		
#198	11/B	Upper wall plaster	Tan	3-18-97 5:41		
#207	12/C	Electrical Wire Tray	white	3-18-97 5:45		
2-17-97-H #47	17/B	Electrical Panel	white	3-18-97 5:53		
#69	98/	Red floor stripe	Red	3-18-97 5:58		
#74	98/A	Black wall board	Black	3-18-97 6:02		
#85	99/C	Climbing Bars	Gray	3-18-97 6:05		


Sampled By: Mark M / PFL Date: 3-18-97 Time: 5:12-6:05

Received By: Mark M Date: 3-18-97 Time: 5:12-6:05 Delivered By: Greg A-M Date: 4/9/97 Time: 12:10 p

Received By Lab: Mark M Date: 4/9/97 Time: 5:08 Delivered By: _____ Date: _____ Time: _____

Disposition of Samples _____

Notes: Report + 12 pm

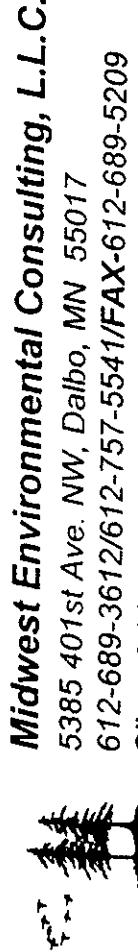

5385 401st Ave. NW, Duluth, MN 55017
612-689-3612/612-757-5541/FAX: 612-689-5209

Client Address _____

Contact _____

CHAIN OF CUSTODY RECORD

Project Number 62/0197-H
Client St. Paul School District
Project Hazel Park Academy
Phone/Fax _____

Sample ID	Sample Description	Collection Date/Time	Matrix (Vol./Area)	Analysis Requested
29 62/0197-H #89	99 Floor Stripe	3-18-97 6:08		Pb % wt. or ppm
30 #93	18 ceiling hatch	White 3-18-97 6:11		
31 #162	Hall 3/C Metal Door	Yellow 3-18-97 6:19		
32 #175	28/C "Office" letters	orange 3-18-97 6:31		
33 #177	28/A Door Header	Yellow 3-18-97 6:36		
34 #179	28/A Upper wall concrete	gray 3-18-97 6:40		
35 #190	100/B Upper wall plaster	light blue 3-18-97 6:46		
36 #204	101/D Upper wall plaster	blue/red 3-18-97 6:51		
37 2-18-97-H #18	104/D upper wall plaster	light blue 3-18-97 7:03		
38 #19	104/D upper wall plaster	orange 3-18-97 7:07		
39 #20	104/D upper wall plaster	yellow 3-18-97 7:10		
40 #21	104/D upper wall plaster	green 3-18-97 7:14		
41 #36	Bath A/B wall hatch	brown 3-18-97 7:22		
42 #59	100/A Wall diffuser	white 3-18-97 7:27		

Sampled By: Musb / OEL Date: 3-18-97 Time: 6:08-7:27 Delivered By: Greg Amyos Date: 4/9/97 Time: 12:10p

Received By: John O'Neil Date: 4/9/97 Time: 12:08p

Received By Lab: John O'Neil Date: 4/9/97 Time: 12:08p
Disposition of Samples _____

Notes: Report in progress

Delivered By: John O'Neil Date: 4/9/97 Time: 12:10p

Delivered By: John O'Neil Date: 4/9/97 Time: 12:10p

APPENDIX C INSPECTORS

**Patrick Leahy
MDH Lead Inspector # 237**

**Michael Buck
MDH Lead Inspector # 140**