


Midwest
Environmental
Consulting, L.L.C.

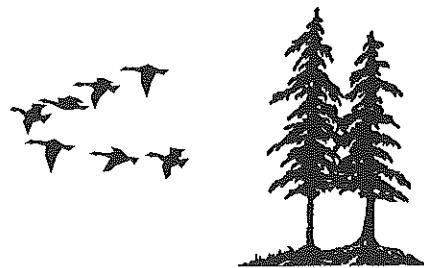

 Printed on Recycled Paper

**Ramsey Junior High
Saint Paul Public Schools**

Lead-Based Paint Inspection

**Inspection Dates: 2/20/97, 2/21/97, 2/22/97, 2/24/97,
2/25/97, 2/28/97, 3/4/97**

submitted to:

Saint Paul Public Schools

MEC Project # 62/0197K

INTRODUCTION

At the request of Saint Paul Public Schools Environmental Safety Department, Midwest Environmental Consulting, L.L.C. (MEC), conducted a lead-based paint inspection at Ramsey Junior High, 1700 Summit Ave., St. Paul, MN. The purpose of this inspection was to identify lead-based painted, varnished, or otherwise coated building components on the interior and exterior of the school building.

The inspection protocol incorporated applicable portions of the U.S. Department of Housing and Urban Development (HUD) *Guidelines for the Evaluation and Control of Lead-based Paint Hazards in Housing* (HUD Guidelines, June 1995) and OSHA 1926.62 requirements (Lead in Construction). The HUD guidelines are formulated to guide agencies in conducting random sampling of the interiors and exteriors of dwellings and common areas in public housing. The OSHA requirement is designed to minimize worker exposure when working with material containing lead.

Confirmatory testing was conducted when inconclusive XRF results were encountered. Inconclusive refers to XRF readings less than 0.2 mg/cm² (milligrams per square centimeter). Inconclusive results were confirmed with laboratory analysis of paint chip samples (Appendix B). This report contains a list of such results.

The United States Environmental Protection Agency defines "lead-based paint" as a paint or other surface coating that contains lead equal to or in excess of 1.0 milligrams per square centimeter when analyzed by XRF or more than 0.5% by weight (5000 parts per million) by laboratory analysis of a bulk sample.

Minnesota Department of Labor and Industry (MN OSHA) adopted the EPA lead levels for the purpose of enforcing OSHA 1926.62 federal regulations. Detection of lead in dried paint film by XRF is a dependable indicator of levels of lead and is accepted by MN OSHA.

For this Saint Paul Public Schools Lead Inspection, all building components were tested on site using a Niton XL® X-ray Fluorescence Spectrum Analyzer⁽¹⁾. Building components included walls, ceilings, floors, moldings, window and door components, door surfaces, and miscellaneous features such as shelves or bookcases. Only painted or glazed surfaces or surfaces which were varnished were tested. Suspended ceilings, structural steel, and corrugated decking were not included in the inspection. Neither anodized (e.g., window sashes) nor plastic (e.g., vinyl baseboard and vinyl mini-blinds) were included in the scope of this inspection.

⁽¹⁾ This is a portable hand held machine that can analyze building components instantly for lead concentrations.

Each building was divided into unique sites based on the year of construction or renovation. Portable classrooms, playgrounds, and other detached buildings were automatically designated as a unique site. Each site was inspected independently assuming differences in painting history and construction characteristics.

SITE DESCRIPTION AND BUILDING HISTORY

According to information provided to MEC by Saint Paul Public Schools, Ramsey Junior High was constructed in essentially four phases. The initial phase includes the 58,483 square-foot older section of the building and dates from 1927. A second phase of 24,842 square feet dates from 1965. A 7,345 square foot addition was added in 1977 for phase three, and a fourth phase of 8,800 square feet was added in 1997.

The 1997 phase was not inspected due to the date of the addition.

All room and area designations used in this report are depicted on sampling maps found in Appendix A.

XRF SAMPLE RESULTS TABLE

The results of all samples analyzed are listed in the table at the end of this section. The following is a description of the column headings:

Site	Each school is divided into sites based on their unique construction characteristics. Each site has a unique date of construction or major renovation.
Sample #	Each sample taken was given a unique number to identify the type and location of the sample. The sampling date is an integral part of the sample number.
Analysis	This defines the type of analysis which can be categorized into two types: 1) XRF: This is an on-site analysis using a hand held Niton XL® X-ray Fluorescence Spectrum Analyzer; 2) Bulk or Chip: This is a bulk sample where paint is removed from the substrate and sent to a laboratory for analysis;
Floor	This is the level of the building in which the area tested was found, example, 1 (first floor), 0 (basement), etc.

Area	This further defines the specific functional space inspected such as a classroom, exterior, playground, gym, kitchen, etc.
Room #	This is typically the actual number on the room as identified at the building.
Component	Building "components" included walls, ceilings, floors, moldings, window and door components, door surfaces, and miscellaneous features such as shelves or bookcases.
Feature	Identifies more detailed information of the component.
Condition	This describes condition of the surface, whether it is intact, cracked, peeling, or chalking.
Substrate	This refers to the material the building component is made of (wood, concrete, drywall, metal, etc.).
Result	This is the analysis results for lead. Less than 1.0 mg/cm ² or less than 0.5% by weight is considered to be non-lead and these building components are below the action levels of EPA and HUD. (All results are in mg/cm ² except where noted.)

The table of results is designed for quick information on lead concentrations of tested building components. Generally, all repetitions of a test combination within a given room or area, may be assumed to contain similar concentrations of lead to that of the tested sample. For instance, the lead concentration of a tested wooden window sash was found to be above the action level of 1.0 mg/cm² in a given classroom. The classroom has five windows, all of wood, the same color and appearing to be of the same era. It can be assumed that the remaining four wooden window sashes each contain lead above the action limit.

Other columns identify the component and the component feature tested, condition of the component, type of substrate and the result of the analytical test.

As an example, the following illustration shows that the wooden door jamb in Room 123, first floor in the 1923 building section was in good, solid condition, and had an XRF test result of 0.3 mg/cm², which is below the action level.

Illustration Only

Site	Sample #	Date	Analysis	Floor	Area	Room #	Component	Feature	Condition	Substrate	Results
1923 Bldg.	52		XRF	1	Room	123	Door	Jamb	Solid	Wood	0.3

In a similar manner, the table shows that the plaster walls in room 23, on the second floor has peeling paint with more than 1.0 mg/cm² (shaded).

ILLUSTRATION ONLY

Site	Sample #	Date	Analysis	Floor	Area	Room #	Component	Feature	Condition	Substrate	Results
1910 Bldg.	16		XRF	2	Room	23	Door	Jamb	Peeling	Wood	0.25
1910 Bldg.	17		XRF	2	Room	23	Wall	Wall	Peeling	Plaster	1.2
1910 Bldg.	18		XRF	2	Room	23	Ceiling	Peeling	Plaster		0.25
1910 Bldg.	19		XRF	2	Room	23	Wall	Baseboard	Peeling	Wood	0.002

APPLICABLE REGULATIONS

When building components test above 1.0 mg/cm² of lead by XRF or 0.5% lead by weight from laboratory analysis all employees and contractors who will be working with these components in a construction related activity must be notified. The requirements of OSHA 1926.62, Lead in Construction are enforceable. This regulation defines construction work as "work for construction, alteration and/or repair, including painting and decorating." This regulation further defines monitoring requirements to minimize employee exposure to lead during construction activities.

When work is performed on external painted building structures (i.e. flashing, fire escapes, playground equipment, handrails, etc.), regulations of the Minnesota Pollution Control Agency (MPCA) may also be applicable. For removal of lead based paint from steel structures, MN Rules 7025.0200 - 7025.0380 apply to steel materials on the exterior of a building, or on the property when levels exceed 0.5 mg/cm² based on the average of three XRF spectrum results of the sample tested, or 5,000 ppm by laboratory analysis. If it is other than a steel surface, then MPCA regulates the painted surfaces under MN Rules 7025.010 - 7025.0080, when surfaces are to be disturbed using abrasive blasting methods.

Please contact MEC directly if you have questions about any portion of this report or the lead-based paint inspection itself.


APPENDIX A

XRF TESTING DATA WITH LOCATION MAPS

part of 2/24/97 samples


Ramsey Jr. High Floor Plans

2/24/97
2/25/97 - #6 -

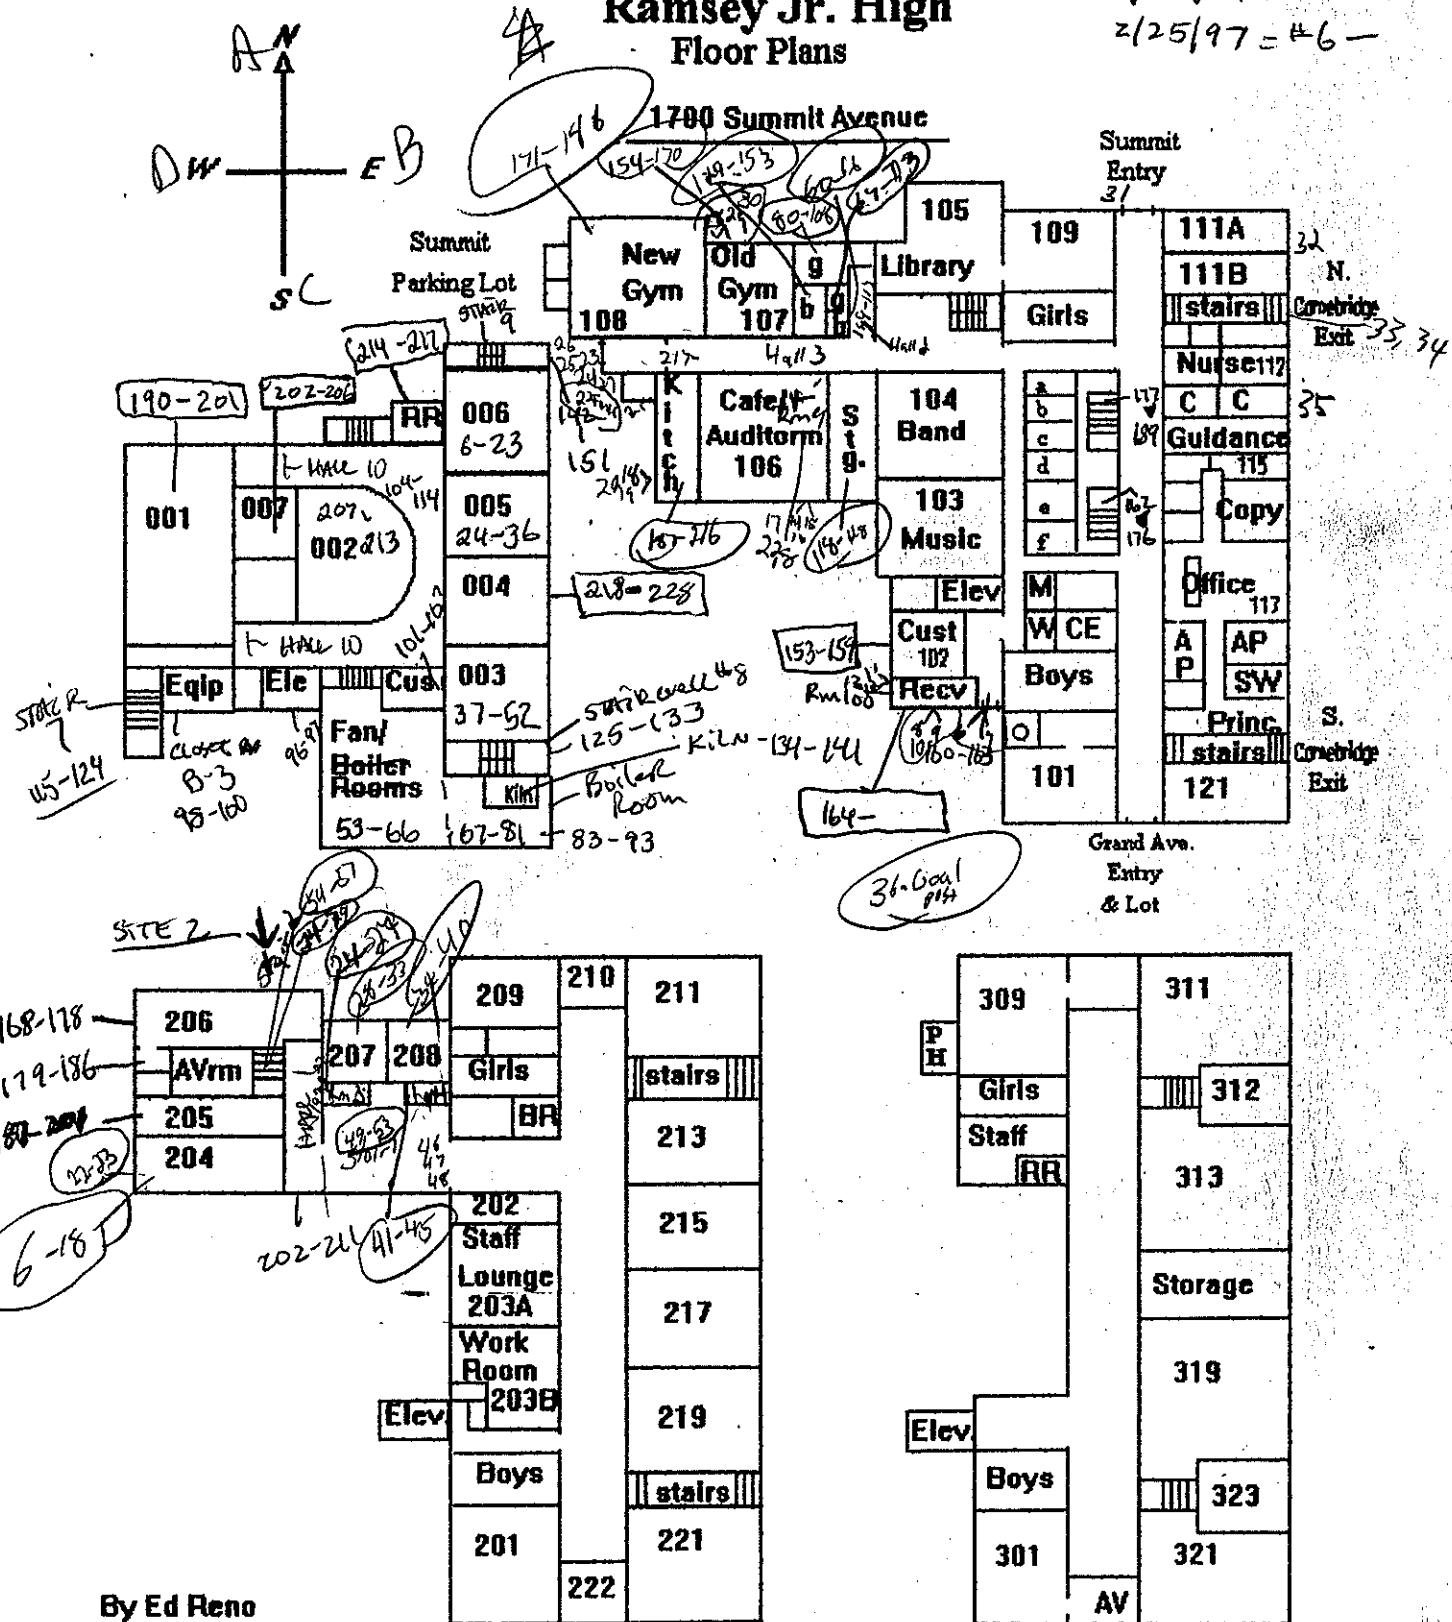

Ramsey Jr. High Floor Plans

1700 Summit Avenue

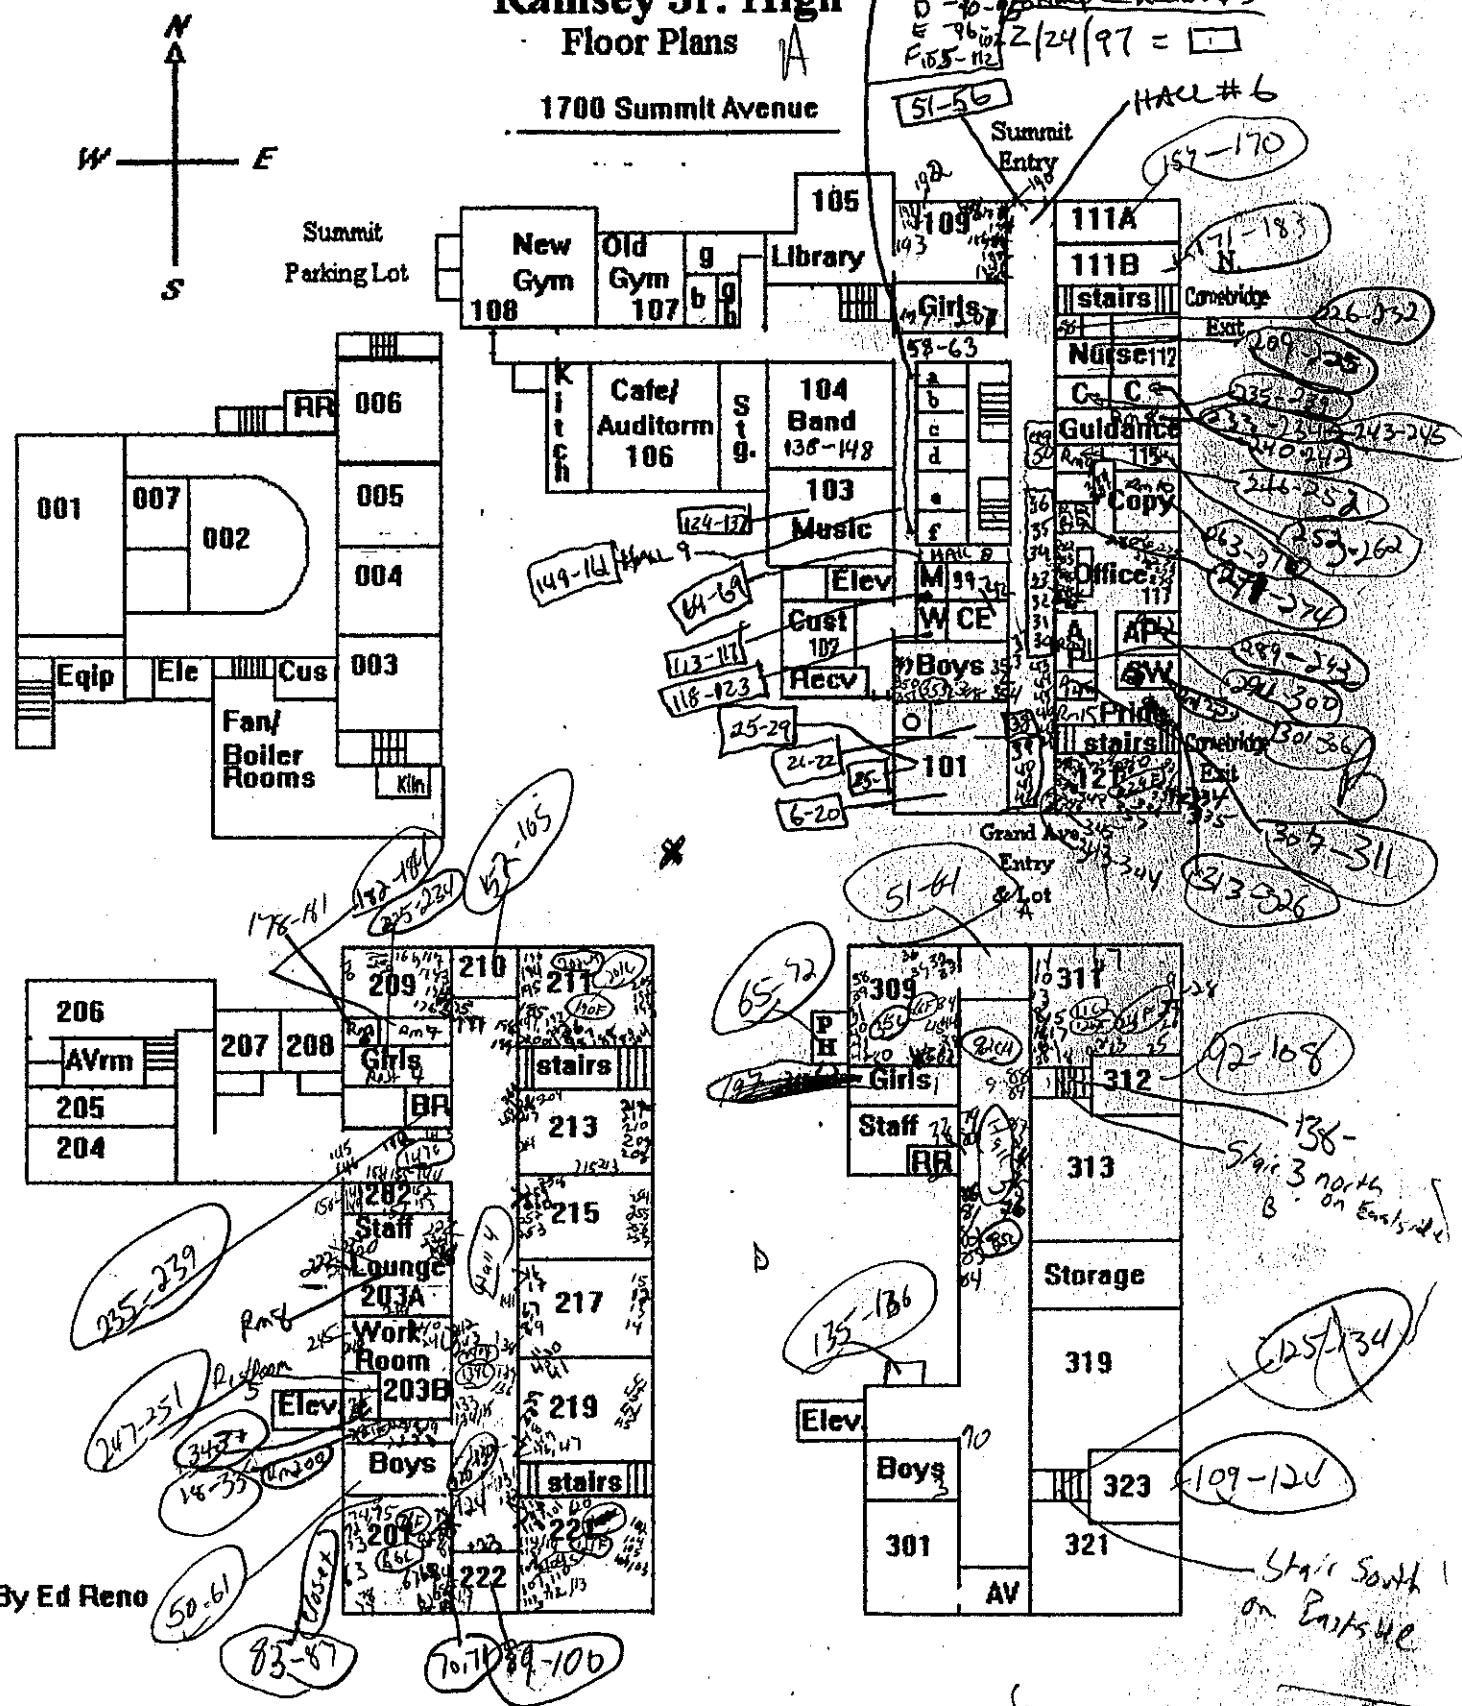

Saint Paul Public Schools
 Ramsey Junior High School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
1	Ramsey Junior High											
2												
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
4	1927 Bldg	190	XRF	2/24/97	0	Classroo	1	Wall	Midle Wall	Solid	Concrete	0
5	1927 Bldg	37	XRF	2/25/97	0	Classroo	3	Wall	Midle Wall	Solid	Concrete	0
6	1927 Bldg	38	XRF	2/25/97	0	Classroo	3	Door	Door	Cracked	Wood	0
7	1927 Bldg	39	XRF	2/25/97	0	Classroo	3	Door	Casing	Cracked	Metal	0
8	1927 Bldg	40	XRF	2/25/97	0	Classroo	3	Cabinet	Door	Cracked	Wood	0
9	1927 Bldg	41	XRF	2/25/97	0	Classroo	3	Wire Tray		Cracked	Metal	0.03
10	1927 Bldg	42	XRF	2/25/97	0	Classroo	3	Wall	Wall	Cracked	Drywall	0
11	1927 Bldg	43	XRF	2/25/97	0	Classroo	3	Univent		Cracked	Wood	0
12	1927 Bldg	44	XRF	2/25/97	0	Classroo	3	Window	Casing	Solid	Wood	0.02
13	1927 Bldg	45	XRF	2/25/97	0	Classroo	3	Wall	Wall	Solid	Metal	0
14	1927 Bldg	46	XRF	2/25/97	0	Classroo	3	Wall	Wall	Cracked	Plaster	5.09
15	1927 Bldg	47	XRF	2/25/97	0	Classroo	3	Door	Door	Cracked	Wood	5.09
16	1927 Bldg	48	XRF	2/25/97	0	Classroo	3	Door	Casing	Cracked	Metal	0.17
17	1927 Bldg	49	XRF	2/25/97	0	Classroo	3	Closet	Wall	Cracked	Plaster	5.09
18	1927 Bldg	50	XRF	2/25/97	0	Classroo	3	Closet	Wall	Solid	Concrete	0
19	1927 Bldg	51	XRF	2/25/97	0	Classroo	3	Closet	Floor	Cracked	Concrete	0.04
20	1927 Bldg	52	XRF	2/25/97	0	Classroo	3	Closet	Column	Cracked	Plaster	3.03
21	1927 Bldg	53	XRF	2/25/97	0	Classroo	3	Wall	Midle Wall	Solid	Concrete	0
22	1927 Bldg	54	XRF	2/25/97	0	Classroo	3	Wall	Wall	Cracked	Plaster	0.03
23	1927 Bldg	55	XRF	2/25/97	0	Classroo	3	Wall	Wall	Cracked	Plaster	0.04
24	1927 Bldg	56	XRF	2/25/97	0	Classroo	3	Wall	Midle Wall	Cracked	Drywall	0.01
25	1927 Bldg	57	XRF	2/25/97	0	Classroo	3	Floor		Cracked	Concrete	0.04
26	1927 Bldg	24	XRF	2/25/97	0	Classroo	5	Wall	Wall	Solid	Concrete	0
27	1927 Bldg	25	XRF	2/25/97	0	Classroo	5	Door	Door	Cracked	Wood	0
28	1927 Bldg	26	XRF	2/25/97	0	Classroo	5	Door	Casing	Cracked	Metal	0.03
29	1927 Bldg	27	XRF	2/25/97	0	Classroo	5	Cabinet	Door	Solid	Wood	0
30	1927 Bldg	28	XRF	2/25/97	0	Classroo	5	Cabinet	Inside	Solid	Wood	0
31	1927 Bldg	29	XRF	2/25/97	0	Classroo	5	Cabinet	Column	Cracked	Plaster	5.09
32	1927 Bldg	30	XRF	2/25/97	0	Classroo	5	Wall	Wall	Cracked	Drywall	0.11
33	1927 Bldg	31	XRF	2/25/97	0	Classroo	5	Univent	Wall	Cracked	Wood	0
34	1927 Bldg	32	XRF	2/25/97	0	Classroo	5		Radiator	Solid	Metal	0
35	1927 Bldg	33	XRF	2/25/97	0	Classroo	5	Wall	Wall	Cracked	Plaster	3.8
36	1927 Bldg	34	XRF	2/25/97	0	Classroo	5	Window	Casing	Solid	Wood	0.04
37	1927 Bldg	35	XRF	2/25/97	0	Classroo	5	Wall	Wall	Solid	Metal	0
38	1927 Bldg	36	XRF	2/25/97	0	Classroo	5	Wire Tray		Solid	Metal	0.02
39	1927 Bldg	6	XRF	2/25/97	0	Classroo	6	Wall	Wall	Cracked	Plaster	0
40	1927 Bldg	7	XRF	2/25/97	0	Classroo	6	Wall	Wall	Cracked	Plaster	4.38
41	1927 Bldg	8	XRF	2/25/97	0	Classroo	6	Door	Door	Cracked	Wood	5.09
42	1927 Bldg	9	XRF	2/25/97	0	Classroo	6	Door	Casing	Cracked	Wood	0.44
43	1927 Bldg	10	XRF	2/25/97	0	Classroo	6	Wall	Wall	Cracked	Drywall	0.02
44	1927 Bldg	11	XRF	2/25/97	0	Classroo	6	Univent		Cracked	Wood	0
45	1927 Bldg	12	XRF	2/25/97	0	Classroo	6		Radiator	Solid	Metal	0
46	1927 Bldg	13	XRF	2/25/97	0	Classroo	6	Window	Casing	Solid	Wood	0.01
47	1927 Bldg	14	XRF	2/25/97	0	Classroo	6	Wall	Wall	Solid	Metal	0
48	1927 Bldg	15	XRF	2/25/97	0	Classroo	6	Door	Door	Solid	Wood	0
49	1927 Bldg	16	XRF	2/25/97	0	Classroo	6	Door	Casing	Solid	Metal	0
50	1927 Bldg	17	XRF	2/25/97	0	Classroo	6	Wall	Midle Wall	Solid	Concrete	0
51	1927 Bldg	18	XRF	2/25/97	0	Classroo	6	Wall	Column	Cracked	Plaster	0.01
52	1927 Bldg	19	XRF	2/25/97	0	Classroo	6	Cabinet	Door	Solid	Wood	0
53	1927 Bldg	20	XRF	2/25/97	0	Classroo	6	Wire Tray		Solid	Metal	0.05
54	1927 Bldg	21	XRF	2/25/97	0	Classroo	6	Closet	Wall	Solid	Concrete	0
55	1927 Bldg	22	XRF	2/25/97	0	Classroo	6	Closet	Wall	Solid	Plaster	4.06
56	1927 Bldg	23	XRF	2/25/97	0	Classroo	6	Closet	Floor	Cracked	Concrete	0.05
57	1927 Bldg	17	XRF	2/24/97	1	Classroo	101	Cabinet	Inside	Cracked	Wood	0.02
58	1927 Bldg	18	XRF	2/24/97	1	Classroo	101	Wall	Wall	Cracked	Plaster	3.67
59	1927 Bldg	19	XRF	2/24/97	1	Classroo	101	Door	Door	Cracked	Wood	0.01
60	1927 Bldg	20	XRF	2/24/97	1	Classroo	101	Door	Casing	Cracked	Wood	0.02

Saint Paul Public Schools
 Ramsey Junior High School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
61	1927 Bldg	21	XRF	2/24/97	1	Classroo	101	Closet	Wall	Cracked	Plaster	0.56
62	1927 Bldg	22	XRF	2/24/97	1	Classroo	101	Closet	Wall	Cracked	Plaster	0.01
63	1927 Bldg	23	XRF	2/24/97	1	Classroo	101	Closet	Baseboar	Solid	Wood	0.02
64	1927 Bldg	24	XRF	2/24/97	1	Classroo	101	Closet	Casing	Solid	Wood	0.02
65	1927 Bldg	25	XRF	2/24/97	1	Classroo	101	Chair Rail		Solid	Wood	0.02
66	1927 Bldg	26	XRF	2/24/97	1	Classroo	101		Radiator	Peeling	Metal	2.67
67	1927 Bldg	27	XRF	2/24/97	1	Classroo	101	Window	Casing	Solid	Wood	0.05
68	1927 Bldg	28	XRF	2/24/97	1	Classroo	101	Wall	Wall	Solid	Metal	0
69	1927 Bldg	29	XRF	2/24/97	1	Classroo	101	Wall	Wall	Cracked	Plaster	0.01
70	1927 Bldg	124	XRF	2/24/97	1	Classroo	103	Wall	Wall	Solid	Concrete	0.06
71	1927 Bldg	125	XRF	2/24/97	1	Classroo	103	Wall	Wall	Solid	Metal	0
72	1927 Bldg	126	XRF	2/24/97	1	Classroo	103	Wall	Midle Wall	Cracked	Plaster	0.11
73	1927 Bldg	127	XRF	2/24/97	1	Classroo	103		Radiator	Solid	Metal	0.02
74	1927 Bldg	128	XRF	2/24/97	1	Classroo	103	Bulletin	Board	Solid	Wood	0
75	1927 Bldg	129	XRF	2/24/97	1	Classroo	103	Cabinet	Door	Solid	Wood	0
76	1927 Bldg	130	XRF	2/24/97	1	Classroo	103	TV Mount	Board	Solid	Wood	0
77	1927 Bldg	131	XRF	2/24/97	1	Classroo	103	Door	Door	Cracked	Wood	0
78	1927 Bldg	132	XRF	2/24/97	1	Classroo	103	Door	Casing	Solid	Wood	0.05
79	1927 Bldg	133	XRF	2/24/97	1	Classroo	103	Door	Door	Cracked	Wood	0.01
80	1927 Bldg	134	XRF	2/24/97	1	Classroo	103	Door	Casing	Solid	Wood	0.01
81	1927 Bldg	135	XRF	2/24/97	1	Classroo	103	Wall	Wall	Cracked	Plaster	5.09
82	1927 Bldg	136	XRF	2/24/97	1	Classroo	103	Wall	Wall Rgstr	Cracked	Metal	0.23
83	1927 Bldg	137	XRF	2/24/97	1	Classroo	103	Wall	Wall	Solid	Concrete	0.03
84	1927 Bldg	138	XRF	2/24/97	1	Classroo	104	Wall	Midle Wall	Cracked	Plaster	0.09
85	1927 Bldg	139	XRF	2/24/97	1	Classroo	104	Wall	Wall	Cracked	Plaster	0.06
86	1927 Bldg	140	XRF	2/24/97	1	Classroo	104	Door	Door	Cracked	Wood	0.01
87	1927 Bldg	141	XRF	2/24/97	1	Classroo	104	Door	Casing	Cracked	Wood	0.01
88	1927 Bldg	142	XRF	2/24/97	1	Classroo	104	Wall	Midle Wall	Solid	Concrete	0.3
89	1927 Bldg	143	XRF	2/24/97	1	Classroo	104	Wall	Wall Rgstr	Solid	Metal	0.01
90	1927 Bldg	144	XRF	2/24/97	1	Classroo	104	Cabinet	Door	Cracked	Wood	0
91	1927 Bldg	145	XRF	2/24/97	1	Classroo	104	Wall	Wall	Solid	Concrete	0.43
92	1927 Bldg	146	XRF	2/24/97	1	Classroo	104	Bulletin	Board	Solid	Wood	0.01
93	1927 Bldg	147	XRF	2/24/97	1	Classroo	104	Wall	Wall	Solid	Metal	0
94	1927 Bldg	148	XRF	2/24/97	1	Classroo	104	TV Mount	Board	Solid	Wood	0
95	1927 Bldg	327	XRF	2/22/97	1	Classroo	121	Wall	Wall	Cracked	Plaster	0.05
96	1927 Bldg	328	XRF	2/22/97	1	Classroo	121	Wall	Baseboar	Solid	Wood	0.04
97	1927 Bldg	329	XRF	2/22/97	1	Classroo	121	Wall	Wall	Solid	Wood	0.02
98	1927 Bldg	330	XRF	2/22/97	1	Classroo	121	Bulletin	Board	Cracked	Wood	0.03
99	1927 Bldg	331	XRF	2/22/97	1	Classroo	121	Chair Rail		Solid	Wood	0.05
100	1927 Bldg	332	XRF	2/22/97	1	Classroo	121	Wall	Wall	Cracked	Plaster	5.09
101	1927 Bldg	333	XRF	2/22/97	1	Classroo	121	Window	Casing	Solid	Wood	0.03
102	1927 Bldg	334	XRF	2/22/97	1	Classroo	121	Wall	Wall	Solid	Metal	0
103	1927 Bldg	335	XRF	2/22/97	1	Classroo	121		Radiator	Peeling	Metal	4.39
104	1927 Bldg	336	XRF	2/22/97	1	Classroo	121	TV Mount	Board	Solid	Wood	0
105	1927 Bldg	337	XRF	2/22/97	1	Classroo	121	Wire Tray		Solid	Metal	0.07
106	1927 Bldg	338	XRF	2/22/97	1	Classroo	121	Wall	Midle Wall	Cracked	Plaster	0.07
107	1927 Bldg	339	XRF	2/22/97	1	Classroo	121	Wall	Wall	Cracked	Plaster	0.01
108	1927 Bldg	340	XRF	2/22/97	1	Classroo	121	Ceiling		Solid	Plaster	0.1
109	1927 Bldg	341	XRF	2/22/97	1	Classroo	121	Wall	Wall Rgstr	Solid	Metal	3.23
110	1927 Bldg	342	XRF	2/22/97	1	Classroo	121	Wall	Crown mol	Solid	Wood	0.04
111	1927 Bldg	343	XRF	2/22/97	1	Classroo	121	Cabinet	Door	Cracked	Wood	0.01
112	1927 Bldg	344	XRF	2/22/97	1	Classroo	121	Cabinet	Shelf	Solid	Wood	0.02
113	1927 Bldg	345	XRF	2/22/97	1	Classroo	121	Wall	Wall	Cracked	Plaster	4.02
114	1927 Bldg	346	XRF	2/22/97	1	Classroo	121	Door	Door	Cracked	Wood	0.03
115	1927 Bldg	347	XRF	2/22/97	1	Classroo	121	Door	Jamb	Cracked	Wood	0.04
116	1927 Bldg	185	XRF	2/21/97	2	Classroo	211	Wall	Wall	Cracked	Plaster	1.64
117	1927 Bldg	186	XRF	2/21/97	2	Classroo	211	Wall	Midle Wall	Cracked	Plaster	0.02
118	1927 Bldg	187	XRF	2/21/97	2	Classroo	211	Wire Tray		Solid	Metal	0
119	1927 Bldg	188	XRF	2/21/97	2	Classroo	211	Bulletin	Board	Cracked	Wood	0.01

Saint Paul Public Schools
 Ramsey Junior High School
 Lead-Based Paint Inspection

3	A	B	C	D	E	F	G	H	I	J	K	L
	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
120	1927 Bldg	189	XRF	2/21/97	2	Classroo	211	Wall	Baseboar	Solid	Wood	0.01
121	1927 Bldg	190	XRF	2/21/97	2	Classroo	211	Floor		Solid	Wood	0.01
122	1927 Bldg	191	XRF	2/21/97	2	Classroo	211	Wall	Midle Wall	Cracked	Plaster	3.84
123	1927 Bldg	192	XRF	2/21/97	2	Classroo	211		Radiator	Peeling	Metal	4.33
124	1927 Bldg	193	XRF	2/21/97	2	Classroo	211	Window	Casing	Cracked	Wood	0.01
125	1927 Bldg	194	XRF	2/21/97	2	Classroo	211	Cabinet	Door	Cracked	Wood	0
126	1927 Bldg	195	XRF	2/21/97	2	Classroo	211	Cabinet	Inside	Cracked	Wood	0.01
127	1927 Bldg	196	XRF	2/21/97	2	Classroo	211	Wall	Wall Rgstr	Cracked	Metal	3.49
128	1927 Bldg	197	XRF	2/21/97	2	Classroo	211	Chair Rail		Solid	Wood	0.01
129	1927 Bldg	198	XRF	2/21/97	2	Classroo	211	Door	Door	Cracked	Wood	0.01
130	1927 Bldg	199	XRF	2/21/97	2	Classroo	211	Door	Casing	Cracked	Wood	0.01
131	1927 Bldg	200	XRF	2/21/97	2	Classroo	211	Wall	Wall	Solid	Plaster	0.05
132	1927 Bldg	201	XRF	2/21/97	2	Classroo	211	Ceiling		Cracked	Plaster	0.05
133	1927 Bldg	202	XRF	2/21/97	2	Classroo	211	Wire Tray		Cracked		0
134	1927 Bldg	203	XRF	2/21/97	2	Classroo	211	Wall	Crown mo	Solid	Wood	0.02
135	1927 Bldg	204	XRF	2/21/97	2	Classroo	211	TV Mount	Board	Solid	Wood	0
136	1927 Bldg	205	XRF	2/21/97	2	Classroo	211	Wall	Wall	Solid	Metal	0
137	1927 Bldg	207	XRF	2/21/97	2	Classroo	213	Wall	Wall	Cracked	Plaster	3.27
138	1927 Bldg	208	XRF	2/21/97	2	Classroo	213	Wall	Wall	Solid	Plaster	5.09
139	1927 Bldg	209	XRF	2/21/97	2	Classroo	213	Wall	Midle Wall	Cracked	Drywall	0.01
140	1927 Bldg	210	XRF	2/21/97	2	Classroo	213		Radiator	Solid	Metal	2.99
141	1927 Bldg	211	XRF	2/21/97	2	Classroo	213	Window	Casing	Solid	Wood	2.91
142	1927 Bldg	212	XRF	2/21/97	2	Classroo	213	Wall	Wall	Solid	Metal	0
143	1927 Bldg	213	XRF	2/21/97	2	Classroo	213	Wall	Midle Wall	Solid		0.01
144	1927 Bldg	214	XRF	2/21/97	2	Classroo	213	Wall	Wall	Solid	Plaster	0
145	1927 Bldg	215	XRF	2/21/97	2	Classroo	213	TV Mount	Board	Solid	Wood	0
146	1927 Bldg	216	XRF	2/21/97	2	Classroo	213	Door	Door	Cracked	Wood	0.37
147	1927 Bldg	217	XRF	2/21/97	2	Classroo	213	Door	Casing	Solid	Wood	2.99
148	1927 Bldg	252	XRF	2/21/97	2	Classroo	215	Wall	Midle Wall	Solid	Drywall	0
149	1927 Bldg	253	XRF	2/21/97	2	Classroo	215	Wall	Wall	Solid	Plaster	0.01
150	1927 Bldg	254	XRF	2/21/97	2	Classroo	215	Wall	Wall	Solid	Plaster	0
151	1927 Bldg	255	XRF	2/21/97	2	Classroo	215	Window	Casing	Solid	Wood	0.08
152	1927 Bldg	256	XRF	2/21/97	2	Classroo	215	Wall	Wall	Solid	Metal	0
153	1927 Bldg	257	XRF	2/21/97	2	Classroo	215		Radiator	Solid	Metal	0
154	1927 Bldg	258	XRF	2/21/97	2	Classroo	215	TV Mount	Board	Solid	Wood	0
155	1927 Bldg	259	XRF	2/21/97	2	Classroo	215	Door	Door	Solid	Wood	0
156	1927 Bldg	260	XRF	2/21/97	2	Classroo	215	Door	Casing	Solid	Metal	0.02
157	1927 Bldg	6	XRF	2/22/97	2	Classroo	217	Wall	Wall	Cracked	Plaster	5.09
158	1927 Bldg	7	XRF	2/22/97	2	Classroo	217	Wall	Wall	Cracked	Plaster	0.1
159	1927 Bldg	8	XRF	2/22/97	2	Classroo	217	Wall	Wall Rgstr	Solid	Wood	0
160	1927 Bldg	9	XRF	2/22/97	2	Classroo	217	Wall	Wall Rgstr	Solid	Metal	0.02
161	1927 Bldg	10	XRF	2/22/97	2	Classroo	217	Wall	Wall Rgstr	Solid	Drywall	0
162	1927 Bldg	11	XRF	2/22/97	2	Classroo	217	TV Mount	Board	Solid	Wood	0
163	1927 Bldg	12	XRF	2/22/97	2	Classroo	217	Wall	Wall	Solid	Plaster	0.05
164	1927 Bldg	13	XRF	2/22/97	2	Classroo	217	Wall	Wall	Solid	Metal	0
165	1927 Bldg	14	XRF	2/22/97	2	Classroo	217		Radiator	Solid	Metal	0
166	1927 Bldg	15	XRF	2/22/97	2	Classroo	217	Window	Casing	Cracked	Wood	0.03
167	1927 Bldg	16	XRF	2/22/97	2	Classroo	217	Door	Door	Solid	Wood	0
168	1927 Bldg	17	XRF	2/22/97	2	Classroo	217	Door	Casing	Solid	Metal	0.01
169	1927 Bldg	38	XRF	2/22/97	2	Classroo	219	Wall	Wall	Cracked	Plaster	5.09
170	1927 Bldg	39	XRF	2/22/97	2	Classroo	219	Wall	Wall	Solid	Plaster	0.01
171	1927 Bldg	40	XRF	2/22/97	2	Classroo	219	Wall	Midle Wall	Solid	Drywall	0.03
172	1927 Bldg	41	XRF	2/22/97	2	Classroo	219	TV Mount	Board	Solid	Wood	0
173	1927 Bldg	42	XRF	2/22/97	2	Classroo	219	Wall	Wall	Cracked	Plaster	5.09
174	1927 Bldg	43	XRF	2/22/97	2	Classroo	219		Radiator	Solid	Metal	0.03
175	1927 Bldg	44	XRF	2/22/97	2	Classroo	219	Window	Casing	Cracked	Wood	0.03
176	1927 Bldg	45	XRF	2/22/97	2	Classroo	219	Wall	Wall	Solid	Metal	0
177	1927 Bldg	46	XRF	2/22/97	2	Classroo	219	Wall	Wall Rgstr	Solid	Wood	0
178	1927 Bldg	47	XRF	2/22/97	2	Classroo	219	Wall	Wall Rgstr	Solid	Metal	0.03

Saint Paul Public Schools
 Ramsey Junior High School
 Lead-Based Paint Inspection

3	A	B	C	D	E	F	G	H	I	J	K	L
	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
179	1927 Bldg	48	XRF	2/22/97	2	Classroo	219	Door	Door	Cracked	Wood	0.01
180	1927 Bldg	49	XRF	2/22/97	2	Classroo	219	Door	Casing	Cracked	Wood	0.02
181	1927 Bldg	101	XRF	2/22/97	2	Classroo	221	Wall	Wall	Cracked	Plaster	0.02
182	1927 Bldg	102	XRF	2/22/97	2	Classroo	221	Wall	Wall	Cracked	Plaster	0.11
183	1927 Bldg	103	XRF	2/22/97	2	Classroo	221	Wall	Midle Wall	Cracked	Plaster	3.76
184	1927 Bldg	104	XRF	2/22/97	2	Classroo	221	Wall	Midle Wall	Solid	Metal	0.03
185	1927 Bldg	105	XRF	2/22/97	2	Classroo	221	Window	Casing	Cracked	Wood	0.02
186	1927 Bldg	106	XRF	2/22/97	2	Classroo	221		Radiator	Peeling	Metal	5.09
187	1927 Bldg	107	XRF	2/22/97	2	Classroo	221	Wall	Midle Wall	Cracked	Plaster	0.08
188	1927 Bldg	108	XRF	2/22/97	2	Classroo	221	Wall	Wall	Cracked	Plaster	0.04
189	1927 Bldg	109	XRF	2/22/97	2	Classroo	221	Ceiling		Solid	Plaster	0.03
190	1927 Bldg	110	XRF	2/22/97	2	Classroo	221	Wall	Wall Rgstr	Cracked	Metal	1.6
191	1927 Bldg	111	XRF	2/22/97	2	Classroo	221	Wall	Crown mol	Solid	Wood	0.02
192	1927 Bldg	112	XRF	2/22/97	2	Classroo	221	Wire Tray		Solid	Metal	0.02
193	1927 Bldg	113	XRF	2/22/97	2	Classroo	221	Bulletin	Board	Cracked	Wood	0.02
194	1927 Bldg	114	XRF	2/22/97	2	Classroo	221	Cabinet	Door	Cracked	Wood	0.02
195	1927 Bldg	115	XRF	2/22/97	2	Classroo	221	Cabinet	Inside	Solid		0.03
196	1927 Bldg	116	XRF	2/22/97	2	Classroo	221	Wall	Wall	Cracked	Plaster	3.65
197	1927 Bldg	117	XRF	2/22/97	2	Classroo	221	Door	Door	Cracked	Wood	0.03
198	1927 Bldg	118	XRF	2/22/97	2	Classroo	221	Door	Casing	Cracked	Wood	0.02
199	1927 Bldg	119	XRF	2/22/97	2	Classroo	221	Wall	Chair rail	Solid	Wood	0.02
200	1927 Bldg	120	XRF	2/22/97	2	Classroo	221	Wall	Baseboar	Solid	Wood	0.02
201	1927 Bldg	121	XRF	2/22/97	2	Classroo	221	Floor		Solid	Wood	0.01
202	1927 Bldg	6	XRF	2/20/97	3	Classroo	301	Wall	Wall	Cracked	Plaster	5.09
203	1927 Bldg	7	XRF	2/20/97	3	Classroo	301	Wall	Midle Wall	Peeling	Plaster	0.07
204	1927 Bldg	8	XRF	2/20/97	3	Classroo	301	Wall	Wall	Cracked	Plaster	0.08
205	1927 Bldg	9	XRF	2/20/97	3	Classroo	301	Ceiling		Solid	Plaster	0.1
206	1927 Bldg	10	XRF	2/20/97	3	Classroo	301	Wall	Crown mol	Solid	Wood	0.01
207	1927 Bldg	11	XRF	2/20/97	3	Classroo	301	Wall	Wall Rgstr	Solid	Metal	2.41
208	1927 Bldg	12	XRF	2/20/97	3	Classroo	301	Door	Door	Solid	Wood	0.02
209	1927 Bldg	13	XRF	2/20/97	3	Classroo	301	Door	Casing	Solid	Wood	0.02
210	1927 Bldg	14	XRF	2/20/97	3	Classroo	301	Door	Casing	Solid	Metal	0.13
211	1927 Bldg	15	XRF	2/20/97	3	Classroo	301	Wall	Baseboar	Solid	Wood	0.01
212	1927 Bldg	16	XRF	2/20/97	3	Classroo	301	Cabinet	Door	Solid	Wood	0
213	1927 Bldg	17	XRF	2/20/97	3	Classroo	301	Cabinet	Floor	Solid	Wood	0
214	1927 Bldg	18	XRF	2/20/97	3	Classroo	301	Floor		Solid	Wood	0.02
215	1927 Bldg	19	XRF	2/20/97	3	Classroo	301	Bulletin	Board	Solid	Wood	0.03
216	1927 Bldg	20	XRF	2/20/97	3	Classroo	301	Window	Casing	Cracked	Wood	0.07
217	1927 Bldg	21	XRF	2/20/97	3	Classroo	301		Radiator	Peeling	Metal	2.98
218	1927 Bldg	22	XRF	2/20/97	3	Classroo	301	Wall	Chair rail	Solid	Wood	0.02
219	1927 Bldg	23	XRF	2/20/97	3	Classroo	301	Cabinet	Door	Cracked	Wood	0.02
220	1927 Bldg	24	XRF	2/20/97	3	Classroo	301	Cabinet	Shelf	Solid	Wood	0
221	1927 Bldg	25	XRF	2/20/97	3	Classroo	301	Cabinet	Inside	Solid	Wood	0
222	1927 Bldg	26	XRF	2/20/97	3	Classroo	301	Wall	Midle Wall	Solid	Metal	0.01
223	1927 Bldg	27	XRF	2/20/97	3	Classroo	301		Midle Wall	Cracked	Wood	0
224	1927 Bldg	28	XRF	2/20/97	3	Classroo	301	Wall	Wall	Cracked	Plaster	5.09
225	1927 Bldg	29	XRF	2/21/97	3	Classroo	309	Wall	Wall	Chalking	Plaster	0.09
226	1927 Bldg	30	XRF	2/21/97	3	Classroo	309	Wall	Midle Wall	Cracked		0.01
227	1927 Bldg	31	XRF	2/21/97	3	Classroo	309	Wall	Midle Wall	Solid	Metal	0
228	1927 Bldg	32	XRF	2/21/97	3	Classroo	309	Wall	Wall	Solid	Plaster	0.06
229	1927 Bldg	33	XRF	2/21/97	3	Classroo	309	Wall	Wall Rgstr	Cracked	Metal	4
230	1927 Bldg	34	XRF	2/21/97	3	Classroo	309	Wall	Crown mol	Cracked	Wood	0.03
231	1927 Bldg	35	XRF	2/21/97	3	Classroo	309	Ceiling		Cracked	Plaster	0.07
232	1927 Bldg	36	XRF	2/21/97	3	Classroo	309	Cabinet	Door	Cracked	Wood	0.01
233	1927 Bldg	37	XRF	2/21/97	3	Classroo	309	Cabinet	Door	Cracked	Wood	0
234	1927 Bldg	38	XRF	2/21/97	3	Classroo	309		Radiator	Peeling		0.96
235	1927 Bldg	39	XRF	2/21/97	3	Classroo	309	Window	Casing	Solid	Wood	0.03
236	1927 Bldg	40	XRF	2/21/97	3	Classroo	309	Bulletin	Board	Solid	Wood	0.03
237	1927 Bldg	41	XRF	2/21/97	3	Classroo	309	Door	Door	Solid	Metal	0

Saint Paul Public Schools
 Ramsey Junior High School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
238	1927 Bldg	42	XRF	2/21/97	3	Classroo	309	Door	Casing	Solid	Metal	0
239	1927 Bldg	43	XRF	2/21/97	3	Classroo	309	Wire Tray		Solid	Metal	0.01
240	1927 Bldg	44	XRF	2/21/97	3	Classroo	309	Chair Rail		Cracked	Wood	0.01
241	1927 Bldg	45	XRF	2/21/97	3	Classroo	309	Wall	Baseboar	Cracked	Wood	0.03
242	1927 Bldg	46	XRF	2/21/97	3	Classroo	309	Floor		Solid	Wood	0
243	1927 Bldg	47	XRF	2/21/97	3	Classroo	309	Door	Door	Cracked	Wood	0.02
244	1927 Bldg	48	XRF	2/21/97	3	Classroo	309	Door	Casing	Cracked	Wood	0.02
245	1927 Bldg	49	XRF	2/21/97	3	Classroo	309	Wall	Wall	Cracked	Plaster	0.09
246	1927 Bldg	50	XRF	2/21/97	3	Classroo	309	TV Mount	Board	Solid	Wood	0
247	1927 Bldg	6	XRF	2/21/97	3	Classroo	311	Wall	Wall	Cracked	Plaster	0.03
248	1927 Bldg	7	XRF	2/21/97	3	Classroo	311	Wall	Midle Wall	Peeling	Plaster	0.02
249	1927 Bldg	8	XRF	2/21/97	3	Classroo	311	Wall	Wall	Cracked	Plaster	0.1
250	1927 Bldg	9	XRF	2/21/97	3	Classroo	311	Wall	Midle Wall	Cracked	Metal	0.02
251	1927 Bldg	10	XRF	2/21/97	3	Classroo	311	Wall	Wall	Cracked	Plaster	0.03
252	1927 Bldg	11	XRF	2/21/97	3	Classroo	311	Ceiling		Cracked	Plaster	0.03
253	1927 Bldg	12	XRF	2/21/97	3	Classroo	311	Wire Tray		Solid	Metal	0
254	1927 Bldg	13	XRF	2/21/97	3	Classroo	311	Wall	Crown mol	Solid	Wood	0.01
255	1927 Bldg	14	XRF	2/21/97	3	Classroo	311	Wall	Wall Rgstr	Solid	Metal	3
256	1927 Bldg	15	XRF	2/21/97	3	Classroo	311	Bulletin	Board	Cracked	Wood	0.01
257	1927 Bldg	16	XRF	2/21/97	3	Classroo	311	Cabinet	Door	Cracked	Wood	0
258	1927 Bldg	17	XRF	2/21/97	3	Classroo	311	Cabinet	Inside	Cracked	Wood	0.01
259	1927 Bldg	18	XRF	2/21/97	3	Classroo	311	Wall	Wall	Cracked	Plaster	0.09
260	1927 Bldg	19	XRF	2/21/97	3	Classroo	311	Door	Door	Solid	Wood	0
261	1927 Bldg	20	XRF	2/21/97	3	Classroo	311	Door	Casing	Cracked	Wood	0.01
262	1927 Bldg	21	XRF	2/21/97	3	Classroo	311	Wall	Midle Wall	Cracked	Wood	0
263	1927 Bldg	22	XRF	2/21/97	3	Classroo	311	Bulletin	Board	Cracked	Wood	0
264	1927 Bldg	23	XRF	2/21/97	3	Classroo	311	Wall	Baseboar	Solid	Wood	0
265	1927 Bldg	24	XRF	2/21/97	3	Classroo	311	Floor		Solid	Wood	0.01
266	1927 Bldg	25	XRF	2/21/97	3	Classroo	311	TV Mount	Board	Solid	Wood	0
267	1927 Bldg	26	XRF	2/21/97	3	Classroo	311	Wire Tray		Solid	Metal	0.08
268	1927 Bldg	27	XRF	2/21/97	3	Classroo	311		Radiator	Peeling	Metal	2.8
269	1927 Bldg	28	XRF	2/21/97	3	Classroo	311	Window	Casing	Chalking	Wood	0.1
270	1927 Bldg	142	XRF	2/20/97	3	Classroo	313	Wall	Wall	Cracked	Plaster	4.17
271	1927 Bldg	143	XRF	2/20/97	3	Classroo	313	Wall	Chair rail	Cracked	Wood	0.01
272	1927 Bldg	144	XRF	2/20/97	3	Classroo	313	Wall	Midle Wall	Solid	Metal	0
273	1927 Bldg	145	XRF	2/20/97	3	Classroo	313	Window	Casing	Solid	Wood	0.01
274	1927 Bldg	146	XRF	2/20/97	3	Classroo	313		Radiator	Peeling	Metal	2.92
275	1927 Bldg	147	XRF	2/20/97	3	Classroo	313	Wall	Midle Wall	Cracked	Plaster	0.03
276	1927 Bldg	148	XRF	2/20/97	3	Classroo	313	Wall	Wall	Cracked	Plaster	0.06
277	1927 Bldg	149	XRF	2/20/97	3	Classroo	313	Ceiling		Cracked	Plaster	0.06
278	1927 Bldg	150	XRF	2/20/97	3	Classroo	313	Wall	Wall	Cracked	Plaster	0.15
279	1927 Bldg	151	XRF	2/20/97	3	Classroo	313	Bulletin	Board	Cracked	Wood	0.01
280	1927 Bldg	152	XRF	2/20/97	3	Classroo	313	Cabinet	Door	Cracked	Wood	0.01
281	1927 Bldg	153	XRF	2/20/97	3	Classroo	313	Wall	Baseboar	Solid	Wood	0
282	1927 Bldg	154	XRF	2/20/97	3	Classroo	313	Floor		Solid	Wood	0.01
283	1927 Bldg	155	XRF	2/20/97	3	Classroo	313	Wire Tray		Solid	Metal	0.04
284	1927 Bldg	156	XRF	2/20/97	3	Classroo	313	Cablnet	Door	Solid	Wood	0
285	1927 Bldg	157	XRF	2/20/97	3	Classroo	313	Cabinet	Door	Solid	Wood	0.23
286	1927 Bldg	158	XRF	2/20/97	3	Classroo	313	Wall	Wall Rgstr	Solid	Metal	2.5
287	1927 Bldg	159	XRF	2/20/97	3	Classroo	313	Door	Door	Solid	Wood	0
288	1927 Bldg	160	XRF	2/20/97	3	Classroo	313	Door	Jamb	Solid	Wood	0
289	1927 Bldg	99	XRF	2/20/97	3	Classroo	319	Wall	Wall	Cracked	Plaster	0.01
290	1927 Bldg	100	XRF	2/20/97	3	Classroo	319	Wall	Wall	Cracked	Plaster	0.29
291	1927 Bldg	101	XRF	2/20/97	3	Classroo	319	Wall	Wall	Cracked	Plaster	0.06
292	1927 Bldg	102	XRF	2/20/97	3	Classroo	319	Wall	Midle Wall	Cracked	Plaster	0.06
293	1927 Bldg	103	XRF	2/20/97	3	Classroo	319	Wall	Wall	Cracked	Plaster	0.07
294	1927 Bldg	104	XRF	2/20/97	3	Classroo	319	Ceiling		Cracked	Plaster	0.01
295	1927 Bldg	105	XRF	2/20/97	3	Classroo	319	Wall	Crown mol	Solid	Wood	0.1
296	1927 Bldg	106	XRF	2/20/97	3	Classroo	319	Wall	Wall Rgstr	Solid	Metal	2.61

Saint Paul Public Schools
 Ramsey Junior High School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
297	1927 Bldg	107	XRF	2/20/97	3	Classroo	319	Wall	Wall Rgstr	Solid	Metal	0
298	1927 Bldg	108	XRF	2/20/97	3	Classroo	319	Cabinet	Door	Solid	Wood	0
299	1927 Bldg	109	XRF	2/20/97	3	Classroo	319	Cabinet	Door	Solid	Wood	0
300	1927 Bldg	110	XRF	2/20/97	3	Classroo	319	Cabinet	Door	Solid	Metal	0
301	1927 Bldg	111	XRF	2/20/97	3	Classroo	319	Window	Casing	Solid	Wood	0.05
302	1927 Bldg	112	XRF	2/20/97	3	Classroo	319	Wall	Midle Wall	Solid	Metal	0
303	1927 Bldg	113	XRF	2/20/97	3	Classroo	319		Radiator	Peeling	Metal	5.09
304	1927 Bldg	114	XRF	2/20/97	3	Classroo	319		Radiator	Peeling	Metal	3.13
305	1927 Bldg	115	XRF	2/20/97	3	Classroo	319	Wall	Baseboar	Solid	Wood	0.02
306	1927 Bldg	116	XRF	2/20/97	3	Classroo	319	Floor		Solid	Wood	0
307	1927 Bldg	117	XRF	2/20/97	3	Classroo	319	Cabinet	Outside	Solid	Wood	0
308	1927 Bldg	118	XRF	2/20/97	3	Classroo	319	Wall	Chair rail	Solid	Wood	0
309	1927 Bldg	119	XRF	2/20/97	3	Classroo	319	Bulletin	Board	Solid	Wood	0.04
310	1927 Bldg	120	XRF	2/20/97	3	Classroo	319	Wire Tray		Solid	Metal	0.02
311	1927 Bldg	121	XRF	2/20/97	3	Classroo	319	Cabinet	Door	Solid	Wood	0.01
312	1927 Bldg	122	XRF	2/20/97	3	Classroo	319	Door	Door	Solid	Wood	0
313	1927 Bldg	123	XRF	2/20/97	3	Classroo	319	Door	Casing	Cracked	Wood	0
314	1927 Bldg	44	XRF	2/20/97	3	Classroo	321	Wall	Wall	Peeling	Plaster	5.09
315	1927 Bldg	45	XRF	2/20/97	3	Classroo	321	Wall	Midle Wall	Solid	Metal	0
316	1927 Bldg	46	XRF	2/20/97	3	Classroo	321	Window	Casing	Solid	Wood	0.07
317	1927 Bldg	47	XRF	2/20/97	3	Classroo	321		Radiator	Peeling	Metal	5.09
318	1927 Bldg	48	XRF	2/20/97	3	Classroo	321	Wall	Midle Wall	Cracked	Plaster	0.04
319	1927 Bldg	49	XRF	2/20/97	3	Classroo	321	Wall	Wall	Cracked	Plaster	0.05
320	1927 Bldg	50	XRF	2/20/97	3	Classroo	321	Ceiling		Solid	Plaster	0.1
321	1927 Bldg	51	XRF	2/20/97	3	Classroo	321	Wall	Wall Rgstr	Cracked	Metal	2.6
322	1927 Bldg	52	XRF	2/20/97	3	Classroo	321	Door	Crown mol	Solid	Wood	0.02
323	1927 Bldg	53	XRF	2/20/97	3	Classroo	321	Wire Tray		Solid	Metal	0
324	1927 Bldg	54	XRF	2/20/97	3	Classroo	321	Bulletin	Board	Peeling	Wood	0.01
325	1927 Bldg	55	XRF	2/20/97	3	Classroo	321	Wall	Baseboar	Cracked	Wood	0.01
326	1927 Bldg	56	XRF	2/20/97	3	Classroo	321	Cabinet	Door	Chalking	Wood	0.02
327	1927 Bldg	57	XRF	2/20/97	3	Classroo	321	Cabinet	Inside	Solid	Wood	0.01
328	1927 Bldg	58	XRF	2/20/97	3	Classroo	321	Floor		Solid	Wood	0
329	1927 Bldg	59	XRF	2/20/97	3	Classroo	321	Wall	Chair rail	Solid	Wood	0
330	1927 Bldg	60	XRF	2/20/97	3	Classroo	321	Wall	Wall	Peeling	Plaster	2.64
331	1927 Bldg	61	XRF	2/20/97	3	Classroo	321	Door	Door	Solid	Wood	0
332	1927 Bldg	62	XRF	2/20/97	3	Classroo	321	Door	Grate	Solid	Metal	0.03
333	1927 Bldg	63	XRF	2/20/97	3	Classroo	321	Door	Casing	Cracked	Wood	0
334	1927 Bldg	154	XRF	2/28/97	1	Gym	1	Wall	Wall	Solid	Concrete	0.07
335	1927 Bldg	155	XRF	2/28/97	1	Gym	1	Wall	Midle Wall	Solid	Concrete	0.03
336	1927 Bldg	156	XRF	2/28/97	1	Gym	1	Door	Door	Cracked	Wood	0
337	1927 Bldg	157	XRF	2/28/97	1	Gym	1	Wall	Midle Wall	Cracked	Concrete	0.05
338	1927 Bldg	158	XRF	2/28/97	1	Gym	1	Wall	Backboar	Cracked	Metal	0
339	1927 Bldg	159	XRF	2/28/97	1	Gym	1	Door	Door	Cracked	Wood	0
340	1927 Bldg	160	XRF	2/28/97	1	Gym	1	Door	Door	Cracked	Concrete	0.36
341	1927 Bldg	161	XRF	2/28/97	1	Gym	1	Door	Casing	Cracked	Metal	0.24
342	1927 Bldg	162	XRF	2/28/97	1	Gym	1	Ceiling		Solid	Plaster	0.05
343	1927 Bldg	163	XRF	2/28/97	1	Gym	1	Door	Door	Cracked	Concrete	0.08
344	1927 Bldg	164	XRF	2/28/97	1	Gym	1	Door	Casing	Cracked	Metal	0.3
345	1927 Bldg	165	XRF	2/28/97	1	Gym	1	Door	Door	Cracked	Metal	0
346	1927 Bldg	166	XRF	2/28/97	1	Gym	1	Door	Casing	Cracked	Metal	0.01
347	1927 Bldg	167	XRF	2/28/97	1	Gym	1		Radiator	Solid	Metal	0.06
348	1927 Bldg	168	XRF	2/28/97	1	Gym	1	Wall	Baseboar	Cracked	Wood	0
349	1927 Bldg	169	XRF	2/28/97	1	Gym	1	Wall	Wall Rgstr	Solid	Metal	0.21
350	1927 Bldg	170	XRF	2/28/97	1	Gym	1	Door	Casing	Solid	Wood	0
351	1927 Bldg	171	XRF	2/28/97	1	Gym	2	Door	Door	Cracked	Metal	0
352	1927 Bldg	172	XRF	2/28/97	1	Gym	2	Door	Casing	Solid	Metal	0.01
353	1927 Bldg	173	XRF	2/28/97	1	Gym	2	Door	Door	Solid	Metal	0.03
354	1927 Bldg	174	XRF	2/28/97	1	Gym	2	Door	Casing	Solid	Metal	0.01
355	1927 Bldg	175	XRF	2/28/97	1	Gym	2	Wall	Wall	Solid	Concrete	0

Saint Paul Public Schools
 Ramsey Junior High School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
356	1927 Bldg	176	XRF	2/28/97	1	Gym	2	Elec Pane	Cracked	Metal		0
357	1927 Bldg	177	XRF	2/28/97	1	Gym	2	Door	Cracked	Metal		0.01
358	1927 Bldg	178	XRF	2/28/97	1	Gym	2	Door	Cracked	Metal		0
359	1927 Bldg	179	XRF	2/28/97	1	Gym	2	Door	Cracked	Metal		0.01
360	1927 Bldg	180	XRF	2/28/97	1	Gym	2	Closet	Solid	Concrete		0
361	1927 Bldg	181	XRF	2/28/97	1	Gym	2	Closet	Solid	Metal		0.03
362	1927 Bldg	182	XRF	2/28/97	1	Gym	2	Closet	Solid	Concrete		0.01
363	1927 Bldg	183	XRF	2/28/97	1	Gym	2	Closet	Solid	Metal		0.02
364	1927 Bldg	184	XRF	2/28/97	1	Gym	2	Wall	Backboar	Solid	Metal	0.01
365	1927 Bldg	185	XRF	2/28/97	1	Gym	2	Wall	Transom	Solid	Metal	0.03
366	1927 Bldg	186	XRF	2/28/97	1	Gym	2	Casing	Solid	Wood		0
367	1927 Bldg	124	XRF	2/20/97	3	Hall	1	Wall	Midle Wall	Cracked	Plaster	0.09
368	1927 Bldg	125	XRF	2/20/97	3	Hall	1	Door	Door	Solid	Wood	0
369	1927 Bldg	126	XRF	2/20/97	3	Hall	1	Door	Casing	Solid	Wood	0
370	1927 Bldg	127	XRF	2/20/97	3	Hall	1	Cabinet	Door	Solid	Wood	0
371	1927 Bldg	131	XRF	2/20/97	3	Hall	2	Wall	Wall	Cracked	Plaster	5.09
372	1927 Bldg	132	XRF	2/20/97	3	Hall	2	Wall	Wall	Cracked	Plaster	0.36
373	1927 Bldg	133	XRF	2/20/97	3	Hall	2	Door	Door	Solid	Wood	0
374	1927 Bldg	134	XRF	2/20/97	3	Hall	2	Door	Casing	Solid	Wood	0
375	1927 Bldg	135	XRF	2/20/97	3	Hall	2	Wall	Chair rail	Solid	Wood	0
376	1927 Bldg	136	XRF	2/20/97	3	Hall	2	Wall	Baseboar	Solid	Wood	0
377	1927 Bldg	137	XRF	2/20/97	3	Hall	2	Cabinet	Door	Solid	Wood	0.01
378	1927 Bldg	138	XRF	2/20/97	3	Hall	2	Wall	Wall Rgstr	Solid	Metal	0.13
379	1927 Bldg	139	XRF	2/20/97	3	Hall	2	Wall	Wall	Cracked	Plaster	0.09
380	1927 Bldg	140	XRF	2/20/97	3	Hall	2	Wall	Crown mol	Solid	Wood	0.2
381	1927 Bldg	141	XRF	2/20/97	3	Hall	2	Ceiling		Cracked	Plaster	0.07
382	1927 Bldg	109	XRF	2/28/97	1	Hall	2	Wall	Midle Wall	Solid	Concrete	0.03
383	1927 Bldg	110	XRF	2/28/97	1	Hall	2	Wall	Radiator	Solid	Metal	0.03
384	1927 Bldg	111	XRF	2/28/97	1	Hall	2	Door	Door	Solid	Metal	0
385	1927 Bldg	112	XRF	2/28/97	1	Hall	2	Door	Casing	Solid	Metal	0
386	1927 Bldg	113	XRF	2/28/97	1	Hall	2	Closet	Wall	Solid	Concrete	0.02
387	1927 Bldg	114	XRF	2/28/97	1	Hall	2	Closet	Floor	Peeling	Concrete	0.7
388	1927 Bldg	115	XRF	2/28/97	1	Hall	2	Closet	Casing	Cracked	Metal	0.23
389	1927 Bldg	116	XRF	2/28/97	1	Hall	2	Ceiling		Solid	Plaster	0.01
390	1927 Bldg	75	XRF	2/21/97	3	Hall	3	Wall	Wall	Cracked	Plaster	0.08
391	1927 Bldg	76	XRF	2/21/97	3	Hall	3	Chair Rail		Solid	Wood	0.02
392	1927 Bldg	77	XRF	2/21/97	3	Hall	3	Door	Door	Solid	Wood	0.03
393	1927 Bldg	78	XRF	2/21/97	3	Hall	3	Door	Casing	Solid	Wood	0.02
394	1927 Bldg	79	XRF	2/21/97	3	Hall	3	Cabinet	Door	Solid	Wood	0.01
395	1927 Bldg	80	XRF	2/21/97	3	Hall	3	Cabinet	Inside	Solid	Wood	0
396	1927 Bldg	81	XRF	2/21/97	3	Hall	3	Window	Casing	Solid	Wood	0.05
397	1927 Bldg	82	XRF	2/21/97	3	Hall	3	Wall	Wall	Solid	Metal	0
398	1927 Bldg	83	XRF	2/21/97	3	Hall	3		Radiator	Cracked	Metal	3.21
399	1927 Bldg	84	XRF	2/21/97	3	Hall	3	Wall	Crown mol	Solid	Wood	0.03
400	1927 Bldg	85	XRF	2/21/97	3	Hall	3	Ceiling		Solid	Plaster	0.07
401	1927 Bldg	86	XRF	2/21/97	3	Hall	3		Locker	Chalking	Metal	0.32
402	1927 Bldg	87	XRF	2/21/97	3	Hall	3		Locker	Chalking	Metal	0.21
403	1927 Bldg	88	XRF	2/21/97	3	Hall	3	Door	Door	Cracked	Metal	5.09
404	1927 Bldg	89	XRF	2/21/97	3	Hall	3	Door	Casing	Cracked	Metal	0.89
405	1927 Bldg	90	XRF	2/21/97	3	Hall	3		Elec Pane	Solid	Metal	0.02
406	1927 Bldg	91	XRF	2/21/97	3	Hall	3			Solid	Metal	0
407	1927 Bldg	92	XRF	2/21/97	3	Hall	3	Wall	Wall	Cracked	Plaster	0.04
408	1927 Bldg	93	XRF	2/21/97	3	Hall	3	Wall	Midle Wall	Cracked	Plaster	2.52
409	1927 Bldg	94	XRF	2/21/97	3	Hall	3	Wall	Wall	Cracked	Plaster	4.34
410	1927 Bldg	95	XRF	2/21/97	3	Hall	3	Chair Rail		Solid	Wood	0.02
411	1927 Bldg	96	XRF	2/21/97	3	Hall	3	Wall	Wall	Cracked	Plaster	0.05
412	1927 Bldg	97	XRF	2/21/97	3	Hall	3	Ceiling		Solid	Plaster	0.09
413	1927 Bldg	98	XRF	2/21/97	3	Hall	3	Unlisted	Wall	Solid	Metal	0.25
414	1927 Bldg	99	XRF	2/21/97	3	Hall	3	Wall	Crown mol	Solid	Wood	0.02

Saint Paul Public Schools
 Ramsey Junior High School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
415	1927 Bldg	100	XRF	2/21/97	3	Hall	3	Door	Door	Cracked	Wood	0.05
416	1927 Bldg	101	XRF	2/21/97	3	Hall	3	Door	Casing	Cracked	Wood	0.03
417	1927 Bldg	102	XRF	2/21/97	3	Hall	3	Cabinet	Door	Solid	Wood	0
418	1927 Bldg	103	XRF	2/21/97	3	Hall	3	Wall	Midle Wall	Solid	Metal	0.05
419	1927 Bldg	104	XRF	2/21/97	3	Hall	3	Window	Casing	Solid	Wood	0.02
420	1927 Bldg	105	XRF	2/21/97	3	Hall	3		Radiator	Cracked	Metal	0.08
421	1927 Bldg	106	XRF	2/21/97	3	Hall	3	Floor		Cracked	Concrte	0.08
422	1927 Bldg	107	XRF	2/21/97	3	Hall	3	Ladder		Cracked	Metal	2
423	1927 Bldg	108	XRF	2/21/97	3	Hall	3	Bookcase	Shelf	Cracked	Wood	0
424	1927 Bldg	217	XRF	2/28/97	1	Hall	3	Ceiling		Solid	Plaster	0
425	1927 Bldg	218	XRF	2/28/97	1	Hall	3	Wall	Midle Wall	Solid	Concrte	0.04
426	1927 Bldg	219	XRF	2/28/97	1	Hall	3	Wall	Wall	Solid	Wood	0
427	1927 Bldg	220	XRF	2/28/97	1	Hall	3	Door	Door	Solid	Metal	0.01
428	1927 Bldg	221	XRF	2/28/97	1	Hall	3	Door	Jamb	Solid	Metal	0.17
429	1927 Bldg	222	XRF	2/28/97	1	Hall	3	Door	Casing	Solid	Metal	0
430	1927 Bldg	223	XRF	2/28/97	1	Hall	3	Door	Casing	Solid	Metal	0.41
431	1927 Bldg	224	XRF	2/28/97	1	Hall	3		Radiator	Solid	Metal	0.01
432	1927 Bldg	225	XRF	2/28/97	1	Hall	3	Door	Door	Cracked	Metal	0.27
433	1927 Bldg	226	XRF	2/28/97	1	Hall	3	Door	Casing	Cracked	Metal	0.36
434	1927 Bldg	227	XRF	2/28/97	1	Hall	3		Locker	Solid	Metal	0.05
435	1927 Bldg	123	XRF	2/22/97	2	Hall	4	Wall	Wall	Cracked	Plaster	3.8
436	1927 Bldg	124	XRF	2/22/97	2	Hall	4	Wall	Wall	Cracked	Plaster	0.12
437	1927 Bldg	125	XRF	2/22/97	2	Hall	4	Closet	Wall	Cracked	Plaster	5.09
438	1927 Bldg	126	XRF	2/22/97	2	Hall	4	Closet	Wall	Cracked	Plaster	0.2
439	1927 Bldg	127	XRF	2/22/97	2	Hall	4	Closet	Shelf	Solid	Wood	0.19
440	1927 Bldg	128	XRF	2/22/97	2	Hall	4		Coat Rack	Solid	Wood	0.03
441	1927 Bldg	129	XRF	2/22/97	2	Hall	4	Floor		Cracked	Concrte	0.15
442	1927 Bldg	130	XRF	2/22/97	2	Hall	4	Closet	Casing	Cracked	Wood	0.01
443	1927 Bldg	131	XRF	2/22/97	2	Hall	4	Door	Door	Peeling	Metal	5.09
444	1927 Bldg	132	XRF	2/22/97	2	Hall	4	Door	Casing	Cracked	Metal	5.09
445	1927 Bldg	133	XRF	2/22/97	2	Hall	4	Cabinet	Door	Solid	Wood	0.03
446	1927 Bldg	134	XRF	2/22/97	2	Hall	4		Elec Pane	Solid	Metal	0.04
447	1927 Bldg	135	XRF	2/22/97	2	Hall	4		Chair Rail	Solid	Wood	0.02
448	1927 Bldg	136	XRF	2/22/97	2	Hall	4	Wall	Wall Rgstr	Solid	Metal	0.14
449	1927 Bldg	137	XRF	2/22/97	2	Hall	4		Locker	Cracked	Metal	0.32
450	1927 Bldg	138	XRF	2/22/97	2	Hall	4		Locker	Cracked	Metal	0.38
451	1927 Bldg	139	XRF	2/22/97	2	Hall	4	Ceiling		Solid	Plaster	0.08
452	1927 Bldg	140	XRF	2/22/97	2	Hall	4	Hatch		Solid	Metal	0
453	1927 Bldg	141	XRF	2/22/97	2	Hall	4		Locker	Solid	Metal	0.01
454	1927 Bldg	142	XRF	2/22/97	2	Hall	5	Cabinet	Door	Solid	Wood	0
455	1927 Bldg	143	XRF	2/22/97	2	Hall	5	Wall	Wall	Solid	Plaster	0.1
456	1927 Bldg	144	XRF	2/22/97	2	Hall	5	Wall	Wall	Solid	Plaster	0.05
457	1927 Bldg	145	XRF	2/22/97	2	Hall	5	Door	Door	Solid	Metal	0.21
458	1927 Bldg	146	XRF	2/22/97	2	Hall	5	Door	Casing	Solid	Metal	0.21
459	1927 Bldg	147	XRF	2/22/97	2	Hall	5	Ceiling		Solid	Plaster	0.23
460	1927 Bldg	30	XRF	2/24/97	1	Hall	6	Wall	Wall	Solid	Plaster	5.09
461	1927 Bldg	31	XRF	2/24/97	1	Hall	6	Wall	Wall	Cracked	Plaster	0.08
462	1927 Bldg	32	XRF	2/24/97	1	Hall	6	Wall	Wall Rgstr	Solid	Metal	0.18
463	1927 Bldg	33	XRF	2/24/97	1	Hall	6	Chair Rail		Solid	Wood	0.02
464	1927 Bldg	34	XRF	2/24/97	1	Hall	6	Bulletin	Board	Cracked	Wood	0.07
465	1927 Bldg	35	XRF	2/24/97	1	Hall	6		Locker	Cracked	Metal	0.08
466	1927 Bldg	36	XRF	2/24/97	1	Hall	6		Locker	Cracked	Metal	0
467	1927 Bldg	37	XRF	2/24/97	1	Hall	6	Cabinet	Door	Cracked	Wood	0
468	1927 Bldg	38	XRF	2/24/97	1	Hall	6	Cabinet	Door	Solid	Metal	0.02
469	1927 Bldg	39	XRF	2/24/97	1	Hall	6	Closet	Wall	Cracked	Plaster	5.09
470	1927 Bldg	40	XRF	2/24/97	1	Hall	6	Closet	Wall	Cracked	Plaster	0.14
471	1927 Bldg	41	XRF	2/24/97	1	Hall	6	Closet	Shelf	Cracked	Wood	0.2
472	1927 Bldg	42	XRF	2/24/97	1	Hall	6	Closet	Floor	Peeling	Concrete	1.92
473	1927 Bldg	43	XRF	2/24/97	1	Hall	6	Door	Door	Solid	Wood	0.04

Saint Paul Public Schools
 Ramsey Junior High School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
474	1927 Bldg	44	XRF	2/24/97	1	Hall	6	Door	Casing	Cracked	Wood	0.01
475	1927 Bldg	45	XRF	2/24/97	1	Hall	6	Wall	Baseboar	Cracked	Concrte	0.1
476	1927 Bldg	46	XRF	2/24/97	1	Hall	6	Radiator	Cracked	Metal	5.09	
477	1927 Bldg	47	XRF	2/24/97	1	Hall	6	Door	Door	Cracked	Metal	5.09
478	1927 Bldg	48	XRF	2/24/97	1	Hall	6	Casing	Cracked	Metal	1.34	
479	1927 Bldg	49	XRF	2/24/97	1	Hall	6	Ceiling		Solid	Plaster	0.02
480	1927 Bldg	50	XRF	2/24/97	1	Hall	6	Hatch		Solid	Metal	0
481	1927 Bldg	51	XRF	2/24/97	1	Hall	6	Door	Door	Solid	Metal	0.02
482	1927 Bldg	52	XRF	2/24/97	1	Hall	6	Door	Casing	Solid	Metal	0.01
483	1927 Bldg	53	XRF	2/24/97	1	Hall	6	Door	Door	Solid	Metal	0.02
484	1927 Bldg	54	XRF	2/24/97	1	Hall	6	Door	Jamb	Solid	Metal	0.1
485	1927 Bldg	55	XRF	2/24/97	1	Hall	6	Radiator	Solid	Metal	0.05	
486	1927 Bldg	56	XRF	2/24/97	1	Hall	6	Wall	Midle Wall	Solid	Drywall	0
487	1927 Bldg	58	XRF	2/24/97	1	Hall	7	Wall	Midle Wall	Solid	Plaster	0.08
488	1927 Bldg	59	XRF	2/24/97	1	Hall	7	Door	Door	Solid	Metal	0.01
489	1927 Bldg	60	XRF	2/24/97	1	Hall	7	Door	Casing	Solid	Metal	0.02
490	1927 Bldg	61	XRF	2/24/97	1	Hall	7	Door	Casing	Cracked	Wood	0.03
491	1927 Bldg	62	XRF	2/24/97	1	Hall	7	Cabinet	Door	Solid	Wood	0
492	1927 Bldg	63	XRF	2/24/97	1	Hall	7	Ceiling		Cracked	Plaster	0.08
493	1927 Bldg	64	XRF	2/24/97	1	Hall	8	Ceiling		Cracked	Plaster	0.05
494	1927 Bldg	65	XRF	2/24/97	1	Hall	8	Wall	Wall	Cracked	Plaster	0.04
495	1927 Bldg	66	XRF	2/24/97	1	Hall	8	Wall	Wall	Solid	Plaster	0.06
496	1927 Bldg	67	XRF	2/24/97	1	Hall	8	Wall	Chair rail	Solid	Wood	0.03
497	1927 Bldg	68	XRF	2/24/97	1	Hall	8	Wall	Baseboar	Solid	Concrete	0.11
498	1927 Bldg	69	XRF	2/24/97	1	Hall	8	Floor		Peeling	Concrete	0.02
499	1927 Bldg	149	XRF	2/24/97	1	Hall	9	Wall	Midle Wall	Solid	Concrete	0.05
500	1927 Bldg	150	XRF	2/24/97	1	Hall	9	Wall	Wall	Solid	Concrete	0.39
501	1927 Bldg	151	XRF	2/24/97	1	Hall	9	Wall	Wall	Solid	Plaster	5.09
502	1927 Bldg	152	XRF	2/24/97	1	Hall	9	Wall	Baseboar	Solid	Wood	0.01
503	1927 Bldg	153	XRF	2/24/97	1	Hall	9	Floor		Solid	Wood	0.01
504	1927 Bldg	154	XRF	2/24/97	1	Hall	9	Floor		Cracked	Concrete	0.09
505	1927 Bldg	155	XRF	2/24/97	1	Hall	9	Door	Door	Cracked	Wood	0
506	1927 Bldg	156	XRF	2/24/97	1	Hall	9	Door	Casing	Cracked	Metal	0
507	1927 Bldg	157	XRF	2/24/97	1	Hall	9	Door	Door	Cracked	Metal	0.02
508	1927 Bldg	158	XRF	2/24/97	1	Hall	9	Door	Jamb	Cracked	Metal	0.01
509	1927 Bldg	159	XRF	2/24/97	1	Hall	9	Rolling Door		Solid	Metal	0
510	1927 Bldg	160	XRF	2/24/97	1	Hall	9	Ceiling		Solid	Plaster	0.06
511	1927 Bldg	161	XRF	2/24/97	1	Hall	9	Door	Door	Solid	Metal	0
512	1927 Bldg	94	XRF	2/25/97	0	Hall	10	Wall	Midle Wall	Cracked	Plaster	0.01
513	1927 Bldg	95	XRF	2/25/97	0	Hall	10	Wall	Wall	Solid	Concrete	0
514	1927 Bldg	96	XRF	2/25/97	0	Hall	10	Door	Door	Cracked	Metal	0.03
515	1927 Bldg	97	XRF	2/25/97	0	Hall	10	Door	Casing	Cracked	Metal	0.01
516	1927 Bldg	101	XRF	2/25/97	0	Hall	10	Closet	Wall	Solid	Concrete	0.01
517	1927 Bldg	102	XRF	2/25/97	0	Hall	10	Closet	Floor	Cracked	Concrete	0
518	1927 Bldg	103	XRF	2/25/97	0	Hall	10	Closet	Casing	Solid	Metal	0
519	1927 Bldg	104	XRF	2/25/97	0	Hall	10	Ceiling		Solid	Drywall	0.02
520	1927 Bldg	105	XRF	2/25/97	0	Hall	10	Ceiling	Hatch	Solid	Metal	0.02
521	1927 Bldg	106	XRF	2/25/97	0	Hall	10	Closet	Wall	Cracked	Plaster	0.1
522	1927 Bldg	107	XRF	2/25/97	0	Hall	10	Closet	Casing	Cracked	Wood	0
523	1927 Bldg	108	XRF	2/25/97	0	Hall	10	Closet	Wall	Cracked	Concrete	0.01
524	1927 Bldg	109	XRF	2/25/97	0	Hall	10	Closet	Floor	Cracked	Concrete	0.04
525	1927 Bldg	110	XRF	2/25/97	0	Hall	10	Closet	Wall	Solid	Concrete	0.12
526	1927 Bldg	111	XRF	2/25/97	0	Hall	10	Closet	Wall	Cracked	Plaster	0.25
527	1927 Bldg	112	XRF	2/25/97	0	Hall	10	Closet	Wall	Solid	Concrete	0.12
528	1927 Bldg	113	XRF	2/25/97	0	Hall	10	Closet	Floor	Cracked	Concrete	0.02
529	1927 Bldg	114	XRF	2/25/97	0	Hall	10	Closet	Casing	Solid	Metal	0.06
530	1927 Bldg	160	XRF	2/25/97	1	Hall	11	Wall	Midle Wall	Solid	Concrete	0
531	1927 Bldg	161	XRF	2/25/97	1	Hall	11	Door	Door	Cracked	Metal	0
532	1927 Bldg	162	XRF	2/25/97	1	Hall	11	Door	Casing	Cracked	Metal	0.01

Saint Paul Public Schools
 Ramsey Junior High School
 Lead-Based Paint Inspection

3	A	B	C	D	E	F	G	H	I	J	K	L
	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
533	1927 Bldg	163	XRF	2/25/97	1	Hall	11	Ceiling		Solid	Plaster	0.02
534	1927 Bldg	187	XRF	2/28/97	1	Kitchen	1	Wall	Wall	Solid	Tile	1.88
535	1927 Bldg	188	XRF	2/28/97	1	Kitchen	1	Wall	Wall	Solid	Concrete	0.04
536	1927 Bldg	189	XRF	2/28/97	1	Kitchen	1	Door	Door	Cracked	Metal	0.3
537	1927 Bldg	190	XRF	2/28/97	1	Kitchen	1	Door	Casing	Cracked	Metal	0.21
538	1927 Bldg	191	XRF	2/28/97	1	Kitchen	1	Wall	Wall	Solid	Concrete	0.05
539	1927 Bldg	192	XRF	2/28/97	1	Kitchen	1	Door	Header	Solid	Metal	0.06
540	1927 Bldg	193	XRF	2/28/97	1	Kitchen	1		Radiator	Solid	Metal	0.02
541	1927 Bldg	194	XRF	2/28/97	1	Kitchen	1	Ceiling		Cracked	Plaster	0.03
542	1927 Bldg	195	XRF	2/28/97	1	Kitchen	1		Wall	Solid	Metal	0.05
543	1927 Bldg	6	XRF	3/4/97	1	Outside	0	Door	Door	Cracked	Metal	0
544	1927 Bldg	7	XRF	3/4/97	1	Outside	0	Door	Jamb	Cracked	Metal	0.01
545	1927 Bldg	8	XRF	3/4/97	1	Outside	0	Door	Peeling	Metal		
546	1927 Bldg	9	XRF	3/4/97	1	Outside	0	Door	Door	Solid	Metal	2.75
547	1927 Bldg	10	XRF	3/4/97	1	Outside	0	Door	Jamb	Cracked	Wood	0.12
548	1927 Bldg	11	XRF	3/4/97	1	Outside	0	Door	Door	Cracked	Wood	0
549	1927 Bldg	12	XRF	3/4/97	1	Outside	0	Door	Jamb	Cracked	Wood	5.09
550	1927 Bldg	13	XRF	3/4/97	1	Outside	0	Stairs	Hand rail	Solid	Metal	0.43
551	1927 Bldg	14	XRF	3/4/97	1	Outside	0	Door	Door	Solid		0.01
552	1927 Bldg	15	XRF	3/4/97	1	Outside	0	Door	Door	Solid	Metal	0.2
553	1927 Bldg	16	XRF	3/4/97	1	Outside	0		Soffit	Solid	Concrete	0
554	1927 Bldg	17	XRF	3/4/97	1	Outside	0		Soffit	Solid	Concrete	1.97
555	1927 Bldg	18	XRF	3/4/97	1	Outside	0	Door	Door	Solid	Metal	0.38
556	1927 Bldg	19	XRF	3/4/97	1	Outside	0	Ext Wall	Trim	Cracked	Wood	0
557	1927 Bldg	20	XRF	3/4/97	1	Outside	0	Door	Jamb	Cracked	Metal	0.25
558	1927 Bldg	21	XRF	3/4/97	1	Outside	0	Door	Door	Solid	Metal	0.01
559	1927 Bldg	22	XRF	3/4/97	1	Outside	0	Grounds	Fence	Solid	Metal	0
560	1927 Bldg	23	XRF	3/4/97	1	Outside	0	Door	Door	Solid	Metal	0.03
561	1927 Bldg	24	XRF	3/4/97	1	Outside	0	Door	Jamb	Solid	Metal	0
562	1927 Bldg	25	XRF	3/4/97	1	Outside	0	Door	Header	Solid	Metal	0
563	1927 Bldg	26	XRF	3/4/97	1	Outside	0		Hand rail	Solid	Metal	0.01
564	1927 Bldg	27	XRF	3/4/97	1	Outside	0		Downspou	Solid	Metal	0.05
565	1927 Bldg	28	XRF	3/4/97	1	Outside	0	Door	Door	Solid	Metal	0
566	1927 Bldg	29	XRF	3/4/97	1	Outside	0	Door	Jamb	Cracked	Metal	0.04
567	1927 Bldg	30	XRF	3/4/97	1	Outside	0		Hand rail	Cracked	Metal	1.3
568	1927 Bldg	31	XRF	3/4/97	1	Outside	0	Door	Jamb	Solid	Metal	0.02
569	1927 Bldg	32	XRF	3/4/97	1	Outside	0	Ext Wall	Trim	Solid	Metal	0.04
570	1927 Bldg	33	XRF	3/4/97	1	Outside	0	Door	Door	Cracked	Metal	0.01
571	1927 Bldg	34	XRF	3/4/97	1	Outside	0	Door	Jamb	Peeling	Wood	5.09
572	1927 Bldg	35	XRF	3/4/97	1	Outside	0	Fence		Cracked	Metal	1.86
573	1927 Bldg	37	XRF	3/4/97	1	Outside	0		Hand rail	Solid	Metal	0
574	1927 Bldg	65	XRF	2/20/97	3	Restroom	1	Wall	Wall	Cracked	Plaster	5.09
575	1927 Bldg	66	XRF	2/20/97	3	Restroom	1	Wall	Peeling	Plaster		0.04
576	1927 Bldg	67	XRF	2/20/97	3	Restroom	1	Wall	Chair rail	Solid	Wood	0
577	1927 Bldg	68	XRF	2/20/97	3	Restroom	1	Wall	Midle Wall	Solid	Metal	0
578	1927 Bldg	69	XRF	2/20/97	3	Restroom	1	Window	Casing	Solid	Wood	0.05
579	1927 Bldg	70	XRF	2/20/97	3	Restroom	1		Radlator	Cracked	Metal	0.05
580	1927 Bldg	71	XRF	2/20/97	3	Restroom	1	Door	Door	Cracked	Wood	0.01
581	1927 Bldg	72	XRF	2/20/97	3	Restroom	1	Door	Casing	Solid	Wood	0.01
582	1927 Bldg	73	XRF	2/20/97	3	Restroom	1	Ceiling		Cracked	Plaster	1.77
583	1927 Bldg	74	XRF	2/20/97	3	Restroom	1	Ceiling		Cracked	Plaster	2.58
584	1927 Bldg	75	XRF	2/20/97	3	Restroom	1		Stall Door	Cracked	Wood	0.04
585	1927 Bldg	76	XRF	2/20/97	3	Restroom	1	Wall	Wall Rgstr	Cracked	Metal	0.14
586	1927 Bldg	60	XRF	2/28/97	1	Restroom	1	Wall	Wall	Solid	Tile	3.44
587	1927 Bldg	61	XRF	2/28/97	1	Restroom	1	Wall	Wall	Solid	Concrete	0.1
588	1927 Bldg	62	XRF	2/28/97	1	Restroom	1	Door	Door	Solid	Wood	0
589	1927 Bldg	63	XRF	2/28/97	1	Restroom	1	Door	Casing	Cracked	Metal	0.23
590	1927 Bldg	64	XRF	2/28/97	1	Restroom	1		Bthrm Stll	Cracked	Metal	0.2
591	1927 Bldg	65	XRF	2/28/97	1	Restroom	1	Ceiling		Solid	Plaster	0.06

Saint Paul Public Schools
 Ramsey Junior High School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
592	1927 Bldg	66	XRF	2/28/97	1	Restroom	1	Wall	Diffuser	Solid	Metal	0
593	1927 Bldg	180	XRF	2/20/97	3	Restroom	2	Wall	Wall	Cracked	Plaster	4.33
594	1927 Bldg	181	XRF	2/20/97	3	Restroom	2	Wall	Wall	Cracked	Plaster	5.09
595	1927 Bldg	182	XRF	2/20/97	3	Restroom	2	Wall	Midle Wall	Solid	Wood	0.02
596	1927 Bldg	183	XRF	2/20/97	3	Restroom	2	Mirror	Casing	Solid	Wood	0.01
597	1927 Bldg	184	XRF	2/20/97	3	Restroom	2	Wall	Wall Rgstr	Solid	Metal	2.44
598	1927 Bldg	185	XRF	2/20/97	3	Restroom	2	Floor		Cracked	Concrete	1.01
599	1927 Bldg	186	XRF	2/20/97	3	Restroom	2	Door	Door	Solid	Wood	0.01
600	1927 Bldg	187	XRF	2/20/97	3	Restroom	2	Door	Casing	Solid	Wood	0.03
601	1927 Bldg	188	XRF	2/20/97	3	Restroom	2	Window	Sash	Solid	Wood	0.03
602	1927 Bldg	189	XRF	2/20/97	3	Restroom	2	Ceiling		Cracked	Plaster	5.09
603	1927 Bldg	67	XRF	2/28/97	1	Restroom	2	Wall	Wall	Solid	Tile	3.35
604	1927 Bldg	68	XRF	2/28/97	1	Restroom	2	Wall	Wall	Solid	Concrete	0.06
605	1927 Bldg	69	XRF	2/28/97	1	Restroom	2	Door	Door	Solid	Wood	0.01
606	1927 Bldg	70	XRF	2/28/97	1	Restroom	2	Door	Casing	Cracked	Metal	0.28
607	1927 Bldg	71	XRF	2/28/97	1	Restroom	2		Bthrm Stll	Cracked	Metal	0.18
608	1927 Bldg	72	XRF	2/28/97	1	Restroom	2	Ceiling		Solid	Plaster	0.03
609	1927 Bldg	73	XRF	2/28/97	1	Restroom	2	Wall	Diffuser	Solid	Metal	0
610	1927 Bldg	190	XRF	2/20/97	3	Restroom	3	Wall	Wall	Cracked	Plaster	0.03
611	1927 Bldg	191	XRF	2/20/97	3	Restroom	3	Wall	Wall	Cracked	Plaster	0.01
612	1927 Bldg	192	XRF	2/20/97	3	Restroom	3	Wall	Chair rail	Solid	Wood	0
613	1927 Bldg	193	XRF	2/20/97	3	Restroom	3	Mirror	Casing	Cracked	Wood	0
614	1927 Bldg	194	XRF	2/20/97	3	Restroom	3		Radiator	Cracked	Metal	3.8
615	1927 Bldg	195	XRF	2/20/97	3	Restroom	3	Door	Door	Solid	Wood	0.01
616	1927 Bldg	196	XRF	2/20/97	3	Restroom	3	Door	Casing	Solid	Wood	0
617	1927 Bldg	197	XRF	2/20/97	3	Restroom	3		Stall Door	Peeling	Wood	0.03
618	1927 Bldg	198	XRF	2/20/97	3	Restroom	3	Wall	Wall Rgstr	Solid	Metal	0.15
619	1927 Bldg	199	XRF	2/20/97	3	Restroom	3	Ceiling		Cracked	Plaster	5.09
620	1927 Bldg	80	XRF	2/28/97	1	Restroom	3	Wall	Wall	Solid	Concrete	0.02
621	1927 Bldg	81	XRF	2/28/97	1	Restroom	3	Wall	Wall	Solid	Concrete	0.04
622	1927 Bldg	82	XRF	2/28/97	1	Restroom	3	Wall	Wall	Solid	Tile	3.53
623	1927 Bldg	83	XRF	2/28/97	1	Restroom	3		Radiator	Solid	Metal	0.04
624	1927 Bldg	84	XRF	2/28/97	1	Restroom	3		Bthrm Stll	Cracked	Metal	0.13
625	1927 Bldg	85	XRF	2/28/97	1	Restroom	3		Radiator	Solid	Metal	0.08
626	1927 Bldg	86	XRF	2/28/97	1	Restroom	3		Locker	Cracked	Metal	0.08
627	1927 Bldg	87	XRF	2/28/97	1	Restroom	3	Floor		Cracked	Concrete	0.01
628	1927 Bldg	88	XRF	2/28/97	1	Restroom	3	Bench		Cracked	Wood	0
629	1927 Bldg	89	XRF	2/28/97	1	Restroom	3	Bench		Cracked	Metal	0.05
630	1927 Bldg	90	XRF	2/28/97	1	Restroom	3	Ceiling		Solid	Plaster	0.22
631	1927 Bldg	91	XRF	2/28/97	1	Restroom	3	Hatch		Solid	Metal	0
632	1927 Bldg	92	XRF	2/28/97	1	Restroom	3	Bulletin	Board	Solid	Wood	0.01
633	1927 Bldg	93	XRF	2/28/97	1	Restroom	3	Door	Door	Cracked	Wood	0.01
634	1927 Bldg	94	XRF	2/28/97	1	Restroom	3	Door	Casing	Solid	Wood	0
635	1927 Bldg	95	XRF	2/28/97	1	Restroom	3	Door	Door	Cracked	Wood	0
636	1927 Bldg	96	XRF	2/28/97	1	Restroom	3	Door	Casing	Cracked	Metal	0.24
637	1927 Bldg	97	XRF	2/28/97	1	Restroom	3	Door	Door	Solid	Wood	0
638	1927 Bldg	98	XRF	2/28/97	1	Restroom	3	Door	Casing	Solid	Metal	0
639	1927 Bldg	106	XRF	2/28/97	1	Restroom	3	Closet	Wall	Solid		0.05
640	1927 Bldg	107	XRF	2/28/97	1	Restroom	3	Closet	Floor	Cracked	Concrete	0.03
641	1927 Bldg	108	XRF	2/28/97	1	Restroom	3	Closet	Casing	Solid	Metal	0.18
642	1927 Bldg	225	XRF	2/21/97	2	Restroom	4	Wall	Wall	Solid	Plaster	5.09
643	1927 Bldg	226	XRF	2/21/97	2	Restroom	4	Wall	Wall	Cracked	Plaster	5.09
644	1927 Bldg	227	XRF	2/21/97	2	Restroom	4	Chair Rail		Solid	Wood	0
645	1927 Bldg	228	XRF	2/21/97	2	Restroom	4		Midle Wall	Solid	Wood	0.02
646	1927 Bldg	229	XRF	2/21/97	2	Restroom	4		Radiator	Peeling	Metal	4.22
647	1927 Bldg	230	XRF	2/21/97	2	Restroom	4	Door	Door	Solid	Wood	0.04
648	1927 Bldg	231	XRF	2/21/97	2	Restroom	4	Door	Casing	Solid	Wood	0.01
649	1927 Bldg	232	XRF	2/21/97	2	Restroom	4	Door	Stall Door	Solid	Wood	0.04
650	1927 Bldg	233	XRF	2/21/97	2	Restroom	4	Wall	Wall Rgstr	Solid	Metal	0.16

Saint Paul Public Schools
 Ramsey Junior High School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
651	1927 Bldg	234	XRF	2/21/97	2	Restroom	4	Ceiling		Cracked	Plaster	5.09
652	1927 Bldg	129	XRF	2/28/97	1	Restroom	4	Wall	Wall	Solid	Concrete	0.05
653	1927 Bldg	130	XRF	2/28/97	1	Restroom	4	Bulletin	Board	Solid	Wood	0
654	1927 Bldg	131	XRF	2/28/97	1	Restroom	4	Door	Door	Cracked	Wood	0
655	1927 Bldg	132	XRF	2/28/97	1	Restroom	4	Door	Casing	Cracked	Metal	0.28
656	1927 Bldg	133	XRF	2/28/97	1	Restroom	4	Wall	Midle Wall	Solid	Tile	2.8
657	1927 Bldg	134	XRF	2/28/97	1	Restroom	4		Locker	Cracked	Metal	0.21
658	1927 Bldg	135	XRF	2/28/97	1	Restroom	4	Wall	Wall	Solid	Concrete	0.04
659	1927 Bldg	136	XRF	2/28/97	1	Restroom	4	Bench		Solid	Wood	0
660	1927 Bldg	137	XRF	2/28/97	1	Restroom	4	Bench		Solid	Metal	0.07
661	1927 Bldg	138	XRF	2/28/97	1	Restroom	4	Floor		Cracked	Concrete	0.01
662	1927 Bldg	139	XRF	2/28/97	1	Restroom	4	Ceiling		Solid	Plaster	0.02
663	1927 Bldg	140	XRF	2/28/97	1	Restroom	4	Hatch		Solid	Metal	0
664	1927 Bldg	153	XRF	2/28/97	1	Restroom	4	Wall	Wall	Cracked	Wood	0.89
665	1927 Bldg	247	XRF	2/21/97	2	Restroom	5	Wall	Midle Wall	Solid	Tile	0.16
666	1927 Bldg	248	XRF	2/21/97	2	Restroom	5	Ceiling		Solid	Drywall	0
667	1927 Bldg	249	XRF	2/21/97	2	Restroom	5	Hatch		Solid	Metal	0
668	1927 Bldg	250	XRF	2/21/97	2	Restroom	5	Door	Door	Solid	Wood	0
669	1927 Bldg	251	XRF	2/21/97	2	Restroom	5	Door	Casing	Solid	Metal	0.01
670	1927 Bldg	149	XRF	2/28/97	1	Restroom	5	Wall	Wall	Solid	Tile	3.32
671	1927 Bldg	150	XRF	2/28/97	1	Restroom	5	Wall	Wall	Solid	Concrete	0.07
672	1927 Bldg	151	XRF	2/28/97	1	Restroom	5	Door	Door	Solid	Wood	0.01
673	1927 Bldg	152	XRF	2/28/97	1	Restroom	5	Door	Casing	Solid	Metal	0.27
674	1927 Bldg	50	XRF	2/22/97	2	Restroom	6	Wall	Wall	Cracked	Plaster	5.09
675	1927 Bldg	51	XRF	2/22/97	2	Restroom	6	Wall	Wall	Cracked	Plaster	5.09
676	1927 Bldg	52	XRF	2/22/97	2	Restroom	6	Window	Casing	Solid	Wood	0.05
677	1927 Bldg	53	XRF	2/22/97	2	Restroom	6		Radiator	Peeling	Metal	0.04
678	1927 Bldg	54	XRF	2/22/97	2	Restroom	6		Radiator	Peeling	Metal	3.78
679	1927 Bldg	55	XRF	2/22/97	2	Restroom	6	Chair Rail		Solid	Wood	0
680	1927 Bldg	56	XRF	2/22/97	2	Restroom	6		Stall Door	Cracked	Wood	0.02
681	1927 Bldg	211	XRF	2/28/97	1	Restroom	6	Wall	Wall	Solid	Tile	2.84
682	1927 Bldg	212	XRF	2/28/97	1	Restroom	6	Wall	Wall	Solid	Concrete	0.07
683	1927 Bldg	213	XRF	2/28/97	1	Restroom	6	Door	Door	Solid	Metal	0.39
684	1927 Bldg	214	XRF	2/28/97	1	Restroom	6	Door	Casing	Cracked	Metal	0.22
685	1927 Bldg	215	XRF	2/28/97	1	Restroom	6		Bthrm Stll	Solid	Metal	0.01
686	1927 Bldg	216	XRF	2/28/97	1	Restroom	6	Ceiling		Solid	Plaster	0.15
687	1927 Bldg	197	XRF	2/22/97	1	Restroom	7	Wall	Wall	Cracked	Plaster	5.09
688	1927 Bldg	198	XRF	2/22/97	1	Restroom	7	Wall	Wall	Solid	Plaster	0.03
689	1927 Bldg	199	XRF	2/22/97	1	Restroom	7	Chair Rail		Cracked	Wood	0.01
690	1927 Bldg	200	XRF	2/22/97	1	Restroom	7	Mirror	Casing	Cracked	Wood	0
691	1927 Bldg	201	XRF	2/22/97	1	Restroom	7	Wall	Wall	Cracked	Plaster	5.09
692	1927 Bldg	202	XRF	2/22/97	1	Restroom	7	Wall	Wall	Cracked	Plaster	5.09
693	1927 Bldg	203	XRF	2/22/97	1	Restroom	7		Radiator	Cracked	Metal	5.09
694	1927 Bldg	204	XRF	2/22/97	1	Restroom	7		Stall Door	Cracked	Wood	0
695	1927 Bldg	205	XRF	2/22/97	1	Restroom	7	Wall	Wall Rgstr	Cracked	Metal	0.09
696	1927 Bldg	206	XRF	2/22/97	1	Restroom	7	Door	Door	Cracked	Wood	0.02
697	1927 Bldg	207	XRF	2/22/97	1	Restroom	7	Door	Casing	Cracked	Wood	0.02
698	1927 Bldg	226	XRF	2/22/97	1	Restroom	8	Wall	Wall	Cracked	Plaster	0.08
699	1927 Bldg	227	XRF	2/22/97	1	Restroom	8	Wall	Midle Wall	Solid	Drywall	0.02
700	1927 Bldg	228	XRF	2/22/97	1	Restroom	8	Hatch		Solid	Metal	0
701	1927 Bldg	229	XRF	2/22/97	1	Restroom	8	Wall	Baseboar	Solid	Tile	0.6
702	1927 Bldg	230	XRF	2/22/97	1	Restroom	8	Door	Door	Solid	Wood	0
703	1927 Bldg	231	XRF	2/22/97	1	Restroom	8	Door	Casing	Solid	Metal	0.03
704	1927 Bldg	232	XRF	2/22/97	1	Restroom	8	Wall	Wall Rgstr	Solid	Metal	0.2
705	1927 Bldg	271	XRF	2/22/97	1	Restroom	9	Wall	Midle Wall	Solid	Drywall	0.07
706	1927 Bldg	272	XRF	2/22/97	1	Restroom	9	Wall	Baseboar	Solid	Tile	0.57
707	1927 Bldg	273	XRF	2/22/97	1	Restroom	9	Door	Door	Solid	Wood	0
708	1927 Bldg	274	XRF	2/22/97	1	Restroom	9	Door	Casing	Solid	Metal	0.01
709	1927 Bldg	348	XRF	2/22/97	1	Restroom	10	Wall	Wall	Cracked	Plaster	5.09

Saint Paul Public Schools
 Ramsey Junior High School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
710	1927 Bldg	349	XRF	2/22/97	1	Restroom	10	Wall	Wall	Solid		0.07
711	1927 Bldg	350	XRF	2/22/97	1	Restroom	10		Radiator	Cracked	Metal	2.99
712	1927 Bldg	351	XRF	2/22/97	1	Restroom	10	Wall	Chair rail	Solid	Wood	0.07
713	1927 Bldg	352	XRF	2/22/97	1	Restroom	10	Wall	Wall Rgstr	Cracked	Metal	0.03
714	1927 Bldg	353	XRF	2/22/97	1	Restroom	10	Door	Door	Cracked	Wood	0.02
715	1927 Bldg	354	XRF	2/22/97	1	Restroom	10	Door	Casing	Solid	Wood	0.02
716	1927 Bldg	355	XRF	2/22/97	1	Restroom	10	Ceiling		Solid	Plaster	5.09
717	1927 Bldg	113	XRF	2/24/97	1	Restroom	11	Wall	Wall	Cracked	Plaster	3.92
718	1927 Bldg	114	XRF	2/24/97	1	Restroom	11	Wall	Wall	Solid	Plaster	0.04
719	1927 Bldg	115	XRF	2/24/97	1	Restroom	11	Wall	Baseboar	Solid	Tile	0.16
720	1927 Bldg	116	XRF	2/24/97	1	Restroom	11	Door	Door	Solid	Wood	0
721	1927 Bldg	117	XRF	2/24/97	1	Restroom	11	Door	Casing	Solid	Metal	0.02
722	1927 Bldg	118	XRF	2/24/97	1	Restroom	12	Wall	Midle Wall	Cracked	Plaster	0.18
723	1927 Bldg	119	XRF	2/24/97	1	Restroom	12	Wall	Wall Rgstr	Solid	Metal	0.09
724	1927 Bldg	120	XRF	2/24/97	1	Restroom	12	Mirror Casing		Solid	Wood	0
725	1927 Bldg	121	XRF	2/24/97	1	Restroom	12	Wall	Baseboar	Solid	Tile	0.14
726	1927 Bldg	122	XRF	2/24/97	1	Restroom	12	Door	Door	Solid	Wood	0
727	1927 Bldg	123	XRF	2/24/97	1	Restroom	12	Door	Casing	Solid	Metal	0.01
728	1927 Bldg	192	XRF	2/24/97	0	Rm	1		Column	Cracked	Plaster	0.17
729	1927 Bldg	193	XRF	2/24/97	0	Rm	1	Door	Door	Solid	Wood	0
730	1927 Bldg	58	XRF	2/25/97	0	Room	0	Floor		Solid	Concrte	0.02
731	1927 Bldg	59	XRF	2/25/97	0	Room	0	Door	Door	Solid	Wood	0.01
732	1927 Bldg	60	XRF	2/25/97	0	Room	0	Door	Casing	Solid	Metal	0
733	1927 Bldg	61	XRF	2/25/97	0	Room	0	Stairs	Hand rail	Cracked	Metal	0.03
734	1927 Bldg	62	XRF	2/25/97	0	Room	0	Stairs	Hand rail	Cracked		0
735	1927 Bldg	63	XRF	2/25/97	0	Room	0	Stairs	Baseboar	Cracked		0.01
736	1927 Bldg	64	XRF	2/25/97	0	Room	0	Ceiling		Solid	Concrte	0.06
737	1927 Bldg	65	XRF	2/25/97	0	Room	0	Door	Door	Cracked	Metal	2.83
738	1927 Bldg	66	XRF	2/25/97	0	Room	0	Door	Casing	Cracked	Metal	5.09
739	1927 Bldg	29	XRF	2/20/97	3	Room	1	Wall	Wall	Cracked	Plaster	3.92
740	1927 Bldg	30	XRF	2/20/97	3	Room	1	Wall	Midle Wall	Cracked	Plaster	5.09
741	1927 Bldg	31	XRF	2/20/97	3	Room	1	Wall	Wall	Cracked	Plaster	0.05
742	1927 Bldg	32	XRF	2/20/97	3	Room	1	Ceiling		Solid	Plaster	0.05
743	1927 Bldg	33	XRF	2/20/97	3	Room	1	Wall	Crown mol	Solid	Wood	0
744	1927 Bldg	34	XRF	2/20/97	3	Room	1	Door	Door	Solid	Wood	0.03
745	1927 Bldg	35	XRF	2/20/97	3	Room	1	Door	Casing	Solid	Wood	0.28
746	1927 Bldg	36	XRF	2/20/97	3	Room	1		Radiator	Peeling	Metal	2.69
747	1927 Bldg	37	XRF	2/20/97	3	Room	1	Window	Casing	Solid	Wood	0.01
748	1927 Bldg	38	XRF	2/20/97	3	Room	1	Wall	Midle Wall	Peeling	Metal	0
749	1927 Bldg	39	XRF	2/20/97	3	Room	1	Wall	Baseboar	Solid	Wood	0.01
750	1927 Bldg	40	XRF	2/20/97	3	Room	1	Wall	Chair rail	Solid	Wood	0.01
751	1927 Bldg	41	XRF	2/20/97	3	Room	1	Floor		Solid	Wood	0
752	1927 Bldg	42	XRF	2/20/97	3	Room	1	Wire Tray		Solid	Metal	0.07
753	1927 Bldg	43	XRF	2/20/97	3	Room	1	Coat Rack		Solid	Wood	0.08
754	1927 Bldg	93	XRF	2/20/97	4	Room	2	Door	Door	Solid		3.28
755	1927 Bldg	94	XRF	2/20/97	4	Room	2	Door	Casing	Chalking	Metal	2.92
756	1927 Bldg	67	XRF	2/25/97	0	Room	2	Wall	Wall	Cracked	Concrte	0.08
757	1927 Bldg	68	XRF	2/25/97	0	Room	2	Door	Door	Cracked	Metal	5.09
758	1927 Bldg	69	XRF	2/25/97	0	Room	2	Door	Casing	Cracked	Metal	0.33
759	1927 Bldg	70	XRF	2/25/97	0	Room	2	Door	Door	Cracked	Metal	2.87
760	1927 Bldg	71	XRF	2/25/97	0	Room	2	Door	Door	Cracked		4.14
761	1927 Bldg	72	XRF	2/25/97	0	Room	2	Door	Casing	Peeling	Metal	5.09
762	1927 Bldg	73	XRF	2/25/97	0	Room	2	Door	Door	Solid	Metal	0
763	1927 Bldg	74	XRF	2/25/97	0	Room	2	Door	Casing	Cracked	Metal	0.31
764	1927 Bldg	75	XRF	2/25/97	0	Room	2	Stairs	Baseboar	Cracked	Metal	3.94
765	1927 Bldg	76	XRF	2/25/97	0	Room	2	Stairs	Baseboar	Cracked		3.69
766	1927 Bldg	77	XRF	2/25/97	0	Room	2	Stairs	Hand rail	Cracked	Metal	5.09
767	1927 Bldg	78	XRF	2/25/97	0	Room	2	Door	Door	Cracked	Metal	5.09
768	1927 Bldg	79	XRF	2/25/97	0	Room	2	Door	Casing	Cracked	Metal	0.11

Saint Paul Public Schools
 Ramsey Junior High School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
769	1927 Bldg	80	XRF	2/25/97	0	Room	2	Ceiling		Cracked	Concrete	0.02
770	1927 Bldg	81	XRF	2/25/97	0	Room	2	Floor		Cracked	Concrete	0.05
771	1927 Bldg	128	XRF	2/20/97	3	Room	3	Wall	Midle Wall	Cracked	Plaster	0.27
772	1927 Bldg	129	XRF	2/20/97	3	Room	3	Wall	Baseboar	Solid	Wood	0
773	1927 Bldg	130	XRF	2/20/97	3	Room	3	Bookcase	Inside	Solid	Wood	0.01
774	1927 Bldg	51	XRF	2/21/97	3	Room	4	Wall	Wall	Cracked	Plaster	5.09
775	1927 Bldg	52	XRF	2/21/97	3	Room	4	Wall	Wall	Cracked	Plaster	0.09
776	1927 Bldg	53	XRF	2/21/97	3	Room	4	Radiator	Cracked	Metal	2.51	
777	1927 Bldg	54	XRF	2/21/97	3	Room	4	Chair Rail		Solid	Wood	0.02
778	1927 Bldg	99	XRF	2/28/97	1	Room	5	Wall	Wall	Solid	Tile	2.71
779	1927 Bldg	100	XRF	2/28/97	1	Room	5	Wall	Wall	Solid	Concrete	0.05
780	1927 Bldg	101	XRF	2/28/97	1	Room	5	Bulletin	Board	Solid	Wood	0
781	1927 Bldg	102	XRF	2/28/97	1	Room	5	Radiator	Solid	Metal	0.03	
782	1927 Bldg	103	XRF	2/28/97	1	Room	5	Door	Door	Solid	Wood	0.01
783	1927 Bldg	104	XRF	2/28/97	1	Room	5	Window	Casing	Solid	Metal	0.35
784	1927 Bldg	105	XRF	2/28/97	1	Room	5	Cabinet	Door	Solid	Wood	0
785	1927 Bldg	178	XRF	2/21/97	2	Room	6	Door	Door	Solid	Wood	0
786	1927 Bldg	179	XRF	2/21/97	2	Room	6	Door	Casing	Solid	Metal	0.02
787	1927 Bldg	180	XRF	2/21/97	2	Room	6	Ceiling		Solid	Drywall	0
788	1927 Bldg	181	XRF	2/21/97	2	Room	6	Ceiling	Diffuser	Solid	Metal	0.01
789	1927 Bldg	141	XRF	2/28/97	1	Room	6	Wall	Wall	Solid	Concrete	0.09
790	1927 Bldg	142	XRF	2/28/97	1	Room	6	Door	Door	Cracked	Wood	0.01
791	1927 Bldg	143	XRF	2/28/97	1	Room	6	Door	Casing	Cracked	Metal	0.42
792	1927 Bldg	144	XRF	2/28/97	1	Room	6	Cabinet	Door	Cracked	Wood	0
793	1927 Bldg	145	XRF	2/28/97	1	Room	6	Wall	Midle Wall	Solid	Concrete	0.22
794	1927 Bldg	146	XRF	2/28/97	1	Room	6	Bookcase	Shelf	Solid	Wood	0
795	1927 Bldg	147	XRF	2/28/97	1	Room	6	Floor		Peeling	Concrete	0.04
796	1927 Bldg	148	XRF	2/28/97	1	Room	6	Ceiling		Solid	Plaster	0.08
797	1927 Bldg	182	XRF	2/21/97	2	Room	7	Wall		Solid	Drywall	0
798	1927 Bldg	183	XRF	2/21/97	2	Room	7	Door	Door	Solid	Wood	0
799	1927 Bldg	184	XRF	2/21/97	2	Room	7	Door	Casing	Solid	Metal	0.01
800	1927 Bldg	196	XRF	2/28/97	1	Room	7	Wall	Midle Wall	Solid	Concrete	0.07
801	1927 Bldg	197	XRF	2/28/97	1	Room	7	Door	Door	Cracked	Metal	0.25
802	1927 Bldg	198	XRF	2/28/97	1	Room	7	Door	Casing	Cracked	Metal	0.27
803	1927 Bldg	199	XRF	2/28/97	1	Room	7	Ceiling		Solid	Plaster	0.09
804	1927 Bldg	200	XRF	2/28/97	1	Room	7	Floor		Peeling	Concrete	0.03
805	1927 Bldg	220	XRF	2/21/97	2	Room	8	Wall	Wall	Solid	Concrete	0
806	1927 Bldg	221	XRF	2/21/97	2	Room	8	Wall	Wall	Peeling	Plaster	5.09
807	1927 Bldg	222	XRF	2/21/97	2	Room	8		Radiator	Solid	Metal	0.01
808	1927 Bldg	223	XRF	2/21/97	2	Room	8	Door	Door	Solid	Wood	0
809	1927 Bldg	224	XRF	2/21/97	2	Room	8	Door	Casing	Solid	Metal	0
810	1927 Bldg	233	XRF	2/22/97	1	Room	8	Wall	Wall	Cracked	Plaster	0.06
811	1927 Bldg	234	XRF	2/22/97	1	Room	8	Wall	Midle Wall	Cracked	Plaster	0.04
812	1927 Bldg	235	XRF	2/22/97	1	Room	8	Wall	Wall	Cracked	Drywall	0
813	1927 Bldg	236	XRF	2/22/97	1	Room	8	Wall	Wall	Cracked	Plaster	0.04
814	1927 Bldg	237	XRF	2/22/97	1	Room	8	Wall	Baseboar	Solid	Wood	0
815	1927 Bldg	238	XRF	2/22/97	1	Room	8	Door	Door	Solid	Wood	0
816	1927 Bldg	239	XRF	2/22/97	1	Room	8	Door	Casing	Solid	Metal	0
817	1927 Bldg	240	XRF	2/22/97	1	Room	8	Wall	Wall	Peeling	Metal	5.09
818	1927 Bldg	241	XRF	2/22/97	1	Room	8	Wall	Wall	Cracked	Plaster	5.09
819	1927 Bldg	242	XRF	2/22/97	1	Room	8	Window	Casing	Cracked	Wood	0.04
820	1927 Bldg	243	XRF	2/22/97	1	Room	8		Radiator	Solid	Metal	0.02
821	1927 Bldg	244	XRF	2/22/97	1	Room	8	Door	Door	Solid	Wood	0.02
822	1927 Bldg	245	XRF	2/22/97	1	Room	8	Door	Casing	Solid	Wood	0
823	1927 Bldg	201	XRF	2/28/97	1	Room	8	Wall	Midle Wall	Peeling	Concrete	0.06
824	1927 Bldg	202	XRF	2/28/97	1	Room	8		Radiator	Solid	Metal	0.01
825	1927 Bldg	203	XRF	2/28/97	1	Room	8	Wall	Wall	Solid	Wood	0
826	1927 Bldg	204	XRF	2/28/97	1	Room	8	Door	Door	Cracked	Metal	0.38
827	1927 Bldg	205	XRF	2/28/97	1	Room	8	Door	Casing	Cracked	Metal	0.25

Saint Paul Public Schools
 Ramsey Junior High School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
828	1927 Bldg	206	XRF	2/28/97	1	Room	8	Window	Sash	Solid	Wood	0
829	1927 Bldg	207	XRF	2/28/97	1	Room	8	Wall	Wall	Solid	Tile	1.69
830	1927 Bldg	208	XRF	2/28/97	1	Room	8	Floor		Peeling	Concrete	0.02
831	1927 Bldg	209	XRF	2/28/97	1	Room	8	Ceiling		Cracked	Plaster	0.19
832	1927 Bldg	246	XRF	2/22/97	1	Room	9	Wall	Midle Wall	Cracked	Plaster	0.03
833	1927 Bldg	247	XRF	2/22/97	1	Room	9	Wall	Wall	Solid	Drywall	0
834	1927 Bldg	248	XRF	2/22/97	1	Room	9	Wall	Baseboar	Solid	Wood	0
835	1927 Bldg	249	XRF	2/22/97	1	Room	9	Door	Door	Solid	Wood	0.02
836	1927 Bldg	250	XRF	2/22/97	1	Room	9	Door	Casing	Solid	Wood	0.05
837	1927 Bldg	251	XRF	2/22/97	1	Room	9	Door	Door	Solid	Wood	0
838	1927 Bldg	252	XRF	2/22/97	1	Room	9	Door	Casing	Solid	Metal	0.01
839	1927 Bldg	228	XRF	2/28/97	1	Room	9	Wall	Wall	Solid	Concrete	0
840	1927 Bldg	229	XRF	2/28/97	1	Room	9	Wall	Baseboar	Solid	Concrete	0.01
841	1927 Bldg	230	XRF	2/28/97	1	Room	9	Door	Door	Cracked	Metal	0.19
842	1927 Bldg	231	XRF	2/28/97	1	Room	9	Door	Casing	Cracked	Metal	0.26
843	1927 Bldg	232	XRF	2/28/97	1	Room	9	Floor		Cracked	Concrete	0.48
844	1927 Bldg	233	XRF	2/28/97	1	Room	9	Wall	Wall	Solid	Tile	2.58
845	1927 Bldg	234	XRF	2/28/97	1	Room	9	Wall	Wall	Solid	Concrete	0.11
846	1927 Bldg	235	XRF	2/28/97	1	Room	9		Column	Cracked	Concrete	0.09
847	1927 Bldg	236	XRF	2/28/97	1	Room	9	Door	Door	Cracked	Wood	0
848	1927 Bldg	237	XRF	2/28/97	1	Room	9	Door	Door	Solid	Metal	0.15
849	1927 Bldg	238	XRF	2/28/97	1	Room	9	Door	Jamb	Cracked	Metal	0.08
850	1927 Bldg	239	XRF	2/28/97	1	Room	9	Wall	Midle Wall	Cracked	Wood	0.03
851	1927 Bldg	240	XRF	2/28/97	1	Room	9	Door	Casing	Solid	Metal	0.35
852	1927 Bldg	241	XRF	2/28/97	1	Room	9		Radiator	Cracked	Metal	0
853	1927 Bldg	242	XRF	2/28/97	1	Room	9	Wall	Wall Rgstr	Cracked	Metal	0.03
854	1927 Bldg	243	XRF	2/28/97	1	Room	9	Wall	Wall	Cracked	Wood	0
855	1927 Bldg	244	XRF	2/28/97	1	Room	9	Door	Door	Cracked	Metal	0.26
856	1927 Bldg	245	XRF	2/28/97	1	Room	9	Door	Casing	Cracked	Metal	0.22
857	1927 Bldg	246	XRF	2/28/97	1	Room	9		Column	Cracked	Concrete	0.04
858	1927 Bldg	247	XRF	2/28/97	1	Room	9	Wall	Wall	Solid	Plaster	0.06
859	1927 Bldg	248	XRF	2/28/97	1	Room	9	Ceiling		Solid	Plaster	0.03
860	1927 Bldg	263	XRF	2/22/97	1	Room	10	Wall	Midle Wall	Cracked	Plaster	5.09
861	1927 Bldg	264	XRF	2/22/97	1	Room	10	Window	Casing	Solid	Wood	0.04
862	1927 Bldg	265	XRF	2/22/97	1	Room	10	Wall	Wall	Solid	Metal	0
863	1927 Bldg	266	XRF	2/22/97	1	Room	10		Radiator	Solid	Metal	0.03
864	1927 Bldg	267	XRF	2/22/97	1	Room	10	Cabinet	Door	Solid	Wood	0
865	1927 Bldg	268	XRF	2/22/97	1	Room	10	Wall	Wall	Solid	Plaster	0
866	1927 Bldg	269	XRF	2/22/97	1	Room	10	Wall	Baseboar	Solid	Wood	0
867	1927 Bldg	270	XRF	2/22/97	1	Room	10	Floor		Solid	Wood	0
868	1927 Bldg	289	XRF	2/22/97	1	Room	11	Wall	Wall	Cracked	Plaster	0.11
869	1927 Bldg	290	XRF	2/22/97	1	Room	11	Wall	Baseboar	Solid	Wood	0
870	1927 Bldg	291	XRF	2/22/97	1	Room	11	Wall	Wall	Solid		0.01
871	1927 Bldg	292	XRF	2/22/97	1	Room	11	Door	Door	Solid	Wood	0
872	1927 Bldg	293	XRF	2/22/97	1	Room	11	Door	Casing	Solid	Metal	0.01
873	1927 Bldg	294	XRF	2/22/97	1	Room	12	Chair Rail		Cracked	Plaster	0.09
874	1927 Bldg	295	XRF	2/22/97	1	Room	12	Window	Casing	Solid	Wood	0.03
875	1927 Bldg	296	XRF	2/22/97	1	Room	12	Wall	Wall	Solid	Metal	0
876	1927 Bldg	297	XRF	2/22/97	1	Room	12		Radiator	Peeling	Metal	3.93
877	1927 Bldg	298	XRF	2/22/97	1	Room	12		Elec Pane	Solid	Metal	0
878	1927 Bldg	299	XRF	2/22/97	1	Room	12	Wall	Wall	Cracked	Plaster	0.16
879	1927 Bldg	300	XRF	2/22/97	1	Room	12	Bulletin	Board	Solid	Wood	0
880	1927 Bldg	301	XRF	2/22/97	1	Room	13	Wall	Wall	Peeling	Plaster	5.09
881	1927 Bldg	302	XRF	2/22/97	1	Room	13		Radiator	Cracked	Metal	0.01
882	1927 Bldg	303	XRF	2/22/97	1	Room	13	Window	Casing	Solid	Wood	0.05
883	1927 Bldg	304	XRF	2/22/97	1	Room	13	Wall	Wall	Solid	Metal	0.02
884	1927 Bldg	305	XRF	2/22/97	1	Room	13	Wall	Wall	Solid	Plaster	0.02
885	1927 Bldg	306	XRF	2/22/97	1	Room	13	Bulletin	Board	Solid	Wood	0
886	1927 Bldg	307	XRF	2/22/97	1	Room	14	Wall	Midle Wall	Cracked	Plaster	0.03

Saint Paul Public Schools
 Ramsey Junior High School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
887	1927 Bldg	308	XRF	2/22/97	1	Room	14	Cabinet	Door	Solid	Wood	0
888	1927 Bldg	309	XRF	2/22/97	1	Room	14	Door	Door	Solid	Metal	0
889	1927 Bldg	310	XRF	2/22/97	1	Room	14	Door	Casing	Solid	Metal	0
890	1927 Bldg	311	XRF	2/22/97	1	Room	14	Ceiling		Solid	Plaster	0.07
891	1927 Bldg	313	XRF	2/22/97	1	Room	15	Wall	Wall	Cracked	Metal	5.09
892	1927 Bldg	314	XRF	2/22/97	1	Room	15	Wall	Midle Wall	Cracked	Plaster	3.13
893	1927 Bldg	315	XRF	2/22/97	1	Room	15		Radiator	Cracked	Metal	5.09
894	1927 Bldg	316	XRF	2/22/97	1	Room	15	Window	Casing	Solid	Wood	0.03
895	1927 Bldg	317	XRF	2/22/97	1	Room	15	Wall	Wall	Solid	Metal	0
896	1927 Bldg	318	XRF	2/22/97	1	Room	15	Wall	Baseboar	Solid	Wood	0
897	1927 Bldg	319	XRF	2/22/97	1	Room	15	Wall	Wall	Solid	Plaster	0.13
898	1927 Bldg	320	XRF	2/22/97	1	Room	15	Door	Door	Solid	Wood	0
899	1927 Bldg	321	XRF	2/22/97	1	Room	15	Door	Casing	Solid	Metal	0.01
900	1927 Bldg	322	XRF	2/22/97	1	Room	15	Wall	Midle Wall	Solid	Wood	0.09
901	1927 Bldg	323	XRF	2/22/97	1	Room	15	Wall	Wall Rgstr	Solid	Metal	0.02
902	1927 Bldg	324	XRF	2/22/97	1	Room	15	Door	Door	Solid	Wood	0.03
903	1927 Bldg	325	XRF	2/22/97	1	Room	15	Door	Casing	Solid	Wood	0.03
904	1927 Bldg	326	XRF	2/22/97	1	Room	15	Mini Blinds		Solid	Metal	0
905	1927 Bldg	134	XRF	2/25/97	0	Room	16	Wall	Midle Wall	Solid	Concrete	0
906	1927 Bldg	135	XRF	2/25/97	0	Room	16	Door	Door	Cracked	Metal	1.38
907	1927 Bldg	136	XRF	2/25/97	0	Room	16	Door	Casing	Solid	Metal	1.26
908	1927 Bldg	137	XRF	2/25/97	0	Room	16	Vent Hood		Solid	Metal	0.03
909	1927 Bldg	138	XRF	2/25/97	0	Room	16	Cabinet	Door	Solid	Wood	0
910	1927 Bldg	139	XRF	2/25/97	0	Room	16	Cabinet	Inside	Solid	Wood	0
911	1927 Bldg	140	XRF	2/25/97	0	Room	16	Wall	Wall Rgstr	Solid	Metal	0
912	1927 Bldg	141	XRF	2/25/97	0	Room	16	Ceiling		Solid	Concrete	0.03
913	1927 Bldg	164	XRF	2/25/97	1	Room	100	Wall	Midle Wall	Solid	Concrete	0.01
914	1927 Bldg	165	XRF	2/25/97	1	Room	100	Stairs	Hand rail	Cracked	Metal	0.01
915	1927 Bldg	166	XRF	2/25/97	1	Room	100	Door	Door	Cracked	Metal	0.02
916	1927 Bldg	167	XRF	2/25/97	1	Room	100	Door	Casing	Cracked	Metal	0.02
917	1927 Bldg	6	XRF	2/24/97	1	Room	101	Wall	Wall	Cracked	Plaster	0
918	1927 Bldg	7	XRF	2/24/97	1	Room	101	Wall	Baseboar	Solid	Wood	0.02
919	1927 Bldg	8	XRF	2/24/97	1	Room	101	Floor		Solid	Wood	0.02
920	1927 Bldg	9	XRF	2/24/97	1	Room	101	Unlisted	Midle Wall	Cracked	Wood	0.01
921	1927 Bldg	10	XRF	2/24/97	1	Room	101	TV Mount	Board	Solid	Wood	0
922	1927 Bldg	11	XRF	2/24/97	1	Room	101	Wall	Midle Wall	Cracked	Plaster	0.08
923	1927 Bldg	12	XRF	2/24/97	1	Room	101	Wall	Wall	Solid	Plaster	0.06
924	1927 Bldg	13	XRF	2/24/97	1	Room	101	Ceiling		Cracked	Plaster	0.04
925	1927 Bldg	14	XRF	2/24/97	1	Room	101	Wall	Wall Rgstr	Cracked	Metal	3.02
926	1927 Bldg	15	XRF	2/24/97	1	Room	101	Wire Tray		Solid	Metal	0.01
927	1927 Bldg	16	XRF	2/24/97	1	Room	101	Cabinet	Door	Cracked	Wood	0.01
928	1927 Bldg	153	XRF	2/25/97	1	Room	102	Wall	Wall	Solid	Concrete	0.01
929	1927 Bldg	154	XRF	2/25/97	1	Room	102	Wall	Wall	Solid	Concrete	0
930	1927 Bldg	155	XRF	2/25/97	1	Room	102	Floor		Cracked	Concrete	0.06
931	1927 Bldg	156	XRF	2/25/97	1	Room	102	Cabinet	Door	Solid	Wood	0.01
932	1927 Bldg	157	XRF	2/25/97	1	Room	102	Cabinet	Door	Solid	Wood	0.03
933	1927 Bldg	158	XRF	2/25/97	1	Room	102	Door	Door	Cracked	Metal	0.02
934	1927 Bldg	159	XRF	2/25/97	1	Room	102	Door	Casing	Cracked	Metal	0
935	1927 Bldg	183	XRF	2/22/97	1	Room	109	Wall	Wall	Solid	Plaster	0.06
936	1927 Bldg	184	XRF	2/22/97	1	Room	109	Wall	Wall	Solid	Plaster	0
937	1927 Bldg	185	XRF	2/22/97	1	Room	109	Chair Rail		Solid	Wood	0
938	1927 Bldg	186	XRF	2/22/97	1	Room	109	Wire Tray		Solid	Metal	0.03
939	1927 Bldg	187	XRF	2/22/97	1	Room	109	Wall	Midle Wall	Solid	Plaster	5.09
940	1927 Bldg	188	XRF	2/22/97	1	Room	109		Radiator	Solid	Metal	0.07
941	1927 Bldg	189	XRF	2/22/97	1	Room	109	TV Mount	Board	Solid	Wood	0
942	1927 Bldg	190	XRF	2/22/97	1	Room	109	Door	Door	Solid	Wood	0.02
943	1927 Bldg	191	XRF	2/22/97	1	Room	109	Door	Casing	Solid	Wood	0.02
944	1927 Bldg	192	XRF	2/22/97	1	Room	109	Wall	Midle Wall	Cracked	Wood	0.01
945	1927 Bldg	193	XRF	2/22/97	1	Room	109	Window	Casing	Solid	Metal	0

Saint Paul Public Schools
 Ramsey Junior High School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
946	1927 Bldg	194	XRF	2/22/97	1	Room	109	Window	Casing	Solid		0
947	1927 Bldg	195	XRF	2/22/97	1	Room	109	Door	Door	Solid	Wood	0
948	1927 Bldg	196	XRF	2/22/97	1	Room	109	Door	Casing	Solid	Metal	0
949	1927 Bldg	157	XRF	2/22/97	1	Room	111	Wall	Wall	Cracked	Plaster	4.37
950	1927 Bldg	158	XRF	2/22/97	1	Room	111	Wall	Wall	Cracked	Plaster	0.01
951	1927 Bldg	159	XRF	2/22/97	1	Room	111	TV Mount	Board	Solid	Wood	0
952	1927 Bldg	160	XRF	2/22/97	1	Room	111	Chair Rail		Solid	Wood	0
953	1927 Bldg	161	XRF	2/22/97	1	Room	111	Bulletin	Board	Cracked	Wood	0.03
954	1927 Bldg	162	XRF	2/22/97	1	Room	111	Wall	Baseboar	Solid	Wood	0.01
955	1927 Bldg	163	XRF	2/22/97	1	Room	111	Wire Tray		Solid	Metal	0.02
956	1927 Bldg	164	XRF	2/22/97	1	Room	111	Window	Casing	Solid	Wood	0.06
957	1927 Bldg	165	XRF	2/22/97	1	Room	111	Wall	Radiator	Cracked	Metal	0.19
958	1927 Bldg	166	XRF	2/22/97	1	Room	111	Wall	Wall	Solid	Metal	0
959	1927 Bldg	167	XRF	2/22/97	1	Room	111	Wall	Midle Wall	Solid	Drywall	0
960	1927 Bldg	168	XRF	2/22/97	1	Room	111	Wall	Chair rail	Solid	Wood	0
961	1927 Bldg	169	XRF	2/22/97	1	Room	111	Door	Door	Solid	Wood	0
962	1927 Bldg	170	XRF	2/22/97	1	Room	111	Door	Casing	Solid	Metal	0.01
963	1927 Bldg	171	XRF	2/22/97	1	Room	111	Wall	Midle Wall	Solid	Drywall	0
964	1927 Bldg	172	XRF	2/22/97	1	Room	111	Wall	Wall	Solid	Metal	0.04
965	1927 Bldg	173	XRF	2/22/97	1	Room	111	Window	Casing	Solid	Wood	0.01
966	1927 Bldg	174	XRF	2/22/97	1	Room	111		Radiator	Cracked	Metal	3.91
967	1927 Bldg	175	XRF	2/22/97	1	Room	111	Chair Rail		Solid	Wood	0.02
968	1927 Bldg	176	XRF	2/22/97	1	Room	111	Wall	Wall	Solid	Plaster	0.02
969	1927 Bldg	177	XRF	2/22/97	1	Room	111	Wall	Midle Wall	Cracked	Wood	0.02
970	1927 Bldg	178	XRF	2/22/97	1	Room	111	Wall	Wall	Solid	Plaster	5.09
971	1927 Bldg	179	XRF	2/22/97	1	Room	111	Wall	Baseboar	Solid	Wood	0.02
972	1927 Bldg	180	XRF	2/22/97	1	Room	111	Door	Door	Solid	Wood	0
973	1927 Bldg	181	XRF	2/22/97	1	Room	111	Door	Casing	Solid	Metal	0
974	1927 Bldg	182	XRF	2/22/97	1	Room	111	Wire Tray		Solid	Metal	0
975	1927 Bldg	209	XRF	2/22/97	1	Room	112	Wall	Wall	Cracked	Plaster	0.02
976	1927 Bldg	210	XRF	2/22/97	1	Room	112	Wall	Wall	Cracked	Plaster	0.25
977	1927 Bldg	211	XRF	2/22/97	1	Room	112	Wall	Midle Wall	Solid	Drywall	0.04
978	1927 Bldg	212	XRF	2/22/97	1	Room	112	Wall	Wall	Solid	Drywall	0.04
979	1927 Bldg	213	XRF	2/22/97	1	Room	112	Wall	Wall	Solid	Plaster	5.09
980	1927 Bldg	214	XRF	2/22/97	1	Room	112	Wall	Baseboar	Solid	Wood	0
981	1927 Bldg	215	XRF	2/22/97	1	Room	112	Floor		Solid	Wood	0
982	1927 Bldg	216	XRF	2/22/97	1	Room	112	Window	Casing	Solid	Wood	0.05
983	1927 Bldg	217	XRF	2/22/97	1	Room	112		Radiator	Cracked	Metal	0.55
984	1927 Bldg	218	XRF	2/22/97	1	Room	112	Window	Casing	Solid	Metal	0
985	1927 Bldg	219	XRF	2/22/97	1	Room	112	Door	Door	Solid	Wood	0
986	1927 Bldg	220	XRF	2/22/97	1	Room	112	Door	Casing	Solid	Metal	0.01
987	1927 Bldg	221	XRF	2/22/97	1	Room	112	Door	Radiator	Solid	Metal	0.02
988	1927 Bldg	222	XRF	2/22/97	1	Room	112	Door	Door	Solid	Metal	0
989	1927 Bldg	223	XRF	2/22/97	1	Room	112	Closet	Wall	Cracked	Plaster	0.15
990	1927 Bldg	224	XRF	2/22/97	1	Room	112	Closet	Baseboar	Solid	Wood	0
991	1927 Bldg	225	XRF	2/22/97	1	Room	112	Ceiling		Solid	Plaster	0.02
992	1927 Bldg	253	XRF	2/22/97	1	Room	115	Wall	Wall	Cracked	Plaster	0
993	1927 Bldg	254	XRF	2/22/97	1	Room	115	Wall	Wall	Solid	Plaster	0.03
994	1927 Bldg	255	XRF	2/22/97	1	Room	115	Door	Door	Solid	Wood	0
995	1927 Bldg	256	XRF	2/22/97	1	Room	115	Door	Casing	Solid	Metal	0
996	1927 Bldg	257	XRF	2/22/97	1	Room	115	Wire Tray		Solid	Metal	0.02
997	1927 Bldg	258	XRF	2/22/97	1	Room	115	Bulletin	Board	Solid	Wood	0
998	1927 Bldg	259	XRF	2/22/97	1	Room	115	Window	Casing	Solid	Wood	0.06
999	1927 Bldg	260	XRF	2/22/97	1	Room	115	Wall	Wall	Solid	Metal	0
1000	1927 Bldg	261	XRF	2/22/97	1	Room	115		Radiator	Solid	Metal	0.02
1001	1927 Bldg	262	XRF	2/22/97	1	Room	115	Wall	Baseboar	Solid	Wood	0
1002	1927 Bldg	275	XRF	2/22/97	1	Room	117	Wall	Wall	Solid	Plaster	0.02
1003	1927 Bldg	276	XRF	2/22/97	1	Room	117		Radiator	Solid	Metal	0.02
1004	1927 Bldg	277	XRF	2/22/97	1	Room	117	Wire Tray		Solid	Metal	0

Saint Paul Public Schools
 Ramsey Junior High School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
1005	1927 Bldg	278	XRF	2/22/97	1	Room	117	Window	Casing	Cracked	Wood	0.03
1006	1927 Bldg	279	XRF	2/22/97	1	Room	117	Wall	Wall	Solid	Metal	0
1007	1927 Bldg	280	XRF	2/22/97	1	Room	117	Wall	Midle Wall	Solid	Plaster	0.02
1008	1927 Bldg	281	XRF	2/22/97	1	Room	117	Bookcase	Inside	Solid	Wood	0
1009	1927 Bldg	282	XRF	2/22/97	1	Room	117	Wall	Baseboar	Solid	Wood	0
1010	1927 Bldg	283	XRF	2/22/97	1	Room	117	Wall	Wall Rgstr	Solid	Metal	0.06
1011	1927 Bldg	284	XRF	2/22/97	1	Room	117	Door	Door	Solid	Wood	0.01
1012	1927 Bldg	285	XRF	2/22/97	1	Room	117	Door	Casing	Solid	Wood	0
1013	1927 Bldg	286	XRF	2/22/97	1	Room	117	TV Mount	Board	Solid	Wood	0
1014	1927 Bldg	287	XRF	2/22/97	1	Room	117	Door	Door	Solid	Metal	0
1015	1927 Bldg	288	XRF	2/22/97	1	Room	117	Door	Casing	Solid	Metal	0
1016	1927 Bldg	18	XRF	2/22/97	2	Room	200	Wall	Wall	Solid	Plaster	5.09
1017	1927 Bldg	19	XRF	2/22/97	2	Room	200	Wall	Wall	Solid	Plaster	0.23
1018	1927 Bldg	20	XRF	2/22/97	2	Room	200	Wall	Baseboar	Cracked	Wood	0
1019	1927 Bldg	21	XRF	2/22/97	2	Room	200	Floor		Solid	Wood	0
1020	1927 Bldg	22	XRF	2/22/97	2	Room	200	Cabinet	Door	Cracked	Wood	0
1021	1927 Bldg	23	XRF	2/22/97	2	Room	200	Cabinet	Inside	Solid	Wood	0
1022	1927 Bldg	24	XRF	2/22/97	2	Room	200	Door	Door	Solid	Metal	0.03
1023	1927 Bldg	25	XRF	2/22/97	2	Room	200	Door	Casing	Solid	Metal	0.01
1024	1927 Bldg	26	XRF	2/22/97	2	Room	200	Door	Door	Solid	Metal	0.01
1025	1927 Bldg	27	XRF	2/22/97	2	Room	200	Door	Casing	Cracked	Metal	0.01
1026	1927 Bldg	28	XRF	2/22/97	2	Room	200	Wire Tray		Solid	Metal	0.35
1027	1927 Bldg	29	XRF	2/22/97	2	Room	200	Door	Casing	Cracked	Wood	0.04
1028	1927 Bldg	30	XRF	2/22/97	2	Room	200	Door	Casing	Cracked	Wood	0
1029	1927 Bldg	31	XRF	2/22/97	2	Room	200	Wall	Wall Rgstr	Cracked	Metal	0.13
1030	1927 Bldg	32	XRF	2/22/97	2	Room	200	Wire Tray		Solid	Metal	0.03
1031	1927 Bldg	33	XRF	2/22/97	2	Room	200	Ceiling		Cracked	Plaster	0.02
1032	1927 Bldg	34	XRF	2/22/97	2	Room	200	Closet	Wall	Cracked	Plaster	5.09
1033	1927 Bldg	35	XRF	2/22/97	2	Room	200	TV Mount	Board	Solid	Wood	0.04
1034	1927 Bldg	36	XRF	2/22/97	2	Room	200	Bookcase	Shelf	Solid	Wood	0
1035	1927 Bldg	37	XRF	2/22/97	2	Room	200	Ceiling		Solid	Plaster	0.06
1036	1927 Bldg	148	XRF	2/22/97	2	Room	202	Wall	Wall	Solid	Concrete	0.03
1037	1927 Bldg	149	XRF	2/22/97	2	Room	202	Wall	Wall	Solid	Plaster	5.09
1038	1927 Bldg	150	XRF	2/22/97	2	Room	202	Radiator	Solid	Metal	0.02	
1039	1927 Bldg	151	XRF	2/22/97	2	Room	202	Wall	Midle Wall	Solid	Drywall	0.04
1040	1927 Bldg	152	XRF	2/22/97	2	Room	202	Wall	Midle Wall	Cracked	Plaster	0.09
1041	1927 Bldg	153	XRF	2/22/97	2	Room	202	Wall	Baseboar	Solid	Wood	0
1042	1927 Bldg	154	XRF	2/22/97	2	Room	202	Door	Door	Solid	Wood	0
1043	1927 Bldg	155	XRF	2/22/97	2	Room	202	Door	Casing	Solid	Metal	0.01
1044	1927 Bldg	240	XRF	2/21/97	2	Room	203	Wall	Wall	Solid	Drywall	0.01
1045	1927 Bldg	241	XRF	2/21/97	2	Room	203	Wall	Midle Wall	Solid	Plaster	0.01
1046	1927 Bldg	242	XRF	2/21/97	2	Room	203	Door	Door	Solid	Wood	0
1047	1927 Bldg	243	XRF	2/21/97	2	Room	203	Door	Casing	Solid	Metal	0.01
1048	1927 Bldg	244	XRF	2/21/97	2	Room	203	Wall	Wall	Solid	Concrete	0
1049	1927 Bldg	245	XRF	2/21/97	2	Room	203	Wall	Wall	Solid	Plaster	5.09
1050	1927 Bldg	246	XRF	2/21/97	2	Room	203		Radiator	Solid	Metal	0
1051	1927 Bldg	235	XRF	2/21/97	2	Room	207	Ceiling		Solid	Plaster	0.05
1052	1927 Bldg	236	XRF	2/21/97	2	Room	207	Wall	Midle Wall	Cracked	Plaster	0.16
1053	1927 Bldg	237	XRF	2/21/97	2	Room	207	Door	Door	Cracked	Wood	0.03
1054	1927 Bldg	238	XRF	2/21/97	2	Room	207	Door	Casing	Cracked	Wood	0
1055	1927 Bldg	239	XRF	2/21/97	2	Room	207	Bookcase	Shelf	Solid	Wood	0.03
1056	1927 Bldg	152	XRF	2/21/97	2	Room	210	Wall	Wall	Cracked	Plaster	0.08
1057	1927 Bldg	153	XRF	2/21/97	2	Room	210	Wall	Wall	Cracked	Plaster	0.27
1058	1927 Bldg	154	XRF	2/21/97	2	Room	210	Door	Door	Solid	Wood	0.02
1059	1927 Bldg	155	XRF	2/21/97	2	Room	210	Door	Door	Solid	Metal	0.07
1060	1927 Bldg	156	XRF	2/21/97	2	Room	210	Door	Casing	Cracked	Wood	0.02
1061	1927 Bldg	157	XRF	2/21/97	2	Room	210	Wall	Baseboar	Solid	Wood	0.03
1062	1927 Bldg	158	XRF	2/21/97	2	Room	210	Floor	Baseboar	Solid	Wood	0
1063	1927 Bldg	159	XRF	2/21/97	2	Room	210	Window	Casing	Solid	Wood	0.05

Saint Paul Public Schools
 Ramsey Junior High School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
1064	1927 Bldg	160	XRF	2/21/97	2	Room	210		Radiator	Peeling	Metal	0.07
1065	1927 Bldg	161	XRF	2/21/97	2	Room	210		Radiator	Peeling	Metal	0.06
1066	1927 Bldg	162	XRF	2/21/97	2	Room	210	Cabinet	Door	Solid	Wood	0.02
1067	1927 Bldg	163	XRF	2/21/97	2	Room	210	Bookcase	Shelf	Solid	Wood	0.03
1068	1927 Bldg	164	XRF	2/21/97	2	Room	210	Wire Tray		Solid	Metal	0.01
1069	1927 Bldg	165	XRF	2/21/97	2	Room	210	Ceiling		Peeling	Plaster	0.04
1070	1927 Bldg	166	XRF	2/21/97	2	Room	210	Wall	Solid	Plaster	0.04	
1071	1927 Bldg	167	XRF	2/21/97	2	Room	210	Wall	Solid	Plaster	0.03	
1072	1927 Bldg	168	XRF	2/21/97	2	Room	210		Radiator	Solid	Metal	0
1073	1927 Bldg	169	XRF	2/21/97	2	Room	210	Wall	Baseboar	Solid	Wood	0.03
1074	1927 Bldg	170	XRF	2/21/97	2	Room	210	Chair Rail		Solid	Wood	0
1075	1927 Bldg	171	XRF	2/21/97	2	Room	210	Wall	Midle Wall	Solid	Drywall	0
1076	1927 Bldg	172	XRF	2/21/97	2	Room	210	Wall	Baseboar	Solid	Wood	0
1077	1927 Bldg	173	XRF	2/21/97	2	Room	210	Bulletin	Board	Cracked	Wood	0
1078	1927 Bldg	174	XRF	2/21/97	2	Room	210	Wall	Wall	Solid	Plaster	5.09
1079	1927 Bldg	175	XRF	2/21/97	2	Room	210	Wall	Midle Wall	Solid	Plaster	4.25
1080	1927 Bldg	176	XRF	2/21/97	2	Room	210	Door	Door	Cracked	Wood	0.02
1081	1927 Bldg	177	XRF	2/21/97	2	Room	210	Door	Casing	Cracked	Wood	0.03
1082	1927 Bldg	89	XRF	2/22/97	2	Room	222	Wall	Wall	Cracked	Plaster	5.09
1083	1927 Bldg	90	XRF	2/22/97	2	Room	222	Wall	Wall	Cracked	Plaster	0.08
1084	1927 Bldg	91	XRF	2/22/97	2	Room	222	Coat Rack		Solid	Wood	0.21
1085	1927 Bldg	92	XRF	2/22/97	2	Room	222	Window	Casing	Solid	Wood	0.03
1086	1927 Bldg	93	XRF	2/22/97	2	Room	222	Wall	Wall	Solid	Metal	0
1087	1927 Bldg	94	XRF	2/22/97	2	Room	222		Radiator	Peeling	Metal	4.41
1088	1927 Bldg	95	XRF	2/22/97	2	Room	222	Door	Door	Cracked	Wood	0.02
1089	1927 Bldg	96	XRF	2/22/97	2	Room	222	Door	Casing	Solid	Wood	0.03
1090	1927 Bldg	97	XRF	2/22/97	2	Room	222	Wall	Baseboar	Solid	Wood	0.03
1091	1927 Bldg	98	XRF	2/22/97	2	Room	222	Floor		Solid	Wood	0.01
1092	1927 Bldg	99	XRF	2/22/97	2	Room	222	Wire Tray		Solid	Metal	0.04
1093	1927 Bldg	100	XRF	2/22/97	2	Room	222	Ceiling		Cracked	Plaster	0.05
1094	1927 Bldg	161	XRF	2/20/97	3	Room	300	Wall	Wall	Cracked	Plaster	5.09
1095	1927 Bldg	162	XRF	2/20/97	3	Room	300	Wall	Midle Wall	Peeling	Plaster	0
1096	1927 Bldg	163	XRF	2/20/97	3	Room	300	Window	Casing	Solid	Wood	0.04
1097	1927 Bldg	164	XRF	2/20/97	3	Room	300	Wall	Midle Wall	Solid	Metal	0
1098	1927 Bldg	165	XRF	2/20/97	3	Room	300	Wall	Chair rail	Solid	Wood	0.01
1099	1927 Bldg	166	XRF	2/20/97	3	Room	300	Wall	Baseboar	Solid	Wood	0
1100	1927 Bldg	167	XRF	2/20/97	3	Room	300	Floor		Solid	Wood	0.01
1101	1927 Bldg	169	XRF	2/20/97	3	Room	300		Radiator	Peeling	Metal	2.93
1102	1927 Bldg	170	XRF	2/20/97	3	Room	300	Closet	Wall	Peeling	Plaster	4.2
1103	1927 Bldg	171	XRF	2/20/97	3	Room	300	Closet	Wall	Peeling	Plaster	0.04
1104	1927 Bldg	172	XRF	2/20/97	3	Room	300	Closet	Casing	Solid	Wood	0.01
1105	1927 Bldg	173	XRF	2/20/97	3	Room	300	Bulletin	Board	Solid	Wood	0.02
1106	1927 Bldg	174	XRF	2/20/97	3	Room	300	Wire Tray		Solid	Metal	0.1
1107	1927 Bldg	175	XRF	2/20/97	3	Room	300	Wall	Wall	Cracked	Plaster	5.09
1108	1927 Bldg	176	XRF	2/20/97	3	Room	300	Wall	Wall Rgstr	Solid	Metal	5.09
1109	1927 Bldg	177	XRF	2/20/97	3	Room	300	Wall	Wall	Cracked	Plaster	0.05
1110	1927 Bldg	178	XRF	2/20/97	3	Room	300	Ceiling		Solid	Plaster	0.1
1111	1927 Bldg	179	XRF	2/20/97	3	Room	300	Wall	Crown mol	Solid	Wood	0.08
1112	1927 Bldg	109	XRF	2/21/97	3	Room	323	Wall	Wall	Solid	Plaster	0.06
1113	1927 Bldg	110	XRF	2/21/97	3	Room	323	Wall	Midle Wall	Cracked	Plaster	0.06
1114	1927 Bldg	111	XRF	2/21/97	3	Room	323	Wall	Wall	Cracked	Plaster	0.06
1115	1927 Bldg	112	XRF	2/21/97	3	Room	323	Ceiling		Solid	Plaster	0.06
1116	1927 Bldg	113	XRF	2/21/97	3	Room	323	Wall	Midle Wall	Solid	Metal	0
1117	1927 Bldg	114	XRF	2/21/97	3	Room	323	Window	Casing	Solid	Wood	0.01
1118	1927 Bldg	115	XRF	2/21/97	3	Room	323	Wall	Crown mol	Solid	Wood	0.02
1119	1927 Bldg	116	XRF	2/21/97	3	Room	323	Chair Rail		Solid	Wood	0.03
1120	1927 Bldg	117	XRF	2/21/97	3	Room	323		Radiator	Peeling	Metal	5.09
1121	1927 Bldg	118	XRF	2/21/97	3	Room	323	Mirror Casing		Cracked	Wood	0.16
1122	1927 Bldg	119	XRF	2/21/97	3	Room	323	Bulletin	Board	Solid	Wood	0.07

Saint Paul Public Schools
 Ramsey Junior High School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
1123	1927 Bldg	120	XRF	2/21/97	3	Room	323	Bulletin	Board	Solid	Wood	0.06
1124	1927 Bldg	121	XRF	2/21/97	3	Room	323	Wall	Baseboar	Solid	Concrete	0.13
1125	1927 Bldg	122	XRF	2/21/97	3	Room	323	Floor		Cracked	Concrete	0.03
1126	1927 Bldg	123	XRF	2/21/97	3	Room	323	Door	Door	Solid	Wood	0.02
1127	1927 Bldg	124	XRF	2/21/97	3	Room	323	Door	Casing	Solid	Wood	0.03
1128	1927 Bldg	218	XRF	2/21/97	2	Room	203A	Wall	Wall	Solid	Plaster	0.03
1129	1927 Bldg	219	XRF	2/21/97	2	Room	203A	Wall	Midle Wall	Solid	Drywall	0
1130	1927 Bldg	98	XRF	2/25/97	0	Room	3B	Wall	Wall	Solid	Concrete	0
1131	1927 Bldg	99	XRF	2/25/97	0	Room	3B	Door	Door	Solid	Metal	0.01
1132	1927 Bldg	100	XRF	2/25/97	0	Room	3B	Door	Casing	Solid	Metal	0.02
1133	1927 Bldg	70	XRF	2/24/97	1	Room	A	Wall	Wall	Solid	Plaster	4.14
1134	1927 Bldg	71	XRF	2/24/97	1	Room	A	Wall	Wall	Solid	Plaster	5.09
1135	1927 Bldg	72	XRF	2/24/97	1	Room	A	Wall	Midle Wall	Solid	Wood	0.05
1136	1927 Bldg	73	XRF	2/24/97	1	Room	A	Door	Door	Solid	Wood	0.03
1137	1927 Bldg	74	XRF	2/24/97	1	Room	A	Door	Casing	Solid	Wood	0.03
1138	1927 Bldg	75	XRF	2/24/97	1	Room	A	Floor		Cracked	Concrete	0.01
1139	1927 Bldg	76	XRF	2/24/97	1	Room	A	Ceiling		Peeling	Plaster	0.06
1140	1927 Bldg	77	XRF	2/24/97	1	Room	B	Wall	Midle Wall	Solid	Concrete	0.01
1141	1927 Bldg	78	XRF	2/24/97	1	Room	B	Window	Casing	Solid	Wood	0.01
1142	1927 Bldg	79	XRF	2/24/97	1	Room	B	Wall	Baseboar	Solid	Wood	0.01
1143	1927 Bldg	80	XRF	2/24/97	1	Room	B	Wall	Midle Wall	Cracked	Plaster	0.51
1144	1927 Bldg	81	XRF	2/24/97	1	Room	B	Door	Door	Cracked	Wood	0
1145	1927 Bldg	82	XRF	2/24/97	1	Room	B	Door	Casing	Cracked	Wood	0.01
1146	1927 Bldg	83	XRF	2/24/97	1	Room	B	Wall	Wall	Solid	Concrete	0.18
1147	1927 Bldg	84	XRF	2/24/97	1	Room	C	Wall	Midle Wall	Solid	Plaster	0.2
1148	1927 Bldg	85	XRF	2/24/97	1	Room	C	Wall	Baseboar	Solid	Wood	0.03
1149	1927 Bldg	86	XRF	2/24/97	1	Room	C	Window	Casing	Solid	Wood	0.01
1150	1927 Bldg	87	XRF	2/24/97	1	Room	C	Cabinet	Door	Cracked	Wood	0
1151	1927 Bldg	88	XRF	2/24/97	1	Room	C	Door	Door	Cracked	Wood	0.01
1152	1927 Bldg	89	XRF	2/24/97	1	Room	C	Door	Casing	Cracked	Wood	0.02
1153	1927 Bldg	90	XRF	2/24/97	1	Room	C	Wall	Midle Wall	Solid	Concrete	0.05
1154	1927 Bldg	91	XRF	2/24/97	1	Room	D	Wall	Baseboar	Solid	Wood	0.01
1155	1927 Bldg	92	XRF	2/24/97	1	Room	D	Door	Casing	Solid	Wood	0.01
1156	1927 Bldg	93	XRF	2/24/97	1	Room	D	Wall	Wall	Cracked	Plaster	0.08
1157	1927 Bldg	94	XRF	2/24/97	1	Room	D	Door	Door	Cracked	Wood	0.01
1158	1927 Bldg	95	XRF	2/24/97	1	Room	D	Door	Casing	Cracked	Wood	0
1159	1927 Bldg	96	XRF	2/24/97	1	Room	D	Wall	Midle Wall	Solid	Concrete	0.03
1160	1927 Bldg	97	XRF	2/24/97	1	Room	E	Wall	Baseboar	Solid	Wood	0
1161	1927 Bldg	98	XRF	2/24/97	1	Room	E	Wall	Wall	Solid	Plaster	0.23
1162	1927 Bldg	99	XRF	2/24/97	1	Room	E	Window	Casing	Solid	Wood	0.01
1163	1927 Bldg	100	XRF	2/24/97	1	Room	E	Wall	Wall	Solid	Plaster	0.08
1164	1927 Bldg	101	XRF	2/24/97	1	Room	E	Door	Door	Cracked	Wood	0
1165	1927 Bldg	102	XRF	2/24/97	1	Room	E	Door	Casing	Solid	Wood	0.01
1166	1927 Bldg	103	XRF	2/24/97	1	Room	E	Wall	Midle Wall	Solid	Concrete	0.01
1167	1927 Bldg	105	XRF	2/24/97	1	Room	F	Wall	Midle Wall	Solid	Concrete	0.05
1168	1927 Bldg	106	XRF	2/24/97	1	Room	F	Wall	Midle Wall	Solid	Plaster	0.06
1169	1927 Bldg	107	XRF	2/24/97	1	Room	F	Wall	Baseboar	Solid	Wood	0.02
1170	1927 Bldg	108	XRF	2/24/97	1	Room	F	Bulletin	Board	Solid	Wood	0.02
1171	1927 Bldg	109	XRF	2/24/97	1	Room	F	Bookcase	Shelf	Solid	Wood	0
1172	1927 Bldg	110	XRF	2/24/97	1	Room	F	Door	Door	Cracked	Wood	0.01
1173	1927 Bldg	111	XRF	2/24/97	1	Room	F	Door	Casing	Cracked	Wood	0
1174	1927 Bldg	112	XRF	2/24/97	1	Room	F	Ceiling		Solid	Plaster	0.01
1175	1927 Bldg	118	XRF	2/28/97	1	Stage	1	Wall	Wall	Solid	Concrete	0.08
1176	1927 Bldg	119	XRF	2/28/97	1	Stage	1	Door	Door	Solid	Wood	0
1177	1927 Bldg	120	XRF	2/28/97	1	Stage	1	Door	Casing	Solid	Metal	0.21
1178	1927 Bldg	121	XRF	2/28/97	1	Stage	1	Stairs	Tread	Solid	Wood	0
1179	1927 Bldg	122	XRF	2/28/97	1	Stage	1	Stairs	Baluster	Solid	Metal	0.08
1180	1927 Bldg	123	XRF	2/28/97	1	Stage	1	Floor		Solid	Wood	0
1181	1927 Bldg	124	XRF	2/28/97	1	Stage	1	Wall	Wall Rgstr	Solid	Metal	0.05

Saint Paul Public Schools
 Ramsey Junior High School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
1182	1927 Bldg	125	XRF	2/28/97	1	Stage	1	Door	Door	Solid	Metal	0.22
1183	1927 Bldg	126	XRF	2/28/97	1	Stage	1	Door	Casing	Solid	Metal	0.12
1184	1927 Bldg	127	XRF	2/28/97	1	Stage	1	Ceiling		Solid	Plaster	0.11
1185	1927 Bldg	128	XRF	2/28/97	1	Stage	1	Hatch		Solid	Metal	0.01
1186	1927 Bldg	77	XRF	2/20/97	3	Stairwell	1	Wall	Wall	Cracked	Plaster	5.09
1187	1927 Bldg	78	XRF	2/20/97	3	Stairwell	1	Wall	Wall	Cracked	Plaster	0.08
1188	1927 Bldg	79	XRF	2/20/97	3	Stairwell	1	Wall	Baseboar	Cracked	Wood	0.09
1189	1927 Bldg	80	XRF	2/20/97	3	Stairwell	1	Floor	Baseboar	Cracked	Wood	0.01
1190	1927 Bldg	81	XRF	2/20/97	3	Stairwell	1	Door	Door	Solid	Metal	0
1191	1927 Bldg	82	XRF	2/20/97	3	Stairwell	1	Door	Casing	Solid	Metal	0
1192	1927 Bldg	83	XRF	2/20/97	3	Stairwell	1	Door	Door	Cracked	Metal	0.01
1193	1927 Bldg	84	XRF	2/20/97	3	Stairwell	1	Door	Casing	Cracked	Metal	0.05
1194	1927 Bldg	85	XRF	2/20/97	3	Stairwell	1	Door	Casing	Cracked	Wood	0.02
1195	1927 Bldg	86	XRF	2/20/97	3	Stairwell	1	Door	Door	Cracked	Wood	0.02
1196	1927 Bldg	87	XRF	2/20/97	3	Stairwell	1	Stairs	Baseboar	Solid	Metal	4.35
1197	1927 Bldg	88	XRF	2/20/97	3	Stairwell	1	Stairs	Baseboar	Solid		5.09
1198	1927 Bldg	89	XRF	2/20/97	3	Stairwell	1	Stairs	Tread	Cracked	Metal	5.09
1199	1927 Bldg	90	XRF	2/20/97	3	Stairwell	1	Stairs	Hand rail	Cracked	Metal	4.42
1200	1927 Bldg	91	XRF	2/20/97	4	Stairwell	1	Door	Door	Cracked	Metal	3.4
1201	1927 Bldg	92	XRF	2/20/97	4	Stairwell	1	Door	Jamb	Cracked	Metal	3.44
1202	1927 Bldg	98	XRF	2/20/97	3	Stairwell	1	Ceiling		Cracked	Plaster	0.07
1203	1927 Bldg	135	XRF	2/21/97	3	Stairwell	1	Closet	Wall	Cracked	Plaster	0.01
1204	1927 Bldg	136	XRF	2/21/97	3	Stairwell	1	Closet	Elec Pane	Solid	Metal	0
1205	1927 Bldg	95	XRF	2/20/97	4	Stairwell	2	Stairs	Hand rail	Chalking		5.09
1206	1927 Bldg	96	XRF	2/20/97	4	Stairwell	2	Window	Casing	Chalking	Metal	0.08
1207	1927 Bldg	97	XRF	2/20/97	4	Stairwell	2	Floor		Cracked	Concrete	0.09
1208	1927 Bldg	125	XRF	2/21/97	3	Stairwell	2	Wall	Wall	Cracked	Plaster	0.04
1209	1927 Bldg	126	XRF	2/21/97	3	Stairwell	2	Wall	Wall	Cracked	Plaster	0.06
1210	1927 Bldg	127	XRF	2/21/97	3	Stairwell	2	Wall	Chair rail	Solid	Wood	0.01
1211	1927 Bldg	128	XRF	2/21/97	3	Stairwell	2	Stairs	Rail cap	Cracked	Plaster	0.04
1212	1927 Bldg	129	XRF	2/21/97	3	Stairwell	2		Radiator	Cracked	Metal	3.33
1213	1927 Bldg	130	XRF	2/21/97	3	Stairwell	2	Window	Casing	Solid	Wood	0.01
1214	1927 Bldg	131	XRF	2/21/97	3	Stairwell	2	Stairs	Hand rail	Cracked	Wood	0.01
1215	1927 Bldg	132	XRF	2/21/97	3	Stairwell	2	Stairs	Baseboar	Cracked	Concrete	0.03
1216	1927 Bldg	133	XRF	2/21/97	3	Stairwell	2	Wall	Midle Wall	Cracked	Metal	0
1217	1927 Bldg	134	XRF	2/21/97	3	Stairwell	2	Ceiling		Solid	Plaster	0.02
1218	1927 Bldg	74	XRF	2/28/97	1	Stairwell	2	Stairs	Baluster	Cracked	Metal	0.11
1219	1927 Bldg	75	XRF	2/28/97	1	Stairwell	2	Stairs	Stringer	Solid	Metal	0.06
1220	1927 Bldg	76	XRF	2/28/97	1	Stairwell	2	Floor		Cracked	Concrete	0.02
1221	1927 Bldg	77	XRF	2/28/97	1	Stairwell	2		Elec Pane	Solid	Metal	0.08
1222	1927 Bldg	78	XRF	2/28/97	1	Stairwell	2	Door	Door	Cracked	Metal	0.19
1223	1927 Bldg	79	XRF	2/28/97	1	Stairwell	2	Door	Casing	Cracked	Metal	0.38
1224	1927 Bldg	138	XRF	2/21/97	2	Stairwell	3	Wall	Wall	Cracked	Plaster	4.46
1225	1927 Bldg	139	XRF	2/21/97	2	Stairwell	3	Wall	Wall	Cracked	Plaster	0.01
1226	1927 Bldg	140	XRF	2/21/97	2	Stairwell	3		Radiator	Cracked	Metal	4.12
1227	1927 Bldg	141	XRF	2/21/97	2	Stairwell	3	Wall	Chair rail	Solid	Wood	0.01
1228	1927 Bldg	142	XRF	2/21/97	2	Stairwell	3	Stairs	Baseboar	Cracked	Concrete	0.02
1229	1927 Bldg	143	XRF	2/21/97	2	Stairwell	3	Window	Casing	Solid	Wood	0.03
1230	1927 Bldg	144	XRF	2/21/97	2	Stairwell	3	Stairs	Hand rail	Cracked	Wood	0.02
1231	1927 Bldg	145	XRF	2/21/97	2	Stairwell	3	Stairs	Rail cap	Cracked	Plaster	0.46
1232	1927 Bldg	146	XRF	2/21/97	2	Stairwell	3	Ceiling		0 Solid	Plaster	1.94
1233	1927 Bldg	147	XRF	2/21/97	2	Stairwell	3		Radiator	Solid	Metal	0.02
1234	1927 Bldg	148	XRF	2/21/97	2	Stairwell	3	Door	Door	Cracked	Wood	0
1235	1927 Bldg	149	XRF	2/21/97	2	Stairwell	3	Door	Jamb	Cracked	Metal	0
1236	1927 Bldg	150	XRF	2/21/97	2	Stairwell	3	Door	Casing	Solid	Wood	0.04
1237	1927 Bldg	151	XRF	2/21/97	2	Stairwell	3	Wall	Crown mol	Solid	Wood	0.02
1238	1927 Bldg	162	XRF	2/24/97	1	Stairwell	4	Wall	Wall	Solid	Plaster	5.09
1239	1927 Bldg	163	XRF	2/24/97	1	Stairwell	4	Wall	Wall	Solid	Plaster	5.09
1240	1927 Bldg	164	XRF	2/24/97	1	Stairwell	4	Chair Rail		Solid	Wood	0.02

Saint Paul Public Schools
 Ramsey Junior High School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
1241	1927 Bldg	165	XRF	2/24/97	1	Stairwell	4	Wall	Baseboar	Solid	Concrte	0.48
1242	1927 Bldg	166	XRF	2/24/97	1	Stairwell	4	Stairs	Tread	Cracked	Concrte	0.07
1243	1927 Bldg	167	XRF	2/24/97	1	Stairwell	4	Stairs	Hand rail	Cracked	Wood	0.05
1244	1927 Bldg	168	XRF	2/24/97	1	Stairwell	4	Door	Door	Cracked	Wood	0.01
1245	1927 Bldg	169	XRF	2/24/97	1	Stairwell	4	Door	Casing	Solid	Wood	0.01
1246	1927 Bldg	170	XRF	2/24/97	1	Stairwell	4	Ceiling		Cracked	Plaster	0.15
1247	1927 Bldg	171	XRF	2/24/97	0	Stairwell	4	Wall	Midle Wall	Solid	Concrte	0
1248	1927 Bldg	172	XRF	2/24/97	0	Stairwell	4	Elec Pane	Solid	Metal	0.03	
1249	1927 Bldg	173	XRF	2/24/97	0	Stairwell	4	Door	Door	Solid	Metal	0
1250	1927 Bldg	174	XRF	2/24/97	0	Stairwell	4	Door	Casing	Solid	Metal	0
1251	1927 Bldg	175	XRF	2/24/97	0	Stairwell	4	Ceiling		Solid	Drywall	0.04
1252	1927 Bldg	176	XRF	2/24/97	0	Stairwell	4	Hatch		Solid	Metal	0.21
1253	1927 Bldg	177	XRF	2/24/97	0	Stairwell	5	Ceiling		Solid	Plaster	5.09
1254	1927 Bldg	178	XRF	2/24/97	0	Stairwell	5	Wall	Wall	Cracked	Plaster	5.09
1255	1927 Bldg	179	XRF	2/24/97	0	Stairwell	5	Wall	Wall	Cracked	Plaster	0
1256	1927 Bldg	180	XRF	2/24/97	0	Stairwell	5	Chair Rail		Solid	Wood	0.03
1257	1927 Bldg	181	XRF	2/24/97	0	Stairwell	5	Stairs	Hand rail	Solid	Wood	0.01
1258	1927 Bldg	182	XRF	2/24/97	0	Stairwell	5	Stairs	Baseboar	Solid	Concrte	0.13
1259	1927 Bldg	183	XRF	2/24/97	1	Stairwell	5	Stairs	Tread	Cracked	Concrte	0.02
1260	1927 Bldg	184	XRF	2/24/97	1	Stairwell	5	Door	Door	Solid	Wood	0.01
1261	1927 Bldg	185	XRF	2/24/97	1	Stairwell	5	Door	Casing	Solid	Wood	0.02
1262	1927 Bldg	186	XRF	2/24/97	0	Stairwell	5	Wall	Midle Wall	Solid	Concrte	0
1263	1927 Bldg	187	XRF	2/24/97	0	Stairwell	5	Door	Door	Solid	Wood	0
1264	1927 Bldg	188	XRF	2/24/97	0	Stairwell	5	Door	Casing	Cracked	Metal	0
1265	1927 Bldg	189	XRF	2/24/97	0	Stairwell	5	Ceiling		Solid	Drywall	0
1266	1927 Bldg	83	XRF	2/25/97	0	Stairwell	6	Stairs	Wall	Solid	Concrte	0.04
1267	1927 Bldg	84	XRF	2/25/97	0	Stairwell	6	Stairs	Wall	Cracked	Drywall	0
1268	1927 Bldg	85	XRF	2/25/97	0	Stairwell	6	Stairs	Tread	Cracked		0.05
1269	1927 Bldg	86	XRF	2/25/97	0	Stairwell	6	Door	Door	Cracked	Metal	5.09
1270	1927 Bldg	87	XRF	2/25/97	0	Stairwell	6	Door	Casing	Cracked	Metal	0.27
1271	1927 Bldg	88	XRF	2/25/97	0	Stairwell	6	Door	Door	Cracked	Metal	5.09
1272	1927 Bldg	89	XRF	2/25/97	0	Stairwell	6	Door	Casing	Cracked	Metal	0.25
1273	1927 Bldg	90	XRF	2/25/97	0	Stairwell	6	Closet	Wall	Cracked	Drywall	0.01
1274	1927 Bldg	91	XRF	2/25/97	0	Stairwell	6	Closet	Shelf	Cracked	Wood	0
1275	1927 Bldg	92	XRF	2/25/97	0	Stairwell	6	Closet	Casing	Solid	Wood	0
1276	1927 Bldg	93	XRF	2/25/97	0	Stairwell	6	Closet	Floor	Cracked	Wood	0.01
1277	1927 Bldg	115	XRF	2/25/97	0	Stairwell	7	Closet	Casing	Cracked	Plaster	0.14
1278	1927 Bldg	116	XRF	2/25/97	0	Stairwell	7	Wall	Wall	Cracked	Plaster	5.09
1279	1927 Bldg	117	XRF	2/25/97	0	Stairwell	7	Wall	Midle Wall	Solid	Concrte	0
1280	1927 Bldg	118	XRF	2/25/97	0	Stairwell	7	Door	Casing	Solid	Metal	0
1281	1927 Bldg	119	XRF	2/25/97	0	Stairwell	7	Door	Door	Cracked	Metal	0
1282	1927 Bldg	120	XRF	2/25/97	0	Stairwell	7	Ceiling		Solid	Drywall	0
1283	1927 Bldg	121	XRF	2/25/97	0	Stairwell	7	Stairs	Hand rail	Cracked	Metal	0
1284	1927 Bldg	122	XRF	2/25/97	0	Stairwell	7	Stairs	Wall	Solid	Concrte	0
1285	1927 Bldg	123	XRF	2/25/97	0	Stairwell	7	Door	Door	Cracked	Metal	0.01
1286	1927 Bldg	124	XRF	2/25/97	0	Stairwell	7	Door	Casing	Cracked	Metal	0.02
1287	1927 Bldg	125	XRF	2/25/97	0	Stairwell	8	Door	Door	Peeling	Metal	5.09
1288	1927 Bldg	126	XRF	2/25/97	0	Stairwell	8	Door	Casing	Cracked	Metal	5.09
1289	1927 Bldg	127	XRF	2/25/97	0	Stairwell	8	Wall	Wall	Cracked	Plaster	5.09
1290	1927 Bldg	128	XRF	2/25/97	0	Stairwell	8	Wall	Wall	Cracked	Plaster	0.06
1291	1927 Bldg	129	XRF	2/25/97	0	Stairwell	8	Ceiling		Solid	Plaster	0.09
1292	1927 Bldg	130	XRF	2/25/97	0	Stairwell	8	Chair Rail		Solid	Wood	0.02
1293	1927 Bldg	131	XRF	2/25/97	0	Stairwell	8	Stairs	Hand rail	Solid	Wood	0
1294	1927 Bldg	132	XRF	2/25/97	0	Stairwell	8	Stairs	Tread	Peeling	Concrte	0.02
1295	1927 Bldg	133	XRF	2/25/97	0	Stairwell	8	Stairs	Baseboar	Peeling	Concrte	0.09
1296	1927 Bldg	142	XRF	2/25/97	0	Stairwell	9	Wall	Wall	Cracked	Plaster	0.58
1297	1927 Bldg	143	XRF	2/25/97	0	Stairwell	9	Wall	Wall	Peeling	Plaster	0.19
1298	1927 Bldg	144	XRF	2/25/97	0	Stairwell	9	Door	Door	Solid	Metal	0.19
1299	1927 Bldg	145	XRF	2/25/97	0	Stairwell	9	Door	Casing	Solid	Wood	0.19

Saint Paul Public Schools
 Ramsey Junior High School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
1300	1927 Bldg	146	XRF	2/25/97	0	Stairwell	9	Chair Rail		Cracked	Wood	0.03
1301	1927 Bldg	147	XRF	2/25/97	0	Stairwell	9	Stairs	Baseboar	Solid	Concrete	0.1
1302	1927 Bldg	148	XRF	2/25/97	0	Stairwell	9	Stairs	Hand rail	Solid	Wood	0.02
1303	1927 Bldg	149	XRF	2/25/97	0	Stairwell	9	Ceiling		Solid	Plaster	0.02
1304	1927 Bldg	150	XRF	2/25/97	0	Stairwell	9	Door	Door	Cracked	Wood	0.02
1305	1927 Bldg	151	XRF	2/25/97	0	Stairwell	9	Door	Casing	Cracked	Metal	5.09
1306	1965 Bldg	62	XRF	2/22/97	2	Classroo	201	Wall	Wall	Cracked	Plaster	0.01
1307	1965 Bldg	63	XRF	2/22/97	2	Classroo	201	Wall	Wall	Cracked	Plaster	0.08
1308	1965 Bldg	64	XRF	2/22/97	2	Classroo	201	Wall	Midle Wall	Cracked	Plaster	0.12
1309	1965 Bldg	65	XRF	2/22/97	2	Classroo	201	Wall	Wall	Cracked	Plaster	0.09
1310	1965 Bldg	66	XRF	2/22/97	2	Classroo	201	Ceiling	Wall	Solid	Plaster	0.04
1311	1965 Bldg	67	XRF	2/22/97	2	Classroo	201	Wall	Wall Rgstr	Solid	Metal	2.35
1312	1965 Bldg	68	XRF	2/22/97	2	Classroo	201	Wall	Crown mol	Solid	Wood	0.01
1313	1965 Bldg	69	XRF	2/22/97	2	Classroo	201	Wire Tray	Midle Wall	Solid	Metal	0.04
1314	1965 Bldg	70	XRF	2/22/97	2	Classroo	201	Cabinet	Door	Solid	Wood	0.02
1315	1965 Bldg	71	XRF	2/22/97	2	Classroo	201	Cabinet	Inside	Solid	Wood	0.04
1316	1965 Bldg	72	XRF	2/22/97	2	Classroo	201	Wall	Wall	Solid	Metal	0
1317	1965 Bldg	73	XRF	2/22/97	2	Classroo	201	Window	Casing	Solid	Wood	0.02
1318	1965 Bldg	74	XRF	2/22/97	2	Classroo	201		Radiator	Peeling	Metal	3.52
1319	1965 Bldg	75	XRF	2/22/97	2	Classroo	201	Wall	Baseboar	Solid	Wood	0.02
1320	1965 Bldg	76	XRF	2/22/97	2	Classroo	201	Floor		Solid	Wood	0
1321	1965 Bldg	77	XRF	2/22/97	2	Classroo	201	TV Mount	Board	Solid	Wood	0
1322	1965 Bldg	78	XRF	2/22/97	2	Classroo	201	Bulletin	Board	Cracked	Wood	0.02
1323	1965 Bldg	79	XRF	2/22/97	2	Classroo	201	Door	Door	Cracked	Wood	0.03
1324	1965 Bldg	80	XRF	2/22/97	2	Classroo	201	Door	Casing	Cracked	Wood	0.02
1325	1965 Bldg	81	XRF	2/22/97	2	Classroo	201	Wall	Chair rail	Solid	Wood	0.01
1326	1965 Bldg	82	XRF	2/22/97	2	Classroo	201	Wall	Wall	Cracked	Plaster	3.54
1327	1965 Bldg	83	XRF	2/22/97	2	Classroo	201	Closet	Wall	Peeling	Plaster	5.09
1328	1965 Bldg	84	XRF	2/22/97	2	Classroo	201	Closet	Wall	Peeling		0.1
1329	1965 Bldg	85	XRF	2/22/97	2	Classroo	201	Closet	Baseboar	Solid	Wood	0.03
1330	1965 Bldg	86	XRF	2/22/97	2	Classroo	201	Closet	Shelf	Solid	Wood	0.02
1331	1965 Bldg	87	XRF	2/22/97	2	Classroo	201	Closet	Casing	Solid	Wood	0.01
1332	1965 Bldg	6	XRF	2/28/97	2	Classroo	204	Wall	Midle Wall	Solid	Concrete	0.07
1333	1965 Bldg	7	XRF	2/28/97	2	Classroo	204	Chalk Board		Solid	Wood	0
1334	1965 Bldg	8	XRF	2/28/97	2	Classroo	204		Column	Solid	Plaster	0.12
1335	1965 Bldg	9	XRF	2/28/97	2	Classroo	204	Wall	Wall	Solid	Plaster	0.66
1336	1965 Bldg	10	XRF	2/28/97	2	Classroo	204	Door	Door	Cracked	Metal	0.42
1337	1965 Bldg	11	XRF	2/28/97	2	Classroo	204	Door	Casing	Cracked	Metal	0.24
1338	1965 Bldg	12	XRF	2/28/97	2	Classroo	204	Door	Door	Cracked	Wood	0
1339	1965 Bldg	13	XRF	2/28/97	2	Classroo	204	Door	Casing	Cracked	Metal	0.26
1340	1965 Bldg	14	XRF	2/28/97	2	Classroo	204	Wall	Wall	Solid	Metal	0
1341	1965 Bldg	15	XRF	2/28/97	2	Classroo	204	Wall	Wall	Solid	Wood	0.12
1342	1965 Bldg	16	XRF	2/28/97	2	Classroo	204	Window	Casing	Solid	Metal	0.42
1343	1965 Bldg	17	XRF	2/28/97	2	Classroo	204	Cabinet	Door	Solid	Metal	0
1344	1965 Bldg	18	XRF	2/28/97	2	Classroo	204	Ceiling		Solid	Plaster	0.07
1345	1965 Bldg	187	XRF	2/25/97	2	Classroo	205	Wall	Wall	Solid	Concrete	0.08
1346	1965 Bldg	188	XRF	2/25/97	2	Classroo	205	Wall	Midle Wall	Solid	Drywall	0
1347	1965 Bldg	189	XRF	2/25/97	2	Classroo	205	TV Mount	Board	Solid	Wood	0
1348	1965 Bldg	190	XRF	2/25/97	2	Classroo	205	Door	Door	Solid	Wood	0
1349	1965 Bldg	191	XRF	2/25/97	2	Classroo	205	Closet	Wall	Solid	Concrete	0.04
1350	1965 Bldg	192	XRF	2/25/97	2	Classroo	205	Closet	Casing	Cracked	Metal	0.19
1351	1965 Bldg	193	XRF	2/25/97	2	Classroo	205	Ceiling		Solid	Plaster	0.06
1352	1965 Bldg	194	XRF	2/25/97	2	Classroo	205	Wall	Wall	Solid	Plaster	0.06
1353	1965 Bldg	195	XRF	2/25/97	2	Classroo	205	Cabinet	Door	Solid	Wood	0
1354	1965 Bldg	196	XRF	2/25/97	2	Classroo	205	Bulletin	Board	Solid	Wood	0
1355	1965 Bldg	197	XRF	2/25/97	2	Classroo	205	Window	Casing	Solid	Metal	0.38
1356	1965 Bldg	198	XRF	2/25/97	2	Classroo	205	Ceiling		Solid	Plaster	0.08
1357	1965 Bldg	199	XRF	2/25/97	2	Classroo	205	Door	Door	Cracked	Wood	0.01
1358	1965 Bldg	200	XRF	2/25/97	2	Classroo	205	Door	Casing	Cracked	Metal	0.28

Saint Paul Public Schools
 Ramsey Junior High School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
1359	1965 Bldg	201	XRF	2/25/97	2	Classroo	205		Elec Pane	Solid	Metal	0.05
1360	1965 Bldg	168	XRF	2/25/97	2	Classroo	206	Door	Casing	Solid	Concrte	0.06
1361	1965 Bldg	169	XRF	2/25/97	2	Classroo	206	Wall	Wall	Solid	Plaster	0.09
1362	1965 Bldg	170	XRF	2/25/97	2	Classroo	206	Wire Tray		Solid	Metal	0.05
1363	1965 Bldg	171	XRF	2/25/97	2	Classroo	206	Cabinet	Door	Solid	Wood	0
1364	1965 Bldg	172	XRF	2/25/97	2	Classroo	206	Wall	Wall Rgstr	Solid	Metal	0.02
1365	1965 Bldg	173	XRF	2/25/97	2	Classroo	206	Wall	Midle Wall	Solid	Concrte	0
1366	1965 Bldg	174	XRF	2/25/97	2	Classroo	206	Bookcase	Shelf	Cracked	Wood	0
1367	1965 Bldg	175	XRF	2/25/97	2	Classroo	206	Door	Door	Cracked	Wood	0.01
1368	1965 Bldg	176	XRF	2/25/97	2	Classroo	206	Door	Casing	Cracked	Metal	0.34
1369	1965 Bldg	177	XRF	2/25/97	2	Classroo	206	Bulletin	Board	Solid	Wood	0
1370	1965 Bldg	178	XRF	2/25/97	2	Classroo	206	Door	Door	Solid	Wood	0
1371	1965 Bldg	28	XRF	2/28/97	2	Classroo	207	Wall	Midle Wall	Solid	Drywall	0.01
1372	1965 Bldg	29	XRF	2/28/97	2	Classroo	207		Radiator	Solid	Metal	0
1373	1965 Bldg	30	XRF	2/28/97	2	Classroo	207	TV Mount	Board	Solid	Wood	0
1374	1965 Bldg	31	XRF	2/28/97	2	Classroo	207		Column	Cracked	Concrte	0.01
1375	1965 Bldg	32	XRF	2/28/97	2	Classroo	207	Door	Door	Solid	Wood	0.01
1376	1965 Bldg	33	XRF	2/28/97	2	Classroo	207	Door	Casing	Solid	Metal	0.01
1377	1965 Bldg	34	XRF	2/28/97	2	Classroo	208	Door	Door	Solid	Wood	0
1378	1965 Bldg	35	XRF	2/28/97	2	Classroo	208	Door	Casing	Solid	Metal	0.02
1379	1965 Bldg	36	XRF	2/28/97	2	Classroo	208	Wall	Wall	Solid	Drywall	0.06
1380	1965 Bldg	37	XRF	2/28/97	2	Classroo	208	Wall	Wall	Cracked	Concrte	0
1381	1965 Bldg	38	XRF	2/28/97	2	Classroo	208	Ceiling		Solid	Drywall	0
1382	1965 Bldg	39	XRF	2/28/97	2	Classroo	208		Radiator	Solid	Metal	0
1383	1965 Bldg	40	XRF	2/28/97	2	Classroo	208	TV Mount	Board	Solid	Wood	0
1384	1965 Bldg	202	XRF	2/25/97	2	Hall	1		Elec Pane	Solid	Concrte	0.07
1385	1965 Bldg	203	XRF	2/25/97	2	Hall	1		Radiator	Solid	Metal	0.07
1386	1965 Bldg	204	XRF	2/25/97	2	Hall	1	Door	Door	Cracked	Metal	0.21
1387	1965 Bldg	205	XRF	2/25/97	2	Hall	1	Door	Casing	Cracked	Metal	0.3
1388	1965 Bldg	206	XRF	2/25/97	2	Hall	1	Wall	Wall	Solid	Wood	0.27
1389	1965 Bldg	207	XRF	2/25/97	2	Hall	1	Wall	Wall	Solid	Wood	0.07
1390	1965 Bldg	208	XRF	2/25/97	2	Hall	1	Wall	Wall Rgstr	Solid	Metal	0.02
1391	1965 Bldg	209	XRF	2/25/97	2	Hall	1	Door	Door	Solid	Metal	0
1392	1965 Bldg	210	XRF	2/25/97	2	Hall	1	Door	Casing	Solid	Metal	0.06
1393	1965 Bldg	211	XRF	2/25/97	2	Hall	1	Ceiling		Solid	Plaster	0.02
1394	1965 Bldg	19	XRF	2/28/97	2	Hall	1	Closet	Wall	Solid	Drywall	0
1395	1965 Bldg	20	XRF	2/28/97	2	Hall	1	Closet	Column	Solid	Concrete	0
1396	1965 Bldg	21	XRF	2/28/97	2	Hall	1	Door	Casing	Solid	Metal	0
1397	1965 Bldg	74	XRF	2/21/97	3	Hall	3	Wall	Wall	Cracked	Plaster	5.09
1398	1965 Bldg	57	XRF	2/22/97	2	Restroom	6	Wall	Wall Rgstr	Cracked	Metal	0.07
1399	1965 Bldg	58	XRF	2/22/97	2	Restroom	6	Door	Door	Cracked	Wood	0.02
1400	1965 Bldg	59	XRF	2/22/97	2	Restroom	6	Door	Casing	Cracked	Wood	0.01
1401	1965 Bldg	60	XRF	2/22/97	2	Restroom	6	Wall	Wall	Solid	Metal	0
1402	1965 Bldg	61	XRF	2/22/97	2	Restroom	6	Ceiling		Solid	Plaster	5.09
1403	1965 Bldg	179	XRF	2/25/97	2	Room	1	Wall	Wall	Solid	Concrte	0.08
1404	1965 Bldg	180	XRF	2/25/97	2	Room	1	Cabinet	Door	Solid	Wood	0
1405	1965 Bldg	181	XRF	2/25/97	2	Room	1	Ceiling		Solid	Plaster	0.03
1406	1965 Bldg	182	XRF	2/25/97	2	Room	1	Door	Door	Solid	Wood	0
1407	1965 Bldg	183	XRF	2/25/97	2	Room	1	Door	Casing	Solid	Metal	0.01
1408	1965 Bldg	184	XRF	2/25/97	2	Room	1	Wall	Midle Wall	Solid	Drywall	0.01
1409	1965 Bldg	185	XRF	2/25/97	2	Room	1	TV Mount	Board	Solid	Wood	0
1410	1965 Bldg	186	XRF	2/25/97	2	Room	1	Wall	Wall	Solid	Plaster	0.14
1411	1965 Bldg	22	XRF	2/28/97	2	Room	2	Floor		Cracked	Concrte	0.01
1412	1965 Bldg	23	XRF	2/28/97	2	Room	2	Ceiling		Solid	Plaster	0.14
1413	1965 Bldg	24	XRF	2/28/97	2	Room	3	Wall	Wall	Solid	Drywall	0.04
1414	1965 Bldg	25	XRF	2/28/97	2	Room	3	Wall	Column	Solid	Concrete	0
1415	1965 Bldg	26	XRF	2/28/97	2	Room	3	Door	Door	Solid	Wood	0
1416	1965 Bldg	27	XRF	2/28/97	2	Room	3	Door	Casing	Solid	Metal	0.03
1417	1965 Bldg	55	XRF	2/21/97	3	Room	4	Wall	Baseboar	Solid	Wood	0.03

Saint Paul Public Schools
 Ramsey Junior High School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
1418	1965 Bldg	56	XRF	2/21/97	3	Room	4	Floor		Solid	Wood	0.01
1419	1965 Bldg	57	XRF	2/21/97	3	Room	4	Door	Door	Solid	Wood	0.03
1420	1965 Bldg	58	XRF	2/21/97	3	Room	4	Door	Casing	Solid	Wood	0.02
1421	1965 Bldg	59	XRF	2/21/97	3	Room	4	Cabinet	Door	Solid	Wood	0.02
1422	1965 Bldg	60	XRF	2/21/97	3	Room	4	Closet	Wall	Cracked	Plaster	5.09
1423	1965 Bldg	61	XRF	2/21/97	3	Room	4	Closet	Wall	Cracked	Plaster	0.05
1424	1965 Bldg	62	XRF	2/21/97	3	Room	4	Closet	Casing	Solid	Wood	0.02
1425	1965 Bldg	63	XRF	2/21/97	3	Room	4	Closet	Casing	Solid	Wood	0.02
1426	1965 Bldg	64	XRF	2/21/97	3	Room	4	Ceiling		Solid	Plaster	0.07
1427	1965 Bldg	41	XRF	2/28/97	2	Room	4	Wall	Midle Wall	Solid	Drywall	0
1428	1965 Bldg	42	XRF	2/28/97	2	Room	4		Column	Solid	Concrete	0
1429	1965 Bldg	43	XRF	2/28/97	2	Room	4	Hatch		Solid	Metal	0
1430	1965 Bldg	44	XRF	2/28/97	2	Room	4	Door	Door	Solid	Wood	0
1431	1965 Bldg	45	XRF	2/28/97	2	Room	4	Door	Casing	Solid	Metal	0.02
1432	1965 Bldg	65	XRF	2/21/97	3	Room	5	Wall	Midle Wall	Solid	Drywall	0
1433	1965 Bldg	66	XRF	2/21/97	3	Room	5	Door	Door	Solid	Metal	0.04
1434	1965 Bldg	67	XRF	2/21/97	3	Room	5	Door	Casing	Solid	Metal	0.01
1435	1965 Bldg	68	XRF	2/21/97	3	Room	5		Elec Pane	Solid	Metal	0
1436	1965 Bldg	69	XRF	2/21/97	3	Room	5	Stairs	Tread	Solid	Metal	0.01
1437	1965 Bldg	70	XRF	2/21/97	3	Room	5	Stairs	Hand rail	Solid	Metal	0
1438	1965 Bldg	71	XRF	2/21/97	3	Room	5		Midle Wall	Solid	Wood	0
1439	1965 Bldg	72	XRF	2/21/97	3	Room	5	Ceiling		Solid	Drywall	0
1440	1965 Bldg	46	XRF	2/28/97	2	Stairwell	1	Wall	Wall	Solid	Plaster	0.14
1441	1965 Bldg	47	XRF	2/28/97	2	Stairwell	1	Door	Door	Solid	Metal	0.27
1442	1965 Bldg	48	XRF	2/28/97	2	Stairwell	1	Door	Header	Solid	Metal	0.18
1443	1965 Bldg	49	XRF	2/28/97	2	Stairwell	1	Stairs	Baluster	Solid	Metal	0.11
1444	1965 Bldg	50	XRF	2/28/97	2	Stairwell	1	Stairs	Wall	Solid	Concrete	0.04
1445	1965 Bldg	51	XRF	2/28/97	2	Stairwell	1	Stairs	Baseboar	Solid	Metal	0.05
1446	1965 Bldg	52	XRF	2/28/97	2	Stairwell	1	Door	Header	Solid	Metal	0
1447	1965 Bldg	53	XRF	2/28/97	2	Stairwell	1	Ceiling		Solid	Plaster	0.14
1448	1965 Bldg	54	XRF	2/28/97	2	Stairwell	2	Wall	Wall	Solid	Concrete	0.05
1449	1965 Bldg	55	XRF	2/28/97	2	Stairwell	2	Fence		Solid	Metal	0.01
1450	1965 Bldg	56	XRF	2/28/97	2	Stairwell	2	Ceiling		Solid	Plaster	0.06
1451	1965 Bldg	57	XRF	2/28/97	2	Stairwell	2	Stairs	Tread	Cracked	Concrete	0.03
1452	1977 Bldg	194	XRF	2/24/97	0	Classroo	1	Door	Casing	Cracked	Metal	0
1453	1977 Bldg	195	XRF	2/24/97	0	Classroo	1	Bookcase	Shelf	Solid	Wood	0
1454	1977 Bldg	196	XRF	2/24/97	0	Classroo	1	Wall	Wall	Cracked	Plaster	0.17
1455	1977 Bldg	197	XRF	2/24/97	0	Classroo	1	Wire Tray		Solid	Metal	0.05
1456	1977 Bldg	198	XRF	2/24/97	0	Classroo	1	Floor		Cracked	Concrete	0.03
1457	1977 Bldg	199	XRF	2/24/97	0	Classroo	1		Locker	Cracked	Metal	0.82
1458	1977 Bldg	200	XRF	2/24/97	0	Classroo	1	Wall	Wall Rgstr	Solid	Metal	0
1459	1977 Bldg	201	XRF	2/24/97	0	Classroo	1	Ceiling	Column	Peeling	Plaster	0.27
1460	1977 Bldg	207	XRF	2/24/97	0	Classroo	2	Wall	Wall	Solid	Concrete	0.01
1461	1977 Bldg	208	XRF	2/24/97	0	Classroo	2		Column	Cracked	Plaster	0.07
1462	1977 Bldg	209	XRF	2/24/97	0	Classroo	2	TV Mount		Solid	Wood	0
1463	1977 Bldg	210	XRF	2/24/97	0	Classroo	2	Door	Door	Solid	Wood	0
1464	1977 Bldg	211	XRF	2/24/97	0	Classroo	2	Door	Casing	Cracked	Metal	0.01
1465	1977 Bldg	212	XRF	2/24/97	0	Classroo	2	Cabinet	Door	Solid	Wood	0
1466	1977 Bldg	213	XRF	2/24/97	0	Classroo	2	Ceiling		Cracked	Drywall	0.01
1467	1977 Bldg	218	XRF	2/24/97	0	Classroo	4	Wall	Wall	Solid	Concrete	0.01
1468	1977 Bldg	219	XRF	2/24/97	0	Classroo	4	Wall	Midle Wall	Solid	Drywall	0.01
1469	1977 Bldg	220	XRF	2/24/97	0	Classroo	4	Wall	Midle Wall	Solid	Plaster	0.03
1470	1977 Bldg	221	XRF	2/24/97	0	Classroo	4	Wall	Midle Wall	Solid	Metal	0
1471	1977 Bldg	222	XRF	2/24/97	0	Classroo	4	Window	Casing	Solid	Wood	0.04
1472	1977 Bldg	223	XRF	2/24/97	0	Classroo	4		Radiator	Solid	Metal	0
1473	1977 Bldg	224	XRF	2/24/97	0	Classroo	4	Univent		Solid	Wood	0
1474	1977 Bldg	225	XRF	2/24/97	0	Classroo	4	Cabinet	Door	Solid	Wood	0
1475	1977 Bldg	226	XRF	2/24/97	0	Classroo	4	Door	Door	Solid	Wood	0
1476	1977 Bldg	227	XRF	2/24/97	0	Classroo	4	Door	Casing	Cracked	Metal	0

Saint Paul Public Schools
 Ramsey Junior High School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
1477	1977 Bldg	228	XRF	2/24/97	0	Classroo	4	Door	Column	Cracked	Plaster	3.71
1478	1977 Bldg	202	XRF	2/24/97	0	Classroo	7	Wall	Midle Wall	Solid	Concrete	0
1479	1977 Bldg	203	XRF	2/24/97	0	Classroo	7		Column	Cracked	Plaster	0.11
1480	1977 Bldg	204	XRF	2/24/97	0	Classroo	7	Wall	Diffuser	Solid	Metal	0.01
1481	1977 Bldg	205	XRF	2/24/97	0	Classroo	7	Door	Door	Solid	Wood	0
1482	1977 Bldg	206	XRF	2/24/97	0	Classroo	7	Door	Jamb	Cracked	Metal	0.04
1483	1977 Bldg	214	XRF	2/24/97	0	Restroom	13	Wall	Midle Wall	Cracked	Concrete	0.03
1484	1977 Bldg	215	XRF	2/24/97	0	Restroom	13	Door	Door	Solid	Wood	0
1485	1977 Bldg	216	XRF	2/24/97	0	Restroom	13	Door	Casing	Solid	Metal	0
1486	1977 Bldg	217	XRF	2/24/97	0	Restroom	13	Ceiling		Solid	Drywall	0

APPENDIX B

LABORATORY SAMPLE ANALYSIS DATA

LABORATORY ANALYSIS REPORT

DATE: March 18, 1997 **PAGE:** 1 Of 2

CLIENT: Midwest Environmental Cons.
5385 401st Ave. NW
Dalbo, MN 55017 **PROJECT NO.:** 031297-200888
COLLECTION DATE: 2/20/97-3/11/97
COLLECTED BY: Client
RECEIVED DATE: 3/12/97
PROJECT DESCRIPT.: 62/0197K Ramsey Jr. High

CONTACT: Greg Myers/Richard Cox

SAMPLE #	DESCP.	MDL	LEAD (6010A)	ANALYSIS
			RESULTS	
Units=mg/kg	DATE			
L971324-1	B1	38	610	3/17/97
L971324-2	B2	36	880	3/17/97
L971324-3	B3	29	990	3/17/97
L971324-4	B4	26	3000	3/17/97
L971324-5	B5	350	ND	3/17/97
L971324-6	B6	220	17,000	3/17/97
L971324-7	B7	39	450	3/17/97
L971324-8	B8	34	1600	3/17/97
L971324-9	B9	110	2200	3/17/97
L971324-10	B10	330	27,000	3/17/97
L971324-11	B11	21	4000	3/17/97
L971324-12	B12	24	64	3/17/97
L971324-13	B13	21	5300	3/17/97
L971324-14	B14	40	130	3/17/97
L971324-15	B15	35	390	3/17/97
L971324-16	B16	22	120	3/17/97
L971324-17	B17	27	2000	3/17/97
L971324-18	B18	23	35	3/17/97
L971324-19	B19	16	1500	3/17/97
L971324-20	B20	27	440	3/17/97
L971324-21	B21	40	15,000	3/17/97
L971324-22	B22	49	2400	3/17/97
L971324-23	B23	30	1400	3/17/97
L971324-24	B24	63	270	3/17/97
L971324-25	B25	540	19,000	3/17/97

ND means Not Detected or below reported MDL

MDL means Method Detection Limit

mg/kg means Milligrams Per Kilogram which is equivalent to Parts Per Million (ppm)

As a mutual protection, all reports are submitted in confidentiality and may not be reproduced except in full without written authorization.



A member of The Marmon Group of Companies

LABORATORY ANALYSIS REPORT**DATE:** March 18, 1997**PAGE:**

2 Of 2

CLIENT: Midwest Environmental Cons.
5385 401st Ave. NW
Dalbo, MN 55017**PROJECT NO.:** 031297-200888
COLLECTION DATE: 2/20/97-3/11/97
COLLECTED BY: Client
RECEIVED DATE: 3/12/97
PROJECT DESCRIPT.: 62/0197K Ramsey Jr. High**CONTACT:** Greg Myers/Richard Cox

This report has been reviewed by me for technical accuracy and completeness. The analyses were performed using EPA or other approved methodologies and the results were reported on an "as received" basis unless otherwise noted. Organic soil analyses were reported on a dry weight basis. The results reported relate only to the items tested. Please contact me if you have any questions or comments regarding this report. Spectrum Labs, Inc. appreciates the opportunity to provide this analytical service for you.

Report Submitted By,

Thomas L. Halverson
Laboratory ManagerTLH:wmc
mec077-1*As a mutual protection, all reports are submitted in confidentiality and may not be reproduced except in full without written authorization.*

A member of The Marmon Group of Companies

Midwest Environmental Consulting, L.L.C.

5385 401st Ave. NW, Duluth, MN 55017

612-689-3612/612-757-5541/FAX-612-689-5209

Client Address 1700 Summit Ave

Contact Greg Myers / Richard Cox



CHAIN OF CUSTODY RECORD

Project Number 62/0197-K

Client St. Paul Iso

Project Remsey TR. H.H.

Phone/Fax _____

Sample ID	Sample Description	Collection Date/Time	Matrix (Vol/Area)	Analysis Requested
62/0197-K-B-1	Middlewall white side C	2-20-97 5:35p	2 1/4 "	Pb 1324-1
62/0197-K-B-2	upper wall purple side B	2-20-97 5:38p	2 1/4 "	2
62/0197-K-B-3	purple side B C, living white plaster by side of door	2-20-97 5:40p	2 1/4 "	3
62/0197-K-B-4	Rm.301 Side D wood window casing Dk	2-20-97 5:45p	2 1/4 "	4
62/0197-K-B-5	Rm 1 kitchen 3rd fl. 3rd fl. side D cabinet back	2-20-97 5:48p	2 1/4 "	5
62/0197-K-B-6	Rm between 3rd & 3rd floor banister trap	2-20-97 5:53p	2 1/4 "	6
62/0197-K-B-7	1m 3rd side D upper wall/blue green	2-20-97 6:23p	1 1/2 "	7
62/0197-K-B-8	Bedsroom 1 Side A gray wall Register	2-20-97 6:50p	1 1/2 "	8
62/0197-K-B-9	Stair 1 wood baseboard Side A	2-20-97 7:15p	2 1/4 "	9
62/0197-K-B-10	Floor 4 metal/marble black metal railing	2-20-97 7:10p	2 1/4 "	10
62/0197-K-B-11	Am 2 floor metal rail in gray Elmer B	2-20-97 7:25p	2 1/4 "	11
62/0197-K-B-12	Rm 309 Side D baseboard white plaster	2-21-97 4:55p	2 1/4 "	12
62/0197-K-B-13	Side A ceiling white Radiator Am 210	2-21-97 7:10p	2 1/4 "	13
62/0197-K-B-14	Side A Rm 210 gray Lower wall	2-21-97 7:15p	2 1/4 "	14

Sampled By: Greg Myers Date: 3-11-97 Time: _____ Delivered By: Greg Myers Date: 3/12/97 Time: 2:15A

Received By: _____ Date: _____ Time: _____ Delivered By: _____ Date: _____ Time: _____

Received By Lab: Greg Myers Date: 3/12/97 Time: 2:25 Disposition of Samples _____

Notes: Report is part per million (ppm)

1042



Midwest Environmental Consulting, L.L.C.

55385 401st Ave. NW, Dalbo, MN 55017

612-689-3612/612-757-5541/FAX-612-689-5209

Client Address *[Signature]*

Client Address _____
Contact _____ Name _____ / Relationship _____

CHAIN OF CUSTODY RECORD

Project Number 6210197-K

Client St. Paul EsD

SCHILL Project Pamset Jr. High

Phone/Fax

Sample ID	Sample Description	Collection Date/Time	Matrix (Vol/Area)	Analysis Requested
62/0197-K-B-15	Sidewall of floor metal bracket containing 0.742g	3-21-97 7:30 pm	2 "Sg"	Pb 324-15
62/0197-K-B-16	Sidewall ceiling metal plate	3-11-97 4:55 pm	1 "Sg"	16
62/0197-K-B-17	Sidewall Bauxite-Brown metal	3-11-97 5:05 pm	2 "Sg"	17
62/0197-K-B-18	Sidewall metal abalone shell mix with white material	3-11-97 5:08 pm	2 "Sg"	18
62/0197-K-B-19	Rm 204 side A concrete block height 9" width 9"	3-11-97 5:15 pm	2 "Sg"	19
62/0197-K-B-20	Rm 204 column side A. Above liquid	3-11-97 5:20 pm	2 "Sg"	20
62/0197-K-B-21	Stage Bauxite metal blocks size & light greenish	3-11-97 6:40 pm	2 "Sg"	21
62/0197-K-B-22	Kitchen cabinet ceiling sidewall concrete	3/11/97 6:45 pm	2 "Sg"	22
62/0197-K-B-23	Kitchen Bettele upper wall yellow metal	3/11/97 6:55 pm	1 "Sg"	23
62/0197-K-B-24	Girshocker Room Staff (main and metal)	3/11/97 7:30 pm	2 "Sg"	24
62/0197-K-B-25	Girls Locker Room Locker sidewall	3/11/97 7:35 pm	2 "Sg"	25

Sampled By: Greg A. Myers Date: 3-11-97 J-21-97

Received By: _____ Date: _____ Time: _____

Received by: _____ Date: _____

Disposition of Samples

Delivered By: Greg A. May

Delivered By:

Report in parts per million

Notes

Greg A. Myers Date: 3/12/07 Time: 2:15A

APPENDIX C INSPECTORS

**Greg A. Myers
MDH Lead Inspector # 116**