


Midwest
Environmental
Consulting, L.L.C.

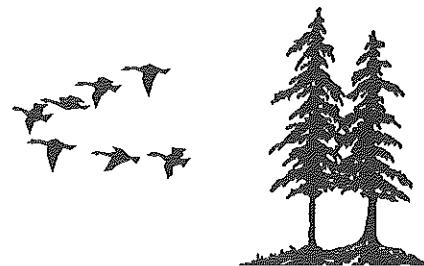

 Printed on Recycled Paper

**Highland Park Junior High School
Saint Paul Public Schools**

Lead-Based Paint Inspection

**Inspection Dates: 4/12/97, 4/16/97, 4/24/97, 4/26/97, 5/7/97, 5/22/97,
5/23/97, 5/27/97, 5/28/97, 6/2/97, 6/3/97, 6/17/97**

submitted to:

Saint Paul Public Schools

MEC Project # 62/0197M

INTRODUCTION

At the request of Saint Paul Public Schools Environmental Safety Department, Midwest Environmental Consulting, L.L.C. (MEC), conducted a lead-based paint inspection at Highland Park Junior High School, 975 S. Snelling Avenue, St. Paul, MN. The purpose of this inspection was to identify lead-based painted, varnished, or otherwise coated building components on the interior and exterior of the school building.

The inspection protocol incorporated applicable portions of the U.S. Department of Housing and Urban Development (HUD) *Guidelines for the Evaluation and Control of Lead-based Paint Hazards in Housing* (HUD Guidelines, June 1995) and OSHA 1926.62 requirements (Lead in Construction). The HUD guidelines are formulated to guide agencies in conducting random sampling of the interiors and exteriors of dwellings and common areas in public housing. The OSHA requirement is designed to minimize worker exposure when working with material containing lead.

Confirmatory testing was conducted when inconclusive XRF results were encountered. Inconclusive refers to XRF readings less than 0.2 mg/cm² (milligrams per square centimeter). Inconclusive results were confirmed with laboratory analysis of paint chip samples (Appendix B). This report contains a list of such results.

The United States Environmental Protection Agency defines "lead-based paint" as a paint or other surface coating that contains lead equal to or in excess of 1.0 milligrams per square centimeter when analyzed by XRF or more than 0.5% by weight (5000 parts per million) by laboratory analysis of a bulk sample.

Minnesota Department of Labor and Industry (MN OSHA) adopted the EPA lead levels for the purpose of enforcing OSHA 1926.62 federal regulations. Detection of lead in dried paint film by XRF is a dependable indicator of levels of lead and is accepted by MN OSHA.

For this Saint Paul Public Schools Lead Inspection, all building components were tested on site using a Niton XL® X-ray Fluorescence Spectrum Analyzer⁽¹⁾. Building components included walls, ceilings, floors, moldings, window and door components, door surfaces, and miscellaneous features such as shelves or bookcases. Only painted or glazed surfaces or surfaces which were varnished were tested. Suspended ceilings, structural steel, and corrugated decking were not included in the inspection. Neither anodized (e.g., window sashes) nor plastic (e.g., vinyl baseboard and vinyl mini-blinds) were included in the scope of this inspection.

⁽¹⁾ This is a portable hand held machine that can analyze building components instantly for lead concentrations.

Each building was divided into unique sites based on the year of construction or renovation. Portable classrooms, playgrounds, and other detached buildings were automatically designated as a unique site. Each site was inspected independently assuming differences in painting history and construction characteristics.

SITE DESCRIPTION AND BUILDING HISTORY

According to information provided to MEC by Saint Paul Public Schools, Highland Park Junior High School was constructed in essentially one phase. The building is 146,088 square-feet and dates from 1958.

All room and area designations used in this report are depicted on sampling maps found in Appendix A.

XRF SAMPLE RESULTS TABLE

The results of all samples analyzed are listed in the table at the end of this section. The following is a description of the column headings:

Site	Each school is divided into sites based on their unique construction characteristics. Each site has a unique date of construction or major renovation.
Sample #	Each sample taken was given a unique number to identify the type and location of the sample. The sampling date is an integral part of the sample number.
Analysis	This defines the type of analysis which can be categorized into two types: 1) XRF: This is an on-site analysis using a hand held Niton XL® X-ray Fluorescence Spectrum Analyzer; 2) Bulk or Chip: This is a bulk sample where paint is removed from the substrate and sent to a laboratory for analysis;
Floor	This is the level of the building in which the area tested was found, example, 1 (first floor), 0 (basement), etc.
Area	This further defines the specific functional space inspected such as a classroom, exterior, playground, gym, kitchen, etc.

Room #	This is typically the actual number on the room as identified at the building.
Component	Building "components" included walls, ceilings, floors, moldings, window and door components, door surfaces, and miscellaneous features such as shelves or bookcases.
Feature	Identifies more detailed information of the component.
Condition	This describes condition of the surface, whether it is intact, cracked, peeling, or chalking.
Substrate	This refers to the material the building component is made of (wood, concrete, drywall, metal, etc.).
Result	This is the analysis results for lead. Less than 1.0 mg/cm ² or less than 0.5% by weight is considered to be non-lead and these building components are below the action levels of EPA and HUD. (All results are in mg/cm ² except where noted.)

The table of results is designed for quick information on lead concentrations of tested building components. Generally, all repetitions of a test combination within a given room or area, may be assumed to contain similar concentrations of lead to that of the tested sample. For instance, the lead concentration of a tested wooden window sash was found to be above the action level of 1.0 mg/cm² in a given classroom. The classroom has five windows, all of wood, the same color and appearing to be of the same era. It can be assumed that the remaining four wooden window sashes each contain lead above the action limit.

Other columns identify the component and the component feature tested, condition of the component, type of substrate and the result of the analytical test.

As an example, the following illustration shows that the wooden door jamb in Room 123, first floor in the 1923 building section was in good, solid condition, and had an XRF test result of 0.3 mg/cm², which is below the action level.

Illustration Only

Site	Sample #	Date	Analysis	Floor	Area	Room #	Component	Feature	Condition	Substrate	Results
1923 Bldg.	52		XRF	1	Room	123	Door	Jamb	Solid	Wood	0.3

In a similar manner, the table shows that the plaster walls in room 23, on the second floor has peeling paint with more than 1.0 mg/cm² (shaded).

ILLUSTRATION ONLY

Site	Sample #	Date	Analysis	Floor	Area	Room #	Component	Feature	Condition	Substrate	Results
1910 Bldg.	16		XRF	2	Room	23	Door	Jamb	Peeling	Wood	0.25
1910 Bldg.	17		XRF	2	Room	23	Wall	Wall	Peeling	Plaster	1.2
1910 Bldg.	18		XRF	2	Room	23	Ceiling	Peeling	Plaster		0.25
1910 Bldg.	19		XRF	2	Room	23	Wall	Baseboard	Peeling	Wood	0.002

APPLICABLE REGULATIONS


When building components test above 1.0 mg/cm² of lead by XRF or 0.5% lead by weight from laboratory analysis all employees and contractors who will be working with these components in a construction related activity must be notified. The requirements of OSHA 1926.62, Lead in Construction are enforceable. This regulation defines construction work as "work for construction, alteration and/or repair, including painting and decorating." This regulation further defines monitoring requirements to minimize employee exposure to lead during construction activities.


When work is performed on external painted building structures (i.e. flashing, fire escapes, playground equipment, handrails, etc.), regulations of the Minnesota Pollution Control Agency (MPCA) may also be applicable. For removal of lead based paint from steel structures, MN Rules 7025.0200 - 7025.0380 apply to steel materials on the exterior of a building, or on the property when levels exceed 0.5 mg/cm² based on the average of three XRF spectrum results of the sample tested, or 5,000 ppm by laboratory analysis. If it is other than a steel surface, then MPCA regulates the painted surfaces under MN Rules 7025.010 - 7025.0080, when surfaces are to be disturbed using abrasive blasting methods.

Please contact MEC directly if you have questions about any portion of this report or the lead-based paint inspection itself.

APPENDIX A

XRF TESTING DATA WITH LOCATION MAPS

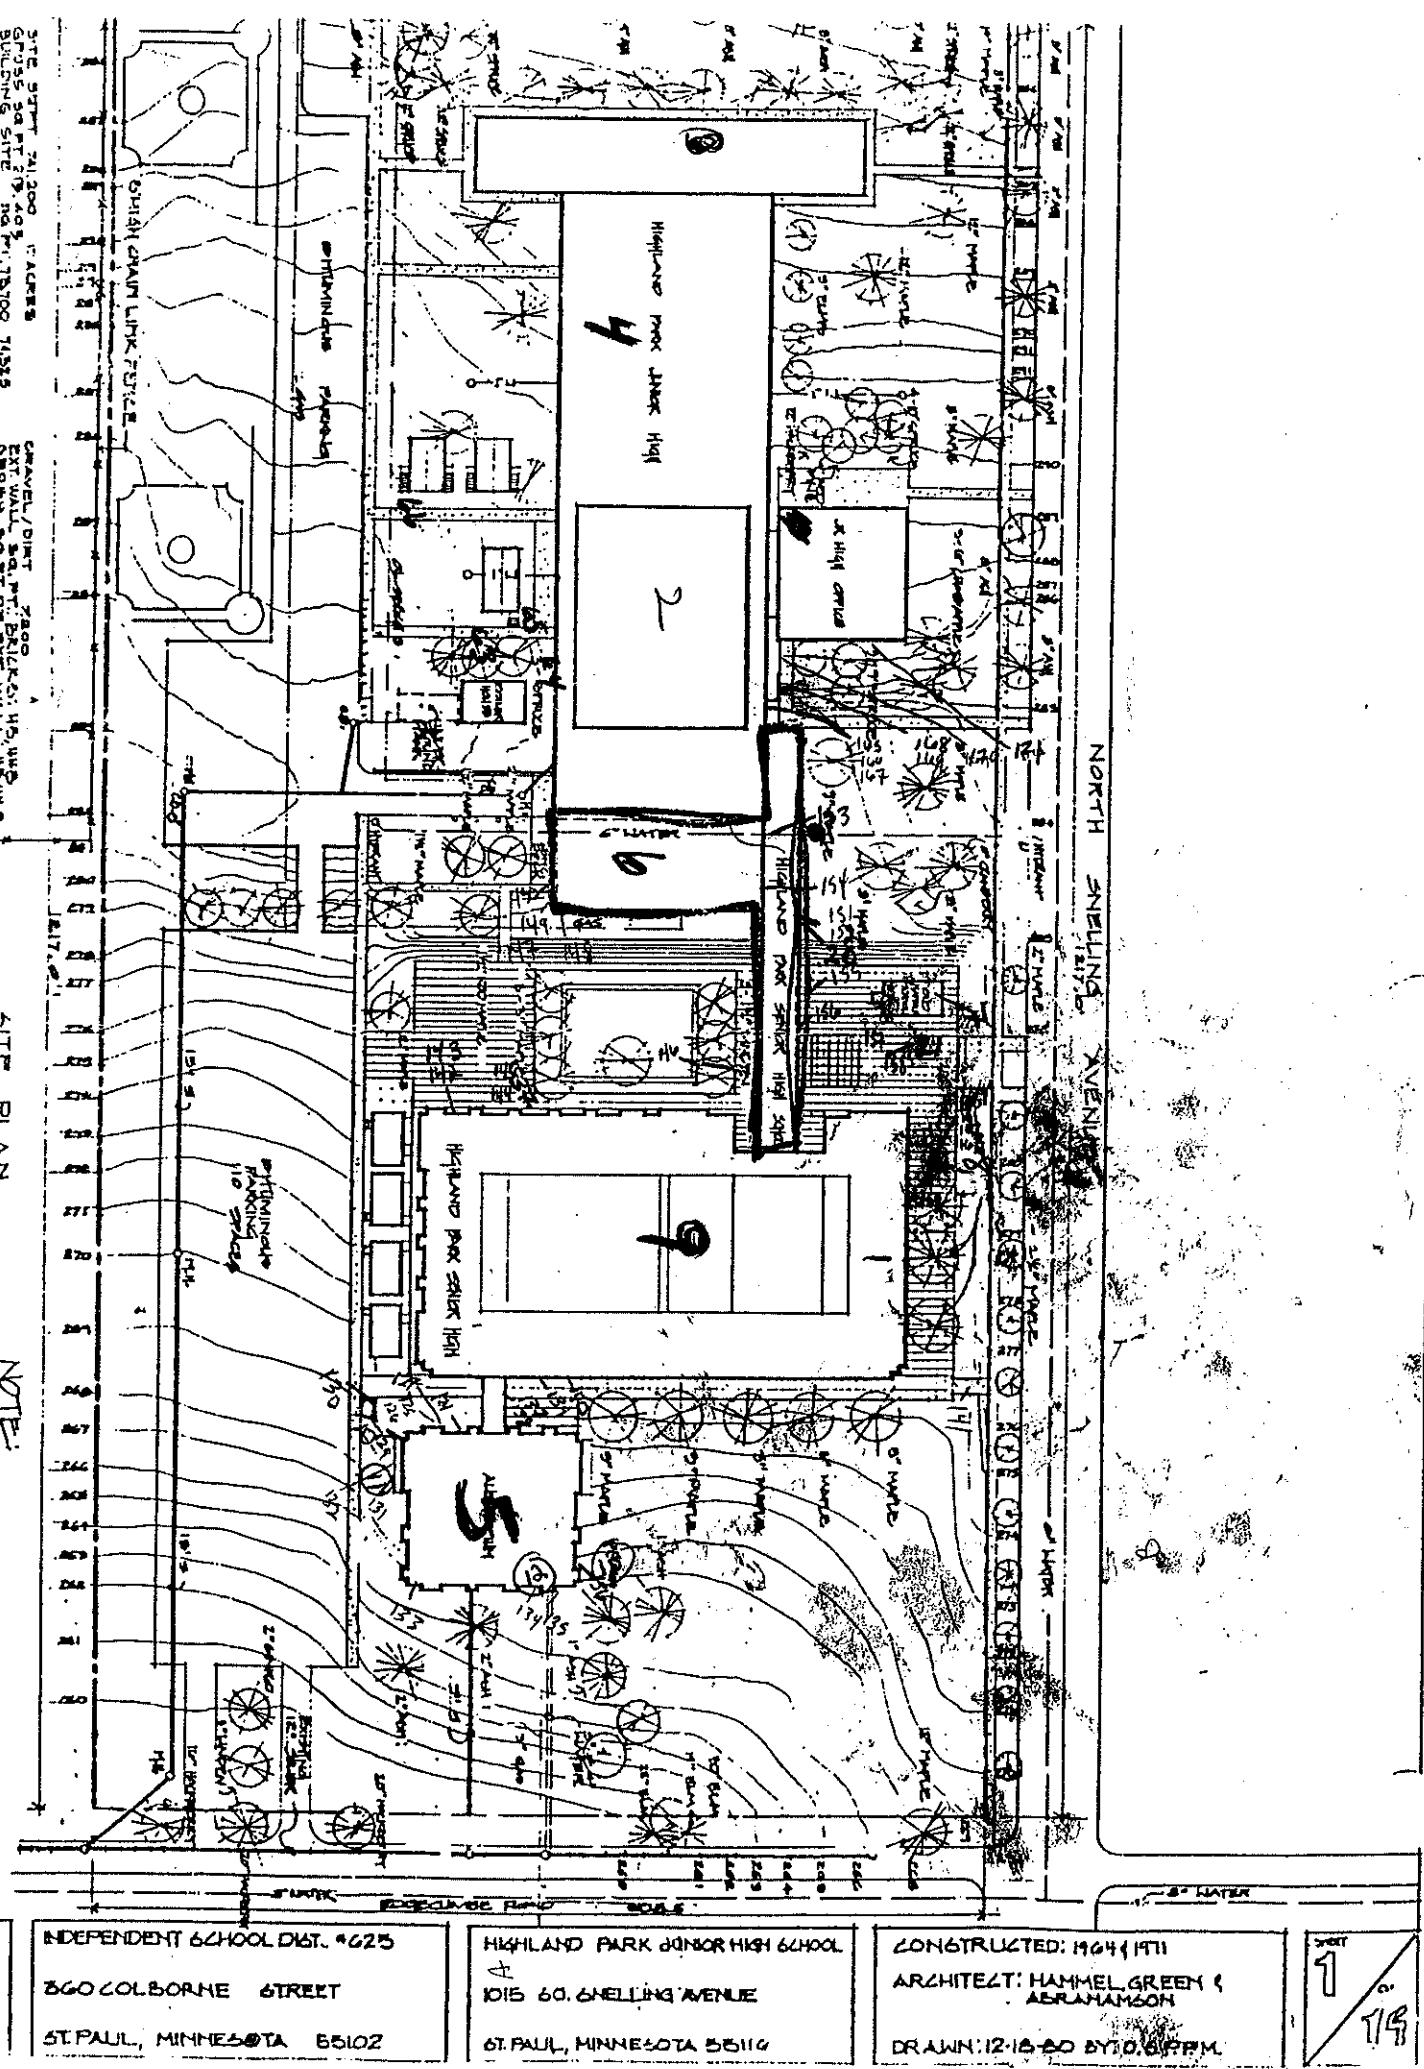

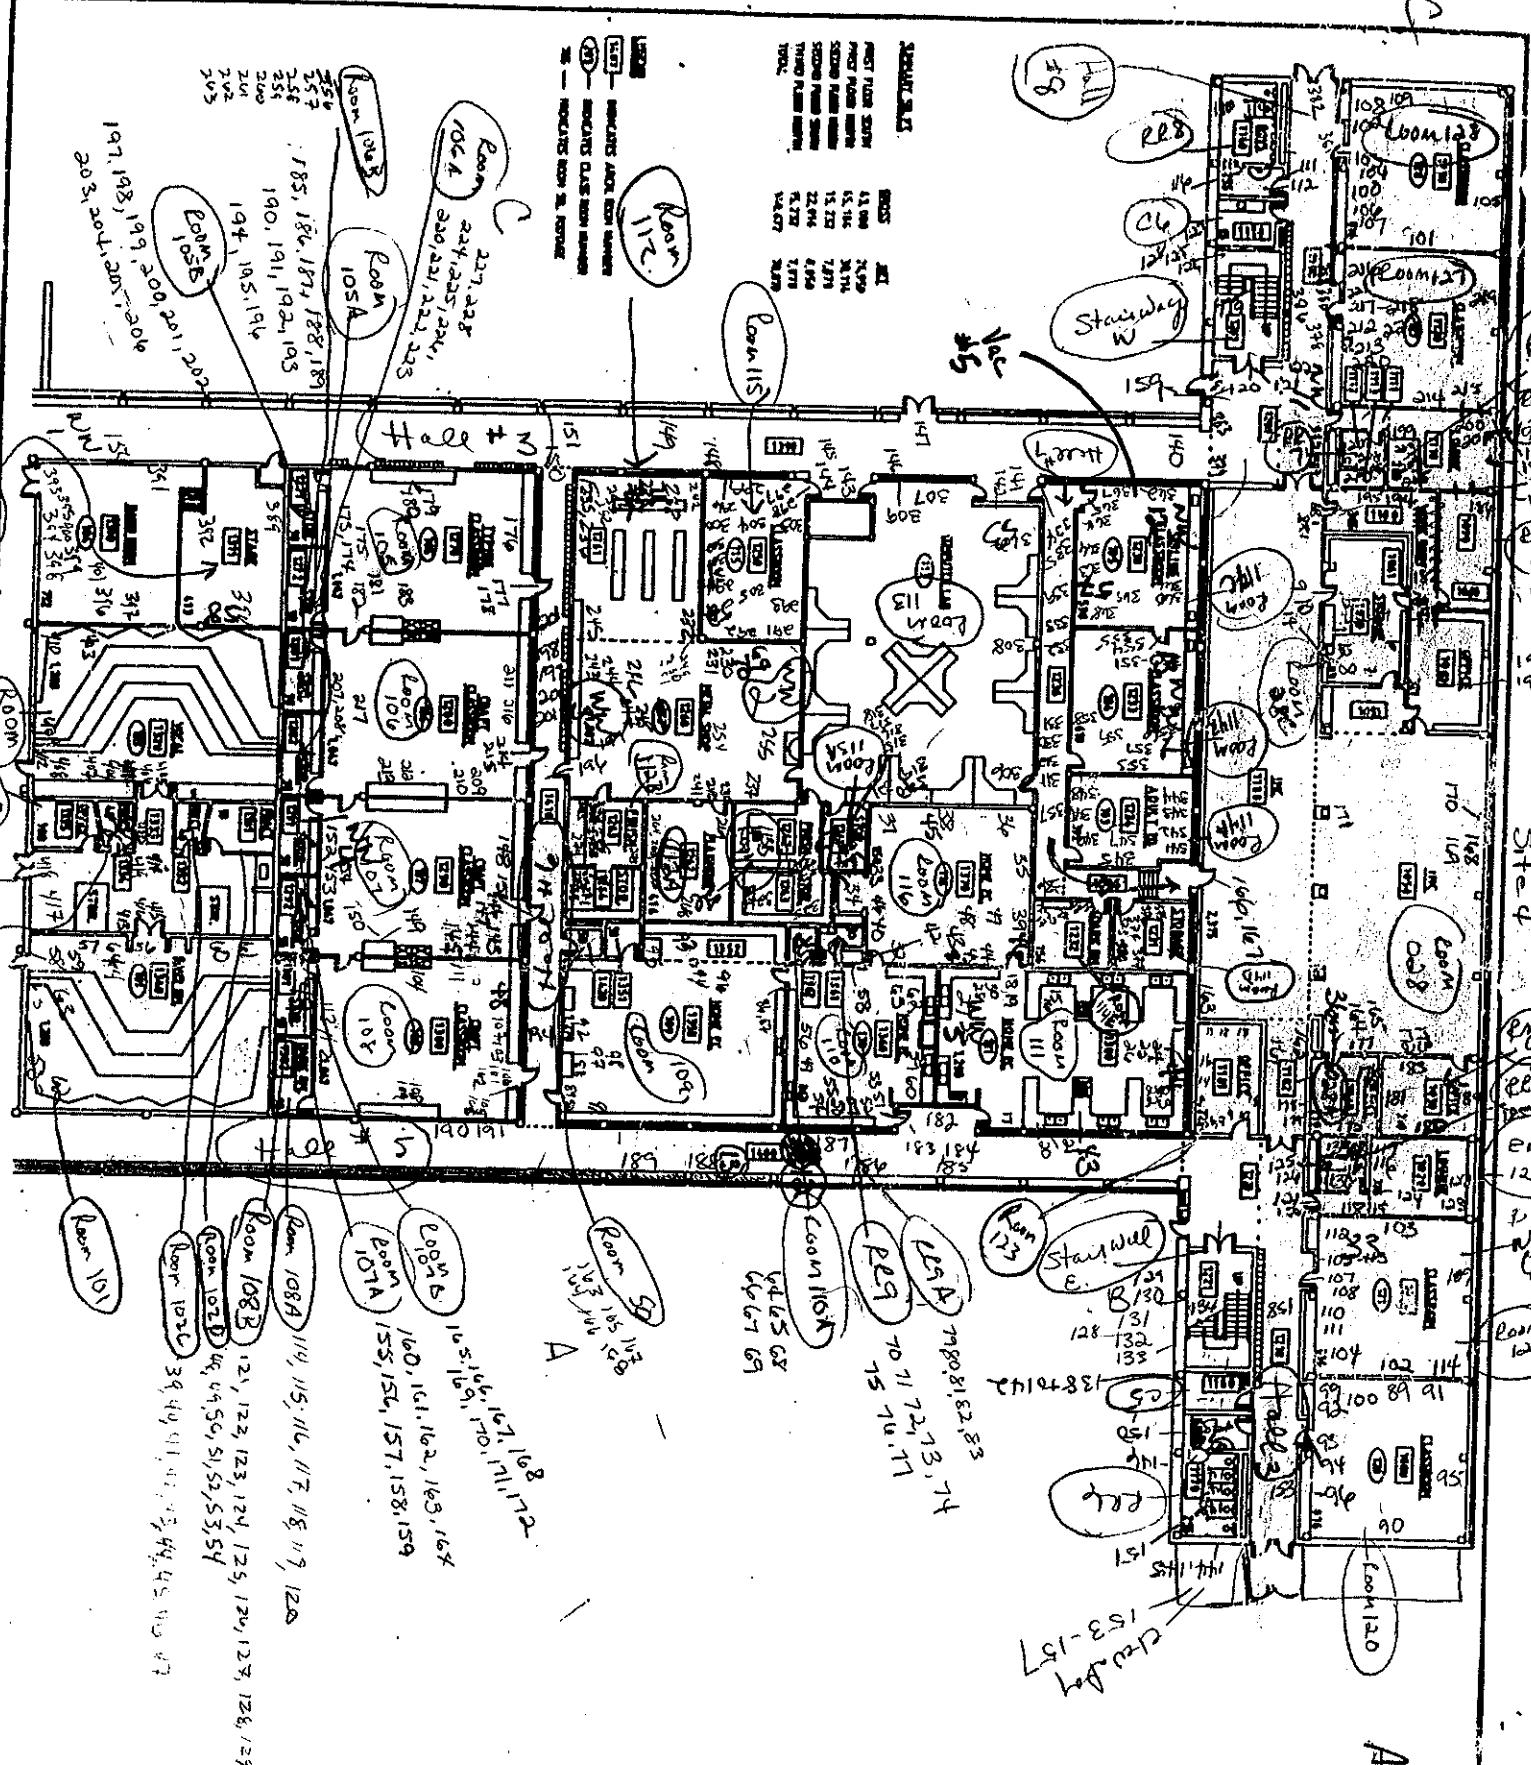


INDEPENDANT SCHOOL DIST. #625
380 COLBONNE STREET
ST. PAUL, MN 55102

HIGHLAND PARK JUNIOR HIGH
1015 S. SNELLING AVE.
ST. PAUL, MN 55116

CONSTRUCTED 1964, 71

100-201
2 04
8

SECOND FLOOR PLAN - NORTH

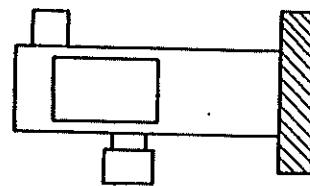



INDEPENDANT SCHOOL DIST. #625
360 COLBORNE STREET
ST. PAUL, MN 55102

HIGHLAND PARK JUNIOR HIGH
1015 S. SNELLING AVE.
ST. PAUL, MN 55116

CONSTRUCTED 1964, 71

SHEET
3 OF
8

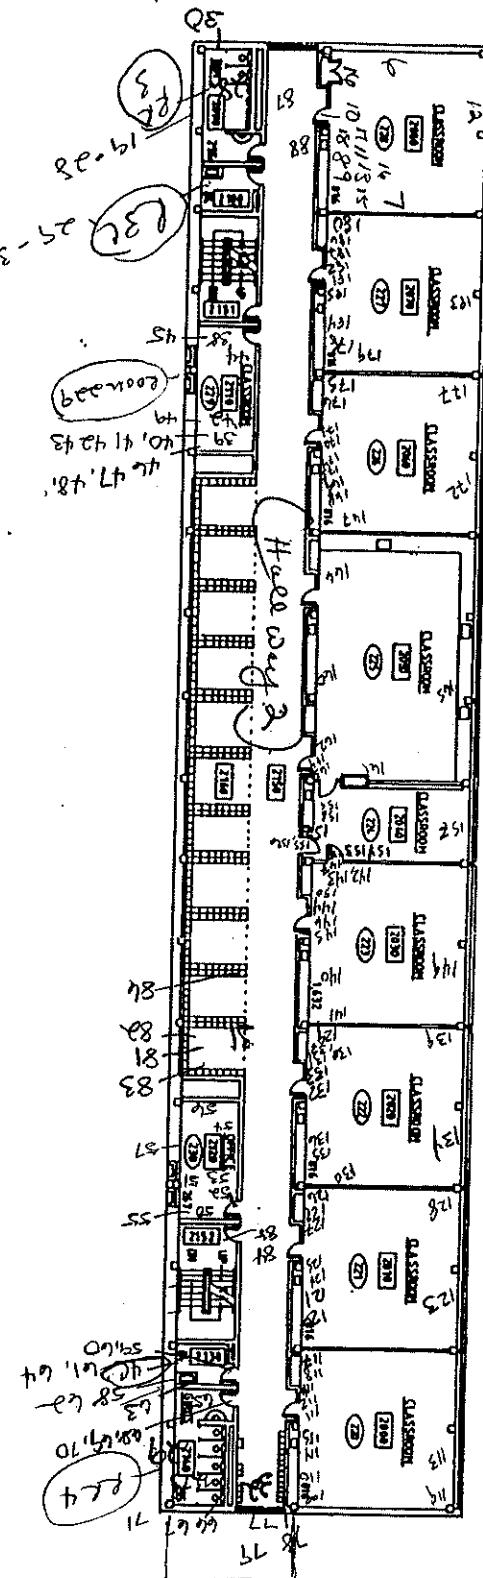

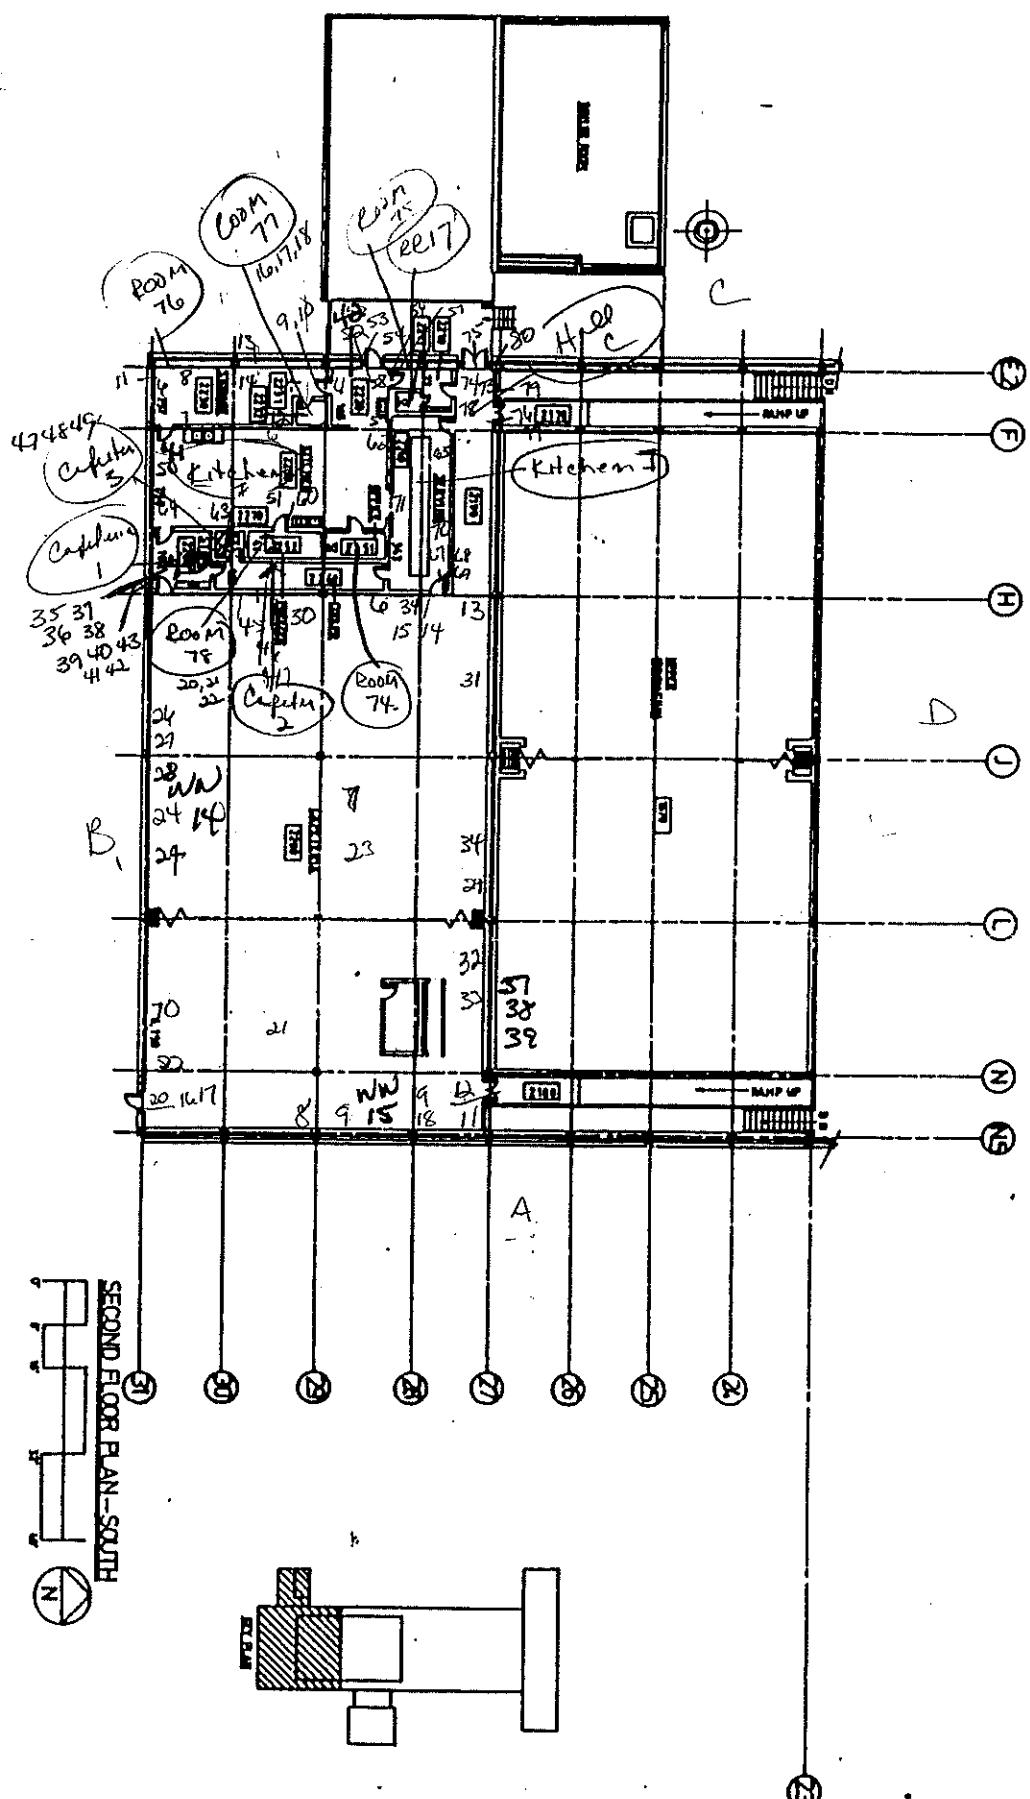


INDEPENDENT SCHOOL DIST. #625
380 COLBORNE STREET
ST. PAUL, MINNESOTA 55102

HIGHLAND PARK JUNIOR HIGH
1015 S. SNELLING AVE.
ST. PAUL, MINNESOTA 55116

CONSTRUCTED: 1964.71

6
8

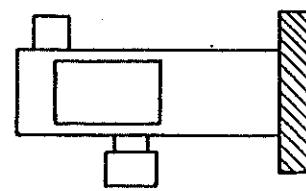


INDEPENDENT SCHOOL DIST. #625
360 COLBORNE STREET
ST. PAUL, MINNESOTA 55102

HIGHLAND PARK JUNIOR HIGH
1015 S. SNELLING AVE.
ST. PAUL, MINNESOTA 55116


CONSTRUCTED: 1964, 71


4
8

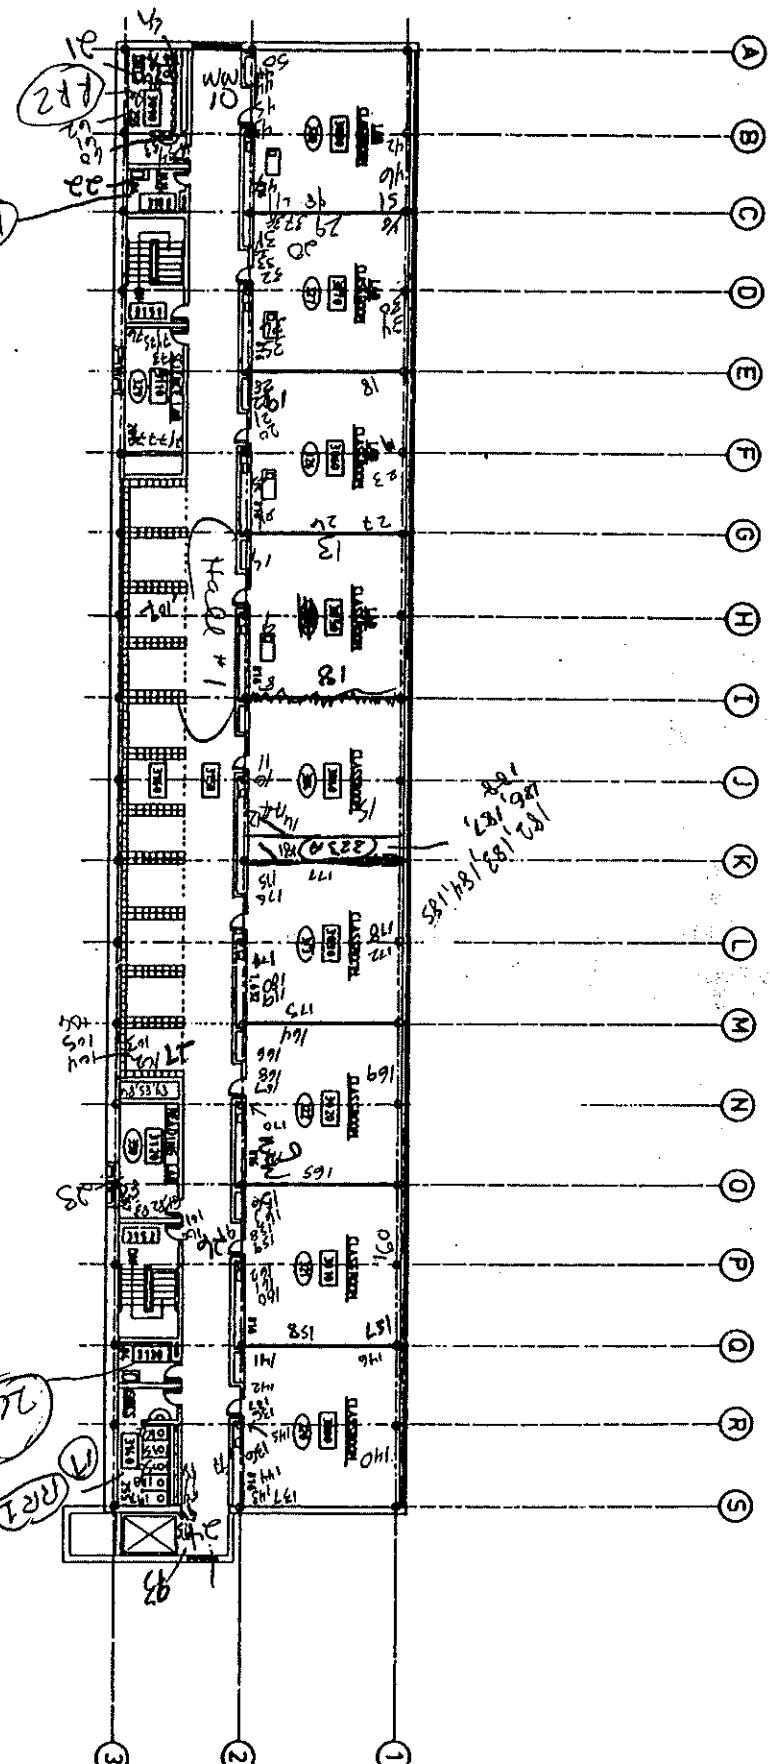


L6-91-1
L610.0

26'11" x 63'8" x 10'9"



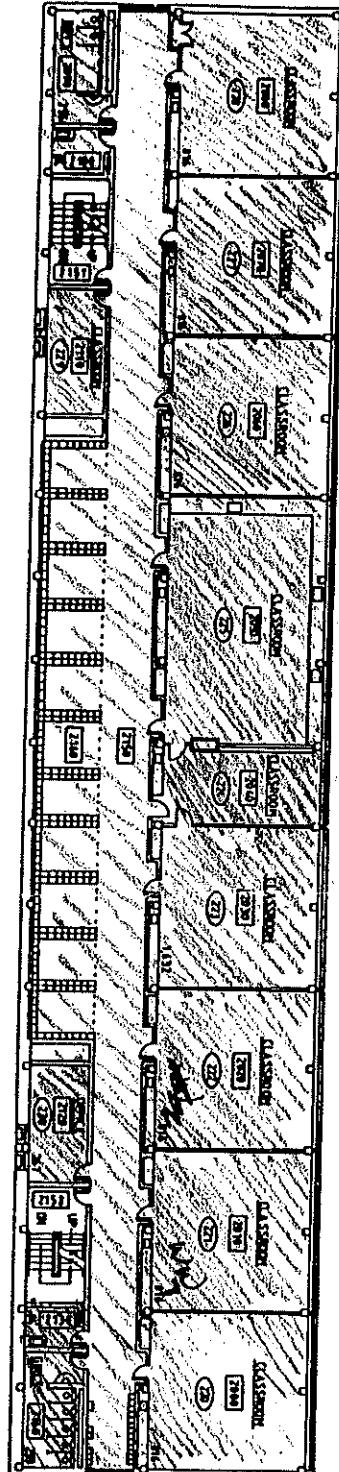

SECOND FLOOR PLAN - NORTH

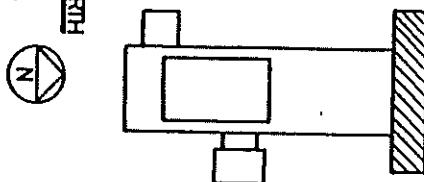

**INDEPENDANT SCHOOL DIST. #626
360 COLBORNE STREET
ST. PAUL, MN 55102**

HIGHLAND PARK JUNIOR HIGH
1015 S. SNELLING AVE.
ST. PAUL, MN 55116

CONSTRUCTED 1964, 71

8
2
1

CONSTRUCTED 1964-71


HIGHLAND PARK JUNIOR HIGH
1015 S. SNELLING AVE.
ST. PAUL, MN 55116

INDEPENDENT SCHOOL DIST. #625
300 COLBORNE STREET
ST. PAUL, MN 55102

1
2
3
4
5
6
7
8
9
10
11
12


A

62-0197 M
4-16-97

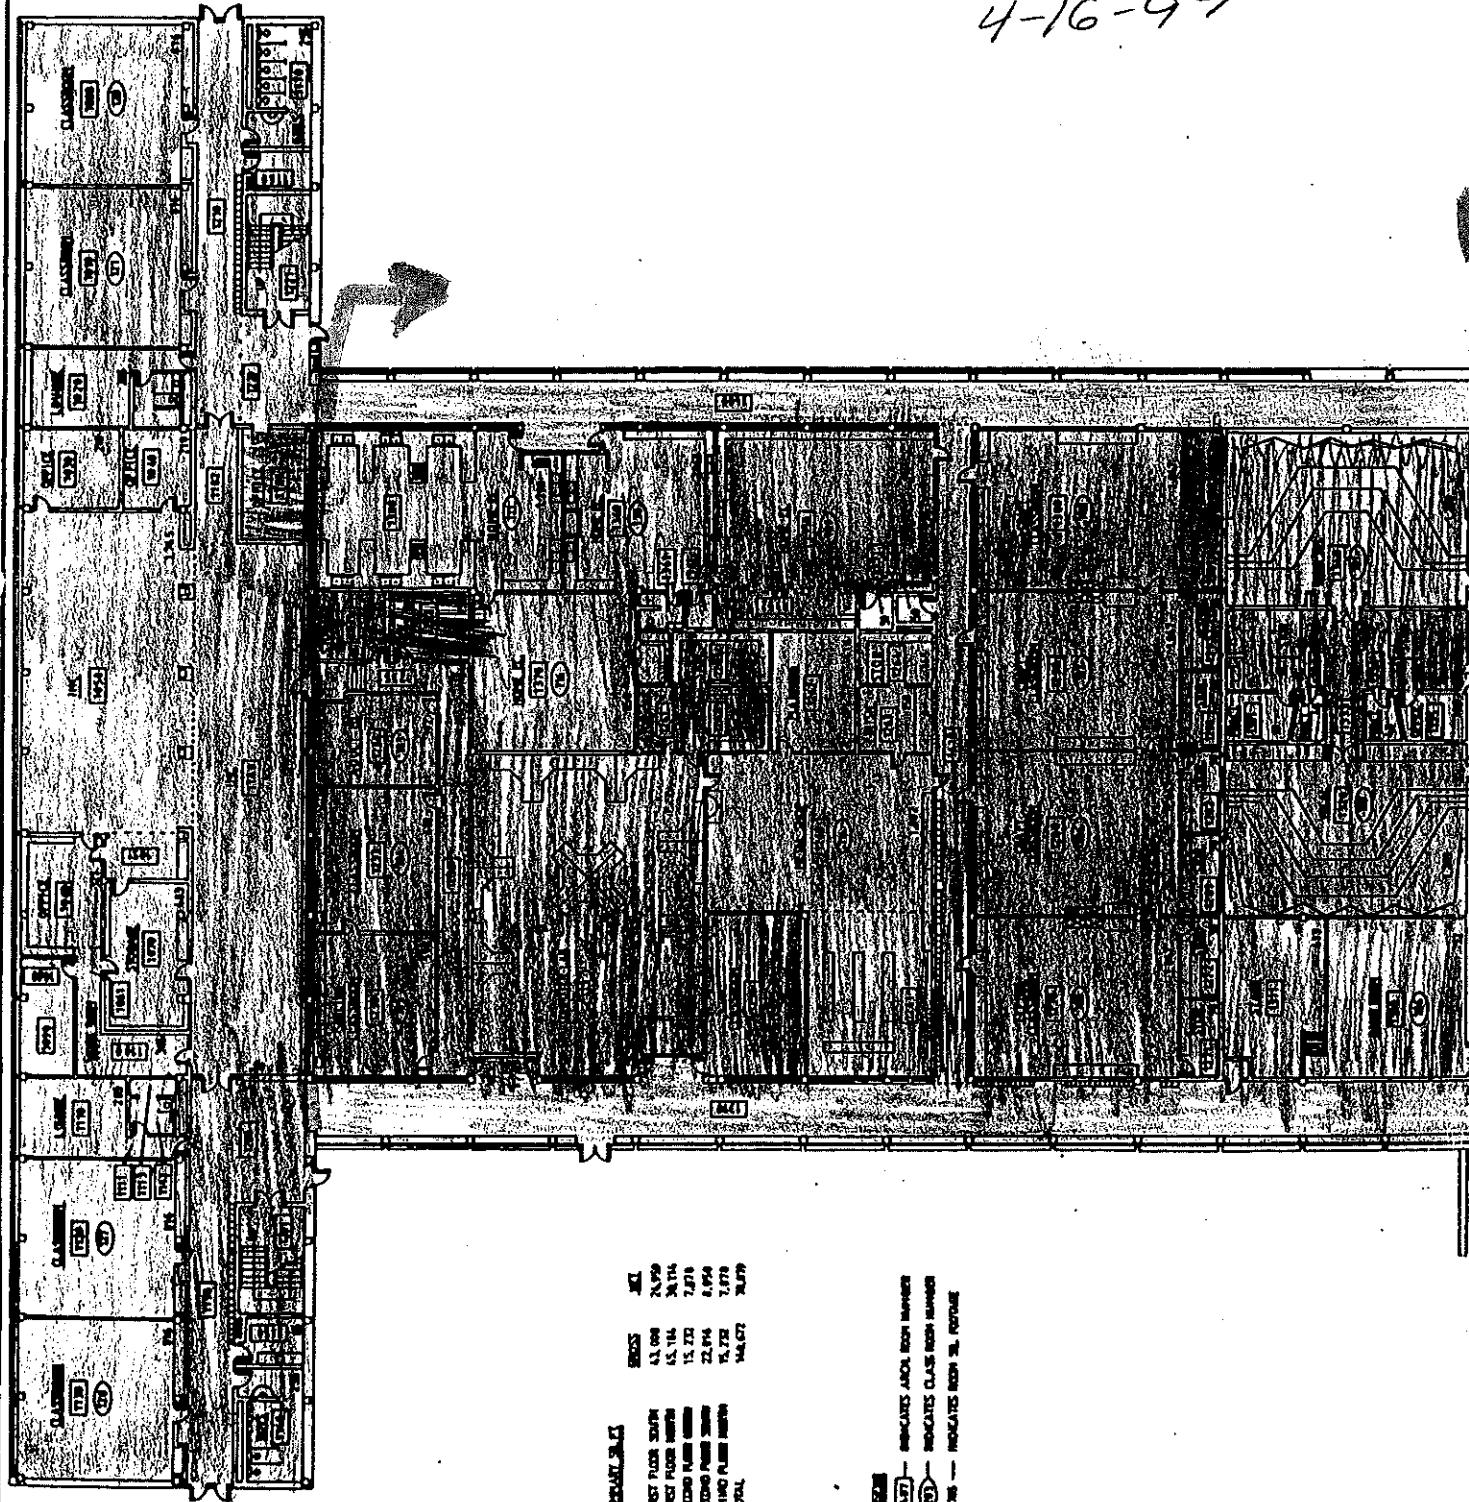

GRADE	SECTION	STUDENTS
FIRST FLOOR	1A	100
FIRST FLOOR	1B	104
FIRST FLOOR	1C	114
FIRST FLOOR	1D	114
FIRST FLOOR	1E	114
FIRST FLOOR	1F	114
SECOND FLOOR	2A	122
SECOND FLOOR	2B	124
SECOND FLOOR	2C	124
SECOND FLOOR	2D	124
SECOND FLOOR	2E	124
SECOND FLOOR	2F	124
THIRD FLOOR	3A	122
THIRD FLOOR	3B	122
THIRD FLOOR	3C	122
THIRD FLOOR	3D	122
THIRD FLOOR	3E	122
THIRD FLOOR	3F	122
TOTAL		1475

INDICATES ADULT STAFF NUMBER
INDICATES CLASS ROOM NUMBER
— INDICATES STUDENT NUMBER

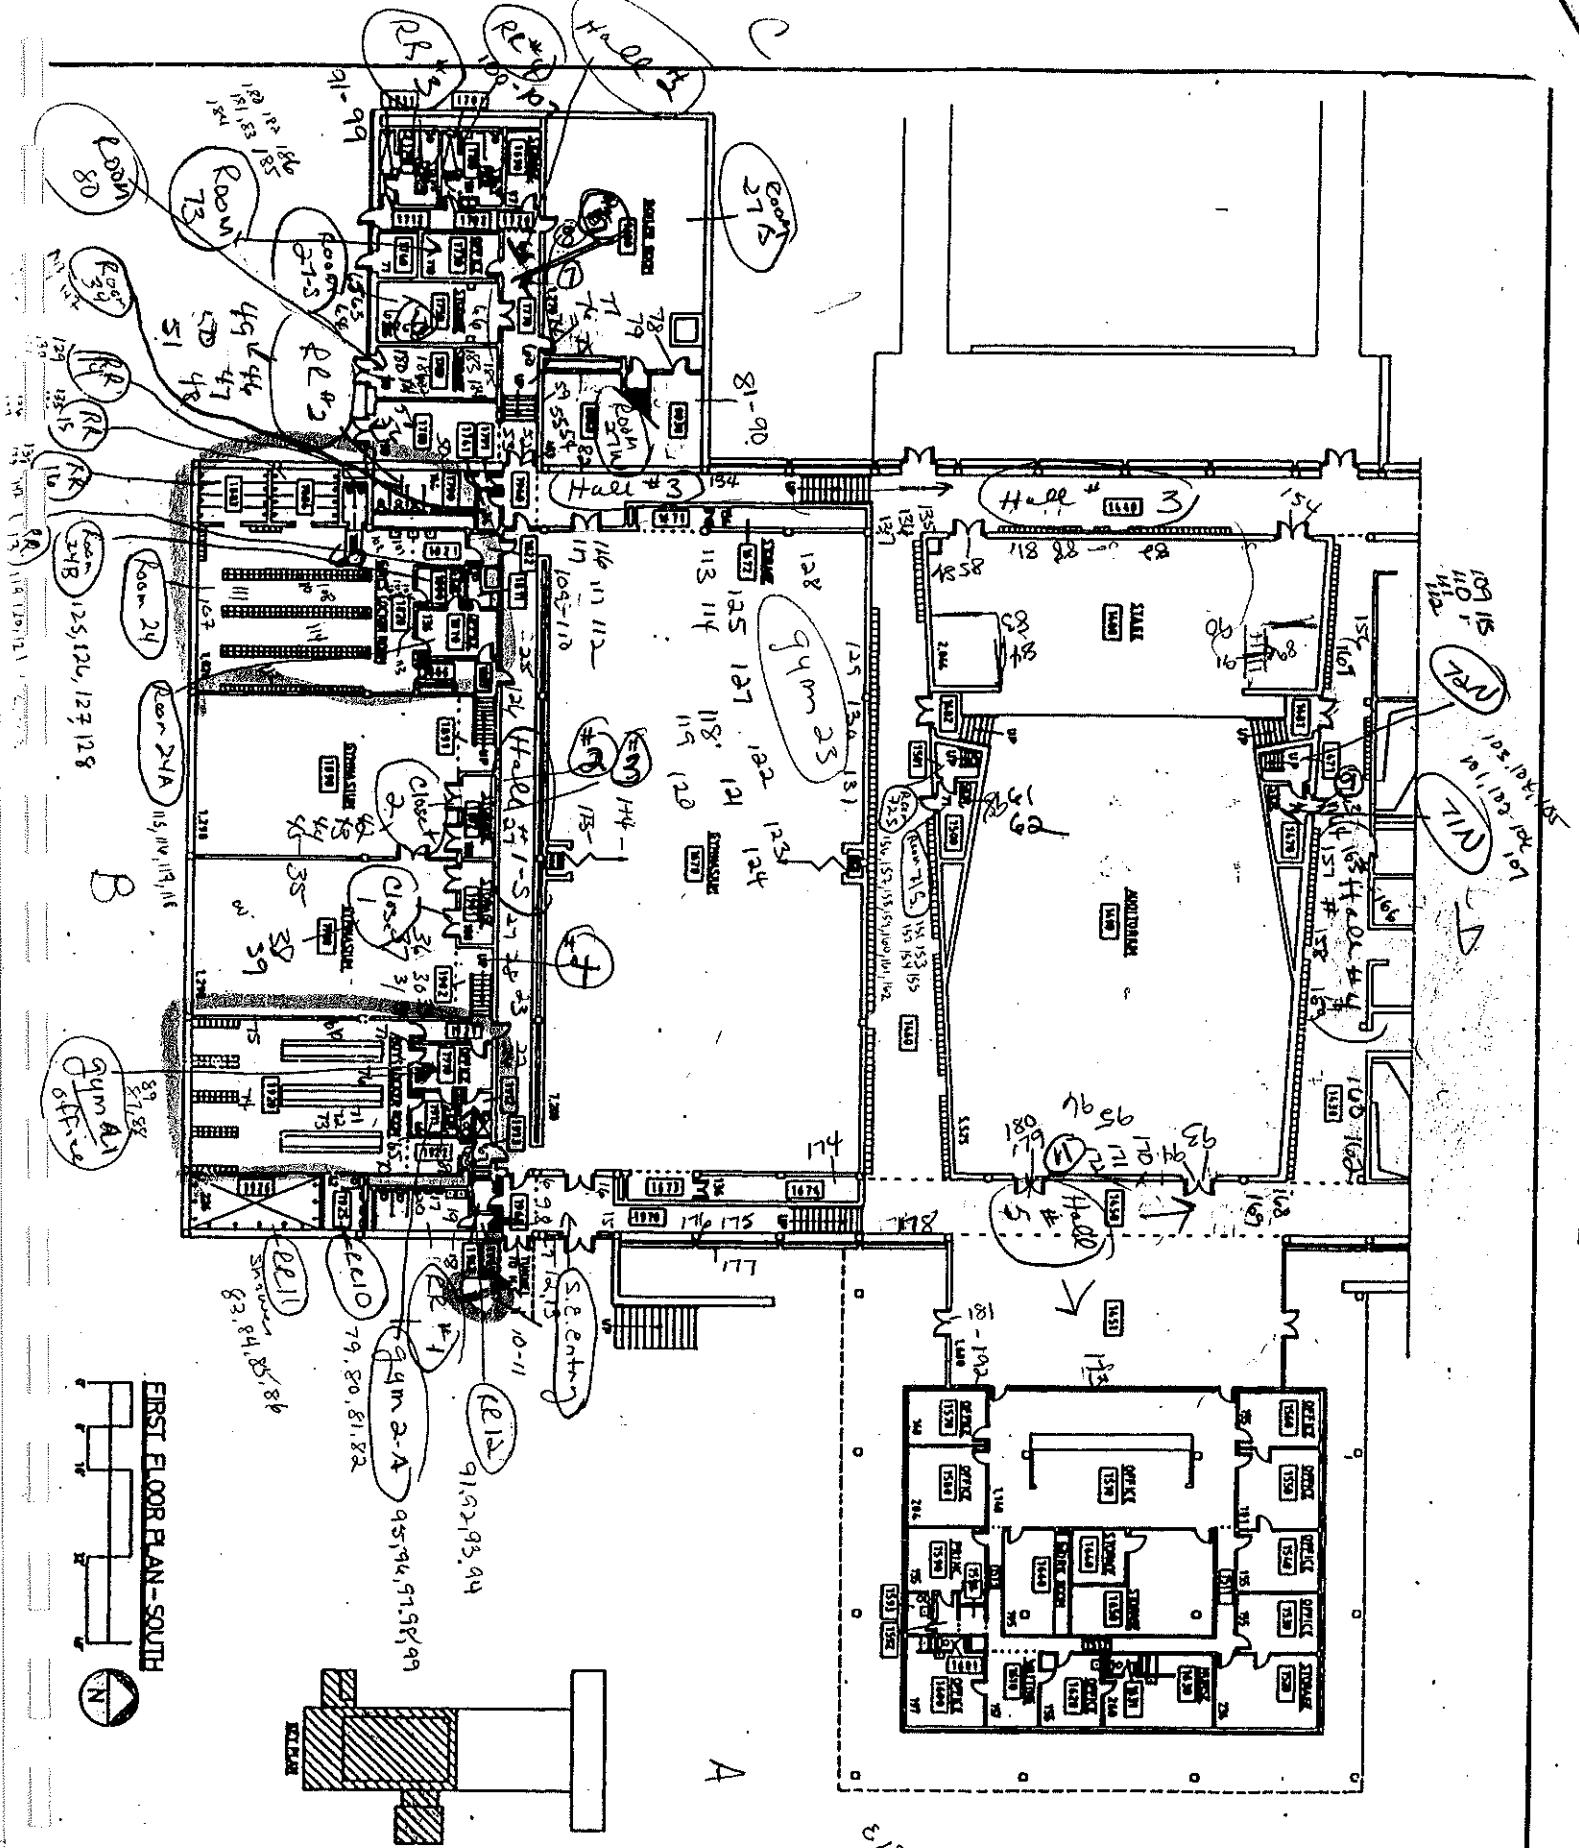

INDEPENDANT SCHOOL DIST. #625
360 COLBORNE STREET
ST. PAUL, MN 55102

HIGHLAND PARK JUNIOR HIGH
1015 S. SNELLING AVE.
ST. PAUL, MN 55116


CONSTRUCTED 1964, 71

S 8



FIRST FLOOR PLAN - SOUTH

62-0197 M
416-91

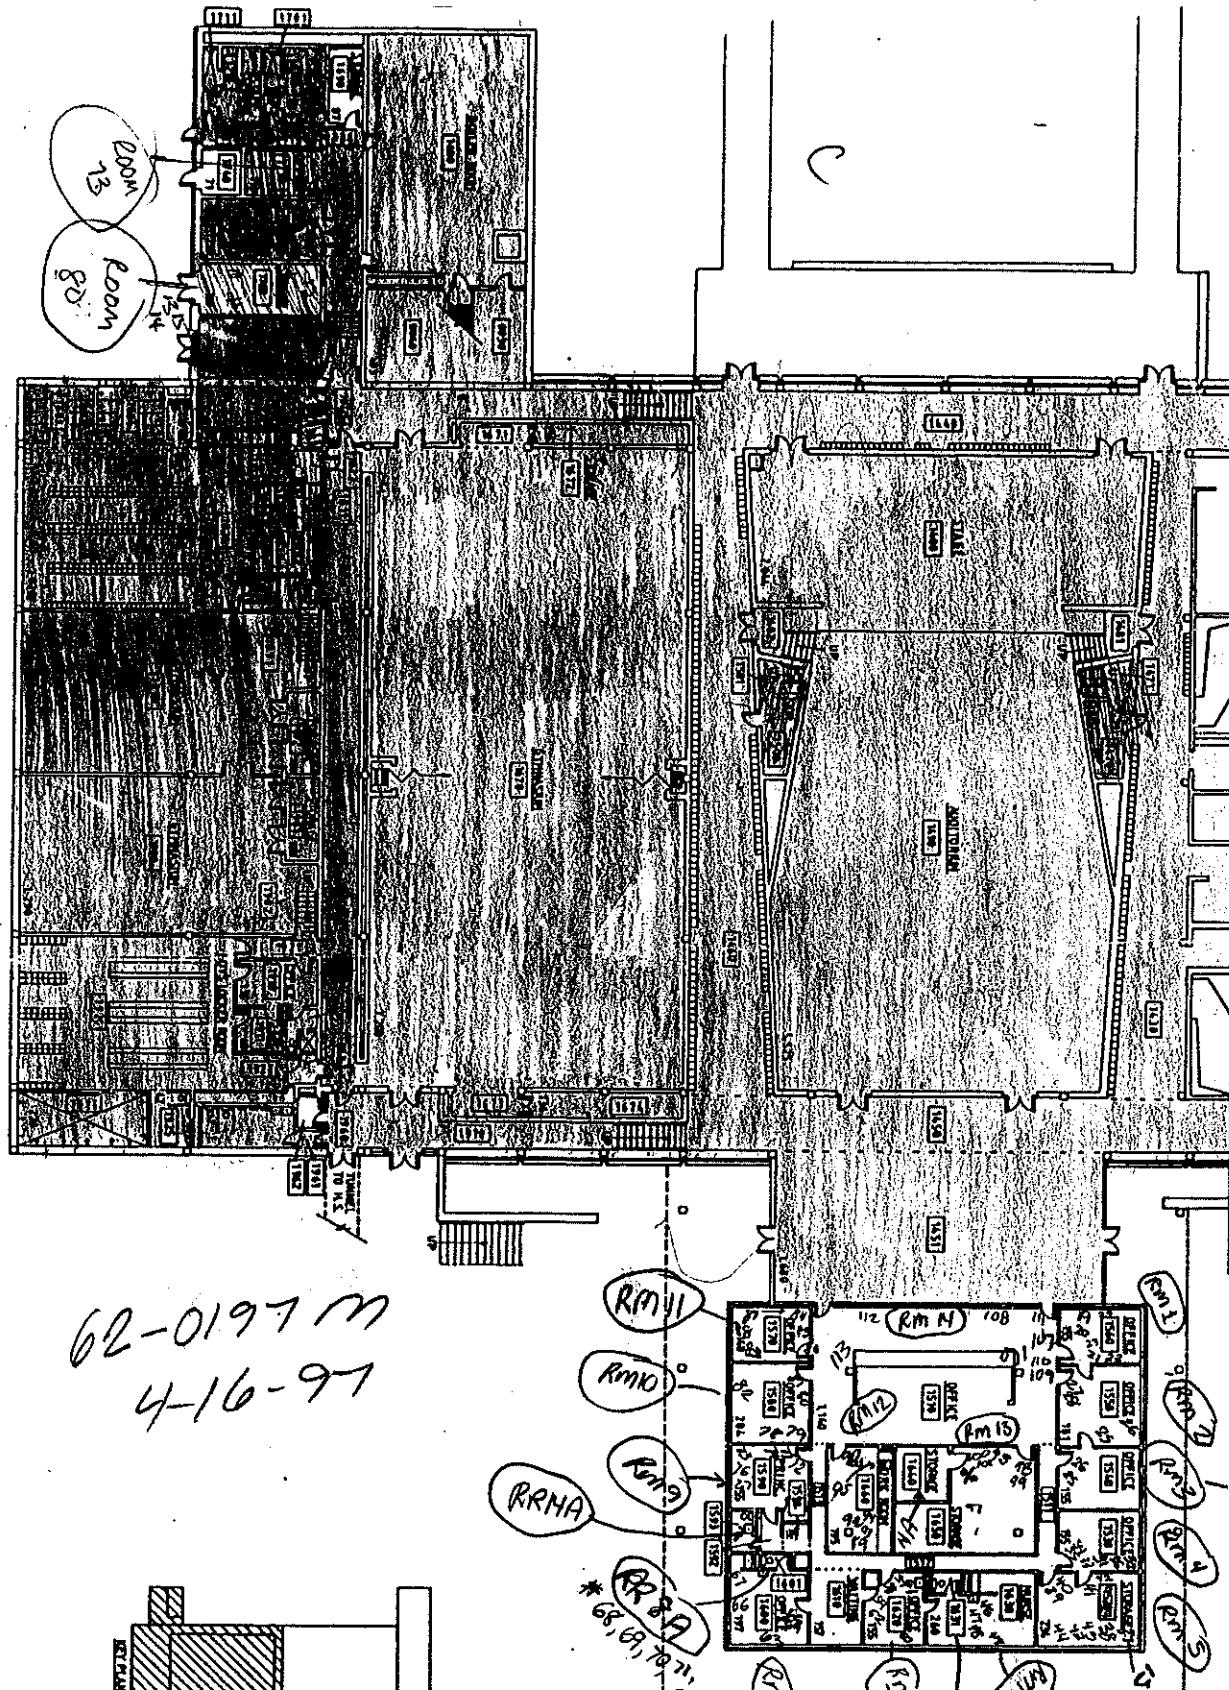

5 He 9

INDEPENDANT SCHOOL DIST. #825
360 COLBORNE STREET
ST. PAUL, MN 55102

HIGHLAND PARK JUNIOR HIGH
1015 S. SNELLING AVE.
ST. PAUL, MN 55116

CONSTRUCTED 1964, 71

STREET
\$ OF
8

Saint Paul Public Schools
 Highland Park Junior High School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
1	Highland Park Junior High School											
2												
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Componen	Feature	Condition	Substrate	Result
4	1958 Bldg	92	XRF	5/7/97	1	Auditoriu	S	Wall	Midle Wall	Solid	Metal	0.02
5	1958 Bldg	93	XRF	5/7/97	1	Auditoriu	S	Door	Door	Solid	Metal	0.08
6	1958 Bldg	94	XRF	5/7/97	1	Auditoriu	S	Door	Jamb	Solid	Metal	0.25
7	1958 Bldg	95	XRF	5/7/97	1	Auditoriu	S	Ceiling	Jamb	Solid	Plaster	0.02
8	1958 Bldg	96	XRF	5/7/97	1	Auditoriu	S	Ceiling	Trim	Solid	Metal	0.03
9	1958 Bldg	97	XRF	5/7/97	1	Auditoriu	S	Seats		Solid	Metal	0.42
10	1958 Bldg	98	XRF	5/7/97	1	Auditoriu	S		Hand rail	Solid	Metal	0.05
11	1958 Bldg	70	XRF	5/22/97	1	Bath	9A	Wall	Wall	Solid	Plaster	0.01
12	1958 Bldg	71	XRF	5/22/97	1	Bath	9A	Wall	Wall	Solid	Plaster	0
13	1958 Bldg	72	XRF	5/22/97	1	Bath	9A	Wall	Midle Wall	Solid	Concrete	0.18
14	1958 Bldg	73	XRF	5/22/97	1	Bath	9A	Door	Door	Solid	Wood	0.01
15	1958 Bldg	74	XRF	5/22/97	1	Bath	9A	Door	Casing	Solid	Metal	0.08
16	1958 Bldg	75	XRF	5/22/97	1	Bath	9A	Cabinet	Door	Solid	Wood	0.01
17	1958 Bldg	76	XRF	5/22/97	1	Bath	9A	Ceiling	Diffuser	Solid	Metal	0.02
18	1958 Bldg	77	XRF	5/22/97	1	Bath	9A	Floor		Solid	Concrete	0.22
19	1958 Bldg	78	XRF	5/22/97	1	Bath	9A	Wall	Wall	Solid	Plaster	0.01
20	1958 Bldg	79	XRF	5/22/97	1	Bath	9A	Wall	Wall	Solid	Plaster	0.02
21	1958 Bldg	80	XRF	5/22/97	1	Bath	9A	Door	Door	Solid	Wood	0.02
22	1958 Bldg	81	XRF	5/22/97	1	Bath	9A	Door	Casing	Solid	Metal	0.12
23	1958 Bldg	82	XRF	5/22/97	1	Bath	9A	Shelf		Solid	Wood	0.01
24	1958 Bldg	83	XRF	5/22/97	1	Bath	9A	Ceiling		Solid	Plaster	0.01
25	1958 Bldg	8	XRF	5/7/97	2	Cafeteria	0	Wall	Wall	Solid	Wood	0.01
26	1958 Bldg	9	XRF	5/7/97	2	Cafeteria	0	Wall	Wall	Solid	Wood	0.03
27	1958 Bldg	10	XRF	5/7/97	2	Cafeteria	0	Wall	Midle Wall	Solid	Concrete	0.01
28	1958 Bldg	11	XRF	5/7/97	2	Cafeteria	0	Wall	Wall	Solid	Wood	0.01
29	1958 Bldg	12	XRF	5/7/97	2	Cafeteria	0	Wall	Wall	Solid	Plaster	0.01
30	1958 Bldg	13	XRF	5/7/97	2	Cafeteria	0	Wall	Wall	Solid	Plaster	0.01
31	1958 Bldg	14	XRF	5/7/97	2	Cafeteria	0	Door	Door	Solid	Wood	0.02
32	1958 Bldg	15	XRF	5/7/97	2	Cafeteria	0	Door	Jamb	Solid	Metal	0.06
33	1958 Bldg	16	XRF	5/7/97	2	Cafeteria	0	Door	Door	Solid	Metal	0.44
34	1958 Bldg	17	XRF	5/7/97	2	Cafeteria	0	Door	Jamb	Solid	Metal	0.16
35	1958 Bldg	18	XRF	5/7/97	2	Cafeteria	0	Door	Door	Solid	Metal	0.08
36	1958 Bldg	19	XRF	5/7/97	2	Cafeteria	0	Door	Jamb	Solid	Metal	0.22
37	1958 Bldg	20	XRF	5/7/97	2	Cafeteria	0	Door	Header	Solid	Metal	4.34
38	1958 Bldg	21	XRF	5/7/97	2	Cafeteria	0		Column	Solid	Metal	0.05
39	1958 Bldg	22	XRF	5/7/97	2	Cafeteria	0		Column	Solid	Metal	0.04
40	1958 Bldg	23	XRF	5/7/97	2	Cafeteria	0		Column	Solid	Wood	0.02
41	1958 Bldg	24	XRF	5/7/97	2	Cafeteria	0		Radiator	Solid	Metal	0.09
42	1958 Bldg	25	XRF	5/7/97	2	Cafeteria	0	Bulletin B	Frame	Solid	Metal	0
43	1958 Bldg	26	XRF	5/7/97	2	Cafeteria	0	Bulletin B	Frame	Solid	Wood	0
44	1958 Bldg	27	XRF	5/7/97	2	Cafeteria	0	Chalk Boa	Frame	Solid	Wood	0.01
45	1958 Bldg	28	XRF	5/7/97	2	Cafeteria	0	Bulletin B	Frame	Solid	Wood	1.62
46	1958 Bldg	29	XRF	5/7/97	2	Cafeteria	0	Wall	Baseboar	Solid	Concrete	0.01
47	1958 Bldg	30	XRF	5/7/97	2	Cafeteria	0	Wall	Wall Rgstr	Solid	Metal	0.12
48	1958 Bldg	31	XRF	5/7/97	2	Cafeteria	0	Wall	Wall Rgstr	Solid	Metal	0.11
49	1958 Bldg	32	XRF	5/7/97	2	Cafeteria	0	Wall	Wall Rgstr	Solid	Wood	0.08
50	1958 Bldg	33	XRF	5/7/97	2	Cafeteria	0	Unlisted	Hatch	Solid	Metal	0.13
51	1958 Bldg	34	XRF	5/7/97	2	Cafeteria	0	Fire	Extinguish	Solid	Metal	0.02
52	1958 Bldg	207	XRF	6/2/97	2	Cafeteria	0	Wall	Midle Wall	Solid	Concrete	1.56
53	1958 Bldg	208	XRF	6/2/97	2	Cafeteria	0	Wall	Midle Wall	Solid	Concrete	0.03
54	1958 Bldg	209	XRF	6/2/97	2	Cafeteria	0	Wall	Midle Wall	Solid	Metal	0.03
55	1958 Bldg	210	XRF	6/2/97	2	Cafeteria	0	Wall	Wall	Solid	Plaster	0.09
56	1958 Bldg	211	XRF	6/2/97	2	Cafeteria	0	Window	Panel	Solid	Wood	0.03
57	1958 Bldg	212	XRF	6/2/97	2	Cafeteria	0	Wall	Baseboar	Solid	Tile	1.15
58	1958 Bldg	213	XRF	6/2/97	2	Cafeteria	0	Door	Door	Solid	Metal	0.47
59	1958 Bldg	214	XRF	6/2/97	2	Cafeteria	0	Door	Casing	Solid	Metal	0.08
60	1958 Bldg	215	XRF	6/2/97	2	Cafeteria	0	Window	Panel	Solid	Wood	0
61	1958 Bldg	216	XRF	6/2/97	2	Cafeteria	0	Door	Door	Solid	Wood	0.01
62	1958 Bldg	217	XRF	6/2/97	2	Cafeteria	0	Door	Casing	Solid	Metal	0.01
63	1958 Bldg	218	XRF	6/2/97	2	Cafeteria	0	Door	Door	Solid	Metal	0
64	1958 Bldg	219	XRF	6/2/97	2	Cafeteria	0	Wall	Chair rail	Solid	Wood	0

Saint Paul Public Schools
 Highland Park Junior High School
 Lead-Based Paint Inspection

A	B	C	D	E	F	G	H	I	J	K	L	
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Compon	Feature	Condition	Substrate	Result
65	1958 Bldg	220	XRF	6/2/97	2	Cafeteria	0	Wall	Wall Rgstr	Solid	Metal	0.02
66	1958 Bldg	221	XRF	6/2/97	2	Cafeteria	0	Ceiling	Diffuser	Solid	Metal	0.03
67	1958 Bldg	222	XRF	6/2/97	2	Cafeteria	0	Wall	Wall Rgstr	Solid	Metal	0.02
68	1958 Bldg	223	XRF	6/2/97	2	Cafeteria	0	Column	Solid	Metal		4.13
69	1958 Bldg	35	XRF	5/7/97	2	Cafeteria	1	Wall	Midle Wall	Solid	Tile	0.18
70	1958 Bldg	36	XRF	5/7/97	2	Cafeteria	1	Wall	Midle Wall	Solid	Concrete	0.05
71	1958 Bldg	37	XRF	5/7/97	2	Cafeteria	1	Door	Door	Solid	Wood	0.03
72	1958 Bldg	38	XRF	5/7/97	2	Cafeteria	1	Door	Jamb	Solid		0.07
73	1958 Bldg	39	XRF	5/7/97	2	Cafeteria	1	Door	Header	Solid	Metal	0.08
74	1958 Bldg	40	XRF	5/7/97	2	Cafeteria	1	Cabinet	Door	Solid	Wood	0.01
75	1958 Bldg	41	XRF	5/7/97	2	Cafeteria	1	Cabinet	Shelf	Solid	Wood	0.03
76	1958 Bldg	42	XRF	5/7/97	2	Cafeteria	1		Radiator	Solid	Metal	0.03
77	1958 Bldg	43	XRF	5/7/97	2	Cafeteria	1	Wall	Hatch	Solid	Metal	0.01
78	1958 Bldg	44	XRF	5/7/97	2	Cafeteria	2	Wall	Midle Wall	Solid	Tile	0.24
79	1958 Bldg	45	XRF	5/7/97	2	Cafeteria	2	Door	Door	Solid	Wood	0.02
80	1958 Bldg	46	XRF	5/7/97	2	Cafeteria	2	Door	Jamb	Solid	Metal	0.11
81	1958 Bldg	47	XRF	5/7/97	2	Cafeteria	3	Ceiling		Solid	Plaster	0.01
82	1958 Bldg	48	XRF	5/7/97	2	Cafeteria	3	Wall	Midle Wall	Solid	Tile	0.26
83	1958 Bldg	49	XRF	5/7/97	2	Cafeteria	3	Wall	Wall	Solid	Wood	0
84	1958 Bldg	109	XRF	4/12/97	1	Gym	23	Wall	Wall	Solid	Tile	0.2
85	1958 Bldg	110	XRF	4/12/97	1	Gym	23	Wall	Wall	Solid	Concrete	0.01
86	1958 Bldg	111	XRF	4/12/97	1	Gym	23	I-Beam		Solid	Metal	0.02
87	1958 Bldg	112	XRF	4/12/97	1	Gym	23	Wall	Wall	Solid	Concrete	0.01
88	1958 Bldg	113	XRF	4/12/97	1	Gym	23	Wall	Wall	Solid	Wood	0
89	1958 Bldg	114	XRF	4/12/97	1	Gym	23	Wall	Wall	Solid	Wood	0.01
90	1958 Bldg	115	XRF	4/12/97	1	Gym	23	Wall	Baseboar	Solid	Wood	0
91	1958 Bldg	116	XRF	4/12/97	1	Gym	23	Wall	Baseboar	Solid	Wood	0
92	1958 Bldg	117	XRF	4/12/97	1	Gym	23	Door	Door	Solid	Wood	0.03
93	1958 Bldg	118	XRF	4/12/97	1	Gym	23	Door	Jamb	Solid	Metal	0.08
94	1958 Bldg	119	XRF	4/12/97	1	Gym	23	Floor		Solid	Wood	0.02
95	1958 Bldg	120	XRF	4/12/97	1	Gym	23	Floor		Solid	Wood	0.03
96	1958 Bldg	121	XRF	4/12/97	1	Gym	23	Floor		Solid	Wood	0.01
97	1958 Bldg	122	XRF	4/12/97	1	Gym	23	Floor		Solid	Wood	0.01
98	1958 Bldg	123	XRF	4/12/97	1	Gym	23	Floor		Solid	Wood	0.03
99	1958 Bldg	124	XRF	4/12/97	1	Gym	23	Floor		Solid	Wood	0
100	1958 Bldg	125	XRF	4/12/97	1	Gym	23	Backboard		Solid	Metal	0.24
101	1958 Bldg	126	XRF	4/12/97	1	Gym	23	Backboar	Bracket	Solid	Wood	0.89
102	1958 Bldg	127	XRF	4/12/97	1	Gym	23	Backboar	Hoop	Solid	Metal	0.46
103	1958 Bldg	128	XRF	4/12/97	1	Gym	23	Wood	Panel	Solid	Wood	0
104	1958 Bldg	129	XRF	4/12/97	1	Gym	23	Jungle Bars		Solid	Wood	0
105	1958 Bldg	130	XRF	4/12/97	1	Gym	23	Bracket		Solid	Metal	0.04
106	1958 Bldg	131	XRF	4/12/97	1	Gym	23	Wall	Wall Rgstr	Solid	Metal	0.06
107	1958 Bldg	132	XRF	4/12/97	1	Gym	23	Door	Threshold	Solid	Wood	0.01
108	1958 Bldg	30	XRF	4/12/97	1	Gym	0A	Wall	Midle Wall	Solid	Concrete	0.25
109	1958 Bldg	31	XRF	4/12/97	1	Gym	0A	Wall	Midle Wall	Solid	Concrete	0.08
110	1958 Bldg	32	XRF	4/12/97	1	Gym	0A	Door	Door	Solid	Wood	0.01
111	1958 Bldg	33	XRF	4/12/97	1	Gym	0A	Door	Jamb	Solid	Metal	0.04
112	1958 Bldg	34	XRF	4/12/97	1	Gym	0A		Column	Solid	Metal	0.04
113	1958 Bldg	35	XRF	4/12/97	1	Gym	0A		Radiator	Solid	Wood	0
114	1958 Bldg	36	XRF	4/12/97	1	Gym	0A	Stairs	Hand rail	Solid	Metal	0.02
115	1958 Bldg	37	XRF	4/12/97	1	Gym	0A	Stairs	Stringer	Solid	Metal	0.04
116	1958 Bldg	38	XRF	4/12/97	1	Gym	0A	Closet	Wall	Solid	Concrete	0.03
117	1958 Bldg	39	XRF	4/12/97	1	Gym	0A	Door	Door	Solid	Wood	0.01
118	1958 Bldg	40	XRF	4/12/97	1	Gym	0A	Door	Jamb	Solid	Metal	0.08
119	1958 Bldg	41	XRF	4/12/97	1	Gym	0A	Door	Header	Solid	Metal	0.04
120	1958 Bldg	42	XRF	4/12/97	1	Gym	0A	Closet	Wall	Solid	Concrete	0.03
121	1958 Bldg	43	XRF	4/12/97	1	Gym	0A	Door	Door	Solid	Wood	0.02
122	1958 Bldg	44	XRF	4/12/97	1	Gym	0A	Door	Jamb	Solid	Metal	0.06
123	1958 Bldg	45	XRF	4/12/97	1	Gym	0A	Door	Header	Solid	Metal	0.04
124	1958 Bldg	87	XRF	5/28/97	1	Gym	1A	Wall	Midle Wall	Solid	Tile	0.15
125	1958 Bldg	88	XRF	5/28/97	1	Gym	1A	Door	Door	Solid	Wood	0.01
126	1958 Bldg	89	XRF	5/28/97	1	Gym	1A	Door	Casing	Solid	Metal	0.02
127	1958 Bldg	90	XRF	5/28/97	1	Gym	1A	Bookcase	Shelf	Solid	Wood	0.01

Saint Paul Public Schools
 Highland Park Junior High School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L	
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Compon	Feature	Condition	Substrate	Result	
128	1958 Bldg	95	XRF	5/28/97	1	Gym	2A	Wall	Midle Wall	Solid	Tile	0.16	
129	1958 Bldg	96	XRF	5/28/97	1	Gym	2A	Door	Door	Solid	Wood	0.04	
130	1958 Bldg	97	XRF	5/28/97	1	Gym	2A	Door	Casing	Solid	Metal	0.06	
131	1958 Bldg	98	XRF	5/28/97	1	Gym	2A	Bookcase	Shelf	Solid	Wood	0.01	
132	1958 Bldg	99	XRF	5/28/97	1	Gym	2A	Bookcase	Shelf	Solid	Wood	0.2	
133	1958 Bldg	65	XRF	5/28/97	1	Gym	B	Wall	Midle Wall	Solid	Tile	0.27	
134	1958 Bldg	66	XRF	5/28/97	1	Gym	B	Wall	Midle Wall	Solid	Metal	0.06	
135	1958 Bldg	67	XRF	5/28/97	1	Gym	B	Door	Door	Solid	Wood	0.02	
136	1958 Bldg	68	XRF	5/28/97	1	Gym	B	Door	Casing	Solid	Metal	0.06	
137	1958 Bldg	69	XRF	5/28/97	1	Gym	B	Corkboard		Solid	Wood	0.02	
138	1958 Bldg	70	XRF	5/28/97	1	Gym	B	Picture	Board	Solid	Wood	0.01	
139	1958 Bldg	71	XRF	5/28/97	1	Gym	B	Bench		Solid	Wood	0.26	
140	1958 Bldg	72	XRF	5/28/97	1	Gym	B	Shelf		Solid	Wood	0.02	
141	1958 Bldg	73	XRF	5/28/97	1	Gym	B	Pole		Solid	Metal	0.19	
142	1958 Bldg	74	XRF	5/28/97	1	Gym	B	Locker		Solid	Metal	0.05	
143	1958 Bldg	75	XRF	5/28/97	1	Gym	B	Wall	Wall Rgstr	Peeling	Metal	0.04	
144	1958 Bldg	76	XRF	5/28/97	1	Gym	B	Window	Casing	Peeling	Metal	0.05	
145	1958 Bldg	77	XRF	5/28/97	1	Gym	B	Window	Casing	Peeling	Wood	0.01	
146	1958 Bldg	78	XRF	5/28/97	1	Gym	B	Ceiling		Solid	Wood	0	
147	1958 Bldg	93	XRF	4/24/97	3	Hall		1	Wall	Midle Wall	Plaster	0.14	
148	1958 Bldg	94	XRF	4/24/97	3	Hall		1	Wall	Midle Wall	Tile	0.26	
149	1958 Bldg	95	XRF	4/24/97	3	Hall		1	Elevator	Door	Solid	Metal	0.06
150	1958 Bldg	96	XRF	4/24/97	3	Hall		1	Elevator D	Jamb	Solid	Metal	0.03
151	1958 Bldg	97	XRF	4/24/97	3	Hall		1	Locker	Solid	Metal	0.04	
152	1958 Bldg	98	XRF	4/24/97	3	Hall		1	Radiator	Solid	Metal	0.12	
153	1958 Bldg	99	XRF	4/24/97	3	Hall		1	Wall	Wall Rgstr	Solid	Metal	0.07
154	1958 Bldg	100	XRF	4/24/97	3	Hall		1	Door	Door	Solid	Metal	0.11
155	1958 Bldg	101	XRF	4/24/97	3	Hall		1	Door	Jamb	Solid	Metal	0.08
156	1958 Bldg	102	XRF	4/24/97	3	Hall		1	Wall	Wall	Solid	Plaster	1.64
157	1958 Bldg	103	XRF	4/24/97	3	Hall		1	Wall	Wall	Solid	Plaster	1.17
158	1958 Bldg	104	XRF	4/24/97	3	Hall		1	Wall	Hatch	Solid	Metal	1.57
159	1958 Bldg	105	XRF	4/24/97	3	Hall		1	Wall	Hatch	Solid	Metal	1.77
160	1958 Bldg	106	XRF	4/24/97	3	Hall		1	Wall	Wall	Solid	Plaster	1.52
161	1958 Bldg	107	XRF	4/24/97	3	Hall		1	Locker	Solid	Metal	0.07	
162	1958 Bldg	251	XRF	6/2/97	1	Hall		1	Wall	Midle Wall	Solid	Concrete	0.02
163	1958 Bldg	252	XRF	6/2/97	1	Hall		1	Door	Door	Solid	Metal	0.19
164	1958 Bldg	253	XRF	6/2/97	1	Hall		1	Door	Casing	Solid	Metal	0.01
165	1958 Bldg	254	XRF	6/2/97	1	Hall		1	Door	Door	Solid	Wood	0.1
166	1958 Bldg	255	XRF	6/2/97	1	Hall		1	Door	Door	Solid	Metal	0.02
167	1958 Bldg	256	XRF	6/2/97	1	Hall		1	Door	Casing	Solid	Metal	0.01
168	1958 Bldg	257	XRF	6/2/97	1	Hall		1	Wall	Midle Wall	Solid	Concrte	0.02
169	1958 Bldg	258	XRF	6/2/97	1	Hall		1	Radiator	Solid	Metal	0.01	
170	1958 Bldg	259	XRF	6/2/97	1	Hall		1	Wall	Wall Rgstr	Solid	Metal	0.02
171	1958 Bldg	260	XRF	6/2/97	1	Hall		1	Elec Pane	Solid	Metal	0	
172	1958 Bldg	261	XRF	6/2/97	1	Hall		1	Elec Pane	Solid	Metal	0	
173	1958 Bldg	262	XRF	6/2/97	1	Hall		1	Ceiling		Solid	Wood	0
174	1958 Bldg	263	XRF	6/2/97	1	Hall		1	Ceiling		Solid	Wood	0.01
175	1958 Bldg	264	XRF	6/2/97	1	Hall		1	Ceiling		Solid	Concrte	0.01
176	1958 Bldg	52	XRF	4/12/97	1	Hall		2	Wall	Midle Wall	Solid	Concrete	0.02
177	1958 Bldg	53	XRF	4/12/97	1	Hall		2	Wall	Midle Wall	Solid	Concrete	0.06
178	1958 Bldg	54	XRF	4/12/97	1	Hall		2	Door	Door	Solid	Wood	0.04
179	1958 Bldg	55	XRF	4/12/97	1	Hall		2	Door	Jamb	Solid	Metal	0.06
180	1958 Bldg	56	XRF	4/12/97	1	Hall		2	Door	Door	Solid	Metal	0.25
181	1958 Bldg	57	XRF	4/12/97	1	Hall		2	Door	Jamb	Solid	Metal	0.42
182	1958 Bldg	58	XRF	4/12/97	1	Hall		2	Radiator	Solid	Metal	0	
183	1958 Bldg	59	XRF	4/12/97	1	Hall		2	Stairs	Hand rail	Solid	Metal	0.02
184	1958 Bldg	60	XRF	4/12/97	1	Hall		2	Fire Ext.	Cabinet	Solid	Metal	0.04
185	1958 Bldg	61	XRF	4/12/97	1	Hall		2	Ball	Mount	Solid	Wood	0.01
186	1958 Bldg	77	XRF	4/26/97	2	Hall		2	Wall	Midle Wall	Solid	Plaster	0.07
187	1958 Bldg	78	XRF	4/26/97	2	Hall		2	Wall	Midle Wall	Solid	Tile	0.2
188	1958 Bldg	79	XRF	4/26/97	2	Hall		2	Door	Door	Solid	Metal	0.06
189	1958 Bldg	80	XRF	4/26/97	2	Hall		2	Door	Jamb	Solid	Metal	0.08
190	1958 Bldg	81	XRF	4/26/97	2	Hall		2	Wall	Midle Wall	Solid	Plaster	1.26

Saint Paul Public Schools
 Highland Park Junior High School
 Lead-Based Paint Inspection

A	B	C	D	E	F	G	H	I	J	K	L	
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Compon	Feature	Condition	Substrate	Result
191	1958 Bldg	82	XRF	4/26/97	2	Hall	2	Wall	Wall	Solid	Plaster	1.29
192	1958 Bldg	83	XRF	4/26/97	2	Hall	2	Wall	Wall	Solid	Plaster	1
193	1958 Bldg	84	XRF	4/26/97	2	Hall	2	Door	Door	Solid	Metal	0.02
194	1958 Bldg	85	XRF	4/26/97	2	Hall	2	Door	Jamb	Solid	Metal	0.17
195	1958 Bldg	86	XRF	4/26/97	2	Hall	2		Locker	Solid	Metal	0.07
196	1958 Bldg	87	XRF	4/26/97	2	Hall	2		Radiator	Solid	Metal	0.06
197	1958 Bldg	88	XRF	4/26/97	2	Hall	2	Wall	Wall Rgstr	Solid	Metal	0.04
198	1958 Bldg	33	XRF	6/3/97	2	Hall	2	Wall	Midle Wall	Cracked	Concrete	0.02
199	1958 Bldg	34	XRF	6/3/97	2	Hall	2	Wall	Baseboar	Cracked	Tile	1.22
200	1958 Bldg	35	XRF	6/3/97	2	Hall	2	Door	Door	Cracked	Metal	0.06
201	1958 Bldg	36	XRF	6/3/97	2	Hall	2	Door	Casing	Cracked	Metal	0.07
202	1958 Bldg	37	XRF	6/3/97	2	Hall	2	Wall	Chair rail	Peeling	Wood	0.01
203	1958 Bldg	38	XRF	6/3/97	2	Hall	2	Floor		Solid	Tile	0.24
204	1958 Bldg	134	XRF	4/12/97	1	Hall	3	Wall	Wall	Solid	Tile	0.16
205	1958 Bldg	135	XRF	4/12/97	1	Hall	3	Wall	Midle Wall	Solid	Plaster	0
206	1958 Bldg	136	XRF	4/12/97	1	Hall	3	Wall	Midle Wall	Solid	Plaster	0.01
207	1958 Bldg	137	XRF	4/12/97	1	Hall	3	Wall	Midle Wall	Solid	Plaster	0
208	1958 Bldg	138	XRF	4/12/97	1	Hall	3	Wall	Wall	Solid	Wood	0
209	1958 Bldg	139	XRF	4/12/97	1	Hall	3	Wall	Wall	Solid	Wood	0.02
210	1958 Bldg	140	XRF	4/12/97	1	Hall	3		Column	Solid	Metal	0.03
211	1958 Bldg	141	XRF	4/12/97	1	Hall	3	Wall	Midle Wall	Solid	Tile	2.39
212	1958 Bldg	142	XRF	4/12/97	1	Hall	3	Wall	Midle Wall	Solid	Tile	0.18
213	1958 Bldg	143	XRF	4/12/97	1	Hall	3	Wall	Midle Wall	Solid	Metal	0.02
214	1958 Bldg	144	XRF	4/12/97	1	Hall	3	Door	Door	Solid	Wood	0.02
215	1958 Bldg	145	XRF	4/12/97	1	Hall	3	Door	Jamb	Solid	Metal	0.07
216	1958 Bldg	146	XRF	4/12/97	1	Hall	3	Window	Casing	Solid	Metal	0.05
217	1958 Bldg	147	XRF	4/12/97	1	Hall	3	Door	Door	Solid	Metal	0.26
218	1958 Bldg	148	XRF	4/12/97	1	Hall	3	Wall	Wall	Solid	Wood	0.01
219	1958 Bldg	149	XRF	4/12/97	1	Hall	3	Stairs	Hand rail	Solid	Wood	0.01
220	1958 Bldg	150	XRF	4/12/97	1	Hall	3		Column	Solid	Metal	0.04
221	1958 Bldg	151	XRF	4/12/97	1	Hall	3		Radiator	Solid	Metal	0.07
222	1958 Bldg	152	XRF	4/12/97	1	Hall	3		Locker	Solid	Metal	0.05
223	1958 Bldg	153	XRF	4/12/97	1	Hall	3	Door	Door	Solid	Metal	0.11
224	1958 Bldg	154	XRF	4/12/97	1	Hall	3	Wall	Panel	Solid	Wood	0
225	1958 Bldg	155	XRF	4/12/97	1	Hall	3	Window	Casing	Solid	Wood	0.01
226	1958 Bldg	153	XRF	4/26/97	1	Hall	3	Wall	Midle Wall	Solid	Plaster	0.07
227	1958 Bldg	154	XRF	4/26/97	1	Hall	3	Wall	Midle Wall	Solid	Tile	0.17
228	1958 Bldg	155	XRF	4/26/97	1	Hall	3	Door	Door	Solid	Metal	0.06
229	1958 Bldg	156	XRF	4/26/97	1	Hall	3	Door	Jamb	Solid	Metal	0.03
230	1958 Bldg	157	XRF	4/26/97	1	Hall	3		Radiator	Solid	Metal	0
231	1958 Bldg	158	XRF	4/26/97	1	Hall	3		Locker	Solid	Metal	0.02
232	1958 Bldg	159	XRF	4/26/97	1	Hall	3	Wall	Wall	Solid	Wood	0.02
233	1958 Bldg	160	XRF	4/26/97	1	Hall	3	Door	Door	Solid	Metal	0.01
234	1958 Bldg	156	XRF	4/12/97	1	Hall	4	Wall	Midle Wall	Solid	Tile	0.28
235	1958 Bldg	157	XRF	4/12/97	1	Hall	4	Wall	Wall	Solid	Plaster	0
236	1958 Bldg	158	XRF	4/12/97	1	Hall	4	Wall	Midle Wall	Solid	Plaster	0.01
237	1958 Bldg	159	XRF	4/12/97	1	Hall	4	Wall	Wall	Solid	Plaster	0.01
238	1958 Bldg	160	XRF	4/12/97	1	Hall	4	Door	Door	Solid	Wood	0.02
239	1958 Bldg	161	XRF	4/12/97	1	Hall	4	Door	Jamb	Solid	Metal	0.08
240	1958 Bldg	162	XRF	4/12/97	1	Hall	4	Door	Jamb	Solid	Metal	0.08
241	1958 Bldg	163	XRF	4/12/97	1	Hall	4	Door	Door	Solid	Metal	0.07
242	1958 Bldg	164	XRF	4/12/97	1	Hall	4	Door	Jamb	Solid	Metal	0.08
243	1958 Bldg	165	XRF	4/12/97	1	Hall	4		Column	Solid	Metal	0.06
244	1958 Bldg	166	XRF	4/12/97	1	Hall	4		Elec Pane	Solid	Metal	0.12
245	1958 Bldg	167	XRF	4/12/97	1	Hall	4		Locker	Solid	Metal	0.22
246	1958 Bldg	168	XRF	4/12/97	1	Hall	5	Wall	Wall	Solid	Plaster	0
247	1958 Bldg	169	XRF	4/12/97	1	Hall	5	Wall	Midle Wall	Solid	Plaster	0.02
248	1958 Bldg	170	XRF	4/12/97	1	Hall	5	Wall	Wall	Solid	Plaster	0.01
249	1958 Bldg	171	XRF	4/12/97	1	Hall	5	Wall	Wall	Solid	Plaster	0.01
250	1958 Bldg	172	XRF	4/12/97	1	Hall	5	Wall	Wall	Solid	Plaster	0.01
251	1958 Bldg	173	XRF	4/12/97	1	Hall	5	Wall	Wall	Solid	Tile	5.09
252	1958 Bldg	174	XRF	4/12/97	1	Hall	5	Wall	Midle Wall	Solid	Tile	0.21
253	1958 Bldg	175	XRF	4/12/97	1	Hall	5	Wall	Panel	Solid	Wood	0.03

Saint Paul Public Schools
 Highland Park Junior High School
 Lead-Based Paint Inspection

A	B	C	D	E	F	G	H	I	J	K	L
Site	Sample #	Analysis	Date	Floor	Area	Room#	Compon	Feature	Condition	Substrate	Result
254	1958 Bldg	176 XRF	4/12/97	1 Hall		5	Wall	Panel	Solid	Wood	0.04
255	1958 Bldg	177 XRF	4/12/97	1 Hall		5	Stairs	Baluster	Solid	Metal	0.03
256	1958 Bldg	178 XRF	4/12/97	1 Hall		5	Wall	Wall Rgstr	Solid	Metal	0
257	1958 Bldg	179 XRF	4/12/97	1 Hall		5	Door	Door	Solid	Metal	0.12
258	1958 Bldg	180 XRF	4/12/97	1 Hall		5	Door	Jamb	Solid	Metal	0.16
259	1958 Bldg	181 XRF	4/12/97	1 Hall		5	Door	Door	Solid	Metal	0.25
260	1958 Bldg	182 XRF	4/12/97	1 Hall		5	Wall	Midle Wall	Solid	Tile	2.02
261	1958 Bldg	183 XRF	4/12/97	1 Hall		5	Door	Door	Solid	Wood	0.02
262	1958 Bldg	184 XRF	4/12/97	1 Hall		5	Door	Jamb	Solid	Metal	0.07
263	1958 Bldg	185 XRF	4/12/97	1 Hall		5	Elec Pane	Solid	Metal	0.18	
264	1958 Bldg	186 XRF	4/12/97	1 Hall		5	Column	Solid	Metal	0.04	
265	1958 Bldg	187 XRF	4/12/97	1 Hall		5	Window	Casing	Solid	Metal	0.08
266	1958 Bldg	188 XRF	4/12/97	1 Hall		5	Radiator	Solid	Metal	0.1	
267	1958 Bldg	189 XRF	4/12/97	1 Hall		5	Stairs	Hand rail	Solid	Wood	0
268	1958 Bldg	190 XRF	4/12/97	1 Hall		5		Locker	Solid	Metal	0.19
269	1958 Bldg	191 XRF	4/12/97	1 Hall		5		Crown mo	Solid	Wood	0
270	1958 Bldg	192 XRF	4/12/97	1 Hall		5		Radiator	Solid	Metal	0.02
271	1958 Bldg	193 XRF	4/12/97	1 Hall		6	Wall	Midle Wall	Solid	Tile	0.28
272	1958 Bldg	194 XRF	4/12/97	1 Hall		6	Wall	Wall	Solid	Wood	0.01
273	1958 Bldg	195 XRF	4/12/97	1 Hall		6	Wall	Wall	Solid	Wood	0
274	1958 Bldg	196 XRF	4/12/97	1 Hall		6	Door	Door	Solid	Wood	0.02
275	1958 Bldg	197 XRF	4/12/97	1 Hall		6	Door	Jamb	Solid	Metal	0.07
276	1958 Bldg	198 XRF	4/12/97	1 Hall		6	Window	Casing	Solid	Metal	0.09
277	1958 Bldg	199 XRF	4/12/97	1 Hall		6		Column	Solid	Metal	0.03
278	1958 Bldg	200 XRF	4/12/97	1 Hall		6		Column	Solid	Metal	0.07
279	1958 Bldg	201 XRF	4/12/97	1 Hall		6		Elec Pane	Solid	Metal	0.17
280	1958 Bldg	6 XRF	4/16/97	1 Hall		7	Wall	Midle Wall	Solid	Brick	5.09
281	1958 Bldg	7 XRF	4/16/97	1 Hall		7	Wall	Midle Wall	Solid	Concrte	0.03
282	1958 Bldg	8 XRF	4/16/97	1 Hall		7	Door	Door	Solid	Metal	0
283	1958 Bldg	9 XRF	4/16/97	1 Hall		7	Door	Jamb	Solid	Metal	0.02
284	1958 Bldg	10 XRF	4/16/97	1 Hall		7	Gate		Solid	Metal	0.02
285	1958 Bldg	11 XRF	4/16/97	1 Hall		7	Stairs	Hand rail	Solid	Wood	0.01
286	1958 Bldg	12 XRF	4/16/97	1 Hall		7	Stairs	Hand rail	Solid	Metal	0.16
287	1958 Bldg	13 XRF	4/16/97	1 Hall		7	Ceiling		Solid	Plaster	0.08
288	1958 Bldg	14 XRF	4/16/97	1 Hall		7	Door	Door	Solid	Metal	0.18
289	1958 Bldg	15 XRF	4/16/97	1 Hall		7	Door	Jamb	Solid	Metal	0.1
290	1958 Bldg	16 XRF	4/16/97	1 Hall		7	Door	Header	Solid	Metal	5.09
291	1958 Bldg	17 XRF	4/16/97	1 Hall		7		Radiator	Solid	Metal	0.01
292	1958 Bldg	18 XRF	4/16/97	1 Hall		7		Radiator	Solid	Metal	0.01
293	1958 Bldg	330 XRF	5/27/97	1 Hall		7	Wall	Wall	Solid	Concrte	0.09
294	1958 Bldg	331 XRF	5/27/97	1 Hall		7	Wall	Wall	Solid	Concrte	0.04
295	1958 Bldg	332 XRF	5/27/97	1 Hall		7	Wall	Midle Wall	Solid	Drywall	0
296	1958 Bldg	333 XRF	5/27/97	1 Hall		7	Beam		Solid	Metal	0.01
297	1958 Bldg	334 XRF	5/27/97	1 Hall		7	Door	Door	Solid	Wood	0.02
298	1958 Bldg	335 XRF	5/27/97	1 Hall		7	Door	Casing	Solid	Metal	0.08
299	1958 Bldg	336 XRF	5/27/97	1 Hall		7	Wall	Wall Rgstr	Solid	Metal	0.6
300	1958 Bldg	337 XRF	5/27/97	1 Hall		7	Wall	Wall Rgstr	Solid	Metal	0.02
301	1958 Bldg	338 XRF	5/27/97	1 Hall		7	Window	Casing	Solid	Metal	0.02
302	1958 Bldg	339 XRF	5/27/97	1 Hall		7	Speaker	Box	Solid	Metal	0
303	1958 Bldg	340 XRF	5/27/97	1 Hall		7	Ceiling		Solid	Drywall	0.01
304	1958 Bldg	370 XRF	5/27/97	1 Hall		7	Wall	Baseboar	Solid	Metal	0.09
305	1958 Bldg	378 XRF	5/27/97	1 Hall		8	Wall	Wall	Solid	Tile	0.25
306	1958 Bldg	379 XRF	5/27/97	1 Hall		8	Ceiling		Solid	Plaster	0.01
307	1958 Bldg	380 XRF	5/27/97	1 Hall		8	Wall	Midle Wall	Solid	Wood	0.02
308	1958 Bldg	381 XRF	5/27/97	1 Hall		8	Wall	Midle Wall	Solid	Wood	0.69
309	1958 Bldg	382 XRF	5/27/97	1 Hall		8	Wall	Midle Wall	Solid	Wood	0.02
310	1958 Bldg	383 XRF	5/27/97	1 Hall		8	Wall	Midle Wall	Solid	Wood	0
311	1958 Bldg	384 XRF	5/27/97	1 Hall		8	Door	Door	Solid	Metal	0.25
312	1958 Bldg	385 XRF	5/27/97	1 Hall		8		Radiator	Solid	Metal	0
313	1958 Bldg	386 XRF	5/27/97	1 Hall		8		Locker	Solid	Metal	0.04
314	1958 Bldg	387 XRF	5/27/97	1 Hall		8	Ceiling	Hatch	Solid	Metal	0.02
315	1958 Bldg	388 XRF	5/27/97	1 Hall		8	Wall	Wall Rgstr	Solid	Metal	0.05
316	1958 Bldg	141 XRF	6/17/97	1 Hall		109	Wall	Midle Wall	Solid	Drywall	0.05

Saint Paul Public Schools
 Highland Park Junior High School
 Lead-Based Paint Inspection

A	B	C	D	E	F	G	H	I	J	K	L
Site	Sample #	Analysis	Date	Floor	Area	Room#	Componen	Feature	Condition	Substrate	Result
3	1958 Bldg	142 XRF	6/17/97	1	Hall	109	Wall	Midle Wall	Solid	Concrete	0.03
317	1958 Bldg	143 XRF	6/17/97	1	Hall	109	Wall	Midle Wall	Solid	Wood	0.02
318	1958 Bldg	144 XRF	6/17/97	1	Hall	109	Wall	Midle Wall	Solid	Metal	0.01
319	1958 Bldg	145 XRF	6/17/97	1	Hall	109	Door	Door	Solid	Wood	0
320	1958 Bldg	146 XRF	6/17/97	1	Hall	109	Door	Casing	Solid	Metal	0.03
321	1958 Bldg	147 XRF	6/17/97	1	Hall	109	Wall	Midle Wall	Solid	Wood	0.08
322	1958 Bldg	148 XRF	6/17/97	1	Hall	109	Floor		Solid	Wood	0
323	1958 Bldg	22 XRF	4/12/97	1	Hall	1S	Wall	Midle Wall	Solid	Tile	0.25
324	1958 Bldg	23 XRF	4/12/97	1	Hall	1S	Wall	Midle Wall	Solid	Concrete	0.05
325	1958 Bldg	24 XRF	4/12/97	1	Hall	1S	Wall	Midle Wall	Solid	Metal	0.02
326	1958 Bldg	25 XRF	4/12/97	1	Hall	1S	Door	Door	Solid	Wood	0.02
327	1958 Bldg	26 XRF	4/12/97	1	Hall	1S	Door	Jamb	Solid	Metal	0.08
328	1958 Bldg	27 XRF	4/12/97	1	Hall	1S	Wall	Wall Rgstr	Solid	Metal	0
329	1958 Bldg	28 XRF	4/12/97	1	Hall	1S	Ceiling	Hatch	Solid	Metal	0.12
330	1958 Bldg	29 XRF	4/12/97	1	Hall	1S		Elec Pane	Solid	Metal	0.07
331	1958 Bldg	73 XRF	5/7/97	2	Hall	C	Wall	Midle Wall	Solid	Wood	0
332	1958 Bldg	74 XRF	5/7/97	2	Hall	C	Wall	Midle Wall	Solid	Tile	0.18
333	1958 Bldg	75 XRF	5/7/97	2	Hall	C	Door	Door	Solid	Metal	0.31
334	1958 Bldg	76 XRF	5/7/97	2	Hall	C	Door	Door	Solid	Metal	0.02
335	1958 Bldg	77 XRF	5/7/97	2	Hall	C	Door	Jamb	Solid	Metal	0.14
336	1958 Bldg	78 XRF	5/7/97	2	Hall	C		Radiator	Solid	Metal	0.02
337	1958 Bldg	79 XRF	5/7/97	2	Hall	C		Hand rail	Solid	Wood	0
338	1958 Bldg	80 XRF	5/7/97	2	Hall	C		Column	Solid	Metal	0.05
339	1958 Bldg	50 XRF	5/7/97	2	Kitchen	1	Wall	Midle Wall	Solid	Concrete	0.09
340	1958 Bldg	51 XRF	5/7/97	2	Kitchen	1	Wall	Wall	Solid	Plaster	0.01
341	1958 Bldg	52 XRF	5/7/97	2	Kitchen	1	Wall	Midle Wall	Solid	Wood	0.04
342	1958 Bldg	53 XRF	5/7/97	2	Kitchen	1	Door	Door	Solid	Wood	0.02
343	1958 Bldg	54 XRF	5/7/97	2	Kitchen	1	Door	Jamb	Solid	Wood	0
344	1958 Bldg	55 XRF	5/7/97	2	Kitchen	1	Door	Door	Solid	Metal	0.34
345	1958 Bldg	56 XRF	5/7/97	2	Kitchen	1	Door	Door	Solid	Metal	0.08
346	1958 Bldg	57 XRF	5/7/97	2	Kitchen	1	Door	Jamb	Solid	Metal	0.07
347	1958 Bldg	58 XRF	5/7/97	2	Kitchen	1	Door	Door	Solid	Wood	0.02
348	1958 Bldg	59 XRF	5/7/97	2	Kitchen	1	Door	Jamb	Solid	Metal	0.08
349	1958 Bldg	60 XRF	5/7/97	2	Kitchen	1	Freezer	Door	Solid	Metal	0
350	1958 Bldg	61 XRF	5/7/97	2	Kitchen	1		Column	Solid	Metal	0.07
351	1958 Bldg	62 XRF	5/7/97	2	Kitchen	1		Elec Pane	Solid	Metal	0.02
352	1958 Bldg	63 XRF	5/7/97	2	Kitchen	1		Wall Rgstr	Solid	Metal	0.04
353	1958 Bldg	64 XRF	5/7/97	2	Kitchen	1	Wall	Hatch	Solid	Metal	0
354	1958 Bldg	65 XRF	5/7/97	2	Kitchen	1	Wall	Midle Wall	Solid	Tile	0.18
355	1958 Bldg	66 XRF	5/7/97	2	Kitchen	1	Door	Door	Solid	Wood	0.03
356	1958 Bldg	67 XRF	5/7/97	2	Kitchen	1	Door	Jamb	Solid	Metal	0.06
357	1958 Bldg	68 XRF	5/7/97	2	Kitchen	1	Door	Header	Solid	Metal	0.06
358	1958 Bldg	69 XRF	5/7/97	2	Kitchen	1	Door	Header	Solid	Metal	0.04
359	1958 Bldg	70 XRF	5/7/97	2	Kitchen	1	Wall	Wall Rgstr	Solid	Metal	0.04
360	1958 Bldg	71 XRF	5/7/97	2	Kitchen	1	Door	Header	Solid	Metal	0.24
361	1958 Bldg	72 XRF	5/7/97	2	Kitchen	1		Frame	Solid	Wood	0
362	1958 Bldg	6 XRF	5/7/97	2	Lunch Are	0	Wall	Midle Wall	Solid	Tile	0.22
363	1958 Bldg	7 XRF	5/7/97	2	Lunch Are	0	Wall	Wall	Solid	Tile	2.3
364	1958 Bldg	124 XRF	6/3/97	1	Outside	0	Ext Wall	Siding	Cracked	Concrete	0.01
365	1958 Bldg	125 XRF	6/3/97	1	Outside	0	Door	Door	Cracked	Metal	0.03
366	1958 Bldg	126 XRF	6/3/97	1	Outside	0	Door	Jamb	Cracked	Metal	0.05
367	1958 Bldg	127 XRF	6/3/97	1	Outside	0	Window	Sill	Cracked	Metal	0.03
368	1958 Bldg	128 XRF	6/3/97	1	Outside	0	Window	Downspou	Cracked	Metal	0.05
369	1958 Bldg	129 XRF	6/3/97	1	Outside	0	Window	Downspou	Cracked	Metal	0.06
370	1958 Bldg	130 XRF	6/3/97	1	Outside	0	Grounds	Fence	Cracked	Wood	0
371	1958 Bldg	131 XRF	6/3/97	1	Outside	0	Ext Wall	Siding	Cracked	Plaster	0
372	1958 Bldg	132 XRF	6/3/97	1	Outside	0	Ext Wall	Trim	Cracked	Metal	0.07
373	1958 Bldg	133 XRF	6/3/97	1	Outside	0	Ext Wall	Downspou	Cracked	Metal	0.37
374	1958 Bldg	134 XRF	6/3/97	1	Outside	0		Downspou	Cracked	Metal	0.08
375	1958 Bldg	135 XRF	6/3/97	1	Outside	0		Downspou	Cracked	Metal	0.01
376	1958 Bldg	136 XRF	6/3/97	1	Outside	0	Wall	Wall Rgstr	Cracked	Metal	0.06
377	1958 Bldg	137 XRF	6/3/97	1	Outside	0		Column	Cracked	Metal	0.02
378	1958 Bldg	138 XRF	6/3/97	1	Outside	0	Gas	Pipe	Cracked	Metal	0
379	1958 Bldg	139 XRF	6/3/97	1	Outside	0	Window	Mullion	Cracked	Tile	0

Saint Paul Public Schools
 Highland Park Junior High School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Componen	Feature	Condition	Substrate	Result
380	1958 Bldg	140	XRF	6/3/97	1	Outside	0	Ext Wall	Siding	Cracked	Concrete	0.05
381	1958 Bldg	141	XRF	6/3/97	1	Outside	0	Stairs	Hand rail	Cracked	Metal	0.04
382	1958 Bldg	142	XRF	6/3/97	1	Outside	0	Wall	Middle Wall	Cracked	Wood	0.61
383	1958 Bldg	143	XRF	6/3/97	1	Outside	0	Wall	Middle Wall	Cracked	Metal	0.01
384	1958 Bldg	144	XRF	6/3/97	1	Outside	0	Bike	Racks	Cracked	Metal	1.05
385	1958 Bldg	145	XRF	6/3/97	1	Outside	0	Light	Pole	Cracked	Metal	0.07
386	1958 Bldg	146	XRF	6/3/97	1	Outside	0	Beam		Cracked	Tile	5.09
387	1958 Bldg	147	XRF	6/3/97	1	Outside	0	Stairs	Hand rail	Cracked	Metal	0.04
388	1958 Bldg	148	XRF	6/3/97	1	Outside	0	Ext Wall	Siding	Cracked	Concrete	0.08
389	1958 Bldg	149	XRF	6/3/97	1	Outside	0	Ext Wall	Siding	Cracked	Concrete	0.02
390	1958 Bldg	150	XRF	6/3/97	1	Outside	0	Wall	Wall Rgstr	Cracked	Metal	0.04
391	1958 Bldg	151	XRF	6/3/97	1	Outside	0	Stairs	Hand rail	Cracked	Metal	0.13
392	1958 Bldg	152	XRF	6/3/97	1	Outside	0	Ext Wall	Trim	Cracked	Metal	0.16
393	1958 Bldg	153	XRF	6/3/97	1	Outside	0	Ext Wall	Siding	Cracked	Metal	0.09
394	1958 Bldg	154	XRF	6/3/97	1	Outside	0	Ext Wall	Siding	Cracked	Wood	0
395	1958 Bldg	155	XRF	6/3/97	1	Outside	0	Stairs	Hand rail	Cracked	Metal	0.05
396	1958 Bldg	156	XRF	6/3/97	1	Outside	0	Ext Wall	Siding	Cracked	Concrete	5.09
397	1958 Bldg	157	XRF	6/3/97	1	Outside	0		Stool	Cracked	Concrete	0.04
398	1958 Bldg	158	XRF	6/3/97	1	Outside	0	Light	Pole	Cracked	Metal	0.15
399	1958 Bldg	159	XRF	6/3/97	1	Outside	0	Ext Wall	Siding	Cracked	Concrete	0
400	1958 Bldg	160	XRF	6/3/97	1	Outside	0	Ext Wall	Siding	Cracked	Wood	0
401	1958 Bldg	161	XRF	6/3/97	1	Outside	0	Ext Wall	Siding	Cracked	Wood	0
402	1958 Bldg	162	XRF	6/3/97	1	Outside	0	Door	Door	Cracked	Metal	0
403	1958 Bldg	163	XRF	6/3/97	1	Outside	0	Door	Jamb	Cracked	Metal	0
404	1958 Bldg	164	XRF	6/3/97	1	Outside	0	Wall	Wall Rgstr	Cracked	Metal	0
405	1958 Bldg	165	XRF	6/3/97	1	Outside	0	Door	Door	Cracked	Metal	0.17
406	1958 Bldg	166	XRF	6/3/97	1	Outside	0	Ext Wall	Siding	Cracked	Wood	0
407	1958 Bldg	167	XRF	6/3/97	1	Outside	0		Column	Cracked	Metal	0.12
408	1958 Bldg	168	XRF	6/3/97	1	Outside	0	Stairs	Hand rail	Cracked	Metal	0.01
409	1958 Bldg	169	XRF	6/3/97	1	Outside	0	Ext Wall	Siding	Cracked	Concrete	0.06
410	1958 Bldg	170	XRF	6/3/97	1	Outside	0	Ext Wall	Siding	Cracked	Concrete	0.07
411	1958 Bldg	171	XRF	6/3/97	1	Outside	0	Ext Wall	Siding	Cracked	Concrete	5.09
412	1958 Bldg	172	XRF	6/3/97	1	Outside	0	Ceiling		Cracked	Plaster	0
413	1958 Bldg	173	XRF	6/3/97	1	Outside	0	Beam		Cracked	Metal	0.05
414	1958 Bldg	174	XRF	6/3/97	1	Outside	0	Ext Wall	Siding	Cracked	Wood	0.41
415	1958 Bldg	175	XRF	6/3/97	1	Outside	0	Ext Wall	Siding	Cracked	Metal	0.01
416	1958 Bldg	176	XRF	6/3/97	1	Outside	0	Wall	Wall Rgstr	Cracked	Metal	0.04
417	1958 Bldg	177	XRF	6/3/97	1	Outside	0	TSCS	Pipe	Cracked	Metal	0.07
418	1958 Bldg	6	XRF	6/17/97	1	Outside	0	Ext Wall	Trim	Solid	Metal	0.06
419	1958 Bldg	7	XRF	6/17/97	1	Outside	0	Door	Door	Solid	Wood	0
420	1958 Bldg	8	XRF	6/17/97	1	Outside	0	Door	Door	Solid	Metal	0.13
421	1958 Bldg	9	XRF	6/17/97	1	Outside	0	Door	Jamb	Solid	Metal	0.1
422	1958 Bldg	101	XRF	6/17/97	1	Outside	0	Wall	Middle Wall	Solid	Tile	0.14
423	1958 Bldg	17	XRF	4/12/97	1	Restroom	1	Wall	Middle Wall	Solid	Tile	0.29
424	1958 Bldg	18	XRF	4/12/97	1	Restroom	1	Door	Door	Solid	Wood	0.01
425	1958 Bldg	19	XRF	4/12/97	1	Restroom	1	Door	Jamb	Solid	Metal	0.07
426	1958 Bldg	20	XRF	4/12/97	1	Restroom	1	Wall	Wall Rgstr	Solid	Metal	0.06
427	1958 Bldg	21	XRF	4/12/97	1	Restroom	1	Wall	Bthrm Stll	Solid	Metal	0.1
428	1958 Bldg	147	XRF	4/16/97	3	Restroom	1	Wall	Middle Wall	Solid	Plaster	0.03
429	1958 Bldg	148	XRF	4/16/97	3	Restroom	1	Wall	Wall	Solid	Plaster	0.03
430	1958 Bldg	149	XRF	4/16/97	3	Restroom	1	Wall	Middle Wall	Solid	Tile	0.23
431	1958 Bldg	150	XRF	4/16/97	3	Restroom	1		Radiator	Solid	Metal	0.05
432	1958 Bldg	151	XRF	4/16/97	3	Restroom	1	Wall	Bthrm Stll	Solid	Metal	0.02
433	1958 Bldg	152	XRF	4/16/97	3	Restroom	1	Door	Door	Solid	Metal	0
434	1958 Bldg	153	XRF	4/16/97	3	Restroom	1	Wall	Hatch	Solid	Metal	0.07
435	1958 Bldg	154	XRF	4/16/97	3	Restroom	1	Door	Door	Solid	Wood	0.02
436	1958 Bldg	155	XRF	4/16/97	3	Restroom	1	Door	Jamb	Solid	Metal	0.17
437	1958 Bldg	53	XRF	4/24/97	3	Restroom	2	Wall	Middle Wall	Solid	Tile	0.16
438	1958 Bldg	54	XRF	4/24/97	3	Restroom	2	Door	Door	Solid	Wood	0.03
439	1958 Bldg	55	XRF	4/24/97	3	Restroom	2	Door	Jamb	Solid	Metal	0.1
440	1958 Bldg	56	XRF	4/24/97	3	Restroom	2		Radiator	Solid	Metal	0.08
441	1958 Bldg	57	XRF	4/24/97	3	Restroom	2	Wall	Bthrm Stll	Solid	Metal	0
442	1958 Bldg	58	XRF	4/24/97	3	Restroom	2	Door	Stall Door	Solid	Metal	0.03

Saint Paul Public Schools
 Highland Park Junior High School
 Lead-Based Paint Inspection

A	B	C	D	E	F	G	H	I	J	K	L
Site	Sample #	Analysis	Date	Floor	Area	Room#	Componen	Feature	Condition	Substrate	Result
3	443	1958 Bldg	59 XRF	4/24/97	3 Restroom	2	Wall	Wall Rgstr	Solid	Metal	0.02
	444	1958 Bldg	60 XRF	4/24/97	3 Restroom	2	Wall	Hatch	Solid	Metal	0.09
	445	1958 Bldg	61 XRF	4/24/97	3 Restroom	2	Sink	Base	Solid	Metal	0.03
	446	1958 Bldg	62 XRF	4/24/97	3 Restroom	2	Shelf	Bracket	Solid	Metal	0.05
	447	1958 Bldg	91 XRF	4/12/97	1 Restroom	3	Wall	Midle Wall	Solid	Concrete	0.02
	448	1958 Bldg	92 XRF	4/12/97	1 Restroom	3	Wall	Midle Wall	Peeling	Concrete	0.06
	449	1958 Bldg	93 XRF	4/12/97	1 Restroom	3	Wall	Midle Wall	Solid	Tile	0.23
	450	1958 Bldg	94 XRF	4/12/97	1 Restroom	3	Ceiling		Solid	Concrete	0.01
	451	1958 Bldg	95 XRF	4/12/97	1 Restroom	3	Wall	Wall Rgstr	Solid	Metal	0.03
	452	1958 Bldg	96 XRF	4/12/97	1 Restroom	3	Door	Door	Solid	Wood	0.02
	453	1958 Bldg	97 XRF	4/12/97	1 Restroom	3	Door	Jamb	Solid	Metal	0.11
	454	1958 Bldg	98 XRF	4/12/97	1 Restroom	3	Door	Bthrm Stll	Solid	Metal	0.03
	455	1958 Bldg	99 XRF	4/12/97	1 Restroom	3	Shelf	Solid	Solid	Wood	0.02
	456	1958 Bldg	19 XRF	4/26/97	2 Restroom	3	Wall	Midle Wall	Solid	Tile	0.52
	457	1958 Bldg	20 XRF	4/26/97	2 Restroom	3	Door	Door	Solid	Wood	0.02
	458	1958 Bldg	21 XRF	4/26/97	2 Restroom	3	Door	Jamb	Solid	Metal	0.19
	459	1958 Bldg	22 XRF	4/26/97	2 Restroom	3	Radiator	Solid	Solid	Metal	0.1
	460	1958 Bldg	23 XRF	4/26/97	2 Restroom	3	Wall	Bthrm Stll	Solid	Metal	0.01
	461	1958 Bldg	24 XRF	4/26/97	2 Restroom	3	Door	Stall Door	Solid	Metal	0.08
	462	1958 Bldg	25 XRF	4/26/97	2 Restroom	3	Wall	Wall Rgstr	Solid	Metal	0.03
	463	1958 Bldg	26 XRF	4/26/97	2 Restroom	3	Wall	Wall Rgstr	Solid	Metal	0.09
	464	1958 Bldg	27 XRF	4/26/97	2 Restroom	3	Sink	Base	Solid	Metal	0.01
	465	1958 Bldg	28 XRF	4/26/97	2 Restroom	3	Shelf	Solid	Solid	Metal	0.06
	466	1958 Bldg	100 XRF	4/12/97	1 Restroom	4	Wall	Midle Wall	Solid	Concrete	0.02
	467	1958 Bldg	101 XRF	4/12/97	1 Restroom	4	Wall	Midle Wall	Solid	Tile	0.2
	468	1958 Bldg	102 XRF	4/12/97	1 Restroom	4	Door	Door	Solid	Wood	0.03
	469	1958 Bldg	103 XRF	4/12/97	1 Restroom	4	Door	Jamb	Solid	Metal	0.05
	470	1958 Bldg	104 XRF	4/12/97	1 Restroom	4	Ceiling		Solid	Concrete	0.01
	471	1958 Bldg	105 XRF	4/12/97	1 Restroom	4	Wall	Wall Rgstr	Solid	Metal	0.02
	472	1958 Bldg	106 XRF	4/12/97	1 Restroom	4	Wall	Bthrm Stll	Solid	Metal	0
	473	1958 Bldg	107 XRF	4/12/97	1 Restroom	4	Shelf	Solid	Solid	Wood	0.02
	474	1958 Bldg	65 XRF	4/26/97	2 Restroom	4	Wall	Midle Wall	Solid	Tile	0.17
	475	1958 Bldg	66 XRF	4/26/97	2 Restroom	4	Wall	Midle Wall	Solid	Drywall	0.1
	476	1958 Bldg	67 XRF	4/26/97	2 Restroom	4	Wall	Wall	Solid	Drywall	0.11
	477	1958 Bldg	68 XRF	4/26/97	2 Restroom	4	Door	Door	Solid	Wood	0.01
	478	1958 Bldg	69 XRF	4/26/97	2 Restroom	4	Door	Jamb	Solid	Metal	0.18
	479	1958 Bldg	70 XRF	4/26/97	2 Restroom	4	Radiator	Solid	Solid	Metal	0.06
	480	1958 Bldg	71 XRF	4/26/97	2 Restroom	4	Wall	Bthrm Stll	Solid	Metal	0.02
	481	1958 Bldg	72 XRF	4/26/97	2 Restroom	4	Door	Stall Door	Solid	Metal	0
	482	1958 Bldg	73 XRF	4/26/97	2 Restroom	4	Wall	Wall Rgstr	Solid	Metal	0.02
	483	1958 Bldg	74 XRF	4/26/97	2 Restroom	4	Wall	Hatch	Peeling	Metal	0.13
	484	1958 Bldg	75 XRF	4/26/97	2 Restroom	4	Sink	Base	Peeling	Metal	0.04
	485	1958 Bldg	76 XRF	4/26/97	2 Restroom	4	Shelf	Bracket	Solid	Metal	0.05
	486	1958 Bldg	125 XRF	4/26/97	1 Restroom	5	Wall	Midle Wall	Solid	Tile	0.23
	487	1958 Bldg	126 XRF	4/26/97	1 Restroom	5	Door	Door	Solid	Wood	0.01
	488	1958 Bldg	127 XRF	4/26/97	1 Restroom	5	Door	Jamb	Solid	Metal	0.06
	489	1958 Bldg	128 XRF	4/26/97	1 Restroom	5	Wall	Bthrm Stll	Solid	Metal	0.01
	490	1958 Bldg	129 XRF	4/26/97	1 Restroom	5	Door	Stall Door	Solid	Metal	0.01
	491	1958 Bldg	130 XRF	4/26/97	1 Restroom	5		Radiator	Solid	Metal	0.15
	492	1958 Bldg	131 XRF	4/26/97	1 Restroom	5	Ceiling		Solid	Plaster	0.76
	493	1958 Bldg	132 XRF	4/26/97	1 Restroom	5	Wall	Diffuser	Solid	Metal	0.01
	494	1958 Bldg	133 XRF	4/26/97	1 Restroom	5	Wall	Wall Rgstr	Solid	Metal	0.02
	495	1958 Bldg	134 XRF	4/26/97	1 Restroom	5	Bench		Solid	Wood	0
	496	1958 Bldg	207 XRF	4/26/97	1 Restroom	7	Wall	Midle Wall	Solid	Tile	0.19
	497	1958 Bldg	208 XRF	4/26/97	1 Restroom	7	Door	Door	Solid	Wood	0
	498	1958 Bldg	209 XRF	4/26/97	1 Restroom	7	Door	Jamb	Solid	Metal	0.01
	499	1958 Bldg	210 XRF	4/26/97	1 Restroom	7	Wall	Wall Rgstr	Solid	Metal	0.03
	500	1958 Bldg	211 XRF	4/26/97	1 Restroom	7		Radiator	Solid	Metal	0.05
	501	1958 Bldg	110 XRF	5/7/97	1 Restroom	8	Wall	Midle Wall	Solid	Tile	0.13
	502	1958 Bldg	111 XRF	5/7/97	1 Restroom	8	Door	Door	Solid	Wood	0.02
	503	1958 Bldg	112 XRF	5/7/97	1 Restroom	8		Jamb	Solid	Metal	0.08
	504	1958 Bldg	113 XRF	5/7/97	1 Restroom	8		Radiator	Solid	Metal	0.09
	505	1958 Bldg	114 XRF	5/7/97	1 Restroom	8	Wall	Bthrm Stll	Solid	Metal	0.01

Saint Paul Public Schools
 Highland Park Junior High School
 Lead-Based Paint Inspection

A	B	C	D	E	F	G	H	I	J	K	L	
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Compone	Feature	Condition	Substrate	Result
506	1958 Bldg	115	XRF	5/7/97	1	Restroom	8	Wall	Wall Rgstr	Solid	Metal	0.03
507	1958 Bldg	116	XRF	5/7/97	1	Restroom	8	Wall	Hatch	Solid	Metal	0.11
508	1958 Bldg	117	XRF	5/7/97	1	Restroom	8	Sink	Base	Solid	Metal	0.02
509	1958 Bldg	118	XRF	5/7/97	1	Restroom	8	Shelf	Bracket	Solid	Metal	0.02
510	1958 Bldg	79	XRF	5/28/97	1	Restroom	10	Wall	Midle Wall	Solid	Tile	0.27
511	1958 Bldg	80	XRF	5/28/97	1	Restroom	10	Molding		Solid	Wood	0
512	1958 Bldg	81	XRF	5/28/97	1	Restroom	10	Ceiling	Diffuser	Solid	Metal	0
513	1958 Bldg	82	XRF	5/28/97	1	Restroom	10	Floor		Solid	Tile	0.25
514	1958 Bldg	83	XRF	5/28/97	1	Restroom	11	Wall	Midle Wall	Solid	Tile	0.33
515	1958 Bldg	84	XRF	5/28/97	1	Restroom	11	Ceiling	Diffuser	Solid	Metal	0.01
516	1958 Bldg	85	XRF	5/28/97	1	Restroom	11	Ceiling		Solid	Plaster	0
517	1958 Bldg	86	XRF	5/28/97	1	Restroom	11	Floor		Solid	Tile	0.13
518	1958 Bldg	91	XRF	5/28/97	1	Restroom	12	Wall	Midle Wall	Solid	Tile	0.24
519	1958 Bldg	92	XRF	5/28/97	1	Restroom	12	Ceiling		Solid	Plaster	0
520	1958 Bldg	93	XRF	5/28/97	1	Restroom	12	Ceiling	Diffuser	Solid	Metal	0.04
521	1958 Bldg	94	XRF	5/28/97	1	Restroom	12	Floor		Solid	Tile	0.14
522	1958 Bldg	133	XRF	5/28/97	1	Restroom	15	Wall	Midle Wall	Solid	Tile	0.28
523	1958 Bldg	134	XRF	5/28/97	1	Restroom	15	Wall	Stall Door	Solid	Metal	0.01
524	1958 Bldg	135	XRF	5/28/97	1	Restroom	15	Ceiling	Diffuser	Solid	Metal	0.01
525	1958 Bldg	136	XRF	5/28/97	1	Restroom	15	Ceiling		Solid	Plaster	0
526	1958 Bldg	137	XRF	5/28/97	1	Restroom	15	Floor		Solid	Tile	0.19
527	1958 Bldg	138	XRF	5/28/97	1	Restroom	16	Wall	Midle Wall	Solid	Tile	0.22
528	1958 Bldg	139	XRF	5/28/97	1	Restroom	16	Wall	Bthrm Stll	Solid	Metal	0
529	1958 Bldg	140	XRF	5/28/97	1	Restroom	16	Ceiling	Diffuser	Solid	Metal	0.01
530	1958 Bldg	141	XRF	5/28/97	1	Restroom	16	Ceiling		Solid	Plaster	0
531	1958 Bldg	142	XRF	5/28/97	1	Restroom	16	Floor		Solid	Tile	0.15
532	1958 Bldg	204	XRF	6/2/97	2	Restroom	17	Wall	Midle Wall	Solid	Tile	0.31
533	1958 Bldg	205	XRF	6/2/97	2	Restroom	17	Ceiling	Diffuser	Solid	Metal	0.02
534	1958 Bldg	206	XRF	6/2/97	2	Restroom	17	Floor		Solid	Tile	0.24
535	1958 Bldg	266	XRF	6/2/97	1	Restroom	18	Wall	Midle Wall	Solid	Tile	1.35
536	1958 Bldg	267	XRF	6/2/97	1	Restroom	18	Ceiling	Diffuser	Solid	Metal	0.01
537	1958 Bldg	268	XRF	6/2/97	1	Restroom	18	Ceiling		Solid	Plaster	0.03
538	1958 Bldg	269	XRF	6/2/97	1	Restroom	18	Ceiling	Hatch	Solid	Metal	0.02
539	1958 Bldg	270	XRF	6/2/97	1	Restroom	18	Door	Stall Door	Solid	Metal	0.02
540	1958 Bldg	271	XRF	6/2/97	1	Restroom	18	Floor		Solid	Tile	0.08
541	1958 Bldg	272	XRF	6/2/97	1	Restroom	19	Wall	Midle Wall	Solid	Tile	1.22
542	1958 Bldg	273	XRF	6/2/97	1	Restroom	19	Ceiling	Diffuser	Solid	Metal	0.02
543	1958 Bldg	274	XRF	6/2/97	1	Restroom	19	Ceiling		Solid	Plaster	0.02
544	1958 Bldg	275	XRF	6/2/97	1	Restroom	19	Door	Stall Door	Solid	Metal	0.01
545	1958 Bldg	276	XRF	6/2/97	1	Restroom	19	Floor		Solid	Tile	0.06
546	1958 Bldg	308	XRF	6/2/97	1	Restroom	20	Wall	Midle Wall	Solid	Concrete	0.03
547	1958 Bldg	309	XRF	6/2/97	1	Restroom	20	Door	Door	Solid	Wood	0.02
548	1958 Bldg	310	XRF	6/2/97	1	Restroom	20	Door	Casing	Solid	Metal	0.02
549	1958 Bldg	311	XRF	6/2/97	1	Restroom	20	Ceiling	Diffuser	Solid	Metal	0.01
550	1958 Bldg	312	XRF	6/2/97	1	Restroom	20	Ceiling		Solid	Plaster	0.01
551	1958 Bldg	313	XRF	6/2/97	1	Restroom	20		Baseboar	Solid	Tile	1.23
552	1958 Bldg	314	XRF	6/2/97	1	Restroom	20		Baseboar	Solid	Tile	1.37
553	1958 Bldg	315	XRF	6/2/97	1	Restroom	20	Floor		Solid	Tile	0.17
554	1958 Bldg	26	XRF	6/17/97	0	Restroom	100	Wall	Midle Wall	Solid	Tile	1.43
555	1958 Bldg	27	XRF	6/17/97	0	Restroom	100	Wall	Midle Wall	Solid	Concrete	0.01
556	1958 Bldg	28	XRF	6/17/97	0	Restroom	100	Door	Door	Chalkin	Wood	0.01
557	1958 Bldg	29	XRF	6/17/97	0	Restroom	100	Door	Casing	Solid	Metal	0.25
558	1958 Bldg	30	XRF	6/17/97	0	Restroom	100	Door	Stall Door	Solid	Metal	0.01
559	1958 Bldg	31	XRF	6/17/97	0	Restroom	100		Locker	Solid	Metal	0.03
560	1958 Bldg	32	XRF	6/17/97	0	Restroom	100	Ceiling	Diffuser	Solid	Metal	0.02
561	1958 Bldg	33	XRF	6/17/97	0	Restroom	100	Ceiling		Solid	Plaster	0.01
562	1958 Bldg	34	XRF	6/17/97	0	Restroom	100	Ceiling		Solid	Plaster	0.01
563	1958 Bldg	35	XRF	6/17/97	0	Restroom	100	Floor		Solid	Tile	0.08
564	1958 Bldg	156	XRF	6/17/97	1	Restroom	101	Wall	Midle Wall	Solid	Tile	1.61
565	1958 Bldg	157	XRF	6/17/97	1	Restroom	101	Door	Door	Solid	Wood	0.02
566	1958 Bldg	158	XRF	6/17/97	1	Restroom	101	Door	Casing	Solid	Metal	0.02
567	1958 Bldg	159	XRF	6/17/97	1	Restroom	101		Shelf	Solid	Metal	0.08
568	1958 Bldg	160	XRF	6/17/97	1	Restroom	101	Wall	Bthrm Stll	Solid	Metal	0.46

Saint Paul Public Schools
 Highland Park Junior High School
 Lead-Based Paint Inspection

A	B	C	D	E	F	G	H	I	J	K	L
Site	Sample #	Analysis	Date	Floor	Area	Room#	Componen	Feature	Condition	Substrate	Result
3	569	1958 Bldg	161 XRF	6/17/97	1 Restroom	101	Door	Stall Door	Solid	Metal	0
	570	1958 Bldg	162 XRF	6/17/97	1 Restroom	101		Radiator	Solid	Metal	0.01
	571	1958 Bldg	163 XRF	6/17/97	1 Restroom	101	Wall	Wall Rgstr	Solid	Metal	0.01
	572	1958 Bldg	164 XRF	6/17/97	0 Restroom	101	Ceiling		Solid	Plaster	0.22
	573	1958 Bldg	165 XRF	6/17/97	0 Restroom	101	Floor		Solid	Tile	0.15
	574	1958 Bldg	119 XRF	5/28/97	1 Restroom	13A	Wall	Midle Wall	Solid	Tile	0.1
	575	1958 Bldg	120 XRF	5/28/97	1 Restroom	13A	Door	Door	Solid	Wood	0.01
	576	1958 Bldg	121 XRF	5/28/97	1 Restroom	13A	Door	Casing	Solid	Metal	0.18
	577	1958 Bldg	122 XRF	5/28/97	1 Restroom	13A	Ceiling		Solid	Plaster	0
	578	1958 Bldg	123 XRF	5/28/97	1 Restroom	13A	Floor		Solid	Tile	0.29
	579	1958 Bldg	124 XRF	5/28/97	1 Restroom	13A	Ceiling	Diffuser	Solid	Metal	0.05
	580	1958 Bldg	115 XRF	4/16/97	1 Restroom	14A	Wall	Midle Wall	Solid	Plaster	0.05
	581	1958 Bldg	116 XRF	4/16/97	1 Restroom	14A	Door	Door	Solid	Wood	0.02
	582	1958 Bldg	117 XRF	4/16/97	1 Restroom	14A	Door	Jamb	Solid	Metal	0.42
	583	1958 Bldg	118 XRF	4/16/97	1 Restroom	14A		Radiator	Solid	Metal	0.03
	584	1958 Bldg	129 XRF	5/28/97	1 Restroom	14B	Wall	Midle Wall	Solid	Tile	0.19
	585	1958 Bldg	130 XRF	5/28/97	1 Restroom	14B	Door	Stall Door	Solid	Metal	0
	586	1958 Bldg	131 XRF	5/28/97	1 Restroom	14B	Ceiling	Diffuser	Solid	Metal	0.04
	587	1958 Bldg	132 XRF	5/28/97	1 Restroom	14B	Floor	Wall Rgstr	Solid	Tile	0.11
	588	1958 Bldg	17 XRF	6/17/97	1 Restroom	298A	Wall	Midle Wall	Solid	Concrete	0.03
	589	1958 Bldg	18 XRF	6/17/97	1 Restroom	298A	Wall	Midle Wall	Solid	Concrete	0.02
	590	1958 Bldg	19 XRF	6/17/97	1 Restroom	298A	Wall	Baseboar	Solid	Tile	1.53
	591	1958 Bldg	20 XRF	6/17/97	1 Restroom	298A	Door	Door	Solid	Wood	0.01
	592	1958 Bldg	21 XRF	6/17/97	1 Restroom	298A	Door	Door	Solid	Metal	0.01
	593	1958 Bldg	22 XRF	6/17/97	1 Restroom	298A	Door	Casing	Solid	Metal	0.26
	594	1958 Bldg	23 XRF	6/17/97	1 Restroom	298A		Elec Pane	Solid	Metal	0
	595	1958 Bldg	24 XRF	6/17/97	1 Restroom	298A	Ceiling	Diffuser	Solid	Metal	0
	596	1958 Bldg	25 XRF	6/17/97	1 Restroom	298A	Floor		Solid	Metal	0.04
	597	1958 Bldg	46 XRF	4/12/97	1 Restroom	2A	Wall	Midle Wall	Solid	Tile	0.23
	598	1958 Bldg	47 XRF	4/12/97	1 Restroom	2A	Door	Door	Solid	Wood	0.02
	599	1958 Bldg	48 XRF	4/12/97	1 Restroom	2A	Door	Door	Solid	Metal	0.08
	600	1958 Bldg	49 XRF	4/12/97	1 Restroom	2A	Wall	Wall Rgstr	Solid	Metal	0.05
	601	1958 Bldg	50 XRF	4/12/97	1 Restroom	2A	Wall	Bthrm Stl	Solid	Metal	0.01
	602	1958 Bldg	51 XRF	4/12/97	1 Restroom	2A	Wall	Hatch	Solid	Metal	0.04
	603	1958 Bldg	50 XRF	4/16/97	1 Restroom	6A	Wall	Midle Wall	Solid	Plaster	0
	604	1958 Bldg	51 XRF	4/16/97	1 Restroom	6A	Door	Door	Solid	Wood	0.03
	605	1958 Bldg	52 XRF	4/16/97	1 Restroom	6A	Door	Jamb	Solid	Metal	0.12
	606	1958 Bldg	53 XRF	4/16/97	1 Restroom	6A	Ceiling	Diffuser	Solid	Metal	0
	607	1958 Bldg	143 XRF	4/26/97	1 Restroom	6C	Wall	Midle Wall	Solid	Tile	0.19
	608	1958 Bldg	144 XRF	4/26/97	1 Restroom	6C	Wall	Midle Wall	Solid	Drywall	0.11
	609	1958 Bldg	145 XRF	4/26/97	1 Restroom	6C	Wall	Wall	Solid	Drywall	0.17
	610	1958 Bldg	146 XRF	4/26/97	1 Restroom	6C		Radiator	Solid	Metal	0.03
	611	1958 Bldg	147 XRF	4/26/97	1 Restroom	6C	Wall	Bthrm Stl	Solid	Metal	0.02
	612	1958 Bldg	148 XRF	4/26/97	1 Restroom	6C	Door	Stall Door	Solid	Metal	0.05
	613	1958 Bldg	149 XRF	4/26/97	1 Restroom	6C	Wall	Wall Rgstr	Solid	Metal	0.04
	614	1958 Bldg	150 XRF	4/26/97	1 Restroom	6C	Wall	Hatch	Solid	Metal	0.12
	615	1958 Bldg	151 XRF	4/26/97	1 Restroom	6C	Sink	Base	Solid	Metal	0.02
	616	1958 Bldg	152 XRF	4/26/97	1 Restroom	6C	Shelf	Bracket	Solid	Metal	0.06
	617	1958 Bldg	68 XRF	4/16/97	1 Restroom	8A	Wall	Midle Wall	Solid	Plaster	0.01
	618	1958 Bldg	69 XRF	4/16/97	1 Restroom	8A	Door	Door	Solid	Wood	0.03
	619	1958 Bldg	70 XRF	4/16/97	1 Restroom	8A	Door	Jamb	Solid	Metal	0.15
	620	1958 Bldg	71 XRF	4/16/97	1 Restroom	8A	Ceiling	Diffuser	Solid	Metal	0
	621	1958 Bldg	19 XRF	4/16/97	1 Room	1	Wall	Wall	Solid	Plaster	0.01
	622	1958 Bldg	20 XRF	4/16/97	1 Room	1	Wall	Wall	Solid	Plaster	0.05
	623	1958 Bldg	21 XRF	4/16/97	1 Room	1	Door	Door	Solid	Wood	0.02
	624	1958 Bldg	22 XRF	4/16/97	1 Room	1	Door	Jamb	Solid	Metal	0.05
	625	1958 Bldg	23 XRF	4/16/97	1 Room	1		Transom	Solid	Glass	0
	626	1958 Bldg	24 XRF	4/16/97	1 Room	1		Radiator	Solid	Metal	0.01
	627	1958 Bldg	277 XRF	6/2/97	1 Room	1	Wall	Midle Wall	Solid	Concrte	0.02
	628	1958 Bldg	278 XRF	6/2/97	1 Room	1	Chair Rail		Solid	Wood	0.02
	629	1958 Bldg	279 XRF	6/2/97	1 Room	1	Bookcase	Shelf	Solid	Wood	0.03
	630	1958 Bldg	280 XRF	6/2/97	1 Room	1	Ceiling	Hatch	Solid	Metal	0.02
	631	1958 Bldg	281 XRF	6/2/97	1 Room	1	Ceiling		Solid	Plaster	0.03

Saint Paul Public Schools
 Highland Park Junior High School
 Lead-Based Paint Inspection

A	B	C	D	E	F	G	H	I	J	K	L
Site	Sample #	Analysis	Date	Floor	Area	Room#	Componen	Feature	Condition	Substrate	Result
3	1958 Bldg	282 XRF	6/2/97	1	Room	1	Ceiling	Diffuser	Solid	Metal	0.01
632	1958 Bldg	283 XRF	6/2/97	1	Room	1	Door	Door	Solid	Wood	0.02
633	1958 Bldg	284 XRF	6/2/97	1	Room	1	Door	Casing	Solid	Metal	0.17
634	1958 Bldg	25 XRF	4/16/97	1	Room	2	Wall	Midle Wall	Solid	Plaster	0.01
635	1958 Bldg	26 XRF	4/16/97	1	Room	2	Wall	Wall	Solid	Plaster	0.01
637	1958 Bldg	27 XRF	4/16/97	1	Room	2	Door	Door	Solid	Wood	0.02
638	1958 Bldg	28 XRF	4/16/97	1	Room	2	Door	Jamb	Solid	Metal	0.11
639	1958 Bldg	29 XRF	4/16/97	1	Room	2		Transom	Solid	Glass	0.05
640	1958 Bldg	30 XRF	4/16/97	1	Room	2		Radiator	Solid	Metal	0.05
641	1958 Bldg	285 XRF	6/2/97	1	Room	2	Wall	Midle Wall	Solid	Concrete	0.02
642	1958 Bldg	286 XRF	6/2/97	1	Room	2	Wall	Midle Wall	Solid	Concrete	0.04
643	1958 Bldg	287 XRF	6/2/97	1	Room	2	Wall	Wall Rgstr	Solid	Metal	0
644	1958 Bldg	288 XRF	6/2/97	1	Room	2		Radiator	Solid	Metal	0
645	1958 Bldg	289 XRF	6/2/97	1	Room	2	Door	Door	Solid	Wood	0.01
646	1958 Bldg	290 XRF	6/2/97	1	Room	2	Wall	Wall Rgstr	Solid	Metal	0.01
647	1958 Bldg	291 XRF	6/2/97	1	Room	2	Work Ben	Top	Solid	Wood	0
648	1958 Bldg	292 XRF	6/2/97	1	Room	2	Locker		Solid	Metal	0.09
649	1958 Bldg	293 XRF	6/2/97	1	Room	2	Work Ben	Top	Solid	Wood	0
650	1958 Bldg	294 XRF	6/2/97	1	Room	2		Baseboar	Solid	Tile	1.55
651	1958 Bldg	295 XRF	6/2/97	1	Room	2		Elec Pane	Solid	Metal	0.03
652	1958 Bldg	329 XRF	6/2/97	1	Room	2	Floor		Peeling	Concrete	0.36
653	1958 Bldg	120 XRF	4/16/97	1	Room	3	Wall	Midle Wall	Solid	Plaster	0.01
654	1958 Bldg	121 XRF	4/16/97	1	Room	3	Wall	Wall	Solid	Plaster	0.01
655	1958 Bldg	122 XRF	4/16/97	1	Room	3	Door	Door	Solid	Wood	0.02
656	1958 Bldg	123 XRF	4/16/97	1	Room	3	Door	Jamb	Solid	Metal	0.2
657	1958 Bldg	124 XRF	4/16/97	1	Room	3		Radiator	Solid	Metal	0.06
658	1958 Bldg	125 XRF	4/16/97	1	Room	3	Wall	Chair rail	Solid	Wood	0
659	1958 Bldg	126 XRF	4/16/97	1	Room	3		Transom	Solid	Glass	0.01
660	1958 Bldg	296 XRF	6/2/97	1	Room	3	Wall	Midle Wall	Solid	Concrete	0.01
661	1958 Bldg	297 XRF	6/2/97	1	Room	3	Wall	Wall	Solid	Wood	0.01
662	1958 Bldg	298 XRF	6/2/97	1	Room	3	Window	Panel	Solid	Wood	0.01
663	1958 Bldg	299 XRF	6/2/97	1	Room	3	Door	Door	Solid	Wood	0.01
664	1958 Bldg	300 XRF	6/2/97	1	Room	3	Door	Casing	Solid	Metal	0.01
665	1958 Bldg	301 XRF	6/2/97	1	Room	3	Window	Casing	Solid	Metal	0.02
666	1958 Bldg	302 XRF	6/2/97	1	Room	3	Window	Casing	Solid	Metal	0.03
667	1958 Bldg	303 XRF	6/2/97	1	Room	3	Beam		Solid	Metal	5.09
668	1958 Bldg	304 XRF	6/2/97	1	Room	3		Column	Solid	Metal	3.87
669	1958 Bldg	305 XRF	6/2/97	1	Room	3	Bookcase	Shelf	Solid	Wood	0.02
670	1958 Bldg	306 XRF	6/2/97	1	Room	3	Bookcase	Shelf	Solid	Wood	0.01
671	1958 Bldg	307 XRF	6/2/97	1	Room	3	Ceiling	Diffuser	Solid	Metal	0.01
672	1958 Bldg	31 XRF	4/16/97	1	Room	4	Wall	Wall	Solid	Plaster	0.01
673	1958 Bldg	32 XRF	4/16/97	1	Room	4	Wall	Wall	Solid	Plaster	0.02
674	1958 Bldg	33 XRF	4/16/97	1	Room	4		Transom	Solid	Glass	0.01
675	1958 Bldg	34 XRF	4/16/97	1	Room	4	Door	Door	Solid	Wood	0.02
676	1958 Bldg	35 XRF	4/16/97	1	Room	4	Door	Jamb	Solid	Metal	0.11
677	1958 Bldg	36 XRF	4/16/97	1	Room	4		Radiator	Peeling	Metal	0.03
678	1958 Bldg	316 XRF	6/2/97	1	Room	4	Wall	Midle Wall	Solid	Concrete	0.03
679	1958 Bldg	317 XRF	6/2/97	1	Room	4	Door	Door	Solid	Wood	0.02
680	1958 Bldg	318 XRF	6/2/97	1	Room	4	Door	Casing	Solid	Metal	0.01
681	1958 Bldg	319 XRF	6/2/97	1	Room	4	Bookcase	Shelf	Solid	Wood	0.02
682	1958 Bldg	320 XRF	6/2/97	1	Room	4	Ceiling		Solid	Plaster	0.1
683	1958 Bldg	321 XRF	6/2/97	1	Room	4		Baseboar	Solid	Tile	1.15
684	1958 Bldg	37 XRF	4/16/97	1	Room	5	Wall	Wall	Peeling	Plaster	0.19
685	1958 Bldg	38 XRF	4/16/97	1	Room	5	Wall	Midle Wall	Peeling	Plaster	0.18
686	1958 Bldg	39 XRF	4/16/97	1	Room	5	Door	Door	Peeling	Wood	0.02
687	1958 Bldg	40 XRF	4/16/97	1	Room	5	Door	Jamb	Peeling	Metal	0.16
688	1958 Bldg	41 XRF	4/16/97	1	Room	5		Transom	Peeling	Wood	0.01
689	1958 Bldg	42 XRF	4/16/97	1	Room	5		Transom	Solid	Glass	0.02
690	1958 Bldg	43 XRF	4/16/97	1	Room	5		Radiator	Solid	Metal	0.14
691	1958 Bldg	44 XRF	4/16/97	1	Room	5		Chair rail	Solid	Wood	0
692	1958 Bldg	45 XRF	4/16/97	1	Room	5		Chair rail	Solid	Wood	0
693	1958 Bldg	322 XRF	6/2/97	1	Room	5	Wall	Midle Wall	Solid	Concrete	0.03
694	1958 Bldg	323 XRF	6/2/97	1	Room	5	Door	Door	Solid	Wood	0.02

Saint Paul Public Schools
 Highland Park Junior High School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Componen	Feature	Condition	Substrate	Result
695	1958 Bldg	324	XRF	6/2/97	1	Room	5	Door	Casing	Solid	Metal	0.01
696	1958 Bldg	325	XRF	6/2/97	1	Room	5	Storage	Racks	Solid	Metal	0.18
697	1958 Bldg	326	XRF	6/2/97	1	Room	5	Beam		Solid	Metal	5.09
698	1958 Bldg	327	XRF	6/2/97	1	Room	5	Baseboar	Solid	Tile		1.23
699	1958 Bldg	328	XRF	6/2/97	1	Room	5	Duct		Peeling	Metal	0.1
700	1958 Bldg	46	XRF	4/16/97	1	Room	6	Chair rail	Solid	Plaster		0.02
701	1958 Bldg	47	XRF	4/16/97	1	Room	6	Door	Door	Solid	Wood	0.02
702	1958 Bldg	48	XRF	4/16/97	1	Room	6	Door	Jamb	Solid	Metal	0.13
703	1958 Bldg	49	XRF	4/16/97	1	Room	6	Radiator	Solid	Metal		0.03
704	1958 Bldg	23	XRF	6/3/97	2	Room	6	Wall	Midle Wall	Solid	Tile	1.32
705	1958 Bldg	24	XRF	6/3/97	2	Room	6	Door	Door	Solid	Wood	0.01
706	1958 Bldg	25	XRF	6/3/97	2	Room	6	Door	Casing	Solid	Metal	0.07
707	1958 Bldg	26	XRF	6/3/97	2	Room	6	Ceiling	Diffuser	Solid	Metal	0.01
708	1958 Bldg	27	XRF	6/3/97	2	Room	6	Ceiling	Diffuser	Solid	Metal	0
709	1958 Bldg	28	XRF	6/3/97	2	Room	6	Floor		Solid	Tile	0.28
710	1958 Bldg	29	XRF	6/3/97	2	Room	6	Door	Door	Solid	Wood	0.13
711	1958 Bldg	30	XRF	6/3/97	2	Room	6	Door	Casing	Peeling	Metal	0.07
712	1958 Bldg	31	XRF	6/3/97	2	Room	6	Ceiling		Peeling	Plaster	0.01
713	1958 Bldg	32	XRF	6/3/97	2	Room	6	Floor		Peeling	Tile	0.25
714	1958 Bldg	39	XRF	6/3/97	1	Room	7	Wall	Midle Wall	Solid	Concrete	0.03
715	1958 Bldg	40	XRF	6/3/97	1	Room	7	Wall	Midle Wall	Solid	Plaster	0.11
716	1958 Bldg	41	XRF	6/3/97	1	Room	7	Wall	Baseboar	Solid	Tile	1.69
717	1958 Bldg	42	XRF	6/3/97	1	Room	7	Wall	Midle Wall	Solid	Wood	2.1
718	1958 Bldg	43	XRF	6/3/97	1	Room	7	Door	Door	Solid	Wood	0.01
719	1958 Bldg	44	XRF	6/3/97	1	Room	7	Door	Casing	Solid	Metal	0.01
720	1958 Bldg	45	XRF	6/3/97	1	Room	7	Door	Door	Solid	Metal	0.25
721	1958 Bldg	46	XRF	6/3/97	1	Room	7	Door	Casing	Solid	Metal	0.09
722	1958 Bldg	47	XRF	6/3/97	1	Room	7	Door	Casing	Solid	Metal	0.1
723	1958 Bldg	48	XRF	6/3/97	1	Room	7	Elec Pane	Solid	Metal	0.01	
724	1958 Bldg	49	XRF	6/3/97	1	Room	7	Elec Pane	Solid	Metal	0.03	
725	1958 Bldg	50	XRF	6/3/97	1	Room	7	Elec Pane	Solid	Metal	0.03	
726	1958 Bldg	51	XRF	6/3/97	1	Room	7	Elec Pane	Solid	Metal	0.02	
727	1958 Bldg	52	XRF	6/3/97	1	Room	7	Radiator	Solid	Metal	0.01	
728	1958 Bldg	53	XRF	6/3/97	1	Room	7	Door	Door	Solid	Metal	0.15
729	1958 Bldg	65	XRF	4/16/97	1	Room	8	Door	Jamb	Solid	Metal	0.15
730	1958 Bldg	66	XRF	4/16/97	1	Room	8	Radiator	Solid	Metal	0.01	
731	1958 Bldg	67	XRF	4/16/97	1	Room	8	Cabinet	Door	Solid	Wood	0.01
732	1958 Bldg	54	XRF	6/3/97	1	Room	8	Door	Casing	Solid	Metal	0.1
733	1958 Bldg	72	XRF	4/16/97	1	Room	9	Wall	Midle Wall	Solid	Plaster	0.02
734	1958 Bldg	73	XRF	4/16/97	1	Room	9	Wall	Wall	Solid	Plaster	0.02
735	1958 Bldg	74	XRF	4/16/97	1	Room	9	Door	Door	Solid	Wood	0.02
736	1958 Bldg	75	XRF	4/16/97	1	Room	9	Door	Jamb	Solid	Metal	0.15
737	1958 Bldg	76	XRF	4/16/97	1	Room	9	Cabinet	Door	Solid	Wood	0.01
738	1958 Bldg	77	XRF	4/16/97	1	Room	9	Bookcase	Shelf	Solid	Wood	0.01
739	1958 Bldg	55	XRF	6/3/97	1	Room	9	Wall	Midle Wall	Solid	Concrte	0.01
740	1958 Bldg	56	XRF	6/3/97	1	Room	9	Wall	Midle Wall	Solid	Concrte	0.02
741	1958 Bldg	57	XRF	6/3/97	1	Room	9	Wall	Baseboar	Solid	Tile	1.49
742	1958 Bldg	58	XRF	6/3/97	1	Room	9	Door	Door	Solid	Wood	0.03
743	1958 Bldg	59	XRF	6/3/97	1	Room	9	Door	Casing	Solid	Metal	0.01
744	1958 Bldg	60	XRF	6/3/97	1	Room	9	Door	Door	Solid	Metal	0.02
745	1958 Bldg	61	XRF	6/3/97	1	Room	9	Door	Door	Solid	Metal	0.19
746	1958 Bldg	62	XRF	6/3/97	1	Room	9	Door	Casing	Solid	Metal	0.01
747	1958 Bldg	63	XRF	6/3/97	1	Room	9	Cabinet	Door	Solid	Wood	0.01
748	1958 Bldg	64	XRF	6/3/97	1	Room	9	Wall	Wall	Peeling	Plaster	0.25
749	1958 Bldg	65	XRF	6/3/97	1	Room	9	Wall	Wall	Peeling	Plaster	0.24
750	1958 Bldg	66	XRF	6/3/97	1	Room	9	Wall	Wall	Peeling	Plaster	0.4
751	1958 Bldg	67	XRF	6/3/97	1	Room	9	Fire	Box	Peeling	Metal	0.41
752	1958 Bldg	68	XRF	6/3/97	1	Room	9	Wall	Midle Wall	Peeling	Wood	0.93
753	1958 Bldg	69	XRF	6/3/97	1	Room	9	Wall	Hatch	Cracked	Metal	0.01
754	1958 Bldg	70	XRF	6/3/97	1	Room	9	Wall	Wall Rgstr	Cracked	Metal	0.01
755	1958 Bldg	71	XRF	6/3/97	1	Room	9	Wall	Wall Rgstr	Cracked	Metal	0.01
756	1958 Bldg	72	XRF	6/3/97	1	Room	9	Elec Pane	Cracked	Metal		0
757	1958 Bldg	73	XRF	6/3/97	1	Room	9	Wall	Elec Pane	Cracked	Metal	0.01

Saint Paul Public Schools
 Highland Park Junior High School
 Lead-Based Paint Inspection

A	B	C	D	E	F	G	H	I	J	K	L	
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Compon	Feature	Condition	Substrate	Result
758	1958 Bldg	74	XRF	6/3/97	1	Room	9	Locker	Cracked	Metal	0.21	
759	1958 Bldg	75	XRF	6/3/97	1	Room	9	Elec Pane	Cracked	Metal	0.01	
760	1958 Bldg	76	XRF	6/3/97	1	Room	9	Wall	Wall Rgstr	Cracked	Metal	0.01
761	1958 Bldg	77	XRF	6/3/97	1	Room	9	Work Ben	Top	Cracked	Wood	0
762	1958 Bldg	78	XRF	6/3/97	1	Room	9	Cabinet	Door	Cracked	Metal	0.06
763	1958 Bldg	79	XRF	6/3/97	1	Room	9	Work Ben	Top	Cracked	Metal	0.03
764	1958 Bldg	80	XRF	6/3/97	1	Room	9	Work Ben	Top	Cracked	Metal	0.08
765	1958 Bldg	81	XRF	6/3/97	1	Room	9	Cabinet	Door	Cracked	Wood	0
766	1958 Bldg	82	XRF	6/3/97	1	Room	9	Beam	Column	Cracked	Metal	5.09
767	1958 Bldg	83	XRF	6/3/97	1	Room	9	Ceiling		Solid	Plaster	0.26
768	1958 Bldg	84	XRF	6/3/97	1	Room	9	Floor		Solid	Concrete	0.02
769	1958 Bldg	78	XRF	4/16/97	1	Room	10	Wall	Midle Wall	Solid	Plaster	0.01
770	1958 Bldg	79	XRF	4/16/97	1	Room	10	Wall	Wall	Solid	Plaster	0.03
771	1958 Bldg	80	XRF	4/16/97	1	Room	10	Door	Door	Solid	Wood	0.02
772	1958 Bldg	81	XRF	4/16/97	1	Room	10	Door	Jamb	Solid	Metal	0.06
773	1958 Bldg	82	XRF	4/16/97	1	Room	10	Radiator	Solid	Metal	0.01	
774	1958 Bldg	85	XRF	6/3/97	1	Room	10	Wall	Midle Wall	Solid	Concrete	0.04
775	1958 Bldg	86	XRF	6/3/97	1	Room	10	Door	Door	Solid	Wood	0.02
776	1958 Bldg	87	XRF	6/3/97	1	Room	10	Door	Casing	Solid	Metal	0.12
777	1958 Bldg	88	XRF	6/3/97	1	Room	10	Wall	Baseboar	Solid	Tile	1.88
778	1958 Bldg	89	XRF	6/3/97	1	Room	10	Radiator	Solid	Metal	0.01	
779	1958 Bldg	90	XRF	6/3/97	1	Room	10	Racks		Solid	Metal	0.07
780	1958 Bldg	83	XRF	4/16/97	1	Room	11	Wall	Midle Wall	Solid	Plaster	0.01
781	1958 Bldg	84	XRF	4/16/97	1	Room	11	Wall	Wall	Solid	Plaster	0.02
782	1958 Bldg	85	XRF	4/16/97	1	Room	11	Door	Door	Solid	Wood	0.02
783	1958 Bldg	86	XRF	4/16/97	1	Room	11	Door	Jamb	Solid	Metal	0.07
784	1958 Bldg	87	XRF	4/16/97	1	Room	11	Wall	Midle Wall	Solid	Plaster	0.03
785	1958 Bldg	88	XRF	4/16/97	1	Room	11	Bookcase	Shelf	Solid	Wood	0.02
786	1958 Bldg	91	XRF	6/3/97	1	Room	11	Wall	Midle Wall	Solid	Concrte	0.02
787	1958 Bldg	92	XRF	6/3/97	1	Room	11	Wall	Midle Wall	Solid	Concrte	0.03
788	1958 Bldg	93	XRF	6/3/97	1	Room	11	Wall	Baseboar	Solid	Tile	1.56
789	1958 Bldg	94	XRF	6/3/97	1	Room	11	Door	Door	Solid	Wood	0.02
790	1958 Bldg	95	XRF	6/3/97	1	Room	11	Door	Casing	Solid	Metal	0.01
791	1958 Bldg	96	XRF	6/3/97	1	Room	11	Door	Door	Solid	Metal	0.21
792	1958 Bldg	97	XRF	6/3/97	1	Room	11	Door	Casing	Solid	Metal	0.01
793	1958 Bldg	98	XRF	6/3/97	1	Room	11	Elec Pane	Solid	Metal	0.07	
794	1958 Bldg	99	XRF	6/3/97	1	Room	11	Ceiling	Hatch	Solid	Metal	0.03
795	1958 Bldg	100	XRF	6/3/97	1	Room	11	Ceiling		Peeling	Plaster	0.1
796	1958 Bldg	89	XRF	4/16/97	1	Room	12	Wall	Midle Wall	Solid	Plaster	0.01
797	1958 Bldg	90	XRF	4/16/97	1	Room	12	Door	Door	Solid	Wood	0.02
798	1958 Bldg	91	XRF	4/16/97	1	Room	12	Door	Jamb	Solid	Metal	0.16
799	1958 Bldg	92	XRF	4/16/97	1	Room	12	Column	Solid	Metal	0.1	
800	1958 Bldg	93	XRF	4/16/97	1	Room	12	Radiator	Solid	Metal	0	
801	1958 Bldg	94	XRF	4/16/97	1	Room	12	Cabinet	Door	Solid	Wood	0.01
802	1958 Bldg	95	XRF	4/16/97	1	Room	12	Ceiling		Solid	Plaster	0.01
803	1958 Bldg	101	XRF	6/3/97	1	Room	12	Wall	Midle Wall	Peeling	Concrte	0.18
804	1958 Bldg	102	XRF	6/3/97	1	Room	12	Wall	Baseboar	Peeling	Tile	1.03
805	1958 Bldg	103	XRF	6/3/97	1	Room	12	Wall	Baseboar	Solid	Tile	1.88
806	1958 Bldg	104	XRF	6/3/97	1	Room	12	Wall	Wall	Solid	Concrte	0.03
807	1958 Bldg	105	XRF	6/3/97	1	Room	12	Door	Door	Solid	Metal	0.1
808	1958 Bldg	106	XRF	6/3/97	1	Room	12	Door	Casing	Solid	Metal	0.03
809	1958 Bldg	107	XRF	6/3/97	1	Room	12	Radiator	Solid	Metal	0.02	
810	1958 Bldg	108	XRF	6/3/97	1	Room	12	Wall	Wall Rgstr	Solid	Metal	0.06
811	1958 Bldg	109	XRF	6/3/97	1	Room	12	Cabinet	Door	Solid	Metal	0.07
812	1958 Bldg	110	XRF	6/3/97	1	Room	12	Ceiling		Solid	Plaster	0.18
813	1958 Bldg	96	XRF	4/16/97	1	Room	13	Wall	Midle Wall	Solid	Plaster	0.01
814	1958 Bldg	97	XRF	4/16/97	1	Room	13	Wall	Midle Wall	Solid	Drywall	0.03
815	1958 Bldg	98	XRF	4/16/97	1	Room	13	Door	Door	Solid	Wood	0.02
816	1958 Bldg	99	XRF	4/16/97	1	Room	13	Door	Door	Solid	Wood	0.03
817	1958 Bldg	100	XRF	4/16/97	1	Room	13	Door	Jamb	Solid	Metal	0.18
818	1958 Bldg	101	XRF	4/16/97	1	Room	13	Door	Door	Solid	Metal	0.01
819	1958 Bldg	102	XRF	4/16/97	1	Room	13	Door	Jamb	Solid	Metal	0.12
820	1958 Bldg	103	XRF	4/16/97	1	Room	13	Door	Door	Solid	Wood	0.02

Saint Paul Public Schools
 Highland Park Junior High School
 Lead-Based Paint Inspection

A	B	C	D	E	F	G	H	I	J	K	L	
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Compon	Feature	Condition	Substrate	Result
821	1958 Bldg	104	XRF	4/16/97	1	Room	13	Door	Casing	Solid	Wood	0.02
822	1958 Bldg	105	XRF	4/16/97	1	Room	13	Bookcase	Inside	Solid	Wood	0.01
823	1958 Bldg	106	XRF	4/16/97	1	Room	13		Column	Solid	Metal	0.08
824	1958 Bldg	111	XRF	6/3/97	1	Room	13	Wall	Midle Wall	Solid	Concrete	0.01
825	1958 Bldg	112	XRF	6/3/97	1	Room	13	Wall	Midle Wall	Solid	Concrete	0.03
826	1958 Bldg	113	XRF	6/3/97	1	Room	13	Wall	Midle Wall	Solid	Wood	0
827	1958 Bldg	114	XRF	6/3/97	1	Room	13	Wall	Baseboar	Solid	Tile	1.71
828	1958 Bldg	115	XRF	6/3/97	1	Room	13	Door	Door	Solid	Metal	0.14
829	1958 Bldg	116	XRF	6/3/97	1	Room	13	Door	Casing	Solid	Metal	0.1
830	1958 Bldg	117	XRF	6/3/97	1	Room	13	Door	Door	Solid	Wood	0.02
831	1958 Bldg	118	XRF	6/3/97	1	Room	13	Door	Casing	Solid	Metal	0.12
832	1958 Bldg	119	XRF	6/3/97	1	Room	13	Cabinet	Door	Solid	Wood	0
833	1958 Bldg	120	XRF	6/3/97	1	Room	13	Cabinet	Shelf	Solid	Wood	0.01
834	1958 Bldg	121	XRF	6/3/97	1	Room	13	Cabinet	Outside	Solid	Wood	0
835	1958 Bldg	122	XRF	6/3/97	1	Room	13	Ceiling	Diffuser	Solid	Metal	0.01
836	1958 Bldg	107	XRF	4/16/97	1	Room	14	Wall	Midle Wall	Solid	Plaster	0.01
837	1958 Bldg	108	XRF	4/16/97	1	Room	14	Wall	Wall	Solid	Plaster	0.2
838	1958 Bldg	109	XRF	4/16/97	1	Room	14	Door	Door	Solid	Wood	0.03
839	1958 Bldg	110	XRF	4/16/97	1	Room	14	Door	Jamb	Solid	Metal	0.14
840	1958 Bldg	111	XRF	4/16/97	1	Room	14	Door	Door	Solid	Metal	0.3
841	1958 Bldg	112	XRF	4/16/97	1	Room	14		Radiator	Solid	Metal	0.08
842	1958 Bldg	113	XRF	4/16/97	1	Room	14		Column	Solid	Metal	0.11
843	1958 Bldg	114	XRF	4/16/97	1	Room	14		Elec Pane	Solid	Metal	0.21
844	1958 Bldg	101	XRF	5/28/97	1	Room	24	Wall	Midle Wall	Solid	Tile	0.12
845	1958 Bldg	102	XRF	5/28/97	1	Room	24	Wall	Midle Wall	Solid	Metal	0.05
846	1958 Bldg	103	XRF	5/28/97	1	Room	24		Crown mo	Solid	Wood	0
847	1958 Bldg	104	XRF	5/28/97	1	Room	24		Crown mo	Solid	Wood	0.01
848	1958 Bldg	105	XRF	5/28/97	1	Room	24	Door	Door	Solid	Wood	0.01
849	1958 Bldg	106	XRF	5/28/97	1	Room	24	Door	Casing	Solid	Metal	0.1
850	1958 Bldg	107	XRF	5/28/97	1	Room	24	Wall	Chair rail	Solid	Wood	0.02
851	1958 Bldg	108	XRF	5/28/97	1	Room	24	Bench		Solid	Wood	0.01
852	1958 Bldg	109	XRF	5/28/97	1	Room	24	Bench	Back	Solid	Metal	0.16
853	1958 Bldg	110	XRF	5/28/97	1	Room	24	Bench	Bracket	Solid	Metal	0.13
854	1958 Bldg	111	XRF	5/28/97	1	Room	24		Locker	Solid	Metal	0.04
855	1958 Bldg	112	XRF	5/28/97	1	Room	24	Wall	Wall Rgstr	Solid	Metal	0.01
856	1958 Bldg	113	XRF	5/28/97	1	Room	24	Window	Casing	Solid	Metal	0.07
857	1958 Bldg	114	XRF	5/28/97	1	Room	24	Ceiling	Hatch	Solid	Metal	0
858	1958 Bldg	108	XRF	4/12/97	1	Room	27	Wall	Baseboar	Solid	Concrete	0.03
859	1958 Bldg	161	XRF	4/26/97	1	Room	28	Wall	Midle Wall	Solid	Plaster	0
860	1958 Bldg	162	XRF	4/26/97	1	Room	28	Wall	Midle Wall	Solid	Tile	0.13
861	1958 Bldg	163	XRF	4/26/97	1	Room	28	Wall	Midle Wall	Solid	Drywall	0
862	1958 Bldg	164	XRF	4/26/97	1	Room	28	Door	Door	Solid	Wood	0.01
863	1958 Bldg	165	XRF	4/26/97	1	Room	28	Door	Jamb	Solid	Metal	0.14
864	1958 Bldg	166	XRF	4/26/97	1	Room	28	Door	Door	Solid	Wood	0.01
865	1958 Bldg	167	XRF	4/26/97	1	Room	28	Door	Jamb	Solid	Metal	0.01
866	1958 Bldg	168	XRF	4/26/97	1	Room	28		Radiator	Solid	Metal	0.01
867	1958 Bldg	169	XRF	4/26/97	1	Room	28	Wall	Wall Rgstr	Solid	Metal	0
868	1958 Bldg	170	XRF	4/26/97	1	Room	28		Column	Solid	Plaster	0.01
869	1958 Bldg	171	XRF	4/26/97	1	Room	28		Column	Solid	Drywall	0
870	1958 Bldg	172	XRF	4/26/97	1	Room	28	Bookcase	Shelf	Solid	Wood	0.01
871	1958 Bldg	173	XRF	4/26/97	1	Room	28	Bookcase	Inside	Solid	Wood	0.01
872	1958 Bldg	143	XRF	5/28/97	1	Room	34	Wall	Midle Wall	Solid	Tile	0.15
873	1958 Bldg	144	XRF	5/28/97	1	Room	34	Wall	Hatch	Solid	Metal	0.06
874	1958 Bldg	145	XRF	5/28/97	1	Room	34	Wall	Wall Rgstr	Solid	Metal	0.09
875	1958 Bldg	146	XRF	5/28/97	1	Room	34	Bookcase	Shelf	Solid	Wood	0.02
876	1958 Bldg	147	XRF	5/28/97	1	Room	34	Wall	Chair rail	Solid	Wood	0.31
877	1958 Bldg	148	XRF	5/28/97	1	Room	34	Door	Door	Solid	Wood	0.03
878	1958 Bldg	149	XRF	5/28/97	1	Room	34	Door	Jamb	Solid	Metal	0.05
879	1958 Bldg	150	XRF	5/28/97	1	Room	34	Ceiling		Solid	Plaster	0.01
880	1958 Bldg	163	XRF	5/28/97	1	Room	50	Wall	Midle Wall	Solid	Tile	0.14
881	1958 Bldg	164	XRF	5/28/97	1	Room	50	Wall	Midle Wall	Solid	Wood	0
882	1958 Bldg	165	XRF	5/28/97	1	Room	50	Bookcase	Shelf	Solid	Wood	0.01
883	1958 Bldg	166	XRF	5/28/97	1	Room	50	Floor		Solid	Tile	0.16

Saint Paul Public Schools
 Highland Park Junior High School
 Lead-Based Paint Inspection

A	B	C	D	E	F	G	H	I	J	K	L	
Site	Sample #	Analysis	Date	Floor	Area	Room#	Compon	Feature	Condition	Substrate	Result	
3	884	1958 Bldg	167 XRF	5/28/97	1 Room	50	Ceiling		Peeling	Plaster	0.01	
	885	1958 Bldg	168 XRF	5/28/97	1 Room	50	Ceiling	Diffuser	Peeling	Metal	0	
	886	1958 Bldg	180 XRF	6/2/97	1 Room	73	Wall	Wall	Solid	Concrte	0.01	
	887	1958 Bldg	181 XRF	6/2/97	1 Room	73	Door	Door	Solid	Wood	0.02	
	888	1958 Bldg	182 XRF	6/2/97	1 Room	73	Door	Casing	Solid	Metal	0.07	
	889	1958 Bldg	183 XRF	6/2/97	1 Room	73	Bulletin B	Frame	Solid	Wood	0	
	890	1958 Bldg	184 XRF	6/2/97	1 Room	73	Bulletin B	Frame	Solid	Wood	0	
	891	1958 Bldg	185 XRF	6/2/97	1 Room	73	Wall	Chair rail	Solid	Wood	0.01	
	892	1958 Bldg	186 XRF	6/2/97	1 Room	73	Wall	Baseboar	Solid	Metal	0.04	
	893	1958 Bldg	187 XRF	6/2/97	1 Room	73	Ceiling		Solid	Concrte	0	
	894	1958 Bldg	188 XRF	6/2/97	1 Room	73	Bookcase	Shelf	Solid	Wood	0.01	
	895	1958 Bldg	189 XRF	6/2/97	2 Room	74	Wall	Midle Wall	Solid	Tile	0.25	
	896	1958 Bldg	190 XRF	6/2/97	2 Room	74	Door	Door	Solid	Wood	0.01	
	897	1958 Bldg	191 XRF	6/2/97	2 Room	74	Door	Casing	Solid	Metal	0.08	
	898	1958 Bldg	192 XRF	6/2/97	2 Room	74	Ceiling	Diffuser	Solid	Metal	0.02	
	899	1958 Bldg	193 XRF	6/2/97	2 Room	74	Ceiling	Hatch	Solid	Metal	0.03	
	900	1958 Bldg	194 XRF	6/2/97	2 Room	74	Floor		Solid	Tile	0.25	
	901	1958 Bldg	195 XRF	6/2/97	2 Room	75	Wall	Midle Wall	Solid	Tile	0.15	
	902	1958 Bldg	196 XRF	6/2/97	2 Room	75	Window	Panel	Solid	Wood	0.04	
	903	1958 Bldg	197 XRF	6/2/97	2 Room	75	Door	Door	Solid	Wood	0.02	
	904	1958 Bldg	198 XRF	6/2/97	2 Room	75	Door	Casing	Solid	Metal	0.15	
	905	1958 Bldg	199 XRF	6/2/97	2 Room	75	Radiator	Solid	Metal	0.09		
	906	1958 Bldg	200 XRF	6/2/97	2 Room	75	Column	Solid	Metal	0.05		
	907	1958 Bldg	201 XRF	6/2/97	2 Room	75	Wall	Baseboar	Solid	Tile	0.1	
	908	1958 Bldg	202 XRF	6/2/97	2 Room	75	Locker	Solid	Metal	0.06		
	909	1958 Bldg	203 XRF	6/2/97	2 Room	75	Bookcase	Shelf	Solid	Wood	0.02	
	910	1958 Bldg	6 XRF	6/3/97	2 Room	76	Wall	Midle Wall	Solid	Concrte	0.07	
	911	1958 Bldg	7 XRF	6/3/97	2 Room	76	Wall	Midle Wall	Solid	Tile	0.24	
	912	1958 Bldg	8 XRF	6/3/97	2 Room	76	Wall	Midle Wall	Solid	Wood	0.08	
	913	1958 Bldg	9 XRF	6/3/97	2 Room	76	Door	Door	Solid	Metal	0.1	
	914	1958 Bldg	10 XRF	6/3/97	2 Room	76	Door	Casing	Solid	Metal	0.08	
	915	1958 Bldg	11 XRF	6/3/97	2 Room	76	Door	Radiator	Solid	Metal	0.05	
	916	1958 Bldg	12 XRF	6/3/97	2 Room	76	Cooler		Solid	Metal	0.05	
	917	1958 Bldg	13 XRF	6/3/97	2 Room	76	Beam		Solid	Metal	0.03	
	918	1958 Bldg	14 XRF	6/3/97	2 Room	76	Ceiling	Diffuser	Solid	Metal	0.01	
	919	1958 Bldg	15 XRF	6/3/97	2 Room	76	Ceiling		Solid	Plaster	0	
	920	1958 Bldg	16 XRF	6/3/97	2 Room	77	Wall	Midle Wall	Solid	Metal	0.25	
	921	1958 Bldg	17 XRF	6/3/97	2 Room	77	Door	Door	Solid	Wood	0.01	
	922	1958 Bldg	18 XRF	6/3/97	2 Room	77	Door	Casing	Solid	Metal	0.07	
	923	1958 Bldg	19 XRF	6/3/97	2 Room	77			Locker	Solid	Metal	0.17
	924	1958 Bldg	20 XRF	6/3/97	2 Room	78	Wall	Midle Wall	Solid	Plaster	0.04	
	925	1958 Bldg	21 XRF	6/3/97	2 Room	78	Ceiling		Solid	Plaster	0.03	
	926	1958 Bldg	22 XRF	6/3/97	2 Room	78	Floor		Solid	Tile	0.26	
	927	1958 Bldg	10 XRF	6/17/97	1 Room	80	Wall	Midle Wall	Solid	Concrte	0.04	
	928	1958 Bldg	11 XRF	6/17/97	1 Room	80	Wall	Midle Wall	Chalkin	Concrte	0.03	
	929	1958 Bldg	12 XRF	6/17/97	1 Room	80	Wall	Midle Wall	Chalkin	Concrte	0.02	
	930	1958 Bldg	13 XRF	6/17/97	1 Room	80	Door	Door	Chalkin	Wood	0	
	931	1958 Bldg	14 XRF	6/17/97	1 Room	80	Door	Door	Chalkin	Metal	0.07	
	932	1958 Bldg	15 XRF	6/17/97	1 Room	80	Door	Casing	Chalkin	Metal	0.19	
	933	1958 Bldg	16 XRF	6/17/97	1 Room	80	Ceiling		Solid	Concrte	0.09	
	934	1958 Bldg	55 XRF	5/28/97	1 Room	101	Wall	Midle Wall	Solid	Metal	0	
	935	1958 Bldg	56 XRF	5/28/97	1 Room	101	Wall	Wall	Solid	Plaster	0	
	936	1958 Bldg	57 XRF	5/28/97	1 Room	101	Wall	Wall	Solid	Wood	0.09	
	937	1958 Bldg	58 XRF	5/28/97	1 Room	101	Door	Door	Solid	Wood	0.03	
	938	1958 Bldg	59 XRF	5/28/97	1 Room	101	Door	Casing	Solid	Metal	0.05	
	939	1958 Bldg	60 XRF	5/28/97	1 Room	101	Cabinet	Door	Solid	Wood	0.01	
	940	1958 Bldg	61 XRF	5/28/97	1 Room	101	Wall	Wall Rgstr	Solid	Metal	0	
	941	1958 Bldg	62 XRF	5/28/97	1 Room	101	Wall	Wall Rgstr	Solid	Metal	0	
	942	1958 Bldg	63 XRF	5/28/97	1 Room	101	Bookcase	Shelf	Solid	Wood	0.03	
	943	1958 Bldg	64 XRF	5/28/97	1 Room	101	Ceiling		Solid	Plaster	0.01	
	944	1958 Bldg	413 XRF	5/27/97	1 Room	102	Wall	Wall	Solid	Plaster	0.02	
	945	1958 Bldg	414 XRF	5/27/97	1 Room	102	Wall	Wall	Solid	Plaster	0.01	
	946	1958 Bldg	415 XRF	5/27/97	1 Room	102	Door	Door	Solid	Wood	0.02	

Saint Paul Public Schools
 Highland Park Junior High School
 Lead-Based Paint Inspection

A	B	C	D	E	F	G	H	I	J	K	L	
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Compon	Feature	Condition	Substrate	Result
947	1958 Bldg	416	XRF	5/27/97	1	Room	102	Door	Casing	Solid	Metal	0.02
948	1958 Bldg	417	XRF	5/27/97	1	Room	102	Cabinet	Door	Solid	Wood	0.02
949	1958 Bldg	418	XRF	5/27/97	1	Room	102	Wall	Wall Rgstr	Solid	Metal	0.03
950	1958 Bldg	419	XRF	5/27/97	1	Room	102	Wall	Wall Rgstr	Solid	Metal	0.01
951	1958 Bldg	420	XRF	5/27/97	1	Room	102	Celling		Solid	Plaster	0.01
952	1958 Bldg	389	XRF	5/27/97	1	Room	104	Wall	Wall	Solid	Plaster	0.09
953	1958 Bldg	390	XRF	5/27/97	1	Room	104	Wall	Wall	Solid	Plaster	0.01
954	1958 Bldg	391	XRF	5/27/97	1	Room	104	Wall	Wall	Solid	Plaster	0.01
955	1958 Bldg	392	XRF	5/27/97	1	Room	104	Door	Casing	Solid	Wood	0.02
956	1958 Bldg	393	XRF	5/27/97	1	Room	104	Door	Door	Solid	Wood	0.02
957	1958 Bldg	394	XRF	5/27/97	1	Room	104	Cabinet	Door	Solid	Wood	0.01
958	1958 Bldg	395	XRF	5/27/97	1	Room	104	Door	Header	Solid	Metal	0.24
959	1958 Bldg	396	XRF	5/27/97	1	Room	104	Chalkboar	Rail	Solid	Wood	0
960	1958 Bldg	397	XRF	5/27/97	1	Room	104	Baseboar	Solid	Wood	0.02	
961	1958 Bldg	398	XRF	5/27/97	1	Room	104	Wall	Wall	Solid	Wood	0.01
962	1958 Bldg	399	XRF	5/27/97	1	Room	104	Wall	Wall Rgstr	Solid	Metal	0.02
963	1958 Bldg	400	XRF	5/27/97	1	Room	104	Beam		Solid	Metal	0
964	1958 Bldg	401	XRF	5/27/97	1	Room	104	Celling		Solid	Plaster	0
965	1958 Bldg	402	XRF	5/27/97	1	Room	104	Baseboar	Solid	Metal	0.01	
966	1958 Bldg	128	XRF	4/16/97	1	Room	105	Wall	Midle Wall	Solid	Plaster	0.01
967	1958 Bldg	129	XRF	4/16/97	1	Room	105	Wall	Wall	Solid	Plaster	0.03
968	1958 Bldg	130	XRF	4/16/97	1	Room	105	Door	Door	Solid	Wood	0.03
969	1958 Bldg	131	XRF	4/16/97	1	Room	105	Door	Jamb	Solid	Metal	0.11
970	1958 Bldg	132	XRF	4/16/97	1	Room	105	Cabinet	Door	Solid	Wood	0.01
971	1958 Bldg	133	XRF	4/16/97	1	Room	105	Cabinet	Shelf	Solid	Wood	0.03
972	1958 Bldg	134	XRF	4/16/97	1	Room	105	Wall	Wall Rgstr	Solid	Metal	0.83
973	1958 Bldg	135	XRF	4/16/97	1	Room	105	Window	Casing	Solid	Metal	0.1
974	1958 Bldg	173	XRF	5/23/97	1	Room	105	Wall	Wall	Solid	Plaster	0.5
975	1958 Bldg	174	XRF	5/23/97	1	Room	105	Wall	Wall	Solid	Plaster	0.44
976	1958 Bldg	175	XRF	5/23/97	1	Room	105	Wall	Wall	Solid	Plaster	0.6
977	1958 Bldg	176	XRF	5/23/97	1	Room	105	Wall	Midle Wall	Solid	Wood	0.01
978	1958 Bldg	177	XRF	5/23/97	1	Room	105	Door	Door	Solid	Wood	0.02
979	1958 Bldg	178	XRF	5/23/97	1	Room	105	Door	Casing	Solid	Metal	0.05
980	1958 Bldg	179	XRF	5/23/97	1	Room	105	Cabinet	Door	Solid	Wood	0.01
981	1958 Bldg	180	XRF	5/23/97	1	Room	105	Cabinet	Floor	Solid	Wood	0.02
982	1958 Bldg	181	XRF	5/23/97	1	Room	105	Wall	Wall Rgstr	Solid	Metal	0.52
983	1958 Bldg	182	XRF	5/23/97	1	Room	105	TV	Bracket	Solid	Metal	0.01
984	1958 Bldg	183	XRF	5/23/97	1	Room	105	Ceiling	Hatch	Solid	Metal	0.23
985	1958 Bldg	184	XRF	5/23/97	1	Room	105	Ceiling	Ceil. Tile	Solid	Wood	0
986	1958 Bldg	207	XRF	5/23/97	1	Room	106	Wall	Wall	Cracked	Plaster	0.38
987	1958 Bldg	208	XRF	5/23/97	1	Room	106	Wall	Wall	Cracked	Plaster	0.41
988	1958 Bldg	209	XRF	5/23/97	1	Room	106	Wall	Wall	Solid	Plaster	0.03
989	1958 Bldg	210	XRF	5/23/97	1	Room	106	Wall	Wall	Solid	Plaster	0.04
990	1958 Bldg	211	XRF	5/23/97	1	Room	106	Wall	Midle Wall	Solid	Wood	0
991	1958 Bldg	212	XRF	5/23/97	1	Room	106	Cabinet	Door	Solid	Wood	0.01
992	1958 Bldg	213	XRF	5/23/97	1	Room	106	Cabinet	Door	Solid	Wood	0
993	1958 Bldg	214	XRF	5/23/97	1	Room	106	Door	Door	Solid	Wood	0.02
994	1958 Bldg	215	XRF	5/23/97	1	Room	106	Door	Casing	Solid	Metal	0.08
995	1958 Bldg	216	XRF	5/23/97	1	Room	106	Window	Stool	Solid	Metal	0.1
996	1958 Bldg	217	XRF	5/23/97	1	Room	106	Wall	Wall Rgstr	Solid	Metal	0.33
997	1958 Bldg	218	XRF	5/23/97	1	Room	106	Camera	Bracket	Solid	Metal	0.01
998	1958 Bldg	219	XRF	5/23/97	1	Room	106	TV	Bracket	Solid	Metal	0.02
999	1958 Bldg	143	XRF	5/23/97	1	Room	107	Wall	Wall	Solid	Plaster	0.02
1000	1958 Bldg	144	XRF	5/23/97	1	Room	107	Wall	Wall	Solid	Plaster	0.03
1001	1958 Bldg	145	XRF	5/23/97	1	Room	107	Wall	Wall	Solid	Plaster	0.02
1002	1958 Bldg	146	XRF	5/23/97	1	Room	107	Door	Door	Solid	Wood	0.02
1003	1958 Bldg	147	XRF	5/23/97	1	Room	107	Door	Casing	Solid	Metal	0.07
1004	1958 Bldg	148	XRF	5/23/97	1	Room	107	Window	Mullion	Solid	Metal	0.2
1005	1958 Bldg	149	XRF	5/23/97	1	Room	107	Cabinet	Door	Solid	Wood	0.01
1006	1958 Bldg	150	XRF	5/23/97	1	Room	107	Cabinet	Shelf	Solid	Wood	0.01
1007	1958 Bldg	151	XRF	5/23/97	1	Room	107	Ceiling	Hatch	Solid	Metal	0.05
1008	1958 Bldg	152	XRF	5/23/97	1	Room	107	Wall	Wall Rgstr	Solid	Metal	2.61
1009	1958 Bldg	153	XRF	5/23/97	1	Room	107	Wall	Wall	Solid	Wood	0

Saint Paul Public Schools
 Highland Park Junior High School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Componen	Feature	Condition	Substrate	Result
1010	1958 Bldg	154	XRF	5/23/97	1	Room	107	TV	Bracket	Solid	Metal	0.03
1011	1958 Bldg	100	XRF	5/22/97	1	Room	108	Wall	Wall	Solid	Plaster	0.01
1012	1958 Bldg	101	XRF	5/22/97	1	Room	108	Wall	Wall	Solid	Plaster	0.01
1013	1958 Bldg	102	XRF	5/22/97	1	Room	108	Crown mo	Solid	Wood	0	
1014	1958 Bldg	103	XRF	5/22/97	1	Room	108	Wall	Wall	Solid	Plaster	0.02
1015	1958 Bldg	104	XRF	5/22/97	1	Room	108	Wall	Board	Solid	Wood	0.02
1016	1958 Bldg	105	XRF	5/22/97	1	Room	108	Door	Door	Solid	Wood	0.03
1017	1958 Bldg	106	XRF	5/22/97	1	Room	108	Door	Casing	Solid	Metal	0.07
1018	1958 Bldg	107	XRF	5/22/97	1	Room	108	Window	Stool	Solid	Metal	0.08
1019	1958 Bldg	108	XRF	5/22/97	1	Room	108	Cabinet	Door	Solid	Wood	0.01
1020	1958 Bldg	109	XRF	5/22/97	1	Room	108	Cabinet	Floor	Solid	Wood	0
1021	1958 Bldg	110	XRF	5/22/97	1	Room	108	Wall	Wall Rgstr	Solid	Metal	0
1022	1958 Bldg	111	XRF	5/22/97	1	Room	108	Ceiling		Solid	Plaster	0
1023	1958 Bldg	112	XRF	5/22/97	1	Room	108	Screen	Bracket	Solid	Metal	0.04
1024	1958 Bldg	113	XRF	5/22/97	1	Room	108	Speaker		Solid	Metal	0
1025	1958 Bldg	86	XRF	5/22/97	1	Room	109	Wall	Wall	Solid	Plaster	0.01
1026	1958 Bldg	87	XRF	5/22/97	1	Room	109	Wall	Wall	Solid	Plaster	0.01
1027	1958 Bldg	88	XRF	5/22/97	1	Room	109	Wall	Wall	Solid	Plaster	0.01
1028	1958 Bldg	89	XRF	5/22/97	1	Room	109	Door	Door	Solid	Wood	0.02
1029	1958 Bldg	90	XRF	5/22/97	1	Room	109	Door	Casing	Solid	Metal	0.07
1030	1958 Bldg	91	XRF	5/22/97	1	Room	109	Window	Casing	Solid	Metal	0.17
1031	1958 Bldg	92	XRF	5/22/97	1	Room	109	Cabinet	Door	Solid	Wood	0.01
1032	1958 Bldg	93	XRF	5/22/97	1	Room	109	Bookcase	Shelf	Solid	Wood	0.01
1033	1958 Bldg	94	XRF	5/22/97	1	Room	109		Columns	Solid	Metal	0.05
1034	1958 Bldg	95	XRF	5/22/97	1	Room	109	Wall	Wall Rgstr	Solid	Metal	0
1035	1958 Bldg	96	XRF	5/22/97	1	Room	109	Wall	Wall Rgstr	Solid	Metal	0.01
1036	1958 Bldg	97	XRF	5/22/97	1	Room	109	Wall	Wall Rgstr	Solid	Wood	0
1037	1958 Bldg	98	XRF	5/22/97	1	Room	109	TV	Bracket	Solid	Metal	0.02
1038	1958 Bldg	99	XRF	5/22/97	1	Room	109	Ceiling	Hatch	Solid	Metal	0.02
1039	1958 Bldg	49	XRF	5/22/97	1	Room	110	Wall	Wall	Solid	Plaster	0.01
1040	1958 Bldg	50	XRF	5/22/97	1	Room	110	Wall	Wall	Solid	Plaster	0.02
1041	1958 Bldg	51	XRF	5/22/97	1	Room	110	Door	Door	Solid	Wood	0.03
1042	1958 Bldg	52	XRF	5/22/97	1	Room	110	Door	Casing	Solid	Metal	0.11
1043	1958 Bldg	53	XRF	5/22/97	1	Room	110		Crown mo	Solid	Wood	0.02
1044	1958 Bldg	54	XRF	5/22/97	1	Room	110	Window	Mullion	Solid	Metal	0.19
1045	1958 Bldg	55	XRF	5/22/97	1	Room	110	Window	Casing	Solid	Metal	0.14
1046	1958 Bldg	56	XRF	5/22/97	1	Room	110	Cabinet	Door	Solid	Wood	0.02
1047	1958 Bldg	57	XRF	5/22/97	1	Room	110	Bookcase	Shelf	Solid	Wood	0.01
1048	1958 Bldg	58	XRF	5/22/97	1	Room	110	Wall	Wall Rgstr	Solid	Metal	2.17
1049	1958 Bldg	59	XRF	5/22/97	1	Room	110	Wall	Wall Rgstr	Solid	Metal	0
1050	1958 Bldg	60	XRF	5/22/97	1	Room	110	Wall	Wall Rgstr	Solid	Metal	0.01
1051	1958 Bldg	61	XRF	5/22/97	1	Room	110	Bracket		Solid	Metal	0.03
1052	1958 Bldg	62	XRF	5/22/97	1	Room	110	Bracket		Solid	Metal	0.02
1053	1958 Bldg	63	XRF	5/22/97	1	Room	110	Ceiling	Hatch	Solid	Metal	0.03
1054	1958 Bldg	15	XRF	5/22/97	1	Room	111	Wall	Wall	Solid	Plaster	0.77
1055	1958 Bldg	16	XRF	5/22/97	1	Room	111	Wall	Wall	Solid	Plaster	0.56
1056	1958 Bldg	17	XRF	5/22/97	1	Room	111	Wall	Wall	Solid	Plaster	0.02
1057	1958 Bldg	18	XRF	5/22/97	1	Room	111	Door	Door	Solid	Wood	0.02
1058	1958 Bldg	19	XRF	5/22/97	1	Room	111	Door	Casing	Solid	Metal	0.29
1059	1958 Bldg	20	XRF	5/22/97	1	Room	111	Window	Mullion	Solid	Metal	0.15
1060	1958 Bldg	21	XRF	5/22/97	1	Room	111	Wire	Tray	Solid	Metal	0.2
1061	1958 Bldg	22	XRF	5/22/97	1	Room	111	Cabinet	Door	Solid	Metal	0
1062	1958 Bldg	23	XRF	5/22/97	1	Room	111	Cabinet	Outside	Solid	Metal	0
1063	1958 Bldg	24	XRF	5/22/97	1	Room	111	Cupboard	Door	Solid	Metal	0
1064	1958 Bldg	25	XRF	5/22/97	1	Room	111	Cabinet	Shelf	Solid	Metal	0
1065	1958 Bldg	26	XRF	5/22/97	1	Room	111	Cabinet	Shelf	Solid	Metal	0.07
1066	1958 Bldg	27	XRF	5/22/97	1	Room	111	Board	Bracket	Solid	Wood	0
1067	1958 Bldg	28	XRF	5/22/97	1	Room	111	Fire Blank	Cabinet	Solid	Metal	0.55
1068	1958 Bldg	29	XRF	5/22/97	1	Room	111	Screen	Bracket	Solid	Metal	0.02
1069	1958 Bldg	30	XRF	5/22/97	1	Room	111	Wall	Wall Rgstr	Solid	Metal	0.71
1070	1958 Bldg	31	XRF	5/22/97	1	Room	111	Ceiling	Diffuser	Solid	Metal	0
1071	1958 Bldg	118	XRF	6/17/97	1	Room	111	Wall	Midle Wall	Solid	Drywall	0.03
1072	1958 Bldg	119	XRF	6/17/97	1	Room	111	Wall	Midle Wall	Solid	Plaster	0.04

Saint Paul Public Schools
 Highland Park Junior High School
 Lead-Based Paint Inspection

A	B	C	D	E	F	G	H	I	J	K	L	
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Compon	Feature	Condition	Substrate	Result
1073	1958 Bldg	120	XRF	6/17/97	1	Room	111	Wall	Midle Wall	Solid	Wood	0
1074	1958 Bldg	121	XRF	6/17/97	1	Room	111	Wall	Midle Wall	Solid	Drywall	0.02
1075	1958 Bldg	122	XRF	6/17/97	1	Room	111	Wall	Midle Wall	Solid	Concrete	0.02
1076	1958 Bldg	123	XRF	6/17/97	1	Room	111	Wall	Midle Wall	Solid	Concrete	5.09
1077	1958 Bldg	124	XRF	6/17/97	1	Room	111	Wall	Midle Wall	Solid	Concrete	5.09
1078	1958 Bldg	125	XRF	6/17/97	1	Room	111	Door	Door	Solid	Wood	0
1079	1958 Bldg	126	XRF	6/17/97	1	Room	111	Door	Casing	Solid	Metal	0.03
1080	1958 Bldg	127	XRF	6/17/97	1	Room	111	Cabinet	Door	Solid	Metal	0.08
1081	1958 Bldg	128	XRF	6/17/97	1	Room	111	Cabinet	Door	Solid	Metal	0.11
1082	1958 Bldg	129	XRF	6/17/97	1	Room	111	Cabinet	Outside	Solid	Wood	0
1083	1958 Bldg	130	XRF	6/17/97	1	Room	111	Wall	Midle Wall	Solid	Wood	0.06
1084	1958 Bldg	131	XRF	6/17/97	1	Room	111	Wall	Wall Rgstr	Solid	Metal	0.02
1085	1958 Bldg	132	XRF	6/17/97	1	Room	111	Wall	Chair rail	Solid	Wood	0
1086	1958 Bldg	133	XRF	6/17/97	1	Room	111	Cabinet	Door	Solid	Wood	0
1087	1958 Bldg	134	XRF	6/17/97	1	Room	111		Radiator	Solid	Metal	0.02
1088	1958 Bldg	230	XRF	5/23/97	1	Room	112	Wall	Wall	Solid	Plaster	0.07
1089	1958 Bldg	231	XRF	5/23/97	1	Room	112	Wall	Wall	Solid	Plaster	0.11
1090	1958 Bldg	232	XRF	5/23/97	1	Room	112	Wall	Wall	Solid	Drywall	0.05
1091	1958 Bldg	233	XRF	5/23/97	1	Room	112	Wall	Wall	Solid	Plaster	0.07
1092	1958 Bldg	234	XRF	5/23/97	1	Room	112	Wall	Wall	Solid	Plaster	0.14
1093	1958 Bldg	235	XRF	5/23/97	1	Room	112	Wall	Wall	Solid	Concrete	0.1
1094	1958 Bldg	236	XRF	5/23/97	1	Room	112	Wall	Wall	Solid	Concrete	0.05
1095	1958 Bldg	237	XRF	5/23/97	1	Room	112	Wall	Wall	Solid	Concrete	1.33
1096	1958 Bldg	238	XRF	5/23/97	1	Room	112	Window	Panel	Solid	Wood	0
1097	1958 Bldg	239	XRF	5/23/97	1	Room	112	Door	Door	Solid	Wood	0.01
1098	1958 Bldg	240	XRF	5/23/97	1	Room	112	Door	Casing	Solid	Metal	0.09
1099	1958 Bldg	241	XRF	5/23/97	1	Room	112	Door	Vent	Solid	Metal	0.05
1100	1958 Bldg	242	XRF	5/23/97	1	Room	112	Window	Stool	Solid	Metal	0.13
1101	1958 Bldg	243	XRF	5/23/97	1	Room	112	Cabinet	Door	Solid	Wood	0.01
1102	1958 Bldg	244	XRF	5/23/97	1	Room	112	Counter	Top	Solid	Wood	0.01
1103	1958 Bldg	245	XRF	5/23/97	1	Room	112	Bookcase	Inside	Solid	Wood	0.01
1104	1958 Bldg	246	XRF	5/23/97	1	Room	112	Locker	Inside	Solid	Metal	0.21
1105	1958 Bldg	247	XRF	5/23/97	1	Room	112	Locker		Solid	Metal	0.05
1106	1958 Bldg	248	XRF	5/23/97	1	Room	112	Work Ben	Top	Solid	Wood	0.04
1107	1958 Bldg	249	XRF	5/23/97	1	Room	112	Chalkboar	Rail	Solid	Wood	0
1108	1958 Bldg	250	XRF	5/23/97	1	Room	112	TV	Board	Solid	Wood	0
1109	1958 Bldg	251	XRF	5/23/97	1	Room	112	TV	Bracket	Solid	Metal	0.02
1110	1958 Bldg	252	XRF	5/23/97	1	Room	112		Elec Pane	Solid	Metal	0.17
1111	1958 Bldg	253	XRF	5/23/97	1	Room	112	Wall	Wall Rgstr	Solid	Metal	0.26
1112	1958 Bldg	254	XRF	5/23/97	1	Room	112	Floor		Solid	Concrete	0.01
1113	1958 Bldg	255	XRF	5/23/97	1	Room	112	Floor		Solid	Tile	0.21
1114	1958 Bldg	264	XRF	5/23/97	1	Room	112	Wall	Wall	Solid	Plaster	0.01
1115	1958 Bldg	265	XRF	5/23/97	1	Room	112	Wall	Wall	Solid	Plaster	0.01
1116	1958 Bldg	266	XRF	5/23/97	1	Room	112	Wall	Wall Rgstr	Solid	Metal	0.01
1117	1958 Bldg	267	XRF	5/23/97	1	Room	112	Wall	Board	Solid	Metal	0
1118	1958 Bldg	268	XRF	5/23/97	1	Room	112	Wall	Board	Solid	Metal	0
1119	1958 Bldg	269	XRF	5/23/97	1	Room	112	Ceiling	Hatch	Solid	Metal	0.06
1120	1958 Bldg	270	XRF	5/23/97	1	Room	112	Wall	Wall	Solid	Concrete	0.19
1121	1958 Bldg	271	XRF	5/23/97	1	Room	112	Wall	Wall	Solid	Concrete	0
1122	1958 Bldg	272	XRF	5/23/97	1	Room	112	Door	Door	Solid	Wood	0.01
1123	1958 Bldg	273	XRF	5/23/97	1	Room	112	Door	Casing	Solid	Metal	0.05
1124	1958 Bldg	274	XRF	5/23/97	1	Room	112	Cabinet	Door	Solid	Wood	0.01
1125	1958 Bldg	275	XRF	5/23/97	1	Room	112	Door	Vent	Solid	Metal	0.04
1126	1958 Bldg	276	XRF	5/23/97	1	Room	112	Ceiling	Diffuser	Solid	Metal	0
1127	1958 Bldg	277	XRF	5/23/97	1	Room	112	Ceiling		Solid	Plaster	0
1128	1958 Bldg	278	XRF	5/23/97	1	Room	112	Ceiling	Diffuser	Solid	Metal	0.01
1129	1958 Bldg	279	XRF	5/23/97	1	Room	112	Ceiling		Solid	Plaster	0.01
1130	1958 Bldg	306	XRF	5/27/97	1	Room	113	Wall	Wall	Solid	Concrete	1.16
1131	1958 Bldg	307	XRF	5/27/97	1	Room	113	Wall	Wall	Solid	Concrete	0.05
1132	1958 Bldg	308	XRF	5/27/97	1	Room	113	Wall	Midle Wall	Solid	Metal	0.01
1133	1958 Bldg	309	XRF	5/27/97	1	Room	113	Window	Panel	Solid	Wood	0
1134	1958 Bldg	310	XRF	5/27/97	1	Room	113	Door	Door	Solid	Wood	0.01
1135	1958 Bldg	311	XRF	5/27/97	1	Room	113	Door	Casing	Solid	Metal	0.06

Saint Paul Public Schools
 Highland Park Junior High School
 Lead-Based Paint Inspection

A	B	C	D	E	F	G	H	I	J	K	L	
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Compon	Feature	Condition	Substrate	Result
1136	1958 Bldg	312	XRF	5/27/97	1	Room	113	Elec Pane	Solid	Metal	0.13	
1137	1958 Bldg	313	XRF	5/27/97	1	Room	113	Ceiling	Diffuser	Solid	Metal	0.01
1138	1958 Bldg	291	XRF	5/27/97	1	Room	115	Wall	Wall	Solid	Plaster	0.06
1139	1958 Bldg	292	XRF	5/27/97	1	Room	115	Wall	Wall	Solid	Plaster	0.07
1140	1958 Bldg	293	XRF	5/27/97	1	Room	115	Wall	Wall	Solid	Concrte	0.05
1141	1958 Bldg	294	XRF	5/27/97	1	Room	115	Wall	Wall	Solid	Drywall	0.01
1142	1958 Bldg	295	XRF	5/27/97	1	Room	115	Wall	Wall	Solid	Concrte	0.05
1143	1958 Bldg	296	XRF	5/27/97	1	Room	115	Window	Panel	Solid	Wood	0
1144	1958 Bldg	297	XRF	5/27/97	1	Room	115	Door	Door	Solid	Wood	0.02
1145	1958 Bldg	298	XRF	5/27/97	1	Room	115	Door	Casing	Solid	Metal	0.12
1146	1958 Bldg	299	XRF	5/27/97	1	Room	115	Window	Casing	Solid	Metal	0.14
1147	1958 Bldg	300	XRF	5/27/97	1	Room	115	Chalkboar	Rail	Solid	Wood	0
1148	1958 Bldg	301	XRF	5/27/97	1	Room	115	TV	Backboar	Solid	Wood	0
1149	1958 Bldg	302	XRF	5/27/97	1	Room	115	TV	Bracket	Solid	Metal	0.02
1150	1958 Bldg	303	XRF	5/27/97	1	Room	115	Wall	Wall Rgstr	Solid	Metal	0.06
1151	1958 Bldg	304	XRF	5/27/97	1	Room	115	Wall	Wall Rgstr	Solid	Metal	0.19
1152	1958 Bldg	305	XRF	5/27/97	1	Room	115	Ceiling	Hatch	Solid	Metal	0.18
1153	1958 Bldg	32	XRF	5/22/97	1	Room	116	Wall	Wall	Solid	Wood	0
1154	1958 Bldg	33	XRF	5/22/97	1	Room	116	Wall	Midle Wall	Solid	Concrte	0
1155	1958 Bldg	34	XRF	5/22/97	1	Room	116	Wall	Midle Wall	Solid	Concrte	0.13
1156	1958 Bldg	35	XRF	5/22/97	1	Room	116	Wall	Wall	Solid	Wood	0.01
1157	1958 Bldg	36	XRF	5/22/97	1	Room	116	Wall	Wall	Solid	Metal	0
1158	1958 Bldg	37	XRF	5/22/97	1	Room	116	TV	Bracket	Solid	Metal	0.03
1159	1958 Bldg	38	XRF	5/22/97	1	Room	116	Partitian		Solid	Metal	0.06
1160	1958 Bldg	39	XRF	5/22/97	1	Room	116	Wall	Wall Rgstr	Solid	Metal	0.12
1161	1958 Bldg	40	XRF	5/22/97	1	Room	116	Wall	Wall Rgstr	Solid	Metal	0.01
1162	1958 Bldg	41	XRF	5/22/97	1	Room	116	Wall	Wall Rgstr	Solid	Metal	0.01
1163	1958 Bldg	42	XRF	5/22/97	1	Room	116	Door	Door	Solid	Wood	0.01
1164	1958 Bldg	43	XRF	5/22/97	1	Room	116	Door	Casing	Solid	Metal	0.1
1165	1958 Bldg	44	XRF	5/22/97	1	Room	116	Crown mo	Solid	Wood	0.01	
1166	1958 Bldg	45	XRF	5/22/97	1	Room	116	Window	Mullion	Solid	Metal	0.11
1167	1958 Bldg	46	XRF	5/22/97	1	Room	116	Chalkboar	Rall	Solid	Wood	0.01
1168	1958 Bldg	47	XRF	5/22/97	1	Room	116	Ceiling		Solid	Plaster	0.02
1169	1958 Bldg	48	XRF	5/22/97	1	Room	116	Floor		Solid	Concrte	0.34
1170	1958 Bldg	89	XRF	4/26/97	1	Room	120	Wall	Midle Wall	Solid	Plaster	0.02
1171	1958 Bldg	90	XRF	4/26/97	1	Room	120	Wall	Wall	Solid	Plaster	0.08
1172	1958 Bldg	91	XRF	4/26/97	1	Room	120	Wall	Midle Wall	Solid	Plaster	0.02
1173	1958 Bldg	92	XRF	4/26/97	1	Room	120	Wall	Wall	Solid	Wood	0
1174	1958 Bldg	93	XRF	4/26/97	1	Room	120	Door	Door	Solid	Wood	0.02
1175	1958 Bldg	94	XRF	4/26/97	1	Room	120	Door	Jamb	Solid	Metal	0.07
1176	1958 Bldg	95	XRF	4/26/97	1	Room	120	Door	Radiator	Solid	Metal	0.02
1177	1958 Bldg	96	XRF	4/26/97	1	Room	120	Cabinet	Door	Solid	Wood	0.01
1178	1958 Bldg	98	XRF	4/26/97	1	Room	120	Cabinet	Shelf	Solid	Wood	0.02
1179	1958 Bldg	99	XRF	4/26/97	1	Room	120		Transom	Solid	Metal	0.01
1180	1958 Bldg	100	XRF	4/26/97	1	Room	120	Door	Mullion	Solid	Metal	0.01
1181	1958 Bldg	101	XRF	4/26/97	1	Room	120	TV	Mount	Solid	Wood	0
1182	1958 Bldg	102	XRF	4/26/97	1	Room	121	Wall	Midle Wall	Solid	Plaster	0.09
1183	1958 Bldg	103	XRF	4/26/97	1	Room	121	Wall	Wall	Solid	Plaster	0.01
1184	1958 Bldg	104	XRF	4/26/97	1	Room	121	Wall	Wall	Solid	Plaster	0.8
1185	1958 Bldg	105	XRF	4/26/97	1	Room	121	Wall	Wall	Solid	Plaster	0.78
1186	1958 Bldg	106	XRF	4/26/97	1	Room	121	Wall	Wall	Solid	Wood	0
1187	1958 Bldg	107	XRF	4/26/97	1	Room	121	Door	Door	Solid	Wood	0.02
1188	1958 Bldg	108	XRF	4/26/97	1	Room	121	Door	Jamb	Solid	Metal	0.06
1189	1958 Bldg	109	XRF	4/26/97	1	Room	121		Radiator	Solid	Metal	0
1190	1958 Bldg	110	XRF	4/26/97	1	Room	121	Cabinet	Door	Solid	Wood	0.02
1191	1958 Bldg	111	XRF	4/26/97	1	Room	121	Cabinet	Floor	Solid	Wood	0.01
1192	1958 Bldg	112	XRF	4/26/97	1	Room	121		Transom	Solid	Metal	0.01
1193	1958 Bldg	113	XRF	4/26/97	1	Room	121	Door	Mullion	Solid	Metal	0.01
1194	1958 Bldg	114	XRF	4/26/97	1	Room	121	TV	Mount	Solid	Wood	0
1195	1958 Bldg	116	XRF	4/26/97	1	Room	122	Wall	Midle Wall	Solid	Plaster	1.6
1196	1958 Bldg	117	XRF	4/26/97	1	Room	122	Wall	Wall	Solid	Plaster	2.11
1197	1958 Bldg	118	XRF	4/26/97	1	Room	122	Wall	Midle Wall	Solid	Plaster	0.11
1198	1958 Bldg	119	XRF	4/26/97	1	Room	122	Wall	Wall	Solid	Plaster	0.05

Saint Paul Public Schools
 Highland Park Junior High School
 Lead-Based Paint Inspection

A	B	C	D	E	F	G	H	I	J	K	L	
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Compon	Feature	Condition	Substrate	Result
1199	1958 Bldg	120	XRF	4/26/97	1	Room	122	Door	Door	Solid	Wood	0.02
1200	1958 Bldg	121	XRF	4/26/97	1	Room	122	Door	Jamb	Solid	Metal	0.04
1201	1958 Bldg	122	XRF	4/26/97	1	Room	122	Bookcase	Shelf	Solid	Wood	0.01
1202	1958 Bldg	123	XRF	4/26/97	1	Room	122	Bookcase	Inside	Solid	Wood	0.02
1203	1958 Bldg	124	XRF	4/26/97	1	Room	122	Wall	Wall Rgstr	Solid	Metal	1.34
1204	1958 Bldg	135	XRF	4/26/97	1	Room	122	Wall	Hatch	Solid	Metal	0.01
1205	1958 Bldg	186	XRF	4/26/97	1	Room	123	Wall	Midle Wall	Solid	Plaster	0.01
1206	1958 Bldg	187	XRF	4/26/97	1	Room	123	Wall	Wall	Solid	Plaster	0.02
1207	1958 Bldg	188	XRF	4/26/97	1	Room	123	Door	Door	Solid	Wood	0.03
1208	1958 Bldg	189	XRF	4/26/97	1	Room	123	Door	Jamb	Solid	Metal	0.07
1209	1958 Bldg	190	XRF	4/26/97	1	Room	123	Door	Door	Solid	Wood	0.02
1210	1958 Bldg	191	XRF	4/26/97	1	Room	123	Door	Jamb	Solid	Metal	0.24
1211	1958 Bldg	192	XRF	4/26/97	1	Room	123	Door	Jamb	Solid	Wood	0.01
1212	1958 Bldg	193	XRF	4/26/97	1	Room	123	Door	Jamb	Solid	Metal	0.03
1213	1958 Bldg	194	XRF	4/26/97	1	Room	123	Cabinet	Door	Solid	Wood	0
1214	1958 Bldg	195	XRF	4/26/97	1	Room	123	Cabinet	Floor	Solid	Wood	0
1215	1958 Bldg	196	XRF	4/26/97	1	Room	123	Cabinet	Door	Solid	Wood	0.02
1216	1958 Bldg	197	XRF	4/26/97	1	Room	123	Cabinet	Shelf	Solid	Wood	0.02
1217	1958 Bldg	6	XRF	5/28/97	1	Room	123	Wall	Wall	Solid	Plaster	0.01
1218	1958 Bldg	7	XRF	5/28/97	1	Room	123	Wall	Wall	Solid	Plaster	0.03
1219	1958 Bldg	8	XRF	5/28/97	1	Room	123	Wall	Wall	Solid	Plaster	0.01
1220	1958 Bldg	9	XRF	5/28/97	1	Room	123	Door	Door	Solid	Wood	0
1221	1958 Bldg	10	XRF	5/28/97	1	Room	123	Door	Casing	Solid	Metal	0.03
1222	1958 Bldg	11	XRF	5/28/97	1	Room	123					
1223	1958 Bldg	12	XRF	5/28/97	1	Room	123	Wall	Wall Rgstr	Solid	Metal	0.01
1224	1958 Bldg	13	XRF	5/28/97	1	Room	123	Wall	Wall Rgstr	Solid	Metal	0.01
1225	1958 Bldg	14	XRF	5/28/97	1	Room	123	Ceiling	Diffuser	Solid	Metal	0
1226	1958 Bldg	15	XRF	5/28/97	1	Room	123	Bulletin	Board	Solid	Wood	0.01
1227	1958 Bldg	16	XRF	5/28/97	1	Room	123	Ceiling		Solid	Plaster	0.01
1228	1958 Bldg	198	XRF	4/26/97	1	Room	124	Wall	Midle Wall	Solid	Plaster	0.16
1229	1958 Bldg	199	XRF	4/26/97	1	Room	124	Wall	Midle Wall	Solid	Concrte	0
1230	1958 Bldg	200	XRF	4/26/97	1	Room	124	Door	Door	Solid	Wood	0.01
1231	1958 Bldg	201	XRF	4/26/97	1	Room	124	Door	Jamb	Solid	Metal	0.03
1232	1958 Bldg	202	XRF	4/26/97	1	Room	124	Bookcase	Shelf	Solid	Wood	0.02
1233	1958 Bldg	212	XRF	4/26/97	1	Room	127	Wall	Midle Wall	Solid	Plaster	0.61
1234	1958 Bldg	213	XRF	4/26/97	1	Room	127	Wall	Wall	Solid	Plaster	0.59
1235	1958 Bldg	214	XRF	4/26/97	1	Room	127	Wall	Midle Wall	Solid	Plaster	0.01
1236	1958 Bldg	215	XRF	4/26/97	1	Room	127	Wall	Wall	Solid	Plaster	0.03
1237	1958 Bldg	216	XRF	4/26/97	1	Room	127	Wall	Wall	Solid	Wood	0.01
1238	1958 Bldg	217	XRF	4/26/97	1	Room	127	Door	Door	Solid	Wood	0.03
1239	1958 Bldg	218	XRF	4/26/97	1	Room	127	Door	Jamb	Solid	Metal	0.07
1240	1958 Bldg	219	XRF	4/26/97	1	Room	127		Radiator	Solid	Metal	0
1241	1958 Bldg	220	XRF	4/26/97	1	Room	127	Cabinet	Door	Solid	Wood	0.03
1242	1958 Bldg	221	XRF	4/26/97	1	Room	127		Transom	Solid	Metal	0
1243	1958 Bldg	222	XRF	4/26/97	1	Room	127	Window	Mullion	Solid	Metal	0.08
1244	1958 Bldg	100	XRF	5/7/97	1	Room	128	Wall	Midle Wall	Solid	Plaster	0.01
1245	1958 Bldg	101	XRF	5/7/97	1	Room	128	Wall	Wall	Solid	Plaster	0
1246	1958 Bldg	102	XRF	5/7/97	1	Room	128	Wall	Wall	Solid	Wood	0
1247	1958 Bldg	103	XRF	5/7/97	1	Room	128	Door	Door	Solid	Wood	0.03
1248	1958 Bldg	104	XRF	5/7/97	1	Room	128	Door	Jamb	Solid	Metal	0.11
1249	1958 Bldg	105	XRF	5/7/97	1	Room	128		Radiator	Solid	Metal	0
1250	1958 Bldg	106	XRF	5/7/97	1	Room	128	Cabinet	Door	Solid	Wood	0.01
1251	1958 Bldg	107	XRF	5/7/97	1	Room	128	Cabinet	Floor	Solid	Wood	0.02
1252	1958 Bldg	108	XRF	5/7/97	1	Room	128		Transom	Solid	Metal	0.01
1253	1958 Bldg	109	XRF	5/7/97	1	Room	128		Mullion	Solid	Metal	0.05
1254	1958 Bldg	109	XRF	4/24/97	2	Room	220	Wall	Midle Wall	Solid	Plaster	0.01
1255	1958 Bldg	110	XRF	4/24/97	2	Room	220	Wall	Wall	Solid	Plaster	0.01
1256	1958 Bldg	111	XRF	4/24/97	2	Room	220	Door	Door	Solid	Wood	0.02
1257	1958 Bldg	112	XRF	4/24/97	2	Room	220	Door	Jamb	Solid	Metal	0.17
1258	1958 Bldg	113	XRF	4/24/97	2	Room	220		Radiator	Solid	Metal	0.01
1259	1958 Bldg	114	XRF	4/24/97	2	Room	220	Cabinet	Door	Solid	Wood	0.01
1260	1958 Bldg	115	XRF	4/24/97	2	Room	220	Cabinet	Inside	Solid	Wood	0.03
1261	1958 Bldg	116	XRF	4/24/97	2	Room	220	Wall	Wall	Solid	Wood	0.01

Saint Paul Public Schools
 Highland Park Junior High School
 Lead-Based Paint Inspection

A	B	C	D	E	F	G	H	I	J	K	L	
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Componen	Feature	Condition	Substrate	Result
1262	1958 Bldg	117	XRF	4/24/97	2	Room	220		Transom	Solid	Metal	0
1263	1958 Bldg	118	XRF	4/24/97	2	Room	220	Door	Mullion	Solid	Metal	0.09
1264	1958 Bldg	119	XRF	4/24/97	2	Room	220	TV	Mount	Solid	Wood	0
1265	1958 Bldg	186	XRF	6/17/97	2	Room	220	Wall	Midle Wall	Solid	Concrete	0.01
1266	1958 Bldg	187	XRF	6/17/97	2	Room	220	Wall	Column	Solid	Concrete	0.03
1267	1958 Bldg	188	XRF	6/17/97	2	Room	220	Wall	Baseboar	Solid	Tile	1.34
1268	1958 Bldg	189	XRF	6/17/97	2	Room	220	Cabinet	Door	Solid	Wood	0.01
1269	1958 Bldg	190	XRF	6/17/97	2	Room	220	Bookcase	Shelf	Solid	Wood	0.01
1270	1958 Bldg	191	XRF	6/17/97	2	Room	220		Radiator	Solid	Metal	0.15
1271	1958 Bldg	192	XRF	6/17/97	2	Room	220	Ceiling		Solid	Plaster	0.02
1272	1958 Bldg	120	XRF	4/24/97	2	Room	221	Wall	Midle Wall	Solid	Plaster	0.02
1273	1958 Bldg	121	XRF	4/24/97	2	Room	221	Wall	Wall	Solid	Plaster	0.01
1274	1958 Bldg	122	XRF	4/24/97	2	Room	221	Wall	Wall	Solid	Wood	0
1275	1958 Bldg	123	XRF	4/24/97	2	Room	221		Radiator	Solid	Metal	0
1276	1958 Bldg	124	XRF	4/24/97	2	Room	221	Cabinet	Door	Solid	Wood	0.02
1277	1958 Bldg	125	XRF	4/24/97	2	Room	221	Cabinet	Shelf	Solid	Wood	0.02
1278	1958 Bldg	126	XRF	4/24/97	2	Room	221		Transom	Solid	Metal	0
1279	1958 Bldg	127	XRF	4/24/97	2	Room	221	Door	Mullion	Solid	Metal	0.1
1280	1958 Bldg	128	XRF	4/24/97	2	Room	221	TV	Mount	Solid	Wood	0
1281	1958 Bldg	129	XRF	4/24/97	2	Room	222	Wall	Midle Wall	Solid	Plaster	0.02
1282	1958 Bldg	130	XRF	4/24/97	2	Room	222	Wall	Wall	Solid	Plaster	0.01
1283	1958 Bldg	131	XRF	4/24/97	2	Room	222	Wall	Wall	Solid	Wood	0.01
1284	1958 Bldg	132	XRF	4/24/97	2	Room	222	Door	Door	Solid	Wood	0.02
1285	1958 Bldg	133	XRF	4/24/97	2	Room	222	Door	Jamb	Solid	Metal	0.18
1286	1958 Bldg	134	XRF	4/24/97	2	Room	222		Radiator	Solid	Metal	0
1287	1958 Bldg	135	XRF	4/24/97	2	Room	222	Cabinet	Door	Solid	Wood	0.01
1288	1958 Bldg	136	XRF	4/24/97	2	Room	222	Cabinet	Shelf	Solid	Wood	0.02
1289	1958 Bldg	137	XRF	4/24/97	2	Room	222		Transom	Solid	Metal	0.01
1290	1958 Bldg	138	XRF	4/24/97	2	Room	222	Door	Mullion	Solid	Metal	0.08
1291	1958 Bldg	139	XRF	4/24/97	2	Room	222	TV	Mount	Solid	Wood	0
1292	1958 Bldg	140	XRF	4/24/97	2	Room	223	Wall	Midle Wall	Solid	Plaster	0
1293	1958 Bldg	141	XRF	4/24/97	2	Room	223	Wall	Wall	Solid	Plaster	0.01
1294	1958 Bldg	142	XRF	4/24/97	2	Room	223	Wall	Midle Wall	Solid	Drywall	0.01
1295	1958 Bldg	143	XRF	4/24/97	2	Room	223	Wall	Wall	Solid	Drywall	0
1296	1958 Bldg	144	XRF	4/24/97	2	Room	223	Wall	Wall	Solid	Wood	0.02
1297	1958 Bldg	145	XRF	4/24/97	2	Room	223	Door	Door	Solid	Wood	0.02
1298	1958 Bldg	146	XRF	4/24/97	2	Room	223	Door	Jamb	Solid	Metal	0.26
1299	1958 Bldg	147	XRF	4/24/97	2	Room	223	Door	Door	Solid	Wood	0.01
1300	1958 Bldg	148	XRF	4/24/97	2	Room	223	Door	Jamb	Solid	Metal	0.01
1301	1958 Bldg	149	XRF	4/24/97	2	Room	223		Radiator	Solid	Metal	0
1302	1958 Bldg	150	XRF	4/24/97	2	Room	223	Door	Mullion	Solid	Metal	0.09
1303	1958 Bldg	152	XRF	4/24/97	2	Room	224	Wall	Midle Wall	Solid	Plaster	0.56
1304	1958 Bldg	153	XRF	4/24/97	2	Room	224	Wall	Midle Wall	Solid	Drywall	0
1305	1958 Bldg	154	XRF	4/24/97	2	Room	224	Wall	Wall	Solid	Drywall	0.02
1306	1958 Bldg	155	XRF	4/24/97	2	Room	224	Door	Door	Solid	Wood	0.03
1307	1958 Bldg	156	XRF	4/24/97	2	Room	224	Door	Jamb	Solid	Metal	0.03
1308	1958 Bldg	157	XRF	4/24/97	2	Room	224		Radiator	Solid	Metal	0.01
1309	1958 Bldg	158	XRF	4/24/97	2	Room	224	Cabinet	Door	Solid	Wood	0.02
1310	1958 Bldg	159	XRF	4/24/97	2	Room	224	Cabinet	Door	Solid	Wood	0
1311	1958 Bldg	160	XRF	4/24/97	2	Room	225	Wall	Midle Wall	Solid	Plaster	0
1312	1958 Bldg	161	XRF	4/24/97	2	Room	225	Wall	Midle Wall	Solid	Drywall	0
1313	1958 Bldg	162	XRF	4/24/97	2	Room	225	Wall	Wall	Solid	Wood	0.01
1314	1958 Bldg	163	XRF	4/24/97	2	Room	225	Door	Door	Solid	Wood	0
1315	1958 Bldg	164	XRF	4/24/97	2	Room	225	Door	Jamb	Solid	Metal	0.22
1316	1958 Bldg	165	XRF	4/24/97	2	Room	225		Radiator	Solid	Metal	0
1317	1958 Bldg	166	XRF	4/24/97	2	Room	225	Door	Mullion	Solid	Metal	0.1
1318	1958 Bldg	167	XRF	4/24/97	2	Room	226	Wall	Midle Wall	Solid	Plaster	0.06
1319	1958 Bldg	168	XRF	4/24/97	2	Room	226	Wall	Wall	Solid	Plaster	0.71
1320	1958 Bldg	169	XRF	4/24/97	2	Room	226	Wall	Midle Wall	Solid	Plaster	1.12
1321	1958 Bldg	170	XRF	4/24/97	2	Room	226	Door	Door	Solid	Wood	0.04
1322	1958 Bldg	171	XRF	4/24/97	2	Room	226	Door	Jamb	Solid	Metal	0.18
1323	1958 Bldg	172	XRF	4/24/97	2	Room	226		Radiator	Solid	Metal	0
1324	1958 Bldg	173	XRF	4/24/97	2	Room	226	Cabinet	Door	Solid	Wood	0.02

Saint Paul Public Schools
 Highland Park Junior High School
 Lead-Based Paint Inspection

A	B	C	D	E	F	G	H	I	J	K	L	
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Compono	Feature	Condition	Substrate	Result
1325	1958 Bldg	174	XRF	4/24/97	2	Room	226	Cabinet	Shelf	Solid	Wood	0.02
1326	1958 Bldg	175	XRF	4/24/97	2	Room	226		Transom	Solid	Metal	0.01
1327	1958 Bldg	176	XRF	4/24/97	2	Room	226	Door	Mullion	Solid	Metal	0.1
1328	1958 Bldg	177	XRF	4/24/97	2	Room	226	TV	Mount	Solid	Wood	0
1329	1958 Bldg	178	XRF	4/24/97	2	Room	227	Wall	Midle Wall	Solid	Plaster	0.52
1330	1958 Bldg	179	XRF	4/24/97	2	Room	227	Wall	Midle Wall	Solid	Plaster	0
1331	1958 Bldg	180	XRF	4/24/97	2	Room	227	Wall	Wall	Solid	Plaster	0
1332	1958 Bldg	181	XRF	4/24/97	2	Room	227	Door	Door	Solid	Wood	0.03
1333	1958 Bldg	182	XRF	4/24/97	2	Room	227	Door	Jamb	Solid	Metal	0.11
1334	1958 Bldg	183	XRF	4/24/97	2	Room	227		Column	Solid	Plaster	0.01
1335	1958 Bldg	184	XRF	4/24/97	2	Room	227	Cabinet	Door	Solid	Wood	0.02
1336	1958 Bldg	185	XRF	4/24/97	2	Room	227	Wall	Wall	Solid	Wood	0
1337	1958 Bldg	186	XRF	4/24/97	2	Room	227		Transom	Solid	Metal	0
1338	1958 Bldg	187	XRF	4/24/97	2	Room	227	Door	Mullion	Solid	Metal	0.09
1339	1958 Bldg	6	XRF	4/26/97	2	Room	228	Wall	Midle Wall	Solid	Plaster	0.02
1340	1958 Bldg	7	XRF	4/26/97	2	Room	228	Wall	Wall	Solid	Plaster	0.03
1341	1958 Bldg	8	XRF	4/26/97	2	Room	228	Wall	Midle Wall	Solid	Plaster	0.01
1342	1958 Bldg	9	XRF	4/26/97	2	Room	228	Wall	Wall	Solid	Wood	0.01
1343	1958 Bldg	10	XRF	4/26/97	2	Room	228	Door	Door	Solid	Wood	0.03
1344	1958 Bldg	11	XRF	4/26/97	2	Room	228	Door	Jamb	Solid	Metal	0.19
1345	1958 Bldg	12	XRF	4/26/97	2	Room	228		Radiator	Solid	Metal	0
1346	1958 Bldg	13	XRF	4/26/97	2	Room	228	Cabinet	Door	Solid	Wood	0.02
1347	1958 Bldg	14	XRF	4/26/97	2	Room	228	Cabinet	Shelf	Solid	Wood	0.01
1348	1958 Bldg	15	XRF	4/26/97	2	Room	228		Transom	Solid	Metal	0
1349	1958 Bldg	16	XRF	4/26/97	2	Room	228	Door	Mullion	Solid	Metal	0.1
1350	1958 Bldg	17	XRF	4/26/97	2	Room	228	TV	Mount	Solid	Wood	0
1351	1958 Bldg	18	XRF	4/26/97	2	Room	228	Cork	Board	Solid	Wood	1.4
1352	1958 Bldg	224	XRF	6/2/97	2	Room	233	Wall	Midle Wall	Solid	Concrete	1.92
1353	1958 Bldg	225	XRF	6/2/97	2	Room	233	Wall	Midle Wall	Solid	Concrete	0.05
1354	1958 Bldg	226	XRF	6/2/97	2	Room	233	Wall	Baseboar	Solid	Tile	1.61
1355	1958 Bldg	227	XRF	6/2/97	2	Room	233	Wall	Wall	Solid	Wood	0.07
1356	1958 Bldg	228	XRF	6/2/97	2	Room	233	Door	Door	Solid	Wood	0.01
1357	1958 Bldg	229	XRF	6/2/97	2	Room	233	Door	Casing	Solid	Metal	0.01
1358	1958 Bldg	230	XRF	6/2/97	2	Room	233	Window	Panel	Solid	Wood	0.04
1359	1958 Bldg	231	XRF	6/2/97	2	Room	233		Radiator	Solid	Metal	0.02
1360	1958 Bldg	232	XRF	6/2/97	2	Room	233		Column	Solid	Metal	5.09
1361	1958 Bldg	233	XRF	6/2/97	2	Room	233	Wall	Wall Rgstr	Solid	Metal	0.01
1362	1958 Bldg	177	XRF	6/17/97	2	Room	250	Wall	Midle Wall	Solid	Concrete	0.04
1363	1958 Bldg	178	XRF	6/17/97	2	Room	250	Door	Door	Solid	Wood	0
1364	1958 Bldg	136	XRF	4/16/97	3	Room	321	Wall	Midle Wall	Solid	Plaster	0.01
1365	1958 Bldg	137	XRF	4/16/97	3	Room	321	Wall	Wall	Solid	Plaster	0.02
1366	1958 Bldg	138	XRF	4/16/97	3	Room	321	Door	Door	Solid	Wood	0.03
1367	1958 Bldg	139	XRF	4/16/97	3	Room	321	Door	Jamb	Solid	Metal	0.13
1368	1958 Bldg	140	XRF	4/16/97	3	Room	321		Radiator	Solid	Metal	0.01
1369	1958 Bldg	141	XRF	4/16/97	3	Room	321		Transit	Tube	Metal	0.01
1370	1958 Bldg	142	XRF	4/16/97	3	Room	321	Wall	Midle Wall	Solid	Wood	0.01
1371	1958 Bldg	143	XRF	4/16/97	3	Room	321	Cabinet	Door	Solid	Wood	0.03
1372	1958 Bldg	144	XRF	4/16/97	3	Room	321	Cabnet	Inside	Solid	Wood	0.02
1373	1958 Bldg	145	XRF	4/16/97	3	Room	321	Wall	Diffuser	Solid	Metal	0
1374	1958 Bldg	146	XRF	4/16/97	3	Room	321	Wall	Wall	Solid	Wood	0
1375	1958 Bldg	156	XRF	4/16/97	3	Room	321	Wall	Midle Wall	Solid	Plaster	0.01
1376	1958 Bldg	157	XRF	4/16/97	3	Room	321	Wall	Wall	Solid	Plaster	0.03
1377	1958 Bldg	158	XRF	4/16/97	3	Room	321	Wall	Wall	Solid	Wood	0.01
1378	1958 Bldg	159	XRF	4/16/97	3	Room	321	Door	Door	Solid	Wood	0.03
1379	1958 Bldg	160	XRF	4/16/97	3	Room	321		Radiator	Solid	Metal	0
1380	1958 Bldg	161	XRF	4/16/97	3	Room	321	Cabinet	Door	Solid	Wood	0.01
1381	1958 Bldg	162	XRF	4/16/97	3	Room	321	Wall	Diffuser	Solid	Metal	0
1382	1958 Bldg	163	XRF	4/16/97	3	Room	321		Transom	Solid	Glass	0
1383	1958 Bldg	164	XRF	4/16/97	3	Room	322	Wall	Midle Wall	Solid	Plaster	0.01
1384	1958 Bldg	165	XRF	4/16/97	3	Room	322	Wall	Wall	Solid	Plaster	0.01
1385	1958 Bldg	166	XRF	4/16/97	3	Room	322	Wall	Wall	Solid	Plaster	0.01
1386	1958 Bldg	167	XRF	4/16/97	3	Room	322	Door	Door	Solid	Wood	0.05
1387	1958 Bldg	168	XRF	4/16/97	3	Room	322	Door	Jamb	Solid	Metal	0.21

Saint Paul Public Schools
 Highland Park Junior High School
 Lead-Based Paint Inspection

A	B	C	D	E	F	G	H	I	J	K	L	
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Componen	Feature	Condition	Substrate	Result
1388	1958 Bldg	169	XRF	4/16/97	3	Room	322		Radiator	Solid	Metal	0
1389	1958 Bldg	170	XRF	4/16/97	3	Room	322	Wall	Wall	Solid	Metal	0.02
1390	1958 Bldg	171	XRF	4/16/97	3	Room	322	Cabinet	Door	Solid	Wood	0.01
1391	1958 Bldg	172	XRF	4/16/97	3	Room	323		Column	Solid	Plaster	0.02
1392	1958 Bldg	173	XRF	4/16/97	3	Room	323	Wall	Wall	Solid	Plaster	0.01
1393	1958 Bldg	174	XRF	4/16/97	3	Room	323	Wall	Wall	Solid	Wood	0
1394	1958 Bldg	175	XRF	4/16/97	3	Room	323	Door	Door	Solid	Wood	0.01
1395	1958 Bldg	176	XRF	4/16/97	3	Room	323	Door	Jamb	Solid	Metal	0.03
1396	1958 Bldg	177	XRF	4/16/97	3	Room	323	Wall	Midle Wall	Solid	Drywall	0.01
1397	1958 Bldg	178	XRF	4/16/97	3	Room	323		Radiator	Solid	Metal	0.01
1398	1958 Bldg	179	XRF	4/16/97	3	Room	323	Cabinet	Door	Solid	Wood	0
1399	1958 Bldg	180	XRF	4/16/97	3	Room	323	Cabinet	Door	Solid	Wood	0.03
1400	1958 Bldg	6	XRF	4/24/97	3	Room	324	Wall	Midle Wall	Solid	Drywall	0
1401	1958 Bldg	7	XRF	4/24/97	3	Room	324	Wall	Midle Wall	Solid	Plaster	0.05
1402	1958 Bldg	8	XRF	4/24/97	3	Room	324	Wall	Wall	Solid	Wood	0
1403	1958 Bldg	9	XRF	4/24/97	3	Room	324	Door	Door	Solid	Wood	0.01
1404	1958 Bldg	10	XRF	4/24/97	3	Room	324	Door	Jamb	Solid	Metal	0.16
1405	1958 Bldg	11	XRF	4/24/97	3	Room	324	Door	Jamb	Solid	Metal	0.01
1406	1958 Bldg	12	XRF	4/24/97	3	Room	324		Radiator	Solid	Metal	0.02
1407	1958 Bldg	13	XRF	4/24/97	3	Room	324	Bookcase	Shelf	Solid	Wood	0.03
1408	1958 Bldg	14	XRF	4/24/97	3	Room	324	Cabinet	Door	Solid	Wood	0.02
1409	1958 Bldg	15	XRF	4/24/97	3	Room	324	TV	Mount	Solid	Wood	0
1410	1958 Bldg	16	XRF	4/24/97	3	Room	324	Cabinet	Door	Solid	Wood	0.1
1411	1958 Bldg	17	XRF	4/24/97	3	Room	324	Fume	Hood	Solid	Metal	0
1412	1958 Bldg	18	XRF	4/24/97	3	Room	326	Wall	Midle Wall	Solid	Plaster	0.01
1413	1958 Bldg	19	XRF	4/24/97	3	Room	326		Column	Solid	Plaster	0.02
1414	1958 Bldg	20	XRF	4/24/97	3	Room	326	Door	Door	Solid	Wood	0.04
1415	1958 Bldg	21	XRF	4/24/97	3	Room	326	Door	Jamb	Solid	Metal	0.15
1416	1958 Bldg	22	XRF	4/24/97	3	Room	326	Wall	Wall	Solid	Wood	0.31
1417	1958 Bldg	23	XRF	4/24/97	3	Room	326		Radiator	Solid	Metal	0
1418	1958 Bldg	24	XRF	4/24/97	3	Room	326	Cabinet	Door	Solid	Wood	0.02
1419	1958 Bldg	25	XRF	4/24/97	3	Room	326	Cabinet	Door	Solid	Wood	0.01
1420	1958 Bldg	26	XRF	4/24/97	3	Room	326	Bookcase	Shelf	Solid	Wood	0.02
1421	1958 Bldg	27	XRF	4/24/97	3	Room	326	TV	Mount	Solid	Wood	0
1422	1958 Bldg	28	XRF	4/24/97	3	Room	326	Door	Mullion	Solid	Metal	0.1
1423	1958 Bldg	29	XRF	4/24/97	3	Room	327	Wall	Midle Wall	Solid	Plaster	0.01
1424	1958 Bldg	30	XRF	4/24/97	3	Room	327		Column	Solid	Plaster	0.02
1425	1958 Bldg	31	XRF	4/24/97	3	Room	327	Wall	Wall	Solid	Wood	0.4
1426	1958 Bldg	32	XRF	4/24/97	3	Room	327	Door	Door	Solid	Wood	0.03
1427	1958 Bldg	33	XRF	4/24/97	3	Room	327	Door	Jamb	Solid	Metal	0.22
1428	1958 Bldg	34	XRF	4/24/97	3	Room	327		Radiator	Solid	Metal	0.01
1429	1958 Bldg	35	XRF	4/24/97	3	Room	327	Cabinet	Floor	Solid	Wood	0.02
1430	1958 Bldg	36	XRF	4/24/97	3	Room	327	Cabinet	Door	Solid	Wood	0.01
1431	1958 Bldg	37	XRF	4/24/97	3	Room	327	Bookcase	Shelf	Solid	Wood	0.02
1432	1958 Bldg	38	XRF	4/24/97	3	Room	327	Shelf	Bracket	Solid	Metal	0.06
1433	1958 Bldg	39	XRF	4/24/97	3	Room	327	Door	Mullion	Solid	Metal	0.08
1434	1958 Bldg	40	XRF	4/24/97	3	Room	327	TV	Mount	Solid	Wood	0
1435	1958 Bldg	41	XRF	4/24/97	3	Room	328	Wall	Midle Wall	Solid	Plaster	0.02
1436	1958 Bldg	42	XRF	4/24/97	3	Room	328		Column	Solid	Plaster	0.02
1437	1958 Bldg	43	XRF	4/24/97	3	Room	328	Wall	Wall	Solid	Wood	1.04
1438	1958 Bldg	44	XRF	4/24/97	3	Room	328	Door	Door	Solid	Wood	0.03
1439	1958 Bldg	45	XRF	4/24/97	3	Room	328	Door	Jamb	Solid	Metal	0.16
1440	1958 Bldg	46	XRF	4/24/97	3	Room	328		Radiator	Solid	Metal	0.01
1441	1958 Bldg	47	XRF	4/24/97	3	Room	328	Cabinet	Door	Solid	Wood	0.02
1442	1958 Bldg	48	XRF	4/24/97	3	Room	328	Bookcase	Shelf	Solid	Wood	0.02
1443	1958 Bldg	49	XRF	4/24/97	3	Room	328	Door	Mullion	Solid	Metal	0.05
1444	1958 Bldg	50	XRF	4/24/97	3	Room	328		Transom	Solid	Metal	0.01
1445	1958 Bldg	51	XRF	4/24/97	3	Room	328	TV	Mount	Solid	Wood	0
1446	1958 Bldg	73	XRF	4/24/97	3	Room	329	Wall	Midle Wall	Solid	Plaster	0.02
1447	1958 Bldg	74	XRF	4/24/97	3	Room	329	Door	Door	Solid	Wood	0.02
1448	1958 Bldg	75	XRF	4/24/97	3	Room	329	Door	Jamb	Solid	Metal	0.13
1449	1958 Bldg	76	XRF	4/24/97	3	Room	329		Radiator	Solid	Metal	0.01
1450	1958 Bldg	77	XRF	4/24/97	3	Room	329	Cabinet	Door	Solid	Wood	0.03

Saint Paul Public Schools
 Highland Park Junior High School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Compon	Feature	Condition	Substrate	Result
1451	1958 Bldg	78	XRF	4/24/97	3	Room	329	Cabinet	Floor	Solid	Wood	0.03
1452	1958 Bldg	79	XRF	4/24/97	3	Room	329	Wall	Wall Rgstr	Solid	Metal	0.03
1453	1958 Bldg	80	XRF	4/24/97	3	Room	330	Wall	Midle Wall	Solid	Plaster	0.03
1454	1958 Bldg	81	XRF	4/24/97	3	Room	330	Door	Door	Solid	Wood	0.02
1455	1958 Bldg	82	XRF	4/24/97	3	Room	330	Door	Jamb	Solid	Metal	0.15
1456	1958 Bldg	83	XRF	4/24/97	3	Room	330		Radiator	Solid	Metal	0.01
1457	1958 Bldg	84	XRF	4/24/97	3	Room	330	Cabinet	Door	Solid	Wood	0.04
1458	1958 Bldg	85	XRF	4/24/97	3	Room	330	Cabinet	Outside	Solid	Wood	0.06
1459	1958 Bldg	86	XRF	4/24/97	3	Room	330	Wall	Wall Rgstr	Solid	Metal	0.04
1460	1958 Bldg	201	XRF	6/17/97	4	Room	400	Door	Door	Solid	Metal	0.33
1461	1958 Bldg	202	XRF	6/17/97	4	Room	400	Door	Casing	Solid	Metal	0.26
1462	1958 Bldg	203	XRF	6/17/97	4	Room	400	Stairs	Hand rail	Solid	Metal	0.21
1463	1958 Bldg	198	XRF	6/17/97	4	Room	401	Door	Door	Solid	Metal	0.23
1464	1958 Bldg	199	XRF	6/17/97	4	Room	401	Door	Casing	Solid	Metal	0.08
1465	1958 Bldg	200	XRF	6/17/97	4	Room	401	Stairs	Hand rail	Solid	Metal	0.24
1466	1958 Bldg	24	XRF	5/28/97	1	Room	102A	Wall	Wall	Solid	Plaster	0.01
1467	1958 Bldg	25	XRF	5/28/97	1	Room	102A	Wall	Wall	Solid	Plaster	0.03
1468	1958 Bldg	26	XRF	5/28/97	1	Room	102A	Bookcase	Shelf	Solid	Wood	0.02
1469	1958 Bldg	27	XRF	5/28/97	1	Room	102A	Door	Door	Solid	Wood	0.02
1470	1958 Bldg	28	XRF	5/28/97	1	Room	102A	Door	Casing	Solid	Metal	0.11
1471	1958 Bldg	29	XRF	5/28/97	1	Room	102A	Ceiling	Hatch	Solid	Metal	0.03
1472	1958 Bldg	30	XRF	5/28/97	1	Room	102A	Wall	Wall	Solid	Plaster	0.01
1473	1958 Bldg	31	XRF	5/28/97	1	Room	102A	Wall	Wall	Solid	Plaster	0.01
1474	1958 Bldg	32	XRF	5/28/97	1	Room	102A	Wall	Midle Wall	Solid	Wood	0
1475	1958 Bldg	33	XRF	5/28/97	1	Room	102A	Door	Door	Solid	Wood	0.02
1476	1958 Bldg	34	XRF	5/28/97	1	Room	102A	Door	Casing	Solid	Metal	0.05
1477	1958 Bldg	35	XRF	5/28/97	1	Room	102A	Wall	Box	Solid	Metal	0.07
1478	1958 Bldg	36	XRF	5/28/97	1	Room	102A	Wall	Wall Rgstr	Solid	Metal	0.01
1479	1958 Bldg	37	XRF	5/28/97	1	Room	102A	Wall	Wall Rgstr	Solid	Metal	0.02
1480	1958 Bldg	38	XRF	5/28/97	1	Room	102A	Ceiling	Plate	Solid	Metal	0.03
1481	1958 Bldg	39	XRF	5/28/97	1	Room	102C	Wall	Wall	Solid	Plaster	0.03
1482	1958 Bldg	40	XRF	5/28/97	1	Room	102C	Wall	Wall	Solid	Plaster	0
1483	1958 Bldg	41	XRF	5/28/97	1	Room	102C	Wall	Midle Wall	Solid	Metal	0.02
1484	1958 Bldg	42	XRF	5/28/97	1	Room	102C	Door	Door	Solid	Wood	0.01
1485	1958 Bldg	43	XRF	5/28/97	1	Room	102C	Door	Casing	Solid	Metal	0.1
1486	1958 Bldg	44	XRF	5/28/97	1	Room	102C	Wall	Box	Solid	Metal	0.12
1487	1958 Bldg	45	XRF	5/28/97	1	Room	102C	Wall	Wall Rgstr	Solid	Metal	0.01
1488	1958 Bldg	46	XRF	5/28/97	1	Room	102C	Wall	Wall Rgstr	Solid	Metal	0.01
1489	1958 Bldg	47	XRF	5/28/97	1	Room	102C	Ceiling	Plate	Solid	Metal	0.02
1490	1958 Bldg	48	XRF	5/28/97	1	Room	102D	Wall	Wall	Solid	Plaster	0.01
1491	1958 Bldg	49	XRF	5/28/97	1	Room	102D	Wall	Wall	Solid	Plaster	0.03
1492	1958 Bldg	50	XRF	5/28/97	1	Room	102D	Door	Midle Wall	Solid	Metal	0.02
1493	1958 Bldg	51	XRF	5/28/97	1	Room	102D	Door	Door	Solid	Wood	0.01
1494	1958 Bldg	52	XRF	5/28/97	1	Room	102D	Door	Casing	Solid	Metal	0.08
1495	1958 Bldg	53	XRF	5/28/97	1	Room	102D	Ceiling	Hatch	Solid	Metal	0.03
1496	1958 Bldg	54	XRF	5/28/97	1	Room	102D	Ceiling	Plate	Solid	Metal	0.02
1497	1958 Bldg	403	XRF	5/27/97	1	Room	103D	Wall	Midle Wall	Solid	Metal	0
1498	1958 Bldg	404	XRF	5/27/97	1	Room	103D	Wall	Wall	Solid	Wood	0.01
1499	1958 Bldg	405	XRF	5/27/97	1	Room	103D	Door	Door	Solid	Wood	0.01
1500	1958 Bldg	406	XRF	5/27/97	1	Room	103D	Door	Casing	Solid	Metal	0.09
1501	1958 Bldg	407	XRF	5/27/97	1	Room	103D	Chalkboar	Rail	Solid	Wood	0
1502	1958 Bldg	408	XRF	5/27/97	1	Room	103D	Cabinet	Door	Solid	Wood	0.01
1503	1958 Bldg	409	XRF	5/27/97	1	Room	103D	Bookcase	Shelf	Solid	Wood	0.02
1504	1958 Bldg	410	XRF	5/27/97	1	Room	103D	Wall	Wall Rgstr	Solid	Metal	0
1505	1958 Bldg	411	XRF	5/27/97	1	Room	103D	Wall	Wall Rgstr	Solid	Metal	0
1506	1958 Bldg	412	XRF	5/27/97	1	Room	103D	Baseboar	Solid	Metal	0.01	
1507	1958 Bldg	185	XRF	5/23/97	1	Room	105A	Wall	Wall	Solid	Plaster	0.01
1508	1958 Bldg	186	XRF	5/23/97	1	Room	105A	Wall	Wall	Solid	Plaster	0.03
1509	1958 Bldg	187	XRF	5/23/97	1	Room	105A	Wall	Midle Wall	Solid	Plaster	0.04
1510	1958 Bldg	188	XRF	5/23/97	1	Room	105A	Wall	Wall	Solid	Plaster	0.01
1511	1958 Bldg	189	XRF	5/23/97	1	Room	105A	Door	Door	Solid	Wood	0.01
1512	1958 Bldg	190	XRF	5/23/97	1	Room	105A	Door	Casing	Solid	Metal	0.05
1513	1958 Bldg	191	XRF	5/23/97	1	Room	105A	Door	Vent	Solid	Metal	0.04

Saint Paul Public Schools
 Highland Park Junior High School
 Lead-Based Paint Inspection

A	B	C	D	E	F	G	H	I	J	K	L	
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Compono	Feature	Condition	Substrate	Result
1514	1958 Bldg	192	XRF	5/23/97	1	Room	105A	Door	Door	Solid	Wood	0
1515	1958 Bldg	193	XRF	5/23/97	1	Room	105A	Door	Casing	Solid	Wood	0.01
1516	1958 Bldg	194	XRF	5/23/97	1	Room	105A	Bookcase	Inside	Solid	Wood	0.01
1517	1958 Bldg	195	XRF	5/23/97	1	Room	105A	Ceiling	Diffuser	Solid	Metal	0.02
1518	1958 Bldg	196	XRF	5/23/97	1	Room	105A	Ceiling		Cracked	Plaster	0.03
1519	1958 Bldg	197	XRF	5/23/97	1	Room	105B	Wall	Wall	Cracked	Plaster	0.02
1520	1958 Bldg	198	XRF	5/23/97	1	Room	105B	Wall	Wall	Cracked	Plaster	0.03
1521	1958 Bldg	199	XRF	5/23/97	1	Room	105B	Wall	Midle Wall	Cracked	Plaster	0.03
1522	1958 Bldg	200	XRF	5/23/97	1	Room	105B	Door	Door	Cracked	Wood	0.02
1523	1958 Bldg	201	XRF	5/23/97	1	Room	105B	Door	Casing	Solid	Metal	0.09
1524	1958 Bldg	202	XRF	5/23/97	1	Room	105B	Bookcase	Inside	Solid	Wood	0.01
1525	1958 Bldg	203	XRF	5/23/97	1	Room	105B	Cabinet	Door	Solid	Wood	0.02
1526	1958 Bldg	204	XRF	5/23/97	1	Room	105B	Door	Vent	Solid	Metal	0.04
1527	1958 Bldg	205	XRF	5/23/97	1	Room	105B	Ceiling	Diffuser	Solid	Metal	0.01
1528	1958 Bldg	206	XRF	5/23/97	1	Room	105B	Ceiling		Cracked	Plaster	0.01
1529	1958 Bldg	220	XRF	5/23/97	1	Room	106A	Wall	Wall	Solid	Plaster	0.02
1530	1958 Bldg	221	XRF	5/23/97	1	Room	106A	Wall	Wall	Solid	Plaster	0.01
1531	1958 Bldg	222	XRF	5/23/97	1	Room	106A	Door	Door	Solid	Wood	0.01
1532	1958 Bldg	223	XRF	5/23/97	1	Room	106A	Door	Casing	Solid	Metal	0.08
1533	1958 Bldg	224	XRF	5/23/97	1	Room	106A	Bookcase	Shelf	Solid	Wood	0.02
1534	1958 Bldg	225	XRF	5/23/97	1	Room	106A	Cabinet	Door	Solid	Wood	0
1535	1958 Bldg	226	XRF	5/23/97	1	Room	106A	Door	Vent	Solid	Metal	0.03
1536	1958 Bldg	227	XRF	5/23/97	1	Room	106A	Ceiling	Diffuser	Solid	Metal	0.01
1537	1958 Bldg	228	XRF	5/23/97	1	Room	106A	Ceiling		Solid	Plaster	0.01
1538	1958 Bldg	256	XRF	5/23/97	1	Room	106B	Wall	Wall	Solid	Plaster	0.01
1539	1958 Bldg	257	XRF	5/23/97	1	Room	106B	Wall	Wall	Solid	Plaster	0.02
1540	1958 Bldg	258	XRF	5/23/97	1	Room	106B	Door	Door	Solid	Wood	0.02
1541	1958 Bldg	259	XRF	5/23/97	1	Room	106B	Door	Casing	Solid	Metal	0.08
1542	1958 Bldg	260	XRF	5/23/97	1	Room	106B	Door	Vent	Solid	Metal	0.04
1543	1958 Bldg	261	XRF	5/23/97	1	Room	106B	Bookcase	Shelf	Solid	Wood	0.02
1544	1958 Bldg	262	XRF	5/23/97	1	Room	106B	Ceiling	Diffuser	Solid	Metal	0.01
1545	1958 Bldg	263	XRF	5/23/97	1	Room	106B	Ceiling		Solid	Plaster	0.01
1546	1958 Bldg	155	XRF	5/23/97	1	Room	107A	Wall	Wall	Solid	Plaster	0.01
1547	1958 Bldg	156	XRF	5/23/97	1	Room	107A	Wall	Wall	Solid	Plaster	0.02
1548	1958 Bldg	157	XRF	5/23/97	1	Room	107A	Door	Door	Solid	Wood	0.02
1549	1958 Bldg	158	XRF	5/23/97	1	Room	107A	Door	Casing	Solid	Metal	0.04
1550	1958 Bldg	159	XRF	5/23/97	1	Room	107A	Bookcase	Inside	Solid	Wood	0.01
1551	1958 Bldg	160	XRF	5/23/97	1	Room	107A	Bookcase	Shelf	Solid	Wood	0
1552	1958 Bldg	161	XRF	5/23/97	1	Room	107A	Bookcase	Shelf	Solid	Wood	0.01
1553	1958 Bldg	162	XRF	5/23/97	1	Room	107A	Bookcase	Inside	Solid	Wood	0
1554	1958 Bldg	163	XRF	5/23/97	1	Room	107A	Ceiling	Diffuser	Solid	Metal	0.05
1555	1958 Bldg	164	XRF	5/23/97	1	Room	107A	Ceiling		Solid	Plaster	0.01
1556	1958 Bldg	165	XRF	5/23/97	1	Room	107B	Wall	Wall	Solid	Plaster	0.04
1557	1958 Bldg	166	XRF	5/23/97	1	Room	107B	Wall	Wall	Solid	Plaster	0.03
1558	1958 Bldg	167	XRF	5/23/97	1	Room	107B	Door	Door	Solid	Wood	0.02
1559	1958 Bldg	168	XRF	5/23/97	1	Room	107B	Door	Casing	Solid	Metal	0.05
1560	1958 Bldg	169	XRF	5/23/97	1	Room	107B	Cabinet	Door	Solid	Wood	0.01
1561	1958 Bldg	170	XRF	5/23/97	1	Room	107B	Bookcase	Shelf	Solid	Wood	0.01
1562	1958 Bldg	171	XRF	5/23/97	1	Room	107B	Ceiling	Diffuser	Solid	Metal	0.02
1563	1958 Bldg	172	XRF	5/23/97	1	Room	107B	Ceiling		Solid	Plaster	0.01
1564	1958 Bldg	114	XRF	5/22/97	1	Room	108A	Wall	Wall	Solid	Plaster	0.01
1565	1958 Bldg	115	XRF	5/22/97	1	Room	108A	Wall	Wall	Solid	Plaster	0.01
1566	1958 Bldg	116	XRF	5/22/97	1	Room	108A	Door	Door	Solid	Wood	0.02
1567	1958 Bldg	117	XRF	5/22/97	1	Room	108A	Door	Casing	Solid	Metal	0.15
1568	1958 Bldg	118	XRF	5/22/97	1	Room	108A	Door	Vent	Solid	Metal	0.05
1569	1958 Bldg	119	XRF	5/22/97	1	Room	108A	Ceiling	Diffuser	Solid	Metal	0
1570	1958 Bldg	120	XRF	5/22/97	1	Room	108A	Ceiling		Solid	Plaster	0.01
1571	1958 Bldg	121	XRF	5/22/97	1	Room	108B	Wall	Wall	Solid	Plaster	0.01
1572	1958 Bldg	122	XRF	5/22/97	1	Room	108B	Wall	Wall	Solid	Plaster	0.03
1573	1958 Bldg	123	XRF	5/22/97	1	Room	108B	Wall	Midle Wall	Solid	Wood	0
1574	1958 Bldg	124	XRF	5/22/97	1	Room	108B	Wall	Midle Wall	Solid	Wood	4.39
1575	1958 Bldg	125	XRF	5/22/97	1	Room	108B	Bookcase	Shelf	Solid	Wood	0.02
1576	1958 Bldg	126	XRF	5/22/97	1	Room	108B	Bookcase	Shelf	Solid	Wood	0.02

Saint Paul Public Schools
 Highland Park Junior High School
 Lead-Based Paint Inspection

A	B	C	D	E	F	G	H	I	J	K	L	
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Compon	Feature	Condition	Substrate	Result
1577	1958 Bldg	127	XRF	5/22/97	1	Room	108B	Door	Door	Solid	Wood	0.02
1578	1958 Bldg	128	XRF	5/22/97	1	Room	108B	Door	Jamb	Solid	Metal	0.06
1579	1958 Bldg	129	XRF	5/22/97	1	Room	108B	Door	Vent	Solid	Metal	0.03
1580	1958 Bldg	130	XRF	5/22/97	1	Room	108B	Ceiling	Diffuser	Solid	Metal	0.01
1581	1958 Bldg	131	XRF	5/22/97	1	Room	108B	Ceiling		Peeling	Plaster	0.02
1582	1958 Bldg	64	XRF	5/22/97	1	Room	110A	Wall	Wall	Solid	Plaster	0.01
1583	1958 Bldg	65	XRF	5/22/97	1	Room	110A	Wall	Wall	Solid	Plaster	0.01
1584	1958 Bldg	66	XRF	5/22/97	1	Room	110A	Door	Door	Solid	Wood	0.02
1585	1958 Bldg	67	XRF	5/22/97	1	Room	110A	Door	Jamb	Solid	Metal	0.14
1586	1958 Bldg	68	XRF	5/22/97	1	Room	110A	Bookcase	Shelf	Solid	Wood	0
1587	1958 Bldg	69	XRF	5/22/97	1	Room	110A	Ceiling		Solid	Plaster	0.01
1588	1958 Bldg	135	XRF	6/17/97	1	Room	111A	Wall	Midle Wall	Solid	Wood	0
1589	1958 Bldg	136	XRF	6/17/97	1	Room	111A	Wall	Midle Wall	Solid	Plaster	0.01
1590	1958 Bldg	137	XRF	6/17/97	1	Room	111A	Wall	Wall	Solid	Concrte	0.1
1591	1958 Bldg	138	XRF	6/17/97	1	Room	111A	Wall	Wall	Solid	Concrte	0.05
1592	1958 Bldg	139	XRF	6/17/97	1	Room	111A	Cabinet	Door	Solid	Wood	0.01
1593	1958 Bldg	140	XRF	6/17/97	1	Room	111A	Cabinet	Door	Solid	Wood	0
1594	1958 Bldg	314	XRF	5/27/97	1	Room	113A	Wall	Wall	Solid	Concrte	0.16
1595	1958 Bldg	315	XRF	5/27/97	1	Room	113A	Wall	Wall	Solid	Concrte	0.15
1596	1958 Bldg	316	XRF	5/27/97	1	Room	113A	Wall	Midle Wall	Solid	Wood	0.01
1597	1958 Bldg	317	XRF	5/27/97	1	Room	113A	Wall	Midle Wall	Solid	Wood	0.02
1598	1958 Bldg	318	XRF	5/27/97	1	Room	113A	Cabinet	Door	Solid	Wood	0
1599	1958 Bldg	319	XRF	5/27/97	1	Room	113A	Cabinet	Outside	Solid	Wood	0.01
1600	1958 Bldg	320	XRF	5/27/97	1	Room	113A	Cabinet	Outside	Solid	Wood	0
1601	1958 Bldg	321	XRF	5/27/97	1	Room	113A	Ceiling		Solid	Plaster	0.06
1602	1958 Bldg	322	XRF	5/27/97	1	Room	113A	Door	Door	Solid	Wood	0.01
1603	1958 Bldg	323	XRF	5/27/97	1	Room	113A	Door	Casing	Solid	Metal	0.06
1604	1958 Bldg	324	XRF	5/27/97	1	Room	113B	Wall	Wall	Solid	Concrte	0.06
1605	1958 Bldg	325	XRF	5/27/97	1	Room	113B	Wall	Wall	Solid	Concrte	0.18
1606	1958 Bldg	326	XRF	5/27/97	1	Room	113B	Door	Door	Solid	Wood	0.02
1607	1958 Bldg	327	XRF	5/27/97	1	Room	113B	Door	Casing	Solid	Metal	0.07
1608	1958 Bldg	328	XRF	5/27/97	1	Room	113B	Ceiling	Diffuser	Solid	Metal	0.01
1609	1958 Bldg	329	XRF	5/27/97	1	Room	113B	Ceiling		Solid	Plaster	0.01
1610	1958 Bldg	341	XRF	5/27/97	1	Room	114A	Wall	Wall	Solid	Concrte	0.02
1611	1958 Bldg	342	XRF	5/27/97	1	Room	114A	Wall	Wall	Solid	Concrte	0.03
1612	1958 Bldg	343	XRF	5/27/97	1	Room	114A	Wall	Midle Wall	Solid	Metal	0.03
1613	1958 Bldg	344	XRF	5/27/97	1	Room	114A		Crownmol	Solid	Wood	0
1614	1958 Bldg	345	XRF	5/27/97	1	Room	114A	Wall	Midle Wall	Solid	Drywall	0.03
1615	1958 Bldg	346	XRF	5/27/97	1	Room	114A	Bookcase	Shelf	Solid	Wood	0
1616	1958 Bldg	347	XRF	5/27/97	1	Room	114A	Ceiling	Hatch	Solid	Metal	0.05
1617	1958 Bldg	348	XRF	5/27/97	1	Room	114A	Wall	Wall Rgstr	Solid	Metal	0.23
1618	1958 Bldg	349	XRF	5/27/97	1	Room	114A	Wall	Wall Rgstr	Solid	Metal	0.02
1619	1958 Bldg	350	XRF	5/27/97	1	Room	114B	Wall	Wall	Solid	Concrte	0.05
1620	1958 Bldg	351	XRF	5/27/97	1	Room	114B	Wall	Wall	Solid	Wood	0
1621	1958 Bldg	352	XRF	5/27/97	1	Room	114B	Beam		Solid	Metal	0.02
1622	1958 Bldg	353	XRF	5/27/97	1	Room	114B	Wall	Midle Wall	Solid	Drywall	0
1623	1958 Bldg	354	XRF	5/27/97	1	Room	114B	Door	Door	Solid	Wood	0
1624	1958 Bldg	355	XRF	5/27/97	1	Room	114B	Door	Casing	Solid	Metal	0.01
1625	1958 Bldg	356	XRF	5/27/97	1	Room	114B	Cabinet	Door	Solid	Wood	0.02
1626	1958 Bldg	357	XRF	5/27/97	1	Room	114B	Cabinet	Shelf	Solid	Wood	0.02
1627	1958 Bldg	358	XRF	5/27/97	1	Room	114B	Wall	Wall Rgstr	Solid	Metal	0.01
1628	1958 Bldg	359	XRF	5/27/97	1	Room	114B	Ceiling	Diffuser	Solid	Metal	0
1629	1958 Bldg	360	XRF	5/27/97	1	Room	114C	Wall	Wall	Solid	Concrte	0.03
1630	1958 Bldg	361	XRF	5/27/97	1	Room	114C	Wall	Wall	Solid	Wood	0
1631	1958 Bldg	362	XRF	5/27/97	1	Room	114C	Wall	Wall	Solid	Concrte	0.08
1632	1958 Bldg	363	XRF	5/27/97	1	Room	114C	Wall	Midle Wall	Solid	Drywall	0
1633	1958 Bldg	364	XRF	5/27/97	1	Room	114C	Door	Door	Solid	Wood	0
1634	1958 Bldg	365	XRF	5/27/97	1	Room	114C	Door	Casing	Solid	Metal	0.04
1635	1958 Bldg	366	XRF	5/27/97	1	Room	114C	Coat	Rack	Solid	Wood	0
1636	1958 Bldg	367	XRF	5/27/97	1	Room	114C	Wall	Baseboar	Solid	Metal	0.09
1637	1958 Bldg	368	XRF	5/27/97	1	Room	114C	Wall	Wall Rgstr	Solid	Metal	0.02
1638	1958 Bldg	369	XRF	5/27/97	1	Room	114C	Ceiling	Diffuser	Solid	Metal	0
1639	1958 Bldg	372	XRF	5/27/97	1	Room	114D	Wall	Wall	Solid	Concrte	0.09

Saint Paul Public Schools
 Highland Park Junior High School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Compon	Feature	Condition	Substrate	Result
1640	1958 Bldg	373	XRF	5/27/97	1	Room	114D	Wall	Wall	Solid	Concrete	0.11
1641	1958 Bldg	374	XRF	5/27/97	1	Room	114D	Door	Door	Solid	Wood	0.02
1642	1958 Bldg	375	XRF	5/27/97	1	Room	114D	Door	Casing	Solid	Metal	0.06
1643	1958 Bldg	376	XRF	5/27/97	1	Room	114D		Elec Pane	Solid	Metal	0
1644	1958 Bldg	377	XRF	5/27/97	1	Room	114D	Ceiling		Solid	Plaster	0.01
1645	1958 Bldg	17	XRF	5/28/97	1	Room	114E	Wall	Wall	Solid	Plaster	0.01
1646	1958 Bldg	18	XRF	5/28/97	1	Room	114E	Wall	Wall	Solid	Plaster	0.02
1647	1958 Bldg	19	XRF	5/28/97	1	Room	114E	Door	Door	Solid	Wood	0.01
1648	1958 Bldg	20	XRF	5/28/97	1	Room	114E	Door	Casing	Solid	Metal	0.01
1649	1958 Bldg	21	XRF	5/28/97	1	Room	114E	Wall	Wall Rgstr	Solid	Metal	0.01
1650	1958 Bldg	22	XRF	5/28/97	1	Room	114E	Wall	Wall Rgstr	Solid	Metal	0.01
1651	1958 Bldg	23	XRF	5/28/97	1	Room	114E	Ceiling	Hatch	Solid	Metal	0.02
1652	1958 Bldg	203	XRF	4/26/97	1	Room	124B	Wall	Midle Wall	Solid	Wood	0
1653	1958 Bldg	204	XRF	4/26/97	1	Room	124B	Door	Door	Solid	Wood	0
1654	1958 Bldg	205	XRF	4/26/97	1	Room	124B	Door	Jamb	Solid	Metal	0.01
1655	1958 Bldg	206	XRF	4/26/97	1	Room	124B	Wall	Wall Rgstr	Solid	Metal	1.16
1656	1958 Bldg	119	XRF	4/16/97	1	Room	13A	Ceiling		Solid	Plaster	0.02
1657	1958 Bldg	36	XRF	6/17/97	0	Room	160B	Wall	Midle Wall	Solid	Concrete	0.01
1658	1958 Bldg	37	XRF	6/17/97	0	Room	160B	Wall	Midle Wall	Solid	Concrete	0
1659	1958 Bldg	38	XRF	6/17/97	0	Room	160B	Wall	Baseboar	Solid	Tile	1.03
1660	1958 Bldg	39	XRF	6/17/97	0	Room	160B	Wall	Wall	Solid	Wood	0.02
1661	1958 Bldg	40	XRF	6/17/97	0	Room	160B	Door	Door	Solid	Wood	0.01
1662	1958 Bldg	41	XRF	6/17/97	0	Room	160B	Door	Casing	Solid	Metal	0.27
1663	1958 Bldg	42	XRF	6/17/97	0	Room	160B	Ceiling	Diffuser	Solid	Metal	0
1664	1958 Bldg	43	XRF	6/17/97	0	Room	160B	Bookcase	Shelf	Solid	Wood	0
1665	1958 Bldg	44	XRF	6/17/97	0	Room	160C	Wall	Midle Wall	Solid	Tile	1.49
1666	1958 Bldg	45	XRF	6/17/97	0	Room	160C	Wall	Midle Wall	Solid	Concrete	0.01
1667	1958 Bldg	46	XRF	6/17/97	0	Room	160C		Locker	Solid	Metal	0.05
1668	1958 Bldg	47	XRF	6/17/97	0	Room	160C	Door	Stall Door	Solid	Metal	0.02
1669	1958 Bldg	48	XRF	6/17/97	0	Room	160C	Shelf	Bracket	Solid	Metal	0.06
1670	1958 Bldg	49	XRF	6/17/97	0	Room	160C	Door	Door	Solid	Wood	0.01
1671	1958 Bldg	50	XRF	6/17/97	0	Room	160C	Door	Casing	Solid	Metal	0.24
1672	1958 Bldg	51	XRF	6/17/97	0	Room	160C	Ceiling	Diffuser	Solid	Metal	0.02
1673	1958 Bldg	52	XRF	6/17/97	0	Room	160C	Ceiling		Solid	Plaster	0.02
1674	1958 Bldg	53	XRF	6/17/97	0	Room	160C	Floor		Solid	Tile	0.09
1675	1958 Bldg	63	XRF	4/24/97	3	Room	1C	Wall	Midle Wall	Solid	Tile	0.08
1676	1958 Bldg	64	XRF	4/24/97	3	Room	1C	Door	Door	Solid	Wood	0.02
1677	1958 Bldg	65	XRF	4/24/97	3	Room	1C	Door	Jamb	Solid	Metal	0.15
1678	1958 Bldg	66	XRF	4/24/97	3	Room	1C	Wall	Wall	Solid	Wood	0
1679	1958 Bldg	67	XRF	4/24/97	3	Room	1C		Radiator	Solid	Metal	0.01
1680	1958 Bldg	68	XRF	4/24/97	3	Room	1C	Bookcase	Shelf	Solid	Wood	0.29
1681	1958 Bldg	69	XRF	4/24/97	3	Room	1C		Elec Pane	Solid	Metal	0.14
1682	1958 Bldg	70	XRF	4/24/97	3	Room	1C	Ceiling		Solid	Plaster	0.03
1683	1958 Bldg	71	XRF	4/24/97	3	Room	1C	Ladder		Solid	Metal	1.24
1684	1958 Bldg	72	XRF	4/24/97	3	Room	1C	Ceiling	Hatch	Solid	Metal	0.9
1685	1958 Bldg	54	XRF	6/17/97	0	Room	211A	Wall	Midle Wall	Solid	Concrete	0.01
1686	1958 Bldg	55	XRF	6/17/97	0	Room	211A	Wall	Midle Wall	Solid	Concrete	0.01
1687	1958 Bldg	56	XRF	6/17/97	0	Room	211A	Wall	Baseboar	Solid	Tile	1.36
1688	1958 Bldg	57	XRF	6/17/97	0	Room	211A	Wall	Wall	Solid	Wood	0.01
1689	1958 Bldg	58	XRF	6/17/97	0	Room	211A	Door	Door	Solid	Wood	0.01
1690	1958 Bldg	59	XRF	6/17/97	0	Room	211A	Door	Door	Solid	Metal	0.02
1691	1958 Bldg	60	XRF	6/17/97	0	Room	211A	Door	Casing	Solid	Metal	0.29
1692	1958 Bldg	61	XRF	6/17/97	0	Room	211A	Cabinet	Outside	Solid	Metal	0
1693	1958 Bldg	62	XRF	6/17/97	0	Room	211A	Ceiling	Diffuser	Solid	Metal	0.06
1694	1958 Bldg	63	XRF	6/17/97	0	Room	211B	Wall	Midle Wall	Solid	Tile	1.46
1695	1958 Bldg	64	XRF	6/17/97	0	Room	211B	Wall	Midle Wall	Solid	Concrete	0.02
1696	1958 Bldg	65	XRF	6/17/97	0	Room	211B		Locker	Solid	Metal	0.03
1697	1958 Bldg	66	XRF	6/17/97	0	Room	211B	Wall	Bthrm Stl	Solid	Metal	0.03
1698	1958 Bldg	67	XRF	6/17/97	0	Room	211B	Door	Casing	Solid	Metal	0.25
1699	1958 Bldg	68	XRF	6/17/97	0	Room	211B	Ceiling	Diffuser	Solid	Metal	0.14
1700	1958 Bldg	69	XRF	6/17/97	0	Room	211B	Ceiling		Solid	Plaster	0.02
1701	1958 Bldg	70	XRF	6/17/97	0	Room	211B	Floor		Solid	Tile	0.06
1702	1958 Bldg	179	XRF	6/17/97	2	Room	218A	Wall	Midle Wall	Solid	Concrete	0.05

Saint Paul Public Schools
 Highland Park Junior High School
 Lead-Based Paint inspection

A	B	C	D	E	F	G	H	I	J	K	L	
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Compon	Feature	Condition	Substrate	Result
1703	1958 Bldg	180	XRF	6/17/97	2	Room	218A	Wall	Midle Wall	Solid	Concrete	1.7
1704	1958 Bldg	181	XRF	6/17/97	2	Room	218A	Wall	Midle Wall	Solid	Concrete	0.02
1705	1958 Bldg	182	XRF	6/17/97	2	Room	218A	Cabinet	Door	Solid	Wood	0.01
1706	1958 Bldg	183	XRF	6/17/97	2	Room	218A	Wall	Baseboar	Solid	Tile	1.66
1707	1958 Bldg	184	XRF	6/17/97	2	Room	218A	Ceiling	Diffuser	Solid	Metal	0.01
1708	1958 Bldg	185	XRF	6/17/97	2	Room	218A	Ceiling		Solid	Plaster	0.02
1709	1958 Bldg	193	XRF	6/17/97	2	Room	220A	Wall	Midle Wall	Solid	Concrete	0.03
1710	1958 Bldg	194	XRF	6/17/97	2	Room	220A	Wall	Midle Wall	Solid	Concrete	1.01
1711	1958 Bldg	195	XRF	6/17/97	2	Room	220A	Wall	Baseboar	Solid	Tile	1.32
1712	1958 Bldg	196	XRF	6/17/97	2	Room	220A	Door	Door	Solid	Wood	0.01
1713	1958 Bldg	197	XRF	6/17/97	2	Room	220A	Bookcase	Shelf	Solid	Wood	0
1714	1958 Bldg	38	XRF	4/26/97	2	Room	229C	Wall	Midle Wall	Solid	Plaster	0.01
1715	1958 Bldg	39	XRF	4/26/97	2	Room	229C	Wall	Wall	Solid	Plaster	1.46
1716	1958 Bldg	40	XRF	4/26/97	2	Room	229C	Wall	Midle Wall	Solid	Plaster	1.77
1717	1958 Bldg	41	XRF	4/26/97	2	Room	229C	Wall	Midle Wall	Solid	Plaster	0.04
1718	1958 Bldg	42	XRF	4/26/97	2	Room	229C	Wall	Wall	Solid	Plaster	0.01
1719	1958 Bldg	43	XRF	4/26/97	2	Room	229C	Door	Door	Solid	Wood	0.02
1720	1958 Bldg	44	XRF	4/26/97	2	Room	229C	Door	Jamb	Solid	Metal	0.14
1721	1958 Bldg	45	XRF	4/26/97	2	Room	229C		Radiator	Solid	Metal	0.01
1722	1958 Bldg	46	XRF	4/26/97	2	Room	229C	Wall	Wall Rgstr	Solid	Metal	1.16
1723	1958 Bldg	47	XRF	4/26/97	2	Room	229C	Wall	Wall Rgstr	Solid	Metal	1.37
1724	1958 Bldg	48	XRF	4/26/97	2	Room	229C	Wall	Wall	Solid	Plaster	0
1725	1958 Bldg	49	XRF	4/26/97	2	Room	229C	Wall	Wall	Solid	Wood	0
1726	1958 Bldg	50	XRF	4/26/97	2	Room	230C	Wall	Midle Wall	Solid	Plaster	0.02
1727	1958 Bldg	51	XRF	4/26/97	2	Room	230C	Wall	Midle Wall	Solid	Plaster	0.02
1728	1958 Bldg	52	XRF	4/26/97	2	Room	230C	Door	Door	Solid	Wood	0.03
1729	1958 Bldg	53	XRF	4/26/97	2	Room	230C	Door	Jamb	Solid	Metal	0.15
1730	1958 Bldg	54	XRF	4/26/97	2	Room	230C	Wall	Wall	Solid	Plaster	0.02
1731	1958 Bldg	55	XRF	4/26/97	2	Room	230C		Radiator	Solid	Metal	0
1732	1958 Bldg	56	XRF	4/26/97	2	Room	230C	Wall	Wall Rgstr	Solid	Metal	0
1733	1958 Bldg	57	XRF	4/26/97	2	Room	230C	Bookcase	Inside	Solid	Wood	0.05
1734	1958 Bldg	115	XRF	5/28/97	1	Room	24A	Wall	Midle Wall	Solid	Tile	0.16
1735	1958 Bldg	116	XRF	5/28/97	1	Room	24A	Door	Door	Solid	Wood	0.01
1736	1958 Bldg	117	XRF	5/28/97	1	Room	24A	Door	Casing	Solid	Metal	0.19
1737	1958 Bldg	118	XRF	5/28/97	1	Room	24A	Bookcase	Shelf	Solid	Wood	0
1738	1958 Bldg	125	XRF	5/28/97	1	Room	24B	Wall	Midle Wall	Solid	Tile	0.16
1739	1958 Bldg	126	XRF	5/28/97	1	Room	24B	Door	Door	Solid	Wood	0.01
1740	1958 Bldg	127	XRF	5/28/97	1	Room	24B	Door	Casing	Solid	Metal	0.25
1741	1958 Bldg	128	XRF	5/28/97	1	Room	24B	Bookcase	Shelf	Solid	Wood	0.08
1742	1958 Bldg	74	XRF	4/12/97	1	Room	27B	Wall	Wall	Peeling	Concrete	0.06
1743	1958 Bldg	75	XRF	4/12/97	1	Room	27B	Wall	Wall	Solid	Concrete	0.05
1744	1958 Bldg	76	XRF	4/12/97	1	Room	27B	Door	Door	Solid	Metal	0.09
1745	1958 Bldg	77	XRF	4/12/97	1	Room	27B	Door	Jamb	Solid	Metal	0.07
1746	1958 Bldg	78	XRF	4/12/97	1	Room	27B	Door	Door	Solid	Metal	0.14
1747	1958 Bldg	79	XRF	4/12/97	1	Room	27B	Door	Jamb	Solid	Metal	0.16
1748	1958 Bldg	80	XRF	4/12/97	1	Room	27B	Wall	Wall	Solid	Brick	0.04
1749	1958 Bldg	63	XRF	4/12/97	1	Room	27S	Wall	Midle Wall	Solid	Concrete	0.04
1750	1958 Bldg	64	XRF	4/12/97	1	Room	27S	Wall	Wall	Solid	Concrete	0.04
1751	1958 Bldg	65	XRF	4/12/97	1	Room	27S	Door	Door	Solid	Wood	0.03
1752	1958 Bldg	66	XRF	4/12/97	1	Room	27S	Door	Jamb	Solid	Metal	0.09
1753	1958 Bldg	67	XRF	4/12/97	1	Room	27S		Locker	Solid	Metal	0.22
1754	1958 Bldg	68	XRF	4/12/97	1	Room	27S		Shelf	Solid	Wood	0.03
1755	1958 Bldg	69	XRF	4/12/97	1	Room	27S	Bulletin B	Trim	Solid	Wood	0.09
1756	1958 Bldg	70	XRF	4/12/97	1	Room	27S	Bulletin B	Cork	Solid	Wood	1.54
1757	1958 Bldg	71	XRF	4/12/97	1	Room	27S		Column	Solid	Concrete	0.03
1758	1958 Bldg	72	XRF	4/12/97	1	Room	27S	Ceiling		Solid	Concrete	0.04
1759	1958 Bldg	73	XRF	4/12/97	1	Room	27S	Wall	Wall	Solid	Wood	0.02
1760	1958 Bldg	81	XRF	4/12/97	1	Room	27W	Wall	Wall	Solid	Concrete	0.05
1761	1958 Bldg	82	XRF	4/12/97	1	Room	27W	Wall	Midle Wall	Solid	Concrete	0.06
1762	1958 Bldg	83	XRF	4/12/97	1	Room	27W	Door	Header	Solid	Metal	0.05
1763	1958 Bldg	84	XRF	4/12/97	1	Room	27W	Stairs	Hand rail	Solid	Metal	0.05
1764	1958 Bldg	85	XRF	4/12/97	1	Room	27W	Stairs	Stringer	Solid	Metal	0.05
1765	1958 Bldg	86	XRF	4/12/97	1	Room	27W	Panel	Board	Solid	Wood	0.03

Saint Paul Public Schools
 Highland Park Junior High School
 Lead-Based Paint Inspection

A	B	C	D	E	F	G	H	I	J	K	L	
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Compon	Feature	Condition	Substrate	Result
1766	1958 Bldg	87	XRF	4/12/97	1	Room	27W	Ceiling	I-Beam	Solid	Metal	0.05
1767	1958 Bldg	88	XRF	4/12/97	1	Room	27W	Wall	Midle Wall	Solid	Concrete	0.03
1768	1958 Bldg	89	XRF	4/12/97	1	Room	27W	Wall	Midle Wall	Solid	Concrete	0.01
1769	1958 Bldg	90	XRF	4/12/97	1	Room	27W		Shelf	Solid	Wood	0
1770	1958 Bldg	175	XRF	4/26/97	1	Room	28A	Wall	Midle Wall	Solid	Plaster	0.01
1771	1958 Bldg	176	XRF	4/26/97	1	Room	28A	Wall	Midle Wall	Solid	Drywall	0
1772	1958 Bldg	177	XRF	4/26/97	1	Room	28A	Window	Casing	Solid	Metal	0.15
1773	1958 Bldg	178	XRF	4/26/97	1	Room	28A	Bookcase	Shelf	Solid	Wood	0.03
1774	1958 Bldg	179	XRF	4/26/97	1	Room	28A	Bookcase	Inside	Solid	Wood	0.21
1775	1958 Bldg	180	XRF	4/26/97	1	Room	28B	Wall	Midle Wall	Solid	Plaster	0.09
1776	1958 Bldg	181	XRF	4/26/97	1	Room	28B	Wall	Midle Wall	Solid	Drywall	0.01
1777	1958 Bldg	182	XRF	4/26/97	1	Room	28B	Door	Door	Solid	Wood	0.01
1778	1958 Bldg	183	XRF	4/26/97	1	Room	28B	Door	Jamb	Solid	Metal	0.17
1779	1958 Bldg	184	XRF	4/26/97	1	Room	28B	Bookcase	Shelf	Solid	Wood	0.03
1780	1958 Bldg	185	XRF	4/26/97	1	Room	28B	Cabinet	Inside	Solid	Wood	0.02
1781	1958 Bldg	6	XRF	5/22/97	1	Room	28C	Wall	Wall	Solid	Plaster	0.01
1782	1958 Bldg	7	XRF	5/22/97	1	Room	28C	Wall	Wall	Solid	Plaster	0.58
1783	1958 Bldg	8	XRF	5/22/97	1	Room	28C	Wall	Midle Wall	Solid	Wood	2.15
1784	1958 Bldg	9	XRF	5/22/97	1	Room	28C	Door	Door	Solid	Wood	0.02
1785	1958 Bldg	10	XRF	5/22/97	1	Room	28C	Door	Casing	Solid	Metal	0.12
1786	1958 Bldg	11	XRF	5/22/97	1	Room	28C	Cabinet	Door	Solid	Wood	0.02
1787	1958 Bldg	12	XRF	5/22/97	1	Room	28C	Cabinet	Shelf	Solid	Wood	0
1788	1958 Bldg	13	XRF	5/22/97	1	Room	28C	Bulletin	Board	Solid	Wood	0.01
1789	1958 Bldg	14	XRF	5/22/97	1	Room	28C		Elec Pane	Solid	Metal	0.05
1790	1958 Bldg	87	XRF	4/24/97	3	Room	2C	Wall	Midle Wall	Solid	Tile	0.41
1791	1958 Bldg	88	XRF	4/24/97	3	Room	2C	Door	Door	Solid	Wood	0.02
1792	1958 Bldg	89	XRF	4/24/97	3	Room	2C	Door	Jamb	Solid	Metal	0.15
1793	1958 Bldg	90	XRF	4/24/97	3	Room	2C		Shelf	Solid	Wood	0.02
1794	1958 Bldg	91	XRF	4/24/97	3	Room	2C	Ceiling		Solid	Plaster	0.01
1795	1958 Bldg	92	XRF	4/24/97	3	Room	2C	Ceiling	Diffuser	Solid	Metal	0
1796	1958 Bldg	167	XRF	6/17/97	3	Room	301A	Wall	Midle Wall	Solid	Concrete	0.03
1797	1958 Bldg	168	XRF	6/17/97	3	Room	301A	Wall	Midle Wall	Solid	Concrete	0.03
1798	1958 Bldg	169	XRF	6/17/97	3	Room	301A	Wall	Baseboar	Solid	Tile	0.97
1799	1958 Bldg	170	XRF	6/17/97	3	Room	301A	Wall	Baseboar	Solid	Tile	1.12
1800	1958 Bldg	171	XRF	6/17/97	3	Room	301A	Wall	Baseboar	Solid	Tile	1.27
1801	1958 Bldg	172	XRF	6/17/97	3	Room	301A	Door	Door	Solid	Wood	0.02
1802	1958 Bldg	173	XRF	6/17/97	3	Room	301A	Door	Casing	Solid	Metal	0.14
1803	1958 Bldg	174	XRF	6/17/97	3	Room	301A	Bookcase	Shelf	Solid	Wood	0.01
1804	1958 Bldg	175	XRF	6/17/97	3	Room	301A	Cabinet	Door	Solid	Wood	0.01
1805	1958 Bldg	176	XRF	6/17/97	3	Room	301A	Ceiling	Diffuser	Solid	Metal	0.02
1806	1958 Bldg	181	XRF	4/16/97	3	Room	323A	Wall	Midle Wall	Solid	Plaster	0.18
1807	1958 Bldg	182	XRF	4/16/97	3	Room	323A	Wall	Midle Wall	Solid	Drywall	0
1808	1958 Bldg	183	XRF	4/16/97	3	Room	323A	Wall	Wall	Solid	Drywall	0.01
1809	1958 Bldg	184	XRF	4/16/97	3	Room	323A	Door	Door	Solid	Wood	0.02
1810	1958 Bldg	185	XRF	4/16/97	3	Room	323A	Door	Jamb	Solid	Metal	0.01
1811	1958 Bldg	186	XRF	4/16/97	3	Room	323A		Radiator	Solid	Metal	0.01
1812	1958 Bldg	187	XRF	4/16/97	3	Room	323A	Cabinet	Door	Solid	Wood	0.01
1813	1958 Bldg	188	XRF	4/16/97	3	Room	323A	Cabinet	Door	Solid	Wood	0.02
1814	1958 Bldg	189	XRF	4/16/97	3	Room	323A	Cabinet	Shelf	Solid	Wood	0.01
1815	1958 Bldg	29	XRF	4/26/97	2	Room	3C	Wall	Midle Wall	Solid	Concrete	0.02
1816	1958 Bldg	30	XRF	4/26/97	2	Room	3C	Door	Door	Solid	Wood	0.03
1817	1958 Bldg	31	XRF	4/26/97	2	Room	3C	Door	Jamb	Solid	Metal	0.18
1818	1958 Bldg	32	XRF	4/26/97	2	Room	3C		Radiator	Solid	Metal	0
1819	1958 Bldg	33	XRF	4/26/97	2	Room	3C	Ceiling		Solid	Plaster	0.01
1820	1958 Bldg	34	XRF	4/26/97	2	Room	3C	Bookcase	Shelf	Solid	Wood	0.33
1821	1958 Bldg	35	XRF	4/26/97	2	Room	3C		Elec Pane	Solid	Metal	0.05
1822	1958 Bldg	36	XRF	4/26/97	2	Room	3C	Bookcase	Inside	Solid	Wood	0.32
1823	1958 Bldg	37	XRF	4/26/97	2	Room	3C	Wall	Midle Wall	Solid	Concrete	0.08
1824	1958 Bldg	58	XRF	4/26/97	2	Room	4C	Wall	Midle Wall	Solid	Tile	0.16
1825	1958 Bldg	59	XRF	4/26/97	2	Room	4C	Door	Door	Solid	Wood	0.03
1826	1958 Bldg	60	XRF	4/26/97	2	Room	4C	Door	Jamb	Solid	Metal	0.17
1827	1958 Bldg	61	XRF	4/26/97	2	Room	4C		Radiator	Solid	Metal	0.03
1828	1958 Bldg	62	XRF	4/26/97	2	Room	4C	Mount	Cable	Solid	Wood	0

Saint Paul Public Schools
 Highland Park Junior High School
 Lead-Based Paint Inspection

A	B	C	D	E	F	G	H	I	J	K	L	
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Componen	Feature	Condition	Substrate	Result
1829	1958 Bldg	63	XRF	4/26/97	2	Room	4C	Bookcase	Shelf	Solid	Wood	0.02
1830	1958 Bldg	64	XRF	4/26/97	2	Room	4C	Ceiling		Solid	Plaster	0.02
1831	1958 Bldg	136	XRF	4/26/97	1	Room	5C	Wall	Midle Wall	Solid	Tile	0.18
1832	1958 Bldg	137	XRF	4/26/97	1	Room	5C	Door	Door	Solid	Wood	0.02
1833	1958 Bldg	138	XRF	4/26/97	1	Room	5C	Door	Jamb	Solid	Metal	0.07
1834	1958 Bldg	139	XRF	4/26/97	1	Room	5C		Radiator	Solid	Metal	0.07
1835	1958 Bldg	140	XRF	4/26/97	1	Room	5C	Bookcase	Shelf	Solid	Wood	0.01
1836	1958 Bldg	141	XRF	4/26/97	1	Room	5C		Elec Pane	Solid	Metal	0.09
1837	1958 Bldg	142	XRF	4/26/97	1	Room	5C	Ceiling		Solid	Plaster	0
1838	1958 Bldg	55	XRF	4/16/97	1	Room	6A	Cabinet	Door	Solid	Wood	0.02
1839	1958 Bldg	56	XRF	4/16/97	1	Room	6A	Cabinet	Shelf	Solid	Wood	0
1840	1958 Bldg	102	XRF	6/17/97	1	Room	71N	Door	Door	Solid	Metal	0.11
1841	1958 Bldg	103	XRF	6/17/97	1	Room	71N	Door	Casing	Solid	Metal	0.08
1842	1958 Bldg	104	XRF	6/17/97	1	Room	71N	Door	Door	Solid	Wood	0.01
1843	1958 Bldg	105	XRF	6/17/97	1	Room	71N	Door	Casing	Solid	Metal	0.08
1844	1958 Bldg	106	XRF	6/17/97	1	Room	71N	Bookcase	Shelf	Solid	Wood	0.02
1845	1958 Bldg	107	XRF	6/17/97	1	Room	71N	Ceiling		Solid	Plaster	0.04
1846	1958 Bldg	108	XRF	6/17/97	1	Room	71N	Floor		Solid	Tile	0.17
1847	1958 Bldg	151	XRF	5/28/97	1	Room	71S	Wall	Midle Wall	Solid	Tile	0.13
1848	1958 Bldg	152	XRF	5/28/97	1	Room	71S	Wall	Midle Wall	Solid	Concrete	0.09
1849	1958 Bldg	153	XRF	5/28/97	1	Room	71S	Door	Door	Solid	Metal	0.11
1850	1958 Bldg	154	XRF	5/28/97	1	Room	71S	Door	Casing	Solid	Metal	0.11
1851	1958 Bldg	155	XRF	5/28/97	1	Room	71S	Stairs	Baseboar	Solid	Metal	0.05
1852	1958 Bldg	109	XRF	6/17/97	1	Room	72N	Wall	Midle Wall	Solid	Tile	0.06
1853	1958 Bldg	110	XRF	6/17/97	1	Room	72N	Wall	Midle Wall	Solid	Concrete	0.04
1854	1958 Bldg	111	XRF	6/17/97	1	Room	72N	Wall	Baseboar	Solid	Metal	0.08
1855	1958 Bldg	112	XRF	6/17/97	1	Room	72N	Stairs		Solid	Metal	0.02
1856	1958 Bldg	113	XRF	6/17/97	1	Room	72N	Stairs	Hand rail	Solid	Metal	0.02
1857	1958 Bldg	114	XRF	6/17/97	1	Room	72N	Stairs	Hand rail	Solid	Metal	0.03
1858	1958 Bldg	115	XRF	6/17/97	1	Room	72N		Column	Solid	Metal	0.04
1859	1958 Bldg	116	XRF	6/17/97	1	Room	72N	Ceiling		Solid	Metal	0.02
1860	1958 Bldg	156	XRF	5/28/97	1	Room	72S	Wall	Midle Wall	Solid	Tile	0.05
1861	1958 Bldg	157	XRF	5/28/97	1	Room	72S	Wall	Wall	Solid	Concrete	0.08
1862	1958 Bldg	158	XRF	5/28/97	1	Room	72S	Wall	Baseboar	Solid	Metal	0.05
1863	1958 Bldg	159	XRF	5/28/97	1	Room	72S		Hand rail	Solid	Metal	0.04
1864	1958 Bldg	160	XRF	5/28/97	1	Room	72S	Beam		Solid	Metal	0.06
1865	1958 Bldg	161	XRF	5/28/97	1	Room	72S	Ladder		Solid	Metal	0.02
1866	1958 Bldg	162	XRF	5/28/97	1	Room	72S	Ceiling		Solid	Metal	0.03
1867	1958 Bldg	57	XRF	4/16/97	1	Room	7A	Wall	Midle Wall	Solid	Plaster	0.01
1868	1958 Bldg	58	XRF	4/16/97	1	Room	7A	Door	Door	Solid	Wood	0.02
1869	1958 Bldg	59	XRF	4/16/97	1	Room	7A	Door	Jamb	Solid	Metal	0.16
1870	1958 Bldg	60	XRF	4/16/97	1	Room	7A		Radiator	Solid	Metal	0.03
1871	1958 Bldg	61	XRF	4/16/97	1	Room	7A	Cabinet	Door	Solid	Wood	0.03
1872	1958 Bldg	62	XRF	4/16/97	1	Room	7A	Cabinet	Outside	Solid	Wood	0.02
1873	1958 Bldg	63	XRF	4/16/97	1	Room	8A	Wall	Wall	Solid	Plaster	0.02
1874	1958 Bldg	64	XRF	4/16/97	1	Room	8A	Door	Door	Solid	Wood	0.02
1875	1958 Bldg	6	XRF	4/12/97	1	SE Entry	0E	Wall	Wall	Solid	Tile	0.27
1876	1958 Bldg	7	XRF	4/12/97	1	SE Entry	0E	Wall	Midle Wall	Solid	Concrete	0.02
1877	1958 Bldg	8	XRF	4/12/97	1	SE Entry	0E	Door	Door	Solid	Wood	0.03
1878	1958 Bldg	9	XRF	4/12/97	1	SE Entry	0E	Door	Jamb	Solid	Metal	0.07
1879	1958 Bldg	10	XRF	4/12/97	1	SE Entry	0E	Door	Door	Solid	Metal	0.22
1880	1958 Bldg	11	XRF	4/12/97	1	SE Entry	0E	Door	Jamb	Solid	Metal	0.02
1881	1958 Bldg	12	XRF	4/12/97	1	SE Entry	0E	Window	Panel	Solid	Wood	0
1882	1958 Bldg	13	XRF	4/12/97	1	SE Entry	0E		Column	Solid	Metal	0.04
1883	1958 Bldg	14	XRF	4/12/97	1	SE Entry	0E	Ceiling		Solid	Plaster	0.01
1884	1958 Bldg	15	XRF	4/12/97	1	SE Entry	0E	Door	Header	Solid	Metal	0.01
1885	1958 Bldg	16	XRF	4/12/97	1	SE Entry	0E		Radiator	Solid	Metal	0
1886	1958 Bldg	81	XRF	5/7/97	1	Stage	S	Wall	Wall	Solid	Concrete	0.04
1887	1958 Bldg	82	XRF	5/7/97	1	Stage	S	Wall	Wall	Solid	Concrete	0.02
1888	1958 Bldg	83	XRF	5/7/97	1	Stage	S	Wall	Wall	Solid	Wood	0
1889	1958 Bldg	84	XRF	5/7/97	1	Stage	S	Door	Door	Solid	Wood	0.03
1890	1958 Bldg	85	XRF	5/7/97	1	Stage	S	Door	Door	Solid	Metal	0.12
1891	1958 Bldg	86	XRF	5/7/97	1	Stage	S	Door	Jamb	Solid	Metal	0.08

Saint Paul Public Schools
 Highland Park Junior High School
 Lead-Based Paint Inspection

A	B	C	D	E	F	G	H	I	J	K	L		
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Compon	Feature	Condition	Substrate	Result	
1892	1958 Bldg	87	XRF	5/7/97	1	Stage	S	Door	Header	Solid	Metal	0.09	
1893	1958 Bldg	88	XRF	5/7/97	1	Stage	S		Column	Solid	Metal	0.03	
1894	1958 Bldg	89	XRF	5/7/97	1	Stage	S	Floor		Solid	Wood	1.08	
1895	1958 Bldg	90	XRF	5/7/97	1	Stage	S	Floor		Solid	Wood	0.01	
1896	1958 Bldg	91	XRF	5/7/97	1	Stage	S	Wall	Wall	Solid	Wood	0.94	
1897	1958 Bldg	234	XRF	6/2/97	0	Stairwell		1	Wall	Midle Wall	Solid	Concrte	0.04
1898	1958 Bldg	235	XRF	6/2/97	0	Stairwell		1	Stairs	Stringer	Solid	Metal	1.62
1899	1958 Bldg	236	XRF	6/2/97	0	Stairwell		1	Stairs	Hand rail	Solid	Wood	0.01
1900	1958 Bldg	237	XRF	6/2/97	0	Stairwell		1	Stairs	Baseboar	Solid	Metal	1.47
1901	1958 Bldg	238	XRF	6/2/97	0	Stairwell		1	Ceiling		Solid	Concrte	0.01
1902	1958 Bldg	239	XRF	6/2/97	0	Stairwell		1	Door	Door	Solid	Metal	0
1903	1958 Bldg	240	XRF	6/2/97	0	Stairwell		1	Door	Casing	Solid	Metal	0.01
1904	1958 Bldg	241	XRF	6/2/97	0	Stairwell		2	Stairs	Wall	Solid	Concrete	0.05
1905	1958 Bldg	242	XRF	6/2/97	0	Stairwell		2	Stairs	Wall	Solid	Concrete	0.04
1906	1958 Bldg	243	XRF	6/2/97	0	Stairwell		2	Wall	Wall	Solid	Metal	0.06
1907	1958 Bldg	244	XRF	6/2/97	0	Stairwell		2	Stairs	Baluster	Solid	Metal	0.04
1908	1958 Bldg	245	XRF	6/2/97	0	Stairwell		2	Stairs	Stringer	Solid	Metal	1.34
1909	1958 Bldg	246	XRF	6/2/97	0	Stairwell		2	Stairs	Baseboar	Solid	Metal	1.08
1910	1958 Bldg	247	XRF	6/2/97	0	Stairwell		2	Stairs	Hand rail	Solid	Wood	0
1911	1958 Bldg	248	XRF	6/2/97	0	Stairwell		2	Door	Door	Solid	Metal	0.03
1912	1958 Bldg	249	XRF	6/2/97	0	Stairwell		2	Door	Casing	Solid	Metal	0.01
1913	1958 Bldg	250	XRF	6/2/97	0	Stairwell		2	Wall	Wall	Solid	Plaster	0.08
1914	1958 Bldg	149	XRF	6/17/97	1	Stairwell		109	Wall	Midle Wall	Solid	Concrte	0.02
1915	1958 Bldg	150	XRF	6/17/97	1	Stairwell		109	Wall	Midle Wall	Solid	Concrte	0.03
1916	1958 Bldg	151	XRF	6/17/97	1	Stairwell		109	Wall	Wall	Solid	Plaster	0.03
1917	1958 Bldg	152	XRF	6/17/97	1	Stairwell		109	Wall	Wall	Solid	Concrete	0.03
1918	1958 Bldg	153	XRF	6/17/97	1	Stairwell		109	Stairs	Baseboar	Solid	Metal	0.05
1919	1958 Bldg	154	XRF	6/17/97	1	Stairwell		109	Stairs	Riser	Solid	Metal	0.07
1920	1958 Bldg	155	XRF	6/17/97	1	Stairwell		109	Stairs	Hand rail	Solid	Metal	0.07
1921	1958 Bldg	128	XRF	5/7/97	1	Stairwell	E	Wall	Midle Wall	Solid	Tile	0.31	
1922	1958 Bldg	129	XRF	5/7/97	1	Stairwell	E	Door	Door	Solid	Metal	0.03	
1923	1958 Bldg	130	XRF	5/7/97	1	Stairwell	E	Door	Jamb	Solid	Metal	0.06	
1924	1958 Bldg	131	XRF	5/7/97	1	Stairwell	E		Radiator	Solid	Metal	0.05	
1925	1958 Bldg	132	XRF	5/7/97	1	Stairwell	E	Stairs	Baluster	Solid	Wood	0.02	
1926	1958 Bldg	133	XRF	5/7/97	1	Stairwell	E	Stairs	Baluster	Solid	Wood	0.02	
1927	1958 Bldg	134	XRF	5/7/97	1	Stairwell	E	Stairs	Stringer	Solid	Metal	0.03	
1928	1958 Bldg	135	XRF	5/7/97	1	Stairwell	E	Stairs	Hand rail	Solid	Metal	0.03	
1929	1958 Bldg	119	XRF	5/7/97	1	Stairwell	W	Wall	Midle Wall	Solid	Tile	0.13	
1930	1958 Bldg	120	XRF	5/7/97	1	Stairwell	W	Door	Door	Solid	Metal	0.03	
1931	1958 Bldg	121	XRF	5/7/97	1	Stairwell	W	Door	Door	Solid	Metal	0.08	
1932	1958 Bldg	122	XRF	5/7/97	1	Stairwell	W	Door	Header	Solid	Metal	0.09	
1933	1958 Bldg	123	XRF	5/7/97	1	Stairwell	W		Radiator	Solid	Metal	0.04	
1934	1958 Bldg	124	XRF	5/7/97	1	Stairwell	W	Stairs	Baluster	Solid	Wood	0.02	
1935	1958 Bldg	125	XRF	5/7/97	1	Stairwell	W	Stairs	Baluster	Solid	Wood	0.02	
1936	1958 Bldg	126	XRF	5/7/97	1	Stairwell	W	Stairs	Hand rail	Solid	Metal	0.04	
1937	1958 Bldg	127	XRF	5/7/97	1	Stairwell	W	Stairs	Stringer	Solid	Metal	0.04	

APPENDIX B

LABORATORY SAMPLE ANALYSIS DATA

LABORATORY ANALYSIS REPORT

DATE: July 31, 1997 **PAGE:** 1 Of 4

CLIENT: Midwest Environmental Cons.
5385 401st Ave. NW
Dalbo, MN 55017 **PROJECT NO.:** 071697-200888
COLLECTION DATE: 6/19/97
COLLECTED BY: Client
RECEIVED DATE: 7/16/97
PROJECT DESCRP.: 62/0197M

CONTACT: Richard Cox

<u>SAMPLE #</u>	<u>DESCP.</u>	<u>MDL</u>	LEAD (6010A)		<u>ANALYSIS</u>
			<u>RESULTS</u>	<u>Units=mg/kg</u>	
L974611-1	M-9	33	940		7/28/97
L974611-2	M-28	45	ND		7/28/97
L974611-3	M-29	37	3400		7/28/97
L974611-4	M-31	16	460		7/28/97
L974611-5	M-53	12	550		7/28/97
L974611-6	M-69	17	1900		7/28/97
L974611-7	M-74	17	1400		7/28/97
L974611-8	M-76	37	6200		7/28/97
L974611-9	M-163	22	1800		7/28/97
L974611-10	M-165	19	910		7/28/97
L974611-11	M-179	24	450		7/28/97
L974611-12	M-187	44	2400		7/28/97
L974611-13	M-188	38	3000		7/28/97
L974611-14	M-200	43	1500		7/28/97
L974611-15	M-43	33	2800		7/28/97
L974611-16	M-113	26	1500		7/28/97
L974611-17	M-153	21	2800		7/28/97
L974611-18	M-16	180	ND		7/28/97
L974611-19	M-28	20	2100		7/28/97
L974611-20	M-38	32	1100		7/28/97
L974611-21	M-56	36	3200		7/29/97
L974611-22	M-69	16	2800		7/29/97
L974611-23	M-85	110	4600		7/29/97
L974611-24	M-93	23	ND		7/29/97
L974611-25	M-95	32	3300		7/29/97
L974611-26	M-99	77	7300		7/29/97
L974611-27	M-107	290	14,000		7/29/97
L974611-28	M-28	43	5300		7/29/97

As a mutual protection, all reports are submitted in confidentiality and may not be reproduced except in full without written authorization.



A member of The Marmon Group of Companies

LABORATORY ANALYSIS REPORT

DATE: July 31, 1997 **PAGE:** 2 Of 4

CLIENT: Midwest Environmental Cons.
5385 401st Ave. NW
Dalbo, MN 55017 **PROJECT NO.:** 071697-200888
COLLECTION DATE: 6/19/97
COLLECTED BY: Client
RECEIVED DATE: 7/16/97
PROJECT DESCRIPT.: 62/0197M

CONTACT: Richard Cox

<u>SAMPLE #</u>	<u>DESCP.</u>	<u>MDL</u>	<i>LEAD (6010A)</i>	<i>ANALYSIS</i>
			<i>Units=mg/kg</i>	
<u>RESULTS</u>	<u>DATE</u>			
L974611-29	M-70	40	920	7/29/97
L974611-30	M-74	26	1900	7/29/97
L974611-31	M-86	35	870	7/29/97
L974611-32	M-87	42	ND	7/29/97
L974611-33	M-90	14	92	7/29/97
L974611-34	M-130	43	4300	7/29/97
L974611-35	M-150	29	3100	7/29/97
L974611-36	M-163	32	3000	7/29/97
L974611-37	M-31	36	2000	7/29/97
L974611-38	M-32	32	ND	7/29/97
L974611-39	M-33	35	4700	7/29/97
L974611-40	M-39	33	440	7/29/97
L974611-41	M-56	23	9700	7/30/97
L974611-42	M-61	15	2100	7/30/97
L974611-43	M-20	31	5300	7/30/97
L974611-44	M-26	49	2600	7/30/97
L974611-45	M-38	38	5000	7/30/97
L974611-46	M-39	48	5300	7/30/97
L974611-47	M-67	34	10,000	7/30/97
L974611-48	M-107	22	2600	7/30/97
L974611-49	M-128	48	6300	7/30/97
L974611-50	M-235	31	670	7/30/97
L974611-51	M-291	17	810	7/30/97
L974611-52	M-292	16	1100	7/30/97
L974611-53	M-312	13	2600	7/30/97
L974611-54	M-315	19	3600	7/30/97
L974611-55	M-321	6.2	440	7/30/97
L974611-56	M-324	13	2000	7/30/97

As a mutual protection, all reports are submitted in confidentiality and may not be reproduced except in full without written authorization.



A member of The Marmon Group of Companies

LABORATORY ANALYSIS REPORT

DATE: July 31, 1997 **PAGE:** 3 Of 4

CLIENT: Midwest Environmental Cons.
5385 401st Ave. NW
Dalbo, MN 55017 **PROJECT NO.:** 071697-200888
COLLECTION DATE: 6/19/97
COLLECTED BY: Client
RECEIVED DATE: 7/16/97
PROJECT DESCRIPT.: 62/0197M

CONTACT: Richard Cox

<u>SAMPLE #</u>	<u>DESCP.</u>	<u>MDL</u>	LEAD (6010A)	<u>ANALYSIS</u>	<u>DATE</u>
			<u>RESULTS</u>		
L974611-57	M-367	32	6200		7/30/97
L974611-58	M-389	8.7	130		7/30/97
L974611-59	M-35	22	270		7/30/97
L974611-60	M-110	22	3800		7/30/97
L974611-61	M-151	33	1000		7/30/97
L974611-62	M-152	28	850		7/30/97
L974611-63	M-14	38	160		7/31/97
L974611-64	M-167	35	3800		7/31/97
L974611-65	M-6	42	51		7/31/97
L974611-66	M-177	37	440		7/31/97
L974611-67	M-202	530	10,000		7/31/97
L974611-68	M-144	48	6000		7/31/97
L974611-69	M-230	19	1900		7/31/97
L974611-70	M-231	13	1500		7/31/97
L974611-71	M-233	15	3000		7/31/97
L974611-72	M-234	8.9	4100		7/31/97

ND means Not Detected or below reported MDL

MDL means Method Detection Limit

mg/L means Milligrams Per Liter which is equivalent to Parts Per Million (ppm)

As a mutual protection, all reports are submitted in confidentiality and may not be reproduced except in full without written authorization.




A member of The Marmon Group of Companies

LABORATORY ANALYSIS REPORT

DATE:	<i>July 31, 1997</i>	PAGE:	<i>4 Of 4</i>
CLIENT:	<i>Midwest Environmental Cons. 5385 401st Ave. NW Dalbo, MN 55017</i>	PROJECT NO.:	<i>071697-200888</i>
		COLLECTION DATE:	<i>6/19/97</i>
		COLLECTED BY:	<i>Client</i>
		RECEIVED DATE:	<i>7/16/97</i>
		PROJECT DESCRIPT.:	<i>62/0197M</i>
CONTACT:	<i>Richard Cox</i>		

This report has been reviewed by me for technical accuracy and completeness. The analyses were performed using EPA or other approved methodologies and the results were reported on an "as received" basis unless otherwise noted. Organic soil analyses were reported on a dry weight basis. The results reported relate only to the items tested. Please contact me if you have any questions or comments regarding this report. Spectrum Labs, Inc. appreciates the opportunity to provide this analytical service for you.

Report Submitted By,




*Thomas L. Halverson
Laboratory Manager*

*TLH:wmc
mec212-3*

As a mutual protection, all reports are submitted in confidentiality and may not be reproduced except in full without written authorization.



A member of The Marmon Group of Companies

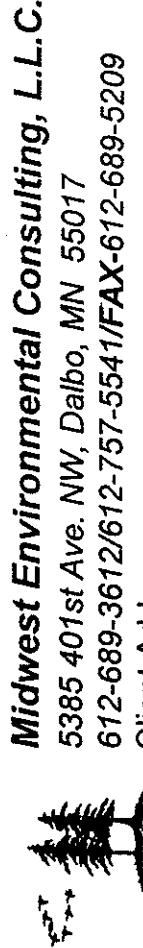

Midwest Environmental Consulting, L.L.C.

5385 401st Ave. NW, Dalbo, MN 55017

612-689-3612/612-757-5541/FAX-612-689-5209

Client Address _____

Contact _____

CHAIN OF CUSTODY RECORD

Project Number 62/6197M
 Client S. Paul School District
 Project Highland Jr. High School
 Phone/Fax _____

Sample ID	Sample Description	Collection Date/Time	Matrix (Vol/Area)	Analysis Requested
4-12-97-9	SE Entry - Door Jam - Brown	6-19-97	—	Pb % wt. or ppm
4-12-97-10	Hall 1 - Ceiling Hatch - White	—	—	—
4-12-97-11	Hall 1 - Electric Panel - Gray	—	—	—
4-12-97-12	Gym A - Middle Wall - White	—	—	—
4-12-97-13	Hall 2 - Middle Wall - White	—	—	—
4-12-97-14	27-3 - Bulletin Board Trim - Blue	—	—	—
4-12-97-15	27-3 - Lawyer Wall - Gray	—	—	—
4-12-97-16	27-3 - Door - Gray	—	—	—
4-12-97-17	Hall 4 - Door - Brown	—	—	—
4-12-97-18	Hall 4 - Column - Tan	—	—	—
4-12-97-19	Hall 5 - Door - Red	—	—	—
4-12-97-20	Hall 5 - Window Casing - Brown	—	—	—
4-12-97-21	Hall 5 - Radiator - Brown	—	—	—
4-12-97-22	Hall 6 - Column - Brown	—	—	—

Sampled By: Bryan Angstrom Date: 6-19-97 Time: _____

Received By: _____ Date: _____ Time: _____


Received By Lab: B.B. Date: 7/16 Time: 11:30A Disposition of Samples _____

Notes: Site 4

Delivered By: Greg A. Myers Date: 7/16/97 Time: 11:20A

Delivered By: _____ Date: _____ Time: _____

Disposition of Samples _____

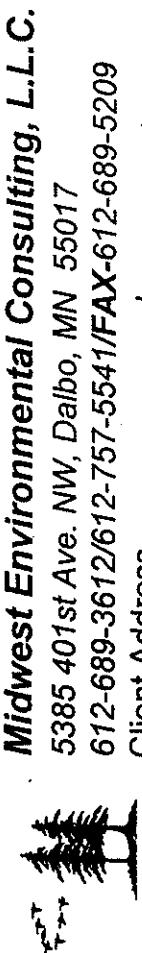**Midwest Environmental Consulting, L.L.C.**

5385 401st Ave. NW, Duluth, MN 55017

612-689-3612/612-757-5541/FAX-612-689-5209

Client Address Georges Recycled Co.Contact George Angstrom**CHAIN OF CUSTODY RECORD**Project Number 62/0197M

Client St. Paul School District

Project Holland Park Jr. High School

Phone/Fax

Sample ID	Sample Description	Collection Date/Time	Matrix (Vol/Area)	Analysis Requested
B-62/0197M 4-16-97	5 - Radiator - white	6-19-97	→	Pb % wt. or ppm
4-16-97	14 - Column - Orange	→		
14	112	→		
17	4-16-97 Restroom 1 - Wall Hatch - Tan	→		
18	153 4-24-97 324 - Cabinet Door (inside) - Varnish	→		
19	16 4-24-97 326 - Door Pullion - Brown	→		
20	28 4-24-97 327 - Shelf Bracket - Tan	→		
21	38 4-24-97 328 Restroom 2 - Radiator - Cream	→		
22	56 4-24-97 1C - Electric Panel - Green	→		
23	69 4-24-97 330 - Cabinet (outside) - Varnish	→		
24	85 4-24-97 93 Hallway 1 - Middle wall - white	→		
25	93 4-24-97 95 Hallway 1 - Elevation 1st floor Brown	→		
26	95 4-24-97 49 Hallway 1 - Upper wall Defeater - Green	→		
27	49 4-24-97 167 Hallway 1 - Locker - Orange	→		
28	28 4-24-97 Restroom 3 - Shelf Backet - Black	→		

Sampled By: George Angstrom Date: 6-19-97 Time: _____ Delivered By: George Angstrom Date: 7/16/97 Time: 11:20am

Received By: _____ Date: _____ Time: _____ Delivered By: _____ Date: _____ Time: _____

Received By Lab: B.B. Date: 7/16 Time: 1:30A Disposition of Samples _____

Notes: Side 4

Midwest Environmental Consulting, L.L.C.

5385 401st Ave. NW, Duluth, MN 55017

612-689-3612/612-757-5541/FAX-612-689-5209

Client Address _____

Contact _____

Deg Myers / Stewart Cox



CHAIN OF CUSTODY RECORD

Project Number 6/2/017M

Client St. Paul School District

Project Highland Park Jr. High School

Phone/Fax _____

Sample ID	Sample Description	Collection Date/Time	Matrix (Vol/Area)	Analysis Requested
29 B-62/0197M-70	Restroom 4 - Backdoor - Tan	6-19-97	—	Pb % wt. or ppm
30 4-26-97 74	Restroom 4 - Hatch - Gray	—	—	—
31 4-26-97 86	Hall 2 - Locker - Blue	—	—	—
32 4-26-97 92	Hall 2 - Backdoor - Gray	—	—	—
33 4-26-97 90	120 - Upperwall - Purple	—	—	—
34 130	Restroom 5 - Backdoor - Gray	—	—	—
35 4-26-97 150	Restroom 6 - Hatch - Gray	—	—	—
36 165	28 - Door Jam - Brown	—	—	—
37 5-7-97	Cabinet - wall register - Tan	—	—	—
38 5-7-97	Cabinet - Access Panel - Green	—	—	—
39 5-7-97	Cabinet - Fire Extinguisher - Tan	—	—	—
40 5-7-97	Cabinet 1 - Handle - Brown	—	—	—
41 5-7-97	Kitchen Door	Grey	—	—
42 5-7-97	Kitchen Column	White	—	—

Sampled By: Bryan Angstrom Date: 6-19-97 Time: _____ Delivered By: Greg Ayres Date: 7/16/97 Time: 11:20 a

Received By: _____ Date: _____ Time: _____ Delivered By: _____ Date: _____ Time: _____

Received By Lab: B.B. Date: 7/16 Time: 1:30 A Disposition of Samples _____

Notes: Side 4


Midwest Environmental Consulting, L.L.C.
 5385 401st Ave. NW, Duluth, MN 55017
 612-689-3612/612-757-5544/FAX-612-689-5209
 Client Address _____
 Contact _____

CHAIN OF CUSTODY RECORD

Project Number 62/0197M
 Client St. Paul School District
 Project Hazardous Material Survey
 Phone/Fax _____


Sample ID	Sample Description	Collection Date/Time	Matrix (Vol/Area)	Analysis Requested
4011-43	5-3251 Room 111 window brown	6-19-97	—	Pb% w/t. or ppm
44	5-3249 Room 111 shelf cream	—	—	—
45	5-3247 Room 114 wall brown	—	—	—
46	5-3249 Room 116 registered grey	—	—	—
47	5-3249 Room 110A door grey	—	—	—
48	5-3249 Room 108 steel grey	—	—	—
49	5-3249 Room 108B aluminum grey	—	—	—
50	5-3249 Room 112 comf. white	—	—	—
51	5-3249 Room 115 wall white	—	—	—
52	5-3249 Room 115 wall orange	—	—	—
53	5-3249 Room 113 panel white	—	—	—
54	5-3249 Room 113A wall white	—	—	—
55	5-3249 Room 113C wall white	—	—	—
56	5-3249 Room 113D wall white	—	—	—

Sampled By: John Gour Date: 6-19-97 Time: 11:20a
 Received By: _____ Date: _____ Time: _____

Received By Lab: Bob Date: 7/10 Time: 11:30a
 Disposition of Samples _____

Notes:

Side 4

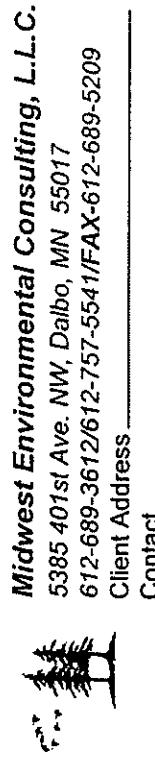

CHAIN OF CUSTODY RECORD

Project Number 602/6197n
Client St. Paul School District
Project Highland Park Jr. High School
Phone/Fax _____

Sample ID	Sample Description	Collection Date/Time	Matrix (Vol/Area)	Analysis Requested
57	5-31-97 Room 114C D. b. grey	6-19-97	—	Pb % Hg or ppm
58	5-31-97 Room 104 wall white	—	—	—
59	5-31-97 Room 102B wall dry white	—	—	—
60	5-31-97 Room 34 bench red	—	—	—
61	5-31-97 Room 71.5 wall tan	—	—	—
62	5-31-97 Room 11.5 wall tan	—	—	—
63	5-31-97 Room 80 door brown	—	—	—
64	5-31-97 outside beam brown	—	—	—
65	5-31-97 outside trim brown	—	—	—
66	5-31-97 outside pipe brown	—	—	—
67	5-31-97 Room 75 hock grey	—	—	—
68	5-31-97 Room 34 hatch grey	—	—	—
69	5-23-97 Room 112 wall cream	—	—	—
70	5-23-97 Room 113 wall red	—	—	—

Sampled By: Sean Goss Date: 6-19-97 Time: _____
Received By: _____ Date: _____ Time: _____
Received By Lab: B.H. Date: 7/16 Time: 11:30 A

Notes: _____
Site 4

Delivered By: _____ Date: 7/16/97 Time: 11:20 a
Delivered By: _____ Date: _____ Time: _____
Disposition of Samples _____

APPENDIX C INSPECTORS

**Roger Jeremiah
MDH Lead Inspector # 139**

**Michael Buck
MDH Lead Inspector #140**

**Bryan Angstman
MDH Lead Inspector #467**

**Patrick Leahy
MDH Lead Inspector #237**

**John Allen
MDH Lead Inspector #236**