


Midwest
Environmental
Consulting, L.L.C.

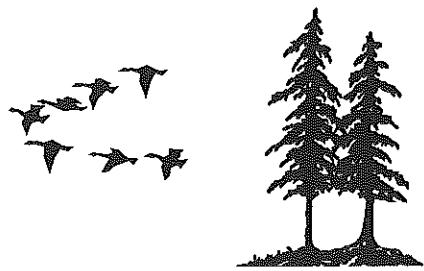

Printed on Recycled Paper

**Wilson EXPO for Excellence Middle School
Saint Paul Public Schools**

Lead-Based Paint Inspection

**Inspection Dates: 2/3/98, 2/9/98, 2/17/98, 2/18/98,
2/19/98, 2/25/98, 3/10/98, 3/11/98**

submitted to:

Saint Paul Public Schools

MEC Project # 62/0197BG

INTRODUCTION

At the request of Saint Paul Public Schools Environmental Safety Department, Midwest Environmental Consulting, L.L.C. (MEC), conducted a lead-based paint inspection at Wilson EXPO for Excellence Middle School, 631 N. Albert Street, St. Paul, MN. The purpose of this inspection was to identify lead-based painted, varnished, or otherwise coated building components on the interior and exterior of the school building.

The inspection protocol incorporated applicable portions of the U.S. Department of Housing and Urban Development (HUD) *Guidelines for the Evaluation and Control of Lead-based Paint Hazards in Housing* (HUD Guidelines, June 1995) and OSHA 1926.62 requirements (Lead in Construction). The HUD guidelines are formulated to guide agencies in conducting random sampling of the interiors and exteriors of dwellings and common areas in public housing. The OSHA requirement is designed to minimize worker exposure when working with material containing lead.

The United States Environmental Protection Agency defines "lead-based paint" as a paint or other surface coating that contains lead equal to or in excess of 1.0 milligrams per square centimeter when analyzed by XRF or more than 0.5% by weight (5000 parts per million) by laboratory analysis of a bulk sample.

Minnesota Department of Labor and Industry (MN OSHA) adopted the EPA lead levels for the purpose of enforcing OSHA 1926.62 federal regulations. Detection of lead in dried paint film by XRF is a dependable indicator of levels of lead and is accepted by MN OSHA.

No paint chip samples were collected from this school for laboratory analysis.

For this Saint Paul Public Schools Lead Inspection, all building components were tested on site using a Niton XL® X-ray Fluorescence Spectrum Analyzer⁽¹⁾. Building components included walls, ceilings, floors, moldings, window and door components, door surfaces, and miscellaneous features such as shelves or bookcases. Only painted or glazed surfaces or surfaces which were varnished were tested. Suspended ceilings, structural steel, and corrugated decking were not included in the inspection. Neither anodized (e.g., window sashes) nor plastic (e.g., vinyl baseboard and vinyl mini-blinds) were included in the scope of this inspection.

⁽¹⁾ This is a portable hand held machine that can analyze building components instantly for lead concentrations.

Each building was divided into unique sites based on the year of construction or renovation. Portable classrooms, playgrounds, and other detached buildings were automatically designated as a unique site. Each site was inspected independently assuming differences in painting history and construction characteristics.

SITE DESCRIPTION AND BUILDING HISTORY

According to information provided to MEC by Saint Paul Public Schools, Wilson EXPO for Excellence Middle School was constructed in essentially three phases. The initial phase includes the 77,771 square-foot older section of the building and dates from 1925. The second phase is a 4,472 square foot addition dating from 1964. The third phase is a 1,977 square foot addition from 1992.

For the purpose of this inspection, the 1992 addition was not inspected.

All room and area designations used in this report are depicted on sampling maps found in Appendix A.

XRF SAMPLE RESULTS TABLE

The results of all samples analyzed are listed in the table at the end of this section. The following is a description of the column headings:

Site	Each school is divided into sites based on their unique construction characteristics. Each site has a unique date of construction or major renovation.
Sample #	Each sample taken was given a unique number to identify the type and location of the sample. The sampling date is an integral part of the sample number.
Analysis	This defines the type of analysis which can be categorized into two types: 1) XRF: This is an on-site analysis using a hand held Niton XL® X-ray Fluorescence Spectrum Analyzer; 2) Bulk or Chip: This is a bulk sample where paint is removed from the substrate and sent to a laboratory for analysis;
Floor	This is the level of the building in which the area tested was found, example, 1 (first floor), 0 (basement), etc.

Area	This further defines the specific functional space inspected such as a classroom, exterior, playground, gym, kitchen, etc.
Room #	This is typically the actual number on the room as identified at the building.
Component	Building "components" included walls, ceilings, floors, moldings, window and door components, door surfaces, and miscellaneous features such as shelves or bookcases.
Feature	Identifies more detailed information of the component.
Condition	This describes condition of the surface, whether it is intact, cracked, peeling, or chalking.
Substrate	This refers to the material the building component is made of (wood, concrete, drywall, metal, etc.).
Result	This is the analysis results for lead. Less than 1.0 mg/cm ² or less than 0.5% by weight is considered to be non-lead and these building components are below the action levels of EPA and HUD. (All results are in mg/cm ² except where noted.)

The table of results is designed for quick information on lead concentrations of tested building components. Generally, all repetitions of a test combination within a given room or area, may be assumed to contain similar concentrations of lead to that of the tested sample. For instance, the lead concentration of a tested wooden window sash was found to be above the action level of 1.0 mg/cm² in a given classroom. The classroom has five windows, all of wood, the same color and appearing to be of the same era. It can be assumed that the remaining four wooden window sashes each contain lead above the action limit.

Other columns identify the component and the component feature tested, condition of the component, type of substrate and the result of the analytical test.

As an example, the following illustration shows that the wooden door jamb in Room 123, first floor in the 1923 building section was in good, solid condition, and had an XRF test result of 0.3 mg/cm², which is below the action level.

Illustration Only

Site	Sample #	Date	Analysis	Floor	Area	Room #	Component	Feature	Condition	Substrate	Results
1923 Bldg.	52		XRF	1	Room	123	Door	Jamb	Solid	Wood	0.3

In a similar manner, the table shows that the plaster walls in room 23, on the second floor has peeling paint with more than 1.0 mg/cm² (shaded).

ILLUSTRATION ONLY

Site	Sample #	Date	Analysis	Floor	Area	Room #	Component	Feature	Condition	Substrate	Results
1910 Bldg.	16		XRF	2	Room	23	Door	Jamb	Peeling	Wood	0.25
1910 Bldg.	17		XRF	2	Room	23	Wall	Wall	Peeling	Plaster	1.2
1910 Bldg.	18		XRF	2	Room	23	Ceiling	Peeling	Plaster		0.25
1910 Bldg.	19		XRF	2	Room	23	Wall	Baseboard	Peeling	Wood	0.002

APPLICABLE REGULATIONS


When building components test above 1.0 mg/cm² of lead by XRF or 0.5% lead by weight from laboratory analysis all employees and contractors who will be working with these components in a construction related activity must be notified. The requirements of OSHA 1926.62, Lead in Construction are enforceable. This regulation defines construction work as "work for construction, alteration and/or repair, including painting and decorating." This regulation further defines monitoring requirements to minimize employee exposure to lead during construction activities.

When work is performed on external painted building structures (i.e. flashing, fire escapes, playground equipment, handrails, etc.), regulations of the Minnesota Pollution Control Agency (MPCA) may also be applicable. For removal of lead based paint from steel structures, MN Rules 7025.0200 - 7025.0380 apply to steel materials on the exterior of a building, or on the property when levels exceed 0.5 mg/cm² based on the average of three XRF spectrum results of the sample tested, or 5,000 ppm by laboratory analysis. If it is other than a steel surface, then MPCA regulates the painted surfaces under MN Rules 7025.010 - 7025.0080, when surfaces are to be disturbed using abrasive blasting methods.

Please contact MEC directly if you have questions about any portion of this report or the lead-based paint inspection itself.

APPENDIX A

XRF TESTING DATA WITH LOCATION MAPS


 **BASMENT FLOOR PLAN**


 INDEPENDANT SCHOOL DIST. #625
360 COLBORNE STREET
ST. PAUL, MN 55102


 WILSON / EXPO SCHOOL
631 NORTH ALBERT STREET
ST. PAUL, MN 55104

 CONSTRUCTED:



 DRAWING
2 OF
6

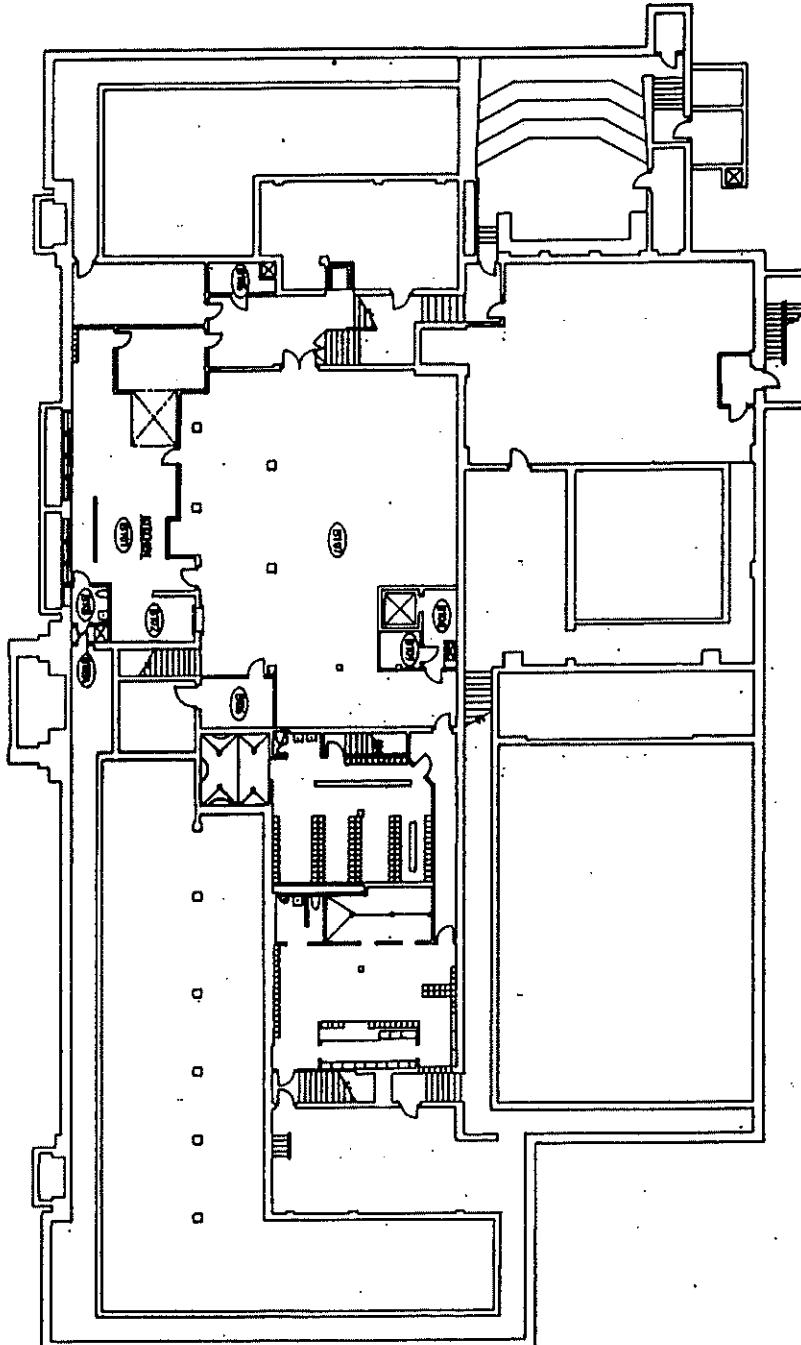

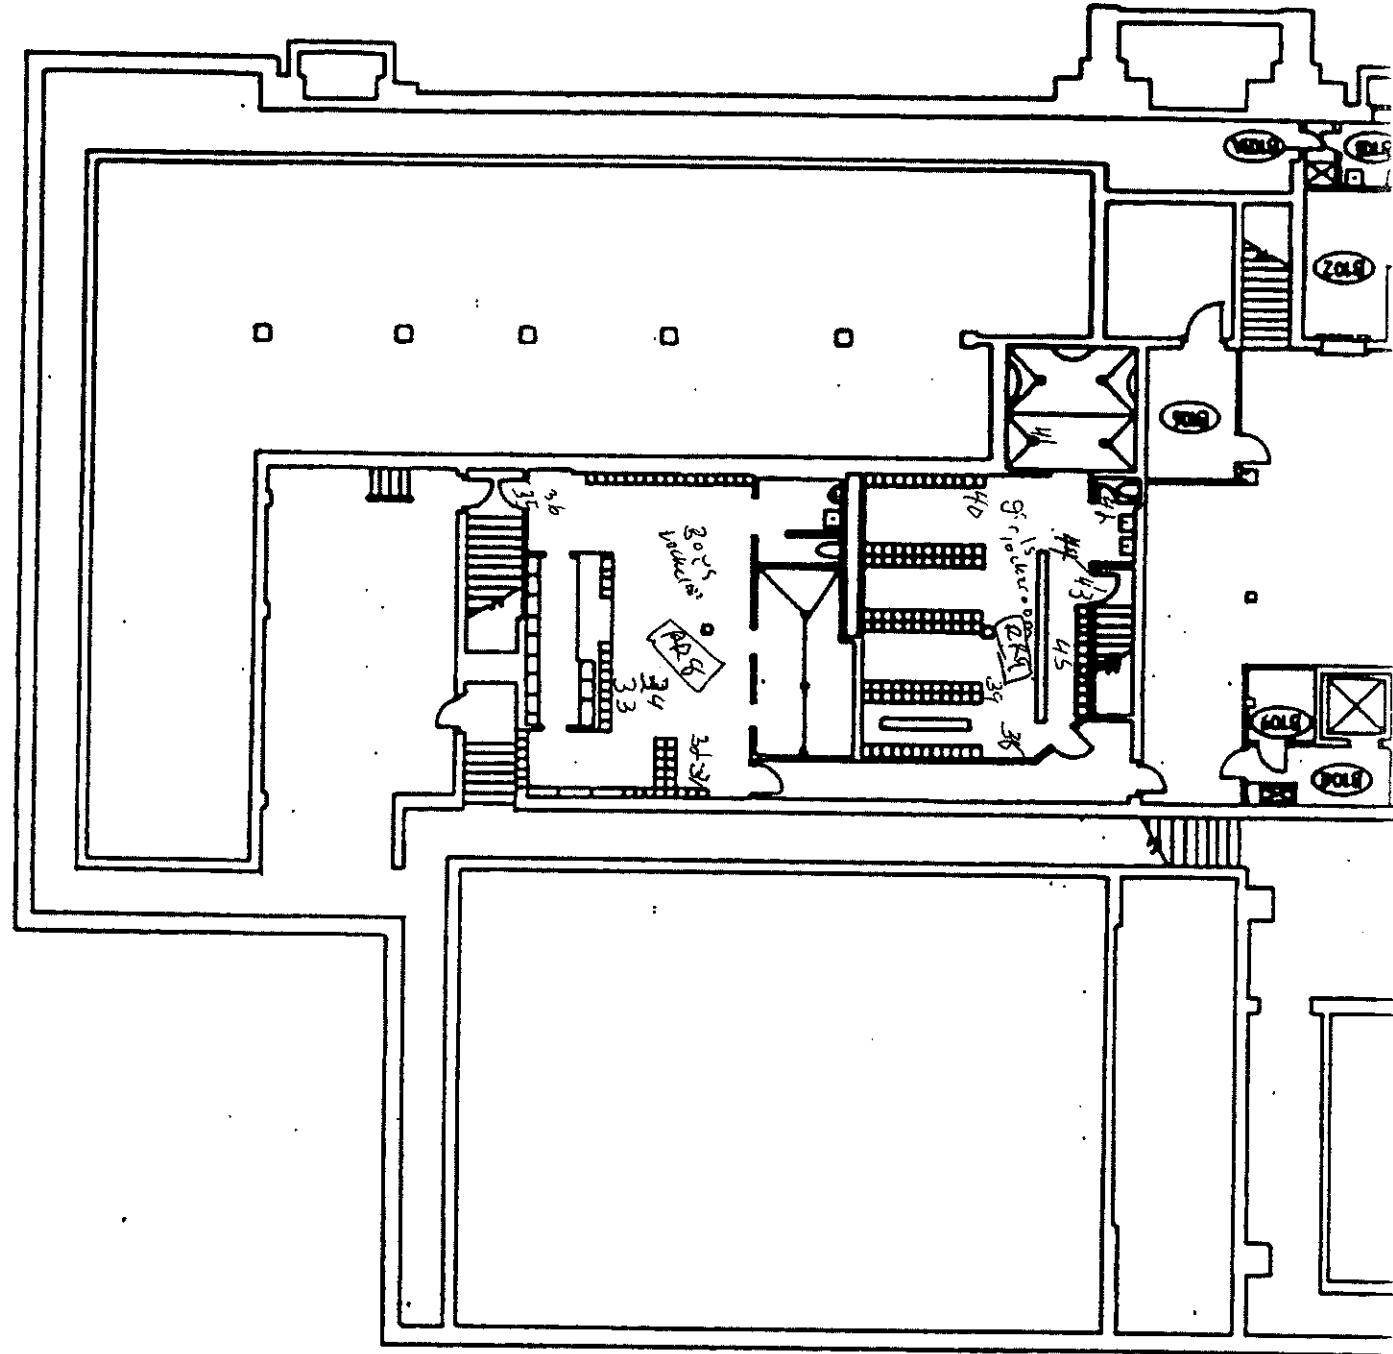

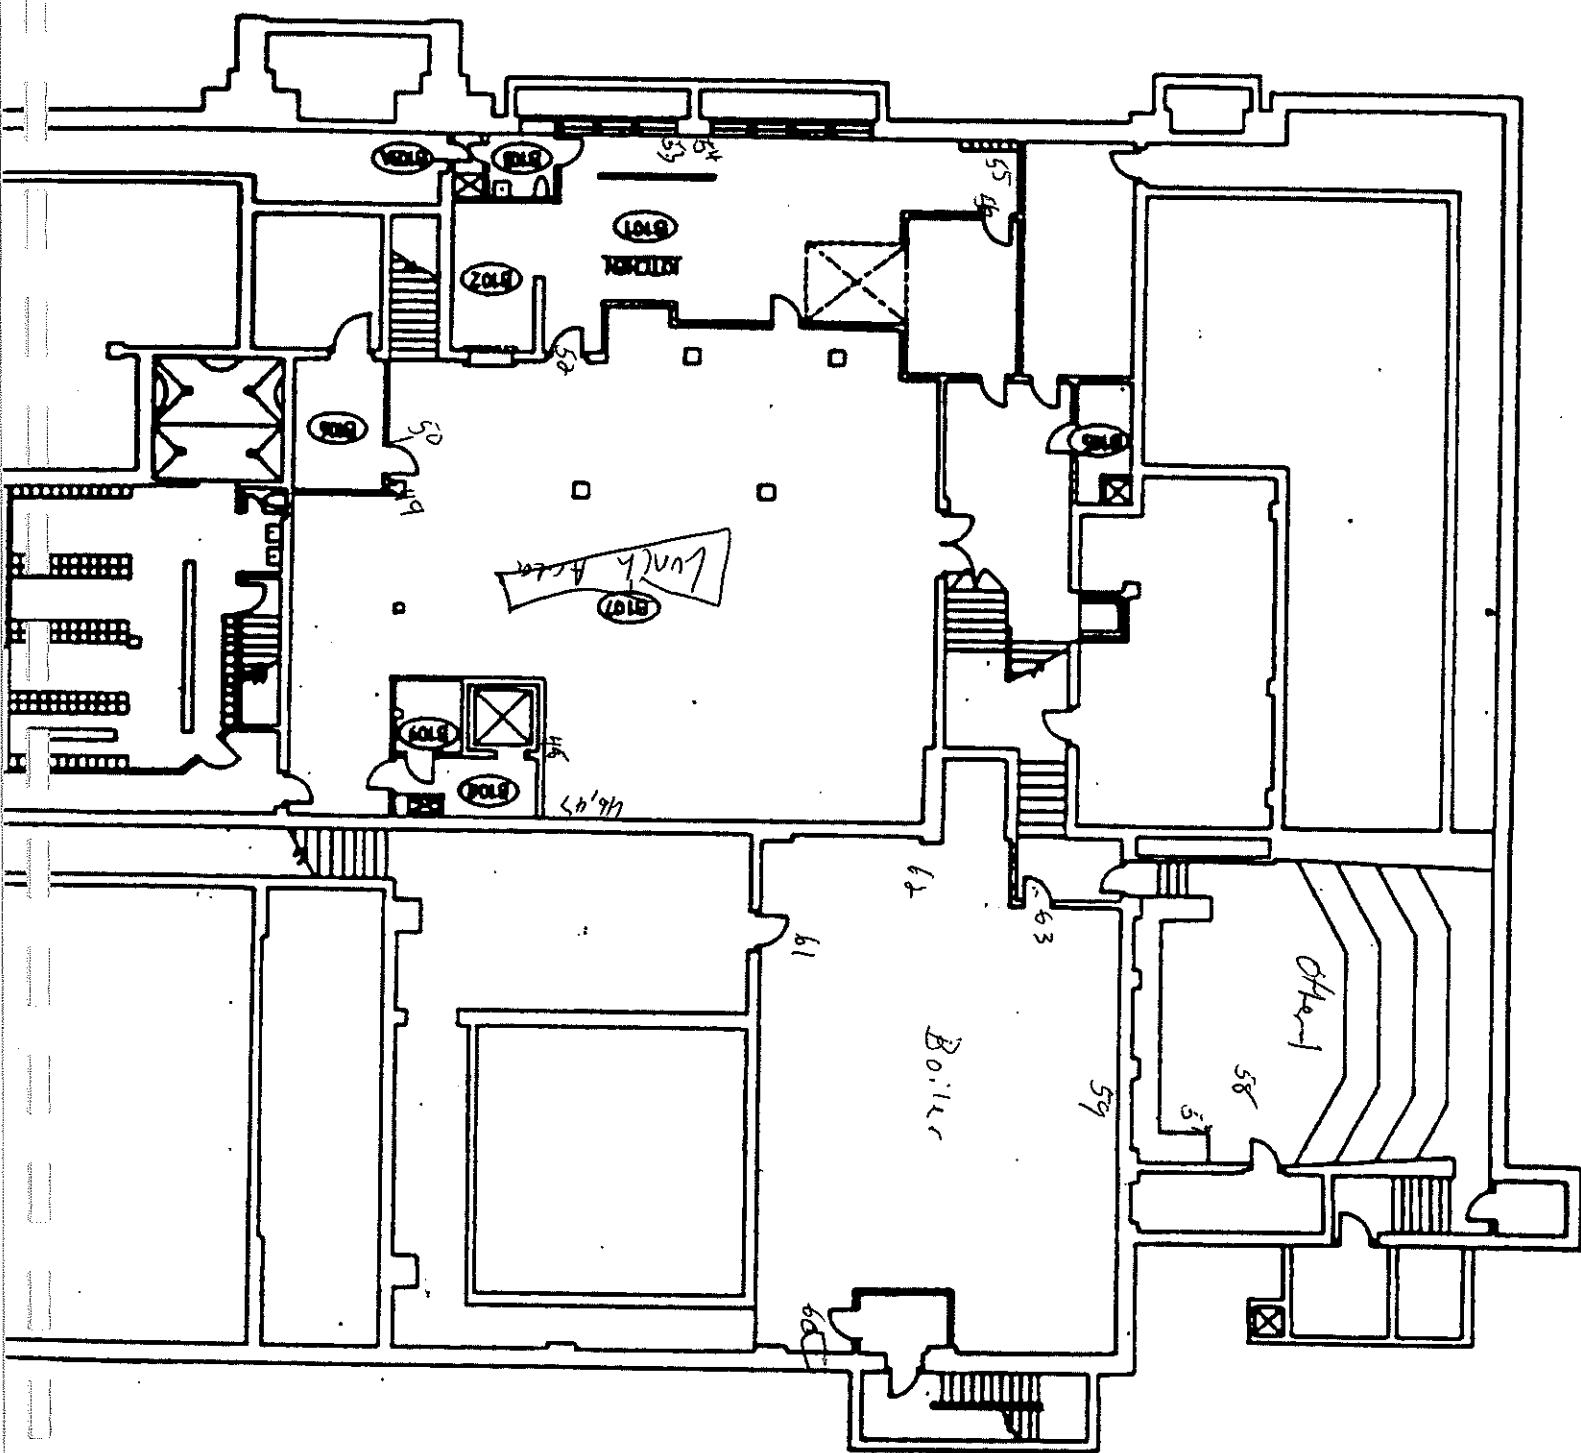

3-11-18
W. Wilson

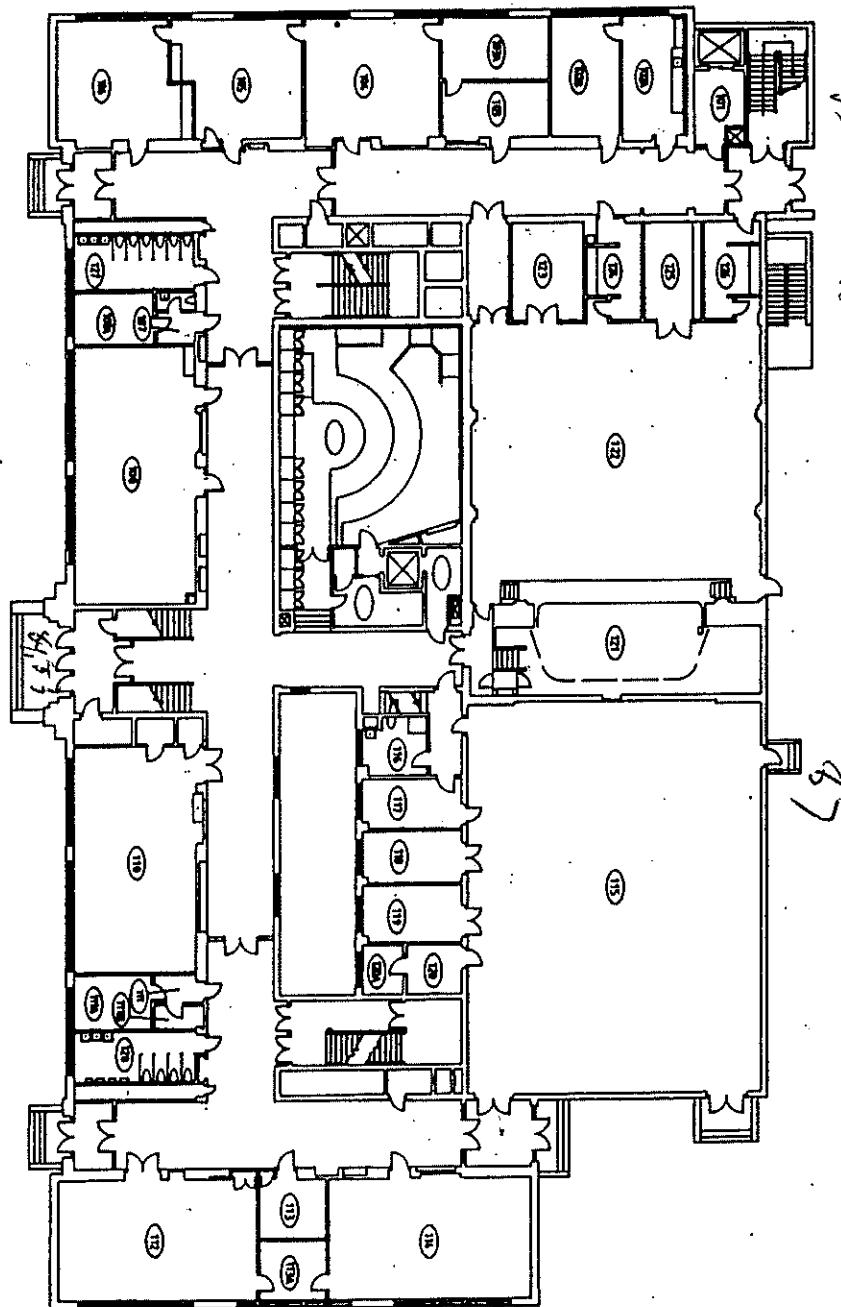

INDEPENDANT SCHOOL DIST. #626
360 COLBOURNE STREET
ST. PAUL, MN 55102


WILSON / EXPO SCHOOL
631 NORTH ALBERT STREET
ST. PAUL, MN 55104


CONSTRUCTED:

3 OF
6

3-11-98-(4112)

(= ceiling)

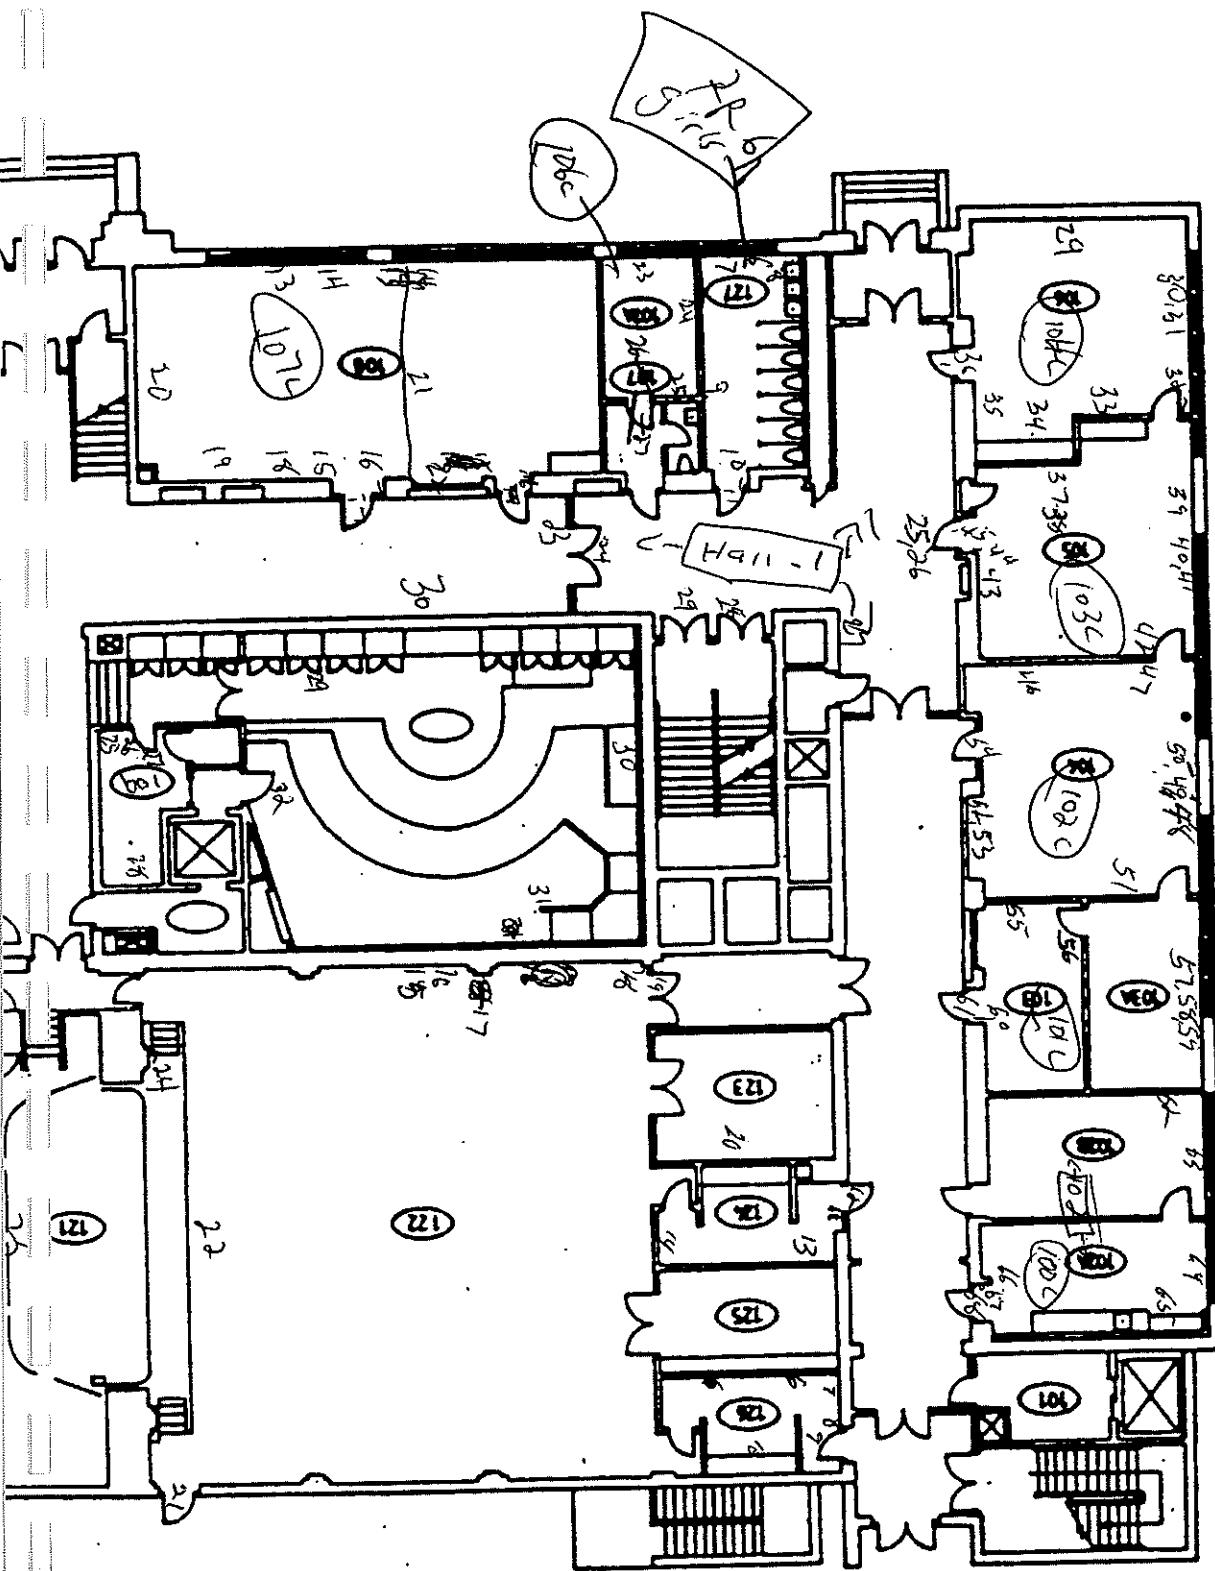


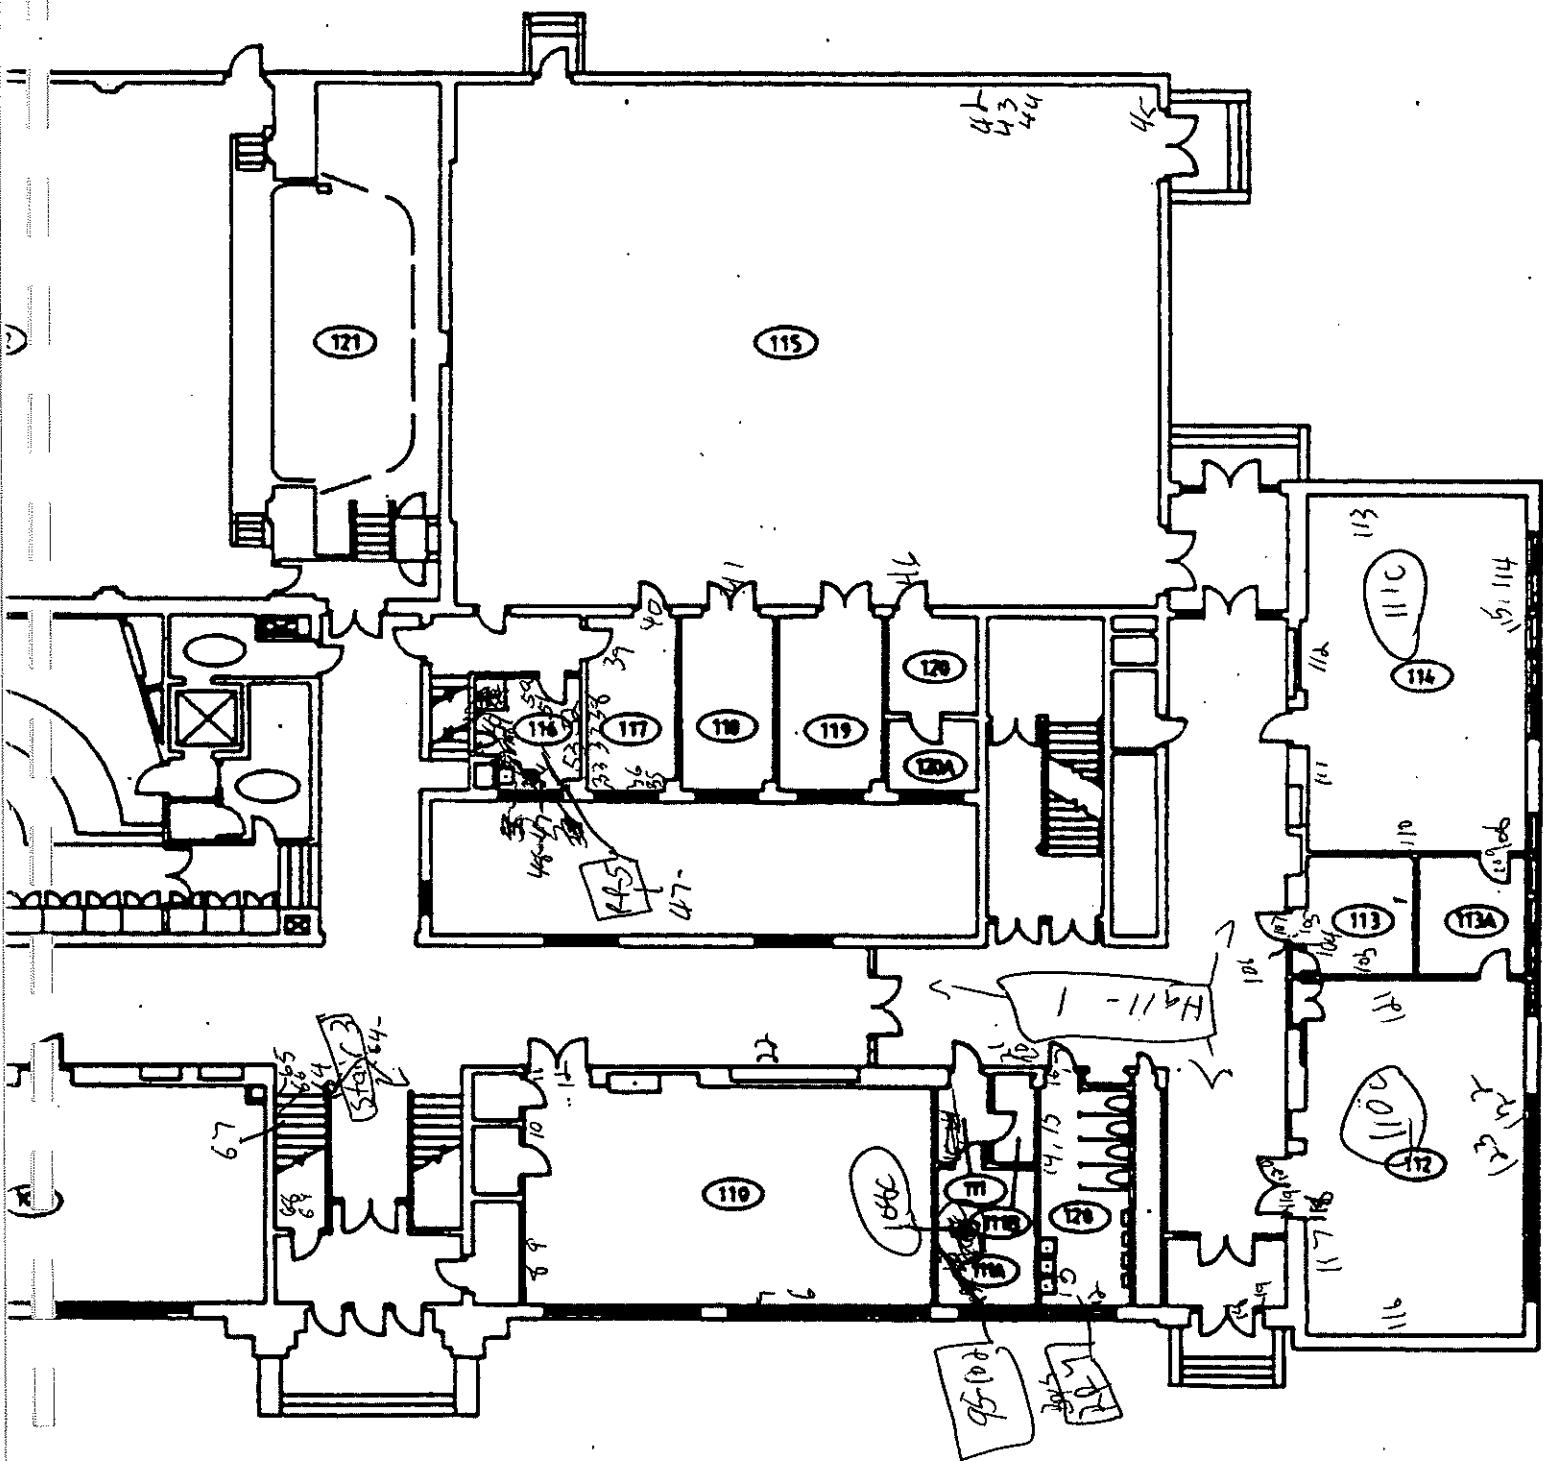

FIRST FLOOR PLAN



SECOND FLOOR PLAN

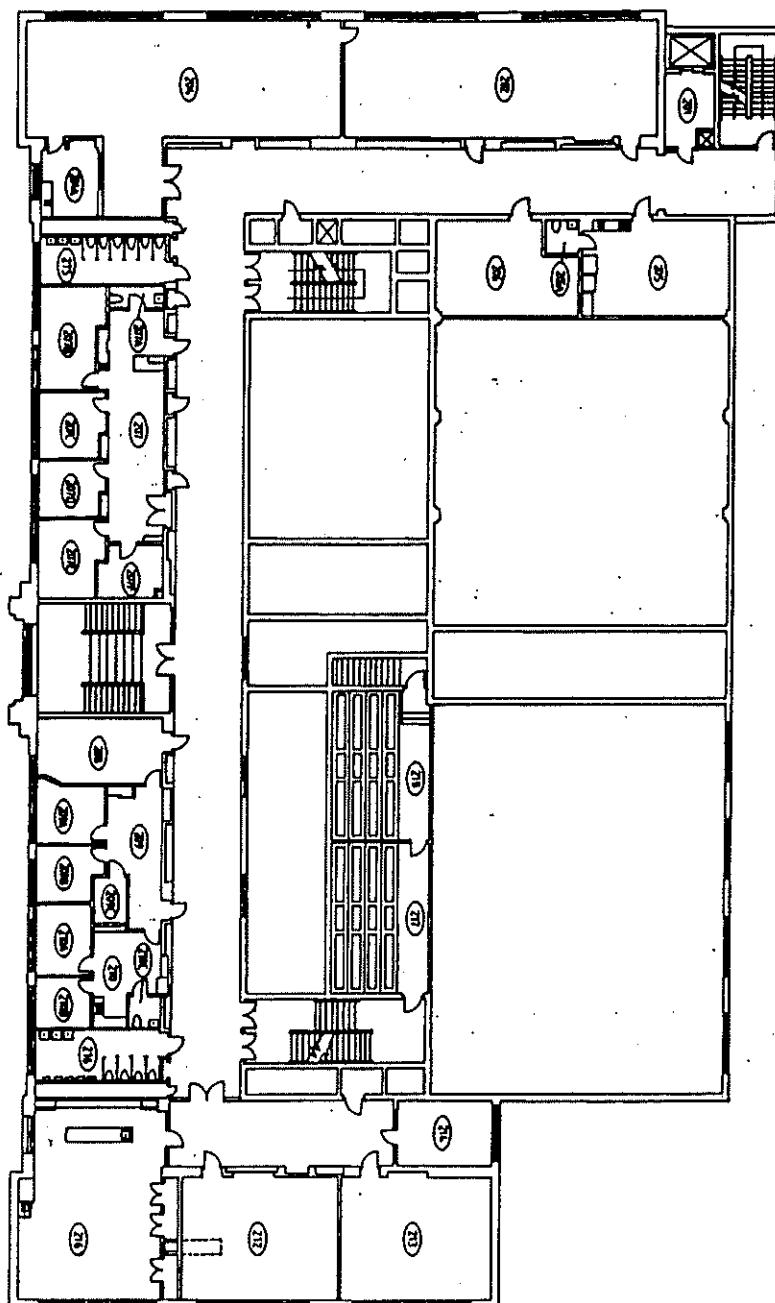


INDEPENDANT SCHOOL DIST. #625
360 COLBORNE STREET
ST. PAUL, MN 55102

WILSON / EXPO SCHOOL
631 NORTH ALBERT STREET
ST. PAUL, MN 55104

CONSTRUCTED:


STREET
4 OF
6

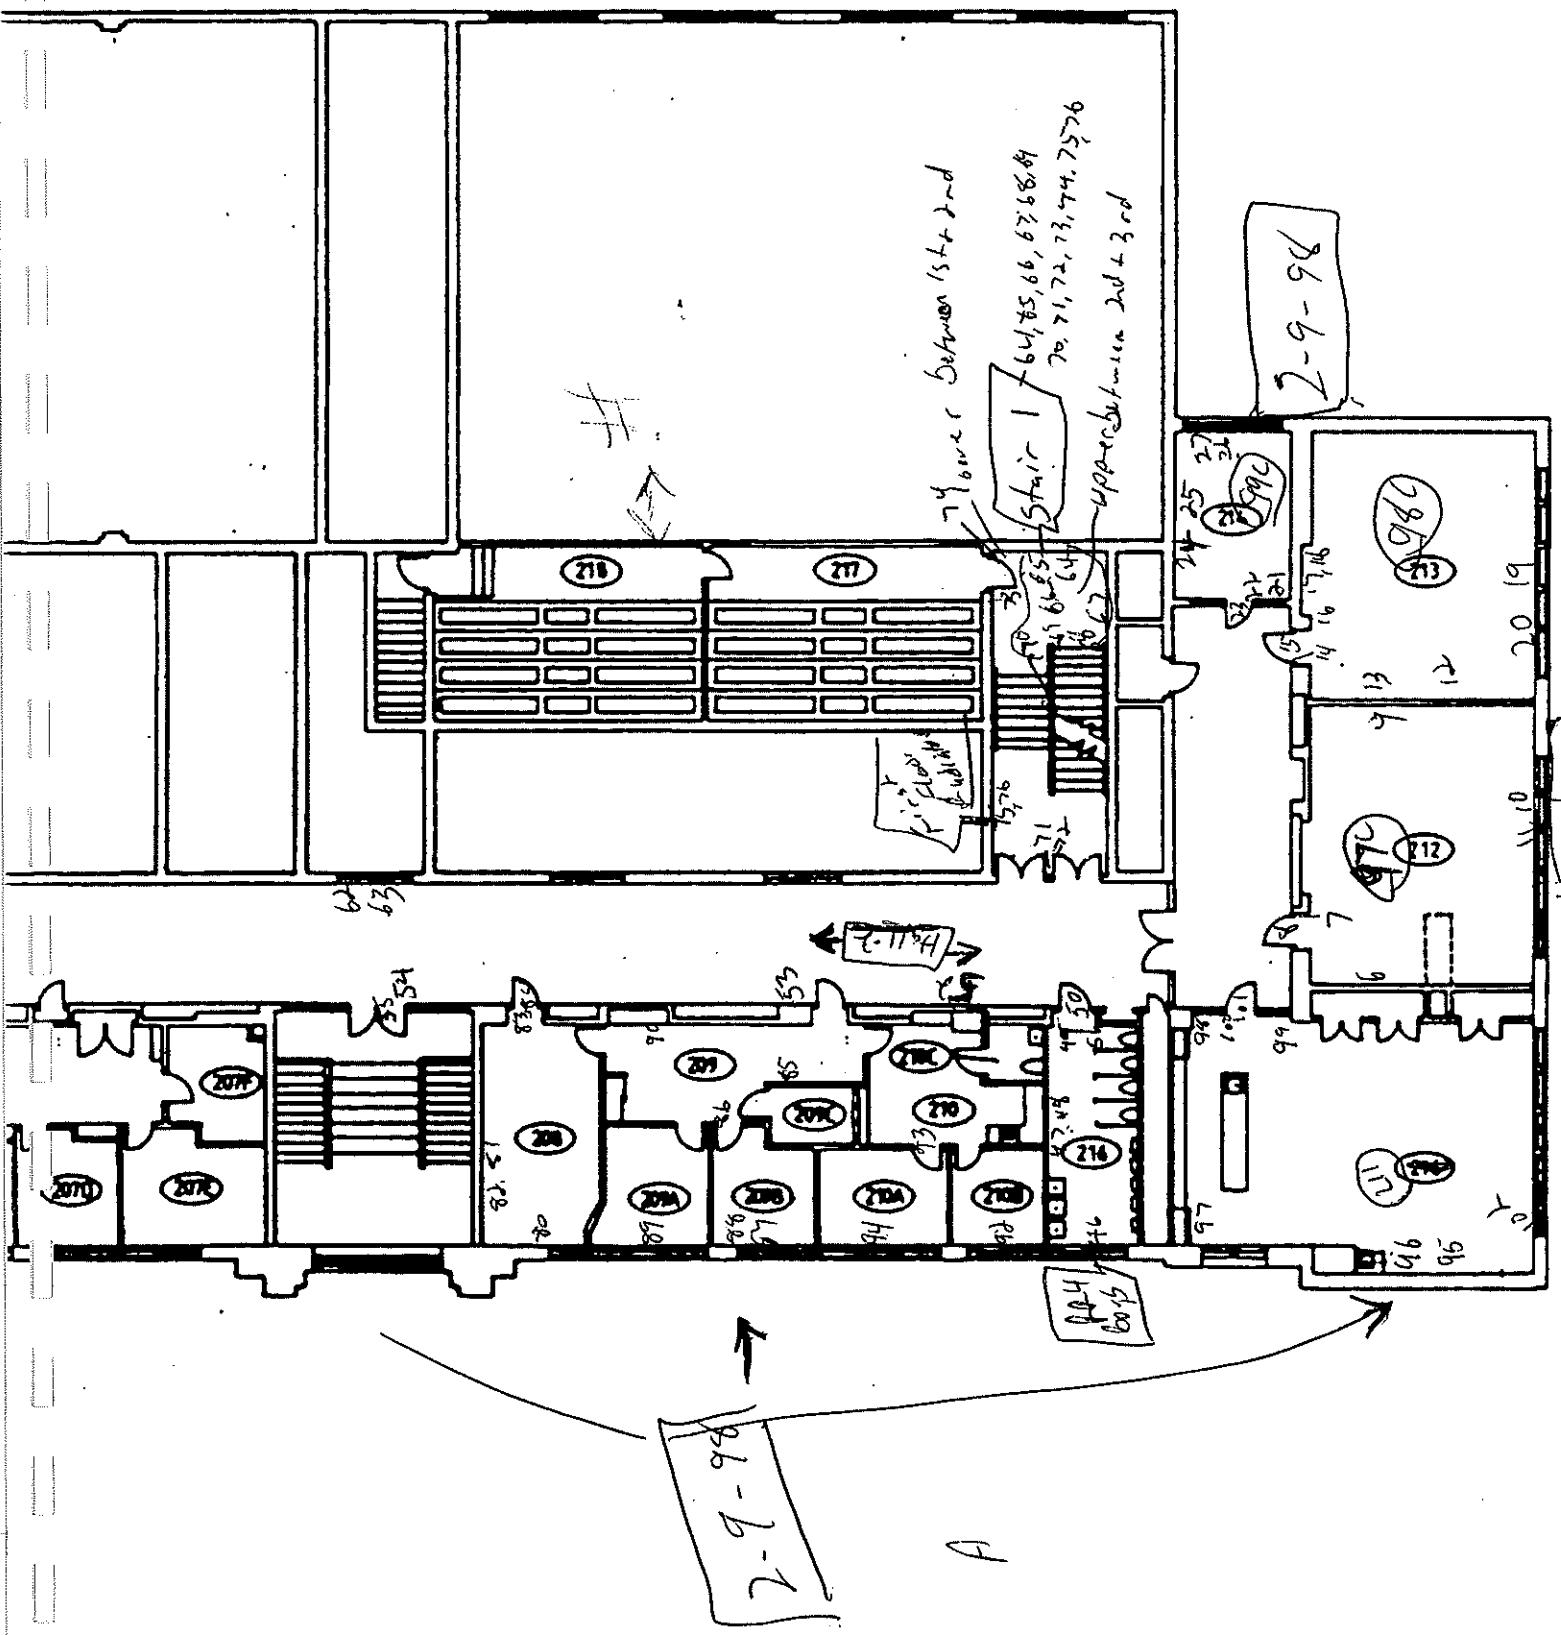


SECOND FLOOR PLAN

3 - 11 - 98

C: Ceilings
S: Stairs

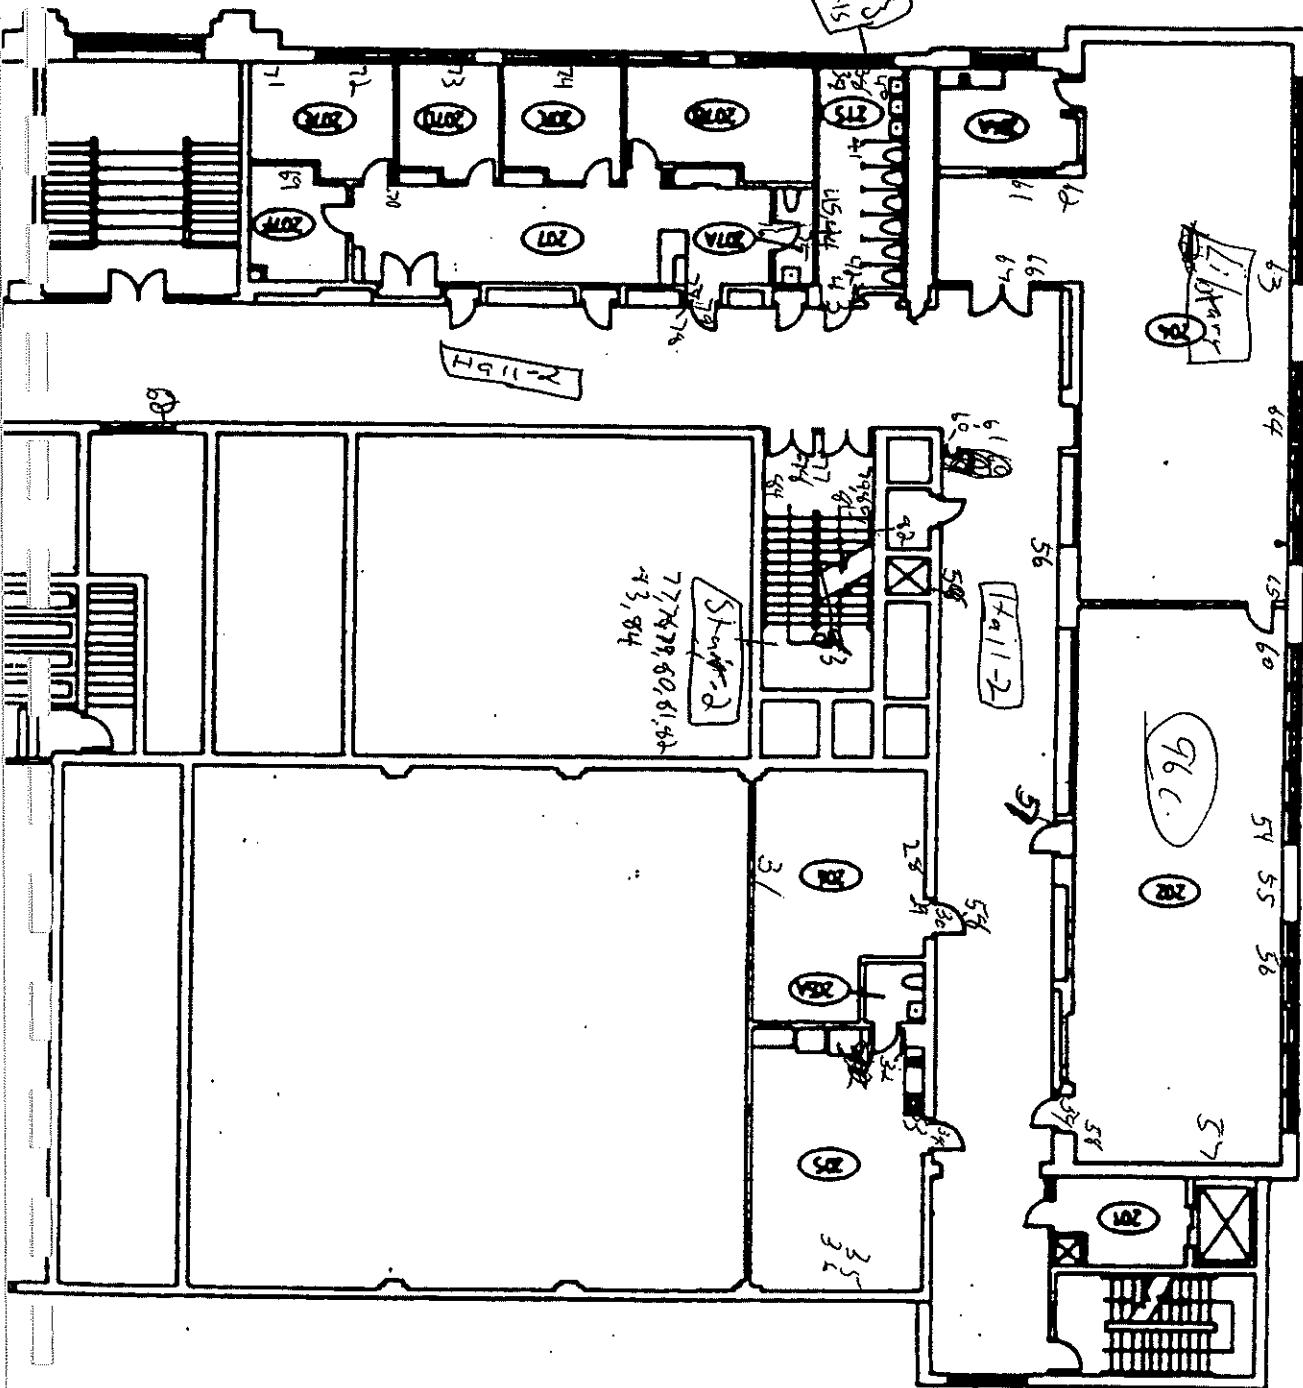

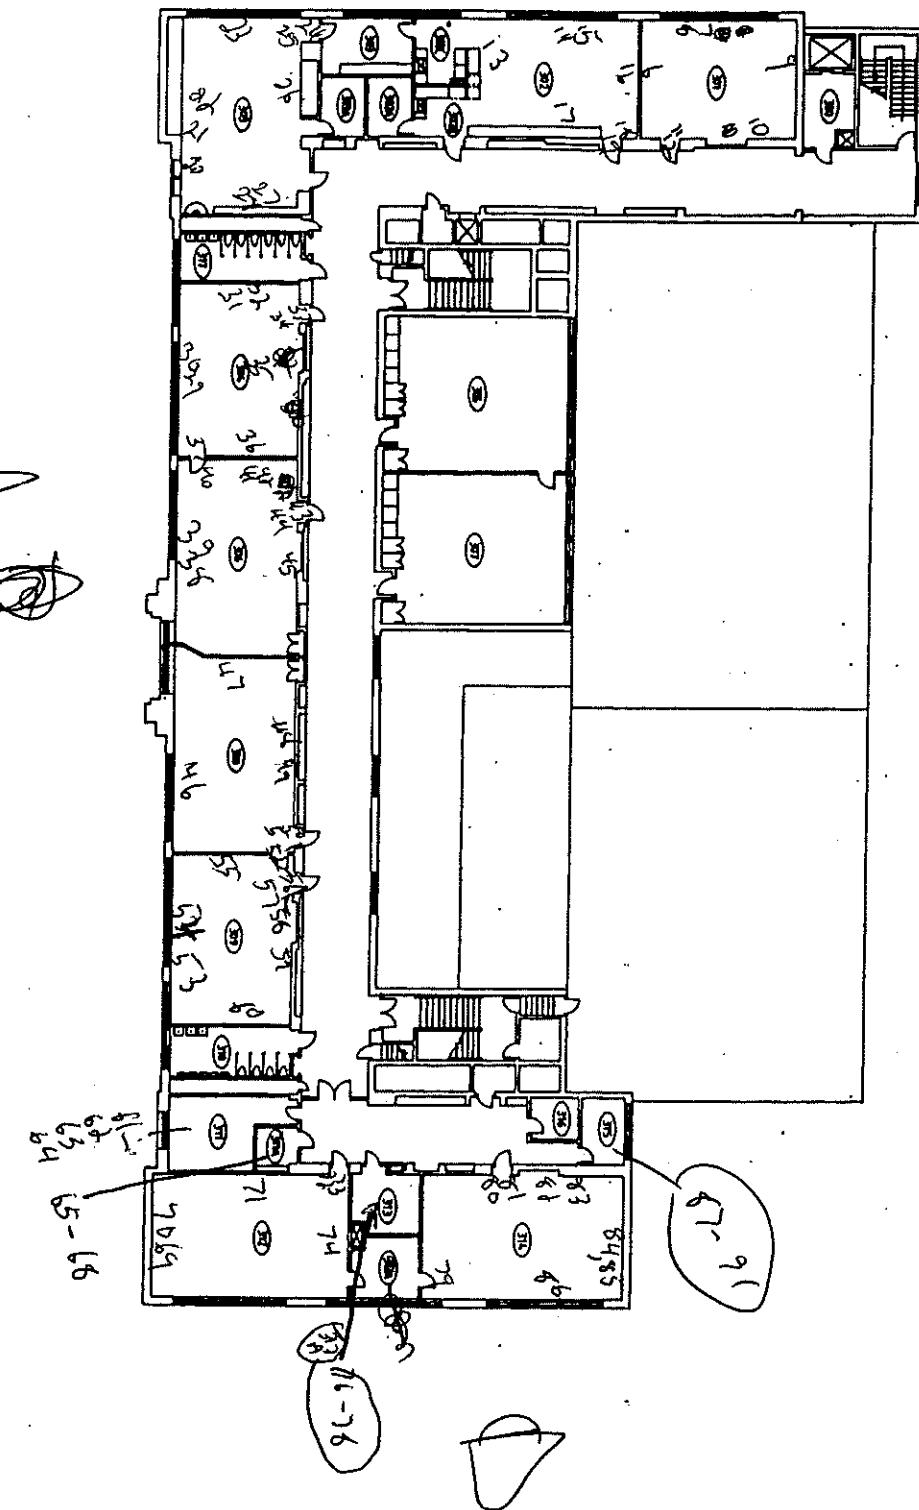


INDEPENDANT SCHOOL DIST. #625
360 COLBORNE STREET
ST. PAUL, MN 55102

WILSON / EXPO SCHOOL
631 NORTH ALBERT STREET
ST. PAUL, MN 55104


CONSTRUCTED:

SHEET
5
OF
6

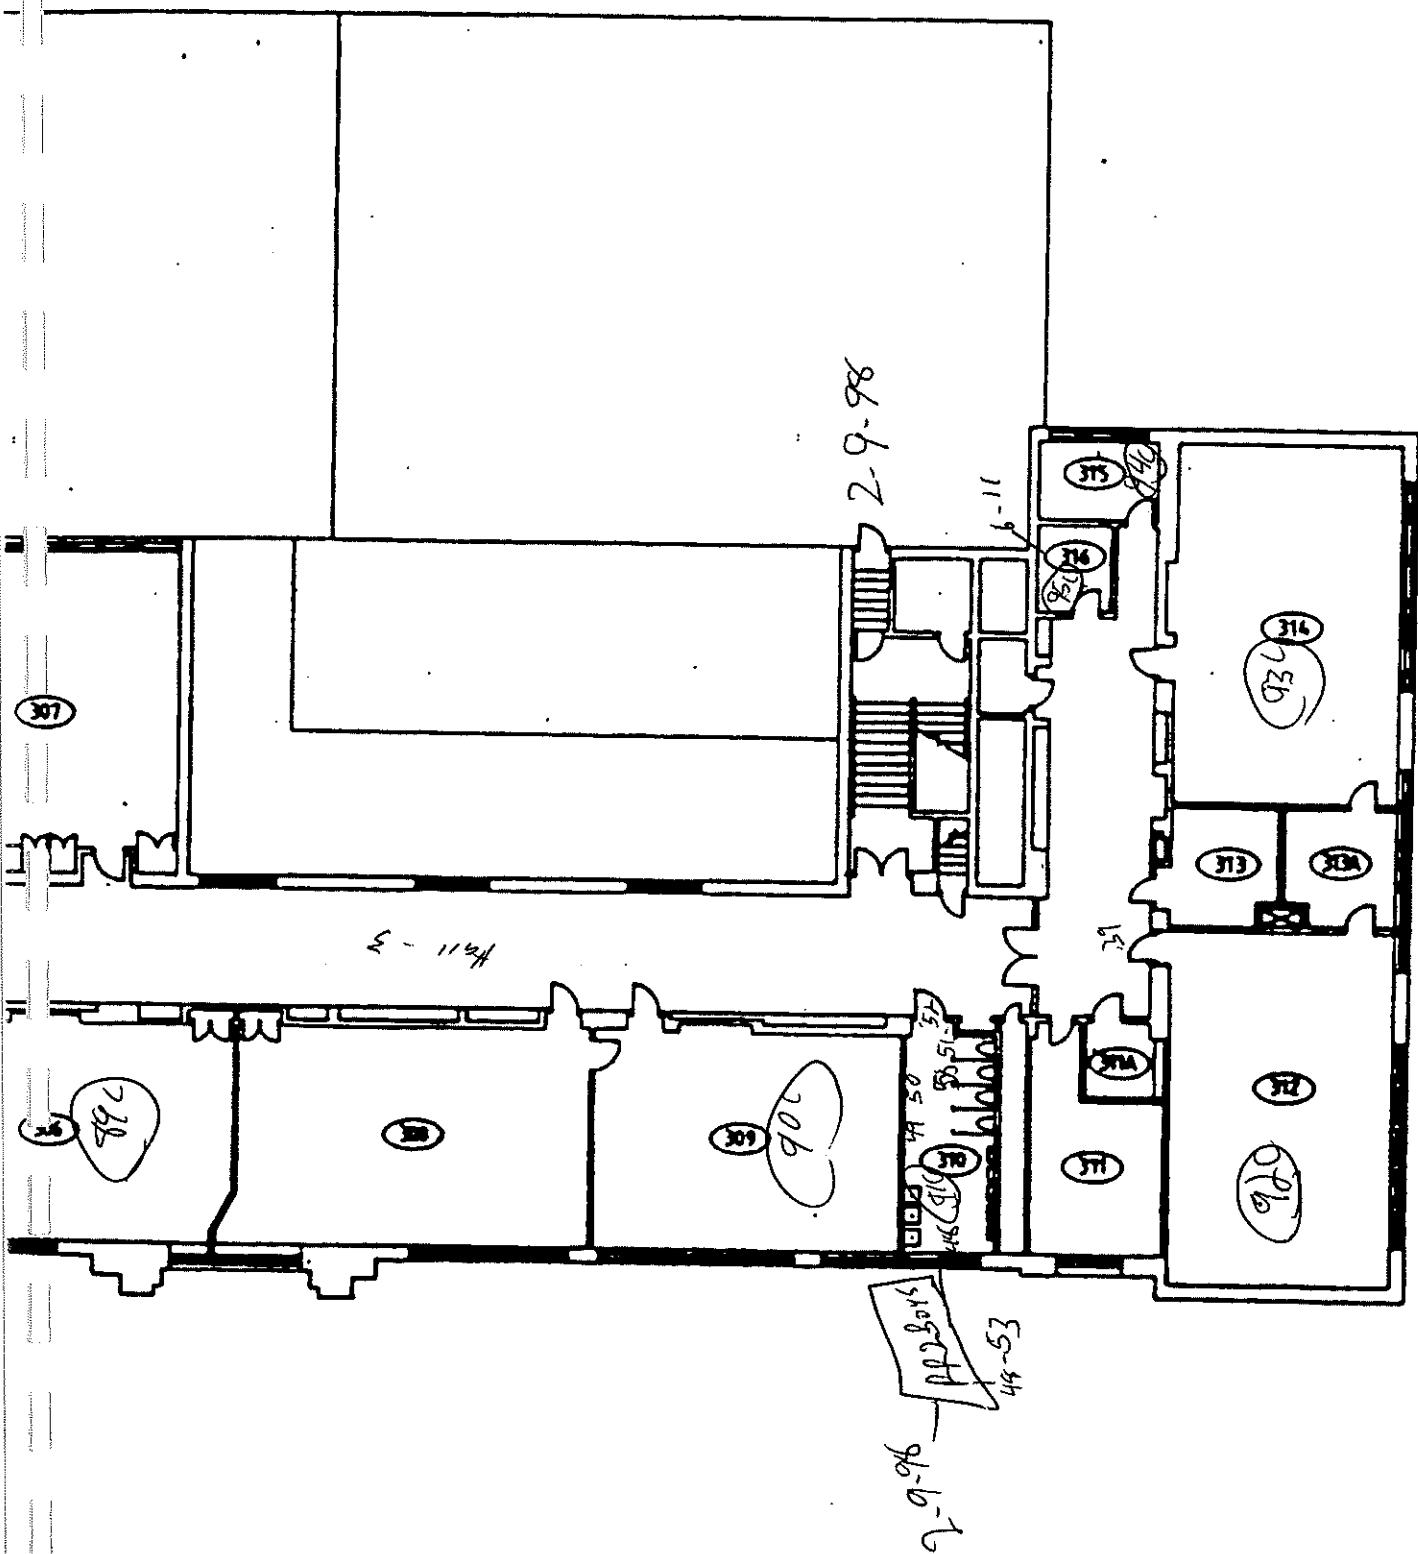

THIRD FLOOR PLAN



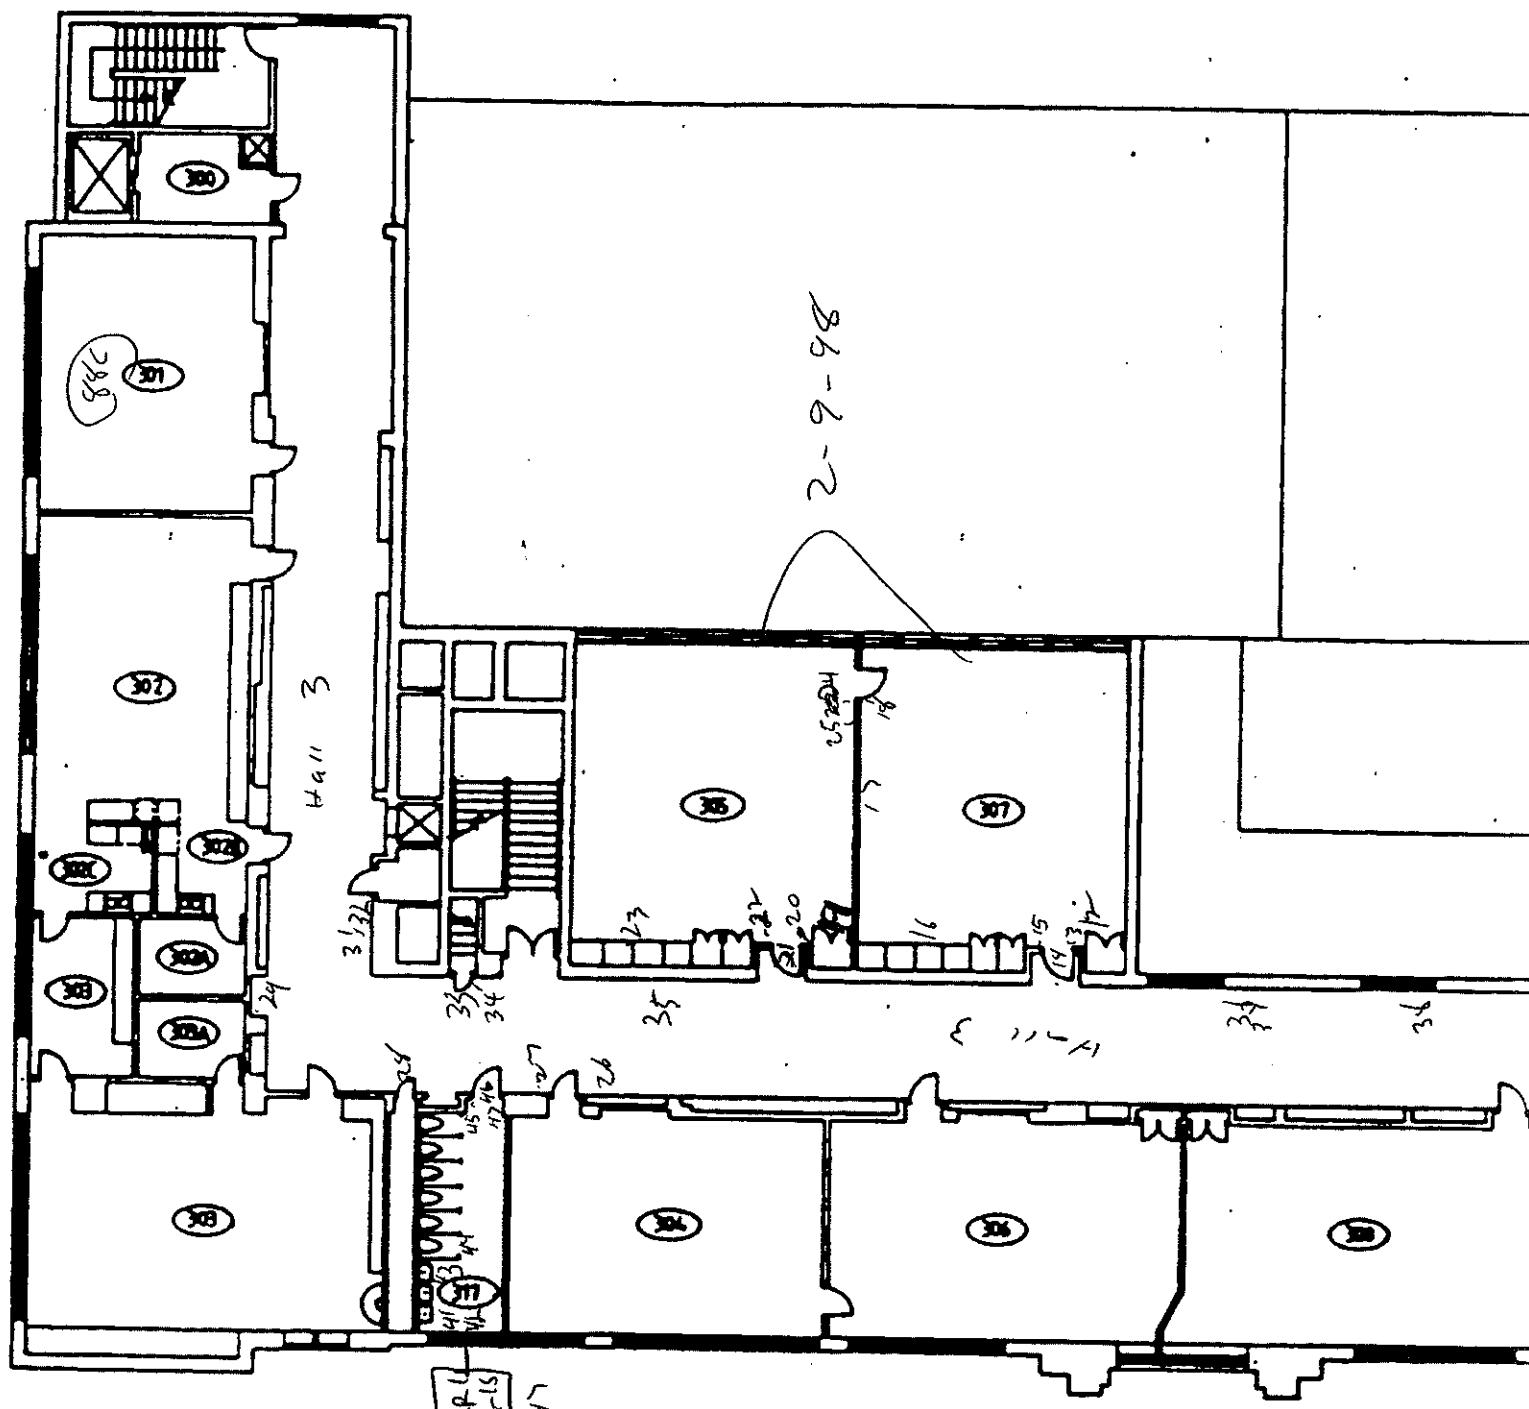

C = Ceiling
3-11-98 Ceilings

2-9-98

A

Saint Paul School District
 Wilson Expo for Excellence Middle School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K
1	Wilson Junior High School										
2											
3	Site	Sample#	Analysis	Date	Floor	Area	Component	Feature	Condition	Substrate	Result
4	1926 Bldg.	62	XRF	3/10/98	0	Boiler Room	Cabinet	Door-Out	Solid	Wood	0.06
5	1926 Bldg.	60	XRF	3/10/98	0	Boiler Room	Door	Door	Peeling	Metal	>>5.0
6	1926 Bldg.	61	XRF	3/10/98	0	Boiler Room	Door	Door	Peeling	Metal	4.45
7	1926 Bldg.	63	XRF	3/10/98	0	Boiler Room	Door	Door	Peeling	Wood	0
8	1926 Bldg.	59	XRF	3/10/98	0	Boiler Room	Wall	Column	Solid	Concrete	0.03
9	1926 Bldg.	56	XRF	2/19/98	1	Classroom-103	Door	Casing-Rht	Solid	Metal	>0.09
10	1926 Bldg.	60	XRF	2/19/98	1	Classroom-103	Door	Casing-Lft	Solid	Wood	0.03
11	1926 Bldg.	61	XRF	2/19/98	1	Classroom-103	Door	Door	Solid	Wood	0.08
12	1926 Bldg.	55	XRF	2/19/98	1	Classroom-103	Wall	Midle Wall	Solid	Drywall	0.03
13	1926 Bldg.	59	XRF	2/19/98	1	Classroom-103	Wall	Midle Wall	Cracked	Plaster	2.12
14	1926 Bldg.	57	XRF	2/19/98	1	Classroom-103	Window	Casing-Lft	Solid	Wood	0.07
15	1926 Bldg.	58	XRF	2/19/98	1	Classroom-103		Radiator	Peeling	Metal	>1.62
16	1926 Bldg.	52	XRF	2/19/98	1	Classroom-104	Bookcase	Shelf	Solid	Wood	0
17	1926 Bldg.	46	XRF	2/19/98	1	Classroom-104	Cabinet	Door-Out	Solid	Wood	0
18	1926 Bldg.	102	XRF	3/11/98	1	Classroom-104	Ceiling		Peeling	Plaster	0
19	1926 Bldg.	47	XRF	2/19/98	1	Classroom-104	Door	Casing-Rht	Solid	Metal	0.19
20	1926 Bldg.	54	XRF	2/19/98	1	Classroom-104	Door	Door	Solid	Wood	0
21	1926 Bldg.	50	XRF	2/19/98	1	Classroom-104	Wall	Wall-Lwr	Solid	Plaster	1.96
22	1926 Bldg.	51	XRF	2/19/98	1	Classroom-104	Wall	Midle Wall	Peeling	Drywall	0
23	1926 Bldg.	53	XRF	2/19/98	1	Classroom-104	Wall	Wall-Upn	Solid	Plaster	0.24
24	1926 Bldg.	48	XRF	2/19/98	1	Classroom-104	Window	Casing-Lft	Solid	Wood	0.05
25	1926 Bldg.	49	XRF	2/19/98	1	Classroom-104		Radiator	Peeling	Metal	2.73
26	1926 Bldg.	103	XRF	3/11/98	1	Classroom-105	Ceiling		Solid	Plaster	0
27	1926 Bldg.	42	XRF	2/19/98	1	Classroom-105	Door	Casing-Lft	Solid	Metal	0.24
28	1926 Bldg.	44	XRF	2/19/98	1	Classroom-105	Door	Casing-Lft	Solid	Wood	0.03
29	1926 Bldg.	45	XRF	2/19/98	1	Classroom-105	Door	Door	Solid	Wood	0.05
30	1926 Bldg.	37	XRF	2/19/98	1	Classroom-105	Wall	Midle Wall	Solid	Drywall	0
31	1926 Bldg.	38	XRF	2/19/98	1	Classroom-105	Wall	Midle Wall	Solid	Drywall	0
32	1926 Bldg.	39	XRF	2/19/98	1	Classroom-105	Wall	Midle Wall	Peeling	Plaster	0.27
33	1926 Bldg.	43	XRF	2/19/98	1	Classroom-105	Wall	Baseboard	Cracked	Wood	0
34	1926 Bldg.	40	XRF	2/19/98	1	Classroom-105	Window	Casing-Rht	Cracked	Wood	0.04
35	1926 Bldg.	41	XRF	2/19/98	1	Classroom-105		Radiator	Peeling	Metal	>>5.0
36	1926 Bldg.	34	XRF	2/19/98	1	Classroom-106	Cabinet	Door-Out	Solid	Wood	0
37	1926 Bldg.	35	XRF	2/19/98	1	Classroom-106	Cabinet	Outside	Peeling	Wood	0.11
38	1926 Bldg.	104	XRF	3/11/98	1	Classroom-106	Ceiling		Solid	Plaster	0
39	1926 Bldg.	105	XRF	3/11/98	1	Classroom-106	Ceiling		Solid	Plaster	0
40	1926 Bldg.	32	XRF	2/19/98	1	Classroom-106	Door	Casing-Rht	Solid	Metal	0.07
41	1926 Bldg.	36	XRF	2/19/98	1	Classroom-106	Door	Door	Solid	Wood	0
42	1926 Bldg.	29	XRF	2/19/98	1	Classroom-106	Wall	Wall-Lwr	Solid	Plaster	0.01
43	1926 Bldg.	33	XRF	2/19/98	1	Classroom-106	Wall	Midle Wall	Solid	Drywall	0
44	1926 Bldg.	31	XRF	2/19/98	1	Classroom-106	Window	Casing-Lft	Solid	Wood	0.08
45	1926 Bldg.	30	XRF	2/19/98	1	Classroom-106		Radiator	Peeling	Metal	0.22
46	1926 Bldg.	18	XRF	2/19/98	1	Classroom-108	Cabinet	Door-Out	Solid	Wood	0.08
47	1926 Bldg.	108	XRF	3/11/98	1	Classroom-108	Ceiling		Solid	Plaster	0.01
48	1926 Bldg.	19	XRF	2/19/98	1	Classroom-108	Chalkboard	Rail	Peeling	Wood	0
49	1926 Bldg.	22	XRF	2/19/98	1	Classroom-108	Chalkboard	Rail	Peeling	Wood	0.17
50	1926 Bldg.	16	XRF	2/19/98	1	Classroom-108	Door	Casing-Lft	Cracked	Wood	0.02
51	1926 Bldg.	17	XRF	2/19/98	1	Classroom-108	Door	Door	Solid	Wood	0.05
52	1926 Bldg.	15	XRF	2/19/98	1	Classroom-108	Wall	Wall-Lwr	Peeling	Plaster	0.11
53	1926 Bldg.	20	XRF	2/19/98	1	Classroom-108	Wall	Wall-Upn	Solid	Plaster	0.18
54	1926 Bldg.	21	XRF	2/19/98	1	Classroom-108	Wall	Midle Wall	Solid	Drywall	0
55	1926 Bldg.	13	XRF	2/19/98	1	Classroom-108	Window	Casing-Rht	Solid	Wood	0.05
56	1926 Bldg.	14	XRF	2/19/98	1	Classroom-108		Radiator	Peeling	Metal	>1.37

Saint Paul School District
 Wilson Expo for Excellence Middle School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K
3	Site	Sample#	Analysis	Date	Floor	Area	Component	Feature	Condition	Substrate	Result
57	1926 Bldg.	9	XRF	2/19/98	1	Classroom-110	Chalkboard	Rail	Peeling	Wood	0.11
58	1926 Bldg.	11	XRF	2/19/98	1	Classroom-110	Door	Casing-Lft	Cracked	Wood	0.09
59	1926 Bldg.	12	XRF	2/19/98	1	Classroom-110	Door	Door	Cracked	Wood	0.07
60	1926 Bldg.	8	XRF	2/19/98	1	Classroom-110	Wall	Wall-Lwr	Solid	Plaster	0.15
61	1926 Bldg.	10	XRF	2/19/98	1	Classroom-110	Wall	Wall-Upr	Solid	Plaster	0.1
62	1926 Bldg.	6	XRF	2/19/98	1	Classroom-110	Window	Casing-Rht	Cracked	Wood	0.09
63	1926 Bldg.	7	XRF	2/19/98	1	Classroom-110		Radiator	Peeling	Metal	3.81
64	1926 Bldg.	117	XRF	2/18/98	1	Classroom-112	Cabinet	Door-Out	Peeling	Wood	0
65	1926 Bldg.	110	XRF	3/11/98	1	Classroom-112	Ceiling		Solid	Plaster	0.01
66	1926 Bldg.	119	XRF	2/18/98	1	Classroom-112	Door	Casing-Lft	Solid	Wood	0.02
67	1926 Bldg.	120	XRF	2/18/98	1	Classroom-112	Door	Door	Cracked	Wood	0.05
68	1926 Bldg.	116	XRF	2/18/98	1	Classroom-112	Wall	Midle Wall	Solid	Plaster	0.01
69	1926 Bldg.	118	XRF	2/18/98	1	Classroom-112	Wall	Wall-Lwr	Solid	Plaster	0.01
70	1926 Bldg.	121	XRF	2/18/98	1	Classroom-112	Wall	Wall-Lwr	Solid	Drywall	>0.18
71	1926 Bldg.	122	XRF	2/18/98	1	Classroom-112	Window	Casing-Rht	Cracked	Wood	0.24
72	1926 Bldg.	123	XRF	2/18/98	1	Classroom-112		Radiator	Peeling	Metal	>1.37
73	1926 Bldg.	112	XRF	2/18/98	1	Classroom-114	Cabinet	Door-Out	Solid	Wood	0.02
74	1926 Bldg.	111	XRF	3/11/98	1	Classroom-114	Ceiling		Solid	Plaster	0.03
75	1926 Bldg.	113	XRF	2/18/98	1	Classroom-114	Chalkboard	Rail	Peeling	Wood	0.02
76	1926 Bldg.	108	XRF	2/18/98	1	Classroom-114	Door	Casing-Lft	Solid	Metal	0
77	1926 Bldg.	109	XRF	2/18/98	1	Classroom-114	Door	Door	Solid	Wood	0
78	1926 Bldg.	110	XRF	2/18/98	1	Classroom-114	Wall	Wall-Lwr	Solid	Drywall	0.15
79	1926 Bldg.	111	XRF	2/18/98	1	Classroom-114	Wall	Wall-Lwr	Peeling	Plaster	>>5.0
80	1926 Bldg.	114	XRF	2/18/98	1	Classroom-114	Window	Casing-Lft	Solid	Wood	0.07
81	1926 Bldg.	115	XRF	2/18/98	1	Classroom-114		Radiator	Solid	Metal	1.65
82	1926 Bldg.	58	XRF	2/9/98	2	Classroom-202	Door	Casing-Lft	Solid	Wood	0.04
83	1926 Bldg.	59	XRF	2/9/98	2	Classroom-202	Door	Door	Solid	Wood	0.05
84	1926 Bldg.	60	XRF	2/9/98	2	Classroom-202	Door	Casing-Lft	Solid	Metal	0
85	1926 Bldg.	55	XRF	2/9/98	2	Classroom-202	Wall	Midle Wall	Cracked	Plaster	>>5.0
86	1926 Bldg.	57	XRF	2/9/98	2	Classroom-202	Wall	Midle Wall	Solid	Plaster	0.04
87	1926 Bldg.	56	XRF	2/9/98	2	Classroom-202	Window	Casing-Rht	Solid	Wood	0.08
88	1926 Bldg.	54	XRF	2/9/98	2	Classroom-202		Radiator	Solid	Metal	>1.74
89	1926 Bldg.	36	XRF	2/17/98	2	Classroom-205	Chalkboard	Rail	Cracked	Wood	0
90	1926 Bldg.	32	XRF	2/17/98	2	Classroom-205	Door	Casing-Rht	Solid	Metal	0.05
91	1926 Bldg.	33	XRF	2/17/98	2	Classroom-205	Door	Casing-Lft	Solid	Wood	0.07
92	1926 Bldg.	34	XRF	2/17/98	2	Classroom-205	Door	Door	Solid	Wood	0.06
93	1926 Bldg.	35	XRF	2/17/98	2	Classroom-205	Wall	Wall-Lwr	Solid	Plaster	0.08
94	1926 Bldg.	97	XRF	2/9/98	2	Classroom-211	Cabinet	Door-Out	Cracked	Wood	0.1
95	1926 Bldg.	100	XRF	2/9/98	2	Classroom-211	Door	Casing-Lft	Cracked	Wood	0.08
96	1926 Bldg.	101	XRF	2/9/98	2	Classroom-211	Door	Door	Solid	Wood	0.3
97	1926 Bldg.	95	XRF	2/9/98	2	Classroom-211	Wall	Midle Wall	Solid	Plaster	>1.50
98	1926 Bldg.	96	XRF	2/9/98	2	Classroom-211	Wall	Chair rail	Solid	Wood	>0.19
99	1926 Bldg.	99	XRF	2/9/98	2	Classroom-211	Wall	Wall-Upr	Solid	Plaster	0.12
100	1926 Bldg.	98	XRF	2/9/98	2	Classroom-211	Window	Stool	Solid	Wood	0.11
101	1926 Bldg.	102	XRF	2/9/98	2	Classroom-211		Radiator	Peeling	Metal	1.72
102	1926 Bldg.	97	XRF	3/11/98	1	Classroom-212	Ceiling		Solid	Plaster	0.04
103	1926 Bldg.	7	XRF	2/17/98	2	Classroom-212	Door	Casing-Rht	Solid	Wood	0.07
104	1926 Bldg.	8	XRF	2/17/98	2	Classroom-212	Door	Door	Solid	Wood	0.1
105	1926 Bldg.	6	XRF	2/17/98	2	Classroom-212	Wall	Baseboard	Solid	Wood	0.01
106	1926 Bldg.	9	XRF	2/17/98	2	Classroom-212	Wall	Wall-Lwr	Solid	Plaster	>0.29
107	1926 Bldg.	10	XRF	2/17/98	2	Classroom-212	Window	Casing-Rht	Solid	Wood	0.08
108	1926 Bldg.	11	XRF	2/17/98	2	Classroom-212		Radiator	Peeling	Metal	>2.18
109	1926 Bldg.	17	XRF	2/17/98	2	Classroom-213	Bookcase	Shelf	Solid	Wood	0.04
110	1926 Bldg.	12	XRF	2/17/98	2	Classroom-213	Cabinet	Door-Out	Peeling	Wood	0
111	1926 Bldg.	18	XRF	2/17/98	2	Classroom-213	Cabinet	Door-Out	Solid	Wood	0.06

Saint Paul School District
 Wilson Expo for Excellence Middle School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K
3	Site	Sample#	Analysis	Date	Floor	Area	Component	Feature	Condition	Substrate	Result
112	1926 Bldg.	98	XRF	3/11/98	1	Classroom-213	Ceiling		Solid	Plaster	0.01
113	1926 Bldg.	13	XRF	2/17/98	2	Classroom-213	Chalkboard	Rail	Peeling	Wood	0.01
114	1926 Bldg.	14	XRF	2/17/98	2	Classroom-213	Door	Casing-Lft	Solid	Wood	0.04
115	1926 Bldg.	15	XRF	2/17/98	2	Classroom-213	Door	Door	Solid	Wood	0.07
116	1926 Bldg.	16	XRF	2/17/98	2	Classroom-213	Wall	Wall-Lwr	Solid	Plaster	3.8
117	1926 Bldg.	19	XRF	2/17/98	2	Classroom-213	Window	Casing-Rht	Solid	Wood	0.1
118	1926 Bldg.	20	XRF	2/17/98	2	Classroom-213		Radiator	Peeling	Metal	>1.90
119	1926 Bldg.	24	XRF	2/17/98	2	Classroom-214	Cabinet	Door-Out	Solid	Wood	0
120	1926 Bldg.	22	XRF	2/17/98	2	Classroom-214	Door	Casing-Lft	Cracked	Wood	0.04
121	1926 Bldg.	23	XRF	2/17/98	2	Classroom-214	Door	Door	Solid	Wood	0.05
122	1926 Bldg.	25	XRF	2/17/98	2	Classroom-214	Wall	Midle Wall	Solid	Plaster	>>5.0
123	1926 Bldg.	21	XRF	2/17/98	2	Classroom-214	Window	Stool	Solid	Wood	0.03
124	1926 Bldg.	27	XRF	2/17/98	2	Classroom-214	Window	Casing-Rht	Solid	Wood	0.06
125	1926 Bldg.	26	XRF	2/17/98	2	Classroom-214		Radiator	Solid	Metal	>2.79
126	1926 Bldg.	10	XRF	2/3/98	3	Classroom-301	Cabinet	Door-Out	Solid	Wood	0.05
127	1926 Bldg.	88	XRF	3/11/98	1	Classroom-301	Ceiling		Solid	Plaster	0.01
128	1926 Bldg.	6	XRF	2/3/98	3	Classroom-301	Chalkboard	Rail	Peeling	Wood	0.12
129	1926 Bldg.	11	XRF	2/3/98	3	Classroom-301	Door	Casing-Lft	Solid	Wood	0.07
130	1926 Bldg.	12	XRF	2/3/98	3	Classroom-301	Door	Door	Solid	Wood	0.04
131	1926 Bldg.	9	XRF	2/3/98	3	Classroom-301	Wall	Wall-Lwr	Solid	Plaster	3.74
132	1926 Bldg.	8	XRF	2/3/98	3	Classroom-301	Window	Casing-Rht	Solid	Wood	0.08
133	1926 Bldg.	7	XRF	2/3/98	3	Classroom-301		Radiator	Solid	Metal	2.98
134	1926 Bldg.	17	XRF	2/3/98	3	Classroom-302	Cabinet	Door-Out	Solid	Metal	0
135	1926 Bldg.	13	XRF	2/3/98	3	Classroom-302	Door	Casing-Rht	Solid	Metal	0.06
136	1926 Bldg.	18	XRF	2/3/98	3	Classroom-302	Door	Casing-Lft	Solid	Wood	0.07
137	1926 Bldg.	19	XRF	2/3/98	3	Classroom-302	Door	Door	Solid	Wood	0
138	1926 Bldg.	16	XRF	2/3/98	3	Classroom-302	Wall	Wall-Lwr	Solid	Plaster	>4.49
139	1926 Bldg.	15	XRF	2/3/98	3	Classroom-302	Window	Casing-Rht	Solid	Wood	0.08
140	1926 Bldg.	14	XRF	2/3/98	3	Classroom-302		Radiator	Peeling	Metal	0.3
141	1926 Bldg.	22	XRF	2/3/98	3	Classroom-303	Cabinet	Door-Out	Solid	Wood	0
142	1926 Bldg.	27	XRF	2/3/98	3	Classroom-303	Cabinet	Door-Out	Cracked	Wood	0.04
143	1926 Bldg.	28	XRF	2/3/98	3	Classroom-303	Cabinet	Outside	Peeling	Wood	0.01
144	1926 Bldg.	24	XRF	2/3/98	3	Classroom-303	Door	Door	Solid	Wood	0
145	1926 Bldg.	25	XRF	2/3/98	3	Classroom-303	Door	Casing-Lft	Peeling	Metal	0.11
146	1926 Bldg.	21	XRF	2/3/98	3	Classroom-303	Wall	Wall-Up	Solid	Plaster	0.13
147	1926 Bldg.	26	XRF	2/3/98	3	Classroom-303	Wall	Wall-Lwr	Solid	Plaster	0.14
148	1926 Bldg.	23	XRF	2/3/98	3	Classroom-303	Window	Casing-Rht	Solid	Wood	0.11
149	1926 Bldg.	20	XRF	2/3/98	3	Classroom-303		Radiator	Peeling	Metal	2.1
150	1926 Bldg.	35	XRF	2/3/98	3	Classroom-304	Cabinet	Door-Out	Solid	Wood	0.02
151	1926 Bldg.	31	XRF	2/3/98	3	Classroom-304	Chalkboard	Rail	Solid	Wood	0
152	1926 Bldg.	33	XRF	2/3/98	3	Classroom-304	Door	Casing-Lft	Solid	Wood	0.07
153	1926 Bldg.	34	XRF	2/3/98	3	Classroom-304	Door	Door	Solid	Wood	0.09
154	1926 Bldg.	37	XRF	2/3/98	3	Classroom-304	Door	Casing-Lft	Solid	Metal	0
155	1926 Bldg.	32	XRF	2/3/98	3	Classroom-304	Wall	Wall-Lwr	Solid	Plaster	0.03
156	1926 Bldg.	36	XRF	2/3/98	3	Classroom-304	Wall	Wall-Lwr	Cracked	Plaster	0.15
157	1926 Bldg.	30	XRF	2/3/98	3	Classroom-304	Window	Casing-Rht	Solid	Wood	0.08
158	1926 Bldg.	29	XRF	2/3/98	3	Classroom-304		Radiator	Peeling	Metal	0.42
159	1926 Bldg.	23	XRF	2/9/98	3	Classroom-305	Bookcase	Shelf	Solid	Wood	0
160	1926 Bldg.	19	XRF	2/9/98	3	Classroom-305	Cabinet	Door-Out	Solid	Wood	0
161	1926 Bldg.	20	XRF	2/9/98	3	Classroom-305	Door	Casing-Lft	Solid	Metal	0.04
162	1926 Bldg.	21	XRF	2/9/98	3	Classroom-305	Door	Door	Solid	Wood	0.01
163	1926 Bldg.	24	XRF	2/9/98	3	Classroom-305	Door	Casing-Rht	Solid	Metal	0
164	1926 Bldg.	22	XRF	2/9/98	3	Classroom-305	Wall	Midle Wall	Solid	Wood	0
165	1926 Bldg.	25	XRF	2/9/98	3	Classroom-305	Wall	Midle Wall	Cracked	Plaster	0.09
166	1926 Bldg.	45	XRF	2/3/98	3	Classroom-306	Cabinet	Door-Out	Solid	Wood	0.11

Saint Paul School District
 Wilson Expo for Excellence Middle School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K
3	Site	Sample#	Analysis	Date	Floor	Area	Component	Feature	Condition	Substrate	Result
167	1926 Bldg.	41	XRF	2/3/98	3	Classroom-306	Chalkboard	Rail	Cracked	Wood	0
168	1926 Bldg.	40	XRF	2/3/98	3	Classroom-306	Door	Casing-Lft	Solid	Metal	0
169	1926 Bldg.	43	XRF	2/3/98	3	Classroom-306	Door	Casing-Lft	Solid	Wood	0.01
170	1926 Bldg.	44	XRF	2/3/98	3	Classroom-306	Door	Door	Solid	Wood	0.04
171	1926 Bldg.	42	XRF	2/3/98	3	Classroom-306	Wall	Wall-Lwr	Solid	Plaster	3.58
172	1926 Bldg.	39	XRF	2/3/98	3	Classroom-306	Window	Casing-Rht	Solid	Wood	0.1
173	1926 Bldg.	38	XRF	2/3/98	3	Classroom-306		Radiator	Peeling	Metal	2.79
174	1926 Bldg.	89	XRF	3/11/98	1	Classroom-306D	Ceiling		Solid	Plaster	0
175	1926 Bldg.	16	XRF	2/9/98	3	Classroom-307	Bookcase	Shelf	Solid	Wood	0
176	1926 Bldg.	12	XRF	2/9/98	3	Classroom-307	Cabinet	Door-Out	Solid	Wood	0.01
177	1926 Bldg.	13	XRF	2/9/98	3	Classroom-307	Door	Casing-Lft	Solid	Metal	0.01
178	1926 Bldg.	14	XRF	2/9/98	3	Classroom-307	Door	Door	Peeling	Wood	0.03
179	1926 Bldg.	18	XRF	2/9/98	3	Classroom-307	Door	Casing-Lft	Solid	Metal	0
180	1926 Bldg.	15	XRF	2/9/98	3	Classroom-307	Wall	Midle Wall	Solid	Wood	0
181	1926 Bldg.	17	XRF	2/9/98	3	Classroom-307	Wall	Wall-Lwr	Solid	Plaster	0.12
182	1926 Bldg.	49	XRF	2/3/98	3	Classroom-308	Chalkboard	Rail	Peeling	Wood	0
183	1926 Bldg.	50	XRF	2/3/98	3	Classroom-308	Door	Casing-Lft	Solid	Wood	0.06
184	1926 Bldg.	51	XRF	2/3/98	3	Classroom-308	Door	Door	Solid	Wood	0.07
185	1926 Bldg.	52	XRF	2/3/98	3	Classroom-308	Door	Casing-Lft	Solid	Metal	0
186	1926 Bldg.	47	XRF	2/3/98	3	Classroom-308	Wall	Wall-Upr	Solid	Drywall	0
187	1926 Bldg.	48	XRF	2/3/98	3	Classroom-308	Wall	Wall-Lwr	Solid	Plaster	0.05
188	1926 Bldg.	46	XRF	2/3/98	3	Classroom-308		Radiator	Peeling	Metal	>0.44
189	1926 Bldg.	59	XRF	2/3/98	3	Classroom-309	Cabinet	Door-Out	Solid	Wood	0.05
190	1926 Bldg.	90	XRF	3/11/98	1	Classroom-309	Ceiling		Solid	Plaster	0.01
191	1926 Bldg.	55	XRF	2/3/98	3	Classroom-309	Chalkboard	Rail	Peeling	Wood	0
192	1926 Bldg.	56	XRF	2/3/98	3	Classroom-309	Door	Casing-Lft	Solid	Metal	0
193	1926 Bldg.	57	XRF	2/3/98	3	Classroom-309	Door	Casing-Lft	Peeling	Wood	0.06
194	1926 Bldg.	58	XRF	2/3/98	3	Classroom-309	Door	Door	Cracked	Wood	0.07
195	1926 Bldg.	60	XRF	2/3/98	3	Classroom-309	Wall	Wall-Lwr	Solid	Plaster	>>5.0
196	1926 Bldg.	54	XRF	2/3/98	3	Classroom-309	Window	Casing-Lft	Solid	Wood	0.08
197	1926 Bldg.	53	XRF	2/3/98	3	Classroom-309		Radiator	Peeling	Metal	2.96
198	1926 Bldg.	63	XRF	2/3/98	3	Classroom-311	Door	Casing-Lft	Solid	Wood	0
199	1926 Bldg.	64	XRF	2/3/98	3	Classroom-311	Door	Door	Solid	Wood	0.02
200	1926 Bldg.	62	XRF	2/3/98	3	Classroom-311	Wall	Midle Wall	Cracked	Plaster	0
201	1926 Bldg.	61	XRF	2/3/98	3	Classroom-311		Radiator	Peeling	Metal	2.13
202	1926 Bldg.	92	XRF	3/11/98	1	Classroom-312	Ceiling		Solid	Plaster	0.01
203	1926 Bldg.	70	XRF	2/3/98	3	Classroom-312A	Chalkboard	Rail	Cracked	Wood	0.03
204	1926 Bldg.	72	XRF	2/3/98	3	Classroom-312A	Door	Casing-Lft	Cracked	Wood	0.11
205	1926 Bldg.	73	XRF	2/3/98	3	Classroom-312A	Door	Door	Cracked	Wood	0.04
206	1926 Bldg.	74	XRF	2/3/98	3	Classroom-312A	Door	Casing-Lft	Solid	Metal	0
207	1926 Bldg.	69	XRF	2/3/98	3	Classroom-312A	Wall	Wall-Lwr	Solid	Plaster	>>5.0
208	1926 Bldg.	71	XRF	2/3/98	3	Classroom-312A	Wall	Midle Wall	Solid	Drywall	>0.10
209	1926 Bldg.	75	XRF	2/3/98	3	Classroom-312A		Radiator	Peeling	Metal	>1.17
210	1926 Bldg.	93	XRF	3/11/98	1	Classroom-314	Ceiling		Solid	Plaster	0
211	1926 Bldg.	83	XRF	2/3/98	3	Classroom-314A	Cabinet	Door-Out	Cracked	Wood	0.11
212	1926 Bldg.	82	XRF	2/3/98	3	Classroom-314A	Chalkboard	Rail	Solid	Wood	0
213	1926 Bldg.	84	XRF	2/3/98	3	Classroom-314A	Chalkboard	Rail	Cracked	Wood	0.02
214	1926 Bldg.	79	XRF	2/3/98	3	Classroom-314A	Door	Casing-Rht	Solid	Metal	0.02
215	1926 Bldg.	80	XRF	2/3/98	3	Classroom-314A	Door	Casing-Lft	Cracked	Wood	0.07
216	1926 Bldg.	81	XRF	2/3/98	3	Classroom-314A	Door	Door	Cracked	Wood	0.03
217	1926 Bldg.	85	XRF	2/3/98	3	Classroom-314A	Wall	Wall-Lwr	Solid	Plaster	4.28
218	1926 Bldg.	86	XRF	2/3/98	3	Classroom-314A		Radiator	Peeling	Metal	0.09
219	1926 Bldg.	18	XRF	3/10/98	1	Hall-1	Door	Door	Solid	Wood	0
220	1926 Bldg.	19	XRF	3/10/98	1	Hall-1	Door	Casing-Lft	Solid	Wood	0.05
221	1926 Bldg.	23	XRF	3/10/98	1	Hall-1	Door	Casing-Lft	Solid	Metal	0

Saint Paul School District
 Wilson Expo for Excellence Middle School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K
3	Site	Sample#	Analysis	Date	Floor	Area	Component	Feature	Condition	Substrate	Result
222	1926 Bldg.	24	XRF	3/10/98	1	Hall-1	Door	Door	Solid	Metal	0.14
223	1926 Bldg.	25	XRF	3/10/98	1	Hall-1	Door	Casing-Lft	Peeling	Wood	0.06
224	1926 Bldg.	26	XRF	3/10/98	1	Hall-1	Door	Door	Solid	Wood	0.05
225	1926 Bldg.	28	XRF	3/10/98	1	Hall-1	Door	Casing-Lft	Solid	Metal	0.29
226	1926 Bldg.	29	XRF	3/10/98	1	Hall-1	Door	Door	Solid	Metal	0.27
227	1926 Bldg.	20	XRF	3/10/98	1	Hall-1	Wall	Wall-Lwr	Solid	Plaster	3.77
228	1926 Bldg.	21	XRF	3/10/98	1	Hall-1	Wall	Chair rail	Solid	Wood	0.02
229	1926 Bldg.	22	XRF	3/10/98	1	Hall-1		Locker	Peeling	Metal	0.21
230	1926 Bldg.	27	XRF	3/10/98	1	Hall-1		Elec Panel	Solid	Metal	0.08
231	1926 Bldg.	30	XRF	3/10/98	1	Hall-1		Radiator	Peeling	Metal	0.02
232	1926 Bldg.	54	XRF	2/17/98	2	Hall-2	Door	Casing-Lft	Solid	Metal	0.9
233	1926 Bldg.	55	XRF	2/17/98	2	Hall-2	Door	Door	Solid	Metal	0.41
234	1926 Bldg.	57	XRF	2/17/98	2	Hall-2	Door	Casing-Lft	Solid	Wood	0.11
235	1926 Bldg.	58	XRF	2/17/98	2	Hall-2	Door	Door	Solid	Wood	0.09
236	1926 Bldg.	59	XRF	2/17/98	2	Hall-2	Door	Door	Solid	Wood	0.11
237	1926 Bldg.	53	XRF	2/17/98	2	Hall-2	Wall	Chair rail	Solid	Wood	0.05
238	1926 Bldg.	56	XRF	2/17/98	2	Hall-2	Wall	Wall-Lwr	Solid	Plaster	0.05
239	1926 Bldg.	63	XRF	2/17/98	2	Hall-2	Window	Casing-Rht	Solid	Wood	0.13
240	1926 Bldg.	52	XRF	2/17/98	2	Hall-2		Locker	Solid	Metal	0.31
241	1926 Bldg.	60	XRF	2/17/98	2	Hall-2		Elec Panel	Solid	Metal	0.03
242	1926 Bldg.	61	XRF	2/17/98	2	Hall-2		Elec Panel	Solid	Metal	0.09
243	1926 Bldg.	62	XRF	2/17/98	2	Hall-2		Radiator	Solid	Metal	1.73
244	1926 Bldg.	27	XRF	2/9/98	3	Hall-3	Door	Casing-Lft	Solid	Wood	0.07
245	1926 Bldg.	33	XRF	2/9/98	3	Hall-3	Door	Casing-Lft	Solid	Metal	0.18
246	1926 Bldg.	34	XRF	2/9/98	3	Hall-3	Door	Door	Solid	Metal	0.29
247	1926 Bldg.	39	XRF	2/9/98	3	Hall-3	Door	Door	Solid	Wood	0.05
248	1926 Bldg.	29	XRF	2/9/98	3	Hall-3	Wall	Wall-Lwr	Solid	Plaster	>0.23
249	1926 Bldg.	30	XRF	2/9/98	3	Hall-3	Wall	Wall-Upr	Solid	Plaster	0.14
250	1926 Bldg.	35	XRF	2/9/98	3	Hall-3	Wall	Chair rail	Solid	Wood	0.01
251	1926 Bldg.	28	XRF	2/9/98	3	Hall-3	Window	Stool	Peeling	Wood	0.06
252	1926 Bldg.	38	XRF	2/9/98	3	Hall-3	Window	Casing-Rht	Solid	Wood	0.09
253	1926 Bldg.	26	XRF	2/9/98	3	Hall-3		Locker	Peeling	Metal	0.32
254	1926 Bldg.	31	XRF	2/9/98	3	Hall-3		Elec Panel	Solid	Metal	0.06
255	1926 Bldg.	32	XRF	2/9/98	3	Hall-3		Elec Panel	Solid	Metal	0.05
256	1926 Bldg.	36	XRF	2/9/98	3	Hall-3		Radiator	Peeling	Metal	0.01
257	1926 Bldg.	37	XRF	2/9/98	3	Hall-3		Radiator	Peeling	Metal	0
258	1926 Bldg.	56	XRF	3/10/98	0	Kitchen-101	Door	Casing-Rht	Solid	Metal	0
259	1926 Bldg.	55	XRF	3/10/98	0	Kitchen-101	Wall	Midle Wall	Solid	Plaster	1.03
260	1926 Bldg.	53	XRF	3/10/98	0	Kitchen-101	Window	Sash-Upr	Solid	Wood	0.21
261	1926 Bldg.	54	XRF	3/10/98	0	Kitchen-101		Radiator	Solid	Wood	0
262	1926 Bldg.	65	XRF	2/9/98	2	Library-204	Door	Casing-Rht	Solid	Metal	0
263	1926 Bldg.	66	XRF	2/9/98	2	Library-204	Door	Casing-Lft	Solid	Metal	0
264	1926 Bldg.	67	XRF	2/9/98	2	Library-204	Door	Door	Solid	Metal	0
265	1926 Bldg.	62	XRF	2/9/98	2	Library-204	Wall	Midle Wall	Solid	Plaster	>>5.0
266	1926 Bldg.	68	XRF	2/9/98	2	Library-204	Wall	Chair rail	Solid	Wood	2.1
267	1926 Bldg.	61	XRF	2/9/98	2	Library-204	Window	Stool	Solid	Wood	0.08
268	1926 Bldg.	64	XRF	2/9/98	2	Library-204	Window	Casing-Rht	Solid	Wood	0.07
269	1926 Bldg.	63	XRF	2/9/98	2	Library-204		Radiator	Peeling	Metal	0.64
270	1926 Bldg.	109	XRF	3/11/98	1	Lounge-111	Ceiling		Solid	Plaster	0.01
271	1926 Bldg.	100	XRF	2/18/98	1	Lounge-111	Door	Casing-Lft	Peeling	Wood	0.08
272	1926 Bldg.	102	XRF	2/18/98	1	Lounge-111	Door	Door	Solid	Wood	0.06
273	1926 Bldg.	97	XRF	2/18/98	1	Lounge-111	Wall	Midle Wall	Solid	Plaster	>>5.0
274	1926 Bldg.	101	XRF	2/18/98	1	Lounge-111	Wall	Chair rail	Solid	Wood	0
275	1926 Bldg.	95	XRF	2/18/98	1	Lounge-111	Window	Casing-Rht	Cracked	Wood	0.1
276	1926 Bldg.	98	XRF	2/18/98	1	Lounge-111	Window	Stool	Solid	Wood	0.08

Saint Paul School District
 Wilson Expo for Excellence Middle School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K
3	Site	Sample#	Analysis	Date	Floor	Area	Component	Feature	Condition	Substrate	Result
277	1926 Bldg.	99	XRF	2/18/98	1	Lounge-111	Window	Stool	Solid	Wood	0.1
278	1926 Bldg.	96	XRF	2/18/98	1	Lounge-111		Radiator	Peeling	Metal	>3.07
279	1926 Bldg.	46	XRF	3/10/98	1	Lunch Area-101	Wall	Chair rail	Solid	Wood	0
280	1926 Bldg.	50	XRF	3/10/98	0	Lunch Area-107	Door	Casing-Rht	Solid	Metal	0
281	1926 Bldg.	51	XRF	3/10/98	0	Lunch Area-107	Door	Door	Solid	Wood	0.08
282	1926 Bldg.	52	XRF	3/10/98	0	Lunch Area-107	Table	Top	Peeling	Wood	0.01
283	1926 Bldg.	47	XRF	3/10/98	0	Lunch Area-107	Wall	Wall-Lwr	Solid	Plaster	2.87
284	1926 Bldg.	48	XRF	3/10/98	0	Lunch Area-107	Wall	Midle Wall	Solid	Drywall	0
285	1926 Bldg.	49	XRF	3/10/98	0	Lunch Area-107	Wall	Wall-Lwr	Solid	Metal	>0.16
286	1926 Bldg.	71	XRF	2/9/98	2	Main-207	Cabinet	Door-Out	Solid	Wood	0.05
287	1926 Bldg.	70	XRF	2/9/98	2	Main-207	Door	Casing-Rht	Solid	Metal	0
288	1926 Bldg.	78	XRF	2/9/98	2	Main-207	Door	Casing-Rht	Peeling	Wood	3.51
289	1926 Bldg.	79	XRF	2/9/98	2	Main-207	Door	Door	Solid	Wood	2.75
290	1926 Bldg.	69	XRF	2/9/98	2	Main-207	Wall	Midle Wall	Solid	Drywall	0
291	1926 Bldg.	73	XRF	2/9/98	2	Main-207	Wall	Wall-Lwr	Solid	Plaster	>>5.0
292	1926 Bldg.	75	XRF	2/9/98	2	Main-207	Wall	Midle Wall	Solid	Plaster	2.61
293	1926 Bldg.	76	XRF	2/9/98	2	Main-207	Wall	Chair rail	Solid	Wood	1.84
294	1926 Bldg.	77	XRF	2/9/98	2	Main-207	Wall	Baseboard	Solid	Wood	0.05
295	1926 Bldg.	72	XRF	2/9/98	2	Main-207	Window	Casing-Rht	Solid	Wood	0.01
296	1926 Bldg.	74	XRF	2/9/98	2	Main-207		Radiator	Solid	Metal	>2.84
297	1926 Bldg.	90	XRF	2/9/98	2	Main-209	Cabinet	Door-Out	Solid	Wood	0.07
298	1926 Bldg.	86	XRF	2/9/98	2	Main-209	Door	Casing-Lft	Solid	Metal	0
299	1926 Bldg.	91	XRF	2/9/98	2	Main-209	Door	Door	Solid	Wood	0.04
300	1926 Bldg.	85	XRF	2/9/98	2	Main-209	Wall	Midle Wall	Solid	Drywall	0.01
301	1926 Bldg.	88	XRF	2/9/98	2	Main-209	Window	Casing-Rht	Solid	Wood	0
302	1926 Bldg.	87	XRF	2/9/98	2	Main-209		Radiator	Peeling	Metal	0.01
303	1926 Bldg.	89	XRF	2/9/98	2	Main-209		Radiator	Peeling	Metal	>1.76
304	1926 Bldg.	93	XRF	2/9/98	2	Main-210	Door	Casing-Rht	Solid	Metal	0
305	1926 Bldg.	94	XRF	2/9/98	2	Main-210	Wall	Wall-Lwr	Solid	Plaster	3.23
306	1926 Bldg.	92	XRF	2/9/98	2	Main-210		Radiator	Peeling	Metal	1.84
307	1926 Bldg.	57	XRF	3/10/98	0	Other-1	Cabinet	Door-Out	Peeling	Wood	0
308	1926 Bldg.	58	XRF	3/10/98	0	Other-1	Wall	Wall-Lwr	Peeling	Plaster	0.07
309	1926 Bldg.	83	XRF	3/11/98	1	Outside-0	Door	Door	Peeling	Wood	0
310	1926 Bldg.	84	XRF	3/11/98	1	Outside-0	Door	Casing-Lft	Peeling	Wood	>>5.0
311	1926 Bldg.	87	XRF	3/11/98	1	Outside-0	Door	Door	Solid	Metal	0
312	1926 Bldg.	86	XRF	3/11/98	1	Outside-0	Floor		Peeling	Concrte	0.07
313	1926 Bldg.	85	XRF	3/11/98	1	Outside-0	Stairs	Hand rail	Solid	Metal	0
314	1926 Bldg.	44	XRF	2/9/98	3	Restroom-1	Door	Stall Door	Solid	Wood	0.03
315	1926 Bldg.	45	XRF	2/9/98	3	Restroom-1	Door	Casing-Lft	Cracked	Wood	0.07
316	1926 Bldg.	46	XRF	2/9/98	3	Restroom-1	Door	Door	Cracked	Wood	0.06
317	1926 Bldg.	43	XRF	2/9/98	3	Restroom-1	Wall	Wall-Lwr	Solid	Plaster	>>5.0
318	1926 Bldg.	47	XRF	2/9/98	3	Restroom-1	Wall	Chair rail	Solid	Wood	0.01
319	1926 Bldg.	41	XRF	2/9/98	3	Restroom-1	Window	Casing-Rht	Solid	Wood	0.07
320	1926 Bldg.	42	XRF	2/9/98	3	Restroom-1		Radiator	Peeling	Metal	0.44
321	1926 Bldg.	91	XRF	3/11/98	1	Restroom-2	Ceiling		Solid	Plaster	0.01
322	1926 Bldg.	51	XRF	2/9/98	3	Restroom-2	Door	Casing-Rht	Cracked	Wood	0.02
323	1926 Bldg.	52	XRF	2/9/98	3	Restroom-2	Door	Door	Cracked	Wood	0.05
324	1926 Bldg.	53	XRF	2/9/98	3	Restroom-2	Door	Stall Door	Solid	Wood	0.03
325	1926 Bldg.	49	XRF	2/9/98	3	Restroom-2	Wall	Wall-Lwr	Solid	Plaster	>>5.0
326	1926 Bldg.	50	XRF	2/9/98	3	Restroom-2	Wall	Chair rail	Solid	Wood	0
327	1926 Bldg.	48	XRF	2/9/98	3	Restroom-2	Window	Casing-Rht	Peeling	Wood	0.03
328	1926 Bldg.	42	XRF	2/17/98	2	Restroom-3	Door	Casing-Lft	Solid	Wood	0.09
329	1926 Bldg.	43	XRF	2/17/98	2	Restroom-3	Door	Door	Cracked	Wood	0.07
330	1926 Bldg.	39	XRF	2/17/98	2	Restroom-3	Wall	Midle Wall	Solid	Plaster	0.09
331	1926 Bldg.	44	XRF	2/17/98	2	Restroom-3	Wall	Wall-Lwr	Solid	Plaster	3.6

Saint Paul School District
 Wilson Expo for Excellence Middle School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K
3	Site	Sample#	Analysis	Date	Floor	Area	Component	Feature	Condition	Substrate	Result
332	1926 Bldg.	45	XRF	2/17/98	2	Restroom-3	Wall	Chair rail	Solid	Wood	0.02
333	1926 Bldg.	38	XRF	2/17/98	2	Restroom-3	Window	Casing-Rht	Solid	Wood	0.07
334	1926 Bldg.	40	XRF	2/17/98	2	Restroom-3	Window	Casing-Rht	Cracked	Wood	0.01
335	1926 Bldg.	41	XRF	2/17/98	2	Restroom-3		Stall Door	Solid	Wood	0.05
336	1926 Bldg.	49	XRF	2/17/98	2	Restroom-4	Door	Casing-Lft	Solid	Wood	0.06
337	1926 Bldg.	50	XRF	2/17/98	2	Restroom-4	Door	Door	Solid	Wood	0.15
338	1926 Bldg.	51	XRF	2/17/98	2	Restroom-4	Door	Stall Door	Cracked	Wood	0.06
339	1926 Bldg.	47	XRF	2/17/98	2	Restroom-4	Wall	Chair rail	Solid	Wood	0
340	1926 Bldg.	48	XRF	2/17/98	2	Restroom-4	Wall	Wall-Lwr	Solid	Plaster	>>5.0
341	1926 Bldg.	46	XRF	2/17/98	2	Restroom-4	Window	Casing-Rht	Solid	Wood	0.09
342	1926 Bldg.	50	XRF	2/25/98	1	Restroom-5	Door	Casing-Lft	Solid	Metal	0
343	1926 Bldg.	51	XRF	2/25/98	1	Restroom-5	Door	Door	Solid	Wood	0
344	1926 Bldg.	49	XRF	2/25/98	1	Restroom-5	Wall	Midle Wall	Solid	Drywall	0
345	1926 Bldg.	53	XRF	2/25/98	1	Restroom-5	Wall	Wall-Upr	Solid	Plaster	2.58
346	1926 Bldg.	47	XRF	2/25/98	1	Restroom-5	Window	Sash-Lwr	Cracked	Wood	0.29
347	1926 Bldg.	48	XRF	2/25/98	1	Restroom-5		Radiator	Peeling	Metal	1.47
348	1926 Bldg.	52	XRF	2/25/98	1	Restroom-5		Locker	Solid	Metal	0.5
349	1926 Bldg.	106	XRF	3/11/98	1	Restroom-6	Ceiling		Cracked	Metal	>>5.0
350	1926 Bldg.	10	XRF	3/10/98	1	Restroom-6	Door	Casing-Lft	Solid	Wood	0.04
351	1926 Bldg.	11	XRF	3/10/98	1	Restroom-6	Door	Door	Cracked	Wood	0.01
352	1926 Bldg.	8	XRF	3/10/98	1	Restroom-6	Wall	Wall-Lwr	Solid	Plaster	3.8
353	1926 Bldg.	9	XRF	3/10/98	1	Restroom-6	Wall	Chair rail	Solid	Wood	0.02
354	1926 Bldg.	6	XRF	3/10/98	1	Restroom-6	Window	Casing-Rht	Solid	Wood	0.11
355	1926 Bldg.	7	XRF	3/10/98	1	Restroom-6		Radiator	Peeling	Metal	0.18
356	1926 Bldg.	16	XRF	3/10/98	1	Restroom-7	Door	Casing-Lft	Solid	Wood	0.08
357	1926 Bldg.	17	XRF	3/10/98	1	Restroom-7	Door	Door	Cracked	Wood	0.04
358	1926 Bldg.	13	XRF	3/10/98	1	Restroom-7	Wall	Midle Wall	Solid	Drywall	0.05
359	1926 Bldg.	14	XRF	3/10/98	1	Restroom-7	Wall	Wall-Lwr	Solid	Plaster	3.99
360	1926 Bldg.	15	XRF	3/10/98	1	Restroom-7	Wall	Chair rail	Solid	Wood	0.43
361	1926 Bldg.	12	XRF	3/10/98	1	Restroom-7	Window	Casing-Rht	Solid	Wood	0.06
362	1926 Bldg.	34	XRF	3/10/98	0	Restroom-8	Bench		Peeling	Wood	0.43
363	1926 Bldg.	35	XRF	3/10/98	0	Restroom-8	Door	Door	Peeling	Wood	0
364	1926 Bldg.	36	XRF	3/10/98	0	Restroom-8	Door	Jamb-Lft	Peeling	Wood	0
365	1926 Bldg.	37	XRF	3/10/98	0	Restroom-8	Door	Casing-Lft	Peeling	Metal	0.13
366	1926 Bldg.	32	XRF	3/10/98	1	Restroom-8	Wall	Wall-Upr	Solid	Concrte	0.09
367	1926 Bldg.	31	XRF	3/10/98	1	Restroom-8		Locker	Solid	Metal	0
368	1926 Bldg.	33	XRF	3/10/98	1	Restroom-8		Locker	Peeling	Metal	0.59
369	1926 Bldg.	40	XRF	3/10/98	0	Restroom-9	Bench		Peeling	Wood	0.44
370	1926 Bldg.	42	XRF	3/10/98	0	Restroom-9	Door	Stall Door	Solid	Metal	0.11
371	1926 Bldg.	43	XRF	3/10/98	0	Restroom-9	Door	Door	Peeling	Wood	0
372	1926 Bldg.	44	XRF	3/10/98	0	Restroom-9	Door	Casing-Lft	Peeling	Metal	0.11
373	1926 Bldg.	38	XRF	3/10/98	0	Restroom-9	Wall	Midle Wall	Solid	Concrte	0.07
374	1926 Bldg.	41	XRF	3/10/98	0	Restroom-9	Wall	Bthrm Stll	Solid	Metal	>0.19
375	1926 Bldg.	39	XRF	3/10/98	0	Restroom-9		Locker	Solid	Metal	0.61
376	1926 Bldg.	45	XRF	3/10/98	0	Restroom-9		Locker	Peeling	Metal	0.66
377	1926 Bldg.	65	XRF	2/19/98	1	Room-102	Cabinet	Door-Out	Solid	Wood	0
378	1926 Bldg.	69	XRF	2/19/98	1	Room-102	Cabinet	Door-Out	Solid	Wood	0.02
379	1926 Bldg.	100	XRF	3/11/98	1	Room-102	Ceiling		Solid	Plaster	0.3
380	1926 Bldg.	67	XRF	2/19/98	1	Room-102	Door	Casing-Lft	Solid	Wood	0.03
381	1926 Bldg.	68	XRF	2/19/98	1	Room-102	Door	Door	Solid	Wood	0.06
382	1926 Bldg.	62	XRF	2/19/98	1	Room-102	Wall	Midle Wall	Solid	Drywall	0.08
383	1926 Bldg.	66	XRF	2/19/98	1	Room-102	Wall	Wall-Lwr	Solid	Plaster	2.16
384	1926 Bldg.	63	XRF	2/19/98	1	Room-102	Window	Casing-Rht	Solid	Wood	0.08
385	1926 Bldg.	64	XRF	2/19/98	1	Room-102		Radiator	Solid	Metal	>1.09
386	1926 Bldg.	101	XRF	3/11/98	1	Room-103	Ceiling		Solid	Plaster	0.02

Saint Paul School District
 Wilson Expo for Excellence Middle School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K
3	Site	Sample#	Analysis	Date	Floor	Area	Component	Feature	Condition	Substrate	Result
387	1926 Bldg.	107	XRF	3/11/98	1	Room-107	Ceiling		Solid	Plaster	0.08
388	1926 Bldg.	26	XRF	2/19/98	1	Room-107	Door	Casing-Rht	Cracked	Wood	0.06
389	1926 Bldg.	27	XRF	2/19/98	1	Room-107	Door	Door	Cracked	Wood	0.08
390	1926 Bldg.	24	XRF	2/19/98	1	Room-107	Wall	Wall-Lwr	Solid	Plaster	>>5.0
391	1926 Bldg.	28	XRF	2/19/98	1	Room-107	Wall	Wall-Upr	Solid	Plaster	0.18
392	1926 Bldg.	25	XRF	2/19/98	1	Room-107	Window	Stool	Solid	Wood	0.08
393	1926 Bldg.	23	XRF	2/19/98	1	Room-107		Radiator	Peeling	Metal	>>5.0
394	1926 Bldg.	29	XRF	2/25/98	1	Room-109	Cabinet	Door-Out	Solid	Wood	0
395	1926 Bldg.	26	XRF	2/25/98	1	Room-109	Door	Jamb-Lft	Solid	Metal	0.08
396	1926 Bldg.	27	XRF	2/25/98	1	Room-109	Door	Door	Solid	Wood	0
397	1926 Bldg.	32	XRF	2/25/98	1	Room-109	Door	Door	Solid	Metal	0
398	1926 Bldg.	31	XRF	2/25/98	1	Room-109	Stairs	Hand rail	Solid	Metal	0
399	1926 Bldg.	25	XRF	2/25/98	1	Room-109	Wall	Midle Wall	Solid	Plaster	0.04
400	1926 Bldg.	28	XRF	2/25/98	1	Room-109	Wall	Midle Wall	Solid	Drywall	0.04
401	1926 Bldg.	30	XRF	2/25/98	1	Room-109	Wall	Wall-Lwr	Solid	Concrete	0.01
402	1926 Bldg.	106	XRF	2/18/98	1	Room-113	Door	Casing-Lft	Solid	Wood	0.03
403	1926 Bldg.	107	XRF	2/18/98	1	Room-113	Door	Door	Solid	Wood	0.06
404	1926 Bldg.	103	XRF	2/18/98	1	Room-113	Wall	Wall-Lwr	Cracked	Drywall	0.15
405	1926 Bldg.	104	XRF	2/18/98	1	Room-113	Wall	Baseboard	Solid	Wood	0.03
406	1926 Bldg.	105	XRF	2/18/98	1	Room-113	Wall	Wall-Lwr	Solid	Plaster	>>5.0
407	1926 Bldg.	112	XRF	3/11/98	1	Room-117	Ceiling		Solid	Plaster	>>5.0
408	1926 Bldg.	11	XRF	2/25/98	1	Room-124	Door	Casing-Rht	Peeling	Metal	0.03
409	1926 Bldg.	12	XRF	2/25/98	1	Room-124	Door	Door	Solid	Wood	0
410	1926 Bldg.	13	XRF	2/25/98	1	Room-124	Wall	Wall-Lwr	Solid	Drywall	>0.27
411	1926 Bldg.	14	XRF	2/25/98	1	Room-124	Wall	Wall-Lwr	Solid	Plaster	0.06
412	1926 Bldg.	8	XRF	2/25/98	1	Room-126	Door	Casing-Lft	Solid	Metal	0
413	1926 Bldg.	9	XRF	2/25/98	1	Room-126	Door	Door	Solid	Wood	0
414	1926 Bldg.	6	XRF	2/25/98	1	Room-126	Wall	Midle Wall	Solid	Drywall	0.04
415	1926 Bldg.	7	XRF	2/25/98	1	Room-126	Wall	Wall-Lwr	Peeling	Plaster	0.15
416	1926 Bldg.	10	XRF	2/25/98	1	Room-126		Radiator	Solid	Metal	0
417	1926 Bldg.	96	XRF	3/11/98	1	Room-202	Ceiling		Solid	Plaster	0.06
418	1926 Bldg.	29	XRF	2/17/98	2	Room-206	Door	Casing-Lft	Solid	Wood	0.08
419	1926 Bldg.	30	XRF	2/17/98	2	Room-206	Door	Door	Solid	Wood	0.06
420	1926 Bldg.	28	XRF	2/17/98	2	Room-206	Wall	Midle Wall	Solid	Drywall	0.08
421	1926 Bldg.	31	XRF	2/17/98	2	Room-206	Wall	Midle Wall	Solid	Plaster	0.18
422	1926 Bldg.	82	XRF	2/9/98	2	Room-208	Chalkboard	Rail	Peeling	Wood	0.1
423	1926 Bldg.	83	XRF	2/9/98	2	Room-208	Door	Casing-Lft	Solid	Wood	0.02
424	1926 Bldg.	84	XRF	2/9/98	2	Room-208	Door	Door	Solid	Wood	0.06
425	1926 Bldg.	81	XRF	2/9/98	2	Room-208	Wall	Midle Wall	Solid	Plaster	0.01
426	1926 Bldg.	80	XRF	2/9/98	2	Room-208		Radiator	Peeling	Metal	0.02
427	1926 Bldg.	99	XRF	3/11/98	1	Room-214	Ceiling		Solid	Plaster	>>5.0
428	1926 Bldg.	67	XRF	2/3/98	3	Room-311A	Door	Casing-Lft	Cracked	Wood	0.03
429	1926 Bldg.	68	XRF	2/3/98	3	Room-311A	Door	Door	Solid	Wood	0.06
430	1926 Bldg.	65	XRF	2/3/98	3	Room-311A	Wall	Wall-Lwr	Solid	Plaster	0.01
431	1926 Bldg.	66	XRF	2/3/98	3	Room-311A	Window	Stool	Solid	Wood	0.08
432	1926 Bldg.	77	XRF	2/3/98	3	Room-313A	Door	Casing-Rht	Solid	Metal	0
433	1926 Bldg.	78	XRF	2/3/98	3	Room-313A	Door	Door	Solid	Wood	0
434	1926 Bldg.	76	XRF	2/3/98	3	Room-313A	Wall	Midle Wall	Solid	Drywall	0
435	1926 Bldg.	94	XRF	3/11/98	1	Room-315	Ceiling		Solid	Plaster	3.41
436	1926 Bldg.	87	XRF	2/3/98	3	Room-315A	Door	Casing-Rht	Solid	Metal	0.04
437	1926 Bldg.	88	XRF	2/3/98	3	Room-315A	Door	Door	Solid	Wood	0
438	1926 Bldg.	89	XRF	2/3/98	3	Room-315A	Wall	Wall-Lwr	Solid	Plaster	0.03
439	1926 Bldg.	91	XRF	2/3/98	3	Room-315A	Window	Casing-Rht	Peeling	Wood	0.07
440	1926 Bldg.	90	XRF	2/3/98	3	Room-315A		Radiator	Peeling	Metal	1.7
441	1926 Bldg.	9	XRF	2/9/98	3	Room-316	Bookcase	Shelf	Solid	Wood	0

Saint Paul School District
 Wilson Expo for Excellence Middle School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K
3	Site	Sample#	Analysis	Date	Floor	Area	Component	Feature	Condition	Substrate	Result
442	1926 Bldg.	95	XRF	3/11/98	1	Room-316	Ceiling		Solid	Plaster	>>5.0
443	1926 Bldg.	6	XRF	2/9/98	3	Room-316	Door	Casing-Rht	Solid	Metal	0.05
444	1926 Bldg.	7	XRF	2/9/98	3	Room-316	Door	Door	Solid	Wood	0
445	1926 Bldg.	10	XRF	2/9/98	3	Room-316	Floor		Peeling	Wood	0
446	1926 Bldg.	8	XRF	2/9/98	3	Room-316	Wall	Midle Wall	Peeling	Plaster	0.12
447	1926 Bldg.	11	XRF	2/9/98	3	Room-316	Wall	Baseboard	Solid	Wood	0
448	1926 Bldg.	64	XRF	2/17/98	1	Stairwell-1	Door	Casing-Lft	Solid	Wood	0.04
449	1926 Bldg.	65	XRF	2/17/98	1	Stairwell-1	Door	Door	Solid	Wood	0.02
450	1926 Bldg.	71	XRF	2/17/98	1	Stairwell-1	Door	Door	Solid	Metal	0.18
451	1926 Bldg.	72	XRF	2/17/98	1	Stairwell-1	Door	Casing-Rht	Solid	Metal	0.18
452	1926 Bldg.	73	XRF	2/17/98	1	Stairwell-1	Door	Casing-Lft	Solid	Wood	0
453	1926 Bldg.	74	XRF	2/17/98	1	Stairwell-1	Door	Door	Solid	Wood	0
454	1926 Bldg.	67	XRF	2/17/98	1	Stairwell-1	Stairs	Wall	Solid	Plaster	>>5.0
455	1926 Bldg.	68	XRF	2/17/98	1	Stairwell-1	Stairs	Hand rail	Solid	Wood	0
456	1926 Bldg.	69	XRF	2/17/98	1	Stairwell-1	Stairs	Baseboard-Ins	Solid	Concrete	0.2
457	1926 Bldg.	70	XRF	2/17/98	1	Stairwell-1	Stairs	Rail cap	Solid	Plaster	0.22
458	1926 Bldg.	66	XRF	2/17/98	1	Stairwell-1	Wall	Chair rail	Solid	Wood	0.02
459	1926 Bldg.	75	XRF	2/17/98	1	Stairwell-1		Radiator	Solid	Metal	0.34
460	1926 Bldg.	76	XRF	2/17/98	1	Stairwell-1		Radiator	Solid	Metal	0.2
461	1926 Bldg.	77	XRF	2/17/98	1	Stairwell-2	Door	Door	Solid	Metal	0.26
462	1926 Bldg.	78	XRF	2/17/98	1	Stairwell-2	Door	Casing-Rht	Solid	Metal	0.23
463	1926 Bldg.	81	XRF	2/17/98	1	Stairwell-2	Stairs	Hand rail	Solid	Wood	0
464	1926 Bldg.	82	XRF	2/17/98	1	Stairwell-2	Stairs	Baseboard-Ins	Solid	Concrete	0.12
465	1926 Bldg.	83	XRF	2/17/98	1	Stairwell-2	Stairs	Rail cap	Solid	Plaster	0
466	1926 Bldg.	79	XRF	2/17/98	1	Stairwell-2	Wall	Chair rail	Solid	Wood	0.03
467	1926 Bldg.	80	XRF	2/17/98	1	Stairwell-2	Wall	Wall-Lwr	Solid	Plaster	4.05
468	1926 Bldg.	84	XRF	2/17/98	1	Stairwell-2		Radiator	Peeling	Metal	0.06
469	1926 Bldg.	71	XRF	3/10/98	1	Stairwell-3	Door	Door	Solid	Metal	0.15
470	1926 Bldg.	72	XRF	3/10/98	1	Stairwell-3	Door	Casing-Lft	Solid	Metal	0.15
471	1926 Bldg.	64	XRF	3/10/98	1	Stairwell-3	Stairs	Rail cap	Solid	Plaster	0.65
472	1926 Bldg.	65	XRF	3/10/98	1	Stairwell-3	Stairs	Hand rail	Peeling	Wood	0.02
473	1926 Bldg.	67	XRF	3/10/98	1	Stairwell-3	Stairs	Wall	Solid	Plaster	4.26
474	1926 Bldg.	70	XRF	3/10/98	1	Stairwell-3	Stairs	Hand rail	Solid	Metal	0
475	1926 Bldg.	66	XRF	3/10/98	1	Stairwell-3	Wall	Baseboard	Peeling	Metal	0.1
476	1926 Bldg.	69	XRF	3/10/98	1	Stairwell-3	Wall	Chair rail	Solid	Wood	0.05
477	1926 Bldg.	68	XRF	3/10/98	1	Stairwell-3		Radiator	Solid	Metal	>3.89
478	1964 Bldg.	22	XRF	2/25/98	1	Auditorium-122	Cabinet	Door-Out	Cracked	Wood	0
479	1964 Bldg.	18	XRF	2/25/98	1	Auditorium-122	Door	Casing-Lft	Solid	Metal	0.01
480	1964 Bldg.	19	XRF	2/25/98	1	Auditorium-122	Door	Door	Solid	Wood	0
481	1964 Bldg.	21	XRF	2/25/98	1	Auditorium-122	Door	Door	Solid	Metal	0.01
482	1964 Bldg.	24	XRF	2/25/98	1	Auditorium-122	Stairs	Hand rail	Solid	Metal	0
483	1964 Bldg.	15	XRF	2/25/98	1	Auditorium-122	Wall	Wall-Lwr	Solid	Plaster	0.56
484	1964 Bldg.	16	XRF	2/25/98	1	Auditorium-122	Wall	Wall-Lwr	Solid	Plaster	>>5.0
485	1964 Bldg.	17	XRF	2/25/98	1	Auditorium-122	Wall	Wall-Lwr	Solid	Plaster	>>5.0
486	1964 Bldg.	20	XRF	2/25/98	1	Auditorium-122	Wall	Midle Wall	Solid	Plaster	0.05
487	1964 Bldg.	23	XRF	2/25/98	1	Auditorium-122	Wall	Midle Wall	Solid	Plaster	0.11
488	1964 Bldg.	39	XRF	2/25/98	1	Gym-115	Door	Casing-Lft	Solid	Wood	0.04
489	1964 Bldg.	40	XRF	2/25/98	1	Gym-115	Door	Door	Solid	Wood	0.07
490	1964 Bldg.	41	XRF	2/25/98	1	Gym-115	Door	Door	Cracked	Wood	0.08
491	1964 Bldg.	45	XRF	2/25/98	1	Gym-115	Door	Door	Solid	Metal	0
492	1964 Bldg.	46	XRF	2/25/98	1	Gym-115	Door	Door	Solid	Wood	0
493	1964 Bldg.	37	XRF	2/25/98	1	Gym-115	Wall	Wall-Upr	Solid	Wood	0.26
494	1964 Bldg.	38	XRF	2/25/98	1	Gym-115	Wall	Wall-Upr	Solid	Plaster	>>5.0
495	1964 Bldg.	42	XRF	2/25/98	1	Gym-115	Wall	Wall-Upr	Solid	Plaster	0.36
496	1964 Bldg.	43	XRF	2/25/98	1	Gym-115	Wall	Wall-Upr	Solid	Plaster	0.47

Saint Paul School District
 Wilson Expo for Excellence Middle School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K
3	Site	Sample#	Analysis	Date	Floor	Area	Component	Feature	Condition	Substrate	Result
497	1964 Bldg.	44	XRF	2/25/98	1	Gym-115	Wall	Wall-Upr	Solid	Plaster	0.07
498	1964 Bldg.	34	XRF	2/25/98	1	Gym-115	Window	Sash-Lwr	Cracked	Wood	0.29
499	1964 Bldg.	35	XRF	2/25/98	1	Gym-115	Window	Sill-Ext	Peeling	Wood	>>5.0
500	1964 Bldg.	36	XRF	2/25/98	1	Gym-115	Window	Mullion	Solid	Tile	0.98
501	1964 Bldg.	33	XRF	2/25/98	1	Gym-115		Radiator	Peeling	Metal	3.22

APPENDIX C

INSPECTOR

Bob Hargrove
MDH Lead Inspector # 416