


Midwest
Environmental
Consulting, L.L.C.

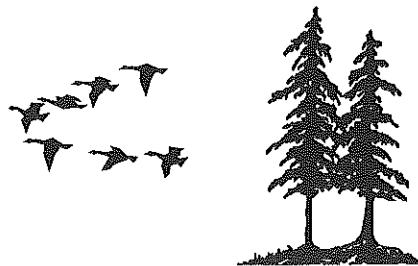

 Printed on Recycled Paper

**Maxfield Magnet School of Academic Excellence
Saint Paul Public Schools**

Lead-Based Paint Inspection

Inspection Dates: 4/5/97, 4/6/97, 4/13/97, 4/19/97

submitted to:

Saint Paul Public Schools

MEC Project # 62/0197L

INTRODUCTION

At the request of Saint Paul Public Schools Environmental Safety Department, Midwest Environmental Consulting, L.L.C. (MEC), conducted a lead-based paint inspection at Maxfield Magnet School, Victoria & St. Anthony, St. Paul, MN. The purpose of this inspection was to identify lead-based painted, varnished, or otherwise coated building components on the interior and exterior of the school building.

The inspection protocol incorporated applicable portions of the U.S. Department of Housing and Urban Development (HUD) *Guidelines for the Evaluation and Control of Lead-based Paint Hazards in Housing* (HUD Guidelines, June 1995) and OSHA 1926.62 requirements (Lead in Construction). The HUD guidelines are formulated to guide agencies in conducting random sampling of the interiors and exteriors of dwellings and common areas in public housing. The OSHA requirement is designed to minimize worker exposure when working with material containing lead.

Confirmatory testing was conducted when inconclusive XRF results were encountered. Inconclusive refers to XRF readings less than 0.2 mg/cm² (milligrams per square centimeter). Inconclusive results were confirmed with laboratory analysis of paint chip samples (Appendix B). This report contains a list of such results.

The United States Environmental Protection Agency defines "lead-based paint" as a paint or other surface coating that contains lead equal to or in excess of 1.0 milligrams per square centimeter when analyzed by XRF or more than 0.5% by weight (5000 parts per million) by laboratory analysis of a bulk sample.

Minnesota Department of Labor and Industry (MN OSHA) adopted the EPA lead levels for the purpose of enforcing OSHA 1926.62 federal regulations. Detection of lead in dried paint film by XRF is a dependable indicator of levels of lead and is accepted by MN OSHA.

For this Saint Paul Public Schools Lead Inspection, all building components were tested on site using a Niton XL® X-ray Fluorescence Spectrum Analyzer⁽¹⁾. Building components included walls, ceilings, floors, moldings, window and door components, door surfaces, and miscellaneous features such as shelves or bookcases. Only painted or glazed surfaces or surfaces which were varnished were tested. Suspended ceilings, structural steel, and corrugated decking were not included in the inspection. Neither anodized (e.g., window sashes) nor plastic (e.g., vinyl baseboard and vinyl mini-blinds) were included in the scope of this inspection.

⁽¹⁾ This is a portable hand held machine that can analyze building components instantly for lead concentrations.

Each building was divided into unique sites based on the year of construction or renovation. Portable classrooms, playgrounds, and other detached buildings were automatically designated as a unique site. Each site was inspected independently assuming differences in painting history and construction characteristics.

SITE DESCRIPTION AND BUILDING HISTORY

According to information provided to MEC by Saint Paul Public Schools, Maxfield Magnet School was constructed in essentially two phases. The initial phase includes the 32,517 square-foot older section of the building and dates from 1956. The second phase of 34,333 square feet dates from 1974.

All room and area designations used in this report are depicted on sampling maps found in Appendix A.

XRF SAMPLE RESULTS TABLE

The results of all samples analyzed are listed in the table at the end of this section. The following is a description of the column headings:

Site	Each school is divided into sites based on their unique construction characteristics. Each site has a unique date of construction or major renovation.
Sample #	Each sample taken was given a unique number to identify the type and location of the sample. The sampling date is an integral part of the sample number.
Analysis	This defines the type of analysis which can be categorized into two types: 1) XRF: This is an on-site analysis using a hand held Niton XL® X-ray Fluorescence Spectrum Analyzer; 2) Bulk or Chip: This is a bulk sample where paint is removed from the substrate and sent to a laboratory for analysis;
Floor	This is the level of the building in which the area tested was found, example, 1 (first floor), 0 (basement), etc.
Area	This further defines the specific functional space inspected such as a classroom, exterior, playground, gym, kitchen, etc.

Room #	This is typically the actual number on the room as identified at the building.
Component	Building "components" included walls, ceilings, floors, moldings, window and door components, door surfaces, and miscellaneous features such as shelves or bookcases.
Feature	Identifies more detailed information of the component.
Condition	This describes condition of the surface, whether it is intact, cracked, peeling, or chalking.
Substrate	This refers to the material the building component is made of (wood, concrete, drywall, metal, etc.).
Result	This is the analysis results for lead. Less than 1.0 mg/cm ² or less than 0.5% by weight is considered to be non-lead and these building components are below the action levels of EPA and HUD. (All results are in mg/cm ² except where noted.)

The table of results is designed for quick information on lead concentrations of tested building components. Generally, all repetitions of a test combination within a given room or area, may be assumed to contain similar concentrations of lead to that of the tested sample. For instance, the lead concentration of a tested wooden window sash was found to be above the action level of 1.0 mg/cm² in a given classroom. The classroom has five windows, all of wood, the same color and appearing to be of the same era. It can be assumed that the remaining four wooden window sashes each contain lead above the action limit.

Other columns identify the component and the component feature tested, condition of the component, type of substrate and the result of the analytical test.

As an example, the following illustration shows that the wooden door jamb in Room 123, first floor in the 1923 building section was in good, solid condition, and had an XRF test result of 0.3 mg/cm², which is below the action level.

Illustration Only

Site	Sample #	Date	Analysis	Floor	Area	Room #	Component	Feature	Condition	Substrate	Results
1923 Bldg.	52		XRF	1	Room	123	Door	Jamb	Solid	Wood	0.3

In a similar manner, the table shows that the plaster walls in room 23, on the second floor has peeling paint with more than 1.0 mg/cm² (shaded).

ILLUSTRATION ONLY

Site	Sample #	Date	Analysis	Floor	Area	Room #	Component	Feature	Condition	Substrate	Results
1910 Bldg.	16		XRF	2	Room	23	Door	Jamb	Peeling	Wood	0.25
1910 Bldg.	17		XRF	2	Room	23	Wall	Wall	Peeling	Plaster	1.2
1910 Bldg.	18		XRF	2	Room	23	Ceiling	Peeling	Plaster		0.25
1910 Bldg.	19		XRF	2	Room	23	Wall	Baseboard	Peeling	Wood	0.002

APPLICABLE REGULATIONS


When building components test above 1.0 mg/cm² of lead by XRF or 0.5% lead by weight from laboratory analysis all employees and contractors who will be working with these components in a construction related activity must be notified. The requirements of OSHA 1926.62, Lead in Construction are enforceable. This regulation defines construction work as "work for construction, alteration and/or repair, including painting and decorating." This regulation further defines monitoring requirements to minimize employee exposure to lead during construction activities.


When work is performed on external painted building structures (i.e. flashing, fire escapes, playground equipment, handrails, etc.), regulations of the Minnesota Pollution Control Agency (MPCA) may also be applicable. For removal of lead based paint from steel structures, MN Rules 7025.0200 - 7025.0380 apply to steel materials on the exterior of a building, or on the property when levels exceed 0.5 mg/cm² based on the average of three XRF spectrum results of the sample tested, or 5,000 ppm by laboratory analysis. If it is other than a steel surface, then MPCA regulates the painted surfaces under MN Rules 7025.010 - 7025.0080, when surfaces are to be disturbed using abrasive blasting methods.


Please contact MEC directly if you have questions about any portion of this report or the lead-based paint inspection itself.

APPENDIX A


XRF TESTING DATA WITH LOCATION MAPS

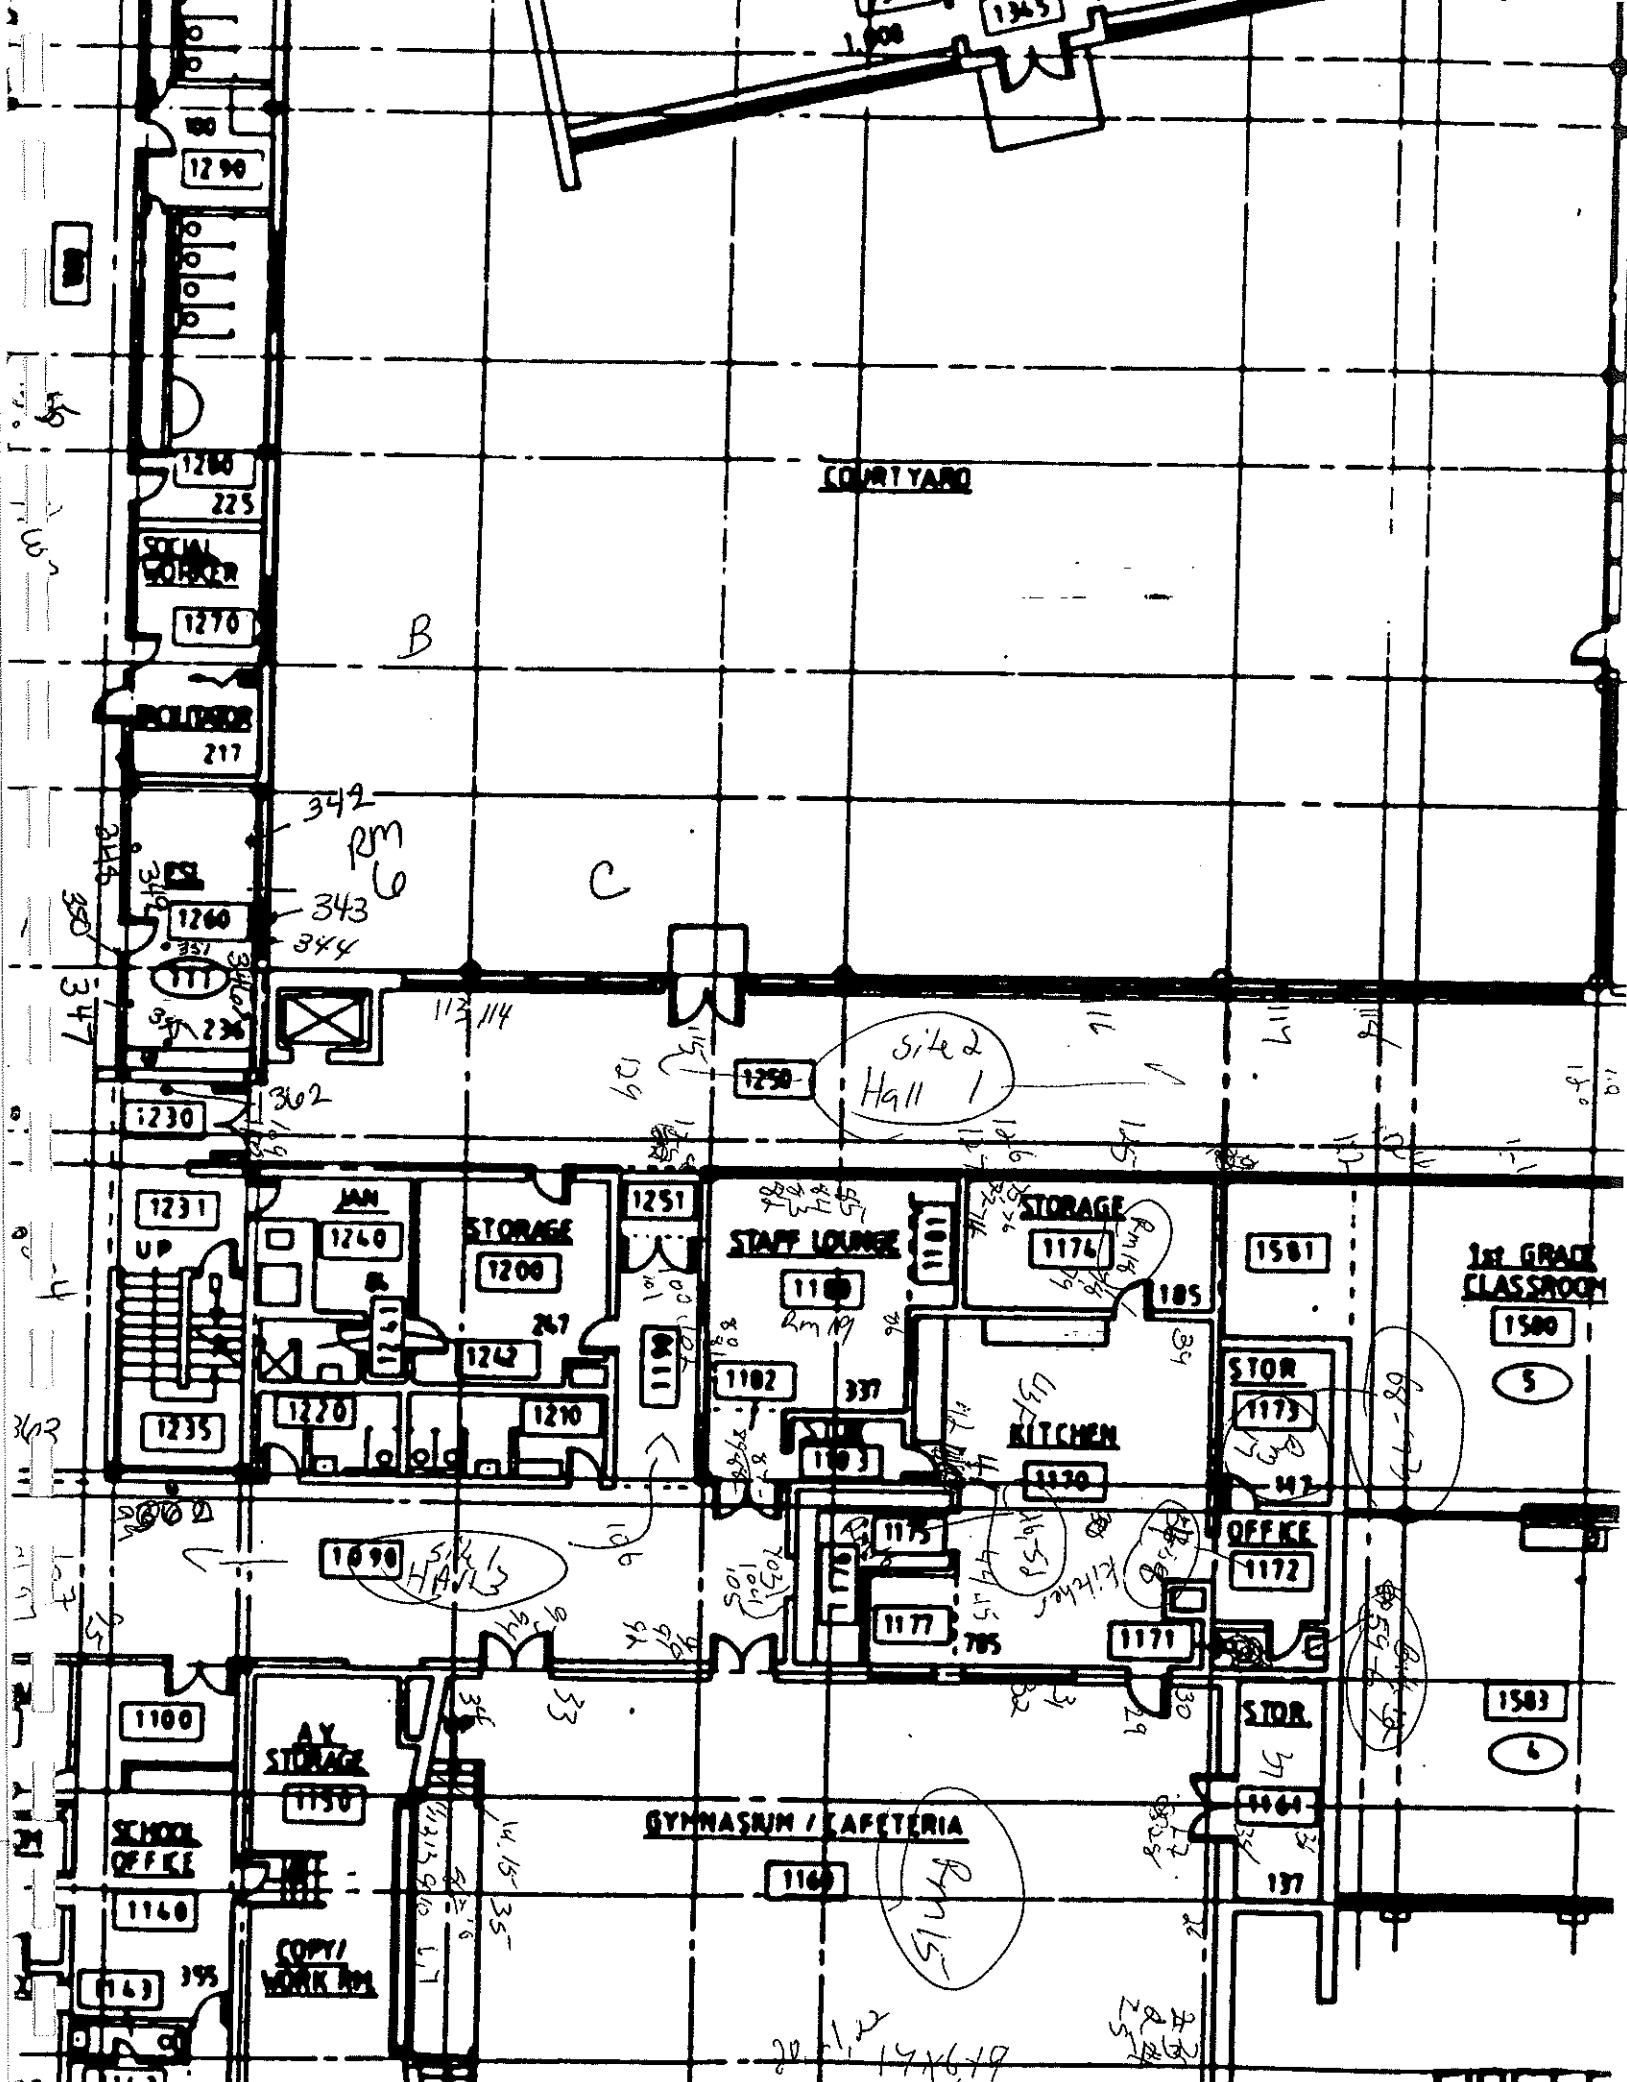

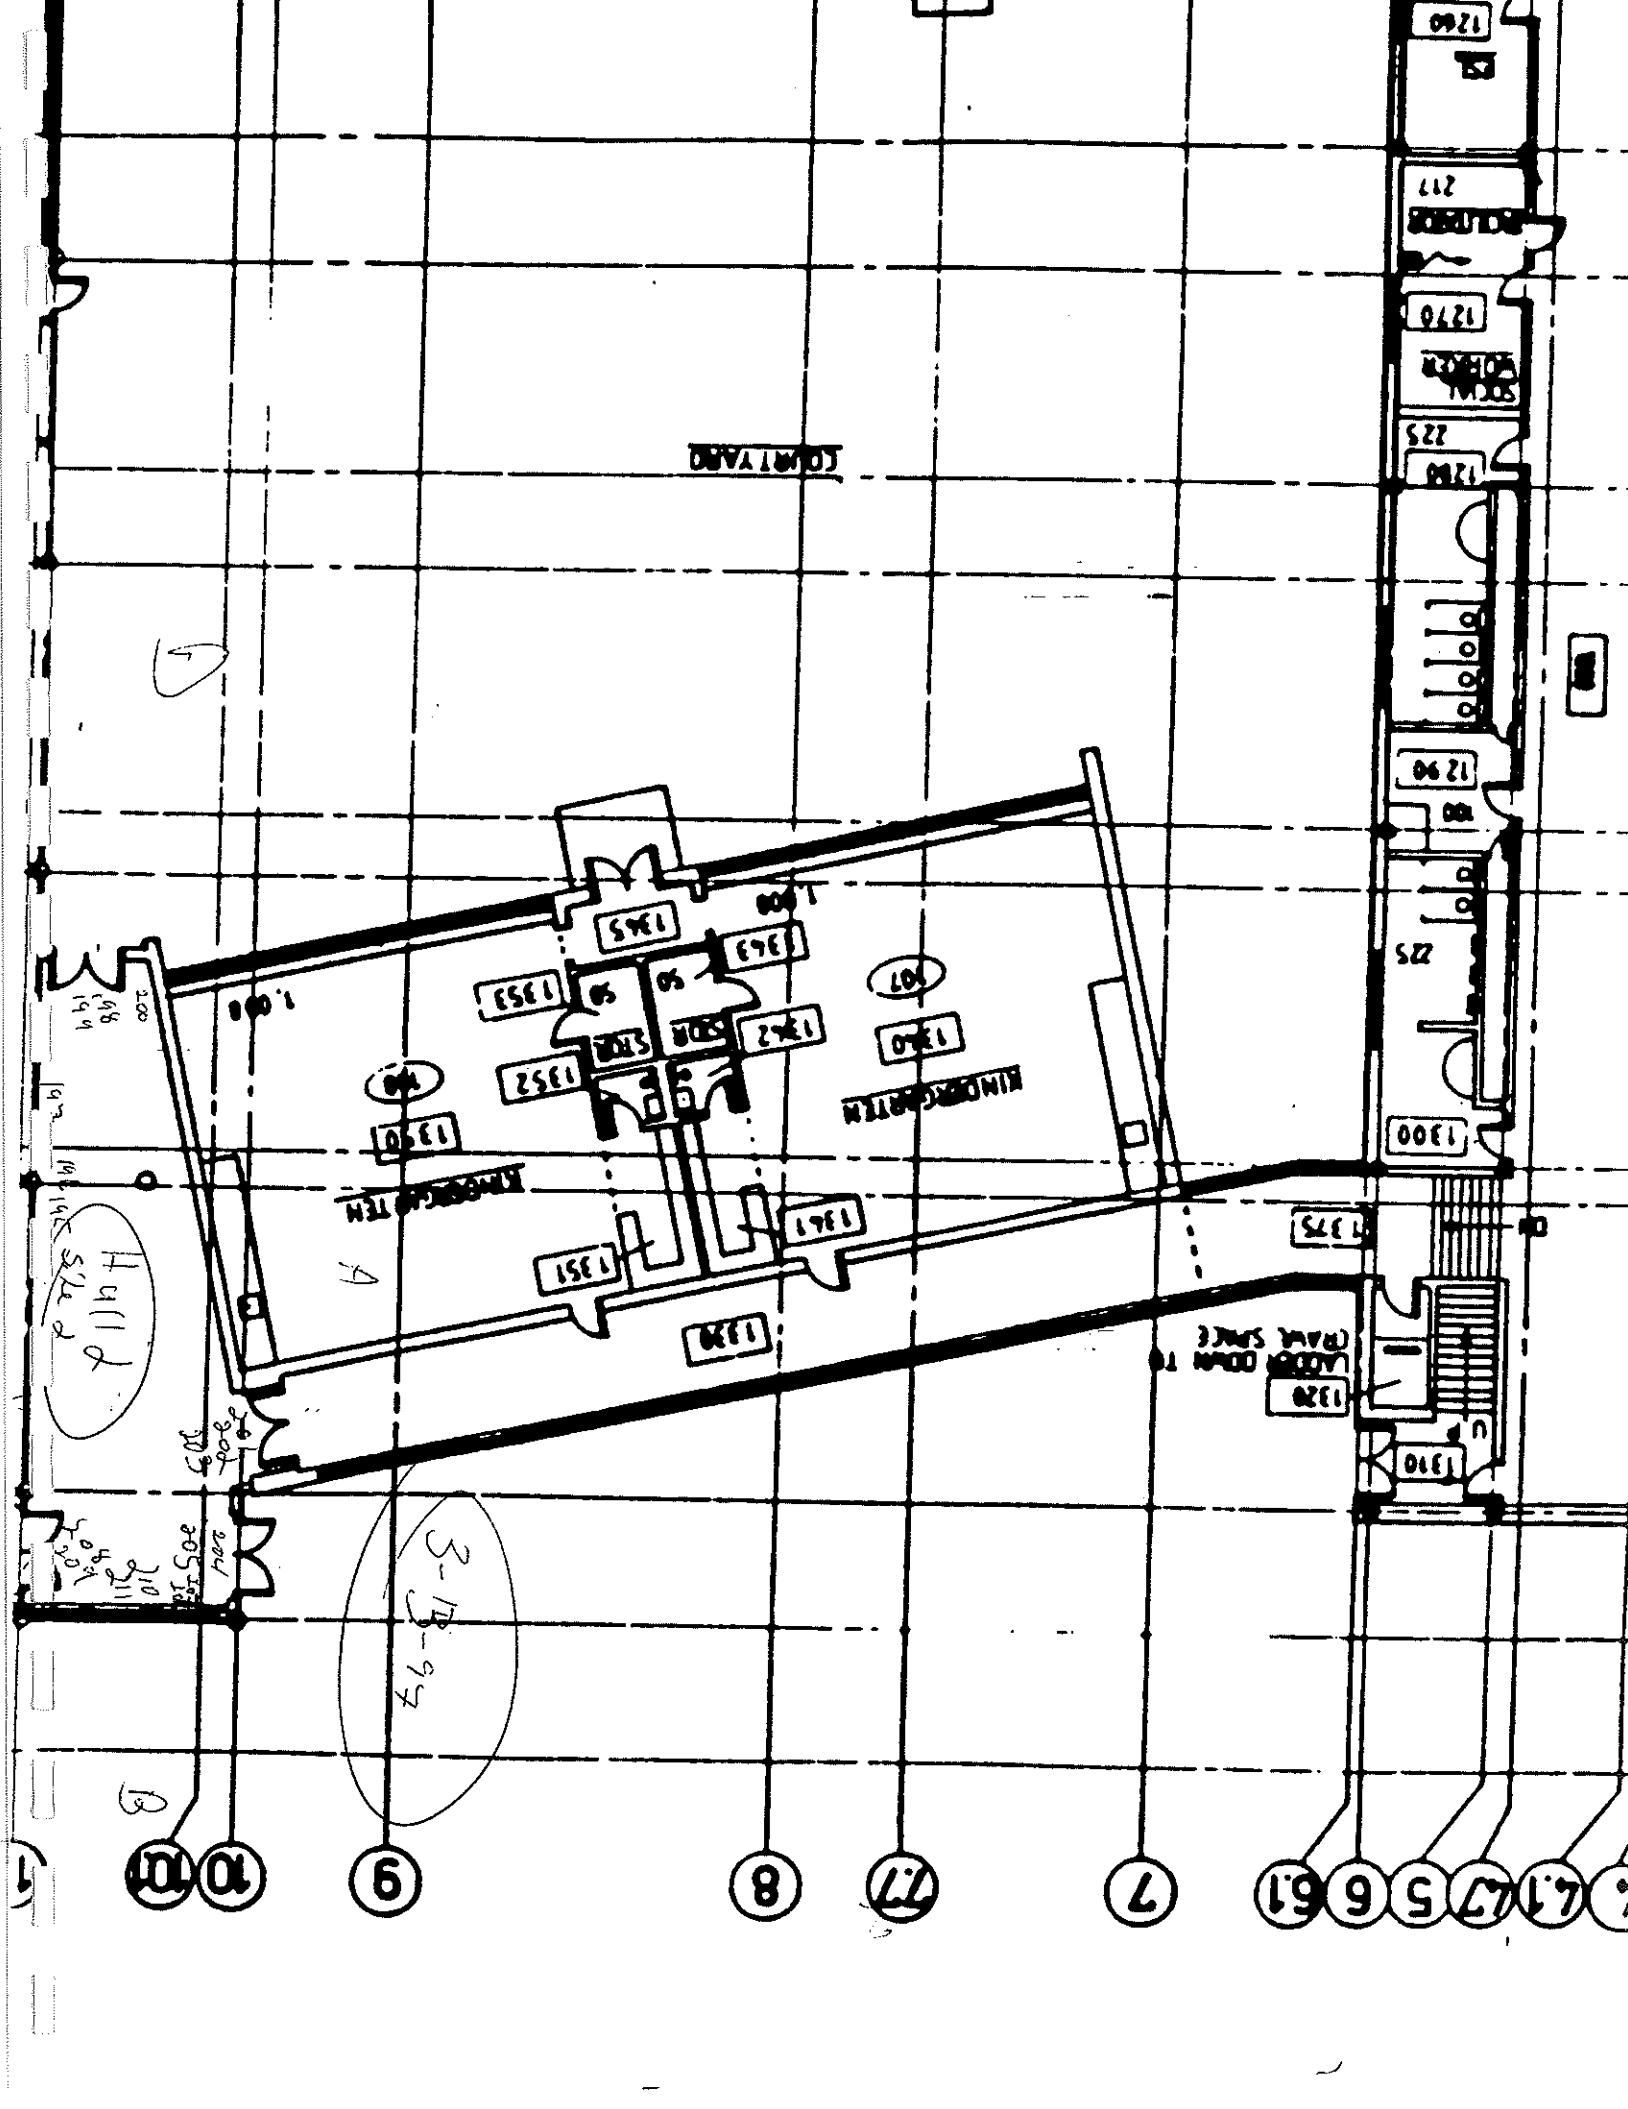

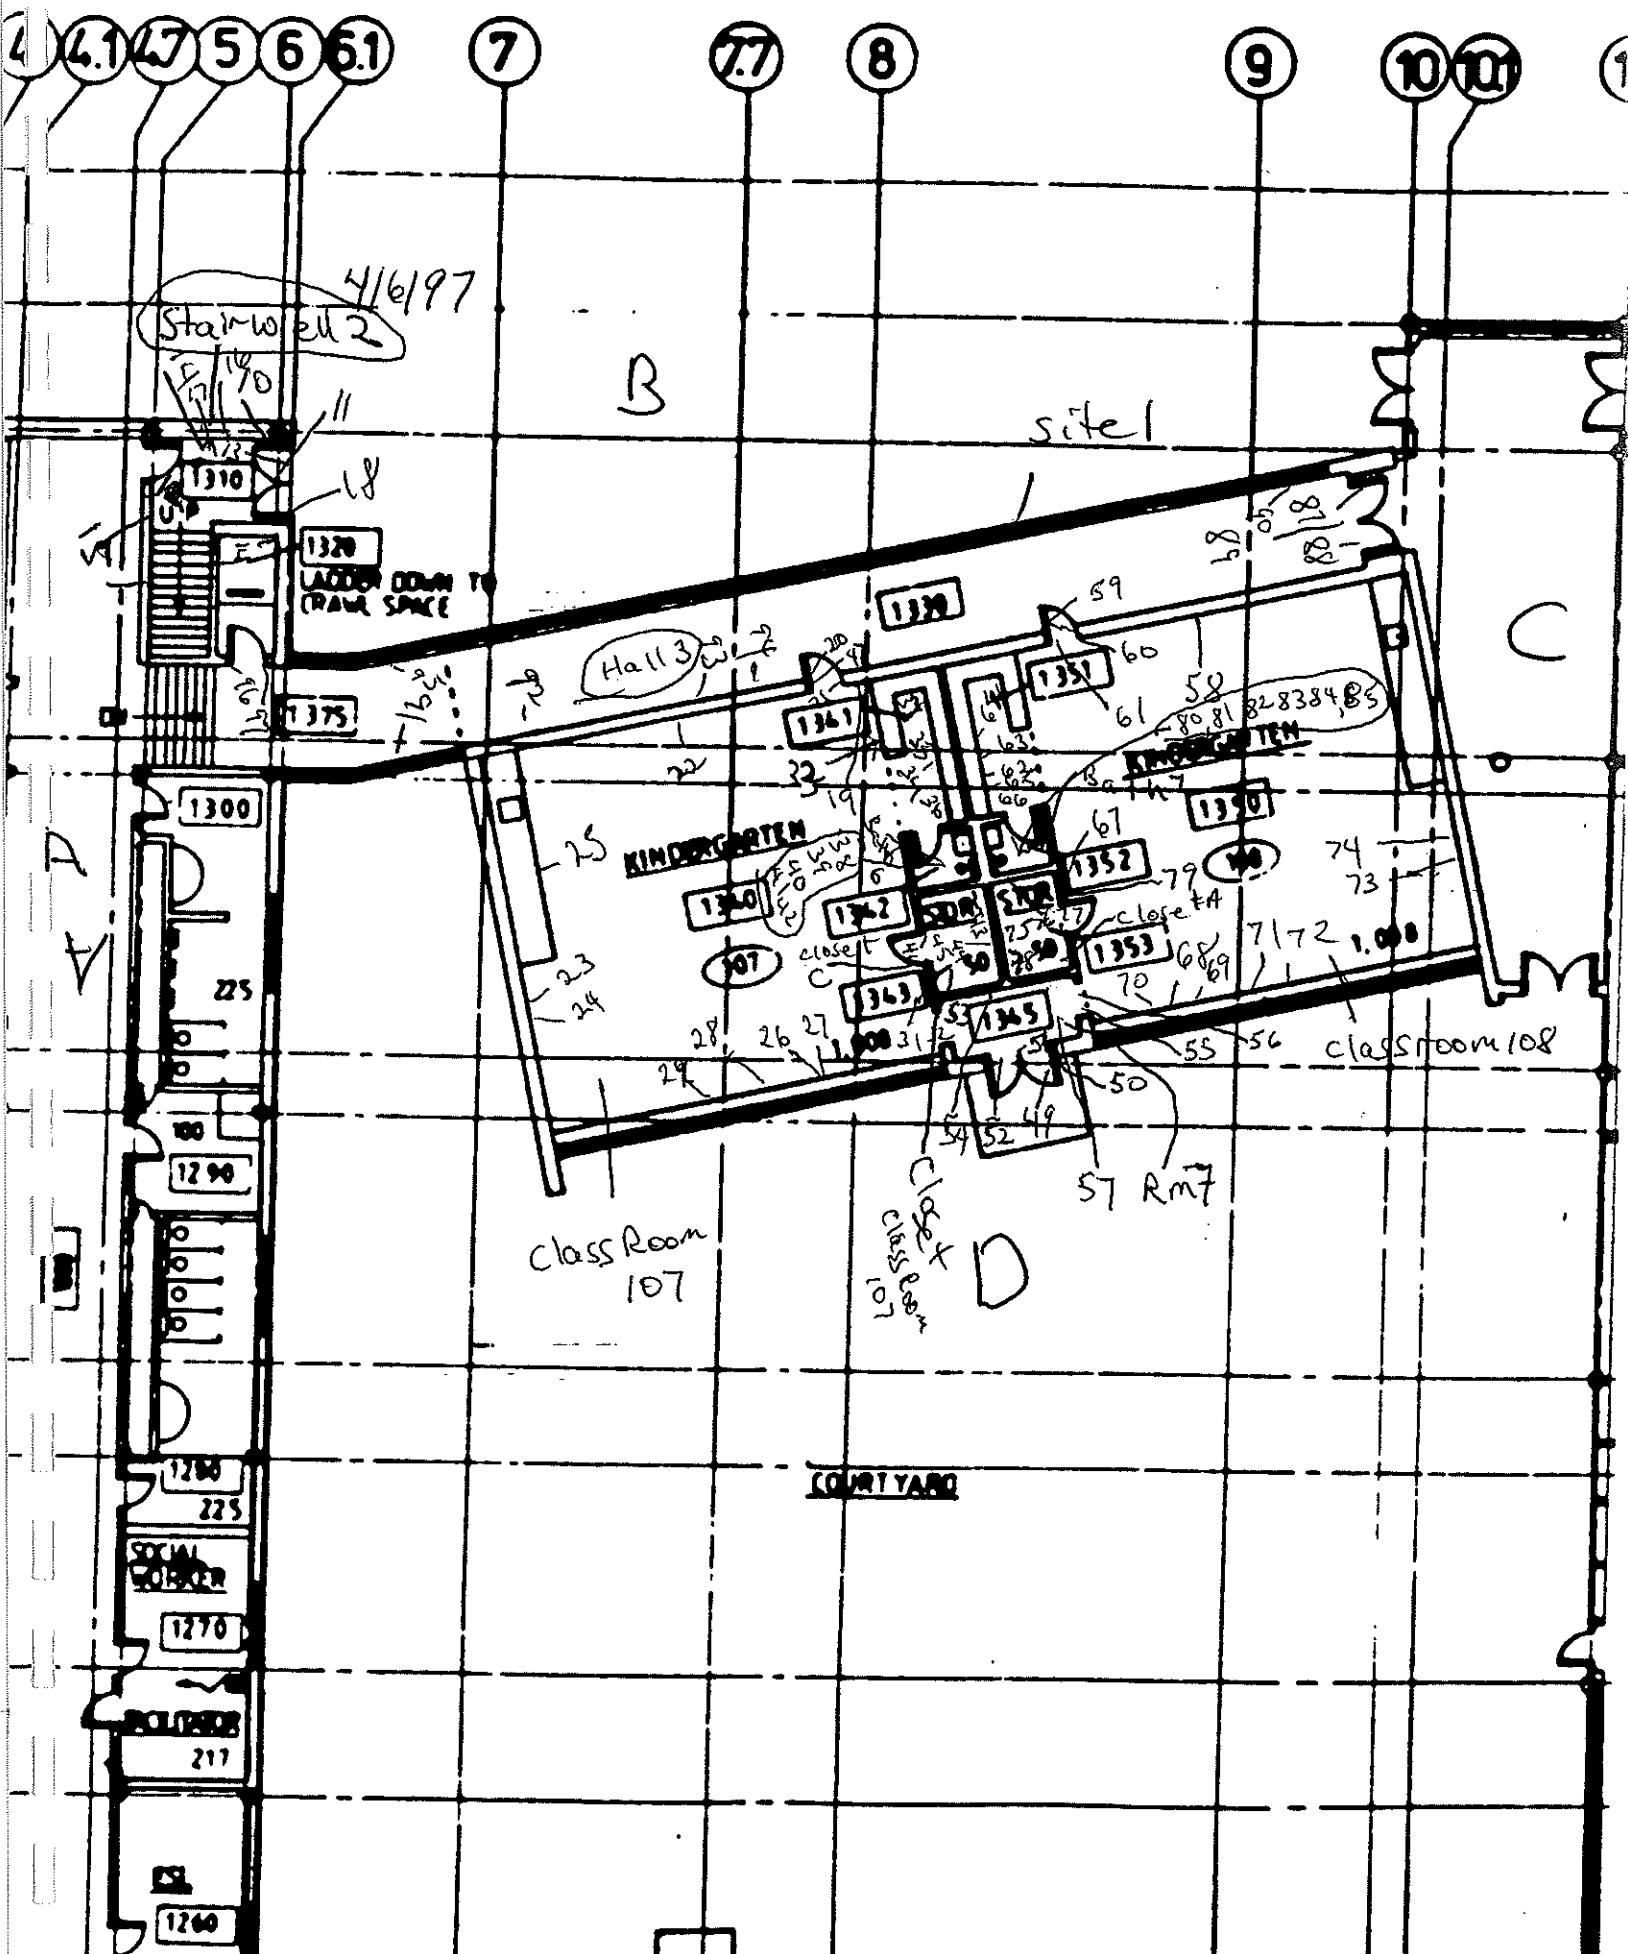

1) 245

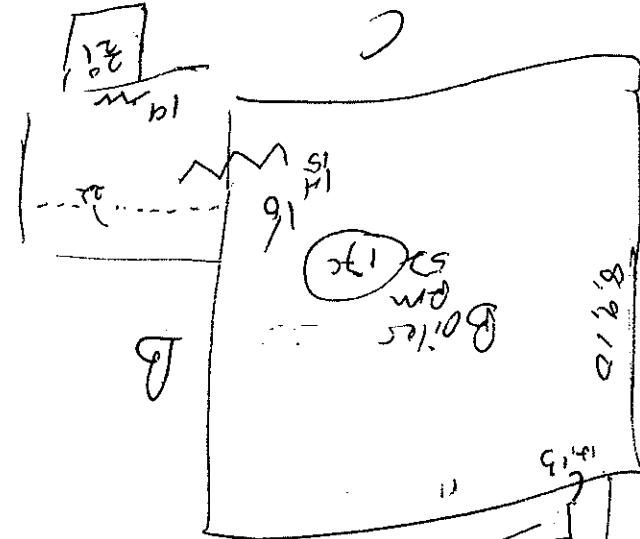


W 121.09 ft 3 ft 11 ft 5 ft
EG-SE

(1)


INDEPENDENT SCHOOL DIST #625
360 COLBORNE STREET
ST. PAUL, MINNESOTA 55102

MAXFIELD ELEMENTARY
VICTORIA & ST. ANTHONY
ST. PAUL, MN 55104

CONSTRUCTED: 1974

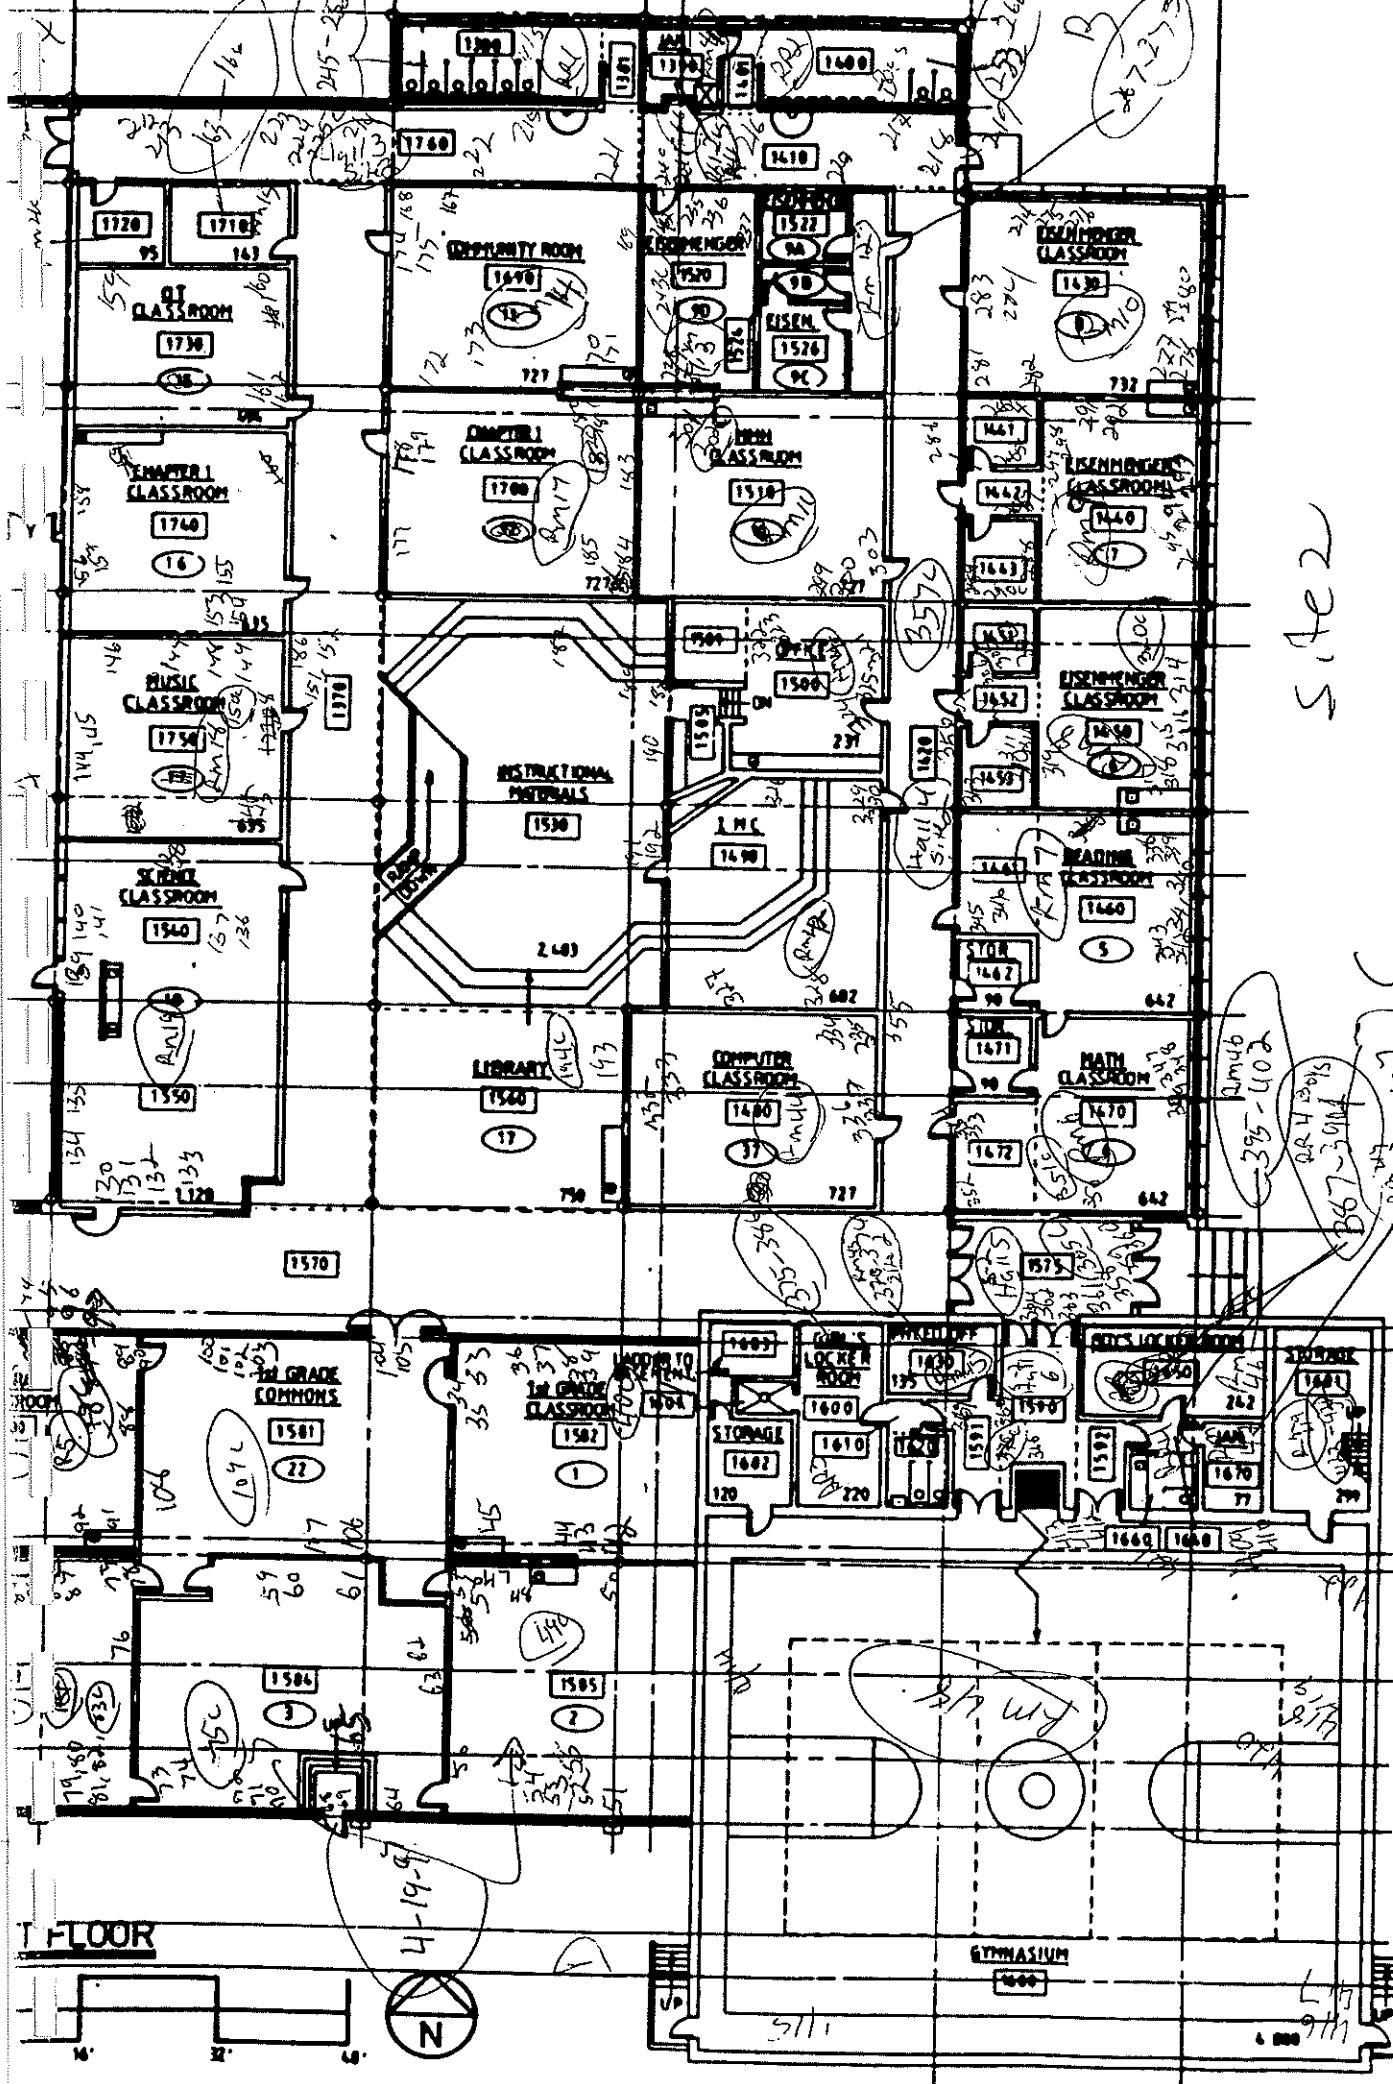


4/5/97

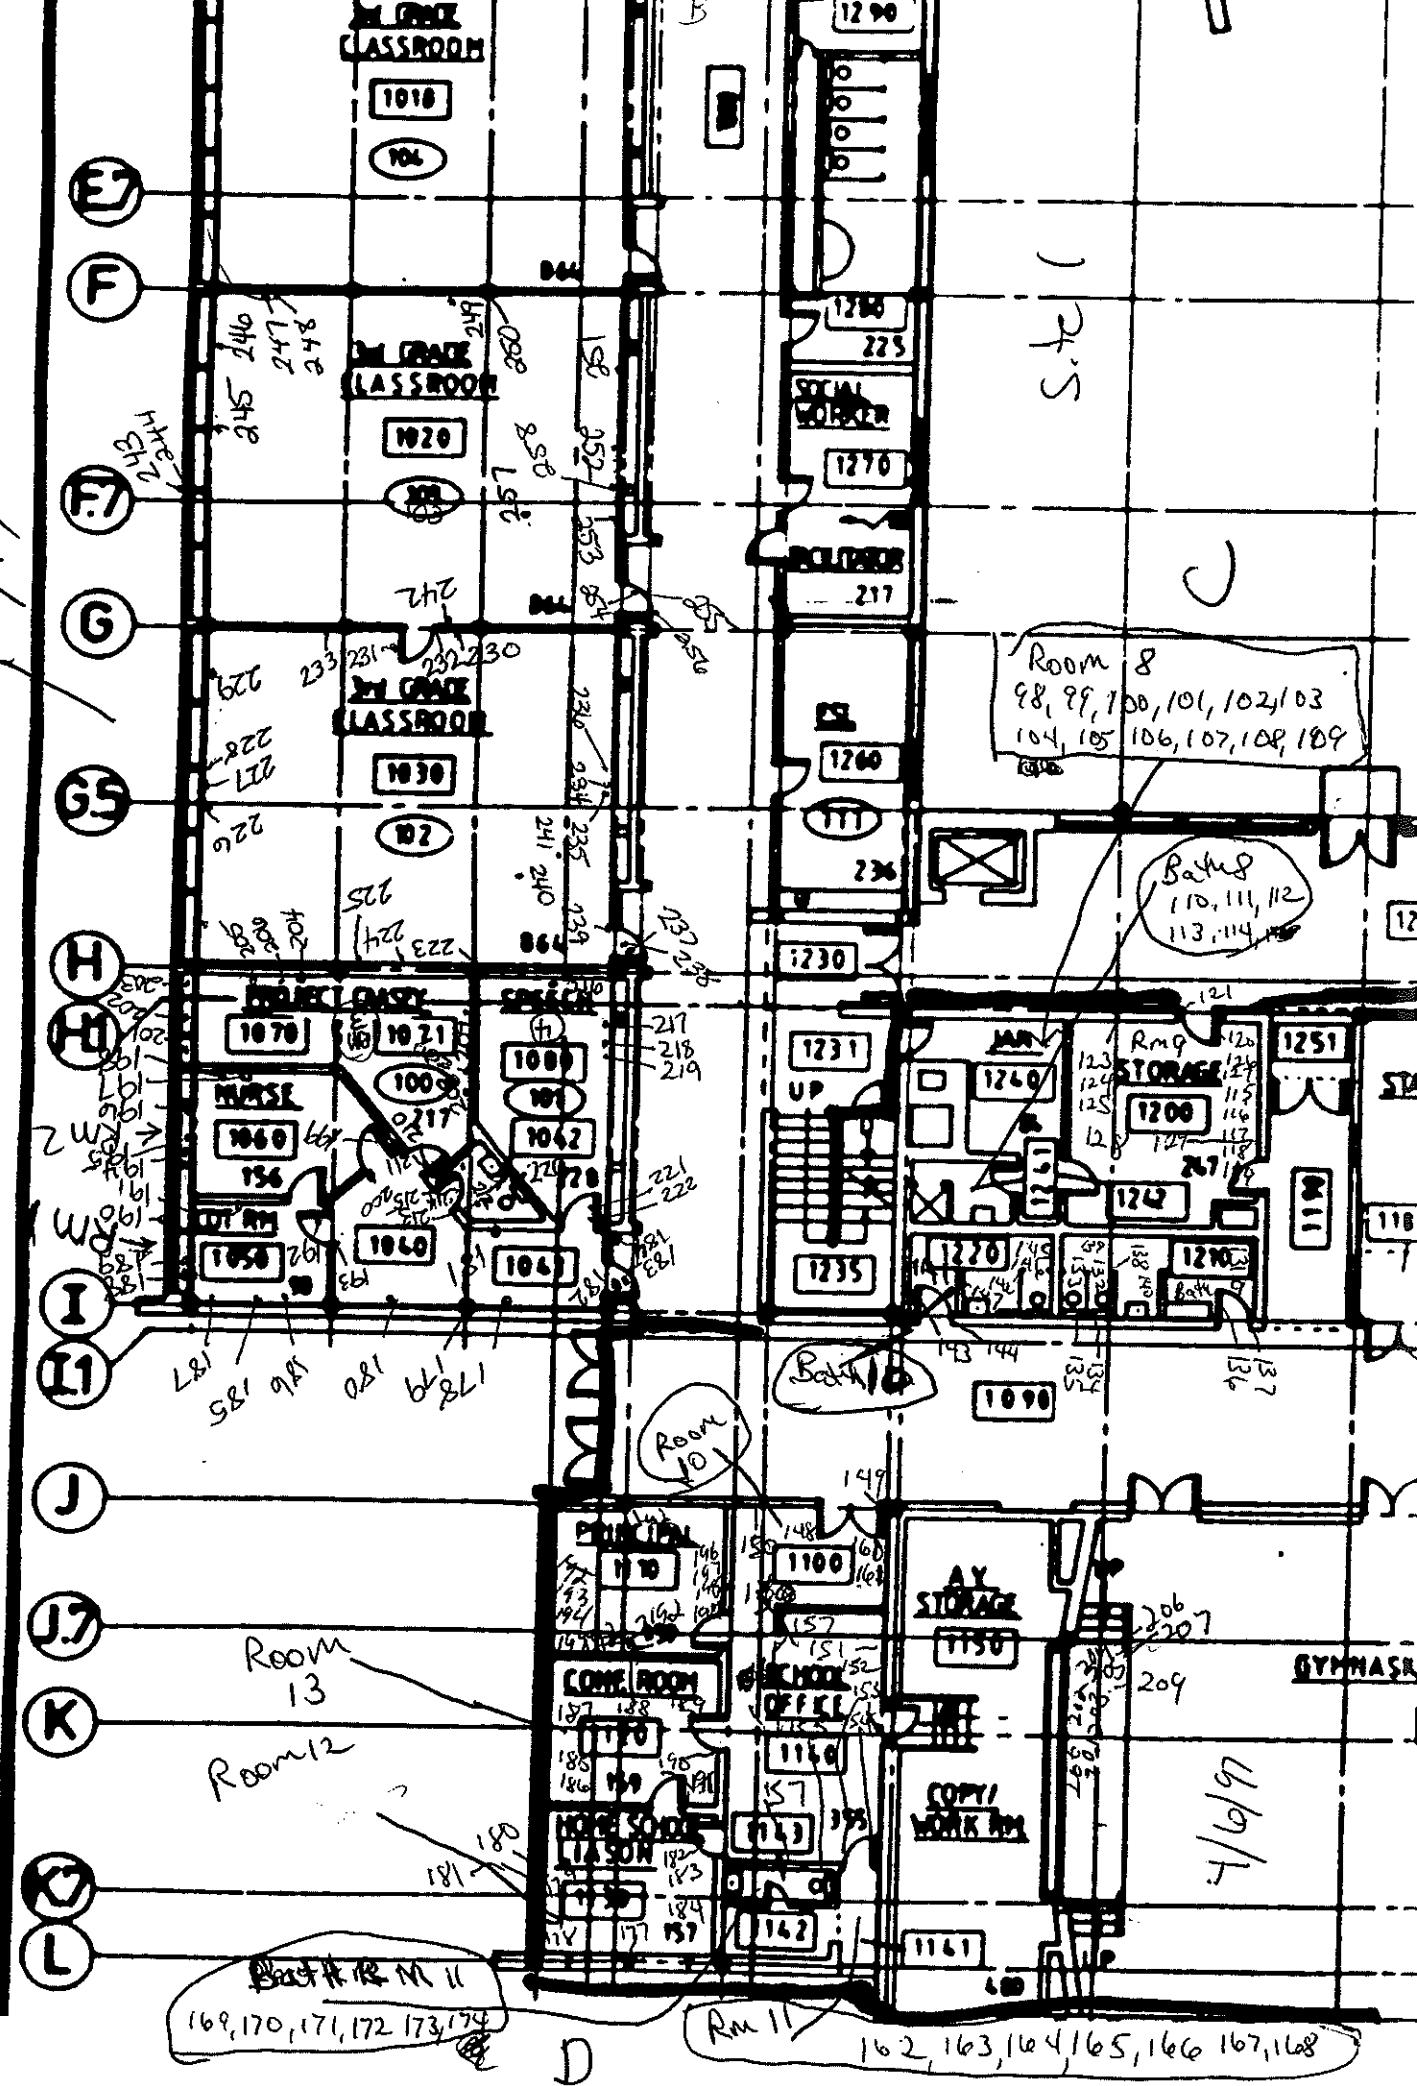


14-5-97


一
四

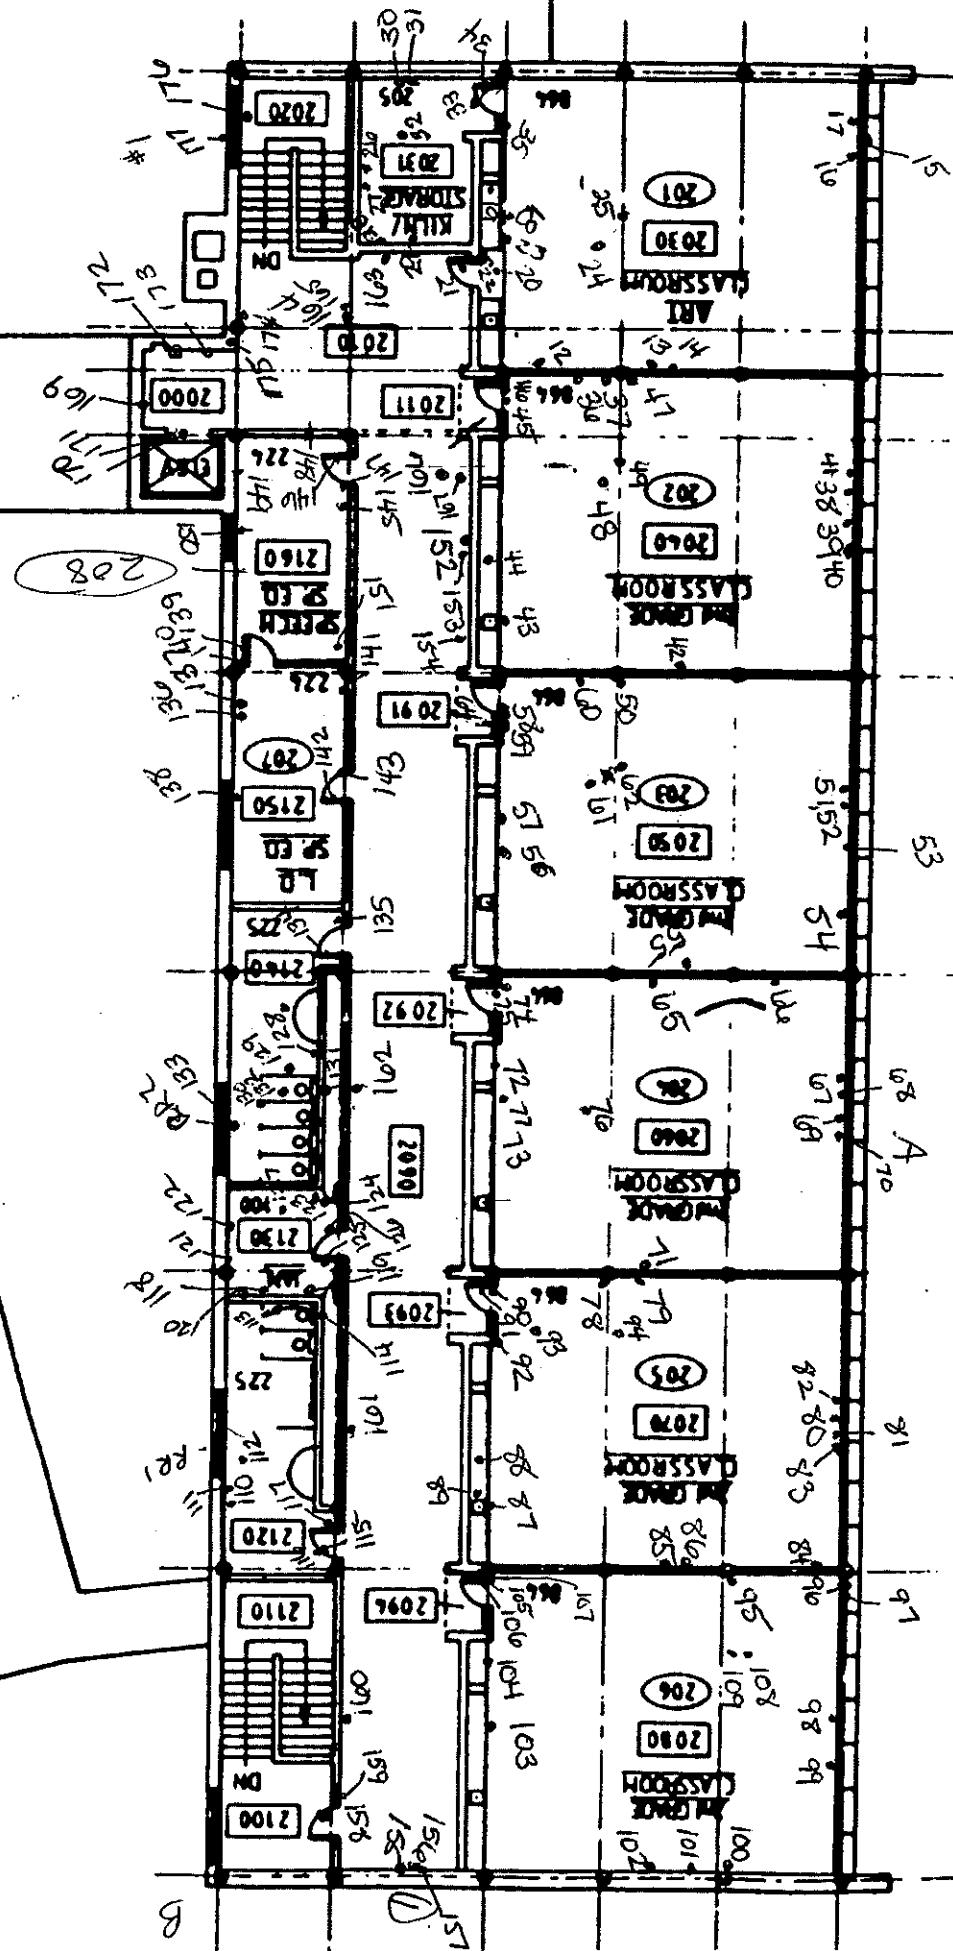

21-5-97

一
四

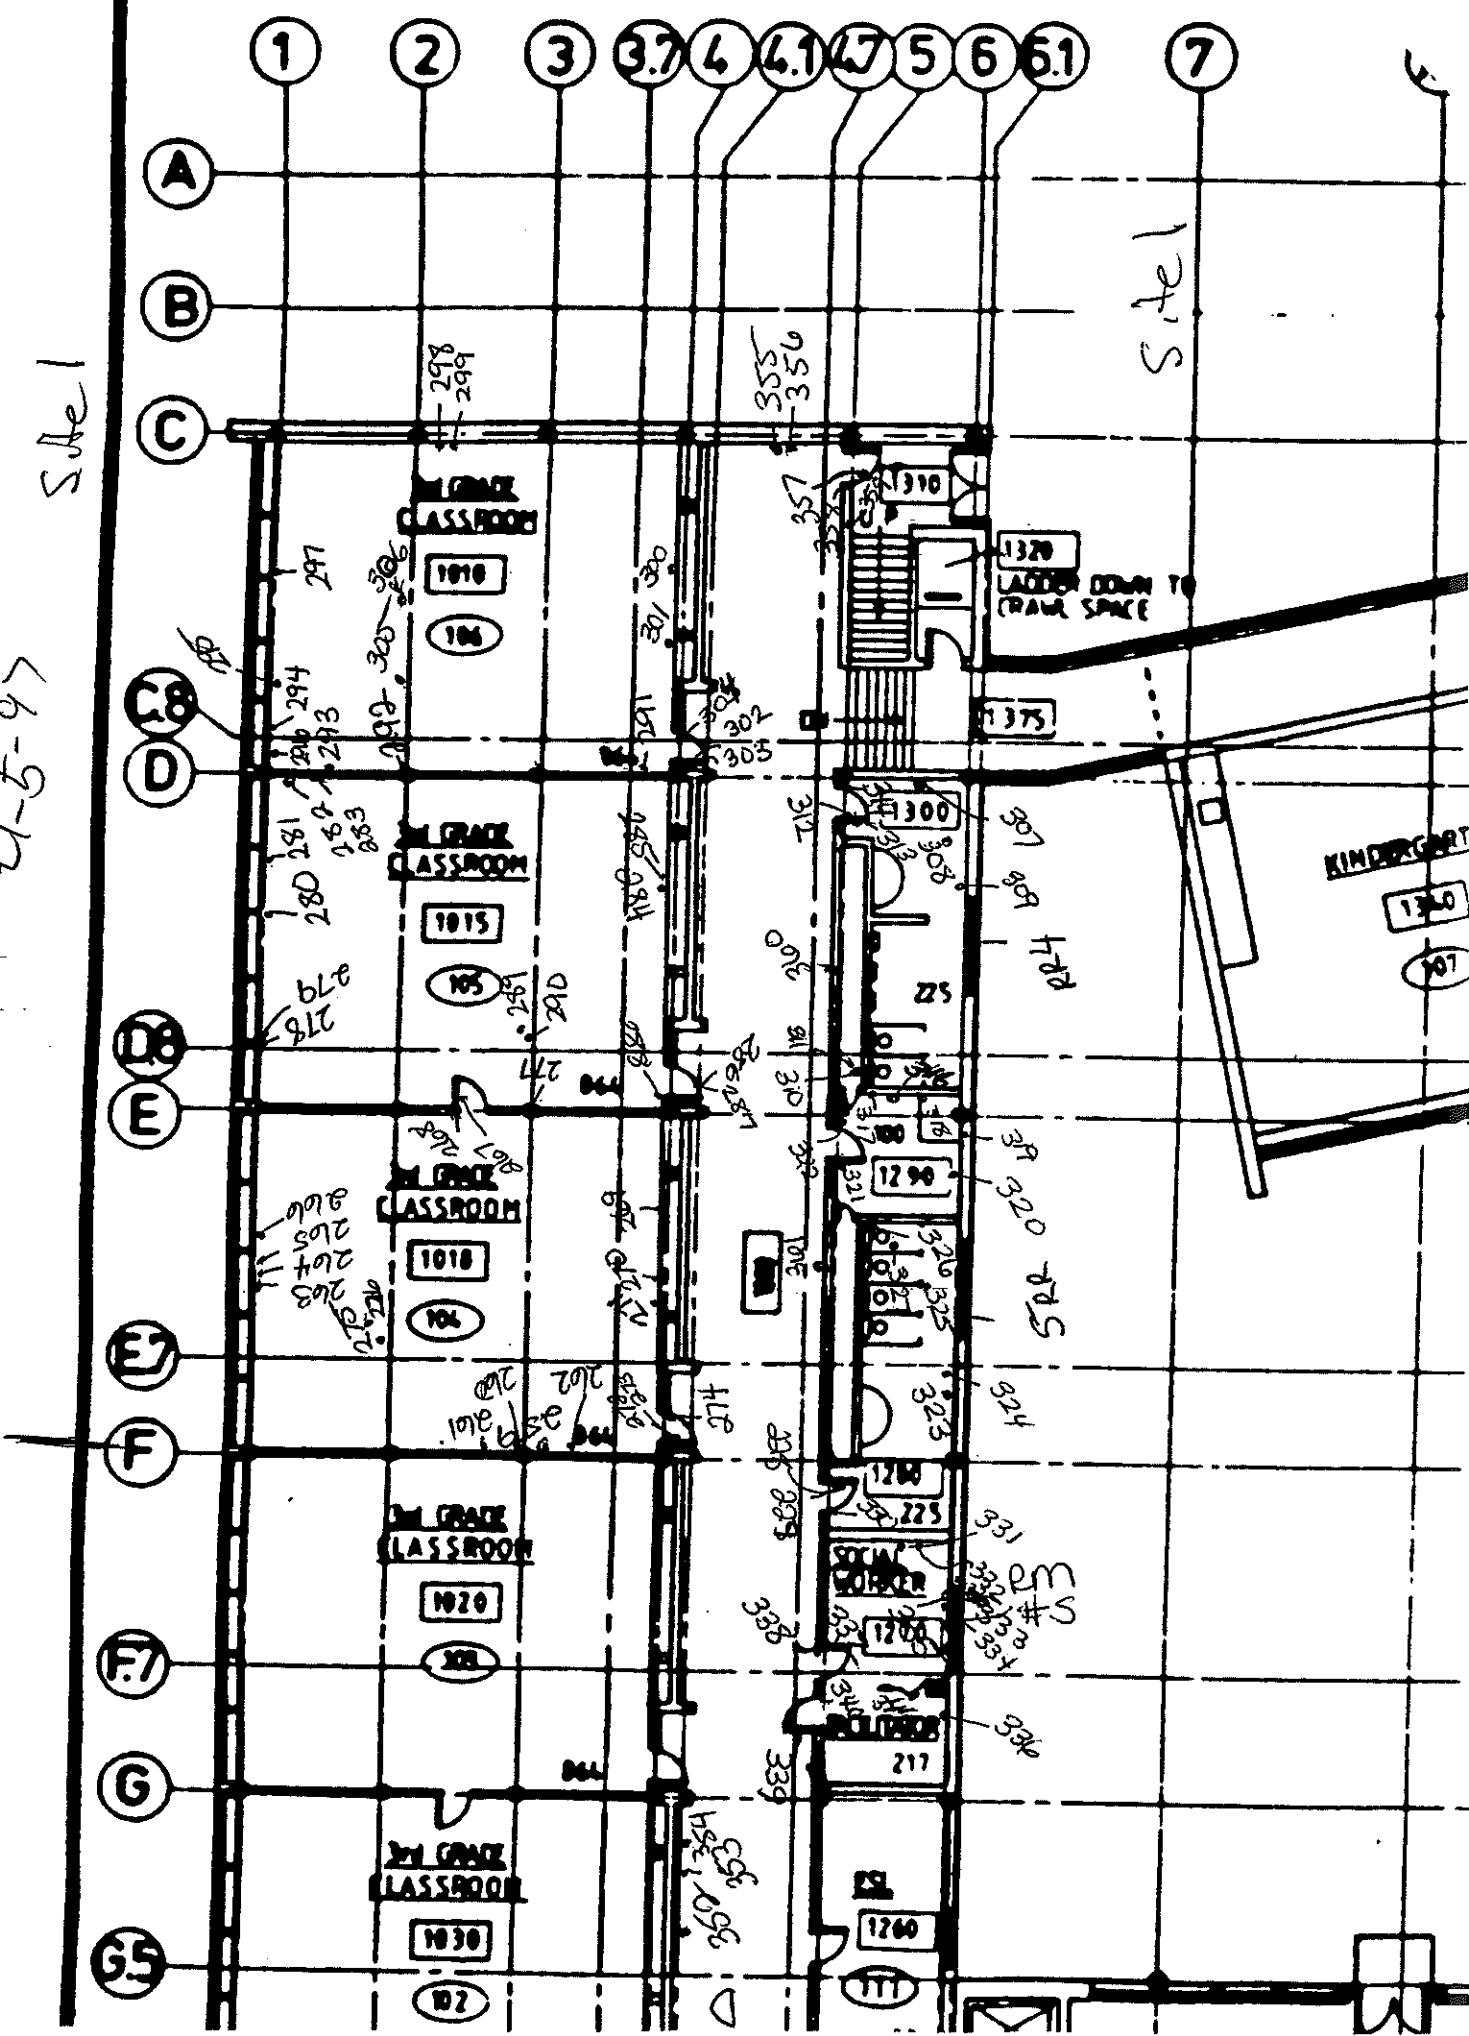

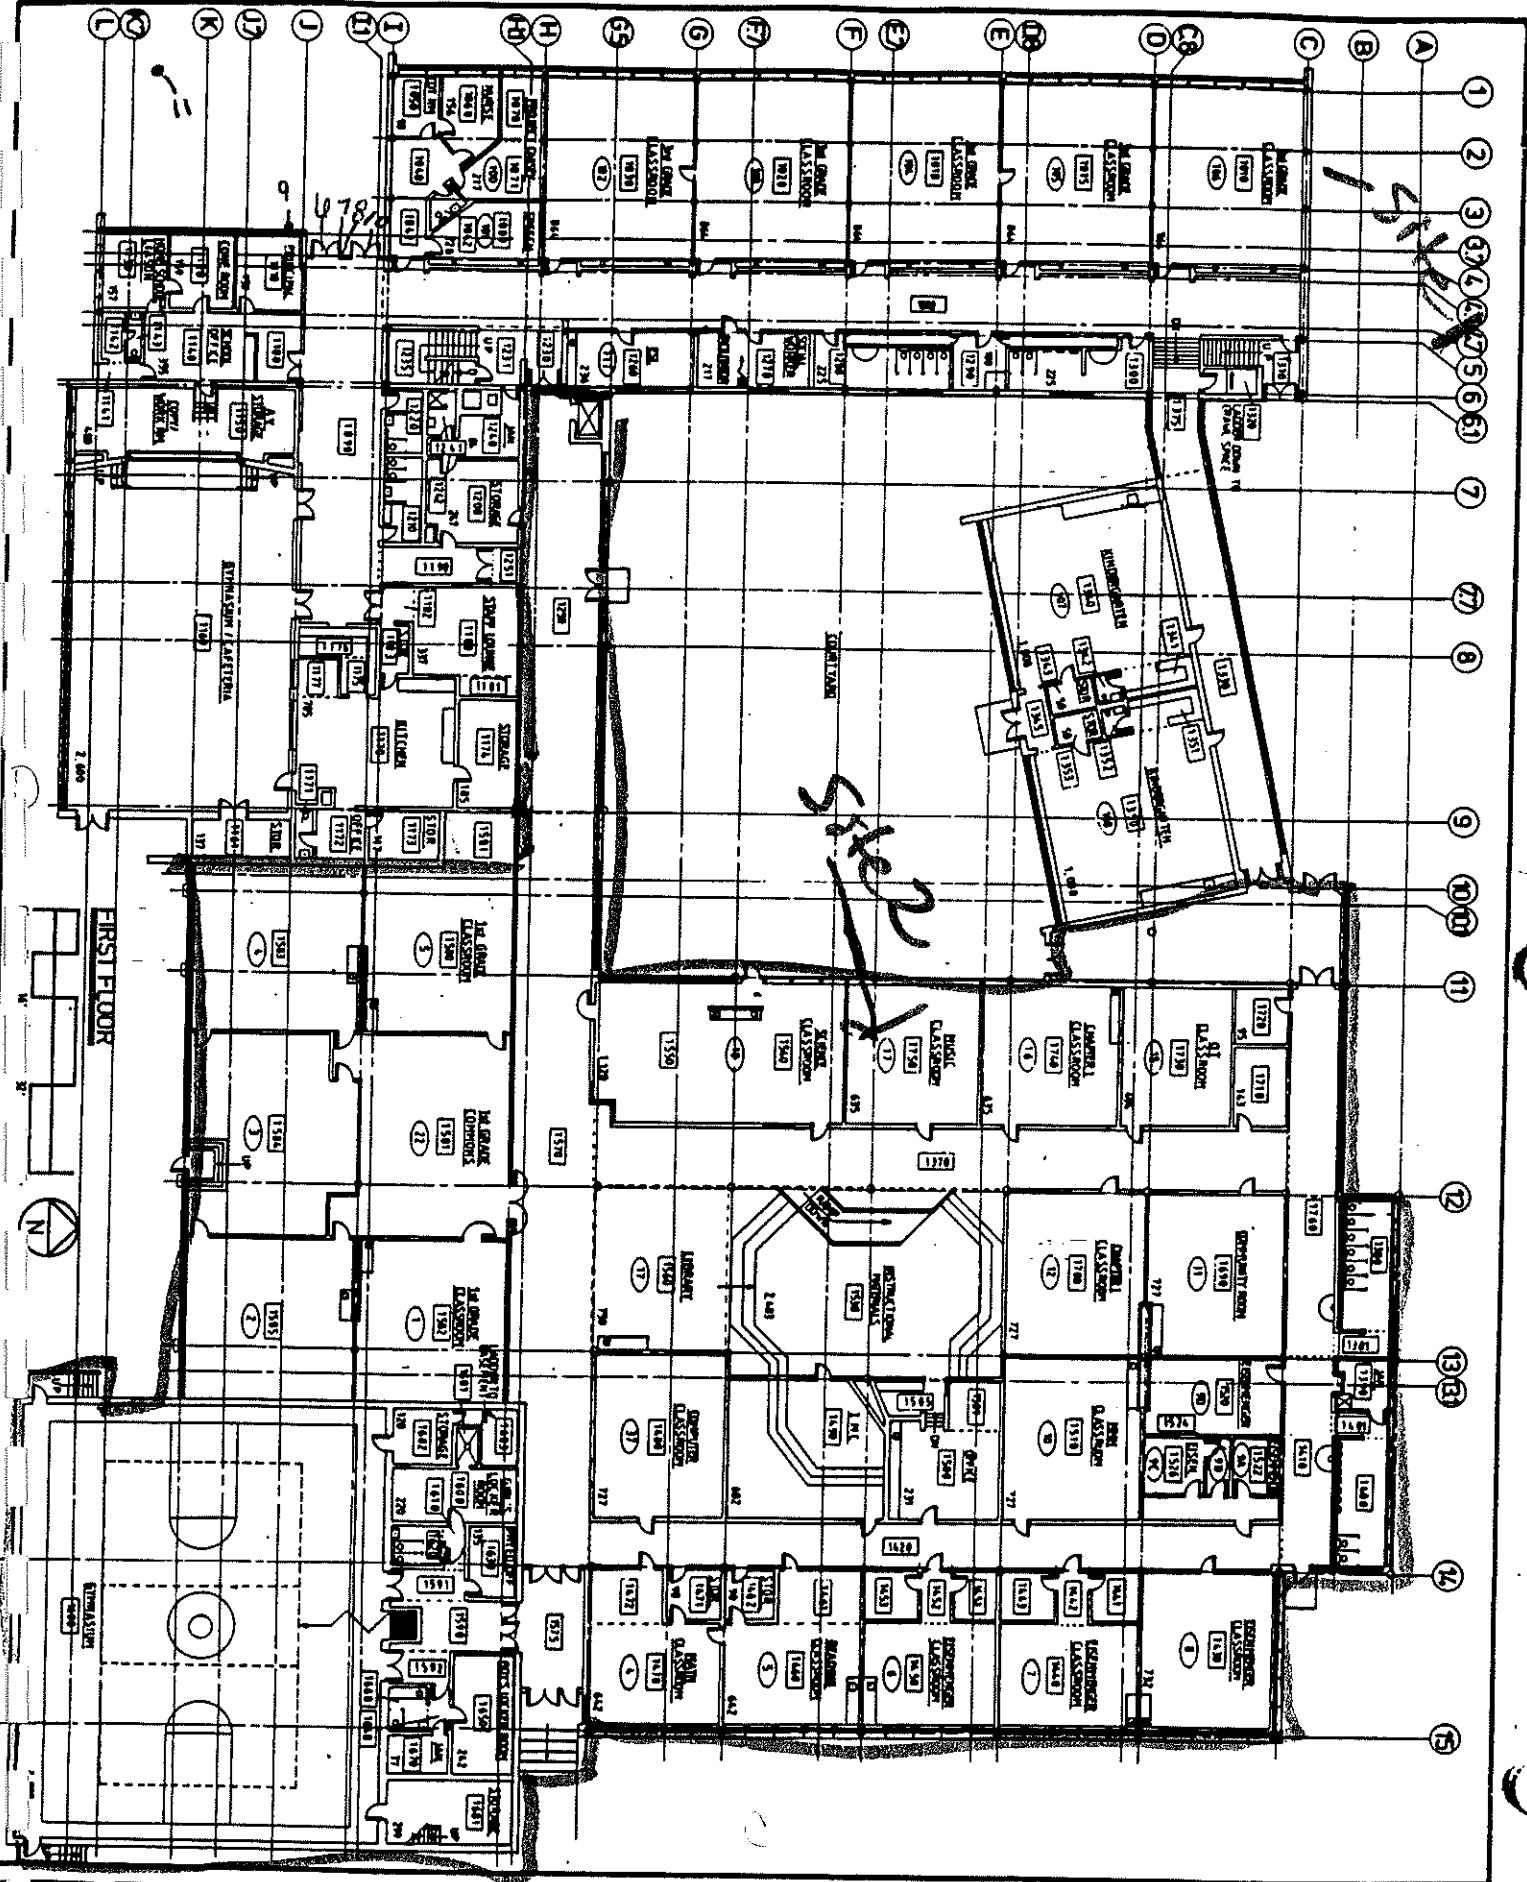

INDEPENDENT SCHOOL DIST. #625
360 COLBORNE STREET
ST. PAUL, MINNESOTA 55102

MAXFIELD ELEMENTARY
VICTORIA & ST. ANTHONY
ST PAUL, MN 55104

CONSTRUCTED: 1974

Sheet 3 of 5

Saint Paul Public Schools
 Maxfield Magnet School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
1	Maxfield Magnet School											
2												
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
4	1956 Bldg	59	XRF	4/13/97	1	Bath	12	Wall	Middle Wall	Solid	Concrete	0.01
5	1956 Bldg	60	XRF	4/13/97	1	Bath	12	Wall	Radiator	Solid	Metal	0.13
6	1956 Bldg	61	XRF	4/13/97	1	Bath	12	Wall	Wall	Solid	Drywall	0.02
7	1956 Bldg	62	XRF	4/13/97	1	Bath	12	Door	Door	Solid	Wood	0
8	1956 Bldg	63	XRF	4/13/97	1	Bath	12	Door	Casing	Solid	Metal	0
9	1956 Bldg	64	XRF	4/13/97	1	Bath	12	Wall	Wall Rgstr	Solid	Metal	0
10	1956 Bldg	65	XRF	4/13/97	1	Bath	12	Floor		Solid	Tile	0.07
11	1956 Bldg	66	XRF	4/13/97	1	Bath	12	Ceiling		Solid	Plaster	0.04
12	1956 Bldg	67	XRF	4/13/97	1	Bath	12	Ceiling	Diffuser	Solid	Metal	0
13	1956 Bldg	210	XRF	4/6/97	1	Cafeteria	0	Wall	Wall	Solid	Tile	0
14	1956 Bldg	6	XRF	4/6/97	1	Cafeteria	1	Ceiling		Solid	Plaster	0.02
15	1956 Bldg	223	XRF	4/5/97	1	Classroo	102		Column	Solid	Concrete	0.19
16	1956 Bldg	224	XRF	4/5/97	1	Classroo	102	Wall	Wall	Solid	Concrete	0.3
17	1956 Bldg	225	XRF	4/5/97	1	Classroo	102	Bulletin Board	Frame	Solid	Wood	0.03
18	1956 Bldg	226	XRF	4/5/97	1	Classroo	102	Window	Stool	Solid	Metal	0.81
19	1956 Bldg	227	XRF	4/5/97	1	Classroo	102	Bookshelf	Rgstr	Solid	Metal	0.01
20	1956 Bldg	228	XRF	4/5/97	1	Classroo	102		Univent	Cracked	Metal	0.02
21	1956 Bldg	229	XRF	4/5/97	1	Classroo	102	Bookcase	Shelf	Cracked	Metal	0.01
22	1956 Bldg	230	XRF	4/5/97	1	Classroo	102	Wall	Middle Wall	Solid	Drywall	0.01
23	1956 Bldg	231	XRF	4/5/97	1	Classroo	102	Door	Door	Solid	Wood	0
24	1956 Bldg	232	XRF	4/5/97	1	Classroo	102	Door	Casing	Cracked	Metal	0
25	1956 Bldg	233	XRF	4/5/97	1	Classroo	102	Screen	Mountbrd	Solid	Wood	0
26	1956 Bldg	234	XRF	4/5/97	1	Classroo	102	Cabinet	Door	Solid	Wood	0
27	1956 Bldg	235	XRF	4/5/97	1	Classroo	102	Wall	Middle Wall	Solid	Plaster	0.1
28	1956 Bldg	236	XRF	4/5/97	1	Classroo	102	Wall	Soffit	Solid	Plaster	1.33
29	1956 Bldg	237	XRF	4/5/97	1	Classroo	102	Door	Door	Solid	Wood	0.01
30	1956 Bldg	238	XRF	4/5/97	1	Classroo	102	Door	Door Rgst	Solid	Metal	0
31	1956 Bldg	239	XRF	4/5/97	1	Classroo	102	Door	Casing	Cracked	Metal	0.5
32	1956 Bldg	240	XRF	4/5/97	1	Classroo	102	Ceiling		Solid	Concrete	0.06
33	1956 Bldg	241	XRF	4/5/97	1	Classroo	102		Wire Tray	Solid	Metal	0
34	1956 Bldg	242	XRF	4/5/97	1	Classroo	103	Wall	Wall	Solid	Drywall	0
35	1956 Bldg	243	XRF	4/5/97	1	Classroo	103	Window	Stool	Solid	Metal	0.68
36	1956 Bldg	244	XRF	4/5/97	1	Classroo	103	Bookshelf	Rgstr	Solid	Metal	0.02
37	1956 Bldg	245	XRF	4/5/97	1	Classroo	103		Univent	Solid	Metal	0.04
38	1956 Bldg	246	XRF	4/5/97	1	Classroo	103	Bookcase	Inside	Cracked	Metal	0.03
39	1956 Bldg	247	XRF	4/5/97	1	Classroo	103	Bulletin Board	Frame	Solid	Wood	0
40	1956 Bldg	248	XRF	4/5/97	1	Classroo	103	Screen	Mountbrd	Solid	Wood	0
41	1956 Bldg	249	XRF	4/5/97	1	Classroo	103	Wall	Wall	Solid	Drywall	0.06
42	1956 Bldg	250	XRF	4/5/97	1	Classroo	103		Column	Solid	Concrete	0.04
43	1956 Bldg	251	XRF	4/5/97	1	Classroo	103	Wall	Middle Wall	Solid	Plaster	0.01
44	1956 Bldg	252	XRF	4/5/97	1	Classroo	103	Wall	Soffit	Solid	Plaster	0.28
45	1956 Bldg	253	XRF	4/5/97	1	Classroo	103	Cabinet	Door	Solid	Wood	0.01
46	1956 Bldg	254	XRF	4/5/97	1	Classroo	103	Door	Door	Solid	Wood	0.01
47	1956 Bldg	255	XRF	4/5/97	1	Classroo	103	Wall	Wall Rgstr	Solid	Metal	0
48	1956 Bldg	256	XRF	4/5/97	1	Classroo	103	Door	Casing	Cracked	Metal	0.24
49	1956 Bldg	257	XRF	4/5/97	1	Classroo	103	Ceiling		Solid	Concrete	0.1
50	1956 Bldg	258	XRF	4/5/97	1	Classroo	103	Ceiling	Wire Tray	Solid	Metal	0
51	1956 Bldg	259	XRF	4/5/97	1	Classroo	104	Wall	Wall	Solid	Concrete	0.07
52	1956 Bldg	260	XRF	4/5/97	1	Classroo	104		Column	Solid	Concrete	0.11
53	1956 Bldg	261	XRF	4/5/97	1	Classroo	104	Wall	Middle Wall	Solid	Drywall	0
54	1956 Bldg	262	XRF	4/5/97	1	Classroo	104	Bulletin Board	Frame	Solid	Wood	0.03
55	1956 Bldg	263	XRF	4/5/97	1	Classroo	104	Window	Stool	Cracked	Metal	0.39
56	1956 Bldg	264	XRF	4/5/97	1	Classroo	104	Bookshelf	Rgstr	Cracked	Metal	0.03
57	1956 Bldg	265	XRF	4/5/97	1	Classroo	104		Univent	Cracked	Metal	0.02
58	1956 Bldg	266	XRF	4/5/97	1	Classroo	104	Bookcase	Shelf	Cracked	Metal	0.04
59	1956 Bldg	267	XRF	4/5/97	1	Classroo	104	Door	Door	Solid	Wood	0
60	1956 Bldg	268	XRF	4/5/97	1	Classroo	104	Door	Casing	Cracked	Metal	0

Saint Paul Public Schools
 Maxfield Magnet School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
61	1956 Bldg	269	XRF	4/5/97	1	Classroo	104	Wall	Midle Wall	Solid	Plaster	0.01
62	1956 Bldg	270	XRF	4/5/97	1	Classroo	104	Wall	Soffit	Solid	Plaster	1.08
63	1956 Bldg	271	XRF	4/5/97	1	Classroo	104	Cabinet	Door	Solid	Wood	0.1
64	1956 Bldg	272	XRF	4/5/97	1	Classroo	104	Door	Door	Solid	Wood	0.01
65	1956 Bldg	273	XRF	4/5/97	1	Classroo	104	Door	Door Rgst	Solid	Metal	0
66	1956 Bldg	274	XRF	4/5/97	1	Classroo	104	Door	Casing	Solid	Metal	0.33
67	1956 Bldg	275	XRF	4/5/97	1	Classroo	104	Ceiling		Solid	Concrete	0.09
68	1956 Bldg	276	XRF	4/5/97	1	Classroo	104	Ceiling	Wire Tray	Solid	Metal	0
69	1956 Bldg	277	XRF	4/5/97	1	Classroo	105		Column	Solid	Concrete	0.26
70	1956 Bldg	278	XRF	4/5/97	1	Classroo	105	Window	Stool	Solid	Metal	0.58
71	1956 Bldg	279	XRF	4/5/97	1	Classroo	105	Bookshelf	Rgstr	Solid	Metal	0.03
72	1956 Bldg	280	XRF	4/5/97	1	Classroo	105		Univent	Solid	Metal	0.02
73	1956 Bldg	281	XRF	4/5/97	1	Classroo	105	Bookcase	Shelf	Solid	Metal	0.04
74	1956 Bldg	282	XRF	4/5/97	1	Classroo	105	Wall	Midle Wall	Solid	Drywall	0.01
75	1956 Bldg	283	XRF	4/5/97	1	Classroo	105	Bulletin Board	Frame	Cracked	Wood	0
76	1956 Bldg	284	XRF	4/5/97	1	Classroo	105		Soffit	Solid	Plaster	1.01
77	1956 Bldg	285	XRF	4/5/97	1	Classroo	105	Cabinet	Door	Solid	Wood	0
78	1956 Bldg	286	XRF	4/5/97	1	Classroo	105	Door	Door	Solid	Wood	0.01
79	1956 Bldg	287	XRF	4/5/97	1	Classroo	105	Door	Dorr Rgstr	Solid	Metal	0
80	1956 Bldg	288	XRF	4/5/97	1	Classroo	105	Door	Casing	Solid	Metal	0.58
81	1956 Bldg	289	XRF	4/5/97	1	Classroo	105	Ceiling		Solid	Concrete	0.04
82	1956 Bldg	290	XRF	4/5/97	1	Classroo	105		Wire Tray	Solid	Metal	0
83	1956 Bldg	291	XRF	4/5/97	1	Classroo	106	Wall	Wall	Solid	Drywall	0.01
84	1956 Bldg	292	XRF	4/5/97	1	Classroo	106		Column	Solid	Concrete	0.04
85	1956 Bldg	293	XRF	4/5/97	1	Classroo	106	Bulletin Board	Frame	Solid	Wood	0
86	1956 Bldg	294	XRF	4/5/97	1	Classroo	106	Window	Stool	Solid	Metal	0.66
87	1956 Bldg	295	XRF	4/5/97	1	Classroo	106	Bookshelf	Rgstr	Solid	Metal	0.03
88	1956 Bldg	296	XRF	4/5/97	1	Classroo	106	Bookcase	Inside	Cracked	Metal	0.03
89	1956 Bldg	297	XRF	4/5/97	1	Classroo	106		Univent	Solid	Metal	0.02
90	1956 Bldg	298	XRF	4/5/97	1	Classroo	106	Wall	Wall	Solid	Concrete	0.03
91	1956 Bldg	299	XRF	4/5/97	1	Classroo	106	Screem	Mountbrd	Solid	Wood	0
92	1956 Bldg	300	XRF	4/5/97	1	Classroo	106	Wall	Soffit	Solid	Plaster	0.29
93	1956 Bldg	301	XRF	4/5/97	1	Classroo	106	Cabinet	Door	Solid	Wood	0.01
94	1956 Bldg	302	XRF	4/5/97	1	Classroo	106	Door	Door	Solid	Wood	0.01
95	1956 Bldg	303	XRF	4/5/97	1	Classroo	106	Door	Door Rgst	Solid	Metal	0
96	1956 Bldg	304	XRF	4/5/97	1	Classroo	106	Door	Casing	Cracked	Metal	0.37
97	1956 Bldg	305	XRF	4/5/97	1	Classroo	106	Ceiling		Solid	Concrete	0.03
98	1956 Bldg	306	XRF	4/5/97	1	Classroo	106		Wire Tray	Solid	Metal	0
99	1956 Bldg	19	XRF	4/6/97	1	Classroo	107	Wall	Midle Wall	Solid	Plaster	0.04
100	1956 Bldg	20	XRF	4/6/97	1	Classroo	107	Door	Door	Solid	Wood	0.02
101	1956 Bldg	21	XRF	4/6/97	1	Classroo	107	Door	Casing	Cracked	Metal	0.01
102	1956 Bldg	22	XRF	4/6/97	1	Classroo	107	Bulletin Board	Midle Wall	Solid	Wood	0.03
103	1956 Bldg	23	XRF	4/6/97	1	Classroo	107	Wall	Wall	Solid	Concrete	0.07
104	1956 Bldg	24	XRF	4/6/97	1	Classroo	107	Mounting Board	Wall	Solid	Wood	0.01
105	1956 Bldg	25	XRF	4/6/97	1	Classroo	107	Cabinet	Door	Cracked	Wood	0.01
106	1956 Bldg	26	XRF	4/6/97	1	Classroo	107	Window	Stool	Solid	Metal	0.54
107	1956 Bldg	27	XRF	4/6/97	1	Classroo	107	Wall	Wall Rgstr	Solid	Metal	0.02
108	1956 Bldg	28	XRF	4/6/97	1	Classroo	107	Wall	Radiator	Solid	Metal	0.02
109	1956 Bldg	29	XRF	4/6/97	1	Classroo	107	Bookcase	Shelf	Cracked	Metal	0.03
110	1956 Bldg	30	XRF	4/6/97	1	Classroo	107	Wall	Column	Solid	Plaster	0.15
111	1956 Bldg	31	XRF	4/6/97	1	Classroo	107	Wall	Midle Wall	Solid	Plaster	0.13
112	1956 Bldg	32	XRF	4/6/97	1	Classroo	107	Door	Casing	Solid	Metal	0.01
113	1956 Bldg	33	XRF	4/6/97	1	Classroo	107	Wall	Soffit	Solid	Plaster	0.1
114	1956 Bldg	34	XRF	4/6/97	1	Classroo	107	Wall	Wall	Solid	Tile	2.9
115	1956 Bldg	35	XRF	4/6/97	1	Classroo	107	Coat Rack	Midle Wall	Solid	Wood	0.01
116	1956 Bldg	36	XRF	4/6/97	1	Classroo	107	Wall	Midle Wall	Solid	Plaster	0.25
117	1956 Bldg	37	XRF	4/6/97	1	Classroo	107	Ceiling		Solid	Plaster	0.34
118	1956 Bldg	58	XRF	4/6/97	1	Classroo	108	Wall	Wall	Solid	Plaster	0.06
119	1956 Bldg	59	XRF	4/6/97	1	Classroo	108	Door	Door	Solid	Wood	0.02

Saint Paul Public Schools
 Maxfield Magnet School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
120	1956 Bldg	60	XRF	4/6/97	1	Classroo	108	Wall	Wall Rgstr	Solid	Metal	0
121	1956 Bldg	61	XRF	4/6/97	1	Classroo	108	Door	Casing	Cracked	Metal	0.02
122	1956 Bldg	62	XRF	4/6/97	1	Classroo	108	Cabinet	Door	Cracked	Wood	0
123	1956 Bldg	63	XRF	4/6/97	1	Classroo	108	Coat Rack	Midle Wall	Solid	Wood	0.01
124	1956 Bldg	64	XRF	4/6/97	1	Classroo	108	Wall	Wall	Solid	Tile	2.93
125	1956 Bldg	65	XRF	4/6/97	1	Classroo	108	Wall	Midle Wall	Solid	Plaster	0.22
126	1956 Bldg	66	XRF	4/6/97	1	Classroo	108	Ceiling		Solid	Plaster	0.21
127	1956 Bldg	67	XRF	4/6/97	1	Classroo	108	Wall	Wall	Solid	Plaster	0.06
128	1956 Bldg	68	XRF	4/6/97	1	Classroo	108	Window	Stool	Solid	Metal	0.51
129	1956 Bldg	69	XRF	4/6/97	1	Classroo	108	Wall	Radiator	Solid	Metal	0.01
130	1956 Bldg	70	XRF	4/6/97	1	Classroo	108	Bookcase	Shelf	Cracked	Metal	0.03
131	1956 Bldg	71	XRF	4/6/97	1	Classroo	108	Wall	Column	Solid	Plaster	0.11
132	1956 Bldg	72	XRF	4/6/97	1	Classroo	108	Wall	Wall Rgstr	Solid	Metal	0.03
133	1956 Bldg	73	XRF	4/6/97	1	Classroo	108	Bulletin Board	Midle Wall	Solid	Wood	0.01
134	1956 Bldg	74	XRF	4/6/97	1	Classroo	108	Wall	Wall	Solid	Concrete	0.1
135	1956 Bldg	75	XRF	4/6/97	1	Classroo	108	Cabinet	Door	Solid	Wood	0.01
136	1956 Bldg	76	XRF	4/6/97	1	Classroo	108	Closet	Wall	Solid	Plaster	0.09
137	1956 Bldg	77	XRF	4/6/97	1	Classroo	108	Closet	Casing	Solid	Metal	0.03
138	1956 Bldg	78	XRF	4/6/97	1	Classroo	108	Ceiling		Solid	Plaster	0.06
139	1956 Bldg	79	XRF	4/6/97	1	Classroo	108	Door	Casing	Solid	Metal	0.04
140	1956 Bldg	12	XRF	4/5/97	2	Classroo	201	Wall	Wall	Solid	Concrete	0.04
141	1956 Bldg	13	XRF	4/5/97	2	Classroo	201	Bulletin Board	Frame	Solid	Wood	0.01
142	1956 Bldg	14	XRF	4/5/97	2	Classroo	201	Screen	Mounting	Solid	Wood	0
143	1956 Bldg	15	XRF	4/5/97	2	Classroo	201	Window	Stool	Cracked	Metal	0.66
144	1956 Bldg	16	XRF	4/5/97	2	Classroo	201	Bookcase	Inside	Cracked	Metal	0.02
145	1956 Bldg	17	XRF	4/5/97	2	Classroo	201	Bookshelf	Rgstr	Solid	Metal	0.03
146	1956 Bldg	18	XRF	4/5/97	2	Classroo	201	Cabinet	Door	Cracked	Wood	0
147	1956 Bldg	19	XRF	4/5/97	2	Classroo	201	Cabinet	Inside	Solid	Wood	0
148	1956 Bldg	24	XRF	4/5/97	2	Classroo	201	Ceiling		Solid	Concrete	0.06
149	1956 Bldg	25	XRF	4/5/97	2	Classroo	201	Ceiling	Wire Tray	Solid	Metal	0
150	1956 Bldg	36	XRF	4/5/97	2	Classroo	202	Wall	Midle Wall	Solid	Concrete	0
151	1956 Bldg	37	XRF	4/5/97	2	Classroo	202	Bulletin Board	Frame	Solid	Wood	0.01
152	1956 Bldg	38	XRF	4/5/97	2	Classroo	202	Window	Stool	Solid	Metal	0.71
153	1956 Bldg	39	XRF	4/5/97	2	Classroo	202	Wall	Wall Rgstr	Solid	Metal	0.03
154	1956 Bldg	40	XRF	4/5/97	2	Classroo	202	Wall	Radiator	Cracked	Metal	0.02
155	1956 Bldg	41	XRF	4/5/97	2	Classroo	202	Bookcase	Shelf	Cracked	Metal	0.02
156	1956 Bldg	42	XRF	4/5/97	2	Classroo	202	Wall	Midle Wall	Solid	Concrete	0.21
157	1956 Bldg	43	XRF	4/5/97	2	Classroo	202	Cabinet	Door	Solid	Wood	0.01
158	1956 Bldg	44	XRF	4/5/97	2	Classroo	202		Soffit	Solid	Plaster	0.54
159	1956 Bldg	45	XRF	4/5/97	2	Classroo	202	Door	Door	Solid	Wood	0.01
160	1956 Bldg	46	XRF	4/5/97	2	Classroo	202	Wall	Wall Rgstr	Solid	Metal	0
161	1956 Bldg	47	XRF	4/5/97	2	Classroo	202		Column	Solid	Concrete	0.2
162	1956 Bldg	48	XRF	4/5/97	2	Classroo	202	Ceiling		Solid	Concrete	0.1
163	1956 Bldg	49	XRF	4/5/97	2	Classroo	202	Ceiling	Wire Tray	Solid	Metal	0
164	1956 Bldg	50	XRF	4/5/97	2	Classroo	203	Wall	Column	Solid	Concrete	0.04
165	1956 Bldg	51	XRF	4/5/97	2	Classroo	203	Window	Stool	Cracked	Metal	0.76
166	1956 Bldg	52	XRF	4/5/97	2	Classroo	203	Bookshelf	Rgstr	Cracked	Metal	0.03
167	1956 Bldg	53	XRF	4/5/97	2	Classroo	203		Univent	Solid	Metal	0.02
168	1956 Bldg	54	XRF	4/5/97	2	Classroo	203	Bookcase	Inside	Cracked	Metal	0.04
169	1956 Bldg	55	XRF	4/5/97	2	Classroo	203	Wall	Wall	Solid	Concrete	0.01
170	1956 Bldg	56	XRF	4/5/97	2	Classroo	203	Cabinet	Door	Solid	Wood	0
171	1956 Bldg	57	XRF	4/5/97	2	Classroo	203		Soffit	Solid	Plaster	0.17
172	1956 Bldg	58	XRF	4/5/97	2	Classroo	203	Door	Door	Solid	Wood	0.01
173	1956 Bldg	59	XRF	4/5/97	2	Classroo	203	Door	Door Rgst	Solid	Metal	0
174	1956 Bldg	60	XRF	4/5/97	2	Classroo	203	Bulletin Board	Frame	Solid	Wood	0
175	1956 Bldg	61	XRF	4/5/97	2	Classroo	203	Ceiling		Solid	Concrete	0.1
176	1956 Bldg	62	XRF	4/5/97	2	Classroo	203	Ceiling	Wire Tray	Solid	Metal	0
177	1956 Bldg	64	XRF	4/5/97	2	Classroo	203	Door	Casing	Cracked	Metal	0.16
178	1956 Bldg	65	XRF	4/5/97	2	Classroo	204	Wall	Wall	Solid	Concrete	0

Saint Paul Public Schools
 Maxfield Magnet School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
179	1956 Bldg	66	XRF	4/5/97	2	Classroo	204	Bulletin Board	Frame	Solid	Wood	0
180	1956 Bldg	67	XRF	4/5/97	2	Classroo	204	Window	Stool	Solid	Metal	0.59
181	1956 Bldg	68	XRF	4/5/97	2	Classroo	204	Wall	Wall Rgstr	Solid	Metal	0.02
182	1956 Bldg	69	XRF	4/5/97	2	Classroo	204	Univent	Solid	Metal	0.03	
183	1956 Bldg	70	XRF	4/5/97	2	Classroo	204	Bookcase	Shelf	Cracked	Metal	0.02
184	1956 Bldg	71	XRF	4/5/97	2	Classroo	204	Screen	Mountbrd	Solid	Wood	0
185	1956 Bldg	72	XRF	4/5/97	2	Classroo	204	Cabinet	Door	Solid	Wood	0.01
186	1956 Bldg	76	XRF	4/5/97	2	Classroo	204	Ceiling		Solid	Concrete	0.07
187	1956 Bldg	77	XRF	4/5/97	2	Classroo	204	Ceiling	Wire Tray	Solid	Metal	0
188	1956 Bldg	78	XRF	4/5/97	2	Classroo	205		Column	Solid	Concrete	0.21
189	1956 Bldg	79	XRF	4/5/97	2	Classroo	205	Bulletin Board	Frame	Solid	Wood	0.01
190	1956 Bldg	80	XRF	4/5/97	2	Classroo	205	Window	Stool	Solid	Metal	0.54
191	1956 Bldg	81	XRF	4/5/97	2	Classroo	205	Bookshelf	Rgstr	Cracked	Metal	0.03
192	1956 Bldg	82	XRF	4/5/97	2	Classroo	205	Univent	Cracked	Metal	0.02	
193	1956 Bldg	83	XRF	4/5/97	2	Classroo	205	Bookcase	Shelf	Cracked	Metal	0.03
194	1956 Bldg	84	XRF	4/5/97	2	Classroo	205	Wall	Wall	Solid	Concrete	0.12
195	1956 Bldg	85	XRF	4/5/97	2	Classroo	205	Wall	Wall	Solid	Concrte	0.2
196	1956 Bldg	86	XRF	4/5/97	2	Classroo	205	Screen	Mountbrd	Solid	Wood	0
197	1956 Bldg	87	XRF	4/5/97	2	Classroo	205	Cabinet	Door	Solid	Wood	0.01
198	1956 Bldg	88	XRF	4/5/97	2	Classroo	205	Wall	Soffit	Solid	Plaster	0.65
199	1956 Bldg	89	XRF	4/5/97	2	Classroo	205	Wall	Midle Wall	Solid	Plaster	0.02
200	1956 Bldg	90	XRF	4/5/97	2	Classroo	205	Door	Door	Solid	Wood	0.01
201	1956 Bldg	91	XRF	4/5/97	2	Classroo	205	Door	Door Rgst	Solid	Metal	0
202	1956 Bldg	92	XRF	4/5/97	2	Classroo	205	Door	Casing	Cracked	Metal	0.28
203	1956 Bldg	93	XRF	4/5/97	2	Classroo	205	Ceiling		Solid	Concre	0.05
204	1956 Bldg	94	XRF	4/5/97	2	Classroo	205		Wire Tray	Solid	Metal	0
205	1956 Bldg	95	XRF	4/5/97	2	Classroo	206		Column	Solid	Concrete	0.02
206	1956 Bldg	96	XRF	4/5/97	2	Classroo	206	Window	Stool	Solid	Metal	0.55
207	1956 Bldg	97	XRF	4/5/97	2	Classroo	206	Wall	Wall Rgstr	Solid	Metal	0.03
208	1956 Bldg	98	XRF	4/5/97	2	Classroo	206	Univent	Cracked	Metal	0.03	
209	1956 Bldg	99	XRF	4/5/97	2	Classroo	206	Bookcase	Inside	Cracked	Metal	0.03
210	1956 Bldg	100	XRF	4/5/97	2	Classroo	206	Bulletin Board	Frame	Solid	Wood	0
211	1956 Bldg	101	XRF	4/5/97	2	Classroo	206	Wall	Wall	Solid	Concre	0.07
212	1956 Bldg	102	XRF	4/5/97	2	Classroo	206	Screen	Mountbrd	Solid	Wood	0
213	1956 Bldg	103	XRF	4/5/97	2	Classroo	206	Cabinet	Door	Solid	Wood	0.01
214	1956 Bldg	104	XRF	4/5/97	2	Classroo	206	Wall	Soffit	Solid	Plaster	0.26
215	1956 Bldg	105	XRF	4/5/97	2	Classroo	206	Door	Door	Solid	Wood	0.01
216	1956 Bldg	106	XRF	4/5/97	2	Classroo	206	Door	Door Rgst	Cracked	Metal	0.01
217	1956 Bldg	107	XRF	4/5/97	2	Classroo	206	Door	Casing	Cracked	Metal	0.2
218	1956 Bldg	108	XRF	4/5/97	2	Classroo	206	Ceiling		Solid	Concre	0.03
219	1956 Bldg	109	XRF	4/5/97	2	Classroo	206		Wire Tray	Solid	Metal	0
220	1956 Bldg	43	XRF	4/6/97	1	Closet	107	Closet	Wall	Solid	Plaster	0.05
221	1956 Bldg	44	XRF	4/6/97	1	Closet	107	Cabinet	Door	Solid	Wood	0.01
222	1956 Bldg	45	XRF	4/6/97	1	Closet	107	Ceiling	Door	Solid	Plaster	0.06
223	1956 Bldg	46	XRF	4/6/97	1	Closet	107	Closet	Casing	Solid	Metal	0.01
224	1956 Bldg	47	XRF	4/6/97	1	Closet	107	Wall	Wall Rgstr	Solid	Metal	0
225	1956 Bldg	7	XRF	4/6/97	1	Gym	1	Ceiling		Solid	Concrete	0
226	1956 Bldg	8	XRF	4/6/97	1	Gym	1	Ceiling		Solid	Plaster	0.01
227	1956 Bldg	9	XRF	4/6/97	1	Gym	1	Door	Header	Solid	Metal	0
228	1956 Bldg	152	XRF	4/5/97	2	Hall	1	Wall	Midle Wall	Solid	Tile	3.07
229	1956 Bldg	153	XRF	4/5/97	2	Hall	1	Coat Rack	Shelf	Solid	Wood	0.01
230	1956 Bldg	154	XRF	4/5/97	2	Hall	1	Bench		Solid	Wood	0.02
231	1956 Bldg	155	XRF	4/5/97	2	Hall	1		Radiator	Solid	Metal	0.07
232	1956 Bldg	156	XRF	4/5/97	2	Hall	1	Cabinet	Door	Solid	Metal	0.07
233	1956 Bldg	157	XRF	4/5/97	2	Hall	1	Cabinet	Inside	Solid	Metal	0.1
234	1956 Bldg	158	XRF	4/5/97	2	Hall	1	Door	Door	Solid	Metal	0.01
235	1956 Bldg	159	XRF	4/5/97	2	Hall	1	Door	Casing	Cracked	Metal	0
236	1956 Bldg	160	XRF	4/5/97	2	Hall	1	Wall	Midle Wall	Solid	Tile	0.74
237	1956 Bldg	161	XRF	4/5/97	2	Hall	1	Wall	Elec Pane	Solid	Metal	0.18

Saint Paul Public Schools
 Maxfield Magnet School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
238	1956 Bldg	162	XRF	4/5/97	2	Hall	1	Bulletin Board	Frame	Solid	Wood	0.02
239	1956 Bldg	163	XRF	4/5/97	2	Hall	1	Wall	Wall	Solid	Tile	5.09
240	1956 Bldg	164	XRF	4/5/97	2	Hall	1	Door	Door	Solid	Metal	0
241	1956 Bldg	165	XRF	4/5/97	2	Hall	1	Door	Casing	Solid	Metal	0
242	1956 Bldg	166	XRF	4/5/97	2	Hall	1	Ceiling	Diffuser	Solid	Metal	0.06
243	1956 Bldg	167	XRF	4/5/97	2	Hall	1	Ceiling	Hatch	Solid	Metal	0.11
244	1956 Bldg	352	XRF	4/5/97	1	Hall	2	Wall	Wall	Solid	Tile	2.97
245	1956 Bldg	353	XRF	4/5/97	1	Hall	2	Coat Rack	Shelf	Solid	Wood	0
246	1956 Bldg	354	XRF	4/5/97	1	Hall	2	Bench		Solid	Wood	0.01
247	1956 Bldg	355	XRF	4/5/97	1	Hall	2	Cabinet	Door	Solid	Metal	0.07
248	1956 Bldg	356	XRF	4/5/97	1	Hall	2	Cabinet	Inside	Solid	Metal	0.05
249	1956 Bldg	357	XRF	4/5/97	1	Hall	2	Door	Door	Cracked	Metal	0.02
250	1956 Bldg	358	XRF	4/5/97	1	Hall	2	Door	Casing	Cracked	Metal	0
251	1956 Bldg	359	XRF	4/5/97	1	Hall	2	Wall	Midle Wall	Solid	Tile	0.52
252	1956 Bldg	360	XRF	4/5/97	1	Hall	2	Wall	Elec Pane	Solid	Metal	0.1
253	1956 Bldg	361	XRF	4/5/97	1	Hall	2	Bulletin Board	Frame	Solid	Wood	0.02
254	1956 Bldg	362	XRF	4/5/97	1	Hall	2	Radiator	Solid	Metal	0.05	
255	1956 Bldg	363	XRF	4/5/97	1	Hall	2	Rolling Gate	Case	Solid	Metal	0.49
256	1956 Bldg	364	XRF	4/5/97	1	Hall	2	Ceiling	Hatch	Solid	Metal	0.16
257	1956 Bldg	365	XRF	4/5/97	1	Hall	2	Ceiling	Hatch	Solid	Wood	0
258	1956 Bldg	87	XRF	4/6/97	1	Hall	3	Door	Door	Solid	Metal	0.13
259	1956 Bldg	88	XRF	4/6/97	1	Hall	3	Door	Casing	Cracked	Metal	0.1
260	1956 Bldg	89	XRF	4/6/97	1	Hall	3	Wall	Wall	Solid	Wood	0.02
261	1956 Bldg	90	XRF	4/6/97	1	Hall	3	Bulletin Board		Solid	Metal	0.06
262	1956 Bldg	91	XRF	4/6/97	1	Hall	3	Wall	Radiator	Solid	Metal	0.09
263	1956 Bldg	92	XRF	4/6/97	1	Hall	3	Bulletin Board	Midle Wall	Solid	Wood	0.02
264	1956 Bldg	93	XRF	4/6/97	1	Hall	3	Hatch	Wall	Solid	Wood	0
265	1956 Bldg	94	XRF	4/6/97	1	Hall	3	Elec Pane	Solid	Metal	0.11	
266	1956 Bldg	95	XRF	4/6/97	1	Hall	3	Wall	Wall	Solid	Plaster	0.15
267	1956 Bldg	96	XRF	4/6/97	1	Hall	3	Door	Door	Solid	Wood	0
268	1956 Bldg	97	XRF	4/6/97	1	Hall	3	Door	Casing	Cracked	Metal	0.1
269	1956 Bldg	90	XRF	4/13/97	1	Hall	4	Wall	Wall	Solid	Tile	2.97
270	1956 Bldg	91	XRF	4/13/97	1	Hall	4	Bulletin Board	Wall	Solid	Wood	0.01
271	1956 Bldg	92	XRF	4/13/97	1	Hall	4		Elec Pane	Solid	Metal	0.07
272	1956 Bldg	93	XRF	4/13/97	1	Hall	4	Door	Door	Solid	Wood	0.01
273	1956 Bldg	94	XRF	4/13/97	1	Hall	4	Door	Casing	Solid	Metal	0.13
274	1956 Bldg	95	XRF	4/13/97	1	Hall	4	Wall	Wall	Solid	Plaster	0.15
275	1956 Bldg	96	XRF	4/13/97	1	Hall	4	Door	Door	Solid	Metal	0.04
276	1956 Bldg	97	XRF	4/13/97	1	Hall	4	Door	Casing	Solid	Metal	0.04
277	1956 Bldg	98	XRF	4/13/97	1	Hall	4	Wall	Wall	Cracked	Wood	0.01
278	1956 Bldg	99	XRF	4/13/97	1	Hall	4	Cabinet	Door	Solid	Metal	0.06
279	1956 Bldg	100	XRF	4/13/97	1	Hall	4	Door	Door	Solid	Metal	0.05
280	1956 Bldg	101	XRF	4/13/97	1	Hall	4	Door	Casing	Solid	Metal	0.05
281	1956 Bldg	102	XRF	4/13/97	1	Hall	4	Wall	Radiator	Solid	Metal	0.06
282	1956 Bldg	103	XRF	4/13/97	1	Hall	4	Wall	Midle Wall	Solid	Tile	5.09
283	1956 Bldg	104	XRF	4/13/97	1	Hall	4	Door	Door	Cracked	Wood	0.01
284	1956 Bldg	105	XRF	4/13/97	1	Hall	4	Door	Casing	Cracked	Metal	0.07
285	1956 Bldg	106	XRF	4/13/97	1	Hall	4	Ceiling	Hatch	Cracked	Metal	0.13
286	1956 Bldg	107	XRF	4/13/97	1	Hall	4	Ceiling	Radlator	Solid	Metal	0.55
287	1956 Bldg	39	XRF	4/13/97	1	Kitchen	1	Wall	Midle Wall	Solid	Plaster	0.08
288	1956 Bldg	40	XRF	4/13/97	1	Kitchen	1	Door	Door	Solid	Wood	0
289	1956 Bldg	41	XRF	4/13/97	1	Kitchen	1	Door	Casing	Solid	Metal	0.01
290	1956 Bldg	42	XRF	4/13/97	1	Kitchen	1	Wall	Baseboar	Solid	Tile	0.84
291	1956 Bldg	43	XRF	4/13/97	1	Kitchen	1	Floor		Solid	Tile	0.03
292	1956 Bldg	44	XRF	4/13/97	1	Kitchen	1	Wall	Wall	Solid	Tile	0.56
293	1956 Bldg	45	XRF	4/13/97	1	Kitchen	1	Cabinet	Door	Cracked	Metal	0.55
294	1956 Bldg	54	XRF	4/13/97	1	Kitchen	1	Wall	Midle Wall	Solid	Concrete	0.02
295	1956 Bldg	55	XRF	4/13/97	1	Kitchen	1		Wire Tray	Solid	Metal	0.06
296	1956 Bldg	56	XRF	4/13/97	1	Kitchen	1	Bulletin Board	Midle Wall	Solid	Wood	0.03

Saint Paul Public Schools
 Maxfield Magnet School
 Lead-Based Paint Inspection

3	A	B	C	D	E	F	G	H	I	J	K	L
	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
297	1956 Bldg	57	XRF	4/13/97	1	Kitchen	1	Wall	Wall Rgstr	Solid	Metal	0.01
298	1956 Bldg	58	XRF	4/13/97	1	Kitchen	1	Ceiling		Solid	Plaster	0.08
299	1956 Bldg	6	XRF	4/5/97	1	Outside	0	Door	Door	Cracked	Metal	0.42
300	1956 Bldg	7	XRF	4/5/97	1	Outside	0	Door	Jamb	Cracked	Metal	0.67
301	1956 Bldg	8	XRF	4/5/97	1	Outside	0	Ext Wall	Siding	Solid	Wood	0.07
302	1956 Bldg	9	XRF	4/5/97	1	Outside	0	Ext Wall	Trim	Solid	Metal	0.76
303	1956 Bldg	10	XRF	4/5/97	1	Outside	0	Ext Wall	Soffit	Solid	Plaster	0
304	1956 Bldg	11	XRF	4/5/97	1	Outside	0	Outside	Flag Pole	Solid	Metal	0
305	1956 Bldg	6	XRF	4/19/97	1	Outside	0	Door	Door	Cracked	Metal	0.43
306	1956 Bldg	7	XRF	4/19/97	1	Outside	0	Door	Jamb	Solid	Metal	0.36
307	1956 Bldg	127	XRF	4/19/97	1	Outside	0	Ext Wall	Siding	Solid	Wood	0.01
308	1956 Bldg	128	XRF	4/19/97	1	Outside	0	Ext Wall	Trim	Cracked	Metal	0.19
309	1956 Bldg	129	XRF	4/19/97	1	Outside	0	Door	Door	Cracked	Metal	0.43
310	1956 Bldg	130	XRF	4/19/97	1	Outside	0	Door	Jamb	Solid	Metal	0.43
311	1956 Bldg	131	XRF	4/19/97	1	Outside	0	Stairs	Hand rail	Cracked	Metal	0
312	1956 Bldg	132	XRF	4/19/97	1	Outside	0	Wall	Wall Rgstr	Cracked	Metal	0.34
313	1956 Bldg	110	XRF	4/5/97	2	Restroom	1	Wall	Midle Wall	Solid	Tile	2.85
314	1956 Bldg	111	XRF	4/5/97	2	Restroom	1	Wall	Radiator	Solid	Metal	0.01
315	1956 Bldg	112	XRF	4/5/97	2	Restroom	1	Floor		Solid	Tile	0.44
316	1956 Bldg	113	XRF	4/5/97	2	Restroom	1	Wall	Wall Rgstr	Solid	Metal	0.01
317	1956 Bldg	114	XRF	4/5/97	2	Restroom	1	Ceiling		Solid	Plaster	0.07
318	1956 Bldg	115	XRF	4/5/97	2	Restroom	1	Door	Door	Cracked		0.01
319	1956 Bldg	116	XRF	4/5/97	2	Restroom	1	Door	Door Rgst	Cracked	Metal	0
320	1956 Bldg	117	XRF	4/5/97	2	Restroom	1	Door	Casing	Cracked	Metal	0.03
321	1956 Bldg	128	XRF	4/5/97	2	Restroom	2	Wall	Wall	Solid	Tile	3.3
322	1956 Bldg	129	XRF	4/5/97	2	Restroom	2	Floor		Solid	Tile	0.21
323	1956 Bldg	130	XRF	4/5/97	2	Restroom	2	Wall	Bthrm Stll	Solid	Metal	0.5
324	1956 Bldg	131	XRF	4/5/97	2	Restroom	2	Wall	Wall Rgstr	Solid	Metal	0.04
325	1956 Bldg	132	XRF	4/5/97	2	Restroom	2	Ceiling		Solid	Plaster	0.11
326	1956 Bldg	133	XRF	4/5/97	2	Restroom	2		Radiator	Cracked	Metal	0.06
327	1956 Bldg	134	XRF	4/5/97	2	Restroom	2	Door	Door	Solid	Wood	0.01
328	1956 Bldg	135	XRF	4/5/97	2	Restroom	2	Door	Casing	Cracked	Metal	0.11
329	1956 Bldg	212	XRF	4/5/97	1	Restroom	3	Wall	Wall	Solid	Drywall	0.03
330	1956 Bldg	213	XRF	4/5/97	1	Restroom	3	Floor		Solid	Tile	0.01
331	1956 Bldg	214	XRF	4/5/97	1	Restroom	3	Door	Door	Solid	Wood	0
332	1956 Bldg	215	XRF	4/5/97	1	Restroom	3	Door	Casing	Solid	Metal	0
333	1956 Bldg	307	XRF	4/5/97	1	Restroom	4	Wall	Midle Wall	Solid	Tile	2.83
334	1956 Bldg	308	XRF	4/5/97	1	Restroom	4	Floor		Solid	Tile	0.34
335	1956 Bldg	309	XRF	4/5/97	1	Restroom	4	Wall	Radiator	Cracked	Metal	0.01
336	1956 Bldg	310	XRF	4/5/97	1	Restroom	4	Wall	Wall Rgstr	Cracked	Metal	0.01
337	1956 Bldg	311	XRF	4/5/97	1	Restroom	4	Ceiling		Solid	Plaster	0.03
338	1956 Bldg	312	XRF	4/5/97	1	Restroom	4	Door	Door	Solid	Wood	0.01
339	1956 Bldg	313	XRF	4/5/97	1	Restroom	4	Door	Door Rgst	Cracked	Metal	0
340	1956 Bldg	314	XRF	4/5/97	1	Restroom	4	Door	Casing	Cracked	Metal	0.02
341	1956 Bldg	323	XRF	4/5/97	1	Restroom	5	Wall	Midle Wall	Solid	Tile	3.11
342	1956 Bldg	324	XRF	4/5/97	1	Restroom	5	Wall	Radiator	Cracked	Metal	0.09
343	1956 Bldg	325	XRF	4/5/97	1	Restroom	5	Wall	Bthrm Stll	Solid	Metal	0.61
344	1956 Bldg	326	XRF	4/5/97	1	Restroom	5	Wall	Wall Rgstr	Solid	Metal	0.04
345	1956 Bldg	327	XRF	4/5/97	1	Restroom	5	Ceiling		Solid	Plaster	0.01
346	1956 Bldg	328	XRF	4/5/97	1	Restroom	5	Door	Door	Solid	Wood	0.01
347	1956 Bldg	329	XRF	4/5/97	1	Restroom	5	Door	Door Rgst	Solid	Metal	0.02
348	1956 Bldg	330	XRF	4/5/97	1	Restroom	5	Door	Casing	Cracked	Metal	0.07
349	1956 Bldg	38	XRF	4/6/97	1	Restroom	6	Wall	Midle Wall	Solid	Tile	3.25
350	1956 Bldg	39	XRF	4/6/97	1	Restroom	6	Floor	Midle Wall	Solid	Tile	0.27
351	1956 Bldg	40	XRF	4/6/97	1	Restroom	6	Door	Door	Solid	Wood	0.01
352	1956 Bldg	41	XRF	4/6/97	1	Restroom	6	Door	Casing	Solid	Metal	0.05
353	1956 Bldg	42	XRF	4/6/97	1	Restroom	6	Ceiling		Solid	Plaster	0.04
354	1956 Bldg	80	XRF	4/6/97	1	Restroom	7	Wall	Wall	Solid	Tile	2.57
355	1956 Bldg	81	XRF	4/6/97	1	Restroom	7	Door	Door	Solid	Wood	0

Saint Paul Public Schools
 Maxfield Magnet School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
356	1956 Bldg	82	XRF	4/6/97	1	Restroom	7	Door	Casing	Solid	Metal	0.04
357	1956 Bldg	83	XRF	4/6/97	1	Restroom	7	Floor		Solid	Tile	0.14
358	1956 Bldg	84	XRF	4/6/97	1	Restroom	7	Ceiling		Solid	Plaster	0.09
359	1956 Bldg	85	XRF	4/6/97	1	Restroom	7	Wall	Wall Rgstr	Cracked	Metal	0.02
360	1956 Bldg	110	XRF	4/6/97	1	Restroom	8	Wall	Middle Wall	Solid	Tile	2.83
361	1956 Bldg	111	XRF	4/6/97	1	Restroom	8	Door	Door	Solid	Wood	0.01
362	1956 Bldg	112	XRF	4/6/97	1	Restroom	8	Door	Casing	Cracked	Metal	0.03
363	1956 Bldg	113	XRF	4/6/97	1	Restroom	8	Ceiling		Solid	Plaster	0.05
364	1956 Bldg	114	XRF	4/6/97	1	Restroom	8	Wall	Diffuser	Solid	Metal	0.01
365	1956 Bldg	131	XRF	4/6/97	1	Restroom	9	Wall	Wall	Solid	Plaster	0.14
366	1956 Bldg	132	XRF	4/6/97	1	Restroom	9	Wall	Wall	Solid	Tile	3.42
367	1956 Bldg	133	XRF	4/6/97	1	Restroom	9	Wall	Bthrm Sttl	Solid	Metal	0.05
368	1956 Bldg	134	XRF	4/6/97	1	Restroom	9	Ceiling		Solid	Plaster	0.04
369	1956 Bldg	135	XRF	4/6/97	1	Restroom	9	Ceiling	Diffuser	Solid		0.01
370	1956 Bldg	136	XRF	4/6/97	1	Restroom	9	Door	Door	Solid	Wood	0.01
371	1956 Bldg	137	XRF	4/6/97	1	Restroom	9	Door	Casing	Solid	Metal	0.14
372	1956 Bldg	138	XRF	4/6/97	1	Restroom	9	Door	Casing	Solid	Metal	0.07
373	1956 Bldg	139	XRF	4/6/97	1	Restroom	9	Floor		Solid	Tile	0.27
374	1956 Bldg	140	XRF	4/6/97	1	Restroom	9	Ceiling	Hatch	Solid	Metal	0.2
375	1956 Bldg	141	XRF	4/6/97	1	Restroom	10	Wall	Middle Wall	Solid	Tile	3.12
376	1956 Bldg	142	XRF	4/6/97	1	Restroom	10	Wall	Bthrm Sttl	Solid	Metal	0.04
377	1956 Bldg	143	XRF	4/6/97	1	Restroom	10	Door	Door	Solid	Wood	0.01
378	1956 Bldg	144	XRF	4/6/97	1	Restroom	10	Door	Casing	Cracked	Metal	0.04
379	1956 Bldg	145	XRF	4/6/97	1	Restroom	10	Ceiling		Solid	Plaster	0.04
380	1956 Bldg	146	XRF	4/6/97	1	Restroom	10	Ceiling	Diffuser	Solid		0.01
381	1956 Bldg	147	XRF	4/6/97	1	Restroom	10	Floor		Solid	Tile	0.34
382	1956 Bldg	169	XRF	4/6/97	1	Restroom	11	Wall	Midle Wall	Solid	Tile	3.42
383	1956 Bldg	170	XRF	4/6/97	1	Restroom	11	Wall	Midle Wall	Solid	Tile	0.45
384	1956 Bldg	171	XRF	4/6/97	1	Restroom	11	Bookcase	Shelf	Solid	Wood	0.26
385	1956 Bldg	172	XRF	4/6/97	1	Restroom	11	Door	Door	Solid	Wood	0.01
386	1956 Bldg	173	XRF	4/6/97	1	Restroom	11	Door	Casing	Cracked	Metal	0.05
387	1956 Bldg	174	XRF	4/6/97	1	Restroom	11	Wall	Wall Rgstr	Cracked	Metal	0.02
388	1956 Bldg	175	XRF	4/6/97	1	Restroom	11	Ceiling		Solid	Plaster	0.02
389	1956 Bldg	185	XRF	4/5/97	1	Room	1	Wall	Wall	Solid	Concrete	0.01
390	1956 Bldg	186	XRF	4/5/97	1	Room	1	Wall	Radiator	Solid	Metal	0.3
391	1956 Bldg	187	XRF	4/5/97	1	Room	1		Wire Tray	Solid	Metal	0.01
392	1956 Bldg	188	XRF	4/5/97	1	Room	1	Window	Stool	Solid	Metal	0.75
393	1956 Bldg	189	XRF	4/5/97	1	Room	1	Bookshelf	Rgstr	Solid	Metal	0.02
394	1956 Bldg	190	XRF	4/5/97	1	Room	1	Bookcase	Shelf	Solid	Metal	0.04
395	1956 Bldg	191	XRF	4/5/97	1	Room	1	Wall	Middle Wall	Solid	Drywall	0
396	1956 Bldg	192	XRF	4/5/97	1	Room	1	Door	Door	Solid	Wood	0
397	1956 Bldg	193	XRF	4/5/97	1	Room	1	Door	Casing	Solid	Metal	0
398	1956 Bldg	194	XRF	4/5/97	1	Room	2	Window	Stool	Solid	Metal	0.6
399	1956 Bldg	195	XRF	4/5/97	1	Room	2	Wall	Wall Rgstr	Solid	Metal	0.01
400	1956 Bldg	196	XRF	4/5/97	1	Room	2		Univent	Solid	Metal	0.03
401	1956 Bldg	197	XRF	4/5/97	1	Room	2	Wall	Wall	Solid	Drywall	0
402	1956 Bldg	198	XRF	4/5/97	1	Room	2		Wire Tray	Solid	Metal	0.01
403	1956 Bldg	199	XRF	4/5/97	1	Room	2	Door	Door	Solid	Metal	0.01
404	1956 Bldg	200	XRF	4/5/97	1	Room	2	Door	Casing	Solid	Metal	0.02
405	1956 Bldg	201	XRF	4/5/97	1	Room	3	Window	Stool	Solid	Metal	0.78
406	1956 Bldg	202	XRF	4/5/97	1	Room	3	Bookshelf	Rgstr	Solid	Metal	0.02
407	1956 Bldg	203	XRF	4/5/97	1	Room	3	Bookcase	Shelf	Cracked	Metal	0.06
408	1956 Bldg	204	XRF	4/5/97	1	Room	3	Wall	Middle Wall	Solid	Concrte	0.02
409	1956 Bldg	205	XRF	4/5/97	1	Room	3		Wire Tray	Solid	Metal	0.01
410	1956 Bldg	206	XRF	4/5/97	1	Room	3	Wall	Radiator	Solid	Metal	0.31
411	1956 Bldg	207	XRF	4/5/97	1	Room	3	Wall	Midle Wall	Solid	Drywall	0
412	1956 Bldg	208	XRF	4/5/97	1	Room	3	Bulletin Board	Frame	Solid	Wood	0
413	1956 Bldg	209	XRF	4/5/97	1	Room	3	Screen	Mountbrd	Solid	Wood	0
414	1956 Bldg	210	XRF	4/5/97	1	Room	3	Door	Door	Solid	Wood	0

Saint Paul Public Schools
 Maxfield Magnet School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
415	1956 Bldg	211	XRF	4/5/97	1	Room	3	Door	Casing	Solid	Metal	0
416	1956 Bldg	216	XRF	4/5/97	1	Room	4	Wall	Wall	Solid	Concrete	0.03
417	1956 Bldg	217	XRF	4/5/97	1	Room	4	Wall	Middle Wall	Solid	Plaster	0.01
418	1956 Bldg	218	XRF	4/5/97	1	Room	4	Wall	Soffit	Solid	Plaster	0.56
419	1956 Bldg	219	XRF	4/5/97	1	Room	4	Cabinet	Door	Solid	Wood	0.01
420	1956 Bldg	220	XRF	4/5/97	1	Room	4	Wall	Middle Wall	Solid	Drywall	0.01
421	1956 Bldg	221	XRF	4/5/97	1	Room	4	Door	Door	Solid	Wood	0
422	1956 Bldg	222	XRF	4/5/97	1	Room	4	Door	Casing	Solid	Metal	0
423	1956 Bldg	331	XRF	4/5/97	1	Room	5	Wall	Middle Wall	Solid	Plaster	0.08
424	1956 Bldg	332	XRF	4/5/97	1	Room	5	Bookcase	Shelf	Solid	Wood	0
425	1956 Bldg	333	XRF	4/5/97	1	Room	5	Window	Stool	Solid	Metal	0.11
426	1956 Bldg	334	XRF	4/5/97	1	Room	5	Wall	Radiator	Solid	Metal	0.05
427	1956 Bldg	335	XRF	4/5/97	1	Room	5	Wall Tile	Trim	Solid	Wood	0.02
428	1956 Bldg	336	XRF	4/5/97	1	Room	5	Bulletin Board	Frame	Solid	Wood	0
429	1956 Bldg	337	XRF	4/5/97	1	Room	5	Door	Door	Solid	Wood	0.02
430	1956 Bldg	338	XRF	4/5/97	1	Room	5	Door	Casing	Solid	Metal	0.03
431	1956 Bldg	339	XRF	4/5/97	1	Room	5	Door	Door	Solid	Wood	0
432	1956 Bldg	340	XRF	4/5/97	1	Room	5	Door	Casing	Solid	Metal	0.01
433	1956 Bldg	341	XRF	4/5/97	1	Room	5	Door	Header	Solid	Metal	0.01
434	1956 Bldg	342	XRF	4/5/97	1	Room	6	Wall	Wall	Cracked	Plaster	0.09
435	1956 Bldg	343	XRF	4/5/97	1	Room	6	Wall	Radiator	Solid	Metal	0.03
436	1956 Bldg	344	XRF	4/5/97	1	Room	6	Window	Stool	Solid	Metal	0.37
437	1956 Bldg	345	XRF	4/5/97	1	Room	6	Cabinet	Door	Solid	Wood	0
438	1956 Bldg	346	XRF	4/5/97	1	Room	6		Wire Tray	Solid	Metal	0.01
439	1956 Bldg	347	XRF	4/5/97	1	Room	6	Bulletin Board	Frame	Solid	Wood	0
440	1956 Bldg	348	XRF	4/5/97	1	Room	6	Bulletin Board	Frame	Solid	Wood	0.04
441	1956 Bldg	349	XRF	4/5/97	1	Room	6	Door	Door	Solid	Wood	0
442	1956 Bldg	350	XRF	4/5/97	1	Room	6	Door	Casing	Solid	Metal	0.03
443	1956 Bldg	351	XRF	4/5/97	1	Room	6	Ceiling		Solid	Plaster	0.09
444	1956 Bldg	49	XRF	4/6/97	1	Room	7	Door	Door	Cracked	Metal	0.07
445	1956 Bldg	50	XRF	4/6/97	1	Room	7	Door	Casing	Cracked	Metal	0.07
446	1956 Bldg	51	XRF	4/6/97	1	Room	7	Door	Jamb	Cracked	Metal	0.07
447	1956 Bldg	52	XRF	4/6/97	1	Room	7	Wall	Wall	Solid	Wood	0.01
448	1956 Bldg	53	XRF	4/6/97	1	Room	7	Wall	Middle Wall	Solid	Tile	3.03
449	1956 Bldg	54	XRF	4/6/97	1	Room	7	Wall	Radiator	Solid	Metal	0.04
450	1956 Bldg	55	XRF	4/6/97	1	Room	7	Door	Door	Solid	Wood	0.02
451	1956 Bldg	56	XRF	4/6/97	1	Room	7	Door	Casing	Cracked	Metal	0.08
452	1956 Bldg	57	XRF	4/6/97	1	Room	7	Ceiling		Solid	Plaster	0.09
453	1956 Bldg	98	XRF	4/6/97	1	Room	8	Door	Door	Solid	Wood	0.02
454	1956 Bldg	99	XRF	4/6/97	1	Room	8	Door	Casing	Solid	Metal	0.05
455	1956 Bldg	100	XRF	4/6/97	1	Room	8	Wall	Wall	Solid	Plaster	0.07
456	1956 Bldg	101	XRF	4/6/97	1	Room	8	Window	Stool	Solid	Metal	0.09
457	1956 Bldg	102	XRF	4/6/97	1	Room	8	Window	Casing	Solid	Metal	0
458	1956 Bldg	103	XRF	4/6/97	1	Room	8	Wall	Middle Wall	Solid	Wood	0
459	1956 Bldg	104	XRF	4/6/97	1	Room	8	Bulletin Board	Middle Wall	Solid	Wood	0
460	1956 Bldg	105	XRF	4/6/97	1	Room	8	Wall	Radiator	Solid	Metal	0.08
461	1956 Bldg	106	XRF	4/6/97	1	Room	8		Wire Tray	Solid	Metal	0.07
462	1956 Bldg	107	XRF	4/6/97	1	Room	8	Ceiling	Hatch	Solid	Metal	0.21
463	1956 Bldg	108	XRF	4/6/97	1	Room	8	Cabinet	Door	Solid	Metal	0.01
464	1956 Bldg	109	XRF	4/6/97	1	Room	8	Cabinet	Door	Solid	Metal	0.04
465	1956 Bldg	115	XRF	4/6/97	1	Room	9	Wall	Middle Wall	Solid	Concrete	0.11
466	1956 Bldg	116	XRF	4/6/97	1	Room	9	Ladder		Cracked	Metal	0.14
467	1956 Bldg	117	XRF	4/6/97	1	Room	9	Wall	Radiator	Solid	Metal	0.01
468	1956 Bldg	118	XRF	4/6/97	1	Room	9	Door	Door	Solid	Wood	0.01
469	1956 Bldg	119	XRF	4/6/97	1	Room	9	Door	Casing	Cracked	Metal	0.02
470	1956 Bldg	120	XRF	4/6/97	1	Room	9	Door	Door	Solid	Wood	0.01
471	1956 Bldg	121	XRF	4/6/97	1	Room	9	Door	Casing	Solid	Metal	0.05
472	1956 Bldg	122	XRF	4/6/97	1	Room	9	Window	Stool	Solid	Metal	0.2
473	1956 Bldg	123	XRF	4/6/97	1	Room	9	Window	Casing	Solid	Metal	0

Saint Paul Public Schools
 Maxfield Magnet School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
474	1956 Bldg	124	XRF	4/6/97	1	Room	9	Wall	Midle Wall	Solid	Wood	0
475	1956 Bldg	125	XRF	4/6/97	1	Room	9	Coat Rack	Midle Wall	Solid	Wood	0
476	1956 Bldg	126	XRF	4/6/97	1	Room	9	Frame	Midle Wall	Cracked	Metal	0.01
477	1956 Bldg	127	XRF	4/6/97	1	Room	9	Stairs	Hand rail	Cracked	Metal	0
478	1956 Bldg	128	XRF	4/6/97	1	Room	9	Ceiling		Solid	Plaster	0.22
479	1956 Bldg	129	XRF	4/6/97	1	Room	9	Ceiling	Hatch	Solid	Metal	0.4
480	1956 Bldg	148	XRF	4/6/97	1	Room	10	Door	Door	Cracked	Metal	0.02
481	1956 Bldg	149	XRF	4/6/97	1	Room	10	Door	Casing	Solid	Metal	0.01
482	1956 Bldg	150	XRF	4/6/97	1	Room	10	Wall	Wall	Solid	Plaster	0.03
483	1956 Bldg	151	XRF	4/6/97	1	Room	10	Wall	Wall	Solid	Plaster	0.03
484	1956 Bldg	152	XRF	4/6/97	1	Room	10	Wall	Radiator	Solid	Metal	0.04
485	1956 Bldg	153	XRF	4/6/97	1	Room	10	Wall	Wall Rgstr	Solid	Metal	0
486	1956 Bldg	154	XRF	4/6/97	1	Room	10	Door	Door	Solid	Wood	0.01
487	1956 Bldg	155	XRF	4/6/97	1	Room	10	Door	Casing	Solid	Metal	0.17
488	1956 Bldg	156	XRF	4/6/97	1	Room	10		Wire Tray	Solid	Metal	0.01
489	1956 Bldg	157	XRF	4/6/97	1	Room	10	Wall	Elec Pane	Solid	Metal	0
490	1956 Bldg	158	XRF	4/6/97	1	Room	10	Ceiling	Hatch	Solid	Metal	0.2
491	1956 Bldg	159	XRF	4/6/97	1	Room	10	Cabinet	Door	Solid	Wood	0
492	1956 Bldg	160	XRF	4/6/97	1	Room	10	Cabinet	Door	Solid	Wood	0
493	1956 Bldg	161	XRF	4/6/97	1	Room	10	Cabinet	Shelf	Solid	Wood	0
494	1956 Bldg	162	XRF	4/6/97	1	Room	11	Wall	Wall	Solid	Concrte	0.17
495	1956 Bldg	163	XRF	4/6/97	1	Room	11	Wall	Midle Wall	Solid	Plaster	0.11
496	1956 Bldg	164	XRF	4/6/97	1	Room	11	Wall	Wall	Solid	Plaster	0.16
497	1956 Bldg	165	XRF	4/6/97	1	Room	11	Door	Door	Cracked	Wood	0.01
498	1956 Bldg	166	XRF	4/6/97	1	Room	11	Door	Casing	Cracked	Metal	0.11
499	1956 Bldg	167	XRF	4/6/97	1	Room	11	Wall	Radiator	Solid	Metal	0.01
500	1956 Bldg	168	XRF	4/6/97	1	Room	11	Wall	Wall Rgstr	Solid	Metal	0
501	1956 Bldg	177	XRF	4/6/97	1	Room	12	Wall	Midle Wall	Solid	Plaster	0.12
502	1956 Bldg	178	XRF	4/6/97	1	Room	12	Window	Stool	Solid	Metal	0.19
503	1956 Bldg	179	XRF	4/6/97	1	Room	12	Wall	Midle Wall	Solid	Wood	0.01
504	1956 Bldg	180	XRF	4/6/97	1	Room	12	Wall	Radiator	Solid	Metal	0.03
505	1956 Bldg	181	XRF	4/6/97	1	Room	12	Mini Blinds		Solid	Metal	0.35
506	1956 Bldg	182	XRF	4/6/97	1	Room	12	Door	Door	Solid	Wood	0
507	1956 Bldg	183	XRF	4/6/97	1	Room	12	Door	Casing	Cracked	Metal	0
508	1956 Bldg	184	XRF	4/6/97	1	Room	12	Wall	Wall Rgstr	Solid	Metal	0
509	1956 Bldg	185	XRF	4/6/97	1	Room	13	Window	Stool	Cracked	Metal	0.1
510	1956 Bldg	186	XRF	4/6/97	1	Room	13	Wall	Radiator	Solid	Metal	0.16
511	1956 Bldg	187	XRF	4/6/97	1	Room	13	Mini Blinds		Solid	Metal	0.39
512	1956 Bldg	188	XRF	4/6/97	1	Room	13	Wall	Wall	Solid	Plaster	0.01
513	1956 Bldg	189	XRF	4/6/97	1	Room	13	Door	Door	Solid	Wood	0.03
514	1956 Bldg	190	XRF	4/6/97	1	Room	13	Door	Casing	Cracked	Metal	0.04
515	1956 Bldg	191	XRF	4/6/97	1	Room	13	Wall	Wall Rgstr	Solid	Metal	0
516	1956 Bldg	192	XRF	4/6/97	1	Room	14	Wall	Midle Wall	Solid	Plaster	0.1
517	1956 Bldg	193	XRF	4/6/97	1	Room	14	Window	Stool	Solid	Metal	0.12
518	1956 Bldg	194	XRF	4/6/97	1	Room	14	Wall	Radiator	Solid	Metal	0.05
519	1956 Bldg	195	XRF	4/6/97	1	Room	14	Mini Blinds		Solid	Metal	0.35
520	1956 Bldg	196	XRF	4/6/97	1	Room	14	Wall	Soffit	Solid	Plaster	0
521	1956 Bldg	197	XRF	4/6/97	1	Room	14	Wall	Wall Rgstr	Solid	Metal	0
522	1956 Bldg	198	XRF	4/6/97	1	Room	14	Door	Door	Solid	Wood	0
523	1956 Bldg	199	XRF	4/6/97	1	Room	14	Door	Casing	Cracked	Metal	0.02
524	1956 Bldg	17	XRF	4/13/97	1	Room	15	Wall	Wall	Solid	Tile	3.29
525	1956 Bldg	18	XRF	4/13/97	1	Room	15	Cabinet	Door	Solid	Metal	0.01
526	1956 Bldg	19	XRF	4/13/97	1	Room	15	Cabinet	Inside	Cracked	Metal	0.01
527	1956 Bldg	20	XRF	4/13/97	1	Room	15		Mounting	Solid	Wood	0
528	1956 Bldg	21	XRF	4/13/97	1	Room	15	Chalk Board		Solid	Metal	0.01
529	1956 Bldg	22	XRF	4/13/97	1	Room	15	Wall	Midle Wall	Solid	Concrte	0.03
530	1956 Bldg	23	XRF	4/13/97	1	Room	15	Door	Door	Cracked	Metal	0.03
531	1956 Bldg	24	XRF	4/13/97	1	Room	15	Door	Casing	Cracked	Metal	0.09
532	1956 Bldg	25	XRF	4/13/97	1	Room	15	Door	Jamb	Cracked	Metal	0.02

Saint Paul Public Schools
 Maxfield Magnet School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
533	1956 Bldg	26	XRF	4/13/97	1	Room	15	Wall	Wall Rgstr	Solid	Metal	0.03
534	1956 Bldg	27	XRF	4/13/97	1	Room	15	Door	Door	Cracked	Wood	0.01
535	1956 Bldg	28	XRF	4/13/97	1	Room	15	Door	Casing	Solid	Metal	0.12
536	1956 Bldg	29	XRF	4/13/97	1	Room	15	Door	Door	Solid	Wood	0.01
537	1956 Bldg	30	XRF	4/13/97	1	Room	15		Wire Tray	Solid	Metal	0.03
538	1956 Bldg	31	XRF	4/13/97	1	Room	15	Wall	Wall	Solid	Tile	0.4
539	1956 Bldg	32	XRF	4/13/97	1	Room	15	Door	Header	Solid	Metal	0
540	1956 Bldg	33	XRF	4/13/97	1	Room	15	Wall	Wall	Solid	Concrete	0.08
541	1956 Bldg	34	XRF	4/13/97	1	Room	15	Wall	Wall Rgstr	Solid	Metal	0.03
542	1956 Bldg	35	XRF	4/13/97	1	Room	15	Cabinet	Door	Cracked	Wood	0
543	1956 Bldg	36	XRF	4/13/97	1	Room	15	Closet	Wall	Solid	Concrete	0.07
544	1956 Bldg	37	XRF	4/13/97	1	Room	15	Ceiling		Solid	Plaster	0.26
545	1956 Bldg	38	XRF	4/13/97	1	Room	15	Closet	Casing	Solid	Metal	0.16
546	1956 Bldg	46	XRF	4/13/97	1	Room	16	Wall	Midle Wall	Solid	Plaster	0.09
547	1956 Bldg	47	XRF	4/13/97	1	Room	16	Wall	Wall	Solid	Tile	0.51
548	1956 Bldg	48	XRF	4/13/97	1	Room	16		Vent	Solid	Metal	0.15
549	1956 Bldg	49	XRF	4/13/97	1	Room	16	Door	Door	Cracked	Wood	0
550	1956 Bldg	50	XRF	4/13/97	1	Room	16	Door	Casing	Cracked	Metal	0.13
551	1956 Bldg	51	XRF	4/13/97	1	Room	16	Door	Door	Solid	Wood	0.02
552	1956 Bldg	52	XRF	4/13/97	1	Room	16	Door	Casing	Cracked	Metal	0.05
553	1956 Bldg	68	XRF	4/13/97	1	Room	17	Wall	Wall	Solid	Concrete	0
554	1956 Bldg	69	XRF	4/13/97	1	Room	17	Door	Door	Solid	Wood	0
555	1956 Bldg	70	XRF	4/13/97	1	Room	17	Door	Casing	Solid	Metal	0.03
556	1956 Bldg	71	XRF	4/13/97	1	Room	17		Elec Pane	Solid	Metal	0
557	1956 Bldg	72	XRF	4/13/97	1	Room	17	Ceiling		Solid	Plaster	0.31
558	1956 Bldg	73	XRF	4/13/97	1	Room	17	Wall	Diffuser	Solid	Metal	0
559	1956 Bldg	74	XRF	4/13/97	1	Room	18	Wall	Midle Wall	Solid	Concrete	0
560	1956 Bldg	75	XRF	4/13/97	1	Room	18	Wall	Wall	Solid	Wood	0
561	1956 Bldg	76	XRF	4/13/97	1	Room	18	Window	Stool	Cracked	Metal	0.36
562	1956 Bldg	77	XRF	4/13/97	1	Room	18	Window	Casing	Solid	Metal	0
563	1956 Bldg	78	XRF	4/13/97	1	Room	18	Door	Door	Solid	Wood	0
564	1956 Bldg	79	XRF	4/13/97	1	Room	18	Door	Casing	Cracked	Metal	0
565	1956 Bldg	80	XRF	4/13/97	1	Room	19	Wall	Wall	Solid	Concrete	0.29
566	1956 Bldg	81	XRF	4/13/97	1	Room	19	Cabinet	Door	Solid	Wood	0.01
567	1956 Bldg	82	XRF	4/13/97	1	Room	19	Window	Stool	Solid	Metal	0.3
568	1956 Bldg	83	XRF	4/13/97	1	Room	19	Window	Casing	Solid	Metal	0
569	1956 Bldg	84	XRF	4/13/97	1	Room	19	Wall	Wall	Solid	Wood	0
570	1956 Bldg	85	XRF	4/13/97	1	Room	19	Wall	Radiator	Peeling	Metal	0.26
571	1956 Bldg	86	XRF	4/13/97	1	Room	19	Wall	Midle Wall	Cracked	Plaster	0.03
572	1956 Bldg	87	XRF	4/13/97	1	Room	19	Door	Door	Solid	Wood	0
573	1956 Bldg	88	XRF	4/13/97	1	Room	19	Wall	Wall Rgstr	Solid	Metal	0
574	1956 Bldg	89	XRF	4/13/97	1	Room	19	Door	Casing	Solid	Metal	0.25
575	1956 Bldg	8	XRF	4/19/97	0	Room	52	Wall	Midle Wall	Solid	Concrete	0.14
576	1956 Bldg	9	XRF	4/19/97	0	Room	52	Ladder	Midle Wall	Solid	Metal	0.04
577	1956 Bldg	10	XRF	4/19/97	0	Room	52		Elec Pane	Solid	Metal	0.11
578	1956 Bldg	11	XRF	4/19/97	0	Room	52	Wall	Midle Wall	Solid	Concrete	0.09
579	1956 Bldg	12	XRF	4/19/97	0	Room	52	Door	Door	Cracked	Metal	0.06
580	1956 Bldg	13	XRF	4/19/97	0	Room	52	Door	Casing	Cracked	Metal	0.03
581	1956 Bldg	14	XRF	4/19/97	0	Room	52	Stairs	Hand rail	Solid	Metal	0.01
582	1956 Bldg	15	XRF	4/19/97	0	Room	52	Stairs	Baseboar	Solid	Metal	0.04
583	1956 Bldg	16	XRF	4/19/97	0	Room	52	Ladder	Midle Wall	Cracked	Metal	0.15
584	1956 Bldg	17	XRF	4/19/97	0	Room	52	Floor		Cracked	Concrete	0.02
585	1956 Bldg	18	XRF	4/19/97	0	Room	52	Ceiling		Cracked	Plaster	0
586	1956 Bldg	19	XRF	4/19/97	0	Room	52	Ladder	Midle Wall	Solid	Metal	0.04
587	1956 Bldg	20	XRF	4/19/97	0	Room	52	Door	Door	Solid	Metal	0.03
588	1956 Bldg	21	XRF	4/19/97	0	Room	52	Door	Casing	Solid	Metal	0.06
589	1956 Bldg	22	XRF	4/19/97	0	Room	52	Door	Door	Solid	Metal	0.01
590	1956 Bldg	118	XRF	4/5/97	2	Room	100	Wall	Midle Wall	Solid	Plaster	0.05
591	1956 Bldg	119	XRF	4/5/97	2	Room	100	Door	Door	Solid	Wood	0.01

Saint Paul Public Schools
 Maxfield Magnet School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
592	1956 Bldg	120	XRF	4/5/97	2	Room	100	Coat Rack	Shelf	Solid	Wood	0
593	1956 Bldg	121	XRF	4/5/97	2	Room	100	Wall	Wall	Solid	Tile	3.4
594	1956 Bldg	122	XRF	4/5/97	2	Room	100	Wall	Radiator	Solid	Metal	0.06
595	1956 Bldg	123	XRF	4/5/97	2	Room	100	Ladder		Solid	Metal	0.19
596	1956 Bldg	124	XRF	4/5/97	2	Room	100	Ceiling	Door	Cracked	Metal	0.42
597	1956 Bldg	125	XRF	4/5/97	2	Room	100	Door	Door	Solid	Wood	0.01
598	1956 Bldg	126	XRF	4/5/97	2	Room	100	Door	Casing	Solid	Metal	0.07
599	1956 Bldg	127	XRF	4/5/97	2	Room	100	Ceiling		Solid	Plaster	0.12
600	1956 Bldg	316	XRF	4/5/97	1	Room	100	Wall	Wall	Solid	Plaster	0.13
601	1956 Bldg	317	XRF	4/5/97	1	Room	100	Door	Door	Solid	Metal	0.01
602	1956 Bldg	318	XRF	4/5/97	1	Room	100	Coat Rack	Shelf	Solid	Wood	0
603	1956 Bldg	319	XRF	4/5/97	1	Room	100	Wall	Wall	Solid	Concrete	2.02
604	1956 Bldg	320	XRF	4/5/97	1	Room	100	Wall	Radiator	Solid	Metal	0.01
605	1956 Bldg	321	XRF	4/5/97	1	Room	100	Door	Door	Solid	Wood	0.02
606	1956 Bldg	322	XRF	4/5/97	1	Room	100	Door	Casing	Solid	Metal	0.05
607	1956 Bldg	178	XRF	4/5/97	1	Room	101	Wall	Wall	Solid	Concrete	0.05
608	1956 Bldg	179	XRF	4/5/97	1	Room	101		Column	Solid	Concrete	0.1
609	1956 Bldg	180	XRF	4/5/97	1	Room	101	Bulletin Board	Frame	Solid	Wood	0.01
610	1956 Bldg	181	XRF	4/5/97	1	Room	101	Wall	Midle Wall	Solid	Drywall	0
611	1956 Bldg	182	XRF	4/5/97	1	Room	101	Door	Door	Solid	Wood	0.01
612	1956 Bldg	183	XRF	4/5/97	1	Room	101	Door	Door Rgst	Solid	Metal	0
613	1956 Bldg	184	XRF	4/5/97	1	Room	101	Door	Casing	Solid	Metal	0.54
614	1956 Bldg	20	XRF	4/5/97	2	Room	201	Wall	Soffit	Solid	Plaster	0.39
615	1956 Bldg	21	XRF	4/5/97	2	Room	201	Door	Door	Solid	Wood	0
616	1956 Bldg	22	XRF	4/5/97	2	Room	201	Door	Casing	Cracked	Metal	0.05
617	1956 Bldg	23	XRF	4/5/97	2	Room	201	Wall	Midle Wall	Solid	Plaster	0.02
618	1956 Bldg	73	XRF	4/5/97	2	Room	204	Wall	Soffit	Solid	Plaster	0.29
619	1956 Bldg	74	XRF	4/5/97	2	Room	204	Door	Door	Solid	Wood	0.01
620	1956 Bldg	75	XRF	4/5/97	2	Room	204	Door	Casing	Solid	Metal	0.33
621	1956 Bldg	26	XRF	4/5/97	2	Room	205	Wall	Wall	Solid	Tile	0.53
622	1956 Bldg	27	XRF	4/5/97	2	Room	205	Wall	Wall	Solid	Tile	3.18
623	1956 Bldg	28	XRF	4/5/97	2	Room	205	Wall	Midle Wall	Solid	Tile	5.09
624	1956 Bldg	29	XRF	4/5/97	2	Room	205	Bookcase	Shelf	Solid	Wood	0
625	1956 Bldg	30	XRF	4/5/97	2	Room	205	Cabinet	Door	Solid	Metal	0.11
626	1956 Bldg	31	XRF	4/5/97	2	Room	205	Cabinet	Inside	Solid	Metal	0.06
627	1956 Bldg	32	XRF	4/5/97	2	Room	205	Ceiling	Diffuser	Cracked	Metal	0.03
628	1956 Bldg	33	XRF	4/5/97	2	Room	205	Door	Door	Solid	Wood	0.01
629	1956 Bldg	34	XRF	4/5/97	2	Room	205	Door	Door Rgst	Solid	Metal	0
630	1956 Bldg	35	XRF	4/5/97	2	Room	205	Door	Casing	Cracked	Metal	0.07
631	1956 Bldg	136	XRF	4/5/97	2	Room	207	Wall	Wall	Cracked	Plaster	0.08
632	1956 Bldg	137	XRF	4/5/97	2	Room	207	Wall	Radiator	Solid	Metal	0.03
633	1956 Bldg	138	XRF	4/5/97	2	Room	207	Window	Stool	Solid	Metal	0.52
634	1956 Bldg	139	XRF	4/5/97	2	Room	207	Door	Door	Solid	Wood	0
635	1956 Bldg	140	XRF	4/5/97	2	Room	207	Door	Casing	Solid	Wood	0
636	1956 Bldg	141	XRF	4/5/97	2	Room	207		Wire Tray	Solid	Metal	0
637	1956 Bldg	142	XRF	4/5/97	2	Room	207	Door	Door	Solid	Wood	0.01
638	1956 Bldg	143	XRF	4/5/97	2	Room	207	Door	Casing	Solid	Metal	0.13
639	1956 Bldg	145	XRF	4/5/97	2	Room	208	Wall	Wall	Solid	Plaster	0.08
640	1956 Bldg	146	XRF	4/5/97	2	Room	208	Door	Door	Solid	Wood	0.01
641	1956 Bldg	147	XRF	4/5/97	2	Room	208	Door	Casing	Solid	Metal	0.06
642	1956 Bldg	148	XRF	4/5/97	2	Room	208	Bookcase	Shelf	Solid	Wood	0
643	1956 Bldg	149	XRF	4/5/97	2	Room	208	Wall	Radiator	Solid	Metal	0.03
644	1956 Bldg	150	XRF	4/5/97	2	Room	208	Window	Stool	Solid	Metal	0.31
645	1956 Bldg	151	XRF	4/5/97	2	Room	208		Wire Tray	Solid	Metal	0.08
646	1956 Bldg	6	XRF	4/13/97	1	Stage	0	Wall	Midle Wall	Solid	Concrete	0.08
647	1956 Bldg	7	XRF	4/13/97	1	Stage	0	Wall	Baseboar	Cracked	Wood	0
648	1956 Bldg	8	XRF	4/13/97	1	Stage	0	Floor		Cracked	Wood	0
649	1956 Bldg	9	XRF	4/13/97	1	Stage	0		Elec Pane	Solid	Metal	0
650	1956 Bldg	10	XRF	4/13/97	1	Stage	0	Cabinet	Door	Solid	Wood	0

Saint Paul Public Schools
 Maxfield Magnet School
 Lead-Based Paint Inspection

3	A	B	C	D	E	F	G	H	I	J	K	L
	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
651	1956 Bldg	11	XRF	4/13/97	1	Stage	0	Door	Door	Solid	Wood	0
652	1956 Bldg	12	XRF	4/13/97	1	Stage	0	Door	Casing	Solid	Metal	0
653	1956 Bldg	13	XRF	4/13/97	1	Stage	0	Door	Header	Solid	Metal	0.16
654	1956 Bldg	14	XRF	4/13/97	1	Stage	0	Stairs	Tread	Cracked	Wood	0
655	1956 Bldg	15	XRF	4/13/97	1	Stage	0	Stairs	Hand rail	Solid	Metal	0
656	1956 Bldg	16	XRF	4/13/97	1	Stage	0		Elec Pane	Solid	Metal	0.04
657	1956 Bldg	200	XRF	4/6/97	1	Stage	1	Wall	Midle Wall	Solid	Concrete	0.08
658	1956 Bldg	201	XRF	4/6/97	1	Stage	1	Cabinet	Floor	Solid	Wood	0
659	1956 Bldg	202	XRF	4/6/97	1	Stage	1	Cabinet	Elec Pane	Solid	Metal	0
660	1956 Bldg	203	XRF	4/6/97	1	Stage	1	Wall	Baseboar	Solid	Wood	0.12
661	1956 Bldg	204	XRF	4/6/97	1	Stage	1	Door	Door	Solid	Wood	0
662	1956 Bldg	205	XRF	4/6/97	1	Stage	1	Door	Casing	Solid	Metal	0
663	1956 Bldg	206	XRF	4/6/97	1	Stage	1	Stairs	Hand rail	Solid	Metal	0
664	1956 Bldg	207	XRF	4/6/97	1	Stage	1	Stairs	Tread	Cracked	Wood	0
665	1956 Bldg	208	XRF	4/6/97	1	Stage	1	Floor	Wall	Cracked	Wood	0
666	1956 Bldg	209	XRF	4/6/97	1	Stage	1		Elec Pane	Solid	Metal	0
667	1956 Bldg	169	XRF	4/5/97	2	Stairwell	1	Wall	Midle Wall	Solid	Tile	5.09
668	1956 Bldg	170	XRF	4/5/97	2	Stairwell	1	Door	Door	Solid	Metal	0.02
669	1956 Bldg	171	XRF	4/5/97	2	Stairwell	1	Door	Casing	Cracked	Metal	0.02
670	1956 Bldg	172	XRF	4/5/97	2	Stairwell	1	Door	Radiator	Solid	Metal	0
671	1956 Bldg	173	XRF	4/5/97	2	Stairwell	1	Wall	Wall	Solid	Tile	0.73
672	1956 Bldg	174	XRF	4/5/97	2	Stairwell	1	Wall	Wall	Solid	Tile	2.78
673	1956 Bldg	175	XRF	4/5/97	2	Stairwell	1	Cabinet	Door	Solid	Metal	0.08
674	1956 Bldg	176	XRF	4/5/97	2	Stairwell	1	Wall	Radiator	Solid	Metal	0.05
675	1956 Bldg	177	XRF	4/5/97	2	Stairwell	1	Window	Panel	Solid	Wood	0
676	1956 Bldg	10	XRF	4/6/97	1	Stairwell	2	Door	Door	Cracked	Metal	0.05
677	1956 Bldg	11	XRF	4/6/97	1	Stairwell	2	Door	Casing	Solid	Metal	0.11
678	1956 Bldg	12	XRF	4/6/97	1	Stairwell	2	Door	Jamb	Cracked	Metal	0.08
679	1956 Bldg	13	XRF	4/6/97	1	Stairwell	2	Wall	Wall	Solid	Wood	0.01
680	1956 Bldg	14	XRF	4/6/97	1	Stairwell	2	Wall	Radiator	Solid	Metal	0.04
681	1956 Bldg	15	XRF	4/6/97	2	Stairwell	2	Wall	Wall	Solid	Tile	0.47
682	1956 Bldg	16	XRF	4/6/97	2	Stairwell	2	Wall	Midle Wall	Solid	Tile	2.96
683	1956 Bldg	17	XRF	4/6/97	2	Stairwell	2	Cabinet	Door	Solid	Metal	0.05
684	1956 Bldg	18	XRF	4/6/97	2	Stairwell	2	Wall	Radiator	Solid		0.08
685	1956 Bldg	23	XRF	4/19/97	0	Stairwell	3	Stairs	Wall	Cracked	Plaster	0.03
686	1956 Bldg	24	XRF	4/19/97	0	Stairwell	3	Stairs	Wall	Solid	Wood	0.85
687	1956 Bldg	25	XRF	4/19/97	0	Stairwell	3	Stairs	Elec Pane	Solid	Metal	0.05
688	1956 Bldg	26	XRF	4/19/97	0	Stairwell	3	Floor		Cracked	Concrete	0.02
689	1956 Bldg	27	XRF	4/19/97	0	Stairwell	3	Stairs	Tread	Cracked	Concrete	0.03
690	1956 Bldg	28	XRF	4/19/97	0	Stairwell	3	Stairs	Baseboar	Solid	Concrete	0.02
691	1956 Bldg	29	XRF	4/19/97	1	Stairwell	3	Ceiling		Cracked	Plaster	0.03
692	1956 Bldg	30	XRF	4/19/97	1	Stairwell	3	Wall	Midle Wall	Cracked	Plaster	0.02
693	1956 Bldg	31	XRF	4/19/97	1	Stairwell	3	Door	Door	Cracked	Wood	0.01
694	1956 Bldg	32	XRF	4/19/97	1	Stairwell	3	Door	Casing	Cracked	Metal	0.05
695	1974 Bldg	120	XRF	4/19/97	1	Arcade	1	Motor Scooter		Cracked	Metal	0
696	1974 Bldg	121	XRF	4/19/97	1	Arcade	1	Merry -go-round		Cracked	Metal	0
697	1974 Bldg	122	XRF	4/19/97	1	Arcade	1	Merry -go-round		Cracked	Metal	0.02
698	1974 Bldg	123	XRF	4/19/97	1	Arcade	1	Flag Pole		Cracked	Metal	0.04
699	1974 Bldg	245	XRF	4/13/97	1	Bath	1	Wall	Wall	Solid	Concrete	0.01
700	1974 Bldg	246	XRF	4/13/97	1	Bath	1	Wall	Wall	Solid	Concrete	0
701	1974 Bldg	247	XRF	4/13/97	1	Bath	1	Wall	Radiator	Cracked	Metal	0
702	1974 Bldg	248	XRF	4/13/97	1	Bath	1		Stall	Solid	Metal	0.17
703	1974 Bldg	249	XRF	4/13/97	1	Bath	1	Window	Casing	Solid	Metal	0
704	1974 Bldg	250	XRF	4/13/97	1	Bath	1	Wall	Midle Wall	Solid	Concrete	0.01
705	1974 Bldg	251	XRF	4/13/97	1	Bath	1	Ceiling		Solid	Concrete	0.01
706	1974 Bldg	252	XRF	4/13/97	1	Bath	1	Ceiling	Diffuser	Solid	Metal	0.13
707	1974 Bldg	253	XRF	4/13/97	1	Bath	2	Wall	Wall	Solid	Concrete	0
708	1974 Bldg	254	XRF	4/13/97	1	Bath	2	Wall	Wall	Solid	Concrete	0
709	1974 Bldg	255	XRF	4/13/97	1	Bath	2	Wall	Midle Wall	Solid	Concrete	2.08

Saint Paul Public Schools
 Maxfield Magnet School
 Lead-Based Paint Inspection

A	B	C	D	E	F	G	H	I	J	K	L	
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
710	1974 Bldg	256	XRF	4/13/97	1	Bath	2	Wall	Radiator	Solid	Metal	0.01
711	1974 Bldg	257	XRF	4/13/97	1	Bath	2	Window	Casing	Solid	Metal	0.04
712	1974 Bldg	258	XRF	4/13/97	1	Bath	2		Stall	Solid	Metal	0.22
713	1974 Bldg	259	XRF	4/13/97	1	Bath	2	Ceiling		Solid	Concrete	0
714	1974 Bldg	260	XRF	4/13/97	1	Bath	2	Ceiling	Diffuser	Solid	Metal	0.06
715	1974 Bldg	375	XRF	4/13/97	1	Bath	3	Wall	Middle Wall	Solid	Concrete	0
716	1974 Bldg	376	XRF	4/13/97	1	Bath	3		Stall	Solid	Metal	0.06
717	1974 Bldg	377	XRF	4/13/97	1	Bath	3	Ceiling		Solid	Concrete	0.01
718	1974 Bldg	378	XRF	4/13/97	1	Bath	3	Ceiling	Diffuser	Solid		0
719	1974 Bldg	379	XRF	4/13/97	1	Bath	3	Wall	Wall	Solid	Concrete	0
720	1974 Bldg	380	XRF	4/13/97	1	Bath	3	Wall	Wall Rgstr	Solid	Metal	0
721	1974 Bldg	381	XRF	4/13/97	1	Bath	3	Wall	Middle Wall	Solid	Tile	0.03
722	1974 Bldg	382	XRF	4/13/97	1	Bath	3	Door	Door	Solid	Wood	0
723	1974 Bldg	383	XRF	4/13/97	1	Bath	3	Wall	Wall Rgstr	Solid	Metal	0
724	1974 Bldg	384	XRF	4/13/97	1	Bath	3	Door	Casing	Cracked	Metal	0.01
725	1974 Bldg	385	XRF	4/13/97	1	Bath	3	Door	Casing	Solid	Metal	0.02
726	1974 Bldg	386	XRF	4/13/97	1	Bath	3	Ceiling		Solid	Concrete	0.01
727	1974 Bldg	387	XRF	4/13/97	1	Bath	4	Wall	Middle Wall	Solid	Concrete	1.99
728	1974 Bldg	388	XRF	4/13/97	1	Bath	4	Wall	Wall Rgstr	Solid	Metal	1.42
729	1974 Bldg	389	XRF	4/13/97	1	Bath	4	Wall	Wall	Solid	Concrete	0
730	1974 Bldg	390	XRF	4/13/97	1	Bath	4		Stall	Solid	Metal	0.15
731	1974 Bldg	391	XRF	4/13/97	1	Bath	4	Door	Door	Solid	Wood	0
732	1974 Bldg	392	XRF	4/13/97	1	Bath	4	Wall	Wall Rgstr	Cracked	Metal	0
733	1974 Bldg	393	XRF	4/13/97	1	Bath	4	Door	Casing	Solid	Metal	0.02
734	1974 Bldg	394	XRF	4/13/97	1	Bath	4	Ceiling		Solid	Concrete	0
735	1974 Bldg	33	XRF	4/19/97	1	Classroo	1	Wall	Wall	Solid	Drywall	0
736	1974 Bldg	34	XRF	4/19/97	1	Classroo	1	Door	Casing	Solid	Metal	0.02
737	1974 Bldg	35	XRF	4/19/97	1	Classroo	1	Door	Door	Solid	Wood	0
738	1974 Bldg	36	XRF	4/19/97	1	Classroo	1	Wall	Wall	Solid	Wood	0
739	1974 Bldg	37	XRF	4/19/97	1	Classroo	1	Window	Casing	Solid	Metal	0
740	1974 Bldg	38	XRF	4/19/97	1	Classroo	1	Window	Casing	Solid	Metal	0.12
741	1974 Bldg	39	XRF	4/19/97	1	Classroo	1	Wall	Wall	Solid	Drywall	0
742	1974 Bldg	40	XRF	4/19/97	1	Classroo	1	Ceiling		Cracked	Concrete	0
743	1974 Bldg	41	XRF	4/19/97	1	Classroo	1	Wall	Wall	Solid	Drywall	0.08
744	1974 Bldg	42	XRF	4/19/97	1	Classroo	1	Wall	Column	Solid	Concrete	0
745	1974 Bldg	43	XRF	4/19/97	1	Classroo	1	Wall	Middle Wall	Solid	Drywall	1.93
746	1974 Bldg	44	XRF	4/19/97	1	Classroo	1	Wall	Wall Rgstr	Solid	Metal	0.42
747	1974 Bldg	45	XRF	4/19/97	1	Classroo	1	Wall	Wall Rgstr	Solid	Metal	0.4
748	1974 Bldg	47	XRF	4/19/97	1	Classroo	2	Wall	Middle Wall	Solid	Drywall	1.58
749	1974 Bldg	48	XRF	4/19/97	1	Classroo	2	Wall	Wall Rgstr	Solid	Metal	0.19
750	1974 Bldg	49	XRF	4/19/97	1	Classroo	2	Ceiling		Solid	Concrete	0
751	1974 Bldg	50	XRF	4/19/97	1	Classroo	2	Wall	Column	Solid	Concrete	0.02
752	1974 Bldg	51	XRF	4/19/97	1	Classroo	2	Wall	Wall	Solid	Concrete	0
753	1974 Bldg	52	XRF	4/19/97	1	Classroo	2	Wall	Middle Wall	Solid	Concrete	0.02
754	1974 Bldg	53	XRF	4/19/97	1	Classroo	2	Wall	Radiator	Solid	Metal	0
755	1974 Bldg	54	XRF	4/19/97	1	Classroo	2	Window	Casing	Solid	Metal	0
756	1974 Bldg	55	XRF	4/19/97	1	Classroo	2	Blinds		Solid	Metal	0.15
757	1974 Bldg	56	XRF	4/19/97	1	Classroo	2	Wall	Wall	Solid	Drywall	0
758	1974 Bldg	57	XRF	4/19/97	1	Classroo	2	Door	Door	Solid	Wood	0
759	1974 Bldg	58	XRF	4/19/97	1	Classroo	2	Door	Casing	Solid	Metal	0
760	1974 Bldg	59	XRF	4/19/97	1	Classroo	2	Wall	Middle Wall	Solid	Drywall	0.03
761	1974 Bldg	60	XRF	4/19/97	1	Classroo	2	Bulletin Board	Middle Wall	Solid	Wood	0
762	1974 Bldg	61	XRF	4/19/97	1	Classroo	2	Wall	Column	Solid	Concrete	0
763	1974 Bldg	62	XRF	4/19/97	1	Classroo	3	Wall	Wall Rgstr	Solid	Metal	0.03
764	1974 Bldg	63	XRF	4/19/97	1	Classroo	3	Wall	Wall	Solid	Drywall	0.01
765	1974 Bldg	64	XRF	4/19/97	1	Classroo	3	Wall	Middle Wall	Solid	Concrete	0
766	1974 Bldg	65	XRF	4/19/97	1	Classroo	3	Stairs	Hand rail	Cracked	Metal	0
767	1974 Bldg	66	XRF	4/19/97	1	Classroo	3	Stairs	Hand rail	Cracked	Metal	0.01
768	1974 Bldg	67	XRF	4/19/97	1	Classroo	3	Stairs	Hand rail	Cracked		0

Saint Paul Public Schools
 Maxfield Magnet School
 Lead-Based Paint Inspection

A	B	C	D	E	F	G	H	I	J	K	L	
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
769	1974 Bldg	68	XRF	4/19/97	1	Classroo	3	Door	Door	Solid	Metal	2.74
770	1974 Bldg	69	XRF	4/19/97	1	Classroo	3	Door	Casing	Solid	Metal	0.01
771	1974 Bldg	70	XRF	4/19/97	1	Classroo	3	Window	Casing	Solid	Metal	0
772	1974 Bldg	71	XRF	4/19/97	1	Classroo	3	Wall	Radiator	Solid	Metal	0
773	1974 Bldg	72	XRF	4/19/97	1	Classroo	3	Wall	Column	Solid	Metal	0.02
774	1974 Bldg	73	XRF	4/19/97	1	Classroo	3	Door	Door	Solid	Wood	0
775	1974 Bldg	74	XRF	4/19/97	1	Classroo	3	Door	Casing	Solid	Metal	0.01
776	1974 Bldg	75	XRF	4/19/97	1	Classroo	3	Ceiling		Solid	Concrete	0
777	1974 Bldg	76	XRF	4/19/97	1	Classroo	4	Wall	Wall	Solid	Drywall	0
778	1974 Bldg	77	XRF	4/19/97	1	Classroo	4	Door	Door	Solid	Wood	0
779	1974 Bldg	78	XRF	4/19/97	1	Classroo	4	Door	Casing	Solid	Metal	0.03
780	1974 Bldg	79	XRF	4/19/97	1	Classroo	4	Wall	Wall	Solid	Concrete	0
781	1974 Bldg	80	XRF	4/19/97	1	Classroo	4	Wall	Radiator	Solid	Metal	0
782	1974 Bldg	81	XRF	4/19/97	1	Classroo	4	Bulletin Board	Middle Wall	Solid	Wood	0
783	1974 Bldg	82	XRF	4/19/97	1	Classroo	4	Window	Casing	Solid	Metal	0.01
784	1974 Bldg	83	XRF	4/19/97	1	Classroo	4	Ceiling		Solid	Concrete	0.01
785	1974 Bldg	84	XRF	4/19/97	1	Classroo	4	Wall	Column	Solid	Concrete	0.05
786	1974 Bldg	85	XRF	4/19/97	1	Classroo	4	Wall	Middle Wall	Solid	Drywall	0.84
787	1974 Bldg	86	XRF	4/19/97	1	Classroo	4		Wire Tray	Solid	Metal	0.03
788	1974 Bldg	87	XRF	4/19/97	1	Classroo	4	Wall	Wall Rgstr	Solid	Metal	0
789	1974 Bldg	88	XRF	4/19/97	1	Classroo	5	Wall	Wall	Cracked	Drywall	0
790	1974 Bldg	89	XRF	4/19/97	1	Classroo	5	Door	Door	Solid	Wood	0
791	1974 Bldg	90	XRF	4/19/97	1	Classroo	5	Door	Casing	Solid	Metal	0.01
792	1974 Bldg	91	XRF	4/19/97	1	Classroo	5	Wall	Middle Wall	Solid	Drywall	0.89
793	1974 Bldg	92	XRF	4/19/97	1	Classroo	5	Wall	Wall Rgstr	Solid	Metal	0
794	1974 Bldg	93	XRF	4/19/97	1	Classroo	5	Wall	Column	Solid	Concrete	0
795	1974 Bldg	94	XRF	4/19/97	1	Classroo	5	Wall	Wall	Solid	Drywall	0.01
796	1974 Bldg	95	XRF	4/19/97	1	Classroo	5	Window	Casing	Solid	Metal	0.21
797	1974 Bldg	96	XRF	4/19/97	1	Classroo	5	Wall	Wall	Solid	Drywall	0
798	1974 Bldg	97	XRF	4/19/97	1	Classroo	5	Window	Casing	Solid	Metal	0.01
799	1974 Bldg	98	XRF	4/19/97	1	Classroo	5	Ceiling		Solid	Concrete	0
800	1974 Bldg	100	XRF	4/19/97	1	Classroo	22	Wall	Wall	Solid	Drywall	0
801	1974 Bldg	101	XRF	4/19/97	1	Classroo	22	Window	Casing	Solid	Metal	0.21
802	1974 Bldg	102	XRF	4/19/97	1	Classroo	22	Wall	Wall	Solid	Drywall	0
803	1974 Bldg	103	XRF	4/19/97	1	Classroo	22	Window	Casing	Solid	Metal	0
804	1974 Bldg	104	XRF	4/19/97	1	Classroo	22	Door	Door	Solid	Wood	0
805	1974 Bldg	105	XRF	4/19/97	1	Classroo	22	Door	Jamb	Cracked	Metal	0
806	1974 Bldg	106	XRF	4/19/97	1	Classroo	22	Wall	Midle Wall	Solid	Drywall	0.01
807	1974 Bldg	107	XRF	4/19/97	1	Classroo	22	Wall	Column	Solid	Concrete	0.09
808	1974 Bldg	108	XRF	4/19/97	1	Classroo	22	Wall	Wall Rgstr	Solid	Metal	0
809	1974 Bldg	109	XRF	4/19/97	1	Classroo	22	Ceiling		Solid	Concrete	0
810	1974 Bldg	115	XRF	4/19/97	1	Garage	1	Door	Door	Cracked	Metal	0.05
811	1974 Bldg	116	XRF	4/19/97	1	Garage	1	Door	Jamb	Cracked	Metal	0.06
812	1974 Bldg	117	XRF	4/19/97	1	Garage	1	Door	Jamb	Cracked	Wood	0
813	1974 Bldg	109	XRF	4/13/97	1	Hall	1	Door	Door	Cracked	Metal	0.63
814	1974 Bldg	110	XRF	4/13/97	1	Hall	1	Door	Casing	Solid	Metal	0.5
815	1974 Bldg	111	XRF	4/13/97	1	Hall	1	Door	Elevator D	Solid	Metal	0.03
816	1974 Bldg	112	XRF	4/13/97	1	Hall	1	Door	Casing	Cracked	Metal	0.01
817	1974 Bldg	113	XRF	4/13/97	1	Hall	1	Window	Casing	Solid	Metal	0.02
818	1974 Bldg	114	XRF	4/13/97	1	Hall	1	Window	Radiator	Solid	Metal	0.02
819	1974 Bldg	115	XRF	4/13/97	1	Hall	1	Door	Door	Solid	Metal	0.06
820	1974 Bldg	116	XRF	4/13/97	1	Hall	1	Porch	Columns	Solid		0
821	1974 Bldg	117	XRF	4/13/97	1	Hall	1	Wall	Middle Wall	Cracked	Drywall	0.05
822	1974 Bldg	118	XRF	4/13/97	1	Hall	1	Porch	Columns	Solid	Concrete	0
823	1974 Bldg	119	XRF	4/13/97	1	Hall	1	Door	Door	Solid	Metal	1.2
824	1974 Bldg	120	XRF	4/13/97	1	Hall	1	Door	Casing	Solid	Metal	0.03
825	1974 Bldg	121	XRF	4/13/97	1	Hall	1		Elec Pane	Solid	Metal	0.02
826	1974 Bldg	122	XRF	4/13/97	1	Hall	1	Wall	Wall	Solid	Drywall	0
827	1974 Bldg	123	XRF	4/13/97	1	Hall	1	Wall	Wall	Solid	Wood	0

Saint Paul Public Schools
 Maxfield Magnet School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
828	1974 Bldg	124	XRF	4/13/97	1	Hall	1	Window	Casing	Solid	Metal	0.01
829	1974 Bldg	125	XRF	4/13/97	1	Hall	1	Wall	Wall	Solid	Wood	0
830	1974 Bldg	126	XRF	4/13/97	1	Hall	1	Window	Stool	Solid	Metal	0
831	1974 Bldg	127	XRF	4/13/97	1	Hall	1	Window	Casing	Solid	Metal	0.02
832	1974 Bldg	128	XRF	4/13/97	1	Hall	1	Ceiling		Solid	Plaster	0.01
833	1974 Bldg	129	XRF	4/13/97	1	Hall	1	Ceiling		Solid	Concrete	0
834	1974 Bldg	195	XRF	4/13/97	1	Hall	2	Wall	Midle Wall	Solid	Concrete	0
835	1974 Bldg	196	XRF	4/13/97	1	Hall	2	Porch	Columns	Solid	Concrete	0
836	1974 Bldg	197	XRF	4/13/97	1	Hall	2	Wall	Radiator	Solid		0
837	1974 Bldg	198	XRF	4/13/97	1	Hall	2	Door	Door	Cracked	Metal	2.37
838	1974 Bldg	199	XRF	4/13/97	1	Hall	2	Door	Casing	Solid	Metal	0.05
839	1974 Bldg	200	XRF	4/13/97	1	Hall	2	Wall	Midle Wall	Solid	Metal	0.05
840	1974 Bldg	201	XRF	4/13/97	1	Hall	2	Door	Door	Solid	Metal	0.53
841	1974 Bldg	202	XRF	4/13/97	1	Hall	2	Door	Casing	Solid	Metal	0.65
842	1974 Bldg	203	XRF	4/13/97	1	Hall	2	Wall	Wall	Solid	Wood	0.06
843	1974 Bldg	204	XRF	4/13/97	1	Hall	2	Door	Door	Solid	Metal	3.13
844	1974 Bldg	205	XRF	4/13/97	1	Hall	2	Door	Jamb	Solid	Metal	0.03
845	1974 Bldg	206	XRF	4/13/97	1	Hall	2	Wall	Wall	Solid	Concrete	0
846	1974 Bldg	207	XRF	4/13/97	1	Hall	2	Wall	Radiator	Solid	Metal	0.01
847	1974 Bldg	208	XRF	4/13/97	1	Hall	2	Door	Door	Solid	Metal	0.36
848	1974 Bldg	209	XRF	4/13/97	1	Hall	2	Door	Casing	Solid	Metal	0.43
849	1974 Bldg	210	XRF	4/13/97	1	Hall	2	Window	Casing	Solid	Metal	0.01
850	1974 Bldg	211	XRF	4/13/97	1	Hall	2	Ceiling		Solid	Concrete	0
851	1974 Bldg	212	XRF	4/13/97	1	Hall	3	Wall	Midle Wall	Solid	Concrete	0
852	1974 Bldg	213	XRF	4/13/97	1	Hall	3	Wall	Radiator	Solid	Metal	0.01
853	1974 Bldg	214	XRF	4/13/97	1	Hall	3	Wall	Elec Pane	Solid	Metal	0.01
854	1974 Bldg	215	XRF	4/13/97	1	Hall	3	Wall	Midle Wall	Solid	Concrete	0.01
855	1974 Bldg	216	XRF	4/13/97	1	Hall	3	Wall	Midle Wall	Solid	Concrete	3.02
856	1974 Bldg	217	XRF	4/13/97	1	Hall	3	Wall	Radiator	Solid	Metal	0
857	1974 Bldg	218	XRF	4/13/97	1	Hall	3	Door	Door	Solid	Metal	2.49
858	1974 Bldg	219	XRF	4/13/97	1	Hall	3	Door	Casing	Solid	Metal	0.02
859	1974 Bldg	220	XRF	4/13/97	1	Hall	3	Wall	Wall	Cracked	Drywall	0
860	1974 Bldg	221	XRF	4/13/97	1	Hall	3	Wall	Wall	Solid	Drywall	0
861	1974 Bldg	222	XRF	4/13/97	1	Hall	3	Porch	Columns	Solid	Concrete	0
862	1974 Bldg	223	XRF	4/13/97	1	Hall	3	Porch	Columns	Solid	Metal	0
863	1974 Bldg	224	XRF	4/13/97	1	Hall	3	Window	Casing	Solid	Metal	0.01
864	1974 Bldg	225	XRF	4/13/97	1	Hall	3	Ceiling		Solid	Concrete	0
865	1974 Bldg	226	XRF	4/13/97	1	Hall	3		Wire Tray	Solid	Metal	0.06
866	1974 Bldg	355	XRF	4/13/97	1	Hall	4	Wall	Wall	Solid	Drywall	0
867	1974 Bldg	356	XRF	4/13/97	1	Hall	4	Porch	Columns	Solid	Concrete	0
868	1974 Bldg	357	XRF	4/13/97	1	Hall	4	Ceiling		Solid	Concrete	0
869	1974 Bldg	358	XRF	4/13/97	1	Hall	4	Door	Door	Cracked	Metal	1.35
870	1974 Bldg	359	XRF	4/13/97	1	Hall	4	Door	Door	Cracked	Wood	0
871	1974 Bldg	360	XRF	4/13/97	1	Hall	4	Door	Casing	Cracked	Metal	0.01
872	1974 Bldg	361	XRF	4/13/97	1	Hall	5	Wall	Radiator	Cracked	Metal	0
873	1974 Bldg	362	XRF	4/13/97	1	Hall	5	Door	Door	Solid	Metal	0.03
874	1974 Bldg	363	XRF	4/13/97	1	Hall	5	Door	Casing	Cracked	Metal	0.04
875	1974 Bldg	364	XRF	4/13/97	1	Hall	5	Door	Header	Solid	Metal	0.01
876	1974 Bldg	365	XRF	4/13/97	1	Hall	5	Ceiling		Solid	Concrete	0
877	1974 Bldg	366	XRF	4/13/97	1	Hall	6	Wall	Wall	Solid	Concrete	0.65
878	1974 Bldg	367	XRF	4/13/97	1	Hall	6	Wall	Wall	Solid	Concrete	2.26
879	1974 Bldg	368	XRF	4/13/97	1	Hall	6	Window	Casing	Solid	Metal	0.62
880	1974 Bldg	369	XRF	4/13/97	1	Hall	6	Ceiling		Solid	Concrete	0.04
881	1974 Bldg	110	XRF	4/19/97	1	Outside	0	Window	Casing	Solid	Metal	0
882	1974 Bldg	111	XRF	4/19/97	1	Outside	0	Ext Wall	Trim	Peeling		0.2
883	1974 Bldg	112	XRF	4/19/97	1	Outside	0	Door	Door	Solid	Metal	2
884	1974 Bldg	113	XRF	4/19/97	1	Outside	0	Door	Jamb	Solid	Metal	0.02
885	1974 Bldg	114	XRF	4/19/97	1	Outside	0	Stairs	Hand rail	Solid	Metal	0
886	1974 Bldg	118	XRF	4/19/97	1	Outside	0	Door	Door	Cracked	Metal	2.04

Saint Paul Public Schools
 Maxfield Magnet School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
887	1974 Bldg	119	XRF	4/19/97	1	Outside	0	Door	Jamb	Cracked	Metal	0.02
888	1974 Bldg	124	XRF	4/19/97	1	Outside	0	Light Post		Cracked	Metal	0
889	1974 Bldg	125	XRF	4/19/97	1	Outside	0	Door	Door	Solid	Metal	2.56
890	1974 Bldg	126	XRF	4/19/97	1	Outside	0	Door	Jamb	Solid	Metal	0.05
891	1974 Bldg	347	XRF	4/13/97	1	Room	6	Wall	Wall	Solid	Concrete	0
892	1974 Bldg	348	XRF	4/13/97	1	Room	6	Wall	Middle Wall	Solid	Concrete	0
893	1974 Bldg	349	XRF	4/13/97	1	Room	6	Wall	Radiator	Solid	Metal	0
894	1974 Bldg	350	XRF	4/13/97	1	Room	6	Window	Casing	Solid	Metal	0.01
895	1974 Bldg	351	XRF	4/13/97	1	Room	6	Ceiling		Solid	Concrete	0
896	1974 Bldg	352	XRF	4/13/97	1	Room	6	Porch	Columns	Solid	Concrete	0
897	1974 Bldg	353	XRF	4/13/97	1	Room	6	Wall	Middle Wall	Solid	Drywall	0
898	1974 Bldg	354	XRF	4/13/97	1	Room	6	Door	Door	Solid	Wood	0
899	1974 Bldg	338	XRF	4/13/97	1	Room	7	Wall	Wall	Solid	Drywall	0.02
900	1974 Bldg	339	XRF	4/13/97	1	Room	7	Wall	Wall Rgstr	Solid	Metal	0
901	1974 Bldg	340	XRF	4/13/97	1	Room	7	Wall	Wall	Solid	Concrete	0
902	1974 Bldg	341	XRF	4/13/97	1	Room	7	Wall	Middle Wall	Solid	Concrete	0
903	1974 Bldg	342	XRF	4/13/97	1	Room	7	Wall	Radiator	Solid	Metal	0
904	1974 Bldg	343	XRF	4/13/97	1	Room	7	Window	Casing	Solid	Metal	0.01
905	1974 Bldg	344	XRF	4/13/97	1	Room	7	Door	Door	Solid	Wood	0
906	1974 Bldg	345	XRF	4/13/97	1	Room	7	Porch	Columns	Solid	Concrete	0.03
907	1974 Bldg	346	XRF	4/13/97	1	Room	7	Ceiling		Solid	Concrete	0
908	1974 Bldg	304	XRF	4/13/97	1	Room	8	Wall	Middle Wall	Solid	Drywall	0
909	1974 Bldg	305	XRF	4/13/97	1	Room	8	Door	Door	Solid	Wood	0
910	1974 Bldg	306	XRF	4/13/97	1	Room	8	Door	Casing	Solid	Metal	0.01
911	1974 Bldg	307	XRF	4/13/97	1	Room	8	Coat Rack	Middle Wall	Solid	Wood	0
912	1974 Bldg	308	XRF	4/13/97	1	Room	8	Bulletin Board	Middle Wall	Solid	Wood	0
913	1974 Bldg	309	XRF	4/13/97	1	Room	8	Wall	Middle Wall	Solid	Drywall	0
914	1974 Bldg	310	XRF	4/13/97	1	Room	8	Coat Rack	Middle Wall	Solid	Wood	0
915	1974 Bldg	311	XRF	4/13/97	1	Room	8	Bulletin Board	Middle Wall	Solid	Wood	0
916	1974 Bldg	312	XRF	4/13/97	1	Room	8	Porch	Columns	Solid	Concrete	0
917	1974 Bldg	313	XRF	4/13/97	1	Room	8	Wall	Middle Wall	Solid	Concrete	0
918	1974 Bldg	314	XRF	4/13/97	1	Room	8	Window	Casing	Solid	Metal	0.01
919	1974 Bldg	315	XRF	4/13/97	1	Room	8	Wall	Radiator	Solid	Metal	0
920	1974 Bldg	316	XRF	4/13/97	1	Room	8	Wall	Wall	Solid	Drywall	0.02
921	1974 Bldg	317	XRF	4/13/97	1	Room	8	Wall	Wall Rgstr	Solid	Metal	0.34
922	1974 Bldg	318	XRF	4/13/97	1	Room	8	Wall	Wall	Solid	Drywall	0
923	1974 Bldg	319	XRF	4/13/97	1	Room	8	Ceiling		Solid	Concrete	0
924	1974 Bldg	285	XRF	4/13/97	1	Room	9	Door	Door	Solid	Wood	0
925	1974 Bldg	286	XRF	4/13/97	1	Room	9	Door	Casing	Solid	Metal	0
926	1974 Bldg	287	XRF	4/13/97	1	Room	9	Coat Rack	Middle Wall	Solid	Wood	0
927	1974 Bldg	288	XRF	4/13/97	1	Room	9	Wall	Middle Wall	Solid	Drywall	0
928	1974 Bldg	289	XRF	4/13/97	1	Room	9	Porch	Columns	Solid	Concrete	0
929	1974 Bldg	290	XRF	4/13/97	1	Room	9	Ceiling		Solid	Concrete	0.01
930	1974 Bldg	291	XRF	4/13/97	1	Room	9	Wall	Wall	Solid	Drywall	0.04
931	1974 Bldg	292	XRF	4/13/97	1	Room	9	Wall	Wall Rgstr	Solid	Metal	0
932	1974 Bldg	293	XRF	4/13/97	1	Room	9	Wall	Middle Wall	Solid	Concrete	0
933	1974 Bldg	294	XRF	4/13/97	1	Room	9	Wall	Wall	Solid	Concrete	0
934	1974 Bldg	295	XRF	4/13/97	1	Room	9	Wall	Radiator	Solid	Metal	0
935	1974 Bldg	296	XRF	4/13/97	1	Room	9	Window	Casing	Solid	Metal	0
936	1974 Bldg	297	XRF	4/13/97	1	Room	9	Wall	Middle Wall	Solid	Drywall	0
937	1974 Bldg	298	XRF	4/13/97	1	Room	9	Bulletin Board	Middle Wall	Solid	Metal	0
938	1974 Bldg	274	XRF	4/13/97	1	Room	10	Wall	Middle Wall	Solid	Concrete	0
939	1974 Bldg	275	XRF	4/13/97	1	Room	10	Wall	Radiator	Cracked	Metal	0
940	1974 Bldg	276	XRF	4/13/97	1	Room	10	Window	Casing	Solid	Metal	0.01
941	1974 Bldg	277	XRF	4/13/97	1	Room	10	Wall	Middle Wall	Solid	Drywall	0.02
942	1974 Bldg	278	XRF	4/13/97	1	Room	10	Wall	Wall Rgstr	Solid	Metal	0.46
943	1974 Bldg	279	XRF	4/13/97	1	Room	10	Blinds		Solid	Metal	0.07
944	1974 Bldg	280	XRF	4/13/97	1	Room	10	Ceiling		Solid	Concrete	0
945	1974 Bldg	281	XRF	4/13/97	1	Room	10	Porch	Columns	Solid	Concrete	0

Saint Paul Public Schools
 Maxfield Magnet School
 Lead-Based Paint Inspection

	A	B	C	D	E	F	G	H	I	J	K	L
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
946	1974 Bldg	282	XRF	4/13/97	1	Room	10	Cabinet	Door	Cracked	Wood	0
947	1974 Bldg	283	XRF	4/13/97	1	Room	10	Door	Door	Solid	Wood	0
948	1974 Bldg	284	XRF	4/13/97	1	Room	10	Wall	Midle Wall	Solid	Drywall	0
949	1974 Bldg	299	XRF	4/13/97	1	Room	11	Wall	Midle Wall	Solid	Drywall	0
950	1974 Bldg	300	XRF	4/13/97	1	Room	11		Wire Tray	Solid	Metal	0.07
951	1974 Bldg	301	XRF	4/13/97	1	Room	11	Wall	Wall Rgstr	Solid	Metal	0
952	1974 Bldg	302	XRF	4/13/97	1	Room	11	Ceiling		Solid	Concrte	0
953	1974 Bldg	303	XRF	4/13/97	1	Room	11	Door	Door	Solid	Wood	0
954	1974 Bldg	267	XRF	4/13/97	1	Room	12	Wall	Midle Wall	Cracked	Drywall	0
955	1974 Bldg	268	XRF	4/13/97	1	Room	12	Wall	Wall	Cracked	Drywall	0.01
956	1974 Bldg	269	XRF	4/13/97	1	Room	12	Ceiling		Solid	Concrte	0.02
957	1974 Bldg	270	XRF	4/13/97	1	Room	12	Door	Door	Cracked	Metal	0
958	1974 Bldg	271	XRF	4/13/97	1	Room	12	Door	Casing	Solid	Metal	0
959	1974 Bldg	272	XRF	4/13/97	1	Room	12	Wall	Midle Wall	Solid	Wood	0
960	1974 Bldg	273	XRF	4/13/97	1	Room	12	Door	Door	Solid	Wood	0
961	1974 Bldg	235	XRF	4/13/97	1	Room	13	Wall	Wall	Solid	Drywall	0.01
962	1974 Bldg	236	XRF	4/13/97	1	Room	13		Wire Tray	Solid	Metal	0.03
963	1974 Bldg	237	XRF	4/13/97	1	Room	13	Wall	Wall	Solid	Drywall	0
964	1974 Bldg	238	XRF	4/13/97	1	Room	13	Wall	Midle Wall	Solid	Drywall	0.74
965	1974 Bldg	239	XRF	4/13/97	1	Room	13	Wall	Wall Rgstr	Solid	Metal	0.01
966	1974 Bldg	240	XRF	4/13/97	1	Room	13	Door	Door	Solid	Wood	0
967	1974 Bldg	241	XRF	4/13/97	1	Room	13	Door	Casing	Solid	Metal	0
968	1974 Bldg	242	XRF	4/13/97	1	Room	13	Porch	Columns	Solid	Concrte	0.05
969	1974 Bldg	243	XRF	4/13/97	1	Room	13	Ceiling		Solid	Concrte	0.01
970	1974 Bldg	167	XRF	4/13/97	1	Room	14	Wall	Midle Wall	Solid	Drywall	0
971	1974 Bldg	168	XRF	4/13/97	1	Room	14	Porch	Columns	Solid	Concrte	0
972	1974 Bldg	169	XRF	4/13/97	1	Room	14	Wall	Wall	Solid	Wood	0.01
973	1974 Bldg	170	XRF	4/13/97	1	Room	14	Wall	Wall	Solid	Drywall	0.71
974	1974 Bldg	171	XRF	4/13/97	1	Room	14	Wall	Wall Rgstr	Solid	Metal	0
975	1974 Bldg	172	XRF	4/13/97	1	Room	14		Wire Tray	Solid	Metal	0.01
976	1974 Bldg	173	XRF	4/13/97	1	Room	14	Ceiling		Solid	Concrte	0.01
977	1974 Bldg	174	XRF	4/13/97	1	Room	14	Door	Door	Solid	Wood	0
978	1974 Bldg	175	XRF	4/13/97	1	Room	14	Door	Casing	Solid	Metal	0.18
979	1974 Bldg	163	XRF	4/13/97	1	Room	15	Wall	Midle Wall	Solid	Drywall	0
980	1974 Bldg	164	XRF	4/13/97	1	Room	15	Wall	Wall Rgstr	Solid	Metal	0
981	1974 Bldg	165	XRF	4/13/97	1	Room	15	Door	Door	Solid	Wood	0.02
982	1974 Bldg	166	XRF	4/13/97	1	Room	15	Door	Casing	Cracked	Metal	0.22
983	1974 Bldg	153	XRF	4/13/97	1	Room	16	Wall	Wall	Solid	Drywall	1.45
984	1974 Bldg	154	XRF	4/13/97	1	Room	16	Wall	Wall Rgstr	Solid	Metal	0.23
985	1974 Bldg	155	XRF	4/13/97	1	Room	16	Ceiling		Cracked	Concrte	0
986	1974 Bldg	156	XRF	4/13/97	1	Room	16	Window	Casing	Solid	Metal	0.02
987	1974 Bldg	157	XRF	4/13/97	1	Room	16	Window	Radiator	Solid	Metal	0.01
988	1974 Bldg	158	XRF	4/13/97	1	Room	16	Wall	Midle Wall	Solid	Concrte	0
989	1974 Bldg	159	XRF	4/13/97	1	Room	16		Wire Tray	Solid	Metal	0.03
990	1974 Bldg	160	XRF	4/13/97	1	Room	16	Wall	Wall	Solid	Drywall	0
991	1974 Bldg	161	XRF	4/13/97	1	Room	16	Door	Door	Solid	Wood	0
992	1974 Bldg	162	XRF	4/13/97	1	Room	16	Door	Casing	Solid	Metal	0.25
993	1974 Bldg	177	XRF	4/13/97	1	Room	17	Wall	Midle Wall	Cracked	Drywall	0
994	1974 Bldg	178	XRF	4/13/97	1	Room	17	Door	Door	Solid	Wood	0
995	1974 Bldg	179	XRF	4/13/97	1	Room	17	Door	Casing	Solid	Metal	0.13
996	1974 Bldg	180	XRF	4/13/97	1	Room	17	Wall	Wall	Solid	Drywall	0.72
997	1974 Bldg	181	XRF	4/13/97	1	Room	17	Wall	Wall Rgstr	Solid	Metal	0.01
998	1974 Bldg	182	XRF	4/13/97	1	Room	17	Ceiling		Solid	Concrte	0
999	1974 Bldg	183	XRF	4/13/97	1	Room	17	Wall	Wall	Solid	Wood	0.01
1000	1974 Bldg	184	XRF	4/13/97	1	Room	17	Wall	Wall	Solid	Drywall	0.02
1001	1974 Bldg	185	XRF	4/13/97	1	Room	17	Porch	Columns	Solid	Concrte	0
1002	1974 Bldg	142	XRF	4/13/97	1	Room	18	Wall	Midle Wall	Solid	Drywall	0
1003	1974 Bldg	143	XRF	4/13/97	1	Room	18	Bookcase	Inside	Solid	Wood	0
1004	1974 Bldg	144	XRF	4/13/97	1	Room	18	Window	Casing	Solid	Metal	0.03

Saint Paul Public Schools
 Maxfield Magnet School
 Lead-Based Paint Inspection

3	A	B	C	D	E	F	G	H	I	J	K	L
	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
1005	1974 Bldg	145	XRF	4/13/97	1	Room	18	Wall	Radiator	Solid	Metal	0.01
1006	1974 Bldg	146	XRF	4/13/97	1	Room	18	Chalk Board	Midle Wall	Solid	Wood	0
1007	1974 Bldg	147	XRF	4/13/97	1	Room	18	Wall	Midle Wall	Solid	Drywall	1.64
1008	1974 Bldg	148	XRF	4/13/97	1	Room	18	Wall	Wall Rgstr	Solid	Metal	0.43
1009	1974 Bldg	149	XRF	4/13/97	1	Room	18	Wall	Wall	Solid	Drywall	0.01
1010	1974 Bldg	150	XRF	4/13/97	1	Room	18	Ceiling		Cracked	Concrete	0
1011	1974 Bldg	151	XRF	4/13/97	1	Room	18	Door	Door	Solid	Wood	0
1012	1974 Bldg	152	XRF	4/13/97	1	Room	18	Door	Casing	Solid	Metal	0.16
1013	1974 Bldg	130	XRF	4/13/97	1	Room	19	Door	Door	Solid	Wood	0
1014	1974 Bldg	131	XRF	4/13/97	1	Room	19	Window	Casing	Solid	Metal	0.02
1015	1974 Bldg	132	XRF	4/13/97	1	Room	19	Door	Casing	Solid	Metal	0
1016	1974 Bldg	133	XRF	4/13/97	1	Room	19	Window	Casing	Solid	Metal	0
1017	1974 Bldg	134	XRF	4/13/97	1	Room	19	Window	Casing	Solid	Metal	0.02
1018	1974 Bldg	135	XRF	4/13/97	1	Room	19	Window	Radiator	Solid	Metal	0
1019	1974 Bldg	136	XRF	4/13/97	1	Room	19	Wall	Wall Rgstr	Solid	Metal	1.39
1020	1974 Bldg	137	XRF	4/13/97	1	Room	19	Ceiling		Cracked	Concrete	0
1021	1974 Bldg	138	XRF	4/13/97	1	Room	19	Bulletin Board	Midle Wall	Solid	Wood	0
1022	1974 Bldg	139	XRF	4/13/97	1	Room	19	Door	Door	Solid	Metal	0.05
1023	1974 Bldg	140	XRF	4/13/97	1	Room	19	Blinds		Solid		0
1024	1974 Bldg	141	XRF	4/13/97	1	Room	19	Blinds		Solid	Metal	0.07
1025	1974 Bldg	227	XRF	4/13/97	1	Room	40		Midle Wall	Solid	Drywall	0
1026	1974 Bldg	228	XRF	4/13/97	1	Room	40		Radiator	Solid	Metal	0
1027	1974 Bldg	229	XRF	4/13/97	1	Room	40		Radiator	Solid	Metal	0
1028	1974 Bldg	230	XRF	4/13/97	1	Room	40	Wall	Wall Rgstr	Solid	Metal	0
1029	1974 Bldg	231	XRF	4/13/97	1	Room	40	Wall	Wall	Solid	Concrte	0
1030	1974 Bldg	232	XRF	4/13/97	1	Room	40	Door	Door	Solid	Wood	0
1031	1974 Bldg	233	XRF	4/13/97	1	Room	40	Door	Casing	Cracked	Metal	0.38
1032	1974 Bldg	234	XRF	4/13/97	1	Room	40	Ceiling		Solid	Concrte	0
1033	1974 Bldg	261	XRF	4/13/97	1	Room	41	Wall	Midle Wall	Solid	Concrte	0
1034	1974 Bldg	262	XRF	4/13/97	1	Room	41	Wall	Radiator	Cracked	Metal	0
1035	1974 Bldg	263	XRF	4/13/97	1	Room	41	Window	Casing	Solid	Metal	0.01
1036	1974 Bldg	264	XRF	4/13/97	1	Room	41	Door	Door	Solid	Wood	0
1037	1974 Bldg	265	XRF	4/13/97	1	Room	41	Door	Casing	Cracked	Metal	0.02
1038	1974 Bldg	266	XRF	4/13/97	1	Room	41	Porch	Columns	Solid	Metal	0
1039	1974 Bldg	320	XRF	4/13/97	1	Room	42	Wall	Midle Wall	Solid	Drywall	0
1040	1974 Bldg	321	XRF	4/13/97	1	Room	42	Wall	Wall	Solid	Drywall	0
1041	1974 Bldg	322	XRF	4/13/97	1	Room	42	Window	Casing	Solid	Metal	0.04
1042	1974 Bldg	323	XRF	4/13/97	1	Room	42	Door	Door	Solid	Wood	0
1043	1974 Bldg	324	XRF	4/13/97	1	Room	42	Door	Casing	Solid	Metal	0
1044	1974 Bldg	325	XRF	4/13/97	1	Room	43	Wall	Wall	Solid	Drywall	0.02
1045	1974 Bldg	326	XRF	4/13/97	1	Room	43	Window	Casing	Solid	Metal	0
1046	1974 Bldg	327	XRF	4/13/97	1	Room	43		Wire Tray	Solid	Metal	0
1047	1974 Bldg	328	XRF	4/13/97	1	Room	43	Door	Door	Solid	Wood	0
1048	1974 Bldg	329	XRF	4/13/97	1	Room	43	Door	Casing	Solid	Metal	0.01
1049	1974 Bldg	331	XRF	4/13/97	1	Room	44	Wall	Wall	Solid	Drywall	0.06
1050	1974 Bldg	332	XRF	4/13/97	1	Room	44		Wall	Solid	Metal	0
1051	1974 Bldg	333	XRF	4/13/97	1	Room	44	Wall	Elec Pane	Solid	Metal	0
1052	1974 Bldg	334	XRF	4/13/97	1	Room	44	Door	Door	Solid	Wood	0
1053	1974 Bldg	335	XRF	4/13/97	1	Room	44	Door	Casing	Solid	Metal	0
1054	1974 Bldg	336	XRF	4/13/97	1	Room	44	Door	Door	Solid	Wood	0
1055	1974 Bldg	337	XRF	4/13/97	1	Room	44	Window	Casing	Solid	Metal	0.02
1056	1974 Bldg	370	XRF	4/13/97	1	Room	45	Wall	Midle Wall	Solid	Concrete	0
1057	1974 Bldg	371	XRF	4/13/97	1	Room	45	Coat Rack	Midle Wall	Solid	Wood	0
1058	1974 Bldg	372	XRF	4/13/97	1	Room	45	Door	Door	Solid	Wood	0
1059	1974 Bldg	373	XRF	4/13/97	1	Room	45	Door	Casing	Solid	Metal	0.98
1060	1974 Bldg	374	XRF	4/13/97	1	Room	45		0	Solid	Concrete	0
1061	1974 Bldg	395	XRF	4/13/97	1	Room	46	Wall	Wall	Solid	Concrete	0
1062	1974 Bldg	396	XRF	4/13/97	1	Room	46	Wall	Radiator	Solid	Metal	0
1063	1974 Bldg	397	XRF	4/13/97	1	Room	46	Wall	Midle Wall	Solid	Tile	0.05

Saint Paul Public Schools
 Maxfield Magnet School
 Lead-Based Paint Inspection

A	B	C	D	E	F	G	H	I	J	K	L	
3	Site	Sample #	Analysis	Date	Floor	Area	Room#	Component	Feature	Condition	Substrate	Result
1064	1974 Bldg	398	XRF	4/13/97	1	Room	46	Wall	Wall Rgstr	Solid	Metal	0
1065	1974 Bldg	399	XRF	4/13/97	1	Room	46	Door	Door	Solid	Wood	0
1066	1974 Bldg	400	XRF	4/13/97	1	Room	46	Door	Casing	Solid	Metal	0.02
1067	1974 Bldg	401	XRF	4/13/97	1	Room	46	Wall	Midle Wall	Solid	Concrete	2.28
1068	1974 Bldg	402	XRF	4/13/97	1	Room	46	Ceiling		Solid	Concrete	0
1069	1974 Bldg	403	XRF	4/13/97	1	Room	47	Wall	Wall	Solid	Concrete	0.01
1070	1974 Bldg	404	XRF	4/13/97	1	Room	47	Wall	Wall Rgstr	Solid	Metal	0
1071	1974 Bldg	405	XRF	4/13/97	1	Room	47	Door	Door	Solid	Wood	0
1072	1974 Bldg	406	XRF	4/13/97	1	Room	47	Door	Casing	Cracked	Metal	0.01
1073	1974 Bldg	407	XRF	4/13/97	1	Room	47	Ceiling	Wall	Solid	Concrete	0.02
1074	1974 Bldg	409	XRF	4/13/97	1	Room	48	Wall	Wall	Solid	Concrete	0
1075	1974 Bldg	410	XRF	4/13/97	1	Room	48	Wall	Wall	Solid	Concrete	0
1076	1974 Bldg	411	XRF	4/13/97	1	Room	48	Door	Door	Solid	Wood	0
1077	1974 Bldg	412	XRF	4/13/97	1	Room	48	Wall	Wall Rgstr	Solid	Metal	0
1078	1974 Bldg	413	XRF	4/13/97	1	Room	48	Door	Casing	Solid	Metal	0.01
1079	1974 Bldg	414	XRF	4/13/97	1	Room	48	Wall	Wall Rgstr	Solid	Metal	0.02
1080	1974 Bldg	415	XRF	4/13/97	1	Room	48	Wall	Wall	Solid	Concrete	0
1081	1974 Bldg	416	XRF	4/13/97	1	Room	48	Door	Door	Solid	Metal	2.49
1082	1974 Bldg	417	XRF	4/13/97	1	Room	48	Door	Casing	Solid	Metal	0.02
1083	1974 Bldg	418	XRF	4/13/97	1	Room	48	Wall	Wall	Solid	Concrete	0
1084	1974 Bldg	419	XRF	4/13/97	1	Room	48	Transum	Wall	Solid	Metal	0.02
1085	1974 Bldg	420	XRF	4/13/97	1	Room	48	Back Board	Wall	Solid	Wood	0.02
1086	1974 Bldg	421	XRF	4/13/97	1	Room	48	Wall	Wall	Solid	Wood	0
1087	1974 Bldg	422	XRF	4/13/97	1	Room	48	Wall	Wall	Solid	Metal	0.01
1088	1974 Bldg	423	XRF	4/13/97	1	Room	49	Stairs	Stringer	Solid	Metal	0.03
1089	1974 Bldg	424	XRF	4/13/97	1	Room	49	Stairs	Hand rail	Solid	Metal	0.05
1090	1974 Bldg	425	XRF	4/13/97	1	Room	49	Door	Door	Solid	Metal	0.05
1091	1974 Bldg	426	XRF	4/13/97	1	Room	49	Door	Casing	Solid	Metal	0.03
1092	1974 Bldg	427	XRF	4/13/97	1	Room	49	Door	Door	Cracked	Wood	0
1093	1974 Bldg	428	XRF	4/13/97	1	Room	49	Door	Casing	Cracked	Metal	0.01
1094	1974 Bldg	429	XRF	4/13/97	2	Room	49	Door	Door	Cracked		0.01
1095	1974 Bldg	430	XRF	4/13/97	2	Room	49	Door	Casing	Cracked	Metal	0.03
1096	1974 Bldg	431	XRF	4/13/97	2	Room	49	Stairs	Hand rail	Solid	Metal	0.02
1097	1974 Bldg	432	XRF	4/13/97	2	Room	49	Stairs	Baseboar	Solid	Metal	0.01
1098	1974 Bldg	186	XRF	4/13/97	1	Room	1530	Wall	Wall	Solid	Drywall	0
1099	1974 Bldg	187	XRF	4/13/97	1	Room	1530	Porch	Columns	Solid	Concrete	0
1100	1974 Bldg	188	XRF	4/13/97	1	Room	1530	Wall	Wall	Solid	Drywall	0
1101	1974 Bldg	189	XRF	4/13/97	1	Room	1530	Window	Casing	Solid	Metal	0.02
1102	1974 Bldg	190	XRF	4/13/97	1	Room	1530	Wall	Wall Rgstr	Solid	Metal	0
1103	1974 Bldg	191	XRF	4/13/97	1	Room	1530	Door	Door	Solid	Wood	0
1104	1974 Bldg	192	XRF	4/13/97	1	Room	1530	Door	Casing	Solid	Metal	0.01
1105	1974 Bldg	193	XRF	4/13/97	1	Room	1530	Wall	Midle Wall	Solid	Drywall	0.93
1106	1974 Bldg	194	XRF	4/13/97	1	Room	1530	Ceiling		Solid	Concrete	0

APPENDIX B

LABORATORY SAMPLE ANALYSIS DATA

LABORATORY ANALYSIS REPORT

DATE: June 12, 1997 **PAGE:** 1 Of 2

CLIENT: Midwest Environmental Cons.
5385 401st Ave. NW
Dalbo, MN 55017 **PROJECT NO.:** 042397-200888
COLLECTION DATE: 4/19/97
COLLECTED BY: Client
RECEIVED DATE: 4/23/97
PROJECT DESCRP.: 62/0197O

CONTACT: Greg Myers/Richard Cox

SAMPLE #	DESCP.	MDL	LEAD (6010A)	ANALYSIS DATE
			RESULTS	
L972369-1	B-1	8.6	630	6/11/97
L972369-2	B-2	30	3600	6/11/97
L972369-3	B-3	30	3600	6/11/97
L972369-4	B-4	24	3100	6/11/97
L972369-5	B-5	240	ND	6/11/97
L972369-6	B-6	8.7	3700	6/11/97
L972369-7	B-7	19	240	6/11/97
L972369-8	B-8	33	2100	6/11/97
L972369-9	B-9	16	1000	6/11/97
L972369-10	B-10	41	3000	6/11/97
L972369-11	B-11	12	59	6/11/97
L972369-12	B-12	16	300	6/11/97
L972369-13	B-13	32	65	6/11/97
L972369-14	B-14	170	880	6/11/97
L972369-15	B-15	13	160	6/11/97
L972369-16	B-16	17	17	6/11/97
L972369-17	B-17	14	1600	6/11/97
L972369-18	B-18	36	650	6/11/97
L972369-19	B-19	84	8600	6/11/97
L972369-20	B-20	44	230	6/11/97
L972369-21	B-21	12	24	6/11/97
L972369-22	B-22	26	5800	6/11/97
L972369-23	B-23	32	3100	6/11/97
L972369-24	B-24	49	7600	6/11/97
L972369-25	B-25	23	2200	6/11/97
L972369-26	B-26	16	1800	6/11/97

ND means Not Detected or below reported MDL

MDL means Method Detection Limit

mg/kg means Milligrams Per Kilogram which is equivalent to Parts Per Million (ppm)

As a mutual protection, all reports are submitted in confidentiality and may not be reproduced except in full without written authorization.



A member of The Marmon Group of Companies



301 West County Road E2 • St. Paul, MN 55112
(612) 633-0101 • FAX (612) 633-1402

LABORATORY ANALYSIS REPORT

DATE: June 12, 1997

PAGE: 2 Of 2

CLIENT: Midwest Environmental Cons.
5385 401st Ave. NW
Dalbo, MN 55017

PROJECT NO.: 042397-200888
COLLECTION DATE: 4/19/97
COLLECTED BY: Client
RECEIVED DATE: 4/23/97
PROJECT DESCRP.: 62/01970

CONTACT: Greg Myers/Richard Cox

This report has been reviewed by me for technical accuracy and completeness. The analyses were performed using EPA or other approved methodologies and the results were reported on an "as received" basis unless otherwise noted. Organic soil analyses were reported on a dry weight basis. The results reported relate only to the items tested. Please contact me if you have any questions or comments regarding this report. Spectrum Labs, Inc. appreciates the opportunity to provide this analytical service for you.

Report Submitted By,

Thomas L. Halverson
Laboratory Manager

TLH:wmc
mec163-1

As a mutual protection, all reports are submitted in confidentiality and may not be reproduced except in full without written authorization.



A member of The Marmon Group of Companies

Midwest Environmental Consulting, L.L.C.

5385 401st Ave. NW, Duluth, MN 55017
 612-689-3612/612-757-5541/FAX-612-689-5209
 Client Address 360 North Birchwood
 Contact Greg Myers / Principal



CHAIN OF CUSTODY RECORD

Project Number 6d-0197-0
 Client Sgt. ISD
 Project Mark C. & T. Inc.
 Phone/Fax _____


Sample ID	Sample Description	Collection Date/Time	Matrix (Vol/Area)	Analysis Requested
6d-0197-0-B-1	4-5-97 2pm 24 Am 201 fence side 4100 ft long metal fence	11:20 p 4-19-97	2 sq"	pb
6d-0197-0-B-2	4-5-97 2pm 205 Side D 4100 ft long metal fence	11:25 p 4-19-97	2 sq"	
6d-0197-0-B-3	4-5-97 2pm 205 side D Inside white	11:30 p 4-19-97	2 sq"	
6d-0197-0-B-4	4-5-97 2pm 205 Side A white metal fence	11:35 p 4-19-97	2 sq"	
6d-0197-0-B-5	4-5-97 2pm 205 Side B Inside white	11:45 p 4-19-97	2 sq"	
6d-0197-0-B-6	4-5-97 2pm 205 Side C Outside fence	11:50 p 4-19-97	2 sq"	
6d-0197-0-B-7	4-5-97 2pm 100' from 100' white plaster fence	11:55 p 4-19-97	2 sq"	
6d-0197-0-B-8	4-5-97 2pm 100' from 100' white plaster fence	2:00 p 4-19-97	2 sq"	
6d-0197-0-B-9	4-5-97 2pm 100' from 100' white plaster fence	2:05 p 4-19-97	2 sq"	
6d-0197-0-B-10	4-5-97 2pm 100' from 100' white plaster fence	2:10 p 4-19-97	2 sq"	
6d-0197-0-B-11	4-5-97 2pm 207' from 100' white plaster fence	2:20 p 4-19-97	2 sq"	
6d-0197-0-B-12	4-5-97 2pm 100' from 100' white plaster fence	2:25 p 4-19-97	2 sq"	
6d-0197-0-B-13	4-5-97 2pm 100' from 100' white plaster fence	2:30 p 4-19-97	2 sq"	
6d-0197-0-B-14	4-5-97 2pm 100' from 100' white plaster fence	2:40 p 4-19-97	2 sq"	

Sampled By: Greg A. Myers Date: 4/19/97 Time: 11:45 Delivered By: Greg A. Myers Date: 4/20/97 Time: 8:50a

Received By: _____ Date: _____ Time: _____ Delivered By: _____ Date: _____ Time: _____

Received By Lab: Murphy Date: 4/20/97 Time: 8:50 Disposition of Samples _____

Notes: Refrigerate result in part per million

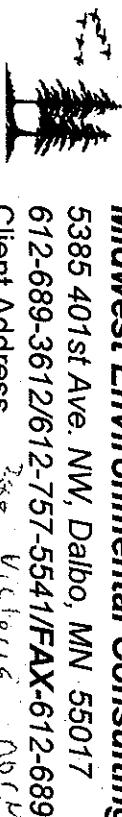

MidWest Environmental Consulting, L.L.C.

5385 401st Ave. NW, Dalbo, MN 55017

3383 401st Ave. NW, Dalbo, MN 55011

612-689-3612/612-757-5541/FAX-612-689-5209

Client A

Craig Myers / Richard Cox

CHAIN OF CUSTODY RECORD

Project Number 62-0147

Project Number 3-201-1

Client _____

Project _____ Math 101 Elementary

Project _____

Sample ID	Sample Description	Collection Date/Time	Matrix (Vol./Area)	Analysis Requested
62-0197-0-0-15	E31 H-6-97 AM 10:30 middle wall side C white	2:45P 4-19-97	2.5g	Pb
62-0197-0-B-16	H-117 4-13-97 4:11 1:50pm S side white middle	2:55P 4-19-97	2.5g	
62-0197-0-B-17	#263 4-13-97 H-112 Side upper wall ground white	3:05P 4-19-97	2.5g	
62-0197-0-B-18	H-219 4-13-97 H-113 3:00pm+ tail clean white	3:10P 4-19-97	2.5g	
62-0197-0-B-19	#376 1.5-3.47 2:53pm Side D white	3:15P 4-19-97	2.5g	
62-0197-0-B-20	#376 4-19-97 2:54pm Side B front window glass white	3:25P 4-19-97	2.5g	
62-0197-0-B-21	H-107 4-13-97 2:54pm Side A white	3:30P 4-19-97	2.5g	
62-0197-0-B-22	H-8 4-13-97 2:54pm Side D gear concrete middle	3:35P 4-19-97	1.5g	
62-0197-0-B-23	H-9 4-13-97 2:54pm Side A gear metal Dope	3:40P 4-19-97	2.5g	
62-0197-0-B-24	H-16 4-19-97 2:54pm Side B Red metal hinge	3:45P 4-19-97	2.5g	
62-0197-0-B-25	H-16 4-19-97 2:54pm Side C house concrete	3:50P 4-19-97	2.5g	
62-0197-0-B-26	H-4 1-5-97 2:54pm Side D door handle white	3:55P 4-19-97	2.5g	

Sampled By: Greg A. Myers Date: 4/19/97 Time: 11: a.m. 4:15 p.m. Delivered By: Greg A. Myers Date: 4/23/97 Time: 8:50 a.m.

Received By: _____ Date: _____ Time: _____

Received By Lab: Hungry Date: 11/23/97 Time: 8:55

Disposition of Samples

Notes:

APPENDIX C INSPECTORS

**Greg A. Myers
MDH Lead Inspector # 116**