



June 29, 2022

Otto Rice
Dayton School District
780 Ferry Street
Dayton, Oregon 97114

Via email: otto.rice@dayton.k12.or.us

Regarding: Drinking Water Sampling Report
Dayton Grade School
526 Ferry Street
Dayton, OR 97114
PBS Project 27350.000, Phase 0001

Mr. Rice:

In May and June 2022, PBS Engineering and Environmental Inc. (PBS) performed drinking water sampling and analysis for lead at Dayton Grade School in Dayton, Oregon. The testing was requested by Dayton School District (the District) to meet requirements from the Oregon Department of Education (ODE) and Oregon Health Authority (OHA) to conduct initial testing for lead in school drinking water systems.

Background and Sampling Procedure

Oregon Administrative Rule (OAR) 333-061-0400 *Reducing Lead In School Drinking Water* requires school districts to conduct initial testing for lead from each qualifying tap.

The sampling methodology followed the protocol described in Section 4 of the EPA document *3Ts for Reducing Lead in Drinking Water in Schools and Childcare Facilities, October 2018* and guidelines established by Oregon Health Authority and Oregon Department of Education. Following these guidelines, PBS assigned identification numbers and collected first draw samples from each test location. First draw samples consist of the first 250 milliliters (mL) of water drawn from a fixture during an early morning after school was in session the previous day, and before the fixture has been used again in the morning. The 3Ts' sampling protocol is designed to maximize the likelihood that the highest concentrations of lead in water used for consumption are identified.

The EPA protocol recommends follow-up flush sampling at all locations where first-draw samples contain lead concentrations greater than 15 parts per billion (ppb). For the sake of expediency, PBS collected flush samples immediately following first draw samples. Only flush samples from fixtures in which the first draw sample was elevated were analyzed. Flush samples were collected after the water from the fixture was allowed to run for 30 seconds with a steady stream of the approximate diameter of a pencil. The purpose of flush sampling is to attempt to pinpoint if lead is getting into the water from the fixture or from the building's interior plumbing.

PBS tested all taps in the building(s) eligible for testing according to OAR 333-061-0400, which requires testing of all taps except the following: shower heads, pipes used for building heating, dedicated eyewash stations and emergency showers, fixtures in areas with no student access used solely for sanitation by staff, fixtures used exclusively for irrigation, and fixtures in science and technical education classrooms (grades 6-12) where the

fixtures have signage indicating they are not a drinking water source and are not intended for use in food preparation.

PBS assigned sample numbers to fixtures according to the ODE naming convention and using the ODE district and building codes provided by the District to PBS. When multiple samples were collected in the same area, PBS assigned numbers and sampled in a clockwise fashion starting on the left.

Results

First draw and flush samples were collected from 99 fixtures and delivered under chain of custody to Apex Laboratories in Tigard, Oregon, for lead analysis using EPA Method 200.8 ICPMS. First draw samples are labeled with an "A" and corresponding flush samples with a "B". Samples above the action level of 15 ppb are shown in bold, for a total of 16 fixtures. A total of 115 samples were analyzed. The following table lists the results of the analysis.

Table 1: Dayton Grade School Sample Results

Fixture Number	Sample Number	Location / Room No.	Fixture Type	Results (ppb)
001	22531211-001CF22A	Classroom 1	Faucet	6.49
002	22531211-002DW22A	Classroom 1	Drinking fountain	7.43
003	22531211-003CF22A	Room B3	Faucet	22.9
003	22531211-003CF22B	-	-	2.39
004	22531211-004CF22A	B-Wing Main Hall	Faucet	0.767
005	22531211-005DW22A	B-Wing Main Hall	Drinking fountain	2.55
006	22531211-006DW22A	B-Wing Main Hall	Drinking fountain	3.00
007	22531211-007CF22A	Classroom 2	Faucet	29.4
007	22531211-007CF22B	-	-	22.3
008	22531211-008BF22A	Boy's Restroom 120	Faucet	12.8
009	22531211-009BF22A	Boy's Restroom 120	Faucet	9.79
010	22531211-010WB22A	Hall 205 east end	Water bottle fill	ND
011	22531211-011DW22A	Hall 205 east end	Drinking fountain	ND
012	22531211-012BF22A	Girl's Restroom 118	Faucet	10.1
013	22531211-013BF22A	Girl's Restroom 118	Faucet	13.7
014	22531211-014CF22A	Classroom 3	Faucet	10.6
015	22531211-015DW22A	Classroom 3	Faucet	5.87
016	22531211-016BF22A	Gym Restroom Wash Area 115	Faucet	21.1
016	22531211-016BF22B	-	-	4.02
017	22531211-017BF22A	Gym Restroom Wash Area 115	Faucet	1.50
018	22531211-018BF22A	Gym Restroom Wash Area 115	Faucet	0.78
019	22531211-019BF22A	Gym Restroom Wash Area 115	Faucet	1.63
020	22531211-020WB22A	Gym Vestibule 114	Water bottle fill	ND
021	22531211-021DW22A	Gym Vestibule 114	Drinking fountain	ND
022	22531211-022CF22A	Classroom 4	Faucet	10.7
023	22531211-023DW22A	Classroom 4	Drinking fountain	4.66
024	22531211-024CF22A	Classroom 5	Faucet	25.0

Fixture Number	Sample Number	Location / Room No.	Fixture Type	Results (ppb)
024	22531211-024CF22B	-	-	1.00
025	22531211-025CF22A	Room 109	Faucet	2.96
026	22531211-026BF22A	Room 109 Restroom	Faucet	1.45
027	22531211-027CF22A	Room 6	Faucet	2.52
028	22531211-028BF22A	Room 6 Restroom	Faucet	1.39
029	22531211-029BF22A	Restroom 107	Faucet	0.998
030	22531211-030BF22A	Restroom 107	Faucet	1.10
031	22531211-031SF22A	Room 107 Kitchen	Faucet	3.39
032	22531211-032BF22A	Girl's Restroom 104	Faucet	9.69
033	22531211-033BF22A	Girl's Restroom 104	Faucet	5.23
034	22531211-034DW22A	Hallway outside Room 104	Drinking fountain	5.09
035	22531211-035DW22A	Hallway outside Room 104	Drinking fountain	1.59
036	22531211-036CF22A	Classroom 7	Faucet	6.44
037	22531211-037DW22A	Classroom 7	Drinking fountain	0.354
038	22531211-038BF22A	Boy's Restroom 101	Faucet	10.6
039	22531211-039BF22A	Boy's Restroom 101	Faucet	5.92
040	22531211-040CF22A	Classroom 9	Faucet	10.6
041	22531211-041DW22A	Classroom 9	Drinking fountain	4.29
042	22531211-042CF22A	Classroom 8	Faucet	6.24
043	22531211-043DW22A	Classroom 8	Drinking fountain	18.3
043	22531211-043DW22B	-	-	3.51
044	22531211-044CF22A	Classroom 11	Faucet	68.2
044	22531211-044CF22B	-	-	6.91
045	22531211-045DW22A	Classroom 11	Drinking fountain	8.71
046	22531211-046CF22A	Classroom 10	Faucet	15.7
046	22531211-046CF22B	-	-	12.8
047	22531211-047DW22A	Classroom 10	Drinking fountain	8.27
048	22531211-048WB22A	Hall 201	Water bottle fill	ND
049	22531211-049DW22A	Hall 201	Drinking fountain	ND
050	22531211-050CF22A	Classroom 12	Faucet	17.4
050	22531211-050CF22B	-	-	8.82
051	22531211-051DW22A	Classroom 12	Drinking fountain	7.26
052	22531211-052NS22A	Nurse Room	Faucet	1.14
053	22531211-053CF22A	Classroom 15	Faucet	6.77
054	22531211-054DW22A	Classroom 15	Drinking fountain	2.61
055	22531211-055BF22A	Bathroom 127	Faucet	0.923
056	22531211-056BF22A	Bathroom 126	Faucet	1.01
057	22531211-057BF22A	Boy's Restroom 125	Faucet	1.15
058	22531211-058BF22A	Girl's Restroom 123	Faucet	3.54
059	22531211-059SF22A	Staff Room 122	Faucet	2.45
060	22531211-060WB22A	Hallway outside Room 121	Water bottle fill	ND

Fixture Number	Sample Number	Location / Room No.	Fixture Type	Results (ppb)
061	22531211-061DW22A	Hallway outside Room 121	Drinking fountain	ND
062	22531211-062CF22A	Classroom 16	Faucet	68.3
062	22531211-062CF22B	-	-	3.77
063	22531211-063DW22A	Classroom 16	Drinking fountain	24.8
063	22531211-063DW22B	-	-	19.4
064	22531211-064CF22A	Classroom 17	Faucet	75.3
064	22531211-064CF22B	-	-	1.03
065	22531211-065DW22A	Classroom 17	Drinking fountain	12.3
066	22531211-066CF22A	Classroom 18	Faucet	61.0
066	22531211-066CF22B	-	-	9.47
067	22531211-067DW22A	Classroom 18	Drinking fountain	14.9
068	22531211-068CF22A	Classroom 19	Faucet	111
068	22531211-068CF22B	-	-	1.19
069	22531211-069DW22A	Classroom 19	Drinking fountain	19.8
069	22531211-069DW22B	-	-	2.00
070	22531211-070CF22A	Classroom 20	Faucet	13.1
071	22531211-071CF22A	Classroom 21	Faucet	4.66
072	22531211-072DW22A	Classroom 21	Drinking fountain	104
073	22531211-073DW22A	Gym/Café main entrance	Drinking fountain	2.48
074	22531211-074DW22A	Gym/Café main entrance	Drinking fountain	2.67
075	22531211-075BF22A	Gym/Café Girl's Restroom	Faucet	5.87
076	22531211-076BF22A	Gym/Café Girl's Restroom	Faucet	3.07
077	22531211-077BF22A	Gym/Café Girl's Restroom	Faucet	2.65
078	22531211-078BF22A	Gym/Café Staff Restroom	Faucet	12.6
079	22531211-079BF22A	Gym/Café Boy's Restroom	Faucet	8.37
080	22531211-080BF22A	Gym/Café Boy's Restroom	Faucet	4.35
081	22531211-081BF22A	Gym/Café Boy's Restroom	Faucet	4.21
082	22531211-082CF22A	Gym/Café Music Room	Faucet	3.90
083	22531211-083BF22A	Gym/Café Gym	Faucet	9.47
084	22531211-084BF22A	Gym/Café Gym	Faucet	2.23
085	22531211-085KF22A	Kitchen	Faucet	8.09
086	22531211-086KF22A	Kitchen	Faucet	3.89
087	22531211-087KF22A	Kitchen	Faucet	3.86
088	22531211-088KF22A	Kitchen	Faucet	17.4
088	22531211-088KF22B	-	-	2.73
089	22531211-089KF22A	Kitchen	Faucet	9.91
090	22531211-090KF22A	Kitchen	Faucet	12.8
091	22531211-091KF22A	Kitchen	Faucet	10.4
092	22531211-092KF22A	Kitchen	Faucet	6.10
093	22531211-093DW22A	Concession by SB field	Drinking fountain	15.3
093	22531211-093DW22B	-	-	20.6

Fixture Number	Sample Number	Location / Room No.	Fixture Type	Results (ppb)
094	22531211-094DW22A	Concession by SB field	Drinking fountain	4.36
095	22531211-095BF22A	Concession by SB field – girl's restroom	Faucet	13.0
096	22531211-096BF22A	Concession by SB field – girl's restroom	Faucet	10.1
097	22531211-097BF22A	Concession by SB field – boy's restroom	Faucet	9.09
098	22531211-098BF22A	Concession by SB field – boy's restroom	Faucet	12.7
099	22531211-099SF22A	Concession by SB field	Faucet	11.7

ND = no lead detected

Elevated concentrations of lead were found in several fixtures throughout the building. Access to the fixtures should be restricted in accordance with Oregon and EPA guidelines. PBS recommends taking corrective action per recommendations in EPA's 3Ts Module 6. Follow-up flush sampling found concentrations remained elevated in three fixtures. Given that the majority of fixtures in the building tested below 15.0, and most flush samples also tested below 15.0, it is unlikely that there is a building-wide source of lead in drinking water beyond the fixtures themselves. PBS recommends remediating all fixtures, flushing them, and retesting in accordance with ODE guidelines. PBS is available to assist with further investigation and corrective actions upon request.

Please refer to the attached sample location field drawing and laboratory analytical report for additional details. The laboratory analytical results are reported in micrograms per liter (µg/L), a unit of measure that is equivalent to ppb.

Reimbursement

The District is eligible for reimbursement from the State of Oregon for the cost of laboratory analytical testing and shipping, but not consultant fees. This is done by completing out the ODE's reimbursement template spreadsheet for each facility and submitting the information to ODE. PBS is available to assist with filing for reimbursement upon request, but it is not currently in our scope of work.

Ongoing Testing

According to OAR 333-061-0400, school districts are required to complete on-going testing at least once every six years, starting from July 1, 2020. Taps are exempt from ongoing testing if the tap was installed after January 4, 2014 and meets the lead-free standard of no more than 0.25 percent lead by weight and the piping feeding the tap is a material other than copper or was installed after January 4, 2014 and the solder and flux meets the leadfree standard of no more than 0.2 percent lead; and was tested during initial testing and results were less than 1 ppb lead. The District should investigate whether any taps at this facility meet the requirements to suspend ongoing testing. The District should consult with ODE to determine when they should complete ongoing testing.

Please feel free to contact me at 503.515.7489 or james.mastanduno@pbsusa.com with any questions or comments.

Sincerely,

James Mastanduno
Project Manager

Attachments: Sample Location Field Drawing
Laboratory Analytical Reports

JM:

6'-0"	7'-6"	1'-3/4"	C	HS	ME	T/IN, 1"	HS	ME	-	6	
3'-0"	7'-0"	1'-3/4"	A	HS	ME	-	HS	ME	-	7	
3'-0"	7'-0"	1'-3/4"	A	SC	WT	-	HS	ME	-	4	
3'-0"	7'-0"	1'-3/4"	B	SC	WT	LS, 5/16"	HS	ME	-	2	
3'-0"	7'-0"	1'-3/4"	A	SC	WT	-	HS	ME	-	4	
3'-0"	7'-0"	1'-3/4"	A	SC	WT	-	HS	ME	-	8	NOTE 4
4'-0"	7'-0"	1'-3/4"	A	SC	WT	-	ST	FF	-	9	NOTE 1
3'-0"	7'-0"	1'-3/4"	C	SC	WT	LS, 5/16"	HS	ME	-	2	
4'-0"	7'-0"	1'-3/4"	C	HS	ME	T/IN, 1"	HS	ME	-	7	
3'-0"	7'-0"	1'-3/4"	B	SC	WT	LS, 5/16"	HS	ME	-	5	
3'-0"	7'-0"	1'-3/4"	B	SC	WT	T	HS	ME	-	5	
3'-0"	7'-0"	1'-3/4"	A	SC	WT	-	HS	ME	-	3	
3'-0"	7'-0"	1'-3/4"	A	SC	WT	-	HS	ME	-	4	
6'-0"	7'-0"	1'-3/4"	B	SC	WT	T	HS	ME	-	10	
3'-0"	7'-0"	1'-3/4"	C	SC	WT	LS, 5/16"	HS	ME	-	5	
3'-0"	7'-0"	1'-3/4"	A	SC	WT	-	HS	ME	-	4	
6'-0"	7'-0"	1'-3/4"	C	HS	ME	T/IN, 1"	HS	ME	-	11	
3'-0"	7'-0"	1'-3/4"	B	SC	WT	T	HS	ME	-	2	
3'-0"	7'-0"	1'-3/4"	B	SC	WT	T	HS	ME	-	2	
3'-0"	7'-0"	1'-3/4"	B	SC	WT	T	HS	ME	-	5	
3'-0"	7'-0"	1'-3/4"	B	SC	WT	T	HS	ME	-	5	
3'-0"	7'-0"	1'-3/4"	B	SC	WT	T	HS	ME	-	2	
3'-0"	7'-0"	1'-3/4"	B	SC	WT	T	HS	ME	-	2	
3'-0"	7'-0"	1'-3/4"	B	SC	WT	T	HS	ME	-	5	
3'-0"	7'-0"	1'-3/4"	B	SC	WT	T	HS	ME	-	2	
3'-0"	7'-0"	1'-3/4"	C	SC	WT	LS, 5/16"	HS	ME	-	12	
6'-0"	7'-0"	1'-3/4"	C	HS	ME	T/IN, 1"	HS	ME	-	11	
6'-0"	7'-0"	1'-3/4"	C	HS	ME	T/IN, 1"	HS	ME	-	11	
3'-0"	7'-0"	1'-3/4"	A	HS	ME	-	HS	ME	-	1	
3'-0"	7'-0"	1'-3/4"	B	SC	WT	T	HS	ME	-	4	
6'-0"	7'-0"	1'-3/4"	C	HS	ME	T/IN, 1"	HS	ME	-	11	
6'-0"	7'-0"	1'-3/4"	C	HS	ME	T/IN, 1"	HS	ME	-	11	
6'-0"	7'-0"	1'-3/4"	C	EX	EX	T/IN, 1"	EX	EX	-	-	NOTE 2
6'-0"	7'-0"	1'-3/4"	C	EX	EX	T/IN, 1"	EX	EX	-	-	NOTE 2


- (ALL GLAZING 1/4" THICK UON)
- ELEVATION
- SEE FRAME ELEVATIONS
3. SEE BID ALTERNATE #1
4. PROVIDE TRANSFER GRILLE IN EAST DOOR, COORD w/ MECH

- FOR EACH IMPACT, APPLY MAT UNIT EXISTING FLOORING TO REMAIN FROM WALL TO WALL IN EACH AREA, BUTT AND OVERLAP MAT JOINTS AND USE HEAVY DUTY CONSTRUCTION TAPE CONTINUOUSLY ALONG ALL SEAMS. IF/WHEN TAPING TO FLOOR, VERIFY TAPE COMPATIBILITY WITH EXISTING FLOORING. MANUFACTURER: RAM BOARD, WWW.RAMBOARD.COM, THICKNESS: 46 MILS
8. REMOVE EXISTING CEILING AS REQUIRED FOR NEW WALLS
9. AT EXIST CEILINGS TO REMAIN, REMOVE CEILING TILES ARE REQUIRED FOR NEW MECHANICAL SUPPLY/RETURN GRILLES, TYP ENTIRE BUILDING

10. INFILL EXISTING OPENING W/ 2x STUDS TO MATCH EXISTING. PROVIDE R-21 BATT INSUL, PLYWD SHTTG AS SCHEDULED FOR SHEARWALL, WRB, & NEW EXTERIOR CLADDING
11. NEW CASEWORK
12. REINSTALL COAT HOOKS/SHELVING
13. PROVIDE FRAMING & WALL FINISHES ON BOTH SIDES TO MATCH ADJACENT SURFACES AFTER ASSOCIATED WORK IS COMPLETE. REPLACE WALL TRIM & TACKABLE SURFACES TO MATCH EXISTING. PROVIDE NEW RUBBER BASE TO MATCH EXISTING.

14. PROVIDE TRANSFER GRILLE IN EAST DOOR, COORD w/ MECH
15. PROVIDE NEW ADHESIVE-APPLIED CEILING TILES TO MATCH EXIST CEILING
16. PIPE CHASE W/ 8"x8" FREE SPACE
17. PICNIC TABLE, OFCI

* Make Gym/Cafe & SB Field (073-099)

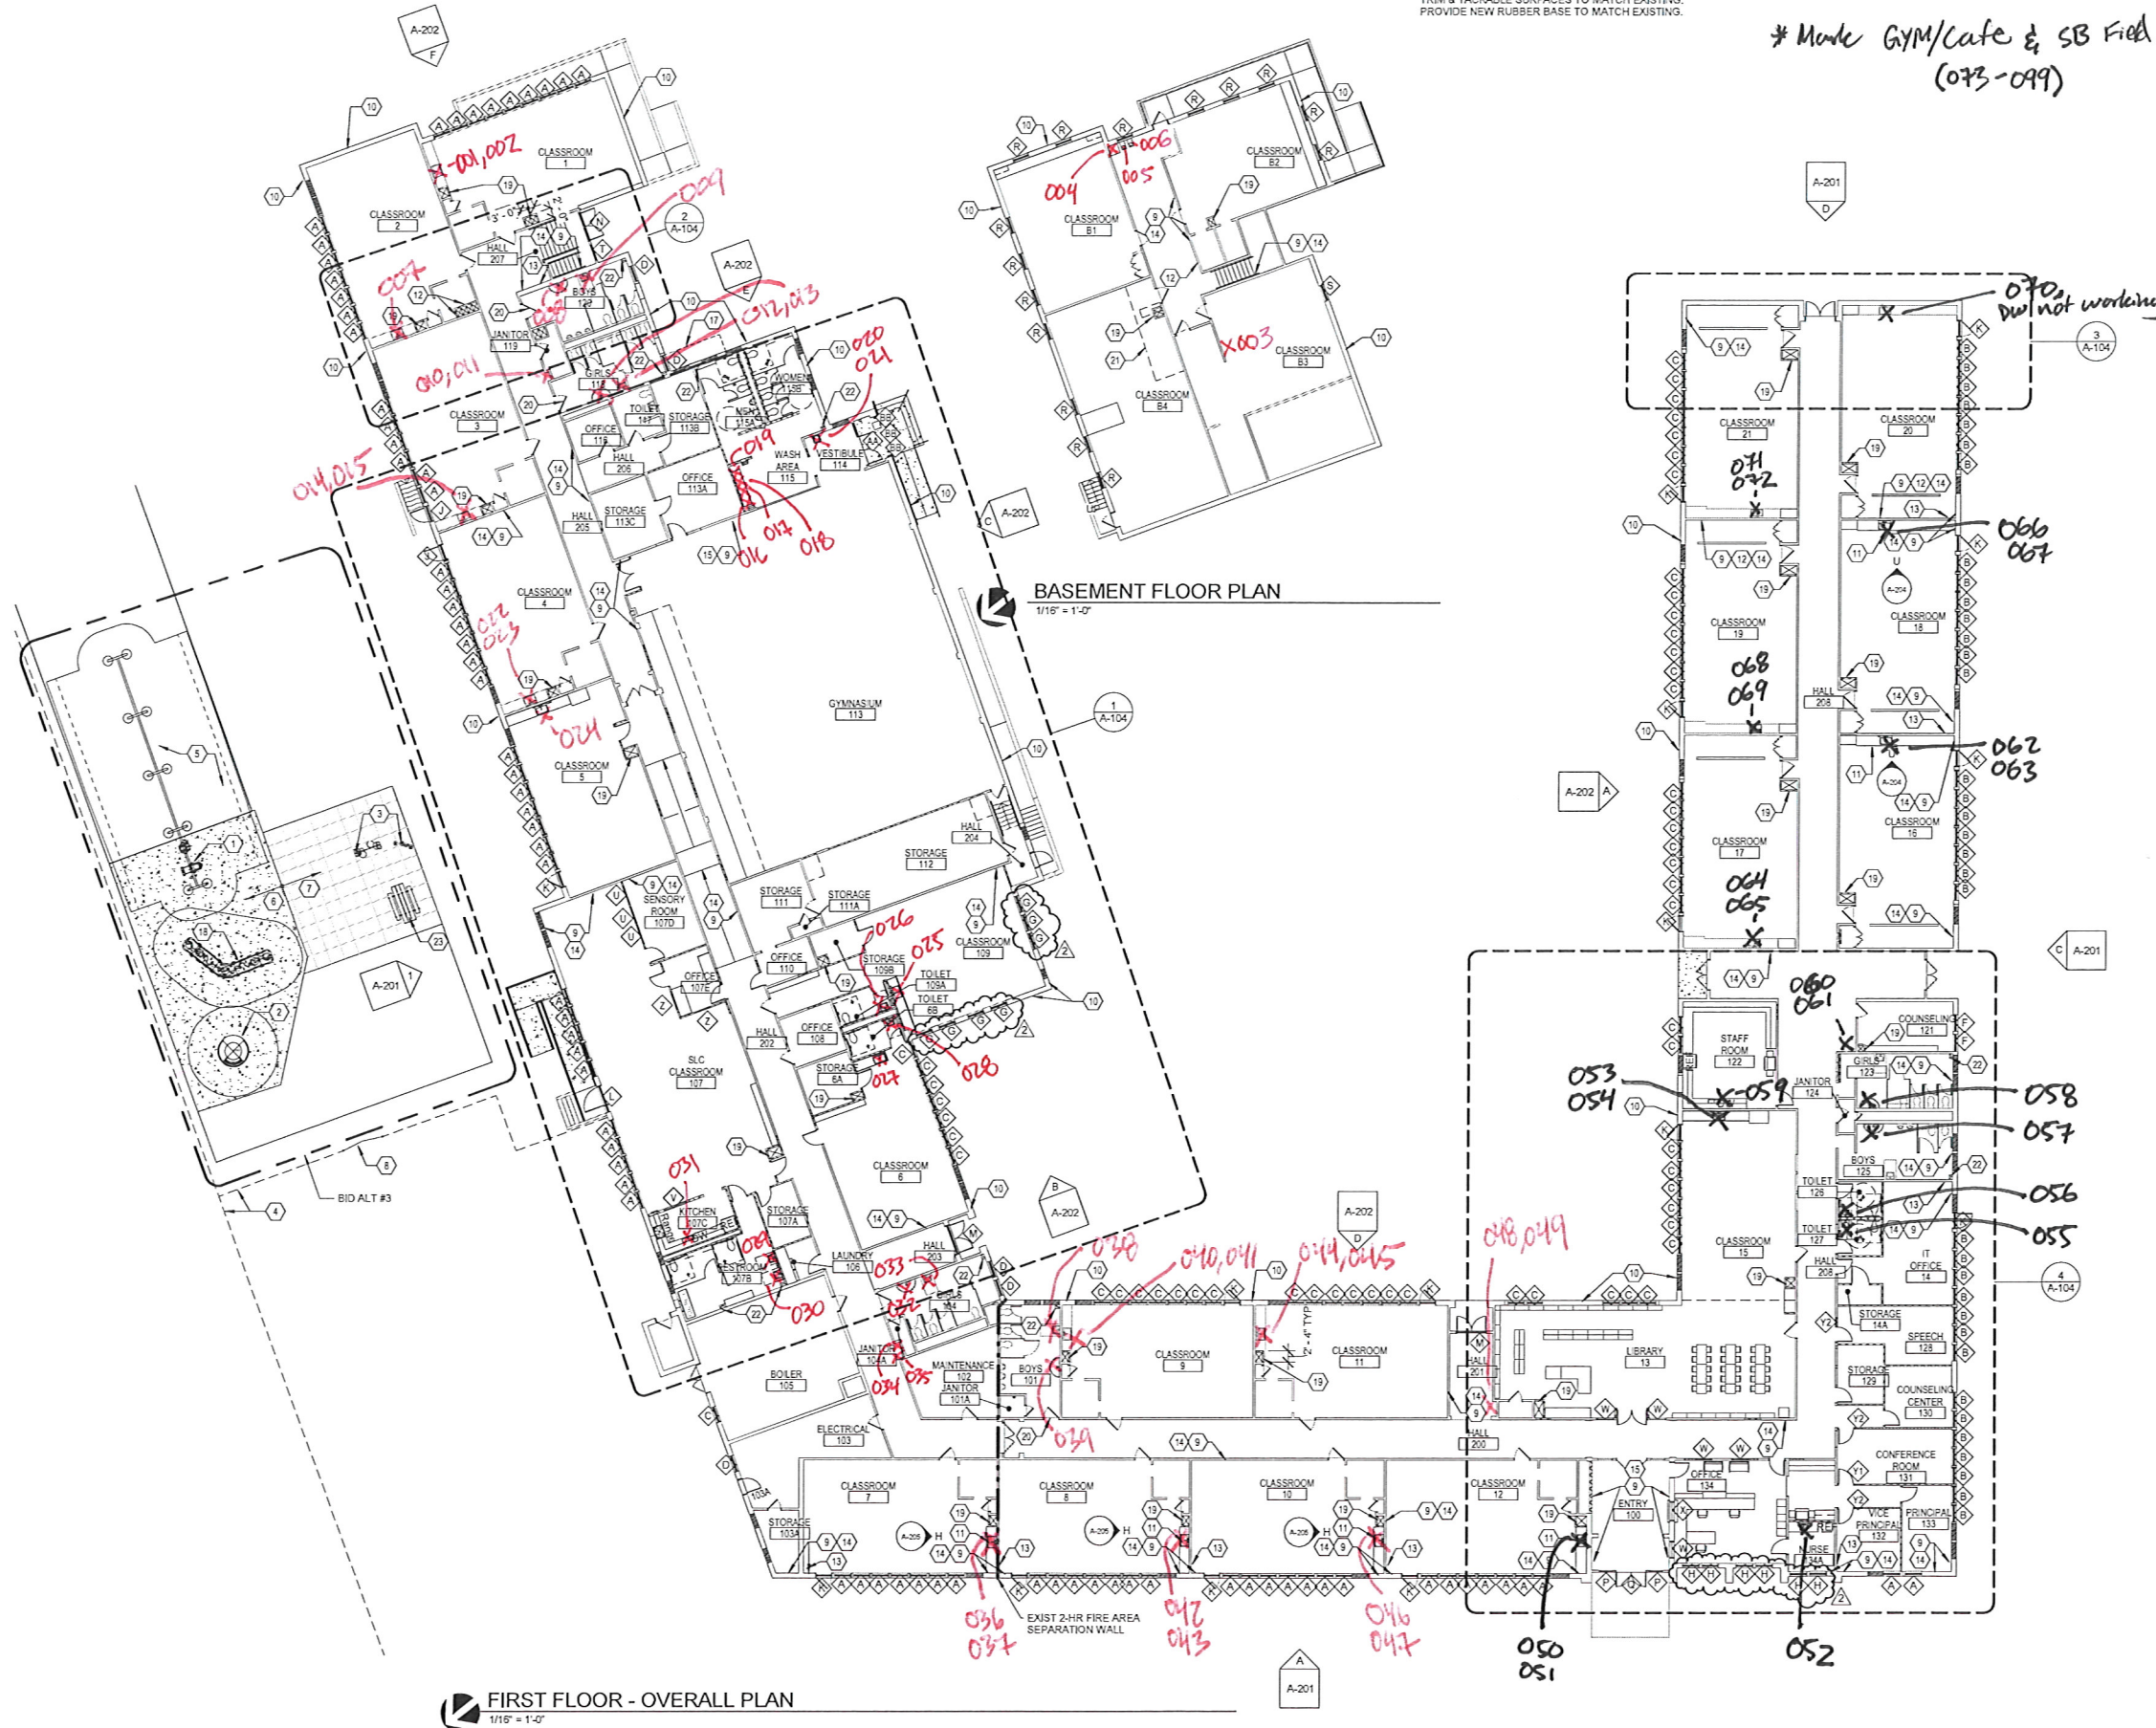

FIRST FLOOR - OVERALL PLAN
1/16\"/>

consultants:

PROJECT:
DAYTON SD - 2018 BOND
GRADE SCHOOL REMODEL

525 PERRY STREET
DAYTON, OREGON 97114


PERMIT SET

#	Description	Date
1	ADDENDUM #2	02-10-21

date: 01/07/21
project: 08319
drawn by: OMK, MTV
checked by: AMF
copyright © 2020
Carlson Velt Junge Architects PC


OVERALL
FLOOR PLANS

sheet:
A-103

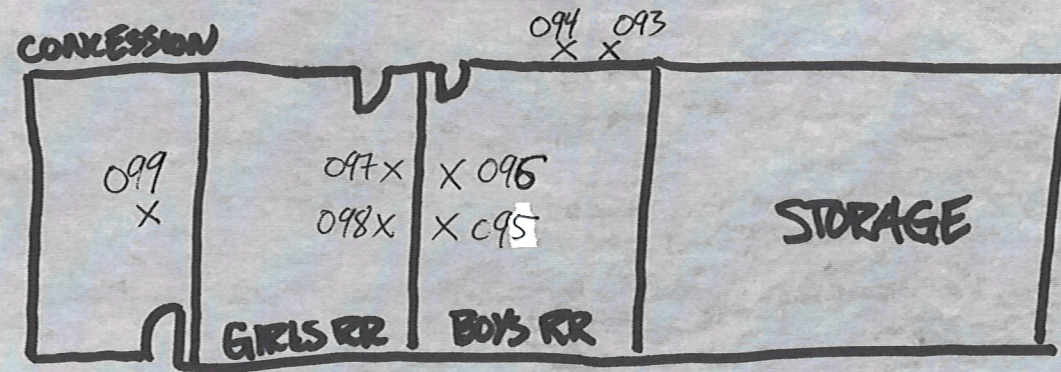

BUILDING BY SB FIELD

School
tion

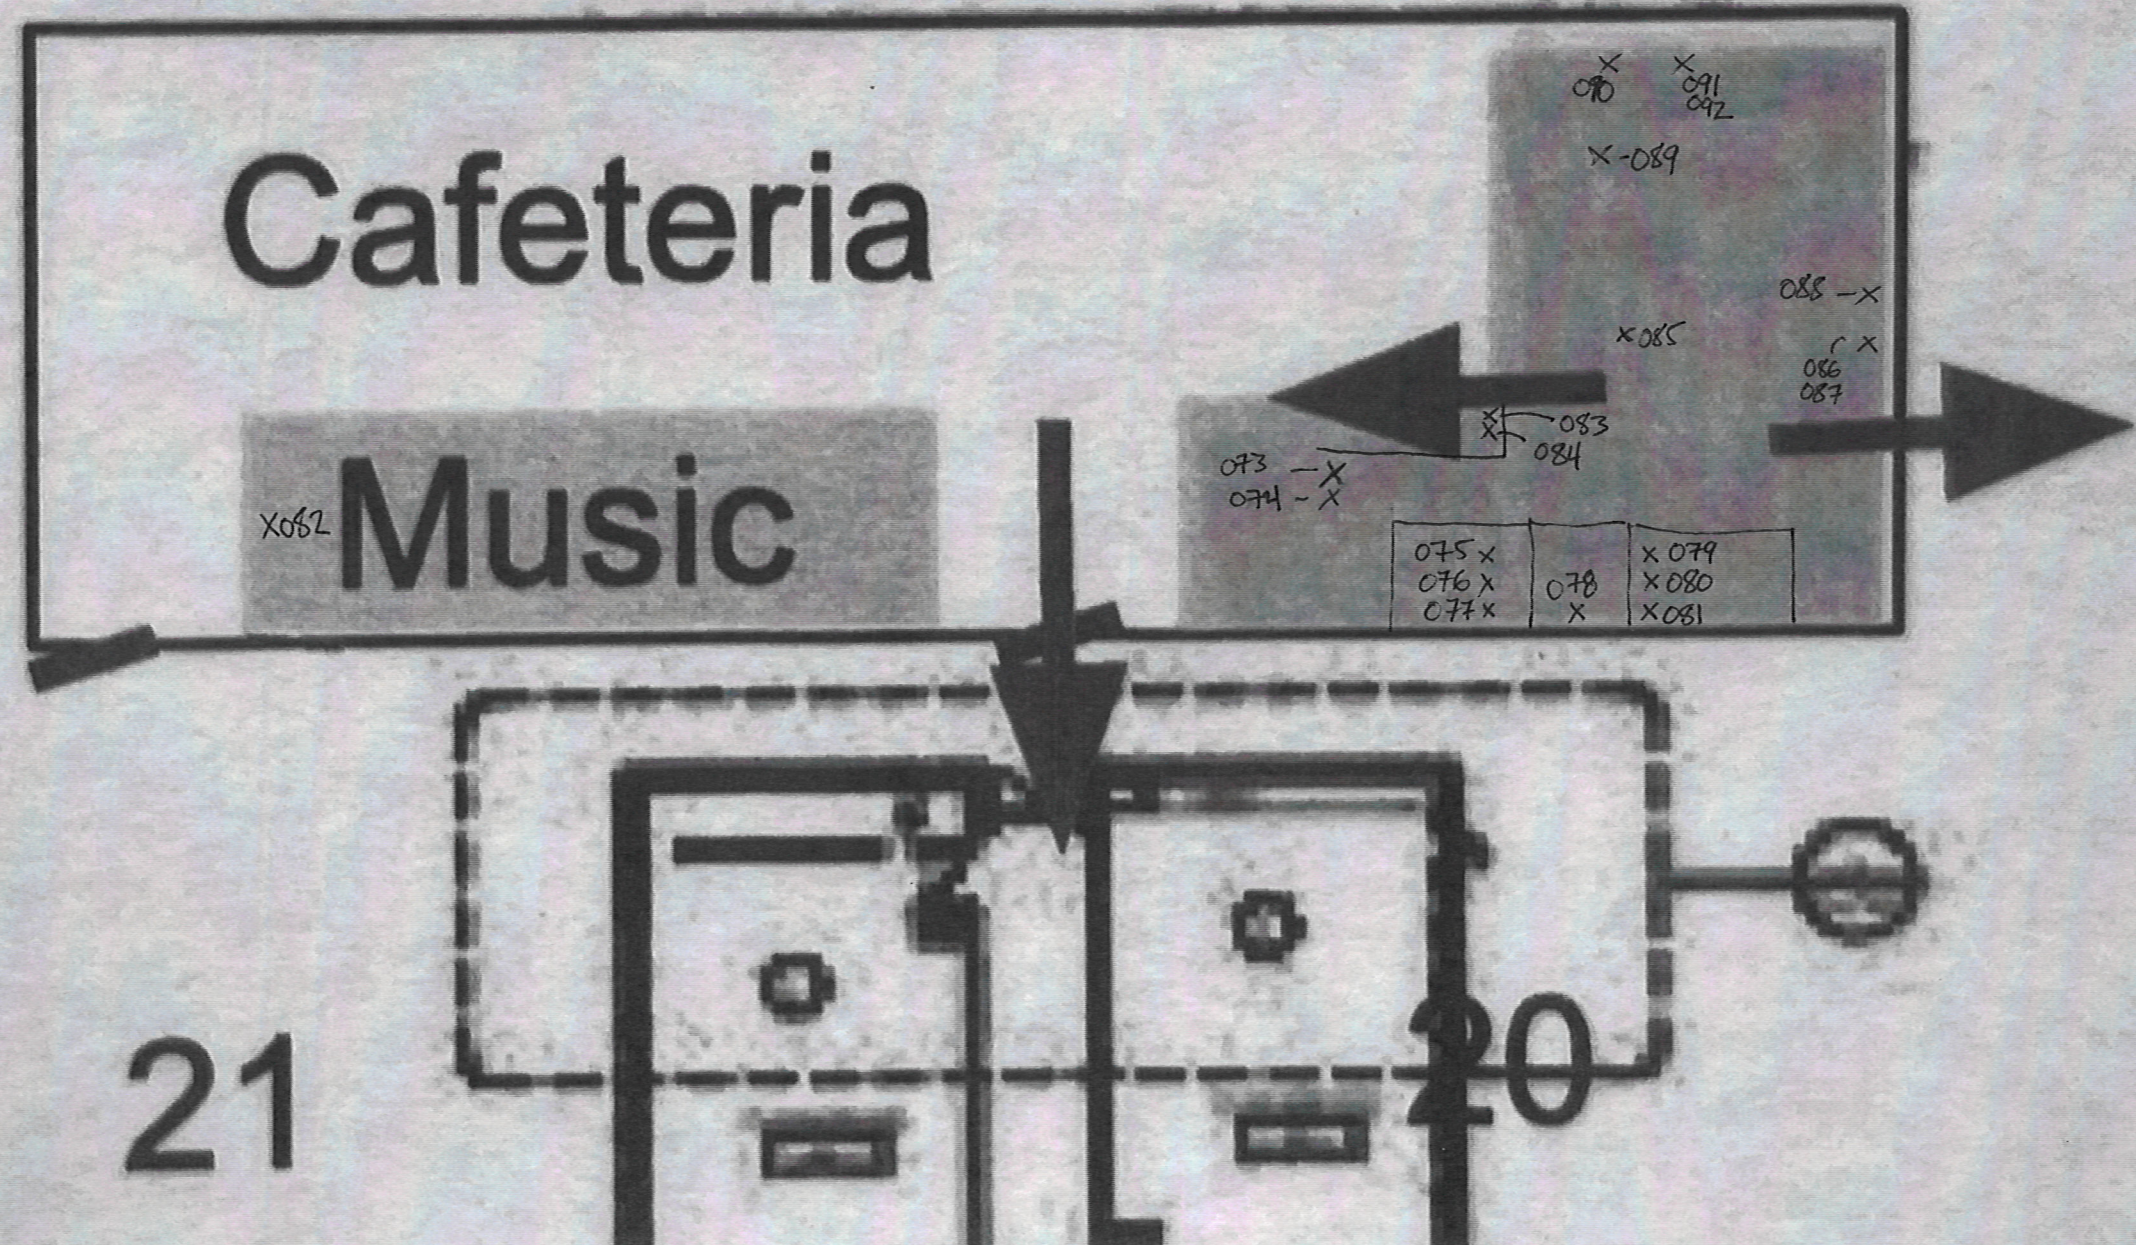



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

Monday, June 20, 2022

James Mastanduno
PBS Engineering and Environmental
4412 S Corbett Ave
Portland, OR 97239

RE: A2F0092 - Dayton School District - Dayton Grade School/27350.000 Phase 01

Thank you for using Apex Laboratories. We greatly appreciate your business and strive to provide the highest quality services to the environmental industry.

Enclosed are the results of analyses for work order A2F0092, which was received by the laboratory on 6/1/2022 at 12:49:00PM.

If you have any questions concerning this report or the services we offer, please feel free to contact me by email at: jwoodcock@apex-labs.com, or by phone at 503-718-2323.

Please note: All samples will be disposed of within 30 days of sample receipt, unless prior arrangements have been made.

Cooler Receipt Information

(See Cooler Receipt Form for details)

Cooler #1	21.1 degC
-----------	-----------

This Final Report is the official version of the data results for this sample submission, unless superseded by a subsequent, labeled amended report.

All other deliverables derived from this data, including Electronic Data Deliverables (EDDs), CLP-like forms, client requested summary sheets, and all other products are considered secondary to this report.



Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**PBS Engineering and Environmental**4412 S Corbett Ave
Portland, OR 97239Project: **Dayton School District**Project Number: **Dayton Grade School/27350**Project Manager: **James Mastanduno****Report ID:****A2F0092 - 06 20 22 1634****ANALYTICAL REPORT FOR SAMPLES****SAMPLE INFORMATION**

Client Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
22531211-001CF22A	A2F0092-01	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-001CF22B	A2F0092-02	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-002DW22A	A2F0092-03	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-002DW22B	A2F0092-04	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-003CF22A	A2F0092-05	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-003CF22B	A2F0092-06	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-004CF22A	A2F0092-07	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-004CF22B	A2F0092-08	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-005DW22A	A2F0092-09	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-005DW22B	A2F0092-10	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-006DW22A	A2F0092-11	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-006DW22B	A2F0092-12	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-007CF22A	A2F0092-13	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-007CF22B	A2F0092-14	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-008BF22A	A2F0092-15	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-008BF22B	A2F0092-16	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-009BF22A	A2F0092-17	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-009BF22B	A2F0092-18	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-010WB22A	A2F0092-19	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-010WB22B	A2F0092-20	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-011DW22A	A2F0092-21	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-011DW22B	A2F0092-22	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-012BF22A	A2F0092-23	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-012BF22B	A2F0092-24	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-013BF22A	A2F0092-25	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-013BF22B	A2F0092-26	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-014CF22A	A2F0092-27	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-014CF22B	A2F0092-28	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-015DW22A	A2F0092-29	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-015DW22B	A2F0092-30	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-016BF22A	A2F0092-31	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-016BF22B	A2F0092-32	Drinking Water	05/13/22 00:00	06/01/22 12:49

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**PBS Engineering and Environmental**4412 S Corbett Ave
Portland, OR 97239Project: **Dayton School District**Project Number: **Dayton Grade School/27350**Project Manager: **James Mastanduno****Report ID:****A2F0092 - 06 20 22 1634****ANALYTICAL REPORT FOR SAMPLES****SAMPLE INFORMATION**

Client Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
22531211-017BF22A	A2F0092-33	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-017BF22B	A2F0092-34	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-018BF22A	A2F0092-35	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-018BF22B	A2F0092-36	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-019BF22A	A2F0092-37	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-019BF22B	A2F0092-38	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-020WB22A	A2F0092-39	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-020WB22B	A2F0092-40	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-021DW22A	A2F0092-41	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-021DW22B	A2F0092-42	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-022CF22A	A2F0092-43	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-022CF22B	A2F0092-44	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-023DW22A	A2F0092-45	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-023DW22B	A2F0092-46	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-024CF22A	A2F0092-47	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-024CF22B	A2F0092-48	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-025CF22A	A2F0092-49	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-025CF22B	A2F0092-50	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-026BF22A	A2F0092-51	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-026BF22B	A2F0092-52	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-027CF22A	A2F0092-53	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-027CF22B	A2F0092-54	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-028BF22A	A2F0092-55	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-028BF22B	A2F0092-56	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-029BF22A	A2F0092-57	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-029BF22B	A2F0092-58	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-030BF22A	A2F0092-59	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-030BF22B	A2F0092-60	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-031SF22A	A2F0092-61	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-031SF22B	A2F0092-62	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-032BF22A	A2F0092-63	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-032BF22B	A2F0092-64	Drinking Water	05/13/22 00:00	06/01/22 12:49

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager

**ANALYTICAL REPORT****Apex Laboratories, LLC**

6700 S.W. Sandburg Street

Tigard, OR 97223

503-718-2323

ORELAP ID: OR100062

PBS Engineering and Environmental

4412 S Corbett Ave

Portland, OR 97239

Project: **Dayton School District**Project Number: **Dayton Grade School/27350**Project Manager: **James Mastanduno****Report ID:****A2F0092 - 06 20 22 1634****ANALYTICAL REPORT FOR SAMPLES****SAMPLE INFORMATION**

Client Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
22531211-033BF22A	A2F0092-65	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-033BF22B	A2F0092-66	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-034DW22A	A2F0092-67	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-034DW22B	A2F0092-68	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-035DW22A	A2F0092-69	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-035DW22B	A2F0092-70	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-036CF22A	A2F0092-71	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-036CF22B	A2F0092-72	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-037DW22A	A2F0092-73	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-037DW22B	A2F0092-74	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-038BF22A	A2F0092-75	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-038BF22B	A2F0092-76	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-039BF22A	A2F0092-77	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-039BF22B	A2F0092-78	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-040CF22A	A2F0092-79	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-040CF22B	A2F0092-80	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-041DW22A	A2F0092-81	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-041DW22B	A2F0092-82	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-042CF22A	A2F0092-83	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-042CF22B	A2F0092-84	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-043DW22A	A2F0092-85	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-043DW22B	A2F0092-86	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-044CF22A	A2F0092-87	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-044CF22B	A2F0092-88	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-045DW22A	A2F0092-89	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-045DW22B	A2F0092-90	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-046CF22A	A2F0092-91	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-046CF22B	A2F0092-92	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-047DW22A	A2F0092-93	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-047DW22B	A2F0092-94	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-048WB22A	A2F0092-95	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-048WB22B	A2F0092-96	Drinking Water	05/13/22 00:00	06/01/22 12:49

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**PBS Engineering and Environmental**4412 S Corbett Ave
Portland, OR 97239Project: **Dayton School District**Project Number: **Dayton Grade School/27350**
Project Manager: **James Mastanduno****Report ID:****A2F0092 - 06 20 22 1634****ANALYTICAL REPORT FOR SAMPLES****SAMPLE INFORMATION**

Client Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
22531211-049DW22A	A2F0092-97	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-049DW22B	A2F0092-98	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-050CF22A	A2F0092-99	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-050CF22B	A2F0092-AA	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-051DW22A	A2F0092-AB	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-051DW22B	A2F0092-AC	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-052NS22A	A2F0092-AD	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-052NS22B	A2F0092-AE	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-053CF22A	A2F0092-AF	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-053CF22B	A2F0092-AG	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-054DW22A	A2F0092-AH	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-054DW22B	A2F0092-AI	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-055BF22A	A2F0092-AJ	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-055BF22B	A2F0092-AK	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-056BF22A	A2F0092-AL	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-056BF22B	A2F0092-AM	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-057BF22A	A2F0092-AN	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-057BF22B	A2F0092-AO	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-058BF22A	A2F0092-AP	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-058BF22B	A2F0092-AQ	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-059SF22A	A2F0092-AR	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-059SF22B	A2F0092-AS	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-060WB22A	A2F0092-AT	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-060WB22B	A2F0092-AU	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-061DW22A	A2F0092-AV	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-061DW22B	A2F0092-AW	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-062CF22A	A2F0092-AX	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-062CF22B	A2F0092-AY	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-063DW22A	A2F0092-AZ	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-063DW22B	A2F0092-BA	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-064CF22A	A2F0092-BB	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-064CF22B	A2F0092-BC	Drinking Water	05/13/22 00:00	06/01/22 12:49

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**PBS Engineering and Environmental**4412 S Corbett Ave
Portland, OR 97239Project: **Dayton School District**Project Number: **Dayton Grade School/27350**
Project Manager: **James Mastanduno****Report ID:****A2F0092 - 06 20 22 1634****ANALYTICAL REPORT FOR SAMPLES****SAMPLE INFORMATION**

Client Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
22531211-065DW22A	A2F0092-BD	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-065DW22B	A2F0092-BE	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-066CF22A	A2F0092-BF	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-066CF22B	A2F0092-BG	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-067DW22A	A2F0092-BH	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-067DW22B	A2F0092-BI	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-068CF22A	A2F0092-BJ	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-068CF22B	A2F0092-BK	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-069DW22A	A2F0092-BL	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-069DW22B	A2F0092-BM	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-070CF22A	A2F0092-BN	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-070CF22B	A2F0092-BO	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-071CF22A	A2F0092-BP	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-071CF22B	A2F0092-BQ	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-072DW22A	A2F0092-BR	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-072DW22B	A2F0092-BS	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-073DW22A	A2F0092-BT	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-073DW22B	A2F0092-BU	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-074DW22A	A2F0092-BV	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-074DW22B	A2F0092-BW	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-075BF22A	A2F0092-BX	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-075BF22B	A2F0092-BY	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-076BF22A	A2F0092-BZ	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-076BF22B	A2F0092-CA	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-077BF22A	A2F0092-CB	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-077BF22B	A2F0092-CC	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-078BF22A	A2F0092-CD	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-078BF22B	A2F0092-CE	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-079BF22A	A2F0092-CF	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-079BF22B	A2F0092-CG	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-080BF22A	A2F0092-CH	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-080BF22B	A2F0092-CI	Drinking Water	05/13/22 00:00	06/01/22 12:49

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**PBS Engineering and Environmental**4412 S Corbett Ave
Portland, OR 97239Project: **Dayton School District**Project Number: **Dayton Grade School/27350**
Project Manager: **James Mastanduno****Report ID:****A2F0092 - 06 20 22 1634****ANALYTICAL REPORT FOR SAMPLES****SAMPLE INFORMATION**

Client Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
22531211-081BF22A	A2F0092-CJ	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-081BF22B	A2F0092-CK	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-082CF22A	A2F0092-CL	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-082CF22B	A2F0092-CM	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-083BF22A	A2F0092-CN	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-083BF22B	A2F0092-CO	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-084BF22A	A2F0092-CP	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-084BF22B	A2F0092-CQ	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-085KF22A	A2F0092-CR	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-085KF22B	A2F0092-CS	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-086KF22A	A2F0092-CT	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-086KF22B	A2F0092-CU	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-087KF22A	A2F0092-CV	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-087KF22B	A2F0092-CW	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-088KF22A	A2F0092-CX	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-088KF22B	A2F0092-CY	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-089KF22A	A2F0092-CZ	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-089KF22B	A2F0092-DA	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-090KF22A	A2F0092-DB	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-090KF22B	A2F0092-DC	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-091KF22A	A2F0092-DD	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-091KF22B	A2F0092-DE	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-092KF22A	A2F0092-DF	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-092KF22B	A2F0092-DG	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-093DW22A	A2F0092-DH	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-093DW22B	A2F0092-DI	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-094DW22A	A2F0092-DJ	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-094DW22B	A2F0092-DK	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-095BF22A	A2F0092-DL	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-095BF22B	A2F0092-DM	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-096BF22A	A2F0092-DN	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-096BF22B	A2F0092-DO	Drinking Water	05/13/22 00:00	06/01/22 12:49

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street

Tigard, OR 97223

503-718-2323

ORELAP ID: OR100062

PBS Engineering and Environmental

4412 S Corbett Ave

Portland, OR 97239

Project: **Dayton School District**

Project Number: **Dayton Grade School/27350**

Project Manager: **James Mastanduno**

Report ID:

A2F0092 - 06 20 22 1634

ANALYTICAL REPORT FOR SAMPLES

SAMPLE INFORMATION

Client Sample ID	Laboratory ID	Matrix	Date Sampled	Date Received
22531211-097BF22A	A2F0092-DP	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-097BF22B	A2F0092-DQ	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-098BF22A	A2F0092-DR	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-098BF22B	A2F0092-DS	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-099SF22A	A2F0092-DT	Drinking Water	05/13/22 00:00	06/01/22 12:49
22531211-099SF22B	A2F0092-DU	Drinking Water	05/13/22 00:00	06/01/22 12:49

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**PBS Engineering and Environmental**
4412 S Corbett Ave
Portland, OR 97239Project: **Dayton School District**
Project Number: **Dayton Grade School/27350**
Project Manager: **James Mastanduno****Report ID:**
A2F0092 - 06 20 22 1634**ANALYTICAL SAMPLE RESULTS****Total Metals in Drinking Water by EPA 200.8 (ICPMS)**

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22531211-001CF22A (A2F0092-01)				Matrix: Drinking Water				
Batch: 22F0257								
Lead	6.49	---	0.200	ug/L	1	06/07/22 19:35	EPA 200.8	
22531211-002DW22A (A2F0092-03)				Matrix: Drinking Water				
Batch: 22F0257								
Lead	7.43	---	0.200	ug/L	1	06/07/22 19:55	EPA 200.8	
22531211-003CF22A (A2F0092-05)				Matrix: Drinking Water				
Batch: 22F0257								
Lead	22.9	---	0.200	ug/L	1	06/07/22 19:59	EPA 200.8	
22531211-003CF22B (A2F0092-06)				Matrix: Drinking Water				
Batch: 22F0668								
Lead	2.39	---	0.200	ug/L	1	06/17/22 18:29	EPA 200.8	
22531211-004CF22A (A2F0092-07)				Matrix: Drinking Water				
Batch: 22F0257								
Lead	0.767	---	0.200	ug/L	1	06/07/22 20:04	EPA 200.8	
22531211-005DW22A (A2F0092-09)				Matrix: Drinking Water				
Batch: 22F0257								
Lead	2.55	---	0.200	ug/L	1	06/07/22 20:07	EPA 200.8	
22531211-006DW22A (A2F0092-11)				Matrix: Drinking Water				
Batch: 22F0257								
Lead	3.00	---	0.200	ug/L	1	06/07/22 20:11	EPA 200.8	
22531211-007CF22A (A2F0092-13)				Matrix: Drinking Water				
Batch: 22F0257								
Lead	29.4	---	0.200	ug/L	1	06/07/22 20:15	EPA 200.8	
22531211-007CF22B (A2F0092-14)				Matrix: Drinking Water				
Batch: 22F0668								
Lead	22.3	---	0.200	ug/L	1	06/17/22 18:49	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street

Tigard, OR 97223

503-718-2323

ORELAP ID: OR100062

PBS Engineering and Environmental

4412 S Corbett Ave

Portland, OR 97239

Project: Dayton School District

Project Number: Dayton Grade School/27350

Project Manager: James Mastanduno

Report ID:

A2F0092 - 06 20 22 1634

ANALYTICAL SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22531211-008BF22A (A2F0092-15)				Matrix: Drinking Water				
Batch: 22F0257								
Lead	12.8	---	0.200	ug/L	1	06/07/22 20:19	EPA 200.8	
22531211-009BF22A (A2F0092-17)				Matrix: Drinking Water				
Batch: 22F0257								
Lead	9.79	---	0.200	ug/L	1	06/07/22 20:24	EPA 200.8	
22531211-010WB22A (A2F0092-19)				Matrix: Drinking Water				
Batch: 22F0257								
Lead	ND	---	0.200	ug/L	1	06/07/22 20:36	EPA 200.8	
22531211-011DW22A (A2F0092-21)				Matrix: Drinking Water				
Batch: 22F0257								
Lead	ND	---	0.200	ug/L	1	06/07/22 20:39	EPA 200.8	
22531211-012BF22A (A2F0092-23)				Matrix: Drinking Water				
Batch: 22F0257								
Lead	10.1	---	0.200	ug/L	1	06/07/22 20:42	EPA 200.8	
22531211-013BF22A (A2F0092-25)				Matrix: Drinking Water				
Batch: 22F0257								
Lead	13.7	---	0.200	ug/L	1	06/07/22 20:46	EPA 200.8	
22531211-014CF22A (A2F0092-27)				Matrix: Drinking Water				
Batch: 22F0257								
Lead	10.6	---	0.200	ug/L	1	06/07/22 20:51	EPA 200.8	
22531211-015DW22A (A2F0092-29)				Matrix: Drinking Water				
Batch: 22F0257								
Lead	5.87	---	0.200	ug/L	1	06/07/22 20:55	EPA 200.8	
22531211-016BF22A (A2F0092-31)				Matrix: Drinking Water				
Batch: 22F0257								
Lead	21.1	---	0.200	ug/L	1	06/07/22 20:59	EPA 200.8	

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062PBS Engineering and Environmental
4412 S Corbett Ave
Portland, OR 97239Project: Dayton School District
Project Number: Dayton Grade School/27350
Project Manager: James MastandunoReport ID:
A2F0092 - 06 20 22 1634

ANALYTICAL SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22531211-016BF22B (A2F0092-32)				Matrix: Drinking Water				
Batch: 22F0668								
Lead	4.02	---	0.200	ug/L	1	06/17/22 18:53	EPA 200.8	
22531211-017BF22A (A2F0092-33)				Matrix: Drinking Water				
Batch: 22F0257								
Lead	1.50	---	0.200	ug/L	1	06/07/22 21:03	EPA 200.8	
22531211-018BF22A (A2F0092-35)				Matrix: Drinking Water				
Batch: 22F0257								
Lead	0.783	---	0.200	ug/L	1	06/07/22 21:07	EPA 200.8	
22531211-019BF22A (A2F0092-37)				Matrix: Drinking Water				
Batch: 22F0257								
Lead	1.63	---	0.200	ug/L	1	06/07/22 21:10	EPA 200.8	
22531211-020WB22A (A2F0092-39)				Matrix: Drinking Water				
Batch: 22F0257								
Lead	ND	---	0.200	ug/L	1	06/07/22 21:22	EPA 200.8	
22531211-021DW22A (A2F0092-41)				Matrix: Drinking Water				
Batch: 22F0264								
Lead	ND	---	0.200	ug/L	1	06/08/22 14:27	EPA 200.8	
22531211-022CF22A (A2F0092-43)				Matrix: Drinking Water				
Batch: 22F0264								
Lead	10.7	---	0.200	ug/L	1	06/08/22 14:38	EPA 200.8	
22531211-023DW22A (A2F0092-45)				Matrix: Drinking Water				
Batch: 22F0264								
Lead	4.66	---	0.200	ug/L	1	06/08/22 14:42	EPA 200.8	
22531211-024CF22A (A2F0092-47)				Matrix: Drinking Water				
Batch: 22F0264								
Lead	25.0	---	0.200	ug/L	1	06/08/22 14:47	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

**ANALYTICAL REPORT****Apex Laboratories, LLC**

6700 S.W. Sandburg Street

Tigard, OR 97223

503-718-2323

ORELAP ID: OR100062

PBS Engineering and Environmental

4412 S Corbett Ave

Portland, OR 97239

Project: **Dayton School District**Project Number: **Dayton Grade School/27350**Project Manager: **James Mastanduno****Report ID:****A2F0092 - 06 20 22 1634****ANALYTICAL SAMPLE RESULTS****Total Metals in Drinking Water by EPA 200.8 (ICPMS)**

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22531211-024CF22B (A2F0092-48)				Matrix: Drinking Water				
Batch: 22F0668								
Lead	1.00	---	0.200	ug/L	1	06/17/22 18:57	EPA 200.8	
22531211-025CF22A (A2F0092-49)				Matrix: Drinking Water				
Batch: 22F0264								
Lead	2.96	---	0.200	ug/L	1	06/08/22 14:51	EPA 200.8	
22531211-026BF22A (A2F0092-51)				Matrix: Drinking Water				
Batch: 22F0264								
Lead	1.45	---	0.200	ug/L	1	06/08/22 14:55	EPA 200.8	
22531211-027CF22A (A2F0092-53)				Matrix: Drinking Water				
Batch: 22F0264								
Lead	2.52	---	0.200	ug/L	1	06/08/22 15:07	EPA 200.8	
22531211-028BF22A (A2F0092-55)				Matrix: Drinking Water				
Batch: 22F0264								
Lead	1.39	---	0.200	ug/L	1	06/08/22 15:11	EPA 200.8	
22531211-029BF22A (A2F0092-57)				Matrix: Drinking Water				
Batch: 22F0264								
Lead	0.998	---	0.200	ug/L	1	06/08/22 15:15	EPA 200.8	
22531211-030BF22A (A2F0092-59)				Matrix: Drinking Water				
Batch: 22F0264								
Lead	1.10	---	0.200	ug/L	1	06/08/22 15:19	EPA 200.8	
22531211-031SF22A (A2F0092-61)				Matrix: Drinking Water				
Batch: 22F0264								
Lead	3.39	---	0.200	ug/L	1	06/08/22 15:23	EPA 200.8	
22531211-032BF22A (A2F0092-63)				Matrix: Drinking Water				
Batch: 22F0264								
Lead	9.69	---	0.200	ug/L	1	06/08/22 15:29	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street

Tigard, OR 97223

503-718-2323

ORELAP ID: OR100062

PBS Engineering and Environmental

4412 S Corbett Ave

Portland, OR 97239

Project: Dayton School District

Project Number: Dayton Grade School/27350

Project Manager: James Mastanduno

Report ID:

A2F0092 - 06 20 22 1634

ANALYTICAL SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22531211-033BF22A (A2F0092-65)				Matrix: Drinking Water				
Batch: 22F0264								
Lead	5.23	---	0.200	ug/L	1	06/08/22 19:10	EPA 200.8	
22531211-034DW22A (A2F0092-67)				Matrix: Drinking Water				
Batch: 22F0264								
Lead	5.09	---	0.200	ug/L	1	06/08/22 19:14	EPA 200.8	
22531211-035DW22A (A2F0092-69)				Matrix: Drinking Water				
Batch: 22F0264								
Lead	1.59	---	0.200	ug/L	1	06/08/22 19:18	EPA 200.8	
22531211-036CF22A (A2F0092-71)				Matrix: Drinking Water				
Batch: 22F0264								
Lead	6.44	---	0.200	ug/L	1	06/08/22 19:22	EPA 200.8	
22531211-037DW22A (A2F0092-73)				Matrix: Drinking Water				
Batch: 22F0264								
Lead	0.354	---	0.200	ug/L	1	06/08/22 19:26	EPA 200.8	
22531211-038BF22A (A2F0092-75)				Matrix: Drinking Water				
Batch: 22F0264								
Lead	10.6	---	0.200	ug/L	1	06/08/22 19:29	EPA 200.8	
22531211-039BF22A (A2F0092-77)				Matrix: Drinking Water				
Batch: 22F0264								
Lead	5.92	---	0.200	ug/L	1	06/08/22 19:33	EPA 200.8	
22531211-040CF22A (A2F0092-79)				Matrix: Drinking Water				
Batch: 22F0264								
Lead	10.6	---	0.200	ug/L	1	06/08/22 19:38	EPA 200.8	
22531211-041DW22A (A2F0092-81)				Matrix: Drinking Water				
Batch: 22F0272								
Lead	4.29	---	0.200	ug/L	1	06/08/22 20:01	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street

Tigard, OR 97223

503-718-2323

ORELAP ID: OR100062

PBS Engineering and Environmental

4412 S Corbett Ave

Portland, OR 97239

Project: Dayton School District

Project Number: Dayton Grade School/27350

Project Manager: James Mastanduno

Report ID:

A2F0092 - 06 20 22 1634

ANALYTICAL SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22531211-042CF22A (A2F0092-83)				Matrix: Drinking Water				
Batch: 22F0272								
Lead	6.24	---	0.200	ug/L	1	06/08/22 20:14	EPA 200.8	
22531211-043DW22A (A2F0092-85)				Matrix: Drinking Water				
Batch: 22F0272								
Lead	18.3	---	0.200	ug/L	1	06/08/22 20:18	EPA 200.8	
22531211-043DW22B (A2F0092-86)				Matrix: Drinking Water				
Batch: 22F0668								
Lead	3.51	---	0.200	ug/L	1	06/17/22 19:01	EPA 200.8	
22531211-044CF22A (A2F0092-87)				Matrix: Drinking Water				
Batch: 22F0272								
Lead	68.2	---	0.200	ug/L	1	06/08/22 20:22	EPA 200.8	
22531211-044CF22B (A2F0092-88)				Matrix: Drinking Water				
Batch: 22F0668								
Lead	6.91	---	0.200	ug/L	1	06/17/22 19:05	EPA 200.8	
22531211-045DW22A (A2F0092-89)				Matrix: Drinking Water				
Batch: 22F0272								
Lead	8.71	---	0.200	ug/L	1	06/08/22 20:27	EPA 200.8	
22531211-046CF22A (A2F0092-91)				Matrix: Drinking Water				
Batch: 22F0272								
Lead	15.7	---	0.200	ug/L	1	06/08/22 20:31	EPA 200.8	
22531211-046CF22B (A2F0092-92)				Matrix: Drinking Water				
Batch: 22F0668								
Lead	12.8	---	0.200	ug/L	1	06/17/22 19:09	EPA 200.8	
22531211-047DW22A (A2F0092-93)				Matrix: Drinking Water				
Batch: 22F0272								
Lead	8.27	---	0.200	ug/L	1	06/08/22 20:35	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street

Tigard, OR 97223

503-718-2323

ORELAP ID: OR100062

PBS Engineering and Environmental

4412 S Corbett Ave

Portland, OR 97239

Project: Dayton School District

Project Number: Dayton Grade School/27350

Project Manager: James Mastanduno

Report ID:

A2F0092 - 06 20 22 1634

ANALYTICAL SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22531211-048WB22A (A2F0092-95)				Matrix: Drinking Water				
Batch: 22F0272								
Lead	ND	---	0.200	ug/L	1	06/08/22 20:47	EPA 200.8	
22531211-049DW22A (A2F0092-97)				Matrix: Drinking Water				
Batch: 22F0272								
Lead	ND	---	0.200	ug/L	1	06/08/22 20:50	EPA 200.8	
22531211-050CF22A (A2F0092-99)				Matrix: Drinking Water				
Batch: 22F0272								
Lead	17.4	---	0.200	ug/L	1	06/08/22 20:54	EPA 200.8	
22531211-050CF22B (A2F0092-AA)				Matrix: Drinking Water				
Batch: 22F0668								
Lead	8.82	---	0.200	ug/L	1	06/17/22 19:13	EPA 200.8	
22531211-051DW22A (A2F0092-AB)				Matrix: Drinking Water				
Batch: 22F0328								
Lead	7.26	---	0.200	ug/L	1	06/10/22 22:26	EPA 200.8	DW-D
22531211-052NS22A (A2F0092-AD)				Matrix: Drinking Water				
Batch: 22F0272								
Lead	1.14	---	0.200	ug/L	1	06/08/22 20:58	EPA 200.8	
22531211-053CF22A (A2F0092-AF)				Matrix: Drinking Water				
Batch: 22F0272								
Lead	6.77	---	0.200	ug/L	1	06/08/22 21:02	EPA 200.8	
22531211-054DW22A (A2F0092-AH)				Matrix: Drinking Water				
Batch: 22F0272								
Lead	2.61	---	0.200	ug/L	1	06/08/22 21:06	EPA 200.8	
22531211-055BF22A (A2F0092-AJ)				Matrix: Drinking Water				
Batch: 22F0272								
Lead	0.923	---	0.200	ug/L	1	06/08/22 21:10	EPA 200.8	

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**PBS Engineering and Environmental**
4412 S Corbett Ave
Portland, OR 97239Project: **Dayton School District**
Project Number: **Dayton Grade School/27350**
Project Manager: **James Mastanduno****Report ID:**
A2F0092 - 06 20 22 1634**ANALYTICAL SAMPLE RESULTS****Total Metals in Drinking Water by EPA 200.8 (ICPMS)**

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22531211-056BF22A (A2F0092-AL)				Matrix: Drinking Water				
Batch: 22F0272								
Lead	1.01	---	0.200	ug/L	1	06/08/22 21:14	EPA 200.8	
22531211-057BF22A (A2F0092-AN)				Matrix: Drinking Water				
Batch: 22F0272								
Lead	1.15	---	0.200	ug/L	1	06/08/22 21:18	EPA 200.8	
22531211-058BF22A (A2F0092-AP)				Matrix: Drinking Water				
Batch: 22F0272								
Lead	3.54	---	0.200	ug/L	1	06/08/22 21:22	EPA 200.8	
22531211-059SF22A (A2F0092-AR)				Matrix: Drinking Water				
Batch: 22F0272								
Lead	2.45	---	0.200	ug/L	1	06/08/22 21:34	EPA 200.8	
22531211-060WB22A (A2F0092-AT)				Matrix: Drinking Water				
Batch: 22F0272								
Lead	ND	---	0.200	ug/L	1	06/08/22 21:38	EPA 200.8	
22531211-061DW22A (A2F0092-AV)				Matrix: Drinking Water				
Batch: 22F0289								
Lead	ND	---	0.200	ug/L	1	06/08/22 21:53	EPA 200.8	
22531211-062CF22A (A2F0092-AX)				Matrix: Drinking Water				
Batch: 22F0289								
Lead	68.3	---	0.200	ug/L	1	06/08/22 22:04	EPA 200.8	
22531211-062CF22B (A2F0092-AY)				Matrix: Drinking Water				
Batch: 22F0668								
Lead	3.77	---	0.200	ug/L	1	06/17/22 19:17	EPA 200.8	
22531211-063DW22A (A2F0092-AZ)				Matrix: Drinking Water				
Batch: 22F0289								
Lead	24.8	---	0.200	ug/L	1	06/08/22 22:09	EPA 200.8	

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street

Tigard, OR 97223

503-718-2323

ORELAP ID: OR100062

PBS Engineering and Environmental

4412 S Corbett Ave

Portland, OR 97239

Project: Dayton School District

Project Number: Dayton Grade School/27350

Project Manager: James Mastanduno

Report ID:

A2F0092 - 06 20 22 1634

ANALYTICAL SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22531211-063DW22B (A2F0092-BA)				Matrix: Drinking Water				
Batch: 22F0668								
Lead	19.4	---	0.200	ug/L	1	06/17/22 19:21	EPA 200.8	
22531211-064CF22A (A2F0092-BB)				Matrix: Drinking Water				
Batch: 22F0289								
Lead	75.3	---	0.200	ug/L	1	06/08/22 22:21	EPA 200.8	
22531211-064CF22B (A2F0092-BC)				Matrix: Drinking Water				
Batch: 22F0668								
Lead	1.03	---	0.200	ug/L	1	06/17/22 19:26	EPA 200.8	
22531211-065DW22A (A2F0092-BD)				Matrix: Drinking Water				
Batch: 22F0289								
Lead	12.3	---	0.200	ug/L	1	06/08/22 22:25	EPA 200.8	
22531211-065DW22B (A2F0092-BE)				Matrix: Drinking Water				
Batch: 22F0668								
Lead	3.39	---	0.200	ug/L	1	06/17/22 19:37	EPA 200.8	
22531211-066CF22A (A2F0092-BF)				Matrix: Drinking Water				
Batch: 22F0289								
Lead	61.0	---	0.200	ug/L	1	06/08/22 22:29	EPA 200.8	
22531211-066CF22B (A2F0092-BG)				Matrix: Drinking Water				
Batch: 22F0668								
Lead	9.47	---	0.200	ug/L	1	06/17/22 19:41	EPA 200.8	
22531211-067DW22A (A2F0092-BH)				Matrix: Drinking Water				
Batch: 22F0289								
Lead	14.9	---	0.200	ug/L	1	06/08/22 22:34	EPA 200.8	
22531211-067DW22B (A2F0092-BI)				Matrix: Drinking Water				
Batch: 22F0668								
Lead	9.47	---	0.200	ug/L	1	06/17/22 19:45	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**PBS Engineering and Environmental**
4412 S Corbett Ave
Portland, OR 97239Project: **Dayton School District**
Project Number: **Dayton Grade School/27350**
Project Manager: **James Mastanduno****Report ID:**
A2F0092 - 06 20 22 1634**ANALYTICAL SAMPLE RESULTS****Total Metals in Drinking Water by EPA 200.8 (ICPMS)**

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22531211-068CF22A (A2F0092-BJRE1)				Matrix: Drinking Water				
Batch: 22F0289								
Lead	111	---	2.00	ug/L	10	06/09/22 14:42	EPA 200.8	
22531211-068CF22B (A2F0092-BK)				Matrix: Drinking Water				
Batch: 22F0668								
Lead	1.19	---	0.200	ug/L	1	06/17/22 19:50	EPA 200.8	
22531211-069DW22A (A2F0092-BL)				Matrix: Drinking Water				
Batch: 22F0289								
Lead	19.8	---	0.200	ug/L	1	06/08/22 22:42	EPA 200.8	
22531211-069DW22B (A2F0092-BM)				Matrix: Drinking Water				
Batch: 22F0668								
Lead	2.00	---	0.200	ug/L	1	06/17/22 19:54	EPA 200.8	
22531211-070CF22A (A2F0092-BN)				Matrix: Drinking Water				
Batch: 22F0289								
Lead	13.1	---	0.200	ug/L	1	06/08/22 22:47	EPA 200.8	
22531211-070CF22B (A2F0092-BO)				Matrix: Drinking Water				
Batch: 22F0668								
Lead	4.66	---	0.200	ug/L	1	06/17/22 19:58	EPA 200.8	
22531211-071CF22A (A2F0092-BPRE1)				Matrix: Drinking Water				
Batch: 22F0289								
Lead	104	---	2.00	ug/L	10	06/09/22 14:46	EPA 200.8	
22531211-072DW22A (A2F0092-BR)				Matrix: Drinking Water				
Batch: 22F0289								
Lead	7.15	---	0.200	ug/L	1	06/08/22 22:55	EPA 200.8	
22531211-073DW22A (A2F0092-BT)				Matrix: Drinking Water				
Batch: 22F0289								
Lead	2.48	---	0.200	ug/L	1	06/08/22 22:59	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street

Tigard, OR 97223

503-718-2323

ORELAP ID: OR100062

PBS Engineering and Environmental

4412 S Corbett Ave

Portland, OR 97239

Project: Dayton School District

Project Number: Dayton Grade School/27350

Project Manager: James Mastanduno

Report ID:

A2F0092 - 06 20 22 1634

ANALYTICAL SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22531211-074DW22A (A2F0092-BV)				Matrix: Drinking Water				
Batch: 22F0289								
Lead	2.67	---	0.200	ug/L	1	06/08/22 23:11	EPA 200.8	
22531211-075BF22A (A2F0092-BX)				Matrix: Drinking Water				
Batch: 22F0289								
Lead	5.87	---	0.200	ug/L	1	06/08/22 23:15	EPA 200.8	
22531211-076BF22A (A2F0092-BZ)				Matrix: Drinking Water				
Batch: 22F0289								
Lead	3.07	---	0.200	ug/L	1	06/08/22 23:20	EPA 200.8	
22531211-077BF22A (A2F0092-CB)				Matrix: Drinking Water				
Batch: 22F0289								
Lead	2.65	---	0.200	ug/L	1	06/08/22 23:24	EPA 200.8	
22531211-078BF22A (A2F0092-CD)				Matrix: Drinking Water				
Batch: 22F0289								
Lead	12.6	---	0.200	ug/L	1	06/08/22 23:28	EPA 200.8	
22531211-079BF22A (A2F0092-CF)				Matrix: Drinking Water				
Batch: 22F0289								
Lead	8.37	---	0.200	ug/L	1	06/08/22 23:32	EPA 200.8	
22531211-080BF22A (A2F0092-CH)				Matrix: Drinking Water				
Batch: 22F0289								
Lead	4.35	---	0.200	ug/L	1	06/08/22 23:36	EPA 200.8	
22531211-081BF22A (A2F0092-CJ)				Matrix: Drinking Water				
Batch: 22F0300								
Lead	4.21	---	0.200	ug/L	1	06/09/22 00:00	EPA 200.8	
22531211-082CF22A (A2F0092-CL)				Matrix: Drinking Water				
Batch: 22F0300								
Lead	3.90	---	0.200	ug/L	1	06/09/22 00:12	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street

Tigard, OR 97223

503-718-2323

ORELAP ID: OR100062

PBS Engineering and Environmental

4412 S Corbett Ave

Portland, OR 97239

Project: Dayton School District

Project Number: Dayton Grade School/27350

Project Manager: James Mastanduno

Report ID:

A2F0092 - 06 20 22 1634

ANALYTICAL SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22531211-083BF22A (A2F0092-CN)				Matrix: Drinking Water				
Batch: 22F0300								
Lead	9.47	---	0.200	ug/L	1	06/09/22 00:17	EPA 200.8	
22531211-084BF22A (A2F0092-CP)				Matrix: Drinking Water				
Batch: 22F0300								
Lead	2.23	---	0.200	ug/L	1	06/09/22 00:21	EPA 200.8	
22531211-085KF22A (A2F0092-CR)				Matrix: Drinking Water				
Batch: 22F0300								
Lead	8.09	---	0.200	ug/L	1	06/09/22 00:25	EPA 200.8	
22531211-086KF22A (A2F0092-CT)				Matrix: Drinking Water				
Batch: 22F0300								
Lead	3.89	---	0.200	ug/L	1	06/09/22 00:29	EPA 200.8	
22531211-087KF22A (A2F0092-CV)				Matrix: Drinking Water				
Batch: 22F0300								
Lead	3.86	---	0.200	ug/L	1	06/09/22 00:33	EPA 200.8	
22531211-088KF22A (A2F0092-CX)				Matrix: Drinking Water				
Batch: 22F0300								
Lead	17.4	---	0.200	ug/L	1	06/09/22 00:37	EPA 200.8	
22531211-088KF22B (A2F0092-CY)				Matrix: Drinking Water				
Batch: 22F0668								
Lead	2.73	---	0.200	ug/L	1	06/17/22 20:02	EPA 200.8	
22531211-089KF22A (A2F0092-CZ)				Matrix: Drinking Water				
Batch: 22F0300								
Lead	9.91	---	0.200	ug/L	1	06/09/22 00:49	EPA 200.8	
22531211-090KF22A (A2F0092-DB)				Matrix: Drinking Water				
Batch: 22F0300								
Lead	12.8	---	0.200	ug/L	1	06/09/22 00:54	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street

Tigard, OR 97223

503-718-2323

ORELAP ID: OR100062

PBS Engineering and Environmental

4412 S Corbett Ave

Portland, OR 97239

Project: Dayton School District

Project Number: Dayton Grade School/27350

Project Manager: James Mastanduno

Report ID:

A2F0092 - 06 20 22 1634

ANALYTICAL SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22531211-091KF22A (A2F0092-DD)				Matrix: Drinking Water				
Batch: 22F0300								
Lead	10.4	---	0.200	ug/L	1	06/09/22 00:58	EPA 200.8	
22531211-092KF22A (A2F0092-DF)				Matrix: Drinking Water				
Batch: 22F0300								
Lead	6.10	---	0.200	ug/L	1	06/09/22 01:02	EPA 200.8	
22531211-093DW22A (A2F0092-DH)				Matrix: Drinking Water				
Batch: 22F0300								
Lead	15.3	---	0.200	ug/L	1	06/09/22 01:06	EPA 200.8	
22531211-093DW22B (A2F0092-DI)				Matrix: Drinking Water				
Batch: 22F0668								
Lead	20.6	---	0.200	ug/L	1	06/17/22 20:06	EPA 200.8	
22531211-094DW22A (A2F0092-DJ)				Matrix: Drinking Water				
Batch: 22F0300								
Lead	4.36	---	0.200	ug/L	1	06/09/22 01:10	EPA 200.8	
22531211-095BF22A (A2F0092-DL)				Matrix: Drinking Water				
Batch: 22F0300								
Lead	13.0	---	0.200	ug/L	1	06/09/22 01:14	EPA 200.8	
22531211-096BF22A (A2F0092-DN)				Matrix: Drinking Water				
Batch: 22F0300								
Lead	10.1	---	0.200	ug/L	1	06/09/22 01:19	EPA 200.8	
22531211-097BF22A (A2F0092-DP)				Matrix: Drinking Water				
Batch: 22F0300								
Lead	9.09	---	0.200	ug/L	1	06/09/22 01:23	EPA 200.8	
22531211-098BF22A (A2F0092-DR)				Matrix: Drinking Water				
Batch: 22F0300								
Lead	12.7	---	0.200	ug/L	1	06/09/22 01:27	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

PBS Engineering and Environmental
4412 S Corbett Ave
Portland, OR 97239

Project: **Dayton School District**
Project Number: **Dayton Grade School/27350**
Project Manager: **James Mastanduno**

Report ID:
A2F0092 - 06 20 22 1634

ANALYTICAL SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Sample Result	Detection Limit	Reporting Limit	Units	Dilution	Date Analyzed	Method Ref.	Notes
22531211-099SF22A (A2F0092-DT)				Matrix: Drinking Water				
Batch: 22F0300								
Lead	11.7	---	0.200	ug/L	1	06/09/22 01:39	EPA 200.8	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street

Tigard, OR 97223

503-718-2323

ORELAP ID: OR100062

PBS Engineering and Environmental

4412 S Corbett Ave

Portland, OR 97239

Project: Dayton School District

Project Number: Dayton Grade School/27350

Project Manager: James Mastanduno

Report ID:

A2F0092 - 06 20 22 1634

QUALITY CONTROL (QC) SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Result	Detection Limit	Reporting Limit	Units	Dilution	Spike Amount	Source Result	% REC	% REC Limits	RPD	RPD Limit	Notes
Batch 22F0257 - EPA 200.8 Direct Analysis							Drinking Water					
Blank (22F0257-BLK1)		Prepared: 06/07/22 18:41		Analyzed: 06/07/22 19:28								
EPA 200.8												
Lead	ND	---	0.200	ug/L	1	---	---	---	---	---	---	
LCS (22F0257-BS1)		Prepared: 06/07/22 18:41		Analyzed: 06/07/22 19:31								
EPA 200.8												
Lead	14.5	---	0.201	ug/L	1	15.0	---	97	85 - 115%	---	---	
Duplicate (22F0257-DUP1)		Prepared: 06/07/22 18:41		Analyzed: 06/07/22 19:47								
QC Source Sample: 22531211-001CF22A (A2F0092-01)												
EPA 200.8												
Lead	6.61	---	0.200	ug/L	1	---	6.49	---	---	2	20%	
Matrix Spike (22F0257-MS1)		Prepared: 06/07/22 18:41		Analyzed: 06/07/22 19:51								
QC Source Sample: 22531211-001CF22A (A2F0092-01)												
EPA 200.8												
Lead	20.8	---	0.201	ug/L	1	15.0	6.49	95	70 - 130%	---	---	
Matrix Spike (22F0257-MS2)		Prepared: 06/07/22 18:41		Analyzed: 06/07/22 21:26								
QC Source Sample: 22531211-020WB22A (A2F0092-39)												
EPA 200.8												
Lead	13.8	---	0.201	ug/L	1	15.0	ND	92	70 - 130%	---	---	
Batch 22F0264 - EPA 200.8 Direct Analysis							Drinking Water					
Blank (22F0264-BLK1)		Prepared: 06/08/22 07:55		Analyzed: 06/08/22 14:20								
EPA 200.8												
Lead	ND	---	0.200	ug/L	1	---	---	---	---	---	---	
LCS (22F0264-BS1)		Prepared: 06/08/22 07:55		Analyzed: 06/08/22 14:23								
EPA 200.8												
Lead	13.6	---	0.201	ug/L	1	15.0	---	91	85 - 115%	---	---	
Duplicate (22F0264-DUP1)		Prepared: 06/08/22 07:55		Analyzed: 06/08/22 14:31								
QC Source Sample: 22531211-021DW22A (A2F0092-41)												

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

PBS Engineering and Environmental
4412 S Corbett Ave
Portland, OR 97239

Project: **Dayton School District**
Project Number: **Dayton Grade School/27350**
Project Manager: **James Mastanduno**

Report ID:
A2F0092 - 06 20 22 1634

QUALITY CONTROL (QC) SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Result	Detection Limit	Reporting Limit	Units	Dilution	Spike Amount	Source Result	% REC	% REC Limits	RPD	RPD Limit	Notes
Batch 22F0264 - EPA 200.8 Direct Analysis							Drinking Water					
Duplicate (22F0264-DUP1)		Prepared: 06/08/22 07:55		Analyzed: 06/08/22 14:31								
QC Source Sample: 22531211-021DW22A (A2F0092-41)												
EPA 200.8												
Lead	ND	---	0.200	ug/L	1	---	ND	---	---	---	20%	
Matrix Spike (22F0264-MS1)		Prepared: 06/08/22 07:55		Analyzed: 06/08/22 14:34								
QC Source Sample: 22531211-021DW22A (A2F0092-41)												
EPA 200.8												
Lead	13.3	---	0.201	ug/L	1	15.0	ND	89	70 - 130%	---	---	
Matrix Spike (22F0264-MS2)		Prepared: 06/08/22 07:55		Analyzed: 06/08/22 19:42								
QC Source Sample: 22531211-040CF22A (A2F0092-79)												
EPA 200.8												
Lead	24.4	---	0.201	ug/L	1	15.0	10.6	92	70 - 130%	---	---	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street

Tigard, OR 97223

503-718-2323

ORELAP ID: OR100062

PBS Engineering and Environmental

4412 S Corbett Ave

Portland, OR 97239

Project: Dayton School District

Project Number: Dayton Grade School/27350

Project Manager: James Mastanduno

Report ID:

A2F0092 - 06 20 22 1634

QUALITY CONTROL (QC) SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Result	Detection Limit	Reporting Limit	Units	Dilution	Spike Amount	Source Result	% REC	% REC Limits	RPD	RPD Limit	Notes
Batch 22F0272 - EPA 200.8 Direct Analysis							Drinking Water					
Blank (22F0272-BLK1)		Prepared: 06/08/22 09:29 Analyzed: 06/08/22 19:46										
EPA 200.8												
Lead	ND	---	0.200	ug/L	1	---	---	---	---	---	---	
LCS (22F0272-BS1)		Prepared: 06/08/22 09:29 Analyzed: 06/08/22 19:57										
EPA 200.8												
Lead	14.0	---	0.201	ug/L	1	15.0	---	94	85 - 115%	---	---	
Duplicate (22F0272-DUP1)		Prepared: 06/08/22 09:29 Analyzed: 06/08/22 20:06										
QC Source Sample: 22531211-041DW22A (A2F0092-81)												
EPA 200.8												
Lead	4.77	---	0.200	ug/L	1	---	4.29	---	---	11	20%	
Matrix Spike (22F0272-MS1)		Prepared: 06/08/22 09:29 Analyzed: 06/08/22 20:10										
QC Source Sample: 22531211-041DW22A (A2F0092-81)												
EPA 200.8												
Lead	18.1	---	0.201	ug/L	1	15.0	4.29	92	70 - 130%	---	---	
Matrix Spike (22F0272-MS2)		Prepared: 06/08/22 09:29 Analyzed: 06/08/22 21:42										
QC Source Sample: 22531211-060WB22A (A2F0092-AT)												
EPA 200.8												
Lead	14.0	---	0.201	ug/L	1	15.0	ND	93	70 - 130%	---	---	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street

Tigard, OR 97223

503-718-2323

ORELAP ID: OR100062

PBS Engineering and Environmental

4412 S Corbett Ave

Portland, OR 97239

Project: Dayton School District

Project Number: Dayton Grade School/27350

Project Manager: James Mastanduno

Report ID:

A2F0092 - 06 20 22 1634

QUALITY CONTROL (QC) SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Result	Detection Limit	Reporting Limit	Units	Dilution	Spike Amount	Source Result	% REC	% REC Limits	RPD	RPD Limit	Notes
Batch 22F0289 - EPA 200.8 Direct Analysis							Drinking Water					
Blank (22F0289-BLK1)		Prepared: 06/08/22 12:07			Analyzed: 06/08/22 21:46							
EPA 200.8												
Lead	ND	---	0.200	ug/L	1	---	---	---	---	---	---	
LCS (22F0289-BS1)		Prepared: 06/08/22 12:07			Analyzed: 06/08/22 21:49							
EPA 200.8												
Lead	14.6	---	0.201	ug/L	1	15.0	---	97	85 - 115%	---	---	
Duplicate (22F0289-DUP1)		Prepared: 06/08/22 12:07			Analyzed: 06/08/22 21:57							
QC Source Sample: 22531211-061DW22A (A2F0092-AV)												
EPA 200.8												
Lead	ND	---	0.200	ug/L	1	---	ND	---	---	---	20%	
Matrix Spike (22F0289-MS1)		Prepared: 06/08/22 12:07			Analyzed: 06/08/22 22:00							
QC Source Sample: 22531211-061DW22A (A2F0092-AV)												
EPA 200.8												
Lead	14.9	---	0.201	ug/L	1	15.0	ND	99	70 - 130%	---	---	
Matrix Spike (22F0289-MS2)		Prepared: 06/08/22 12:07			Analyzed: 06/08/22 23:40							
QC Source Sample: 22531211-080BF22A (A2F0092-CH)												
EPA 200.8												
Lead	18.7	---	0.201	ug/L	1	15.0	4.35	96	70 - 130%	---	---	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**PBS Engineering and Environmental**4412 S Corbett Ave
Portland, OR 97239Project: **Dayton School District**Project Number: **Dayton Grade School/27350**Project Manager: **James Mastanduno****Report ID:****A2F0092 - 06 20 22 1634**

QUALITY CONTROL (QC) SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Result	Detection Limit	Reporting Limit	Units	Dilution	Spike Amount	Source Result	% REC	% REC Limits	RPD	RPD Limit	Notes
Batch 22F0300 - EPA 200.8 Direct Analysis							Drinking Water					
Blank (22F0300-BLK1)		Prepared: 06/08/22 14:39		Analyzed: 06/08/22 23:44								
EPA 200.8												
Lead	ND	---	0.200	ug/L	1	---	---	---	---	---	---	
LCS (22F0300-BS1)		Prepared: 06/08/22 14:39		Analyzed: 06/08/22 23:48								
EPA 200.8												
Lead	14.7	---	0.201	ug/L	1	15.0	---	98	85 - 115%	---	---	
Duplicate (22F0300-DUP1)		Prepared: 06/08/22 14:39		Analyzed: 06/09/22 00:04								
QC Source Sample: 22531211-081BF22A (A2F0092-CJ)												
EPA 200.8												
Lead	4.21	---	0.200	ug/L	1	---	4.21	---	---	0.04	20%	
Matrix Spike (22F0300-MS1)		Prepared: 06/08/22 14:39		Analyzed: 06/09/22 00:08								
QC Source Sample: 22531211-081BF22A (A2F0092-CJ)												
EPA 200.8												
Lead	19.5	---	0.201	ug/L	1	15.0	4.21	102	70 - 130%	---	---	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

PBS Engineering and Environmental
4412 S Corbett Ave
Portland, OR 97239

Project: **Dayton School District**
Project Number: **Dayton Grade School/27350**
Project Manager: **James Mastanduno**

Report ID:
A2F0092 - 06 20 22 1634

QUALITY CONTROL (QC) SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Result	Detection Limit	Reporting Limit	Units	Dilution	Spike Amount	Source Result	% REC	% REC Limits	RPD	RPD Limit	Notes
Batch 22F0328 - EPA 3015A							Drinking Water					
Blank (22F0328-BLK1)		Prepared: 06/09/22 10:05			Analyzed: 06/10/22 20:09							
EPA 200.8												
Lead	ND	---	0.222	ug/L	1	---	---	---	---	---	---	
LCS (22F0328-BS1)		Prepared: 06/09/22 10:05			Analyzed: 06/10/22 20:14							
EPA 200.8												
Lead	16.0	---	0.222	ug/L	1	16.7	---	96	85 - 115%	---	---	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street

Tigard, OR 97223

503-718-2323

ORELAP ID: OR100062

PBS Engineering and Environmental

4412 S Corbett Ave

Portland, OR 97239

Project: Dayton School District

Project Number: Dayton Grade School/27350

Project Manager: James Mastanduno

Report ID:

A2F0092 - 06 20 22 1634

QUALITY CONTROL (QC) SAMPLE RESULTS

Total Metals in Drinking Water by EPA 200.8 (ICPMS)

Analyte	Result	Detection Limit	Reporting Limit	Units	Dilution	Spike Amount	Source Result	% REC	% REC Limits	RPD	RPD Limit	Notes
Batch 22F0668 - EPA 200.8 Direct Analysis							Drinking Water					
Blank (22F0668-BLK1)		Prepared: 06/17/22 14:13		Analyzed: 06/17/22 18:21								
EPA 200.8												
Lead	ND	---	0.200	ug/L	1	---	---	---	---	---	---	
LCS (22F0668-BS1)		Prepared: 06/17/22 14:13		Analyzed: 06/17/22 18:25								
EPA 200.8												
Lead	13.4	---	0.201	ug/L	1	15.0	---	89	85 - 115%	---	---	
Duplicate (22F0668-DUP1)		Prepared: 06/17/22 14:13		Analyzed: 06/17/22 18:33								
QC Source Sample: 22531211-003CF22B (A2F0092-06)												
EPA 200.8												
Lead	2.41	---	0.200	ug/L	1	---	2.39	---	---	0.7	20%	
Matrix Spike (22F0668-MS1)		Prepared: 06/17/22 14:13		Analyzed: 06/17/22 18:37								
QC Source Sample: 22531211-003CF22B (A2F0092-06)												
EPA 200.8												
Lead	15.7	---	0.201	ug/L	1	15.0	2.39	89	70 - 130%	---	---	

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

**ANALYTICAL REPORT****Apex Laboratories, LLC**

6700 S.W. Sandburg Street

Tigard, OR 97223

503-718-2323

ORELAP ID: OR100062

PBS Engineering and Environmental

4412 S Corbett Ave

Portland, OR 97239

Project: **Dayton School District**Project Number: **Dayton Grade School/27350**Project Manager: **James Mastanduno****Report ID:****A2F0092 - 06 20 22 1634****SAMPLE PREPARATION INFORMATION****Total Metals in Drinking Water by EPA 200.8 (ICPMS)****Prep: EPA 200.8 Direct Analysis**

Lab Number	Matrix	Method	Sampled	Prepared	Sample Initial/Final	Default Initial/Final	RL Prep Factor
<u>Batch: 22F0257</u>							
A2F0092-01	Drinking Water	EPA 200.8	05/13/22 00:00	06/07/22 18:41	10mL/10mL	10mL/10mL	1.00
A2F0092-03	Drinking Water	EPA 200.8	05/13/22 00:00	06/07/22 18:41	10mL/10mL	10mL/10mL	1.00
A2F0092-05	Drinking Water	EPA 200.8	05/13/22 00:00	06/07/22 18:41	10mL/10mL	10mL/10mL	1.00
A2F0092-07	Drinking Water	EPA 200.8	05/13/22 00:00	06/07/22 18:41	10mL/10mL	10mL/10mL	1.00
A2F0092-09	Drinking Water	EPA 200.8	05/13/22 00:00	06/07/22 18:41	10mL/10mL	10mL/10mL	1.00
A2F0092-11	Drinking Water	EPA 200.8	05/13/22 00:00	06/07/22 18:41	10mL/10mL	10mL/10mL	1.00
A2F0092-13	Drinking Water	EPA 200.8	05/13/22 00:00	06/07/22 18:41	10mL/10mL	10mL/10mL	1.00
A2F0092-15	Drinking Water	EPA 200.8	05/13/22 00:00	06/07/22 18:41	10mL/10mL	10mL/10mL	1.00
A2F0092-17	Drinking Water	EPA 200.8	05/13/22 00:00	06/07/22 18:41	10mL/10mL	10mL/10mL	1.00
A2F0092-19	Drinking Water	EPA 200.8	05/13/22 00:00	06/07/22 18:41	10mL/10mL	10mL/10mL	1.00
A2F0092-21	Drinking Water	EPA 200.8	05/13/22 00:00	06/07/22 18:41	10mL/10mL	10mL/10mL	1.00
A2F0092-23	Drinking Water	EPA 200.8	05/13/22 00:00	06/07/22 18:41	10mL/10mL	10mL/10mL	1.00
A2F0092-25	Drinking Water	EPA 200.8	05/13/22 00:00	06/07/22 18:41	10mL/10mL	10mL/10mL	1.00
A2F0092-27	Drinking Water	EPA 200.8	05/13/22 00:00	06/07/22 18:41	10mL/10mL	10mL/10mL	1.00
A2F0092-29	Drinking Water	EPA 200.8	05/13/22 00:00	06/07/22 18:41	10mL/10mL	10mL/10mL	1.00
A2F0092-31	Drinking Water	EPA 200.8	05/13/22 00:00	06/07/22 18:41	10mL/10mL	10mL/10mL	1.00
A2F0092-33	Drinking Water	EPA 200.8	05/13/22 00:00	06/07/22 18:41	10mL/10mL	10mL/10mL	1.00
A2F0092-35	Drinking Water	EPA 200.8	05/13/22 00:00	06/07/22 18:41	10mL/10mL	10mL/10mL	1.00
A2F0092-37	Drinking Water	EPA 200.8	05/13/22 00:00	06/07/22 18:41	10mL/10mL	10mL/10mL	1.00
A2F0092-39	Drinking Water	EPA 200.8	05/13/22 00:00	06/07/22 18:41	10mL/10mL	10mL/10mL	1.00

Batch: 22F0264

A2F0092-41	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 07:55	10mL/10mL	10mL/10mL	1.00
A2F0092-43	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 07:55	10mL/10mL	10mL/10mL	1.00
A2F0092-45	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 07:55	10mL/10mL	10mL/10mL	1.00
A2F0092-47	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 07:55	10mL/10mL	10mL/10mL	1.00
A2F0092-49	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 07:55	10mL/10mL	10mL/10mL	1.00
A2F0092-51	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 07:55	10mL/10mL	10mL/10mL	1.00
A2F0092-53	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 07:55	10mL/10mL	10mL/10mL	1.00
A2F0092-55	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 07:55	10mL/10mL	10mL/10mL	1.00
A2F0092-57	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 07:55	10mL/10mL	10mL/10mL	1.00
A2F0092-59	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 07:55	10mL/10mL	10mL/10mL	1.00
A2F0092-61	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 07:55	10mL/10mL	10mL/10mL	1.00
A2F0092-63	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 07:55	10mL/10mL	10mL/10mL	1.00
A2F0092-65	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 07:55	10mL/10mL	10mL/10mL	1.00
A2F0092-67	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 07:55	10mL/10mL	10mL/10mL	1.00
A2F0092-69	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 07:55	10mL/10mL	10mL/10mL	1.00

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager

**ANALYTICAL REPORT****Apex Laboratories, LLC**6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062**PBS Engineering and Environmental**4412 S Corbett Ave
Portland, OR 97239Project: **Dayton School District**Project Number: **Dayton Grade School/27350**Project Manager: **James Mastanduno****Report ID:****A2F0092 - 06 20 22 1634****SAMPLE PREPARATION INFORMATION****Total Metals in Drinking Water by EPA 200.8 (ICPMS)****Prep: EPA 200.8 Direct Analysis**

Lab Number	Matrix	Method	Sampled	Prepared	Sample Initial/Final	Default Initial/Final	RL Prep Factor
A2F0092-71	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 07:55	10mL/10mL	10mL/10mL	1.00
A2F0092-73	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 07:55	10mL/10mL	10mL/10mL	1.00
A2F0092-75	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 07:55	10mL/10mL	10mL/10mL	1.00
A2F0092-77	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 07:55	10mL/10mL	10mL/10mL	1.00
A2F0092-79	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 07:55	10mL/10mL	10mL/10mL	1.00
<u>Batch: 22F0272</u>							
A2F0092-81	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 09:29	10mL/10mL	10mL/10mL	1.00
A2F0092-83	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 09:29	10mL/10mL	10mL/10mL	1.00
A2F0092-85	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 09:29	10mL/10mL	10mL/10mL	1.00
A2F0092-87	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 09:29	10mL/10mL	10mL/10mL	1.00
A2F0092-89	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 09:29	10mL/10mL	10mL/10mL	1.00
A2F0092-91	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 09:29	10mL/10mL	10mL/10mL	1.00
A2F0092-93	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 09:29	10mL/10mL	10mL/10mL	1.00
A2F0092-95	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 09:29	10mL/10mL	10mL/10mL	1.00
A2F0092-97	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 09:29	10mL/10mL	10mL/10mL	1.00
A2F0092-99	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 09:29	10mL/10mL	10mL/10mL	1.00
A2F0092-AD	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 09:29	10mL/10mL	10mL/10mL	1.00
A2F0092-AF	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 09:29	10mL/10mL	10mL/10mL	1.00
A2F0092-AH	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 09:29	10mL/10mL	10mL/10mL	1.00
A2F0092-AJ	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 09:29	10mL/10mL	10mL/10mL	1.00
A2F0092-AL	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 09:29	10mL/10mL	10mL/10mL	1.00
A2F0092-AN	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 09:29	10mL/10mL	10mL/10mL	1.00
A2F0092-AP	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 09:29	10mL/10mL	10mL/10mL	1.00
A2F0092-AR	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 09:29	10mL/10mL	10mL/10mL	1.00
A2F0092-AT	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 09:29	10mL/10mL	10mL/10mL	1.00
<u>Batch: 22F0289</u>							
A2F0092-AV	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 12:07	10mL/10mL	10mL/10mL	1.00
A2F0092-AX	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 12:07	10mL/10mL	10mL/10mL	1.00
A2F0092-AZ	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 12:07	10mL/10mL	10mL/10mL	1.00
A2F0092-BB	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 12:07	10mL/10mL	10mL/10mL	1.00
A2F0092-BD	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 12:07	10mL/10mL	10mL/10mL	1.00
A2F0092-BF	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 12:07	10mL/10mL	10mL/10mL	1.00
A2F0092-BH	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 12:07	10mL/10mL	10mL/10mL	1.00
A2F0092-BJRE1	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 12:07	10mL/10mL	10mL/10mL	1.00
A2F0092-BL	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 12:07	10mL/10mL	10mL/10mL	1.00
A2F0092-BN	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 12:07	10mL/10mL	10mL/10mL	1.00

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager

**ANALYTICAL REPORT****Apex Laboratories, LLC**

6700 S.W. Sandburg Street

Tigard, OR 97223

503-718-2323

ORELAP ID: OR100062

PBS Engineering and Environmental

4412 S Corbett Ave

Portland, OR 97239

Project: **Dayton School District**Project Number: **Dayton Grade School/27350**Project Manager: **James Mastanduno****Report ID:****A2F0092 - 06 20 22 1634****SAMPLE PREPARATION INFORMATION****Total Metals in Drinking Water by EPA 200.8 (ICPMS)****Prep: EPA 200.8 Direct Analysis**

Lab Number	Matrix	Method	Sampled	Prepared	Sample Initial/Final	Default Initial/Final	RL Prep Factor
A2F0092-BPRE1	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 12:07	10mL/10mL	10mL/10mL	1.00
A2F0092-BR	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 12:07	10mL/10mL	10mL/10mL	1.00
A2F0092-BT	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 12:07	10mL/10mL	10mL/10mL	1.00
A2F0092-BV	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 12:07	10mL/10mL	10mL/10mL	1.00
A2F0092-BX	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 12:07	10mL/10mL	10mL/10mL	1.00
A2F0092-BZ	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 12:07	10mL/10mL	10mL/10mL	1.00
A2F0092-CB	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 12:07	10mL/10mL	10mL/10mL	1.00
A2F0092-CD	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 12:07	10mL/10mL	10mL/10mL	1.00
A2F0092-CF	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 12:07	10mL/10mL	10mL/10mL	1.00
A2F0092-CH	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 12:07	10mL/10mL	10mL/10mL	1.00

Batch: 22F0300

A2F0092-CJ	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 14:39	10mL/10mL	10mL/10mL	1.00
A2F0092-CL	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 14:39	10mL/10mL	10mL/10mL	1.00
A2F0092-CN	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 14:39	10mL/10mL	10mL/10mL	1.00
A2F0092-CP	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 14:39	10mL/10mL	10mL/10mL	1.00
A2F0092-CR	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 14:39	10mL/10mL	10mL/10mL	1.00
A2F0092-CT	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 14:39	10mL/10mL	10mL/10mL	1.00
A2F0092-CV	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 14:39	10mL/10mL	10mL/10mL	1.00
A2F0092-CX	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 14:39	10mL/10mL	10mL/10mL	1.00
A2F0092-CZ	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 14:39	10mL/10mL	10mL/10mL	1.00
A2F0092-DB	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 14:39	10mL/10mL	10mL/10mL	1.00
A2F0092-DD	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 14:39	10mL/10mL	10mL/10mL	1.00
A2F0092-DF	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 14:39	10mL/10mL	10mL/10mL	1.00
A2F0092-DH	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 14:39	10mL/10mL	10mL/10mL	1.00
A2F0092-DJ	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 14:39	10mL/10mL	10mL/10mL	1.00
A2F0092-DL	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 14:39	10mL/10mL	10mL/10mL	1.00
A2F0092-DN	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 14:39	10mL/10mL	10mL/10mL	1.00
A2F0092-DP	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 14:39	10mL/10mL	10mL/10mL	1.00
A2F0092-DR	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 14:39	10mL/10mL	10mL/10mL	1.00
A2F0092-DT	Drinking Water	EPA 200.8	05/13/22 00:00	06/08/22 14:39	10mL/10mL	10mL/10mL	1.00

Batch: 22F0668

A2F0092-06	Drinking Water	EPA 200.8	05/13/22 00:00	06/17/22 14:13	10mL/10mL	10mL/10mL	1.00
A2F0092-14	Drinking Water	EPA 200.8	05/13/22 00:00	06/17/22 14:13	10mL/10mL	10mL/10mL	1.00
A2F0092-32	Drinking Water	EPA 200.8	05/13/22 00:00	06/17/22 14:13	10mL/10mL	10mL/10mL	1.00
A2F0092-48	Drinking Water	EPA 200.8	05/13/22 00:00	06/17/22 14:13	10mL/10mL	10mL/10mL	1.00
A2F0092-86	Drinking Water	EPA 200.8	05/13/22 00:00	06/17/22 14:13	10mL/10mL	10mL/10mL	1.00

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager

Page 32 of 44

**ANALYTICAL REPORT****Apex Laboratories, LLC**

6700 S.W. Sandburg Street

Tigard, OR 97223

503-718-2323

ORELAP ID: OR100062

PBS Engineering and Environmental

4412 S Corbett Ave

Portland, OR 97239

Project: **Dayton School District**Project Number: **Dayton Grade School/27350**Project Manager: **James Mastanduno****Report ID:****A2F0092 - 06 20 22 1634****SAMPLE PREPARATION INFORMATION****Total Metals in Drinking Water by EPA 200.8 (ICPMS)****Prep: EPA 200.8 Direct Analysis**

Lab Number	Matrix	Method	Sampled	Prepared	Sample Initial/Final	Default Initial/Final	RL Prep Factor
A2F0092-88	Drinking Water	EPA 200.8	05/13/22 00:00	06/17/22 14:13	10mL/10mL	10mL/10mL	1.00
A2F0092-92	Drinking Water	EPA 200.8	05/13/22 00:00	06/17/22 14:13	10mL/10mL	10mL/10mL	1.00
A2F0092-AA	Drinking Water	EPA 200.8	05/13/22 00:00	06/17/22 14:13	10mL/10mL	10mL/10mL	1.00
A2F0092-AY	Drinking Water	EPA 200.8	05/13/22 00:00	06/17/22 14:13	10mL/10mL	10mL/10mL	1.00
A2F0092-BA	Drinking Water	EPA 200.8	05/13/22 00:00	06/17/22 14:13	10mL/10mL	10mL/10mL	1.00
A2F0092-BC	Drinking Water	EPA 200.8	05/13/22 00:00	06/17/22 14:13	10mL/10mL	10mL/10mL	1.00
A2F0092-BE	Drinking Water	EPA 200.8	05/13/22 00:00	06/17/22 14:13	10mL/10mL	10mL/10mL	1.00
A2F0092-BG	Drinking Water	EPA 200.8	05/13/22 00:00	06/17/22 14:13	10mL/10mL	10mL/10mL	1.00
A2F0092-BI	Drinking Water	EPA 200.8	05/13/22 00:00	06/17/22 14:13	10mL/10mL	10mL/10mL	1.00
A2F0092-BK	Drinking Water	EPA 200.8	05/13/22 00:00	06/17/22 14:13	10mL/10mL	10mL/10mL	1.00
A2F0092-BM	Drinking Water	EPA 200.8	05/13/22 00:00	06/17/22 14:13	10mL/10mL	10mL/10mL	1.00
A2F0092-BO	Drinking Water	EPA 200.8	05/13/22 00:00	06/17/22 14:13	10mL/10mL	10mL/10mL	1.00
A2F0092-CY	Drinking Water	EPA 200.8	05/13/22 00:00	06/17/22 14:13	10mL/10mL	10mL/10mL	1.00
A2F0092-DI	Drinking Water	EPA 200.8	05/13/22 00:00	06/17/22 14:13	10mL/10mL	10mL/10mL	1.00

Prep: EPA 3015A

Lab Number	Matrix	Method	Sampled	Prepared	Sample Initial/Final	Default Initial/Final	RL Prep Factor
<u>Batch: 22F0328</u>							
A2F0092-AB	Drinking Water	EPA 200.8	05/13/22 00:00	06/09/22 10:05	10mL/10mL	10mL/10mL	1.00

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

PBS Engineering and Environmental

4412 S Corbett Ave
Portland, OR 97239

Project: Dayton School District

Project Number: Dayton Grade School/27350
Project Manager: James Mastanduno

Report ID:

A2F0092 - 06 20 22 1634

QUALIFIER DEFINITIONS

Client Sample and Quality Control (QC) Sample Qualifier Definitions:

Apex Laboratories

DW-D Turbidity greater than 1 NTU. Sample was digested per EPA Method 200.8.

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

PBS Engineering and Environmental

4412 S Corbett Ave
Portland, OR 97239

Project: **Dayton School District**

Project Number: **Dayton Grade School/27350**

Project Manager: **James Mastanduno**

Report ID:

A2F0092 - 06 20 22 1634

REPORTING NOTES AND CONVENTIONS:

Abbreviations:

DET Analyte DETECTED at or above the detection or reporting limit.
ND Analyte NOT DETECTED at or above the detection or reporting limit.
NR Result Not Reported.
RPD Relative Percent Difference. RPDs for Matrix Spikes and Matrix Spike Duplicates are based on concentration, not recovery.

Detection Limits: Limit of Detection (LOD)

Limits of Detection (LODs) are normally set at a level of one half the validated Limit of Quantitation (LOQ).
If no value is listed ('-----'), then the data has not been evaluated below the Reporting Limit.

Reporting Limits: Limit of Quantitation (LOQ)

Validated Limits of Quantitation (LOQs) are reported as the Reporting Limits for all analyses where the LOQ, MRL, PQL or CRL are requested. The LOQ represents a level at or above the low point of the calibration curve, that has been validated according to Apex Laboratories' comprehensive LOQ policies and procedures.

Reporting Conventions:

Basis: Results for soil samples are generally reported on a 100% dry weight basis.
The Result Basis is listed following the units as "dry", "wet", or " " (blank) designation.

"dry" Sample results and Reporting Limits are reported on a dry weight basis. (i.e. "ug/kg dry")
See Percent Solids section for details of dry weight analysis.

"wet" Sample results and Reporting Limits for this analysis are normally dry weight corrected, but have not been modified in this case.

" " Results without 'wet' or 'dry' designation are not normally dry weight corrected. These results are considered 'As Received'.

QC Source:

In cases where there is insufficient sample provided for Sample Duplicates and/or Matrix Spikes, a Lab Control Sample Duplicate (LCS Dup) may be analyzed to demonstrate accuracy and precision of the extraction batch.

Non-Client Batch QC Samples (Duplicates and Matrix Spike/Duplicates) are not included in this report. Please request a Full QC report if this data is required.

Miscellaneous Notes:

" --- " QC results are not applicable. For example, % Recoveries for Blanks and Duplicates, % RPD for Blanks, Blank Spikes and Matrix Spikes, etc.

" *** " Used to indicate a possible discrepancy with the Sample and Sample Duplicate results when the %RPD is not available. In this case, either the Sample or the Sample Duplicate has a reportable result for this analyte, while the other is Non Detect (ND).

Blanks:

Standard practice is to evaluate the results from Blank QC Samples down to a level equal to ½ the Reporting Limit (RL).
-For Blank hits falling between ½ the RL and the RL (J flagged hits), the associated sample and QC data will receive a 'B-02' qualifier.
-For Blank hits above the RL, the associated sample and QC data will receive a 'B' qualifier, per Apex Laboratories' Blank Policy.
For further details, please request a copy of this document.

Apex Laboratories

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

Jason Woodcock, Project Manager



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street
Tigard, OR 97223
503-718-2323
ORELAP ID: OR100062

PBS Engineering and Environmental

4412 S Corbett Ave
Portland, OR 97239

Project: **Dayton School District**

Project Number: **Dayton Grade School/27350**
Project Manager: **James Mastanduno**

Report ID:

A2F0092 - 06 20 22 1634

REPORTING NOTES AND CONVENTIONS (Cont.):

Blanks (Cont.):

Sample results flagged with a 'B' or 'B-02' qualifier are potentially biased high if the sample results are less than ten times the level found in the blank for inorganic analyses, or less than five times the level found in the blank for organic analyses.

'B' and 'B-02' qualifications are only applied to sample results detected above the Reporting Level.

Preparation Notes:

Mixed Matrix Samples:

Water Samples:

Water samples containing significant amounts of sediment are decanted or separated prior to extraction, and only the water portion analyzed, unless otherwise directed by the client.

Soil and Sediment Samples:

Soil and Sediment samples containing significant amounts of water are decanted prior to extraction, and only the solid portion analyzed, unless otherwise directed by the client.

Sampling and Preservation Notes:

Certain regulatory programs, such as National Pollutant Discharge Elimination System (NPDES), require that activities such as sample filtration (for dissolved metals, orthophosphate, hexavalent chromium, etc.) and testing of short hold analytes (pH, Dissolved Oxygen, etc.) be performed in the field (on-site) within a short time window. In addition, sample matrix spikes are required for some analyses, and sufficient volume must be provided, and billable site specific QC requested, if this is required. All regulatory permits should be reviewed to ensure that these requirements are being met.

Data users should be aware of which regulations pertain to the samples they submit for testing. If related sample collection activities are not approved for a particular regulatory program, results should be considered estimates. Apex Laboratories will qualify these analytes according to the most stringent requirements, however results for samples that are for non-regulatory purposes may be acceptable.

Samples that have been filtered and preserved at Apex Laboratories per client request are listed in the preparation section of the report with the date and time of filtration listed.

Apex Laboratories maintains detailed records on sample receipt, including client label verification, cooler temperature, sample preservation, hold time compliance and field filtration. Data is qualified as necessary, and the lack of qualification indicates compliance with required parameters.

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.



ANALYTICAL REPORT

Apex Laboratories, LLC

6700 S.W. Sandburg Street

Tigard, OR 97223

503-718-2323

ORELAP ID: OR100062

PBS Engineering and Environmental

4412 S Corbett Ave

Portland, OR 97239

Project: **Dayton School District**

Project Number: **Dayton Grade School/27350**

Project Manager: **James Mastanduno**

Report ID:

A2F0092 - 06 20 22 1634

LABORATORY ACCREDITATION INFORMATION

ORELAP Certification ID: OR100062 (Primary Accreditation)

EPA ID: OR01039

All methods and analytes reported from work performed at Apex Laboratories are included on Apex Laboratories' ORELAP Scope of Certification, with the exception of any analyte(s) listed below:

Apex Laboratories

Matrix	Analysis	TNI_ID	Analyte	TNI_ID	Accreditation
<u>All reported analytes are included in Apex Laboratories' current ORELAP scope.</u>					

Secondary Accreditations

Apex Laboratories also maintains reciprocal accreditation with non-TNI states (Washington DOE), as well as other state specific accreditations not listed here.

Subcontract Laboratory Accreditations

Subcontracted data falls outside of Apex Laboratories' Scope of Accreditation.

Please see the Subcontract Laboratory report for full details, or contact your Project Manager for more information.

Field Testing Parameters

Results for Field Tested data are provided by the client or sampler, and fall outside of Apex Laboratories' Scope of Accreditation.

Apex Laboratories

Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

PBS Engineering and Environmental

4412 S Corbett Ave
Portland, OR 97239

Project: **Dayton School District**

Project Number: **Dayton Grade School/27350**

Project Manager: **James Mastanduno**

Report ID:

A2F0092 - 06 20 22 1634



** Only Analyze Sample A **

DAYTON SCHOOL DISTRICT

A2F0092

Lead in Drinking Water Testing Program

Date Collected: *5/13/22*

PBS Project: *27350.000 Phase 01*

School Name: *Dayton Grade School*

Building: *Main/GYM/CONCESSIONS*

Building Number: *1211*

Analysis Requested: *Lead (Pb) in Drinking Water*

Relinquished By/Signature: *ES*

Date/Time: *5/31/10:30*

Received By/Signature: *Andy Mariposa*

Date/Time: *6/1/22 12:49*


Email Results To: *james.mastanduno@pbsusa.com*

Turnaround Time: *10 - Day*

** Only Analyze sample A **

Fixture Number	Sample Number	Room / Location
001	2253124-001CF22A	Classroom 1
	-001CF22B	"
002	-002DW22A	"
	-002DW22B	"
003	-003CF22A	B3
	-003CF22B	"
004	-004CF22A	B-Wing Main Hallway
	-004CF22B	"
005	-005DW22A	"
	-005DW22B	"
006	-006DW22A	"
	-006DW22B	"
007	-007CF22A	Classroom 2
	-007CF22B	"
008	-008BF22A	Boys RR 120
	-008BF22B	"
009	-009BF22A	"
	-009BF22B	"
010	-010WB22A	Hall 205, east end
	-010WB22B	"
011	-011DW22A	"
	-011DW22B	"
012	-012BF22A	Girls RR 118
	-012BF22B	"
013	-013BF22A	"
	-013BF22B	"
014	-014CF22A	Classroom 3
	-014CF22B	"

Apex Laboratories



Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

PBS Engineering and Environmental

4412 S Corbett Ave

Portland, OR 97239

 Project: **Dayton School District**

 Project Number: **Dayton Grade School/27350**

 Project Manager: **James Mastanduno**
Report ID:
A2F0092 - 06 20 22 1634

Lead in Drinking Water Testing Program

A2F0092

Fixture Number	Sample Number	Room / Location
015	225312A - 015DW22A	Classroom 3
	- 015DW22B	"
016	- 016BF22A	GYM RR Wash area 115
	- 016BF22B	"
017	- 017BF22A	"
	- 017BF22B	"
018	- 018BF22A	"
	- 018BF22B	"
019	- 019BF22A	"
	- 019BF22B	"
020	- 020WB22A	GYM vestibule 114
	- 020WB22B	"
021	- 021DW22A	"
	- 021DW22B	"
022	- 022CF22A	Classroom 4
	- 022CF22B	"
023	- 023DW22A	"
	- 023DW22B	"
024	- 024CF22A	Classroom 5
	- 024CF22B	"
025	- 025CF22A	Room 109
	- 025CF22B	"
026	- 026BF22A	Room 109 RR
	- 026BF22B	"
027	- 027CF22A	Room 6
	- 027CF22B	"
028	- 028BF22A	Room 6 RR
	- 028BF22B	"
029	- 029BF22A	RR 107B
	- 029BF22B	"
030	- 030BF22A	"
	- 030BF22B	"
031	- 031SF22A	Room 107 Kitchen
	- 031SF22B	"
032	- 032BF22A	Girls RR 104
	- 032BF22B	"
033	- 033BF22A	"
	- 033BF22B	"



2 of 2

Apex Laboratories



Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

PBS Engineering and Environmental

4412 S Corbett Ave

Portland, OR 97239

Project: **Dayton School District**

Project Number: **Dayton Grade School/27350**

Project Manager: **James Mastanduno**

Report ID:

A2F0092 - 06 20 22 1634

Lead in Drinking Water Testing Program

A2F0092

Fixture Number	Sample Number	Room / Location
034	22531211-034DW22A	Hallway outside Girls RR 104
	-034DW22B	"
035	-035DW22A	"
	-035DW22B	"
036	-036CF22A	Classroom 7
	-036CF22B	"
037	-037DW22A	"
	-037DW22B	"
038	-038BF22A	Boys RR 101
	-038BF22B	"
039	-039BF22A	"
	-039BF22B	"
040	-040CF22A	Classroom 9
	-040CF22B	"
041	-041DW22A	"
	-041DW22B	"
042	-042CF22A	Classroom 8
	-042CF22B	"
043	-043DW22A	"
	-043DW22B	"
044	-044CF22A	Classroom 11
	-044CF22B	"
045	-045DW22A	"
	-045DW22B	"
046	-046CF22A	Classroom 10
	-046CF22B	"
047	-047DW22A	"
	-047DW22B	"
048	-048WB22A	Hall 201
	-048WB22B	"
049	-049DW22A	"
	-049DW22B	"
050	-050CF22A	Classroom 12
	-050CF22B	"
051	-051DW22A	"
	-051DW22B	"
052	-052NS22A	Nurse Room
	-052NS22B	"



2 of 2

Apex Laboratories



Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

PBS Engineering and Environmental

4412 S Corbett Ave

Portland, OR 97239

Project: **Dayton School District**

Project Number: **Dayton Grade School/27350**

Project Manager: **James Mastanduno**

Report ID:

A2F0092 - 06 20 22 1634

Lead in Drinking Water Testing Program


A2F0092

Fixture Number	Sample Number	Room / Location
053	22531211-053CF22A	Classroom 15
	-053CF22B	"
054	-054XW22A	"
	-054XW22B	"
055	-055BF22A	Bathroom 127
	-055BF22B	"
056	-056BF22A	Bathroom 126
	-056BF22B	"
057	-057BF22A	Boys RR 125
	-057BF22B	"
058	-058BF22A	Girls RR 123
	-058BF22B	"
059	-059SF22A	Staff room 122
	-059SF22B	"
060	-060WB22A	Hallway outside Counseling 121
	-060WB22B	"
061	-061DW22A	"
	-061DW22B	"
062	-062CF22A	Classroom 16
	-062CF22B	"
063	-063DW22A	"
	-063DW22B	"
064	-064CF22A	Classroom 17
	-064CF22B	"
065	-065DW22A	"
	-065DW22B	"
066	-066CF22A	Classroom 18
	-066CF22B	"
067	-067DW22A	"
	-067DW22B	"
068	-068CF22A	Classroom 19
	-068CF22B	"
069	-069DW22A	"
	-069DW22B	"
70	-070CF22A	Classroom 20
	-070CF22B	"
71	-071CF22A	Classroom 21
	-071CF22B	"



2 of 2

Apex Laboratories



Jason Woodcock, Project Manager

The results in this report apply to the samples analyzed in accordance with the chain of custody document. This analytical report must be reproduced in its entirety.

PBS Engineering and Environmental

4412 S Corbett Ave

Portland, OR 97239

Project: Dayton School District

Project Number: Dayton Grade School/27350

Project Manager: James Mastanduno

Report ID:

A2F0092 - 06 20 22 1634

Lead in Drinking Water Testing Program

A2F0092

Fixture Number	Sample Number	Room / Location
072	22531211-072DW2A	Classroom 21
	-072DW2B	"
073	-073DW2A	Gym/Cafe; Main entrance
	-073DW2B	"
074	-074DW2A	"
	-074DW2B	"
075	-075BF2A	Gym/Cafe; Girls RR
	-075BF2B	"
076	-076BF2A	"
	-076BF2B	"
077	-077BF2A	"
	-077BF2B	"
078	-078BF2A	Gym/Cafe; Staff RR
	-078BF2B	"
079	-079BF2A	Gym/Cafe; Boys RR
	-079BF2B	"
080	-080BF2A	"
	-080BF2B	"
081	-081DF2A	"
	-081DF2B	"
082	-082CF2A	Gym/Cafe; Music room
	-082CF2B	"
083	-083BF2A	Gym/Cafe; Gym
	-083BF2B	"
084	-084BF2A	"
	-084BF2B	"
085	-085KF2A	Kitchen
	-085KF2B	"
086	-086KF2A	"
	-086KF2B	"
087	-087KF2A	"
	-087KF2B	"
088	-088KF2A	"
	-088KF2B	"
089	-089KF2A	"
	-089KF2B	"
090	-090KE2A	"
	-090KE2B	"

PBS Engineering and Environmental

4412 S Corbett Ave
Portland, OR 97239

Project: **Dayton School District**

Project Number: **Dayton Grade School/27350**

Project Manager: **James Mastanduno**

Report ID:

A2F0092 - 06 20 22 1634

APEX LABS COOLER RECEIPT FORM

Client: PBS Element WO#: A2F0092
Dayton School District
Project/Project #: Dayton Grade School / 27350.000 Phase 01

Delivery Info:

Date/time received: 6/1/22 @ 1249 By: AM
Delivered by: Apex ☒ Client ☐ ESS ☐ FedEx ☐ UPS ☐ Swift ☐ Senvoy ☐ SDS ☐ Other ☐

Cooler Inspection Date/time inspected: 6/1/22 @ 1357 By: AM

Chain of Custody included? Yes ☒ No ☐ Custody seals? Yes ☐ No ☒

Signed/dated by client? Yes ☒ No ☐

Signed/dated by Apex? Yes ☒ No ☐

	Cooler #1	Cooler #2	Cooler #3	Cooler #4	Cooler #5	Cooler #6	Cooler #7
Temperature (°C)	<u>21.1</u>						
Received on ice? (Y/N)	<u>N</u>						
Temp. blanks? (Y/N)	<u>N</u>						
Ice type: (Gel/Real/Other)	<u>None</u>						
Condition:	<u>N/A</u>						

Cooler out of temp? (Y/N) Possible reason why: Drinking Water

Green dots applied to out of temperature samples? Yes ☐ No ☒

Out of temperature samples form initiated? Yes ☒ No ☐

Sample Inspection: Date/time inspected: 6-3-22 @ 1320 By: DJS

All samples intact? Yes ☒ No ☐ Comments: _____

Bottle labels/COCs agree? Yes ☒ No ☐ Comments: No date on containers.

COC/container discrepancies form initiated? Yes ☐ No ☒

Containers/volumes received appropriate for analysis? Yes ☒ No ☐ Comments: _____

Do VOA vials have visible headspace? Yes ☐ No ☐ NA ☒

Comments: _____

Water samples: pH checked: Yes ☒ No ☐ NA ☐ pH appropriate? Yes ☒ No ☐ NA ☐

Comments: _____

Additional information: Date on COC reads 5/13/22, but samples relinquished on 5/31.

Labeled by: AM Witness: AM Cooler Inspected by: DJS