

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

Reported: 03/17/2017  
Received: 02/02/2017  
Sampled By:  
Work Order: 7033005


**C** Tigard-Tualatin SD  
**L** Attn: Phil Wentz  
**I** 6960 SW Sandburg St.  
**E** Tigard OR, 97223  
**N** Phone: (503) 431-4017  
**T**

**Project:**  
Project # : N/A  
Sample Type :

Sampling Location: Tigard HS

**Lab Number**

	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
<b>7033005-01</b>	<b>Sample Name:</b> Rm 334 Eye Wash <b>Sampled:</b> 2/1/17 5:07						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	11.7	ppb	2.0	20 ppb	03/13/17 16:56
<b>7033005-02</b>	<b>Sample Name:</b> Rm 330 F1 West <b>Sampled:</b> 2/1/17 5:07						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/13/17 16:56
<b>7033005-03</b>	<b>Sample Name:</b> Rm 322 F1 West <b>Sampled:</b> 2/1/17 5:07						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/13/17 16:56
<b>7033005-04</b>	<b>Sample Name:</b> Lower Science Mens F left <b>Sampled:</b> 2/1/17 5:07						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/13/17 16:56
<b>7033005-05</b>	<b>Sample Name:</b> Lower Science Unisex <b>Sampled:</b> 2/1/17 5:07						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/13/17 16:56
<b>7033005-06</b>	<b>Sample Name:</b> Lower Science women F right <b>Sampled:</b> 2/1/17 5:07						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/13/17 16:56
<b>7033005-07</b>	<b>Sample Name:</b> Rm 313 F1 East <b>Sampled:</b> 2/1/17 5:07						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/13/17 16:56
<b>7033005-08</b>	<b>Sample Name:</b> Rm 325 F1 East <b>Sampled:</b> 2/1/17 5:07						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/13/17 16:56
<b>7033005-09</b>	<b>Sample Name:</b> Rm 329 F1 East <b>Sampled:</b> 2/1/17 5:07						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/13/17 16:56
<b>7033005-10</b>	<b>Sample Name:</b> Rm 323 F1 right <b>Sampled:</b> 2/1/17 5:07						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/13/17 16:56

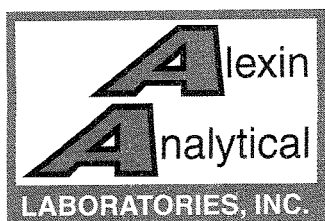

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

# ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 03/17/2017  
Received: 02/02/2017  
Sampled By:  
Work Order: 7033005


**C L I E N T**  
**Tigard-Tualatin SD**  
Attn: Phil Wentz  
6960 SW Sandburg St.  
Tigard OR, 97223  
Phone: (503) 431-4017

**Project:**  
Project # : N/A  
Sample Type :

Sampling Location: Tigard HS

## Lab Number

	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
<b>7033005-11</b>	<b>Sample Name:</b> Rm 319 F1 right West <b>Sampled:</b> 2/1/17 5:17						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/13/17 16:56
<b>7033005-12</b>	<b>Sample Name:</b> Rm 246 F <b>Sampled:</b> 2/1/17 5:17						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/13/17 16:56
<b>7033005-13</b>	<b>Sample Name:</b> library work Rm F <b>Sampled:</b> 2/1/17 5:17						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	2.1	ppb	2.0	20 ppb	03/13/17 16:56
<b>7033005-14</b>	<b>Sample Name:</b> Rm 108 BB <b>Sampled:</b> 2/1/17 5:17						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/13/17 16:56
<b>7033005-15</b>	<b>Sample Name:</b> Rm 108 F right <b>Sampled:</b> 2/1/17 5:17						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/13/17 16:56
<b>7033005-16</b>	<b>Sample Name:</b> Rm 229 F <b>Sampled:</b> 2/1/17 5:17						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/13/17 16:56
<b>7033005-17</b>	<b>Sample Name:</b> Rm 231 restroom F <b>Sampled:</b> 2/1/17 5:17						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/13/17 16:56
<b>7033005-18</b>	<b>Sample Name:</b> Rm 237 restroom F left <b>Sampled:</b> 2/1/17 5:17						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/13/17 16:56
<b>7033005-19</b>	<b>Sample Name:</b> Rm 239 restroom F right <b>Sampled:</b> 2/1/17 5:17						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/13/17 16:56
<b>7033005-20</b>	<b>Sample Name:</b> Activities F <b>Sampled:</b> 2/1/17 5:17						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/13/17 16:56

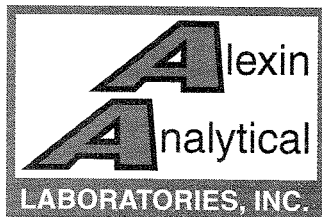

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**Professional  
Laboratory  
Services**

## ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 03/17/2017

Received: 02/02/2017

Sampled By:

Work Order: 7033005

**C**  
**L**  
**I**  
**E**  
**N**  
**T**  
**Tigard-Tualatin SD**  
Attn: Phil Wentz  
6960 SW Sandburg St.  
Tigard OR, 97223  
Phone: (503) 431-4017

**Project:**


Project # : N/A

Sample Type :

Sampling Location: Tigard HS

### Lab Number

	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
<b>7033005-21</b>	<b>Sample Name:</b> Rm 8 restroom F <b>Sampled:</b> 2/1/17 5:30						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/13/17 16:56
<b>7033005-22</b>	<b>Sample Name:</b> student store F <b>Sampled:</b> 2/1/17 5:30						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/13/17 16:56
<b>7033005-23</b>	<b>Sample Name:</b> Rm 414 restroom F left <b>Sampled:</b> 2/1/17 5:30						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/13/17 16:56
<b>7033005-24</b>	<b>Sample Name:</b> Rm 408 BB <b>Sampled:</b> 2/1/17 5:30						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/13/17 16:56
<b>7033005-25</b>	<b>Sample Name:</b> Rm 410 restroom F <b>Sampled:</b> 2/1/17 5:30						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/13/17 16:56
<b>7033005-26</b>	<b>Sample Name:</b> Rm 408 F <b>Sampled:</b> 2/1/17 5:30						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	5.6	ppb	2.0	20 ppb	03/13/17 16:56
<b>7033005-27</b>	<b>Sample Name:</b> Rm 410 F <b>Sampled:</b> 2/1/17 5:30						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	2.0	ppb	2.0	20 ppb	03/13/17 16:56
<b>7033005-28</b>	<b>Sample Name:</b> Rm 434 F 1 right <b>Sampled:</b> 2/1/17 5:30						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/15/17 14:15
<b>7033005-29</b>	<b>Sample Name:</b> By rm 514 Uni Restroom F <b>Sampled:</b> 2/1/17 5:30						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/15/17 14:15
<b>7033005-30</b>	<b>Sample Name:</b> Varsity basketball F <b>Sampled:</b> 2/1/17 5:40						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/15/17 14:15

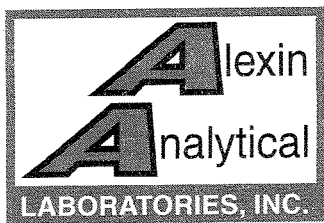

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

## ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 03/17/2017

Received: 02/02/2017

Sampled By:

Work Order: 7033005

C  
L  
I  
E  
N  
T

### Tigard-Tualatin SD

Attn: Phil Wentz

6960 SW Sandburg St.

Tigard OR, 97223

Phone: (503) 431-4017

### Project:


Project # : N/A

Sample Type :

Sampling Location: Tigard HS

### Lab Number

	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
<b>7033005-32</b>	<b>Sample Name:</b> Varsity team Women F West <b>Sampled:</b> 2/1/17 5:40						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/15/17 14:15
<b>7033005-33</b>	<b>Sample Name:</b> Varsity Team Rm 508 F <b>Sampled:</b> 2/1/17 5:40						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/15/17 14:15
<b>7033005-34</b>	<b>Sample Name:</b> Rm 628 Girls restroom F <b>Sampled:</b> 2/1/17 5:40						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	22.3	ppb	2.0	20 ppb	03/15/17 14:15 MCLE
<b>7033005-35</b>	<b>Sample Name:</b> Rm 628 Boys restroom F <b>Sampled:</b> 2/1/17 5:40						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/15/17 14:15
<b>7033005-36</b>	<b>Sample Name:</b> 618 C F <b>Sampled:</b> 2/1/17 5:40						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	7.2	ppb	2.0	20 ppb	03/15/17 14:15
<b>7033005-37</b>	<b>Sample Name:</b> CE 2 restroom F <b>Sampled:</b> 2/1/17 5:40						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/15/17 14:15
<b>7033005-38</b>	<b>Sample Name:</b> Rm 622 F <b>Sampled:</b> 2/1/17 5:40						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	8.7	ppb	2.0	20 ppb	03/15/17 14:15
<b>7033005-39</b>	<b>Sample Name:</b> Rm 602 F left <b>Sampled:</b> 2/1/17 5:50						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	4.9	ppb	2.0	20 ppb	03/15/17 17:23
<b>7033005-40</b>	<b>Sample Name:</b> Rm 600 F1 <b>Sampled:</b> 2/1/17 5:50						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/15/17 17:23
<b>7033005-41</b>	<b>Sample Name:</b> Rm 400A F <b>Sampled:</b> 2/1/17 5:50						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/15/17 17:23

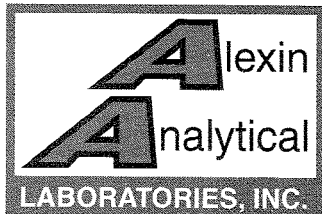

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

Professional  
Laboratory  
Services

## ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 03/17/2017

Received: 02/02/2017

Sampled By:

Work Order: 7033005

**C**  
**L**  
**I**  
**E**  
**N**  
**T** **Tigard-Tualatin SD**  
Attn: Phil Wentz  
6960 SW Sandburg St.  
Tigard OR, 97223  
Phone: (503) 431-4017

**Project:**

Project # : N/A

Sample Type :

Sampling Location: Tigard HS

---

### Lab Number

---

**MCLE** This analyte exceeds the MCL limit.

**ND** = None detected at the MRL    **MRL** = Minimum Reporting Limit    **MCL** = Maximum Contamination Limit


†All procedures for this analysis are in accordance with NELAP standards.

\* The EPA MCL for Lead in Public Drinking Water Systems is 15 ppb. For school, daycare, or non-residential building testing the EPA recommends outlets be taken out of service if the lead level exceeds 20 ppb; this is a maximum contamination level for lead in samples based on a 250 mL first-draw sample, exceedences require remediation or further sampling. This is not an acceptance level for health based exposure.

Approved by: \_\_\_\_\_

Adriana Gonzalez-Gray  
Laboratory Director

*This report shall not be reproduced, except in full, without the written approval of the laboratory.*

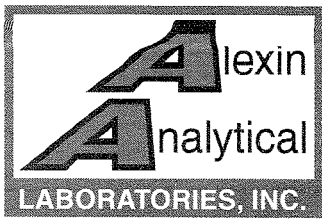

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

**ANALYSIS REPORT**

ORELAP Accredited Lab#: OR-100013

Reported: 03/03/2017  
Received: 01/31/2017  
Sampled By:  
Work Order: 7031005

**C** Tigard-Tualatin SD  
**L** Attn: Phil Wentz  
**I** 6960 SW Sandburg St.  
**E** Tigard OR, 97223  
**N** Phone: (503) 431-4017  
**T**

**Project:**  
Project # : N/A  
Sample Type :

Sampling Location: Tigard HS Cafe Aud.

**Lab Number**

	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
<b>7031005-01</b>	<b>Sample Name:</b> Kitchen hand Wash <b>Sampled:</b> 1/31/17 4:30						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/01/17 14:04
<b>7031005-02</b>	<b>Sample Name:</b> Cafe Boys <b>Sampled:</b> 1/31/17 4:30						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/01/17 14:04
<b>7031005-03</b>	<b>Sample Name:</b> Cafe Girls right <b>Sampled:</b> 1/31/17 4:30						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/01/17 14:04
<b>7031005-04</b>	<b>Sample Name:</b> Theater Dress Boys Right <b>Sampled:</b> 1/31/17 4:30						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	21.0	ppb	2.0	20 ppb	03/01/17 14:04 MCLE
<b>7031005-05</b>	<b>Sample Name:</b> Theater Dress Girls <b>Sampled:</b> 1/31/17 4:30						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	33.9	ppb	2.0	20 ppb	03/01/17 14:04 MCLE
<b>7031005-06</b>	<b>Sample Name:</b> Theater Paint Rm Left <b>Sampled:</b> 1/31/17 4:30						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	14.6	ppb	2.0	20 ppb	03/01/17 14:04
<b>7031005-07</b>	<b>Sample Name:</b> Theater Todd's Bath <b>Sampled:</b> 1/31/17 4:30						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	53.2	ppb	4.0	20 ppb	03/01/17 14:04 MCLE
<b>7031005-08</b>	<b>Sample Name:</b> Theater Front Mens Left <b>Sampled:</b> 1/31/17 4:30						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	21.6	ppb	2.0	20 ppb	03/01/17 14:04 MCLE
<b>7031005-09</b>	<b>Sample Name:</b> Theater Womens Right <b>Sampled:</b> 1/31/17 4:30						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	65.1	ppb	4.0	20 ppb	03/01/17 14:04 MCLE
<b>7031005-10</b>	<b>Sample Name:</b> Kitchen sink by stove <b>Sampled:</b> 1/31/17 4:30						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	03/01/17 14:04



Professional  
Laboratory  
Services

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

## ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 03/03/2017

Received: 01/31/2017

Sampled By:

Work Order: 7031005

**C**  
**L**  
**I**  
**E**  
**N**  
**T** **Tigard-Tualatin SD**  
Attn: Phil Wentz  
6960 SW Sandburg St.  
Tigard OR, 97223  
Phone: (503) 431-4017

**Project:**

Project # : N/A

Sample Type :

Sampling Location: Tigard HS Cafe Aud.

---

### Lab Number

---

**MCLE** This analyte exceeds the MCL limit.

**ND** = None detected at the MRL

**MRL** = Minimum Reporting Limit


**MCL** = Maximum Contamination Limit

†All procedures for this analysis are in accordance with NELAP standards.

\* The EPA MCL for Lead in Public Drinking Water Systems is 15 ppb. For school, daycare, or non-residential building testing the EPA recommends outlets be taken out of service if the lead level exceeds 20 ppb; this is a maximum contamination level for lead in samples based on a 250 mL first-draw sample, exceedences require remediation or further sampling. This is not an acceptance level for health based exposure.

Approved by: \_\_\_\_\_

  
Adriana Gonzalez-Gray  
Laboratory Director

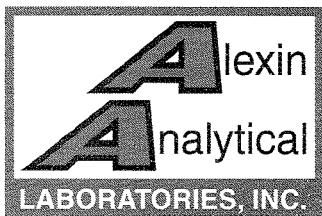

**Professional  
Laboratory  
Services**

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

## ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 03/03/2017  
Received: 01/31/2017  
Sampled By:  
Work Order: 7031004


**C** **Tigard-Tualatin SD**  
**L** Attn: Phil Wentz  
**I** 6960 SW Sandburg St.  
**E** Tigard OR, 97223  
**N** Phone: (503) 431-4017  
**T**

**Project:**  
Project # : N/A  
Sample Type :

Sampling Location: Tigard HS Small Gym

### Lab Number

	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
<b>7031004-01</b>	<b>Sample Name:</b> Gym trainers sink <b>Sampled:</b> 1/31/17 4:54						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	9.7	ppb	2.0	20 ppb	02/28/17 16:38
<b>7031004-02</b>	<b>Sample Name:</b> Gym Boys Locker sink <b>Sampled:</b> 1/31/17 4:54						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	15.8	ppb	2.0	20 ppb	02/28/17 16:38
<b>7031004-03</b>	<b>Sample Name:</b> Gym Boys upper left <b>Sampled:</b> 1/31/17 4:54						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	4.7	ppb	2.0	20 ppb	03/01/17 14:04
<b>7031004-04</b>	<b>Sample Name:</b> Small gym Boys upper left <b>Sampled:</b> 1/31/17 4:54						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	3.3	ppb	2.0	20 ppb	03/01/17 14:04
<b>7031004-05</b>	<b>Sample Name:</b> Small gym Girls upper left <b>Sampled:</b> 1/31/17 4:54						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	6.7	ppb	2.0	20 ppb	03/01/17 14:04
<b>7031004-06</b>	<b>Sample Name:</b> Small gym sink by coaches <b>Sampled:</b> 1/31/17 4:54						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	5.6	ppb	2.0	20 ppb	03/01/17 14:04
<b>7031004-07</b>	<b>Sample Name:</b> Coaches Sink <b>Sampled:</b> 1/31/17 4:54						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	<b>36.7</b>	ppb	2.0	20 ppb	03/01/17 14:04 <b>MCLE</b>
<b>7031004-08</b>	<b>Sample Name:</b> Small gym JV Team <b>Sampled:</b> 1/31/17 4:54						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	<b>60.2</b>	ppb	4.0	20 ppb	03/01/17 14:04 <b>MCLE</b>
<b>7031004-09</b>	<b>Sample Name:</b> Small gym Varsity Team <b>Sampled:</b> 1/31/17 5:05						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	<b>43.2</b>	ppb	4.0	20 ppb	03/01/17 14:04 <b>MCLE</b>
<b>7031004-10</b>	<b>Sample Name:</b> Small gym outside mens rt <b>Sampled:</b> 1/31/17 5:08						<b>Matrix:</b> Water
+Lead	1030	EPA 200.9	11.6	ppb	2.0	20 ppb	03/01/17 14:04

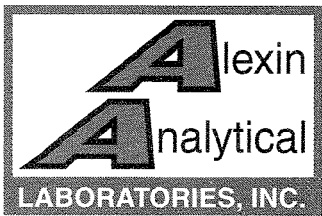

Professional  
Laboratory  
Services

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

## ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 03/03/2017

Received: 01/31/2017

Sampled By:

Work Order: 7031004

C  
L  
I  
E  
N  
T  
**Tigard-Tualatin SD**  
Attn: Phil Wentz  
6960 SW Sandburg St.  
Tigard OR, 97223  
Phone: (503) 431-4017

**Project:**  
Project # : N/A  
Sample Type :

Sampling Location: Tigard HS Small Gym

### Lab Number

	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
<b>7031004-11</b>	<b>Sample Name:</b> Small gym outside womens rt						<b>Matrix:</b> Water
	<b>Sampled:</b> 1/31/17 5:08						
+Lead	1030	EPA 200.9	<b>51.9</b>	ppb	4.0	20 ppb	03/01/17 14:04 <b>MCLE</b>


**MCLE** This analyte exceeds the MCL limit.

**ND** = None detected at the MRL      **MRL** = Minimum Reporting Limit      **MCL** = Maximum Contamination Limit


†All procedures for this analysis are in accordance with NELAP standards.

\* The EPA MCL for Lead in Public Drinking Water Systems is 15 ppb. For school, daycare, or non-residential building testing the EPA recommends outlets be taken out of service if the lead level exceeds 20 ppb; this is a maximum contamination level for lead in samples based on a 250 mL first-draw sample, exceedences require remediation or further sampling. This is not an acceptance level for health based exposure.

Approved by:

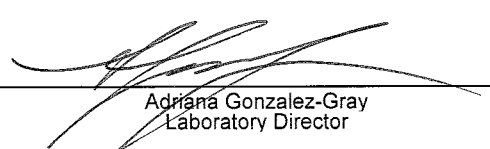  
Adriana Gonzalez-Gray  
Laboratory Director

This report shall not be reproduced, except in full, without the written approval of the laboratory.

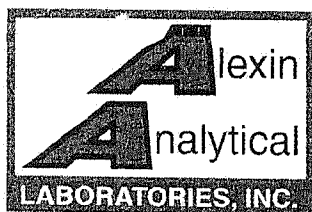

13035 SW Pacific Hwy  
Tigard, OR 97223  
Tel.: (503) 639-9311 Fax: (503) 684-1588

# Professional Laboratory Services

## ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 04/11/2017  
Received: 03/28/2017  
Sampled By:  
Work Order: 7087005

**C** Tigard-Tualatin SD  
**L** Attn: Phil Wentz  
**I** 6960 SW Sandburg St.  
**E** Tigard OR, 97223  
**N** Phone: (503) 431-4017  
**T**

**Project:**  
Project # : N/A  
Sample Type :

Sampling Location: Tigard HS

### Lab Number

	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
<b>7087005-01</b>	<b>Sample Name:</b> Sm-Gym wrestling RT fount <b>Sampled:</b> 3/20/17 6:00						<b>Matrix:</b> Water
†Lead	1030	EPA 200.9	7.0	ppb	2.0	20 ppb	04/10/17 13:54
<b>7087005-02</b>	<b>Sample Name:</b> Sm-Gym wrestling left fount <b>Sampled:</b> 3/20/17 6:00						<b>Matrix:</b> Water
†Lead	1030	EPA 200.9	4.9	ppb	2.0	20 ppb	04/10/17 13:54

**ND** = None detected at the MRL    **MRL** = Minimum Reporting Limit    **MCL** = Maximum Contamination Limit

†All procedures for this analysis are in accordance with NELAP standards.

\* The EPA MCL for Lead in Public Drinking Water Systems is 15 ppb. For school, daycare, or non-residential building testing the EPA recommends outlets be taken out of service if the lead level exceeds 20 ppb; this is a maximum contamination level for lead in samples based on a 250 mL first-draw sample, exceedences require remediation or further sampling. This is not an acceptance level for health based exposure.

Approved by: \_\_\_\_\_

Adriana Gonzalez-Gray  
Laboratory Director

This report shall not be reproduced, except in full, without the written approval of the laboratory.