

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 02/22/2017
Received: 01/27/2017
Sampled By: P Wentz
Work Order: 7027026


C Tigard-Tualatin SD
L Attn: Phil Wentz
I 6960 SW Sandburg St.
E Tigard OR, 97223
N Phone: (503) 431-4017
T

Project:
Project # : N/A
Sample Type :

Sampling Location: Byrom

Lab Number

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
7027026-01	Sample Name: room 1 bubbler Sampled: 1/27/17 5:15		Matrix: Water				
+Lead	1030	EPA 200.9	10.3	ppb	2.0	20 ppb	02/17/17 16:11
7027026-02	Sample Name: room 9 faucet Sampled: 1/27/17 5:15		Matrix: Water				
+Lead	1030	EPA 200.9	22.4	ppb	2.0	20 ppb	02/17/17 16:11 MCLE
7027026-03	Sample Name: room 9 bubbler Sampled: 1/27/17 5:15		Matrix: Water				
+Lead	1030	EPA 200.9	8.5	ppb	2.0	20 ppb	02/17/17 16:11
7027026-04	Sample Name: room 17 faucet Sampled: 1/27/17 5:15		Matrix: Water				
+Lead	1030	EPA 200.9	68.8	ppb	4.0	20 ppb	02/17/17 16:11 MCLE
7027026-05	Sample Name: room 17 bubbler Sampled: 1/27/17 5:15		Matrix: Water				
+Lead	1030	EPA 200.9	17.1	ppb	2.0	20 ppb	02/17/17 16:11
7027026-06	Sample Name: room 20 faucet Sampled: 1/27/17 5:15		Matrix: Water				
+Lead	1030	EPA 200.9	30.9	ppb	2.0	20 ppb	02/17/17 16:11 MCLE
7027026-07	Sample Name: room 20 bubbler Sampled: 1/27/17 5:15		Matrix: Water				
+Lead	1030	EPA 200.9	20.5	ppb	2.0	20 ppb	02/17/17 16:11 MCLE
7027026-08	Sample Name: room 23 faucet Sampled: 1/27/17 5:15		Matrix: Water				
+Lead	1030	EPA 200.9	3.4	ppb	2.0	20 ppb	02/17/17 16:11
7027026-09	Sample Name: room 23 bubbler Sampled: 1/27/17 5:15		Matrix: Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	02/17/17 16:11
7027026-10	Sample Name: Breezeway Boys Sink Sampled: 1/27/17 5:00		Matrix: Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	02/17/17 16:11

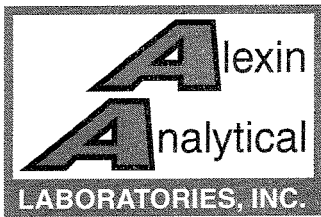

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT
ORELAP Accredited Lab#: OR-100013

Reported: 02/22/2017
Received: 01/27/2017
Sampled By: P Wentz
Work Order: 7027026


C **Tigard-Tualatin SD**
L Attn: Phil Wentz
I 6960 SW Sandburg St.
E Tigard OR, 97223
N Phone: (503) 431-4017
T

Project:
Project # : N/A
Sample Type :

Sampling Location: Byrom

Lab Number

	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
7027026-11	Sample Name: Breezeway Girls Sink Sampled: 1/27/17 5:00		Matrix: Water				
+Lead	1030	EPA 200.9	ND	ppb	2.0	20 ppb	02/17/17 16:11
7027026-12	Sample Name: Gym Boys sink Sampled: 1/27/17 5:00		Matrix: Water				
+Lead	1030	EPA 200.9	131	ppb	8.0	20 ppb	02/17/17 16:11 MCLE
7027026-13	Sample Name: Health room sink Sampled: 1/27/17 5:00		Matrix: Water				
+Lead	1030	EPA 200.9	15.4	ppb	2.0	20 ppb	02/17/17 16:11
7027026-14	Sample Name: Private rr cafe Sampled: 1/27/17 5:00		Matrix: Water				
+Lead	1030	EPA 200.9	19.0	ppb	2.0	20 ppb	02/17/17 16:11
7027026-15	Sample Name: Staff rr women Sampled: 1/27/17 5:00		Matrix: Water				
+Lead	1030	EPA 200.9	13.5	ppb	2.0	20 ppb	02/17/17 16:11
7027026-16	Sample Name: Staff unisex Sampled: 1/27/17 5:00		Matrix: Water				
+Lead	1030	EPA 200.9	8.6	ppb	2.0	20 ppb	02/21/17 17:10
7027026-17	Sample Name: By #3 Girls right sink Sampled: 1/27/17 5:00		Matrix: Water				
+Lead	1030	EPA 200.9	9.1	ppb	2.0	20 ppb	02/21/17 17:10
7027026-18	Sample Name: Boys 4 right Sampled: 1/27/17 5:00		Matrix: Water				
+Lead	1030	EPA 200.9	4.5	ppb	2.0	20 ppb	02/21/17 17:10
7027026-19	Sample Name: Room 7 faucet Sampled: 1/27/17 5:00		Matrix: Water				
+Lead	1030	EPA 200.9	28.0	ppb	2.0	20 ppb	02/21/17 17:10 MCLE
7027026-20	Sample Name: Room 7 Bubblers Sampled: 1/27/17 5:15		Matrix: Water				
+Lead	1030	EPA 200.9	39.1	ppb	2.0	20 ppb	02/21/17 17:10 MCLE

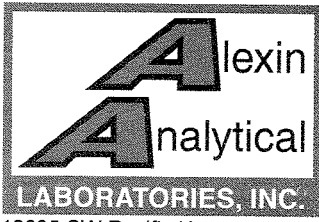

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 02/22/2017
Received: 01/27/2017
Sampled By: P Wentz
Work Order: 7027026

C **Tigard-Tualatin SD**
L Attn: Phil Wentz
I 6960 SW Sandburg St.
E Tigard OR, 97223
N Phone: (503) 431-4017
T

Project:
Project # : N/A
Sample Type :

Sampling Location: Byrom

Lab Number


Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
7027026-21	Sample Name: Girls rr by 11 left Sampled: 1/27/17 5:15		Matrix: Water				
+Lead	1030	EPA 200.9	19.9	ppb	2.0	20 ppb	02/21/17 17:10
7027026-22	Sample Name: Boys 12 left sink Sampled: 1/27/17 5:15		Matrix: Water				
+Lead	1030	EPA 200.9	6.6	ppb	2.0	20 ppb	02/21/17 17:10
7027026-23	Sample Name: Girls 19 left Sampled: 1/27/17 5:15		Matrix: Water				
+Lead	1030	EPA 200.9	14.1	ppb	2.0	20 ppb	02/21/17 17:10
7027026-24	Sample Name: Boys 20 left Sampled: 1/27/17 5:15		Matrix: Water				
+Lead	1030	EPA 200.9	11.2	ppb	2.0	20 ppb	02/21/17 17:10
7027026-25	Sample Name: room 12 faucet Sampled: 1/27/17 5:15		Matrix: Water				
+Lead	1030	EPA 200.9	18.5	ppb	2.0	20 ppb	02/21/17 17:10
7027026-26	Sample Name: room 12 bubbler Sampled: 1/27/17 5:15		Matrix: Water				
+Lead	1030	EPA 200.9	10.0	ppb	2.0	20 ppb	02/21/17 17:10
7027026-27	Sample Name: room 6 faucet Sampled: 1/27/17 5:15		Matrix: Water				
+Lead	1030	EPA 200.9	37.4	ppb	2.0	20 ppb	02/21/17 17:10 MCLE
7027026-28	Sample Name: room 6 bubbler Sampled: 1/27/17 5:15		Matrix: Water				
+Lead	1030	EPA 200.9	33.2	ppb	2.0	20 ppb	02/21/17 17:10 MCLE
7027026-29	Sample Name: room 1 faucet Sampled: 1/27/17 5:15		Matrix: Water				
+Lead	1030	EPA 200.9	20.0	ppb	2.0	20 ppb	02/21/17 17:10

MCLE This analyte exceeds the MCL limit.

ND = None detected at the MRL

MRL = Minimum Reporting Limit

MCL = Maximum Contamination Limit

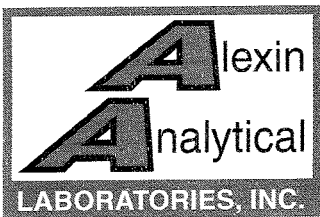

Professional Laboratory Services

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 02/22/2017
Received: 01/27/2017
Sampled By: P Wentz
Work Order: 7027026

C
L
I
E
N
T

Tigard-Tualatin SD

Attn: Phil Wentz
6960 SW Sandburg St.
Tigard OR, 97223
Phone: (503) 431-4017

Project:

Project # : N/A
Sample Type :

Sampling Location: Byrom

Lab Number

†All procedures for this analysis are in accordance with NELAP standards.

* The EPA MCL for Lead in Public Drinking Water Systems is 15 ppb. For school, daycare, or non-residential building testing the EPA recommends outlets be taken out of service if the lead level exceeds 20 ppb; this is a maximum contamination level for lead in samples based on a 250 mL first-draw sample, exceedences require remediation or further sampling. This is not an acceptance level for health based exposure.

Approved by: _____

Adriana Gonzalez-Gray
Laboratory Director

This report shall not be reproduced, except in full, without the written approval of the laboratory.