

**Professional
Laboratory
Services**

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 03/17/2017
Received: 02/23/2017
Sampled By:
Work Order: 7054018

C Tigard-Tualatin SD
L Attn: Phil Wentz
I 6960 SW Sandburg St.
E Tigard OR, 97223
N Phone: (503) 431-4017
T

Project:
Project # : N/A
Sample Type :


Sampling Location: Twality

Lab Number	Code	Method	Result	Units	MRL	EPA MCL*	Analysis Date/ Time
7054018-01	Sample Name: RM L28 faucet RT front Sampled: 2/22/17 5:30		Matrix: Water				
†Lead	1030	EPA 200.9	68.7	ppb	4.0	20 ppb	03/15/17 17:23 MCLE
7054018-02	Sample Name: RM L28 faucet flush RT front Sampled: 2/22/17 5:30		Matrix: Water				
†Lead	1030	EPA 200.9	33.3	ppb	2.0	20 ppb	03/15/17 17:23 MCLE
7054018-03	Sample Name: RM L28 faucet 2nd Sampled: 2/22/17 5:30		Matrix: Water				
†Lead	1030	EPA 200.9	84.7	ppb	8.0	20 ppb	03/15/17 17:23 MCLE
7054018-04	Sample Name: RM L28 faucet flush 2nd Sampled: 2/22/17 5:30		Matrix: Water				
†Lead	1030	EPA 200.9	31.1	ppb	2.0	20 ppb	03/15/17 17:23 MCLE
7054018-05	Sample Name: RM L28 faucet 3rd Sampled: 2/22/17 5:30		Matrix: Water				
†Lead	1030	EPA 200.9	95.8	ppb	8.0	20 ppb	03/15/17 17:23 MCLE
7054018-06	Sample Name: RM L28 faucet flush 3rd Sampled: 2/22/17 5:30		Matrix: Water				
†Lead	1030	EPA 200.9	5.0	ppb	2.0	20 ppb	03/15/17 17:23
7054018-07	Sample Name: RM L28 faucet 4th Sampled: 2/22/17 5:30		Matrix: Water				
†Lead	1030	EPA 200.9	155	ppb	8.0	20 ppb	03/15/17 17:23 MCLE
7054018-08	Sample Name: RM L28 faucet flush 4th Sampled: 2/22/17 6:00		Matrix: Water				
†Lead	1030	EPA 200.9	11.7	ppb	2.0	20 ppb	03/15/17 17:23

MCLE This analyte exceeds the MCL limit.

ND = None detected at the MRL **MRL** = Minimum Reporting Limit **MCL** = Maximum Contamination Limit

†All procedures for this analysis are in accordance with NELAP standards.

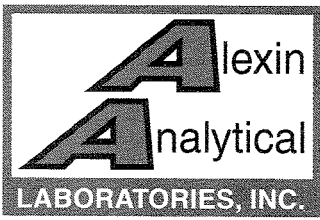

Professional Laboratory Services

13035 SW Pacific Hwy
Tigard, OR 97223
Tel.: (503) 639-9311 Fax: (503) 684-1588

ANALYSIS REPORT

ORELAP Accredited Lab#: OR-100013

Reported: 03/17/2017
Received: 02/23/2017
Sampled By:
Work Order: 7054018

C Tigard-Tualatin SD
L Attn: Phil Wentz
I 6960 SW Sandburg St.
E Tigard OR, 97223
N Phone: (503) 431-4017
T

Project:
Project # : N/A
Sample Type :

Sampling Location: Twality

Lab Number

* The EPA MCL for Lead in Public Drinking Water Systems is 15 ppb. For school, daycare, or non-residential building testing the EPA recommends outlets be taken out of service if the lead level exceeds 20 ppb; this is a maximum contamination level for lead in samples based on a 250 mL first-draw sample, exceedences require remediation or further sampling. This is not an acceptance level for health based exposure.

Approved by: _____

Adriana Gonzalez-Gray
Laboratory Director