



OF CONSTRUCTION)

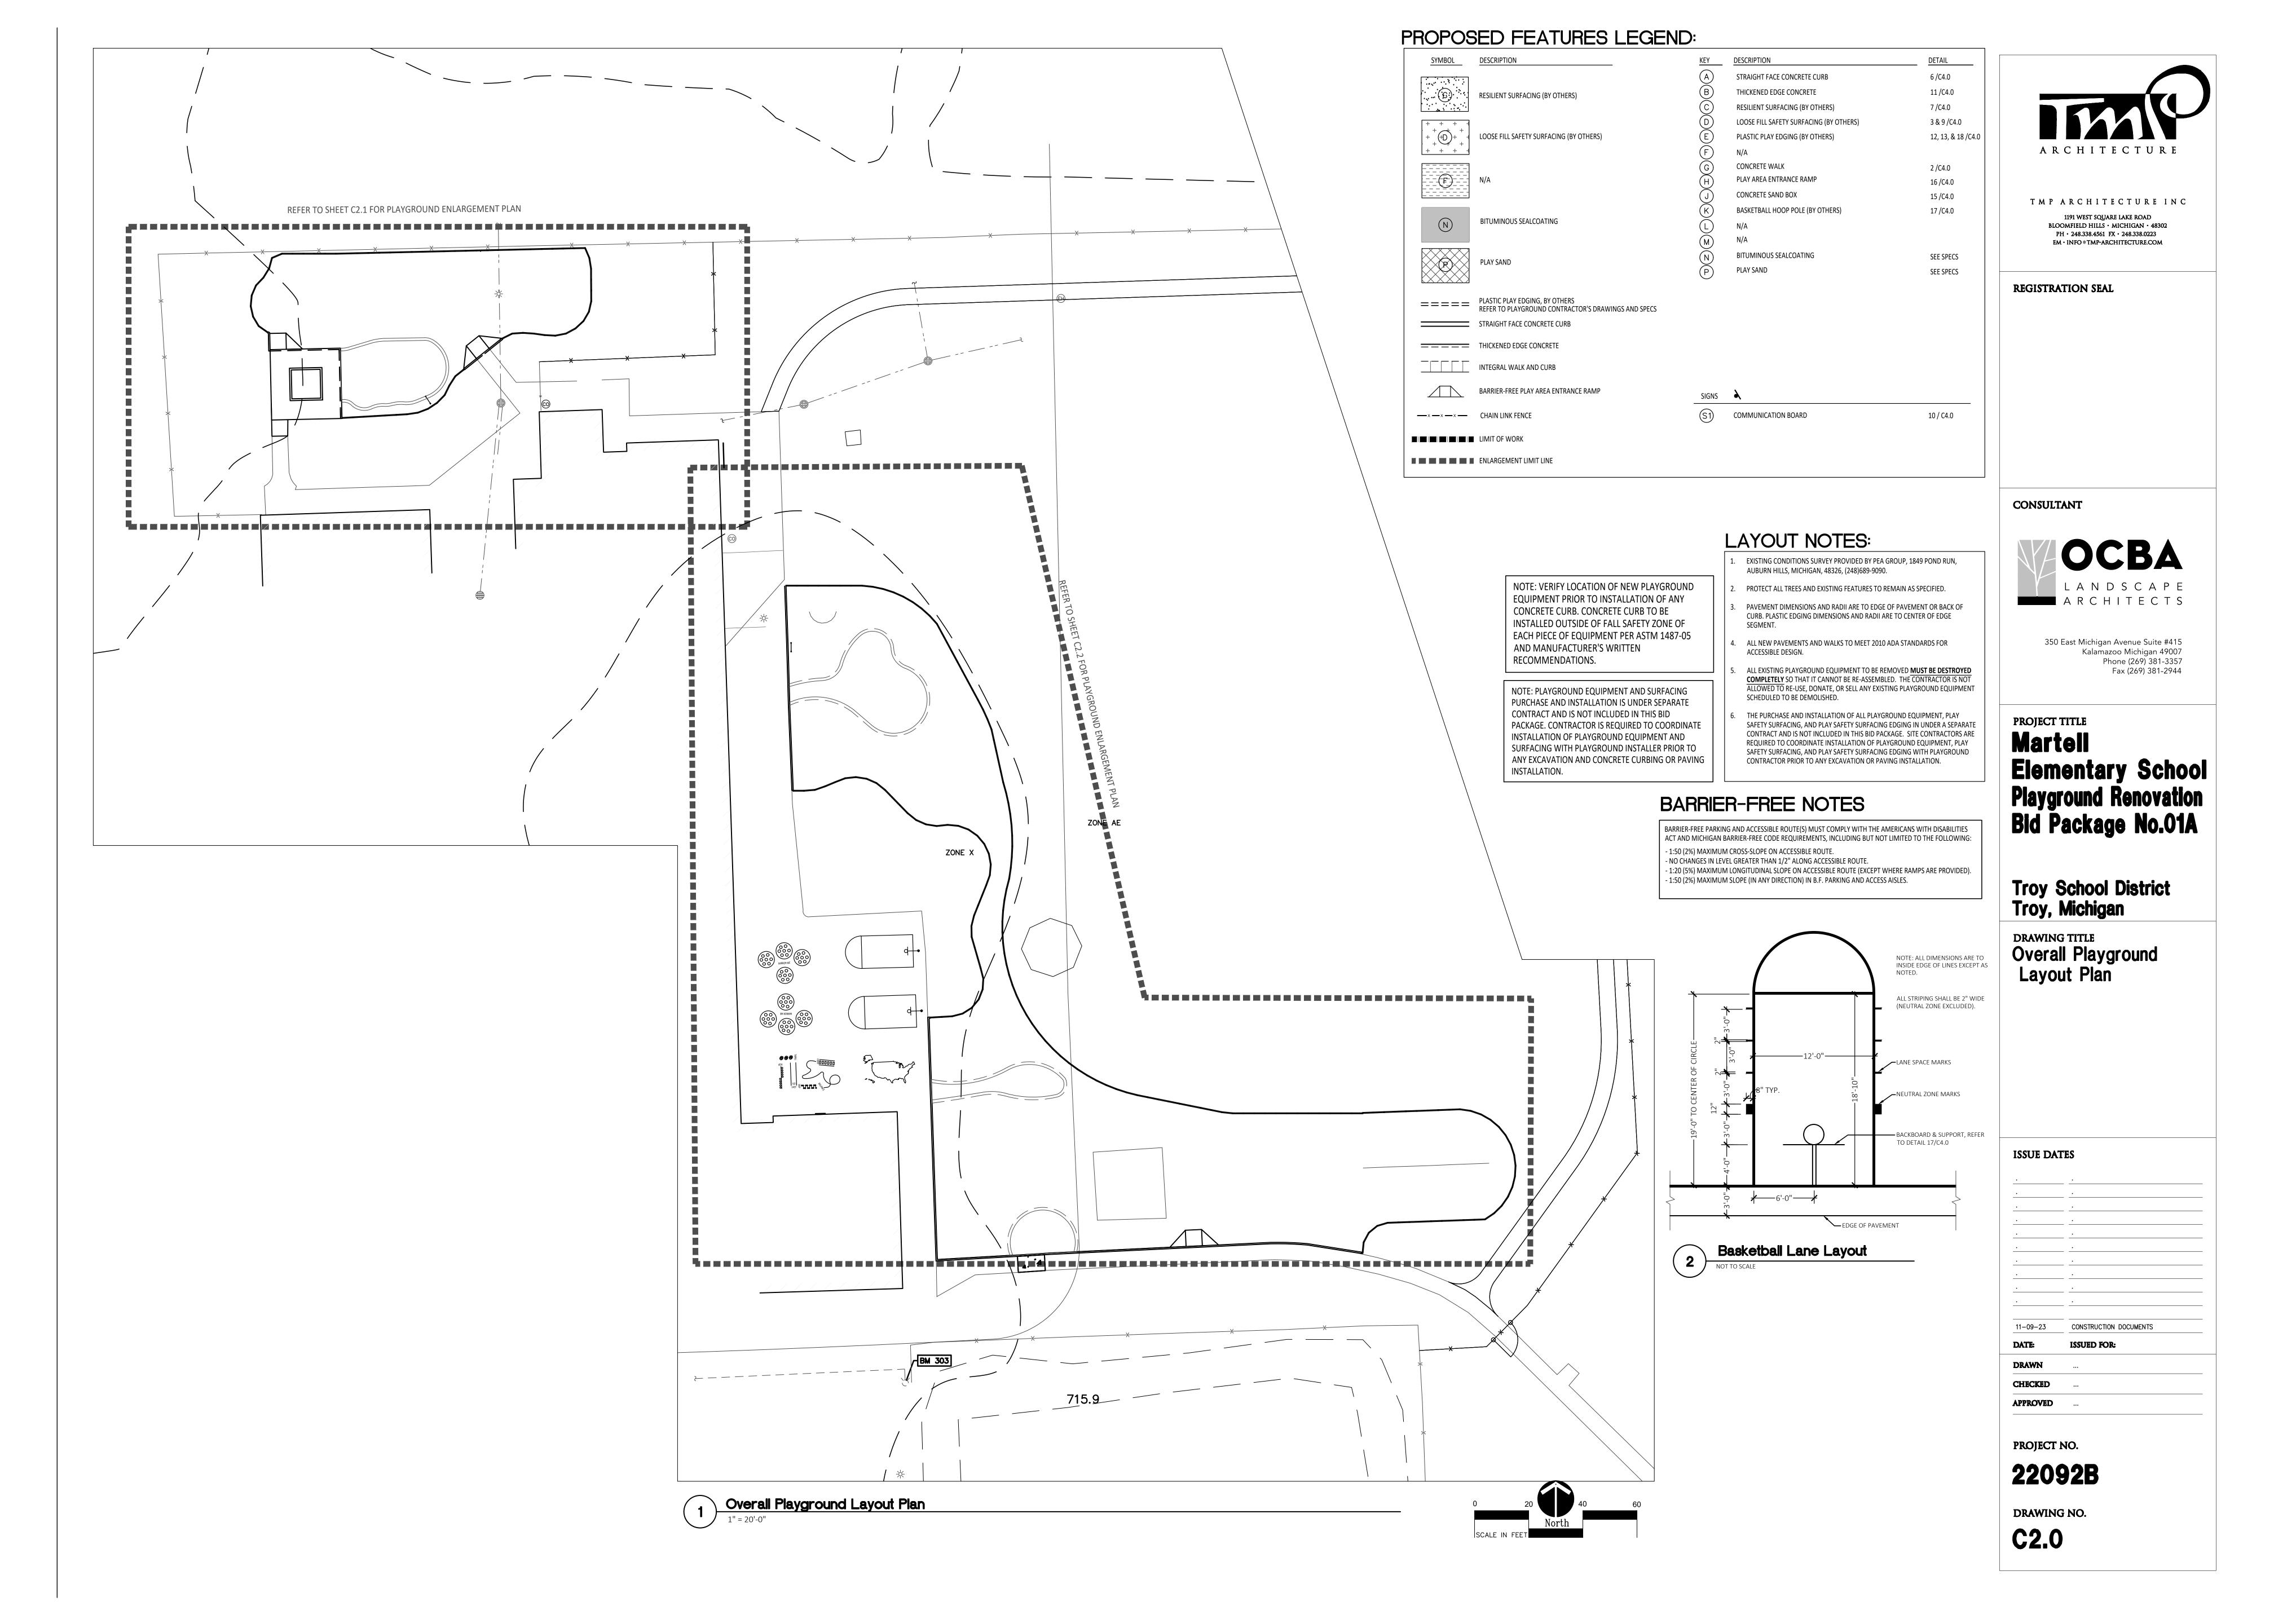

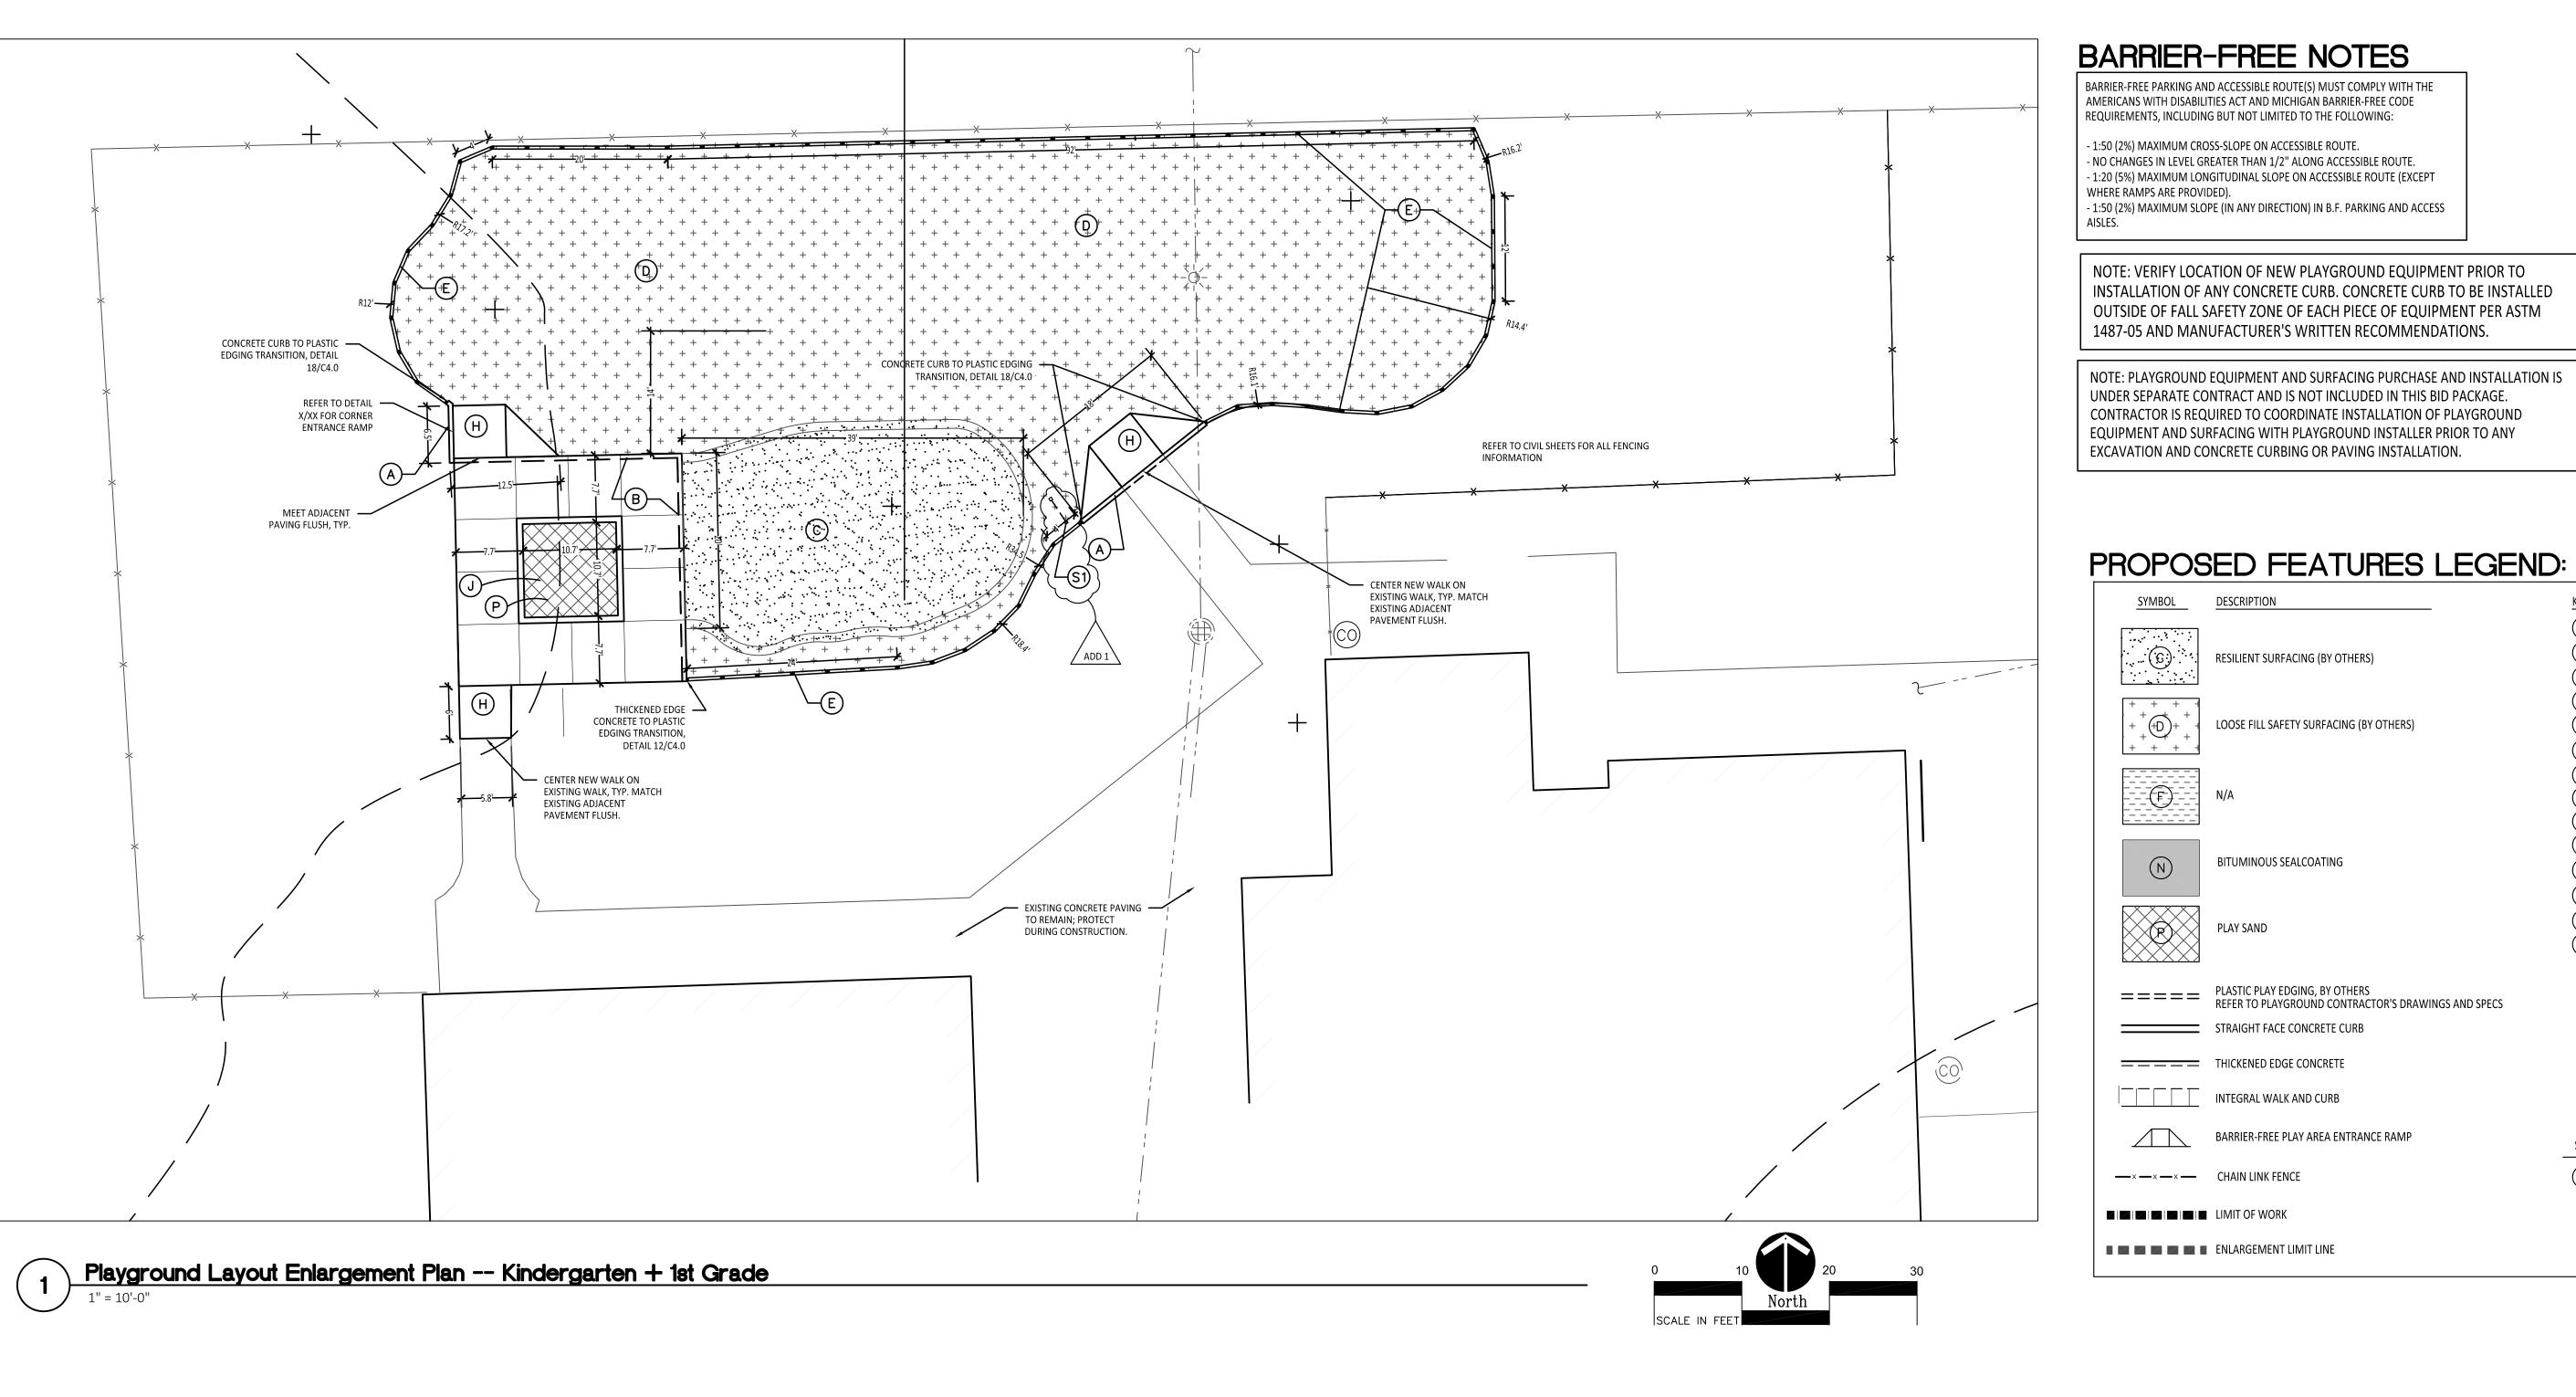

BARRIER-FREE NOTES

AMERICANS WITH DISABILITIES ACT AND MICHIGAN BARRIER-FREE CODE REQUIREMENTS, INCLUDING BUT NOT LIMITED TO THE FOLLOWING:

- 1:50 (2%) MAXIMUM CROSS-SLOPE ON ACCESSIBLE ROUTE. - NO CHANGES IN LEVEL GREATER THAN 1/2" ALONG ACCESSIBLE ROUTE. - 1:20 (5%) MAXIMUM LONGITUDINAL SLOPE ON ACCESSIBLE ROUTE (EXCEPT WHERE RAMPS ARE PROVIDED). - 1:50 (2%) MAXIMUM SLOPE (IN ANY DIRECTION) IN B.F. PARKING AND ACCESS

NOTE: VERIFY LOCATION OF NEW PLAYGROUND EQUIPMENT PRIOR TO INSTALLATION OF ANY CONCRETE CURB. CONCRETE CURB TO BE INSTALLED OUTSIDE OF FALL SAFETY ZONE OF EACH PIECE OF EQUIPMENT PER ASTM 1487-05 AND MANUFACTURER'S WRITTEN RECOMMENDATIONS.

NOTE: PLAYGROUND EQUIPMENT AND SURFACING PURCHASE AND INSTALLATION IS UNDER SEPARATE CONTRACT AND IS NOT INCLUDED IN THIS BID PACKAGE. CONTRACTOR IS REQUIRED TO COORDINATE INSTALLATION OF PLAYGROUND EQUIPMENT AND SURFACING WITH PLAYGROUND INSTALLER PRIOR TO ANY EXCAVATION AND CONCRETE CURBING OR PAVING INSTALLATION.

RESILIENT SURFACING (BY OTHERS)

BITUMINOUS SEALCOATING

STRAIGHT FACE CONCRETE CURB

———— THICKENED EDGE CONCRETE

INTEGRAL WALK AND CURB

—×—×— CHAIN LINK FENCE

==== PLASTIC PLAY EDGING, BY OTHERS
REFER TO PLAYGROUND CONTRACTOR'S DRAWINGS AND SPECS

LOOSE FILL SAFETY SURFACING (BY OTHERS)

LAYOUT NOTES:

SCHEDULED TO BE DEMOLISHED.

STRAIGHT FACE CONCRETE CURB

RESILIENT SURFACING (BY OTHERS)

PLASTIC PLAY EDGING (BY OTHERS)

BASKETBALL HOOP POLE (BY OTHERS)

CONCRETE WALK

PLAY AREA ENTRANCE RAMP

BITUMINOUS SEALCOATING

COMMUNICATION BOARD

PLAY SAND

SIGNS À

CONCRETE SAND BOX

LOOSE FILL SAFETY SURFACING (BY OTHERS)

THICKENED EDGE CONCRETE

EXISTING CONDITIONS SURVEY PROVIDED BY PEA GROUP, 1849 POND RUN, AUBURN HILLS, MICHIGAN, 48326, (248)689-9090.

PROTECT ALL TREES AND EXISTING FEATURES TO REMAIN AS SPECIFIED. PAVEMENT DIMENSIONS AND RADII ARE TO EDGE OF PAVEMENT OR BACK OF CURB. PLASTIC EDGING DIMENSIONS AND RADII ARE TO CENTER OF EDGE

ALL NEW PAVEMENTS AND WALKS TO MEET 2010 ADA STANDARDS FOR ACCESSIBLE DESIGN.

ALL EXISTING PLAYGROUND EQUIPMENT TO BE REMOVED MUST BE DESTROYED **COMPLETELY** SO THAT IT CANNOT BE RE-ASSEMBLED. THE CONTRACTOR IS NOT ALLOWED TO RE-USE, DONATE, OR SELL ANY EXISTING PLAYGROUND EQUIPMENT

6 /C4.0

11 /C4.0

7 /C4.0

2 /C4.0

16 /C4.0

15 /C4.0

17 /C4.0

SEE SPECS

SEE SPECS

10 / C4.0

3 & 9 /C4.0

12, 13, & 18 /C4.0

THE PURCHASE AND INSTALLATION OF ALL PLAYGROUND EQUIPMENT, PLAY REQUIRED TO COORDINATE INSTALLATION OF PLAYGROUND EQUIPMENT, PLAY SAFETY SURFACING, AND PLAY SAFETY SURFACING EDGING WITH PLAYGROUND CONTRACTOR PRIOR TO ANY EXCAVATION OR PAVING INSTALLATION.

TMP ARCHITECTURE INC 1191 WEST SQUARE LAKE ROAD

EM INFO TMP-ARCHITECTURE.COM

PH 248.338.4561 FX 248.338.0223

BLOOMFIELD HILLS MICHIGAN 48302

REGISTRATION SEAL

CONSULTANT



141 E. Michigan Avenue, Suite 500 Kalamazoo Michigan 49007 Phone (269) 381-3357 Fax (269) 381-2944

PROJECT TITLE

Martell Elementary School Playground Renovation Bid Package No.01A


Troy School District Troy, Michigan


DRAWING TITLE Playground Layout Enlargement Plan -Kindergarten & 1st Grade

ISSUE DATES ADDENDUM #1 CONSTRUCTION DOCUMENTS DRAWN CHECKED APPROVED PROJECT NO. 22092B

DRAWING NO.

C2.1

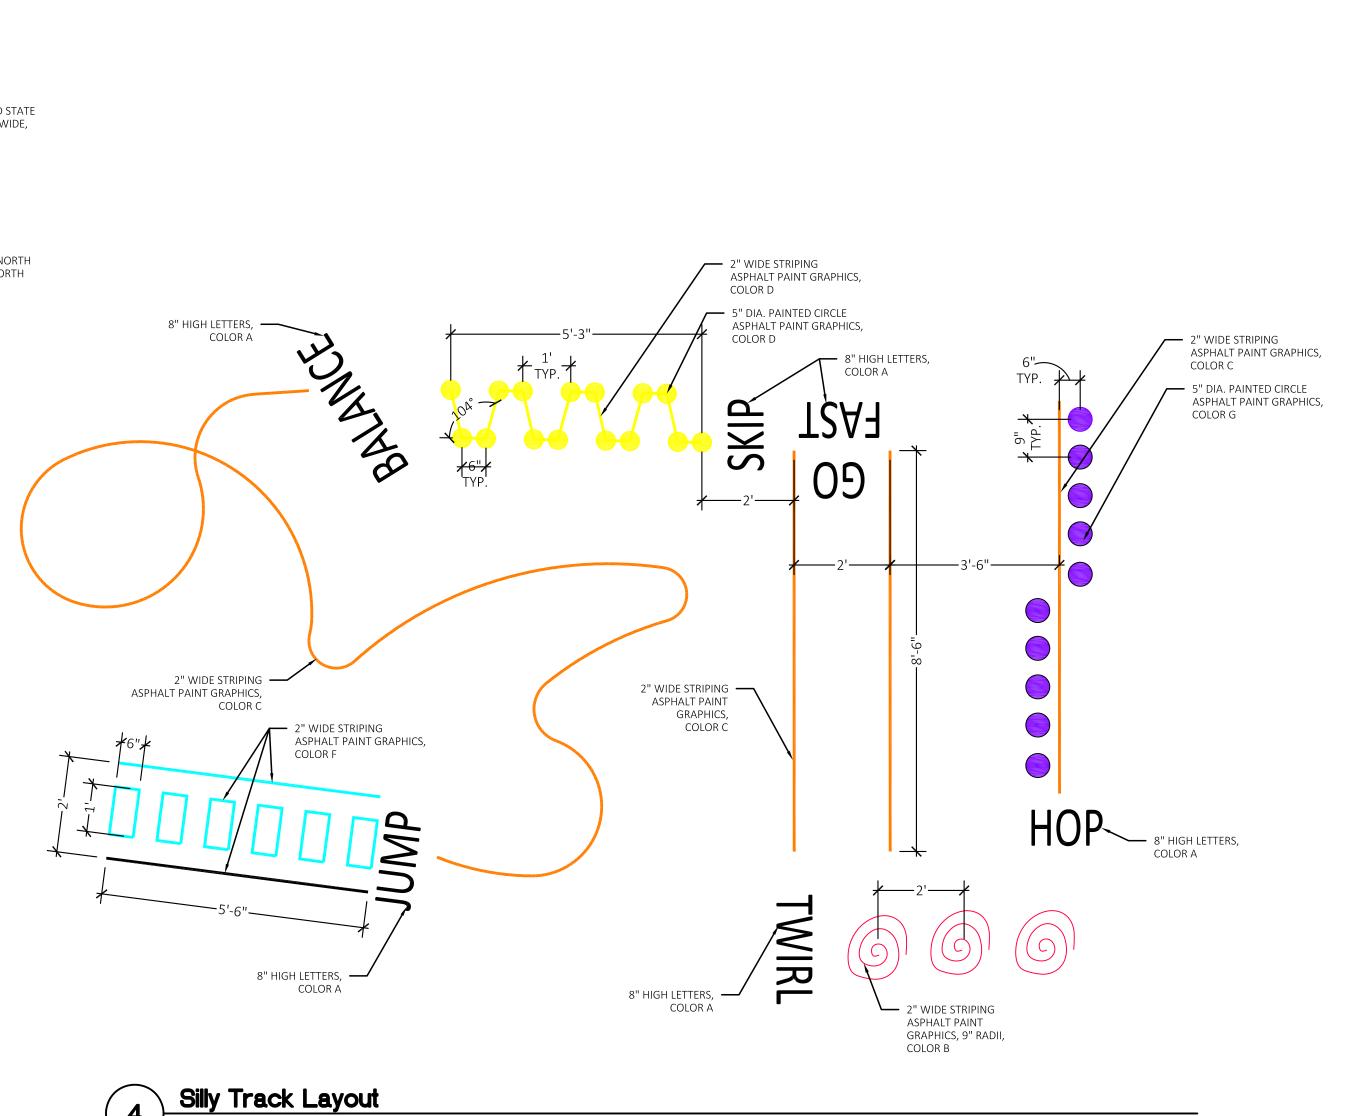


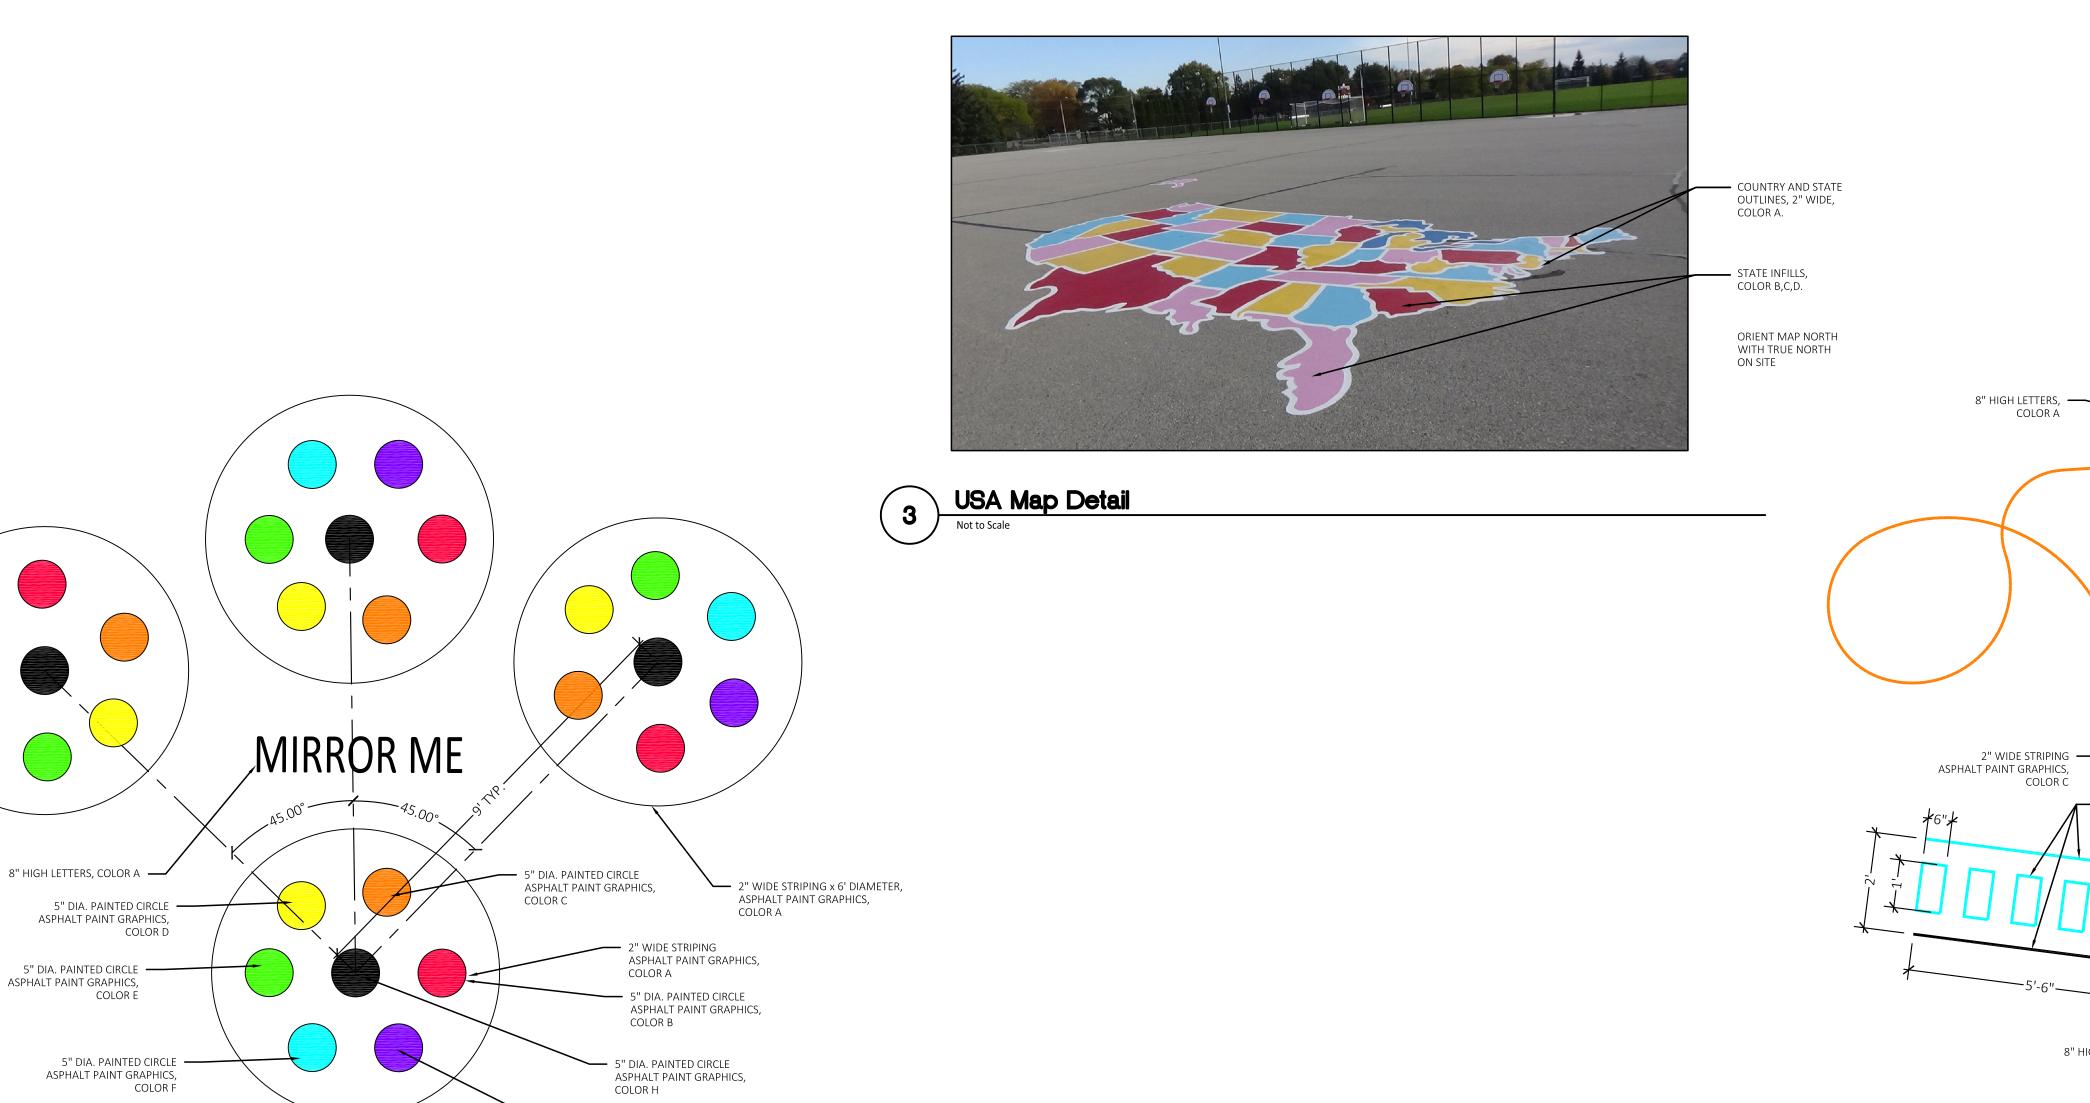

ASPHALT PAINT GRAPHICS,

Mirror Me Detail

Not to Scale

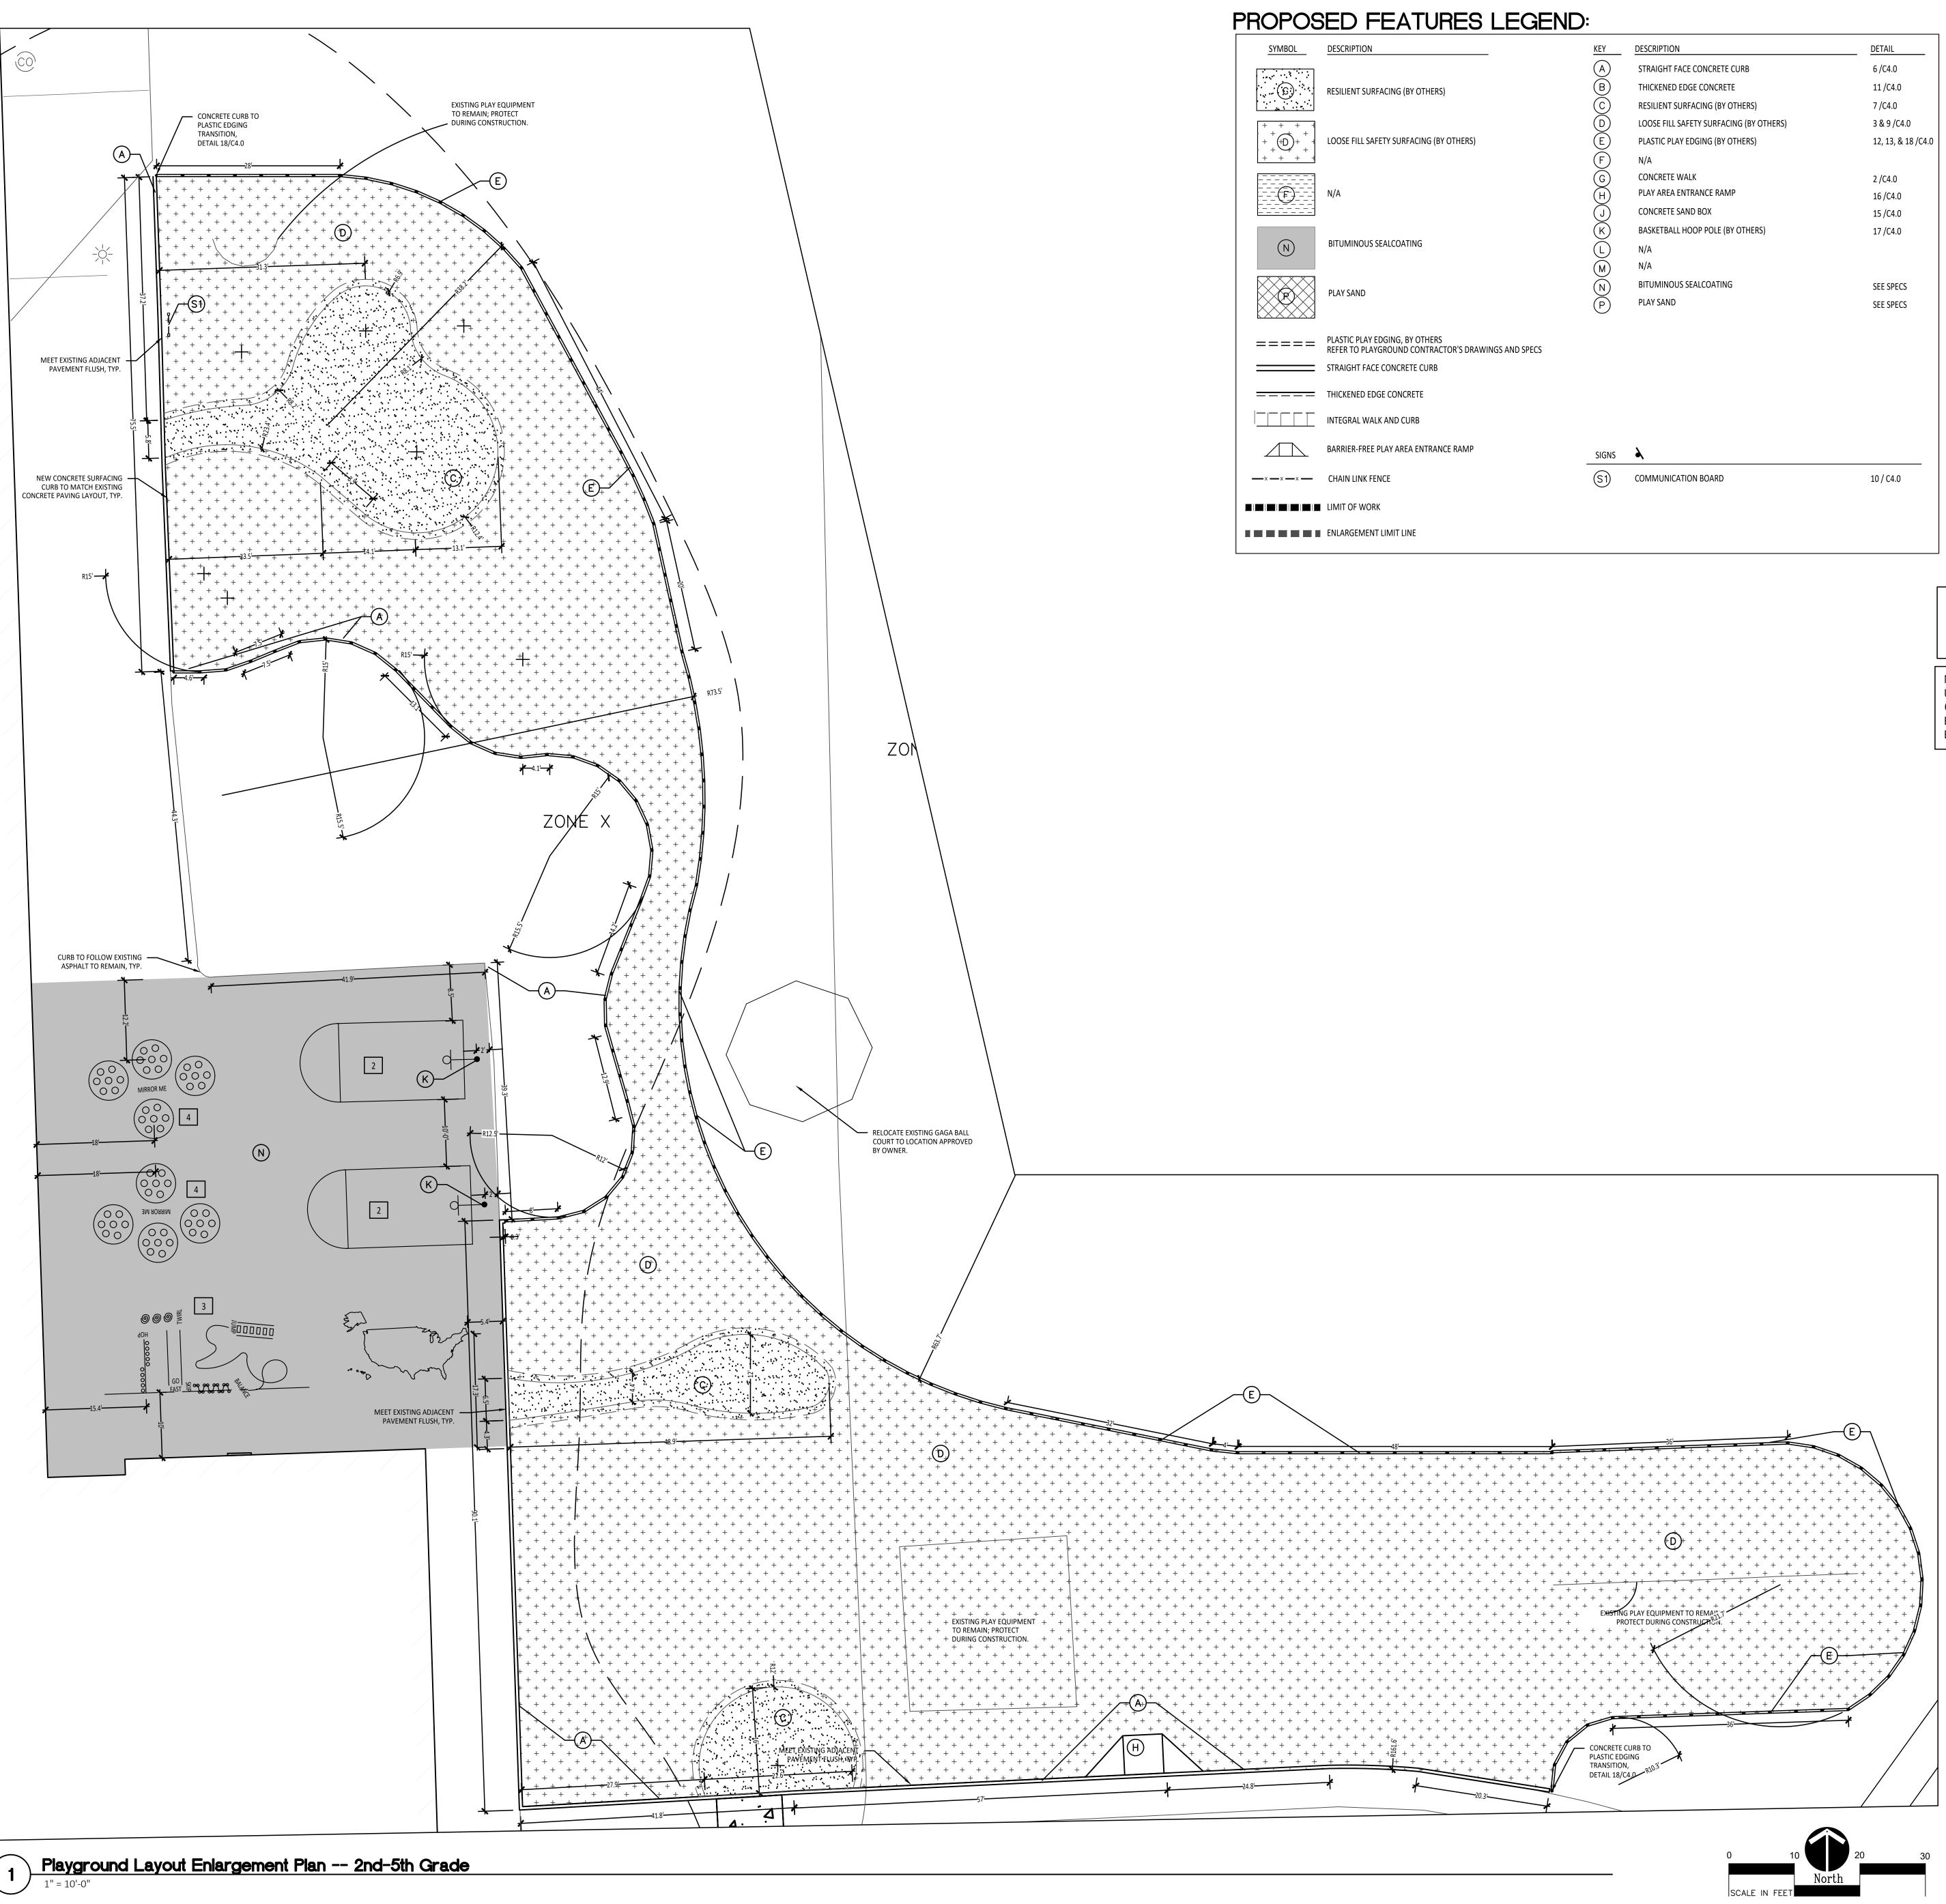

LAYOUT NOTES:

- SURVEY OF EXISTING CONDITIONS PROVIDED BY PEA GROUP, 1849 POND RUN, AUBURN HILLS, MICHIGAN 48326, (248)689-9090.
- EXISTING CONDITIONS SURVEY PROVIDED BY PEA GROUP, 1849 POND RUN, AUBURN HILLS, MICHIGAN, 48326, (248)689-9090.
- PROTECT ALL TREES AND EXISTING FEATURES TO REMAIN AS SPECIFIED.
- PAVEMENT DIMENSIONS AND RADII ARE TO EDGE OF PAVEMENT OR BACK OF CURB. PLASTIC EDGING DIMENSIONS AND RADII ARE TO CENTER OF EDGE SEGMENT.
- ALL NEW PAVEMENTS AND WALKS TO MEET 2010 ADA STANDARDS FOR ACCESSIBLE DESIGN.
- ALL EXISTING PLAYGROUND EQUIPMENT TO BE REMOVED MUST BE DESTROYED COMPLETELY SO THAT IT CANNOT BE RE-ASSEMBLED. THE CONTRACTOR IS NOT ALLOWED TO RE-USE, DONATE, OR SELL ANY EXISTING PLAYGROUND EQUIPMENT SCHEDULED TO BE DEMOLISHED.
- THE PURCHASE AND INSTALLATION OF ALL PLAYGROUND EQUIPMENT, PLAY SAFETY SURFACING, AND PLAY SAFETY SURFACING EDGING IN UNDER A SEPARATE CONTRACT AND IS NOT INCLUDED IN THIS BID PACKAGE. SITE CONTRACTORS ARE REQUIRED TO COORDINATE INSTALLATION OF PLAYGROUND EQUIPMENT, PLAY SAFETY SURFACING, AND PLAY SAFETY SURFACING EDGING WITH PLAYGROUND CONTRACTOR PRIOR TO ANY EXCAVATION OR PAVING INSTALLATION.

BARRIER-FREE NOTES

BARRIER-FREE PARKING AND ACCESSIBLE ROUTE(S) MUST COMPLY WITH THE AMERICANS WITH DISABILITIES ACT AND MICHIGAN BARRIER-FREE CODE REQUIREMENTS, INCLUDING BUT NOT LIMITED TO THE FOLLOWING:

- 1:50 (2%) MAXIMUM CROSS-SLOPE ON ACCESSIBLE ROUTE.
 NO CHANGES IN LEVEL GREATER THAN 1/2" ALONG ACCESSIBLE ROUTE.
 1:20 (5%) MAXIMUM LONGITUDINAL SLOPE ON ACCESSIBLE ROUTE (EXCEPT WHERE RAMPS ARE PROVIDED).
- 1:50 (2%) MAXIMUM SLOPE (IN ANY DIRECTION) IN B.F. PARKING AND ACCESS AISLES.

NOTE: VERIFY LOCATION OF NEW PLAYGROUND EQUIPMENT PRIOR TO INSTALLATION OF ANY CONCRETE CURB. CONCRETE CURB TO BE INSTALLED OUTSIDE OF FALL SAFETY ZONE OF EACH PIECE OF EQUIPMENT PER ASTM 1487-05 AND MANUFACTURER'S WRITTEN RECOMMENDATIONS.

NOTE: PLAYGROUND EQUIPMENT AND SURFACING PURCHASE AND INSTALLATION IS UNDER SEPARATE CONTRACT AND IS NOT INCLUDED IN THIS BID PACKAGE. CONTRACTOR IS REQUIRED TO COORDINATE INSTALLATION OF PLAYGROUND EQUIPMENT AND SURFACING WITH PLAYGROUND INSTALLER PRIOR TO ANY EXCAVATION AND CONCRETE CURBING OR PAVING INSTALLATION.

2ND - 5TH GRADE PAINTED GAMES SCHEDULE:

SYMBOL	DESCRIPTION	DETAIL		
1	MAP OF UNITED STATES	SEE SPECS.		
2	BASKETBALL LANE LAYOUT	3 /C2.1		
3	SILLY TRACK	4 / C2.1		
4	MIRROR ME	2 /C2.1		
5	N/A			
I				



T M P A R C H I T E C T U R E I N C

1191 WEST SQUARE LAKE ROAD

BLOOMFIELD HILLS • MICHIGAN • 48302

PH • 248.338.4561 FX • 248.338.0223

EM • INFO © TMP-ARCHITECTURE.COM

REGISTRATION SEAL

CONSULTANT



350 East Michigan Avenue Suite #415 Kalamazoo Michigan 49007 Phone (269) 381-3357 Fax (269) 381-2944

PROJECT TITLE

Martell Elementary School Playground Renovation Bid Package No.01A

Troy School District Troy, Michigan

Playground Layout Enlargement Plan -Upper Elementary

DATE:	ISSUED FOR:	
11-09-23	CONSTRUCTION DOCUMENTS	
•		
•	•	
•	•	
	•	
•		
	•	
•	•	
•		


DRAWN ...
CHECKED ...
APPROVED ...

PROJECT NO.

22092B

DRAWING NO.


C2.2

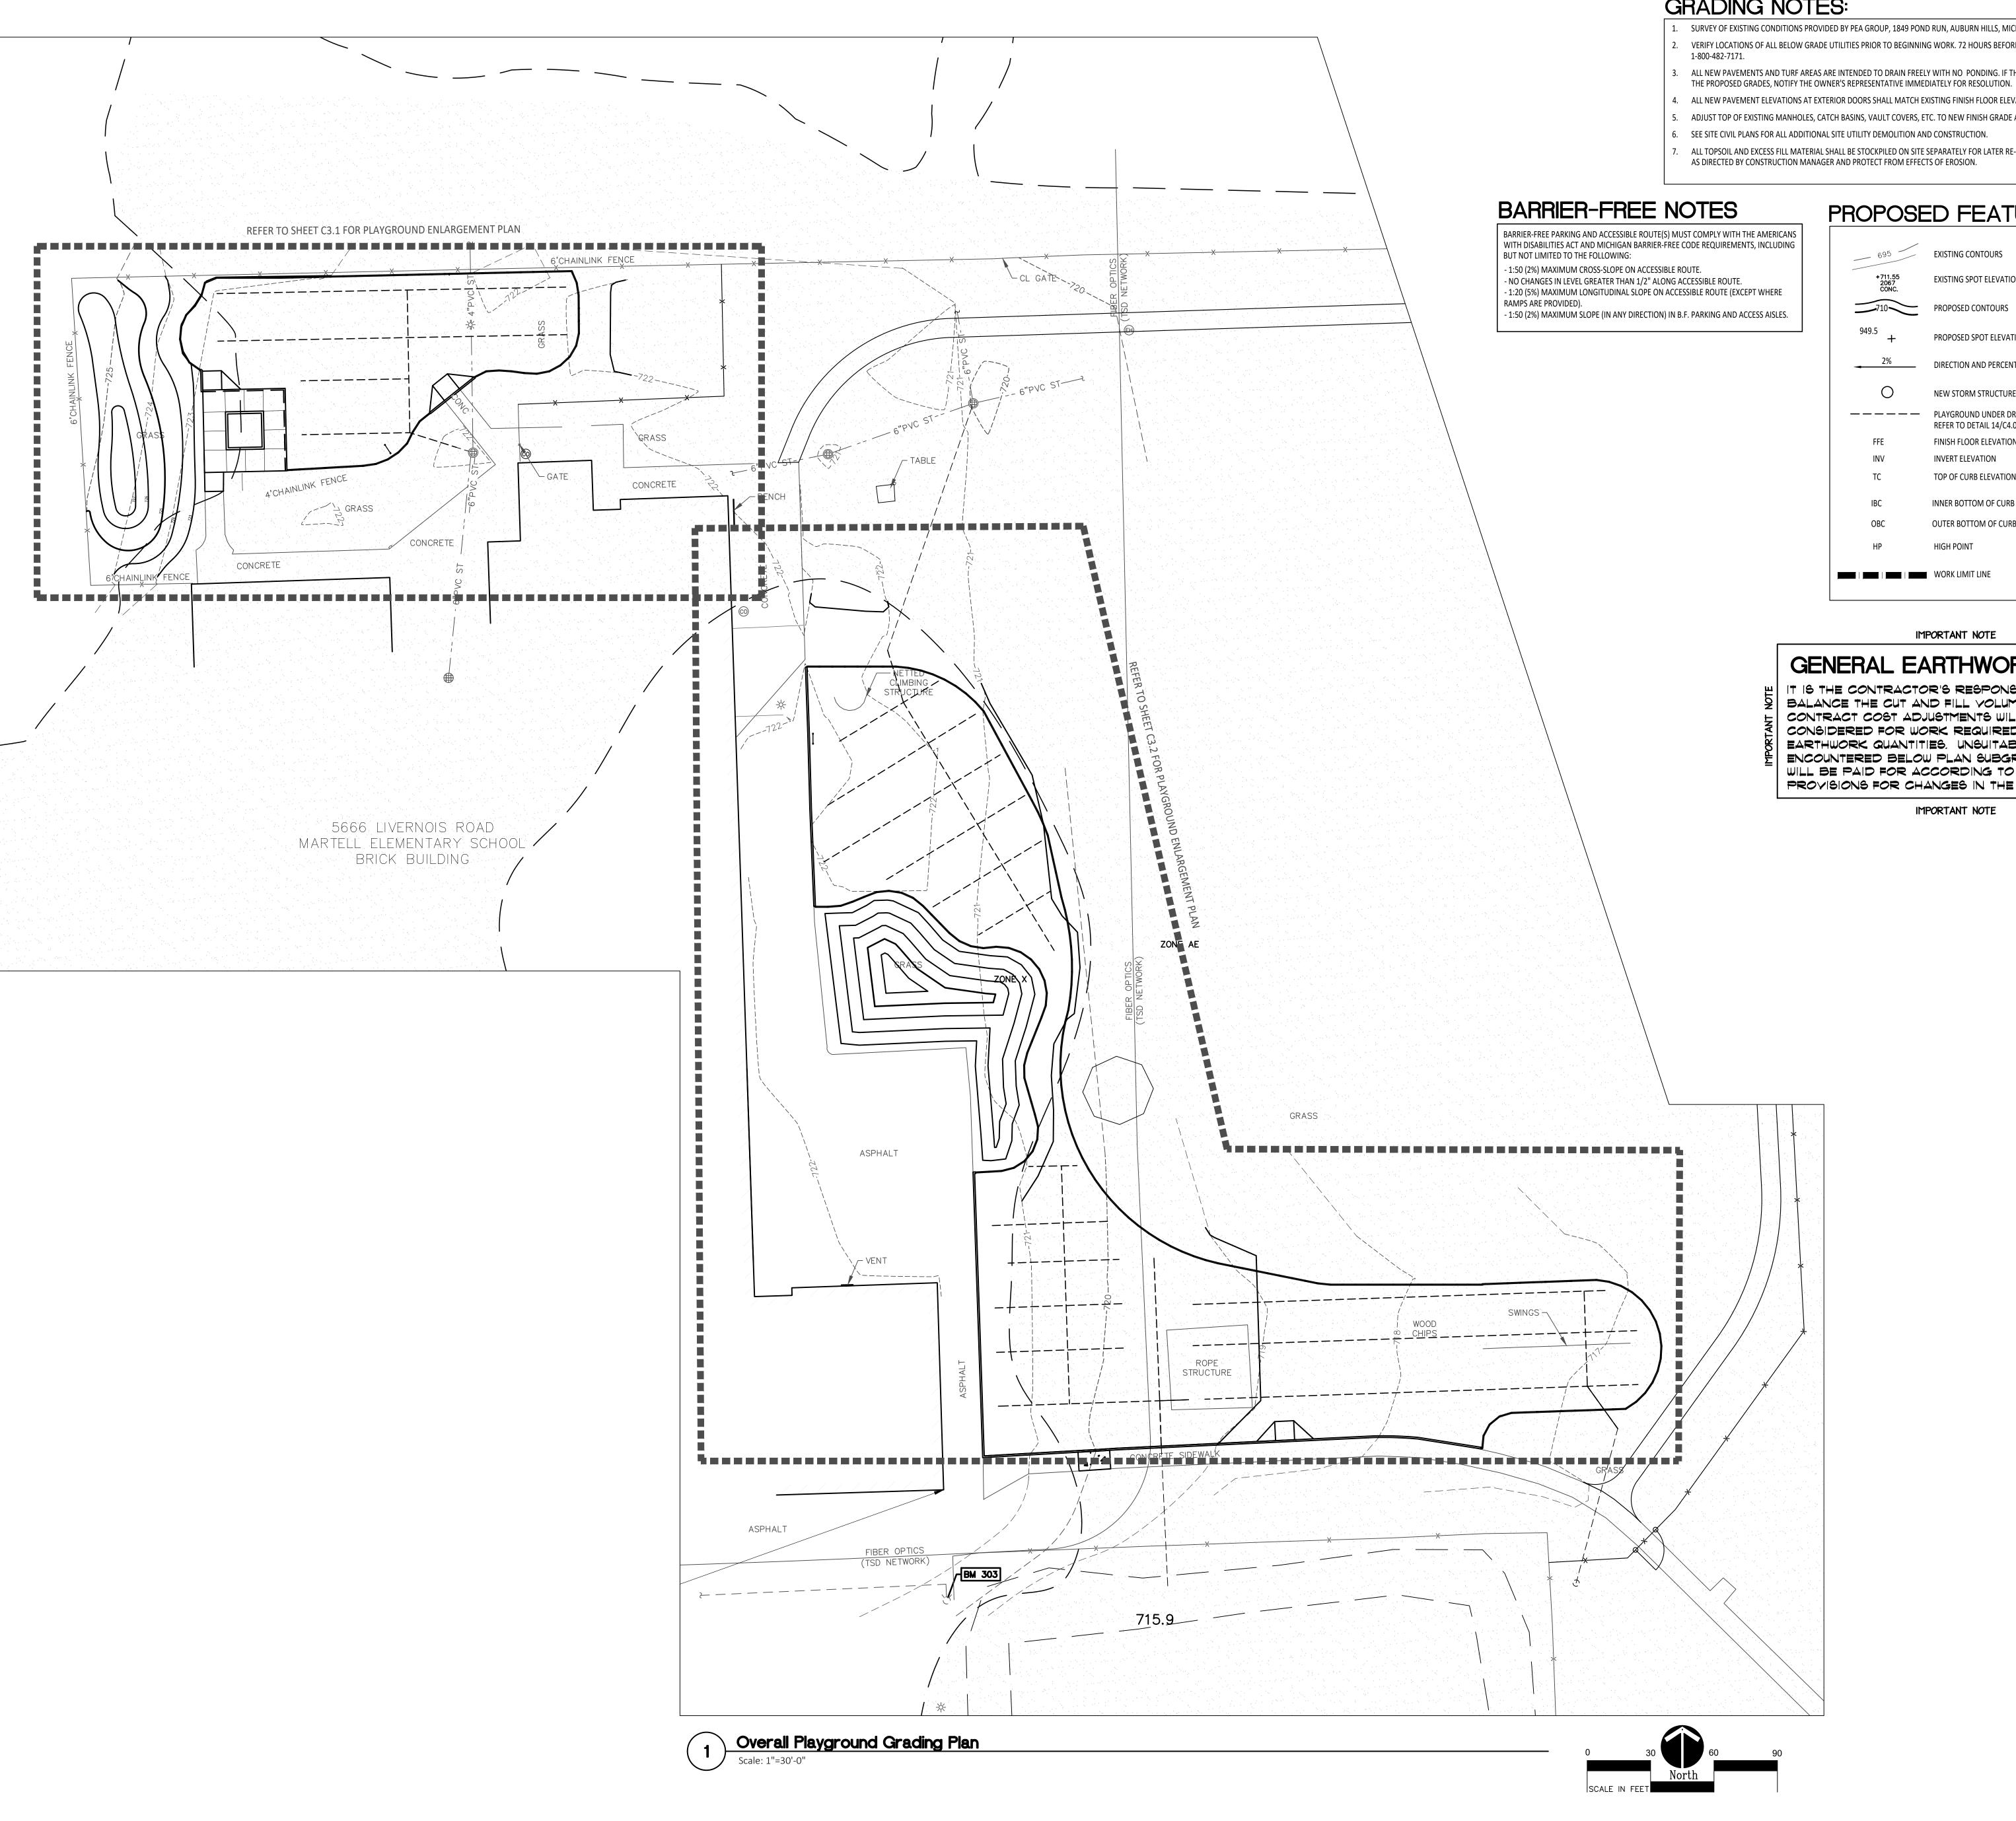

GRADING NOTES:

- SURVEY OF EXISTING CONDITIONS PROVIDED BY PEA GROUP, 1849 POND RUN, AUBURN HILLS, MICHIGAN, 48326, (248)689-9090.
- VERIFY LOCATIONS OF ALL BELOW GRADE UTILITIES PRIOR TO BEGINNING WORK. 72 HOURS BEFORE YOU DIG CALL "MISS DIG" AT
- ALL NEW PAVEMENTS AND TURF AREAS ARE INTENDED TO DRAIN FREELY WITH NO PONDING. IF THIS CANNOT BE ACHIEVED USING
- ALL NEW PAVEMENT ELEVATIONS AT EXTERIOR DOORS SHALL MATCH EXISTING FINISH FLOOR ELEVATIONS, TYPICAL.
- ADJUST TOP OF EXISTING MANHOLES, CATCH BASINS, VAULT COVERS, ETC. TO NEW FINISH GRADE AS REQUIRED.
- ALL TOPSOIL AND EXCESS FILL MATERIAL SHALL BE STOCKPILED ON SITE SEPARATELY FOR LATER RE-USE. LOCATE STOCKPILES IN AREAS
- AS DIRECTED BY CONSTRUCTION MANAGER AND PROTECT FROM EFFECTS OF EROSION.

PROPOSED FEATURES LEGEND:

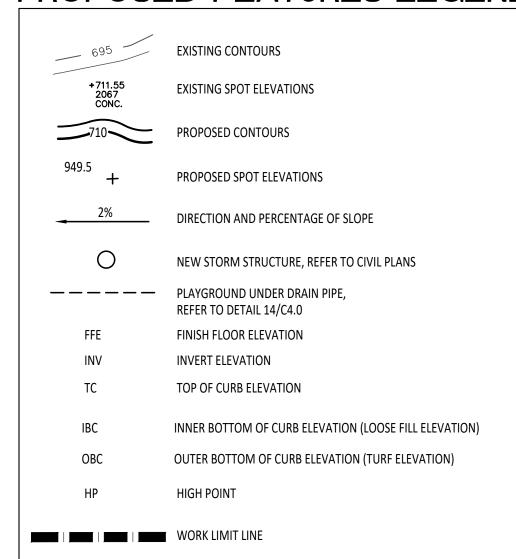

IMPORTANT NOTE

GENERAL EARTHWORK NOTE:

IT IS THE CONTRACTOR'S RESPONSIBILITY TO BALANCE THE CUT AND FILL YOLUMES ON SITE. NO CONTRACT COST ADJUSTMENTS WILL BE CONSIDERED FOR WORK REQUIRED TO BALANCE EARTHWORK QUANTITIES, UNSUITABLE SOILS ENCOUNTERED BELOW PLAN SUBGRADE ELEVATIONS WILL BE PAID FOR ACCORDING TO THE CONTRACT PROVISIONS FOR CHANGES IN THE WORK.

IMPORTANT NOTE



TMP ARCHITECTURE INC 1191 WEST SQUARE LAKE ROAD BLOOMFIELD HILLS • MICHIGAN • 48302 PH • 248.338.4561 FX • 248.338.0223

EM · INFO @ TMP-ARCHITECTURE.COM

REGISTRATION SEAL

CONSULTANT



350 East Michigan Avenue Suite #415 Kalamazoo Michigan 49007 Phone (269) 381-3357 Fax (269) 381-2944

PROJECT TITLE

Martell Elementary School Playground Renovation Bid Package No.01A

Troy School District Troy, Michigan

DRAWING TITLE
Overall Playground
Grading Plan

DRAWN	
DATE:	ISSUED FOR:
11-09-23	CONSTRUCTION DOCUMENTS
•	
•	
•	<u>.</u>


PROJECT NO.

APPROVED

22092B

DRAWING NO.

C3.0

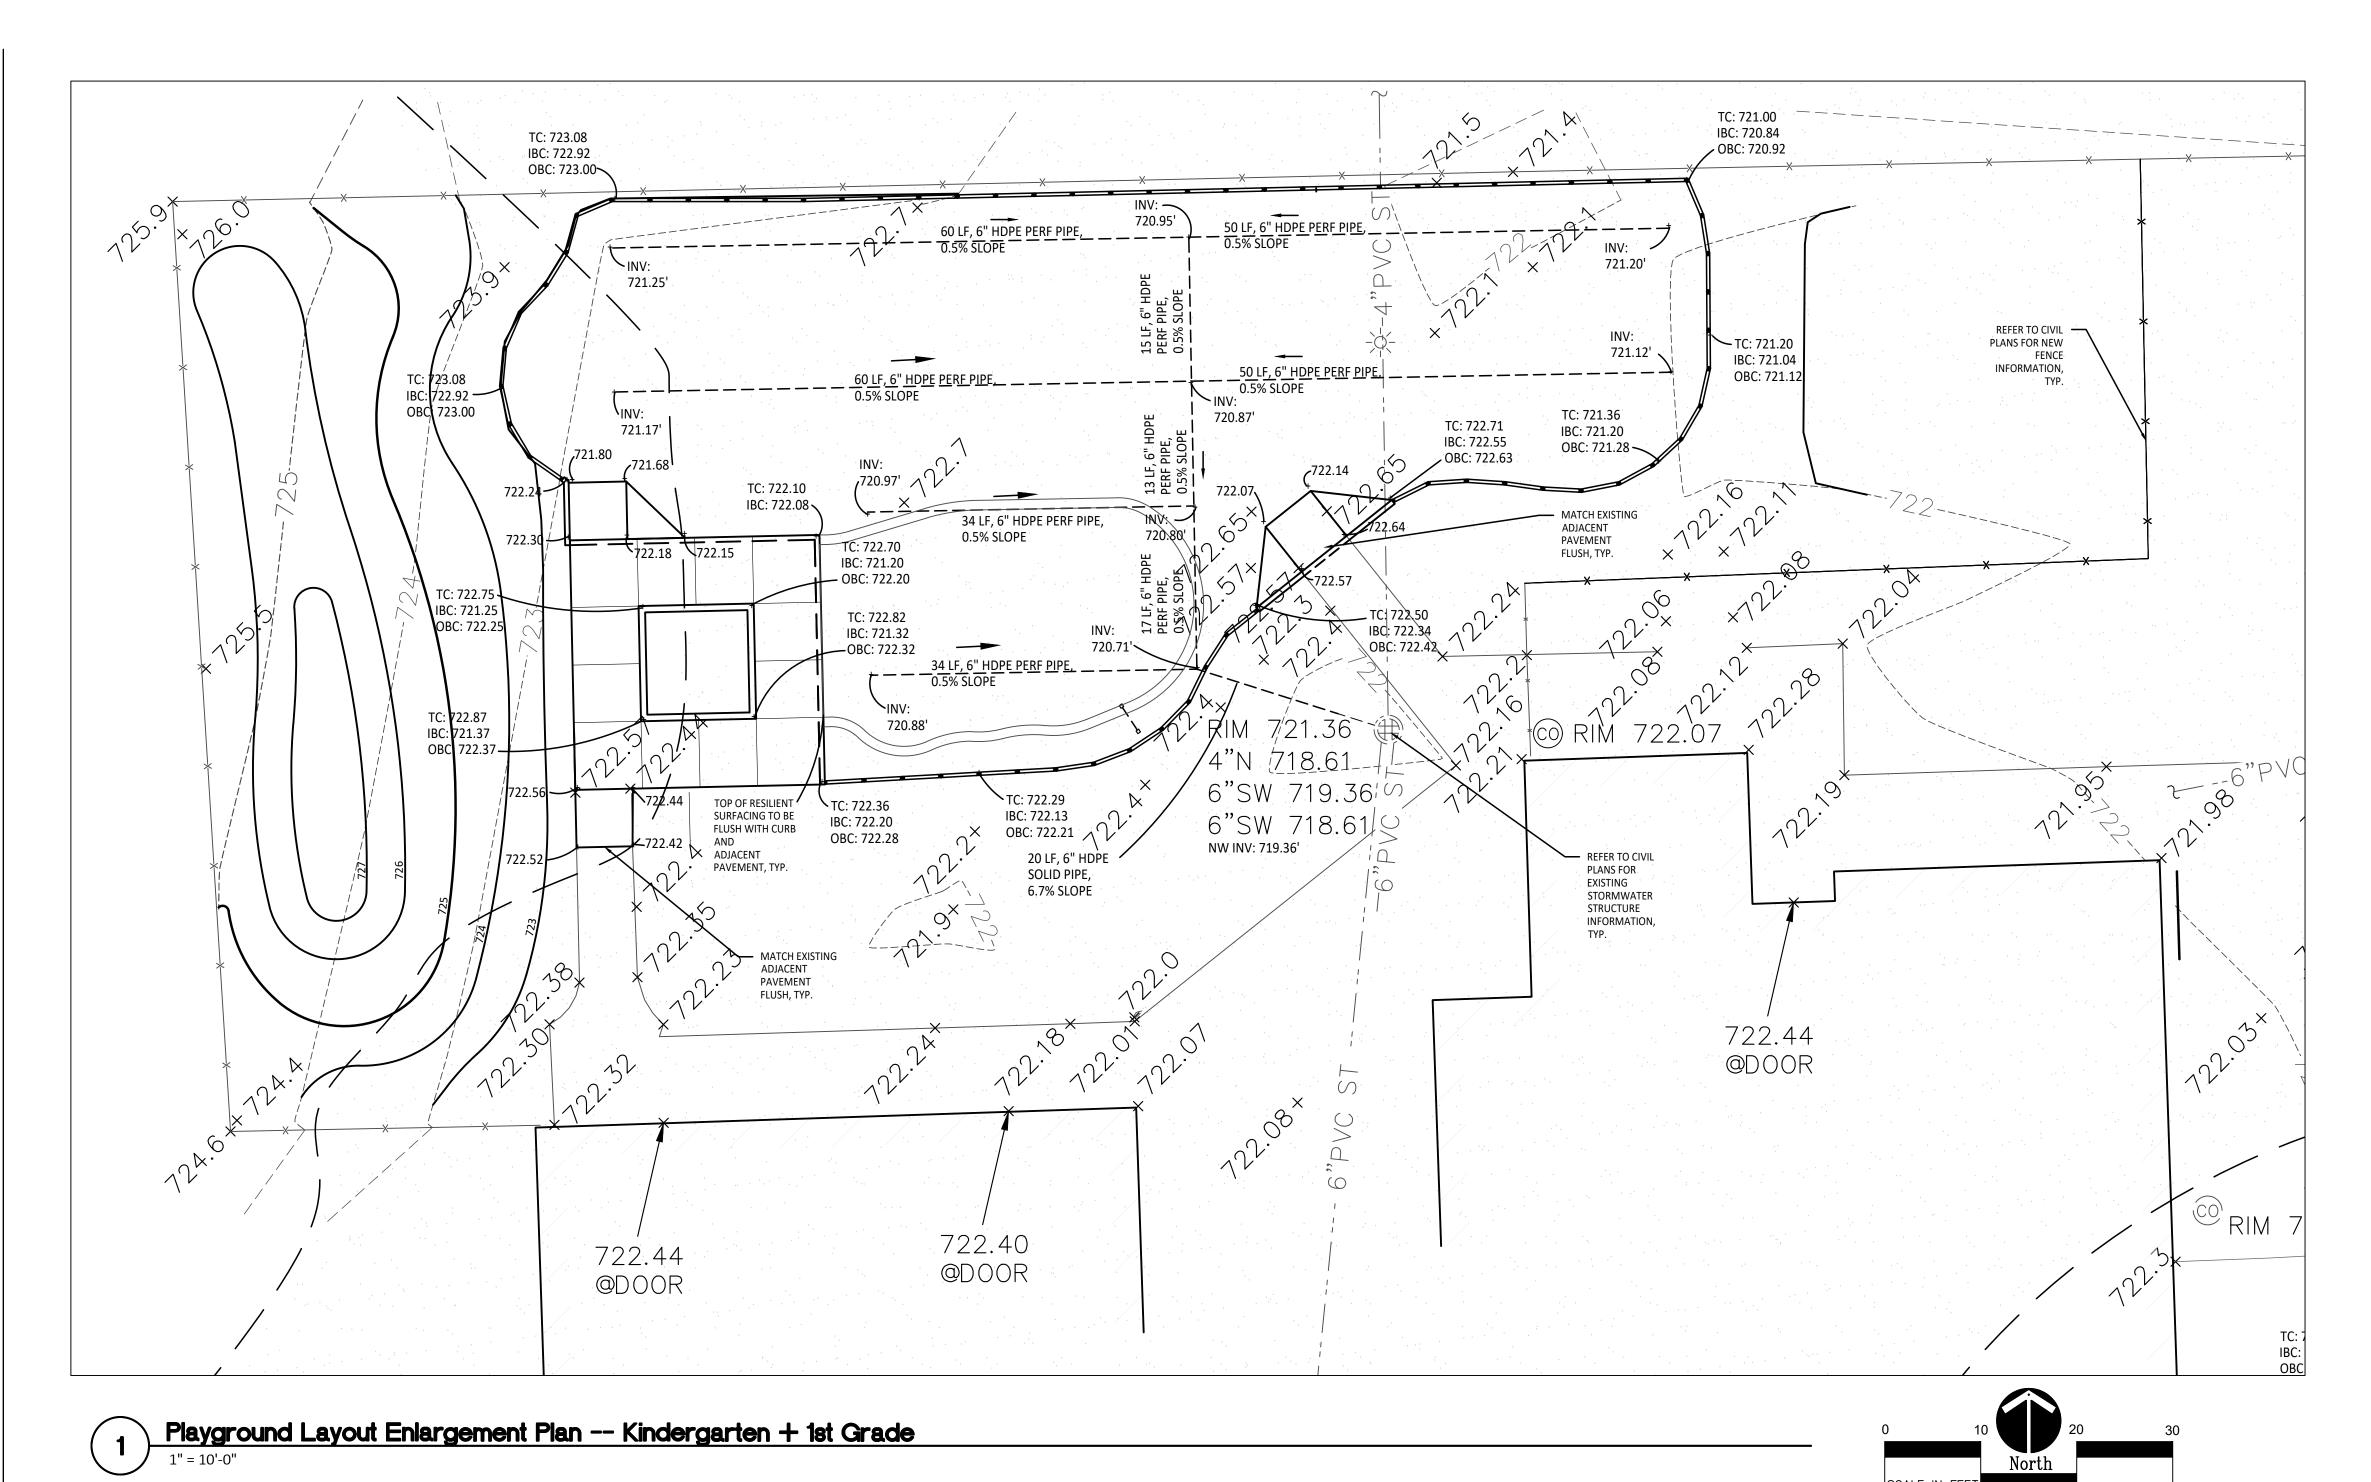

GRADING NOTES:

- SURVEY OF EXISTING CONDITIONS PROVIDED BY PEA GROUP, 1849 POND RUN, AUBURN HILLS, MICHIGAN, 48326, (248)689-9090.
 VERIFY LOCATIONS OF ALL BELOW GRADE UTILITIES PRIOR TO BEGINNING WORK. 72 HOURS BEFORE YOU DIG CALL "MISS DIG" AT
- 3. ALL NEW PAVEMENTS AND TURF AREAS ARE INTENDED TO DRAIN FREELY WITH NO PONDING. IF THIS CANNOT BE ACHIEVED USING
- THE PROPOSED GRADES, NOTIFY THE OWNER'S REPRESENTATIVE IMMEDIATELY FOR RESOLUTION.
- 4. ALL NEW PAVEMENT ELEVATIONS AT EXTERIOR DOORS SHALL MATCH EXISTING FINISH FLOOR ELEVATIONS, TYPICAL
- 5. ADJUST TOP OF EXISTING MANHOLES, CATCH BASINS, VAULT COVERS, ETC. TO NEW FINISH GRADE AS REQUIRED.
- SEE SITE CIVIL PLANS FOR ALL ADDITIONAL SITE UTILITY DEMOLITION AND CONSTRUCTION.
- 7. ALL TOPSOIL AND EXCESS FILL MATERIAL SHALL BE STOCKPILED ON SITE SEPARATELY FOR LATER RE-USE. LOCATE STOCKPILES IN AREAS AS DIRECTED BY CONSTRUCTION MANAGER AND PROTECT FROM EFFECTS OF EROSION.

BARRIER-FREE NOTES

BARRIER-FREE PARKING AND ACCESSIBLE ROUTE(S) MUST COMPLY WITH THE AMERICANS WITH DISABILITIES ACT AND MICHIGAN BARRIER-FREE CODE REQUIREMENTS, INCLUDING BUT NOT LIMITED TO THE FOLLOWING:

- 1:50 (2%) MAXIMUM CROSS-SLOPE ON ACCESSIBLE ROUTE.
- NO CHANGES IN LEVEL GREATER THAN 1/2" ALONG ACCESSIBLE ROUTE.
- 1:20 (5%) MAXIMUM LONGITUDINAL SLOPE ON ACCESSIBLE ROUTE (EXCEPT WHE

- 1:20 (5%) MAXIMUM LONGITUDINAL SLOPE ON ACCESSIBLE ROUTE (EXCEPT WHERE RAMPS ARE PROVIDED).
- 1:50 (2%) MAXIMUM SLOPE (IN ANY DIRECTION) IN B.F. PARKING AND ACCESS AISLES.


EROSION CONTROL REQUIREMENTS:

ALL CONSTRUCTION SHALL COMPLY WITH THE SOIL EROSION AND SEDIMENTATION CONTROL ACT (P.A. 347 OF 1972, AS AMENDED) AS ADMINISTERED BY CITY OF TROY AND OAKLAND COUNTY. THE FOLLOWING EROSION CONTROL DEVICES ARE REFERENCED IN THE STANDARD EROSION CONTROL HANDBOOK PUBLISHED BY THE MICHIGAN DEPARTMENT OF TRANSPORTATION. (MDOT DRAWING R-96-C, 8-9-2001)

ALL TEMPORARY EROSION CONTROL DEVICES SHALL BE REMOVED AT THE END OF CONSTRUCTION. TEMPORARY EROSION CONTROL DEVICES SHOULD BE IN PLACE PRIOR TO EXCAVATION, TO THE EXTENT POSSIBLE.

KEY DESCRIPTION TEMPORARY / PERMANENT

3 PERMANENT/TEMPORARY SEEDING P

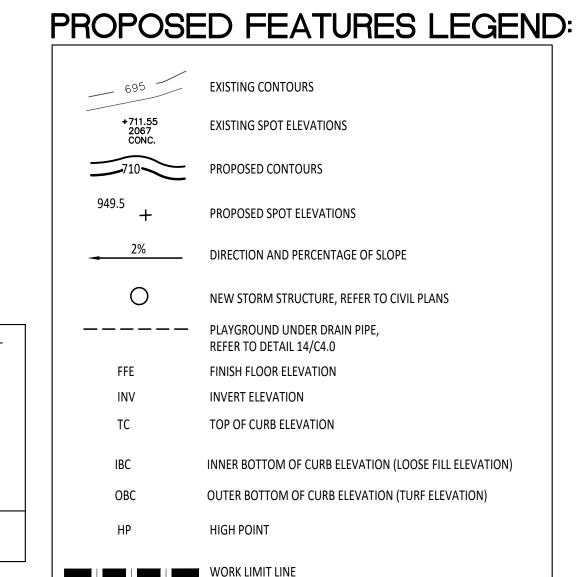


IMPORTANT NOTE

GENERAL EARTHWORK NOTE:

IT IS THE CONTRACTOR'S RESPONSIBILITY TO
BALANCE THE CUT AND FILL VOLUMES ON SITE. NO
CONTRACT COST ADJUSTMENTS WILL BE
CONSIDERED FOR WORK REQUIRED TO BALANCE
EARTHWORK QUANTITIES. UNSUITABLE SOILS
ENCOUNTERED BELOW PLAN SUBGRADE ELEVATIONS
WILL BE PAID FOR ACCORDING TO THE CONTRACT
PROVISIONS FOR CHANGES IN THE WORK.

IMPORTANT NOTE

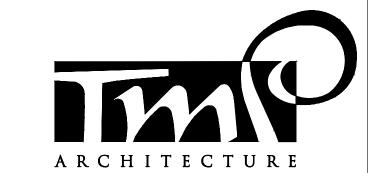

T M P A R C H I T E C T U R E I N C

1191 WEST SQUARE LAKE ROAD

BLOOMFIELD HILLS • MICHIGAN • 48302

PH • 248.338.4561 FX • 248.338.0223

EM · INFO @ TMP-ARCHITECTURE.COM

REGISTRATION SEAL

CONSULTANT



350 East Michigan Avenue Suite #415 Kalamazoo Michigan 49007 Phone (269) 381-3357 Fax (269) 381-2944

PROJECT TITLE

Martell Elementary School Playground Renovation Bid Package No.01A

Troy School District Troy, Michigan


Playground Grading
Enlargement Plan Kindergarten - 1st Grade

APPROVED		
CHECKED		
DRAWN		
DATE:	ISSUED FOR:	
11-09-23	CONSTRUCTION DOCUMENTS	
	_	
•		
•		
•	· · · · · · · · · · · · · · · · · · ·	
•		
•		
•	- ·	
•	_ ·	

22092B


DRAWING NO.

C3.1

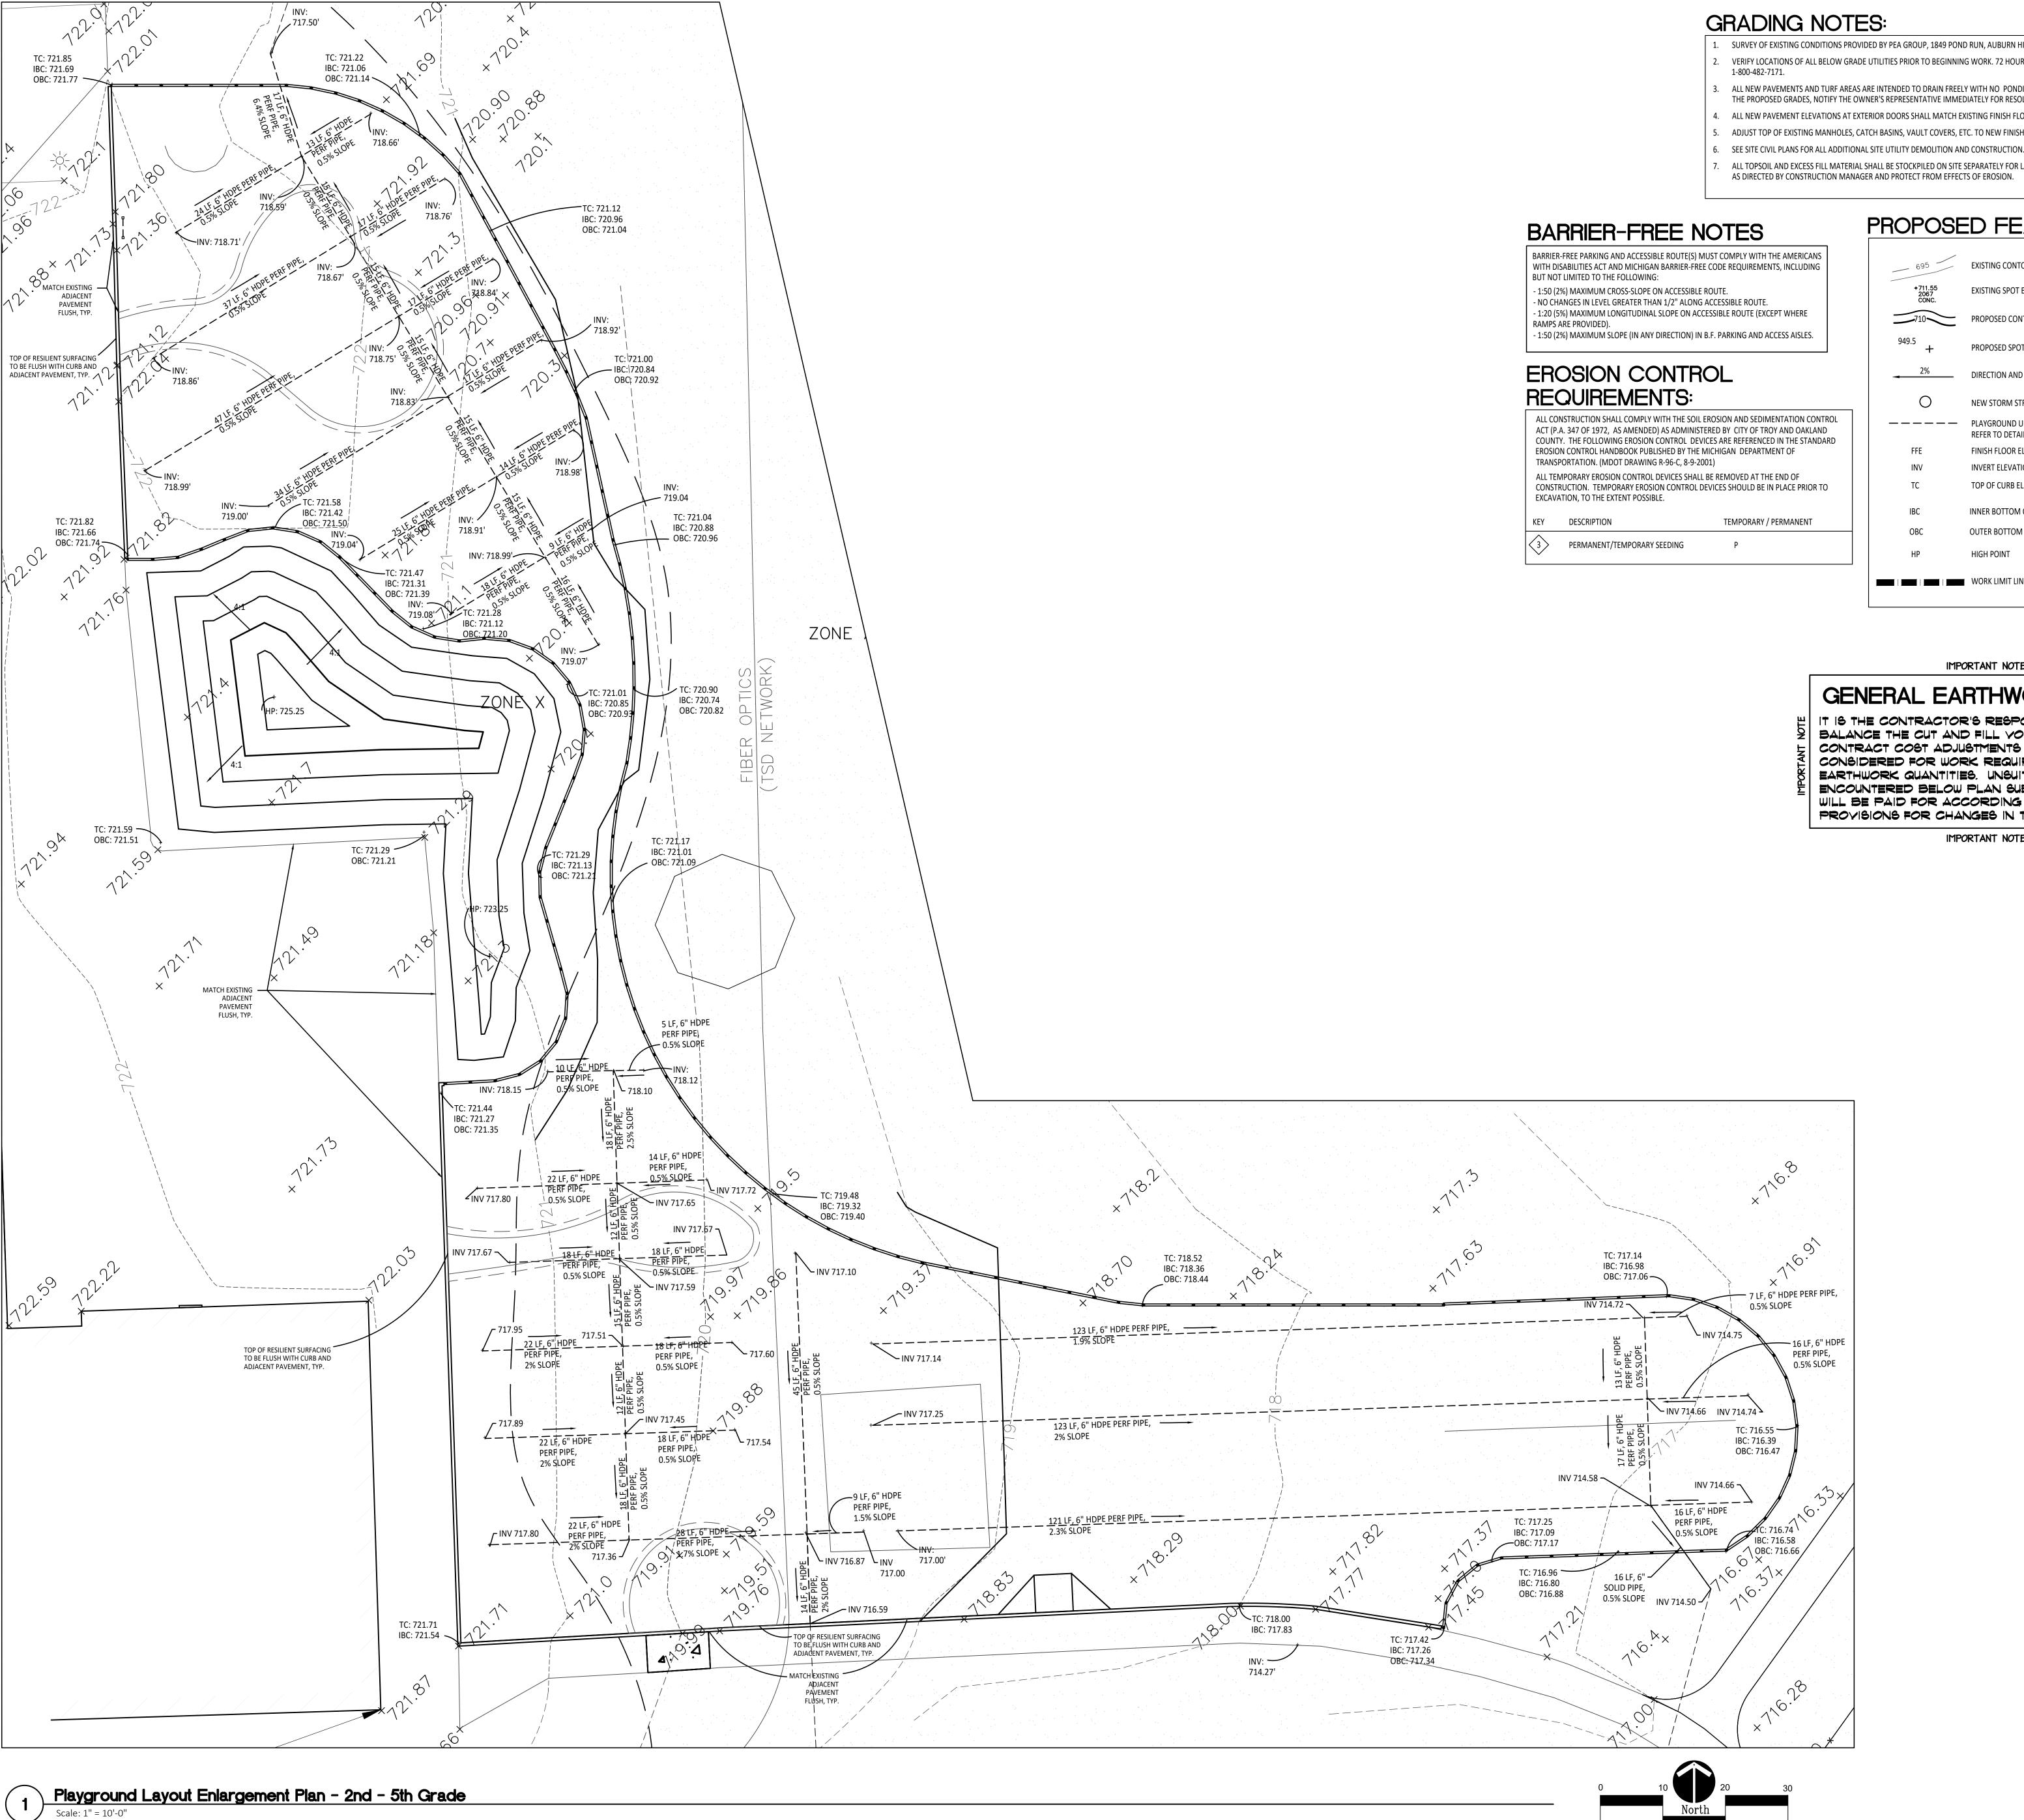

- SURVEY OF EXISTING CONDITIONS PROVIDED BY PEA GROUP, 1849 POND RUN, AUBURN HILLS, MICHIGAN, 48326, (248)689-9090. VERIFY LOCATIONS OF ALL BELOW GRADE UTILITIES PRIOR TO BEGINNING WORK. 72 HOURS BEFORE YOU DIG CALL "MISS DIG" AT
- ALL NEW PAVEMENTS AND TURF AREAS ARE INTENDED TO DRAIN FREELY WITH NO PONDING. IF THIS CANNOT BE ACHIEVED USING THE PROPOSED GRADES, NOTIFY THE OWNER'S REPRESENTATIVE IMMEDIATELY FOR RESOLUTION.
- ALL NEW PAVEMENT ELEVATIONS AT EXTERIOR DOORS SHALL MATCH EXISTING FINISH FLOOR ELEVATIONS, TYPICAL.
- ADJUST TOP OF EXISTING MANHOLES, CATCH BASINS, VAULT COVERS, ETC. TO NEW FINISH GRADE AS REQUIRED.
- ALL TOPSOIL AND EXCESS FILL MATERIAL SHALL BE STOCKPILED ON SITE SEPARATELY FOR LATER RE-USE. LOCATE STOCKPILES IN AREAS

PROPOSED FEATURES LEGEND:

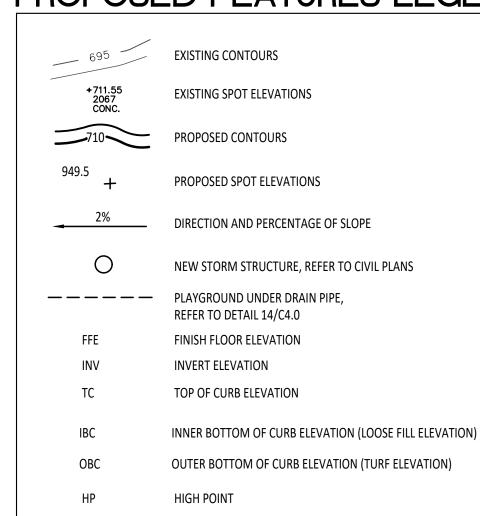

IMPORTANT NOTE

GENERAL EARTHWORK NOTE:

LI IT IS THE CONTRACTOR'S RESPONSIBILITY TO BALANCE THE CUT AND FILL YOLUMES ON SITE. NO CONTRACT COST ADJUSTMENTS WILL BE CONSIDERED FOR WORK REQUIRED TO BALANCE EARTHWORK QUANTITIES. UNSUITABLE SOILS ENCOUNTERED BELOW PLAN SUBGRADE ELEVATIONS WILL BE PAID FOR ACCORDING TO THE CONTRACT Provisions for changes in the work.

IMPORTANT NOTE



TMP ARCHITECTURE INC 1191 WEST SQUARE LAKE ROAD BLOOMFIELD HILLS • MICHIGAN • 48302

PH • 248.338.4561 FX • 248.338.0223

EM · INFO @ TMP-ARCHITECTURE.COM

REGISTRATION SEAL

CONSULTANT



350 East Michigan Avenue Suite #415 Kalamazoo Michigan 49007 Phone (269) 381-3357 Fax (269) 381-2944

PROJECT TITLE

Martell Elementary School Playground Renovation Bid Package No.01A

Troy School District Troy, Michigan

DRAWING TITLE Playground Grading Enlargement Plan -2nd - 5th Grade

ISSUE DATES				
•	<u>.</u>			
•	<u>.</u>			
•	<u>.</u>			
•	<u> </u>			
•	<u> </u>			
•	_ <u>· </u>			
•	<u> </u>			
•	<u>·</u>			
•	_ <u>·</u>			
11-09-23	CONSTRUCTION DOCUMENTS			
DATE:	ISSUED FOR:			
DRAWN				
CHECKED				


PROJECT NO.


APPROVED

22092B

DRAWING NO.

C3.2

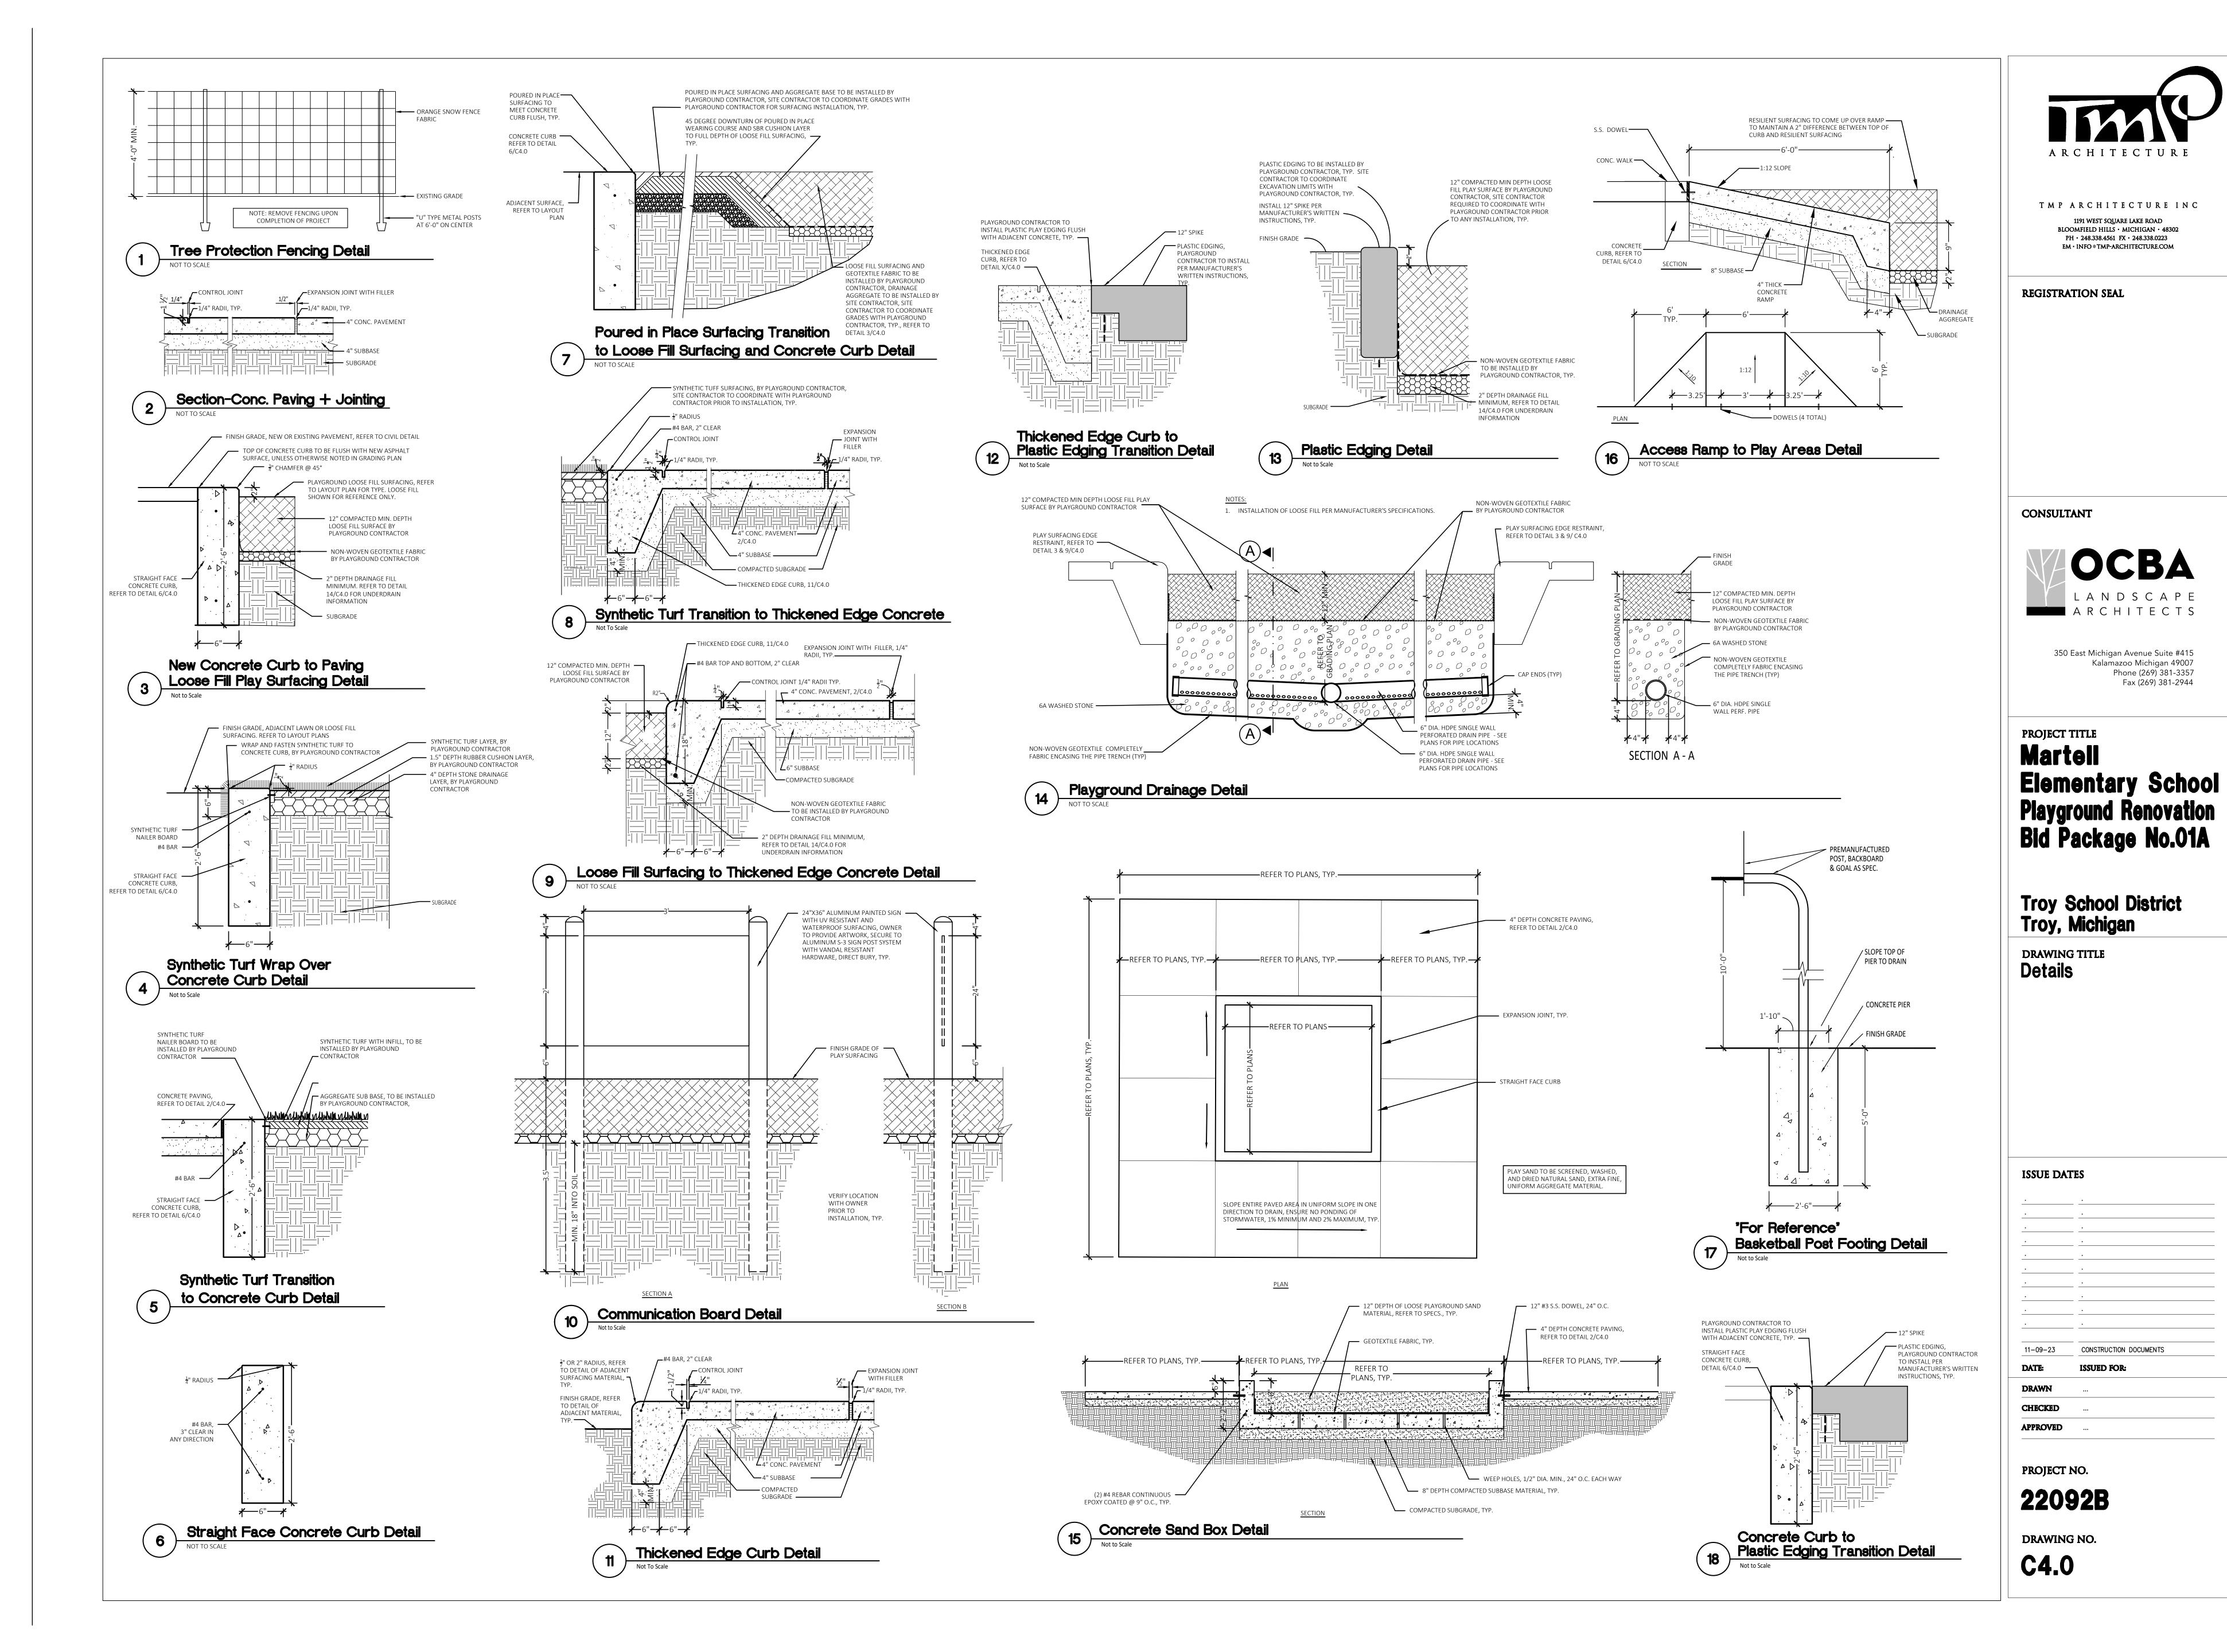

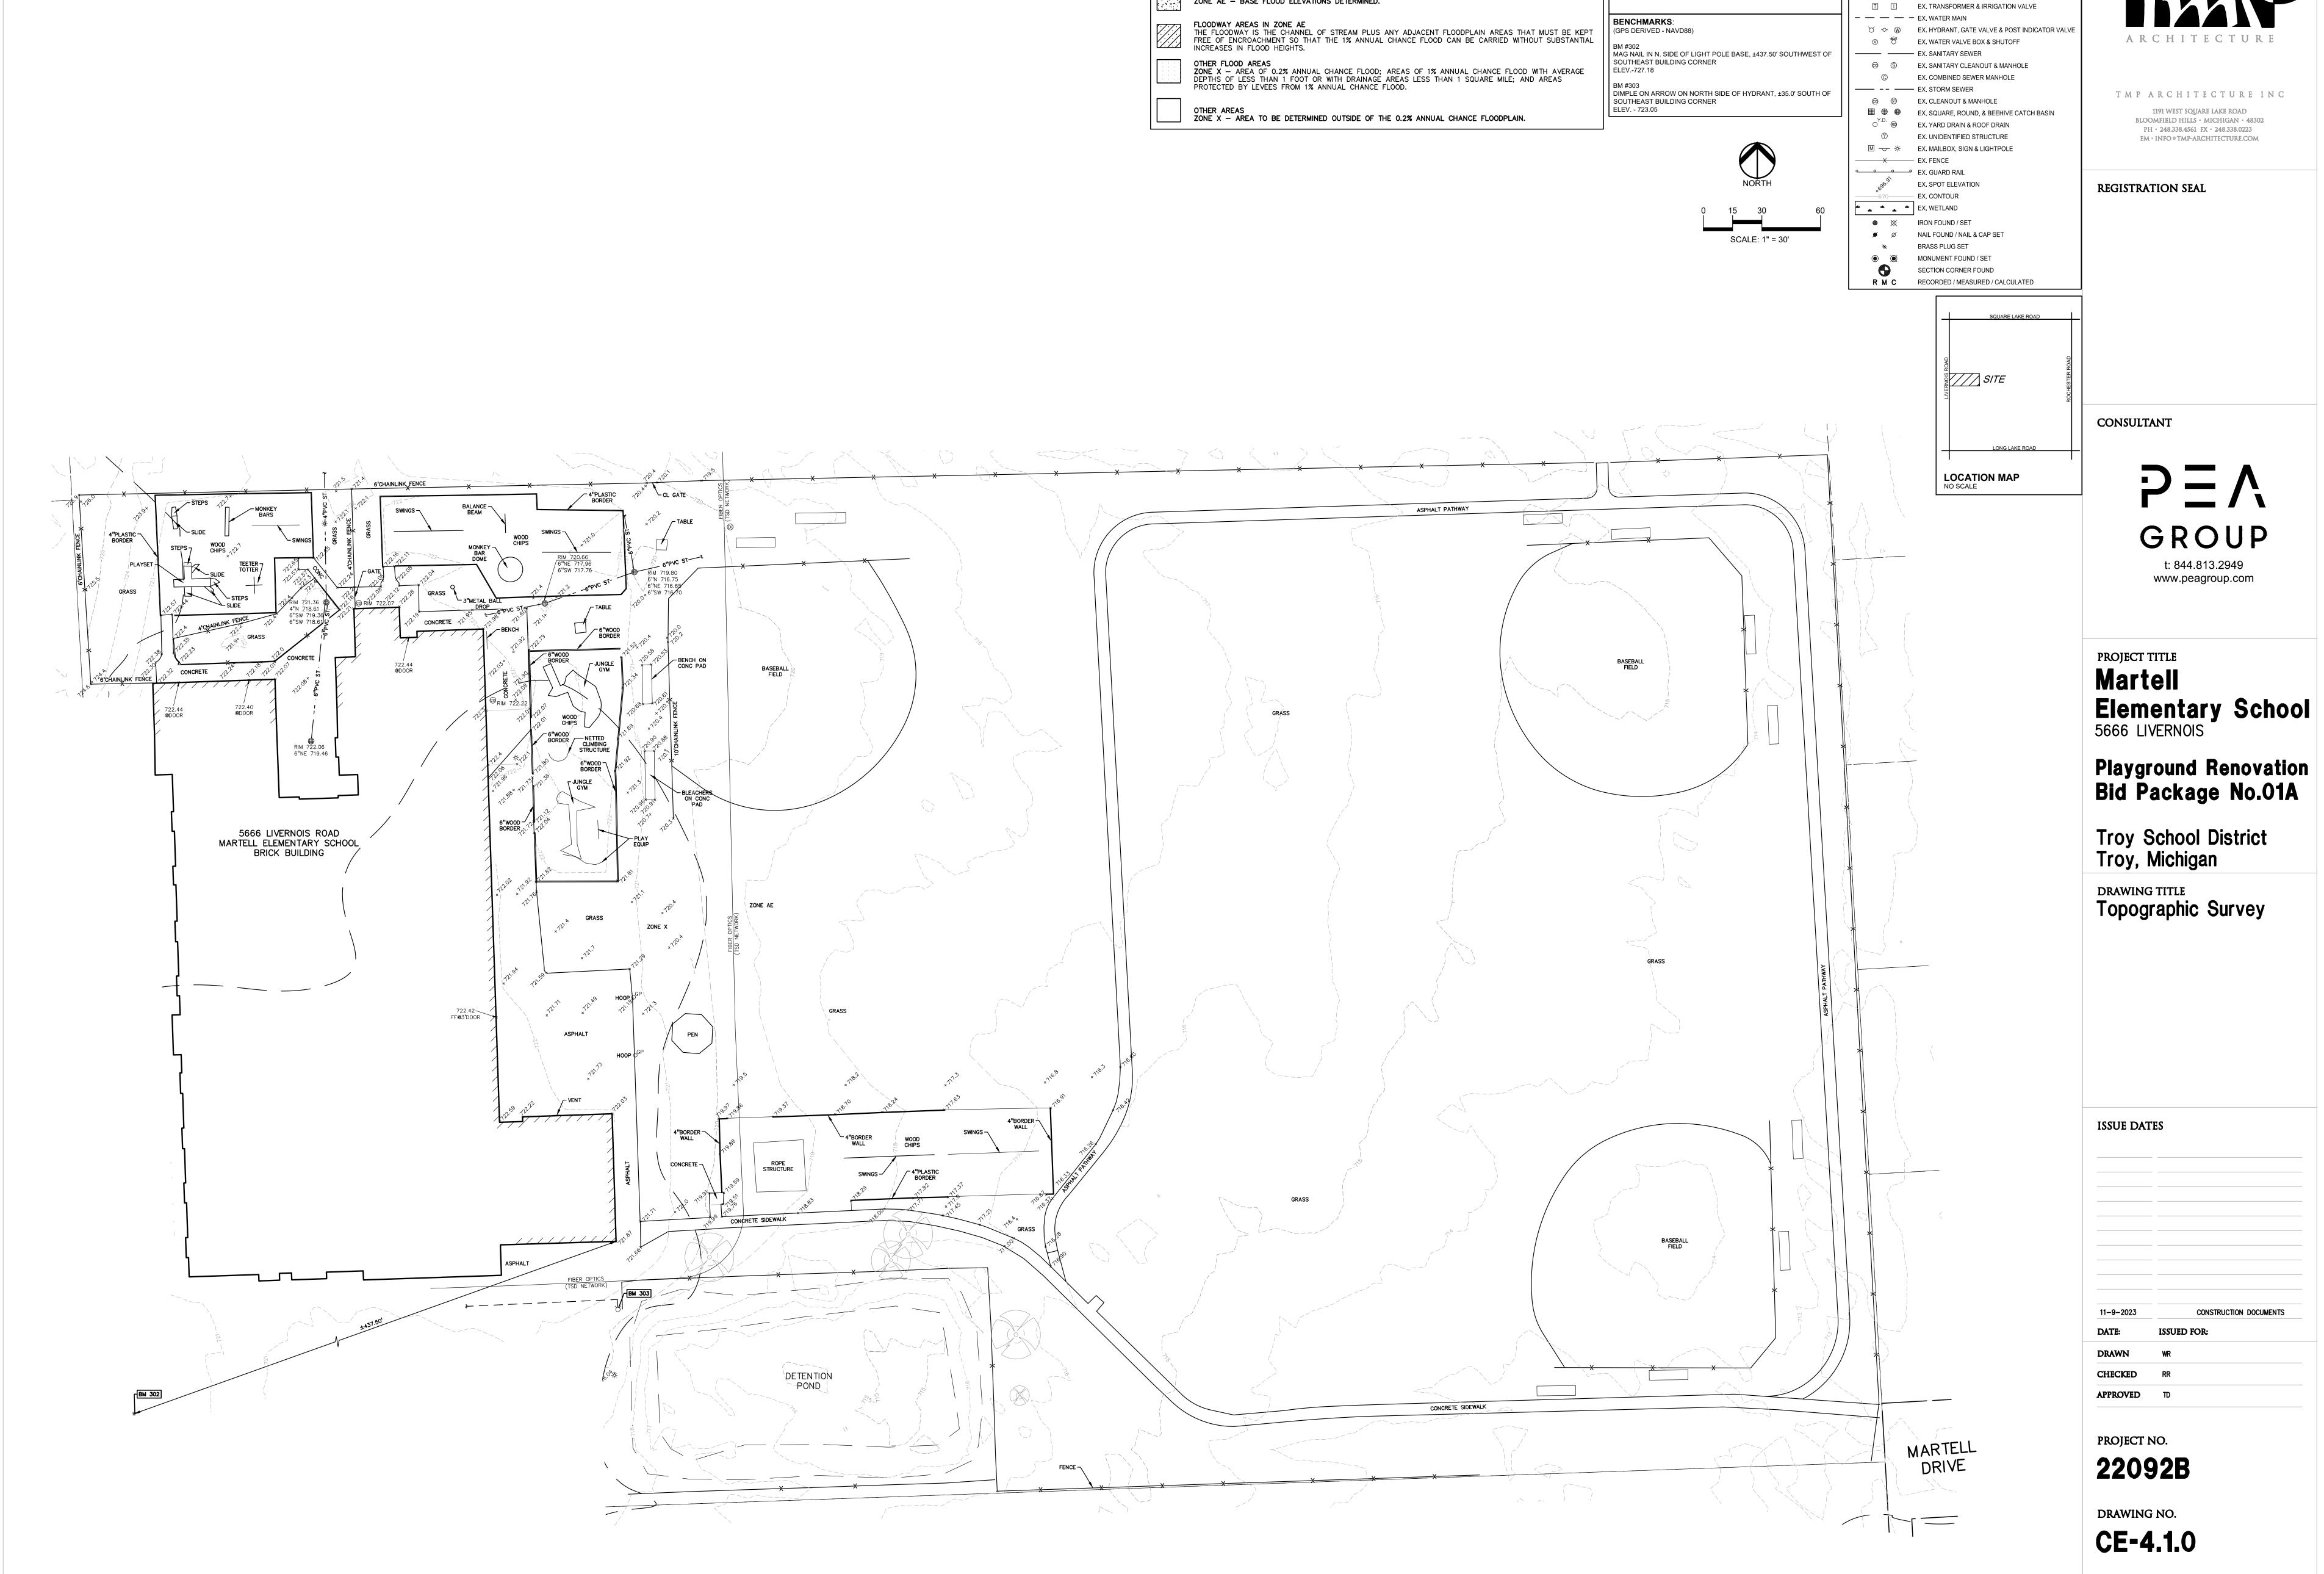

LEGEND:

-OH-ELEC-W-O- EX. OH. ELEC, POLE & GUY WIRE

-UG-CATV-TV- EX. U.G. CABLE TV & PEDESTAL

— - — - — EX. GAS LINE

-UG-COMM---⊠-Ū- EX. U.G. COMMUNICATION LINE, PEDESTAL & MANHOLE

-UG-ELEC-®EKE- EX. U.G. ELEC,MANHOLE, METER & HANDHOLE

© GAS EX. GAS VALVE & GAS LINE MARKER

REFERENCE DRAWINGS:

WATER MAIN

CITY OF TROY GIS ONLINE, DATED 3-23-23

MISS DIG TICKET NO 2023032303485, DATED

TROY SCHOOL DISTRICT FIBER OPTICS

(PER FLOOD INSURANCE RATE MAP NUMBER 26125C-0532F, REVISED DATE SEPTEMBER 29, 2006)


THE 1% ANNUAL CHANCE FLOOD (100 YEAR FLOOD), ALSO KNOWN AS THE BASE FLOOD, IS THE FLOOD THAT HAS A 1% CHANCE OF BEING EQUALED OR EXCEEDED IN ANY GIVEN YEAR. THE SPECIAL FLOOD HAZARD AREA

IS THE AREA SUBJECT TO FLOODING BY THE 1% ANNUAL CHANCE FLOOD. AREAS OF SPECIAL FLOOD HAZARD INCLUDE ZONES A, AE, AH, AO, AR, A99, V AND VE. THE BASE FLOOD ELEVATION IS THE WATER-SURFACE

SPECIAL FLOOD HAZARD AREAS SUBJECT TO INUNDATION BY THE 1% ANNUAL CHANCE FLOOD

ELEVATION OF THE 1% ANNUAL CHANCE FLOOD.

ZONE AE - BASE FLOOD ELEVATIONS DETERMINED.

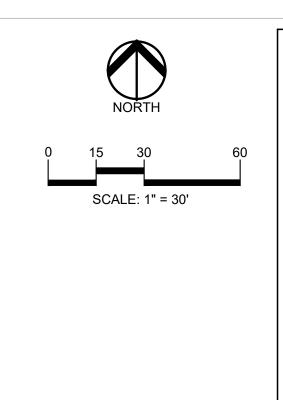

DEMOLITION LEGEND: ITEM TO BE PROTECTED ITEM TO BE REMOVED

CURB/FENCE REMOVAL CONCRETE PAVEMENT AND SIDEWALK REMOVAL

SAWCUT LINE

UTILITY REMOVAL ABANDON UTILITY

AREA OR ITEMS TO BE REMOVED

. ASPHALT REMOVAL TREE REMOVAL

. STAGING/PHASING OF DEMOLITION AND CONSTRUCTION IS TO BE COORDINATED WITH THE OWNER AND THE CONTRACTOR PRIOR TO I. SPECIFIC DEMOLITION ITEMS HAVE BEEN INDICATED ON THE PLANS AS A GUIDE TO THE GENERAL SCOPE OF THE WORK. IT IS THE INTENT THAT THESE ITEMS SHALL BE COMPLETELY REMOVED BY THE CONTRACTOR ABOVE AND BELOW GROUND, UNLESS SPECIFICALLY NOTED OTHERWISE, AND THAT DEMOLITION WILL INCLUDE BUT WILL NOT NECESSARILY BE LIMITED TO THESE ITEMS. CONTRACTOR SHALL VISIT SITE TO VERIFY

·/·/·/·/·/·/·/·/

GENERAL DEMOLITION NOTES:

BURN PITS SHALL BE ALLOWED.

EXISTING CONDITIONS AND EXTENTS OF THE DEMOLITION THAT WILL BE REQUIRED PRIOR TO SUBMITTING A BID. REMOVE ALL STRUCTURES DESIGNATED FOR REMOVAL ACCORDING TO THE DEMOLITION PLAN. THIS INCLUDES FOUNDATIONS, FOOTINGS, FOUNDATION WALLS, FLOOR SLABS, UNDERGROUND UTILITIES, CONCRETE, ASPHALT,

THESE NOTES APPLY TO ALL CONSTRUCTION ACTIVITIES ON THIS PROJECT:

ALL DEMOLITION WORK SHALL CONFORM TO ALL LOCAL CODES AND

ALL MATERIAL TO BE REMOVED, WHETHER SPECIFICALLY NOTED IN THE PLANS OR NOT, SHALL BE REMOVED FROM THE SITE BY THE CONTRACTOR AND DISPOSED OF OFF-SITE IN A LEGAL MANNER. NO ON-SITE BURY OR

. THE CONTRACTOR SHALL, AS A MINIMUM, PROVIDE TREE PROTECTION FENCING AROUND EXISTING TREES TO BE SAVED THAT ARE WITHIN 15 FEET OF CONSTRUCTION ACTIVITIES AND AS INDICATED IN THE PLANS OR

PER LOCAL AGENCY REQUIREMENTS. 7. THE CONTRACTOR SHALL BE RESPONSIBLE FOR CLEAN UP, NOISE, DUST CONTROL, STREET SWEEPING AND HOURS OF OPERATION IN ACCORDANCE WITH THE LOCAL CODES. . THE CONTRACTOR SHALL PROVIDE ALL NECESSARY BARRICADES, SIGNAGE, MARKINGS, LIGHTS AND OTHER TRAFFIC CONTROL DEVICES TO PROTECT THE WORK ZONE AND SAFELY MAINTAIN TRAFFIC PER AGENCY

REQUIREMENTS AND IN ACCORDANCE WITH THE LATEST EDITION OF THE STATE MANUAL OF UNIFORM TRAFFIC CONTROL DEVICES. 9. THE CONTRACTOR SHALL CONTACT THE APPROPRIATE UTILITY COMPANIES TO CONFIRM THAT UTILITY LEADS HAVE BEEN TAKEN OUT OF SERVICE PRIOR TO DEMOLITION.

10. ALL BUILDING GAS LEADS, METERS AND ASSOCIATED EQUIPMENT SHALL BE REMOVED AS SHOWN ON THE PLANS. COORDINATE ALL ASSOCIATED WORK WITH THE APPROPRIATE UTILITY COMPANY.

1. REMOVE ALL OVERHEAD AND UNDERGROUND ELECTRICAL LINES WITHIN THE AREA OF CONSTRUCTION AS SHOWN ON THE PLANS. COORDINATE SHUTDOWNS AND REMOVALS WITH ELECTRICAL SERVICE PROVIDER OR THE APPROPRIATE UTILITY COMPANY. (NOTE: PHONE AND CABLE T.V. SERVICES MAY ALSO BE LOCATED ON OVERHEAD LINES.) 12. THE CONTRACTOR IS RESPONSIBLE FOR THE REMOVAL AND REPLACEMENT

OF SIGNS AND SUPPORTS WITHIN THE WORK AREA, AS NECESSARY TO FACILITATE CONSTRUCTION. SIGNS SHALL BE PROTECTED OR STOCKPILED FOR REUSE AS SPECIFIED IN THE PLANS OR AS REQUIRED BY THE AGENCY OF JURISDICTION. THE CONTRACTOR SHALL REPLACE ANY

TMP ARCHITECTURE INC 1191 WEST SQUARE LAKE ROAD BLOOMFIELD HILLS • MICHIGAN • 48302 PH • 248.338.4561 FX • 248.338.0223 EM · INFO @ TMP-ARCHITECTURE.COM

REGISTRATION SEAL

CONSULTANT

t: 844.813.2949

www.peagroup.com

PROJECT TITLE

Martell Elementary School 5666 LIVERNOIS

Playground Renovation Bid Package No.01A

Troy School District Troy, Michigan

DRAWING TITLE **Demolition Plan**

ISSUE DATES

CONSTRUCTION DOCUMENTS DATE: **ISSUED FOR:**


DRAWN CHECKED

APPROVED TD

PROJECT NO.

22092B

DRAWING NO. CE-4.2.0

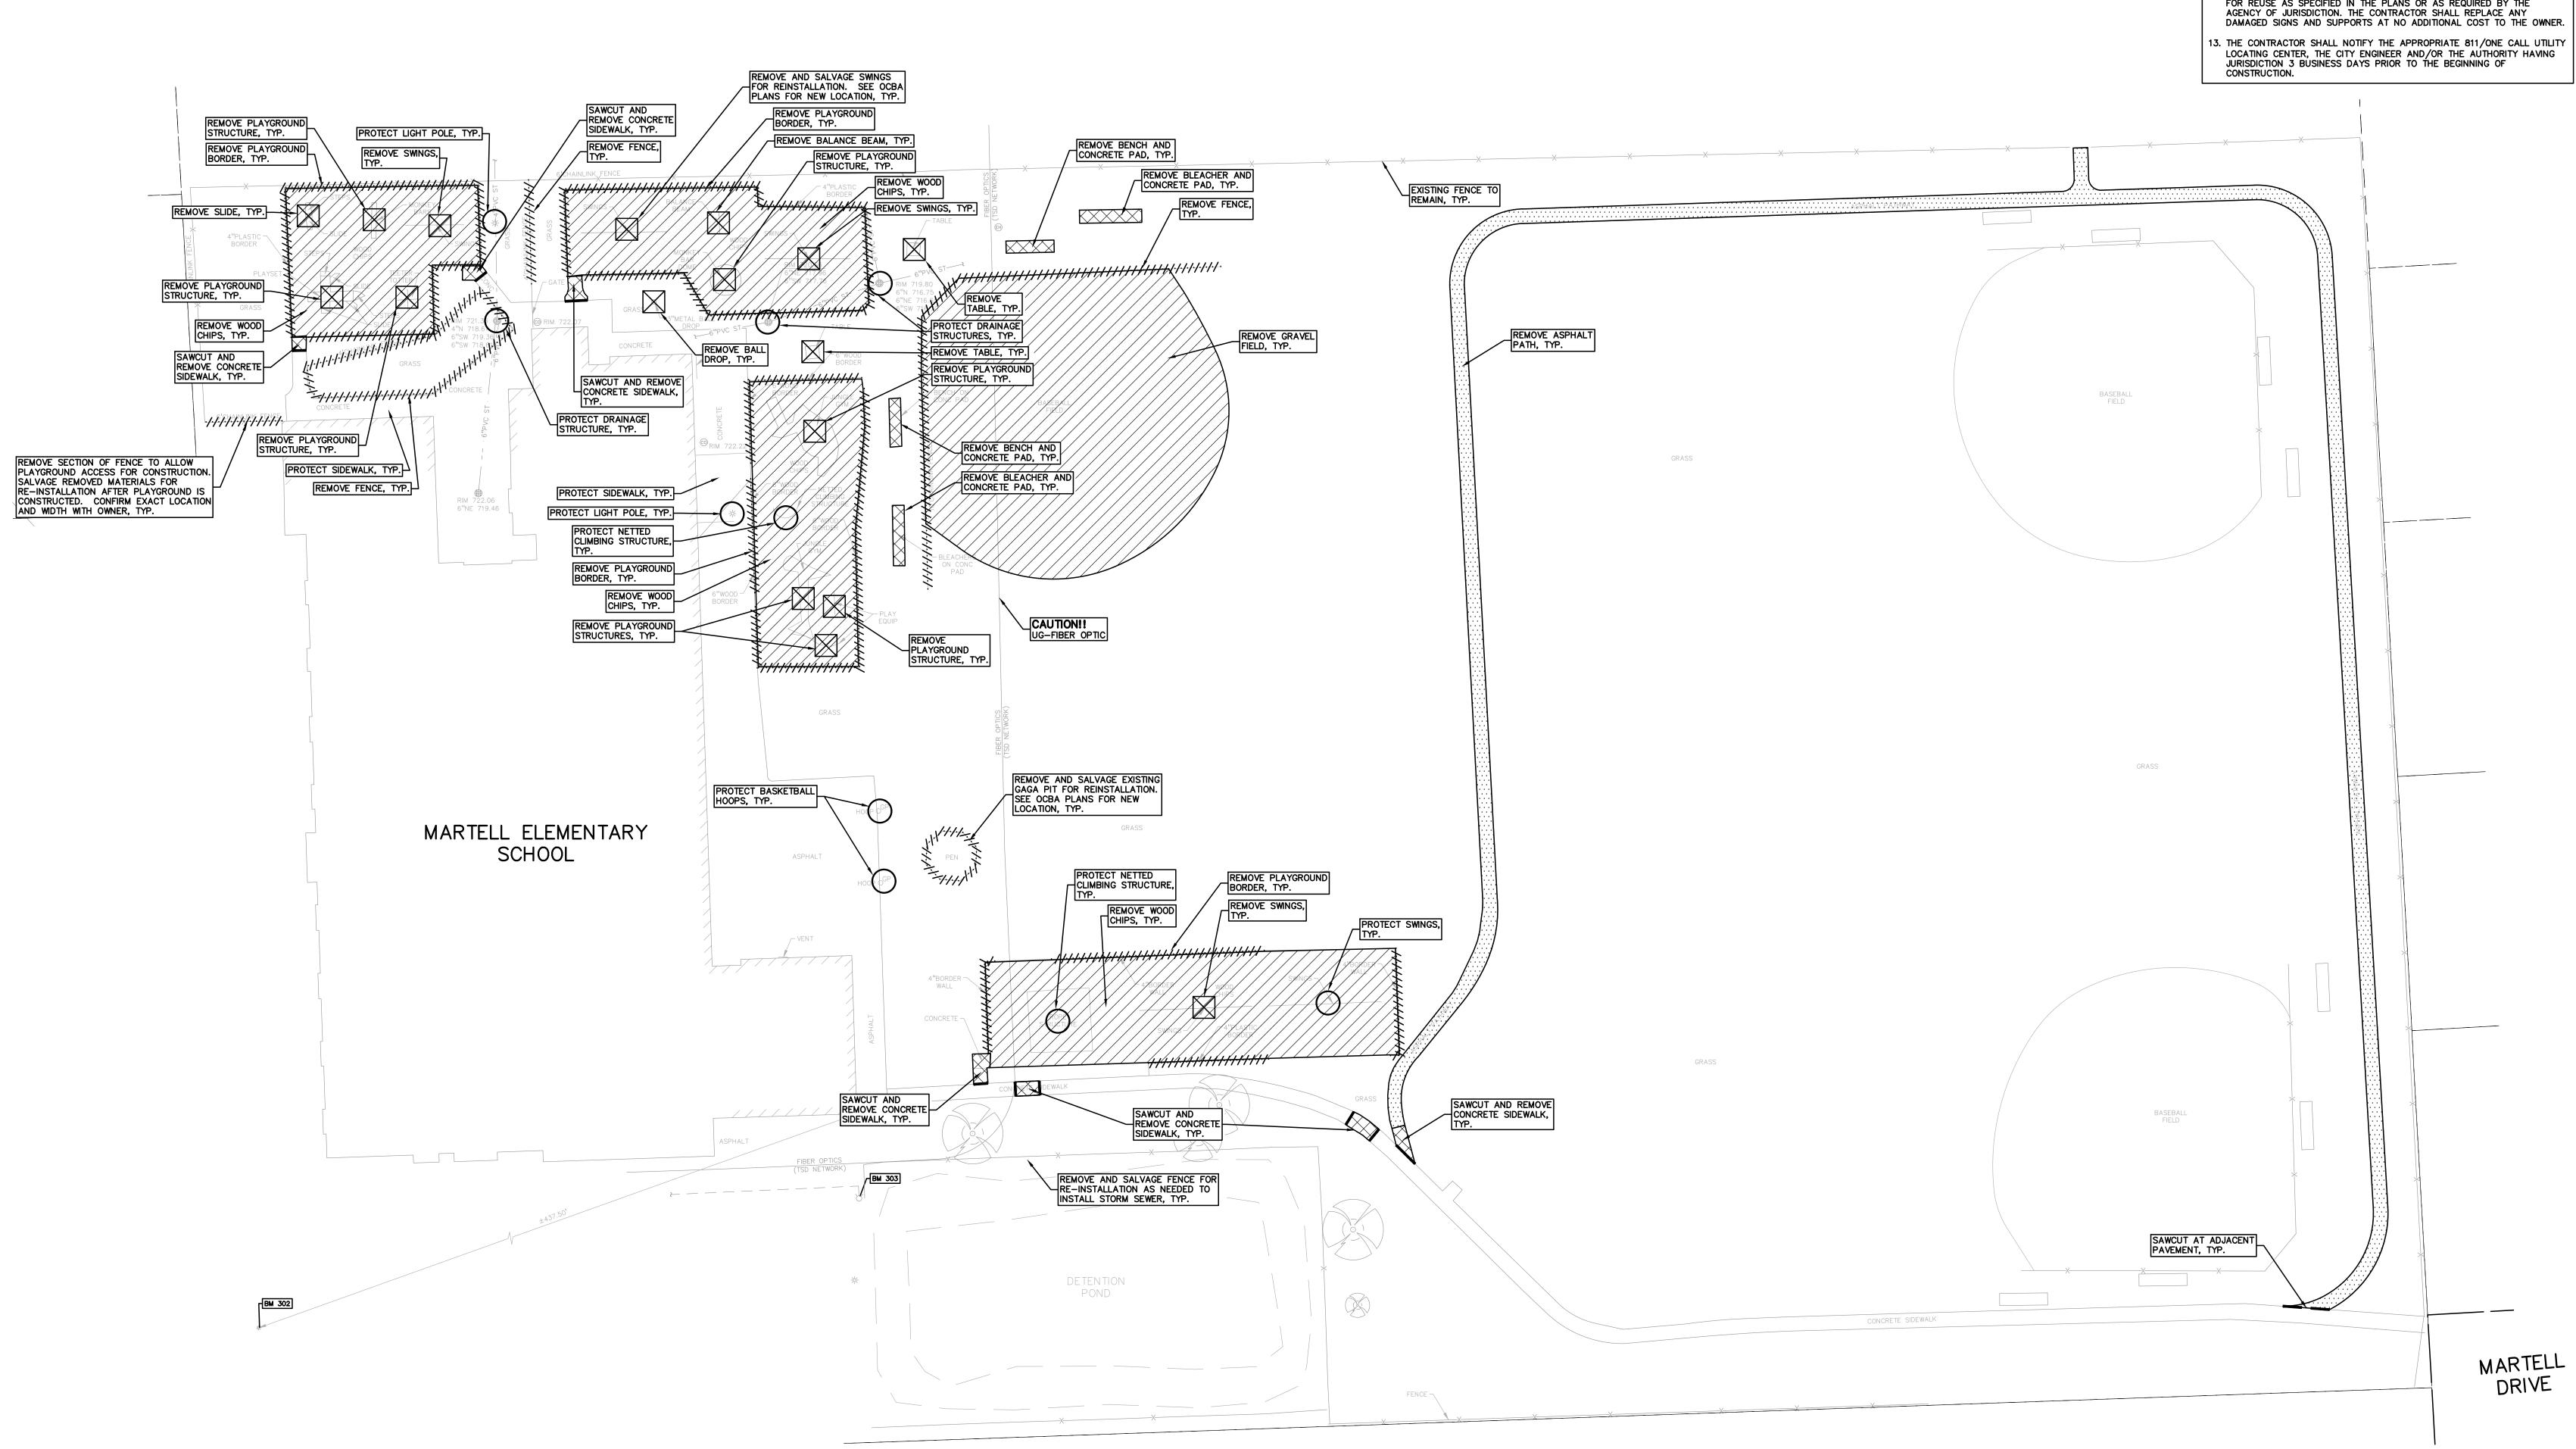

THE QUANTITY FOR "SUBGRADE UNDERCUT" FOR EACH SITE BY THE MODIFIED PROCTOR (ASTM D1557) METHOD OF TESTING. ALL ENGINEERED FILL MATERIAL SHALL BE PLACED AND COMPACTED AT APPROXIMATELY THE OPTIMUM MOIUSTURE IN THE COHESIVE SOILS. THE QUANTITY FOR "SUBGRADE UNDERCUT DRAIN TILE (4")" FOR

SUBGRADE UNDERCUTTING NOTES: TO MINIMIZE SUBGRADE INSTABILITY AND UNDERCUTS, THE SUBGRADE SHALL NOT BE LEFT EXPOSED TO PRECIPITATION AND CONSTRUCTION OPERATIONS AND SHOULD BE PERFORMED DURING THE SUMMER MONTHS TO ENSURE DRY, WARM, WEATHER. ADDITIONALLY, THE SUBGRADE MAY BECOME UNSTABLE UNDER REPEATED LOADING OF CONSTRUCTION TRAFFIC; THEREFORE, CONSTRUCTION EQUIPMENT SHOULD BE LIMITED ON THE EXPOSED SUBGRADE.

SUBGRADE UNDERCUT SHALL BE EVALUATED BY A QUALIFIED ENGINEERING TECHNICIAN TO DETERMINE IF SUBGRADE STABILIZATION IS NECESSARY. UNDERCUT EXCAVATIONS SHALL BE BACKFILLED WITH MDOT 21AA DENSE GRADED AGGREGATE PLACED IN AN ENGINEERED MANNER. LIFT THICKNESS SHALL NOT EXCEED 9 INCHES. THE USE OF TRI—AXIAL GEOGRID MAY BE USED TO REDUCE UNDERCUT DEPTHS, AS APPROVED BY THE DISTRICT AND PER THE UNIT PRICE PROVIDED WITH THE CONTRACTORS BID.

SHALL BE INCLUDED IN THE BASE BID. THIS ITEM IS CONSIDERED AN ALLOWANCE AND FINAL PAYMENT WILL BE BASED ON THE ACTUAL VOLUME OF COMPACTED IN PLACE STONE PER THE UNIT PRICE PROVIDED IN THE BID PACKAGE. ALL ENGINEERED FILL SHALL BE COMPACTED TO A DENSITY OF AT LEAST 95 PERCENT OF THE MAXIMUM DENSITY DETERMINED

CONTENT. FROZEN MATERIAL SHALL NOT BE USED AS FILL, NOR SHOULD FILL BE PLACED ON A FROZEN SUBGRADE. SUBGRADE UNDERCUT DRAIN TILE SHALL BE EVALUATED BY A QUALIFIED ENGINEERING TECHNICIAN TO DETERMINE IF SUBGRADE STABILIZATION IS NECESSARY. DRAIN TILE SHALL BE PLACED WITHIN ANY UNDERCUT AREA AND CONNECTED TO THE CLOSEST CATCH BASIN TO PREVENT GROUNDWATER FROM POOLING WITHIN THE GRANULAR SOILS IN UNDERCUTS AND CREATING "BATHTUBS"

EACH SITE SHALL BE INCLUDED IN THE BASE BID. THIS ITEM IS CONSIDERED AN ALLOWANCE AND FINAL PAYMENT WILL BE BASED ON THE ACTUAL FOOTAGE OF COMPACTED IN PLACE STONE PER THE UNIT PRICE PROVIDED IN THE BID PACKAGE.

CONTRACTOR TO VERIFY ALL QUANTITIES SHOWN ON THE PLANS, ANY DEVIATIONS TO THE PLAN QUANTITIES SHALL BE BROUGHT TO THE ATTENTION OF THE SCHOOL DISTRICT AND PEA GROUP, IN WRITING PER THE BID PACKAGE, FOR VERIFICATION PRIOR TO BIDDING.

ALL DIMENSIONS SHOWN ARE TO BACK OF CURB, FACE OF SIDEWALK, CENTER OF MANHOLE/CATCH BASIN UNLESS OTHERWISE NOTED.

3. DOWEL INTO EXISTING CURB AND GUTTER 9" WITH EPOXY COATED #4 BAR CONTINUOUS BETWEEN EXISTING AND PROPOSED CURBING.

4. REFER TO NOTES AND DETAILS SHEET FOR PAVING DETAILS.

5. CONTRACTOR TO FIELD VERIFY ALL UNDERGROUND UTILITIES PRIOR TO CONSTRUCTION INCLUDING BUT NOT LIMITED TO: SITE LIGHTING, FIBER LINES, ETC. CONTRACTOR TO REMOVE AND REPLACE SIGNS AND POSTS

PER DETAILS ON SHEET C-4.0. ALL SIGNS AND ANY POSTS IN GOOD CONDITION SHALL BE RETURNED TO THE OWNER. ALL POSTS DAMAGED OR OTHERWISE NOT IN USEABLE CONDITION, SHALL BE DISPOSED OF AT NO ADDITIONAL COST 7. FOR THE TWO (2) CATCH BASINS, LOCATED IN THE WORK AREA; BIDDERS ARE TO INCLUDE RECONSTRUCTION OF


THESE STRUCTURES (GREATER THAN 12-INCHES IN DEPTH FROM THE RIM ELEVATION OF REPAIR WORK) IN THE BASE BID. THE SUCCESSFUL BIDDER WILL BE PAID FOR REPAIRING EACH STRUCTURE BASED ON THE ACTUAL DEPTH OF REPAIR WITH EITHER STRUCTURAL ADJUSTMENT (WITHIN TOP 12-INCHES OF RIM ELEVATION) OR STRUCTURAL RECONSTRUCTION (GREATER THAN 12-INCHES IN DEPTH) PER THE UNIT PRICES PROVIDED IN THE BID PACKAGE AND THE SCOPE OF WORK DETERMINED AND APPROVED PRIOR TO THE SCOPE OF WORK DETERMINED AND AFFROYED FRICK THE WORK COMMENCING. REPLASTERING OF THE ENTIRE STRUCTURE SHALL BE INCLUDED IN THE UNIT PRICE FOR BOTH STRUCTURAL ADJUSTMENT AND STRUCTURAL RECONSTRUCTION.

LEGEND: CONCRETE PAVEMENT ASPHALT PAVEMENT GRAVEL alic alic alic METLAND

_____X FENCE

GUARD RAIL

SCALE: 1" = 30'

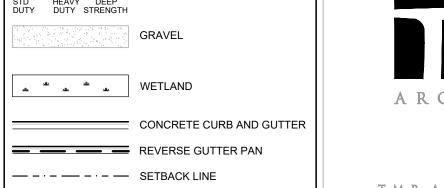

TMP ARCHITECTURE INC 1191 WEST SQUARE LAKE ROAD BLOOMFIELD HILLS • MICHIGAN • 48302 PH • 248.338.4561 FX • 248.338.0223 EM · INFO @ TMP-ARCHITECTURE.COM

REGISTRATION SEAL

CONSULTANT

t: 844.813.2949

www.peagroup.com

PROJECT TITLE

Martell Elementary School 5666 LIVERNOIS

Playground Renovation Bid Package No.01A

Troy School District Troy, Michigan

DRAWING TITLE

Dimension & Paving Plan

ISSUE DATES

CONSTRUCTION DOCUMENTS **ISSUED FOR:**


APPROVED TD

PROJECT NO.

22092B

DRAWING NO.

CE-4.3.0

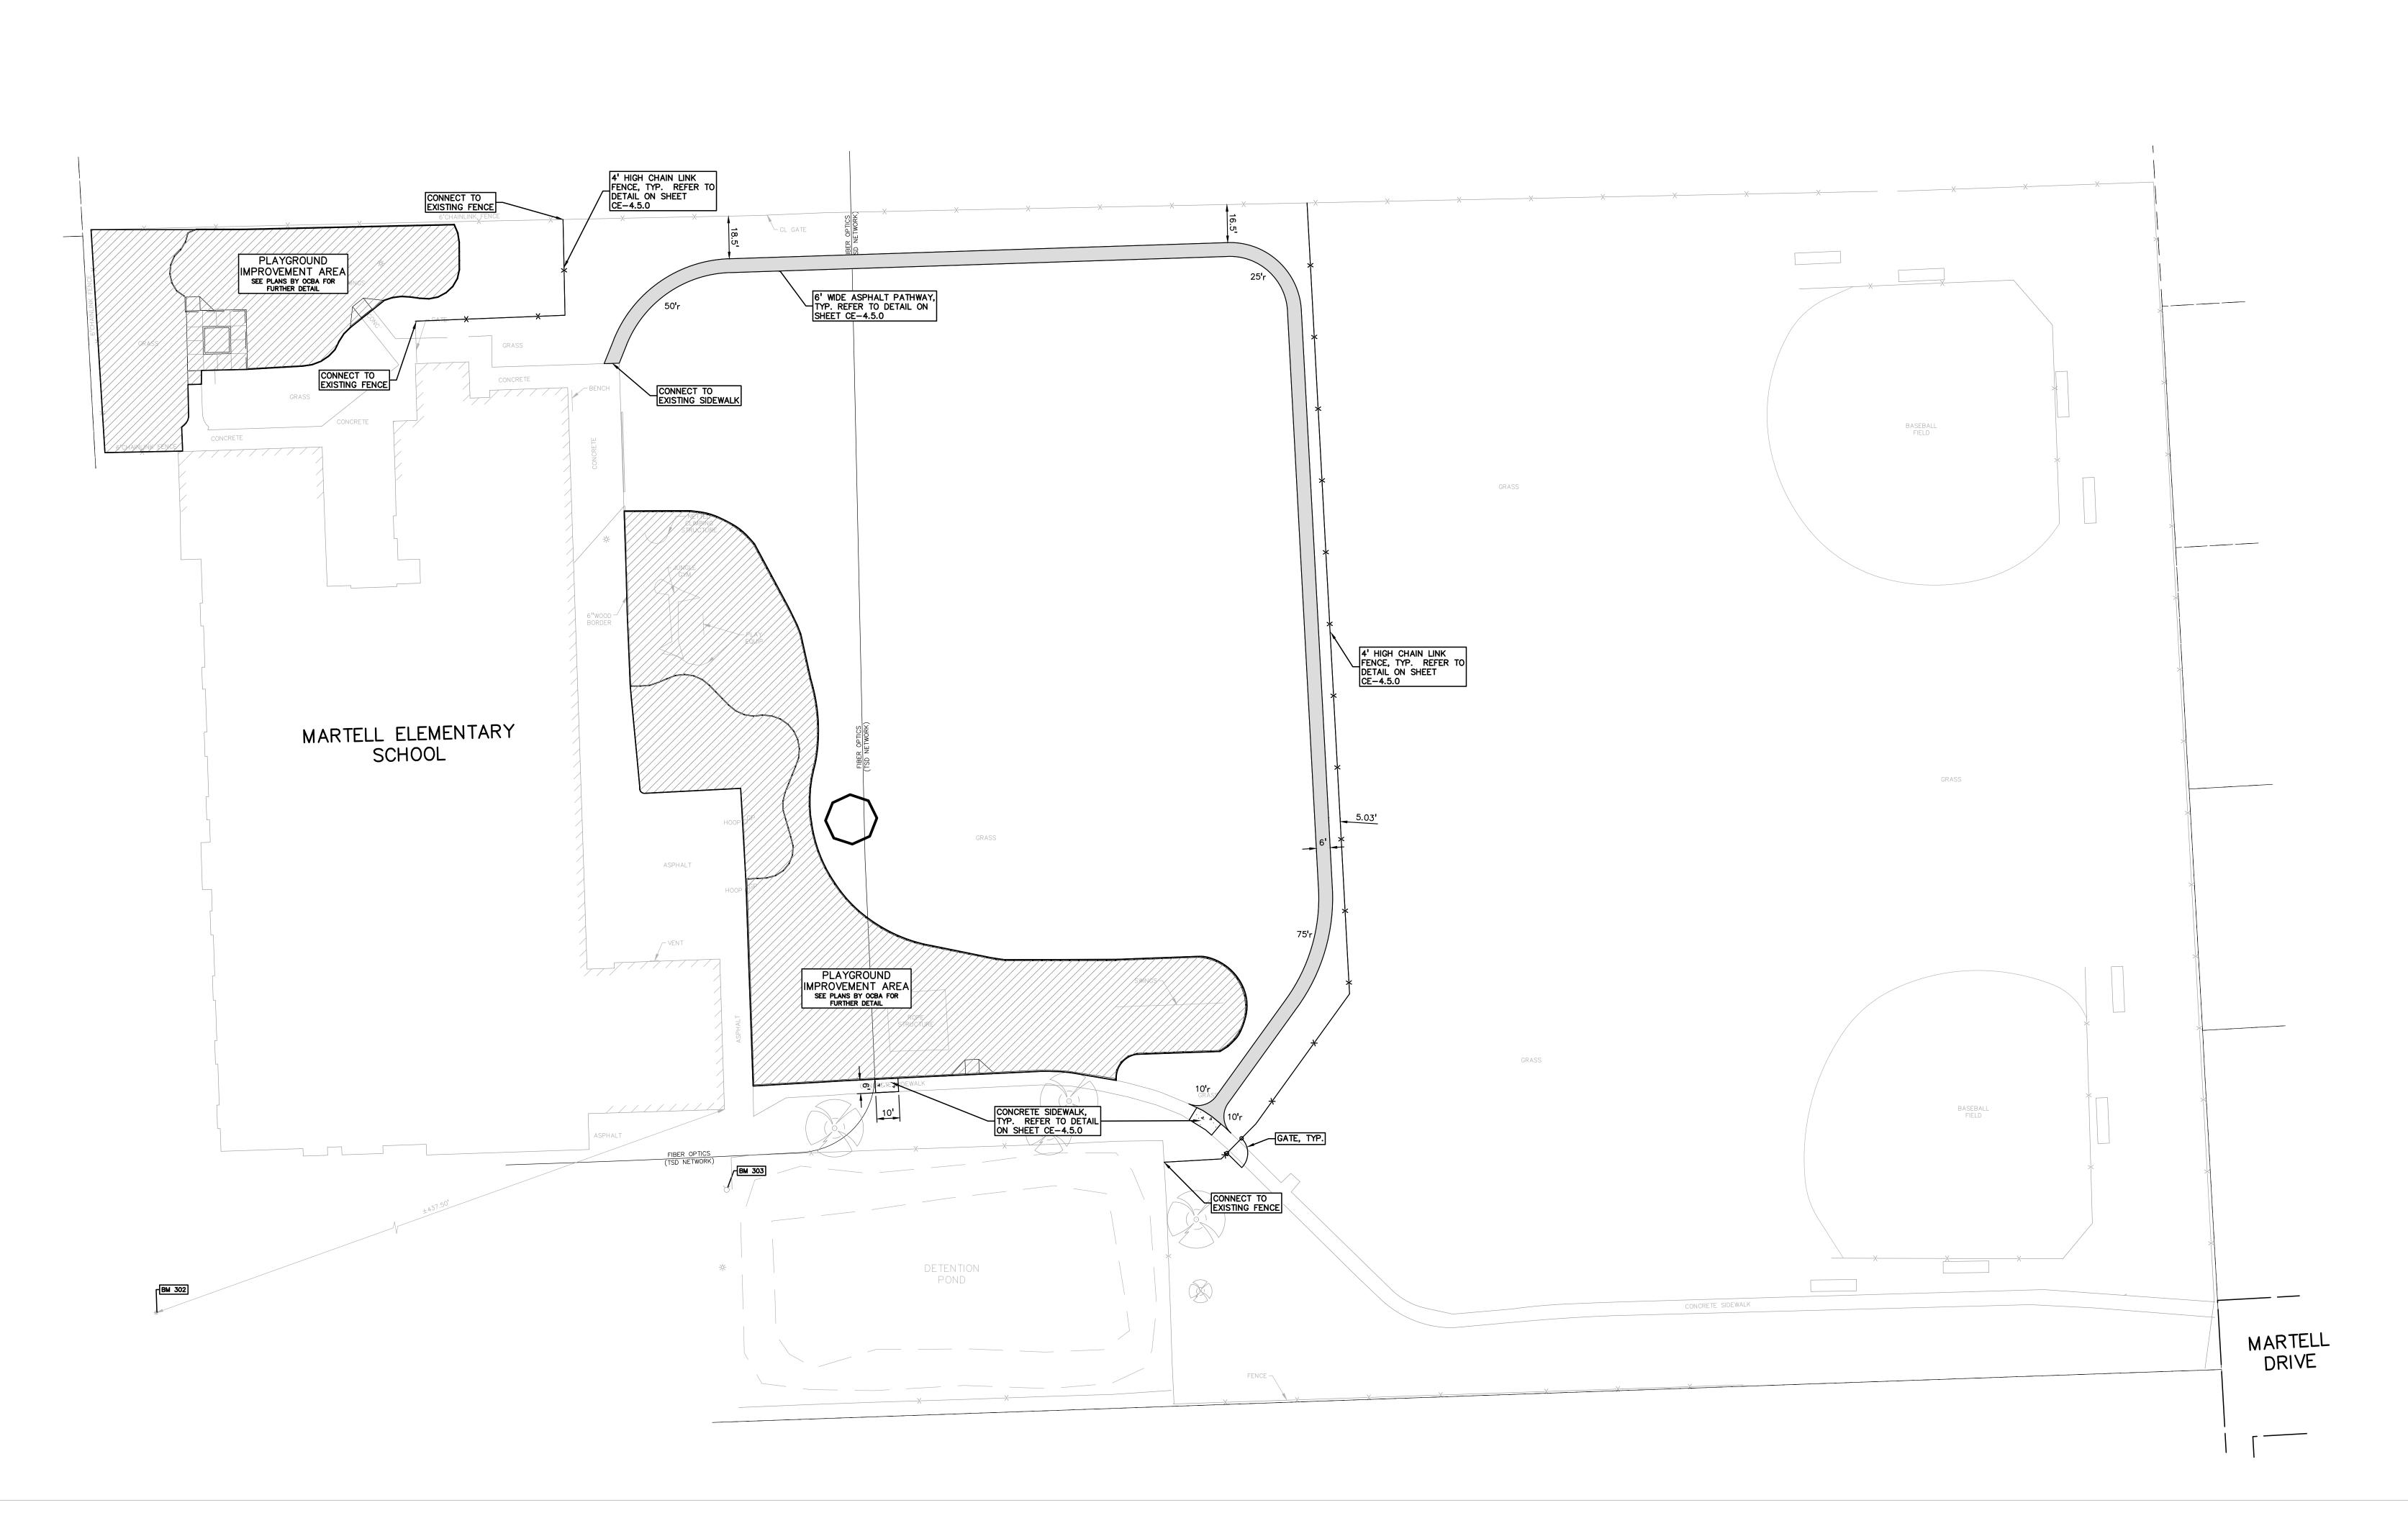

SEQUENCE OF CONSTRUCTION: INSTALL TEMPORARY SOIL EROSION CONTROL MEASURES, SILT FENCES, INLET PROTECTION, ETC. AS 90 MAINTAIN A 25' BUFFER OF VEGETATION AROUND PERIMETER OF SITE WHERE POSSIBLE. 5 STRIP AND STOCKPILE TOPSOIL AS REQUIRED RESTORATION. ALL STOCKPILES MUST BE GRADED AND 15 REMOVE ALL PAVEMENT, CURB, UTILITIES, ETC. AS REQUIRED TO INSTALL THE PROPOSED WORK AS SHOWN ON THE TOPOGRAPHIC SURVEY AND DEMOLITION PLAN. 10 15 DISPOSE OF ALL EXCESS/UNSUITABLE MATERIALS OFF SITE IN A LEGAL MANNER. NO ON-SITE BURN OR 40 ROUGH GRADE SITE. SEED AND MULCH BLANKETS MUST BE INSTALLED AS SHOWN WITHIN 5 DAYS OF FINAL GRADE. REPAIR AND/OR RE-INSTALL ANY TEMPORARY SOIL EROSION CONTROL MEASURES THAT WERE DAMAGED DURING GRADING OPERATIONS. 90 TEMPORARY SEEDING MUST BE PROVIDED IN AREAS NOT TO BE WORKED ON FOR 15 DAYS OR LONGER. 40 50 FINE GRADE SITE AND PREPARE FOR SITE PAVING OPERATIONS. 80 INSTALL ALL PAVEMENT, SIDEWALKS, CURBING AS PROPOSED. IF PERMANENT LANDSCAPING IS NOT TO BE INSTALLED SOON AFTER PAVING IS COMPLETE, ALL AREAS WITHIN 20 FEET OF BACK OF CURB MUST BE TEMPORARILY SEEDED. REPAIR INLET PROTECTION, SILT FENCE AND ANY OTHER DAMAGED SOIL EROSION CONTROL MEASURES AS NECESSARY. 80 89 FINAL GRADE, REDISTRIBUTE STOCKPILED TOPSOIL, ESTABLISH VEGETATION AND INSTALL ALL

90 CLEAN PAVEMENT AND REMOVE ALL TEMPORARY SOIL EROSION CONTROL MEASURES. RE-ESTABLISH VEGETATION AS REQUIRED. 90 90 REMOVE SEDIMENTATION CONTROLS ONCE ENTIRE SITE HAS BEEN PERMANENTLY STABILIZED. BENCHMARKS: (GPS DERIVED - NAVD88)

PERMANENT LANDSCAPING IN ALL DISTURBED AREAS NOT BUILT.

MAG NAIL IN N. SIDE OF LIGHT POLE BASE, ±437.50' SOUTHWEST OF

DIMPLE ON ARROW ON NORTH SIDE OF HYDRANT, ±35.0' SOUTH OF

SOUTHEAST BUILDING CORNER

SOUTHEAST BUILDING CORNER

ELEV.-727.18

ELEV. - 723.05

CONSTRUCTION INCLUDING BUT NOT LIMITED TO: SITE LIGHTING, FIBER **GENERAL SITE CONDITIONS:** THE FOLLOWING SOIL TYPES:

ACCORDING TO THE USDA NRCS WEB SOIL SURVEY, THE SITE CONSISTS OF 41B AQUENTS, SANDY, LOAMY, UNDULATING

PER THE "SOIL EROSION AND SEDIMENTATION CONTROL SEQUENCE OF CONSTRUCTION" NOTES THE SUCCESSFUL BIDDER TO THE CLEAN THE

STORM SEWER. THIS CLEANING SHALL INCLUDE CLEANING OUT THE

STRUCTURES AND ENTIRE SEWER RUNS BETWEEN STRUCTURES USING

HYDRAULICALLY PROPELLED, HIGH-VELOCITY JET, OR MECHANICALLY

POWERED EQUIPMENT. SELECTION OF THE EQUIPMENT USED SHALL BE BASED ON THE CONDITIONS OF LINES AT THE TIME THE WORK

COMMENCES. THE EQUIPMENT AND METHODS SELECTED SHALL BE

SATISFACTORY TO THE SCHOOL DISTRICT'S REPRESENTATIVE. THE EQUIPMENT SHALL BE CAPABLE OF REMOVING DIRT, GREASE, ROCKS,

SAND, AND OTHER MATERIALS AND OBSTRUCTIONS FROM THE SEWER

LINES AND MANHOLES. IF CLEANING OF AN ENTIRE SECTION CANNOT

BE SUCCESSFULLY PERFORMED FROM ONE MANHOLE, THE EQUIPMENT

ATTEMPTED. IF. AGAIN. SUCCESSFUL CLEANING CANNOT BE PERFORMED

SECTION, IT WILL BE ASSUMED THAT A MAJOR BLOCKAGE EXISTS AND

SHALL BE SET UP ON THE OTHER MANHOLE AND CLEANING AGAIN

PER THE PROJECT SPECIFICATIONS: PRIOR TO THE PLACEMENT OF

TOPSOIL THE SUCCESSFUL BIDDER TO SCHEDULE AN INSPECTION BY

THE SCHOOL DISTRICT OR PEA GROUP TO CONFIRM THAT THE GRADE

IS AT THE PROPER ELEVATION WHERE THE MINIMUM DEPTH OF TOPSOIL

CONTRACTOR TO FIELD VERIFY ALL UNDERGROUND UTILITIES PRIOR TO

OR THE EQUIPMENT FAILS TO TRAVERSE THE ENTIRE MANHOLE

THE CLEANING EFFORT SHALL BE ABANDONED.

CAN BE PLACED THROUGHOUT THE AREA.

TOTAL DISTURBED AREA = ± 2.1 ACRES

SOIL EROSION MAINTENANCE SCHEDULE AND NOTES: THE SOIL EROSION CONTROLS WILL BE MAINTAINED WEEKLY AND AFTER EVERY STORM EVENT BY:

SEQUENCE OF CONSTRUCTION

CONCRETE - NO FINES).

STRUCTURES, ACCORDING TO PLANS.

MANNER. NO BURN OR BURY PITS ALLOWED.

OR OTHER MISCELLANEOUS DEBRIS OR TRASH.

WILL BE USED WHERE VEGETATION IS REQUIRED.

SYSTEM. REPAIR INLET FILTERS AS REQUIRED.

AND CATCH BASINS, AS SHOWN.

CHANGED AND MAINTAINED.

MASS GRADE THE SITE IN ACCORDANCE WITH THE PLANS.

. INSTALL TEMPORARY CRUSHED CONCRETE ACCESS DRIVE AT ALL

STRIP AND STOCKPILE TOPSOIL FOR RESTORATION REQUIREMENTS.

CONSTRUCTION ENTRANCES. (80'x24'x8" W/MINIMUM OF 1"-3" CRUSHED

REMOVE CURB, PAVEMENT, TREES, ETC. AS DIRECTED ON THE DEMOLITION

DISPOSE OF ALL EXCESS, UNSUITABLE MATERIALS OFF SITE IN A LEGAL

. INSTALL HYDROSEED AS SHOWN ON THE PLAN WITHIN 5 DAYS OF COMPLETION OF MASS GRADING OR WHENEVER DISTURBED AREAS WILL

REMAIN UNCHANGED FOR 30 DAYS OR GREATER. MINIMUM 3"-4" TOPSOIL

. FINISH GRADE AND PAVE SITE AS PROPOSED TO DRAIN TO STORM SEWER

OF GRADING. THE CONTRACTOR SHALL STAGE CONSTRUCTION ACTIVITIES IN ORDER TO MINIMIZE THE EXPOSURE OF UNSTABILIZED AREAS.

13. CLEAN PAVEMENT AND STORM SEWERS. REMOVE SILT FENCE AND TREE PROTECTION FENCE, AND INLET FILTERS ONCE VEGETATION HAS BEEN

14. ALL DIRT AND MUD TRACKED ONTO PUBLIC ROADS SHALL BE REMOVED

15. STREET CATCH BASINS TO BE PERIODICALLY CLEANED AND FILTER CLOTH

UNSUITABLE MATERIALS CONSIST OF, BUT ARE NOT NECESSARILY LIMITED TO THE FOLLOWING: CONCRETE, ASPHALT, TREES, BRUSH, STUMPS, ROOTS,

TROY SCHOOL DISTRICT 1140 RANKIN TROY, OAKLAND COUNTY, MICHIGAN 248-823-4067

IF ANY DAMAGE HAS OCCURRED AS A RESULT OF STORM WATER DISCHARGE FROM THE SITE, THE FOLLOWING STEPS SHALL BE IMPLEMENTED. ANY DEBRIS OR DIRT ON ANY PAVED AREA RESULTING FROM CONSTRUCTION TRAFFIC SHALL BE CLEANED IN A PROMPT MANNER BY THE CONTRACTOR. THE CONSTRUCTION DRIVE SHALL BE CLEANED AT THE END

ALL DIRT AND MUD TRACKED ONTO PAVED AREAS SHALL BE REMOVED BY THE CONTRACTOR DAILY BY SCRAPING. STREET SWEEPING IS REQUIRED SILT FENCE MAINTENANCE SHALL INCLUDE THE REMOVAL OF ANY BUILT UP SEDIMENT WHEN THE SEDIMENT HEIGHT ACCUMULATES TO 1/3 TO 1/2 OF THE HEIGHT OF THE FENCE. THE CONTRACTOR IS RESPONSIBLE TO REMOVE, REPLACE, RETRENCH OR REBACKFILL THE SILTATION FENCE SHOULD IT FALL

OR BE DAMAGED DURING CONSTRUCTION. INLET FILTER MAINTENANCE SHALL INCLUDE THE REMOVAL OF ANY ACCUMULATED SILT OR OTHER DEBRIS. THE REMOVAL OF SILT SHOULD BE WITH THE USE OF A STIFF BRISTLE BROOM OR SQUARE POINT SHOVEL. IF

INLET FILTERS CAN NOT BE CLEANED OR ARE DAMAGED, THEN THE FABRIC 10. COMPLETE ROUGH GRADING OF SITE. PLACE INLET FILTERS AT ALL INLETS CONTRACTOR TO PROVIDE WATER TRUCK TO WATER DOWN THE SITE ON A DAILY BASIS AS REQUIRED TO MAINTAIN DUST CONTROL. 12. APPLY TOPSOIL, HYDROSEED TO ALL DISTURBED AREAS UPON COMPLETION

IF HIGH GROUNDWATER IS ANTICIPATED OR ENCOUNTERED DURING CONSTRUCTION A DEWATERING PLAN MUST BE SUBMITTED TO THE CITY ENGINEERING DIVISION FOR REVIEW.

EARTHWORK BALANCING NOTE: SOIL EROSION AND SEDIMENTATION CONTROL THE CONTRACTOR SHALL BE RESPONSIBLE FOR IMPORTING OR EXPORTING ALL MATERIALS AS REQUIRED TO PROPERLY GRADE SEE OAKLAND COUNTY W.R.C. SOIL EROSION AND SEDIMENTATION CONTROL THIS PROJECT TO THE FINISHED ELEVATIONS SHOWN ON THE DETAILS SHEET FOR ALL SOIL EROSION CONTROL RELATED DETAILS. APPROVED PLANS. THE CONTRACTOR SHALL MAKE THEIR OWN DETERMINATION OF CUT AND FILL QUANTITIES AND ALLOW FOR PLACE SILT FENCE & INSTALL INLET FILTERS ON EXISTING STORM SEWER REMOVAL OF EXCESS OR IMPORTATION OF ADDITIONAL

> PREMIUM TRENCH BACKFILL NOTE: ALL UTILITIES UNDER PAVEMENT OR WITHIN 3' OF THE EDGE OF PAVEMENT (OR WITHIN THE 45° LINE OF INFLUENCE OF PAVEMENT) SHALL HAVE M.D.O.T. CLASS II GRANULAR BACKFILL CÓMPACTED TO 95% MAX. DRY DENSITY (ASTM D-1557).

MATERIAL AT NO ADDITIONAL COST TO THE OWNER.

GRADING LEGEND: EXISTING SPOT ELEVATION PROPOSED SPOT ELEVATION: TYPICALLY TOP OF PAVEMENT IN PAVED AREAS, GUTTER GRADE IN CURB LINES. - EXISTING CONTOUR ——922—— PROPOSED CONTOUR

PROPOSED REVERSE GUTTER PAN - — — — — PROPOSED RIDGE LINE **ABBREVIATIONS** T/C = TOP OF CURB

----- PROPOSED SWALE/DITCH G = GUTTER GRADE T/P = TOP OF PAVEMENT F.G. = FINISH GRADE T/S = TOP OF SIDEWALK RIM = RIM ELEVATION T/W = TOP OF WALL B/W = BOTTOM OF WALL REFER TO GRADING NOTES ON SHEET CE-4.5.0

—— □ ——— (SP-2) SILT FENCE (SI-2A) LOW POINT INLET FILTER (SI-3) RYCB INLET FILTER (E-9) EROSION CONTROL BLANKET LAWN RESTORATION

SYMBOLS: EROSION CONTROL:

LIMITS OF DISTURBANCE REFER TO CITY OF TROY SOIL EROSION AND SEDIMENTATION CONTROL DETAILS SHEET FOR ALL DEVICE DETAILS.

UTILITY LEGEND: H-ELEC-VV-O--- EX. OH. ELEC, POLE & GUY WIRE G-CATV-TV-EX. U.G. CABLE TV & PEDESTAL G-ELEC-E-E-E-EX. U.G. ELEC,MANHOLE, METER & HANDHOLE

- - EX. GAS LINE © GAS EX. GAS VALVE & GAS LINE MARKER – — — — EX. WATER MAIN ∀ -- W EX. HYDRANT, GATE VALVE & POST INDICATOR VALVE

EX. SANITARY SEWER © S EX. SANITARY CLEANOUT & MANHOLE © EX. COMBINED SEWER MANHOLE — -- EX. STORM SEWER © ST EX. CLEANOUT & MANHOLE EX. SQUARE, ROUND, & BEEHIVE CATCH BASIN

EX. YARD DRAIN & ROOF DRAIN EX. UNIDENTIFIED STRUCTURE - - PROPOSED WATER MAIN ▼ ⊗ PROPOSED HYDRANT AND GATE VALVE PROPOSED TAPPING SLEEVE, VALVE & WELL PROPOSED POST INDICATOR VALVE PROPOSED SANITARY SEWER OC.O. PROPOSED SANITARY CLEANOUT & MANHOLE

PROPOSED CATCH BASIN, INLET & YARD DRAIN

— -- PROPOSED STORM SEWER ○C.O. ■ PROPOSED STORM SEWER CLEANOUT & MANHOLE

CONSULTANT

t: 844.813.2949

www.peagroup.com

TMP ARCHITECTURE INC

1191 WEST SQUARE LAKE ROAD

BLOOMFIELD HILLS • MICHIGAN • 48302

PH • 248.338.4561 FX • 248.338.0223

REGISTRATION SEAL

EM · INFO @ TMP-ARCHITECTURE.COM

PROJECT TITLE

Martell Elementary School 5666 LIVERNOIS

Playground Renovation Bid Package No.01A

Troy School District Troy, Michigan

DRAWING TITLE Grading, Utility & Soil **Erosion Control Plan**

ISSUE DATES

CONSTRUCTION DOCUMENTS


DRAWN

CHECKED **APPROVED** TD

PROJECT NO. 22092B

DRAWING NO.

CE-4.4.0

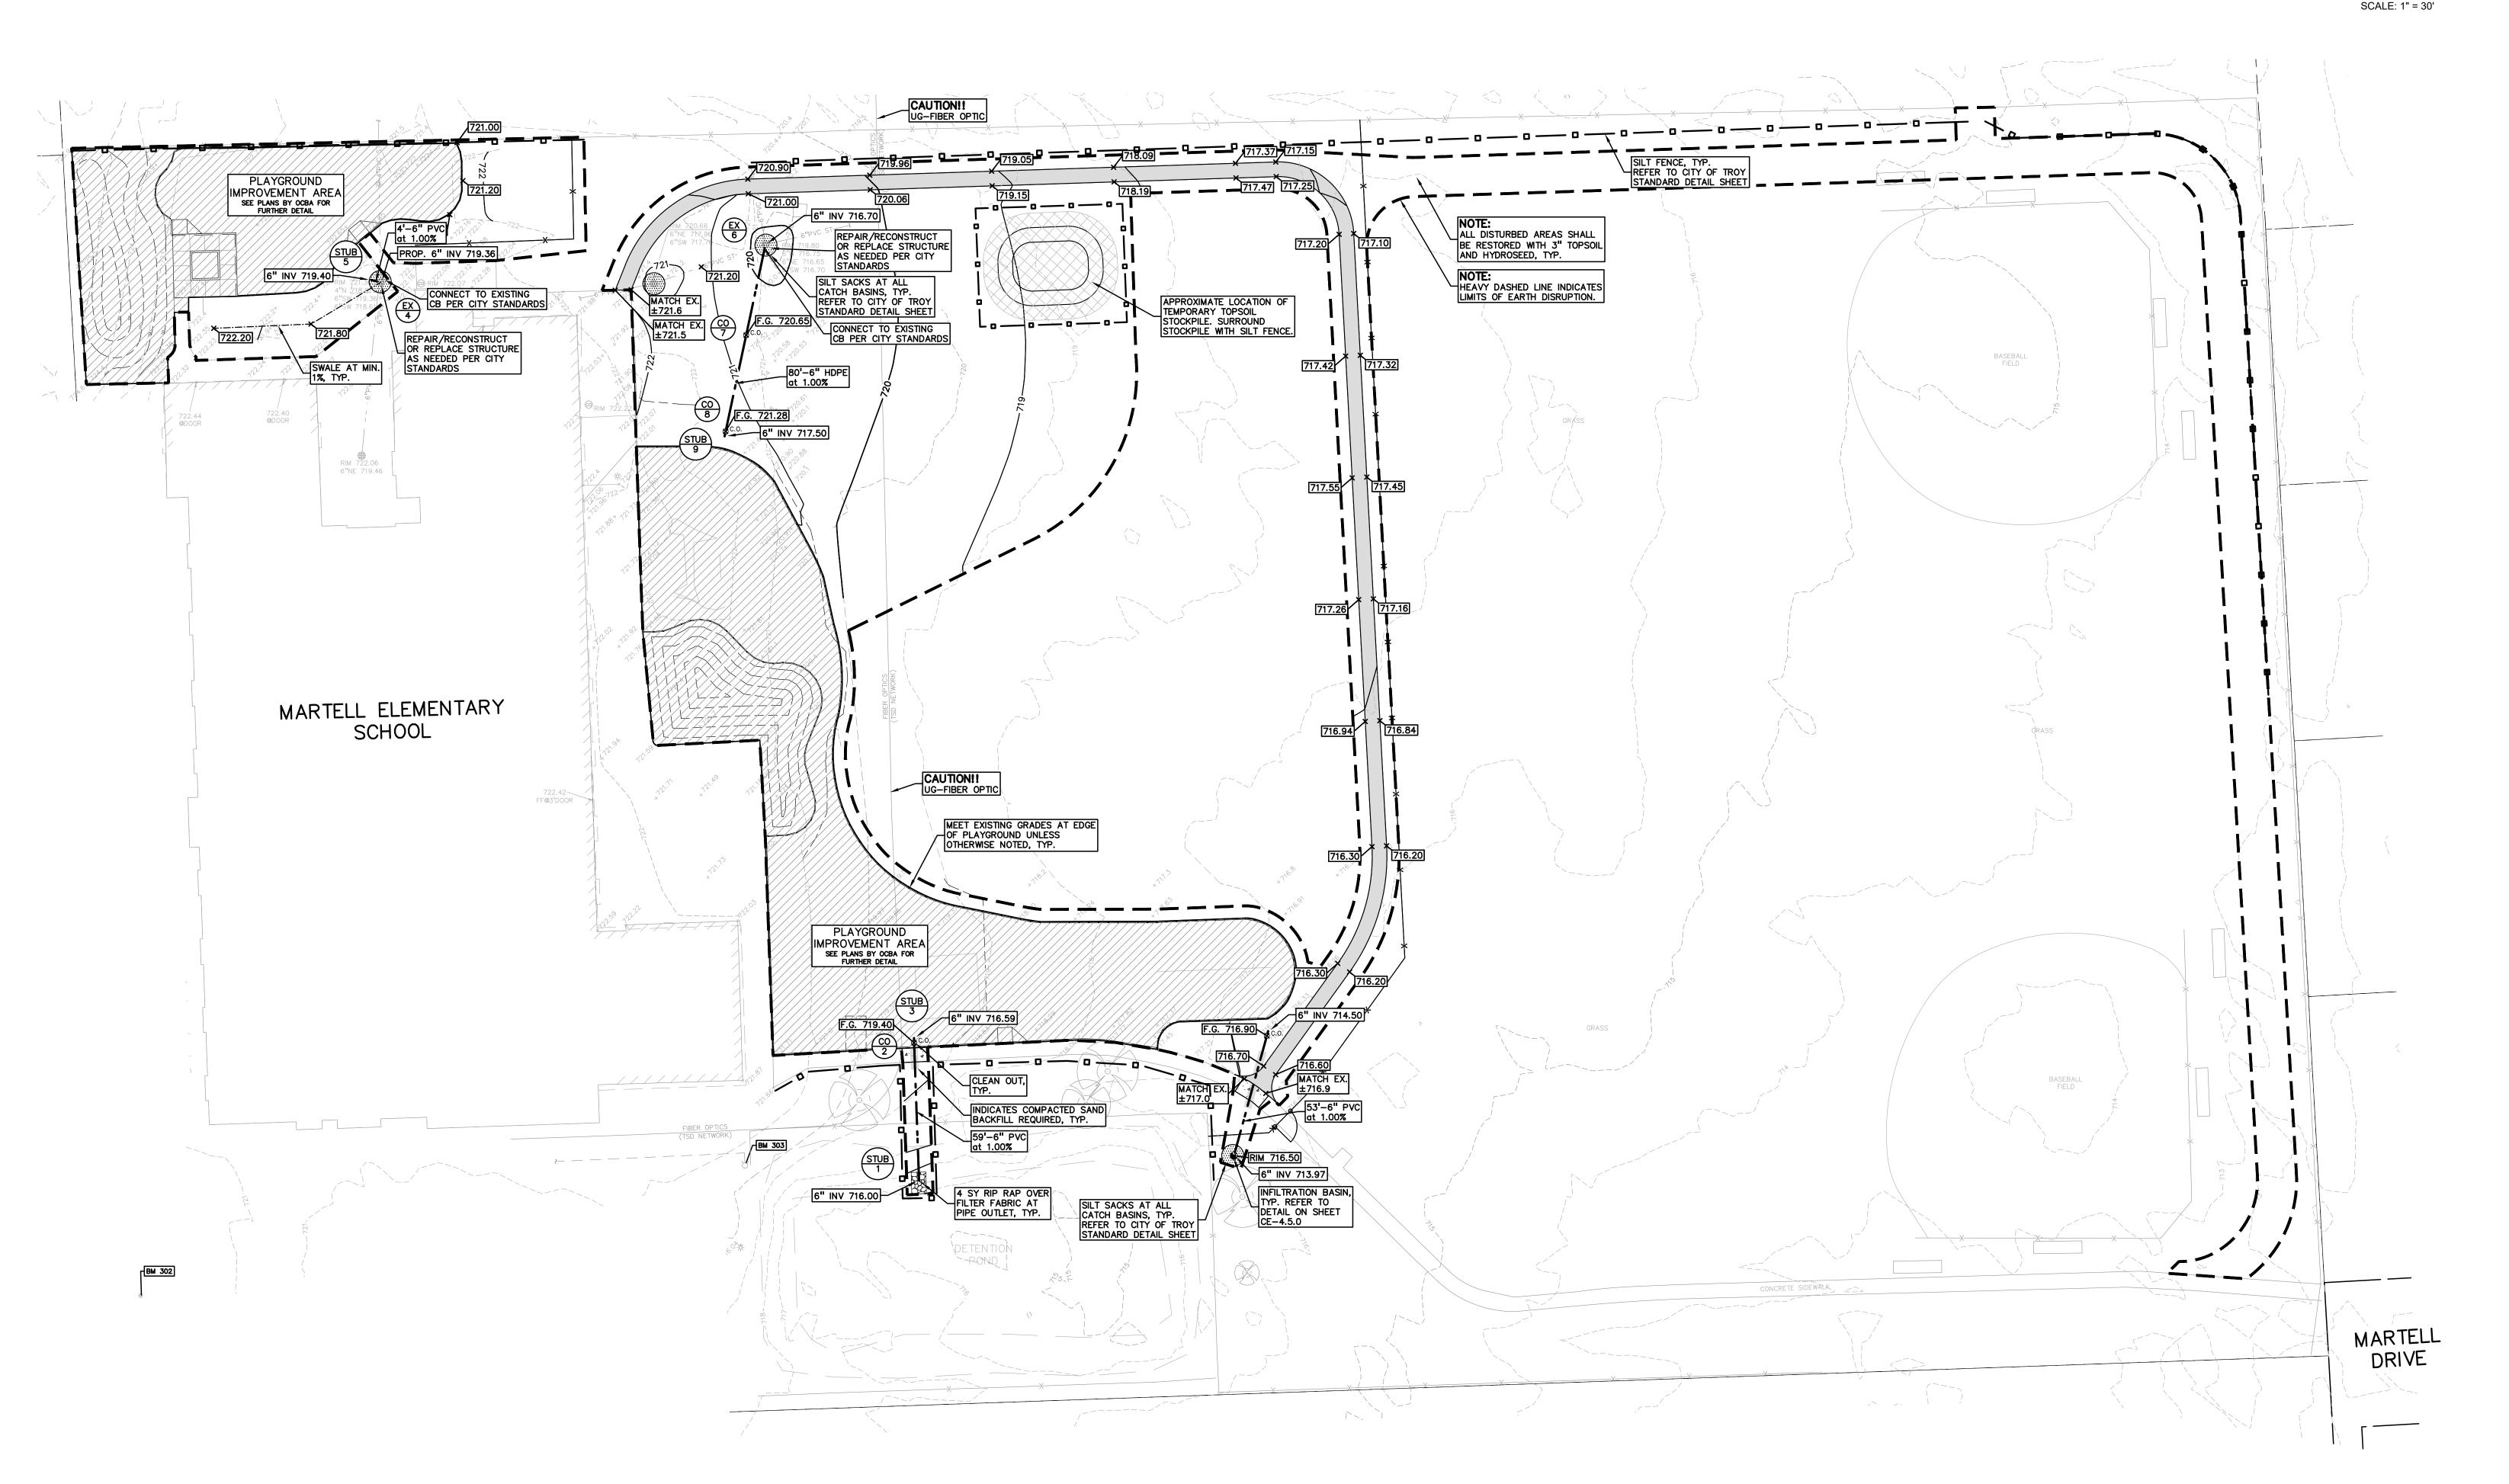

- THESE NOTES APPLY TO ALL CONSTRUCTION ACTIVITIES ON THIS PROJECT. ALL CONSTRUCTION, WORKMANSHIP AND MATERIALS SHALL BE IN
- ACCORDANCE WITH CURRENT OSHA, MDOT AND MUNICIPALITY STANDARDS THE CONTRACTOR SHALL NOTIFY THE CITY OF TROY ENGINEER AND/OR THE
- AUTHORITY HAVING JURISDICTION 3 BUSINESS DAYS PRIOR TO THE BEGINNING OF CONSTRUCTION. 3. THE CONTRACTOR MUST CONTACT THE ENGINEER SHOULD THEY ENCOUNTER
- DESIGN MODIFICATIONS WITHOUT THE WRITTEN DIRECTION OF THE DESIGN ENGINEER, THE CONTRACTOR DOES SO AT HIS OWN RISK. ALL NECESSARY PERMITS, TESTING, BONDS AND INSURANCES ETC., SHALL

ANY DESIGN ISSUES DURING CONSTRUCTION. IF THE CONTRACTOR MAKES

- BE PAID FOR BY THE CONTRACTOR. THE OWNER SHALL PAY FOR ALL CITY
- . THE CONTRACTOR SHALL NOTIFY THE APPROPRIATE 811/ONE CALL UTILITY LOCATING CENTER, THE CITY ENGINEER AND/OR THE AUTHORITY HAVING JURISDICTION 3 BUSINESS DAYS PRIOR TO THE BEGINNING OF CONSTRUCTION. IF NO NOTIFICATION IS GIVEN AND DAMAGE RESULTS, SAID DAMAGE WILL BE REPAIRED AT SOLE EXPENSE OF THE CONTRACTOR. IF EXISTING UTILITY LINES ARE ENCOUNTERED THAT CONFLICT IN LOCATION WITH NEW CONSTRUCTION, THE CONTRACTOR SHALL NOTIFY THE DESIGN ENGINEER SO THAT THE CONFLICT MAY BE RESOLVED.
- CONTRACTOR TO VERIFY THAT THE PLANS AND SPECIFICATIONS ARE THE VERY LATEST PLANS AND SPECIFICATIONS AND FURTHERMORE, VERIFY THAT THESE PLANS AND SPECIFICATIONS HAVE BEEN APPROVED. ALL ITEMS CONSTRUCTED BY THE CONTRACTOR PRIOR TO RECEIVING FINAL APPROVAL HAVING TO BE ADJUSTED OR RE-DONE, SHALL BE AT THE CONTRACTORS EXPENSE. SHOULD THE CONTRACTOR ENCOUNTER A CONFLICT BETWEEN THESE PLANS AND/OR SPECIFICATIONS, THEY SHALL SEEK CLARIFICATION IN WRITING FROM THE ENGINEER BEFORE COMMENCEMENT OF CONSTRUCTION. FAILURE TO DO SO SHALL BE AT SOLE EXPENSE TO THE CONTRACTOR.
- ANY WORK WITHIN THE STREET OR HIGHWAY RIGHTS-OF-WAY SHALL BE PERFORMED IN ACCORDANCE WITH THE REQUIREMENTS OF THE AGENCIES HAVING JURISDICTION AND SHALL NOT BEGIN UNTIL ALL NECESSARY PERMITS HAVE BEEN ISSUED FOR THE WORK.
- ALL PROPERTIES OR FACILITIES IN THE SURROUNDING AREAS, PUBLIC OR PRIVATE, DESTROYED OR OTHERWISE DISTURBED DUE TO CONSTRUCTION, SHALL BE REPLACED AND/OR RESTORED TO THE ORIGINAL CONDITION BY
- . THE CONTRACTOR SHALL PROVIDE ALL NECESSARY BARRICADING, SIGNAGE, LIGHTS AND TRAFFIC CONTROL DEVICES TO PROTECT THE WORK AND SAFELY MAINTAIN TRAFFIC IN ACCORDANCE WITH LOCAL REQUIREMENTS AND THE MANUAL OF UNIFORM TRAFFIC CONTROL DEVICES (LATEST EDITION). THE DESIGN ENGINEER, OWNER, CITY OF TROY AND STATE SHALL NOT BE HELD LIABLE FOR ANY CLAIMS RESULTING FROM ACCIDENTS OR DAMAGES CAUSED BY THE CONTRACTOR'S FAILURE TO COMPLY WITH TRAFFIC AND PUBLIC SAFETY REGULATIONS DURING THE CONSTRUCTION PERIOD.
- 10. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO ADJUST THE TOP OF ALL EXISTING AND PROPOSED STRUCTURES (MANHOLES, CATCH BASINS, INLETS, GATE WELLS ETC.) WITHIN GRADED AND /OR PAVED AREAS TO FINAL GRADE SHOWN ON THE PLANS. ALL SUCH ADJUSTMENTS SHALL BE INCIDENTAL TO THE JOB AND WILL NOT BE PAID FOR SEPARATELY.

- IN AREAS WHERE NEW PAVEMENTS ARE BEING CONSTRUCTED, THE TOPSOIL AND SOIL CONTAINING ORGANIC MATTER SHALL BE REMOVED PRIOR TO PAVEMENT CONSTRUCTION.
- REFER TO ARCHITECTURAL PLANS FOR DETAILS OF FROST SLAB AT EXTERIOR BUILDING DOORS.
- CONSTRUCTION TRAFFIC SHOULD BE MINIMIZED ON THE NEW PAVEMENT. CONSTRUCTION TRAFFIC IS ANTICIPATED ON THE PAVEMENT STRUCTURE. THE INITIAL LIFT THICKNESS COULD BE INCREASED AND PLACEMENT OF THE FINAL LIFT COULD BE DELAYED UNTIL THE MAJORITY OF THE CONSTRUCTION ACTIVITIES HAVE BEEN COMPLETED. THIS ACTION WILL ALLOW REPAIR OF LOCALIZED FAILURE, IF ANY DOES OCCUR, AS WELL AS REDUCE LOAD DAMAGE ON THE PAVEMENT SYSTEM.
- 4. ALL EXPANSION JOINTS AND CONCRETE PAVEMENT JOINTS TO BE SEALED. 5. CONCRETE PAVEMENT JOINTING - UNLESS SHOWN OTHERWISE IN THE PLANS OR REQUIRED BY THE AUTHORITY HAVING JURISDICTION:
- 5.1. WHERE PROPOSED CONCRETE ABUTS A STRUCTURE, PROVIDE A MINIMUM 1/2" EXPANSION JOINT. THE JOINT FILLER BOARD MUST BE AT LEAST THE FULL DEPTH OF THE CONCRETE AND HELD DOWN A 1/2" TO ALLOW FOR SEALING. 5.2. WHERE PROPOSED CONCRETE ABUTS EXISTING CONCRETE OR IN BETWEEN POURS OF PROPOSED CONCRETE (CONSTRUCTION JOINT),
- PROVIDE 5/8" DOWELS EVERY 30" CENTER TO CENTER HALF WAY ALONG THE THICKNESS OF THE PROPOSED PAVEMENT. ALTERNATE DOWELS SIZES AND SPACING MUST BE APPROVED THE ENGINEER PRIOR TO COMMENCING WORK AND VIA THE SUBMITTAL PROCESS.
- WHERE PROPOSED CONCRETE ABUTS EXISTING OR PROPOSED SIDEWALK OR CURBING, PROVIDE A MINIMUM 1/2" EXPANSION JOINT. 5.4. CONTROL. LONGITUDINAL AND OR TRANSVERSE JOINTS SHALL BE PLACED TO PROVIDE PANELS WITHIN THE PAVEMENT AS SQUARE AS POSSIBLE WITH THE FOLLOWING MAXIMUM SPACING PARAMETERS:

5.4.1. 6-INCH THICK CONCRETE PAVEMENT: 12' X 12'

- 5.4.2. 8-INCH THICK CONCRETE PAVEMENT: 15' X 15' 5.5. IRREGULAR-SHAPED PANELS MAY REQUIRE THE USE OF REINFORCING MESH OR FIBER MESH AS DETERMINED BY THE ENGINEER. THE USE OF MESH MUST BE APPROVED THE ENGINEER PRIOR TO COMMENCING WORK
- AND VIA THE SUBMITTAL PROCESS. 5.6. IF A JOINT PLAN IS NOT PROVIDED IN THE PLANS. THE CONTRACTOR SHALL SUBMIT ONE TO THE ENGINEER FOR REVIEW PRIOR TO COMMENCING WORK AND VIA THE SUBMITTAL PROCESS.
- 5. CONCRETE CURBING JOINTING UNLESS SHOWN OTHERWISE IN THE PLANS OR REQUIRED BY THE AUTHORITY HAVING JURISDICTION 6.1. JOINTS WHEN ADJACENT TO ASPHALT PAVEMENT 6.1.1. PLACE CONTRACTION JOINTS AT 10' INTERVALS
- 6.1.2. PLACE 1/2" EXPANSION JOINT AT CATCH BASINS, EXISTING AND PROPOSED SIDEWALK OR EXISTING CURBING. 6.1.3. PLACE 1" EXPANSION JOINT: 6.1.3.1. AT SPRING POINTS OF INTERSECTIONS OR ONE OF THE END OF
- RADIUS LOCATIONS IN A CURVE 6.1.3.2. AT 400' MAXIMUM INTERVALS ON STRAIGHT RUNS 6.1.3.3. AT THE END OF RADIUS AT OPPOSITE ENDS IN A CURBED LANDSCAPE ISLAND
- 6.2. JOINTS WHEN TIED TO CONCRETE PAVEMENT 6.2.1. PLACE CONTRACTION JOINTS OPPOSITE ALL TRANSVERSE CONTRACTION JOINTS IN PAVEMENT
- 6.2.2. PLACE 1/2" EXPANSION JOINT AT CATCH BASINS, EXISTING AND PROPOSÉD SIDEWALK OR EXISTING CURBING. 6.2.3. PLACE 1"EXPANSION JOINT OPPOSITE ALL TRANSVERSE EXPANSION JOINTS IN PAVEMENT
- 6.2.4. CURB AND GUTTER AND CONCRETE SHALL BE TIED TOGETHER SIMILAR TO A LONGITUDINAL LANE TIE JOINT (MDOT B1 JOINT) 6.3. IN BETWEEN POURS OF PROPOSED CONCRETE CURBING (CONSTRUCTION
- 6.3.1. CARRY THE REBAR CONTINUOUSLY BETWEEN POURS 6.3.2. IF THE REBAR IS NOT LONG ENOUGH TO CARRY CONTINUOUSLY, THEN TIE TWO PIECES OF REBAR PER THE LATEST MDOT
- **SPECIFICATIONS** CONCRETE SIDEWALK JOINTING - UNLESS SHOWN OTHERWISE IN THE PLANS OR REQUIRED BY THE AUTHORITY HAVING JURISDICTION 7.1. PLACE TRANSVERSE CONTRACTION JOINTS EQUAL TO THE WIDTH OF THE WALK WHEN WIDTH IS LESS THAN 8'
- 7.2. PLACE TRANSVERSE AND LONGITUDINAL CONTRACTION JOINTS EQUAL TO 1/2 THE WIDTH OF THE WALK WHEN WIDTH IS EQUAL TO OR GREATER
- 7.3. PLACE 1" EXPANSION JOINT WHERE ABUTTING SIDEWALK RAMP AND/OR RADIUS IN INTERSECTION
- 7.4. PLACE TRANSVERSE 1/2" EXPANSION JOINT AT MAXIMUM OF 100'
- 7.5. PLACE 1/2" EXPANSION JOINT WHEN ABUTTING A FIXED STRUCTURE. OTHER PAVEMENT (CONCRETE PAVEMENT AND DRIVE APPROACHES), UTILITY STRUCTURES, LIGHT POLE BASES AND COLUMNS.
- 7.6. WHEN ALONG A CURVE, JOINTS MUST BE PERPENDICULAR TO THE CURVE WITH A MINIMUM LENGTH OF 1 FOOT BEFORE INTERSECTING ANOTHER JOINT(S) IN ANY DIRECTION. NO JOINTS ARE ALLOWED TO BE CUT AT AN ANGLÉ OTHER THAN 90° AT THE CURBLINE

GENERAL GRADING AND EARTHWORK NOTES:

- THESE NOTES APPLY TO ALL CONSTRUCTION ACTIVITIES ON THIS PROJECT CONTRACTOR SHALL FIELD VERIFY ALL EXISTING TREES AND BRUSH AND REMOVE ALL THAT ARE NECESSARY TO GRADE SITE.
- ALL GRADES ARE TO TOP OF PAVEMENT UNLESS OTHERWISE NOTED. THE STAGING OF CONSTRUCTION ACTIVITIES SHALL OCCUR ONLY WITHIN THE
- SITE BOUNDARIES. ANY CONSTRUCTION ACTIVITIES OUTSIDE OF THE WORK AREA BOUNDARIES SHALL BE AT THE SOLE RESPONSIBILITY AND RISK OF
- ALL SOIL EROSION AND SEDIMENTATION CONTROL MEASURES IS SHALL MEET THE REQUIREMENTS OF THE AUTHORIZED PUBLIC AGENCY OF JURISDICTION.

ALL EARTHWORK AND GRADING OPERATIONS SHALL BE PERFORMED IN

- ACCORDANCE WITH THE PLANS AND SPECIFIACTIONS. REFER TO SOIL EROSION CONTROL PLAN FOR ADDITIONAL SOIL EROSION AND SEDIMENTATION CONTROL MEASURES AND NOTES.
- ALL LANDSCAPING IS TO BE COMPLETED BY STALLANTIS. THE CONTRACTOR SHALL NOTE EXISTING UNDERGROUND UTILITIES WITHIN AND ADJACENT TO THE SITE. BACKFILL FOR EXISTING UTILITY TRENCHES SHALL BE EXAMINED CRITICALLY. ANY TRENCHES FOUND TO HAVE SOF UNSTABLE OR UNSUITABLE BACKFILL MATERIAL, IN THE OPINION OF T THIRD PARTY TESTING COMPANY, THAT ARE TO BE WITHIN THE ZONE OF INFLUENCE OF PROPOSED BUILDINGS OR PAVEMENT SHALL BE COMPLETELY
- ON-SITE FILL CAN BE USED IF THE SPECIFIED COMPACTION REQUIREMENTS CAN BE ACHIEVED. IF ON-SITE SOIL IS USED, IT SHOULD BE CLEAN AND FREE OF FROZEN SOIL, ORGANICS, OR OTHER DELETERIOUS MATERIALS.

EXCAVATED AND BACKFILLED WITH SUITABLE MATERIAL.

- D. THE FINAL SUBGRADE/EXISTING AGGREGATE BASE SHOULD BE THOROUGHLY PROOFROLLED USING A FULLY LOADED TANDEM AXLE TRUCK OR FRONT END LOADER UNDER THE OBSERVATION OF A GEOTECHNICAL/PAVEMENT ENGINEER. LOOSE OR YIELDING AREAS THAT CANNOT BE MECHANICALLY STABILIZED SHOULD BE REINFORCED USING GEOGRIDS OR REMOVED AND REPLACED WITH ENGINEERED FILL OR AS DICTATED BY FIELD CONDITIONS.
- . THE REMOVAL OF EXISTING SOIL TO GET TO FINAL SUBGRADE ELEVATION SHALL NOT BE CONSIDERED SUBGRADE UNDERCUTTING. IT IS PART OF THE EARTHWORKS TO BALANCE THE SITE AND ESTABLISH THE ELEVATIONS FOR THE PLACEMENT OF THE PROPOSED PAVEMENT ELEVATIONS. THIS SHALL NOT BE PAID FOR SEPARATELY, BUT INCLUDED IN THE EARTHWORKS FOR
- SUBGRADE UNDERCUTTING, INCLUDING BACKFILLING SHALL BE PERFORMED TO REPLACE MATERIALS SUSCEPTIBLE TO FROST HEAVING AND UNSTABLE SOIL CONDITIONS. ANY EXCAVATIONS THAT MAY BE REQUIRED BELOW THE TOPSOIL IN FILL AREAS OR BELOW SUBGRADE IN CUT AREAS WILL BE
- CLASSIFIED AS SUBGRADE UNDERCUTTING. SUBGRADE UNDERCUTTING SHALL BE PERFORMED WHERE NECESSARY AND HE EXCAVATED MATERIAL SHALL BECOME THE PROPERTY OF THE CONTRACTOR. ANY SUBGRADE UNDERCUTTING SHALL BE BACKFILLED AS RECOMMENDED IN THE GEOTECHNICAL ENGINEERING REPORT FOR THE
- 4. ANY SUB-GRADE WATERING REQUIRED TO ACHIEVE REQUIRED DENSITY SHALL BE CONSIDERED INCIDENTAL TO THE JOB.

CONSTRUCTION MATERIAL SUBMITTALS

- UNLESS REQUIRED OTHERWISE IN THE PROJECT SPECIFICATIONS, THE CONTRACTOR SHALL ONLY SUBMIT THE FOLLOWING CONSTRUCTION MATERIAL SUBMITTALS, AS APPLICABLE TO THE PLANS, FOR REVIEW BY THE ENGINEER. UNLESS APPROVED IN ADVANCE AND IN WRITING BY THE ENGINEER, ANY MATERIAL SUBMITTALS PROVIDED TO THE ENGINEER FOR REVIEW IN ADDITION TO THIS LIST SHALL BE RETURNED TO THE CONTRACTOR WITHOUT A REVIEW BEING
- SOIL EROSION AND SEDIMENTATION CONTROL MEASURES
- UTILITY TRENCH BACKFILL MATERIAL WITH ALL MATERIAL DATA INCLUDED IN THE SUBMITTAL BEING DATED WITHIN 60 DAYS OF THE SUBMITTAL UNLESS APPROVED OTHERWISE BY THE ENGINEER STORM SEWER STRUCTURES
- STORM SEWER STRUCTURE FRAME AND COVERS INCLUDING CLEAN OUTS 5. PAVEMENT AGGREGATE BASE MATERIAL WITH ALL MATERIAL DATA INCLUDED IN THE SUBMITTAL BEING DATED WITHIN 60 DAYS OF THE SUBMITTAL
- UNLESS APPROVED OTHERWISE BY THE ENGINEER PAVEMENT UNDERDRAIN MATERIAL AND BACKFILL WITH ALL BACKFILL MATERIAL DATA INCLUDED IN THE SUBMITTAL BEING DATED WITHIN 60 DAYS
- OF THE SUBMITTAL UNLESS APPROVED OTHERWISE BY THE ENGINEER PAVEMENT MIX DESIGNS SUBMITTED FOR REVIEW BY THE ENGINEER MUST FOLLOW THE CURRENT MOOT REVIEW CHECKLISTS AS SUMMARIZED BELOW AND ALL MATERIAL DATA INCLUDED IN THE SUBMITTAL BEING DATED WITHIN
- 60 DAYS OF THE SUBMITTAL UNLESS APPROVED OTHERWISE BY THE •8.1. CONCRETE MIX DESIGN REVIEW CHECKLIST (FORM 2000) •8.2. SUPERPAVE MIX DESIGN CHECKLIST (FORM 1862)
- •8.3. MARSHALL MIX DESIGN CHECKLIST (FORM 1849) SITE FENCING AND GATES
- ANY ITEMS SHOWN IN THE PLANS OR DETAIL SHEETS THAT SPECIFICALLY STATE FOR THE CONTRACTOR TO SUBMIT A SHOP DRAWING TO THE
- ANY SPECIALITY ITEMS SHOWN IN THE PLANS OR DETAIL SHEETS THAT SPECIFICALLY DO NOT STATE FOR THE CONTRACTOR SHALL SUBMIT A SHOP DRAWING TO THE ENGINEER FOR REVIEW BUT THE CONTRACTOR REQUESTS TO BE REVIEWED. THE CONTRACTOR'S REQUEST FOR REVIEW MUST BE IN WRITING AND APPROVED BY THE ENGINEER PRIOR TO SUBMITTING THE INFORMATION.

ENGINEER FOR REVIEW. THESE ITEMS INCLUDE, BUT ARE NOT LIMITED TO:

GENERAL UTILITY NOTES:

- ALL WORKMANSHIP AND MATERIALS SHALL BE IN ACCORDANCE WITH THE STANDARDS AND SPECIFICATIONS OF THE CITY OF TROY. ALL TRENCHES UNDER OR WITHIN THREE (3) FEET OR THE FORTY-FIVE (45) DEGREE ZONE OF INFLUENCE LINE OF EXISTING AND/OR PROPOSED PAVEMENT, BUILDING PAD OR DRIVE APPROACH SHALL BE BACKFILLED WITH SAND COMPACTED TO AT LEAST NINETY-FIVE (95) PERCENT OF MAXIMUM UNIT WEIGHT (ASTM D-1557). ALL OTHER TRENCHES TO BE COMPACTED TO 90% OR BETTER.
- WHERE EXISTING MANHOLES OR SEWER PIPE ARE TO BE TAPPED, DRILL HOLES 4" CENTER TO CENTER, AROUND PERIPHERY OF OPENING TO CREATE A PLANE OF WEAKNESS JOINT BEFORE BREAKING SECTION OUT.
- THE LOCATIONS AND DIMENSIONS SHOWN ON THE PLANS FOR EXISTING UTILITIES ARE IN ACCORDANCE WITH AVAILABLE INFORMATION WITHOUT UNCOVERING AND MEASURING. THE DESIGN ENGINEER DOES NOT GUARANTEE THE ACCURACY OF THIS INFORMATION OR THAT ALL EXISTING UNDERGROUND FACILITIES ARE SHOWN. CONTRACTOR SHALL FIELD VERIFY
- THE CONTRACTOR SHALL COORDINATE TO ENSURE ALL REQUIRED PIPES, CONDUITS, CABLES AND SLEEVES ARE PROPERLY PLACED FOR THE INSTALLATION OF GAS, ELECTRIC, PHONE, CABLE, IRRIGATION, ETC. IN SUCH A MANNER THAT WILL FACILITATE THEIR PROPER INSTALLATION PRIOR TO THE PLACEMENT OF THE PROPOSED PAVEMENT AND LANDSCAPING.
- PIPE LENGTHS INDICATED ARE FROM CENTER OF STRUCTURE AND TO END OF SECTION UNLESS NOTED OTHERWISE.
- CONTRACTOR SHALL INSPECT ALL EXISTING PUBLIC STORM SEWER, SANITARY SEWER AND WATER MAIN STRUCTURES WITHIN THE LIMITS OF CONSTRUCTION AND WITH THE GOVERNING AGENCY INSPECTOR PRIOR TO ESTABLISHING FINAL GRADE. NOTIFY THE ENGINEER. OWNER/DEVELOPER. AND GOVERNING AGENCY IF STRUCTURE IS DEEMED TO BE STRUCTURALLY UNSOUND AND/OR IN NEED OF REPAIR.

STORM SEWER NOTES:

- ALL STORM SEWER LEADS SHALL BE CONSTRUCTED AT 1.00% MINIMUM
- ALL STORM SEWER 10" OR LESS AND/OR LEADS SHALL BE SDR 26. JOINTS FOR P.V.C. PIPE SHALL BE ELASTOMERIC (RUBBER GASKET) AS

GENERAL BARRIER FREE NOTES:


THE MINIMUM CLEAR WIDTH IS 3 FEET

SPECIFIED IN A.S.T.M. DESIGNATION D-3212.

THE FOLLOWING NOTES PROVIDE AN OUTLINE OF SOME OF THE REQUIREMENTS CONTAINED WITHIN THE "STANDARDS FOR ACCESSIBLE DESIGN - AMERICANS WITH DISABILITIES ACT 2010", AND "ACCESSIBLE AND USEABLE BUILDINGS AND FACILITIES", ICC/ANSI A117.1-2009. THE CONTRACTOR IS RESPONSIBLE FOR ALL OF THE REQUIREMENTS PRESENTED WITHIN THESE DOCUMENTS, WHICH ARE AVAILABLE IN FULL UPON REQUEST.

- AN ACCESSIBLE ROUTE CONSISTS OF WALK SURFACES, CURB RAMPS AND RAMPS. AT LEAST ONE ACCESSIBLE ROUTE SHALL BE PROVIDED WITHIN THE SITE FROM ACCESSIBLE PARKING SPACES, ACCESSIBLE PASSENGER LOADING ZONES, PUBLIC STREETS AND SIDEWALKS, AND PUBLIC TRANSPORTATION STOPS TO THE BUILDING OR FACILITY ENTRANCE THEY SERVE. IE RUNNING SLOPE OF ALL WALKING SURFACES SHALL NOT EXCEED 5% (1:20) AND THE CROSS-SLOPE SHALL NOT EXCEED 2% (1:48). WALKING SURFACES MUST BE LEVEL WITH PERMITTED VERTICAL CHANGES IN LEVEL NOT TO EXCEED 1/4", OR BEVELED CHANGES IN LEVEL NOT TO
- EXCEED 1/2". REFER TO DETAIL DET-8 THIS SHEET. ANY CHANGE IN LEVEL GREATER THAN 1/2" MUST BE RAMPED. TURNING SPACES ALONG ACCESSIBLE ROUTES MUST BE AT LEAST 5 FEET WIDE IN ALL DIRECTIONS AND NOT EXCEED 2% SLOPE (1:48) IN ANY ACCESSIBLE ROUTES WILL BE DESIGNED TO BE A MINIMUM OF 5 FEET WIDE.
- RAMPS ALONG ACCESSIBLE ROUTES WILL HAVE A RUNNING SLOPE GREATER THAN 5% (1:20) AND LESS THAN 8.3% (1:12). THE CROSS-SLOPE OF RAMP RUNS SHALL NOT EXCEED 2% (1:48) 8. THE MINIMUM CLEAR WIDTH OF ANY RAMP IS 36 INCHES. NOT EXCEED 30 INCHES. LANDINGS ARE REQUIRED AT THE TOP AND BOTTOM OF EACH RAMP. LANDINGS SHALL HAVE A CROSS-SLOPE NOT EXCEEDING 2% (1:48), SHALL BE 5 FEET LONG AND AT LEAST AS WIDE AS
- THE RAMP CLEAR WIDTH. IF THERE IS A CHANGE OF DIRECTION AT A LANDING, THEN THE LANDING MUST BE AT LEAST 5 FEET WIDE AND 5 FEET 10. CURB RAMPS ALONG ACCESSIBLE ROUTES SHALL NOT RISE MORE THAN 6 INCHES, NOR BE STEEPER THAN 8.3% (1:12). APPROACHING SLOPES TO THE RAMP CANNOT EXCEED 5%, WHICH INCLUDES SIDEWALKS, PAVEMENT,
- **GUTTERS ETC.** IF CURB RAMP SIDES ARE FLARED, THE FLARES SHALL NOT BE STEEPER THAN 10% (1:10). 12. LANDINGS ARE REQUIRED AT THE TOP OF ALL CURB RAMPS. THE CLEAR LENGTH OF THE LANDING SHALL BE A MINIMUM OF 36" AND WILL BE AS WIDE AS THE CURB RAMP.
- 3. CURB RAMPS SHALL BE LOCATED OR PROTECTED TO PREVENT THEIR OBSTRUCTION BY PARKED VEHICLES.
 4. HANDRAILS ARE NOT REQUIRED ON CURB RAMPS. 15. WHERE DETECTABLE WARNING IS REQUIRED AT CURB RAMPS, THE DETECTABLE WARNING SHALL BE 24" MINIMUM IN DEPTH AND SHALL EXTEND THE FULL WIDTH OF THE RAMP. THE DETECTABLE WARNING SHALL BE LOCATED SO THE EDGE NEAREST THE CURB IS 6 INCHES MINIMUM AND
- 8 INCHES MAXIMUM FROM THE CURB LINE. 16. ACCESSIBLE PARKING SPACES ON SITE SHALL BE PROVIDED AS REQUIRED IN SECTION 502 OF THE A.D.A. IF THE SITE HAS MORE THAN ONE PARKING FACILITY, EACH FACILITY IS REQUIRED TO MEET THESE REQUIREMENTS SEPARATELY. THE REQUIRED NUMBER OF SPACES SHALL BE BASED ON THE
- TOTAL NUMBER OF PARKING SPACES IN EACH PARKING FACILITY ON SITE. . FOR EVERY SIX OR FRACTION OF SIX ACCESSIBLE PARKING SPACES, ONE VAN ACCESSIBLE SPACE SHALL BE PROVIDED. B. ACCESSIBLE PARKING SPACES SHALL BE LOCATED ON THE SHORTEST ACCESSIBLE ROUTE FROM PARKING TO A BUILDING ENTRANCE. IF THERE IS MORE THAN ONE ACCESSIBLE ENTRANCE, PARKING SHALL BE DISPERSED ALONG THE SHORTEST ACCESSIBLE ROUTE TO THE ACCESSIBLE ENTRANCES . BARRIER FREE CAR PARKING SPACES SHALL BE A MINIMUM OF 8 FEET WIDE
- WITH AN ACCESS AISLE 5 FEET WIDE MINIMUM. VAN ACCESSIBLE PARKING SPACES SHALL BE AT LEAST 11 FEET WIDE WITH A 5' WIDE ACCESS AISLE. VAN ACCESSIBLE SPACES ARE ALSO ACCEPTABLE WITH AN 8 FOOT WIDTH AND 8 FOOT WIDE ACCESS AISLE. THE ACCESS AISLE IN ALL CASES MUST EXTEND THE FULL LENGTH OF THE PARKING SPACE.

 20. SURFACE SLOPES WITHIN THE PARKING SPACES AND AISLES SHALL NOT EXCEED 2% (1:48)
- 21. ACCESSIBLE AREAS INCLUDING PARKING SPACES, AISLES AND PATHWAYS, REQUIRE A MINIMUM VERTICAL CLEARANCE OF 98 INCHES. 22. ACCESSIBLE PARKING SPACES ARE REQUIRED TO BE IDENTIFIED BY SIGNS THE SIGNS SHALL INCLUDE THE INTERNATIONAL SYMBOL OF ACCESSIBILITY VAN PARKING SPACES ARE REQUIRED TO BE DESIGNATED AS "VAN ACCESSIBLE". REFER TO DETAILS ON THIS SHEET.

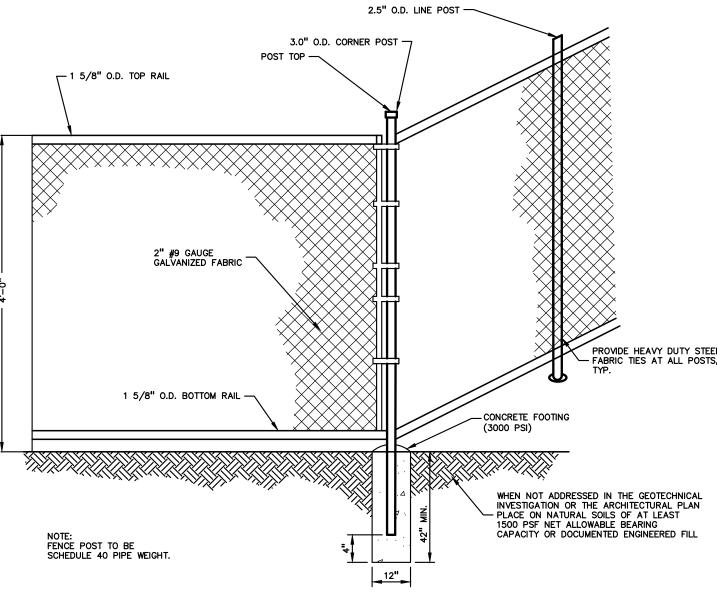

CHAIN LINK FENCE DETAIL

OP SHOWN FOR CONC. PVMT. J TOP SHOWN FOR BIT. PVMT.

<u>CLEANOUT</u>

INFILTRATION BASIN

DETAIL

EJ NO. 2850 FRAME W/ - TYPE 01 BEEHIVE GRATE. SET FRAME INSIDE PIPE.

4 L.F. OF 24" DIA.

WRAP STONE WITH

PROVIDE MDOT 6A STONE ALONG BOTTOM 12" OF INFILTRATION

BASIN AND 12" AROUND SIDES OF DRY

- MIRAFI 140N FILTER FABRIC

- COMPACTED SUBGRADE, TYP.

HEAVY DUTY CAST

IRON HOUSING W/

4"-45° BEND —


WYE FITTING OF SAME MATERIAL AS -ADJACENT SEWER


FRAME IN FULL BED OF MORTAR


FINISHED SURFACE _ PER PLAN.


INLET PIPE PER _ PLAN

SET PIPE ON MIN. 4
BRICKS OR BLOCKS TO ——
TO PREVENT SETTLEMENT

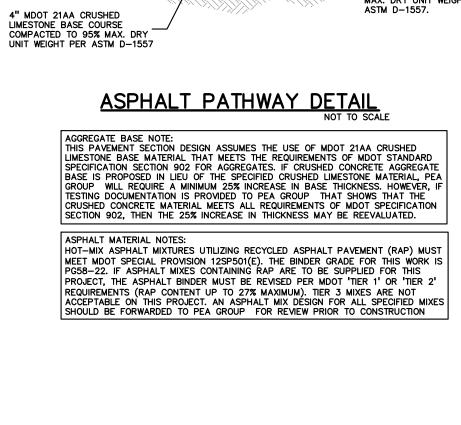

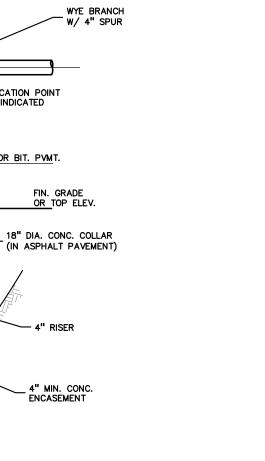

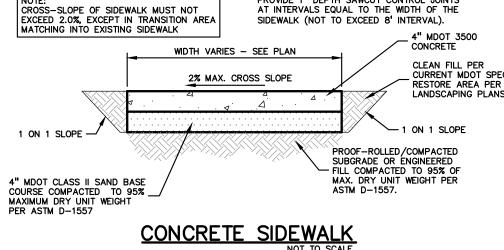

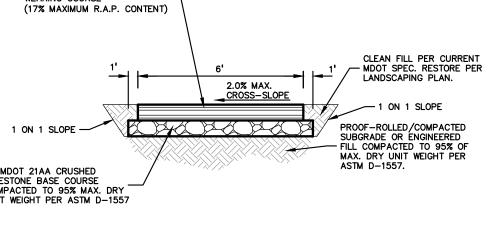

PROVIDE 1" DEPTH SAWCUT CONTROL JOINTS AT INTERVALS EQUAL TO THE WIDTH OF THE

5666 LIVERNOIS Playground Renovation

Bid Package No.01A

Elementary School

t: 844.813.2949

www.peagroup.com

TMP ARCHITECTURE INC

1191 WEST SQUARE LAKE ROAD

BLOOMFIELD HILLS • MICHIGAN • 48302

EM · INFO @ TMP-ARCHITECTURE.COM

PH • 248.338.4561 FX • 248.338.0223

REGISTRATION SEAL

CONSULTANT

PROJECT TITLE

Martell

Troy School District Troy, Michigan

DRAWING TITLE **Notes & Details**

ISSUE DATES

CONSTRUCTION DOCUMENTS DATE: ISSUED FOR:

DRAWN CHECKED

PROJECT NO.

APPROVED TD

22092B

DRAWING NO. CE-4.5.0

Project Information

a. Type of soil being disrupted:

Derived from: Soil Survey Soil Borings Other

b. Present the chronological sequence and expected time of year for each major phase of earth disruption.

DATE

-adjacent property

-lake -----

Site Clearing

Soil Erosion Control

Mass Balancing

Underground Utilities

Paving

ground cover is not acceptable.

Restoration / Stabilization

c. Indicate the measures proposed to prevent sediment from leaving the site:

The graph listed below is used to determine the adequacy of an existing vegetative buffer zone

EXAMPLE

← DISTRUBED → UNDISTURBED AREA

for use as a sediment filter. This graph is only applicable if the vegetation is a dense well-grown

stand of ground cover, at least 4" in height. An area covered with bushes and trees without a good

Hydrologic Characteristics of Site

Grate wraped in

PLAN VIEW

Finish grade elevation -

Grate wraped in nonwoven geotextile filter fabric —

filter fabric

nonwoven geotextile

a. Type of "Offsite" drainage outlet(s) available for this site:


County Drain Name of Drain:
Lake/Pond Name of Lake/Pond:
River/Stream Name of River/Stream:
Enclosed Drain Name of Enclosed Drain:
Detention Basin (with outlet)
Wetland Retention Basin (no oulet)
Overland Flow Open Ditch


- b. Distance to nearest lake, stream, pond, open drain, or wetland:
- c. Does the project include any work or disruption with a flood plain (Yes or No)?
- d. Does the project include work within the cross-section of a lake/stream (Yes or No)?
- e. Is a MDEQ Permit required (Yes or No)? If Yes, what is the MDEQ Permit Number (if known):
- f. If MDEQ Permit is required and application has not been submitted, what is the expected date of submittal?

Builders and developers working in Troy are responsible for complying with the regulations for temporary Storm Drain inserts, also known as "siltsacks". The inserts are used on many construction projects to catch sediment not captured upstream by other construction-related erosion control devices and can be an important temporary environmental safeguard.

- Builders must clean and/or replace the inserts when half of the trap is filled with sediment.
- Builders must inspect and maintain the inserts whenever 1/2 inch of rain falls within a 24-hour period. The inserts are to be removed by the builders within 30 days of site stabilization or after the temporary erosion measures are no longer needed.
- If inserts are removed during times of flooding, the builder is responsible for re-installing them per regulations.

Silt sock inserts are required for all developments with curb inlets or pavement inlets. Rear yard catch basins may utilize a non-woven Geotextile fabric.

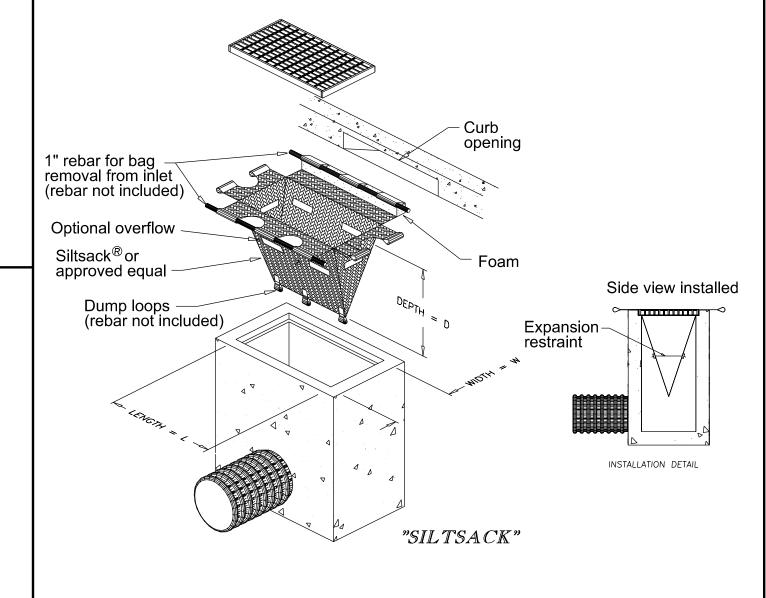

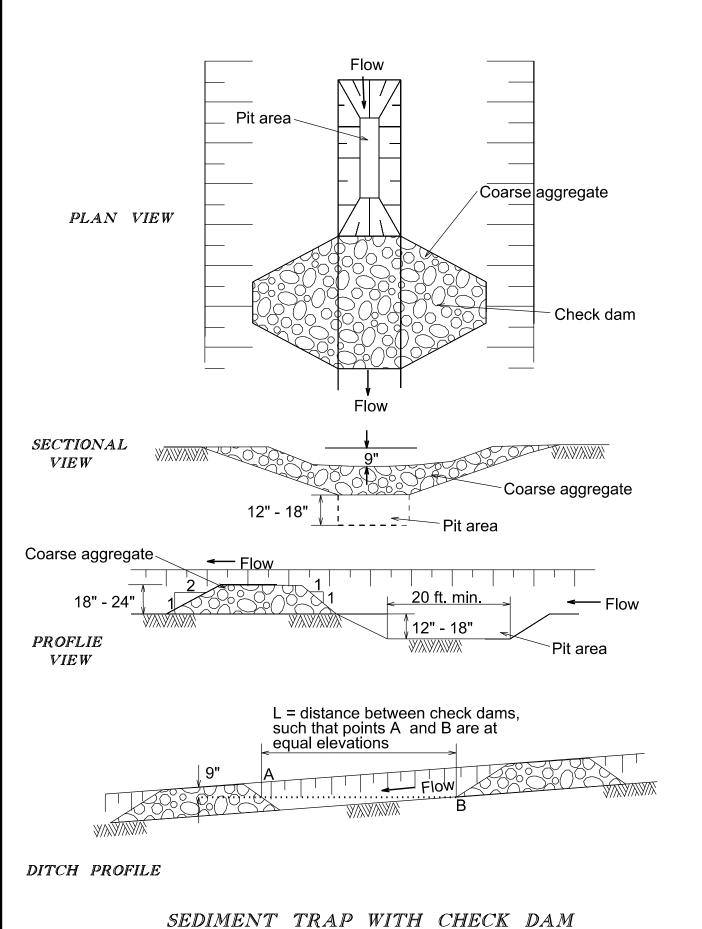

SOIL EROSION & SEDIMENTATION CONTROL NOTES

- 1. The following items are intended to be a guide to the contractor in evaluating Soil Erosion control requirements for the project. Specific Soil Erosion control devices and locations may be detailed on the plans. The contractor should also note that Soil Erosion and Sedimentation controls are included in the project unless specified otherwise on the plans or in the specifications.
- 2. All erosion and Sediment control work shall conform to the permit requirements and the standards and specifications of the City of Troy.
- Daily inspections shall be made by the contractor for effectiveness of Soil Erosion and Sedimentation control measures and any necessary repairs shall be performed without delay.
- 4. Erosion and any sedimentation from work on this site shall be contained on the site and not allowed to collect on any off-site areas or in waterways.
- Waterways include natural or man-made open ditches, streams, storm
- 6. Contractor shall apply temporary soil erosion and sedimentation control measures when required or as directed. Contractor shall remove temporary measures as soon as permanent stabilization of slopes, ditches, and other earth changes has been accomplished.
- 7. Staging the work will be done by the contractor as indicated on the Soil Erosion plans and as required to ensure progressive stabilization of disturbed earth
- 8. The contractor will establish soil erosion control measures in the early stages of construction. Sediment control measures will be applied as a perimeter defense against any transporting of silt off the site.
- 9. Engineer and owner certification must be included on the plans.10. Separate sheets showing soil erosion and sedimentation control plans must

be provided.


11. The following guidelines are to be implemented:

a. Check Dams:


drains, lakes and ponds.


- Stone size must be increased with increased slope and velocity.
- Side slope of the dam should be 2:1 or flatter.Straw bales are not to be used for check dams.
- iv. Add stones as needed to maintain design height and cross section.v. Any accumulation of sediment shall be removed and stockpiled in a
- stabilized area to prevent the material from eroding back into the drainage course.
- b. Vegetative Buffer Zones:
- . Vegetation must be maintained in a vigorous condition.
- ii. Reshape and reseed areas where concentrated flow occurs or vegetation
- ii. To be used for sheet flows only.
- Not to be used as a roadway.
- s. Silt Fence:
- Must be installed along the contour line.
- Must be trenched in at least 6 inches and backfilled.
- iv. Multiple rows are to be used up a slope.
- v. Accumulated sediment must be periodically removed.
 vi. Where necessary, a support fence shall be used to support the geotextile
- vii. To be removed after site is permanently stabilized.
- d. Inlet Sediment Trap:
- i. The sediment deposition area and nonwoven geotextile filter fabric should be cleaned of all accumulated sediment after each storm.
- ii. After all contributing areas are stabilized, the filter fabric will be removed, sediment deposition area filled, and a sod inlet filter placed over the disrupted lawn area.
- iii. The filter material used to backfill parking lot drainage holes will be peastone. The side excavation for the placement of this material will not be deeper than the invert of the drainage holes.
- e. Inlet Filters After Paving or Grading:
- i. Inlet filters will remain in place until all denuded areas contributing to them are stabilized with vegetation.
- ii. Periodic inspection and maintenance will be provided to insure that filters are functioning properly.
- f. Sod Inlet Filter:
- i. Sod inlet filters will only be used to handle light concentrations of sediment.
 ii. Recommended for use after final grading is complete and during the
- establishment of a vegetative cover.


 iii. Catch basin inlet covers may be wrapped in a non-woven geotextile filter
- fabric for additional filtration
- iv. Periodic inspection and maintenance must be provided to insure efficient operation.

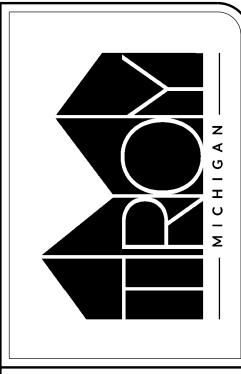


	DETAILS	119	S				
t	IL EROSION CONTROL GINEERING DEPARTMENT	DATE : JUNE 2019	REMARKS				
	V CC	SER	DATE				
		GINI		L SNO	ISI	ΔΕΛ	<u> </u>
	IL EROSION CONT	HUOTARI, CITY ENGINEER					
		J.	S				
	STANDARD S	APPROVED BY : WILLIAM	REMARKS	GENERAL UPDATES			
	STA	APPRC	DATE	APRIL 2019			
				SNO	ISI	3E ∧	1
	2555	caaa	gr.				3231
	South *	WEER Y	SNS.	ζ V	ζλ		E #4323

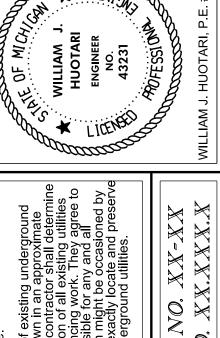

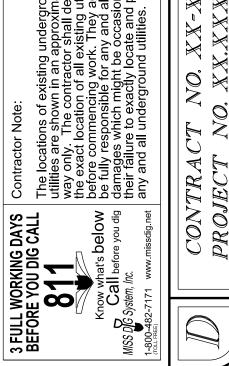

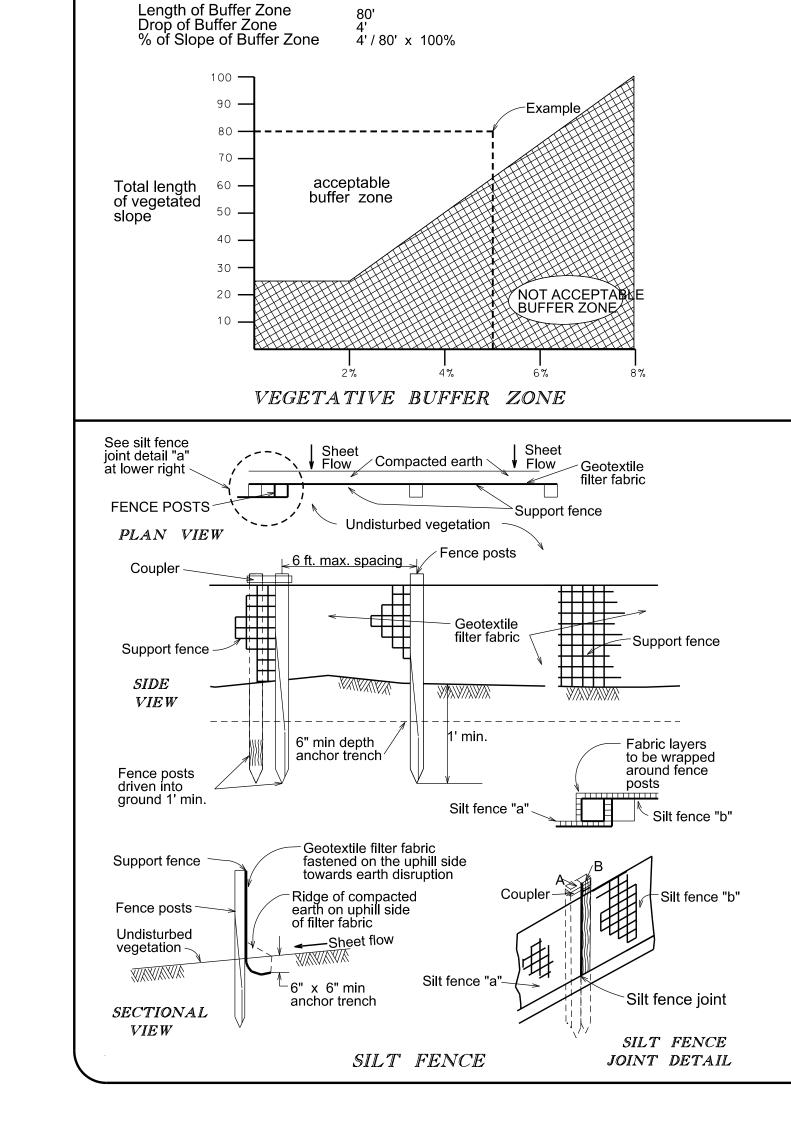

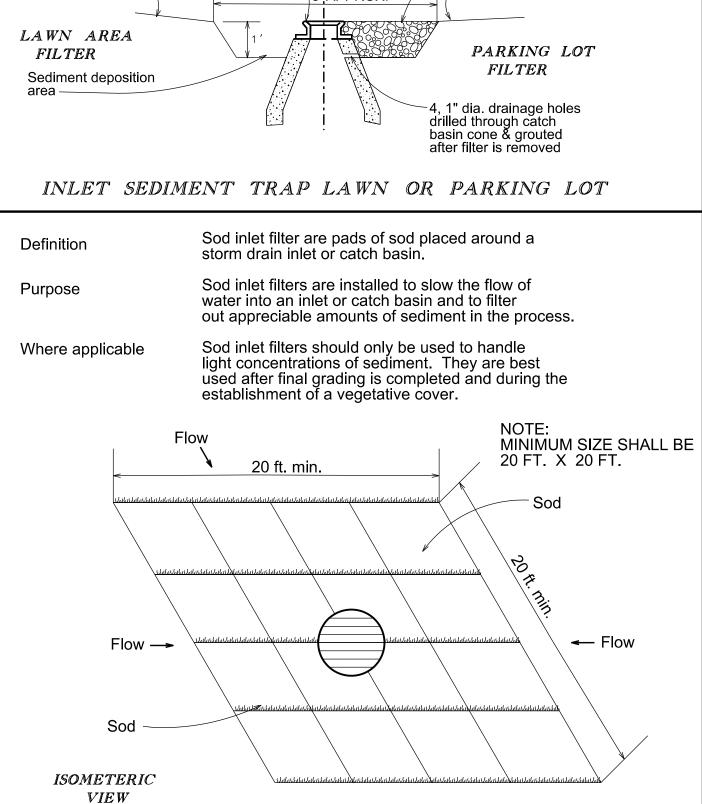

SOD INLET FILTER

Scarify the finish grade


Coarse aggregate
M.D.O.T. 6a

-Proposed final

pavement elevation

perpendicular to the slope

of the parking lot

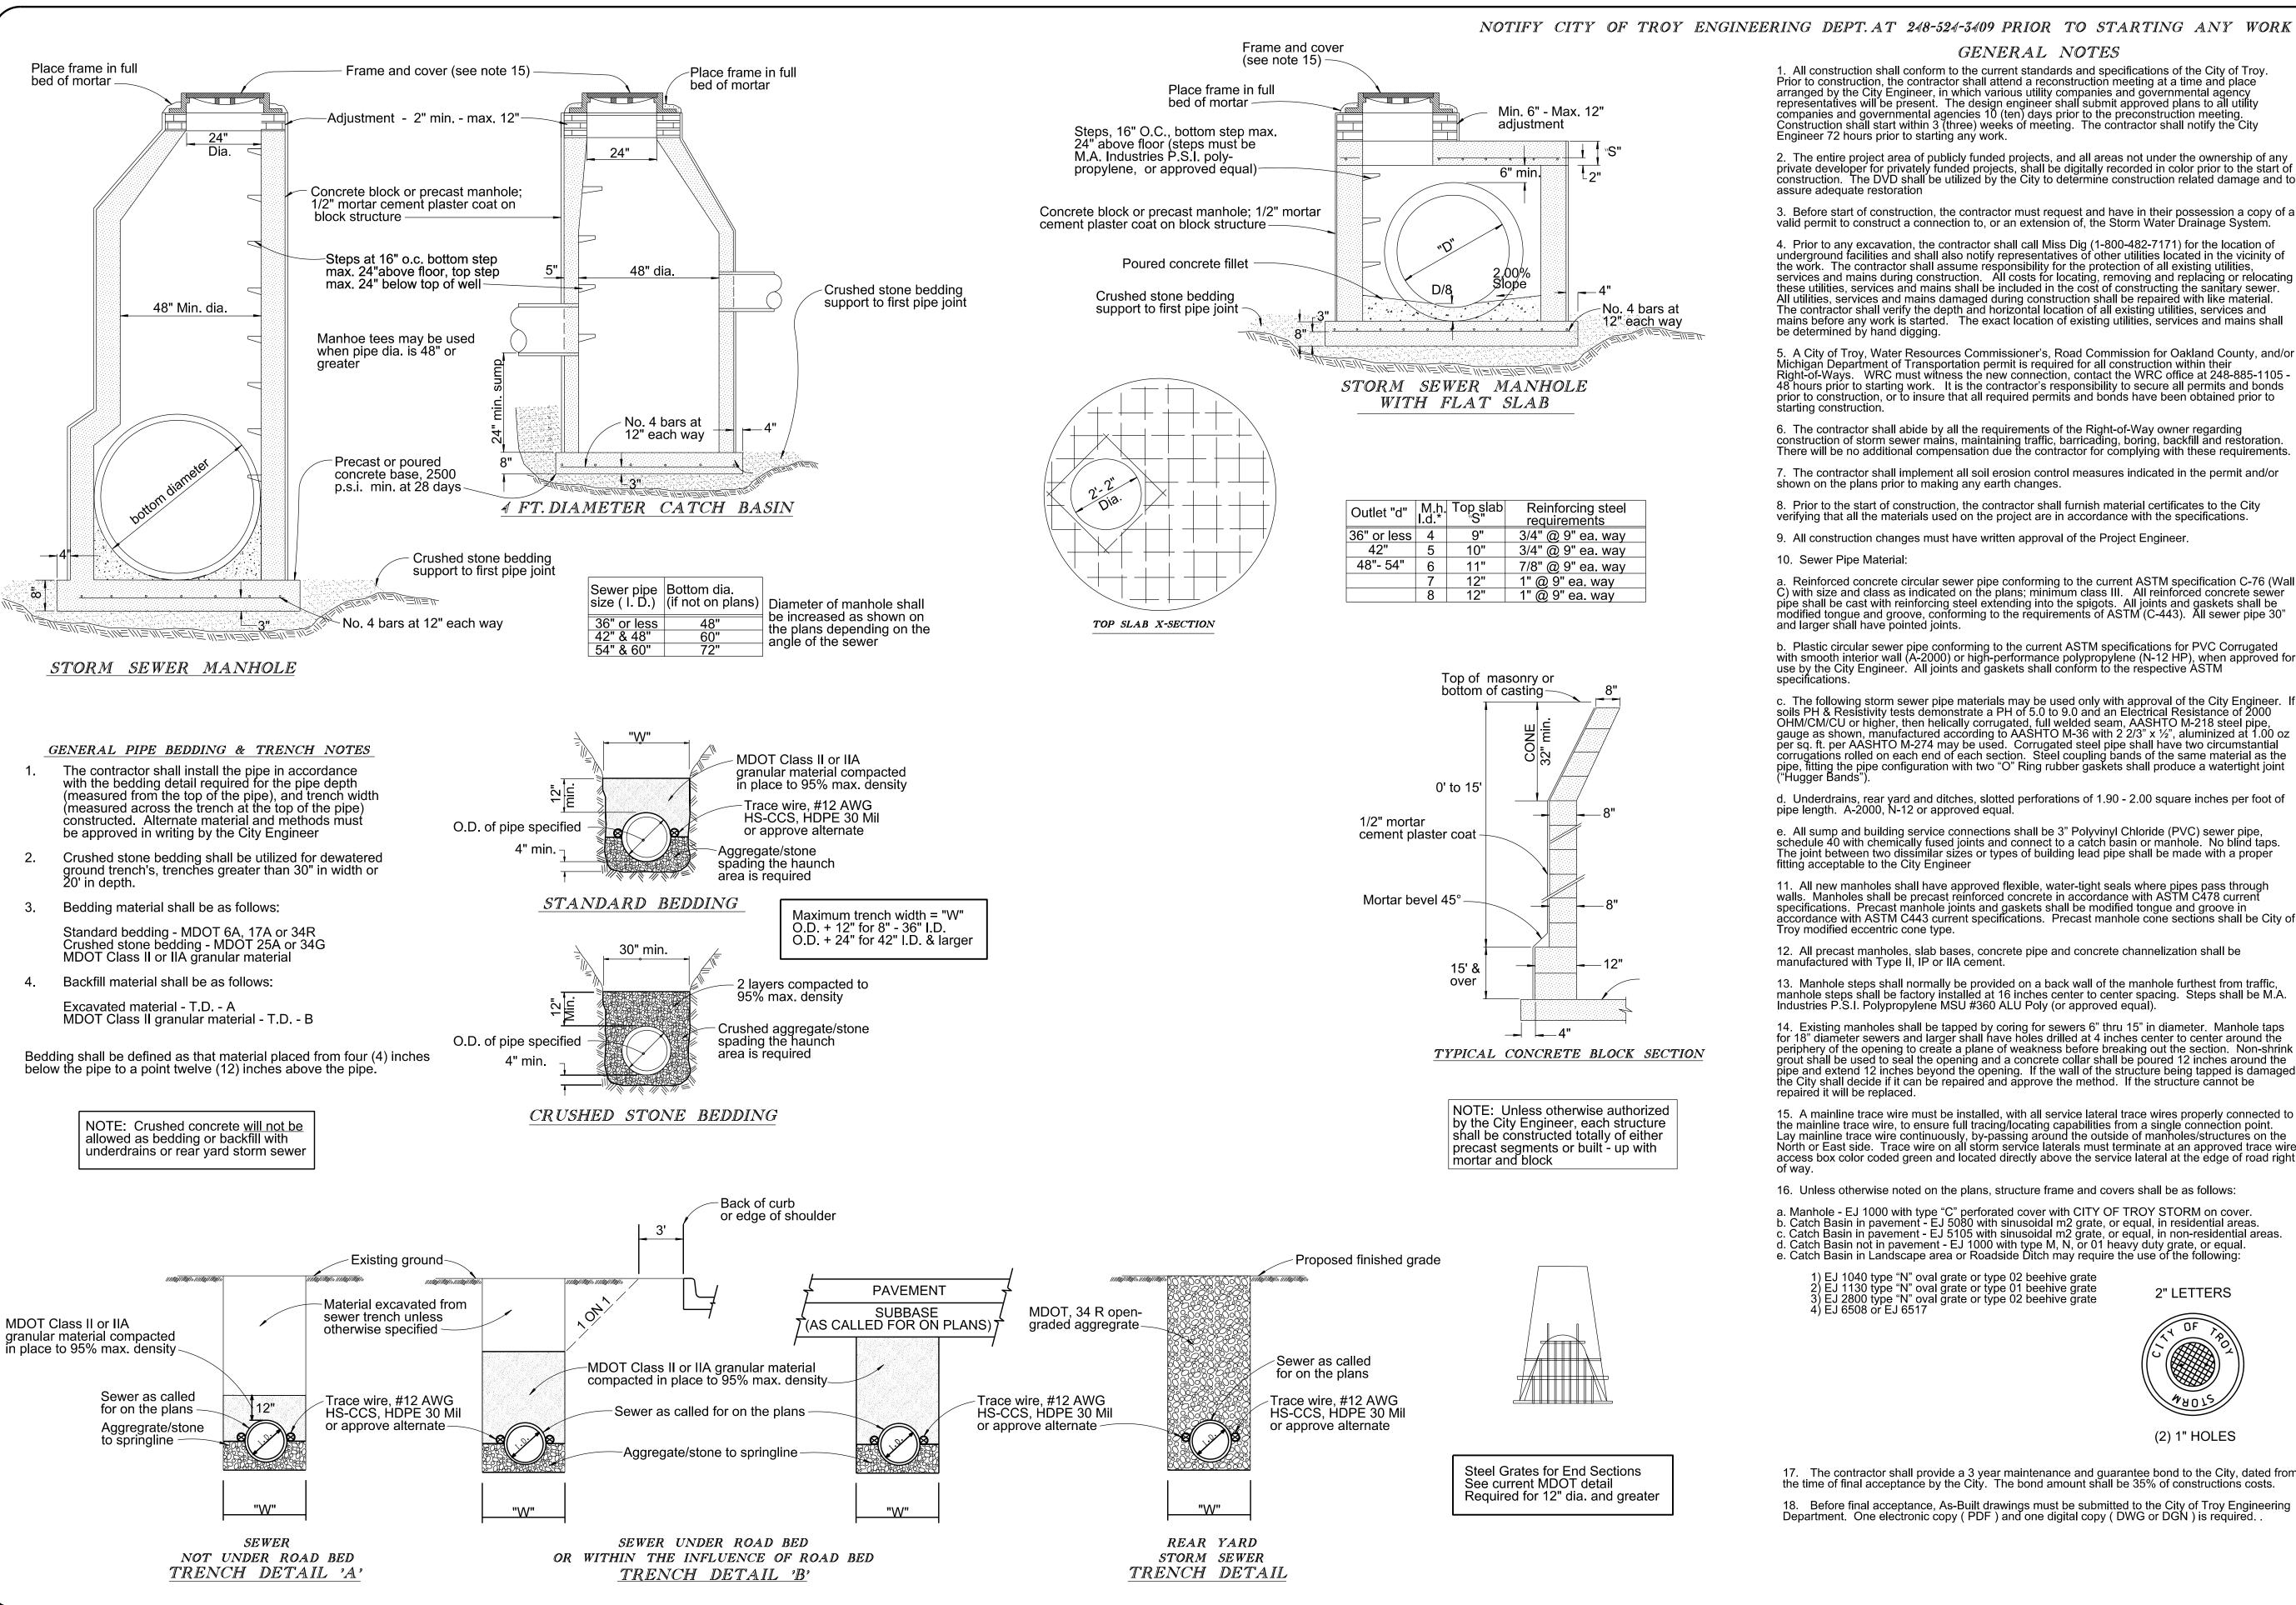



Prior to construction, the contractor shall attend a reconstruction meeting at a time and place arranged by the City Engineer, in which various utility companies and governmental agency representatives will be present. The design engineer shall submit approved plans to all utility companies and governmental agencies 10 (ten) days prior to the preconstruction meeting. Construction shall start within 3 (three) weeks of meeting. The contractor shall notify the City

- 2. The entire project area of publicly funded projects, and all areas not under the ownership of any private developer for privately funded projects, shall be digitally recorded in color prior to the start of construction. The DVD shall be utilized by the City to determine construction related damage and to
- 3. Before start of construction, the contractor must request and have in their possession a copy of a
- 4. Prior to any excavation, the contractor shall call Miss Dig (1-800-482-7171) for the location of underground facilities and shall also notify representatives of other utilities located in the vicinity of the work. The contractor shall assume responsibility for the protection of all existing utilities, services and mains during construction. All costs for locating, removing and replacing or relocating these utilities, services and mains shall be included in the cost of constructing the sanitary sewer.

 All utilities, services and mains damaged during construction shall be repaired with like material. The contractor shall verify the depth and horizontal location of all existing utilities, services and mains before any work is started. The exact location of existing utilities, services and mains shall
- 5. A City of Troy, Water Resources Commissioner's, Road Commission for Oakland County, and/or Michigan Department of Transportation permit is required for all construction within their Right-of-Ways. WRC must witness the new connection, contact the WRC office at 248-885-1105 -48 hours prior to starting work. It is the contractor's responsibility to secure all permits and bonds prior to construction, or to insure that all required permits and bonds have been obtained prior to

6. The contractor shall abide by all the requirements of the Right-of-Way owner regarding construction of storm sewer mains, maintaining traffic, barricading, boring, backfill and restoration. There will be no additional compensation due the contractor for complying with these requirements.

a. Reinforced concrete circular sewer pipe conforming to the current ASTM specification C-76 (Wall C) with size and class as indicated on the plans; minimum class III. All reinforced concrete sewer pipe shall be cast with reinforcing steel extending into the spigots. All joints and gaskets shall be modified tongue and groove, conforming to the requirements of ASTM (C-443). All sewer pipe 30"

b. Plastic circular sewer pipe conforming to the current ASTM specifications for PVC Corrugated with smooth interior wall (A-2000) or high-performance polypropylene (N-12 HP), when approved for use by the City Engineer. All joints and gaskets shall conform to the respective ASTM

c. The following storm sewer pipe materials may be used only with approval of the City Engineer. If soils PH & Resistivity tests demonstrate a PH of 5.0 to 9.0 and an Electrical Resistance of 2000 OHM/CM/CU or higher, then helically corrugated, full welded seam, AASHTO M-218 steel pipe, gauge as shown, manufactured according to AASHTO M-36 with 2 2/3" x ½", aluminized at 1.00 oz per sq. ft. per AASHTO M-274 may be used. Corrugated steel pipe shall have two circumstantial corrugations rolled on each end of each section. Steel coupling bands of the same material as the pipe, fitting the pipe configuration with two "O" Ring rubber gaskets shall produce a watertight joint

d. Underdrains, rear yard and ditches, slotted perforations of 1.90 - 2.00 square inches per foot of pipe length. A-2000, N-12 or approved equal.

e. All sump and building service connections shall be 3" Polyvinyl Chloride (PVC) sewer pipe, schedule 40 with chemically fused joints and connect to a catch basin or manhole. No blind taps. The joint between two dissímilar sizes or types of building lead pipe shall be made with a proper

11. All new manholes shall have approved flexible, water-tight seals where pipes pass through walls. Manholes shall be precast reinforced concrete in accordance with ASTM C478 current specifications. Precast manhole joints and gaskets shall be modified tongue and groove in accordance with ASTM C443 current specifications. Precast manhole cone sections shall be City of


13. Manhole steps shall normally be provided on a back wall of the manhole furthest from traffic, manhole steps shall be factory installed at 16 inches center to center spacing. Steps shall be M.A. Industries P.S.I. Polypropylene MSU #360 ALU Poly (or approved equal).

14. Existing manholes shall be tapped by coring for sewers 6" thru 15" in diameter. Manhole taps for 18" diameter sewers and larger shall have holes drilled at 4 inches center to center around the periphery of the opening to create a plane of weakness before breaking out the section. Non-shrink grout shall be used to seal the opening and a concrete collar shall be poured 12 inches around the pipe and extend 12 inches beyond the opening. If the wall of the structure being tapped is damaged, the City shall decide if it can be repaired and approve the method. If the structure cannot be

15. A mainline trace wire must be installed, with all service lateral trace wires properly connected to the mainline trace wire, to ensure full tracing/locating capabilities from a single connection point. Lay mainline trace wire continuously, by-passing around the outside of manholes/structures on the North or East side. Trace wire on all storm service laterals must terminate at an approved trace wire access box color coded green and located directly above the service lateral at the edge of road right


16. Unless otherwise noted on the plans, structure frame and covers shall be as follows:

a. Manhole - EJ 1000 with type "C" perforated cover with CITY OF TROY STORM on cover. b. Catch Basin in pavement - EJ 5080 with sinusoidal m2 grate, or equal, in residential areas. c. Catch Basin in pavement - EJ 5105 with sinusoidal m2 grate, or equal, in non-residential areas. d. Catch Basin not in pavement - EJ 1000 with type M, N, or 01 heavy duty grate, or equal. e. Catch Basin in Landscape area or Roadside Ditch may require the use of the following:




(2) 1" HOLES

17. The contractor shall provide a 3 year maintenance and guarantee bond to the City, dated from the time of final acceptance by the City. The bond amount shall be 35% of constructions costs.

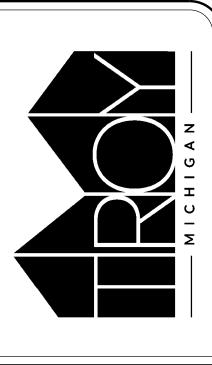

DE SE **BEAISIONS** \mathcal{S} **BENIZIONZ** * HENIONS

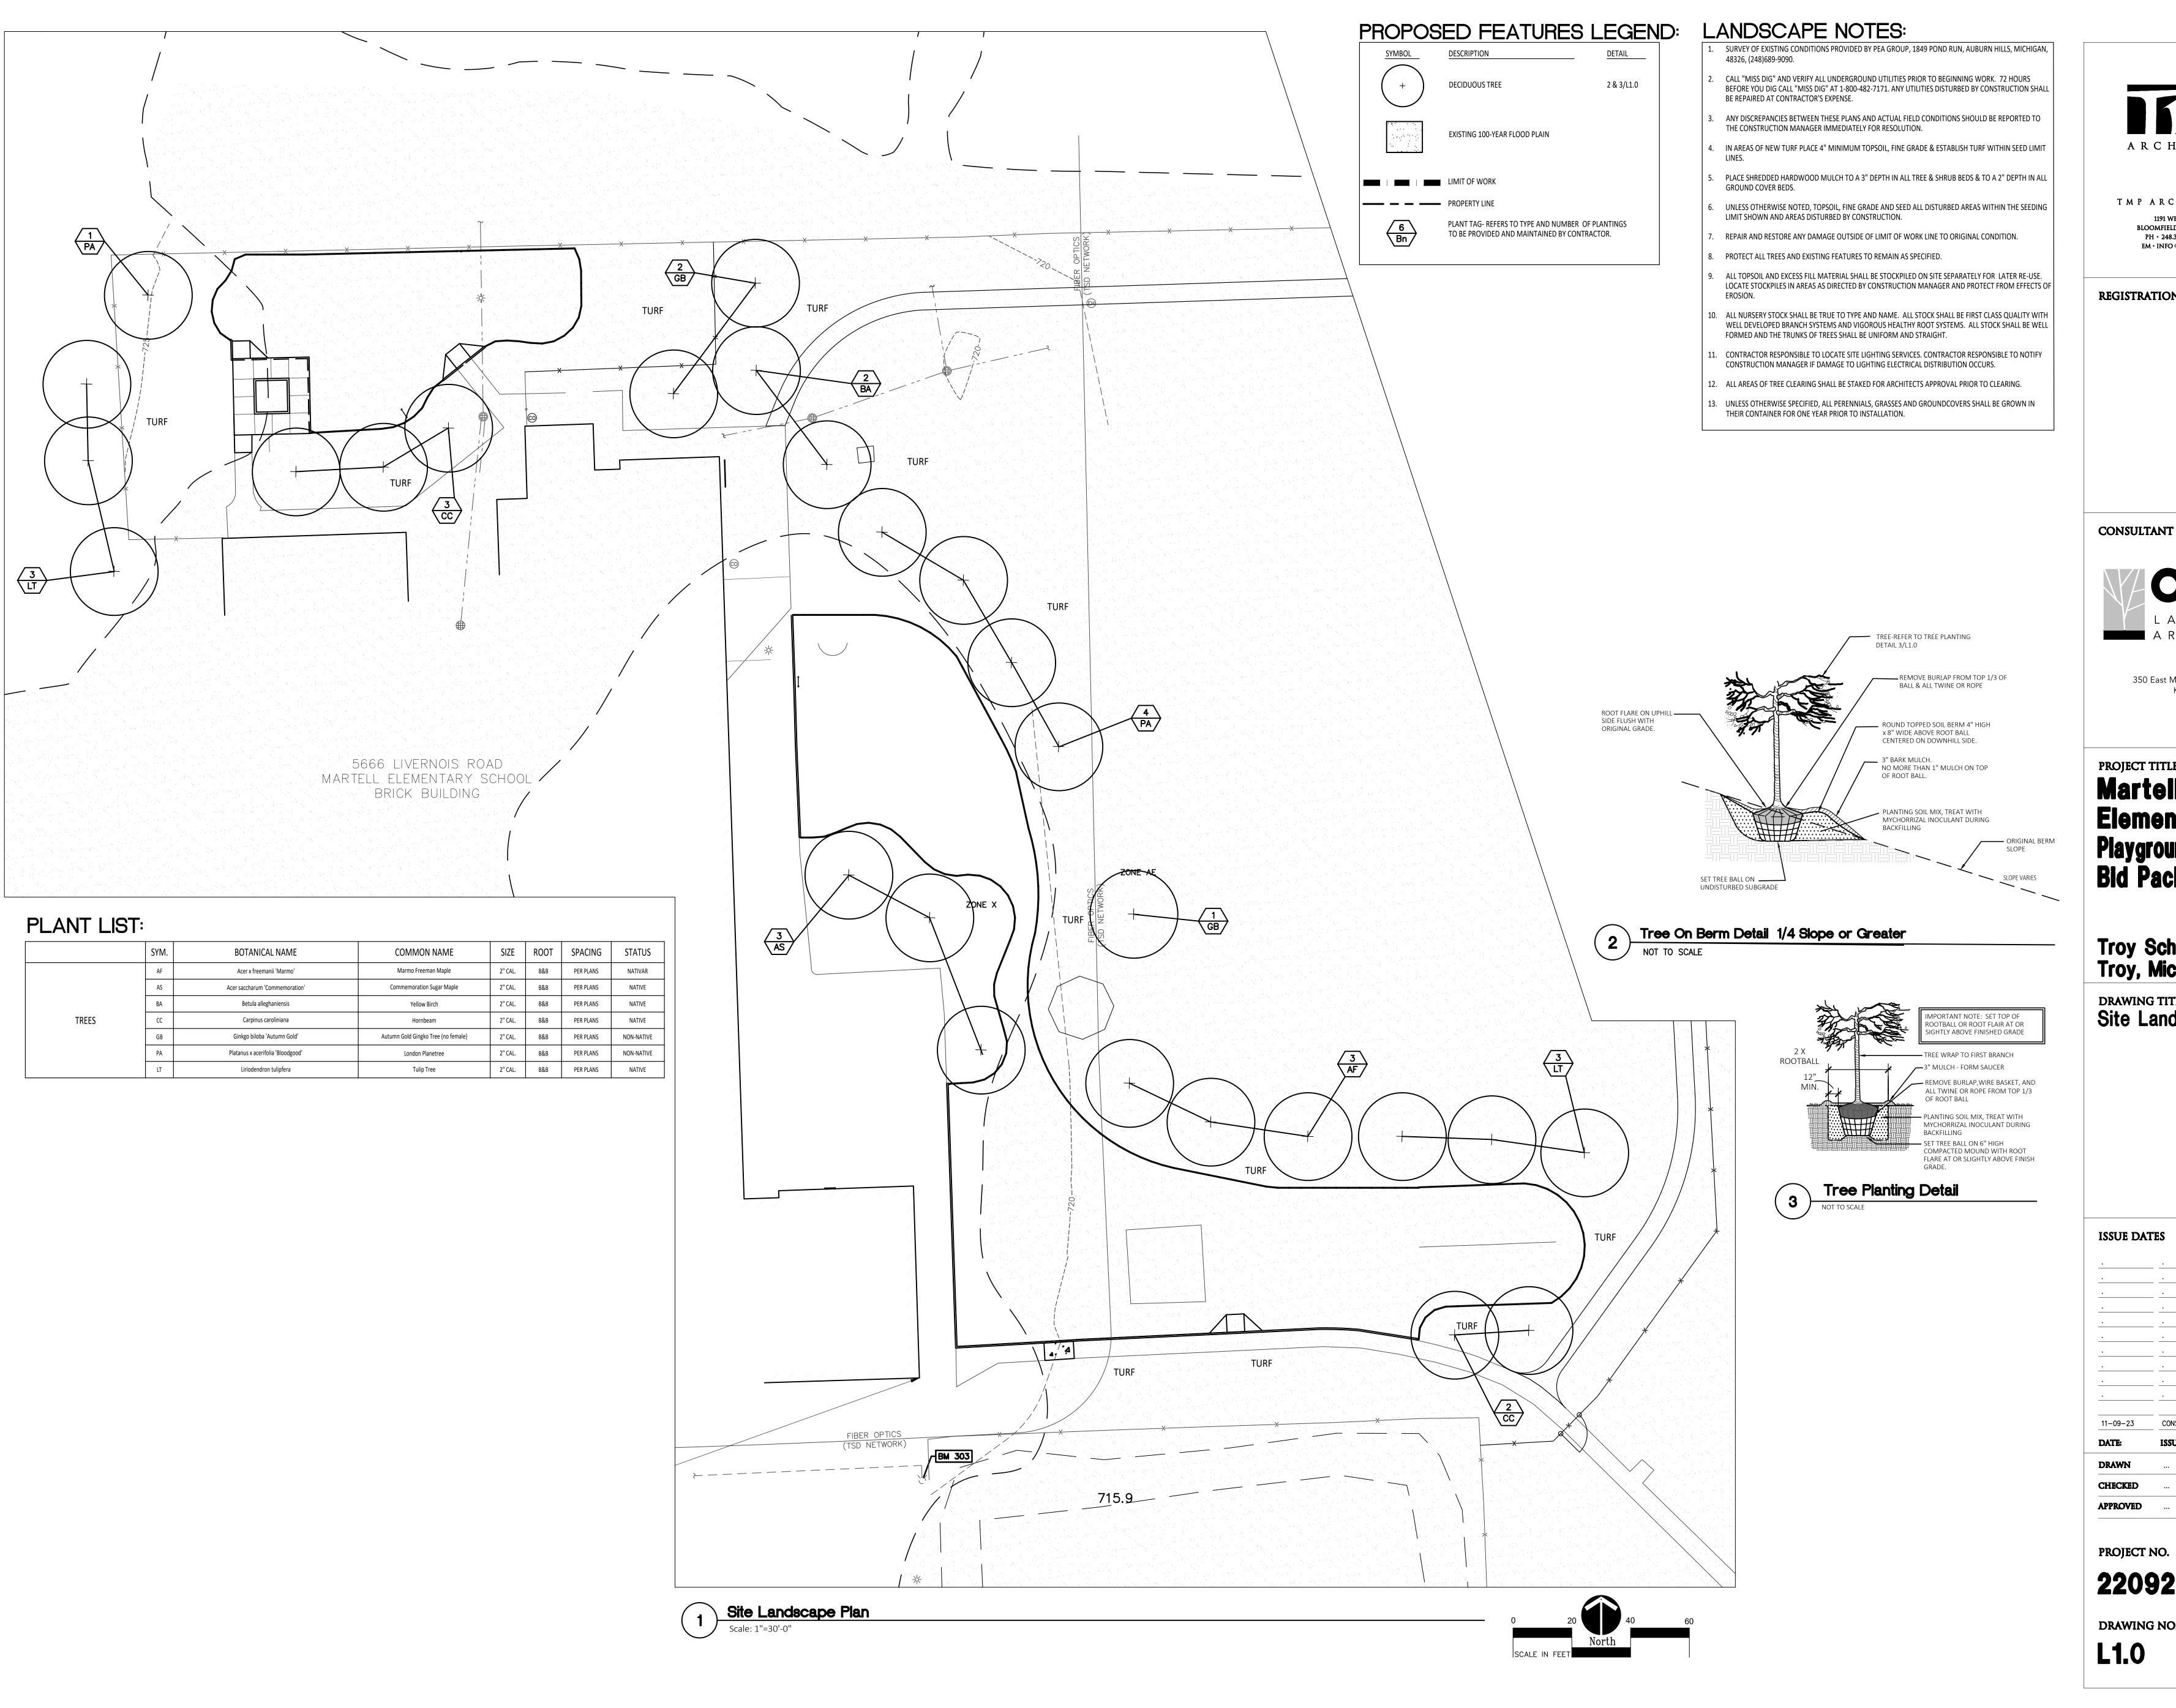



TMP ARCHITECTURE INC 1191 WEST SQUARE LAKE ROAD BLOOMFIELD HILLS • MICHIGAN • 48302 PH • 248.338.4561 FX • 248.338.0223 EM · INFO @ TMP-ARCHITECTURE.COM

REGISTRATION SEAL

CONSULTANT



350 East Michigan Avenue Suite #415 Kalamazoo Michigan 49007 Phone (269) 381-3357 Fax (269) 381-2944

PROJECT TITLE **Martell** Elementary School Playground Renovation Bid Package No.01A

Troy School District Troy, Michigan


DRAWING TITLE
Site Landscape Plan

ISSUE DATES CONSTRUCTION DOCUMENTS DATE: DRAWN

PROJECT NO.

22092B

DRAWING NO. **L1.0**

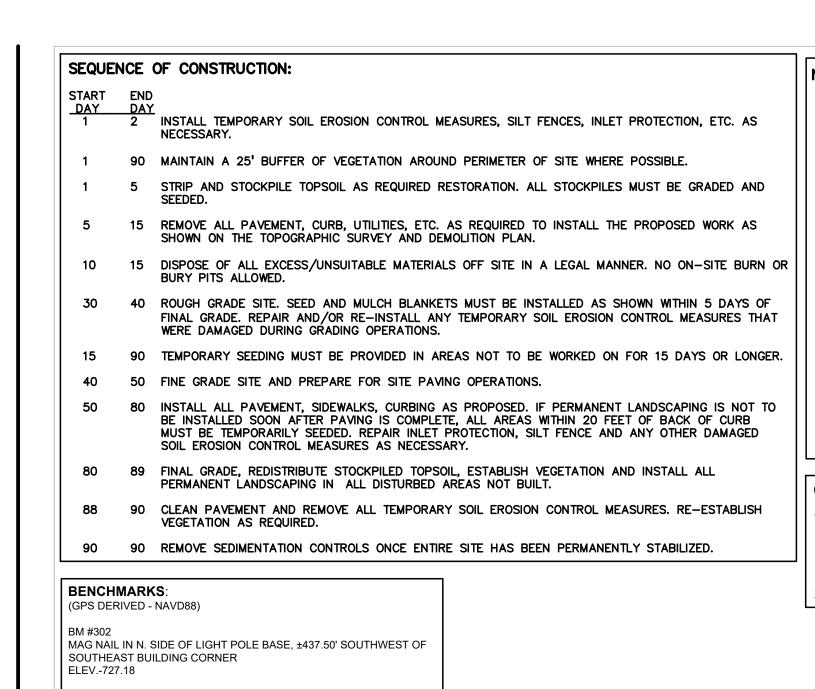

DIMPLE ON ARROW ON NORTH SIDE OF HYDRANT, ±35.0' SOUTH OF

SOUTHEAST BUILDING CORNER

ELEV. - 723.05

ATTEMPTED. IF, AGAIN, SUCCESSFUL CLEANING CANNOT BE PERFORMED OR THE EQUIPMENT FAILS TO TRAVERSE THE ENTIRE MANHOLE SECTION, IT WILL BE ASSUMED THAT A MAJOR BLOCKAGE EXISTS AND THE CLEANING EFFORT SHALL BE ABANDONED. PER THE PROJECT SPECIFICATIONS: PRIOR TO THE PLACEMENT OF TOPSOIL THE SUCCESSFUL BIDDER TO SCHEDULE AN INSPECTION BY THE SCHOOL DISTRICT OR PEA GROUP TO CONFIRM THAT THE GRADE IS AT THE PROPER ELEVATION WHERE THE MINIMUM DEPTH OF TOPSOIL CAN BE PLACED THROUGHOUT THE AREA. CONTRACTOR TO FIELD VERIFY ALL UNDERGROUND UTILITIES PRIOR TO CONSTRUCTION INCLUDING BUT NOT LIMITED TO: SITE LIGHTING, FIBER **GENERAL SITE CONDITIONS:** ACCORDING TO THE USDA NRCS WEB SOIL SURVEY, THE SITE CONSISTS OF THE FOLLOWING SOIL TYPES: 41B AQUENTS, SANDY, LOAMY, UNDULATING

TOTAL DISTURBED AREA = ± 2.1 ACRES

PER THE "SOIL EROSION AND SEDIMENTATION CONTROL SEQUENCE OF CONSTRUCTION" NOTES THE SUCCESSFUL BIDDER TO THE CLEAN THE

STORM SEWER. THIS CLEANING SHALL INCLUDE CLEANING OUT THE

STRUCTURES AND ENTIRE SEWER RUNS BETWEEN STRUCTURES USING

POWERED EQUIPMENT. SELECTION OF THE EQUIPMENT USED SHALL BE BASED ON THE CONDITIONS OF LINES AT THE TIME THE WORK

HYDRAULICALLY PROPELLED, HIGH-VELOCITY JET, OR MECHANICALLY

COMMENCES. THE EQUIPMENT AND METHODS SELECTED SHALL BE

SATISFACTORY TO THE SCHOOL DISTRICT'S REPRESENTATIVE. THE EQUIPMENT SHALL BE CAPABLE OF REMOVING DIRT, GREASE, ROCKS,

SAND, AND OTHER MATERIALS AND OBSTRUCTIONS FROM THE SEWER

LINES AND MANHOLES. IF CLEANING OF AN ENTIRE SECTION CANNOT

BE SUCCESSFULLY PERFORMED FROM ONE MANHOLE, THE EQUIPMENT

SHALL BE SET UP ON THE OTHER MANHOLE AND CLEANING AGAIN

- 1		
	4.	ALL DIRT AND MUD TRACKED ONTO PAVED AREAS SHALL BE REMOVED BY THE CONTRACTOR DAILY BY SCRAPING. STREET SWEEPING IS REQUIRED WEEKLY.
	5.	SILT FENCE MAINTENANCE SHALL INCLUDE THE REMOVAL OF ANY BUILT UP SEDIMENT WHEN THE SEDIMENT HEIGHT ACCUMULATES TO 1/3 TO 1/2 OF THE HEIGHT OF THE FENCE. THE CONTRACTOR IS RESPONSIBLE TO REMOVE REPLACE, RETRENCH OR REBACKFILL THE SILTATION FENCE SHOULD IT FALOR BE DAMAGED DURING CONSTRUCTION.
	6.	INLET FILTER MAINTENANCE SHALL INCLUDE THE REMOVAL OF ANY ACCUMULATED SILT OR OTHER DEBRIS. THE REMOVAL OF SILT SHOULD BE WITH THE USE OF A STIFF BRISTLE BROOM OR SQUARE POINT SHOVEL. IF INLET FILTERS CAN NOT BE CLEANED OR ARE DAMAGED, THEN THE FABRIC MUST BE REPLACED.
•	7.	CONTRACTOR TO PROVIDE WATER TRUCK TO WATER DOWN THE SITE ON A DAILY BASIS AS REQUIRED TO MAINTAIN DUST CONTROL.

8. IF HIGH GROUNDWATER IS ANTICIPATED OR ENCOUNTERED DURING CONSTRUCTION A DEWATERING PLAN MUST BE SUBMITTED TO THE CITY

SOIL EROSION MAINTENANCE SCHEDULE AND NOTES:

EVERY STORM EVENT BY:

1140 RANKIN

248-823-4067

TROY SCHOOL DISTRICT

ENGINEERING DIVISION FOR REVIEW.

TROY, OAKLAND COUNTY, MICHIGAN

THE SOIL EROSION CONTROLS WILL BE MAINTAINED WEEKLY AND AFTER

IF ANY DAMAGE HAS OCCURRED AS A RESULT OF STORM WATER

ANY DEBRIS OR DIRT ON ANY PAVED AREA RESULTING FROM

DISCHARGE FROM THE SITE, THE FOLLOWING STEPS SHALL BE IMPLEMENTED.

CONSTRUCTION TRAFFIC SHALL BE CLEANED IN A PROMPT MANNER BY THE CONTRACTOR. THE CONSTRUCTION DRIVE SHALL BE CLEANED AT THE END


CONCRETE - NO FINES).

CHANGED AND MAINTAINED.


13. CLEAN PAVEMENT AND STORM SEWERS. REMOVE SILT FENCE AND TREE PROTECTION FENCE, AND INLET FILTERS ONCE VEGETATION HAS BEEN

14. ALL DIRT AND MUD TRACKED ONTO PUBLIC ROADS SHALL BE REMOVED

15. STREET CATCH BASINS TO BE PERIODICALLY CLEANED AND FILTER CLOTH

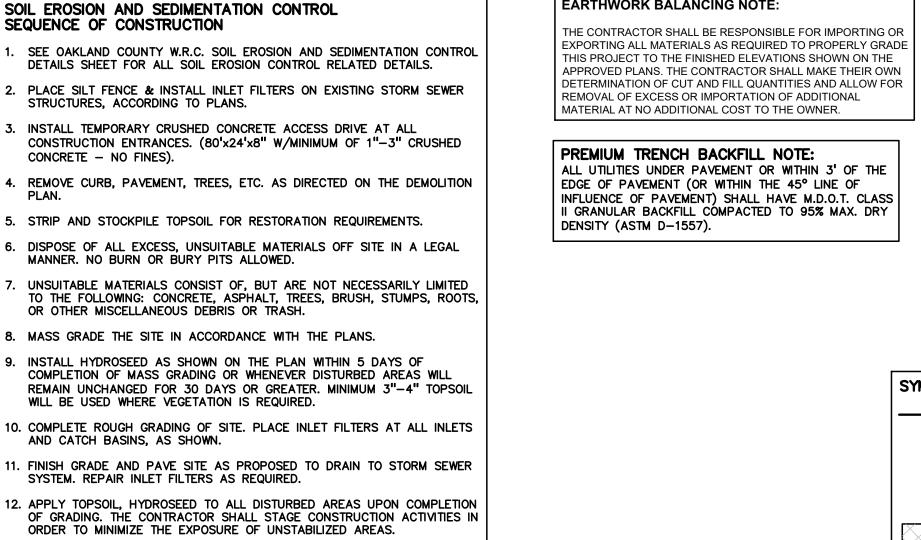

EARTHWORK BALANCING NOTE:

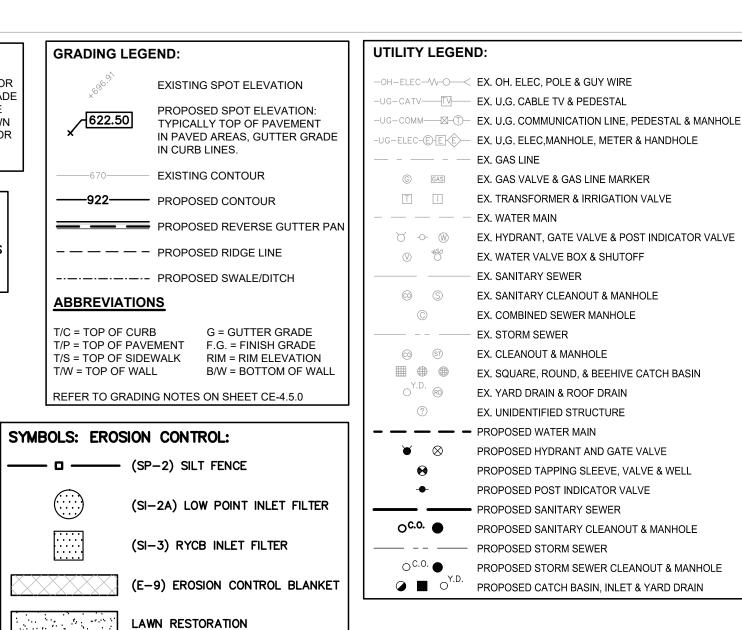


LIMITS OF DISTURBANCE

REFER TO CITY OF TROY SOIL EROSION AND SEDIMENTATION CONTROL DETAILS SHEET FOR ALL

DEVICE DETAILS.



SCALE: 1" = 30'

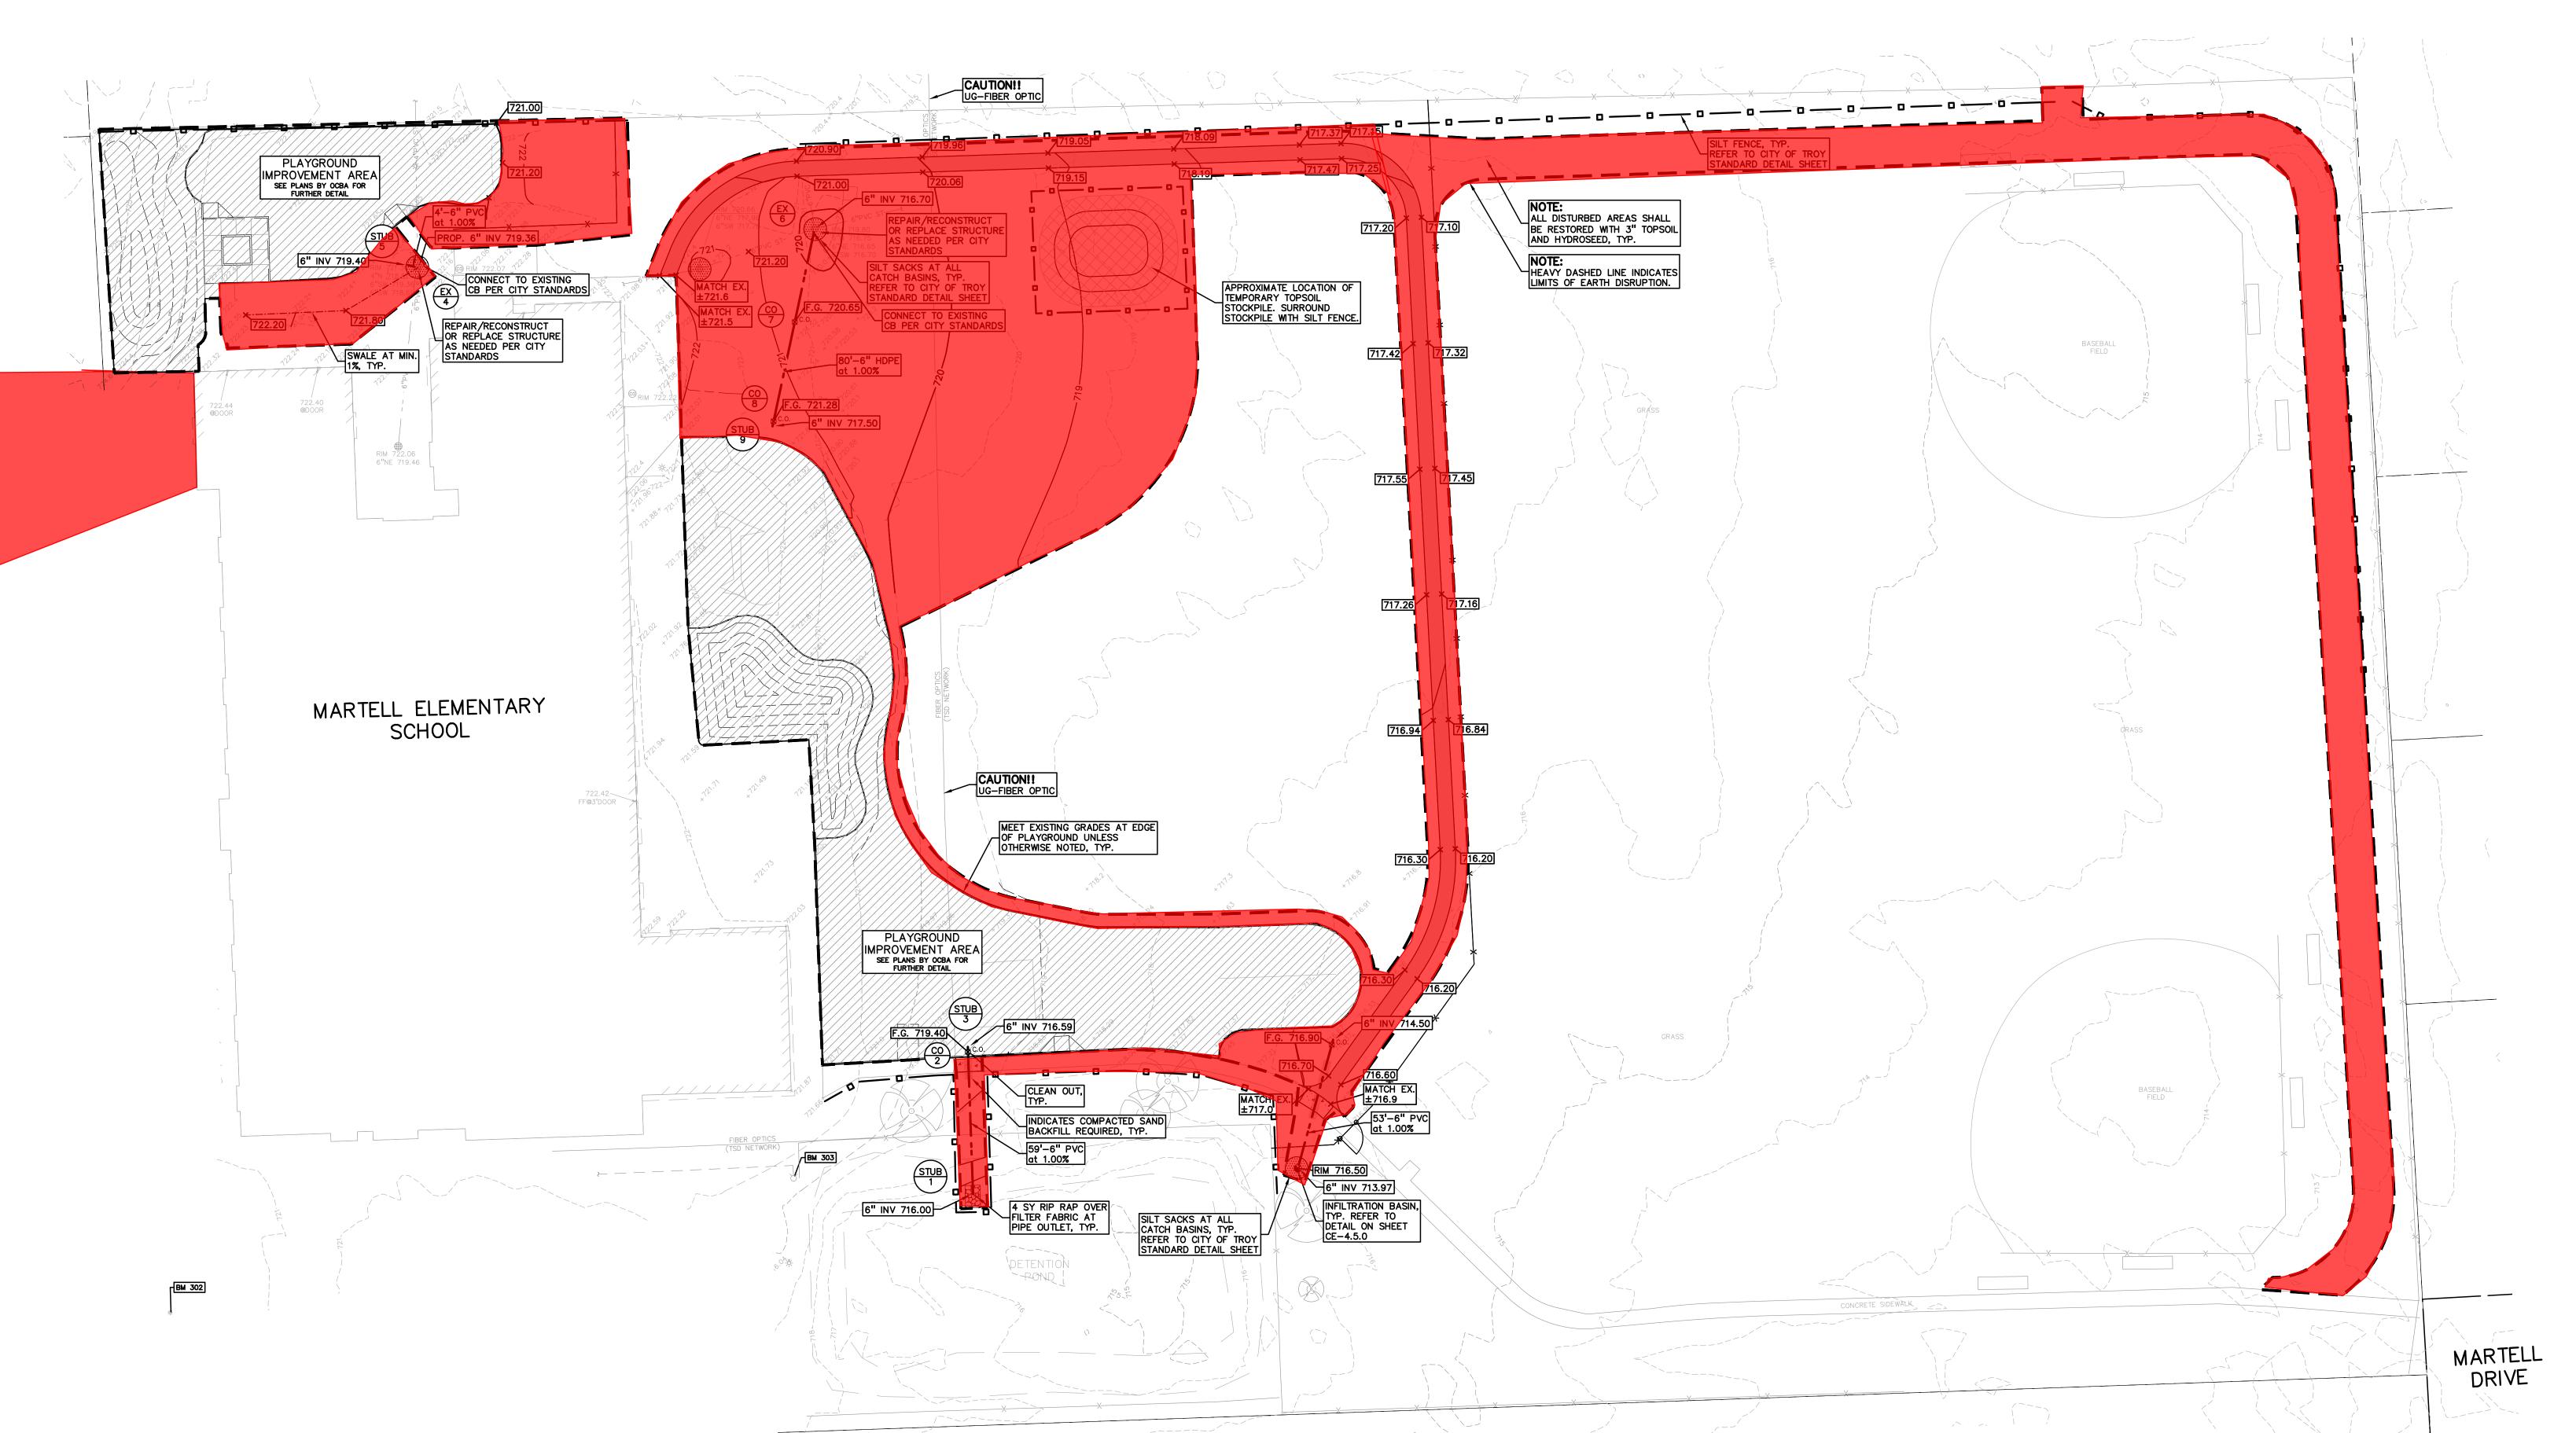

t: 844 813 2949 www.peagroup.com

CONSULTANT

PROJECT TITLE Martell Elementary School 5666 LIVERNOIS

Playground Renovation Bid Package No.01A

Troy School District Troy, Michigan

DRAWING TITLE Grading, Utility & Soil **Erosion Control Plan**

CONSTRUCTION DOCUMENTS

APPROVED

ISSUE DATES

PROJECT NO. 22092B

DRAWING NO. CE-4.4.0

Markup Made By Barton Malow