

Addendum 2

Project Stadium New Press Box – Marlin ISD
Issued January 31st, 2024 by CEI Engineering Associates, Inc.
Proposal Opening February 6th, 2024 at 2:00 PM

The following additions and changes are to be made to the Contract Documents; and hereby become part of the Contract.

Item 1 – Press Box Electrical Scope Clarification

1. Sheet E6.01 – Electrical Site Plan has had its notes revised to clearly indicate the scope of this project.

Item 2 – Press Box Signage

1. Field side signage is to be back-lit LED lights (03/A5.00 South Elevation).
2. Additional signage (“Legion Field” and “Home of the Bulldogs” and “Marlin ISD”) is all back-lit as well. Add this note to 01/A5.00 North Elevation and refer to electrical sheets.
3. Bulldog logo signage is back-lit (see 04/A5.00 West Elevation).

END OF ADDENDUM

This addendum that consists of one (1) addenda sheet and one (1) drawing sheet which shall be included as part of the proposal documents.

This addenda must be acknowledged on the Proposal Form

ARCHITECT

HKS, INC.
350 N SAINT PAUL ST
SUITE 100
DALLAS, TX 75201

CIVIL ENGINEER

CEI ENGINEERING ASSOCIATES, INC.
3030 LBJ FREEWAY
SUITE 100
DALLAS, TX 75234

LANDSCAPE

CEI ENGINEERING ASSOCIATES, INC.
3030 LBJ FREEWAY
SUITE 100
DALLAS, TX 75234

STRUCTURAL

HKS, INC.
350 N SAINT PAUL ST
SUITE 100
DALLAS, TX 75201

MEP

ROMINE, ROMINE & BURGESS, INC.
300 GREENLEAF ST
FORT WORTH, TX 76107



MARLIN

MARLIN ISD PRESS BOX
678 SUCCESS DR B
MARLIN, TX 76661

OWNER

MARLIN ISD
678 SUCCESS DR B
MARLIN, TX 76661

Romine, Romine, & Burgess
Mechanical/Electrical Engineers

300 Greenleaf
St. Worth,
Texas 76107
817.336.4633
Registration #E-509
WWW.ROMINEINC.COM
RRB@ROMINEINC.COM
R004 2812



Lance Morrow
11/16/2023

REVISION	NO	DESCRIPTION	DATE
1	ADDENDUM 2		01/31/24

HKS PROJECT NUMBER

26095.000

DATE


11/16/23

ISSUE

ISSUE FOR BID AND
PERMITSHEET TITLE
ELECTRICAL_SITE_PLAN
NEW_WORK

SHEET NO.

E6.01

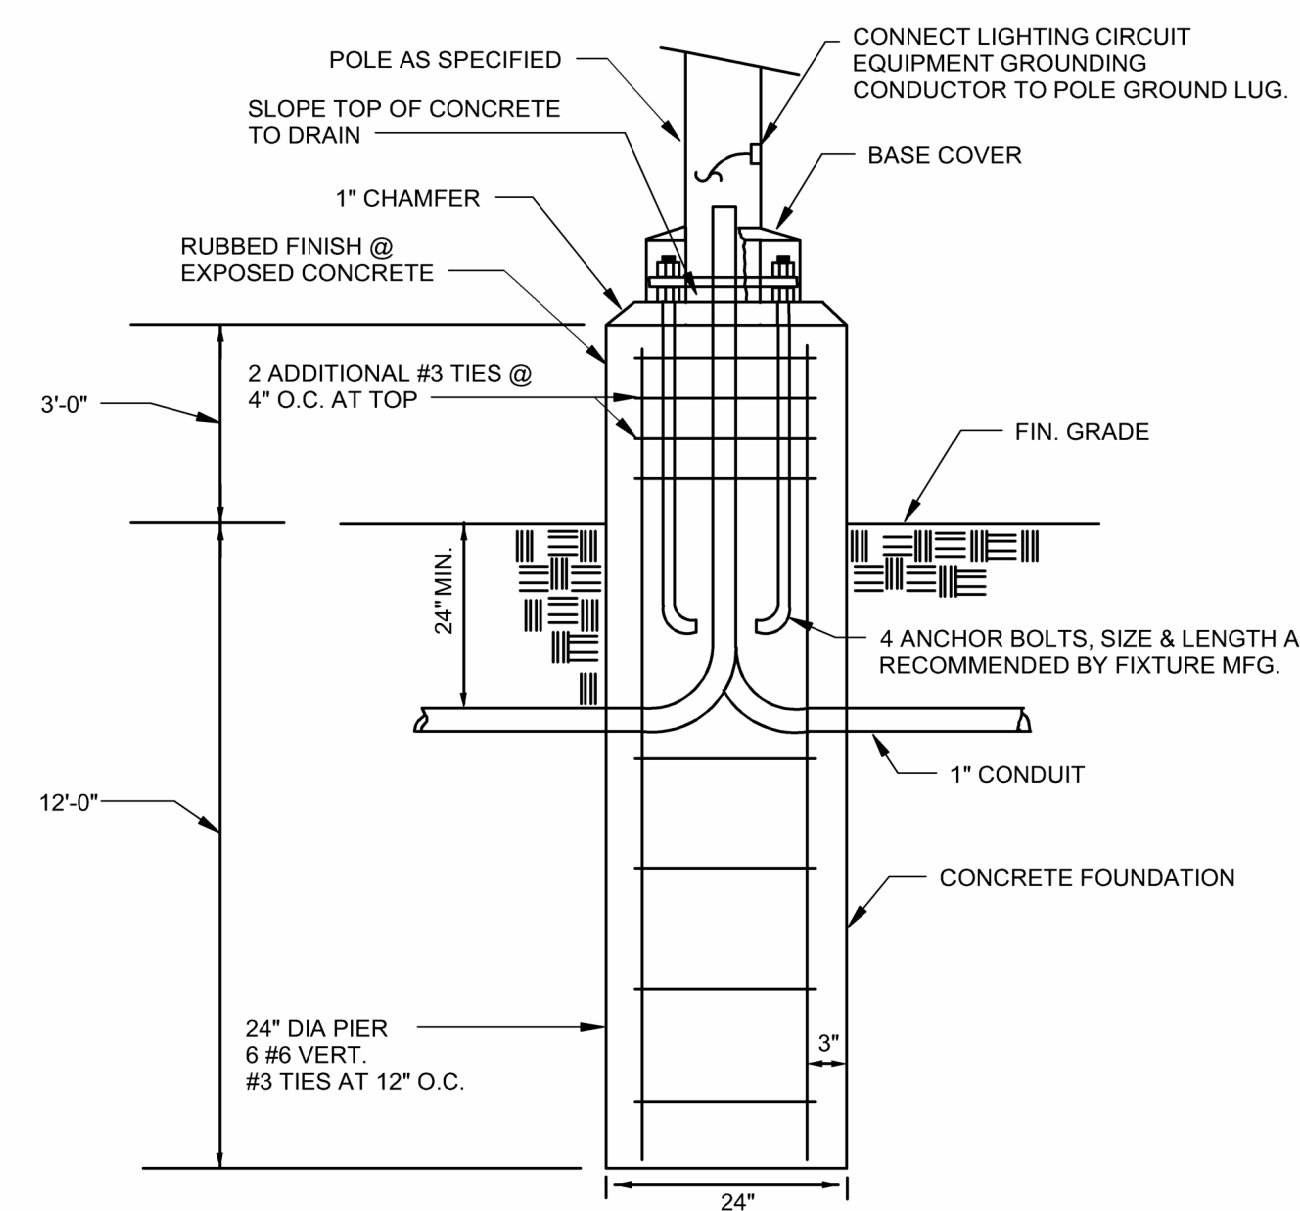

DETAIL - PARKING LOT LIGHT POLE FOUNDATION
NO SCALE

NOTES BY SYMBOL: ☐

- NEW POLE LIGHT WITH TWO FIXTURE HEADS ON CONCRETE FOUNDATION. REFER TO LIGHTING FIXTURE SCHEDULE AND POLE FOUNDATION DETAIL. FIXTURE IS SPECIFIED WITH INTEGRAL DAYLIGHT AND MOTION DIMMING CONTROLS. IF THIS IS NOT PROVIDED, CONTRACTOR SHALL PROVIDE TIME CLOCK CONTROLS.
- NEW PAVED PARKING LOT. REFER TO CIVIL 'CEI' SHEETS FOR ADDITIONAL INFORMATION. PROVIDE INSTALLATION WITH HAT OF PARKING LOT.
- IN-GRADE TELECOMMUNICATIONS PULL BOX TO BE INSTALLED IN PHASE 1 ELECTRICAL SITE DRAWINGS. NOT IN THIS CONTRACT. SHOWN FOR REFERENCE ONLY.
- ELECTRICAL EQUIPMENT ON PIPE RACK, INCLUDING METER TRANSOCKET FOR ELECTRICAL UTILITY SERVICE, MAIN DISCONNECT SWITCH AND ELECTRICAL PANELBOARD 'MP' TO BE INSTALLED IN PHASE 1 ELECTRICAL SITE DRAWINGS. NOT IN THIS CONTRACT. SHOWN FOR REFERENCE ONLY.
- ELECTRICAL EQUIPMENT ON PIPE RACK, INCLUDING PANELBOARDS 'DH' AND 'DL' TO BE INSTALLED IN PHASE 1 ELECTRICAL SITE DRAWINGS. NOT IN THIS CONTRACT. SHOWN FOR REFERENCE ONLY.
- RUN 2 #10-110G IN 1" CONDUIT TO 20A, 1-P C/P IN PANEL 'DH'.
- RUN NEW FEEDER FROM PANEL 'DH' TO PANEL 'HP' IN NEW PRESS BOX BUILDING. REFER TO SH. E101 FOR REQUIREMENTS.
- RUN NEW FEEDERS FROM PANEL 'DL' TO PANELS 'LP' AND 'LM' IN NEW PRESS BOX BUILDING. REFER TO SH. E101 FOR REQUIREMENTS.
- PROVIDE (2) 2" UNDERGROUND CONDUIT WITH PULLCORD WITH MIN. 2" COVER FOR FIBER TO SCOREBOARD FROM PRESS BOX BUILDING. VERIFY POINT OF TERMINATION AT SCOREBOARD WITH SCOREBOARD MANUFACTURER.
- NEW SCOREBOARD. VERIFY ALL REQUIREMENTS WITH SCOREBOARD MANUFACTURER PRIOR TO ANY ELECTRICAL ROUGH-IN.
- PROVIDE (2) 2" UNDERGROUND CONDUITS WITH PULLCORD WITH MIN. 2" COVER, ONE FOR FIBER TO SCOREBOARD AND ONE FOR FUTURE TECHNOLOGY, FROM PULL BOX TO PRESS BOX BUILDING. REFER TO SH. E301 FOR POINT OF TERMINATION IN PRESS BOX BUILDING.
- PROVIDE NEW TRANSFORMER 'T-SB' AND PANEL 'SB' AT BACK SIDE OF PIPE RACK FOR POWER CIRCUITS TO NEW SCOREBOARD. REFER TO SH. E101 FOR REQUIREMENTS.
- RUN (8) 50A/2P CIRCUITS TO NEW SCOREBOARD INDICATED ON PANEL 'SB' SCHEDULE, SH. E101.
- INSTALL WEATHER-RESISTANT GFCI RECEPTACLE WITH WEATHER-PROOF IN-USE COVER. MOUNT SECURELY TO SCOREBOARD BASE AT APPROX. 2' AFF. RUN TO CIRCUIT SB-17 AS INDICATED ON PANEL 'SB' SCHEDULE.
- EXISTING CONDUIT FROM FIELD HOUSE INSTALLED BY SPORTS TURF CONTRACTOR IN PHASE 1 FIELD TURF IMPROVEMENTS PACKAGE. VERIFY EXACT LOCATION AT SITE. NOT IN THIS CONTRACT. SHOWN FOR REFERENCE ONLY.

GENERAL NOTES:

- UNDERGROUND CONDUITS SHALL BE BURIED WITH MINIMUM 24" COVER. REFER TO SPECIFICATIONS FOR SPECIFIC INSTALLATION REQUIREMENTS.
- VERIFY LOCATION OF ALL UNDERGROUND UTILITIES IN CONSTRUCTION AREA PRIOR TO BORING OR DIGGING.
- SAVOUT AND REPAIR SIDEWALKS AND PAVED AREAS AS/IF REQUIRED TO ACCOMMODATE UNDERGROUND CONDUIT INSTALLATION. FIELD VERIFY EXISTING CONDITIONS PRIOR TO BID TO DETERMINE MOST FEASIBLE ROUTING OF ALL ELECTRICAL FEEDERS AND COMPLETE SCOPE OF WORK.
- TWO OR MORE CIRCUITS MAY BE COMBINED IN ONE CONDUIT AT DISCRETION OF CONTRACTOR AS LONG AS INDICATED CONDUIT SIZE IS INCREASED PER NEC REQUIREMENTS.
- REFER TO ELECTRICAL SPECIFICATIONS FOR IN-GRADE JUNCTION BOX REQUIREMENTS. PROVIDE BOXES WHERE REQUIRED TO FACILITATE LONG WIRE PULLS.

NOTE: UNDERGROUND CONDUITS ON SITE SHALL
BE MIN. 24" DEPTH TO TOP OF CONDUIT.

