

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB #: 1.602715A CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ENDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
51 TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 05:29A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-01 KITCHEN BATHROOM SINK

SAMPLE TYPE.: POTABLE

TESTED BY: ANTHONY D. MERLINI

PRESERVATIVES: HNO3

TESTES...:

TEMP RECEIVED: 18C

COLIFORM METH: N/A

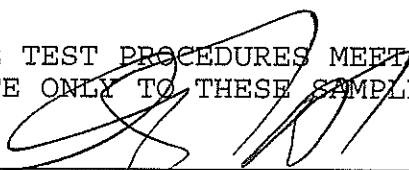
START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/26/16			LEAD (IMS)	9.3 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more  
than 10% of their distribution points have a LEAD value of more  
than 15 ppb and a COPPER value of 1.3 mg/L, else water  
treatment must be undertaken to reduce the waters corrosive  
potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323



YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB #: 1.602715C CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

DRICK HUDSON SCHOOL  
THONY MERLINI  
TROLLEY ROAD  
NTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 05:31A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-03 KITCHEN CUSTODIAL SLOP SINK  
L'D BY: ANTHONY D. MERLINI

SAMPLE TYPE.: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

NOTES....


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/26/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

#: 1.602715D CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
MANTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 05:32A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-04 KITCHEN SINK RIGHT

SAMPLE TYPE.: POTABLE

PRESERVATIVES: HNO3

COL'D BY: ANTHONY D. MERLINI

TEMP RECEIVED: 18C

NOTES...:

COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/26/16			LEAD (IMS)	2.3 ppb	0-15 ppb	SM 18-19 3113B


COMMENTS:

/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB #: 1.602715E CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 05:33A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-05 KITCHEN SINK MIDDLE  
COLLECTED BY: ANTHONY D. MERLINI  
TESTES...:

SAMPLE TYPE...: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

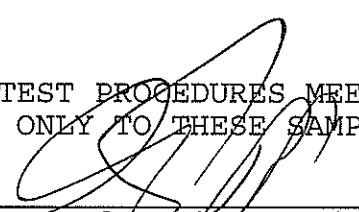
START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/26/16			LEAD (IMS)	8.6 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB #: 1.602715F CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
TROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 05:33A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: DV-06 KITCHEN SINK LEFT  
L'D BY: ANTHONY D. MERLINI  
NOTES....:


SAMPLE TYPE.. : POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/26/16			LEAD (IMS)	1.6 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:   
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

#: 1.602715G CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 05:34A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-07 KITCHEN SINK - ISLAND

SAMPLE TYPE.: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI

NOTES...:

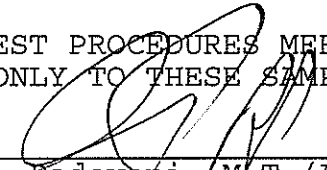
START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/26/16			LEAD (IMS)	8.7 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB #: 1.602715H CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 05:34A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-08 KITCHEN POT FILLER  
COLLECTED BY: ANTHONY D. MERLINI  
TESTES...:

SAMPLE TYPE..: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

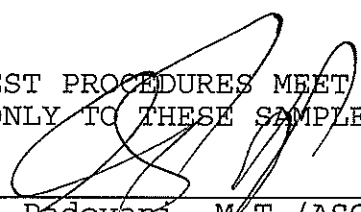
START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/26/16			LEAD (IMS)	9.5 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323



YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB #: 1.602715I CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
61 TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 05:35A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-09 KITCHEN SINK BY CAFE  
COLLECTED BY: ANTHONY D. MERLINI  
LAB USES...:

SAMPLE TYPE.. : POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/26/16			LEAD (IMS)	20.2 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:   
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB #: 1.602715J CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

HENDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
TROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 05:35A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-10 KITCHEN SINK BY SERVING LINE  
COLLECTED BY: ANTHONY D. MERLINI  
TESTS...:

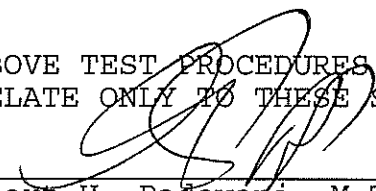
SAMPLE TYPE.. : POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/26/16			LEAD (IMS)	25.6 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:   
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB #: 1.602715K CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
TROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 05:36A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

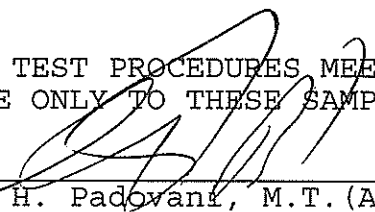
SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-11 CAFETERIA WATER FOUNTAIN  
LEAD BY: ANTHONY D. MERLINI  
NOTES...:

SAMPLE TYPE...: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/26/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:  
Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:   
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

3 #: 1.602715L CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 05:37A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-12 CUSTODIAN BATHROOM

SAMPLE TYPE.: POTABLE

COL'D BY: ANTHONY D. MERLINI

PRESERVATIVES: HNO3

TESTS...:

TEMP RECEIVED: 18C

COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/26/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

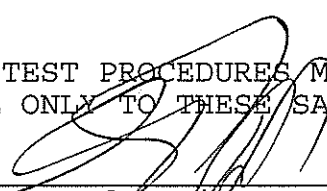
COMMENTS:

/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB #: 1.602715M CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
5 TROLLEY ROAD  
MANTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 05:38A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

PLING SITE: BUCHANAN VERPLANCK ES  
: BV-13 WATER FOUNTAIN - HALLWAY  
L'D BY: ANTHONY D. MERLINI  
TES....:

SAMPLE TYPE.: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

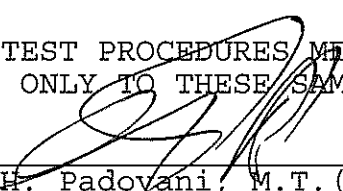
START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/26/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

MITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB #: 1.602715N CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
TROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 05:39A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-14 ART ROOM SINK - LEFT

SAMPLE TYPE.: POTABLE

COL'D BY: ANTHONY D. MERLINI

PRESERVATIVES: HNO3

NOTES...:

TEMP RECEIVED: 18C

COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/26/16			LEAD (IMS)	1.2 ppb	0-15 ppb	SM 18-19 3113B


COMMENTS:

Due LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB #: 1.6027150 CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

DRICK HUDSON SCHOOL  
HONY MERLINI  
TROLLEY ROAD  
NTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 05:40A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-15 ART ROOM SINK RIGHT

SAMPLE TYPE.: POTABLE

PRESERVATIVES: HNO3

COL'D BY: ANTHONY D. MERLINI

TEMP RECEIVED: 18C

NOTES...:

COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/26/16			LEAD (IMS)	1.4 ppb	0-15 ppb	SM 18-19 3113B


COMMENTS:

/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

MITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

#: 1.602715P CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
MANTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 05:41A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-16 ART ROOM SINK LEFT BY WINDOW

SAMPLE TYPE...: POTABLE

PRESERVATIVES: HNO3

COL'D BY: ANTHONY D. MERLINI

TEMP RECEIVED: 18C

NOTES...:

COLIFORM METH: N/A

PART	DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
	09/26/16			LEAD (IMS)	1.1 ppb	0-15 ppb	SM 18-19 3113B

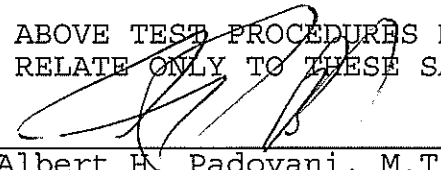
COMMENTS:

/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323



YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB #: 1.602715Q CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

DENDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
84 TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 05:42A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-17 ART ROOM SINK RIGHT BY WINDOW  
COLLECTED BY: ANTHONY D. MERLINI  
COMMENTS:

SAMPLE TYPE.: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

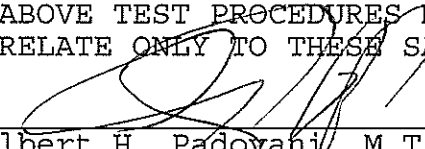
START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/26/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

#: 1.602715R CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 05:45A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-18 GYM OFFICE SINK

SAMPLE TYPE.: POTABLE

PRESERVATIVES: HNO3

COL'D BY: ANTHONY D. MERLINI

TEMP RECEIVED: 18C

NOTES...:

COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/26/16			LEAD (IMS)	26.4 ppb	0-15 ppb	SM 18-19 3113B

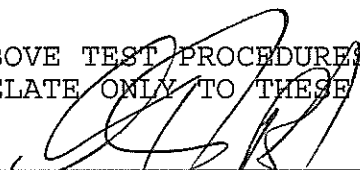
COMMENTS:

/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB #: 1.602715S CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

HENDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
61 TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 05:46A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-19 GYM OFFICE SHOWER  
COLLECTED BY: ANTHONY D. MERLINI  
COMMENTS:

SAMPLE TYPE.: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

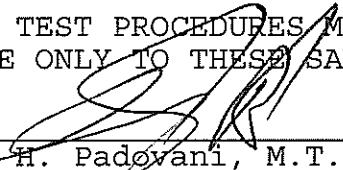
START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/26/16			LEAD (IMS)	216.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:   
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB #: 1.602715T CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
TROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 05:47A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-20 GYM BATHROOM LEFT SINK  
L'D BY: ANTHONY D. MERLINI  
TESTS...:

SAMPLE TYPE...: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

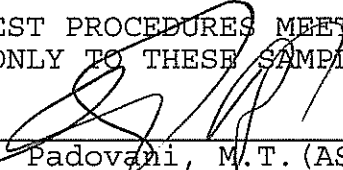
START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/26/16			LEAD (IMS)	6.8 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

MITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
 321 Kear Street  
 Yorktown Heights, N.Y. 10598  
 (914) 245-2800  
 Albert H. Padovani, Director  
 \*\* TEST REPORT \*\*

LAB #: 1.602715U CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
 ANTHONY MERLINI  
 TROLLEY ROAD  
 MANTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 05:48A  
 DATE/TIME REC'D: 09/23/16 03:05P  
 REPORT DATE: 09/28/16  
 PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
 : BV-21 GYM BATHROOM RIGHT SINK  
 COL'D BY: ANTHONY D. MERLINI

SAMPLE TYPE...: POTABLE  
 PRESERVATIVES: HNO3  
 TEMP RECEIVED: 18C  
 COLIFORM METH: N/A

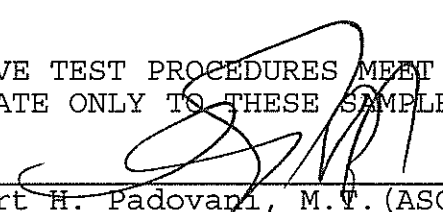
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/26/16			LEAD (IMS)	5.1 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Cu LEAD limits for public schools are set at 15 ppb.  
 EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
 AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:   
 Albert H. Padovani, M.P. (ASCP)  
 Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

#: 1.602715V CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
MANTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 05:50A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-22 OUTSIDE WATER FOUNTAIN PLAYGROUND

SAMPLE TYPE...: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI

NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/26/16			LEAD (IMS)	132.0 ppb	0-15 ppb	SM 18-19 3113B

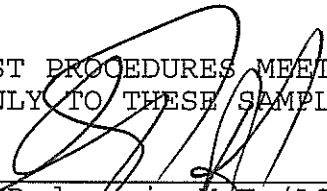
COMMENTS:

/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

B #: 1.602715W CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 05:52A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-23 NURSE BATHROOM SINK  
COLLECTED BY: ANTHONY D. MERLINI  
TESTS...:

SAMPLE TYPE...: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

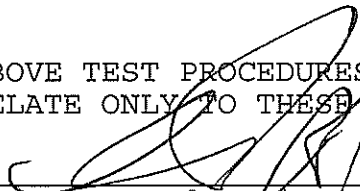
START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/26/16			LEAD (IMS)	1.3 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB # : 1.602715X CLIENT # : 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 05:54A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-24 NURSE OFFICE SINK (1)  
COL'D BY: ANTHONY D. MERLINI

SAMPLE TYPE...: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

NOTES...:

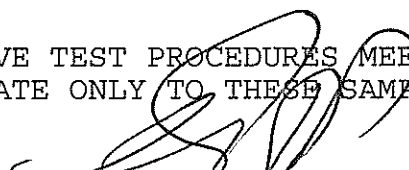
START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/26/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323



YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

#: 1.602715Y CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
MANTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 05:55A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-25 NURSE OFFICE SINK (2)

SAMPLE TYPE.: POTABLE

COL'D BY: ANTHONY D. MERLINI

PRESERVATIVES: HNO3

NOTES . . . :

TEMP RECEIVED: 18C

COLIFORM METH: N/A

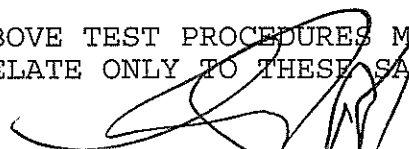
START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/26/16			LEAD (IMS)	177.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

B #: 1.602715Z CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
61 TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 05:56A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-26 TEACHERS LOUNGE SINK  
D BY: ANTHONY D. MERLINI  
ES...:

SAMPLE TYPE.: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/26/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:   
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
 321 Kear Street  
 Yorktown Heights, N.Y. 10598  
 (914) 245-2800  
 Albert H. Padovani, Director  
 \*\* TEST REPORT \*\*

LAB #: 1.602716A CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

HENDRICK HUDSON SCHOOL  
 ANTHONY MERLINI  
 TROLLEY ROAD  
 TROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 05:57A  
 DATE/TIME REC'D: 09/23/16 03:05P  
 REPORT DATE: 09/28/16  
 PHONE: (914)-257-5152

PLING SITE: BUCHANAN VERPLANCK ES  
 : BV-27 LADIES ROOM SINK BY LOBBY  
 L'D BY: ANTHONY D. MERLINI  
 ES....

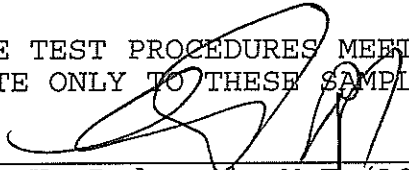
SAMPLE TYPE...: POTABLE  
 PRESERVATIVES: HNO3  
 TEMP RECEIVED: 18C  
 COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/26/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

/Cu LEAD limits for public schools are set at 15 ppb.  
 EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
 AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

MITTED BY:   
 Albert H. Padovani, M.T. (ASCP)  
 Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB #: 1.602716B CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
TROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 05:58A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-28 BATHROOM SINK OFF LOBBY  
COL'D BY: ANTHONY D. MERLINI  
NOTES...:

SAMPLE TYPE.: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/26/16			LEAD (IMS)	1.1 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

B #: 1.602716C CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
61 TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 05:59A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-29 GIRLS BATHROOM LEFT SINK  
ID BY: ANTHONY D. MERLINI  
ES...

SAMPLE TYPE.: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/26/16			LEAD (IMS)	1.4 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:   
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB #: 1.602716D CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
TROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:02A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-30 GIRLS BATHROOM RIGHT SINK

SAMPLE TYPE.: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

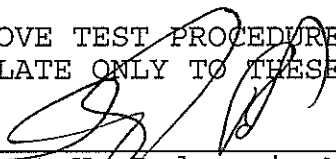
COL'D BY: ANTHONY D. MERLINI  
TESTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/26/16			LEAD (IMS)	2.4 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:   
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

#: 1.602716E CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
MANTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:03A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-31 CUSTODIAL SLOP SINK  
COL'D BY: ANTHONY D. MERLINI

SAMPLE TYPE.: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/26/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

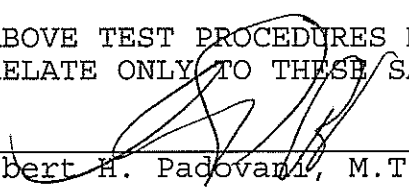
COMMENTS:

/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
 321 Kear Street  
 Yorktown Heights, N.Y. 10598  
 (914) 245-2800  
 Albert H. Padovani, Director  
 \*\* TEST REPORT \*\*

B #: 1.602716F CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
 ANTHONY MERLINI  
 61 TROLLEY ROAD  
 MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:05A  
 DATE/TIME REC'D: 09/23/16 03:05P  
 REPORT DATE: 09/28/16  
 PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
 : BV-32 BOYS BATHROOM LEFT SINK  
 ID BY: ANTHONY D. MERLINI  
 ES...:

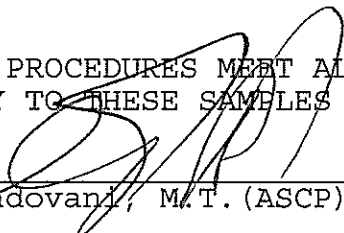
SAMPLE TYPE...: POTABLE  
 PRESERVATIVES: HNO3  
 TEMP RECEIVED: 18C  
 COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/26/16			LEAD (IMS)	1.8 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.  
 EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
 AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:   
 Albert H. Padovani, M.T. (ASCP)  
 Director

ELAP# 10323



YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB #: 1.602716G CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
TROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:06A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

PLING SITE: BUCHANAN VERPLANCK ES  
: BV-33 BOYS BATHROOM RIGHT SINK  
L'D BY: ANTHONY D. MERLINI  
TES...:

SAMPLE TYPE...: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

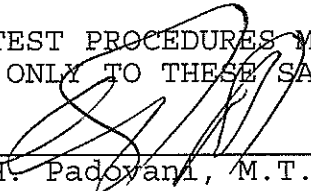
START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/26/16			LEAD (IMS)	1.9 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

MITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

3 #: 1.602716H CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:07A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-34 OUTSIDE GIRLS BATHROOM L SINK

SAMPLE TYPE..: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI  
NOTES...:

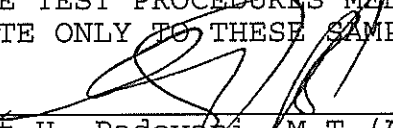
START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/26/16			LEAD (IMS)	11.5 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB #: 1.602716I CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
TROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:08A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-35 OUTSIDE GIRLS BATHROOM R SINK

SAMPLE TYPE.: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

LAB'D BY: ANTHONY D. MERLINI  
RES...:


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/26/16			LEAD (IMS)	3.9 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

#: 1.602716J CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:10A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-36 PSYCH BATHROOM SINK

SAMPLE TYPE.: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI

NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/26/16			LEAD (IMS)	3.7 ppb	0-15 ppb	SM 18-19 3113B

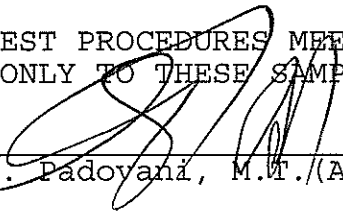
COMMENTS:

/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

B #: 1.602716K CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:10A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-CUSTODIAL SLOP SINK

SAMPLE TYPE.: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A


LAB'D BY: ANTHONY D. MERLINI  
TESTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/26/16			LEAD (IMS)	1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:   
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

B #: 1.602716L CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

HENDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
6 TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:12A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-38 CLASSROOM 17 BUBBLER

SAMPLE TYPE.: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

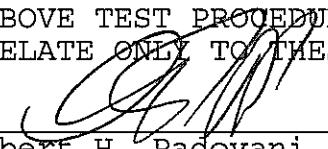
TESTED BY: ANTHONY D. MERLINI  
TESTS...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/26/16			LEAD (IMS)	6.8 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SMITTED BY:   
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB #: 1.602716M CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
TROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:13A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-39 CLASSROOM 17 SINK  
COLLECTED BY: ANTHONY D. MERLINI  
TESTS...:

SAMPLE TYPE...: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

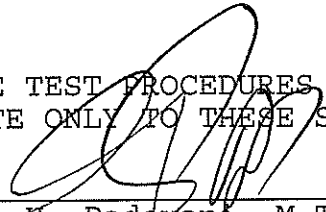
START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	10.4 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

3 #: 1.602716N CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:14A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-40 CLASSROOM 23 BUBBLER

SAMPLE TYPE.: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

ANALYZED BY: ANTHONY D. MERLINI  
RESULTS:


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	2.6 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

o/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323



YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB #: 1.6027160 CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

HENDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
TROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:15A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-41 CLASSROOM 23 SINK

SAMPLE TYPE.: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A


LAB'D BY: ANTHONY D. MERLINI  
TESTS...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	2.2 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

MITTED BY:   
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB #: 1.602716P CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

DRICK HUDSON SCHOOL  
HONY MERLINI  
TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:16A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-42 CLASSROOM 18 BUBBLER  
COLLECTED BY: ANTHONY D. MERLINI

SAMPLE TYPE.: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A


NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	9.8 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:   
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

#: 1.602716Q CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:17A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-43 CLASSROOM 18 SINK

SAMPLE TYPE.: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI

NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	8.4 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

B #: 1.602716R CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
61 TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:18A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-44 CLASSROOM 19 BUBBLER  
ID BY: ANTHONY D. MERLINI  
ES...:

SAMPLE TYPE..: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	2.4 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

B #: 1.602716S CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
51 TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:19P  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-45 CLASSROOM 19 SINK

SAMPLE TYPE...: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

TESTED BY: ANTHONY D. MERLINI  
FES...:

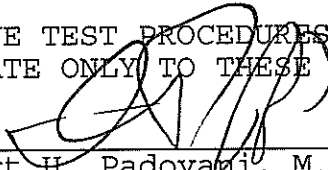
START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	5.7 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

TESTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB #: 1.602716T CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
TROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:20P  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-46 HALL WATER FOUNTAIN  
COL'D BY: ANTHONY D. MERLINI  
TESTS...:

SAMPLE TYPE..: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

MITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

B #: 1.602716U CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
MANTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:21A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-47 CLASSROOM 20 BUBBLER  
COL'D BY: ANTHONY D. MERLINI

SAMPLE TYPE.: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

NOTES....:


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	20.6 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

MITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

#: 1.602716V CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:21A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-48 CLASSROOM 20 SINK

SAMPLE TYPE.: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI

NOTES...:

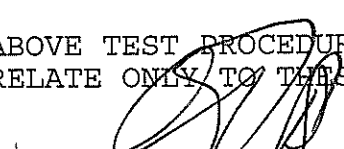
START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	17.9 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323



YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

B #: 1.602716W CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
61 TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:22A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-49 CLASSROOM 21 BUBBLER

SAMPLE TYPE.: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

ANAL'D BY: ANTHONY D. MERLINI  
RES.:


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	24.1 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB #: 1.602716X CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
TROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:23A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-50 CLASSROOM 21 SINK

SAMPLE TYPE.: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

LAB'D BY: ANTHONY D. MERLINI  
NOTES....:


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	13.1 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

#: 1.602716Y CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
MANTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:24A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-51 CLASSROOM 22 BUBBLER

SAMPLE TYPE...: POTABLE

COL'D BY: ANTHONY D. MERLINI

PRESERVATIVES: HNO3

NOTES....:

TEMP RECEIVED: 18C

COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	71.2 ppb	0-15 ppb	SM 18-19 3113B


COMMENTS:

/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

B #: 1.602716Z CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
51 TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:25A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-52 CLASSROOM 22 SINK  
TESTED BY: ANTHONY D . MERLINI  
TESTES....:


SAMPLE TYPE.: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	191 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:   
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB #: 1.602717A CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
TROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:26A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-53 WORKROOM SINK LIBRARY

SAMPLE TYPE..: POTABLE

LAB'D BY: ANTHONY D. MERLINI

PRESERVATIVES: HNO3

NOTES...:

TEMP RECEIVED: 18C

COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	10.8 ppb	0-15 ppb	SM 18-19 3113B


COMMENTS:

Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

#: 1.602717B CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

DRICK HUDSON SCHOOL  
THONY MERLINI  
TROLLEY ROAD  
NTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:28A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-54 SERVICE CLOSET SINK

SAMPLE TYPE...: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI

NOTES...:


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	707.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB #: 1.602717C CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:29A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-55 CLASSROOM 1 BUBBLER  
COL'D BY: ANTHONY D. MERLINI  
RES...:

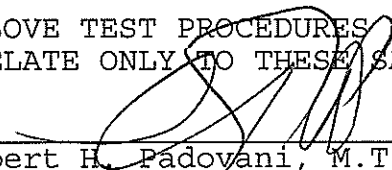
SAMPLE TYPE..: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:   
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB #: 1.602717D CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
MOTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:30A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

TESTING SITE: BUCHANAN VERPLANCK ES  
: BV-56 CLASSROOM 1 SINK  
TESTED BY: ANTHONY D. MERLINI  
TESTES...:

SAMPLE TYPE...: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

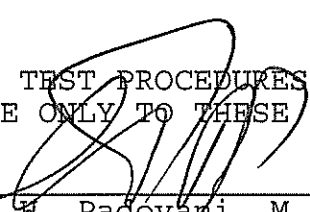
START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323



YML ENVIRONMENTAL SERVICES  
 321 Kear Street  
 Yorktown Heights, N.Y. 10598  
 (914) 245-2800  
 Albert H. Padovani, Director  
 \*\* TEST REPORT \*\*

B #: 1.602717E CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
 ANTHONY MERLINI  
 TROLLEY ROAD  
 WINTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:31A  
 DATE/TIME REC'D: 09/23/16 03:05P  
 REPORT DATE: 09/28/16  
 PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
 : BV-57 CLASSROOM 2 BUBBLER  
 COLLECTED BY: ANTHONY D. MERLINI  
 COMMENTS:

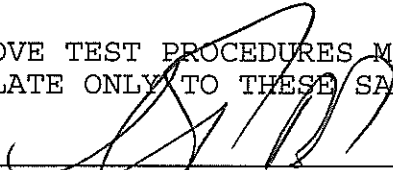
SAMPLE TYPE.: POTABLE  
 PRESERVATIVES: HNO3  
 TEMP RECEIVED: 18C  
 COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

1 /Cu LEAD limits for public schools are set at 15 ppb.  
 EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
 AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:   
 Albert H. Padovani, M.T. (ASCP)  
 Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

B #: 1.602717F CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
64 TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:32A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-58 CLASSROOM 2 SINK  
COLLECTED BY: ANTHONY D. MERLINI  
ES....:

SAMPLE TYPE...: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB #: 1.602717G CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
6 TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:33A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-59 CLASSROOM 3 BUBBLER  
TESTED BY: ANTHONY D. MERLINI  
TESTES....:

SAMPLE TYPE...: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

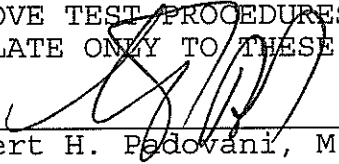
START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	5.1 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB #: 1.602717H CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

HENDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
TROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:34A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-60 CLASSROOM 3 SINK  
COL'D BY: ANTHONY D. MERLINI  
TESTS...:

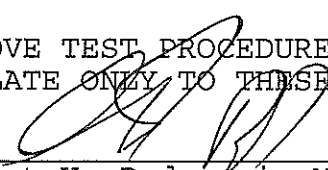
SAMPLE TYPE..: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	3.9 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

MITTED BY:   
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

B #: 1.602717I CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

DRICK HUDSON SCHOOL  
HONY MERLINI  
TROLLEY ROAD  
NTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:35A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-61 CLASSROOM 4 BUBBLER

SAMPLE TYPE.: POTABLE

PRESERVATIVES: HNO3

COL'D BY: ANTHONY D. MERLINI

TEMP RECEIVED: 18C

NOTES...:

COLIFORM METH: N/A

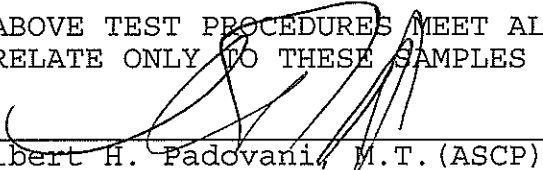
START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	1.6 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

3 #: 1.602717J CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:35A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-62 CLASSROOM 4 SINK

SAMPLE TYPE.: POTABLE

ANAL'D BY: ANTHONY D. MERLINI

PRESERVATIVES: HNO3

YES...:

TEMP RECEIVED: 18C

COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	31.5 ppb	0-15 ppb	SM 18-19 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB #: 1.602717K CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

HENDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
5 TROLLEY ROAD  
WATROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:36A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-63 CLASSROOM 5 BUBBLER  
LEAD BY: ANTHONY D. MERLINI  
TESTS...:


SAMPLE TYPE...: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	1.4 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:   
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

#: 1.602717L CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
MANTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:37A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-64 CLASSROOM 5 SINK

SAMPLE TYPE...: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI

NOTES...:


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	2.2 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323



YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB #: 1.602717M CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
31 TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:38A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-65 CLASSROOM 6 BUBBLER

SAMPLE TYPE.: POTABLE

COLLECTED BY: ANTHONY D. MERLINI

PRESERVATIVES: HNO3

TESTS...:

TEMP RECEIVED: 18C

COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: \_\_\_\_\_

Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB #: 1.602717N CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
61 TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:39A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-66 CLASSROOM 6 SINK  
COLLECTED BY: ANTHONY D. MERLINI  
TESTES...:


SAMPLE TYPE..: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	8.5 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:   
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB #: 1.6027170 CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

DRICK HUDSON SCHOOL  
THONY MERLINI  
TROLLEY ROAD  
TROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:40A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-67 CLASSROOM 13 BUBBLER  
L'D BY: ANTHONY D. MERLINI  
TES....:

SAMPLE TYPE...: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	2.2 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

#: 1.602717P CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:40A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: V-68 CLASSROOM 13 SINK

SAMPLE TYPE...: POTABLE

COL'D BY: ANTHONY D. MERLINI

PRESERVATIVES: HNO3

NOTES...:

TEMP RECEIVED: 18C

COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	5.8 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

COL  
NOY

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

3 #: 1.602717Q CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
5 TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:41A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

PLING SITE: BUCHANAN VERPLANCK ES  
: BV-69 CLASSROOM 14 BUBBLER  
D BY: ANTHONY D. MERLINI  
TES....:

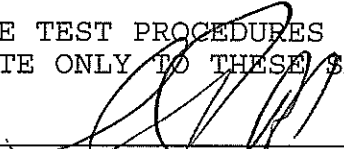
SAMPLE TYPE...: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	1.6 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

MITTED BY:   
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB #: 1.602717R CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
TROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:42A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-70 CLASSROOM 14 SINK  
COLLECTED BY: ANTHONY D. MERLINI  
TESTS...:


SAMPLE TYPE...: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

PART	DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
	09/27/16			LEAD (IMS)	2.6 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

APPROVED BY:   
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

#: 1.602717S CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:43A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-71 CLASSROOM 7 BUBBLER

SAMPLE TYPE.: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

COLLECTED BY: ANTHONY D. MERLINI  
NOTES...:


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	1.1 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

3 #: 1.602717T CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

1. IDRICK HUDSON SCHOOL  
2. ANTHONY MERLINI  
3. TROLLEY ROAD  
4. WINTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:43A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-72 CLASSROOM 7 SINK

SAMPLE TYPE...: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

TESTED BY: ANTHONY D. MERLINI  
TESTES...:


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	1.1 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

P /Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323



YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

Lab #: 1.602717U CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
TROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:44A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-73 CLASSROOM 8 BUBBLER

SAMPLE TYPE...: POTABLE

LAB'D BY: ANTHONY D. MERLINI

PRESERVATIVES: HNO3

RES...:

TEMP RECEIVED: 18C

COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	2.6 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB # : 1.602717V CLIENT # : 65142

NON STAT PROC

PAGE: 1 of 1

DRICK HUDSON SCHOOL  
THONY MERLINI  
TROLLEY ROAD  
NTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:45A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

PLING SITE: BUCHANAN VERPLANCK ES  
: BV-74 CLASSROOM 8 SINK  
D BY: ANTHONY D. MERLINI  
ES...


SAMPLE TYPE.: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	3.1 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

MITTED BY:   
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB # : 1.602717W CLIENT # : 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:46A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-75 CLASSROOM 9 BUBBLER  
LAB'D BY: ANTHONY D. MERLINI  
COMMENTS:

SAMPLE TYPE...: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	1.3 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

-Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

B #: 1.602717X CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

EDRICK HUDSON SCHOOL  
HONY MERLINI  
TROLLEY ROAD  
TROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:47A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-76 CLASSROOM 9 SINK  
D BY: ANTHONY D. MERLINI  
ES....

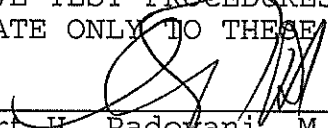
SAMPLE TYPE.: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

PART	DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
	09/27/16			LEAD (IMS)	2.7 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

MITTED BY:   
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

#: 1.602717Y CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

DRICK HUDSON SCHOOL  
HONY MERLINI  
TROLLEY ROAD  
NTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:48A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-77 HALL BATHROOM SINK

SAMPLE TYPE.: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

LD BY: ANTHONY D. MERLINI

ES...:


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	1.4 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

IBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

I : #: 1.602717Z CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

DRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
TITROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:49A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-78 CUSTODIAL SLOP SINK  
LEAD BY: ANTHONY D. MERLINI  
RES...:


SAMPLE TYPE...: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SMITTED BY:   
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

#: 1.602718A CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
TROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:50A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-79 CLASSROOM 10 BUBBLER

SAMPLE TYPE...: POTABLE

COLLECTED BY: ANTHONY D. MERLINI

PRESERVATIVES: HNO3

TESTS...:

TEMP RECEIVED: 18C

COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	6.2 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THOSE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

B #: 1.602718B CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

DRICK HUDSON SCHOOL  
HONY MERLINI  
TROLLEY ROAD  
NTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:50A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-80 CLASSROOM 10 SINK

SAMPLE TYPE...: POTABLE

COLLECTED BY: ANTHONY D. MERLINI

PRESERVATIVES: HNO3

NOTES...:

TEMP RECEIVED: 18C

COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	5.7 ppb	0-15 ppb	SM 18-19 3113B


COMMENTS:

LEAD/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323



YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

#: 1.602718C CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:51A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-81 CLASSROOM 11 BUBBLER

SAMPLE TYPE.: POTABLE

PRESERVATIVES: HNO3

COL'D BY: ANTHONY D. MERLINI

TEMP RECEIVED: 18C

NOTES...:

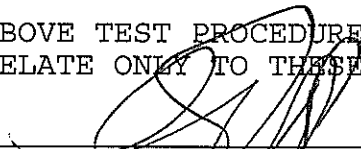
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:   
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB #: 1.602718D CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:52A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-82 CLASSROOM 11 SINK  
COLLECTED BY: ANTHONY D. MERLINI  
RESULTS:

SAMPLE TYPE.: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:   
Albert H. Padovani, M.T.(ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

B #: 1.602718E CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
61 TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:53A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-83 CLASSROOM 12 BUBBLER  
AND BY: ANTHONY D. MERLINI  
ES....:

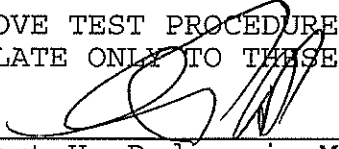
SAMPLE TYPE...: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:   
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

B #: 1.602718F CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
5 TROLLEY ROAD  
MANTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:54A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-84 CLASSROOM 12 SINK  
COLLECTED BY: ANTHONY D. MERLINI  
TESTES....:

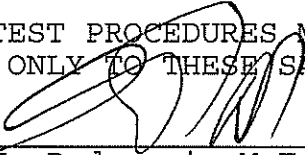
SAMPLE TYPE...: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

PART	DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
	09/27/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:   
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB #: 1.602718G CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
TROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:55A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-85 CLASSROOM 15 BUBBLER

SAMPLE TYPE.: POTABLE

PRESERVATIVES: HNO3

COLLECTED BY: ANTHONY D. MERLINI

TEMP RECEIVED: 18C

TESTES...:

COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

MITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB #: 1.602718H CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
TROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:56A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-86 CLASSROOM 15 SINK  
COL'D BY: ANTHONY D. MERLINI  
TESTES...:


SAMPLE TYPE...: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:   
Albert H. Padovani, M.T.(ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB #: 1.602718I CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

DRICK HUDSON SCHOOL  
HONY MERLINI  
TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:57A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-87 CLASSROOM 16 BUBBLER

SAMPLE TYPE.: POTABLE

PRESERVATIVES: HNO3

COL'D BY: ANTHONY D. MERLINI

TEMP RECEIVED: 18C

NOTES....:


COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:   
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

#: 1.602718J CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

DRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 06:58A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-88 CLASSROOM 16 SINK  
COL'D BY: ANTHONY D. MERLINI  
NOTES...:

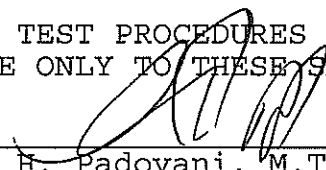
SAMPLE TYPE.: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:   
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323



YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

#: 1.602718K CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 07:05A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-89 HOSE BIB BY LOADING DOCK

SAMPLE TYPE.: POTABLE  
PRESERVATIVES: HNO3  
TEMP RECEIVED: 18C  
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI

NOTES....:


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	4.9 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES  
321 Kear Street  
Yorktown Heights, N.Y. 10598  
(914) 245-2800  
Albert H. Padovani, Director  
\*\* TEST REPORT \*\*

LAB # : 1.602718L CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

ANDRICK HUDSON SCHOOL  
ANTHONY MERLINI  
TROLLEY ROAD  
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/23/16 07:12A  
DATE/TIME REC'D: 09/23/16 03:05P  
REPORT DATE: 09/28/16  
PHONE: (914)-257-5152

SAMPLING SITE: BUCHANAN VERPLANCK ES  
: BV-90 HOSE BIB BY PLAYGROUND

SAMPLE TYPE...: POTABLE

PRESERVATIVES: HNO3

COL'D BY: ANTHONY D. MERLINI

TEMP RECEIVED: 18C

NOTES...:

COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
09/27/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.  
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,  
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:

  
Albert H. Padovani, M.T. (ASCP)  
Director

ELAP# 10323