

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602745A CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:02A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G LINDSEY ES
: FLG-01 BOILER ROOM SLOP SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI

NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	3.9 ppb	0-15 ppb	SM 18-19 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602745B CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:03A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-02 ART ROOM SINK GOOSENECK
COL'D BY: ANTHONY D. MERLINI
NOTES...:

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	2.1 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602745C CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:04A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-03 ART ROOM SINK MIDDLE

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A


COL'D BY: ANTHONY D. MERLINI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	4.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602745D CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:04A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-04 ART ROOM SINK GOOSENECK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

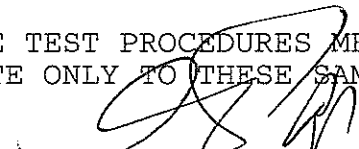
COL'D BY: ANTHONY D. MERLINI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	9.7 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602745E CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:05A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-05 ART ROOM SINK GOOSENECK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI

NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	5.3 ppb	0-15 ppb	SM 18-19 3113B

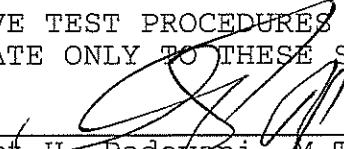
COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602745F CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:06A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-06 ART ROOM SINK MIDDLE

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3

COL'D BY: ANTHONY D. MERLINI

TEMP RECEIVED: 15C

NOTES...:

COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	1.1 ppb	0-15 ppb	SM 18-19 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602745G CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:07A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-07 ART ROOM SINK GOOSENECK

SAMPLE TYPE.: POTABLE

PRESERVATIVES: HNO3

COL'D BY: ANTHONY D. MERLINI

TEMP RECEIVED: 15C

NOTES...:

COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	6.0 ppb	0-15 ppb	SM 18-19 3113B

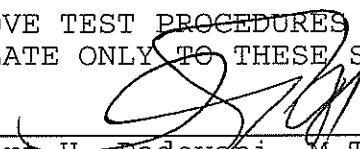
COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602745H CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:09A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-08 BOYS BATHROOM SINK

SAMPLE TYPE.: POTABLE

PRESERVATIVES: HNO3

COL'D BY: ANTHONY D. MERLINI

TEMP RECEIVED: 15C

NOTES...:

COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	1.3 ppb	0-15 ppb	SM 18-19 3113B

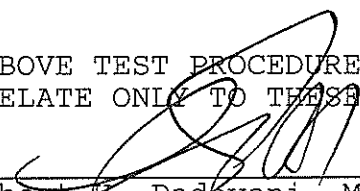
COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602745I CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:10A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-09 BOYS BATHROOM SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI

NOTES...:


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	1.6 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602745J CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:11A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-10 HALL WATER FOUNTAIN

SAMPLE TYPE.: POTABLE

PRESERVATIVES: HNO3

COL'D BY: ANTHONY D. MERLINI

TEMP RECEIVED: 15C

NOTES...:

COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602745K CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:12A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-11 GIRLS BATHROOM SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI

NOTES...:


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602745L CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:13A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-12 GIRLS BATHROOM SINK
COL'D BY: ANTHONY D. MERLINI
NOTES....:

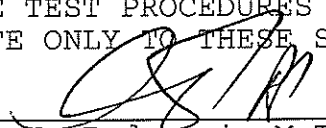
SAMPLE TYPE..: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	3.3 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602745M CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:15A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-13 MATHEW OFFICE SINK
COL'D BY: ANTHONY D. MERLINI
NOTES...:


SAMPLE TYPE..: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	10.4 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602745N CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:18A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-14 CALSSROOM 19 BUBBLER
COL'D BY: ANTHONY D. MERLINI
NOTES....:


SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	1.4 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.6027450 CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:19A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-15 CLASSROOM 19 SINK
COL'D BY: ANTHONY D. MERLINI
NOTES....:

SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	8.5 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602745P CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:20A
DATE/TIME REC'D: 09/26/16 08:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-16 CLASSROOM 16 BUBBLER

SAMPLE TYPE.: POTABLE

COL'D BY: ANTHONY D. MERLINI

PRESERVATIVES: HNO3

NOTES...:

TEMP RECEIVED: 15C

COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	1.9 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602745Q CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:21A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-17 CLSSROOM 16 SINK

SAMPLE TYPE.: POTABLE

PRESERVATIVES: HNO3

COL'D BY: ANTHONY D. MERLINI

TEMP RECEIVED: 15C

NOTES....:

COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	76.4 ppb	0-15 ppb	SM 18-19 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602745R CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:22A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-18 CLASSROOM 15 BUBBLER
COL'D BY: ANTHONY D. MERLINI
NOTES....:

SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602745S CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:23A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-19 CLASSROOM 15 SINK
COL'D BY: ANTHONY D. MERLINI
NOTES...:


SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602745T CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:24A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-20 CLASSROOM 18 BUBBLER

SAMPLE TYPE.: POTABLE

PRESERVATIVES: HNO3

COL'D BY: ANTHONY D. MERLINI

TEMP RECEIVED: 15C

NOTES...:

COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	1.4 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602745U CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:25A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-21 CLASSROOM 18 SINK
COL'D BY: ANTHONY D. MERLINI
NOTES....:

SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	5.4 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602745V CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:26A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-22 CLASSROOM 14 BUBBLER

SAMPLE TYPE.: POTABLE

COL'D BY: ANTHONY D. MERLINI

PRESERVATIVES: HNO3

NOTES...:

TEMP RECEIVED: 15C


COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	2.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602745W CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:27A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-23 CLASSROOM 14 SINK
COL'D BY: ANTHONY D. MERLINI
NOTES...:


SAMPLE TYPE..: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	2.3 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602745X CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:29A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-24 CLASSROOM 17 BUBBLER

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A


COL'D BY: ANTHONY D. MERLINI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	2.6 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602745Y CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:30A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-25 CLASSROOM 17 SINK
COL'D BY: ANTHONY D. MERLINI
NOTES...:


SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	1.3 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602745Z CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:32A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-26 CUSTODIAN SLOP SINK

SAMPLE TYPE..: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A


COL'D BY: ANTHONY D. MERLINI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	6.3 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602746A CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:33A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-27 HALL WATER FOUNTAIN

SAMPLE TYPE...: POTABLE

COL'D BY: ANTHONY D. MERLINI

PRESERVATIVES: HNO3

NOTES...:

TEMP RECEIVED: 15C

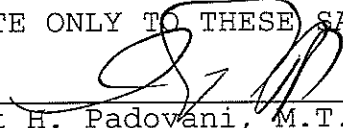
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602746B CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:36A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-28 CLASSROOM 13 BUBBLER
COL'D BY: ANTHONY D. MERLINI
NOTES....:

SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602746C CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:37A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-29 CLASSROOM 13 SINK
COL'D BY: ANTHONY D. MERLINI
NOTES....:


SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	2.2 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602746D CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:38A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-30 CLASSROOM 12 BUBBLER

SAMPLE TYPE...: POTABLE

COL'D BY: ANTHONY D. MERLINI

PRESERVATIVES: HNO3

NOTES...:

TEMP RECEIVED: 15C

COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

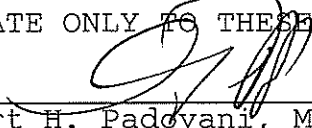
COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602746E CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:39A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-31 CLASSROOM 12 SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A


COL'D BY: ANTHONY D. MERLINI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	2.7 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602746F CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:42A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-32 OLD LOCKER WATER FOUNTAIN
COL'D BY: ANTHONY D. MERLINI
NOTES...:

SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	5.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602746G CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:43A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-33 GYM OFFICE BATHROOM SINK
COL'D BY: ANTHONY D. MERLINI
NOTES...:


SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	2.9 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602746H CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:45A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-34 CLASSROOM 11 BUBBLER
COL'D BY: ANTHONY D. MERLINI
NOTES....:


SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	1.8 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602746I CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:46A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-35 CLASSROOM 11 SINK

SAMPLE TYPE.: POTABLE

COL'D BY: ANTHONY D. MERLINI

PRESERVATIVES: HNO3

NOTES....:

TEMP RECEIVED: 15C

COLIFORM METH: N/A

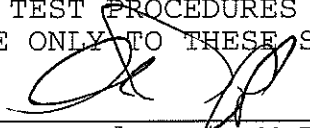
START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	3.3 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602746J CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:47A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-36 HALL WATER FOUNTAIN
COL'D BY: ANTHONY D. MERLINI
NOTES...:


SAMPLE TYPE..: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602746K CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:49A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-37 HALL WATER FOUNTAIN
COL'D BY: ANTHONY D. MERLINI
NOTES...:


SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602746L CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:51A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-38 TEACHERS LOUNGE BATHROOM SINK

SAMPLE TYPE.: POTABLE

COL'D BY: ANTHONY D. MERLINI

PRESERVATIVES: HNO3

NOTES....:

TEMP RECEIVED: 15C

COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	2.2 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602746M CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:52A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-39 TEACHERS LOUNGE BATHROOM SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A


COL'D BY: ANTHONY D. MERLINI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602746N CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:53A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-40 TEACHERS LOUNGE SINK
COL'D BY: ANTHONY D. MERLINI
NOTES...:


SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.6027460 CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:54A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-41 COPY ROOM SINK

SAMPLE TYPE...: POTABLE

COL'D BY: ANTHONY D. MERLINI

PRESERVATIVES: HNO3

NOTES....:

TEMP RECEIVED: 15C

COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	37.9 ppb	0-15 ppb	SM 18-19 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602746P CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:55A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-42 NURSE OFFICE SINK
COL'D BY: ANTHONY D. MERLINI
NOTES...:


SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602746Q CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:56A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-43 NURSE OFFICE BATHROOM SINK
COL'D BY: ANTHONY D. MERLINI
NOTES....:


SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	21.1 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602746R CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 07:59A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-44 KITCHEN ISLAND SINK
COL'D BY: ANTHONY D. MERLINI
NOTES....:


SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	1.5 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602746S CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:00A
DATE/TIME REC'D: 09/24/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-45 ICE MACHINE
COL'D BY: ANTHONY D. MERLINI
NOTES...:


SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	3.2 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602746T CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:01A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-46 KITCHEN SINK LEFT
COL'D BY: ANTHONY D. MERLINI
NOTES...:

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602746U CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:02A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-47 KITCHEN SINK MIDDLE
COL'D BY: ANTHONY D. MERLINI
NOTES...:


SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	8.1 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602746V CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:03A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-48 KITCHEN SINK RIGHT
COL'D BY: ANTHONY D. MERLINI
NOTES...:


SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602746W CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:04A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-49 KITCHEN BATHROOM SINK
COL'D BY: ANTHONY D. MERLINI
NOTES....:

SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	2.6 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602746X CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:05A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-50 CUSTODIAN SLOP SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	3.1 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602746Y CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:08A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-51 PSYCH BATHROOM SINK
COL'D BY: ANTHONY D. MERLINI
NOTES...:


SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602746Z CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:11A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-52 ROOM SW 1 SINK

SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C ON ICE
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	83.6 ppb	0-15 ppb	SM 18-19 3113B

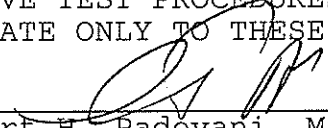
COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602747A CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:13A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-53 CLASSROOM 1 SINK
COL'D BY: ANTHONY D. MERLINI
NOTES...:


SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	162 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602747B CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:14A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-54 CLASSROOM 1 FOUNTAIN

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI
NOTES....:


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	10.3 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602747C CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:15A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-55 CLASSROOM 1 SINK RT
COL'D BY: ANTHONY D. MERLINI
NOTES....:


SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	15.7 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602747D CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:16A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-56 CLASSROOM 1 SINK LT
COL'D BY: ANTHONY D. MERLINI
NOTES...:


SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	6.4 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602747E CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:17A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-57 SP 1 CUSTODIAN SINK
COL'D BY: ANTHONY D. MERLINI
NOTES....:


SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	28.8 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T.(ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602747F CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:19A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-58 CUSTODIAN OFFICE SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A


COL'D BY: ANTHONY D. MERLINI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602747G CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:24A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-59 CLASSROOM 2 SINK LT
COL'D BY: ANTHONY D. MERLINI
NOTES....:

SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	14.3 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602747H CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:25A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-60 CLASSROOM 2 SINK RT
COL'D BY: ANTHONY D. MERLINI
NOTES....:


SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	700 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602747I CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:26A
DATE/TIME REC'D: 09/26/16 08:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-61 CLASSROOM 2 FOUNTAIN

SAMPLE TYPE...: POTABLE

COL'D BY: ANTHONY D. MERLINI

PRESERVATIVES: HNO3

NOTES...:

TEMP RECEIVED: 15C

COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	18.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602747J CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:27A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-62 CLASSROOM 2 SINK
COL'D BY: ANTHONY D. MERLINI
NOTES...:

SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	21.3 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602747K CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:28A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-63 CLASSROOM 6 BUBBLER
COL'D BY: ANTHONY D. MERLINI
NOTES...:


SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602747L CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:29A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-64 CLASSROOM 6 SINK
COL'D BY: ANTHONY D. MERLINI
NOTES...:

SAMPLE TYPE..: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/06/16			LEAD (IMS)	24.8 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602747M CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:30A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-65 CLASSROOM 7 BUBBLER
COL'D BY: ANTHONY D. MERLINI
NOTES...:


SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602747N CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:31A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-66 CLASSROOM 7 SINK

SAMPLE TYPE..: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A


COL'D BY: ANTHONY D. MERLINI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	616 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.6027470 CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:32A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-67 CLASSROOM 3 SINK
COL'D BY: ANTHONY D. MERLINI
NOTES....:


SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	4.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602747P CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:33A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-68 CLASSROOM 3 FOUNTAIN
COL'D BY: ANTHONY D. MERLINI
NOTES....:

SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	5.7 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602747Q CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:34A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-69 CLASSROOM 3 SINK
COL'D BY: ANTHONY D. MERLINI
NOTES....:


SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	5.4 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602747R CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:35A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-70 CLASSROOM 8 BUBBLER
COL'D BY: ANTHONY D. MERLINI
NOTES....:

SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602747S CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1


HENDRICK HUDSON SCHOOL DATE/TIME TAKEN: 09/24/16 08:36A
ANTHONY MERLINI DATE/TIME REC'D: 09/26/16 09:25A
61 TROLLEY ROAD REPORT DATE: 10/12/16
MONTROSE, NY 10548 PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES SAMPLE TYPE.: POTABLE
: FGL-71 CLASSROOM 8 SINK PRESERVATIVES: HNO3
COL'D BY: ANTHONY D. MERLINI TEMP RECEIVED: 15C
NOTES...: COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	4.4 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:
Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602747T CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:38A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-72 CLASSROOM 4 SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A


COL'D BY: ANTHONY D. MERLINI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	7.5 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602747U CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:39A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-73 CLASSROOM 4 SINK
COL'D BY: ANTHONY D. MERLINI
NOTES...:

SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	5.9 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602747V CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:40A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-74 CLASSROOM 4 FOUNTAIN
COL'D BY: ANTHONY D. MERLINI
NOTES....:


SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	2.9 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602747W CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:41A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-75 CLASSROOM 4 SINK
COL'D BY: ANTHONY D. MERLINI
NOTES....:

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	29.2 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602747X CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:42A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-76 CLASSROOM 9 BUBBLER

SAMPLE TYPE...: POTABLE

PRESERVATIVES: HNO3

COL'D BY: ANTHONY D. MERLINI

TEMP RECEIVED: 15C

NOTES...:

COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	1.5 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602747Y CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:43A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-77 CLASSROOM 9 SINK
COL'D BY: ANTHONY D. MERLINI
NOTES....:


SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	3.6 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602747Z CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:44A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-78 OT CLASSROOM SINK
COL'D BY: ANTHONY D. MERLINI
NOTES...:


SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	1.6 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602748A CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:45A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-79 OT CLASSROOM SINK SPRAY
COL'D BY: ANTHONY D. MERLINI
NOTES...:

SAMPLE TYPE..: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	10.9 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602748B CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:48A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-80 CLASSROOM 5 SINK
COL'D BY: ANTHONY D. MERLINI
NOTES....:


SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	5.6 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602748C CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:49A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-81 CLASSROOM 5 FOUNTAIN

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	17.1 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602748D CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:50A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-82 CLASSROOM 5 SINK RT
COL'D BY: ANTHONY D. MERLINI
NOTES...:

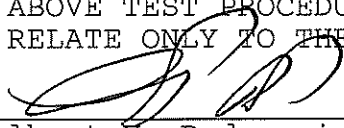
SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	1.4 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602748E CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:51A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-83 CLASSROOM 5 SINK LT

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI
NOTES...:


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	1.1 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602748F CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:54A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-84 CLASSROOM 28 SINK

SAMPLE TYPE.: POTABLE

PRESERVATIVES: HNO3

TEMP RECEIVED: 15C

COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI


NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	11.5 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602748G CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:55A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-85 CLASSROOM 25 BUBBLER

SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	2.3 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602748H CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:56A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-86 CLASSROOM 25 SINK

SAMPLE TYPE.: POTABLE

PRESERVATIVES: HNO3

COL'D BY: ANTHONY D. MERLINI

TEMP RECEIVED: 15C

NOTES...:

COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	2.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602748I CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:57A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-87 CLASSROOM 24 BUBBLER

SAMPLE TYPE.: POTABLE

PRESERVATIVES: HNO3

COL'D BY: ANTHONY D. MERLINI

TEMP RECEIVED: 15C

NOTES...:

COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	1.7 ppb	0-15 ppb	SM 18-19 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602748J CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:58A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-88 CLASSROOM 24 SINK
COL'D BY: ANTHONY D. MERLINI
NOTES...:


SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	4.9 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602748K CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 08:59A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-89 CLASSROOM 27 SINK

SAMPLE TYPE.: POTABLE

PRESERVATIVES: HNO3

TEMP RECEIVED: 15C

COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI

NOTES...:

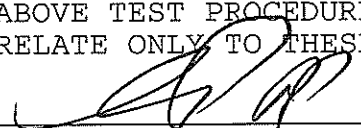
START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	5.1 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602748L CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 09:00A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-90 CLASSROOM 23 BUBBLER

SAMPLE TYPE.: POTABLE

COL'D BY: ANTHONY D. MERLINI

PRESERVATIVES: HNO3

NOTES...:

TEMP RECEIVED: 15C


COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	1.7 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602748M CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 09:01A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-91 CLASSROOM 23 SINK
COL'D BY: ANTHONY D. MERLINI
NOTES...:


SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	2.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602748N CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 09:02A
DATE/TIME REC'D: 09/24/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-92 CLASSROOM 26 SINK

SAMPLE TYPE.: POTABLE

PRESERVATIVES: HNO3

COL'D BY: ANTHONY D. MERLINI

TEMP RECEIVED: 15C

NOTES...:

COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	2.2 ppb	0-15 ppb	SM 18-19 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.6027480 CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 09:04A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY
: FGL-93 CUSTODIAN SLOP SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI
NOTES...:


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	3.7 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602748P CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 09:05A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-94 HALL WATER FOUNTAIN

SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI
NOTES....:


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602748Q CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 09:07A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-95 CLASSROOM 22 BUBBLER
COL'D BY: ANTHONY D. MERLINI
NOTES....:


SAMPLE TYPE..: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602748R CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 09:08A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-96 CLASSROOM 22 SINK

SAMPLE TYPE..: POTABLE

COL'D BY: ANTHONY D. MERLINI

PRESERVATIVES: HNO3

NOTES....:

TEMP RECEIVED: 15C


COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/07/16			LEAD (IMS)	2.4 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602748S CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 09:09A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-97 LIBRARY SINK
COL'D BY: ANTHONY D. MERLINI
NOTES...:


SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	31.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602748T CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 09:10A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-98 HALL WATER FOUNTAIN
COL'D BY: ANTHONY D. MERLINI
NOTES....:


SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	2.2 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602748U CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 09:15A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-99 HOSE BIB FRONT
COL'D BY: ANTHONY D. MERLINI
NOTES...:

SAMPLE TYPE..: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	4.2 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602748V CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 09:20A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-100 HOSE BIB HOT BOX
COL'D BY: ANTHONY D. MERLINI
NOTES...:


SAMPLE TYPE..: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	2020 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602748W CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 09:23A
DATE/TIME REC'D: 09/26/16 09:25A
REPORT DATE: 10/12/16
PHONE: (914)-257-5152

SAMPLING SITE: FRANK G. LINDSEY ES
: FGL-101 HOSE BIB TROLLEY RD
COL'D BY: ANTHONY D. MERLINI
NOTES....:


SAMPLE TYPE..: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	34.5 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

REPORT ADDENDUM

For your information and reporting purposes, we have included an interpretation of lead results as it applies to the Lead Testing of School Drinking Water regulation:

The action level for lead in school drinking water is 15 micrograms per liter (mcg/L) or parts per billion (ppb). That is also equivalent to 0.015 milligrams per liter (mg/L) or parts per million (ppm). For the purposes of interpreting analytical laboratory results relative to what constitutes a lead action level exceedance under the Lead Testing in School Drinking Water regulation, the following guidance is provided:

- Lead results reported by the laboratory that are equal to, or less than, 15 micrograms per liter (≤ 15) does not constitute a lead action level exceedance, and therefore does not require further testing or remediation.
- Lead results reported by the laboratory that are greater than 15 micrograms per liter (i.e. 15.1 micrograms per liter, or greater) exceeds the lead action level and therefore requires the outlet to be taken out of service and a remediation plan to be implemented.