

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.603091A CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 10/27/16 10:08A
DATE/TIME REC'D: 10/28/16 09:00A
REPORT DATE: 11/15/16
PHONE: (914)-257-5152

SAMPLING SITE: BLUE MOUNTAIN MIDDLE SCHOOL
: BM-132 CUSTODIAL SLOP SINK
COL'D BY: ANTHONY D. MERLINI
NOTES...:

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
11/09/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.603091B CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 10/27/16 10:10A
DATE/TIME REC'D: 10/28/16 09:00A
REPORT DATE: 11/15/16
PHONE: (914)-257-5152

SAMPLING SITE: BLUE MOUNTAIN MIDDLE SCHOOL
: BM-133 CUSTODIAL SLOP SINK
COL'D BY: ANTHONY D. MERLINI
NOTES....:

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
11/09/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.603091C CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 10/27/16 10:12A
DATE/TIME REC'D: 10/28/16 09:00A
REPORT DATE: 11/15/16
PHONE: (914)-257-5152

SAMPLING SITE: BLUE MOUNTAIN MIDDLE SCHOOL
: BM-134 WATER FOUNTAIN LT
COL'D BY: ANTHONY D. MERLINI
NOTES...:

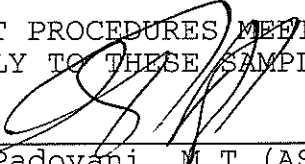
SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
11/09/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.603091D CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 10/27/16 10:13A
DATE/TIME REC'D: 10/28/16 09:00A
REPORT DATE: 11/15/16
PHONE: (914)-257-5152

SAMPLING SITE: BLUE MOUNTAIN MIDDLE SCHOOL
: BM-135 WATER FOUNTAIN RT

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI

NOTES...:


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
11/09/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.603091E CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 10/27/16 10:15A
DATE/TIME REC'D: 10/28/16 09:00A
REPORT DATE: 11/15/16
PHONE: (914)-257-5152

SAMPLING SITE: BLUE MOUNTAIN MIDDLE SCHOOL
: BM-136 MENS RM SINK LT
COL'D BY: ANTHONY D. MERLINI
NOTES...:

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
11/09/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.603091F CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 10/27/16 10:16A
DATE/TIME REC'D: 10/28/16 09:00A
REPORT DATE: 11/15/16
PHONE: (914)-257-5152

SAMPLING SITE: BLUE MOUNTAIN MIDDLE SCHOOL
: BM-137 MENS RM SINK RT

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A


COL'D BY: ANTHONY D. MERLINI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
11/09/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.603091G CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 10/27/16 10:18A
DATE/TIME REC'D: 10/28/16 09:00A
REPORT DATE: 11/15/16
PHONE: (914)-257-5152

SAMPLING SITE: BLUE MOUNTAIN MIDDLE SCHOOL
: BM-138 LADIES RM SINK LT
COL'D BY: ANTHONY D. MERLINI
NOTES...:


SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
11/09/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.603091H CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 10/27/16 10:19A
DATE/TIME REC'D: 10/28/16 09:00A
REPORT DATE: 11/15/16
PHONE: (914)-257-5152

SAMPLING SITE: BLUE MOUNTAIN MIDDLE SCHOOL
: BM-139 LADIES RM SINK RT
COL'D BY: ANTHONY D. MERLINI
NOTES...:


SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
11/09/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.603091I CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 10/27/16 10:25A
DATE/TIME REC'D: 10/28/16 09:00A
REPORT DATE: 11/15/16
PHONE: (914)-257-5152

SAMPLING SITE: BLUE MOUNTAIN MIDDLE SCHOOL
: BM-140 OFFICE SINK
COL'D BY: ANTHONY D. MERLINI
NOTES....:

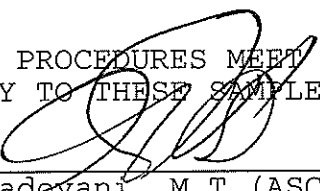
SAMPLE TYPE..: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 15C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
11/09/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323