

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602754A CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 05:42A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-01 CUSTODIAN BATHROOM SINK

SAMPLE TYPE..: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI

NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602754B CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 05:43A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-02 CUTAODIAN SLOP SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI
NOTES...:


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602754C CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 05:44A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-03 GYM WATER FOUNTAIN

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

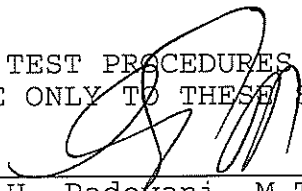
COL'D BY: ANTHONY D. MERLINI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602754D CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 05:45A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-04 GYM BATHROOM SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A


COL'D BY: ANTHONY D. MERLINI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	27.6 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602754E CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 05:46A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-05 KITCHEN ISLAND SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	3.7 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602754F CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 05:46A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-06 KITCHEN SINK RIGHT
COL'D BY: ANTHONY D .MERLINI
NOTES....:

SAMPLE TYPE..: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	3.1 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602754G CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 05:47A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-07 KITCHEN SINK MIDDLE

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI


NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	9.3 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602754H CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 05:48A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-08 KITCHEN SINK LEFT

SAMPLE TYPE.: POTABLE

PRESERVATIVES: HNO3

COL'D BY: ANTHONY D. MERLINI

TEMP RECEIVED: 18C

NOTES...:

COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	1.9 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602754I CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 05:49A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-09 KITCHEN SINK

SAMPLE TYPE..: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A


COL'D BY: ANTHONY D. MERLINI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	23.1 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602754J CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 05:50A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-10 KITCHEN BATHROOM SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A


COL'D BY: ANTHONY D. MERLINI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	27.3 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602754K CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 05:51A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-11 CUSTODIAN SLOP SINK
COL'D BY: ANTHONY D. MERLINI
NOTES....:


SAMPLE TYPE..: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T.(ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602754L CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 05:52A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-12 CAFETERIA WATER FOUNTAIN

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A


COL'D BY: ANTHONY D. MERLINI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	5.6 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602754M CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 05:53A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-13 ART RM SINK RIGHT
COL'D BY: ANTHONY D. MERLINI
NOTES...:


SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	2.2 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602754N CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 05:53A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-14 ART RM SINK MIDDLE
COL'D BY: ANTHONY D. MERLINI
NOTES....:


SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	1.6 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T.(ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.6027540 CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 05:54A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-15 ART RM SINK MIDDLE

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A


COL'D BY: ANTHONY D. MERLINI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	1.5 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602754P CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 05:54A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-16 ART RM SINK RIGHT

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	1.4 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602754Q CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 05:55A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-17 MENS ROOM SINK LEFT

SAMPLE TYPE.: POTABLE

PRESERVATIVES: HNO3

COL'D BY: ANTHONY D. MERLINI

TEMP RECEIVED: 18C

NOTES...:


COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	7.3 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602754R CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 05:56A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-18 MENS ROOM SINK RIGHT

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A


COL'D BY: ANTHONY D. MERLINI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	3.4 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602754S CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 05:58A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOOD ES
: FW-19 WOMENS ROOM SINK LEFT

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	13.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602754T CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 05:59A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-20 WOMENS ROOM SINK RIGHT
COL'D BY: ANTHONY D. MERLINI
NOTES....:


SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	30.6 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602754U CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:00A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-21 GYM WATER FOUNTAIN

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

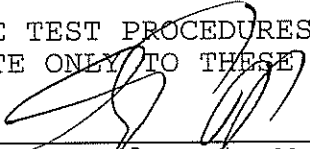
COL'D BY: ANTHONY D. MERLINI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	1.4 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602754V CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:03A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-22 CLASSROOM 20 SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A


COL'D BY: ANTHONY D. MERLINI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	7.3 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602754W CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:04A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-23 CLASSROOM 20 BUBBLER
COL'D BY: ANTHONY D. MERLINI
NOTES...:


SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	17.4 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602754X CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:05A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-24 CUSTODIAN SLOP SINK

SAMPLE TYPE..: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI

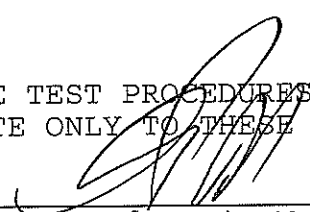
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602754Y CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:06A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-25 CLASSROOM 22 BUBBLER

SAMPLE TYPE.: POTABLE

PRESERVATIVES: HNO3

COL'D BY: ANTHONY D. MERLINI

TEMP RECEIVED: 18C

NOTES....:


COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	7.4 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602754Z CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:07A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-26 CLASSROOM 22 SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	7.6 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602755A CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:08A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-27 CLASSROOM 21 SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	23.3 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602755B CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:09A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-28 CLASSROOM 21 BUBBLER

SAMPLE TYPE..: POTABLE

PRESERVATIVES: HNO3

COL'D BY: ANTHONY D. MERLINI

TEMP RECEIVED: 18C

NOTES...:

COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	15.5 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602755C CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:10A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-29 CLASSROOM 24 SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI

NOTES....:


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	4.2 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602755D CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:11A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-30 CLASSROOM 24 BUBBLER

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A


COL'D BY: ANTHONY D. MERLINI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	3.1 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602755E CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:12A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-31 CLASSROOM 23 BUBBLER

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	3.2 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602755F CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:13A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-32 CLASSROOM 23 SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A


COL'D BY: ANTHONY D. MERLINI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	13.5 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602755G CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:14A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-33 CLASSROOM 26 BUBBLER

SAMPLE TYPE.: POTABLE

COL'D BY: ANTHONY D. MERLINI

PRESERVATIVES: HNO3

NOTES...:

TEMP RECEIVED: 18C


COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	2.3 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602755H CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:15A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-34 CLASSROOM 26 SINK

SAMPLE TYPE.: POTABLE

COL'D BY: ANTHONY D. MERLINI

PRESERVATIVES: HNO3

NOTES....:

TEMP RECEIVED: 18C

COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	14.2 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602755I CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:16A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-35 CLASSROOM 25 SINK
COL'D BY: ANTHONY D. MERLINI
NOTES....:

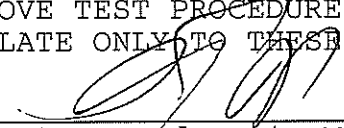
SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	2.5 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602755J CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:17A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-36 CLASSROOM 25 BUBBLER

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI


NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	2.4 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602755K CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:18A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-37 CLASSROOM 27 BUBBLER

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	2.6 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602755L CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:19A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-38 CLASSROOM 27 SINK
COL'D BY: ANTHONY D. MERLINI
NOTES....:


SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	3.7 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602755M CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:20A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-39 CLASSROOM 28 BUBBLER
COL'D BY: ANTHONY D. MERLINI
NOTES....:


SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602755N CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:21A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-40 CLASSROOM 28 SINK
COL'D BY: ANTHONY D. MERLINI
NOTES....:


SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	1.9 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.6027550 CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/24/16 06:23A
DATE/TIME REC'D: 09/24/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-41 CLASSROOM 30 SINK
COL'D BY: ANTHONY D. MERLINI
NOTES....:


SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	1.5 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602755P CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:24A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-42 CLASSROOM 29 BUBBLER

SAMPLE TYPE.: POTABLE

PRESERVATIVES: HNO3

COL'D BY: ANTHONY D. MERLINI

TEMP RECEIVED: 18C

NOTES....:

COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602755Q CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:25A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-43 CLSSROOM 29 SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	2.9 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602755R CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:29A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-44 CLASSROOM 1 BUBBLER
COL'D BY: ANTHONY D. MERLINI
NOTES....:

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	43.2 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602755S CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:30A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-45 CLASSROOM 1 SINK
COL'D BY: ANTHONY D. MERLINI
NOTES...:

SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	9.7 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602755T CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:31A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-46 CLASSROOM 1 BATHROOM SINK
COL'D BY: ANTHONY D. MERLINI
NOTES...:

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	1080 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602755U CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:39A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-47 CLASSROOM 2 SINK
COL'D BY: ANTHONY D. MERLINI
NOTES...:


SAMPLE TYPE..: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	2.2 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602755V CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:40A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-48 CLASSROOM 2 BUBBLER
COL'D BY: ANTHONY D. MERLINI
NOTES....:


SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	3.2 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602755W CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:40A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-49 CLASSROOM 2 BATHROOM SINK
COL'D BY: ANTHONY D. MERLINI
NOTES....:


SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	2.2 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602755X CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:41A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-50 CLASSROOM 3 BUBBLER

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI

NOTES...:


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	10.5 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602755Y CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:42A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-51 CLASSROOM 3 SINK
COL'D BY: ANTHONY D. MERLINI
NOTES....:

SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	4.9 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602755Z CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:43A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-52 CLASSROOM 3 BATHROOM SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A


COL'D BY: ANTHONY D. MERLINI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/10/16			LEAD (IMS)	1270 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602756A CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:45A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-53 CLASSROOM 4 SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A


COL'D BY: ANTHONY D. MERLINI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/11/16			LEAD (IMS)	62.2 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602756B CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:46A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-54 CLASSROOM 4 BUBBLER
COL'D BY: ANTHONY D. MERLINI
NOTES....:


SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/11/16			LEAD (IMS)	5.6 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602756C CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:50A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-55 LIBRARY SINK
COL'D BY: ANTHONY D. MERLINI
NOTES....:


SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/11/16			LEAD (IMS)	29.7 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602756D CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:51A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-56 BATHROOM SINK
COL'D BY: ANTHONY D. MERLINI
NOTES....:


SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/11/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602756E CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:52A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-57 CUSTODIAN SLOP SINK

SAMPLE TYPE.: POTABLE

PRESERVATIVES: HNO3

COL'D BY: ANTHONY D. MERLINI

TEMP RECEIVED: 18C

NOTES....:

COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/11/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602756F CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:53A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-58 TEACHERS LOUNGE BATHROOM SINK

SAMPLE TYPE.: POTABLE

PRESERVATIVES: HNO3

COL'D BY: ANTHONY D. MERLINI

TEMP RECEIVED: 18C

NOTES....:

COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/11/16			LEAD (IMS)	2.4 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602756G CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:54A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-59 TEACHERS LOUNGE SINK
COL'D BY: ANTHONY D. MERLINI
NOTES...:


SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/11/16			LEAD (IMS)	1.7 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602756H CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:55A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-60 MAIN OFFICE PANTRY SINK
COL'D BY: ANTHONY D. MERLINI
NOTES....:

SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/11/16			LEAD (IMS)	3.2 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602756I CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:56A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-61 MAIN OFFICE WATER FOUNTAIN

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A


COL'D BY: ANTHONY D. MERLINI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/11/16			LEAD (IMS)	5.7 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602756J CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:57A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-62 MAIN OFFICE BATHROOM

SAMPLE TYPE...: POTABLE

COL'D BY: ANTHONY D. MERLINI

PRESERVATIVES: HNO3

NOTES...:

TEMP RECEIVED: 18C

COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/11/16			LEAD (IMS)	65.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602756K CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:58A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-63 NURSE OFFICE SINK
COL'D BY: ANTHONY D. MERLINI
NOTES....:


SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/11/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602756L CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 06:59A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-64 NURSE OFFICE BATHROOM SINK
COL'D BY: ANTHONY D. MERLINI
NOTES....:

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/11/16			LEAD (IMS)	10.7 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602756M CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 07:00A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-65 CLASSROOM 8 BUBBLER
COL'D BY: ANTHONY D. MERLINI
NOTES....:


SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/11/16			LEAD (IMS)	5.8 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602756N CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 07:00A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-66 CLASSROOM 8 SINK

SAMPLE TYPE.: POTABLE

PRESERVATIVES: HNO3

COL'D BY: ANTHONY D. MERLINI

TEMP RECEIVED: 18C

NOTES...:

COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/11/16			LEAD (IMS)	6.6 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.6027560 CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 07:01A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-67 CLASSROOM 7 SINK

SAMPLE TYPE.: POTABLE

COL'D BY: ANTHONY D. MERLINI

PRESERVATIVES: HNO3

NOTES....:

TEMP RECEIVED: 18C


COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/11/16			LEAD (IMS)	6.8 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602756P CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 07:02A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-68 CLASSROOM 7 BUBBLER

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A


COL'D BY: ANTHONY D. MERLINI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/11/16			LEAD (IMS)	6.7 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602756Q CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 07:03A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-69 CLASSROOM 10 SINK
COL'D BY: ANTHONY D. MERLINI
NOTES....:

SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/11/16			LEAD (IMS)	2.2 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602756R CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 07:04A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-70 CLASSROOM 10 BUBBLER
COL'D BY: ANTHONY D. MERLINI
NOTES....:


SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/11/16			LEAD (IMS)	2.1 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602756S CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 07:05A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-71 CLASSROOM 9 SINK
COL'D BY: ANTHONY D. MERLINI
NOTES....:


SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/11/16			LEAD (IMS)	41.4 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602756T CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 07:06A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-72 CLASSROOM 9 BUBBLER

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A


COL'D BY: ANTHONY D. MERLINI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/11/16			LEAD (IMS)	3.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602756U CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 07:09A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-73 CLASSROOM 12 SINK
COL'D BY: ANTHONY D. MERLINI
NOTES...:

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/11/16			LEAD (IMS)	9.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602756V CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 07:10A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-74 CLASSROOM 12 BUBBLER

SAMPLE TYPE.: POTABLE

PRESERVATIVES: HNO3

COL'D BY: ANTHONY D. MERLINI

TEMP RECEIVED: 18C

NOTES...:

COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/11/16			LEAD (IMS)	9.0 ppb	0-15 ppb	SM 18-19 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602756W CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 07:11A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-75 CLASSROOM 11 BUBBLER

SAMPLE TYPE.: POTABLE

COL'D BY: ANTHONY D. MERLINI

PRESERVATIVES: HNO3

NOTES...:

TEMP RECEIVED: 18C

COLIFORM METH: N/A


START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/11/16			LEAD (IMS)	5.8 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602756X CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 07:12A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-76 CLASSROOM 11 SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI
NOTES...:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/11/16			LEAD (IMS)	6.4 ppb	0-15 ppb	SM 18-19 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602756Y CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 07:13A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-77 CLASSROOM 14 BUBBLER

SAMPLE TYPE...: POTABLE

PRESERVATIVES: HNO3

COL'D BY: ANTHONY D. MERLINI

TEMP RECEIVED: 18C

NOTES...:


COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/11/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602756Z CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 07:14A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-78 CLASSRROM 14 SINK

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A


COL'D BY: ANTHONY D. MERLINI
NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/11/16			LEAD (IMS)	<1.0 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602757A CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 07:15A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-79 CLASSROOM 13 BUBBLER

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI


NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/12/16			LEAD (IMS)	10.7 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602757B CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 07:16A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-80 CLASSROOM 13 SINK

SAMPLE TYPE.: POTABLE

PRESERVATIVES: HNO3

COL'D BY: ANTHONY D. MERLINI

TEMP RECEIVED: 18C

NOTES....:

COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/12/16			LEAD (IMS)	1.0 ppb	0-15 ppb	SM 18-19 3113B


COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.

EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY:


Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602757C CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 07:25A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-81 OUTSIDE SINK LT (1)
COL'D BY: ANTHONY D. MERLINI
NOTES...:


SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/12/16			LEAD (IMS)	469 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602757D CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 07:26A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-82 OUTSIDE SINK MIDDLE (2)

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

COL'D BY: ANTHONY D. MERLINI


NOTES....:

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/12/16			LEAD (IMS)	156 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602757E CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 07:27A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-83 OUTSIDE SINK MIDDLE (3)
COL'D BY: ANTHONY D. MERLINI
NOTES...:

SAMPLE TYPE.: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/12/16			LEAD (IMS)	90.9 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602757F CLIENT #: 65142

NON STAT PROC

PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 07:27A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152

SAMPLING SITE: FURNACE WOODS ES
: FW-84 UTSIDE SINK RT (4)
COL'D BY: ANTHONY D. MERLINI
NOTES....:


SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/12/16			LEAD (IMS)	109 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:

Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 

Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323

YML ENVIRONMENTAL SERVICES
321 Kear Street
Yorktown Heights, N.Y. 10598
(914) 245-2800
Albert H. Padovani, Director
** TEST REPORT **

LAB #: 1.602757G CLIENT #: 65142 NON STAT PROC PAGE: 1 of 1

HENDRICK HUDSON SCHOOL
ANTHONY MERLINI
61 TROLLEY ROAD
MONTROSE, NY 10548

DATE/TIME TAKEN: 09/27/16 07:40A
DATE/TIME REC'D: 09/27/16 04:20P
REPORT DATE: 10/14/16
PHONE: (914)-257-5152


SAMPLING SITE: FURNACE WOODS ES
: FW-85 OUTSIDE HOSE BIB LOADING DOCK
COL'D BY: ANTHONY D. MERLINI
NOTES...:

SAMPLE TYPE...: POTABLE
PRESERVATIVES: HNO3
TEMP RECEIVED: 18C
COLIFORM METH: N/A

START DATE/TIME	END DATE/TIME	FLAG	PROCEDURE	RESULT	NORMAL - RANGE	METHOD
10/12/16			LEAD (IMS)	460 ppb	0-15 ppb	SM 18-19 3113B

COMMENTS:
Pb/Cu LEAD limits for public schools are set at 15 ppb.
EPA Lead & Copper Rule for Public Systems requires that no more than 10% of their distribution points have a LEAD value of more than 15 ppb and a COPPER value of 1.3 mg/L, else water treatment must be undertaken to reduce the waters corrosive potential.

THE ABOVE TEST PROCEDURES MEET ALL REQUIREMENTS OF NELAC,
AND RELATE ONLY TO THESE SAMPLES RECEIVED BY THE LAB

SUBMITTED BY: 
Albert H. Padovani, M.T. (ASCP)
Director

ELAP# 10323