

ADDENDUM NO. 1

February 19, 2024

MLA Sherman Elementary School Site Improvements Project

OUSD PROJECT NUMBER 24108

Oakland Unified School District
Facilities Planning & Management
955 High Street, Oakland, CA 94601

The following changes, additions, modifications and corrections hereinafter set forth shall apply to the Bid Documents for the project and shall be made a part thereof and subject to all the requirements thereof, as if originally specified and/or shown.

Addendum No 1

**The Bid Due date will be the same:
Monday February 23rd, 2023 @ 2:00 p.m.**

Dear Bidders,

Please take note of the following amendments to the original document:

Project Schedule:

02/23: Bid Due Date

04/10: Board Approval

05/13: Issue NTP

05/28: Site mobilization and fencing setup

05/28 - 06/07: Demo existing asphalt, play mattings, play structure, and planters

06/03 - 06/12: Wall surface preparations to receive mural(s)

06/10 - 06/19: Prep work for a new nature exploration area

06/14: Slurry coating installation

06/17 - 06/19: Tree installation

06/26 - 06/28: Kaboom Build Week (for reference)

07/01 - 07/12: Play mattings installation

07/15: Play Structure inspection (by others)

07/16: Site demobilization (removal of temporary fence and equipment) and yard pressure washing

07/16: Substantial Completion

Revised Scope of Work:

1. Performed by other(s): GPRS scanning for underground utilities, topographic survey, soil testing.
2. Demo existing play structures and play matting. Approx. 2,500 sqft.
3. Demo existing asphalt layer. Approx. 8,000 sqft
4. Demo existing (4) basketball hoops. Include footings.
5. Installation of a new (2ft x 2ft) square shaped play matting tiles. Approx. 3,000 sqft
6. Installation of new (2) Nature Exploration Area. This includes the following:
 1. Nature Exploration Area #1 (Southwest corner of the property):
 1. Remove 1ft of compacted soil. Approx. 3,000 cubic feet.

2. Furnish and install new ½" irrigation & 3" french drainage systems. Approx. 300 linear feet for each system.
3. Infill with 10" of infill soil and add 2" of compost.
4. Installation of (5) 10ft long trees. Trees furnished by others. For the 10 ft long trees, assume 4ft x 4ft x 4ft hole to be excavated and off hauled of spoils for each tree.
2. Nature Exploration Area #2 (near Soccer Mini Pitch):
 1. Remove 1ft of compacted soil. Approx. 3,000 cubic feet.
 2. Furnish and install new ½" irrigation & 3" french drainage systems. Approx. 300 linear feet for each system.
 3. Infill with 10" of infill soil and add 2" of compost.
 4. Installation of (15) 10ft long trees. Trees furnished by others. For the 10 ft long trees, assume 4ft x 4ft x 4ft hole to be excavated and off hauled of spoils for each tree.
7. Installation of new Garden & Outdoor Classroom. This includes the following:
 1. Install new (10) 10ft long trees. Trees furnished by others.
 2. Furnish and install new irrigation & drainage systems.
8. Install slurry throughout. Approx. 20,000 sqft
9. **ADD ALTERNATE #1** - Wall surface preparations to receive mural(s). Approx. 7,000 sqft surface. This includes the following: Pressure wash surface, wall patching, apply primer, apply top/main coat, muralist fees
10. **ADD ALTERNATE #2** - Demo existing (25) planters.

Inclusions:

1. Area of work must be fenced off to ensure a safe working environment on site. Materials should also be stored within a fenced area.
2. Materials and debris generated during construction must be hauled off site after the work is completed.
3. Must provide your own dumpster.
4. Site must be cleaned after the completion of their work.
5. SofSurfaces play matting tile will be furnished through OUSD. Contractor to only include cost for installation. The date for receiving and staging play matting materials will be coordinated with the Contractor.
6. Must have SofSurfaces play matting installation certification.
7. Post-work inspections will be coordinated with a firm provided by OUSD.
8. Deliveries must be coordinated with OUSD.
9. Include furnishing and installation of (2) root watering systems (RWS) for each tree.
Reference: https://store.rainbird.com/rwsb1401-rain-bird-rws-root-watering-system-36-in-tube-0-25-gpm-bubbler-4-in-grate.html?utm_source=google&utm_medium=cpc&utm_campaign=RainBirdPLA&utm_term=%7Bkeyword%7D .

Reference documents:

1. School yard diagram.
2. GRPS scanning for underground utilities, topographic survey, and soil testing reports.
3. SofSurfaces product literature.
4. Revised Bid Cover Sheet

RECEIPT OF THIS ADDENDUM MUST BE ACKNOWLEDGED ON
THE FORM OF PROPOSAL

BID COVER SHEET
DOCUMENT 00 31 00

OAKLAND UNIFIED SCHOOL DISTRICT
Division of Facilities Planning and Management
955 High Street
Oakland, CA 94601

BIDS MUST BE SEALED AND SUBMITTED TO:

FRONT DESK
955 HIGH STREET
OAKLAND, CA 94601

THIS SHEET MUST BE ATTACHED TO THE FRONT OF YOUR BID ENVELOPE

PLEASE NOTE: BID RESULTS WILL BE MADE AVAILABLE VIA EMAIL.

THANK YOU IN ADVANCE FOR YOUR PATIENCE AND COOPERATION.

Bid for: MLA @ Sherman Elementary School Site Improvements

Project No.: 24108

Bidder:

Please print full (Company Name, Address)


Please provide both: (Phone, Fax)

Bids are due: February 23, 2024, at 2:30 p.m.

(Bid will not be considered if submitted after this date and time)

TIME STAMP HERE:

RECEIVED BY:

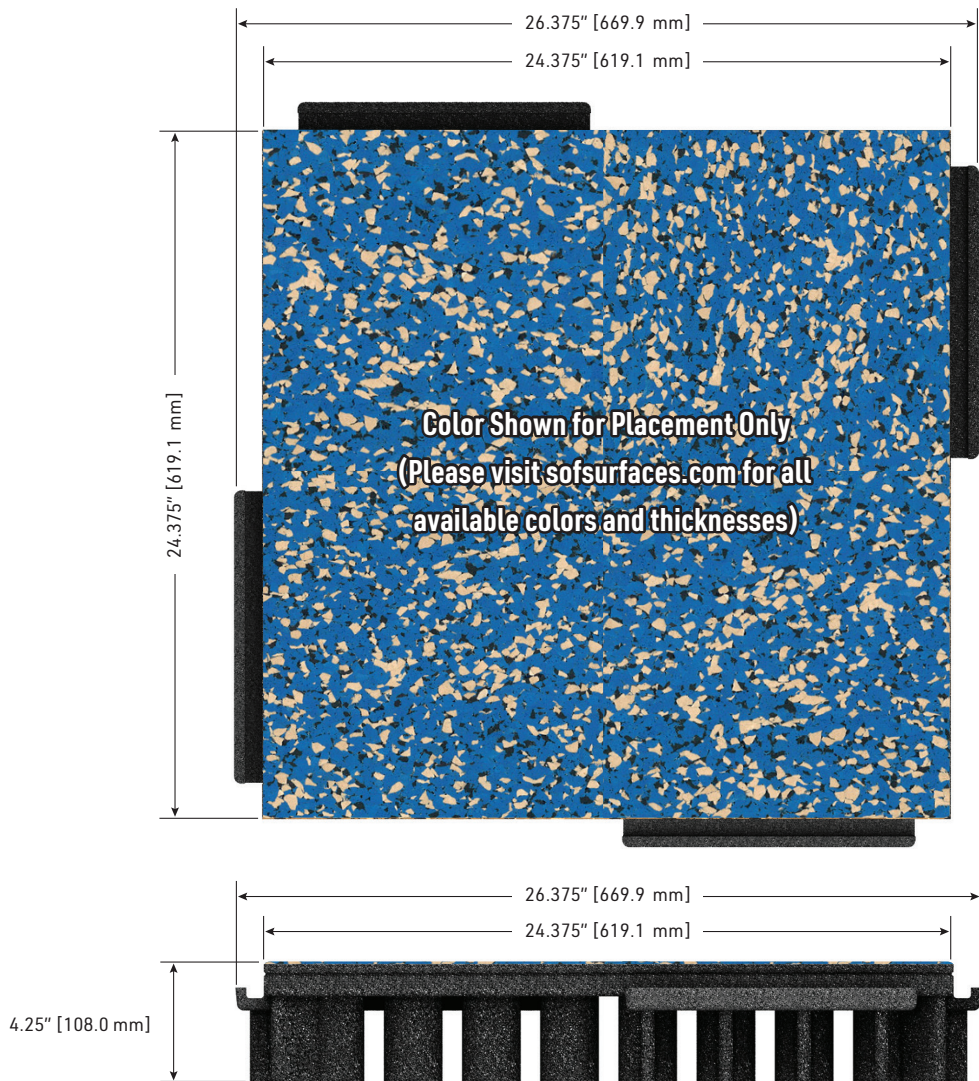

Note: Plus Series and Premium Series Tiles have different manufactured sizes.



Product: Premium 95 Denim
Thickness: 4.25" (108.0 mm)

DURASAFE THICKNESS (in.)	CRITICAL FALL HEIGHT (ft)
2.00" (50.8 mm)	3 Feet (0.91 m)
2.25" (57.2 mm)	4 Feet (1.22 m)
2.75" (69.9 mm)	5 Feet (1.52 m)
3.25" (82.6 mm)	6 Feet (1.83 m)
3.75" (95.3 mm)	7 Feet (2.13 m)
4.25" (108.0 mm)	8 Feet (2.44 m)
4.75" (120.7 mm)	9 Feet (2.74 m)
5.00" (127.0 mm)	10 Feet (3.05 m)
5.25" (133.4 mm)	12 Feet (3.66 m)

Plus Series Mfd. Size: 24.25" x 24.25" (+/- 1/8")

Plus Series Installed Size: 24.00" x 24.00" (24" Centers)

Premium Series Mfd. Size: 24.375" x 24.375" (+/- 1/8")

Premium Series Installed Size: 24.125" x 24.125" (24.125" Centers)



PRODUCT SHOWN
duraSAFE 4.25"

SCENARIO DESCRIPTION
Playgrounds

DATE CREATED
Dec. 2, 2021

PREPARED BY
Brad Goss

SCALE
N/A



REVISION
1

SERIES
Premium95

COLOUR
Denim



FILE NAME
2022_DS_4.25_TileDrawing.pdf

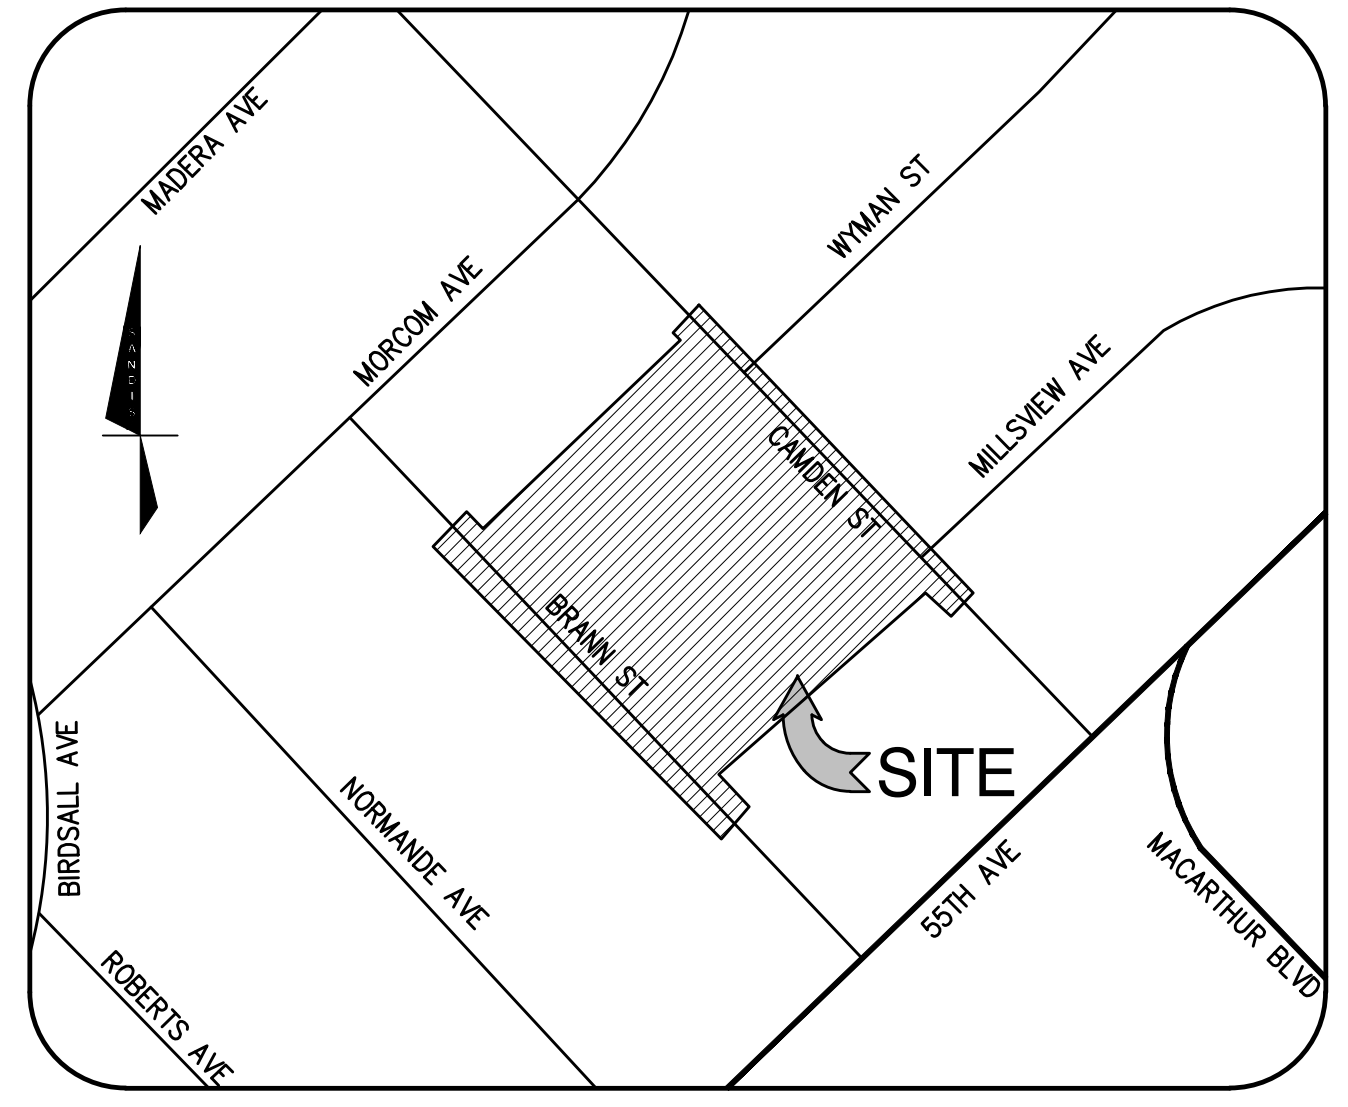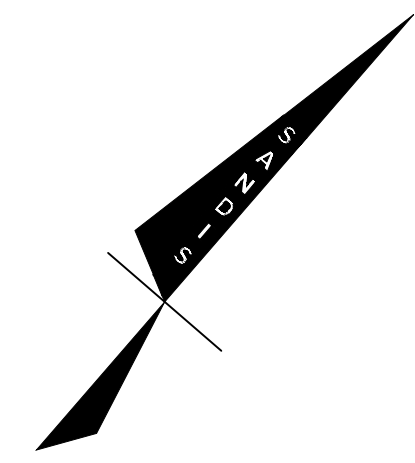

VICINITY MAP

SURVEY NOTES

- ALL DISTANCES AND DIMENSIONS ARE SHOWN IN FEET AND DECIMALS THEREOF.
- DATES OF FIELD SURVEY: 10/20/2022 - 10/24/2022.
- HORIZONTAL WAS BASED ON A GPS SURVEY USING GNSS RTK METHODS CONNECTED TO THE LEICA SMARTNET REAL TIME NETWORK TIED INTO CALIFORNIA STATE PLANE COORDINATES NAD83, EPOCH 2020.750.

LEGEND

- ALL DISTANCES AND DIMENSIONS ARE SHOWN IN FEET AND DECIMALS THEREOF.
- BUILDING FACE
 - BUILDING OVERHANG
 - EDGE OF PAVEMENT
 - CURB LINE
 - CURB & GUTTER LINE
 - RETAINING / SCREENING WALL, HEIGHT AS INDICATED
 - 95
 - 94
 - C-BENCH-L
 - C-DOOR-L
 - C-DWY-L
 - PLAYGROUND MAT
 - ACCESSIBLE RAMP GRADE BREAK/EDGE LINE
 - STEPS
 - FLOW LINE
 - TOP OF SLOPE LINE
 - FENCE LINE, TYPE / HEIGHT AS INDICATED
 - SD
 - SS
 - WTR
 - G
 - E
 - UNK
 - OHE
 - CMN
 -
 - SURVEY CONTROL POINT
 - SURVEY BENCHMARK
 - FOUND SURVEY MONUMENT
 - DRAIN INLET
 - SANITARY SEWER MANHOLE
 - SANITARY SEWER CLEANOUT
 - WATER METER / BOX
 - WATER VALVE
 - WATER VALVE
 - FIRE HYDRANT
 - HOSE BIBB
 - GAS VALVE
 - ELECTRIC VAULT / PULLBOX
 - POWER POLE
 - SPOT ELEVATION
 - TREE WITH DRIPLINE, SIZE AS INDICATED

ABBREVIATIONS


- AD - AREA DRAIN
- BLDC - BUILDING CORNER
- BLDL - BUILDING LINE
- BM - BENCHMARK
- BOW - BOTTOM OF WALL
- BS - BOTTOM OF STAIR
- BW - BACK OF WALK
- CHKSH - SURVEY CHECK SHOT
- CLF - CHAIN LINK FENCE
- COL - COLUMN
- CONC - CONCRETE
- DI - DRAIN INLET
- DW - DOMESTIC WATER
- EP - EDGE OF PAVEMENT
- EPB - ELECTRICAL PULLBOX
- FF - FINISHED FLOOR
- FG@DOOR - FINISHED GRADE AT DOOR
- FH - FIRE HYDRANT
- FL - FLOW LINE
- FND - FOUND SURVEY MONUMENT
- G - GROUND
- GB - GRADE BREAK
- GV - GAS VALVE
- HB - HOSE BIBB
- HCR - ACCESSIBLE RAMP
- IF - IRON FENCE
- LIP - LIP OF GUTTER
- OH - BUILDING OVERHANG
- P - PAVEMENT ELEVATION
- PP - POWER POLE
- RAIL - HANDRAIL / GUARDRAIL
- SSCO - SANITARY SEWER CLEANOUT
- SSMH - SANITARY SEWER MANHOLE
- SW - SIDEWALK
- TC - TOP OF CURB
- TOP - TOP OF SLOPE
- TS - TOP OF STAIR
- VGUT - VALLEY GUTTER
- WF - WOOD FENCE
- WM - WATER METER
- WV - WATER VALVE

UNDERGROUND UTILITY NOTE

THE TYPES, LOCATIONS, SIZES AND/OR DEPTHS OF EXISTING UNDERGROUND UTILITIES AS SHOWN ON THIS TOPOGRAPHIC SURVEY ARE APPROXIMATE AND WERE OBTAINED FROM SOURCES OF VARYING RELIABILITY. ONLY ACTUAL EXCAVATION WILL REVEAL THE TYPES, EXTENT, SIZES, LOCATIONS AND DEPTHS OF SUCH UNDERGROUND UTILITIES. A REASONABLE EFFORT HAS BEEN MADE TO LOCATE AND DELINEATE ALL KNOWN UNDERGROUND UTILITIES. HOWEVER, THE ENGINEER CAN ASSUME NO RESPONSIBILITY FOR THE COMPLETENESS OR ACCURACY OF ITS DELINEATION OF SUCH UNDERGROUND UTILITIES WHICH MAY BE ENCOUNTERED, BUT WHICH ARE NOT SHOWN ON THIS SURVEY.

BENCHMARK

THE ELEVATION REFERENCE FOR THIS SURVEY IS A CITY OF OAKLAND BENCHMARK, BM ID 20/B, STANDARD OAKLAND DISC UNDER STANDARD CASTING IN THE CONCRETE WALK 9 FEET EASTERLY OF THE EAST CURB OF HIGH STREET AND 28 FEET SOUTHERLY OF THE SOUTH CURB OF BROOKDALE AVENUE.
ELEVATION= 112.35 FEET (CITY OF OAKLAND DATUM)

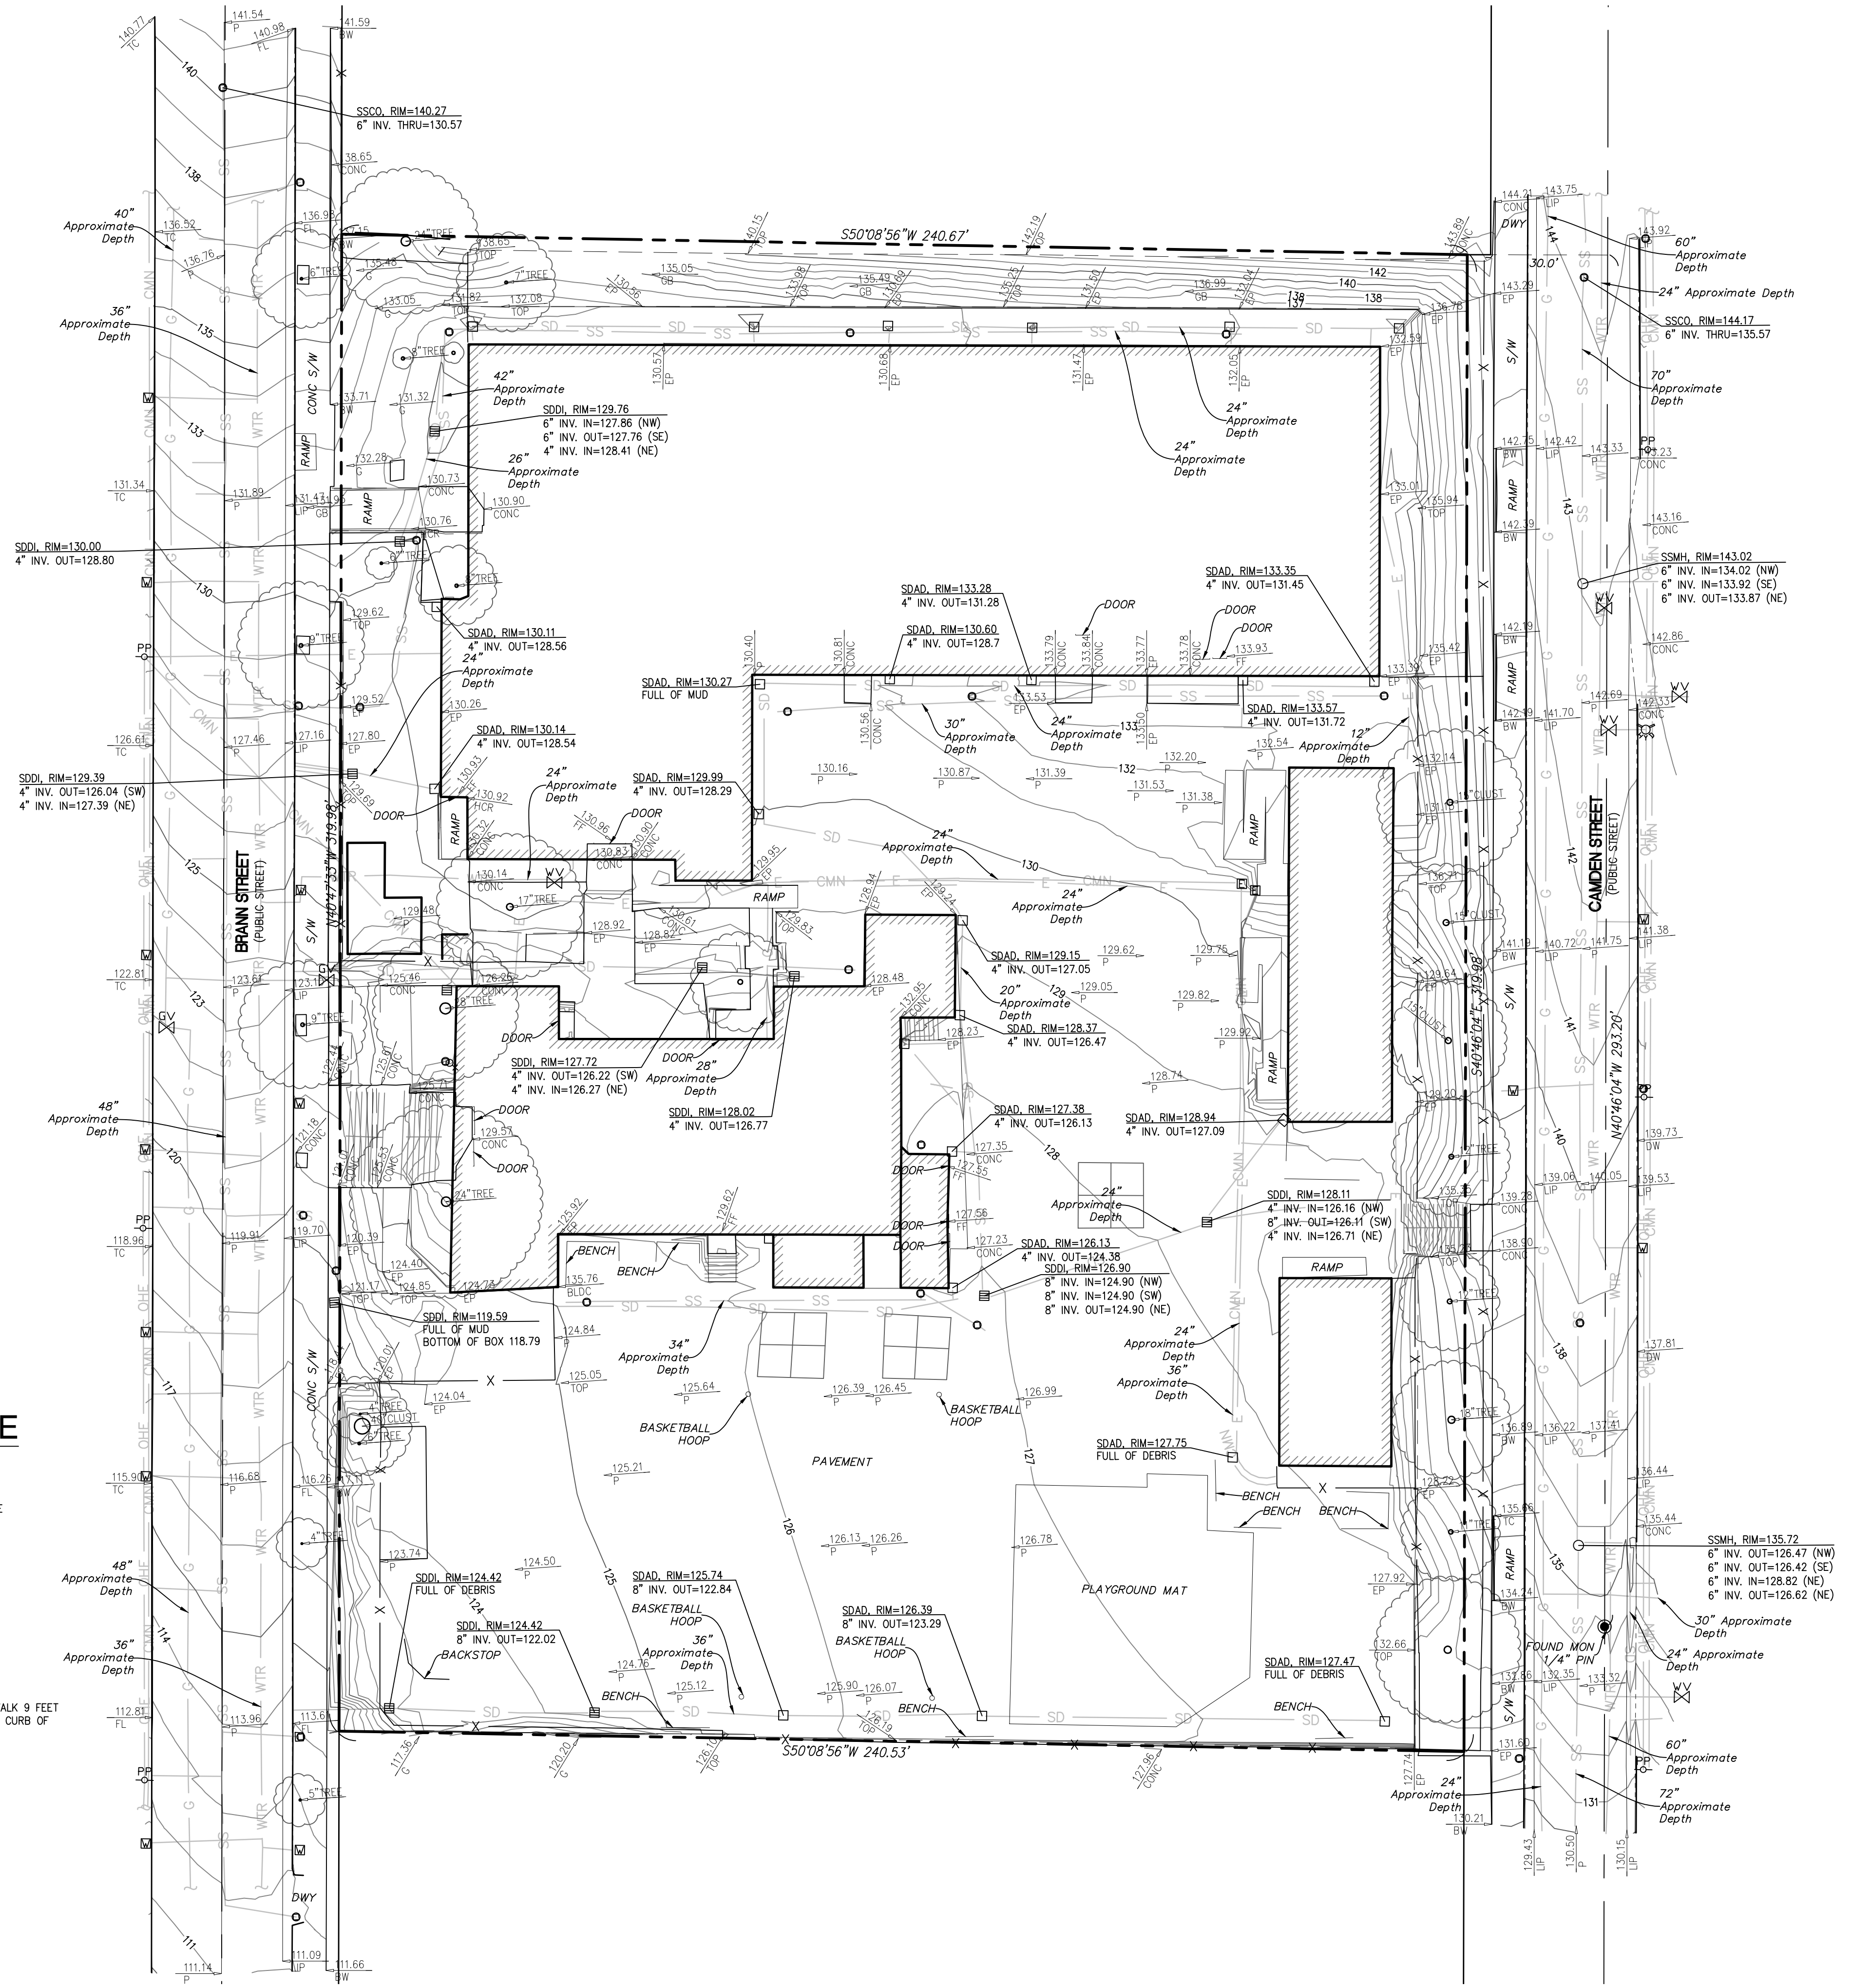

NO PART OF THIS DOCUMENT MAY BE REPRODUCED IN ANY FORM INCLUDING PHOTOCOPY, RECORDING OR ANY INFORMATION RETRIEVABLE AND STORAGE SYSTEM, WITHOUT PERMISSION IN WRITING FROM SANDIS.



BUILD ON.
SANDIS.NET

DATE:	1/4/2023
SCALE:	1"=20'
PROJECT No.:	620124.A

No.	REVISION	DATE	BY

**MELROSE LEADERSHIP ACADEMY
SHERMAN CAMPUS**

OAKLAND

CALIFORNIA

TOPOGRAPHIC SURVEY

SHEET
1
OF 1 SHEETS

Copyright © 2022 by Sandis



February 9, 2024

Oakland Unified School District
955 High Street
Oakland, California 94601

**Re: Soil Characterization
Melrose Leadership Academy (MLA) – Sherman Campus
5328 Brann Street
Oakland, California 94619
ACC Project Number: 3029-332.00**

This letter report presents soil analytical results obtained by ACC Environmental Consultants, Inc. (ACC) for Melrose Leadership Academy – Sherman Campus in Oakland, California (the Site). The purpose of the ACC investigation was to assess shallow on-site soils at the location of proposed playground renovations for lead and arsenic, and to characterize soils with regard to off-site disposal. The scope of soil sampling and chemical analyses for soil off-haul was based on typical landfill criteria for San Francisco Bay area soils.

On December 28, 2023, ACC collected soil samples at four (4) representative locations in the area of the existing asphalt (Figure 1). Soil samples were collected from the first 0.5 foot of soil encountered beneath the asphalt pavement. Engineered baserock was not encountered during this investigation.

Soil samples were collected in steel tubes capped with Teflon sheeting and tight-fitting plastic caps and new Ziploc bags, labeled, logged on a chain-of-custody form, and stored immediately on ice in a cooler pending transport to the laboratory. Soil borings were backfilled with soil cuttings and capped with fast-setting cement subsequent to sampling.

Soil samples were delivered to McCampbell Analytical, Inc. in Pittsburg, California following chain-of-custody protocol. The complete laboratory reports and chain-of-custody are attached as Appendix A. Soil analytical results were compared to Human Health Risk Levels (HHRLs) published by the San Francisco Regional Water Quality Control Board (SFRWQCB) (SFRWQCB ESL Table S-1, 2019 Rev2), and State and Federal hazardous waste criteria. Soil analytical results and corresponding HHRLs are summarized in the attached Tables 1 through 3.

Samples were collected discretely in the field and analyzed discretely for lead and arsenic by

analytical method 6010/6020. Soil samples were additionally composited by the laboratory into one 4:1 composite sample (ACCB1,2,3,4-0.5). Composite samples were analyzed for some or all of the following constituents:

- Total Petroleum Hydrocarbons as gasoline (TPH-g), diesel (TPH-d), and motor oil (TPH-mo) by analytical method 8015;
- Volatile Organic Compounds (VOCs) by analytical method 8260;
- Semi-Volatile Organic Compounds (SVOCs) by analytical method 8270;
- Organochlorine Pesticides (OCPs) by analytical method 8081;
- Polychlorinated Biphenyls (PCBs) by analytical method 8082;
- CAM-17 Metals by analytical method 6010/6020; and
- Asbestos by analytical method CARB 435

TPH: TPH-g, TPH-d, and TPH-mo were detected at respective concentrations of 0.89 J, 24 and 340 milligrams per kilogram (mg/kg), which do not exceed corresponding soil HHRLs. State and Federal hazardous waste criteria are not published for these compounds. Certain analyses, such as petroleum hydrocarbons, are required by landfills despite no published State or Federal hazardous waste criteria.

VOCs: Concentrations of VOCs do not exceed corresponding soil HHRLs or corresponding hazardous waste criteria.

SVOCs: Concentrations of SVOCs do not exceed corresponding soil HHRLs or corresponding hazardous waste criteria.

OCPs: Concentrations of OCPs do not exceed corresponding soil HHRLs or corresponding hazardous waste criteria.

CAM-17 Metals: Metals detected during this sampling event do not exceed SFRWQCB HHRLs for direct exposure at residential properties or direct exposure to construction workers, with the exception of arsenic and lead. Arsenic was detected up to 8.2 mg/kg, which is within typical naturally occurring background concentrations for the San Francisco Bay Area.

Lead was detected in discrete samples up to 630 mg/kg (ACCB2), which exceeds the corresponding direct exposure HHRLs for residential properties of 80 mg/kg and direct exposure to construction workers of 160 mg/kg. Lead was additionally detected above the direct exposure HHRL for residential properties in sample location (ACCB4) at 99 mg/kg. Additional assessment may be warranted if existing hardscape is removed subsequent to completion of site renovations.

Lead was detected at a concentration of 19 mg/kg in the composite sample and does not exceed state or federal hazardous waste criteria.

Additional metals concentrations are within typical naturally occurring background

concentrations for the San Francisco Bay Area and do not present a human health risk or exceed corresponding hazardous waste criteria.

Asbestos: Asbestos was not detected in soil with a reporting limit of 0.25%. No trace concentrations of asbestos were noted in the lab report. Federal and State hazardous waste criteria were not exceeded. HHRLs are not published for asbestos.

PCBs were not detected above laboratory reporting limits in soil during this sampling event.

Prior to soil disturbance at the Site, ACC recommends preparation of an Environmental Health and Safety Plan (EHASP) to address potential worker exposure to lead-impacted soils during asphalt and soil disturbance in the areas of ACCB2 and ACCB4, and to protect site occupants. The generation of airborne dust should be minimized to the extent practical at all times by spraying disturbed soil with water. If visible dust persists, additional dust suppression methods should be conducted (additional water or surfactants). Proper Site security measures should be implemented to prevent students or surrounding residents from accessing exposed soil during renovation activities. Worker health and safety is the responsibility of the corresponding employer.

Additional assessment may be warranted if existing hardscape is removed subsequent to completion of site renovations.

Data indicate that soils within the sampling areas will be classified as non-hazardous waste if hauled off-site to a landfill. The attached data are sufficient for disposal at a landfill.

We appreciate the opportunity to assist you with this project. If you have any questions regarding this report please contact (510) 638-8400 x110 or isutherland@accenv.com.

Sincerely,
ACC ENVIRONMENTAL CONSULTANTS, INC.



Ian Sutherland, PG
Project Manager

Attachments:

Figure 1 - Site Map with Sampling Locations

Table 1 – Soil Analytical Results Summary (CAM-17 Metals)

Table 2 – Soil Analytical Results Summary (TPH, VOCs, OCPs, PCBs, & Asbestos)

Table 3 – Soil Analytical Results Summary (SVOCs)

Appendix A – Complete Laboratory Reports and Chain-of-Custody

Limitations

The service performed by ACC has been conducted in a manner consistent with the levels of care and skill ordinarily exercised by members of our profession currently practicing under similar conditions in the area. No other warranty, expressed or implied, is made.

The conclusions presented in this report are professional opinions based on the indicated data described in this report and applicable regulations and guidelines currently in place. They are intended only for the purpose, site, and project indicated. Opinions and recommendations presented herein apply to site conditions existing at the time of our study. Site conditions and regulations could change over time.

FIGURE 1



BASEMAP SOURCE: GOOGLE EARTH (1.9.24)

ALL DIMENSIONS & LOCATIONS APPROXIMATE

Scale (Feet): 0 50 100

= ACC Sample Location (2023)



FIGURE 1

SITE MAP WITH SAMPLING LOCATIONS

PROPOSED RENOVATIONS

ACC NO: 3029-332.00

DATE: 1.9.24

DRAWN BY: KB

MELROSE LEADERSHIP ACADEMY-SHERMAN CAMPUS
5328 BRANN STREET
OAKLAND, CALIFORNIA

TABLES 1-3

TABLE 1
Soil Analytical Results Summary (Metals)
Melrose Leadership Academy - Sherman Campus, 5328 Brann Street, Oakland, California
ACC Project Number: 3029-332.00

Sample Date	Sample ID	Chemical Compound & Concentrations (mg/kg)																
		Antimony	Arsenic	Barium	Beryllium	Cadmium	Chromium	Cobalt	Copper	Lead	Mercury	Molybdenum	Nickel	Selenium	Silver	Thallium	Vanadium	Zinc
12.28.2023	ACCB1-0.5	--	4.8	--	--	--	--	--	--	8.8	--	--	--	--	--	--	--	--
	ACCB2-0.5	--	4.5	--	--	--	--	--	--	630	--	--	--	--	--	--	--	--
	ACCB3-0.5	--	4.0	--	--	--	--	--	--	12	--	--	--	--	--	--	--	--
	ACCB4-0.5	--	8.2	--	--	--	--	--	--	99	--	--	--	--	--	--	--	--
	ACCB1/2/3/4-0.5	0.40 J	4.3	220	0.27 J	0.14 J	32	11	39	19	0.073	0.44 J	35	<0.50	0.71	0.090 J	45	55
HHRLs - Soil Direct Exposure (Table SS-1; Residential)		11	0.067	15000	16	78	12000	23	3100	80	13	390	820	390	390	0.78	390	23000
HHRLs - Soil Direct Exposure (Table SS-1; Construction Worker)		50	0.98	3000	27	51	53000	28	14000	160	44	1800	86	1700	1800	3.5	470	110000
CA Title 22 Hazardous Waste Threshold (TTLC) (mg/kg)		500	500	10,000	75	100	2,500	8,000	2,500	1,000	20	3,500	2,000	100	500	700	2,400	5,000
Concentration at which STLC is required per CA Title 22 (mg/kg)		150	50	1000	7.5	10	50	800	250	50	2	3500	200	10	50	70	240	2,500
STLC Regulatory Limit - Hazardous Threshold per CA Title 22 (mg/L)		15	5	100	0.75	1	5	80	25	5	0.2	350	20	1	5	7	24	250
Concentration at which TCLP is required per RCRA (mg/kg)		--	100	2000	--	20	100	--	--	100	4	--	--	20	100	--	--	--
TCLP Regulatory Limit - Hazardous Threshold per RCRA (mg/L)		--	5	100	--	1	5	--	--	5	0.2	--	--	1	5	--	--	--
<i>Results reported in milligrams per kilogram (mg/kg); HHRLs = Human Health Risk Levels published by the San Francisco Bay Regional Water Quality Control Board (January 2019, REV2); mg/L = milligrams per liter; < = non-detect less than reporting limit; TTLC = Total Threshold Limit Concentration; STLC = Soluble Threshold Limit Concentration; TCLP = Toxicity Characteristic Leaching Procedure; RCRA = Resource Conservation & Recovery Act; See lab report for explanation of data qualifiers (J, m, etc.); -- = not listed, not available, not analyzed, or varies by analyte.</i>																		

TABLE 2
Soils Analytical Results Summary (TPH, VOCs, OCPs, PCBs, and Asbestos)
Melrose Leadership Academy - Sherman Campus, 5328 Brann Street, Oakland, California
ACC Project Number: 3029-332.00

Sample ID	Sample Date	Chemical Compound & Concentrations (mg/kg)																		
		TPH-g (C6 - C12)	TPH-d (C10 - C28)	TPH-mo	Benzene	Methylene chloride	Xylenes, Total	Other VOCs	g-BHC	Chlordane (Technical)	g-Chlordane	g-Chlordane	p,p-DDE	p,p-DDT	Dieldrin	Heptachlor	Hexachlorobenzene	Other OCPs	Total PCBs	Asbestos (%)
ACCB1/B2/B3/B4-0.5	12.28.2023	0.89 J	24	340	0.0025 J	0.015 J	0.0030 J	ND	0.00011 P	0.081	0.0090	0.010	0.0028	0.0050	0.0010	0.00014 P	0.0059	ND	<0.0050	<0.25
HHRLs - Soil Direct Exposure (Table SS-1; Residential)		430	260	12000	0.33	1.9	580	-	-	0.48	0.48	0.48	1.8	1.9	0.037	0.12	0.18	-	0.23	-
HHRLs - Soil Direct Exposure (Table SS-1; Construction Worker)		1800	1100	54,000	33	490	2,400	-	-	14	14	14	57	57	1.1	3.7	7.7	-	5.5	-
<i>Results reported in milligrams per kilogram (mg/kg); TPH = Total Petroleum Hydrocarbons specified as gasoline-range (TPH-g), diesel-range (TPH-d), and motor oil-range (TPH-mo); VOCs = Volatile Organic Compounds; < = non-detect below reporting limit; HHRLs = Human Health Risk Levels published by the San Francisco Bay Regional Water Quality Control Board (January 2019, REV2); -- = not listed, not available, not analyzed, or varies by analyte; See lab report for explanation of data qualifiers (B, J, m, etc.).</i>																				

TABLE 3
Soils Analytical Results Summary (SVOCs)
Melrose Leadership Academy - Sherman Campus, 5328 Brann Street, Oakland, California
ACC Project Number: 3029-332.00

Sample ID	Sample Date	Chemical Compound & Concentrations (mg/kg)									
		Benzo(a)pyrene	Benzo(b)fluoranthene	Benzo(g,h,i)perylene	Benzo (k) fluoranthene	Butylbenzyl Phthalate	Chrysene	Fluoranthene	Indeno (1,2,3-cd) pyrene	Pyrene	Other SVOCs
ACCB1/B2/B3/B4-0.5	12.28.2023	0.040	0.055	0.054	0.026 J	0.20 J	0.043	0.079	0.031 J	0.067	ND
HHRLs - Soil Direct Exposure (Table SS-1; Residential)		0.11	1.1	--	11	--	110	2400	1.1	1800	--
HHRLs - Soil Direct Exposure (Table SS-1; Construction Worker)		10	110	--	910	--	9100	6700	110	5000	--
<i>Results reported in milligrams per kilogram (mg/kg); SVOCs = Semi-volatile organic compounds; < = non-detect below reporting limit; HHRLs = Human Health Risk Levels published by the San Francisco Bay Regional Water Quality Control Board (January 2019, REV2); -- = not listed, not available, not analyzed, or varies by analyte; See lab report for explanation of data qualifiers (B, J, m, etc.).</i>											

APPENDIX A

COMPLETE LABORATORY REPORTS



McC Campbell Analytical, Inc.

"When Quality Counts"

Analytical Report

WorkOrder: 2312K28

Report Created for: ACC Environmental Consultants, Inc.

7977 Capwell Drive , Suite 100
Oakland, CA 94621

Project Contact: Kim Bunting

Project P.O.:

Project: 3029-322.00; MLA Sherman

Project Received: 12/28/2023

Analytical Report reviewed & approved for release on 01/05/2024 by:

Yen Cao

Project Manager

The report shall not be reproduced except in full, without the written approval of the laboratory. The analytical results relate only to the items tested. Results reported conform to the most current NELAP standards, where applicable, unless otherwise stated in a case narrative.





Glossary of Terms & Qualifier Definitions

Client: ACC Environmental Consultants, Inc.

WorkOrder: 2312K28

Project: 3029-322.00; MLA Sherman

Glossary Abbreviation

%D	Serial Dilution Percent Difference
95% Interval	95% Confident Interval
CCV	Continuing Calibration Verification.
CCV REC (%)	% recovery of Continuing Calibration Verification.
CPT	Consumer Product Testing not NELAP Accredited
DF	Dilution Factor
DI WET	(DISTLC) Waste Extraction Test using DI water
DISS	Dissolved (direct analysis of 0.45 µm filtered and acidified water sample)
DLT	Dilution Test (Serial Dilution)
DUP	Duplicate
EDL	Estimated Detection Limit
ERS	External reference sample. Second source calibration verification.
ITEF	International Toxicity Equivalence Factor
LCS	Laboratory Control Sample
LCS2	Second LCS for the batch. Spike level is lower than that for the first LCS; applicable to method 1633.
LQL	Lowest Quantitation Level
MB	Method Blank
MB % Rec	% Recovery of Surrogate in Method Blank, if applicable
MDL	Method Detection Limit ¹
ML	Minimum Level of Quantitation
MS	Matrix Spike
MSD	Matrix Spike Duplicate
NA	Not Applicable
ND	Not detected at or above the indicated MDL or RL
NR	Data Not Reported due to matrix interference or insufficient sample amount.
PDS	Post Digestion Spike
PF	Prep Factor
RD	Relative Difference
RL	Reporting Limit ²
RPD	Relative Percent Difference
RRT	Relative Retention Time
RSD	Relative Standard Deviation
SNR	Surrogate is diluted out of the calibration range
SPK Val	Spike Value

¹ MDL is the minimum measured concentration of a substance that can be reported with 99% confidence that the measured concentration is distinguishable from method blank results. Definition and Procedure for the Determination of the Method Detection Limit, Revision 2, 40CFR, Part 136, Appendix B, EPA 821-R-16-006, December 2016. Values are based upon our default extraction volume/amount and are subject to change.

² RL is the lowest level that can be reliably determined within specified limits of precision and accuracy during routine laboratory operating conditions. (The RL cannot be lower than the lowest calibration standard used in the initial calibration of the instrument and must be greater than the MDL.) Values are based upon our default extraction volume/amount and are subject to change.



Glossary of Terms & Qualifier Definitions

Client: ACC Environmental Consultants, Inc.

WorkOrder: 2312K28

Project: 3029-322.00; MLA Sherman

SPKRef Val	Spike Reference Value
SPLP	Synthetic Precipitation Leachate Procedure
ST	Sorbent Tube
TCLP	Toxicity Characteristic Leachate Procedure
TEQ	Toxicity Equivalents
TNTC	"Too Numerous to Count," greater than 250 colonies observed on the plate.
TZA	TimeZone Net Adjustment for sample collected outside of MAI's UTC.
WET (STLC)	Waste Extraction Test (Soluble Threshold Limit Concentration)



Analytical Report

Client: ACC Environmental Consultants, Inc.
Date Received: 12/28/2023 10:19
Date Prepared: 12/28/2023
Project: 3029-322.00; MLA Sherman

WorkOrder: 2312K28
Extraction Method: SW3050B
Analytical Method: SW6020
Unit: mg/kg

Metals

Client ID	Lab ID	Matrix	Date Collected	Instrument	Batch ID
ACCB1-0.5	2312K28-001A	Soil	12/28/2023 07:25	ICP-MS4 175SMPL.d	284896

Analytes	Result	MDL	RL	DF	Date Analyzed
Arsenic	4.8	0.084	0.50	1	12/30/2023 01:00
Lead	8.8	0.089	0.50	1	12/30/2023 01:00

Surrogates	REC (%)	Limits
Terbium	109	70-130

Analyst(s): DB

Client ID	Lab ID	Matrix	Date Collected	Instrument	Batch ID
ACCB2-0.5	2312K28-002A	Soil	12/28/2023 07:30	ICP-MS4 176SMPL.d	284896

Analytes	Result	MDL	RL	DF	Date Analyzed
Arsenic	4.5	0.084	0.50	1	12/30/2023 01:04
Lead	630	0.89	5.0	10	01/02/2024 12:41

Surrogates	REC (%)	Limits
Terbium	112	70-130
Terbium	106	70-130

Analyst(s): AL, DB

Client ID	Lab ID	Matrix	Date Collected	Instrument	Batch ID
ACCB3-0.5	2312K28-003A	Soil	12/28/2023 07:45	ICP-MS4 177SMPL.d	284896

Analytes	Result	MDL	RL	DF	Date Analyzed
Arsenic	4.0	0.084	0.50	1	12/30/2023 01:08
Lead	12	0.089	0.50	1	12/30/2023 01:08

Surrogates	REC (%)	Limits
Terbium	105	70-130

Analyst(s): DB

(Cont.)



Analytical Report

Client: ACC Environmental Consultants, Inc.
Date Received: 12/28/2023 10:19
Date Prepared: 12/28/2023
Project: 3029-322.00; MLA Sherman

WorkOrder: 2312K28
Extraction Method: SW3050B
Analytical Method: SW6020
Unit: mg/kg

Metals

Client ID	Lab ID	Matrix	Date Collected	Instrument	Batch ID	
ACCB4-0.5	2312K28-004A	Soil	12/28/2023 07:55	ICP-MS4 178SMPL.d	284896	
<u>Analytes</u>	<u>Result</u>		<u>MDL</u>	<u>RL</u>	<u>DF</u>	<u>Date Analyzed</u>
Arsenic	8.2		0.084	0.50	1	12/30/2023 01:12
Lead	99		0.089	0.50	1	12/30/2023 01:12
<u>Surrogates</u>	<u>REC (%)</u>			<u>Limits</u>		
Terbium	105			70-130		12/30/2023 01:12
<u>Analyst(s):</u> DB						



Quality Control Report

Client: ACC Environmental Consultants, Inc.
Date Prepared: 12/28/2023
Date Analyzed: 12/29/2023
Instrument: ICP-MS4
Matrix: Soil
Project: 3029-322.00; MLA Sherman

WorkOrder: 2312K28
BatchID: 284896
Extraction Method: SW3050B
Analytical Method: SW6020
Unit: mg/kg
Sample ID: MB/LCS/LCSD-284896

QC Summary Report for Metals

Analyte	MB Result	MDL	RL	SPK Val	MB SS %REC	MB SS Limits
Arsenic	ND	0.084	0.50	-	-	-
Lead	ND	0.089	0.50	-	-	-
Surrogate Recovery						
Terbium	510			500	102	70-130

Analyte	LCS Result	LCSD Result	SPK Val	LCS %REC	LCSD %REC	LCS/LCSD Limits	RPD	RPD Limit
Arsenic	49	50	50	97	99	75-125	2.10	20
Lead	47	49	50	95	98	75-125	3.16	20
Surrogate Recovery								
Terbium	490	510	500	97	101	70-130	3.81	20



1534 Willow Pass Rd
Pittsburg, CA 94565-1701
(925) 252-9262

CHAIN-OF-CUSTODY RECORD

WorkOrder: 2312K28

ClientCode: ACCE

- WaterTrax
 CLIP
 EDF
 EQuIS
 Dry-Weight
 Email
 HardCopy
 ThirdParty
 J-flag
 Detection Summary
 Excel

Report to:

Kim Bunting
ACC Environmental Consultants, Inc.
7977 Capwell Drive , Suite 100
Oakland, CA 94621
(510) 638-8400 FAX: (510) 638-8404

Email: kbunting@accenv.com; isutherland@accenv.com
cc/3rd Party:
PO:
Project: 3029-322.00; MLA Sherman

Bill to:

Accounts Payable
ACC Environmental Consultants, Inc.
7977 Capwell Drive , Suite 100
Oakland, CA 94621
accenvap@bill.com

Requested TAT: 5 days;

Date Received: 12/28/2023

Date Logged: 12/28/2023

Lab ID	ClientSampID	Matrix	Collection Date	Hold	Requested Tests (See legend below)												
					1	2	3	4	5	6	7	8	9	10	11	12	
2312K28-001	ACCB1-0.5	Soil	12/28/2023 07:25	<input type="checkbox"/>	A	A											
2312K28-002	ACCB2-0.5	Soil	12/28/2023 07:30	<input type="checkbox"/>	A	A											
2312K28-003	ACCB3-0.5	Soil	12/28/2023 07:45	<input type="checkbox"/>	A	A											
2312K28-004	ACCB4-0.5	Soil	12/28/2023 07:55	<input type="checkbox"/>	A	A											

Test Legend:

1	METALSMS_TTLC_S	2	PRDisposal Fee	3		4	
5		6		7		8	
9		10		11		12	

Project Manager: Jennifer Lagerbom

Prepared by: Agustina Venegas

Comments:

NOTE: Soil samples are discarded 60 days after receipt unless other arrangements are made (Water samples are 30 days). Hazardous samples will be returned to client or disposed of at client expense.



WORK ORDER SUMMARY

Client Name: ACC ENVIRONMENTAL CONSULTANTS, INC.

Project: 3029-322.00; MLA Sherman

Work Order: 2312K28

Client Contact: Kim Bunting

QC Level: LEVEL 2

Contact's Email: kbunting@accenv.com; isutherland@accenv.com

Comments:

Date Logged: 12/28/2023

WaterTrax CLIP EDF Excel EQUIS Email HardCopy ThirdParty J-flag

LabID	ClientSampID	Matrix	Test Name	Containers /Composites	Bottle & Preservative	U**	Head Space	Dry-Weight	Collection Date & Time	TAT	Test Due Date	Sediment Content	Hold	Sub Out
001A	ACCB1-0.5	Soil	SW6020 (Metals) <Arsenic, Lead>	1	Plastic Baggie, Small	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	12/28/2023 7:25	5 days	1/5/2024		<input type="checkbox"/>	<input type="checkbox"/>
002A	ACCB2-0.5	Soil	SW6020 (Metals) <Arsenic, Lead>	1	Plastic Baggie, Small	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	12/28/2023 7:30	5 days	1/5/2024		<input type="checkbox"/>	<input type="checkbox"/>
003A	ACCB3-0.5	Soil	SW6020 (Metals) <Arsenic, Lead>	1	Plastic Baggie, Small	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	12/28/2023 7:45	5 days	1/5/2024		<input type="checkbox"/>	<input type="checkbox"/>
004A	ACCB4-0.5	Soil	SW6020 (Metals) <Arsenic, Lead>	1	Plastic Baggie, Small	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	12/28/2023 7:55	5 days	1/5/2024		<input type="checkbox"/>	<input type="checkbox"/>

NOTES: * STLC and TCLP extractions require 2 days to complete; therefore, all TATs begin after the extraction is completed (i.e., One-day TAT yields results in 3 days from sample submission).

- ISM prep requires 5 to 10 days to complete; therefore, all TATs begin after the extraction is completed (i.e., One-day TAT yields results in 6 to 11 days from sample submission). Due date listed on WO summary will not accurately reflect the time needed for sample preparation.

- Organic extracts are held for 40 days before disposal; Inorganic extract are held for 30 days.

- MAI assumes that all material present in the provided sampling container is considered part of the sample - MAI does not exclude any material from the sample prior to sample preparation unless requested in writing by the client.

U** = An unpreserved container was received for a method that suggests a preservation in order to extend hold time for analysis.



Sample Receipt Checklist

Client Name: ACC Environmental Consultants, Inc.
 Project: 3029-322.00; MLA Sherman

Date and Time Received: 12/28/2023 10:19
 Date Logged: 12/28/2023
 Received by: Agustina Venegas
 Logged by: Agustina Venegas

WorkOrder No: 2312K28 Matrix: Soil
 Carrier: Client Drop-In

Chain of Custody (COC) Information

Chain of custody present?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	
Chain of custody signed when relinquished and received?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	
Chain of custody agrees with sample labels?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	
Sample IDs noted by Client on COC?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	
Date and Time of collection noted by Client on COC?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	
Sampler's name noted on COC?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	
COC agrees with Quote?	Yes <input type="checkbox"/>	No <input type="checkbox"/>	NA <input checked="" type="checkbox"/>

Sample Receipt Information

Custody seals intact on shipping container/cooler?	Yes <input type="checkbox"/>	No <input type="checkbox"/>	NA <input checked="" type="checkbox"/>
Custody seals intact on sample bottles?	Yes <input type="checkbox"/>	No <input type="checkbox"/>	NA <input checked="" type="checkbox"/>
Shipping container/cooler in good condition?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	
Samples in proper containers/bottles?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	
Sample containers intact?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	
Sufficient sample volume for indicated test?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	

Sample Preservation and Hold Time (HT) Information

All samples received within holding time?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	NA <input type="checkbox"/>
Samples Received on Ice?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	

(Ice Type: BLUE ICE)

Sample/Temp Blank temperature	Temp: 12.2°C	NA <input type="checkbox"/>	
ZHS conditional analyses: VOA meets zero headspace requirement (VOCs, TPHg/BTEX, RSK)?	Yes <input type="checkbox"/>	No <input type="checkbox"/>	NA <input checked="" type="checkbox"/>
Sample labels checked for correct preservation?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	
pH acceptable upon receipt (Metal: <2; Nitrate 353.2/4500NO3: <2; 522: <4; 218.7: >8)?	Yes <input type="checkbox"/>	No <input type="checkbox"/>	NA <input checked="" type="checkbox"/>

UCMR Samples:

pH tested and acceptable upon receipt (200.7: ≤2; 533: 6 - 8; 537.1: 6 - 8)?	Yes <input type="checkbox"/>	No <input type="checkbox"/>	NA <input checked="" type="checkbox"/>
Free Chlorine tested and acceptable upon receipt (<0.1mg/L) [not applicable to 200.7]?	Yes <input type="checkbox"/>	No <input type="checkbox"/>	NA <input checked="" type="checkbox"/>

 Comments:



McC Campbell Analytical, Inc.

"When Quality Counts"

Analytical Report

WorkOrder: 2312K27

Report Created for: ACC Environmental Consultants, Inc.

7977 Capwell Drive , Suite 100
Oakland, CA 94621

Project Contact: Kim Bunting

Project P.O.:

Project: 3029.332.00; MLA Sherman

Project Received: 12/28/2023

Analytical Report reviewed & approved for release on 01/09/2024 by:

Yen Cao

Project Manager

The report shall not be reproduced except in full, without the written approval of the laboratory. The analytical results relate only to the items tested. Results reported conform to the most current NELAP standards, where applicable, unless otherwise stated in a case narrative.





Glossary of Terms & Qualifier Definitions

Client: ACC Environmental Consultants, Inc.

WorkOrder: 2312K27

Project: 3029.332.00; MLA Sherman

Glossary Abbreviation

%D	Serial Dilution Percent Difference
95% Interval	95% Confident Interval
CCV	Continuing Calibration Verification.
CCV REC (%)	% recovery of Continuing Calibration Verification.
CPT	Consumer Product Testing not NELAP Accredited
DF	Dilution Factor
DI WET	(DISTLC) Waste Extraction Test using DI water
DISS	Dissolved (direct analysis of 0.45 µm filtered and acidified water sample)
DLT	Dilution Test (Serial Dilution)
DUP	Duplicate
EDL	Estimated Detection Limit
ERS	External reference sample. Second source calibration verification.
ITEF	International Toxicity Equivalence Factor
LCS	Laboratory Control Sample
LCS2	Second LCS for the batch. Spike level is lower than that for the first LCS; applicable to method 1633.
LQL	Lowest Quantitation Level
MB	Method Blank
MB % Rec	% Recovery of Surrogate in Method Blank, if applicable
MDL	Method Detection Limit ¹
ML	Minimum Level of Quantitation
MS	Matrix Spike
MSD	Matrix Spike Duplicate
NA	Not Applicable
ND	Not detected at or above the indicated MDL or RL
NR	Data Not Reported due to matrix interference or insufficient sample amount.
PDS	Post Digestion Spike
PF	Prep Factor
RD	Relative Difference
RL	Reporting Limit ²
RPD	Relative Percent Difference
RRT	Relative Retention Time
RSD	Relative Standard Deviation
SNR	Surrogate is diluted out of the calibration range
SPK Val	Spike Value

¹ MDL is the minimum measured concentration of a substance that can be reported with 99% confidence that the measured concentration is distinguishable from method blank results. Definition and Procedure for the Determination of the Method Detection Limit, Revision 2, 40CFR, Part 136, Appendix B, EPA 821-R-16-006, December 2016. Values are based upon our default extraction volume/amount and are subject to change.

² RL is the lowest level that can be reliably determined within specified limits of precision and accuracy during routine laboratory operating conditions. (The RL cannot be lower than the lowest calibration standard used in the initial calibration of the instrument and must be greater than the MDL.) Values are based upon our default extraction volume/amount and are subject to change.



Glossary of Terms & Qualifier Definitions

Client: ACC Environmental Consultants, Inc.

WorkOrder: 2312K27

Project: 3029.332.00; MLA Sherman

SPKRef Val	Spike Reference Value
SPLP	Synthetic Precipitation Leachate Procedure
ST	Sorbent Tube
TCLP	Toxicity Characteristic Leachate Procedure
TEQ	Toxicity Equivalents
TNTC	"Too Numerous to Count," greater than 250 colonies observed on the plate.
TZA	TimeZone Net Adjustment for sample collected outside of MAI's UTC.
WET (STLC)	Waste Extraction Test (Soluble Threshold Limit Concentration)

Analytical Qualifiers

J	Result is less than the RL/ML but greater than the MDL. The reported concentration is an estimated value.
P	Agreement between the quantitative dual-column confirmation results exceed method recommended limits of 40% RPD. The lowest concentration is reported.
S	Surrogate recovery outside accepted recovery limits.
a2	Sample diluted due to cluttered chromatogram.
c1	Surrogate recovery outside of the control limits due to the dilution of the sample.
d7	Strongly aged gasoline or diesel range compounds are significant in the TPH(g) chromatogram.
e2	Diesel range compounds are detected; no recognizable pattern.
e7	Oil range compounds are detected.
k10	CARB 435 Exception 1 - No asbestos detected. The limit of quantitation (LOQ) = 0.25%.

Quality Control Qualifiers

F2	LCS/LCSD recovery and/or RPD/RSD is out of acceptance criteria.
F3	The surrogate standard recovery and/or RPD is outside of acceptance limits.
F5	LCS/LCSD recovery is outside of acceptance limits; however, the data is acceptable based upon the TNI allowable marginal exceedances.



Analytical Report

Client: ACC Environmental Consultants, Inc.
Date Received: 12/28/2023 10:19
Date Prepared: 12/29/2023
Project: 3029.332.00; MLA Sherman

WorkOrder: 2312K27
Extraction Method: SW3550B/3640Am/3630Cm
Analytical Method: SW8081B/8082A
Unit: mg/kg

Organochlorine Pesticides + PCBs w/ Florisil Clean-up

Client ID	Lab ID	Matrix	Date Collected	Instrument	Batch ID
ACCB1/2/3/4-0.5	2312K27-001A	Soil	12/28/2023 07:55	GC23 12292343.d	285049

Analytes	Result	Qualifiers	MDL	RL	DF	Date Analyzed
Aldrin	ND		0.000047	0.00010	1	12/29/2023 23:58
a-BHC	ND		0.000045	0.00010	1	12/29/2023 23:58
b-BHC	ND		0.000038	0.00010	1	12/29/2023 23:58
d-BHC	ND		0.000040	0.00010	1	12/29/2023 23:58
g-BHC	0.00011	P	0.000056	0.00010	1	12/29/2023 23:58
Chlordane (Technical)	0.081		0.0032	0.0050	2	01/02/2024 15:13
a-Chlordane	0.0090		0.000039	0.00010	1	12/29/2023 23:58
g-Chlordane	0.010		0.000043	0.00010	1	12/29/2023 23:58
p,p-DDD	ND		0.000041	0.00010	1	12/29/2023 23:58
p,p-DDE	0.0028		0.000047	0.00010	1	12/29/2023 23:58
p,p-DDT	0.0050		0.000069	0.00010	1	12/29/2023 23:58
Dieldrin	0.0010		0.000066	0.00010	1	12/29/2023 23:58
Endosulfan I	ND		0.000038	0.00010	1	12/29/2023 23:58
Endosulfan II	ND		0.000059	0.00010	1	12/29/2023 23:58
Endosulfan sulfate	ND		0.000035	0.00010	1	12/29/2023 23:58
Endrin	ND		0.000088	0.00010	1	12/29/2023 23:58
Endrin aldehyde	ND		0.000049	0.00010	1	12/29/2023 23:58
Endrin ketone	ND		0.000083	0.00010	1	12/29/2023 23:58
Heptachlor	0.00014	P	0.000064	0.00010	1	12/29/2023 23:58
Heptachlor epoxide	ND		0.000029	0.00010	1	12/29/2023 23:58
Hexachlorobenzene	0.0059		0.000077	0.0010	1	12/29/2023 23:58
Hexachlorocyclopentadiene	ND		0.00031	0.0020	1	12/29/2023 23:58
Methoxychlor	ND		0.000092	0.00020	1	12/29/2023 23:58
Toxaphene	ND		0.0045	0.010	1	12/29/2023 23:58
Aroclor1016	ND		0.0020	0.0050	1	12/29/2023 23:58
Aroclor1221	ND		0.0020	0.0050	1	12/29/2023 23:58
Aroclor1232	ND		0.0020	0.0050	1	12/29/2023 23:58
Aroclor1242	ND		0.0020	0.0050	1	12/29/2023 23:58
Aroclor1248	ND		0.0020	0.0050	1	12/29/2023 23:58
Aroclor1254	ND		0.0020	0.0050	1	12/29/2023 23:58
Aroclor1260	ND		0.0020	0.0050	1	12/29/2023 23:58
PCBs, total	ND		NA	0.0050	1	12/29/2023 23:58

(Cont.)



Analytical Report

Client: ACC Environmental Consultants, Inc.
Date Received: 12/28/2023 10:19
Date Prepared: 12/29/2023
Project: 3029.332.00; MLA Sherman

WorkOrder: 2312K27
Extraction Method: SW3550B/3640Am/3630Cm
Analytical Method: SW8081B/8082A
Unit: mg/kg

Organochlorine Pesticides + PCBs w/ Florisil Clean-up

Client ID	Lab ID	Matrix	Date Collected	Instrument	Batch ID
ACCB1/2/3/4-0.5	2312K27-001A	Soil	12/28/2023 07:55	GC23 12292343.d	285049

<u>Analytes</u>	<u>Result</u>	<u>Qualifiers</u>	<u>MDL</u>	<u>RL</u>	<u>DF</u>	<u>Date Analyzed</u>
-----------------	---------------	-------------------	------------	-----------	-----------	----------------------

<u>Surrogates</u>	<u>REC (%)</u>	<u>Limits</u>
Decachlorobiphenyl	94	20-145

Analyst(s): CN Analytical Comments: a2



Analytical Report

Client: ACC Environmental Consultants, Inc.
Date Received: 12/28/2023 10:19
Date Prepared: 12/28/2023
Project: 3029.332.00; MLA Sherman

WorkOrder: 2312K27
Extraction Method: SW5030B
Analytical Method: SW8260B
Unit: mg/kg

Volatile Organics

Client ID	Lab ID	Matrix	Date Collected			Instrument	Batch ID
ACCB1/2/3/4-0.5	2312K27-001A	Soil	12/28/2023 07:55			GC49 12292316.D	284970
Analytes	Result	Qualifiers	MDL	RL	DF	Date Analyzed	
Acetone	ND		0.12	0.20	1	12/29/2023 17:40	
tert-Amyl methyl ether (TAME)	ND		0.0012	0.0050	1	12/29/2023 17:40	
Benzene	0.0025	J	0.00095	0.0050	1	12/29/2023 17:40	
Bromobenzene	ND		0.0012	0.0050	1	12/29/2023 17:40	
Bromochloromethane	ND		0.0011	0.0050	1	12/29/2023 17:40	
Bromodichloromethane	ND		0.00023	0.0050	1	12/29/2023 17:40	
Bromoform	ND		0.0038	0.0050	1	12/29/2023 17:40	
Bromomethane	ND		0.0018	0.0050	1	12/29/2023 17:40	
2-Butanone (MEK)	ND		0.040	0.10	1	12/29/2023 17:40	
t-Butyl alcohol (TBA)	ND		0.024	0.050	1	12/29/2023 17:40	
n-Butyl benzene	ND		0.0016	0.0050	1	12/29/2023 17:40	
sec-Butyl benzene	ND		0.0018	0.0050	1	12/29/2023 17:40	
tert-Butyl benzene	ND		0.0021	0.0050	1	12/29/2023 17:40	
Carbon Disulfide	ND		0.0011	0.0050	1	12/29/2023 17:40	
Carbon Tetrachloride	ND		0.00017	0.0050	1	12/29/2023 17:40	
Chlorobenzene	ND		0.0012	0.0050	1	12/29/2023 17:40	
Chloroethane	ND		0.0017	0.0050	1	12/29/2023 17:40	
Chloroform	ND		0.00032	0.0050	1	12/29/2023 17:40	
Chloromethane	ND		0.0017	0.0050	1	12/29/2023 17:40	
2-Chlorotoluene	ND		0.0016	0.0050	1	12/29/2023 17:40	
4-Chlorotoluene	ND		0.0013	0.0050	1	12/29/2023 17:40	
Dibromochloromethane	ND		0.00040	0.0050	1	12/29/2023 17:40	
1,2-Dibromo-3-chloropropane	ND		0.00048	0.00050	1	12/29/2023 17:40	
1,2-Dibromoethane (EDB)	ND		0.00013	0.00025	1	12/29/2023 17:40	
Dibromomethane	ND		0.0012	0.0050	1	12/29/2023 17:40	
1,2-Dichlorobenzene	ND		0.0017	0.0050	1	12/29/2023 17:40	
1,3-Dichlorobenzene	ND		0.0015	0.0050	1	12/29/2023 17:40	
1,4-Dichlorobenzene	ND		0.0015	0.0050	1	12/29/2023 17:40	
Dichlorodifluoromethane	ND		0.00063	0.0050	1	12/29/2023 17:40	
1,1-Dichloroethane	ND		0.0015	0.0050	1	12/29/2023 17:40	
1,2-Dichloroethane (1,2-DCA)	ND		0.000070	0.00010	1	12/29/2023 17:40	
1,1-Dichloroethene	ND		0.00011	0.0050	1	12/29/2023 17:40	
cis-1,2-Dichloroethene	ND		0.0012	0.0050	1	12/29/2023 17:40	
trans-1,2-Dichloroethene	ND		0.0012	0.0050	1	12/29/2023 17:40	
1,2-Dichloropropane	ND		0.0013	0.0050	1	12/29/2023 17:40	
1,3-Dichloropropane	ND		0.00088	0.0050	1	12/29/2023 17:40	

(Cont.)



Analytical Report

Client: ACC Environmental Consultants, Inc.
Date Received: 12/28/2023 10:19
Date Prepared: 12/28/2023
Project: 3029.332.00; MLA Sherman

WorkOrder: 2312K27
Extraction Method: SW5030B
Analytical Method: SW8260B
Unit: mg/kg

Volatile Organics

Client ID	Lab ID	Matrix	Date Collected			Instrument	Batch ID
ACCB1/2/3/4-0.5	2312K27-001A	Soil	12/28/2023 07:55			GC49 12292316.D	284970
Analytes	Result	Qualifiers	MDL	RL	DF	Date Analyzed	
2,2-Dichloropropane	ND		0.0019	0.0050	1	12/29/2023 17:40	
1,1-Dichloropropene	ND		0.0018	0.0050	1	12/29/2023 17:40	
cis-1,3-Dichloropropene	ND		0.00098	0.0050	1	12/29/2023 17:40	
trans-1,3-Dichloropropene	ND		0.00097	0.0050	1	12/29/2023 17:40	
Diisopropyl ether (DIPE)	ND		0.0018	0.0050	1	12/29/2023 17:40	
Ethylbenzene	ND		0.0011	0.0050	1	12/29/2023 17:40	
Ethyl tert-butyl ether (ETBE)	ND		0.0014	0.0050	1	12/29/2023 17:40	
Freon 113	ND		0.0011	0.0050	1	12/29/2023 17:40	
Hexachlorobutadiene	ND		0.0012	0.0050	1	12/29/2023 17:40	
Hexachloroethane	ND		0.00064	0.0050	1	12/29/2023 17:40	
2-Hexanone	ND		0.0027	0.0050	1	12/29/2023 17:40	
Isopropylbenzene	ND		0.0018	0.0050	1	12/29/2023 17:40	
4-Isopropyl toluene	ND		0.0019	0.0050	1	12/29/2023 17:40	
Methyl-t-butyl ether (MTBE)	ND		0.0015	0.0050	1	12/29/2023 17:40	
Methylene chloride	0.015	J	0.012	0.020	1	12/29/2023 17:40	
4-Methyl-2-pentanone (MIBK)	ND		0.0017	0.0050	1	12/29/2023 17:40	
Naphthalene	ND		0.0030	0.0050	1	12/29/2023 17:40	
n-Propyl benzene	ND		0.0019	0.0050	1	12/29/2023 17:40	
Styrene	ND		0.0014	0.0050	1	12/29/2023 17:40	
1,1,1,2-Tetrachloroethane	ND		0.0013	0.0050	1	12/29/2023 17:40	
1,1,2,2-Tetrachloroethane	ND		0.00044	0.0050	1	12/29/2023 17:40	
Tetrachloroethene	ND		0.00029	0.0050	1	12/29/2023 17:40	
Toluene	ND		0.0016	0.0050	1	12/29/2023 17:40	
1,2,3-Trichlorobenzene	ND		0.0021	0.0050	1	12/29/2023 17:40	
1,2,4-Trichlorobenzene	ND		0.0016	0.0050	1	12/29/2023 17:40	
1,1,1-Trichloroethane	ND		0.0016	0.0050	1	12/29/2023 17:40	
1,1,2-Trichloroethane	ND		0.0012	0.0050	1	12/29/2023 17:40	
Trichloroethene	ND		0.0014	0.0050	1	12/29/2023 17:40	
Trichlorofluoromethane	ND		0.0013	0.0050	1	12/29/2023 17:40	
1,2,3-Trichloropropane	ND		0.00017	0.00025	1	12/29/2023 17:40	
1,2,4-Trimethylbenzene	ND		0.0016	0.0050	1	12/29/2023 17:40	
1,3,5-Trimethylbenzene	ND		0.0017	0.0050	1	12/29/2023 17:40	
Vinyl Chloride	ND		0.00012	0.00025	1	12/29/2023 17:40	
m,p-Xylene	0.0030	J	0.0026	0.0050	1	12/29/2023 17:40	
o-Xylene	ND		0.0014	0.0050	1	12/29/2023 17:40	
Xylenes, Total	0.0030	J	NA	0.0050	1	12/29/2023 17:40	

(Cont.)



Analytical Report

Client: ACC Environmental Consultants, Inc.
Date Received: 12/28/2023 10:19
Date Prepared: 12/28/2023
Project: 3029.332.00; MLA Sherman

WorkOrder: 2312K27
Extraction Method: SW5030B
Analytical Method: SW8260B
Unit: mg/kg

Volatile Organics

Client ID	Lab ID	Matrix	Date Collected	Instrument	Batch ID
ACCB1/2/3/4-0.5	2312K27-001A	Soil	12/28/2023 07:55	GC49 12292316.D	284970

Analytes	Result	Qualifiers	MDL	RL	DF	Date Analyzed
<u>Surrogates</u>	<u>REC (%)</u>			<u>Limits</u>		
Dibromofluoromethane	98			70-140		12/29/2023 17:40
Toluene-d8	110			70-140		12/29/2023 17:40
4-BFB	101			70-140		12/29/2023 17:40
Benzene-d6	97			50-140		12/29/2023 17:40
Ethylbenzene-d10	103			50-140		12/29/2023 17:40
1,2-DCB-d4	66			40-140		12/29/2023 17:40

Analyst(s): PRE



Analytical Report

Client: ACC Environmental Consultants, Inc.
Date Received: 12/28/2023 10:19
Date Prepared: 12/29/2023
Project: 3029.332.00; MLA Sherman

WorkOrder: 2312K27
Extraction Method: SW3550B/3640A
Analytical Method: SW8270E
Unit: mg/Kg

Semi-Volatile Organics (Low Level) with GPC Cleanup

Client ID	Lab ID	Matrix	Date Collected			Instrument	Batch ID
ACCB1/2/3/4-0.5	2312K27-001A	Soil	12/28/2023 07:55			GC47 01022406.D	285016
Analytes	Result	Qualifiers	MDL	RL	DF	Date Analyzed	
2,3,4,6-Tetrachlorophenol	ND		3.0	5.0	20	01/02/2024 10:53	
Benzoic Acid	ND		12	25	20	01/02/2024 10:53	
Acenaphthene	ND		0.0088	0.026	20	01/02/2024 10:53	
Acenaphthylene	ND		0.0046	0.026	20	01/02/2024 10:53	
Acetochlor	ND		2.2	5.0	20	01/02/2024 10:53	
Anthracene	ND		0.012	0.026	20	01/02/2024 10:53	
Benzidine	ND		8.0	25	20	01/02/2024 10:53	
Benzo (a) anthracene	ND		0.060	0.25	20	01/02/2024 10:53	
Benzo (a) pyrene	0.040		0.016	0.026	20	01/02/2024 10:53	
Benzo (b) fluoranthene	0.055		0.022	0.050	20	01/02/2024 10:53	
Benzo (g,h,i) perylene	0.054		0.017	0.050	20	01/02/2024 10:53	
Benzo (k) fluoranthene	0.026	J	0.024	0.050	20	01/02/2024 10:53	
Benzyl Alcohol	ND		15	25	20	01/02/2024 10:53	
1,1-Biphenyl	ND		0.11	0.25	20	01/02/2024 10:53	
Bis (2-chloroethoxy) Methane	ND		2.6	5.0	20	01/02/2024 10:53	
Bis (2-chloroethyl) Ether	ND		0.0066	0.026	20	01/02/2024 10:53	
Bis (2-chloroisopropyl) Ether	ND		0.025	0.050	20	01/02/2024 10:53	
Bis (2-ethylhexyl) Adipate	ND		3.6	5.0	20	01/02/2024 10:53	
Bis (2-ethylhexyl) Phthalate	ND		0.16	1.2	20	01/02/2024 10:53	
4-Bromophenyl Phenyl Ether	ND		2.4	5.0	20	01/02/2024 10:53	
Butylbenzyl Phthalate	0.20	J	0.11	1.2	20	01/02/2024 10:53	
4-Chloroaniline	ND		0.020	0.026	20	01/02/2024 10:53	
4-Chloro-3-methylphenol	ND		2.6	5.0	20	01/02/2024 10:53	
2-Chloronaphthalene	ND		2.4	5.0	20	01/02/2024 10:53	
2-Chlorophenol	ND		0.12	0.25	20	01/02/2024 10:53	
4-Chlorophenyl Phenyl Ether	ND		2.4	5.0	20	01/02/2024 10:53	
Chrysene	0.043		0.015	0.026	20	01/02/2024 10:53	
Dibenzo (a,h) anthracene	ND		0.026	0.050	20	01/02/2024 10:53	
Dibenzofuran	ND		0.0064	0.026	20	01/02/2024 10:53	
Di-n-butyl Phthalate	ND		0.14	1.2	20	01/02/2024 10:53	
1,2-Dichlorobenzene	ND		2.8	5.0	20	01/02/2024 10:53	
1,3-Dichlorobenzene	ND		2.6	5.0	20	01/02/2024 10:53	
1,4-Dichlorobenzene	ND		2.4	5.0	20	01/02/2024 10:53	
3,3-Dichlorobenzidine	ND		0.018	0.026	20	01/02/2024 10:53	
2,4-Dichlorophenol	ND		0.025	0.050	20	01/02/2024 10:53	
Diethyl Phthalate	ND		0.11	0.25	20	01/02/2024 10:53	

(Cont.)



Analytical Report

Client: ACC Environmental Consultants, Inc.
Date Received: 12/28/2023 10:19
Date Prepared: 12/29/2023
Project: 3029.332.00; MLA Sherman

WorkOrder: 2312K27
Extraction Method: SW3550B/3640A
Analytical Method: SW8270E
Unit: mg/Kg

Semi-Volatile Organics (Low Level) with GPC Cleanup

Client ID	Lab ID	Matrix	Date Collected	Instrument	Batch ID
ACCB1/2/3/4-0.5	2312K27-001A	Soil	12/28/2023 07:55	GC47 01022406.D	285016

Analytes	Result	Qualifiers	MDL	RL	DF	Date Analyzed
2,4-Dimethylphenol	ND		2.2	5.0	20	01/02/2024 10:53
Dimethyl Phthalate	ND		0.020	0.050	20	01/02/2024 10:53
4,6-Dinitro-2-methylphenol	ND		11	25	20	01/02/2024 10:53
2,4-Dinitrophenol	ND		2.2	5.0	20	01/02/2024 10:53
2,4-Dinitrotoluene	ND		0.0082	0.25	20	01/02/2024 10:53
2,6-Dinitrotoluene	ND		0.16	0.25	20	01/02/2024 10:53
Di-n-octyl Phthalate	ND		6.2	12	20	01/02/2024 10:53
1,2-Diphenylhydrazine	ND		2.2	5.0	20	01/02/2024 10:53
Fluoranthene	0.079		0.015	0.050	20	01/02/2024 10:53
Fluorene	ND		0.016	0.050	20	01/02/2024 10:53
Hexachlorobenzene	ND		0.0076	0.026	20	01/02/2024 10:53
Hexachlorobutadiene	ND		0.0056	0.026	20	01/02/2024 10:53
Hexachlorocyclopentadiene	ND		13	25	20	01/02/2024 10:53
Hexachloroethane	ND		0.012	0.050	20	01/02/2024 10:53
Indeno (1,2,3-cd) pyrene	0.031	J	0.028	0.050	20	01/02/2024 10:53
Isophorone	ND		1.1	5.0	20	01/02/2024 10:53
1-Methylnaphthalene	ND		0.0070	0.026	20	01/02/2024 10:53
2-Methylnaphthalene	ND		0.0088	0.026	20	01/02/2024 10:53
2-Methylphenol (o-Cresol)	ND		3.0	5.0	20	01/02/2024 10:53
3 & 4-Methylphenol (m,p-Cresol)	ND		2.8	5.0	20	01/02/2024 10:53
Naphthalene	ND		0.0084	0.050	20	01/02/2024 10:53
2-Nitroaniline	ND		12	25	20	01/02/2024 10:53
3-Nitroaniline	ND		15	25	20	01/02/2024 10:53
4-Nitroaniline	ND		13	25	20	01/02/2024 10:53
Nitrobenzene	ND		2.8	5.0	20	01/02/2024 10:53
2-Nitrophenol	ND		13	25	20	01/02/2024 10:53
4-Nitrophenol	ND		14	25	20	01/02/2024 10:53
N-Nitrosodimethylamine	ND		12	25	20	01/02/2024 10:53
N-Nitrosodiphenylamine	ND		2.2	5.0	20	01/02/2024 10:53
N-Nitrosodi-n-propylamine	ND		2.8	5.0	20	01/02/2024 10:53
Pentachlorophenol	ND		0.64	1.2	20	01/02/2024 10:53
Phenanthrene	ND		0.020	0.026	20	01/02/2024 10:53
Phenol	ND		0.064	0.20	20	01/02/2024 10:53
Pyrene	0.067		0.013	0.026	20	01/02/2024 10:53
Pyridine	ND		1.9	5.0	20	01/02/2024 10:53
1,2,4-Trichlorobenzene	ND		2.6	5.0	20	01/02/2024 10:53

(Cont.)



Analytical Report

Client: ACC Environmental Consultants, Inc.
Date Received: 12/28/2023 10:19
Date Prepared: 12/29/2023
Project: 3029.332.00; MLA Sherman

WorkOrder: 2312K27
Extraction Method: SW3550B/3640A
Analytical Method: SW8270E
Unit: mg/Kg

Semi-Volatile Organics (Low Level) with GPC Cleanup

Client ID	Lab ID	Matrix	Date Collected	Instrument	Batch ID
ACCB1/2/3/4-0.5	2312K27-001A	Soil	12/28/2023 07:55	GC47 01022406.D	285016

Analytes	Result	Qualifiers	MDL	RL	DF	Date Analyzed
2,4,5-Trichlorophenol	ND		0.013	0.050	20	01/02/2024 10:53
2,4,6-Trichlorophenol	ND		0.012	0.050	20	01/02/2024 10:53

Surrogates	REC (%)	Qualifiers	Limits	Date Analyzed
2-Fluorophenol	54	S	60-130	01/02/2024 10:53
Phenol-d5	53	S	60-130	01/02/2024 10:53
Nitrobenzene-d5	59	S	60-130	01/02/2024 10:53
2-Fluorobiphenyl	63		60-130	01/02/2024 10:53
2,4,6-Tribromophenol	32	S	50-130	01/02/2024 10:53
4-Terphenyl-d14	92		50-130	01/02/2024 10:53

Analyst(s): MV

Analytical Comments: c1



Analytical Report

Client: ACC Environmental Consultants, Inc.
Date Received: 12/28/2023 10:19
Date Prepared: 12/28/2023
Project: 3029.332.00; MLA Sherman

WorkOrder: 2312K27
Extraction Method: SW3050B
Analytical Method: SW6020
Unit: mg/Kg

CAM / CCR 17 Metals

Client ID	Lab ID	Matrix	Date Collected	Instrument	Batch ID
ACCB1/2/3/4-0.5	2312K27-001A	Soil	12/28/2023 07:55	ICP-MS4 174SMPL.d	284896

Analytes	Result	Qualifiers	MDL	RL	DF	Date Analyzed
Antimony	0.40	J	0.10	0.50	1	12/30/2023 00:56
Arsenic	4.3		0.084	0.50	1	12/30/2023 00:56
Barium	220		0.73	5.0	1	12/30/2023 00:56
Beryllium	0.27	J	0.086	0.50	1	12/30/2023 00:56
Cadmium	0.14	J	0.080	0.50	1	12/30/2023 00:56
Chromium	32		0.17	0.50	1	12/30/2023 00:56
Cobalt	11		0.063	0.50	1	12/30/2023 00:56
Copper	39		0.19	0.50	1	12/30/2023 00:56
Lead	19		0.089	0.50	1	12/30/2023 00:56
Mercury	0.073		0.039	0.050	1	12/30/2023 00:56
Molybdenum	0.44	J	0.093	0.50	1	12/30/2023 00:56
Nickel	35		0.28	0.50	1	12/30/2023 00:56
Selenium	ND		0.21	0.50	1	12/30/2023 00:56
Silver	0.71		0.084	0.50	1	12/30/2023 00:56
Thallium	0.090	J	0.073	0.50	1	12/30/2023 00:56
Vanadium	45		0.097	0.50	1	12/30/2023 00:56
Zinc	55		1.8	5.0	1	12/30/2023 00:56

Surrogates	REC (%)	Limits	Date Analyzed
Terbium	107	70-130	12/30/2023 00:56

Analyst(s): DB



Analytical Report

Client:	ACC Environmental Consultants, Inc.	WorkOrder:	2312K27
Date Received:	12/28/2023 10:19	Extraction Method:	CARB 435 Asbestos
Date Prepared:	12/28/2023	Analytical Method:	435 CARB
Project:	3029.332.00; MLA Sherman	Unit:	%

Asbestos (CARB 435) 400 Point Count

Client ID	Lab ID	Matrix	Date Collected	Instrument	Batch ID
ACCB1/2/3/4-0.5	2312K27-001A	Soil	12/28/2023 07:55	Microscope	285125

<u>Analytes</u>	<u>Result</u>	<u>RL</u>	<u>DF</u>	<u>Date Analyzed</u>
Asbestos	ND	0.25	1	01/02/2024 13:00

Analyst(s): DA

Analytical Comments: k10



Analytical Report

Client: ACC Environmental Consultants, Inc.	WorkOrder: 2312K27
Date Received: 12/28/2023 10:19	Extraction Method: SW5035
Date Prepared: 01/02/2024	Analytical Method: SW8021B/8015Bm
Project: 3029.332.00; MLA Sherman	Unit: mg/Kg

Gasoline Range (C6-C12) Volatile Hydrocarbons as Gasoline with BTEX and MTBE

Client ID	Lab ID	Matrix	Date Collected	Instrument	Batch ID	
ACCB1/2/3/4-0.5	2312K27-001A	Soil	12/28/2023 07:55	GC7 01022431.D	285118	
<u>Analytes</u>	<u>Result</u>	<u>Qualifiers</u>	<u>MDL</u>	<u>RL</u>	<u>DF</u>	<u>Date Analyzed</u>
TPH(g) (C6-C12)	0.89	J	0.48	1.0	1	01/03/2024 02:10
MTBE	---		0.0025	0.050	1	01/03/2024 02:10
Benzene	---		0.0014	0.0050	1	01/03/2024 02:10
Toluene	---		0.0021	0.0050	1	01/03/2024 02:10
Ethylbenzene	---		0.00093	0.0050	1	01/03/2024 02:10
m,p-Xylene	---		0.0024	0.010	1	01/03/2024 02:10
o-Xylene	---		0.00090	0.0050	1	01/03/2024 02:10
Xylenes	---		NA	0.0050	1	01/03/2024 02:10
<u>Surrogates</u>	<u>REC (%)</u>			<u>Limits</u>		
2-Fluorotoluene	106			62-126		01/03/2024 02:10
<u>Analyst(s):</u> HD				<u>Analytical Comments:</u> d7		



Analytical Report

Client: ACC Environmental Consultants, Inc.
Date Received: 12/28/2023 10:19
Date Prepared: 12/28/2023
Project: 3029.332.00; MLA Sherman

WorkOrder: 2312K27
Extraction Method: SW3550B
Analytical Method: SW8015B
Unit: mg/Kg

Total Extractable Petroleum Hydrocarbons w/out SG Clean-Up

Client ID	Lab ID	Matrix	Date Collected	Instrument	Batch ID
ACCB1/2/3/4-0.5	2312K27-001A	Soil	12/28/2023 07:55	GC39B 12292381.D	284966

Analytes	Result	MDL	RL	DF	Date Analyzed
TPH-Diesel (C10-C23)	24	5.5	10	5	12/30/2023 18:00
TPH-Motor Oil (C18-C36)	340	22	50	5	12/30/2023 18:00

Surrogates	REC (%)	Limits	Date Analyzed
C9	86	70-130	12/30/2023 18:00

Analyst(s): JNG

Analytical Comments: e2,e7



Quality Control Report

Client: ACC Environmental Consultants, Inc.
Date Prepared: 12/29/2023
Date Analyzed: 12/29/2023
Instrument: GC23
Matrix: Soil
Project: 3029.332.00; MLA Sherman

WorkOrder: 2312K27
BatchID: 285049
Extraction Method: SW3550B/3640Am/3630Cm
Analytical Method: SW8081B/8082A
Unit: mg/kg
Sample ID: MB/LCS/LCSD-285049

QC Summary Report for SW8081B/8082A

Analyte	MB Result	MDL	RL	SPK Val	MB SS %REC	MB SS Limits
Aldrin	ND	0.000047	0.00010	-	-	-
a-BHC	ND	0.000045	0.00010	-	-	-
b-BHC	ND	0.000038	0.00010	-	-	-
d-BHC	ND	0.000040	0.00010	-	-	-
g-BHC	ND	0.000056	0.00010	-	-	-
Chlordane (Technical)	ND	0.0016	0.0025	-	-	-
a-Chlordane	ND	0.000039	0.00010	-	-	-
g-Chlordane	ND	0.000043	0.00010	-	-	-
p,p-DDD	ND	0.000041	0.00010	-	-	-
p,p-DDE	ND	0.000047	0.00010	-	-	-
p,p-DDT	ND	0.000069	0.00010	-	-	-
Dieldrin	ND	0.000066	0.00010	-	-	-
Endosulfan I	ND	0.000038	0.00010	-	-	-
Endosulfan II	ND	0.000059	0.00010	-	-	-
Endosulfan sulfate	ND	0.000035	0.00010	-	-	-
Endrin	ND	0.000088	0.00010	-	-	-
Endrin aldehyde	ND	0.000049	0.00010	-	-	-
Endrin ketone	ND	0.000083	0.00010	-	-	-
Heptachlor	ND	0.000064	0.00010	-	-	-
Heptachlor epoxide	ND	0.000029	0.00010	-	-	-
Hexachlorobenzene	ND	0.000077	0.0010	-	-	-
Hexachlorocyclopentadiene	ND	0.00031	0.0020	-	-	-
Methoxychlor	ND	0.000092	0.00020	-	-	-
Toxaphene	ND	0.0045	0.010	-	-	-
Aroclor1016	ND	0.0020	0.0050	-	-	-
Aroclor1221	ND	0.0020	0.0050	-	-	-
Aroclor1232	ND	0.0020	0.0050	-	-	-
Aroclor1242	ND	0.0020	0.0050	-	-	-
Aroclor1248	ND	0.0020	0.0050	-	-	-
Aroclor1254	ND	0.0020	0.0050	-	-	-
Aroclor1260	ND	0.0020	0.0050	-	-	-
Surrogate Recovery						
Decachlorobiphenyl	0.0050			0.005	100	28-170

(Cont.)



Quality Control Report

Client: ACC Environmental Consultants, Inc.
Date Prepared: 12/29/2023
Date Analyzed: 12/29/2023
Instrument: GC23
Matrix: Soil
Project: 3029.332.00; MLA Sherman

WorkOrder: 2312K27
BatchID: 285049
Extraction Method: SW3550B/3640Am/3630Cm
Analytical Method: SW8081B/8082A
Unit: mg/kg
Sample ID: MB/LCS/LCSD-285049

QC Summary Report for SW8081B/8082A

Analyte	LCS Result	LCSD Result	SPK Val	LCS %REC	LCSD %REC	LCS/LCSD Limits	RPD	RPD Limit
Aldrin	0.0033	0.0037	0.0050	66	74	31-155	11.7	20
a-BHC	0.0033	0.0039	0.0050	65	78	32-160	17.1	20
b-BHC	0.0034	0.0038	0.0050	68	75	44-149	10.4	20
d-BHC	0.0035	0.0040	0.0050	70	80	37-157	12.7	20
g-BHC	0.0035	0.0040	0.0050	69	80	43-154	13.8	20
a-Chlordane	0.0035	0.0039	0.0050	70	78	39-150	10.6	20
g-Chlordane	0.0040	0.0044	0.0050	80	88	39-151	9.63	20
p,p-DDD	0.0035	0.0039	0.0050	70	79	30-158	11.0	20
p,p-DDE	0.0034	0.0038	0.0050	69	76	47-149	10.4	20
p,p-DDT	0.0042	0.0046	0.0050	83	93	56-166	11.3	20
Dieldrin	0.0033	0.0036	0.0050	65	72	50-163	10.3	20
Endosulfan I	0.0031	0.0035	0.0050	63	70	45-159	11.0	20
Endosulfan II	0.0033	0.0036	0.0050	65	73	41-155	10.9	20
Endosulfan sulfate	0.0036	0.0040	0.0050	73	81	45-156	10.8	20
Endrin	0.0038	0.0042	0.0050	75	84	54-154	10.4	20
Endrin aldehyde	0.0029	0.0032	0.0050	57	65	27-159	12.1	20
Endrin ketone	0.0034	0.0038	0.0050	67	76	40-147	11.8	20
Heptachlor	0.0035	0.0039	0.0050	69	79	52-165	12.7	20
Heptachlor epoxide	0.0032	0.0036	0.0050	64	71	46-145	10.4	20
Hexachlorobenzene	0.0036	0.0040	0.0050	72	80	22-156	11.8	20
Hexachlorocyclopentadiene	0.0032	0.0035	0.0050	63	70	43-173	10.0	20
Methoxychlor	0.0034	0.0039	0.0050	68	77	49-150	12.6	20
Aroclor1016	0.011	0.010	0.015	72	69	49-120	4.86	20
Aroclor1260	0.011	0.010	0.015	73	69	48-160	6.13	20
Surrogate Recovery								
Decachlorobiphenyl	0.0049	0.0054	0.0050	97	108	28-170	11.0	20



Quality Control Report

Client: ACC Environmental Consultants, Inc.
Date Prepared: 12/28/2023
Date Analyzed: 12/29/2023
Instrument: GC38
Matrix: Soil
Project: 3029.332.00; MLA Sherman

WorkOrder: 2312K27
BatchID: 284970
Extraction Method: SW5030B
Analytical Method: SW8260B
Unit: mg/kg
Sample ID: MB/LCS/LCSD-284970

QC Summary Report for SW8260B

Analyte	MB Result	MDL	RL	SPK Val	MB SS %REC	MB SS Limits
Acetone	ND	0.12	0.20	-	-	-
tert-Amyl methyl ether (TAME)	ND	0.0012	0.0050	-	-	-
Benzene	0.0032,J	0.00095	0.0050	-	-	-
Bromobenzene	ND	0.0012	0.0050	-	-	-
Bromochloromethane	ND	0.0011	0.0050	-	-	-
Bromodichloromethane	ND	0.00023	0.0050	-	-	-
Bromoform	ND	0.0038	0.0050	-	-	-
Bromomethane	ND	0.0018	0.0050	-	-	-
2-Butanone (MEK)	ND	0.040	0.10	-	-	-
t-Butyl alcohol (TBA)	ND	0.024	0.050	-	-	-
n-Butyl benzene	ND	0.0016	0.0050	-	-	-
sec-Butyl benzene	ND	0.0018	0.0050	-	-	-
tert-Butyl benzene	ND	0.0021	0.0050	-	-	-
Carbon Disulfide	ND	0.0011	0.0050	-	-	-
Carbon Tetrachloride	ND	0.00017	0.0050	-	-	-
Chlorobenzene	ND	0.0012	0.0050	-	-	-
Chloroethane	ND	0.0017	0.0050	-	-	-
Chloroform	ND	0.00032	0.0050	-	-	-
Chloromethane	ND	0.0017	0.0050	-	-	-
2-Chlorotoluene	ND	0.0016	0.0050	-	-	-
4-Chlorotoluene	ND	0.0013	0.0050	-	-	-
Dibromochloromethane	ND	0.00040	0.0050	-	-	-
1,2-Dibromo-3-chloropropane	ND	0.00048	0.00050	-	-	-
1,2-Dibromoethane (EDB)	ND	0.00013	0.00025	-	-	-
Dibromomethane	ND	0.0012	0.0050	-	-	-
1,2-Dichlorobenzene	ND	0.0017	0.0050	-	-	-
1,3-Dichlorobenzene	ND	0.0015	0.0050	-	-	-
1,4-Dichlorobenzene	ND	0.0015	0.0050	-	-	-
Dichlorodifluoromethane	ND	0.00063	0.0050	-	-	-
1,1-Dichloroethane	ND	0.0015	0.0050	-	-	-
1,2-Dichloroethane (1,2-DCA)	ND	0.000070	0.00010	-	-	-
1,1-Dichloroethene	ND	0.00011	0.0050	-	-	-
cis-1,2-Dichloroethene	ND	0.0012	0.0050	-	-	-
trans-1,2-Dichloroethene	ND	0.0012	0.0050	-	-	-
1,2-Dichloropropane	ND	0.0013	0.0050	-	-	-
1,3-Dichloropropane	ND	0.00088	0.0050	-	-	-
2,2-Dichloropropane	ND	0.0019	0.0050	-	-	-
1,1-Dichloropropene	ND	0.0018	0.0050	-	-	-

(Cont.)



Quality Control Report

Client: ACC Environmental Consultants, Inc.
Date Prepared: 12/28/2023
Date Analyzed: 12/29/2023
Instrument: GC38
Matrix: Soil
Project: 3029.332.00; MLA Sherman

WorkOrder: 2312K27
BatchID: 284970
Extraction Method: SW5030B
Analytical Method: SW8260B
Unit: mg/kg
Sample ID: MB/LCS/LCSD-284970

QC Summary Report for SW8260B

Analyte	MB Result	MDL	RL	SPK Val	MB SS %REC	MB SS Limits
cis-1,3-Dichloropropene	ND	0.00098	0.0050	-	-	-
trans-1,3-Dichloropropene	ND	0.00097	0.0050	-	-	-
Diisopropyl ether (DIPE)	ND	0.0018	0.0050	-	-	-
Ethylbenzene	ND	0.0011	0.0050	-	-	-
Ethyl tert-butyl ether (ETBE)	ND	0.0014	0.0050	-	-	-
Freon 113	ND	0.0011	0.0050	-	-	-
Hexachlorobutadiene	ND	0.0012	0.0050	-	-	-
Hexachloroethane	ND	0.00064	0.0050	-	-	-
2-Hexanone	ND	0.0027	0.0050	-	-	-
Isopropylbenzene	ND	0.0018	0.0050	-	-	-
4-Isopropyl toluene	ND	0.0019	0.0050	-	-	-
Methyl-t-butyl ether (MTBE)	ND	0.0015	0.0050	-	-	-
Methylene chloride	0.022	0.012	0.020	-	-	-
4-Methyl-2-pentanone (MIBK)	ND	0.0017	0.0050	-	-	-
Naphthalene	ND	0.0030	0.0050	-	-	-
n-Propyl benzene	ND	0.0019	0.0050	-	-	-
Styrene	ND	0.0014	0.0050	-	-	-
1,1,1,2-Tetrachloroethane	ND	0.0013	0.0050	-	-	-
1,1,2,2-Tetrachloroethane	ND	0.00044	0.0050	-	-	-
Tetrachloroethene	ND	0.00029	0.0050	-	-	-
Toluene	ND	0.0016	0.0050	-	-	-
1,2,3-Trichlorobenzene	ND	0.0021	0.0050	-	-	-
1,2,4-Trichlorobenzene	ND	0.0016	0.0050	-	-	-
1,1,1-Trichloroethane	ND	0.0016	0.0050	-	-	-
1,1,2-Trichloroethane	ND	0.0012	0.0050	-	-	-
Trichloroethene	ND	0.0014	0.0050	-	-	-
Trichlorofluoromethane	ND	0.0013	0.0050	-	-	-
1,2,3-Trichloropropane	ND	0.00017	0.00025	-	-	-
1,2,4-Trimethylbenzene	ND	0.0016	0.0050	-	-	-
1,3,5-Trimethylbenzene	ND	0.0017	0.0050	-	-	-
Vinyl Chloride	ND	0.00012	0.00025	-	-	-
m,p-Xylene	ND	0.0026	0.0050	-	-	-
o-Xylene	ND	0.0014	0.0050	-	-	-

(Cont.)



Quality Control Report

Client: ACC Environmental Consultants, Inc.
Date Prepared: 12/28/2023
Date Analyzed: 12/29/2023
Instrument: GC38
Matrix: Soil
Project: 3029.332.00; MLA Sherman

WorkOrder: 2312K27
BatchID: 284970
Extraction Method: SW5030B
Analytical Method: SW8260B
Unit: mg/kg
Sample ID: MB/LCS/LCSD-284970

QC Summary Report for SW8260B

Analyte	MB Result	MDL	RL	SPK Val	MB SS %REC	MB SS Limits
Surrogate Recovery						
Dibromofluoromethane	0.13			0.125	101	70-140
Toluene-d8	0.14			0.125	108	70-140
4-BFB	0.012			0.0125	100	70-140
Benzene-d6	0.12			0.1	121	70-140
Ethylbenzene-d10	0.12			0.1	116	70-140
1,2-DCB-d4	0.073			0.1	73	70-140



Quality Control Report

Client: ACC Environmental Consultants, Inc.
Date Prepared: 12/28/2023
Date Analyzed: 12/29/2023
Instrument: GC38
Matrix: Soil
Project: 3029.332.00; MLA Sherman

WorkOrder: 2312K27
BatchID: 284970
Extraction Method: SW5030B
Analytical Method: SW8260B
Unit: mg/kg
Sample ID: MB/LCS/LCSD-284970

QC Summary Report for SW8260B

Analyte	LCS Result	LCSD Result	SPK Val	LCS %REC	LCSD %REC	LCS/LCSD Limits	RPD	RPD Limit
Acetone	0.26	0.27	0.20	132	134	60-140	1.41	30
tert-Amyl methyl ether (TAME)	0.018	0.018	0.020	91	91	50-140	0.148	30
Benzene	0.021	0.021	0.020	107	106	60-140	0.700	30
Bromobenzene	0.019	0.019	0.020	97	94	60-140	2.85	30
Bromochloromethane	0.020	0.020	0.020	99	98	60-140	1.08	30
Bromodichloromethane	0.021	0.021	0.020	105	103	60-140	1.94	30
Bromoform	0.017	0.018	0.020	87	89	40-140	1.81	30
Bromomethane	0.027	0.027	0.020	135	136	30-140	0.244	30
2-Butanone (MEK)	0.097	0.11	0.080	122	136	50-140	10.9	30
t-Butyl alcohol (TBA)	0.090	0.088	0.080	112	109	50-140	2.70	30
n-Butyl benzene	0.024	0.024	0.020	119	121	60-150	1.81	30
sec-Butyl benzene	0.023	0.024	0.020	117	119	60-150	1.77	30
tert-Butyl benzene	0.023	0.022	0.020	113	112	60-140	0.837	30
Carbon Disulfide	0.022	0.022	0.020	109	109	50-140	0.0475	30
Carbon Tetrachloride	0.019	0.019	0.020	97	94	60-140	2.33	30
Chlorobenzene	0.019	0.019	0.020	96	96	60-140	0.294	30
Chloroethane	0.026	0.026	0.020	131	131	50-140	0.426	30
Chloroform	0.021	0.021	0.020	105	105	60-140	0.551	30
Chloromethane	0.022	0.022	0.020	109	110	20-140	0.779	30
2-Chlorotoluene	0.021	0.021	0.020	104	106	60-140	1.77	30
4-Chlorotoluene	0.021	0.022	0.020	104	108	60-140	3.38	30
Dibromochloromethane	0.020	0.020	0.020	99	98	50-140	0.883	30
1,2-Dibromo-3-chloropropane	0.0095	0.0094	0.010	95	94	30-140	1.29	30
1,2-Dibromoethane (EDB)	0.0099	0.0098	0.010	99	98	40-140	1.13	30
Dibromomethane	0.020	0.019	0.020	100	94	60-140	5.76	30
1,2-Dichlorobenzene	0.016	0.017	0.020	82	83	60-140	1.19	30
1,3-Dichlorobenzene	0.019	0.019	0.020	95	96	60-140	1.23	30
1,4-Dichlorobenzene	0.019	0.020	0.020	96	98	60-140	1.50	30
Dichlorodifluoromethane	0.011	0.011	0.020	54	53	10-140	2.14	30
1,1-Dichloroethane	0.021	0.021	0.020	105	105	60-140	0.561	30
1,2-Dichloroethane (1,2-DCA)	0.021	0.020	0.020	103	101	60-140	2.11	30
1,1-Dichloroethene	0.022	0.022	0.020	110	109	60-140	1.14	30
cis-1,2-Dichloroethene	0.020	0.020	0.020	101	100	60-140	1.20	30
trans-1,2-Dichloroethene	0.022	0.022	0.020	108	108	60-140	0.525	30
1,2-Dichloropropane	0.019	0.019	0.020	95	94	60-140	1.15	30
1,3-Dichloropropane	0.020	0.020	0.020	98	100	60-140	2.28	30
2,2-Dichloropropane	0.024	0.023	0.020	118	115	60-140	2.71	30
1,1-Dichloropropene	0.022	0.022	0.020	111	110	60-140	0.864	30

(Cont.)



Quality Control Report

Client: ACC Environmental Consultants, Inc.
Date Prepared: 12/28/2023
Date Analyzed: 12/29/2023
Instrument: GC38
Matrix: Soil
Project: 3029.332.00; MLA Sherman

WorkOrder: 2312K27
BatchID: 284970
Extraction Method: SW5030B
Analytical Method: SW8260B
Unit: mg/kg
Sample ID: MB/LCS/LCSD-284970

QC Summary Report for SW8260B

Analyte	LCS Result	LCSD Result	SPK Val	LCS %REC	LCSD %REC	LCS/LCSD Limits	RPD	RPD Limit
cis-1,3-Dichloropropene	0.020	0.020	0.020	102	101	60-140	1.35	30
trans-1,3-Dichloropropene	0.021	0.020	0.020	105	102	60-140	2.63	30
Diisopropyl ether (DIPE)	0.019	0.019	0.020	96	95	60-140	0.752	30
Ethylbenzene	0.022	0.022	0.020	107	109	60-140	1.04	30
Ethyl tert-butyl ether (ETBE)	0.019	0.019	0.020	97	94	60-140	2.35	30
Freon 113	0.019	0.019	0.020	97	96	50-140	1.71	30
Hexachlorobutadiene	0.017	0.017	0.020	87	87	60-140	0.0631	30
Hexachloroethane	0.022	0.022	0.020	111	111	60-140	0.0591	30
2-Hexanone	0.020	0.020	0.020	101	100	40-140	1.22	30
Isopropylbenzene	0.023	0.023	0.020	117	114	60-140	2.56	30
4-Isopropyl toluene	0.024	0.024	0.020	118	119	60-150	0.888	30
Methyl-t-butyl ether (MTBE)	0.019	0.019	0.020	96	94	50-140	1.80	30
Methylene chloride	0.042	0.041	0.020	209,F2	207,F2	60-140	0.885	30
4-Methyl-2-pentanone (MIBK)	0.017	0.016	0.020	83	79	50-140	4.18	30
Naphthalene	0.010	0.010	0.020	53	53	30-140	0.0238	30
n-Propyl benzene	0.023	0.023	0.020	114	115	60-140	1.54	30
Styrene	0.018	0.018	0.020	92	91	60-140	1.37	30
1,1,1,2-Tetrachloroethane	0.020	0.020	0.020	101	98	60-140	2.63	30
1,1,2,2-Tetrachloroethane	0.018	0.018	0.020	89	87	40-140	1.51	30
Tetrachloroethene	0.022	0.022	0.020	112	110	60-140	1.50	30
Toluene	0.021	0.021	0.020	105	103	60-140	1.91	30
1,2,3-Trichlorobenzene	0.013	0.012	0.020	63	60	40-140	4.77	30
1,2,4-Trichlorobenzene	0.014	0.014	0.020	71	68	50-140	3.30	30
1,1,1-Trichloroethane	0.023	0.023	0.020	115	113	60-140	1.48	30
1,1,2-Trichloroethane	0.019	0.018	0.020	94	92	60-140	2.42	30
Trichloroethene	0.020	0.020	0.020	102	101	60-140	1.50	30
Trichlorofluoromethane	0.020	0.020	0.020	101	99	50-140	1.53	30
1,2,3-Trichloropropane	0.010	0.010	0.010	102	100	60-130	1.33	30
1,2,4-Trimethylbenzene	0.023	0.022	0.020	113	112	30-140	1.02	30
1,3,5-Trimethylbenzene	0.023	0.022	0.020	116	112	60-140	2.93	30
Vinyl Chloride	0.012	0.012	0.010	122	121	30-140	0.758	30
m,p-Xylene	0.039	0.039	0.040	97	97	60-140	0.129	30
o-Xylene	0.019	0.020	0.020	97	98	60-140	1.35	30

(Cont.)



Quality Control Report

Client: ACC Environmental Consultants, Inc.
Date Prepared: 12/28/2023
Date Analyzed: 12/29/2023
Instrument: GC38
Matrix: Soil
Project: 3029.332.00; MLA Sherman

WorkOrder: 2312K27
BatchID: 284970
Extraction Method: SW5030B
Analytical Method: SW8260B
Unit: mg/kg
Sample ID: MB/LCS/LCSD-284970

QC Summary Report for SW8260B

Analyte	LCS Result	LCSD Result	SPK Val	LCS %REC	LCSD %REC	LCS/LCSD Limits	RPD	RPD Limit
Surrogate Recovery								
Dibromofluoromethane	0.13	0.13	0.12	103	103	70-140	0.107	30
Toluene-d8	0.13	0.13	0.12	107	106	70-140	1.04	30
4-BFB	0.012	0.013	0.012	99	102	70-140	2.47	30
Benzene-d6	0.12	0.12	0.10	122	121	70-140	0.527	30
Ethylbenzene-d10	0.12	0.12	0.10	115	116	70-140	0.548	30
1,2-DCB-d4	0.073	0.074	0.10	73	74	70-140	0.797	30



Quality Control Report

Client: ACC Environmental Consultants, Inc.
Date Prepared: 12/29/2023
Date Analyzed: 01/02/2024
Instrument: GC17
Matrix: Soil
Project: 3029.332.00; MLA Sherman

WorkOrder: 2312K27
BatchID: 285016
Extraction Method: SW3550B/3640A
Analytical Method: SW8270E
Unit: mg/Kg
Sample ID: MB/LCS/LCSD-285016

QC Summary Report for SW8270E (Low Level) w/ GPC

Analyte	MB Result	MDL	RL	SPK Val	MB SS %REC	MB SS Limits
Acenaphthene	ND	0.00044	0.0013	-	-	-
Acenaphthylene	ND	0.00023	0.0013	-	-	-
Acetochlor	ND	0.11	0.25	-	-	-
Anthracene	ND	0.00060	0.0013	-	-	-
Benzidine	ND	0.40	1.2	-	-	-
Benzo (a) anthracene	ND	0.0030	0.012	-	-	-
Benzo (a) pyrene	ND	0.00078	0.0013	-	-	-
Benzo (b) fluoranthene	ND	0.0011	0.0025	-	-	-
Benzo (g,h,i) perylene	ND	0.00086	0.0025	-	-	-
Benzo (k) fluoranthene	ND	0.0012	0.0025	-	-	-
Benzoic Acid	ND	0.62	1.2	-	-	-
Benzyl Alcohol	ND	0.73	1.2	-	-	-
1,1-Biphenyl	ND	0.0054	0.012	-	-	-
Bis (2-chloroethoxy) Methane	ND	0.13	0.25	-	-	-
Bis (2-chloroethyl) Ether	ND	0.00033	0.0013	-	-	-
Bis (2-chloroisopropyl) Ether	ND	0.0012	0.0025	-	-	-
Bis (2-ethylhexyl) Adipate	ND	0.18	0.25	-	-	-
Bis (2-ethylhexyl) Phthalate	ND	0.0079	0.062	-	-	-
4-Bromophenyl Phenyl Ether	ND	0.12	0.25	-	-	-
Butylbenzyl Phthalate	ND	0.0057	0.062	-	-	-
4-Chloro-3-methylphenol	ND	0.13	0.25	-	-	-
4-Chloroaniline	ND	0.00099	0.0013	-	-	-
2-Chloronaphthalene	ND	0.12	0.25	-	-	-
2-Chlorophenol	ND	0.0061	0.012	-	-	-
4-Chlorophenyl Phenyl Ether	ND	0.12	0.25	-	-	-
Chrysene	ND	0.00073	0.0013	-	-	-
Dibenzo (a,h) anthracene	ND	0.0013	0.0025	-	-	-
Dibenzofuran	ND	0.00032	0.0013	-	-	-
Di-n-butyl Phthalate	ND	0.0070	0.062	-	-	-
1,2-Dichlorobenzene	ND	0.14	0.25	-	-	-
1,3-Dichlorobenzene	ND	0.13	0.25	-	-	-
1,4-Dichlorobenzene	ND	0.12	0.25	-	-	-
3,3-Dichlorobenzidine	ND	0.00089	0.0013	-	-	-
2,4-Dichlorophenol	ND	0.0012	0.0025	-	-	-
Diethyl Phthalate	ND	0.0053	0.012	-	-	-
2,4-Dimethylphenol	ND	0.11	0.25	-	-	-
Dimethyl Phthalate	ND	0.0010	0.0025	-	-	-
4,6-Dinitro-2-methylphenol	ND	0.55	1.2	-	-	-

(Cont.)



Quality Control Report

Client: ACC Environmental Consultants, Inc.
Date Prepared: 12/29/2023
Date Analyzed: 01/02/2024
Instrument: GC17
Matrix: Soil
Project: 3029.332.00; MLA Sherman

WorkOrder: 2312K27
BatchID: 285016
Extraction Method: SW3550B/3640A
Analytical Method: SW8270E
Unit: mg/Kg
Sample ID: MB/LCS/LCSD-285016

QC Summary Report for SW8270E (Low Level) w/ GPC

Analyte	MB Result	MDL	RL	SPK Val	MB SS %REC	MB SS Limits
2,4-Dinitrophenol	ND	0.11	0.25	-	-	-
2,4-Dinitrotoluene	ND	0.00041	0.012	-	-	-
2,6-Dinitrotoluene	ND	0.0078	0.012	-	-	-
Di-n-octyl Phthalate	ND	0.31	0.62	-	-	-
1,2-Diphenylhydrazine	ND	0.11	0.25	-	-	-
Fluoranthene	ND	0.00073	0.0025	-	-	-
Fluorene	ND	0.00078	0.0025	-	-	-
Hexachlorobenzene	ND	0.00038	0.0013	-	-	-
Hexachlorobutadiene	ND	0.00028	0.0013	-	-	-
Hexachlorocyclopentadiene	ND	0.66	1.2	-	-	-
Hexachloroethane	ND	0.00062	0.0025	-	-	-
Indeno (1,2,3-cd) pyrene	ND	0.0014	0.0025	-	-	-
Isophorone	ND	0.055	0.25	-	-	-
1-Methylnaphthalene	ND	0.00035	0.0013	-	-	-
2-Methylnaphthalene	ND	0.00044	0.0013	-	-	-
2-Methylphenol (o-Cresol)	ND	0.15	0.25	-	-	-
3 & 4-Methylphenol (m,p-Cresol)	ND	0.14	0.25	-	-	-
Naphthalene	ND	0.00042	0.0025	-	-	-
2-Nitroaniline	ND	0.59	1.2	-	-	-
3-Nitroaniline	ND	0.73	1.2	-	-	-
4-Nitroaniline	ND	0.64	1.2	-	-	-
Nitrobenzene	ND	0.14	0.25	-	-	-
2-Nitrophenol	ND	0.63	1.2	-	-	-
4-Nitrophenol	ND	0.70	1.2	-	-	-
N-Nitrosodimethylamine	ND	0.61	1.2	-	-	-
N-Nitrosodi-n-propylamine	ND	0.14	0.25	-	-	-
N-Nitrosodiphenylamine	ND	0.11	0.25	-	-	-
Pentachlorophenol	ND	0.032	0.062	-	-	-
Phenanthrene	ND	0.0010	0.0013	-	-	-
Phenol	ND	0.0032	0.010	-	-	-
Pyrene	ND	0.00065	0.0013	-	-	-
Pyridine	ND	0.094	0.25	-	-	-
2,3,4,6-Tetrachlorophenol	ND	0.15	0.25	-	-	-
1,2,4-Trichlorobenzene	ND	0.13	0.25	-	-	-
2,4,5-Trichlorophenol	ND	0.00067	0.0025	-	-	-
2,4,6-Trichlorophenol	ND	0.00062	0.0025	-	-	-

(Cont.)



Quality Control Report

Client: ACC Environmental Consultants, Inc.	WorkOrder: 2312K27
Date Prepared: 12/29/2023	BatchID: 285016
Date Analyzed: 01/02/2024	Extraction Method: SW3550B/3640A
Instrument: GC17	Analytical Method: SW8270E
Matrix: Soil	Unit: mg/Kg
Project: 3029.332.00; MLA Sherman	Sample ID: MB/LCS/LCSD-285016

QC Summary Report for SW8270E (Low Level) w/ GPC

Analyte	MB Result	MDL	RL	SPK Val	MB SS %REC	MB SS Limits
Surrogate Recovery						
2-Fluorophenol	1.5			1.25	123	60-130
Phenol-d5	1.6			1.25	125	60-130
Nitrobenzene-d5	1.8			1.25	144,F3	60-130
2-Fluorobiphenyl	1.4			1.25	113	60-130
2,4,6-Tribromophenol	1.2			1.25	99	50-130
4-Terphenyl-d14	1.6			1.25	125	50-130



Quality Control Report

Client: ACC Environmental Consultants, Inc.
Date Prepared: 12/29/2023
Date Analyzed: 01/02/2024
Instrument: GC17
Matrix: Soil
Project: 3029.332.00; MLA Sherman

WorkOrder: 2312K27
BatchID: 285016
Extraction Method: SW3550B/3640A
Analytical Method: SW8270E
Unit: mg/Kg
Sample ID: MB/LCS/LCSD-285016

QC Summary Report for SW8270E (Low Level) w/ GPC

Analyte	LCS Result	LCSD Result	SPK Val	LCS %REC	LCSD %REC	LCS/LCSD Limits	RPD	RPD Limit
Acenaphthene	0.049	0.049	0.062	79	78	60-130	0.789	30
Acenaphthylene	0.046	0.047	0.062	74	75	60-130	1.83	30
Acetochlor	1.1	1.1	1.25	88	87	60-130	1.03	30
Anthracene	0.051	0.051	0.062	81	82	60-130	1.20	30
Benzidine	0.53	0.50	6.25	8,F5	8,F5	30-130	5.53	30
Benzo (a) anthracene	0.055	0.058	0.062	87	92	60-130	5.44	30
Benzo (a) pyrene	0.052	0.054	0.062	83	86	60-130	4.11	30
Benzo (b) fluoranthene	0.055	0.057	0.062	88	92	40-130	4.28	30
Benzo (g,h,i) perylene	0.047	0.049	0.062	76	78	60-130	2.50	30
Benzo (k) fluoranthene	0.056	0.058	0.062	90	92	60-130	2.06	30
Benzoic Acid	6.7	7.0	6.25	107	112	15-130	4.67	30
Benzyl Alcohol	5.3	5.2	6.25	85	83	60-130	2.53	30
1,1-Biphenyl	0.051	0.052	0.062	82	83	60-130	1.41	30
Bis (2-chloroethoxy) Methane	1.2	1.2	1.25	93	92	60-130	0.402	30
Bis (2-chloroethyl) Ether	0.050	0.052	0.062	80	83	60-130	3.13	30
Bis (2-chloroisopropyl) Ether	0.050	0.051	0.062	80	82	60-130	2.81	30
Bis (2-ethylhexyl) Adipate	1.2	1.3	1.25	96	101	40-130	5.33	30
Bis (2-ethylhexyl) Phthalate	0.047	0.051	0.062	75	81	60-130	8.40	30
4-Bromophenyl Phenyl Ether	1.1	1.2	1.25	88	92	60-130	4.12	30
Butylbenzyl Phthalate	0.054	0.058	0.062	86	93	60-130	6.92	30
4-Chloro-3-methylphenol	1.2	1.2	1.25	95	95	60-130	0.618	30
4-Chloroaniline	0.032	0.030	0.062	52	47	40-130	8.80	30
2-Chloronaphthalene	1.2	1.1	1.25	94	85	60-130	9.18	30
2-Chlorophenol	0.051	0.053	0.062	82	85	60-130	3.60	30
4-Chlorophenyl Phenyl Ether	1.1	1.1	1.25	88	88	60-130	0.129	30
Chrysene	0.052	0.054	0.062	83	86	60-130	3.62	30
Dibenzo (a,h) anthracene	0.050	0.050	0.062	79	80	60-130	0.948	30
Dibenzofuran	0.049	0.049	0.062	78	79	60-130	0.852	30
Di-n-butyl Phthalate	0.053	0.055	0.062	85	88	60-130	3.34	30
1,2-Dichlorobenzene	1.2	1.2	1.25	94	96	60-130	2.11	30
1,3-Dichlorobenzene	1.1	1.1	1.25	88	90	60-130	2.23	30
1,4-Dichlorobenzene	1.1	1.1	1.25	89	89	60-130	0.498	30
3,3-Dichlorobenzidine	0.030	0.030	0.062	48	49	40-130	1.99	30
2,4-Dichlorophenol	0.060	0.062	0.062	96	99	60-130	3.40	30
Diethyl Phthalate	0.042	0.042	0.062	68	68	60-130	0.510	30
2,4-Dimethylphenol	1.2	1.2	1.25	96	98	60-130	1.74	30
Dimethyl Phthalate	0.053	0.054	0.062	85	87	60-130	1.77	30
4,6-Dinitro-2-methylphenol	7.5	8.0	6.25	120	127	30-130	5.71	30

(Cont.)



Quality Control Report

Client: ACC Environmental Consultants, Inc.
Date Prepared: 12/29/2023
Date Analyzed: 01/02/2024
Instrument: GC17
Matrix: Soil
Project: 3029.332.00; MLA Sherman

WorkOrder: 2312K27
BatchID: 285016
Extraction Method: SW3550B/3640A
Analytical Method: SW8270E
Unit: mg/Kg
Sample ID: MB/LCS/LCSD-285016

QC Summary Report for SW8270E (Low Level) w/ GPC

Analyte	LCS Result	LCSD Result	SPK Val	LCS %REC	LCSD %REC	LCS/LCSD Limits	RPD	RPD Limit
2,4-Dinitrophenol	1.4	1.5	1.25	109	116	15-130	6.76	30
2,4-Dinitrotoluene	0.074	0.076	0.062	119	121	60-130	2.24	30
2,6-Dinitrotoluene	0.070	0.073	0.062	112	116	60-130	3.42	30
Di-n-octyl Phthalate	1.3	1.4	1.25	102	109	60-130	6.14	30
1,2-Diphenylhydrazine	1.1	1.1	1.25	88	91	60-130	3.25	30
Fluoranthene	0.048	0.049	0.062	77	79	60-130	2.52	30
Fluorene	0.051	0.052	0.062	81	83	60-130	2.05	30
Hexachlorobenzene	0.066	0.067	0.062	105	108	60-130	2.06	30
Hexachlorobutadiene	0.060	0.061	0.062	96	98	60-130	1.77	30
Hexachlorocyclopentadiene	3.6	3.9	6.25	58	62	40-130	7.35	30
Hexachloroethane	0.053	0.055	0.062	85	88	60-130	3.58	30
Indeno (1,2,3-cd) pyrene	0.050	0.050	0.062	79	79	60-130	0.233	30
Isophorone	0.86	0.88	1.25	69	71	60-130	2.25	30
1-Methylnaphthalene	0.054	0.055	0.062	86	88	60-130	2.31	30
2-Methylnaphthalene	0.056	0.058	0.062	89	93	60-130	4.09	30
2-Methylphenol (o-Cresol)	1.1	1.2	1.25	91	98	60-130	7.50	30
3 & 4-Methylphenol (m,p-Cresol)	1.2	1.1	1.25	95	92	60-130	3.23	30
Naphthalene	0.057	0.058	0.062	91	93	60-130	1.76	30
2-Nitroaniline	5.8	5.9	6.25	92	94	60-130	2.22	30
3-Nitroaniline	4.8	4.4	6.25	77	70	30-130	9.24	30
4-Nitroaniline	5.5	5.5	6.25	88	88	60-130	0.340	30
Nitrobenzene	1.3	1.3	1.25	106	107	60-130	1.10	30
2-Nitrophenol	7.0	7.4	6.25	113	119	60-130	5.37	30
4-Nitrophenol	5.5	5.3	6.25	88	85	60-130	3.35	30
N-Nitrosodimethylamine	4.9	5.1	6.25	79	81	60-130	2.85	30
N-Nitrosodi-n-propylamine	0.97	1.0	1.25	78	81	60-130	3.25	30
N-Nitrosodiphenylamine	1.1	1.1	1.25	89	91	60-130	2.25	30
Pentachlorophenol	0.32	0.34	0.31	104	109	40-130	4.56	30
Phenanthrene	0.055	0.056	0.062	87	90	60-130	2.60	30
Phenol	0.21	0.21	0.25	82	84	60-130	1.86	30
Pyrene	0.055	0.058	0.062	89	93	60-130	4.72	30
Pyridine	0.79	0.79	1.25	63	64	30-130	0.984	30
2,3,4,6-Tetrachlorophenol	1.3	1.3	1.25	102	103	60-130	0.885	30
1,2,4-Trichlorobenzene	1.2	1.2	1.25	93	95	60-130	2.97	30
2,4,5-Trichlorophenol	0.059	0.060	0.062	94	97	60-130	2.89	30
2,4,6-Trichlorophenol	0.049	0.049	0.062	79	78	60-130	1.18	30

(Cont.)



Quality Control Report

Client: ACC Environmental Consultants, Inc.	WorkOrder: 2312K27
Date Prepared: 12/29/2023	BatchID: 285016
Date Analyzed: 01/02/2024	Extraction Method: SW3550B/3640A
Instrument: GC17	Analytical Method: SW8270E
Matrix: Soil	Unit: mg/Kg
Project: 3029.332.00; MLA Sherman	Sample ID: MB/LCS/LCSD-285016

QC Summary Report for SW8270E (Low Level) w/ GPC

Analyte	LCS Result	LCSD Result	SPK Val	LCS %REC	LCSD %REC	LCS/LCSD Limits	RPD	RPD Limit
Surrogate Recovery								
2-Fluorophenol	1.3	1.2	1.25	102	94	60-130	8.13	30
Phenol-d5	1.2	1.1	1.25	97	91	60-130	6.03	30
Nitrobenzene-d5	1.5	1.5	1.25	123	122	60-130	0.842	30
2-Fluorobiphenyl	1.2	1.1	1.25	92	87	60-130	5.68	30
2,4,6-Tribromophenol	1.2	1.1	1.25	96	90	50-130	6.21	30
4-Terphenyl-d14	1.3	1.3	1.25	105	103	50-130	1.78	30



Quality Control Report

Client: ACC Environmental Consultants, Inc.
Date Prepared: 12/28/2023
Date Analyzed: 12/29/2023
Instrument: ICP-MS4
Matrix: Soil
Project: 3029.332.00; MLA Sherman

WorkOrder: 2312K27
BatchID: 284896
Extraction Method: SW3050B
Analytical Method: SW6020
Unit: mg/kg
Sample ID: MB/LCS/LCSD-284896

QC Summary Report for Metals

Analyte	MB Result	MDL	RL	SPK Val	MB SS %REC	MB SS Limits
Antimony	ND	0.10	0.50	-	-	-
Arsenic	ND	0.084	0.50	-	-	-
Barium	ND	0.73	5.0	-	-	-
Beryllium	ND	0.086	0.50	-	-	-
Cadmium	ND	0.080	0.50	-	-	-
Chromium	ND	0.17	0.50	-	-	-
Cobalt	ND	0.063	0.50	-	-	-
Copper	ND	0.19	0.50	-	-	-
Lead	ND	0.089	0.50	-	-	-
Mercury	ND	0.039	0.050	-	-	-
Molybdenum	ND	0.093	0.50	-	-	-
Nickel	ND	0.28	0.50	-	-	-
Selenium	ND	0.21	0.50	-	-	-
Silver	ND	0.084	0.50	-	-	-
Thallium	ND	0.073	0.50	-	-	-
Vanadium	ND	0.097	0.50	-	-	-
Zinc	ND	1.8	5.0	-	-	-
Surrogate Recovery						
Terbium	510			500	102	70-130



Quality Control Report

Client: ACC Environmental Consultants, Inc.
Date Prepared: 12/28/2023
Date Analyzed: 12/29/2023
Instrument: ICP-MS4
Matrix: Soil
Project: 3029.332.00; MLA Sherman

WorkOrder: 2312K27
BatchID: 284896
Extraction Method: SW3050B
Analytical Method: SW6020
Unit: mg/kg
Sample ID: MB/LCS/LCSD-284896

QC Summary Report for Metals

Analyte	LCS Result	LCSD Result	SPK Val	LCS %REC	LCSD %REC	LCS/LCSD Limits	RPD	RPD Limit
Antimony	47	48	50	95	97	75-125	2.08	20
Arsenic	49	50	50	97	99	75-125	2.10	20
Barium	470	480	500	94	97	75-125	3.57	20
Beryllium	47	50	50	94	100	75-125	6.29	20
Cadmium	48	50	50	96	101	75-125	4.70	20
Chromium	48	48	50	96	97	75-125	0.0870	20
Cobalt	46	49	50	93	98	75-125	5.21	20
Copper	49	51	50	99	101	75-125	2.82	20
Lead	47	49	50	95	98	75-125	3.16	20
Mercury	1.2	1.3	1.25	95	100	75-125	5.31	20
Molybdenum	46	48	50	93	96	75-125	3.44	20
Nickel	49	51	50	98	101	75-125	3.69	20
Selenium	48	50	50	96	100	75-125	3.44	20
Silver	47	49	50	93	98	75-125	4.67	20
Thallium	45	47	50	90	95	75-125	5.25	20
Vanadium	48	48	50	96	96	75-125	0.206	20
Zinc	490	500	500	98	100	75-125	2.30	20
Surrogate Recovery								
Terbium	490	510	500	97	101	70-130	3.81	20



Quality Control Report

Client: ACC Environmental Consultants, Inc.
Date Prepared: 01/02/2024
Date Analyzed: 01/03/2024
Instrument: GC7
Matrix: Soil
Project: 3029.332.00; MLA Sherman

WorkOrder: 2312K27
BatchID: 285118
Extraction Method: SW5035
Analytical Method: SW8021B/8015Bm
Unit: mg/Kg
Sample ID: MB/LCS/LCSD-285118

QC Summary Report for SW8021B/8015Bm

Analyte	MB Result	MDL	RL	SPK Val	MB SS %REC	MB SS Limits
TPH(g) (C6-C12)	ND	0.48	1.0	-	-	-
MTBE	ND	0.0025	0.050	-	-	-
Benzene	ND	0.0014	0.0050	-	-	-
Toluene	ND	0.0021	0.0050	-	-	-
Ethylbenzene	ND	0.00093	0.0050	-	-	-
m,p-Xylene	ND	0.0024	0.010	-	-	-
o-Xylene	ND	0.00090	0.0050	-	-	-

Surrogate Recovery

2-Fluorotoluene	0.13			0.1	127	75-134
-----------------	------	--	--	-----	-----	--------

Analyte	LCS Result	LCSD Result	SPK Val	LCS %REC	LCSD %REC	LCS/LCSD Limits	RPD	RPD Limit
TPH(btex)	0.59	0.58	0.60	98	96	82-118	1.74	20
MTBE	0.071	0.066	0.10	71	66	61-119	6.47	20
Benzene	0.090	0.089	0.10	90	89	77-128	1.02	20
Toluene	0.094	0.096	0.10	94	96	74-132	1.93	20
Ethylbenzene	0.10	0.10	0.10	100	102	84-127	2.05	20
m,p-Xylene	0.21	0.21	0.20	104	106	80-120	1.95	20
o-Xylene	0.11	0.11	0.10	107	108	80-120	1.37	20

Surrogate Recovery

2-Fluorotoluene	0.11	0.10	0.10	106	104	75-134	1.70	20
-----------------	------	------	------	-----	-----	--------	------	----



Quality Control Report

Client: ACC Environmental Consultants, Inc.
Date Prepared: 12/28/2023
Date Analyzed: 12/30/2023
Instrument: GC39B
Matrix: Soil
Project: 3029.332.00; MLA Sherman

WorkOrder: 2312K27
BatchID: 284966
Extraction Method: SW3550B
Analytical Method: SW8015B
Unit: mg/Kg
Sample ID: MB/LCS/LCSD-284966

QC Report for SW8015B w/out SG Clean-Up

Analyte	MB Result	MDL	RL	SPK Val	MB SS %REC	MB SS Limits
TPH-Diesel (C10-C23)	ND	1.1	2.0	-	-	-
TPH-Motor Oil (C18-C36)	ND	4.3	10	-	-	-
Surrogate Recovery						
C9	24			25	95	70-130

Analyte	LCS Result	LCSD Result	SPK Val	LCS %REC	LCSD %REC	LCS/LCSD Limits	RPD	RPD Limit
TPH-Diesel (C10-C23)	44	45	40	111	112	70-130	0.821	20
Surrogate Recovery								
C9	24	25	25	98	101	70-130	3.32	20



1534 Willow Pass Rd
Pittsburg, CA 94565-1701
(925) 252-9262

CHAIN-OF-CUSTODY RECORD

WorkOrder: 2312K27

ClientCode: ACCE

- WaterTrax
 CLIP
 EDF
 EQuIS
 Dry-Weight
 Email
 HardCopy
 ThirdParty
 J-flag
 Detection Summary
 Excel

Report to:

Kim Bunting
ACC Environmental Consultants, Inc.
7977 Capwell Drive , Suite 100
Oakland, CA 94621
(510) 638-8400 FAX: (510) 638-8404

Email: kbunting@accenv.com; isutherland@accenv.com
cc/3rd Party:
PO:
Project: 3029.332.00; MLA Sherman

Bill to:

Accounts Payable
ACC Environmental Consultants, Inc.
7977 Capwell Drive , Suite 100
Oakland, CA 94621
accenvap@bill.com

Requested TAT: 5 days;

Date Received: 12/28/2023

Date Logged: 12/28/2023

Lab ID	ClientSampID	Matrix	Collection Date	Hold	Requested Tests (See legend below)												
					1	2	3	4	5	6	7	8	9	10	11	12	
2312K27-001	ACCB1/2/3/4-0.5	Soil	12/28/2023 07:55	<input type="checkbox"/>	A	A	A	A	A	A	A	A	A	A	A		

Test Legend:

1	8081pcB_ESL_LL_S	2	8260B_S	3	8270_SCSM_GPC_S	4	CAM17MS_TTLC_S
5	CARB435_400	6	G-MBTEX_S	7	PRDisposal Fee	8	STLC_MSEXTRACTONLY
9	TCLP_MSEXTRACTONLY	10	TPH(DMO)_S	11		12	

Project Manager: Jennifer Lagerbom

Prepared by: Agustina Venegas

The following SampID: 001A contains testgroup Multi Range_S.

Comments:

NOTE: Soil samples are discarded 60 days after receipt unless other arrangements are made (Water samples are 30 days).
Hazardous samples will be returned to client or disposed of at client expense.



WORK ORDER SUMMARY

Client Name: ACC ENVIRONMENTAL CONSULTANTS, INC.

Project: 3029.332.00; MLA Sherman

Work Order: 2312K27

Client Contact: Kim Bunting

QC Level: LEVEL 2

Contact's Email: kbunting@accenv.com; isutherland@accenv.com

Comments:

Date Logged: 12/28/2023

WaterTrax CLIP EDF Excel EQUIS Email HardCopy ThirdParty J-flag

Table with columns: LabID, ClientSampID, Matrix, Test Name, Containers /Composites, Bottle & Preservative, U**, Head Space, Dry-Weight, Collection Date & Time, TAT, Test Due Date, Sediment Content, Hold, Sub Out. Includes rows for various soil tests like TCLP, STLC, TPH, Asbestos, etc.

NOTES: * STLC and TCLP extractions require 2 days to complete; therefore, all TATs begin after the extraction is completed (i.e., One-day TAT yields results in 3 days from sample submission).

- ISM prep requires 5 to 10 days to complete; therefore, all TATs begin after the extraction is completed (i.e., One-day TAT yields results in 6 to 11 days from sample submission). Due date listed on WO summary will not accurately reflect the time needed for sample preparation.

- Organic extracts are held for 40 days before disposal; Inorganic extract are held for 30 days.

- MAI assumes that all material present in the provided sampling container is considered part of the sample - MAI does not exclude any material from the sample prior to sample preparation unless requested in writing by the client.

U** = An unpreserved container was received for a method that suggests a preservation in order to extend hold time for analysis.



McCAMPBELL ANALYTICAL, INC.

1534 Willow Pass Rd. Pittsburg, Ca. 94565-1701

Telephone: (877) 252-9262 / Fax: (925) 252-9269

www.mccampbell.com

main@mccampbell.com

CHAIN OF CUSTODY RECORD

Turn Around Time: 1 Day Rush	2 Day Rush	3 Day Rush	STD	Quote #
J-Flag / MDL <input checked="" type="checkbox"/>	ESL <input checked="" type="checkbox"/>	Cleanup Approved	Dry Weight	Bottle Order #
Delivery Format: PDF	GeoTracker EDF	EDD	Write On (DW)	Detect Summary

Report To: Kimberly Bunting Bill To: ACC
 Company: ACC Environmental
 Address: 7977 Capwell Drive Suite 100
 Email: Kbunting@accenv.com Tele: 707 481-0795
 Project Name: MLA Sherman Project #: 3029-332-00
 Project Location: 5328 Braun St. PO #
 Sampler Signature: [Signature]

Analysis Requested

SAMPLE ID Location / Field Point	Sampling		#Containers	Matrix	Preservative	Multi Range as Gas, Diesel, and Motor Oil (8021/8015)	BTEX & TPH as Gas (8021/8015) MTBE	TPH as Diesel (8015) + Motor Oil Without Silica Gel	TPH as Diesel (8015) + Motor Oil With Silica Gel	Total Oil & Grease (1664 / 9071) Without Silica Gel	Total Petroleum Hydrocarbons - Oil & Grease (1664 / 9071) With Silica Gel	Total Petroleum Hydrocarbons (418.1) With Silica Gel	EPA 509 / 608 / 8081 (CI Pesticides)	EPA 608 / 8082 PCB's; Aroclors only	EPA 524.2 / 624 / 8260 (VOCs)	EPA 525.2 / 625 / 8270 (SVOCs)	EPA 8270 SIM / 8310 (PAHs / FNAAs)	CAM 17 Metals (200.8 / 6020)*	Metals (200.8 / 6020)*	Baylands Requirements	Lab to filter sample for dissolved metals analysis	CARB 435	STILL FULL OIL + HOLD		
	Date	Time																							
ACCB1-0.5	12/28/23	7:25	1	Soil	ACC	X																			
ACCB2-0.5	↓	7:30	1	↓	↓	X																			
ACCB3-0.5	↓	7:45	1	↓	↓	X																			
ACCB4-0.5	↓	7:55	1	↓	↓	X																			

MAI clients MUST disclose any dangerous chemicals known to be present in their submitted samples in concentrations that may cause immediate harm or serious future health endangerment as a result of brief, gloved, open air, sample handling by MAI staff. Non-disclosure incurs an immediate \$250 surcharge and the client is subject to full legal liability for harm suffered. Thank you for your understanding and for allowing us to work safely.

* If metals are requested for water samples and the water type (Matrix) is not specified on the chain of custody, MAI will default to metals by E200.8.

Please provide an adequate volume of sample. If the volume is not sufficient for a MS/MSD a LCS/LCSD will be prepared in its place and noted in the report.

Relinquished By / Company Name	Date	Time	Received By / Company Name	Date	Time
<u>Davis Leach / ACC</u>	<u>12/28/23</u>	<u>10:19</u>	<u>[Signature]</u>	<u>12/28/23</u>	<u>10:19</u>

Comments / Instructions
4/1 comp
(Hubs)

Matrix Code: DW=Drinking Water, GW=Ground Water, WW=Waste Water, SW=Seawater, S=Soil, SL=Sludge, A=Air, WP=Wipe, O=Other
 Preservative Code: 1=4°C 2=HCl 3=H₂SO₄ 4=HNO₃ 5=NaOH 6=ZnOAc/NaOH 7=None

Temp 12.2°C Initials BLVE



Sample Receipt Checklist

Client Name: ACC Environmental Consultants, Inc.
 Project: 3029.332.00; MLA Sherman

Date and Time Received: 12/28/2023 10:19
 Date Logged: 12/28/2023
 Received by: Agustina Venegas
 Logged by: Agustina Venegas

WorkOrder No: 2312K27 Matrix: Soil
 Carrier: Client Drop-In

Chain of Custody (COC) Information

Chain of custody present?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	
Chain of custody signed when relinquished and received?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	
Chain of custody agrees with sample labels?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	
Sample IDs noted by Client on COC?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	
Date and Time of collection noted by Client on COC?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	
Sampler's name noted on COC?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	
COC agrees with Quote?	Yes <input type="checkbox"/>	No <input type="checkbox"/>	NA <input checked="" type="checkbox"/>

Sample Receipt Information

Custody seals intact on shipping container/cooler?	Yes <input type="checkbox"/>	No <input type="checkbox"/>	NA <input checked="" type="checkbox"/>
Custody seals intact on sample bottles?	Yes <input type="checkbox"/>	No <input type="checkbox"/>	NA <input checked="" type="checkbox"/>
Shipping container/cooler in good condition?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	
Samples in proper containers/bottles?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	
Sample containers intact?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	
Sufficient sample volume for indicated test?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	

Sample Preservation and Hold Time (HT) Information

All samples received within holding time?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	NA <input type="checkbox"/>
Samples Received on Ice?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	

(Ice Type: BLUE ICE)

Sample/Temp Blank temperature	Temp: 12.2°C		NA <input type="checkbox"/>
ZHS conditional analyses: VOA meets zero headspace requirement (VOCs, TPHg/BTEX, RSK)?	Yes <input type="checkbox"/>	No <input type="checkbox"/>	NA <input checked="" type="checkbox"/>
Sample labels checked for correct preservation?	Yes <input checked="" type="checkbox"/>	No <input type="checkbox"/>	
pH acceptable upon receipt (Metal: <2; Nitrate 353.2/4500NO3: <2; 522: <4; 218.7: >8)?	Yes <input type="checkbox"/>	No <input type="checkbox"/>	NA <input checked="" type="checkbox"/>

UCMR Samples:

pH tested and acceptable upon receipt (200.7: ≤2; 533: 6 - 8; 537.1: 6 - 8)?	Yes <input type="checkbox"/>	No <input type="checkbox"/>	NA <input checked="" type="checkbox"/>
Free Chlorine tested and acceptable upon receipt (<0.1mg/L) [not applicable to 200.7]?	Yes <input type="checkbox"/>	No <input type="checkbox"/>	NA <input checked="" type="checkbox"/>

 Comments: