

J.C. Broderick & Associates, Inc.

Environmental / Construction Consulting & Testing



December 29, 2020

Mr. Martin Abrams
Herricks Union Free School District
Herricks Community Center
999 Herricks Road
New Hyde Park, New York 11040

Re: **Lead Testing in School Drinking Water
2020 Compliance 10 NYCRR Subpart 67-4**

JCB#: **19-43807**

Dear Mr. Abrams:

J.C. Broderick & Associates, Inc. (JCB) was retained to perform lead testing and analysis of the outlets which service the above referenced school district in accordance with 10 NYCRR Subpart 67-4 (Subpart 67-4).

The outlets servicing each of the school buildings were inventoried and assigned unique identification numbers. The use and location of each outlet was reviewed to determine its applicability for testing under Subpart 67-4.

An initial first-draw sample was collected from each applicable outlet after the minimum 8-hour stagnation period. Samples were logged into a chain of custody document and delivered to an Environmental Laboratory Approval Program (ELAP) accredited laboratory for analysis.

Results from the laboratory analysis were compared with the Action Level as defined by Subpart 67-4 of 15 parts per billion (ppb). Any outlet which exceeded this level requires a remediation action plan be implemented (i.e. removal from service, placarding for non-drinking uses). Outlets which did not exceed the action level do not require further testing or remediation.

Please see the following attachments which detail the sampling and analysis performed and remediation actions taken to date.

Attachment 1: Lead Testing Results for Applicable Outlets

Attachment 2: Laboratory Analytical Reports

Attachment 3: Laboratory Certifications

If you have any questions, or if more information is needed, please contact our office.


Sincerely,

A handwritten signature in black ink, appearing to read 'George Greve', is located below the 'Sincerely,' text.

George Greve
J C Broderick & Associates, Inc.

Attachment 1:

Lead Testing Results
for Applicable Outlets

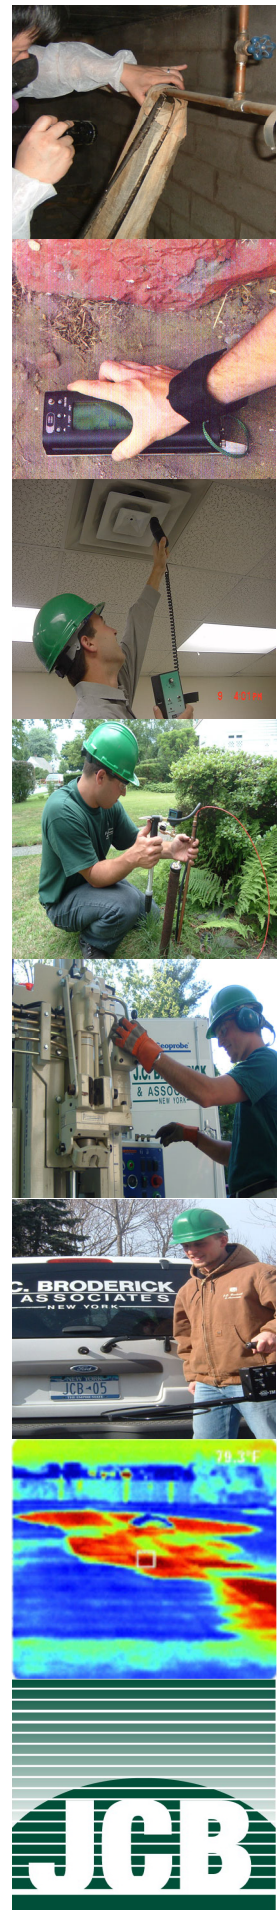

J.C. Broderick & Associates, Inc.

Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395





Laboratory Lead in Water Results

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-43807

Herricks Union Free School District

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
Center Street Elementary School							
HERR-0001	1001	Gym	Water Fountain-No Chiller	Potable	10/20/2020	7.1	Sample Passed, No Action Needed
HERR-0002	1001	Gym	Water Fountain-No Chiller	Potable	10/20/2020	4.4	Sample Passed, No Action Needed
HERR-0006	1007	Room 40	Classroom Faucet	Non-Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0008	1009	Room 29	Classroom Faucet	Non-Potable	10/20/2020	1.9	Sample Passed, No Action Needed
HERR-0010	1010	Room 39	Classroom Faucet	Non-Potable	10/20/2020	6.0	Sample Passed, No Action Needed
HERR-0012	1010	Room 39	Bottled Water Dispenser	Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0013	1007	Room 40	Bottled Water Dispenser	Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0015	1012	Faculty Bathroom	Bathroom Faucet	Non-Potable	10/20/2020	2.4	Sample Passed, No Action Needed
HERR-0016	1013	Room 30	Classroom Faucet	Non-Potable	10/20/2020	6.0	Sample Passed, No Action Needed
HERR-0018	1015	Boys Bathroom	Bathroom Faucet	Non-Potable	10/20/2020	2.5	Sample Passed, No Action Needed
HERR-0019	1015	Boys Bathroom	Bathroom Faucet	Non-Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0020	1016	Room 31	Bottled Water Dispenser	Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-0021	1016	Room 31	Classroom Faucet	Non-Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0022	1016	Room 31	Water Fountain-No Chiller	Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0023	1017	Room 38	Bottled Water Dispenser	Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0025	1017	Room 38	Classroom Faucet	Non-Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0026	1018	Room 37	Classroom Faucet	Non-Potable	10/20/2020	1.2	Sample Passed, No Action Needed
HERR-0028	1018	Room 37	Bottled Water Dispenser	Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0029	1019	Room 32	Classroom Faucet	Non-Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0031	1019	Room 32	Bottled Water Dispenser	Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0032	1020	Room 36	Bottled Water Dispenser	Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0034	1020	Room 36	Classroom Faucet	Non-Potable	10/20/2020	1.8	Sample Passed, No Action Needed
HERR-0035	1021	Room 33	Classroom Faucet	Non-Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0036	1021	Room 33	Water Fountain-No Chiller	Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0037	1021	Room 33	Bottled Water Dispenser	Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0038	1022	Room 34	Bottled Water Dispenser	Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0039	1022	Room 34	Water Fountain-No Chiller	Potable	10/20/2020	6.3	Sample Passed, No Action Needed

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-0040	1022	Room 34	Classroom Faucet	Non-Potable	10/20/2020	2.3	Sample Passed, No Action Needed
HERR-0041	1023	Room 35	Classroom Faucet	Non-Potable	10/20/2020	1.1	Sample Passed, No Action Needed
HERR-0043	1023	Room 35	Bottled Water Dispenser	Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0044	1025	Boy's Bathroom	Bathroom Faucet	Non-Potable	10/20/2020	1.5	Sample Passed, No Action Needed
HERR-0045	1025	Boy's Bathroom	Bathroom Faucet	Non-Potable	10/20/2020	2.4	Sample Passed, No Action Needed
HERR-0046	1025	Boy's Bathroom	Bathroom Faucet	Non-Potable	10/20/2020	4.3	Sample Passed, No Action Needed
HERR-0047	1025	Women's Bathroom	Bathroom Faucet	Non-Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0049	1025A	Girls Bathroom	Bathroom Faucet	Non-Potable	10/20/2020	1.6	Sample Passed, No Action Needed
HERR-0050	1025A	Girls Bathroom	Bathroom Faucet	Non-Potable	10/20/2020	1.2	Sample Passed, No Action Needed
HERR-0051	1028	Room 5A/5B Kitchen/Storage	Classroom Faucet	Non-Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0052	1029	Room 4	Classroom Faucet	Non-Potable	10/20/2020	3.5	Sample Passed, No Action Needed
HERR-0053	1029	Room 4	Water Fountain-No Chiller	Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0054	1030A	Main Office Kitchenette	Classroom Faucet	Non-Potable	10/20/2020	3.5	Sample Passed, No Action Needed
HERR-0055	1031	Room 3 Faculty Lounge	Classroom Faucet	Non-Potable	10/20/2020	1.1	Sample Passed, No Action Needed
HERR-0056	1031	Room 3 Faculty Lounge	Water Fountain-No Chiller	Potable	10/20/2020	25	Removed From Service, Pending Remediation

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-0058	1032	Nurses Office/Entrance	Nurse's Office Sink	Potable	10/20/2020	4.5	Sample Passed, No Action Needed
HERR-0059	1032C	Nurses Bathroom	Bathroom Faucet	Non-Potable	10/20/2020	8.7	Sample Passed, No Action Needed
HERR-0060	1033	Room 2	Classroom Faucet	Non-Potable	10/20/2020	2.6	Sample Passed, No Action Needed
HERR-0061	1033	Room 2	Water Fountain-No Chiller	Potable	10/20/2020	8.9	Sample Passed, No Action Needed
HERR-0062	1037	Corridor Outside Main Office	Bottled Water Dispenser	Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0064	1034	Art Room 43	Classroom Faucet	Non-Potable	10/20/2020	1.8	Sample Passed, No Action Needed
HERR-0065	1034	Art Room 43	Classroom Faucet	Non-Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0066	1034	Art Room 43	Water Fountain-No Chiller	Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0069	1042	Cafeteria	Bottled Water Dispenser	Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0071	1042F	Cafeteria Room 45	Classroom Faucet	Non-Potable	10/20/2020	51	Placarded for Non-Drinking Use Until Remediated
HERR-0072	1042C	Cafeteria Kitchen	Kitchen Faucet (Cold)	Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0074	1042C	Cafeteria Kitchen	Kitchen Faucet (Cold)	Potable	10/20/2020	9.0	Sample Passed, No Action Needed
HERR-0076	1042B1	Cafeteria Kitchen Hall Bathroom	Bathroom Faucet	Non-Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0077	NEW	Media	Classroom Faucet	Non-Potable	10/20/2020	1.6	Sample Passed, No Action Needed
HERR-0078	NEW	Room 7	Classroom Faucet	Non-Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-0079	NEW	Room 7	Water Fountain-No Chiller	Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0080	NEW	Room 7 Bathroom	Bathroom Faucet	Non-Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0081	NEW	Room 6	Classroom Faucet	Non-Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0082	NEW	Room 6	Bottled Water Dispenser	Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0083	NEW	Room 6 Bathroom	Bathroom Faucet	Non-Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0084	NEW	Room 6 and 7 Corridor	Water Fountain-No Chiller	Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0085	NEW	Room 6 and 7 Corridor	Water Fountain-No Chiller	Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0087	1043	Room 8	Classroom Faucet	Non-Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0090	1044	Room 9	Classroom Faucet	Non-Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0091	1045	Room 10	Classroom Faucet	Non-Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0092	1045	Room 10	Water Fountain-No Chiller	Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0096	1046	Room 11	Classroom Faucet	Non-Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0097	1047	Room 27	Classroom Faucet	Non-Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0098	1047	Room 27	Water Fountain-No Chiller	Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0101	1048	Room 26	Water Fountain-No Chiller	Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-0102	1048	Room 26	Classroom Faucet	Non-Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0103	1049	Room 12	Classroom Faucet	Non-Potable	10/20/2020	2.5	Sample Passed, No Action Needed
HERR-0104	1049	Room 12	Water Fountain-No Chiller	Potable	10/20/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0106	1050	Room 13	Water Fountain-No Chiller	Potable	10/20/2020	3.1	Sample Passed, No Action Needed
HERR-0107	1050	Room 13	Classroom Faucet	Non-Potable	10/20/2020	1.4	Sample Passed, No Action Needed
HERR-0108	1051	Room 25	Classroom Faucet	Non-Potable	10/21/2020	1.6	Sample Passed, No Action Needed
HERR-0111	NEW	Room 14	Water Fountain-No Chiller	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0112	NEW	Room 14	Classroom Faucet	Non-Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0113	NEW	Room 14 Bathroom	Bathroom Faucet	Non-Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0114	NEW	Room 25	Classroom Faucet	Non-Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0115	NEW	Room 25	Water Fountain-No Chiller	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0116	NEW	Room 25 Bathroom	Bathroom Faucet	Non-Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0117	NEW	Room 15	Classroom Faucet	Non-Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0118	NEW	Room 15	Water Fountain-No Chiller	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0119	NEW	Room 23	Classroom Faucet	Non-Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-0120	NEW	Room 23	Water Fountain-No Chiller	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0123	NEW	Boy's Bathroom	Bathroom Faucet	Non-Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0124	NEW	Room 22	Classroom Faucet	Non-Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0125	NEW	Room 22	Water Fountain-No Chiller	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0127	NEW	Faculty Bathroom	Bathroom Faucet	Non-Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0131	NEW	Hallway	Bottled Water Dispenser	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0133	NEW	Room 20	Classroom Faucet	Non-Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0134	NEW	Room 20	Water Fountain-No Chiller	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0135	NEW	Room 16	Classroom Faucet	Non-Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0136	NEW	Room 16	Water Fountain-No Chiller	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0137	NEW	Room 19	Classroom Faucet	Non-Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0138	NEW	Room 19	Water Fountain-No Chiller	Potable	10/21/2020	2	Sample Passed, No Action Needed
HERR-0139	NEW	Room 18	Classroom Faucet	Non-Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0140	NEW	Room 18	Water Fountain-No Chiller	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0141	NEW	Room 17	Classroom Faucet	Non-Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-0142	NEW	Room 17	Water Fountain-No Chiller	Potable	10/21/2020	1.2	Sample Passed, No Action Needed
Denton Avenue Elementary School							
HERR-0154	2008	Cafeteria	Bottled Water Dispenser	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0156	2006	Kitchen	Kitchen Faucet (Cold)	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0158	2006	Kitchen	Kitchen Faucet (Cold)	Potable	10/21/2020	6.9	Sample Passed, No Action Needed
HERR-0160	2007A	Kitchen Bathroom	Bathroom Faucet	Non-Potable	10/21/2020	1.1	Sample Passed, No Action Needed
HERR-0161	2009	Cafeteria Music Room 47	Classroom Faucet	Non-Potable	10/21/2020	29	Placarded for Non-Drinking Use Until Remediated
HERR-0163	2014	Art Room 6	Classroom Faucet	Non-Potable	10/21/2020	5.8	Sample Passed, No Action Needed
HERR-0164	2014	Art Room 6	Water Fountain-No Chiller	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0165	2014	Art Room 6	Classroom Faucet	Non-Potable	10/21/2020	61	Placarded for Non-Drinking Use Until Remediated
HERR-0168	2016A	Nurses Office Vestibule Bathroom	Bathroom Faucet	Non-Potable	10/21/2020	7.3	Sample Passed, No Action Needed
HERR-0169	2017	Nurses Office Bed Area	Nurse's Office Sink	Potable	10/21/2020	3.4	Sample Passed, No Action Needed
HERR-0170	2028	Girls Bathroom	Bathroom Faucet	Non-Potable	10/21/2020	3.5	Sample Passed, No Action Needed
HERR-0171	2028	Girls Bathroom	Bathroom Faucet	Non-Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0173	2027	Women's Bathroom (by Room 4)	Bathroom Faucet	Non-Potable	10/21/2020	1.1	Sample Passed, No Action Needed

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-0174	2026	Boys Bathroom	Bathroom Faucet	Non-Potable	10/21/2020	2.4	Sample Passed, No Action Needed
HERR-0175	2026	Boys Bathroom	Bathroom Faucet	Non-Potable	10/21/2020	1.8	Sample Passed, No Action Needed
HERR-0176	2026	Boys Bathroom	Bathroom Faucet	Non-Potable	10/21/2020	7.9	Sample Passed, No Action Needed
HERR-0177	2032	Men's Bathroom	Bathroom Faucet	Non-Potable	10/21/2020	2.1	Sample Passed, No Action Needed
HERR-0178	2033	Women's Bathroom	Bathroom Faucet	Non-Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0179	2023	Main Office Kitchen/Copy Room Storage	Classroom Faucet	Non-Potable	10/21/2020	3.3	Sample Passed, No Action Needed
HERR-0180	2035	Room 1	Classroom Faucet	Non-Potable	10/21/2020	2.8	Sample Passed, No Action Needed
HERR-0181	2035	Room 1	Water Fountain-No Chiller	Potable	10/21/2020	10	Sample Passed, No Action Needed
HERR-0182	2036	Room 2	Classroom Faucet	Non-Potable	10/21/2020	1.8	Sample Passed, No Action Needed
HERR-0183	2036	Room 2	Water Fountain-No Chiller	Potable	10/21/2020	2.4	Sample Passed, No Action Needed
HERR-0184	2037	Room 3	Classroom Faucet	Non-Potable	10/21/2020	1.3	Sample Passed, No Action Needed
HERR-0185	2037	Room 3	Water Fountain-No Chiller	Potable	10/21/2020	2	Sample Passed, No Action Needed
HERR-0186	2040	Faculty Lounge Kitchen	Classroom Faucet	Non-Potable	10/21/2020	1.2	Sample Passed, No Action Needed
HERR-0187	NEW	Room 22	Classroom Faucet	Non-Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0188	NEW	Room 22	Water Fountain-No Chiller	Potable	10/21/2020	2	Sample Passed, No Action Needed

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-0189	NEW	Room 21	Classroom Faucet	Non-Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0190	NEW	Room 21	Water Fountain-No Chiller	Potable	10/21/2020	1.9	Sample Passed, No Action Needed
HERR-0191	NEW	Corridor	Bottled Water Dispenser	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0193	NEW	Room 19	Classroom Faucet	Non-Potable	10/21/2020	9.4	Sample Passed, No Action Needed
HERR-0194	NEW	Room 19	Water Fountain-No Chiller	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0195	NEW	Room 18	Classroom Faucet	Non-Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0196	NEW	Room 18	Water Fountain-No Chiller	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0198	NEW	Girls Bathroom	Bathroom Faucet	Non-Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0199	NEW	Girls Bathroom	Bathroom Faucet	Non-Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0200	NEW	Faculty Bathroom	Bathroom Faucet	Non-Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0202	NEW	Boy's Bathroom	Bathroom Faucet	Non-Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0203	NEW	Boy's Bathroom	Bathroom Faucet	Non-Potable	10/21/2020	2.7	Sample Passed, No Action Needed
HERR-0206	NEW	Room 17	Classroom Faucet	Non-Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0207	NEW	Room 17	Water Fountain-No Chiller	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0208	NEW	Room 16	Classroom Faucet	Non-Potable	10/21/2020	1.5	Sample Passed, No Action Needed

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-0209	NEW	Room 16	Water Fountain-No Chiller	Potable	10/21/2020	2.5	Sample Passed, No Action Needed
HERR-0210	NEW	Room 23	Classroom Faucet	Non-Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0211	NEW	Room 23	Water Fountain-No Chiller	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0212	NEW	Room 15	Classroom Faucet	Non-Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0213	NEW	Room 15	Water Fountain-No Chiller	Potable	10/21/2020	26	Removed From Service, Pending Remediation
HERR-0214	NEW	Room 24	Classroom Faucet	Non-Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0215	NEW	Room 24	Water Fountain-No Chiller	Potable	10/21/2020	2.9	Sample Passed, No Action Needed
HERR-0216	NEW	Room 25	Classroom Faucet	Non-Potable	10/21/2020	2.1	Sample Passed, No Action Needed
HERR-0217	NEW	Room 25	Water Fountain-No Chiller	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0218	NEW	Room 14	Classroom Faucet	Non-Potable	10/21/2020	5.6	Sample Passed, No Action Needed
HERR-0219	NEW	Room 14	Water Fountain-No Chiller	Potable	10/21/2020	2	Sample Passed, No Action Needed
HERR-0220	2049	Room 13	Classroom Faucet	Non-Potable	10/21/2020	6.2	Sample Passed, No Action Needed
HERR-0221	2049	Room 13	Water Fountain-No Chiller	Potable	10/21/2020	2.8	Sample Passed, No Action Needed
HERR-0222	2050	Room 12	Classroom Faucet	Non-Potable	10/21/2020	9.8	Sample Passed, No Action Needed
HERR-0223	2050	Room 12	Water Fountain-No Chiller	Potable	10/21/2020	5.3	Sample Passed, No Action Needed

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-0224	2055	Room 11	Classroom Faucet	Non-Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0225	2055	Room 11	Water Fountain-No Chiller	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0226	2056	Room 10	Water Fountain-No Chiller	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0227	2056	Room 10	Classroom Faucet	Non-Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0228	2061	Room 9	Classroom Faucet	Non-Potable	10/21/2020	3.3	Sample Passed, No Action Needed
HERR-0229	2061	Room 9	Water Fountain-No Chiller	Potable	10/21/2020	1.2	Sample Passed, No Action Needed
HERR-0230	2074	Room 28	Classroom Faucet	Non-Potable	10/21/2020	2.8	Sample Passed, No Action Needed
HERR-0231	2074	Room 28	Water Fountain-No Chiller	Potable	10/21/2020	2	Sample Passed, No Action Needed
HERR-0233	2069	Room 27	Classroom Faucet	Non-Potable	10/21/2020	6.2	Sample Passed, No Action Needed
HERR-0234	2068	Room 26	Water Fountain-No Chiller	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0235	2068	Room 26	Classroom Faucet	Non-Potable	10/21/2020	5.5	Sample Passed, No Action Needed
HERR-0236	NEW	Corridor	Water Fountain-No Chiller	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0237	NEW	Corridor	Water Fountain-No Chiller	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0238	NEW	Room 8	Classroom Faucet	Non-Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0239	NEW	Room 8	Water Fountain-No Chiller	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-0240	NEW	Room 8 Bathroom	Bathroom Faucet	Non-Potable	10/21/2020	1	Sample Passed, No Action Needed
HERR-0241	NEW	Room 7	Classroom Faucet	Non-Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0242	NEW	Room 7	Water Fountain-No Chiller	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0243	NEW	Room 7 Bathroom	Bathroom Faucet	Non-Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0245	2075	Room 29	Classroom Faucet	Non-Potable	10/21/2020	4.1	Sample Passed, No Action Needed
HERR-0246	2075	Room 29	Water Fountain-No Chiller	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0247	2076	Room 30	Water Fountain-No Chiller	Potable	10/21/2020	3.1	Sample Passed, No Action Needed
HERR-0248	2076	Room 30	Classroom Faucet	Non-Potable	10/21/2020	6.2	Sample Passed, No Action Needed
HERR-0249	2077	Room 31	Classroom Faucet	Non-Potable	10/21/2020	5.8	Sample Passed, No Action Needed
HERR-0250	2077	Room 31	Water Fountain-No Chiller	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0252	2078	Room 32	Classroom Faucet	Non-Potable	10/21/2020	8.7	Sample Passed, No Action Needed
HERR-0253	2081	Room 34	Classroom Faucet	Non-Potable	10/21/2020	3.5	Sample Passed, No Action Needed
HERR-0254	2081	Room 34	Water Fountain-No Chiller	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0255	2082	Room 35	Classroom Faucet	Non-Potable	10/21/2020	5.0	Sample Passed, No Action Needed
HERR-0256	2082	Room 35	Water Fountain-No Chiller	Potable	10/21/2020	23	Removed From Service, Pending Remediation

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-0257	2087	Room 36	Water Fountain-No Chiller	Potable	10/21/2020	1.4	Sample Passed, No Action Needed
HERR-0258	2087	Room 36	Classroom Faucet	Non-Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0259	2090	Room 37	Classroom Faucet	Non-Potable	10/21/2020	3.5	Sample Passed, No Action Needed
HERR-0260	2090	Room 37	Water Fountain-No Chiller	Potable	10/21/2020	290	Removed From Service, Pending Remediation
HERR-0261	2093	Room 38	Water Fountain-No Chiller	Potable	10/21/2020	13	Sample Passed, No Action Needed
HERR-0262	2093	Room 38	Classroom Faucet	Non-Potable	10/21/2020	1.7	Sample Passed, No Action Needed
HERR-0263	2095	Room 39	Classroom Faucet	Non-Potable	10/21/2020	3.5	Sample Passed, No Action Needed
HERR-0264	2095	Room 39	Water Fountain-No Chiller	Potable	10/21/2020	16	Removed From Service, Pending Remediation
HERR-0266	2099	Room 40	Classroom Faucet	Non-Potable	10/21/2020	16	Placarded for Non-Drinking Use Until Remediated
HERR-0267	2100	Boys Bathroom	Bathroom Faucet	Non-Potable	10/21/2020	23	Placarded for Non-Drinking Use Until Remediated
HERR-0268	2100	Boys Bathroom	Bathroom Faucet	Non-Potable	10/21/2020	2.5	Sample Passed, No Action Needed
HERR-0270	2102	Women's Bathroom	Bathroom Faucet	Non-Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0271	2102	Women's Bathroom	Bathroom Faucet	Non-Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0272	2105	Room 41	Water Fountain-No Chiller	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0273	2105	Room 41	Classroom Faucet	Non-Potable	10/21/2020	3.4	Sample Passed, No Action Needed

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-0274	2106	Room 42	Classroom Faucet	Non-Potable	10/21/2020	8.1	Sample Passed, No Action Needed
HERR-0275	2106	Room 42	Water Fountain-No Chiller	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0276	2107	Room 43	Water Fountain-No Chiller	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0277	2107	Room 43	Classroom Faucet	Non-Potable	10/21/2020	6.0	Sample Passed, No Action Needed
HERR-0278	2108	Room 44	Classroom Faucet	Non-Potable	10/21/2020	2.2	Sample Passed, No Action Needed
HERR-0281	2112	Gym	Water Fountain-No Chiller	Potable	10/21/2020	38	Removed From Service, Pending Remediation
HERR-0282	2112	Gym	Water Fountain-No Chiller	Potable	10/21/2020	1.5	Sample Passed, No Action Needed
HERR-0283	2122	Gym Girls Toilet	Bathroom Faucet	Non-Potable	10/21/2020	3.1	Sample Passed, No Action Needed
HERR-0284	2121	Gym Boys Toilet	Bathroom Faucet	Non-Potable	10/21/2020	3.9	Sample Passed, No Action Needed
HERR-1001	2075	Room 29	Bottle Fill Station	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-1002	2076	Room 30	Bottle Fill Station	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-1003	2077	Room 31	Bottle Fill Station	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-1004	2081	Room 34	Bottle Fill Station	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-1005	2082	Room 35	Bottle Fill Station	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-1006	2087	Room 36	Bottle Fill Station	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-1007	2090	Room 37	Bottle Fill Station	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-1008	2095	Room 39	Bottle Fill Station	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-1009	2105	Room 41	Bottle Fill Station	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-1010	2106	Room 42	Bottle Fill Station	Potable	10/21/2020	<3.0 ND	Sample Passed, No Action Needed

Herricks Community Center

HERR-0891	2022	Room 122	Classroom Faucet	Non-Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0892	2023	Room 120	Classroom Faucet	Non-Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0893	2023	Room 120	Classroom Faucet	Non-Potable	10/23/2020	5.7	Sample Passed, No Action Needed
HERR-0895	2024	Corridor Room 119 To Custodial Closet	Water Fountain-No Chiller	Potable	10/23/2020	1.6	Sample Passed, No Action Needed
HERR-0896	2024	Corridor Room 119 To Custodial Closet	Bottled Water Dispenser	Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0898	2035	Room 118	Classroom Faucet	Non-Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0899	2035	Room 118	Classroom Faucet	Non-Potable	10/23/2020	2.5	Sample Passed, No Action Needed
HERR-0901	2028	Room 119	Classroom Faucet	Non-Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0904	2030A	Room 115	Classroom Faucet	Non-Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0906	2030A1	Room 117A Bathroom	Bathroom Faucet	Non-Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-0907	2030A1	Room 117A Bathroom	Bathroom Faucet	Non-Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0909	2044	Boys Bathroom	Bathroom Faucet	Non-Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0910	2037	Part of Kitchen	Kitchen Faucet (Cold)	Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0912	2037	Part of Kitchen	Kitchen Faucet (Cold)	Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0913	2037	Part of Kitchen	Spray Nozzle	Non-Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0914	2045	Girls Bathroom	Bathroom Faucet	Non-Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0915	2045	Girls Bathroom	Bathroom Faucet	Non-Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0916	2045	Girls Bathroom	Bathroom Faucet	Non-Potable	10/23/2020	4.3	Sample Passed, No Action Needed
HERR-0917	2046	Women's Bathroom	Bathroom Faucet	Non-Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0918	2046	Women's Bathroom	Bathroom Faucet	Non-Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0919	2047	Men's Bathroom	Bathroom Faucet	Non-Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0920	2052	Corridor Outside Shops	Water Fountain-No Chiller	Potable	10/23/2020	3.8	Sample Passed, No Action Needed
HERR-0922	2048	Shop 2	Water Fountain-No Chiller	Potable	10/23/2020	13	Sample Passed, No Action Needed
HERR-0923	2051B	Shop 1 Office Lounge Area	Water Cooler	Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0924	2051C	Shop 1 Bathroom	Classroom Faucet	Non-Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-0925	2053	Cafeteria	Bottled Water Dispenser	Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0927	2053	Cafeteria	Water Fountain-No Chiller	Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0928	2055	Kitchen	Kitchen Faucet (Cold)	Potable	10/23/2020	2.1	Sample Passed, No Action Needed
HERR-0931	2055	Kitchen	Kitchen Faucet (Cold)	Potable	10/23/2020	9.9	Sample Passed, No Action Needed
HERR-0932	2055	Kitchen	Kitchen Faucet (Cold)	Non-Potable	10/23/2020	920	Placarded for Non-Drinking Use Until Remediated
HERR-0934	2055	Kitchen	Kitchen Faucet (Cold)	Potable	10/23/2020	1.3	Sample Passed, No Action Needed
HERR-0936	2077	Corridor Breezeway To Cafeteria	Bottled Water Dispenser	Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0937	2077	Corridor Breezeway To Cafeteria	Water Fountain-No Chiller	Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0939	2091	Toddlers Bathroom	Bathroom Faucet	Non-Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0940	2091	Toddlers Bathroom	Bathroom Faucet	Non-Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0942	2091	Toddlers Bathroom	Bathroom Faucet	Non-Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0944	2094	Men's Bathroom Vestibule Storage Closet	Bathroom Faucet	Non-Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0948	2114	Room 108A Women's Teachers Vestibule	Water Fountain-No Chiller	Potable	10/23/2020	4.7	Sample Passed, No Action Needed
HERR-0949	2115	Women/Girls Bathroom Adjacent B 11	Bathroom Faucet	Non-Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0950	2115	Women/Girls Bathroom Adjacent B 11	Bathroom Faucet	Non-Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-0951	2115	Women/Girls Bathroom Adjacent B 11	Bathroom Faucet	Non-Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0952	2115	Women/Girls Bathroom Adjacent B 11	Bathroom Faucet	Non-Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0956	2137	Room 114	Classroom Faucet	Non-Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0957	2137	Room 114	Spray Nozzle	Non-Potable	10/23/2020	7.4	Sample Passed, No Action Needed
HERR-0958	2137	Room 114	Classroom Faucet	Non-Potable	10/23/2020	2.2	Sample Passed, No Action Needed
HERR-0959	2137	Room 114	Spray Nozzle	Non-Potable	10/23/2020	17	Placarded for Non-Drinking Use Until Remediated
HERR-0960	2137	Room 114	Classroom Faucet	Non-Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0961	2137	Room 114	Spray Nozzle	Non-Potable	10/23/2020	15	Sample Passed, No Action Needed
HERR-0962	2137	Room 114	Classroom Faucet	Non-Potable	10/23/2020	13	Sample Passed, No Action Needed
HERR-0963	2137A	Room 114 Bathroom	Bathroom Faucet	Non-Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0964	2154	Auxiliary Gym Closet	Ice Machine	Potable	10/23/2020	3.8	Sample Passed, No Action Needed
HERR-0965	2149	Girls Locker Room	Bathroom Faucet	Non-Potable	10/23/2020	3.6	Sample Passed, No Action Needed
HERR-0966	2149	Girls Locker Room	Bathroom Faucet	Non-Potable	10/23/2020	6.2	Sample Passed, No Action Needed
HERR-0967	2149	Girls Locker Room	Bathroom Faucet	Non-Potable	10/23/2020	9.0	Sample Passed, No Action Needed
HERR-0968	2149	Girls Locker Room	Water Fountain-No Chiller	Potable	10/23/2020	4.2	Sample Passed, No Action Needed

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-0969	2160	Gym A	Bottled Water Dispenser	Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0970	2160	Gym A	Water Fountain-No Chiller	Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0971	2168	Boys Locker Room	Bathroom Faucet	Non-Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0972	2168	Boys Locker Room	Bathroom Faucet	Non-Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0973	2168	Boys Locker Room	Bathroom Faucet	Non-Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0975	3185B	Ladies Bathroom	Bathroom Faucet	Non-Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0976	3185B	Ladies Bathroom	Bathroom Faucet	Non-Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0977	3185B	Ladies Bathroom	Bathroom Faucet	Non-Potable	10/23/2020	1.5	Sample Passed, No Action Needed
HERR-0980	3197	2nd Floor Corridor	Bottled Water Dispenser	Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0981	3197	2nd Floor Corridor	Water Fountain-No Chiller	Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0982	3185B	Ladies Bathroom	Bathroom Faucet	Non-Potable	10/23/2020	9.5	Sample Passed, No Action Needed
HERR-0983	3185B	Ladies Bathroom	Bathroom Faucet	Non-Potable	10/23/2020	6.6	Sample Passed, No Action Needed
HERR-0984	3185B	Ladies Bathroom	Bathroom Faucet	Non-Potable	10/23/2020	1.2	Sample Passed, No Action Needed
HERR-1023	2104A	Room 105 Vestibule Left Office Bathroom	Bathroom Faucet	Non-Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-1024	2036	Harbor Daycare Nurse Office	Nurse's Office Sink	Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-1025	2036	Harbor Daycare Nurse Office	Nurse's Office Sink	Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-1026	2036	Harbor Daycare Nurse Office	Nurse's Office Sink	Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed

Herricks High School

HERR-0590	6011	600 Wing Girls Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	1.4	Sample Passed, No Action Needed
HERR-0593	6015	600 Wing Corridor	Bottled Water Dispenser	Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0596	6013	600 Wing Boys Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0629	3323	Boys Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	5.0	Sample Passed, No Action Needed
HERR-0630	3323	Boys Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	2.9	Sample Passed, No Action Needed
HERR-0631	3323	Boys Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	10	Sample Passed, No Action Needed
HERR-0632	3323	Boys Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	2.7	Sample Passed, No Action Needed
HERR-0633	3344	North Wing Second Floor Corridor	Bottled Water Dispenser	Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0636	3325	Girls Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	2.6	Sample Passed, No Action Needed
HERR-0637	3325	Girls Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	15	Sample Passed, No Action Needed
HERR-0638	3325	Girls Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	6.1	Sample Passed, No Action Needed
HERR-0639	3325	Girls Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	12	Sample Passed, No Action Needed

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-0640	3325	Girls Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	9.3	Sample Passed, No Action Needed
HERR-0644	3331A	Chemical Storage Room	Ice Machine	Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0685	2069	Girls Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	3.0	Sample Passed, No Action Needed
HERR-0686	2069	Girls Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	5.8	Sample Passed, No Action Needed
HERR-0688	2069	Girls Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	5.4	Sample Passed, No Action Needed
HERR-0689	2069	Girls Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	10	Sample Passed, No Action Needed
HERR-0691	2067	North Wing Corridor	Water Fountain-No Chiller	Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0692	2070	Boys Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	17	Placarded for Non-Drinking Use Until Remediated
HERR-0693	2070	Boys Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	6.0	Sample Passed, No Action Needed
HERR-0700	2076	Women Faculty Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	1.5	Sample Passed, No Action Needed
HERR-0711	2080	Faculty Men's Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0717	4009	Room 500	Bottle Fill Station	Potable	10/24/2020	1.2	Sample Passed, No Action Needed
HERR-0722	2067	North Wing Corridor	Water Fountain-No Chiller	Potable	10/24/2020	13	Sample Passed, No Action Needed
HERR-0723	2100	West Wing Corridor	Bottled Water Dispenser	Potable	10/24/2020	6.0	Sample Passed, No Action Needed
HERR-0724	2108	Boys Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-0725	2108	Boys Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0727	2107	Girls Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	1.8	Sample Passed, No Action Needed
HERR-0728	2107	Girls Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0729	2107	Girls Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	1.5	Sample Passed, No Action Needed
HERR-0732	2313	Cafeteria B	Bottled Water Dispenser	Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0736	2304	Cafeteria A	Bottled Water Dispenser	Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0738	2309	Cafeteria A Serving Area	Kitchen Service Area	Potable	10/24/2020	1.5	Sample Passed, No Action Needed
HERR-0739	2309	Cafeteria A Serving Area	Kitchen Service Area	Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0740	2313D	Cafeteria B Serving Area	Kitchen Service Area	Potable	10/24/2020	1.4	Sample Passed, No Action Needed
HERR-0741	2312	Kitchen	Kitchen Faucet (Cold)	Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0742	2312	Kitchen	Kitchen Faucet (Cold)	Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0743	2312	Kitchen	Kitchen Faucet (Cold)	Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0744	2312	Kitchen	Spray Nozzle	Non-Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0746	2312	Kitchen	Ice Machine	Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0748	2312	Kitchen	Kitchen Faucet (Cold)	Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-0749	2312	Kitchen	Kitchen Faucet (Cold)	Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0750	2312	Kitchen	Spray Nozzle	Non-Potable	10/24/2020	46	Placarded for Non-Drinking Use Until Remediated
HERR-0751	2312	Kitchen	Pasta Pot/Steam Kettle	Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0752	2312	Kitchen	Pasta Pot/Steam Kettle	Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0753	2312	Kitchen	Pasta Pot/Steam Kettle	Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0754	2312A	Kitchen Washing Area	Kitchen Faucet (Cold)	Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0755	2312A	Kitchen Washing Area	Kitchen Faucet (Cold)	Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0757	0016	Women's Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	3.1	Sample Passed, No Action Needed
HERR-0758	0017	Men's Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	1.1	Sample Passed, No Action Needed
HERR-0761	2114	Faculty Women's Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	1.4	Sample Passed, No Action Needed
HERR-0765	2124	Library Kitchen Area	Kitchen Faucet (Cold)	Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0766	2169	Girls Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0770	2172	Boys Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	1.3	Sample Passed, No Action Needed
HERR-0772	2175	District Information Officer Office (Interior Walls Removed, Now Part Of Space 2174)	Home Economics Faucet (Cold)	Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0773	2177	Room 406	Home Economics Faucet (Cold)	Potable	10/24/2020	7.8	Sample Passed, No Action Needed

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-0774	2177	Room 406	Home Economics Faucet (Cold)	Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0775	2177	Room 406	Home Economics Faucet (Cold)	Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0776	2177	Room 406	Home Economics Faucet (Cold)	Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0777	2177	Room 406	Home Economics Faucet (Cold)	Potable	10/24/2020	2.6	Sample Passed, No Action Needed
HERR-0778	2177	Room 406	Home Economics Faucet (Cold)	Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0779	2181	Boys Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0780	2181	Boys Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0781	2181	Boys Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	1.2	Sample Passed, No Action Needed
HERR-0783	2195A	East Wing Corridor	Bottled Water Dispenser	Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0790	2179	Girls Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	3.4	Sample Passed, No Action Needed
HERR-0791	2179	Girls Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	1.5	Sample Passed, No Action Needed
HERR-0792	2179	Girls Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	1.9	Sample Passed, No Action Needed
HERR-0793	2179	Girls Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0799	2133	Room 307		Non-Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0800	4023A	Health Office Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-0801	4023B	Health Office Nurses Area	Nurse's Office Sink	Potable	10/24/2020	7.9	Sample Passed, No Action Needed
HERR-0802	4023B	Health Office Nurses Area	Nurse's Office Sink	Potable	10/24/2020	1.4	Sample Passed, No Action Needed
HERR-0803	2252	Gym 1 Girls Locker Room	Water Fountain-No Chiller	Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0804	2252	Gym 1 Girls Locker Room	Bathroom Faucet	Non-Potable	10/24/2020	1.6	Sample Passed, No Action Needed
HERR-0805	2252	Gym 1 Girls Locker Room	Bathroom Faucet	Non-Potable	10/24/2020	15	Sample Passed, No Action Needed
HERR-0806	2209	Girls P. E. Office 96 Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	3.3	Sample Passed, No Action Needed
HERR-0808	2203/2207	Gym 2 Girls Locker Room/Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	57	Placarded for Non-Drinking Use Until Remediated
HERR-0811	2219A	Gym 2 Coach Office Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	5.2	Sample Passed, No Action Needed
HERR-0813	2217	Boys Locker Room Bathrooms	Bathroom Faucet	Non-Potable	10/24/2020	38	Placarded for Non-Drinking Use Until Remediated
HERR-0820	2231	Athletic Director Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0824	2237	Boys Bathroom Adjacent C-15	Bathroom Faucet	Non-Potable	10/24/2020	9.0	Sample Passed, No Action Needed
HERR-0826	2261	Corridor Outside Main Office	Bottled Water Dispenser	Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0829	2242	Athletic Training Room	Classroom Faucet	Non-Potable	10/24/2020	18	Placarded for Non-Drinking Use Until Remediated
HERR-0830	2242	Athletic Training Room	Ice Machine	Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0831	2263A	Principal Secretary Office Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	5.9	Sample Passed, No Action Needed

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-0832	2266	Main Office Kitchen/Copy Area	Classroom Faucet	Non-Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0833	2269	Girls Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0834	2269	Girls Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0836	2270	Boys Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0849	4025	Faculty Women's Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	9.0	Sample Passed, No Action Needed
HERR-0850	4025	Faculty Women's Bathroom	Bathroom Faucet	Non-Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0852	4026	Faculty Men's Room	Bathroom Faucet	Non-Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-1036	2074	Room 505 Rear Office D-E	Bottle Fill Station	Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-1040	2313	Cafeteria B	Classroom Faucet	Non-Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-1041	2307	Corridor Boiler Room to Cafeteria B	Classroom Faucet	Non-Potable	10/23/2020	1	Sample Passed, No Action Needed
HERR-1042	2260	Corridor Gym 1 to Room 309	Classroom Faucet	Non-Potable	10/23/2020	<3.0 ND	Sample Passed, No Action Needed

Herricks Middle School

HERR-0430	2072	Corridor Boys Bathroom to Room 2	Bottled Water Dispenser	Potable	10/28/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0432	2053	Classroom A T.A.C.K Room Bathroom	Bathroom Faucet	Non-Potable	10/28/2020	2.3	Sample Passed, No Action Needed
HERR-0433	2069	Main Office Bathroom	Bathroom Faucet	Non-Potable	10/28/2020	1.1	Sample Passed, No Action Needed

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-0434	2066	Assistant Principals Office Bathroom	Bathroom Faucet	Non-Potable	10/28/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0435	2128A	Health Office	Nurse's Office Sink	Potable	10/28/2020	3.6	Sample Passed, No Action Needed
HERR-0436	2130	Custodial Office Hall Bathroom	Bathroom Faucet	Non-Potable	10/28/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0437	2133T	Custodial Office Bathroom	Bathroom Faucet	Non-Potable	10/28/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0439	2124	Kitchen	Kitchen Faucet (Cold)	Potable	10/28/2020	3.4	Sample Passed, No Action Needed
HERR-0440	2124	Kitchen	Kitchen Faucet (Cold)	Potable	10/28/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0441	2124	Kitchen	Kitchen Faucet (Cold)	Potable	10/28/2020	1.1	Sample Passed, No Action Needed
HERR-0442	2124	Kitchen	Kitchen Faucet (Cold)	Potable	10/28/2020	1.3	Sample Passed, No Action Needed
HERR-0443	2124	Kitchen	Kitchen Faucet (Cold)	Potable	10/28/2020	6.2	Sample Passed, No Action Needed
HERR-0444	2124	Kitchen	Kitchen Faucet (Cold)	Potable	10/28/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0445	2124	Kitchen	Kitchen Faucet (Cold)	Potable	10/28/2020	3.3	Sample Passed, No Action Needed
HERR-0446	2135	Boys Bathroom	Bathroom Faucet	Non-Potable	10/28/2020	2.5	Sample Passed, No Action Needed
HERR-0447	2135	Boys Bathroom	Bathroom Faucet	Non-Potable	10/28/2020	1.6	Sample Passed, No Action Needed
HERR-0450	2137	Girls Bathroom	Bathroom Faucet	Non-Potable	10/28/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0451	2137	Girls Bathroom	Bathroom Faucet	Non-Potable	10/28/2020	1.6	Sample Passed, No Action Needed

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-0452	2141	Women's Bathroom	Bathroom Faucet	Non-Potable	10/28/2020	1.5	Sample Passed, No Action Needed
HERR-0453	2141A	Men's Bathroom	Bathroom Faucet	Non-Potable	10/28/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0494	2088	Corridor Between Locker Rooms	Bottled Water Dispenser	Potable	10/28/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0499	2094	Boys Coach Office Bathroom	Bathroom Faucet	Non-Potable	10/28/2020	4.9	Sample Passed, No Action Needed
HERR-0500	2111	Girls Coach Office Bathroom	Bathroom Faucet	Non-Potable	10/28/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0504	2107	Ice Room/Athletic Office	Ice Machine	Potable	10/28/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0505	2117	Women's Faculty Bathroom	Bathroom Faucet	Non-Potable	10/28/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0506	2117	Women's Faculty Bathroom	Bathroom Faucet	Non-Potable	10/28/2020	1.6	Sample Passed, No Action Needed
HERR-0507	2117A	Girls Bathroom	Bathroom Faucet	Non-Potable	11/6/2020	0	Sample Passed, No Action Needed
HERR-0511	2127	Faculty Dining	Classroom Faucet	Non-Potable	10/28/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0513	4021	Faculty Women Bathroom Vestibule	Bathroom Faucet	Non-Potable	10/28/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0514	4020	Faculty Men Bathroom	Bathroom Faucet	Non-Potable	10/28/2020	8.1	Sample Passed, No Action Needed
HERR-0516	4012	Boys Bathroom	Bathroom Faucet	Non-Potable	10/28/2020	3.8	Sample Passed, No Action Needed
HERR-0517	4012	Boys Bathroom	Bathroom Faucet	Non-Potable	10/28/2020	2.6	Sample Passed, No Action Needed
HERR-0518	4012	Boys Bathroom	Bathroom Faucet	Non-Potable	10/28/2020	6.0	Sample Passed, No Action Needed

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-0522	4010	Girls Bathroom	Bathroom Faucet	Non-Potable	10/28/2020	1.4	Sample Passed, No Action Needed
HERR-0523	4010	Girls Bathroom	Bathroom Faucet	Non-Potable	10/28/2020	5.4	Sample Passed, No Action Needed
HERR-0525	4008	Room 110	Classroom Faucet	Non-Potable	10/28/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0526	4022	Corridor Rooms 102-116	Bottle Fill Station	Potable	10/28/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0529	6000	New Construction 1st Floor Boys Bathroom	Bathroom Faucet	Non-Potable	10/28/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0533	6002	New Construction 1st Floor Girls Bathroom	Bathroom Faucet	Non-Potable	10/28/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0535	6003	New Construction Room 124	Home Economics Faucet (Cold)	Potable	10/28/2020	6.0	Sample Passed, No Action Needed
HERR-0536	6003	New Construction Room 124	Home Economics Faucet (Cold)	Potable	10/28/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0537	6003	New Construction Room 124	Home Economics Faucet (Cold)	Potable	10/28/2020	10	Sample Passed, No Action Needed
HERR-0538	6003	New Construction Room 124	Home Economics Faucet (Cold)	Potable	10/28/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0539	6003	New Construction Room 124	Home Economics Faucet (Cold)	Potable	10/28/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0540	6003	New Construction Room 124	Home Economics Faucet (Cold)	Potable	10/28/2020	1	Sample Passed, No Action Needed
HERR-0542	6003	New Construction Room 124	Water Cooler	Potable	10/28/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0545	7000	New Construction 2nd Floor Mens Bathroom	Bathroom Faucet	Non-Potable	10/28/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0549	7002	New Construction 2nd Floor Womens Bathroom	Bathroom Faucet	Non-Potable	10/28/2020	<3.0 ND	Sample Passed, No Action Needed

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-0552	3194	Girls Bathroom	Bathroom Faucet	Non-Potable	10/28/2020	1.6	Sample Passed, No Action Needed
HERR-0553	3194	Girls Bathroom	Bathroom Faucet	Non-Potable	10/28/2020	2.1	Sample Passed, No Action Needed
HERR-0555	3194	Girls Bathroom	Bathroom Faucet	Non-Potable	10/28/2020	4.0	Sample Passed, No Action Needed
HERR-0558	3195	Boys Bathroom	Bathroom Faucet	Non-Potable	11/6/2020	2.5	Sample Passed, No Action Needed
HERR-0559	3195	Boys Bathroom	Bathroom Faucet	Non-Potable	11/6/2020	1.3	Sample Passed, No Action Needed
HERR-0560	3195	Boys Bathroom	Bathroom Faucet	Non-Potable	11/6/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0563	3202	Men's Bathroom	Bathroom Faucet	Non-Potable	10/28/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-1044	2123	Cafeteria	Bottle Fill Station	Potable	10/28/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-1045	2123	Cafeteria	Bottle Fill Station	Potable	10/28/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-1046	2123	Cafeteria	Classroom Faucet	Non-Potable	10/28/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-1047	2123	Cafeteria	Classroom Faucet	Non-Potable	10/28/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-1048	2086	Men's Room	Bathroom Faucet	Non-Potable	10/28/2020	2.1	Sample Passed, No Action Needed
HERR-1050	2085	Boys Bathroom	Bathroom Faucet	Non-Potable	10/28/2020	1	Sample Passed, No Action Needed

Searingtown Elementary School

HERR-0292	NEW	Room 2A	Classroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
-----------	-----	---------	------------------	-------------	------------	---------	---------------------------------

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-0293	NEW	Room 2A	Water Fountain-No Chiller	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0294	NEW	Room 2A Bathroom	Bathroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0295	NEW	Room 2B	Classroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0296	NEW	Room 2B	Water Fountain-No Chiller	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0297	NEW	Room 2B Bathroom	Bathroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0298	NEW	Corridor	Bottled Water Dispenser	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0301	2010	Kindergarten Room 1	Water Fountain-No Chiller	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0302	2010	Kindergarten Room 1	Classroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0303	2014	Kindergarten Room 2	Classroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0304	2014	Kindergarten Room 2	Water Fountain-No Chiller	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0306	2016	Room 4	Classroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0307	2016	Room 4	Water Fountain-No Chiller	Potable	10/22/2020	7.1	Sample Passed, No Action Needed
HERR-0308	2017	Room 3	Classroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0310	2018	Room 5	Classroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0311	2018	Room 5	Water Fountain-No Chiller	Potable	10/22/2020	8.0	Sample Passed, No Action Needed

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-0312	2022	Kindergarten Room 6	Classroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0313	2022	Kindergarten Room 6	Water Fountain-No Chiller	Potable	10/22/2020	2.3	Sample Passed, No Action Needed
HERR-0314	2024	Room 8	Classroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0316	2026	Room 7	Water Fountain-No Chiller	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0317	2026	Room 7	Classroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0318	2029	Faculty Bathroom	Bathroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0319	2033	Room 10	Water Fountain-No Chiller	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0320	2033	Room 10	Classroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0321	2027	Room 9	Classroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0322	2027	Room 9	Water Fountain-No Chiller	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0323	2040	Room 12	Classroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0324	2040	Room 12	Water Fountain-No Chiller	Potable	10/22/2020	1.7	Sample Passed, No Action Needed
HERR-0325	2037	Room 11	Classroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0326	2037	Room 11	Water Fountain-No Chiller	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0327	2042	Room 14	Classroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-0328	2042	Room 14	Water Fountain-No Chiller	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0329	2046	Room 13	Classroom Faucet	Non-Potable	10/22/2020	1.6	Sample Passed, No Action Needed
HERR-0330	2046	Room 13	Water Fountain-No Chiller	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0331	2050	Health Office Entrance	Nurse's Office Sink	Potable	10/22/2020	1.1	Sample Passed, No Action Needed
HERR-0332	2053	File/Copy Room	Classroom Faucet	Non-Potable	10/22/2020	2	Sample Passed, No Action Needed
HERR-0333	2056A	Room 15	Classroom Faucet	Non-Potable	10/22/2020	16	Placarded for Non-Drinking Use Until Remediated
HERR-0335	2057	Office 15A	Classroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0337	2062	Women's Bathroom	Bathroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0338	2062	Women's Bathroom	Bathroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0346	2075	Corridor Room 17 to Faculty	Bottled Water Dispenser	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0349	2073	Room 20	Classroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0351	2074	Room 18	Classroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0352	2076	Room 17	Water Fountain-No Chiller	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0353	2076	Room 17	Classroom Faucet	Non-Potable	10/22/2020	1.2	Sample Passed, No Action Needed
HERR-0354	2077	Room 19	Classroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-0355	2077	Room 19	Water Fountain-No Chiller	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0356	2078	Room 21	Water Fountain-No Chiller	Potable	10/22/2020	2.8	Sample Passed, No Action Needed
HERR-0357	2078	Room 21	Classroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0358	2079	Room 22B Faculty Lounge	Classroom Faucet	Non-Potable	10/22/2020	1.6	Sample Passed, No Action Needed
HERR-0360	2081	Room 23	Classroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0362	2082	Art Room 24	Classroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0363	2082	Art Room 24	Classroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0364	2087	Cafeteria	Bottled Water Dispenser	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0366	2088	Receiving Bathroom	Bathroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0368	2090	Cafeteria Kitchen	Kitchen Faucet (Cold)	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0369	2090	Cafeteria Kitchen	Kitchen Faucet (Cold)	Potable	10/22/2020	1.1	Sample Passed, No Action Needed
HERR-0371	2122	Gym	Water Fountain-No Chiller	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0372	2095	Girls Bathroom	Bathroom Faucet	Non-Potable	10/22/2020	1.7	Sample Passed, No Action Needed
HERR-0373	2095	Girls Bathroom	Bathroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0375	2096	Boys Bathroom	Bathroom Faucet	Non-Potable	10/22/2020	2	Sample Passed, No Action Needed

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-0376	2096	Boys Bathroom	Bathroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0377	2116	Room 28	Classroom Faucet	Non-Potable	10/22/2020	1.2	Sample Passed, No Action Needed
HERR-0378	2116	Room 28	Water Fountain-No Chiller	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0379	2098	Room 25	Water Fountain-No Chiller	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0380	2098	Room 25	Classroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0381	2103	Room 27	Classroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0382	2103	Room 27	Water Fountain-No Chiller	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0383	2104	Room 29	Water Fountain-No Chiller	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0384	2104	Room 29	Classroom Faucet	Non-Potable	10/22/2020	1.3	Sample Passed, No Action Needed
HERR-0385	2114	Room 30	Classroom Faucet	Non-Potable	10/22/2020	1.1	Sample Passed, No Action Needed
HERR-0386	2114	Room 30	Water Fountain-No Chiller	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0387	2112	Room 32	Water Fountain-No Chiller	Potable	10/22/2020	1.3	Sample Passed, No Action Needed
HERR-0388	2112	Room 32	Classroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0389	2109	Room 31	Classroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0390	2109	Room 31	Water Fountain-No Chiller	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-0391	NEW	Boy's Bathroom	Bathroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0394	NEW	Corridor	Bottled Water Dispenser	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0396	NEW	Teachers Bathroom	Bathroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0398	NEW	Girls Bathroom	Bathroom Faucet	Non-Potable	10/22/2020	1.4	Sample Passed, No Action Needed
HERR-0399	NEW	Room 40	Classroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0400	NEW	Room 40	Water Fountain-No Chiller	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0401	NEW	Room 33	Classroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0402	NEW	Room 33	Water Fountain-No Chiller	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0403	NEW	Room 42	Classroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0404	NEW	Room 42	Water Fountain-No Chiller	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0405	NEW	Room 35	Classroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0406	NEW	Room 35	Water Fountain-No Chiller	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0407	NEW	Room 37	Classroom Faucet	Non-Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0408	NEW	Room 37	Water Fountain-No Chiller	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-1011	2022	Kindergarten Room 6	Bottle Fill Station	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-1012	2024	Room 8	Bottle Fill Station	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-1013	2037	Room 11	Bottle Fill Station	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-1014	2042	Room 14	Bottle Fill Station	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-1015	2056A	Room 15	Bottle Fill Station	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-1016	2081	Room 23	Bottle Fill Station	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-1017	2098	Room 25	Bottle Fill Station	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-1018	2103	Room 27	Bottle Fill Station	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-1019	2104	Room 29	Bottle Fill Station	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-1020	2112	Room 32	Bottle Fill Station	Potable	10/22/2020	<3.0 ND	Sample Passed, No Action Needed

Shelter Rock Building

HERR-0989	1017B	Corridor Psychologist To Cafeteria	Bottled Water Dispenser	Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0990	1017B	Corridor Psychologist To Cafeteria	Sports Cooler	Potable	10/24/2020	1.1	Sample Passed, No Action Needed
HERR-0991	1013/1013 A	Room 7	Classroom Faucet	Non Potable	10/24/2020	4.3	Sample Passed, No Action Needed
HERR-0992	1014	Room 8	Classroom Faucet	Non Potable	10/24/2020	3.0	Sample Passed, No Action Needed
HERR-0993	1014A	Room 8 Closet/Storage Room	Bathroom Faucet	Non Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed

Outlet Number	Space ID	Common Room Name	Outlet Type	Potable/ Non-Potable	Sample Date	Result (ppb)	Remediation Actions/Current Status
HERR-0994	1015A	Boys Bathroom	Bathroom Faucet	Non Potable	10/24/2020	3.6	Sample Passed, No Action Needed
HERR-0995	1015B	Women's Bathroom	Bathroom Faucet	Non Potable	10/24/2020	6.8	Sample Passed, No Action Needed
HERR-0996	2039	Nurses Office Bathroom	Bathroom Faucet	Non Potable	10/24/2020	1.6	Sample Passed, No Action Needed
HERR-0997	2041	Faculty Bathroom Adjacent Nurse	Bathroom Faucet	Non Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0998	2033	Girls Bathroom	Bathroom Faucet	Non Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-0999	2023B	Corridor From Stairs To Boys Bathroom	Water Fountain-No Chiller	Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed
HERR-1000	2032/2030	Boys Bathroom	Bathroom Faucet	Non Potable	10/24/2020	<3.0 ND	Sample Passed, No Action Needed

Attachment 2:

Chain of Custody
&
Laboratory Analysis


J.C. Broderick & Associates, Inc.

Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395

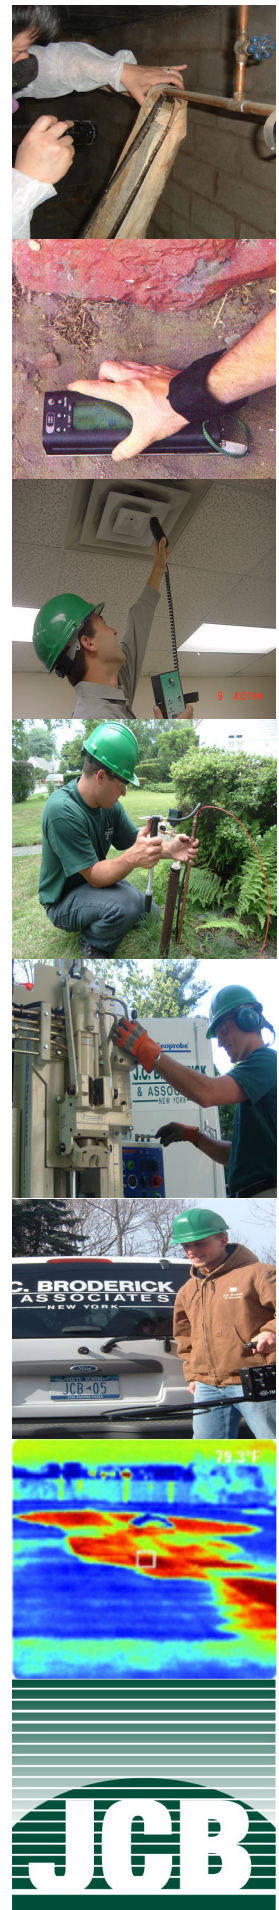



Lead in Water: Chain of Custody for 062019830

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-43807
Building: Center Street Elementary School
CSE

Client:
Herricks Union Free School District

Retest/New Install []
Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
HERR-0001	GY	1001	Gym	DW	10/20/2020	5:54:00 AM
HERR-0002	GY	1001	Gym	DW	10/20/2020	5:55:00 AM
HERR-0006	CR	1007	Room 40	CF	10/20/2020	6:01:00 AM
HERR-0008	CR	1009	Room 29	CF	10/20/2020	6:04:00 AM
HERR-0010	CR	1010	Room 39	CF	10/20/2020	6:06:00 AM
HERR-0012	CR	1010	Room 39	BW	10/20/2020	6:03:00 AM
HERR-0013	CR	1007	Room 40	BW	10/20/2020	6:03:00 AM
HERR-0015	BR	1012	Faculty Bathroom	BF	10/20/2020	6:08:00 AM
HERR-0016	CR	1013	Room 30	CF	10/20/2020	6:09:00 AM
HERR-0018	BR	1015	Boys Bathroom	BF	10/20/2020	6:11:00 AM
HERR-0019	BR	1015	Boys Bathroom	BF	10/20/2020	6:11:00 AM
HERR-0020	CR	1016	Room 31	BW	10/20/2020	6:15:00 AM
HERR-0021	CR	1016	Room 31	CF	10/20/2020	6:15:00 AM
HERR-0022	CR	1016	Room 31	DW	10/20/2020	6:15:00 AM
HERR-0023	CR	1017	Room 38	BW	10/20/2020	6:17:00 AM
HERR-0025	CR	1017	Room 38	CF	10/20/2020	6:18:00 AM
HERR-0026	CR	1018	Room 37	CF	10/20/2020	6:20:00 AM
HERR-0028	CR	1018	Room 37	BW	10/20/2020	6:20:00 AM

Building Address
240 Center Street
Williston Park, NY 11596

Analysis Type: ELAP 200.5

Lab Received: Katherine Viard 10-22-20

Signature: *OK Received* 12:22 PM

Samplers Name: Daniel Smalls
Samplers Signature: *[Signature]*
JCB Project Manager: George Grell



Lead in Water: Chain of Custody for

062019830

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-43807
Building: Center Street Elementary School
CSE

Client: Herricks Union Free School District

Retest/New Install | |
Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
HERR-0029	CR	1019	Room 32	CF	10/20/2020	6:23:00 AM
HERR-0031	CR	1019	Room 32	BW	10/20/2020	6:23:00 AM
HERR-0032	CR	1020	Room 36	BW	10/20/2020	6:24:00 AM
HERR-0034	CR	1020	Room 36	CF	10/20/2020	6:24:00 AM
HERR-0035	CR	1021	Room 33	CF	10/20/2020	6:27:00 AM
HERR-0036	CR	1021	Room 33	DW	10/20/2020	6:27:00 AM
HERR-0037	CR	1021	Room 33	BW	10/20/2020	6:27:00 AM
HERR-0038	CR	1022	Room 34	BW	10/20/2020	6:31:00 AM
HERR-0039	CR	1022	Room 34	DW	10/20/2020	6:31:00 AM
HERR-0040	CR	1022	Room 34	CF	10/20/2020	6:31:00 AM
HERR-0041	CR	1023	Room 35	CF	10/20/2020	6:32:00 AM
HERR-0043	CR	1023	Room 35	BW	10/20/2020	6:32:00 AM
HERR-0044	BR	1025	Boy's Bathroom	BF	10/20/2020	6:38:00 AM
HERR-0045	BR	1025	Boy's Bathroom	BF	10/20/2020	6:38:00 AM
HERR-0046	BR	1025	Boy's Bathroom	BF	10/20/2020	6:38:00 AM
HERR-0047	BR	1025	Women's Bathroom	BF	10/20/2020	6:38:00 AM
HERR-0049	BR	1025A	Girls Bathroom	BF	10/20/2020	6:40:00 AM
HERR-0050	BR	1025A	Girls Bathroom	BF	10/20/2020	6:40:00 AM

Building Address Pb 200.5 11/11/2020
240 Center Street
Williston Park, NY 11596
Analysis Type: ELAP 200.5

Lab Received: Katharine Viana 10-22-20
Signature: 12:21pm

Samplers Name: Daniel Smalls
Samplers Signature: [Signature]
JCB Project Manager: George Grewe



Lead in Water: Chain of Custody for

062019830

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-43807
Building: Center Street Elementary School
CSE

Client:
Herricks Union Free School District

Retest/New Install []
Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
HERR-0051	OF	1028	Room 5A/5B Kitchen/Storage	CF	10/20/2020	6:41:00 AM
HERR-0052	CR	1029	Room 4	CF	10/20/2020	6:42:00 AM
HERR-0053	CR	1029	Room 4	DW	10/20/2020	6:42:00 AM
HERR-0054	OF	1030A	Main Office Kitchenette	CF	10/20/2020	6:43:00 AM
HERR-0055	FL	1031	Room 3 Faculty Lounge	CF	10/20/2020	6:48:00 AM
HERR-0056	FL	1031	Room 3 Faculty Lounge	DW	10/20/2020	6:48:00 AM
HERR-0058	NO	1032	Nurses Office/Entrance	NS	10/20/2020	6:50:00 AM
HERR-0059	BR	1032C	Nurses Bathroom	BF	10/20/2020	6:50:00 AM
HERR-0060	CR	1033	Room 2	CF	10/20/2020	6:52:00 AM
HERR-0061	CR	1033	Room 2	DW	10/20/2020	6:52:00 AM
HERR-0062	HA	1037	Corridor Outside Main Office	BW	10/20/2020	6:53:00 AM
HERR-0064	CR	1034	Art Room 43	CF	10/20/2020	6:56:00 AM
HERR-0065	CR	1034	Art Room 43	CF	10/20/2020	6:56:00 AM
HERR-0066	CR	1034	Art Room 43	DW	10/20/2020	6:56:00 AM
HERR-0069	CA	1042	Cafeteria	BW	10/20/2020	6:59:00 AM
HERR-0071	CR	1042F	Cafeteria Room 45	CF	10/20/2020	7:01:00 AM
HERR-0072	KI	1042C	Cafeteria Kitchen	KC	10/20/2020	7:06:00 AM
HERR-0074	KI	1042C	Cafeteria Kitchen	KC	10/20/2020	7:06:00 AM

Building Address

240 Center Street

Williston Park, NY 11596

Analysis Type: ELAP 200.5

Lab Recovered: Katherine Vaud 10.22.20

Signature: [Signature] 12:21 PM

Samplers Name: Daniel Smalls

Samplers Signature: [Signature]

JCB Project Manager: George Greve



Lead in Water: Chain of Custody for

062019830

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-43807
Building: Center Street Elementary School
CSE

Client:
Herricks Union Free School District

Retest/New Install []
Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
HERR-0076	BR	1042B1	Cafeteria Kitchen Hall Bathroom	BF	10/20/2020	7:06:00 AM
HERR-0077	OF	NEW	Media	CF	10/20/2020	7:09:00 AM
HERR-0078	CR	NEW	Room 7	CF	10/20/2020	7:16:00 AM
HERR-0079	CR	NEW	Room 7	DW	10/20/2020	7:16:00 AM
HERR-0080	BR	NEW	Room 7 Bathroom	BF	10/20/2020	7:16:00 AM
HERR-0081	CR	NEW	Room 6	CF	10/20/2020	7:17:00 AM
HERR-0082	CR	NEW	Room 6	BW	10/20/2020	7:17:00 AM
HERR-0083	BR	NEW	Room 6 Bathroom	BF	10/20/2020	7:17:00 AM
HERR-0084	HA	NEW	Room 6 and 7 Corridor	DW	10/20/2020	7:19:00 AM
HERR-0085	HA	NEW	Room 6 and 7 Corridor	DW	10/20/2020	7:19:00 AM
HERR-0087	CR	1043	Room 8	CF	10/20/2020	7:21:00 AM
HERR-0090	CR	1044	Room 9	CF	10/20/2020	7:23:00 AM
HERR-0091	CR	1045	Room 10	CF	10/20/2020	7:26:00 AM
HERR-0092	CR	1045	Room 10	DW	10/20/2020	7:26:00 AM
HERR-0096	CR	1046	Room 11	CF	10/20/2020	7:29:00 AM
HERR-0097	CR	1047	Room 27	CF	10/20/2020	7:31:00 AM
HERR-0098	CR	1047	Room 27	DW	10/20/2020	7:31:00 AM
HERR-0101	CR	1048	Room 26	DW	10/20/2020	7:34:00 AM

Building Address
240 Center Street
Williston Park, NY 11596

Analysis Type: ELAP 200.5
Lab Received: Katherine Vaid 10-22-20
Signature: *[Signature]* 12:21 PM

Samplers Name: Daniel Smalls
Samplers Signature: *[Signature]*
JCB Project Manager: George Greve



Lead in Water: Chain of Custody for

062019830

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-43807
Building: Center Street Elementary School
CSE

Client: Herricks Union Free School District

Retest/New Install []
Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
HERR-0102	CR	1048	Room 26	CF	10/20/2020	7:34:00 AM
HERR-0103	CR	1049	Room 12	CF	10/20/2020	7:36:00 AM
HERR-0104	CR	1049	Room 12	DW	10/20/2020	7:36:00 AM
HERR-0106	CR	1050	Room 13	DW	10/20/2020	7:38:00 AM
HERR-0107	CR	1050	Room 13	CF	10/20/2020	7:38:00 AM
HERR-0108	CR	1051	Room 25	CF	10/21/2020	5:45:00 AM
HERR-0111	CR	NEW	Room 14	DW	10/21/2020	5:49:00 AM
HERR-0112	CR	NEW	Room 14	CF	10/21/2020	5:49:00 AM
HERR-0113	BR	NEW	Room 14 Bathroom	BF	10/21/2020	6:04:00 AM
HERR-0114	CR	NEW	Room 25	CF	10/21/2020	5:53:00 AM
HERR-0115	CR	NEW	Room 25	DW	10/21/2020	5:53:00 AM
HERR-0116	BR	NEW	Room 25 Bathroom	BF	10/21/2020	6:01:00 AM
HERR-0117	CR	NEW	Room 15	CF	10/21/2020	5:55:00 AM
HERR-0118	CR	NEW	Room 15	DW	10/21/2020	5:55:00 AM
HERR-0119	CR	NEW	Room 23	CF	10/21/2020	5:57:00 AM
HERR-0120	CR	NEW	Room 23	DW	10/21/2020	5:57:00 AM
HERR-0123	BR	NEW	Boy's Bathroom	BF	10/21/2020	6:02:00 AM
HERR-0124	CR	NEW	Room 22	CF	10/21/2020	6:01:00 AM

Building Address: Pb 200.5 DOZ
240 Center Street
Williston Park, NY 11596

Analysis Type: ELAP 200.5

Lab Received: Katherine Vland 10-22-20

Signature: OK Okina 12:21 PM

Samplers Name: Daniel Smalls

Samplers Signature: [Signature]

JCB Project Manager: George Greve



Lead in Water: Chain of Custody for

062019830

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-43807
Building: Center Street Elementary School
CSE

Client: Herricks Union Free School District
Retest/New Install ☐
Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
HERR-0125	CR	NEW	Room 22	DW	10/21/2020	6:01:00 AM
HERR-0127	BR	NEW	Faculty Bathroom	BF	10/21/2020	6:04:00 AM
HERR-0131	HA	NEW	Hallway	BW	10/21/2020	6:10:00 AM
HERR-0133	CR	NEW	Room 20	CF	10/21/2020	6:11:00 AM
HERR-0134	CR	NEW	Room 20	DW	10/21/2020	6:11:00 AM
HERR-0135	CR	NEW	Room 16	CF	10/21/2020	6:09:00 AM
HERR-0136	CR	NEW	Room 16	DW	10/21/2020	6:09:00 AM
HERR-0137	CR	NEW	Room 19	CF	10/21/2020	6:08:00 AM
HERR-0138	CR	NEW	Room 19	DW	10/21/2020	6:08:00 AM
HERR-0139	CR	NEW	Room 18	CF	10/21/2020	6:06:00 AM
HERR-0140	CR	NEW	Room 18	DW	10/21/2020	6:06:00 AM
HERR-0141	CR	NEW	Room 17	CF	10/21/2020	6:05:00 AM
HERR-0142	CR	NEW	Room 17	DW	10/21/2020	6:05:00 AM

Samples Submitted 103

RECEIVED
ANALYTICAL, INC.
PARLE PLACE, NY
21 OCT 22 PM 12:21

Building Address pp 200.5
240 Center Street
Williston Park, NY 11596
A. Liang 11/11/20

Analysis Type: ELAP 200.5

Lab Received: Katherine Vaud 10-22-20

Signature: DR Vaud 12:21 PM

Samplers Name: Daniel Smalls

Samplers Signature: [Signature]

JCB Project Manager: George Greul



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

**George Greve
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788**

11/23/2020

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 10/22/2020. The results are tabulated on the attached data pages for the following client designated project:

**19-43807, Herricks Union Free School District, Center Street
Elementary School CSE, 240 Center Street, Williston Park, NY
11596**

The reference number for these samples is EMSL Order #062019830. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019830

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:22 PM
 Collected: 10/20/2020

Project: 19-43807, Herricks Union Free School District, Center Street Elementary School CSE, 240 Center Street, Williston Park, NY 11596

Analytical Results

Client Sample Description HERR-0001 **Collected:** 10/20/2020 **Lab ID:** 062019830-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.1	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0002 **Collected:** 10/20/2020 **Lab ID:** 062019830-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.4	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0006 **Collected:** 10/20/2020 **Lab ID:** 062019830-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0008 **Collected:** 10/20/2020 **Lab ID:** 062019830-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description HERR-0010 **Collected:** 10/20/2020 **Lab ID:** 062019830-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.0	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0012 **Collected:** 10/20/2020 **Lab ID:** 062019830-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0013 **Collected:** 10/20/2020 **Lab ID:** 062019830-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0015 **Collected:** 10/20/2020 **Lab ID:** 062019830-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019830

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:22 PM
 Collected: 10/20/2020

Project: 19-43807, Herricks Union Free School District, Center Street Elementary School CSE, 240 Center Street, Williston Park, NY 11596

Analytical Results

Client Sample Description HERR-0015 **Collected:** 10/20/2020 **Lab ID:** 062019830-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0 µg/L	11/10/2020	DI	11/11/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description HERR-0016 **Collected:** 10/20/2020 **Lab ID:** 062019830-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.0	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0018 **Collected:** 10/20/2020 **Lab ID:** 062019830-0010

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0 µg/L	11/10/2020	DI	11/11/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description HERR-0019 **Collected:** 10/20/2020 **Lab ID:** 062019830-0011

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0020 **Collected:** 10/20/2020 **Lab ID:** 062019830-0012

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0021 **Collected:** 10/20/2020 **Lab ID:** 062019830-0013

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0022 **Collected:** 10/20/2020 **Lab ID:** 062019830-0014

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019830

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:22 PM
 Collected: 10/20/2020

Project: 19-43807, Herricks Union Free School District, Center Street Elementary School CSE, 240 Center Street, Williston Park, NY 11596

Analytical Results

Client Sample Description HERR-0023 **Collected:** 10/20/2020 **Lab ID:** 062019830-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0025 **Collected:** 10/20/2020 **Lab ID:** 062019830-0016

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0026 **Collected:** 10/20/2020 **Lab ID:** 062019830-0017

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description HERR-0028 **Collected:** 10/20/2020 **Lab ID:** 062019830-0018

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0029 **Collected:** 10/20/2020 **Lab ID:** 062019830-0019

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0031 **Collected:** 10/20/2020 **Lab ID:** 062019830-0020

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0032 **Collected:** 10/20/2020 **Lab ID:** 062019830-0021

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0034 **Collected:** 10/20/2020 **Lab ID:** 062019830-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019830

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:22 PM
 Collected: 10/20/2020

Project: 19-43807, Herricks Union Free School District, Center Street Elementary School CSE, 240 Center Street, Williston Park, NY 11596

Analytical Results

Client Sample Description			HERR-0034		Collected:	10/20/2020	Lab ID:	062019830-0022
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description			HERR-0035		Collected:	10/20/2020	Lab ID:	062019830-0023
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description			HERR-0036		Collected:	10/20/2020	Lab ID:	062019830-0024
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description			HERR-0037		Collected:	10/20/2020	Lab ID:	062019830-0025
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description			HERR-0038		Collected:	10/20/2020	Lab ID:	062019830-0026
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description			HERR-0039		Collected:	10/20/2020	Lab ID:	062019830-0027
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.3	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description			HERR-0040		Collected:	10/20/2020	Lab ID:	062019830-0028
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.3 J	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Lead MDL: 1.0µg/L								

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019830

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:22 PM
 Collected: 10/20/2020

Project: 19-43807, Herricks Union Free School District, Center Street Elementary School CSE, 240 Center Street, Williston Park, NY 11596

Analytical Results

Client Sample Description HERR-0041 **Collected:** 10/20/2020 **Lab ID:** 062019830-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	11/10/2020	DI	11/11/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description HERR-0043 **Collected:** 10/20/2020 **Lab ID:** 062019830-0030

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0044 **Collected:** 10/20/2020 **Lab ID:** 062019830-0031

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	11/10/2020	DI	11/11/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description HERR-0045 **Collected:** 10/20/2020 **Lab ID:** 062019830-0032

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0 µg/L	11/10/2020	DI	11/11/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description HERR-0046 **Collected:** 10/20/2020 **Lab ID:** 062019830-0033

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.3	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0047 **Collected:** 10/20/2020 **Lab ID:** 062019830-0034

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0049 **Collected:** 10/20/2020 **Lab ID:** 062019830-0035

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	11/10/2020	DI	11/11/2020	AL
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019830

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:22 PM
 Collected: 10/20/2020

Project: 19-43807, Herricks Union Free School District, Center Street Elementary School CSE, 240 Center Street, Williston Park, NY 11596

Analytical Results

Client Sample Description HERR-0050 **Collected:** 10/20/2020 **Lab ID:** 062019830-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	11/10/2020	DI	11/11/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description HERR-0051 **Collected:** 10/20/2020 **Lab ID:** 062019830-0037

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0052 **Collected:** 10/20/2020 **Lab ID:** 062019830-0038

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.5	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0053 **Collected:** 10/20/2020 **Lab ID:** 062019830-0039

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0054 **Collected:** 10/20/2020 **Lab ID:** 062019830-0040

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.5	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0055 **Collected:** 10/20/2020 **Lab ID:** 062019830-0041

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	11/10/2020	DI	11/11/2020	DI
Lead MDL: 1.0µg/L							

Client Sample Description HERR-0056 **Collected:** 10/20/2020 **Lab ID:** 062019830-0042

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	25	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019830

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:22 PM
 Collected: 10/20/2020

Project: 19-43807, Herricks Union Free School District, Center Street Elementary School CSE, 240 Center Street, Williston Park, NY 11596

Analytical Results

Client Sample Description HERR-0058 **Collected:** 10/20/2020 **Lab ID:** 062019830-0043

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.5	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

Client Sample Description HERR-0059 **Collected:** 10/20/2020 **Lab ID:** 062019830-0044

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.7	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

Client Sample Description HERR-0060 **Collected:** 10/20/2020 **Lab ID:** 062019830-0045

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.6 J	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

Lead MDL: 1.0µg/L

Client Sample Description HERR-0061 **Collected:** 10/20/2020 **Lab ID:** 062019830-0046

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.9	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

Client Sample Description HERR-0062 **Collected:** 10/20/2020 **Lab ID:** 062019830-0047

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

Client Sample Description HERR-0064 **Collected:** 10/20/2020 **Lab ID:** 062019830-0048

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

Lead MDL: 1.0µg/L

Client Sample Description HERR-0065 **Collected:** 10/20/2020 **Lab ID:** 062019830-0049

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019830

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:22 PM
 Collected: 10/20/2020

Project: 19-43807, Herricks Union Free School District, Center Street Elementary School CSE, 240 Center Street, Williston Park, NY 11596

Analytical Results

Client Sample Description HERR-0066 **Collected:** 10/20/2020 **Lab ID:** 062019830-0050

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

Client Sample Description HERR-0069 **Collected:** 10/20/2020 **Lab ID:** 062019830-0051

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

Client Sample Description HERR-0071 **Collected:** 10/20/2020 **Lab ID:** 062019830-0052

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	51	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

Client Sample Description HERR-0072 **Collected:** 10/20/2020 **Lab ID:** 062019830-0053

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

Client Sample Description HERR-0074 **Collected:** 10/20/2020 **Lab ID:** 062019830-0054

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.0	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

Client Sample Description HERR-0076 **Collected:** 10/20/2020 **Lab ID:** 062019830-0055

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

Client Sample Description HERR-0077 **Collected:** 10/20/2020 **Lab ID:** 062019830-0056

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

Lead MDL: 1.0µg/L

Client Sample Description HERR-0078 **Collected:** 10/20/2020 **Lab ID:** 062019830-0057

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019830

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 10/22/2020 12:22 PM
Collected: 10/20/2020

Project: 19-43807, Herricks Union Free School District, Center Street Elementary School CSE, 240 Center Street, Williston Park, NY 11596

Analytical Results

Client Sample Description HERR-0078 **Collected:** 10/20/2020 **Lab ID:** 062019830-0057

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

Client Sample Description HERR-0079 **Collected:** 10/20/2020 **Lab ID:** 062019830-0058

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

Client Sample Description HERR-0080 **Collected:** 10/20/2020 **Lab ID:** 062019830-0059

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

Client Sample Description HERR-0081 **Collected:** 10/20/2020 **Lab ID:** 062019830-0060

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

Client Sample Description HERR-0082 **Collected:** 10/20/2020 **Lab ID:** 062019830-0061

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

Client Sample Description HERR-0083 **Collected:** 10/20/2020 **Lab ID:** 062019830-0062

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

Client Sample Description HERR-0084 **Collected:** 10/20/2020 **Lab ID:** 062019830-0063

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

Client Sample Description HERR-0085 **Collected:** 10/20/2020 **Lab ID:** 062019830-0064

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019830

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:22 PM
 Collected: 10/20/2020

Project: 19-43807, Herricks Union Free School District, Center Street Elementary School CSE, 240 Center Street, Williston Park, NY 11596

Analytical Results

Client Sample Description HERR-0085 **Collected:** 10/20/2020 **Lab ID:** 062019830-0064

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

Client Sample Description HERR-0087 **Collected:** 10/20/2020 **Lab ID:** 062019830-0065

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

Client Sample Description HERR-0090 **Collected:** 10/20/2020 **Lab ID:** 062019830-0066

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

Client Sample Description HERR-0091 **Collected:** 10/20/2020 **Lab ID:** 062019830-0067

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

Client Sample Description HERR-0092 **Collected:** 10/20/2020 **Lab ID:** 062019830-0068

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

Client Sample Description HERR-0096 **Collected:** 10/20/2020 **Lab ID:** 062019830-0069

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

Client Sample Description HERR-0097 **Collected:** 10/20/2020 **Lab ID:** 062019830-0070

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

Client Sample Description HERR-0098 **Collected:** 10/20/2020 **Lab ID:** 062019830-0071

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019830

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:22 PM
 Collected: 10/20/2020

Project: 19-43807, Herricks Union Free School District, Center Street Elementary School CSE, 240 Center Street, Williston Park, NY 11596

Analytical Results

Client Sample Description HERR-0098 **Collected:** 10/20/2020 **Lab ID:** 062019830-0071

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

Client Sample Description HERR-0101 **Collected:** 10/20/2020 **Lab ID:** 062019830-0072

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

Client Sample Description HERR-0102 **Collected:** 10/20/2020 **Lab ID:** 062019830-0073

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

Client Sample Description HERR-0103 **Collected:** 10/20/2020 **Lab ID:** 062019830-0074

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

Lead MDL: 1.0µg/L

Client Sample Description HERR-0104 **Collected:** 10/20/2020 **Lab ID:** 062019830-0075

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

Client Sample Description HERR-0106 **Collected:** 10/20/2020 **Lab ID:** 062019830-0076

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.1	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

Client Sample Description HERR-0107 **Collected:** 10/20/2020 **Lab ID:** 062019830-0077

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

Lead MDL: 1.0µg/L

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019830

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:22 PM
 Collected: 10/20/2020

Project: 19-43807, Herricks Union Free School District, Center Street Elementary School CSE, 240 Center Street, Williston Park, NY 11596

Analytical Results

Client Sample Description HERR-0108 **Collected:** 10/20/2020 **Lab ID:** 062019830-0078

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	11/10/2020	DI	11/11/2020	DI
Lead MDL: 1.0µg/L							

Client Sample Description HERR-0111 **Collected:** 10/20/2020 **Lab ID:** 062019830-0079

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

Client Sample Description HERR-0112 **Collected:** 10/20/2020 **Lab ID:** 062019830-0080

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	DI

Client Sample Description HERR-0113 **Collected:** 10/20/2020 **Lab ID:** 062019830-0081

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/11/2020	DI

Client Sample Description HERR-0114 **Collected:** 10/20/2020 **Lab ID:** 062019830-0082

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/11/2020	DI

Client Sample Description HERR-0115 **Collected:** 10/20/2020 **Lab ID:** 062019830-0083

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/11/2020	DI

Client Sample Description HERR-0116 **Collected:** 10/20/2020 **Lab ID:** 062019830-0084

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/11/2020	DI

Client Sample Description HERR-0117 **Collected:** 10/20/2020 **Lab ID:** 062019830-0085

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019830

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:22 PM
 Collected: 10/20/2020

Project: 19-43807, Herricks Union Free School District, Center Street Elementary School CSE, 240 Center Street, Williston Park, NY 11596

Analytical Results

Client Sample Description HERR-0117 **Collected:** 10/20/2020 **Lab ID:** 062019830-0085

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/11/2020	DI

Client Sample Description HERR-0118 **Collected:** 10/20/2020 **Lab ID:** 062019830-0086

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/11/2020	DI

Client Sample Description HERR-0119 **Collected:** 10/20/2020 **Lab ID:** 062019830-0087

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/11/2020	DI

Client Sample Description HERR-0120 **Collected:** 10/20/2020 **Lab ID:** 062019830-0088

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/11/2020	DI

Client Sample Description HERR-0123 **Collected:** 10/20/2020 **Lab ID:** 062019830-0089

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/11/2020	DI

Client Sample Description HERR-0124 **Collected:** 10/20/2020 **Lab ID:** 062019830-0090

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/11/2020	DI

Client Sample Description HERR-0125 **Collected:** 10/20/2020 **Lab ID:** 062019830-0091

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/11/2020	DI

Client Sample Description HERR-0127 **Collected:** 10/20/2020 **Lab ID:** 062019830-0092

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019830

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:22 PM
 Collected: 10/20/2020

Project: 19-43807, Herricks Union Free School District, Center Street Elementary School CSE, 240 Center Street, Williston Park, NY 11596

Analytical Results

Client Sample Description HERR-0127 **Collected:** 10/20/2020 **Lab ID:** 062019830-0092

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/11/2020	DI

Client Sample Description HERR-0131 **Collected:** 10/20/2020 **Lab ID:** 062019830-0093

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/11/2020	DI

Client Sample Description HERR-0133 **Collected:** 10/20/2020 **Lab ID:** 062019830-0094

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/11/2020	DI

Client Sample Description HERR-0134 **Collected:** 10/20/2020 **Lab ID:** 062019830-0095

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/11/2020	DI

Client Sample Description HERR-0135 **Collected:** 10/20/2020 **Lab ID:** 062019830-0096

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/11/2020	DI

Client Sample Description HERR-0136 **Collected:** 10/20/2020 **Lab ID:** 062019830-0097

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/11/2020	DI

Client Sample Description HERR-0137 **Collected:** 10/20/2020 **Lab ID:** 062019830-0098

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/11/2020	DI

Client Sample Description HERR-0138 **Collected:** 10/20/2020 **Lab ID:** 062019830-0099

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019830

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:22 PM
 Collected: 10/20/2020

Project: 19-43807, Herricks Union Free School District, Center Street Elementary School CSE, 240 Center Street, Williston Park, NY 11596

Analytical Results

Client Sample Description HERR-0138 **Collected:** 10/20/2020 **Lab ID:** 062019830-0099

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0 µg/L	11/11/2020	DI	11/11/2020	DI
Lead MDL: 1.0µg/L							

Client Sample Description HERR-0139 **Collected:** 10/20/2020 **Lab ID:** 062019830-0100

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/11/2020	DI

Client Sample Description HERR-0140 **Collected:** 10/20/2020 **Lab ID:** 062019830-0101

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0141 **Collected:** 10/20/2020 **Lab ID:** 062019830-0102

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0142 **Collected:** 10/20/2020 **Lab ID:** 062019830-0103

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	11/10/2020	DI	11/11/2020	AL
Lead MDL: 1.0µg/L							

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-43807

Building: Denton Avenue Elementary School

DENT

Client:

Herricks Union Free School District

Retest/New Install ☒

Turn Around: Normal 1 wk Rush _____

Page 1 of 7

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
HERR-0154	CA	2008	Cafeteria	BW	10/21/2020	6:28:00 AM
HERR-0156	KI	2006	Kitchen	KC	10/21/2020	6:28:00 AM
HERR-0158	KI	2006	Kitchen	KC	10/21/2020	6:30:00 AM
HERR-0160	BR	2007A	Kitchen Bathroom	BF	10/21/2020	6:31:00 AM
HERR-0161	CR	2009	Cafeteria Music Room 47	CF	10/21/2020	6:33:00 AM
HERR-0163	CR	2014	Art Room 6	CF	10/21/2020	6:40:00 AM
HERR-0164	CR	2014	Art Room 6	DW	10/21/2020	6:40:00 AM
HERR-0165	CR	2014	Art Room 6	CF	10/21/2020	6:40:00 AM
HERR-0168	BR	2016A	Nurses Office Vestibule Bathroom	BF	10/21/2020	6:42:00 AM
HERR-0169	NO	2017	Nurses Office Bed Area	NS	10/21/2020	6:42:00 AM
HERR-0170	BR	2028	Girls Bathroom	BF	10/21/2020	6:46:00 AM
HERR-0171	BR	2028	Girls Bathroom	BF	10/21/2020	6:46:00 AM
HERR-0173	BR	2027	Women's Bathroom (by Room 4)	BF	10/21/2020	6:47:00 AM
HERR-0174	BR	2026	Boys Bathroom	BF	10/21/2020	6:49:00 AM
HERR-0175	BR	2026	Boys Bathroom	BF	10/21/2020	6:49:00 AM
HERR-0176	BR	2026	Boys Bathroom	BF	10/21/2020	6:49:00 AM
HERR-0177	BR	2032	Men's Bathroom	BF	10/21/2020	6:44:00 AM
HERR-0178	BR	2033	Women's Bathroom	BF	10/21/2020	6:44:00 AM

Building Address Pb 200.5 11/10/2020
 1050 Denton Avenue
 New Hyde Park, NY 11040

Analysis Type: ELAP 200.5 AD

Lab Received: Unique McKay

Signature: um 10/22/20 @ 12:30pm

Samplers Name: Daniel Smalls

Samplers Signature: [Signature]

JCB Project Manager: George Greve

STATE OF NEW YORK
 DEPARTMENT OF ENVIRONMENTAL CONSERVATION
 DIVISION OF WATER
 609 WEST 125th STREET
 NEW YORK, NY 10030

Order ID: 062019850

062019850



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-43807

Building: Denton Avenue Elementary School

DENT

Client:

Herricks Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
HERR-0179	OF	2023	Main Office Kitchen/Copy Room Storage	CF	10/21/2020	6:43:00 AM
HERR-0180	CR	2035	Room 1	CF	10/21/2020	6:45:00 AM
HERR-0181	CR	2035	Room 1	DW	10/21/2020	6:45:00 AM
HERR-0182	CR	2036	Room 2	CF	10/21/2020	6:46:00 AM
HERR-0183	CR	2036	Room 2	DW	10/21/2020	6:46:00 AM
HERR-0184	CR	2037	Room 3	CF	10/21/2020	6:48:00 AM
HERR-0185	CR	2037	Room 3	DW	10/21/2020	6:48:00 AM
HERR-0186	FL	2040	Faculty Lounge Kitchen	CF	10/21/2020	6:49:00 AM
HERR-0187	CR	NEW	Room 22	CF	10/21/2020	6:54:00 AM
HERR-0188	CR	NEW	Room 22	DW	10/21/2020	6:54:00 AM
HERR-0189	CR	NEW	Room 21	CF	10/21/2020	6:55:00 AM
HERR-0190	CR	NEW	Room 21	DW	10/21/2020	6:55:00 AM
HERR-0191	HA	NEW	Corridor	BW	10/21/2020	6:58:00 AM
HERR-0193	CR	NEW	Room 19	CF	10/21/2020	6:57:00 AM
HERR-0194	CR	NEW	Room 19	DW	10/21/2020	6:57:00 AM
HERR-0195	CR	NEW	Room 18	CF	10/21/2020	6:56:00 AM
HERR-0196	CR	NEW	Room 18	DW	10/21/2020	6:56:00 AM
HERR-0198	BR	NEW	Girls Bathroom	BF	10/21/2020	7:00:00 AM

Building Address Pb 200.5 Denton Ave 11/10/2020

1050 Denton Avenue

New Hyde Park, NY 11040

Analysis Type: ELAP 200.5 @

Lab Received: Unique mcr 24

Signature: um 10/22/20 @ 12:30pm

Samplers Name: Daniel Smalls

Samplers Signature: _____

JCB Project Manager: George Grell

062019850

 ANALYTICAL, INC.
 CARLE PLACE, NY
 11/12/20



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-43807

Building: Denton Avenue Elementary School

DENT

Client:

Herricks Union Free School District

Retest/New Install ☐Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
HERR-0199	BR	NEW	Girls Bathroom	BF	10/21/2020	7:00:00 AM
HERR-0200	BR	NEW	Faculty Bathroom	BF	10/21/2020	7:02:00 AM
HERR-0202	BR	NEW	Boy's Bathroom	BF	10/21/2020	7:02:00 AM
HERR-0203	BR	NEW	Boy's Bathroom	BF	10/21/2020	7:02:00 AM
HERR-0206	CR	NEW	Room 17	CF	10/21/2020	7:04:00 AM
HERR-0207	CR	NEW	Room 17	DW	10/21/2020	7:04:00 AM
HERR-0208	CR	NEW	Room 16	CF	10/21/2020	7:06:00 AM
HERR-0209	CR	NEW	Room 16	DW	10/21/2020	7:06:00 AM
HERR-0210	CR	NEW	Room 23	CF	10/21/2020	7:09:00 AM
HERR-0211	CR	NEW	Room 23	DW	10/21/2020	7:09:00 AM
HERR-0212	CR	NEW	Room 15	CF	10/21/2020	7:07:00 AM
HERR-0213	CR	NEW	Room 15	DW	10/21/2020	7:14:00 AM
HERR-0214	CR	NEW	Room 24	CF	10/21/2020	7:10:00 AM
HERR-0215	CR	NEW	Room 24	DW	10/21/2020	7:10:00 AM
HERR-0216	CR	NEW	Room 25	CF	10/21/2020	7:12:00 AM
HERR-0217	CR	NEW	Room 25	DW	10/21/2020	7:12:00 AM
HERR-0218	CR	NEW	Room 14	CF	10/21/2020	7:26:00 AM
HERR-0219	CR	NEW	Room 14	DW	10/21/2020	7:26:00 AM

Building Address Po 200.5 Denton 10/21/2020

1050 Denton Avenue

New Hyde Park, NY 11040

Analysis Type: ELAP 200.5 Q1Lab Received: Unique McKaySignature: LM 10/22/20 @ 12:30pmSamplers Name: Daniel SmallsSamplers Signature: [Signature]JCB Project Manager: George Grewe

062019850

RECEIVED
JCB LABORATORY, INC.
CARLE PLACE, NY
11734
10/21/2020 12:30 PM



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-43807
Building: Denton Avenue Elementary School
DENT

Client: Herricks Union Free School District
Retest/New Install ☐
Turn Around: Normal 1 wk Rush

Page 4 of 7

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
HERR-0220	CR	2049	Room 13	CF	10/21/2020	7:16:00 AM
HERR-0221	CR	2049	Room 13	DW	10/21/2020	7:16:00 AM
HERR-0222	CR	2050	Room 12	CF	10/21/2020	7:18:00 AM
HERR-0223	CR	2050	Room 12	DW	10/21/2020	7:01:00 AM
HERR-0224	CR	2055	Room 11	CF	10/21/2020	7:27:00 AM
HERR-0225	CR	2055	Room 11	DW	10/21/2020	7:27:00 AM
HERR-0226	CR	2056	Room 10	DW	10/21/2020	7:20:00 AM
HERR-0227	CR	2056	Room 10	CF	10/21/2020	7:20:00 AM
HERR-0228	CR	2061	Room 9	CF	10/21/2020	7:20:00 AM
HERR-0229	CR	2061	Room 9	DW	10/21/2020	7:20:00 AM
HERR-0230	CR	2074	Room 28	CF	10/21/2020	7:16:00 AM
HERR-0231	CR	2074	Room 28	DW	10/21/2020	7:16:00 AM
HERR-0233	CR	2069	Room 27	CF	10/21/2020	7:15:00 AM
HERR-0234	CR	2068	Room 26	DW	10/21/2020	7:14:00 AM
HERR-0235	CR	2068	Room 26	CF	10/21/2020	7:14:00 AM
HERR-0236	HA	NEW	Corridor	DW	10/21/2020	7:23:00 AM
HERR-0237	HA	NEW	Corridor	DW	10/21/2020	7:24:00 AM
HERR-0238	CR	NEW	Room 8	CF	10/21/2020	7:23:00 AM

Building Address: 1050 Denton Avenue
1050 Denton Avenue
New Hyde Park, NY 11040

Analysis Type: ELAP 200.5
Lab Received: Unique McKay
Signature: um 10/22/20 @ 12:30pm

Samplers Name: Daniel Smalls
Samplers Signature: [Signature]
JCB Project Manager: George Grewe

062019850

OrderID: 062019850



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-43807

Building: Denton Avenue Elementary School

DENT

Client:

Herricks Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
HERR-0239	CR	NEW	Room 8	DW	10/21/2020	7:23:00 AM
HERR-0240	BR	NEW	Room 8 Bathroom	BF	10/21/2020	7:23:00 AM
HERR-0241	CR	NEW	Room 7	CF	10/21/2020	7:22:00 AM
HERR-0242	CR	NEW	Room 7	DW	10/21/2020	7:22:00 AM
HERR-0243	BR	NEW	Room 7 Bathroom	BF	10/21/2020	7:22:00 AM
HERR-0245	CR	2075	Room 29	CF	10/21/2020	7:31:00 AM
HERR-0246	CR	2075	Room 29	DW	10/21/2020	7:31:00 AM
HERR-0247	CR	2076	Room 30	DW	10/21/2020	7:37:00 AM
HERR-0248	CR	2076	Room 30	CF	10/21/2020	7:37:00 AM
HERR-0249	CR	2077	Room 31	CF	10/21/2020	7:39:00 AM
HERR-0250	CR	2077	Room 31	DW	10/21/2020	7:39:00 AM
HERR-0252	CR	2078	Room 32	CF	10/21/2020	7:41:00 AM
HERR-0253	CR	2081	Room 34	CF	10/21/2020	7:45:00 AM
HERR-0254	CR	2081	Room 34	DW	10/21/2020	7:45:00 AM
HERR-0255	CR	2082	Room 35	CF	10/21/2020	7:47:00 AM
HERR-0256	CR	2082	Room 35	DW	10/21/2020	7:47:00 AM
HERR-0257	CR	2087	Room 36	DW	10/21/2020	7:50:00 AM
HERR-0258	CR	2087	Room 36	CF	10/21/2020	7:50:00 AM

Building Address Pb 200.5 11/10/2020

1050 Denton Avenue

New Hyde Park, NY 11040

Analysis Type: ELAP 200.5 ALLab Received: Unique McKaySignature: um 10/22/20 @ 12:30pmSamplers Name: Daniel SmallsSamplers Signature: [Signature]JCB Project Manager: George Greve

062019850

STELLA INTERNATIONAL, INC.
CARLE PLACE, NY
11734

2020 OCT 22 PM 12:30



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-43807

Building: Denton Avenue Elementary School

DENT

Client:

Herricks Union Free School District

Retest/New Install ☐

Turn Around: Normal ~~Low~~ Rush

Page 6 of 7

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
HERR-0259	CR	2090	Room 37	CF	10/21/2020	7:52:00 AM
HERR-0260	CR	2090	Room 37	DW	10/21/2020	7:52:00 AM
HERR-0261	CR	2093	Room 38	DW	10/21/2020	7:55:00 AM
HERR-0262	CR	2093	Room 38	CF	10/21/2020	7:55:00 AM
HERR-0263	CR	2095	Room 39	CF	10/21/2020	7:55:00 AM
HERR-0264	CR	2095	Room 39	DW	10/21/2020	7:55:00 AM
HERR-0266	CR	2099	Room 40	CF	10/21/2020	7:57:00 AM
HERR-0267	BR	2100	Boys Bathroom	BF	10/21/2020	7:58:00 AM
HERR-0268	BR	2100	Boys Bathroom	BF	10/21/2020	7:58:00 AM
HERR-0270	BR	2102	Women's Bathroom	BF	10/21/2020	8:00:00 AM
HERR-0271	BR	2102	Women's Bathroom	BF	10/21/2020	8:00:00 AM
HERR-0272	CR	2105	Room 41	DW	10/21/2020	8:02:00 AM
HERR-0273	CR	2105	Room 41	CF	10/21/2020	8:02:00 AM
HERR-0274	CR	2106	Room 42	CF	10/21/2020	8:05:00 AM
HERR-0275	CR	2106	Room 42	DW	10/21/2020	8:05:00 AM
HERR-0276	CR	2107	Room 43	DW	10/21/2020	8:07:00 AM
HERR-0277	CR	2107	Room 43	CF	10/21/2020	8:07:00 AM
HERR-0278	CR	2108	Room 44	CF	10/21/2020	8:09:00 AM

Building Address Pb 200.5 Denton Ave 11/10/2020

1050 Denton Avenue

New Hyde Park, NY 11040

Analysis Type: ELAP 200.5

Lab Received: Unique Mexico

Signature: um 10/22/20 @ 12:30 PM

Samplers Name: Daniel Smalls

Samplers Signature: [Signature]

JCB Project Manager: George Grew

062019850

Order ID: 062019850

10/21/2020
8:12:30 AM
JCB PROJECT
MANAGER
GEORGE GREW
11/10/2020



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-43807

Building: Denton Avenue Elementary School

DENT

Client:

Herricks Union Free School District

Retest/New Install ☒

Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
HERR-0281	GY	2112	Gym	DW	10/21/2020	8:14:00 AM
HERR-0282	GY	2112	Gym	DW	10/21/2020	8:14:00 AM
HERR-0283	BR	2122	Gym Girls Toilet	BF	10/21/2020	8:16:00 AM
HERR-0284	BR	2121	Gym Boys Toilet	BF	10/21/2020	8:16:00 AM
HERR-1001	CR	2075	Room 29	WF	10/21/2020	7:35:00 AM
HERR-1002	CR	2076	Room 30	WF	10/21/2020	7:34:00 AM
HERR-1003	CR	2077	Room 31	WF	10/21/2020	7:39:00 AM
HERR-1004	CR	2081	Room 34	WF	10/21/2020	7:45:00 AM
HERR-1005	CR	2082	Room 35	WF	10/21/2020	7:47:00 AM
HERR-1006	CR	2087	Room 36	WF	10/21/2020	7:50:00 AM
HERR-1007	CR	2090	Room 37	WF	10/21/2020	7:52:00 AM
HERR-1008	CR	2095	Room 39	WF	10/21/2020	7:55:00 AM
HERR-1009	CR	2105	Room 41	WF	10/21/2020	8:02:00 AM
HERR-1010	CR	2106	Room 42	WF	10/21/2020	8:05:00 AM

Samples Submitted 122

ANALYTICAL, INC.
CARLE PLACE, NY
OCT 22 PM 12:30

Building Address Pb 200.5 11/10/2020

1050 Denton Avenue

New Hyde Park, NY 11040

Analysis Type: ELAP 200.5 (AL)

Lab Received: _____

Signature: _____

Samplers Name: Daniel Smalls

Samplers Signature: _____

JCB Project Manager: George Greve

062019850



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

**George Greve
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788**

11/23/2020

Phone: (631) 584-5492
Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 10/22/2020. The results are tabulated on the attached data pages for the following client designated project:

**Denton Avenue Elementary School, 1050 Denton Avenue, New
Hyde Park, NY 11040, Herricks Union Free School District, 19-
43807**

The reference number for these samples is EMSL Order #062019850. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019850

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:30 PM
 Collected: 10/21/2020

Project: **Denton Avenue Elementary School, 1050 Denton Avenue, New Hyde Park, NY 11040, Herricks Union Free School District, 19-43807**

Analytical Results

Client Sample Description HERR-0154
Cafeteria
Collected: 10/21/2020
Lab ID: 062019850-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/9/2020	DI	11/10/2020	AL

Client Sample Description HERR-0156
Kitchen
Collected: 10/21/2020
Lab ID: 062019850-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/9/2020	DI	11/10/2020	AL

Client Sample Description HERR-0158
Kitchen
Collected: 10/21/2020
Lab ID: 062019850-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.9	3.0 µg/L	11/9/2020	DI	11/10/2020	AL

Client Sample Description HERR-0160
Kitchen Bathroom
Collected: 10/21/2020
Lab ID: 062019850-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	11/9/2020	DI	11/10/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description HERR-0161
Cafeteria Music Room 47
Collected: 10/21/2020
Lab ID: 062019850-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	29	3.0 µg/L	11/9/2020	DI	11/10/2020	AL

Client Sample Description HERR-0163
Art Room 6
Collected: 10/21/2020
Lab ID: 062019850-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.8	3.0 µg/L	11/9/2020	DI	11/10/2020	AL

Client Sample Description HERR-0164
Art Room 6
Collected: 10/21/2020
Lab ID: 062019850-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/9/2020	DI	11/10/2020	AL

Client Sample Description HERR-0165
Art Room 6
Collected: 10/21/2020
Lab ID: 062019850-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019850

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:30 PM
 Collected: 10/21/2020

Project: **Denton Avenue Elementary School, 1050 Denton Avenue, New Hyde Park, NY 11040, Herricks Union Free School District, 19-43807**

Analytical Results

Client Sample Description		HERR-0165 Art Room 6	Collected:	10/21/2020	Lab ID:	062019850-0008	
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	61	3.0 µg/L	11/9/2020	DI	11/10/2020	AL
Client Sample Description		HERR-0168 Nurses Office Vstibule Bathroom	Collected:	10/21/2020	Lab ID:	062019850-0009	
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.3	3.0 µg/L	11/9/2020	DI	11/10/2020	AL
Client Sample Description		HERR-0169 Nurses Office Bed Area	Collected:	10/21/2020	Lab ID:	062019850-0010	
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.4	3.0 µg/L	11/9/2020	DI	11/10/2020	AL
Client Sample Description		HERR-0170 Girls Bathroom	Collected:	10/21/2020	Lab ID:	062019850-0011	
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.5	3.0 µg/L	11/9/2020	DI	11/10/2020	AL
Client Sample Description		HERR-0171 Girls Bathroom	Collected:	10/21/2020	Lab ID:	062019850-0012	
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/9/2020	DI	11/10/2020	AL
Client Sample Description		HERR-0173 Women's Bathroom (by Room 4)	Collected:	10/21/2020	Lab ID:	062019850-0013	
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	11/9/2020	DI	11/10/2020	AL
Lead MDL: 1.0µg/L							
Client Sample Description		HERR-0174 Boys Bathroom	Collected:	10/21/2020	Lab ID:	062019850-0014	
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0 µg/L	11/9/2020	DI	11/10/2020	AL
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019850

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:30 PM
 Collected: 10/21/2020

Project: **Denton Avenue Elementary School, 1050 Denton Avenue, New Hyde Park, NY 11040, Herricks Union Free School District, 19-43807**

Analytical Results

Client Sample Description		HERR-0175 Boys Bathroom	Collected:	10/21/2020	Lab ID:	062019850-0015	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date Analyst
200.5	Lead	1.8 J	3.0	µg/L	11/9/2020	DI	11/10/2020 AL
Lead MDL: 1.0µg/L							
Client Sample Description		HERR-0176 Boys Bathroom	Collected:	10/21/2020	Lab ID:	062019850-0016	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date Analyst
200.5	Lead	7.9	3.0	µg/L	11/9/2020	DI	11/10/2020 AL
Client Sample Description		HERR-0177 Men's Bathroom	Collected:	10/21/2020	Lab ID:	062019850-0017	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date Analyst
200.5	Lead	2.1 J	3.0	µg/L	11/9/2020	DI	11/10/2020 AL
Lead MDL: 1.0µg/L							
Client Sample Description		HERR-0178 Women's Bathroom	Collected:	10/21/2020	Lab ID:	062019850-0018	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/9/2020	DI	11/10/2020 AL
Client Sample Description		HERR-0179 Main Office Kitchen/ Copy Room Storage	Collected:	10/21/2020	Lab ID:	062019850-0019	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date Analyst
200.5	Lead	3.3	3.0	µg/L	11/9/2020	DI	11/10/2020 AL
Client Sample Description		HERR-0180 Room 1	Collected:	10/21/2020	Lab ID:	062019850-0020	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date Analyst
200.5	Lead	2.8 J	3.0	µg/L	11/9/2020	DI	11/10/2020 AL
Lead MDL: 1.0µg/L							
Client Sample Description		HERR-0181 Room 1	Collected:	10/21/2020	Lab ID:	062019850-0021	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date Analyst
200.5	Lead	10	3.0	µg/L	11/9/2020	DI	11/10/2020 AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019850

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:30 PM
 Collected: 10/21/2020

Project: **Denton Avenue Elementary School, 1050 Denton Avenue, New Hyde Park, NY 11040, Herricks Union Free School District, 19-43807**

Analytical Results

Client Sample Description		HERR-0182 Room 2	Collected:		10/21/2020	Lab ID:		062019850-0022
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0	µg/L	11/9/2020	DI	11/10/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		HERR-0183 Room 2	Collected:		10/21/2020	Lab ID:		062019850-0023
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.4 J	3.0	µg/L	11/9/2020	DI	11/10/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		HERR-0184 Room 3	Collected:		10/21/2020	Lab ID:		062019850-0024
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0	µg/L	11/9/2020	DI	11/10/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		HERR-0185 Room 3	Collected:		10/21/2020	Lab ID:		062019850-0025
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0	µg/L	11/9/2020	DI	11/10/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		HERR-0186 Faculty Lounge Kitchen	Collected:		10/21/2020	Lab ID:		062019850-0026
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0	µg/L	11/9/2020	DI	11/10/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		HERR-0187 Room 22	Collected:		10/21/2020	Lab ID:		062019850-0027
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/9/2020	DI	11/10/2020	AL
Client Sample Description		HERR-0188 Room 22	Collected:		10/21/2020	Lab ID:		062019850-0028
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0	µg/L	11/9/2020	DI	11/10/2020	AL
Lead MDL: 1.0µg/L								

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019850

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:30 PM
 Collected: 10/21/2020

Project: **Denton Avenue Elementary School, 1050 Denton Avenue, New Hyde Park, NY 11040, Herricks Union Free School District, 19-43807**

Analytical Results

Client Sample Description		HERR-0189 Room 21	Collected:	10/21/2020	Lab ID:	062019850-0029		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/9/2020	DI	11/10/2020	AL
Client Sample Description		HERR-0190 Room 21	Collected:	10/21/2020	Lab ID:	062019850-0030		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0	µg/L	11/9/2020	DI	11/10/2020	AL
		Lead MDL: 1.0µg/L						
Client Sample Description		HERR-0191 Corridor	Collected:	10/21/2020	Lab ID:	062019850-0031		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/9/2020	DI	11/10/2020	AL
Client Sample Description		HERR-0193 Room 19	Collected:	10/21/2020	Lab ID:	062019850-0032		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.4	3.0	µg/L	11/9/2020	DI	11/10/2020	AL
Client Sample Description		HERR-0194 Room 19	Collected:	10/21/2020	Lab ID:	062019850-0033		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/9/2020	DI	11/10/2020	AL
Client Sample Description		HERR-0195 Room 18	Collected:	10/21/2020	Lab ID:	062019850-0034		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/9/2020	DI	11/10/2020	AL
Client Sample Description		HERR-0196 Room 18	Collected:	10/21/2020	Lab ID:	062019850-0035		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/9/2020	DI	11/10/2020	AL
Client Sample Description		HERR-0198 Girls Bathroom	Collected:	10/21/2020	Lab ID:	062019850-0036		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019850

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:30 PM
 Collected: 10/21/2020

Project: **Denton Avenue Elementary School, 1050 Denton Avenue, New Hyde Park, NY 11040, Herricks Union Free School District, 19-43807**

Analytical Results

Client Sample Description HERR-0198
Girls Bathroom
Collected: 10/21/2020
Lab ID: 062019850-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/9/2020	DI	11/10/2020	AL

Client Sample Description HERR-0199
Girls Bathroom
Collected: 10/21/2020
Lab ID: 062019850-0037

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/9/2020	DI	11/10/2020	AL

Client Sample Description HERR-0200
Faculty Bathroom
Collected: 10/21/2020
Lab ID: 062019850-0038

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/9/2020	DI	11/10/2020	AL

Client Sample Description HERR-0202
Boy's Bathroom
Collected: 10/21/2020
Lab ID: 062019850-0039

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/9/2020	DI	11/10/2020	AL

Client Sample Description HERR-0203
Boy's Bathroom
Collected: 10/21/2020
Lab ID: 062019850-0040

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.7 J	3.0 µg/L	11/9/2020	DI	11/10/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description HERR-0206
Room 17
Collected: 10/21/2020
Lab ID: 062019850-0041

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/9/2020	DI	11/10/2020	DI

Client Sample Description HERR-0207
Room 17
Collected: 10/21/2020
Lab ID: 062019850-0042

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/9/2020	DI	11/10/2020	DI

Client Sample Description HERR-0208
Room 16
Collected: 10/21/2020
Lab ID: 062019850-0043

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019850

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:30 PM
 Collected: 10/21/2020

Project: **Denton Avenue Elementary School, 1050 Denton Avenue, New Hyde Park, NY 11040, Herricks Union Free School District, 19-43807**

Analytical Results

Client Sample Description HERR-0208
Room 16
Collected: 10/21/2020
Lab ID: 062019850-0043

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	11/9/2020	DI	11/10/2020	DI
Lead MDL: 1.0µg/L							

Client Sample Description HERR-0209
Room 16
Collected: 10/21/2020
Lab ID: 062019850-0044

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0 µg/L	11/9/2020	DI	11/10/2020	DI
Lead MDL: 1.0µg/L							

Client Sample Description HERR-0210
Room 23
Collected: 10/21/2020
Lab ID: 062019850-0045

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/9/2020	DI	11/10/2020	DI

Client Sample Description HERR-0211
Room 23
Collected: 10/21/2020
Lab ID: 062019850-0046

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/9/2020	DI	11/10/2020	DI

Client Sample Description HERR-0212
Room 15
Collected: 10/21/2020
Lab ID: 062019850-0047

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/9/2020	DI	11/10/2020	DI

Client Sample Description HERR-0213
Room 15
Collected: 10/21/2020
Lab ID: 062019850-0048

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	26	3.0 µg/L	11/9/2020	DI	11/10/2020	DI

Client Sample Description HERR-0214
Room 24
Collected: 10/21/2020
Lab ID: 062019850-0049

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/9/2020	DI	11/10/2020	DI

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019850

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:30 PM
 Collected: 10/21/2020

Project: **Denton Avenue Elementary School, 1050 Denton Avenue, New Hyde Park, NY 11040, Herricks Union Free School District, 19-43807**

Analytical Results

Client Sample Description		HERR-0215 Room 24	Collected:	10/21/2020	Lab ID:	062019850-0050		
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst	
200.5	Lead	2.9 J	3.0 µg/L	11/9/2020	DI	11/10/2020	DI	
Lead MDL: 1.0µg/L								
Client Sample Description		HERR-0216 Room 25	Collected:	10/21/2020	Lab ID:	062019850-0051		
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst	
200.5	Lead	2.1 J	3.0 µg/L	11/9/2020	DI	11/10/2020	DI	
Lead MDL: 1.0µg/L								
Client Sample Description		HERR-0217 Room 25	Collected:	10/21/2020	Lab ID:	062019850-0052		
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst	
200.5	Lead	<3.0 ND	3.0 µg/L	11/9/2020	DI	11/10/2020	DI	
Client Sample Description		HERR-0218 Room 14	Collected:	10/21/2020	Lab ID:	062019850-0053		
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst	
200.5	Lead	5.6	3.0 µg/L	11/9/2020	DI	11/10/2020	DI	
Client Sample Description		HERR-0219 Room 14	Collected:	10/21/2020	Lab ID:	062019850-0054		
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst	
200.5	Lead	2.0 J	3.0 µg/L	11/9/2020	DI	11/10/2020	DI	
Lead MDL: 1.0µg/L								
Client Sample Description		HERR-0220 Room 13	Collected:	10/21/2020	Lab ID:	062019850-0055		
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst	
200.5	Lead	6.2	3.0 µg/L	11/9/2020	DI	11/10/2020	DI	
Client Sample Description		HERR-0221 Room 13	Collected:	10/21/2020	Lab ID:	062019850-0056		
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst	
200.5	Lead	2.8 J	3.0 µg/L	11/9/2020	DI	11/10/2020	DI	
Lead MDL: 1.0µg/L								

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019850

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:30 PM
 Collected: 10/21/2020

Project: **Denton Avenue Elementary School, 1050 Denton Avenue, New Hyde Park, NY 11040, Herricks Union Free School District, 19-43807**

Analytical Results

Client Sample Description		HERR-0222 Room 12	Collected:		10/21/2020	Lab ID:		062019850-0057
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst	
200.5	Lead	9.8	3.0 µg/L	11/9/2020	DI	11/10/2020	DI	
Client Sample Description		HERR-0223 Room 12	Collected:		10/21/2020	Lab ID:		062019850-0058
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst	
200.5	Lead	5.3	3.0 µg/L	11/9/2020	DI	11/10/2020	DI	
Client Sample Description		HERR-0224 Room 11	Collected:		10/21/2020	Lab ID:		062019850-0059
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst	
200.5	Lead	<3.0 ND	3.0 µg/L	11/9/2020	DI	11/10/2020	DI	
Client Sample Description		HERR-0225 Room 11	Collected:		10/21/2020	Lab ID:		062019850-0060
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst	
200.5	Lead	<3.0 ND	3.0 µg/L	11/9/2020	DI	11/10/2020	DI	
Client Sample Description		HERR-0226 Room 10	Collected:		10/21/2020	Lab ID:		062019850-0061
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst	
200.5	Lead	<3.0 ND	3.0 µg/L	11/9/2020	DI	11/10/2020	DI	
Client Sample Description		HERR-0227 Room 10	Collected:		10/21/2020	Lab ID:		062019850-0062
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst	
200.5	Lead	<3.0 ND	3.0 µg/L	11/9/2020	DI	11/10/2020	DI	
Client Sample Description		HERR-0228 Room 9	Collected:		10/21/2020	Lab ID:		062019850-0063
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst	
200.5	Lead	3.3	3.0 µg/L	11/9/2020	DI	11/10/2020	DI	
Client Sample Description		HERR-0229 Room 9	Collected:		10/21/2020	Lab ID:		062019850-0064
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst	

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019850

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:30 PM
 Collected: 10/21/2020

Project: **Denton Avenue Elementary School, 1050 Denton Avenue, New Hyde Park, NY 11040, Herricks Union Free School District, 19-43807**

Analytical Results

Client Sample Description		HERR-0229 Room 9	Collected:	10/21/2020	Lab ID:	062019850-0064		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0	µg/L	11/9/2020	DI	11/10/2020	DI
Lead MDL: 1.0µg/L								
Client Sample Description		HERR-0230 Room 28	Collected:	10/21/2020	Lab ID:	062019850-0065		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.8 J	3.0	µg/L	11/9/2020	DI	11/10/2020	DI
Lead MDL: 1.0µg/L								
Client Sample Description		HERR-0231 Room 28	Collected:	10/21/2020	Lab ID:	062019850-0066		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0	µg/L	11/9/2020	DI	11/10/2020	DI
Lead MDL: 1.0µg/L								
Client Sample Description		HERR-0233 Room 27	Collected:	10/21/2020	Lab ID:	062019850-0067		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.2	3.0	µg/L	11/9/2020	DI	11/10/2020	DI
Client Sample Description		HERR-0234 Room 26	Collected:	10/21/2020	Lab ID:	062019850-0068		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/9/2020	DI	11/10/2020	DI
Client Sample Description		HERR-0235 Room 26	Collected:	10/21/2020	Lab ID:	062019850-0069		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.5	3.0	µg/L	11/9/2020	DI	11/10/2020	DI
Client Sample Description		HERR-0236 Corridor	Collected:	10/21/2020	Lab ID:	062019850-0070		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/9/2020	DI	11/10/2020	DI

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019850

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:30 PM
 Collected: 10/21/2020

Project: **Denton Avenue Elementary School, 1050 Denton Avenue, New Hyde Park, NY 11040, Herricks Union Free School District, 19-43807**

Analytical Results

Client Sample Description HERR-0237
Corridor
Collected: 10/21/2020
Lab ID: 062019850-0071

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/9/2020	DI	11/10/2020	DI

Client Sample Description HERR-0238
Room 8
Collected: 10/21/2020
Lab ID: 062019850-0072

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/9/2020	DI	11/10/2020	DI

Client Sample Description HERR-0239
Room 8
Collected: 10/21/2020
Lab ID: 062019850-0073

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/9/2020	DI	11/10/2020	DI

Client Sample Description HERR-0240
Room 8 Bathroom
Collected: 10/21/2020
Lab ID: 062019850-0074

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0 µg/L	11/9/2020	DI	11/10/2020	DI

Lead MDL: 1.0µg/L

Client Sample Description HERR-0241
Room 7
Collected: 10/21/2020
Lab ID: 062019850-0075

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/9/2020	DI	11/10/2020	DI

Client Sample Description HERR-0242
Room 7
Collected: 10/21/2020
Lab ID: 062019850-0076

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/9/2020	DI	11/10/2020	DI

Client Sample Description HERR-0243
Room 7 Bathroom
Collected: 10/21/2020
Lab ID: 062019850-0077

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/9/2020	DI	11/10/2020	DI

Client Sample Description HERR-0245
Room 29
Collected: 10/21/2020
Lab ID: 062019850-0078

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019850

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:30 PM
 Collected: 10/21/2020

Project: **Denton Avenue Elementary School, 1050 Denton Avenue, New Hyde Park, NY 11040, Herricks Union Free School District, 19-43807**

Analytical Results

Client Sample Description		HERR-0245 Room 29	Collected:		10/21/2020	Lab ID:		062019850-0078
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.1	3.0	µg/L	11/9/2020	DI	11/10/2020	DI
Client Sample Description		HERR-0246 Room 29	Collected:		10/21/2020	Lab ID:		062019850-0079
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/9/2020	DI	11/10/2020	DI
Client Sample Description		HERR-0247 Room 30	Collected:		10/21/2020	Lab ID:		062019850-0080
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.1	3.0	µg/L	11/9/2020	DI	11/10/2020	DI
Client Sample Description		HERR-0248 Room 30	Collected:		10/21/2020	Lab ID:		062019850-0081
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.2	3.0	µg/L	11/10/2020	AL	11/11/2020	AL
Client Sample Description		HERR-0249 Room 31	Collected:		10/21/2020	Lab ID:		062019850-0082
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.8	3.0	µg/L	11/10/2020	AL	11/11/2020	AL
Client Sample Description		HERR-0250 Room 31	Collected:		10/21/2020	Lab ID:		062019850-0083
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	AL	11/11/2020	AL
Client Sample Description		HERR-0252 Room 32	Collected:		10/21/2020	Lab ID:		062019850-0084
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.7	3.0	µg/L	11/10/2020	AL	11/11/2020	AL
Client Sample Description		HERR-0253 Room 34	Collected:		10/21/2020	Lab ID:		062019850-0085
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019850

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:30 PM
 Collected: 10/21/2020

Project: **Denton Avenue Elementary School, 1050 Denton Avenue, New Hyde Park, NY 11040, Herricks Union Free School District, 19-43807**

Analytical Results

Client Sample Description		HERR-0253 Room 34	Collected:		10/21/2020	Lab ID:		062019850-0085
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.5	3.0	µg/L	11/10/2020	AL	11/11/2020	AL
Client Sample Description		HERR-0254 Room 34	Collected:		10/21/2020	Lab ID:		062019850-0086
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	AL	11/11/2020	AL
Client Sample Description		HERR-0255 Room 35	Collected:		10/21/2020	Lab ID:		062019850-0087
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.0	3.0	µg/L	11/10/2020	AL	11/11/2020	AL
Client Sample Description		HERR-0256 Room 35	Collected:		10/21/2020	Lab ID:		062019850-0088
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	23	3.0	µg/L	11/10/2020	AL	11/11/2020	AL
Client Sample Description		HERR-0257 Room 36	Collected:		10/21/2020	Lab ID:		062019850-0089
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0	µg/L	11/10/2020	AL	11/11/2020	AL
		Lead MDL: 1.0µg/L						
Client Sample Description		HERR-0258 Room 36	Collected:		10/21/2020	Lab ID:		062019850-0090
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	AL	11/11/2020	AL
Client Sample Description		HERR-0259 Room 37	Collected:		10/21/2020	Lab ID:		062019850-0091
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.5	3.0	µg/L	11/10/2020	AL	11/11/2020	AL
Client Sample Description		HERR-0260 Room 37	Collected:		10/21/2020	Lab ID:		062019850-0092
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019850

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:30 PM
 Collected: 10/21/2020

Project: **Denton Avenue Elementary School, 1050 Denton Avenue, New Hyde Park, NY 11040, Herricks Union Free School District, 19-43807**

Analytical Results

Client Sample Description		HERR-0260 Room 37	Collected:		10/21/2020	Lab ID:		062019850-0092
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	290 D	15	µg/L	11/10/2020	AL	11/11/2020	AL
Client Sample Description		HERR-0261 Room 38	Collected:		10/21/2020	Lab ID:		062019850-0093
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	13	3.0	µg/L	11/10/2020	AL	11/11/2020	AL
Client Sample Description		HERR-0262 Room 38	Collected:		10/21/2020	Lab ID:		062019850-0094
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0	µg/L	11/10/2020	AL	11/11/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		HERR-0263 Room 39	Collected:		10/21/2020	Lab ID:		062019850-0095
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.5	3.0	µg/L	11/10/2020	AL	11/11/2020	AL
Client Sample Description		HERR-0264 Room 39	Collected:		10/21/2020	Lab ID:		062019850-0096
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	16	3.0	µg/L	11/10/2020	AL	11/11/2020	AL
Client Sample Description		HERR-0266 Room 40	Collected:		10/21/2020	Lab ID:		062019850-0097
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	16	3.0	µg/L	11/10/2020	AL	11/11/2020	AL
Client Sample Description		HERR-0267 Boys Bathroom	Collected:		10/21/2020	Lab ID:		062019850-0098
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	23	3.0	µg/L	11/10/2020	AL	11/11/2020	AL
Client Sample Description		HERR-0268 Boys Bathroom	Collected:		10/21/2020	Lab ID:		062019850-0099
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019850

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:30 PM
 Collected: 10/21/2020

Project: **Denton Avenue Elementary School, 1050 Denton Avenue, New Hyde Park, NY 11040, Herricks Union Free School District, 19-43807**

Analytical Results

Client Sample Description HERR-0268
Boys Bathroom
Collected: 10/21/2020
Lab ID: 062019850-0099

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0 µg/L	11/10/2020	AL	11/11/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description HERR-0270
Women's Bathroom
Collected: 10/21/2020
Lab ID: 062019850-0100

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	AL	11/11/2020	AL

Client Sample Description HERR-0271
Women's Bathroom
Collected: 10/21/2020
Lab ID: 062019850-0101

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	AL	11/11/2020	AL

Client Sample Description HERR-0272
Room 41
Collected: 10/21/2020
Lab ID: 062019850-0102

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	AL	11/11/2020	AL

Client Sample Description HERR-0273
Room 41
Collected: 10/21/2020
Lab ID: 062019850-0103

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.4	3.0 µg/L	11/10/2020	AL	11/11/2020	AL

Client Sample Description HERR-0274
Room 42
Collected: 10/21/2020
Lab ID: 062019850-0104

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.1	3.0 µg/L	11/10/2020	AL	11/11/2020	AL

Client Sample Description HERR-0275
Room 42
Collected: 10/21/2020
Lab ID: 062019850-0105

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	AL	11/11/2020	AL

Client Sample Description HERR-0276
Room 43
Collected: 10/21/2020
Lab ID: 062019850-0106

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019850

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:30 PM
 Collected: 10/21/2020

Project: **Denton Avenue Elementary School, 1050 Denton Avenue, New Hyde Park, NY 11040, Herricks Union Free School District, 19-43807**

Analytical Results

Client Sample Description		HERR-0276 Room 43	Collected:	10/21/2020	Lab ID:	062019850-0106	
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	AL	11/11/2020	AL
Client Sample Description		HERR-0277 Room 43	Collected:	10/21/2020	Lab ID:	062019850-0107	
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.0	3.0 µg/L	11/10/2020	AL	11/11/2020	AL
Client Sample Description		HERR-0278 Room 44	Collected:	10/21/2020	Lab ID:	062019850-0108	
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.2 J	3.0 µg/L	11/10/2020	AL	11/11/2020	AL
		Lead MDL: 1.0µg/L					
Client Sample Description		HERR-0281 Gym	Collected:	10/21/2020	Lab ID:	062019850-0109	
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	38	3.0 µg/L	11/10/2020	AL	11/11/2020	AL
Client Sample Description		HERR-0282 Gym	Collected:	10/21/2020	Lab ID:	062019850-0110	
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	11/10/2020	AL	11/11/2020	AL
		Lead MDL: 1.0µg/L					
Client Sample Description		HERR-0283 Gym Girls Toilet	Collected:	10/21/2020	Lab ID:	062019850-0111	
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.1	3.0 µg/L	11/10/2020	AL	11/11/2020	AL
Client Sample Description		HERR-0284 Gym Boys Toilet	Collected:	10/21/2020	Lab ID:	062019850-0112	
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.9	3.0 µg/L	11/10/2020	AL	11/11/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019850

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:30 PM
 Collected: 10/21/2020

Project: **Denton Avenue Elementary School, 1050 Denton Avenue, New Hyde Park, NY 11040, Herricks Union Free School District, 19-43807**

Analytical Results

Client Sample Description		HERR-1001 Room 29	Collected:	10/21/2020	Lab ID:	062019850-0113		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	AL	11/11/2020	AL
Client Sample Description		HERR-1002 Room 30	Collected:	10/21/2020	Lab ID:	062019850-0114		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	AL	11/11/2020	AL
Client Sample Description		HERR-1003 Room 31	Collected:	10/21/2020	Lab ID:	062019850-0115		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	AL	11/11/2020	AL
Client Sample Description		HERR-1004 Room 34	Collected:	10/21/2020	Lab ID:	062019850-0116		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	AL	11/11/2020	AL
Client Sample Description		HERR-1005 Room 35	Collected:	10/21/2020	Lab ID:	062019850-0117		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	AL	11/11/2020	AL
Client Sample Description		HERR-1006 Room 36	Collected:	10/21/2020	Lab ID:	062019850-0118		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	AL	11/11/2020	AL
Client Sample Description		HERR-1007 Room 37	Collected:	10/21/2020	Lab ID:	062019850-0119		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	AL	11/11/2020	AL
Client Sample Description		HERR-1008 Room 39	Collected:	10/21/2020	Lab ID:	062019850-0120		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019850

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 10/22/2020 12:30 PM
Collected: 10/21/2020

Project: **Denton Avenue Elementary School, 1050 Denton Avenue, New Hyde Park, NY 11040, Herricks Union Free School District, 19-43807**

Analytical Results

Client Sample Description		HERR-1008 Room 39	Collected:	10/21/2020	Lab ID:	062019850-0120		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	AL	11/11/2020	AL
Client Sample Description		HERR-1009 Room 41	Collected:	10/21/2020	Lab ID:	062019850-0121		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/9/2020	DI	11/10/2020	AL
Client Sample Description		HERR-1010 Room 42	Collected:	10/21/2020	Lab ID:	062019850-0122		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/9/2020	DI	11/10/2020	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-43807

Building: Herricks Community Center

HCC

062019891

Page 1 of 5

Client:

Herricks Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
HERR-0891	CR	2022	Room 122	CF	10/23/2020	6:12:00 AM
HERR-0892	CR	2023	Room 120	CF	10/23/2020	6:15:00 AM
HERR-0893	CR	2023	Room 120	CF	10/23/2020	6:15:00 AM
HERR-0895	HA	2024	Corridor Room 119 To Custodial Closet	DW	10/23/2020	6:21:00 AM
HERR-0896	HA	2024	Corridor Room 119 To Custodial Closet	BW	10/23/2020	6:17:00 AM
HERR-0898	CR	2035	Room 118	CF	10/23/2020	6:19:00 AM
HERR-0899	CR	2035	Room 118	CF	10/23/2020	6:19:00 AM
HERR-0901	CR	2028	Room 119	CF	10/23/2020	6:22:00 AM
HERR-0904	CR	2030A	Room 115	CF	10/23/2020	6:26:00 AM
HERR-0906	BR	2030A1	Room 117A Bathroom	BF	10/23/2020	6:29:00 AM
HERR-0907	BR	2030A1	Room 117A Bathroom	BF	10/23/2020	6:29:00 AM
HERR-0909	BR	2044	Boys Bathroom	BF	10/23/2020	6:29:00 AM
HERR-0910	KI	2037	Part of Kitchen	KC	10/23/2020	6:09:00 AM
HERR-0912	KI	2037	Part of Kitchen	KC	10/23/2020	6:09:00 AM
HERR-0913	KI	2037	Part of Kitchen	SN	10/23/2020	6:09:00 AM
HERR-0914	BR	2045	Girls Bathroom	BF	10/23/2020	6:32:00 AM
HERR-0915	BR	2045	Girls Bathroom	BF	10/23/2020	6:32:00 AM
HERR-0916	BR	2045	Girls Bathroom	BF	10/23/2020	6:32:00 AM

Building Address

999 B Herricks Road

New Hyde Park, NY 11040

Pb 206.5 -

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Daniel Smalls ; Savannah Crowe

Samplers Signature: *[Signature]* Savannah Crowe

JCB Project Manager: George Greve

OrderID: 062019891



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-43807

Building: Herricks Community Center

HCC

062 019891

Client:

Herricks Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Page 2 of 5

OrderID: 062019891

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
HERR-0917	BR	2046	Women's Bathroom	BF	10/23/2020	6:32:00 AM
HERR-0918	BR	2046	Women's Bathroom	BF	10/23/2020	6:32:00 AM
HERR-0919	BR	2047	Men's Bathroom	BF	10/23/2020	6:31:00 AM
HERR-0920	HA	2052	Corridor Outside Shops	DW	10/23/2020	6:35:00 AM
HERR-0922	SP	2048	Shop 2	DW	10/23/2020	6:34:00 AM
HERR-0923	OF	2051B	Shop 1 Office Lounge Area	WC	10/23/2020	6:36:00 AM
HERR-0924	ST	2051C	Shop 1 Bathroom	CF	10/23/2020	6:36:00 AM
HERR-0925	CA	2053	Cafeteria	BW	10/23/2020	6:40:00 AM
HERR-0927	CA	2053	Cafeteria	DW	10/23/2020	6:49:00 AM
HERR-0928	KI	2055	Kitchen	KC	10/23/2020	6:44:00 AM
HERR-0931	KI	2055	Kitchen	KC	10/23/2020	6:47:00 AM
HERR-0932	KI	2055	Kitchen	KC	10/23/2020	6:47:00 AM
HERR-0934	KI	2055	Kitchen	KC	10/23/2020	6:44:00 AM
HERR-0936	HA	2077	Corridor Breezeway To Cafeteria	BW	10/23/2020	6:52:00 AM
HERR-0937	HA	2077	Corridor Breezeway To Cafeteria	DW	10/23/2020	6:52:00 AM
HERR-0939	BR	2091	Toddlers Bathroom	BF	10/23/2020	6:56:00 AM
HERR-0940	BR	2091	Toddlers Bathroom	BF	10/23/2020	6:56:00 AM
HERR-0942	BR	2091	Toddlers Bathroom	BF	10/23/2020	6:56:00 AM

Building Address

999 B Herricks Road

New Hyde Park, NY 11040

Pb 200.5 -

A. Lundy 11/12/20

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name: Daniel Smalls Savannah Crowe

Samplers Signature: *D. Smalls*, *Savannah Crowe*

JCB Project Manager: *George Grev*



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-43807

Building: Herricks Community Center

HCC

062019891

Client:

Herricks Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush _____

Page 3 of 5

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
HERR-0944	BR	2094	Men's Bathroom Vestibule Storage Closet	BF	10/23/2020	6:58:00 AM
HERR-0948	HA	2114	Room 108A Women's Teachers Vestibule	DW	10/23/2020	7:03:00 AM
HERR-0949	BR	2115	Women/Girls Bathroom Adjacent B 11	BF	10/23/2020	7:06:00 AM
HERR-0950	BR	2115	Women/Girls Bathroom Adjacent B 11	BF	10/23/2020	7:06:00 AM
HERR-0951	BR	2115	Women/Girls Bathroom Adjacent B 11	BF	10/23/2020	7:06:00 AM
HERR-0952	BR	2115	Women/Girls Bathroom Adjacent B 11	BF	10/23/2020	7:06:00 AM
HERR-0956	CR	2137	Room 114	CF	10/23/2020	7:10:00 AM
HERR-0957	CR	2137	Room 114	SN	10/23/2020	7:10:00 AM
HERR-0958	CR	2137	Room 114	CF	10/23/2020	7:10:00 AM
HERR-0959	CR	2137	Room 114	SN	10/23/2020	7:12:00 AM
HERR-0960	CR	2137	Room 114	CF	10/23/2020	7:10:00 AM
HERR-0961	CR	2137	Room 114	SN	10/23/2020	7:13:00 AM
HERR-0962	CR	2137	Room 114	CF	10/23/2020	7:12:00 AM
HERR-0963	BR	2137A	Room 114 Bathroom	BF	10/23/2020	7:12:00 AM
HERR-0964	ST	2154	Auxiliary Gym Closet	IM	10/23/2020	7:35:00 AM
HERR-0965	LR	2149	Girls Locker Room	BF	10/23/2020	7:38:00 AM
HERR-0966	LR	2149	Girls Locker Room	BF	10/23/2020	7:38:00 AM
HERR-0967	LR	2149	Girls Locker Room	BF	10/23/2020	7:38:00 AM

Building Address

999 B Herricks Road

New Hyde Park, NY 11040

Pb 2035-

A. J. Long 11/12/20

Analysis Type: ELAP 200.5 ⁴⁰

Lab Received: *[Signature]*

Signature: *[Signature]*

Samplers Name: *Daniel Smalls, Savannah Crowe*

Samplers Signature: *[Signature]*, Savannah Crowe

JCB Project Manager: *George Greve*

OrderID: 062019891



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-43807
Building: Herricks Community Center
HCC

062019891

Client:

Herricks Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush ☐

Page 4 of 5

OrderID: 062019891

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
HERR-0968	LR	2149	Girls Locker Room	DW	10/23/2020	7:38:00 AM
HERR-0969	GY	2160	Gym A	BW	10/23/2020	7:39:00 AM
HERR-0970	GY	2160	Gym A	DW	10/23/2020	7:39:00 AM
HERR-0971	LR	2168	Boys Locker Room	BF	10/23/2020	7:41:00 AM
HERR-0972	LR	2168	Boys Locker Room	BF	10/23/2020	7:41:00 AM
HERR-0973	LR	2168	Boys Locker Room	BF	10/23/2020	7:41:00 AM
HERR-0975	BR	3185B	Ladies Bathroom	BF	10/23/2020	7:25:00 AM
HERR-0976	BR	3185B	Ladies Bathroom	BF	10/23/2020	7:25:00 AM
HERR-0977	BR	3185B	Ladies Bathroom	BF	10/23/2020	7:25:00 AM
HERR-0980	HA	3197	2nd Floor Corridor	BW	10/23/2020	7:19:00 AM
HERR-0981	HA	3197	2nd Floor Corridor	DW	10/23/2020	7:19:00 AM
HERR-0982	BR	3185B	Ladies Bathroom	BF	10/23/2020	7:21:00 AM
HERR-0983	BR	3185B	Ladies Bathroom	BF	10/23/2020	7:21:00 AM
HERR-0984	BR	3185B	Ladies Bathroom	BF	10/23/2020	7:21:00 AM
HERR-1023	BR	2104A	Room 105 Vestibule Left Office Bathroom	BF	10/23/2020	6:49:00 AM
HERR-1024	OF	2036	Harbor Daycare Nurse Office	NS	10/23/2020	7:51:00 AM
HERR-1025	OF	2036	Harbor Daycare Nurse Office	NS	10/23/2020	7:51:00 AM
HERR-1026	OF	2036	Harbor Daycare Nurse Office	NS	10/23/2020	7:51:00 AM

Building Address

999 B Herricks Road

New Hyde Park, NY 11040

06200.5-

A. Long 11/12/20

Analysis Type: ELAP 200.5 ^(AL)

Lab Received:

Signature:

[Signature]

Samplers Name: *Daniel Snells, Savannah Crome*

Samplers Signature: *[Signature]* Savannah Crome

JCB Project Manager: *George Greve*



Lead in Water: Chain of Custody for

J. C. BRÖDERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-43807

Building: Herricks Community Center

HCC

06209891

Page 5 of 5

Client:

Herricks Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
-----------	-----------------------	----------	------------------	-------------	-------------	-------------

Samples Submitted 72

RECEIVED
ANALYTICAL, INC.
CARLE PLACE, NY
20 OCT 23 PM 3:05

Building Address

999 B Herricks Road

New Hyde Park, NY 11040

200.5

A. Lundy 11/12/20

Analysis Type: ELAP 200.5

Lab Received:

Signature:

[Signature]

Samplers Name: Daniel Smalls, Savannah Crowe

Samplers Signature: *[Signature]* Savannah Crowe

JCB Project Manager: George Grene

OrderID: 062019891



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

**George Greve
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788**

11/23/2020

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 10/23/2020. The results are tabulated on the attached data pages for the following client designated project:

**#19-43807, Herricks Community Center, Herricks Union Free
School District, 999 B Herricks Road, New Hyde Park, NY 11040**

The reference number for these samples is EMSL Order #062019891. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019891

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/23/2020 03:04 PM
 Collected: 10/23/2020

Project: #19-43807, Herricks Community Center, Herricks Union Free School District, 999 B Herricks Road, New Hyde Park, NY 11040

Analytical Results

Client Sample Description		HERR-0891	Collected:	10/23/2020	Lab ID:	062019891-0001		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/11/2020	DI	11/12/2020	AL
Client Sample Description		HERR-0892	Collected:	10/23/2020	Lab ID:	062019891-0002		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/11/2020	DI	11/12/2020	AL
Client Sample Description		HERR-0893	Collected:	10/23/2020	Lab ID:	062019891-0003		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.7	3.0	µg/L	11/11/2020	DI	11/12/2020	AL
Client Sample Description		HERR-0895	Collected:	10/23/2020	Lab ID:	062019891-0004		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0	µg/L	11/11/2020	DI	11/12/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		HERR-0896	Collected:	10/23/2020	Lab ID:	062019891-0005		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/11/2020	DI	11/12/2020	AL
Client Sample Description		HERR-0898	Collected:	10/23/2020	Lab ID:	062019891-0006		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/11/2020	DI	11/12/2020	AL
Client Sample Description		HERR-0899	Collected:	10/23/2020	Lab ID:	062019891-0007		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0	µg/L	11/11/2020	DI	11/12/2020	AL
Lead MDL: 1.0µg/L								

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019891

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/23/2020 03:04 PM
 Collected: 10/23/2020

Project: #19-43807, Herricks Community Center, Herricks Union Free School District, 999 B Herricks Road, New Hyde Park, NY 11040

Analytical Results

Client Sample Description HERR-0901 **Collected:** 10/23/2020 **Lab ID:** 062019891-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0904 **Collected:** 10/23/2020 **Lab ID:** 062019891-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0906 **Collected:** 10/23/2020 **Lab ID:** 062019891-0010

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0907 **Collected:** 10/23/2020 **Lab ID:** 062019891-0011

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0909 **Collected:** 10/23/2020 **Lab ID:** 062019891-0012

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0910 **Collected:** 10/23/2020 **Lab ID:** 062019891-0013

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0912 **Collected:** 10/23/2020 **Lab ID:** 062019891-0014

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0913 **Collected:** 10/23/2020 **Lab ID:** 062019891-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019891

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/23/2020 03:04 PM
 Collected: 10/23/2020

Project: #19-43807, Herricks Community Center, Herricks Union Free School District, 999 B Herricks Road, New Hyde Park, NY 11040

Analytical Results

Client Sample Description		HERR-0913		Collected:	10/23/2020	Lab ID:	062019891-0015	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/11/2020	DI	11/12/2020	AL
Client Sample Description		HERR-0914		Collected:	10/23/2020	Lab ID:	062019891-0016	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/11/2020	DI	11/12/2020	AL
Client Sample Description		HERR-0915		Collected:	10/23/2020	Lab ID:	062019891-0017	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/11/2020	DI	11/12/2020	AL
Client Sample Description		HERR-0916		Collected:	10/23/2020	Lab ID:	062019891-0018	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.3	3.0	µg/L	11/11/2020	DI	11/12/2020	AL
Client Sample Description		HERR-0917		Collected:	10/23/2020	Lab ID:	062019891-0019	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/11/2020	DI	11/12/2020	AL
Client Sample Description		HERR-0918		Collected:	10/23/2020	Lab ID:	062019891-0020	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/11/2020	DI	11/12/2020	AL
Client Sample Description		HERR-0919		Collected:	10/23/2020	Lab ID:	062019891-0021	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/11/2020	DI	11/12/2020	AL
Client Sample Description		HERR-0920		Collected:	10/23/2020	Lab ID:	062019891-0022	
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019891

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/23/2020 03:04 PM
 Collected: 10/23/2020

Project: #19-43807, Herricks Community Center, Herricks Union Free School District, 999 B Herricks Road, New Hyde Park, NY 11040

Analytical Results

Client Sample Description HERR-0920 **Collected:** 10/23/2020 **Lab ID:** 062019891-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.8	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0922 **Collected:** 10/23/2020 **Lab ID:** 062019891-0023

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	13	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0923 **Collected:** 10/23/2020 **Lab ID:** 062019891-0024

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0924 **Collected:** 10/23/2020 **Lab ID:** 062019891-0025

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0925 **Collected:** 10/23/2020 **Lab ID:** 062019891-0026

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0927 **Collected:** 10/23/2020 **Lab ID:** 062019891-0027

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0928 **Collected:** 10/23/2020 **Lab ID:** 062019891-0028

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.1 J	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description HERR-0931 **Collected:** 10/23/2020 **Lab ID:** 062019891-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019891

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/23/2020 03:04 PM
 Collected: 10/23/2020

Project: #19-43807, Herricks Community Center, Herricks Union Free School District, 999 B Herricks Road, New Hyde Park, NY 11040

Analytical Results

Client Sample Description HERR-0931 **Collected:** 10/23/2020 **Lab ID:** 062019891-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.9	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0932 **Collected:** 10/23/2020 **Lab ID:** 062019891-0030

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	920 D	30 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0934 **Collected:** 10/23/2020 **Lab ID:** 062019891-0031

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description HERR-0936 **Collected:** 10/23/2020 **Lab ID:** 062019891-0032

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0937 **Collected:** 10/23/2020 **Lab ID:** 062019891-0033

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0939 **Collected:** 10/23/2020 **Lab ID:** 062019891-0034

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0940 **Collected:** 10/23/2020 **Lab ID:** 062019891-0035

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0942 **Collected:** 10/23/2020 **Lab ID:** 062019891-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019891

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/23/2020 03:04 PM
 Collected: 10/23/2020

Project: #19-43807, Herricks Community Center, Herricks Union Free School District, 999 B Herricks Road, New Hyde Park, NY 11040

Analytical Results

Client Sample Description HERR-0942 **Collected:** 10/23/2020 **Lab ID:** 062019891-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0944 **Collected:** 10/23/2020 **Lab ID:** 062019891-0037

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0948 **Collected:** 10/23/2020 **Lab ID:** 062019891-0038

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.7	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0949 **Collected:** 10/23/2020 **Lab ID:** 062019891-0039

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0950 **Collected:** 10/23/2020 **Lab ID:** 062019891-0040

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0951 **Collected:** 10/23/2020 **Lab ID:** 062019891-0041

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0952 **Collected:** 10/23/2020 **Lab ID:** 062019891-0042

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0956 **Collected:** 10/23/2020 **Lab ID:** 062019891-0043

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019891

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/23/2020 03:04 PM
 Collected: 10/23/2020

Project: #19-43807, Herricks Community Center, Herricks Union Free School District, 999 B Herricks Road, New Hyde Park, NY 11040

Analytical Results

Client Sample Description HERR-0956 **Collected:** 10/23/2020 **Lab ID:** 062019891-0043

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0957 **Collected:** 10/23/2020 **Lab ID:** 062019891-0044

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.4	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0958 **Collected:** 10/23/2020 **Lab ID:** 062019891-0045

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.2 J	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description HERR-0959 **Collected:** 10/23/2020 **Lab ID:** 062019891-0046

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	17	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0960 **Collected:** 10/23/2020 **Lab ID:** 062019891-0047

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0961 **Collected:** 10/23/2020 **Lab ID:** 062019891-0048

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	15	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0962 **Collected:** 10/23/2020 **Lab ID:** 062019891-0049

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	13	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0963 **Collected:** 10/23/2020 **Lab ID:** 062019891-0050

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019891

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/23/2020 03:04 PM
 Collected: 10/23/2020

Project: #19-43807, Herricks Community Center, Herricks Union Free School District, 999 B Herricks Road, New Hyde Park, NY 11040

Analytical Results

Client Sample Description HERR-0963 **Collected:** 10/23/2020 **Lab ID:** 062019891-0050

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0964 **Collected:** 10/23/2020 **Lab ID:** 062019891-0051

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.8	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0965 **Collected:** 10/23/2020 **Lab ID:** 062019891-0052

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.6	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0966 **Collected:** 10/23/2020 **Lab ID:** 062019891-0053

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.2	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0967 **Collected:** 10/23/2020 **Lab ID:** 062019891-0054

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.0	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0968 **Collected:** 10/23/2020 **Lab ID:** 062019891-0055

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.2	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0969 **Collected:** 10/23/2020 **Lab ID:** 062019891-0056

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0970 **Collected:** 10/23/2020 **Lab ID:** 062019891-0057

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019891

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/23/2020 03:04 PM
 Collected: 10/23/2020

Project: #19-43807, Herricks Community Center, Herricks Union Free School District, 999 B Herricks Road, New Hyde Park, NY 11040

Analytical Results

Client Sample Description HERR-0970 **Collected:** 10/23/2020 **Lab ID:** 062019891-0057

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0971 **Collected:** 10/23/2020 **Lab ID:** 062019891-0058

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0972 **Collected:** 10/23/2020 **Lab ID:** 062019891-0059

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0973 **Collected:** 10/23/2020 **Lab ID:** 062019891-0060

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0975 **Collected:** 10/23/2020 **Lab ID:** 062019891-0061

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0976 **Collected:** 10/23/2020 **Lab ID:** 062019891-0062

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0977 **Collected:** 10/23/2020 **Lab ID:** 062019891-0063

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description HERR-0980 **Collected:** 10/23/2020 **Lab ID:** 062019891-0064

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019891

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/23/2020 03:04 PM
 Collected: 10/23/2020

Project: #19-43807, Herricks Community Center, Herricks Union Free School District, 999 B Herricks Road, New Hyde Park, NY 11040

Analytical Results

Client Sample Description HERR-0980 **Collected:** 10/23/2020 **Lab ID:** 062019891-0064

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0981 **Collected:** 10/23/2020 **Lab ID:** 062019891-0065

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0982 **Collected:** 10/23/2020 **Lab ID:** 062019891-0066

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.5	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0983 **Collected:** 10/23/2020 **Lab ID:** 062019891-0067

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.6	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-0984 **Collected:** 10/23/2020 **Lab ID:** 062019891-0068

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description HERR-1023 **Collected:** 10/23/2020 **Lab ID:** 062019891-0069

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-1024 **Collected:** 10/23/2020 **Lab ID:** 062019891-0070

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-1025 **Collected:** 10/23/2020 **Lab ID:** 062019891-0071

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019891

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 10/23/2020 03:04 PM
Collected: 10/23/2020

Project: #19-43807, Herricks Community Center, Herricks Union Free School District, 999 B Herricks Road, New Hyde Park, NY 11040

Analytical Results

Client Sample Description HERR-1025 **Collected:** 10/23/2020 **Lab ID:** 062019891-0071

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Client Sample Description HERR-1026 **Collected:** 10/23/2020 **Lab ID:** 062019891-0072

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/11/2020	DI	11/12/2020	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-43807

Building: Herricks High School

HHS

Client:

Herricks Union Free School District

Retest/New Install ☒Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
HERR-0590	BR	6011	600 Wing Girls Bathroom	BF	10/24/2020	7:42:00 AM
HERR-0593	HA	6015	600 Wing Corridor	BW	10/24/2020	7:44:00 AM
HERR-0596	BR	6013	600 Wing Boys Bathroom	BF	10/24/2020	7:45:00 AM
HERR-0629	BR	3323	Boys Bathroom	BF	10/24/2020	8:07:00 AM
HERR-0630	BR	3323	Boys Bathroom	BF	10/24/2020	8:07:00 AM
HERR-0631	BR	3323	Boys Bathroom	BF	10/24/2020	8:08:00 AM
HERR-0632	BR	3323	Boys Bathroom	BF	10/24/2020	8:08:00 AM
HERR-0633	HA	3344	North Wing Second Floor Corridor	BW	10/24/2020	8:09:00 AM
HERR-0636	BR	3325	Girls Bathroom	BF	10/24/2020	8:16:00 AM
HERR-0637	BR	3325	Girls Bathroom	BF	10/24/2020	8:16:00 AM
HERR-0638	BR	3325	Girls Bathroom	BF	10/24/2020	8:16:00 AM
HERR-0639	BR	3325	Girls Bathroom	BF	10/24/2020	8:17:00 AM
HERR-0640	BR	3325	Girls Bathroom	BF	10/24/2020	8:17:00 AM
HERR-0644	SC	3331A	Chemical Storage Room	IM	10/24/2020	8:20:00 AM
HERR-0685	BR	2069	Girls Bathroom	BF	10/24/2020	8:37:00 AM
HERR-0686	BR	2069	Girls Bathroom	BF	10/24/2020	8:37:00 AM
HERR-0688	BR	2069	Girls Bathroom	BF	10/24/2020	8:38:00 AM
HERR-0689	BR	2069	Girls Bathroom	BF	10/24/2020	8:38:00 AM

Building Address

100 Shelter Rock Road

New Hyde Park, NY 11040

Analysis Type: ELAP 200.5 (M) 40

Lab Received:

Signature:

Michelle DeVito 10/27/20 1230 PM

Samplers Name:

Samplers Signature:

JCB Project Manager:

George Greene

062020089

STATE OF NEW YORK
OFFICE OF THE ATTORNEY GENERAL
DIVISION OF LABOR & INDUSTRY
LABORATORY



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-43807
Building: Herricks High School
HHS

Client: Herricks Union Free School District
Retest/New Install ☒
Turn Around: Normal 1 wk Rush

Page 2 of 6

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
HERR-0691	HA	2067	North Wing Corridor	DW	10/24/2020	8:39:00 AM
HERR-0692	BR	2070	Boys Bathroom	BF	10/24/2020	8:42:00 AM
HERR-0693	BR	2070	Boys Bathroom	BF	10/24/2020	8:42:00 AM
HERR-0700	BR	2076	Women Faculty Bathroom	BF	10/24/2020	8:50:00 AM
HERR-0711	BR	2080	Faculty Men's Bathroom	BF	10/24/2020	8:54:00 AM
HERR-0717	CR	4009	Room 500	WF	10/24/2020	9:02:00 AM
HERR-0722	HA	2067	North Wing Corridor	DW	10/24/2020	9:10:00 AM
HERR-0723	HA	2100	West Wing Corridor	BW	10/24/2020	9:13:00 AM
HERR-0724	BR	2108	Boys Bathroom	BF	10/24/2020	9:15:00 AM
HERR-0725	BR	2108	Boys Bathroom	BF	10/24/2020	9:15:00 AM
HERR-0727	BR	2107	Girls Bathroom	BF	10/24/2020	9:16:00 AM
HERR-0728	BR	2107	Girls Bathroom	BF	10/24/2020	9:16:00 AM
HERR-0729	BR	2107	Girls Bathroom	BF	10/24/2020	9:16:00 AM
HERR-0732	CA	2313	Cafeteria B	BW	10/24/2020	9:22:00 AM
HERR-0736	CA	2304	Cafeteria A	BW	10/24/2020	9:24:00 AM
HERR-0738	KI	2309	Cafeteria A Serving Area	SA	10/24/2020	9:32:00 AM
HERR-0739	KI	2309	Cafeteria A Serving Area	SA	10/24/2020	9:32:00 AM
HERR-0740	KI	2313D	Cafeteria B Serving Area	SA	10/24/2020	9:33:00 AM

Building Address

100 Shelter Rock Road

New Hyde Park, NY 11040

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name:

Samplers Signature:

JCB Project Manager:

062020089

1230 PM

10/27/20

George Greve

STATE OF NEW YORK
OFFICE OF THE ATTORNEY GENERAL
JAMES T. COHEN, JR.
JAMES T. COHEN, JR.
JAMES T. COHEN, JR.

OrderID: 062020089



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-43807

Building: Herricks High School

HHS

Client:

Herricks Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk. Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
HERR-0741	KI	2312	Kitchen	KC	10/24/2020	9:34:00 AM
HERR-0742	KI	2312	Kitchen	KC	10/24/2020	9:39:00 AM
HERR-0743	KI	2312	Kitchen	KC	10/24/2020	9:39:00 AM
HERR-0744	KI	2312	Kitchen	SN	10/24/2020	9:40:00 AM
HERR-0746	KI	2312	Kitchen	IM	10/24/2020	9:45:00 AM
HERR-0748	KI	2312	Kitchen	KC	10/24/2020	9:43:00 AM
HERR-0749	KI	2312	Kitchen	KC	10/24/2020	9:43:00 AM
HERR-0750	KI	2312	Kitchen	PK	10/24/2020	9:33:00 AM
HERR-0751	KI	2312	Kitchen	PK	10/24/2020	9:33:00 AM
HERR-0752	KI	2312	Kitchen	PK	10/24/2020	9:34:00 AM
HERR-0753	KI	2312	Kitchen	PK	10/24/2020	9:34:00 AM
HERR-0754	KI	2312A	Kitchen Washing Area	KC	10/24/2020	9:39:00 AM
HERR-0755	KI	2312A	Kitchen Washing Area	KC	10/24/2020	9:39:00 AM
HERR-0757	BR	0016	Women's Bathroom	BF	10/24/2020	9:58:00 AM
HERR-0758	BR	0017	Men's Bathroom	BF	10/24/2020	9:58:00 AM
HERR-0761	BR	2114	Faculty Women's Bathroom	BF	10/24/2020	9:58:00 AM
HERR-0765	KI	2124	Library Kitchen Area	KC	10/24/2020	10:00:00 AM
HERR-0766	BR	2169	Girls Bathroom	BF	10/24/2020	10:03:00 AM

Building Address

100 Shelter Rock Road

New Hyde Park, NY 11040

Analysis Type: FLAP 200.5

Lab Received:

Signature:

Samplers Name:

Samplers Signature:

JCB Project Manager:

062020089

 Michelle DeVito 10/27/20
 1230 PM

 Edward Gally, Daniel Smalls
 George Grene



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-43807

Building: Herricks High School

HHS

Client:

Herricks Union Free School District

Retest/New Install ☒

Turn Around: Normal 1 wk Rush

Page 4 of 6

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
HERR-0770	BR	2172	Boys Bathroom	BF	10/24/2020	10:07:00 AM
HERR-0772	CR	2175	District Information Officer Office (Interior Walls Removed, Now Part Of Space 2174)	EC	10/24/2020	10:09:00 AM
HERR-0773	HE	2177	Room 406	EC	10/24/2020	10:10:00 AM
HERR-0774	HE	2177	Room 406	EC	10/24/2020	10:10:00 AM
HERR-0775	HE	2177	Room 406	EC	10/24/2020	10:14:00 AM
HERR-0776	HE	2177	Room 406	EC	10/24/2020	10:11:00 AM
HERR-0777	HE	2177	Room 406	EC	10/24/2020	10:11:00 AM
HERR-0778	HE	2177	Room 406	EC	10/24/2020	10:13:00 AM
HERR-0779	BR	2181	Boys Bathroom	BF	10/24/2020	10:18:00 AM
HERR-0780	BR	2181	Boys Bathroom	BF	10/24/2020	10:19:00 AM
HERR-0781	BR	2181	Boys Bathroom	BF	10/24/2020	10:19:00 AM
HERR-0783	HA	2195A	East Wing Corridor	BW	10/24/2020	10:20:00 AM
HERR-0790	BR	2179	Girls Bathroom	BF	10/24/2020	10:21:00 AM
HERR-0791	BR	2179	Girls Bathroom	BF	10/24/2020	10:21:00 AM
HERR-0792	BR	2179	Girls Bathroom	BF	10/24/2020	10:21:00 AM
HERR-0793	BR	2179	Girls Bathroom	BF	10/24/2020	10:21:00 AM
HERR-0799	CF	2133	Room 307	CR	10/24/2020	10:33:00 AM
HERR-0800	BR	4023A	Health Office Bathroom	BF	10/24/2020	10:35:00 AM

Building Address

100 Shelter Rock Road

New Hyde Park, NY 11040

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name:

Samplers Signature:

JCB Project Manager:

062020089

10/27/20 1230 PM

Order ID: 062020089



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-43807

Building: Herricks High School

HHS

Client:

Herricks Union Free School District

Retest/New Install ☒Turn Around: Normal ☒ Rush ☐

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
HERR-0801	NO	4023B	Health Office Nurses Area	NS	10/24/2020	10:36:00 AM
HERR-0802	NO	4023B	Health Office Nurses Area	NS	10/24/2020	10:37:00 AM
HERR-0803	LR	2252	Gym 1 Girls Locker Room	DW	10/24/2020	10:38:00 AM
HERR-0804	LR	2252	Gym 1 Girls Locker Room	BF	10/24/2020	10:38:00 AM
HERR-0805	LR	2252	Gym 1 Girls Locker Room	BF	10/24/2020	10:40:00 AM
HERR-0806	BR	2209	Girls P. E. Office 96 Bathroom	BF	10/24/2020	10:45:00 AM
HERR-0808	BR	2203/2207	Gym 2 Girls Locker Room/Bathroom	BF	10/24/2020	10:47:00 AM
HERR-0811	BR	2219A	Gym 2 Coach Office Bathroom	BF	10/24/2020	10:50:00 AM
HERR-0813	BR	2217	Boys Locker Room Bathrooms	BF	10/24/2020	10:53:00 AM
HERR-0820	BR	2231	Athletic Director Bathroom	BF	10/24/2020	11:00:00 AM
HERR-0824	BR	2237	Boys Bathroom Adjacent C-15	BF	10/24/2020	11:04:00 AM
HERR-0826	HA	2261	Corridor Outside Main Office	BW	10/24/2020	11:09:00 AM
HERR-0829	OF	2242	Athletic Training Room	CF	10/24/2020	11:10:00 AM
HERR-0830	OF	2242	Athletic Training Room	IM	10/24/2020	11:11:00 AM
HERR-0831	BR	2263A	Principal Secretary Office Bathroom	BF	10/24/2020	11:17:00 AM
HERR-0832	OF	2266	Main Office Kitchen/Copy Area	CF	10/24/2020	11:21:00 AM
HERR-0833	BR	2269	Girls Bathroom	BF	10/24/2020	11:22:00 AM
HERR-0834	BR	2269	Girls Bathroom	BF	10/24/2020	11:22:00 AM

Building Address

100 Shelter Rock Road

New Hyde Park, NY 11040

Analysis Type: ELAP 200.5

Lab Received:

Signature:

Samplers Name

Samplers Signature:

JCB Project Manager:

062020089

10/27/20 1230 PM



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-43807

Building: Herricks High School

HHS

Client:

Herricks Union Free School District

Retest/New Install ☒

Turn Around: Normal 1 wk Rush ☒

Page 6 of 6

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
HERR-0836	BR	2270	Boys Bathroom	BF	10/24/2020	11:23:00 AM
HERR-0849	BR	4025	Faculty Women's Bathroom	BF	10/24/2020	11:43:00 AM
HERR-0850	BR	4025	Faculty Women's Bathroom	BF	10/24/2020	11:43:00 AM
HERR-0852	BR	4026	Faculty Men's Room	BF	10/24/2020	11:35:00 AM
HERR-1036	OF	2074	Room 505 Rear Office D-E	WF	10/23/2020	8:58:00 AM
HERR-1040	CA	2313	Cafeteria B	CF	10/23/2020	9:23:00 AM
HERR-1041	HA	2307	Corridor Boiler Room to Cafeteria B	CF	10/23/2020	9:55:00 AM
HERR-1042	HA	2260	Corridor Gym 1 to Room 309	CF	10/23/2020	10:36:00 AM

Samples Submitted 98

062020089

20 OCT 27 PM 12:30
ST ANALYTICAL, INC.
CARLE PLACE, NY

Building Address Pb 200.5 11/23/2020
100 Shelter Rock Road
New Hyde Park, NY 11040 11/24/20

Analysis Type: ELAP 200.5

Lab Received:

Signature:

10/27/20 1230 Pm

Samplers Name: Edward Chalkley, Daniel Smalls

Samplers Signature:

JCB Project Manager:

George Greve



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

**George Greve
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788**

11/24/2020

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 10/27/2020. The results are tabulated on the attached data pages for the following client designated project:

**Herricks Union Free School District, Herricks High School, HHS,
100 Shelter Rock Road, New Hyde Park, NY 11040, #:19-43807**

The reference number for these samples is EMSL Order #062020089. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020089

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/27/2020 12:30 PM
 Collected: 10/24/2020

Project: **Herricks Union Free School District, Herricks High School, HHS, 100 Shelter Rock Road, New Hyde Park, NY 11040, #:19-43807**

Analytical Results

Client Sample Description HERR-0590 **Collected:** 10/24/2020 **Lab ID:** 062020089-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0 µg/L	11/19/2020	DI	11/20/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description HERR-0593 **Collected:** 10/24/2020 **Lab ID:** 062020089-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0596 **Collected:** 10/24/2020 **Lab ID:** 062020089-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0629 **Collected:** 10/24/2020 **Lab ID:** 062020089-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.0	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0630 **Collected:** 10/24/2020 **Lab ID:** 062020089-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.9 J	3.0 µg/L	11/19/2020	DI	11/20/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description HERR-0631 **Collected:** 10/24/2020 **Lab ID:** 062020089-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	10	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0632 **Collected:** 10/24/2020 **Lab ID:** 062020089-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.7 J	3.0 µg/L	11/19/2020	DI	11/20/2020	AL
Lead MDL: 1.0µg/L							

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020089

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/27/2020 12:30 PM
 Collected: 10/24/2020

Project: **Herricks Union Free School District, Herricks High School, HHS, 100 Shelter Rock Road, New Hyde Park, NY 11040, #:19-43807**

Analytical Results

Client Sample Description HERR-0633 **Collected:** 10/24/2020 **Lab ID:** 062020089-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0636 **Collected:** 10/24/2020 **Lab ID:** 062020089-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.6 J	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description HERR-0637 **Collected:** 10/24/2020 **Lab ID:** 062020089-0010

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	15	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0638 **Collected:** 10/24/2020 **Lab ID:** 062020089-0011

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.1	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0639 **Collected:** 10/24/2020 **Lab ID:** 062020089-0012

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	12	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0640 **Collected:** 10/24/2020 **Lab ID:** 062020089-0013

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.3	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0644 **Collected:** 10/24/2020 **Lab ID:** 062020089-0014

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0685 **Collected:** 10/24/2020 **Lab ID:** 062020089-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020089

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/27/2020 12:30 PM
 Collected: 10/24/2020

Project: **Herricks Union Free School District, Herricks High School, HHS, 100 Shelter Rock Road, New Hyde Park, NY 11040, #:19-43807**

Analytical Results

Client Sample Description HERR-0685 **Collected:** 10/24/2020 **Lab ID:** 062020089-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.0	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0686 **Collected:** 10/24/2020 **Lab ID:** 062020089-0016

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.8	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0688 **Collected:** 10/24/2020 **Lab ID:** 062020089-0017

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.4	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0689 **Collected:** 10/24/2020 **Lab ID:** 062020089-0018

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	10	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0691 **Collected:** 10/24/2020 **Lab ID:** 062020089-0019

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0692 **Collected:** 10/24/2020 **Lab ID:** 062020089-0020

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	17	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0693 **Collected:** 10/24/2020 **Lab ID:** 062020089-0021

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.0	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0700 **Collected:** 10/24/2020 **Lab ID:** 062020089-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020089

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/27/2020 12:30 PM
 Collected: 10/24/2020

Project: **Herricks Union Free School District, Herricks High School, HHS, 100 Shelter Rock Road, New Hyde Park, NY 11040, #:19-43807**

Analytical Results

Client Sample Description HERR-0700 **Collected:** 10/24/2020 **Lab ID:** 062020089-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	11/19/2020	DI	11/20/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description HERR-0711 **Collected:** 10/24/2020 **Lab ID:** 062020089-0023

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0717 **Collected:** 10/24/2020 **Lab ID:** 062020089-0024

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	11/19/2020	DI	11/20/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description HERR-0722 **Collected:** 10/24/2020 **Lab ID:** 062020089-0025

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	13	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0723 **Collected:** 10/24/2020 **Lab ID:** 062020089-0026

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.0	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0724 **Collected:** 10/24/2020 **Lab ID:** 062020089-0027

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0725 **Collected:** 10/24/2020 **Lab ID:** 062020089-0028

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020089

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/27/2020 12:30 PM
 Collected: 10/24/2020

Project: **Herricks Union Free School District, Herricks High School, HHS, 100 Shelter Rock Road, New Hyde Park, NY 11040, #:19-43807**

Analytical Results

Client Sample Description HERR-0727 **Collected:** 10/24/2020 **Lab ID:** 062020089-0029

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.8 J	3.0 µg/L	11/19/2020	DI	11/20/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description HERR-0728 **Collected:** 10/24/2020 **Lab ID:** 062020089-0030

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0729 **Collected:** 10/24/2020 **Lab ID:** 062020089-0031

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	11/19/2020	DI	11/20/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description HERR-0732 **Collected:** 10/24/2020 **Lab ID:** 062020089-0032

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0736 **Collected:** 10/24/2020 **Lab ID:** 062020089-0033

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0738 **Collected:** 10/24/2020 **Lab ID:** 062020089-0034

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	11/19/2020	DI	11/20/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description HERR-0739 **Collected:** 10/24/2020 **Lab ID:** 062020089-0035

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020089

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/27/2020 12:30 PM
 Collected: 10/24/2020

Project: **Herricks Union Free School District, Herricks High School, HHS, 100 Shelter Rock Road, New Hyde Park, NY 11040, #:19-43807**

Analytical Results

Client Sample Description HERR-0740 **Collected:** 10/24/2020 **Lab ID:** 062020089-0036

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0 µg/L	11/19/2020	DI	11/20/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description HERR-0741 **Collected:** 10/24/2020 **Lab ID:** 062020089-0037

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0742 **Collected:** 10/24/2020 **Lab ID:** 062020089-0038

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0743 **Collected:** 10/24/2020 **Lab ID:** 062020089-0039

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0744 **Collected:** 10/24/2020 **Lab ID:** 062020089-0040

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0746 **Collected:** 10/24/2020 **Lab ID:** 062020089-0041

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0748 **Collected:** 10/24/2020 **Lab ID:** 062020089-0042

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0749 **Collected:** 10/24/2020 **Lab ID:** 062020089-0043

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020089

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/27/2020 12:30 PM
 Collected: 10/24/2020

Project: **Herricks Union Free School District, Herricks High School, HHS, 100 Shelter Rock Road, New Hyde Park, NY 11040, #:19-43807**

Analytical Results

Client Sample Description HERR-0749 **Collected:** 10/24/2020 **Lab ID:** 062020089-0043

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0750 **Collected:** 10/24/2020 **Lab ID:** 062020089-0044

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	46	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0751 **Collected:** 10/24/2020 **Lab ID:** 062020089-0045

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0752 **Collected:** 10/24/2020 **Lab ID:** 062020089-0046

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0753 **Collected:** 10/24/2020 **Lab ID:** 062020089-0047

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0754 **Collected:** 10/24/2020 **Lab ID:** 062020089-0048

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0755 **Collected:** 10/24/2020 **Lab ID:** 062020089-0049

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0757 **Collected:** 10/24/2020 **Lab ID:** 062020089-0050

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020089

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/27/2020 12:30 PM
 Collected: 10/24/2020

Project: **Herricks Union Free School District, Herricks High School, HHS, 100 Shelter Rock Road, New Hyde Park, NY 11040, #:19-43807**

Analytical Results

Client Sample Description HERR-0757 **Collected:** 10/24/2020 **Lab ID:** 062020089-0050

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.1	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0758 **Collected:** 10/24/2020 **Lab ID:** 062020089-0051

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	11/19/2020	DI	11/20/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description HERR-0761 **Collected:** 10/24/2020 **Lab ID:** 062020089-0052

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0 µg/L	11/19/2020	DI	11/20/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description HERR-0765 **Collected:** 10/24/2020 **Lab ID:** 062020089-0053

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0766 **Collected:** 10/24/2020 **Lab ID:** 062020089-0054

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0770 **Collected:** 10/24/2020 **Lab ID:** 062020089-0055

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	11/19/2020	DI	11/20/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description HERR-0772 **Collected:** 10/24/2020 **Lab ID:** 062020089-0056

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020089

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/27/2020 12:30 PM
 Collected: 10/24/2020

Project: **Herricks Union Free School District, Herricks High School, HHS, 100 Shelter Rock Road, New Hyde Park, NY 11040, #:19-43807**

Analytical Results

Client Sample Description HERR-0773 **Collected:** 10/24/2020 **Lab ID:** 062020089-0057

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.8	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0774 **Collected:** 10/24/2020 **Lab ID:** 062020089-0058

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0775 **Collected:** 10/24/2020 **Lab ID:** 062020089-0059

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0776 **Collected:** 10/24/2020 **Lab ID:** 062020089-0060

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0777 **Collected:** 10/24/2020 **Lab ID:** 062020089-0061

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.6 J	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description HERR-0778 **Collected:** 10/24/2020 **Lab ID:** 062020089-0062

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0779 **Collected:** 10/24/2020 **Lab ID:** 062020089-0063

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0780 **Collected:** 10/24/2020 **Lab ID:** 062020089-0064

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020089

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/27/2020 12:30 PM
 Collected: 10/24/2020

Project: **Herricks Union Free School District, Herricks High School, HHS, 100 Shelter Rock Road, New Hyde Park, NY 11040, #:19-43807**

Analytical Results

Client Sample Description HERR-0780 **Collected:** 10/24/2020 **Lab ID:** 062020089-0064

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0781 **Collected:** 10/24/2020 **Lab ID:** 062020089-0065

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description HERR-0783 **Collected:** 10/24/2020 **Lab ID:** 062020089-0066

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0790 **Collected:** 10/24/2020 **Lab ID:** 062020089-0067

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.4	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0791 **Collected:** 10/24/2020 **Lab ID:** 062020089-0068

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description HERR-0792 **Collected:** 10/24/2020 **Lab ID:** 062020089-0069

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.9 J	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description HERR-0793 **Collected:** 10/24/2020 **Lab ID:** 062020089-0070

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020089

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/27/2020 12:30 PM
 Collected: 10/24/2020

Project: **Herricks Union Free School District, Herricks High School, HHS, 100 Shelter Rock Road, New Hyde Park, NY 11040, #:19-43807**

Analytical Results

Client Sample Description		HERR-0799	Collected:	10/24/2020	Lab ID:	062020089-0071		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/19/2020	DI	11/20/2020	AL
Client Sample Description		HERR-0800	Collected:	10/24/2020	Lab ID:	062020089-0072		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/19/2020	DI	11/20/2020	AL
Client Sample Description		HERR-0801	Collected:	10/24/2020	Lab ID:	062020089-0073		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.9	3.0	µg/L	11/19/2020	DI	11/20/2020	AL
Client Sample Description		HERR-0802	Collected:	10/24/2020	Lab ID:	062020089-0074		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0	µg/L	11/19/2020	DI	11/20/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		HERR-0803	Collected:	10/24/2020	Lab ID:	062020089-0075		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/19/2020	DI	11/20/2020	AL
Client Sample Description		HERR-0804	Collected:	10/24/2020	Lab ID:	062020089-0076		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0	µg/L	11/19/2020	DI	11/20/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		HERR-0805	Collected:	10/24/2020	Lab ID:	062020089-0077		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	15	3.0	µg/L	11/19/2020	DI	11/20/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020089

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/27/2020 12:30 PM
 Collected: 10/24/2020

Project: **Herricks Union Free School District, Herricks High School, HHS, 100 Shelter Rock Road, New Hyde Park, NY 11040, #:19-43807**

Analytical Results

Client Sample Description HERR-0806 **Collected:** 10/24/2020 **Lab ID:** 062020089-0078

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.3	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0808 **Collected:** 10/24/2020 **Lab ID:** 062020089-0079

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	57	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0811 **Collected:** 10/24/2020 **Lab ID:** 062020089-0080

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.2	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0813 **Collected:** 10/24/2020 **Lab ID:** 062020089-0081

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	38	3.0 µg/L	11/20/2020	DT	11/23/2020	DI

Client Sample Description HERR-0820 **Collected:** 10/24/2020 **Lab ID:** 062020089-0082

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/20/2020	DT	11/23/2020	DI

Client Sample Description HERR-0824 **Collected:** 10/24/2020 **Lab ID:** 062020089-0083

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.0	3.0 µg/L	11/20/2020	DT	11/23/2020	DI

Client Sample Description HERR-0826 **Collected:** 10/24/2020 **Lab ID:** 062020089-0084

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/20/2020	DT	11/23/2020	DI

Client Sample Description HERR-0829 **Collected:** 10/24/2020 **Lab ID:** 062020089-0085

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020089

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/27/2020 12:30 PM
 Collected: 10/24/2020

Project: **Herricks Union Free School District, Herricks High School, HHS, 100 Shelter Rock Road, New Hyde Park, NY 11040, #:19-43807**

Analytical Results

Client Sample Description HERR-0829 **Collected:** 10/24/2020 **Lab ID:** 062020089-0085

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	18	3.0 µg/L	11/20/2020	DT	11/23/2020	DI

Client Sample Description HERR-0830 **Collected:** 10/24/2020 **Lab ID:** 062020089-0086

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/20/2020	DT	11/23/2020	DI

Client Sample Description HERR-0831 **Collected:** 10/24/2020 **Lab ID:** 062020089-0087

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.9	3.0 µg/L	11/20/2020	DT	11/23/2020	DI

Client Sample Description HERR-0832 **Collected:** 10/24/2020 **Lab ID:** 062020089-0088

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/20/2020	DT	11/23/2020	DI

Client Sample Description HERR-0833 **Collected:** 10/24/2020 **Lab ID:** 062020089-0089

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/20/2020	DT	11/23/2020	DI

Client Sample Description HERR-0834 **Collected:** 10/24/2020 **Lab ID:** 062020089-0090

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/20/2020	DT	11/23/2020	DI

Client Sample Description HERR-0836 **Collected:** 10/24/2020 **Lab ID:** 062020089-0091

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/20/2020	DT	11/23/2020	DI

Client Sample Description HERR-0849 **Collected:** 10/24/2020 **Lab ID:** 062020089-0092

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020089

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/27/2020 12:30 PM
 Collected: 10/24/2020

Project: **Herricks Union Free School District, Herricks High School, HHS, 100 Shelter Rock Road, New Hyde Park, NY 11040, #:19-43807**

Analytical Results

Client Sample Description		HERR-0849	Collected:	10/24/2020	Lab ID:	062020089-0092		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	9.0	3.0	µg/L	11/20/2020	DT	11/23/2020	DI
Client Sample Description		HERR-0850	Collected:	10/24/2020	Lab ID:	062020089-0093		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/20/2020	DT	11/23/2020	DI
Client Sample Description		HERR-0852	Collected:	10/24/2020	Lab ID:	062020089-0094		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/20/2020	DT	11/23/2020	DI
Client Sample Description		HERR-1036	Collected:	10/24/2020	Lab ID:	062020089-0095		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/20/2020	DT	11/23/2020	DI
Client Sample Description		HERR-1040	Collected:	10/24/2020	Lab ID:	062020089-0096		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/20/2020	DT	11/23/2020	DI
Client Sample Description		HERR-1041	Collected:	10/24/2020	Lab ID:	062020089-0097		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0	3.0	µg/L	11/20/2020	DT	11/23/2020	DI
Lead MDL: 1.0µg/L								
Client Sample Description		HERR-1042	Collected:	10/24/2020	Lab ID:	062020089-0098		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/20/2020	DT	11/23/2020	DI



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>

carleplacelab@emsl.com

EMSL Order:	062020089
CustomerID:	JCBR50
CustomerPO:	
ProjectID:	

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



062020871 Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-43807
Building: Herricks Middle School
HMS

Client: Herricks Union Free School District

Retest/New Install ☐ ☒
Turn Around: Normal 1 wk Rush _____

Page 1 of 4

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
HERR-0430	HA	2072	Corridor Boys Bathroom to Room 2	BW	10/28/2020	5:41:00 AM
HERR-0432	BR	2053	Classroom A T.A.C.K Room Bathroom	BF	10/28/2020	5:45:00 AM
HERR-0433	BR	2069	Main Office Bathroom	BF	10/28/2020	5:48:00 AM
HERR-0434	BR	2066	Assistant Principals Office Bathroom	BF	10/28/2020	5:51:00 AM
HERR-0435	NO	2128A	Health Office	NS	10/28/2020	5:48:00 AM
HERR-0436	BR	2130	Custodial Office Hall Bathroom	BF	10/28/2020	5:52:00 AM
HERR-0437	BR	2133T	Custodial Office Bathroom	BF	10/28/2020	5:52:00 AM
HERR-0439	KI	2124	Kitchen	KC	10/28/2020	5:35:00 AM
HERR-0440	KI	2124	Kitchen	KC	10/28/2020	5:35:00 AM
HERR-0441	KI	2124	Kitchen	KC	10/28/2020	5:35:00 AM
HERR-0442	KI	2124	Kitchen	KC	10/28/2020	5:36:00 AM
HERR-0443	KI	2124	Kitchen	KC	10/28/2020	5:36:00 AM
HERR-0444	KI	2124	Kitchen	KC	10/28/2020	5:36:00 AM
HERR-0445	KI	2124	Kitchen	KC	10/28/2020	5:36:00 AM
HERR-0446	BR	2135	Boys Bathroom	BF	10/28/2020	5:55:00 AM
HERR-0447	BR	2135	Boys Bathroom	BF	10/28/2020	5:55:00 AM
HERR-0450	BR	2137	Girls Bathroom	BF	10/28/2020	5:57:00 AM
HERR-0451	BR	2137	Girls Bathroom	BF	10/28/2020	5:57:00 AM

Building Address

7 Hilldale Road
Albertson, NY 11507

Pb200.5 -
A. Lunny 11/20/20

Analysis Type: ELAP 200.5 AD

Lab Received: Unique McKay

Signature: Um 11/16/20 @ 4:55 PM

Samplers Name: Daniel Smalls

Samplers Signature: [Signature]

JCB Project Manager: George Greul



062020871 Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-43807
Building: Herricks Middle School
HMS

Client: Herricks Union Free School District
Retest/New Install ☐
Turn Around: Normal 1 wk Rush _____

Page 2 of 4

OrderID: 062020871

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
HERR-0452	BR	2141	Women's Bathroom	BF	10/28/2020	5:59:00 AM
HERR-0453	BR	2141A	Men's Bathroom	BF	10/28/2020	6:00:00 AM
HERR-0494	HA	2088	Corridor Between Locker Rooms	BW	10/28/2020	6:14:00 AM
HERR-0499	BR	2094	Boys Coach Office Bathroom	BF	10/28/2020	6:17:00 AM
HERR-0500	BR	2111	Girls Coach Office Bathroom	BF	10/28/2020	6:20:00 AM
HERR-0504	ST	2107	Ice Room/Athletic Office	IM	10/28/2020	6:24:00 AM
HERR-0505	BR	2117	Women's Faculty Bathroom	BF	10/28/2020	6:24:00 AM
HERR-0506	BR	2117	Women's Faculty Bathroom	BF	10/28/2020	6:24:00 AM
HERR-0507	BR	2117A	Girls Bathroom	BF	11/6/2020	7:01:00 AM
HERR-0511	FL	2127	Faculty Dining	CF	10/28/2020	6:44:00 AM
HERR-0513	BR	4021	Faculty Women Bathroom Vestibule	BF	10/28/2020	7:24:00 AM
HERR-0514	BR	4020	Faculty Men Bathroom	BF	10/28/2020	6:49:00 AM
HERR-0516	BR	4012	Boys Bathroom	BF	10/28/2020	6:52:00 AM
HERR-0517	BR	4012	Boys Bathroom	BF	10/28/2020	6:52:00 AM
HERR-0518	BR	4012	Boys Bathroom	BF	10/28/2020	6:51:00 AM
HERR-0522	BR	4010	Girls Bathroom	BF	10/28/2020	6:56:00 AM
HERR-0523	BR	4010	Girls Bathroom	BF	10/28/2020	6:56:00 AM
HERR-0525	HE	4008	Room 110	CF	10/28/2020	6:59:00 AM

Building Address
7 Hilldale Road
Albertson, NY 11507

Pb200.5 -
A. L... 11/29/20

Analysis Type: ELAP 200.5 @
Lab Received: *Unique Mexico*
Signature: *Um 11/20/20 4:55 PM*

Samplers Name: *Daniel Smalls*
Samplers Signature: *[Signature]*
JCB Project Manager: *George Greene*



062020871 Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-43807
Building: Herricks Middle School
HMS

Client: Herricks Union Free School District
Retest/New Install []
Turn Around: Normal 1 wk Rush _____

Page 3 of 4

Order ID: 062020871

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
HERR-0526	HA	4022	Corridor Rooms 102-116	WF	10/28/2020	6:56:00 AM
HERR-0529	BR	6000	New Construction 1st Floor Boys Bathroom	BF	10/28/2020	6:59:00 AM
HERR-0533	BR	6002	New Construction 1st Floor Girls Bathroom	BF	10/28/2020	6:58:00 AM
HERR-0535	HE	6003	New Construction Room 124	EC	10/28/2020	7:03:00 AM
HERR-0536	HE	6003	New Construction Room 124	EC	10/28/2020	7:03:00 AM
HERR-0537	HE	6003	New Construction Room 124	EC	10/28/2020	7:04:00 AM
HERR-0538	HE	6003	New Construction Room 124	EC	10/28/2020	7:04:00 AM
HERR-0539	HE	6003	New Construction Room 124	EC	10/28/2020	7:04:00 AM
HERR-0540	HE	6003	New Construction Room 124	EC	10/28/2020	7:05:00 AM
HERR-0542	HE	6003	New Construction Room 124	WC	10/28/2020	7:06:00 AM
HERR-0545	BR	7000	New Construction 2nd Floor Mens Bathroom	BF	10/28/2020	7:12:00 AM
HERR-0549	BR	7002	New Construction 2nd Floor Womens Bathroom	BF	10/28/2020	7:12:00 AM
HERR-0552	BR	3194	Girls Bathroom	BF	10/28/2020	7:18:00 AM
HERR-0553	BR	3194	Girls Bathroom	BF	10/28/2020	7:18:00 AM
HERR-0555	BR	3194	Girls Bathroom	BF	10/28/2020	7:19:00 AM
HERR-0558	BR	3195	Boys Bathroom	BF	11/6/2020	7:25:00 AM
HERR-0559	BR	3195	Boys Bathroom	BF	11/6/2020	7:25:00 AM
HERR-0560	BR	3195	Boys Bathroom	BF	11/6/2020	7:25:00 AM

Building Address

7 Hilldale Road
Albertson, NY 11507

Pb 200.5 -
1. J. J. 11/20/20

Analysis Type: ELAP 200.5 @

Lab Received: Unique Mckay

Signature: um 11/6/2020 4:55 PM

Samplers Name: Daniel Smalls

Samplers Signature: [Signature]

JCB Project Manager: George Grube



062020871

Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-43807
Building: Herricks Middle School
HMS

Client: Herricks Union Free School District
Retest/New Install ☐
Turn Around: Normal 1 wk Rush _____

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
HERR-0563	BR	3202	Men's Bathroom	BF	10/28/2020	7:29:00 AM
HERR-1044	CA	2123	Cafeteria	WF	10/28/2020	6:32:00 AM
HERR-1045	CA	2123	Cafeteria	WF	10/28/2020	6:33:00 AM
HERR-1046	CA	2123	Cafeteria	CF	10/28/2020	6:34:00 AM
HERR-1047	CA	2123	Cafeteria	CF	10/28/2020	6:33:00 AM
HERR-1048	BR	2086	Men's Room	BF	10/28/2020	6:28:00 AM
HERR-1050	BR	2085	Boys Bathroom	BF	10/28/2020	6:27:00 AM

Samples Submitted 61

20 NOV - 6 PM 4:55
CARLE PLACE, NY
CARLE ANALYTICAL, INC.

Building Address

7 Hilldale Road
Albertson, NY 11507

Pb 200.5 -

H. Young 11/20/20

Analysis Type: ELAP 200.5 *AC*

Lab Received: *Unique McKay*

Signature: *LM 11/16/20 @ 4:55 pm*

Samplers Name: *Daniel Smalls*

Samplers Signature: *[Signature]*

JCB Project Manager: *George Greene*



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

**George Greve
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788**

11/24/2020

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 11/6/2020. The results are tabulated on the attached data pages for the following client designated project:

**Herricks Middle School, 7 Hilldale Road, Albertson, NY 11507,
Herricks Union Free School District, #19-43807**

The reference number for these samples is EMSL Order #062020871. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020871

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/6/2020 04:55 PM
 Collected: 10/28/2020

Project: **Herricks Middle School, 7 Hilldale Road, Albertson, NY 11507, Herricks Union Free School District, #19-43807**

Analytical Results

Client Sample Description HERR-0430 **Collected:** 10/28/2020 **Lab ID:** 062020871-0001
 Corridor Boys Bathroom to Room 2

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0432 **Collected:** 10/28/2020 **Lab ID:** 062020871-0002
 Classroom A T.A.C.K Room Bathroom

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.3 J	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description HERR-0433 **Collected:** 10/28/2020 **Lab ID:** 062020871-0003
 Main Office Bathroom

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description HERR-0434 **Collected:** 10/28/2020 **Lab ID:** 062020871-0004
 Assistant Principals Office Bathroom

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0435 **Collected:** 10/28/2020 **Lab ID:** 062020871-0005
 Health Office

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.6	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0436 **Collected:** 10/28/2020 **Lab ID:** 062020871-0006
 Custodial Office Hall Bathroom

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0437 **Collected:** 10/28/2020 **Lab ID:** 062020871-0007
 Custodial Office Bathroom

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020871

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/6/2020 04:55 PM
 Collected: 10/28/2020

Project: **Herricks Middle School, 7 Hilldale Road, Albertson, NY 11507, Herricks Union Free School District, #19-43807**

Analytical Results

Client Sample Description		HERR-0439 Kitchen	Collected:	10/28/2020	Lab ID:	062020871-0008		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.4	3.0	µg/L	11/19/2020	DI	11/20/2020	AL
Client Sample Description		HERR-0440 Kitchen	Collected:	10/28/2020	Lab ID:	062020871-0009		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/19/2020	DI	11/20/2020	AL
Client Sample Description		HERR-0441 Kitchen	Collected:	10/28/2020	Lab ID:	062020871-0010		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0	µg/L	11/19/2020	DI	11/20/2020	AL
		Lead MDL: 1.0µg/L						
Client Sample Description		HERR-0442 Kitchen	Collected:	10/28/2020	Lab ID:	062020871-0011		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0	µg/L	11/19/2020	DI	11/20/2020	AL
		Lead MDL: 1.0µg/L						
Client Sample Description		HERR-0443 Kitchen	Collected:	10/28/2020	Lab ID:	062020871-0012		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.2	3.0	µg/L	11/19/2020	DI	11/20/2020	AL
Client Sample Description		HERR-0444 Kitchen	Collected:	10/28/2020	Lab ID:	062020871-0013		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/19/2020	DI	11/20/2020	AL
Client Sample Description		HERR-0445 Kitchen	Collected:	10/28/2020	Lab ID:	062020871-0014		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.3	3.0	µg/L	11/19/2020	DI	11/20/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020871

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/6/2020 04:55 PM
 Collected: 10/28/2020

Project: **Herricks Middle School, 7 Hilldale Road, Albertson, NY 11507, Herricks Union Free School District, #19-43807**

Analytical Results

Client Sample Description HERR-0446
Boys Bathroom
Collected: 10/28/2020
Lab ID: 062020871-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0 µg/L	11/19/2020	DI	11/20/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description HERR-0447
Boys Bathroom
Collected: 10/28/2020
Lab ID: 062020871-0016

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	11/19/2020	DI	11/20/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description HERR-0450
Girls Bathroom
Collected: 10/28/2020
Lab ID: 062020871-0017

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0451
Girls Bathroom
Collected: 10/28/2020
Lab ID: 062020871-0018

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	11/19/2020	DI	11/20/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description HERR-0452
Women's Bathroom
Collected: 10/28/2020
Lab ID: 062020871-0019

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.5 J	3.0 µg/L	11/19/2020	DI	11/20/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description HERR-0453
Men's Bathroom
Collected: 10/28/2020
Lab ID: 062020871-0020

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0494
Corridor Between Locker Rooms
Collected: 10/28/2020
Lab ID: 062020871-0021

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020871

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/6/2020 04:55 PM
 Collected: 10/28/2020

Project: **Herricks Middle School, 7 Hilldale Road, Albertson, NY 11507, Herricks Union Free School District, #19-43807**

Analytical Results

Client Sample Description HERR-0499 **Collected:** 10/28/2020 **Lab ID:** 062020871-0022
 Boys Coach Office Bathroom

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.9	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0500 **Collected:** 10/28/2020 **Lab ID:** 062020871-0023
 Girls Coach Office Bathroom

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0504 **Collected:** 10/28/2020 **Lab ID:** 062020871-0024
 Ice Room/ Athletic Office

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0505 **Collected:** 10/28/2020 **Lab ID:** 062020871-0025
 Women's Faculty Bathroom

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0506 **Collected:** 10/28/2020 **Lab ID:** 062020871-0026
 Women's Faculty Bathroom

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description HERR-0507 **Collected:** 10/28/2020 **Lab ID:** 062020871-0027
 Girls Bathroom

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 J	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0511 **Collected:** 10/28/2020 **Lab ID:** 062020871-0028
 Faculty Dining

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0513 **Collected:** 10/28/2020 **Lab ID:** 062020871-0029
 Faculty Women Bathroom Vestibule

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020871

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/6/2020 04:55 PM
 Collected: 10/28/2020

Project: **Herricks Middle School, 7 Hilldale Road, Albertson, NY 11507, Herricks Union Free School District, #19-43807**

Analytical Results

Client Sample Description		HERR-0513 Faculty Women Bathroom Vestibule	Collected:	10/28/2020	Lab ID:	062020871-0029		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/19/2020	DI	11/20/2020	AL
Client Sample Description		HERR-0514 Faculty Men Bathroom	Collected:	10/28/2020	Lab ID:	062020871-0030		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.1	3.0	µg/L	11/19/2020	DI	11/20/2020	AL
Client Sample Description		HERR-0516 Boys Bathroom	Collected:	10/28/2020	Lab ID:	062020871-0031		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.8	3.0	µg/L	11/19/2020	DI	11/20/2020	AL
Client Sample Description		HERR-0517 Boys Bathroom	Collected:	10/28/2020	Lab ID:	062020871-0032		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.6 J	3.0	µg/L	11/19/2020	DI	11/20/2020	AL
		Lead MDL: 1.0µg/L						
Client Sample Description		HERR-0518 Boys Bathroom	Collected:	10/28/2020	Lab ID:	062020871-0033		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.0	3.0	µg/L	11/19/2020	DI	11/20/2020	AL
Client Sample Description		HERR-0522 Girls Bathroom	Collected:	10/28/2020	Lab ID:	062020871-0034		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0	µg/L	11/19/2020	DI	11/20/2020	AL
		Lead MDL: 1.0µg/L						
Client Sample Description		HERR-0523 Girls Bathroom	Collected:	10/28/2020	Lab ID:	062020871-0035		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	5.4	3.0	µg/L	11/19/2020	DI	11/20/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020871

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/6/2020 04:55 PM
 Collected: 10/28/2020

Project: **Herricks Middle School, 7 Hilldale Road, Albertson, NY 11507, Herricks Union Free School District, #19-43807**

Analytical Results

Client Sample Description		HERR-0525 Room 110	Collected:		10/28/2020	Lab ID:		062020871-0036
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/19/2020	DI	11/20/2020	AL
Client Sample Description		HERR-0526 Corridor Rooms 102-116	Collected:		10/28/2020	Lab ID:		062020871-0037
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/19/2020	DI	11/20/2020	AL
Client Sample Description		HERR-0529 New Construction 1st Floor Girls Bathroom	Collected:		10/28/2020	Lab ID:		062020871-0038
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/19/2020	DI	11/20/2020	AL
Client Sample Description		HERR-0533 New Construction 1st Floor Girls Bathroom	Collected:		10/28/2020	Lab ID:		062020871-0039
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/19/2020	DI	11/20/2020	AL
Client Sample Description		HERR-0535 New Construction Room 124	Collected:		10/28/2020	Lab ID:		062020871-0040
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.0	3.0	µg/L	11/19/2020	DI	11/20/2020	AL
Client Sample Description		HERR-0536 New Construction Room 124	Collected:		10/28/2020	Lab ID:		062020871-0041
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/19/2020	DI	11/20/2020	AL
Client Sample Description		HERR-0537 New Construction Room 124	Collected:		10/28/2020	Lab ID:		062020871-0042
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	10	3.0	µg/L	11/19/2020	DI	11/20/2020	AL
Client Sample Description		HERR-0538 New Construction Room 124	Collected:		10/28/2020	Lab ID:		062020871-0043
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020871

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/6/2020 04:55 PM
 Collected: 10/28/2020

Project: **Herricks Middle School, 7 Hilldale Road, Albertson, NY 11507, Herricks Union Free School District, #19-43807**

Analytical Results

Client Sample Description HERR-0538 **Collected:** 10/28/2020 **Lab ID:** 062020871-0043
 New Construction Room 124

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0539 **Collected:** 10/28/2020 **Lab ID:** 062020871-0044
 New Construction Room 124

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0540 **Collected:** 10/28/2020 **Lab ID:** 062020871-0045
 New Construction Room 124

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description HERR-0542 **Collected:** 10/28/2020 **Lab ID:** 062020871-0046
 New Construction Room 124

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0545 **Collected:** 10/28/2020 **Lab ID:** 062020871-0047
 New Construction 2nd Floor Women's Bathroom

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0549 **Collected:** 10/28/2020 **Lab ID:** 062020871-0048
 New Construction 2nd Floor Women's Bathroom

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-0552 **Collected:** 10/28/2020 **Lab ID:** 062020871-0049
 Girls Bathroom

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Lead MDL: 1.0µg/L

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020871

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/6/2020 04:55 PM
 Collected: 10/28/2020

Project: **Herricks Middle School, 7 Hildale Road, Albertson, NY 11507, Herricks Union Free School District, #19-43807**

Analytical Results

Client Sample Description		HERR-0553 Girls Bathroom	Collected:		10/28/2020	Lab ID:		062020871-0050
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.1 J	3.0	µg/L	11/19/2020	DI	11/20/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		HERR-0555 Girls Bathroom	Collected:		10/28/2020	Lab ID:		062020871-0051
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.0	3.0	µg/L	11/19/2020	DI	11/20/2020	AL
Client Sample Description		HERR-0558 Boys Bathroom	Collected:		10/28/2020	Lab ID:		062020871-0052
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.5 J	3.0	µg/L	11/19/2020	DI	11/20/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		HERR-0559 Boys Bathroom	Collected:		10/28/2020	Lab ID:		062020871-0053
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0	µg/L	11/19/2020	DI	11/20/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		HERR-0560 Boys Bathroom	Collected:		10/28/2020	Lab ID:		062020871-0054
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/19/2020	DI	11/20/2020	AL
Client Sample Description		HERR-0563	Collected:		10/28/2020	Lab ID:		062020871-0055
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/19/2020	DI	11/20/2020	AL
Client Sample Description		HERR-1044	Collected:		10/28/2020	Lab ID:		062020871-0056
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/19/2020	DI	11/20/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020871

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 11/6/2020 04:55 PM
 Collected: 10/28/2020

Project: **Herricks Middle School, 7 Hilldale Road, Albertson, NY 11507, Herricks Union Free School District, #19-43807**

Analytical Results

Client Sample Description HERR-1045 **Collected:** 10/28/2020 **Lab ID:** 062020871-0057

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-1046 **Collected:** 10/28/2020 **Lab ID:** 062020871-0058

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-1047 **Collected:** 10/28/2020 **Lab ID:** 062020871-0059

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Client Sample Description HERR-1048 **Collected:** 10/28/2020 **Lab ID:** 062020871-0060

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.1 J	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description HERR-1050 **Collected:** 10/28/2020 **Lab ID:** 062020871-0061

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.0 J	3.0 µg/L	11/19/2020	DI	11/20/2020	AL

Lead MDL: 1.0µg/L

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-43807
Building: Searingtown Elementary School
SEAR

Client: Herricks Union Free School District
Retest/New Install ☒
Turn Around: Normal 1 wk Rush

Page 1 of 6

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
HERR-0292	CR	NEW	Room 2A	CF	10/22/2020	5:52:00 AM
HERR-0293	CR	NEW	Room 2A	DW	10/22/2020	5:52:00 AM
HERR-0294	BR	NEW	Room 2A Bathroom	BF	10/22/2020	5:53:00 AM
HERR-0295	CR	NEW	Room 2B	CF	10/22/2020	5:55:00 AM
HERR-0296	CR	NEW	Room 2B	DW	10/22/2020	5:55:00 AM
HERR-0297	BR	NEW	Room 2B Bathroom	BF	10/22/2020	5:55:00 AM
HERR-0298	HA	NEW	Corridor	BW	10/22/2020	5:56:00 AM
HERR-0301	CR	2010	Kindergarten Room 1	DW	10/22/2020	5:58:00 AM
HERR-0302	CR	2010	Kindergarten Room 1	CF	10/22/2020	5:58:00 AM
HERR-0303	CR	2014	Kindergarten Room 2	CF	10/22/2020	6:00:00 AM
HERR-0304	CR	2014	Kindergarten Room 2	DW	10/22/2020	6:00:00 AM
HERR-0306	CR	2016	Room 4	CF	10/22/2020	6:02:00 AM
HERR-0307	CR	2016	Room 4	DW	10/22/2020	6:02:00 AM
HERR-0308	CR	2017	Room 3	CF	10/22/2020	6:06:00 AM
HERR-0310	CR	2018	Room 5	CF	10/22/2020	6:08:00 AM
HERR-0311	CR	2018	Room 5	DW	10/22/2020	6:08:00 AM
HERR-0312	CR	2022	Kindergarten Room 6	CF	10/22/2020	6:10:00 AM
HERR-0313	CR	2022	Kindergarten Room 6	DW	10/22/2020	6:10:00 AM

Building Address
106 Beverly Drive
Albertson, NY 11507

Pb - *A. Long* 11/11/20

Analysis Type: ELAP 200.5

Lab Received: *Unique McKay*

Signature: *Um 10/22/20 @ 12:11 pm.*

Samplers Name: *Daniel Smalls, Savannah Crouse*

Samplers Signature: *[Signature]*

JCB Project Manager: *George Greel*



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-43807

Building: Searingtown Elementary School

SEAR

Client:

Herricks Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Page 2 of 6

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
HERR-0314	CR	2024	Room 8	CF	10/22/2020	6:13:00 AM
HERR-0316	CR	2026	Room 7	DW	10/22/2020	6:15:00 AM
HERR-0317	CR	2026	Room 7	CF	10/22/2020	6:15:00 AM
HERR-0318	BR	2029	Faculty Bathroom	BF	10/22/2020	6:16:00 AM
HERR-0319	CR	2033	Room 10	DW	10/22/2020	6:20:00 AM
HERR-0320	CR	2033	Room 10	CF	10/22/2020	6:20:00 AM
HERR-0321	CR	2027	Room 9	CF	10/22/2020	6:22:00 AM
HERR-0322	CR	2027	Room 9	DW	10/22/2020	6:22:00 AM
HERR-0323	CR	2040	Room 12	CF	10/22/2020	6:24:00 AM
HERR-0324	CR	2040	Room 12	DW	10/22/2020	6:24:00 AM
HERR-0325	CR	2037	Room 11	CF	10/22/2020	6:25:00 AM
HERR-0326	CR	2037	Room 11	DW	10/22/2020	6:25:00 AM
HERR-0327	CR	2042	Room 14	CF	10/22/2020	6:28:00 AM
HERR-0328	CR	2042	Room 14	DW	10/22/2020	6:28:00 AM
HERR-0329	CR	2046	Room 13	CF	10/22/2020	6:32:00 AM
HERR-0330	CR	2046	Room 13	DW	10/22/2020	6:32:00 AM
HERR-0331	NO	2050	Health Office Entrance	NS	10/22/2020	6:33:00 AM
HERR-0332	ST	2053	File/Copy Room	CF	10/22/2020	6:33:00 AM

Building Address

106 Beverly Drive

Albertson, NY 11507

Pb - *A. Lundy* 11/11/20

Analysis Type: ELAP 200.5 AL

Lab Received: Unique McKay

Signature: UM 10/22/20 @ 12:11pm

Samplers Name: Daniel Smalls, Savannah Crowe

Samplers Signature: *[Signature]* Savannah Crowe

JCB Project Manager: George Grewe

062019829

OrderID: 062019829



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-43807
Building: Searingtown Elementary School
SEAR

Client: Herricks Union Free School District
Retest/New Install: ☐
Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
HERR-0333	CR	2056A	Room 15	CF	10/22/2020	6:28:00 AM
HERR-0335	CR	2057	Office 15A	CF	10/22/2020	6:28:00 AM
HERR-0337	BR	2062	Women's Bathroom	BF	10/22/2020	6:35:00 AM
HERR-0338	BR	2062	Women's Bathroom	BF	10/22/2020	6:35:00 AM
HERR-0346	HA	2075	Corridor Room 17 to Faculty	BW	10/22/2020	6:37:00 AM
HERR-0349	CR	2073	Room 20	CF	10/22/2020	6:46:00 AM
HERR-0351	CR	2074	Room 18	CF	10/22/2020	6:44:00 AM
HERR-0352	CR	2076	Room 17	DW	10/22/2020	6:42:00 AM
HERR-0353	CR	2076	Room 17	CF	10/22/2020	6:42:00 AM
HERR-0354	CR	2077	Room 19	CF	10/22/2020	6:49:00 AM
HERR-0355	CR	2077	Room 19	DW	10/22/2020	6:49:00 AM
HERR-0356	CR	2078	Room 21	DW	10/22/2020	6:48:00 AM
HERR-0357	CR	2078	Room 21	CF	10/22/2020	6:48:00 AM
HERR-0358	FL	2079	Room 22B Faculty Lounge	CF	10/22/2020	6:50:00 AM
HERR-0360	CR	2081	Room 23	CF	10/22/2020	6:52:00 AM
HERR-0362	CR	2082	Art Room 24	CF	10/22/2020	6:55:00 AM
HERR-0363	CR	2082	Art Room 24	CF	10/22/2020	6:57:00 AM
HERR-0364	CA	2087	Cafeteria	BW	10/22/2020	6:56:00 AM

Building Address
106 Beverly Drive
Albertson, NY 11507

Ed - A. Long 11/1/20

Analysis Type: ELAP 200.5 *AL*

Lab Received: *Unique McCoy*

Signature: *Um 10/22/20 @ 12:11 pm*

Samplers Name: *Daniel Smalls, Savannah Crowe*

Samplers Signature: *[Signature]* *Savannah*

JCB Project Manager: *George Grew*

062019829



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.
1775 Expressway North Hauppauge, NY 11788
TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-43807
Building: Searingtown Elementary School

SEAR

Client: Herricks Union Free School District

Retest/New Install ☐
Turn Around: Normal 1 wk Rush

Page 4 of 6

OrderID: 062019829

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
HERR-0366	BR	2088	Receiving Bathroom	BF	10/22/2020	6:59:00 AM
HERR-0368	KI	2090	Cafeteria Kitchen	KC	10/22/2020	6:58:00 AM
HERR-0369	KI	2090	Cafeteria Kitchen	KC	10/22/2020	6:58:00 AM
HERR-0371	GY	2122	Gym	DW	10/22/2020	7:02:00 AM
HERR-0372	BR	2095	Girls Bathroom	BF	10/22/2020	7:04:00 AM
HERR-0373	BR	2095	Girls Bathroom	BF	10/22/2020	7:04:00 AM
HERR-0375	BR	2096	Boys Bathroom	BF	10/22/2020	7:05:00 AM
HERR-0376	BR	2096	Boys Bathroom	BF	10/22/2020	7:05:00 AM
HERR-0377	CR	2116	Room 28	CF	10/22/2020	7:14:00 AM
HERR-0378	CR	2116	Room 28	DW	10/22/2020	7:14:00 AM
HERR-0379	CR	2098	Room 25	DW	10/22/2020	7:07:00 AM
HERR-0380	CR	2098	Room 25	CF	10/22/2020	7:07:00 AM
HERR-0381	CR	2103	Room 27	CF	10/22/2020	7:12:00 AM
HERR-0382	CR	2103	Room 27	DW	10/22/2020	7:12:00 AM
HERR-0383	CR	2104	Room 29	DW	10/22/2020	7:16:00 AM
HERR-0384	CR	2104	Room 29	CF	10/22/2020	7:16:00 AM
HERR-0385	CR	2114	Room 30	CF	10/22/2020	7:18:00 AM
HERR-0386	CR	2114	Room 30	DW	10/22/2020	7:18:00 AM

Building Address
106 Beverly Drive
Albertson, NY 11507

Pb - A. Perry 11/11/20

Analysis Type: ELAP 200.5 (A)

Lab Received: Unique McKay

Signature: Um 10/22/20 @ 12:11 PM

Samplers Name: Dannel Smalls, Savannah Crowe

Samplers Signature: [Signature] Savannah Crowe

JCB Project Manager: George Greene

062019829



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-43807

Building: Searingtown Elementary School

SEAR

Client:

Herricks Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Page 5 of 6

OrderID: 062019829

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
HERR-0387	CR	2112	Room 32	DW	10/22/2020	7:18:00 AM
HERR-0388	CR	2112	Room 32	CF	10/22/2020	7:18:00 AM
HERR-0389	CR	2109	Room 31	CF	10/22/2020	7:20:00 AM
HERR-0390	CR	2109	Room 31	DW	10/22/2020	7:20:00 AM
HERR-0391	BR	NEW	Boy's Bathroom	BF	10/22/2020	7:24:00 AM
HERR-0394	HA	NEW	Corridor	BW	10/22/2020	7:23:00 AM
HERR-0396	BR	NEW	Teachers Bathroom	BF	10/22/2020	7:25:00 AM
HERR-0398	BR	NEW	Girls Bathroom	BF	10/22/2020	7:25:00 AM
HERR-0399	CR	NEW	Room 40	CF	10/22/2020	7:28:00 AM
HERR-0400	CR	NEW	Room 40	DW	10/22/2020	7:28:00 AM
HERR-0401	CR	NEW	Room 33	CF	10/22/2020	7:31:00 AM
HERR-0402	CR	NEW	Room 33	DW	10/22/2020	7:31:00 AM
HERR-0403	CR	NEW	Room 42	CF	10/22/2020	7:32:00 AM
HERR-0404	CR	NEW	Room 42	DW	10/22/2020	7:32:00 AM
HERR-0405	CR	NEW	Room 35	CF	10/22/2020	7:34:00 AM
HERR-0406	CR	NEW	Room 35	DW	10/22/2020	7:34:00 AM
HERR-0407	CR	NEW	Room 37	CF	10/22/2020	7:33:00 AM
HERR-0408	CR	NEW	Room 37	DW	10/22/2020	7:33:00 AM

Building Address

106 Beverly Drive

Albertson, NY 11507

Pb - A. Huang 10/22/20

Analysis Type: ELAP 200.5 *AL*

Lab Received: *Unique Mexico*

Signature: *um 10/22/20 @ 12:11 PM*

Samplers Name: *Daniel Smalls, Savannah Crowe*

Samplers Signature: *[Signature]*, *Savannah Crowe*

JCB Project Manager: *Gerrys Grewe*

062019829



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-43807

Building: Searingtown Elementary School

SEAR

Client:

Herricks Union Free School District

Retest/New Install ☐

Turn Around: Normal 1 wk Rush

Page 6 of 6

OrderID: 062019829

Sample ID	Functional Space Type	AMERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
HERR-1011	CR	2022	Kindergarten Room 6	WF	10/22/2020	6:09:00 AM
HERR-1012	CR	2024	Room 8	WF	10/22/2020	6:13:00 AM
HERR-1013	CR	2037	Room 11	WF	10/22/2020	6:25:00 AM
HERR-1014	CR	2042	Room 14	WF	10/22/2020	6:28:00 AM
HERR-1015	CR	2056A	Room 15	WF	10/22/2020	6:29:00 AM
HERR-1016	CR	2081	Room 23	WF	10/22/2020	6:52:00 AM
HERR-1017	CR	2098	Room 25	WF	10/22/2020	7:07:00 AM
HERR-1018	CR	2103	Room 27	WF	10/22/2020	7:12:00 AM
HERR-1019	CR	2104	Room 29	WF	10/22/2020	7:16:00 AM
HERR-1020	CR	2112	Room 32	WF	10/22/2020	7:18:00 AM

Samples Submitted 100

RECEIVED
ANALYTICAL
CARLE PLACE, NY
20 OCT 22 PM 12:11

Building Address

106 Beverly Drive

Albertson, NY 11507

By: A. Lunny 10/24/20

Analysis Type: ELAP 200.5 (40)

Lab Received: Unique McKay

Signature: Um 10/22/20 @ 12:11 PM

Samplers Name: Daniel Smalls, Savannah Crowe

Samplers Signature: [Signature] Savannah

JCB Project Manager: George Greife

062019829



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

**George Greve
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788**

11/23/2020

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 10/22/2020. The results are tabulated on the attached data pages for the following client designated project:

**Searingtown Elementary School, Herricks Union Free School
District, 106 Beverly Drive, Albertson, NY 11507, 19-43807**

The reference number for these samples is EMSL Order #062019829. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019829

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:11 PM
 Collected: 10/22/2020

Project: **Searingtown Elementary School, Herricks Union Free School District, 106 Beverly Drive, Albertson, NY 11507, 19-43807**

Analytical Results

Client Sample Description		HERR-0292 Room 2A	Collected:		10/22/2020	Lab ID:		062019829-0001
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0293 Room 2A	Collected:		10/22/2020	Lab ID:		062019829-0002
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0294 Room 2A Bathroom	Collected:		10/22/2020	Lab ID:		062019829-0003
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0295 Room 2B	Collected:		10/22/2020	Lab ID:		062019829-0004
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0296 Room 2B	Collected:		10/22/2020	Lab ID:		062019829-0005
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0297 Room 2B Bathroom	Collected:		10/22/2020	Lab ID:		062019829-0006
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0298 Corridor	Collected:		10/22/2020	Lab ID:		062019829-0007
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0301 Kindergarten Room 1	Collected:		10/22/2020	Lab ID:		062019829-0008
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019829

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:11 PM
 Collected: 10/22/2020

Project: **Searingtown Elementary School, Herricks Union Free School District, 106 Beverly Drive, Albertson, NY 11507, 19-43807**

Analytical Results

Client Sample Description		HERR-0301 Kindergarten Room 1	Collected:	10/22/2020	Lab ID:	062019829-0008		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0302 Kindergarten Room 1	Collected:	10/22/2020	Lab ID:	062019829-0009		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0303 Kindergarten Room 2	Collected:	10/22/2020	Lab ID:	062019829-0010		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0304 Kindergarten Room 2	Collected:	10/22/2020	Lab ID:	062019829-0011		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0306 Room 4	Collected:	10/22/2020	Lab ID:	062019829-0012		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0307 Room 4	Collected:	10/22/2020	Lab ID:	062019829-0013		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	7.1	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0308 Room 3	Collected:	10/22/2020	Lab ID:	062019829-0014		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0310 Room 5	Collected:	10/22/2020	Lab ID:	062019829-0015		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019829

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:11 PM
 Collected: 10/22/2020

Project: **Searingtown Elementary School, Herricks Union Free School District, 106 Beverly Drive, Albertson, NY 11507, 19-43807**

Analytical Results

Client Sample Description HERR-0310
Room 5
Collected: 10/22/2020
Lab ID: 062019829-0015

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0311
Room 5
Collected: 10/22/2020
Lab ID: 062019829-0016

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	8.0	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0312
Kindergarten Room 6
Collected: 10/22/2020
Lab ID: 062019829-0017

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0313
Kindergarten Room 6
Collected: 10/22/2020
Lab ID: 062019829-0018

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.3 J	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description HERR-0314
Room 8
Collected: 10/22/2020
Lab ID: 062019829-0019

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0316
Room 7
Collected: 10/22/2020
Lab ID: 062019829-0020

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0317
Room 7
Collected: 10/22/2020
Lab ID: 062019829-0021

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0318
Faculty Bathroom
Collected: 10/22/2020
Lab ID: 062019829-0022

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019829

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:11 PM
 Collected: 10/22/2020

Project: **Searingtown Elementary School, Herricks Union Free School District, 106 Beverly Drive, Albertson, NY 11507, 19-43807**

Analytical Results

Client Sample Description		HERR-0318 Faculty Bathroom	Collected:	10/22/2020	Lab ID:	062019829-0022		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0319 Room 10	Collected:	10/22/2020	Lab ID:	062019829-0023		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0320 Room 10	Collected:	10/22/2020	Lab ID:	062019829-0024		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0321 Room 9	Collected:	10/22/2020	Lab ID:	062019829-0025		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0322 Room 9	Collected:	10/22/2020	Lab ID:	062019829-0026		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0323 Room 12	Collected:	10/22/2020	Lab ID:	062019829-0027		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0324 Room 12	Collected:	10/22/2020	Lab ID:	062019829-0028		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
		Lead MDL: 1.0µg/L						
Client Sample Description		HERR-0325 Room 11	Collected:	10/22/2020	Lab ID:	062019829-0029		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019829

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:11 PM
 Collected: 10/22/2020

Project: **Searingtown Elementary School, Herricks Union Free School District, 106 Beverly Drive, Albertson, NY 11507, 19-43807**

Analytical Results

Client Sample Description		HERR-0325 Room 11	Collected:	10/22/2020	Lab ID:	062019829-0029		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0326 Room 11	Collected:	10/22/2020	Lab ID:	062019829-0030		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0327 Room 14	Collected:	10/22/2020	Lab ID:	062019829-0031		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0328 Room 14	Collected:	10/22/2020	Lab ID:	062019829-0032		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0329 Room 13	Collected:	10/22/2020	Lab ID:	062019829-0033		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		HERR-0330 Room 13	Collected:	10/22/2020	Lab ID:	062019829-0034		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0331 Health Office Entrance	Collected:	10/22/2020	Lab ID:	062019829-0035		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Lead MDL: 1.0µg/L								

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019829

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:11 PM
 Collected: 10/22/2020

Project: **Searingtown Elementary School, Herricks Union Free School District, 106 Beverly Drive, Albertson, NY 11507, 19-43807**

Analytical Results

Client Sample Description		HERR-0332 File/ Copy Room	Collected:	10/22/2020	Lab ID:	062019829-0036		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		HERR-0333 Room 15	Collected:	10/22/2020	Lab ID:	062019829-0037		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	16	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0335 Office 15A	Collected:	10/22/2020	Lab ID:	062019829-0038		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0337 Women's Bathroom	Collected:	10/22/2020	Lab ID:	062019829-0039		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0338 Women's Bathroom	Collected:	10/22/2020	Lab ID:	062019829-0040		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0346 Corridor Room 17 to Faculty	Collected:	10/22/2020	Lab ID:	062019829-0041		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0349 Room 20	Collected:	10/22/2020	Lab ID:	062019829-0042		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0351 Room 18	Collected:	10/22/2020	Lab ID:	062019829-0043		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019829

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:11 PM
 Collected: 10/22/2020

Project: **Searingtown Elementary School, Herricks Union Free School District, 106 Beverly Drive, Albertson, NY 11507, 19-43807**

Analytical Results

Client Sample Description		HERR-0351 Room 18	Collected:	10/22/2020	Lab ID:	062019829-0043		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0352 Room 17	Collected:	10/22/2020	Lab ID:	062019829-0044		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0353 Room 17	Collected:	10/22/2020	Lab ID:	062019829-0045		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
		Lead MDL: 1.0µg/L						
Client Sample Description		HERR-0354 Room 19	Collected:	10/22/2020	Lab ID:	062019829-0046		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0355 Room 19	Collected:	10/22/2020	Lab ID:	062019829-0047		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0356 Room 21	Collected:	10/22/2020	Lab ID:	062019829-0048		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.8 J	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
		Lead MDL: 1.0µg/L						
Client Sample Description		HERR-0357 Room 21	Collected:	10/22/2020	Lab ID:	062019829-0049		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019829

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:11 PM
 Collected: 10/22/2020

Project: **Searingtown Elementary School, Herricks Union Free School District, 106 Beverly Drive, Albertson, NY 11507, 19-43807**

Analytical Results

Client Sample Description HERR-0358 **Collected:** 10/22/2020 **Lab ID:** 062019829-0050
 Room 22B Faculty Lounge

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	11/10/2020	DI	11/11/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description HERR-0360 **Collected:** 10/22/2020 **Lab ID:** 062019829-0051
 Room 23

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0362 **Collected:** 10/22/2020 **Lab ID:** 062019829-0052
 Art Room 24

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0363 **Collected:** 10/22/2020 **Lab ID:** 062019829-0053
 Art Room 24

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0364 **Collected:** 10/22/2020 **Lab ID:** 062019829-0054
 Cafeteria

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0366 **Collected:** 10/22/2020 **Lab ID:** 062019829-0055
 Receiving Bathroom

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0368 **Collected:** 10/22/2020 **Lab ID:** 062019829-0056
 Cafeteria Kitchen

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0369 **Collected:** 10/22/2020 **Lab ID:** 062019829-0057
 Cafeteria Kitchen

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019829

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:11 PM
 Collected: 10/22/2020

Project: **Searingtown Elementary School, Herricks Union Free School District, 106 Beverly Drive, Albertson, NY 11507, 19-43807**

Analytical Results

Client Sample Description		HERR-0369 Cafeteria Kitchen	Collected:	10/22/2020	Lab ID:	062019829-0057		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		HERR-0371 Gym	Collected:	10/22/2020	Lab ID:	062019829-0058		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0372 Girls Bathroom	Collected:	10/22/2020	Lab ID:	062019829-0059		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.7 J	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		HERR-0373 Girls Bathroom	Collected:	10/22/2020	Lab ID:	062019829-0060		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0375 Boys Bathroom	Collected:	10/22/2020	Lab ID:	062019829-0061		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	2.0 J	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		HERR-0376 Boys Bathroom	Collected:	10/22/2020	Lab ID:	062019829-0062		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0377 Room 28	Collected:	10/22/2020	Lab ID:	062019829-0063		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.2 J	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Lead MDL: 1.0µg/L								

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019829

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:11 PM
 Collected: 10/22/2020

Project: **Searingtown Elementary School, Herricks Union Free School District, 106 Beverly Drive, Albertson, NY 11507, 19-43807**

Analytical Results

Client Sample Description		HERR-0378 Room 28	Collected:	10/22/2020	Lab ID:	062019829-0064	
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0379 Room 25	Collected:	10/22/2020	Lab ID:	062019829-0065	
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0380 Room 25	Collected:	10/22/2020	Lab ID:	062019829-0066	
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0381 Room 27	Collected:	10/22/2020	Lab ID:	062019829-0067	
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0382 Room 27	Collected:	10/22/2020	Lab ID:	062019829-0068	
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0383 Room 29	Collected:	10/22/2020	Lab ID:	062019829-0069	
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0384 Room 29	Collected:	10/22/2020	Lab ID:	062019829-0070	
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0 µg/L	11/10/2020	DI	11/11/2020	AL
Lead MDL: 1.0µg/L							
Client Sample Description		HERR-0385 Room 30	Collected:	10/22/2020	Lab ID:	062019829-0071	
Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019829

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:11 PM
 Collected: 10/22/2020

Project: **Searingtown Elementary School, Herricks Union Free School District, 106 Beverly Drive, Albertson, NY 11507, 19-43807**

Analytical Results

Client Sample Description		HERR-0385 Room 30	Collected:	10/22/2020	Lab ID:	062019829-0071		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		HERR-0386 Room 30	Collected:	10/22/2020	Lab ID:	062019829-0072		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0387 Room 32	Collected:	10/22/2020	Lab ID:	062019829-0073		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.3 J	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Lead MDL: 1.0µg/L								
Client Sample Description		HERR-0388 Room 32	Collected:	10/22/2020	Lab ID:	062019829-0074		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0389 Room 31	Collected:	10/22/2020	Lab ID:	062019829-0075		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0390 Room 31	Collected:	10/22/2020	Lab ID:	062019829-0076		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-0391 Boy's Bathroom	Collected:	10/22/2020	Lab ID:	062019829-0077		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019829

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:11 PM
 Collected: 10/22/2020

Project: **Searingtown Elementary School, Herricks Union Free School District, 106 Beverly Drive, Albertson, NY 11507, 19-43807**

Analytical Results

Client Sample Description HERR-0394
Corridor
Collected: 10/22/2020
Lab ID: 062019829-0078

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0396
Teachers Bathroom
Collected: 10/22/2020
Lab ID: 062019829-0079

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0398
Girls Bathroom
Collected: 10/22/2020
Lab ID: 062019829-0080

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.4 J	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Lead MDL: 1.0µg/L

Client Sample Description HERR-0399
Room 40
Collected: 10/22/2020
Lab ID: 062019829-0081

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0400
Room 40
Collected: 10/22/2020
Lab ID: 062019829-0082

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0401
Room 33
Collected: 10/22/2020
Lab ID: 062019829-0083

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0402
Room 33
Collected: 10/22/2020
Lab ID: 062019829-0084

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0403
Room 42
Collected: 10/22/2020
Lab ID: 062019829-0085

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019829

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:11 PM
 Collected: 10/22/2020

Project: **Searingtown Elementary School, Herricks Union Free School District, 106 Beverly Drive, Albertson, NY 11507, 19-43807**

Analytical Results

Client Sample Description HERR-0403
Room 42
Collected: 10/22/2020
Lab ID: 062019829-0085

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0404
Room 42
Collected: 10/22/2020
Lab ID: 062019829-0086

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0405
Room 35
Collected: 10/22/2020
Lab ID: 062019829-0087

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0406
Room 35
Collected: 10/22/2020
Lab ID: 062019829-0088

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0407
Room 37
Collected: 10/22/2020
Lab ID: 062019829-0089

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-0408
Room 37
Collected: 10/22/2020
Lab ID: 062019829-0090

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-1011
Kindergarten Room 6
Collected: 10/22/2020
Lab ID: 062019829-0091

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-1012
Room 8
Collected: 10/22/2020
Lab ID: 062019829-0092

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019829

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/22/2020 12:11 PM
 Collected: 10/22/2020

Project: **Searingtown Elementary School, Herricks Union Free School District, 106 Beverly Drive, Albertson, NY 11507, 19-43807**

Analytical Results

Client Sample Description		HERR-1012 Room 8	Collected:	10/22/2020	Lab ID:	062019829-0092		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-1013 Room 11	Collected:	10/22/2020	Lab ID:	062019829-0093		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-1014 Room 14	Collected:	10/22/2020	Lab ID:	062019829-0094		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-1015 Room 15	Collected:	10/22/2020	Lab ID:	062019829-0095		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-1016 Room 23	Collected:	10/22/2020	Lab ID:	062019829-0096		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-1017 Room 25	Collected:	10/22/2020	Lab ID:	062019829-0097		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-1018 Room 27	Collected:	10/22/2020	Lab ID:	062019829-0098		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL
Client Sample Description		HERR-1019 Room 29	Collected:	10/22/2020	Lab ID:	062019829-0099		
Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062019829

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
Fax:
Received: 10/22/2020 12:11 PM
Collected: 10/22/2020

Project: **Searingtown Elementary School, Herricks Union Free School District, 106 Beverly Drive, Albertson, NY 11507, 19-43807**

Analytical Results

Client Sample Description HERR-1019 **Collected:** 10/22/2020 **Lab ID:** 062019829-0099
Room 29

Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL

Client Sample Description HERR-1020 **Collected:** 10/22/2020 **Lab ID:** 062019829-0100
Room 32

Method	Parameter	Result	RL	Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0	µg/L	11/10/2020	DI	11/11/2020	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL.

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted



Lead in Water: Chain of Custody for

J. C. BRODERICK AND ASSOCIATES, INC.

1775 Expressway North Hauppauge, NY 11788

TEL: (631) 584-5492 FAX: (631) 584-3395

JCB #: 19-43807

Building: Shelter Rock Building

SRB

Client:

Herricks Union Free School District

Retest/New Install []

Turn Around: Normal 1 wk Rush

Sample ID	Functional Space Type	AHERA ID	Common Room Name	Outlet Type	Sample Date	Sample Time
HERR-0989	Hallway	1017B	Corridor Psychologist To Cafeteria	Bottle Fill Station	10/24/2020	7:40:00 AM
HERR-0990	Hallway	1017B	Corridor Psychologist To Cafeteria	Water Cooler	10/24/2020	7:40:00 AM
HERR-0991	Classroom	1013/1013A	Room 7	Classroom Faucet	10/24/2020	7:43:00 AM
HERR-0992	Classroom	1014	Room 8	Classroom Faucet	10/24/2020	7:44:00 AM
HERR-0993	Bathroom	1014A	Room 8 Closet/Storage Room	Bathroom Faucet	10/24/2020	7:45:00 AM
HERR-0994	Bathroom	1015A	Boys Bathroom	Bathroom Faucet	10/24/2020	7:47:00 AM
HERR-0995	Bathroom	1015B	Women's Bathroom	Bathroom Faucet	10/24/2020	7:47:00 AM
HERR-0996	Bathroom	2039	Nurses Office Bathroom	Bathroom Faucet	10/24/2020	7:50:00 AM
HERR-0997	Bathroom	2041	Faculty Bathroom Adjacent Nurse	Bathroom Faucet	10/24/2020	7:50:00 AM
HERR-0998	Bathroom	2033	Girls Bathroom	Bathroom Faucet	10/24/2020	7:51:00 AM
HERR-0999	Hallway	2023B	Corridor From Stairs To Boys Bathroom	Water Fountain -	10/24/2020	7:53:00 AM
HERR-1000	Bathroom	2032/2030	Boys Bathroom	Bathroom Faucet	10/24/2020	7:55:00 AM

Samples Submitted 12

20 OCT 27 PM 12:20

INST. ANALYTICAL, INC.
CARLE PLACE, NY

062020086

Pb 200.5 - A. Long 11/16/20

Building Address

99 Shelter Rock Road

New Hyde Park, NY 11040

Analysis Type: ELAP 200.5 (R) (A)

Lab Received: Michelle Devito

Signature: M Devito 10/27/20
1220 PM

Samplers Name: Daniel Smalls

Samplers Signature: [Signature]

JCB Project Manager: George Greve



EMSL Analytical, Inc.

528 Mineola Avenue, Carle Place, NY 11514

Phone: (516) 997-7251 Fax: (516) 997-7528 Email: carleplacelab@emsl.com

Attn:

**George Greve
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788**

11/23/2020

Phone: (631) 584-5492

Fax:

The following analytical report covers the analysis performed on samples submitted to EMSL Analytical, Inc. on 10/27/2020. The results are tabulated on the attached data pages for the following client designated project:

**Herricks Union Free School District, Shelter Rock Building, SRB,
99 Shelter Rock Road, New Hyde Park, NY 11040, #:19-43807**

The reference number for these samples is EMSL Order #062020086. Please use this reference when calling about these samples. If you have any questions, please do not hesitate to contact me at (516) 997-7251.

Approved By:

Alger Liang, Lead Laboratory Manager

NYS ELAP 11469

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020086

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/27/2020 12:20 PM
 Collected: 10/24/2020

Project: **Herricks Union Free School District, Shelter Rock Building, SRB, 99 Shelter Rock Road, New Hyde Park, NY 11040, #:19-43807**

Analytical Results

Client Sample Description HERR-0989 **Collected:** 10/24/2020 **Lab ID:** 062020086-0001

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/12/2020	DI	11/16/2020	AL

Client Sample Description HERR-0990 **Collected:** 10/24/2020 **Lab ID:** 062020086-0002

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.1 J	3.0 µg/L	11/12/2020	DI	11/16/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description HERR-0991 **Collected:** 10/24/2020 **Lab ID:** 062020086-0003

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	4.3	3.0 µg/L	11/12/2020	DI	11/16/2020	AL

Client Sample Description HERR-0992 **Collected:** 10/24/2020 **Lab ID:** 062020086-0004

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.0	3.0 µg/L	11/12/2020	DI	11/16/2020	AL

Client Sample Description HERR-0993 **Collected:** 10/24/2020 **Lab ID:** 062020086-0005

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/12/2020	DI	11/16/2020	AL

Client Sample Description HERR-0994 **Collected:** 10/24/2020 **Lab ID:** 062020086-0006

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	3.6	3.0 µg/L	11/12/2020	DI	11/16/2020	AL

Client Sample Description HERR-0995 **Collected:** 10/24/2020 **Lab ID:** 062020086-0007

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	6.8	3.0 µg/L	11/12/2020	DI	11/16/2020	AL

Client Sample Description HERR-0996 **Collected:** 10/24/2020 **Lab ID:** 062020086-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
--------	-----------	--------	----------	-----------	---------	---------------	---------

**EMSL Analytical, Inc.**

528 Mineola Avenue, Carle Place, NY 11514

Phone/Fax: (516) 997-7251 / (516) 997-7528

<http://www.EMSL.com>carleplacelab@emsl.com

EMSL Order: 062020086

CustomerID: JCBR50

CustomerPO:

ProjectID:

Attn: **George Greve**
J.C. Broderick & Associates
1775 Expressway Drive North, Suite 1
Hauppauge, NY 11788

Phone: (631) 584-5492
 Fax:
 Received: 10/27/2020 12:20 PM
 Collected: 10/24/2020

Project: **Herricks Union Free School District, Shelter Rock Building, SRB, 99 Shelter Rock Road, New Hyde Park, NY 11040, #:19-43807**

Analytical Results

Client Sample Description HERR-0996 **Collected:** 10/24/2020 **Lab ID:** 062020086-0008

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	1.6 J	3.0 µg/L	11/12/2020	DI	11/16/2020	AL
Lead MDL: 1.0µg/L							

Client Sample Description HERR-0997 **Collected:** 10/24/2020 **Lab ID:** 062020086-0009

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/12/2020	DI	11/16/2020	AL

Client Sample Description HERR-0998 **Collected:** 10/24/2020 **Lab ID:** 062020086-0010

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/12/2020	DI	11/16/2020	AL

Client Sample Description HERR-0999 **Collected:** 10/24/2020 **Lab ID:** 062020086-0011

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/12/2020	DI	11/16/2020	AL

Client Sample Description HERR-1000 **Collected:** 10/24/2020 **Lab ID:** 062020086-0012

Method	Parameter	Result	RL Units	Prep Date	Analyst	Analysis Date	Analyst
200.5	Lead	<3.0 ND	3.0 µg/L	11/12/2020	DI	11/16/2020	AL

Definitions:

MDL - method detection limit

J - Result was below the reporting limit, but at or above the MDL

ND - Result was below the MDL

RL = Reporting Limit (the value below which is not defensibly quantifiable)

D = Sample was diluted

Attachment 3:

Laboratory Certifications


J.C. Broderick & Associates, Inc.

Environmental Consulting & Testing

1775 Expressway Drive North

Hauppauge, New York 11788

631.584.5492 fax 631.584.3395

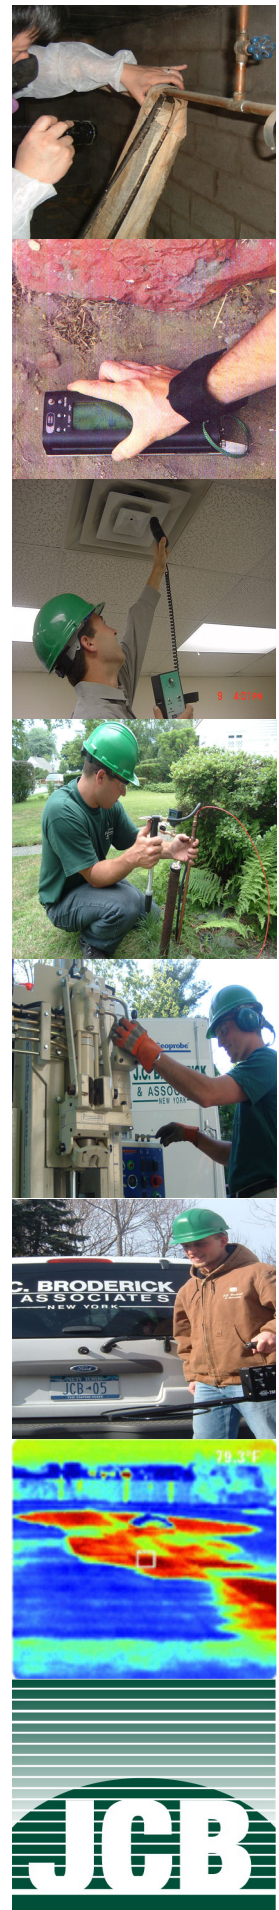

NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2020
Issued April 01, 2019
Revised October 18, 2019

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MR. DANIEL CLARKE
EMSL ANALYTICAL, INC.
528 MINEOLA AVE.
CARLE PLACE, NY 11514

NY Lab Id No: 11469

*is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2003) for the category
ENVIRONMENTAL ANALYSES POTABLE WATER
All approved analytes are listed below:*

Bacteriology

Coliform, Total / E. coli (Qualitative)	SM 21, 23 9222A,B,C SM 20, 21-23 9223B (-04) (Colilert)
E. coli (Enumeration)	SM 21, 23 9222A,B,C
Enterococci	SM 20, 23 9230C (Budnick 1996)
Heterotrophic Plate Count	SimPlate SM 20, 21-23 9215B (-04)

Metals I

Lead, Total	EPA 200.5
-------------	-----------

Miscellaneous

Asbestos	EPA 100.2
----------	-----------

Serial No.: 60618

Property of the New York State Department of Health. Certificates are valid only at the address shown, must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.



NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2021
Issued April 01, 2020

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MR. DANIEL CLARKE
EMSL ANALYTICAL, INC.
528 MINEOLA AVE.
CARLE PLACE, NY 11514

NY Lab Id No: 11469

*is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2003) for the category
ENVIRONMENTAL ANALYSES POTABLE WATER
All approved analytes are listed below:*

Bacteriology

Coliform, Total / E. coli (Qualitative)	SM 21, 23 9222A,B,C SM 20, 21-23 9223B (-04) (Colilert)
E. coli (Enumeration)	SM 21, 23 9222A,B,C
Enterococci	SM 20, 23 9230C (Budnick 1996)
Heterotrophic Plate Count	SimPlate SM 20, 21-23 9215B (-04)

Metals I

Lead, Total	EPA 200.5
-------------	-----------

Miscellaneous

Asbestos	EPA 100.2
----------	-----------

Serial No.: 61397

Property of the New York State Department of Health. Certificates are valid only at the address shown, must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.

