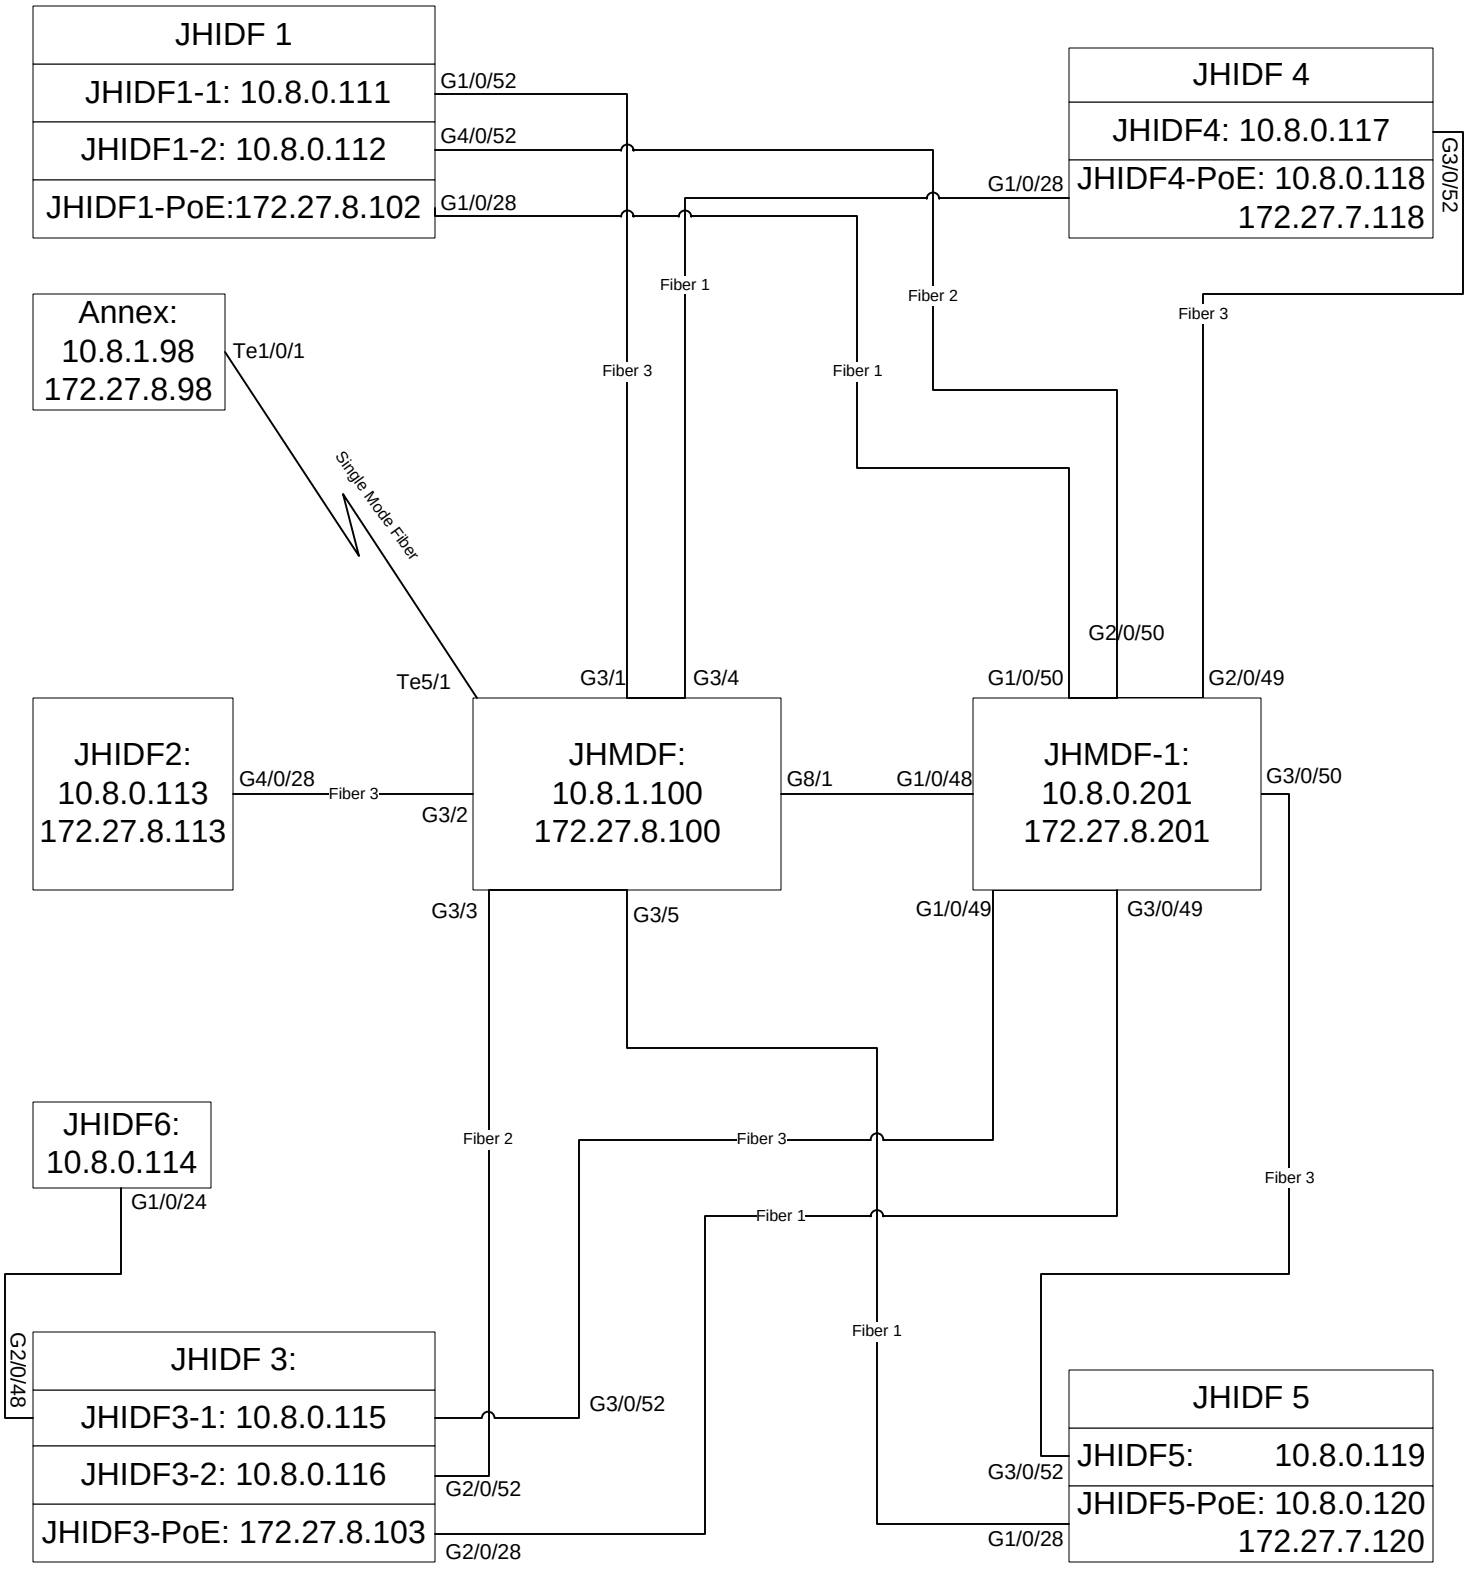
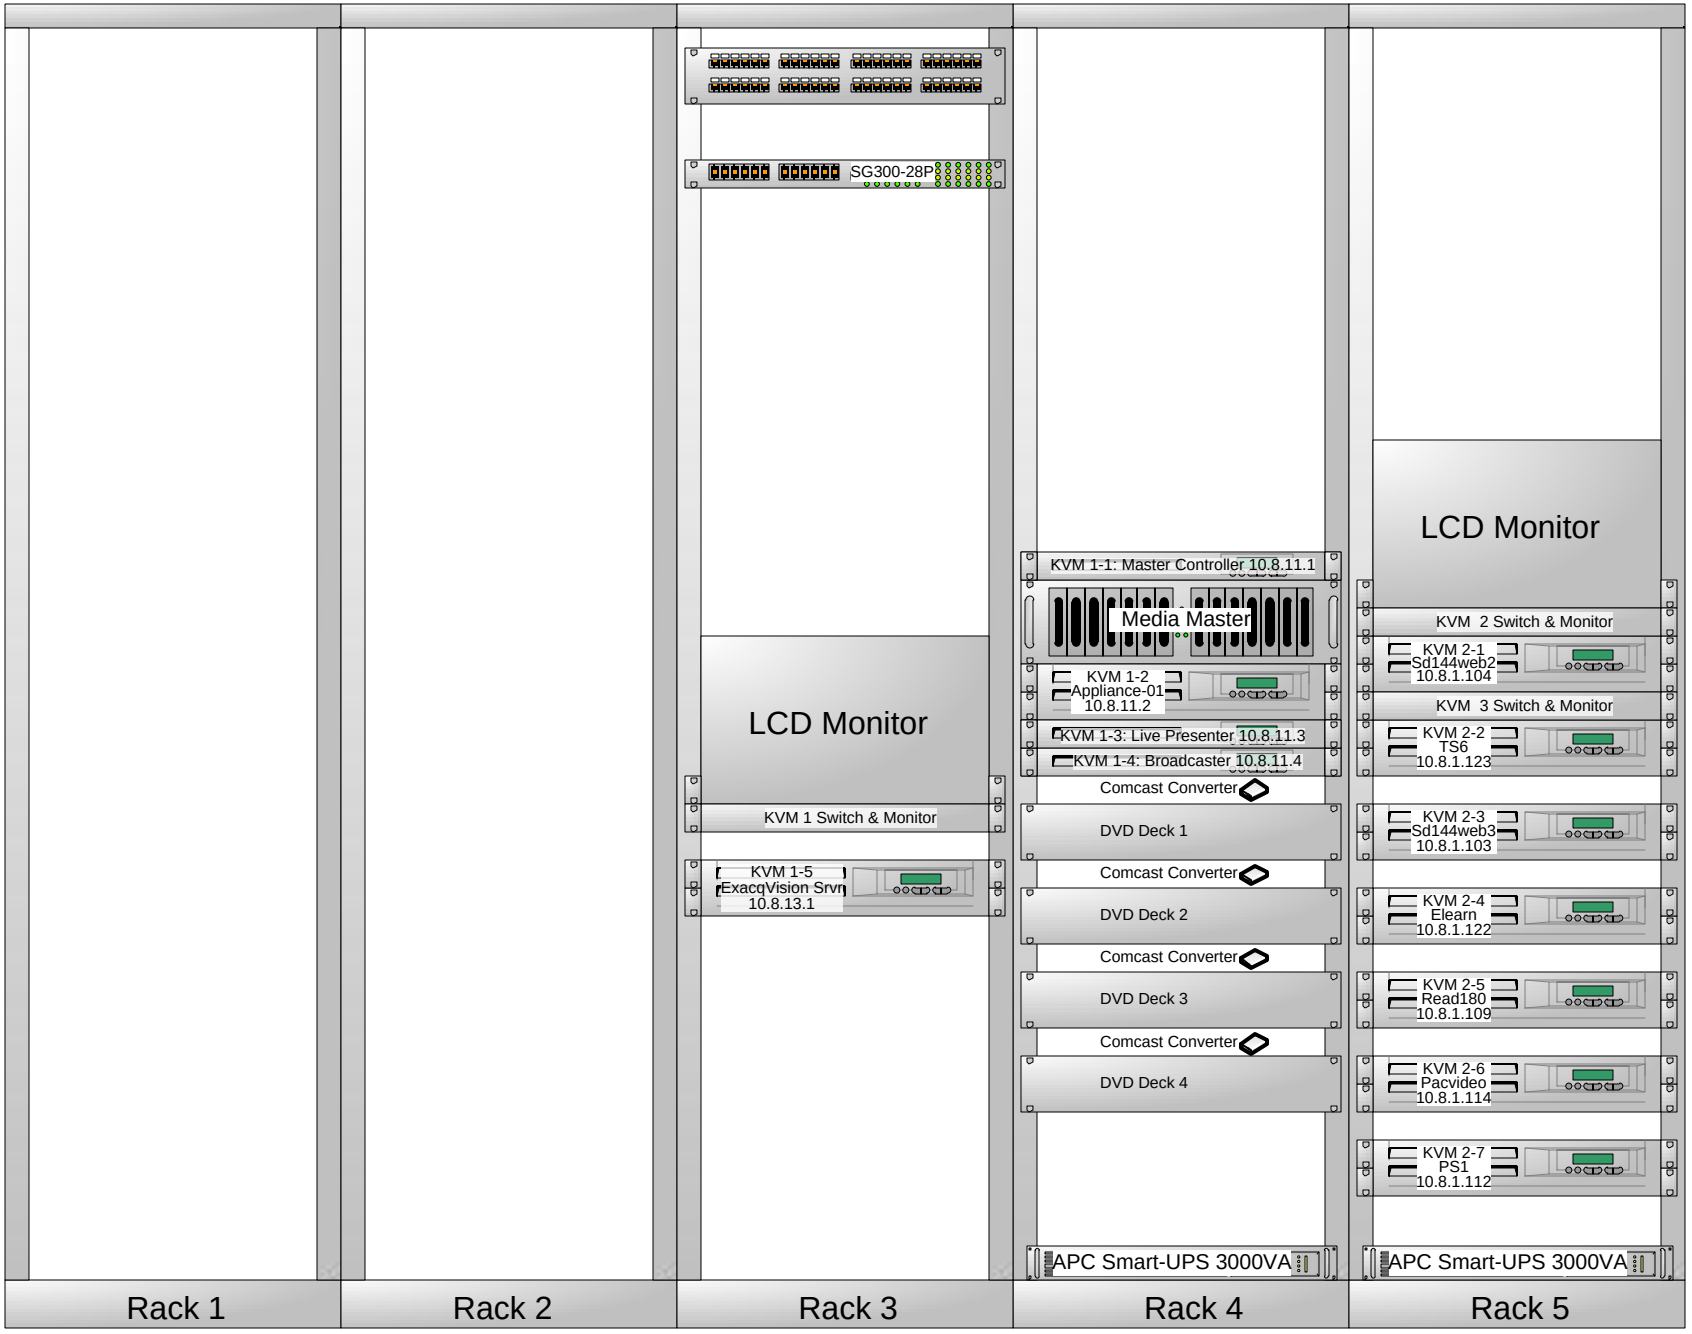
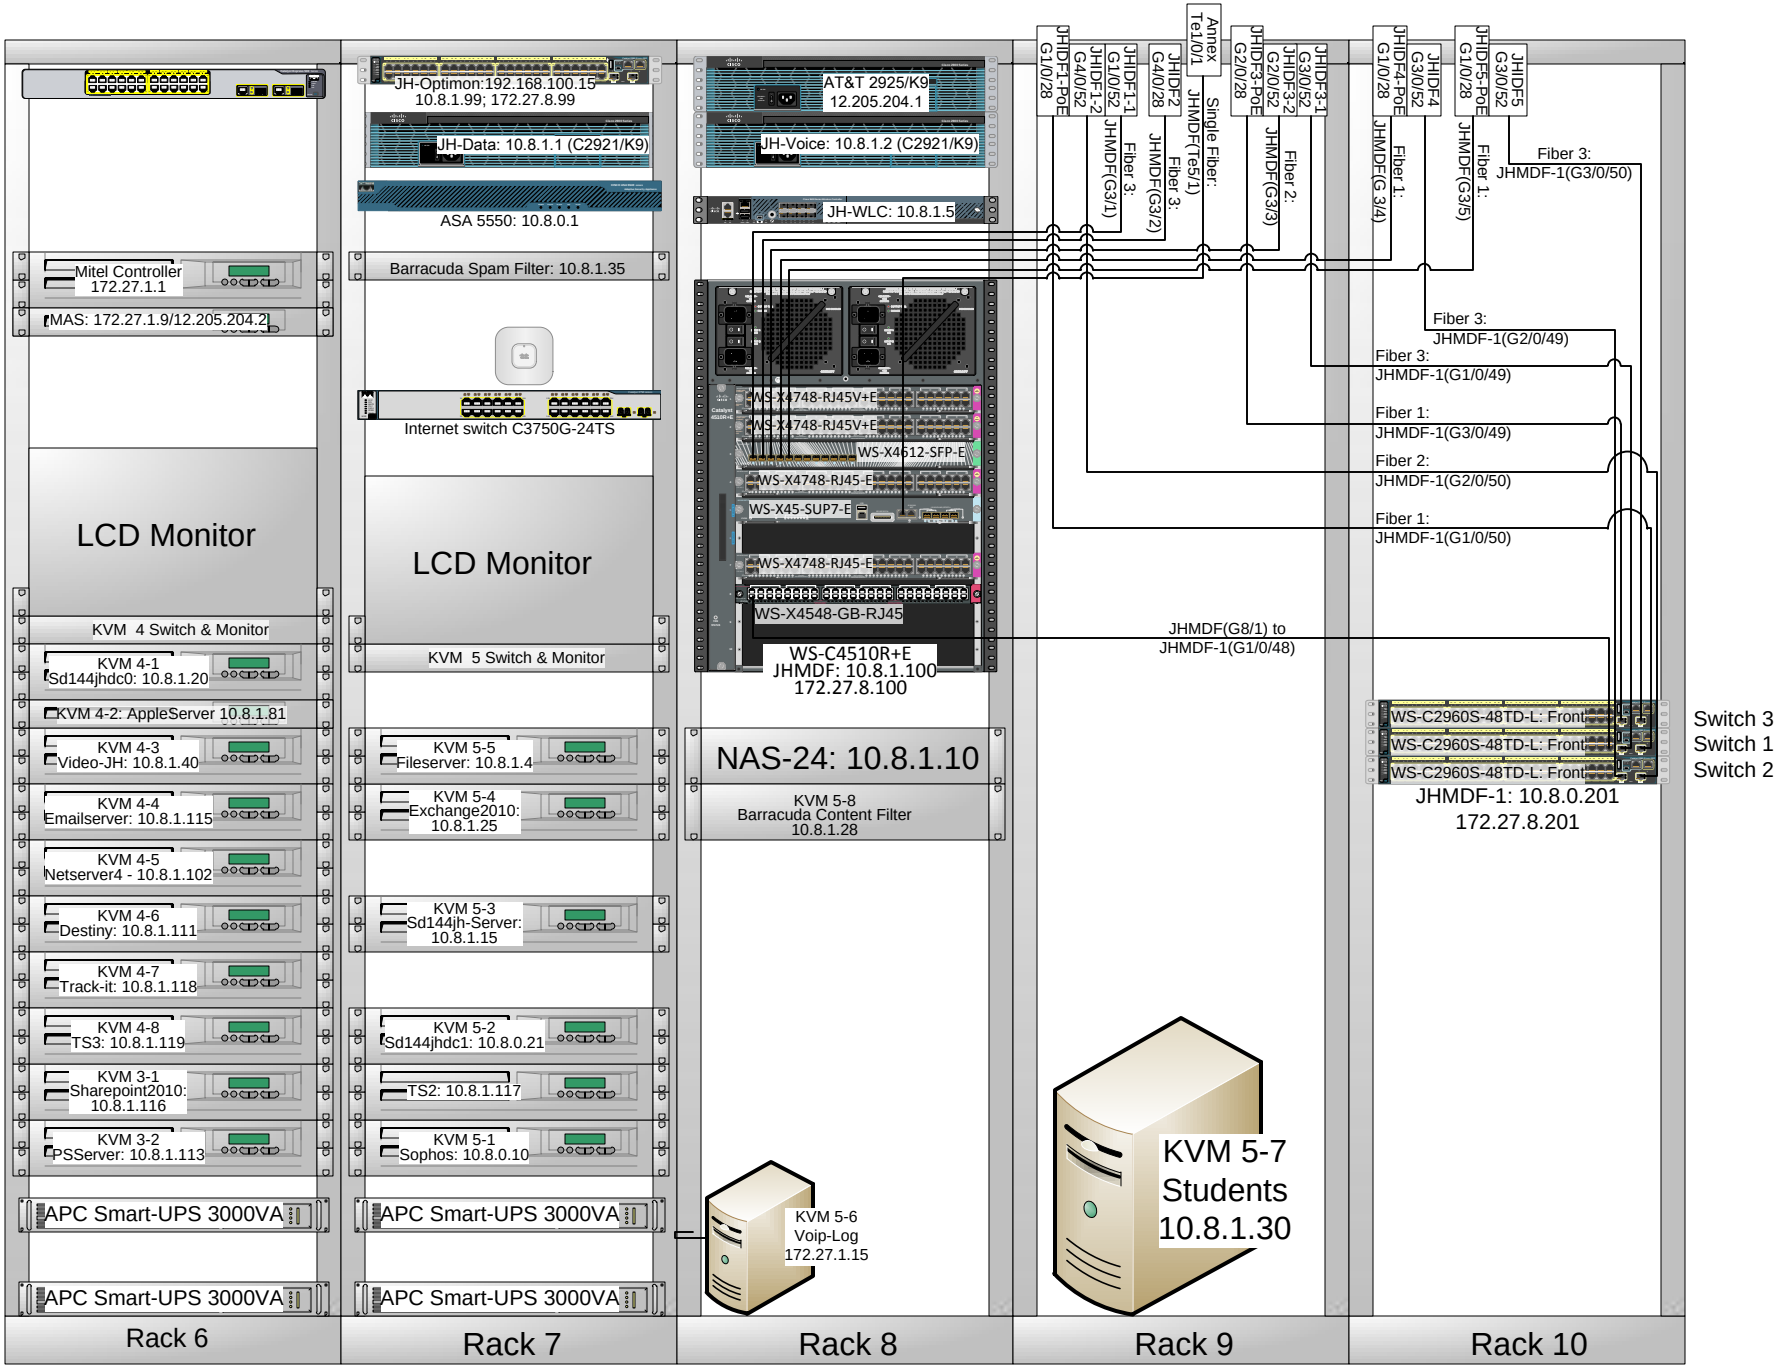

JHIDF 1
JHIDF1-1: 10.8.0.111
JHIDF1-2: 10.8.0.112
JHIDF1-PoE:172.27.8.102
G1/0/52
G4/0/52
G1/0/28
JHIDF 4
JHIDF4: 10.8.0.117
JHIDF4-PoE: 10.8.0.118
172.27.7.118
G1/0/28
G3/0/52
Fiber 1
Fiber 2
Fiber 3
Annex:
10.8.1.98
172.27.8.98
Te1/0/1
Single Mode Fiber
Fiber 3
Fiber 1
Fiber 3
G2/0/50
Te5/1
G3/1
G3/4
G1/0/50
G2/0/49
JHIDF2:
10.8.0.113
172.27.8.113
G4/0/28
Fiber 3
G3/2
JHMDF:
10.8.1.100
172.27.8.100
G8/1
G1/0/48
JHMDF-1:
10.8.0.201
172.27.8.201
G3/0/50
G3/3
G3/5
G1/0/49
G3/0/49
JHIDF6:
10.8.0.114
G1/0/24
Fiber 2
Fiber 3
Fiber 3
Fiber 1
Fiber 1
G2/0/48
JHIDF 3:
JHIDF3-1: 10.8.0.115
JHIDF3-2: 10.8.0.116
JHIDF3-PoE: 172.27.8.103
G3/0/52
G2/0/52
G2/0/28
JHIDF 5
JHIDF5: 10.8.0.119
JHIDF5-PoE: 10.8.0.120
172.27.7.120
G3/0/52
G1/0/28

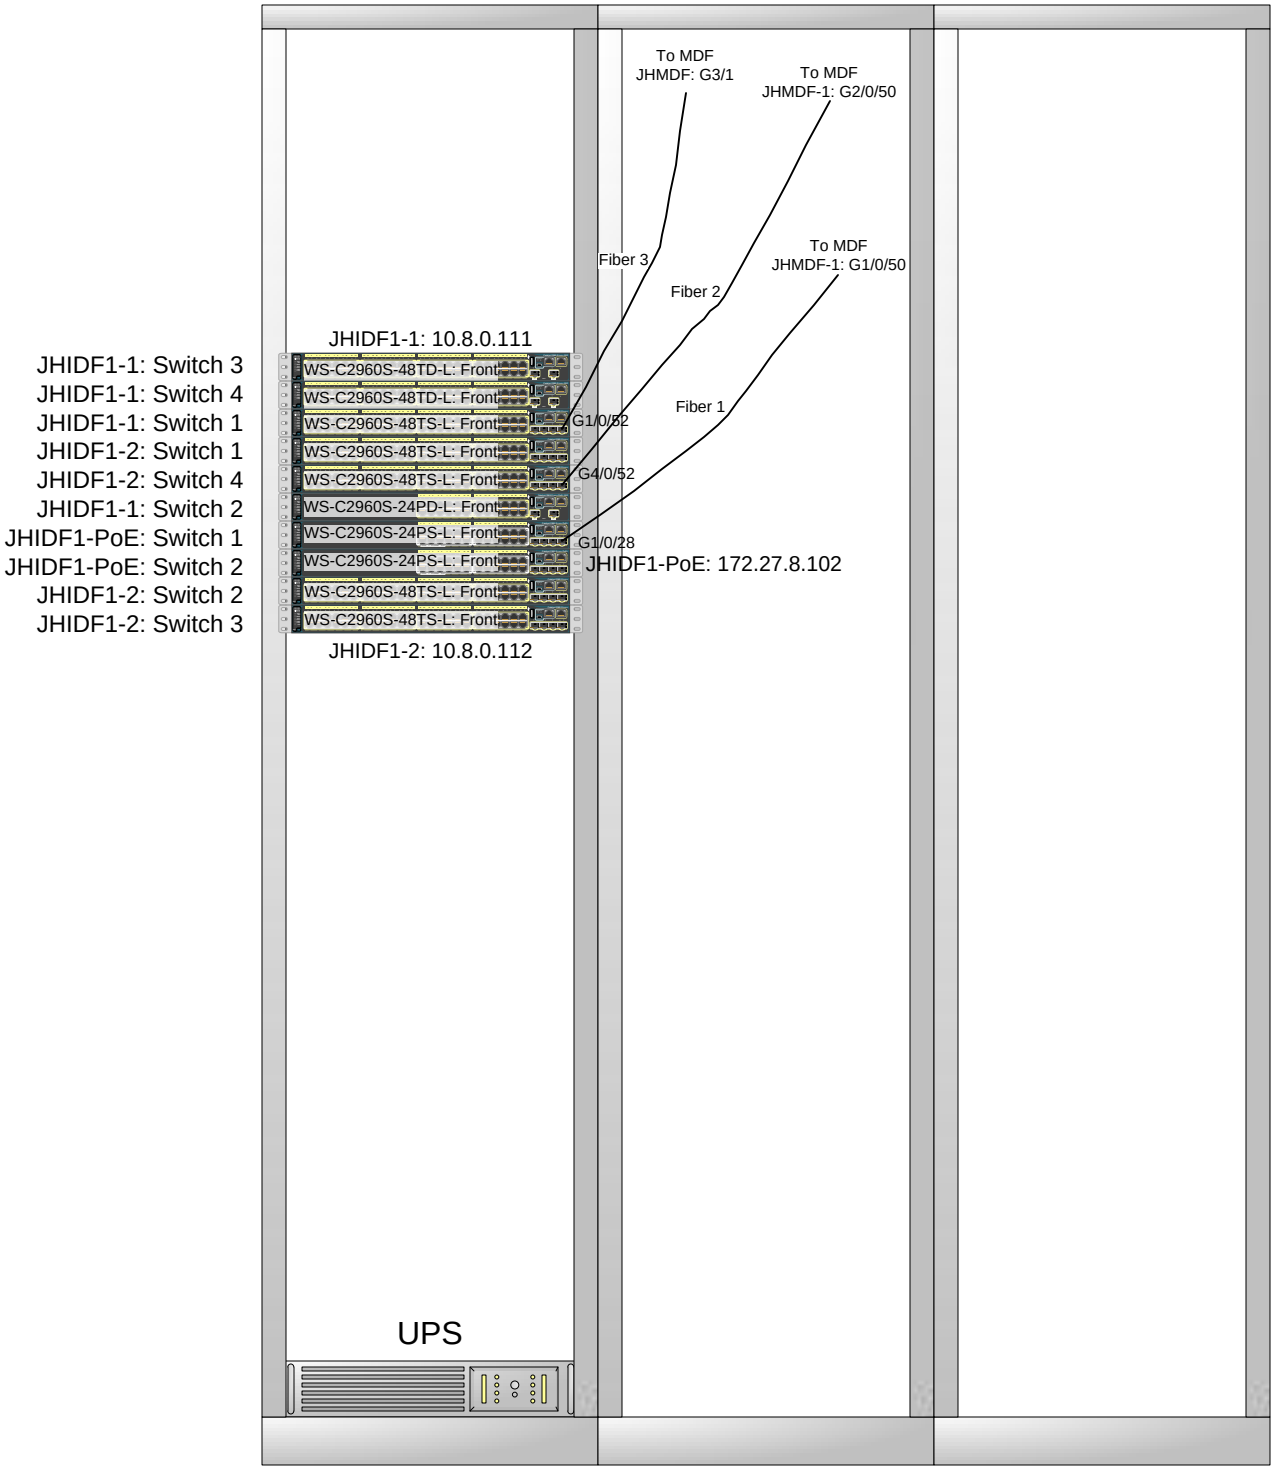
PHJH


SG300-28P
LCD Monitor
KVM 1 Switch & Monitor
KVM 1-5
ExacqVision Srvr
10.8.13.1
KVM 1-1: Master Controller 10.8.11.1
Media Master
KVM 1-2
Appliance-01
10.8.11.2
KVM 1-3: Live Presenter 10.8.11.3
KVM 1-4: Broadcaster 10.8.11.4
Comcast Converter
DVD Deck 1
Comcast Converter
DVD Deck 2
Comcast Converter
DVD Deck 3
Comcast Converter
DVD Deck 4
APC Smart-UPS 3000VA
LCD Monitor
KVM 2 Switch & Monitor
KVM 2-1
Sd144web2
10.8.1.104
KVM 3 Switch & Monitor
KVM 2-2
TS6
10.8.1.123
KVM 2-3
Sd144web3
10.8.1.103
KVM 2-4
Elearn
10.8.1.122
KVM 2-5
Read180
10.8.1.109
KVM 2-6
Pacvideo
10.8.1.114
KVM 2-7
PS1
10.8.1.112
APC Smart-UPS 3000VA
Rack 1
Rack 2
Rack 3
Rack 4
Rack 5

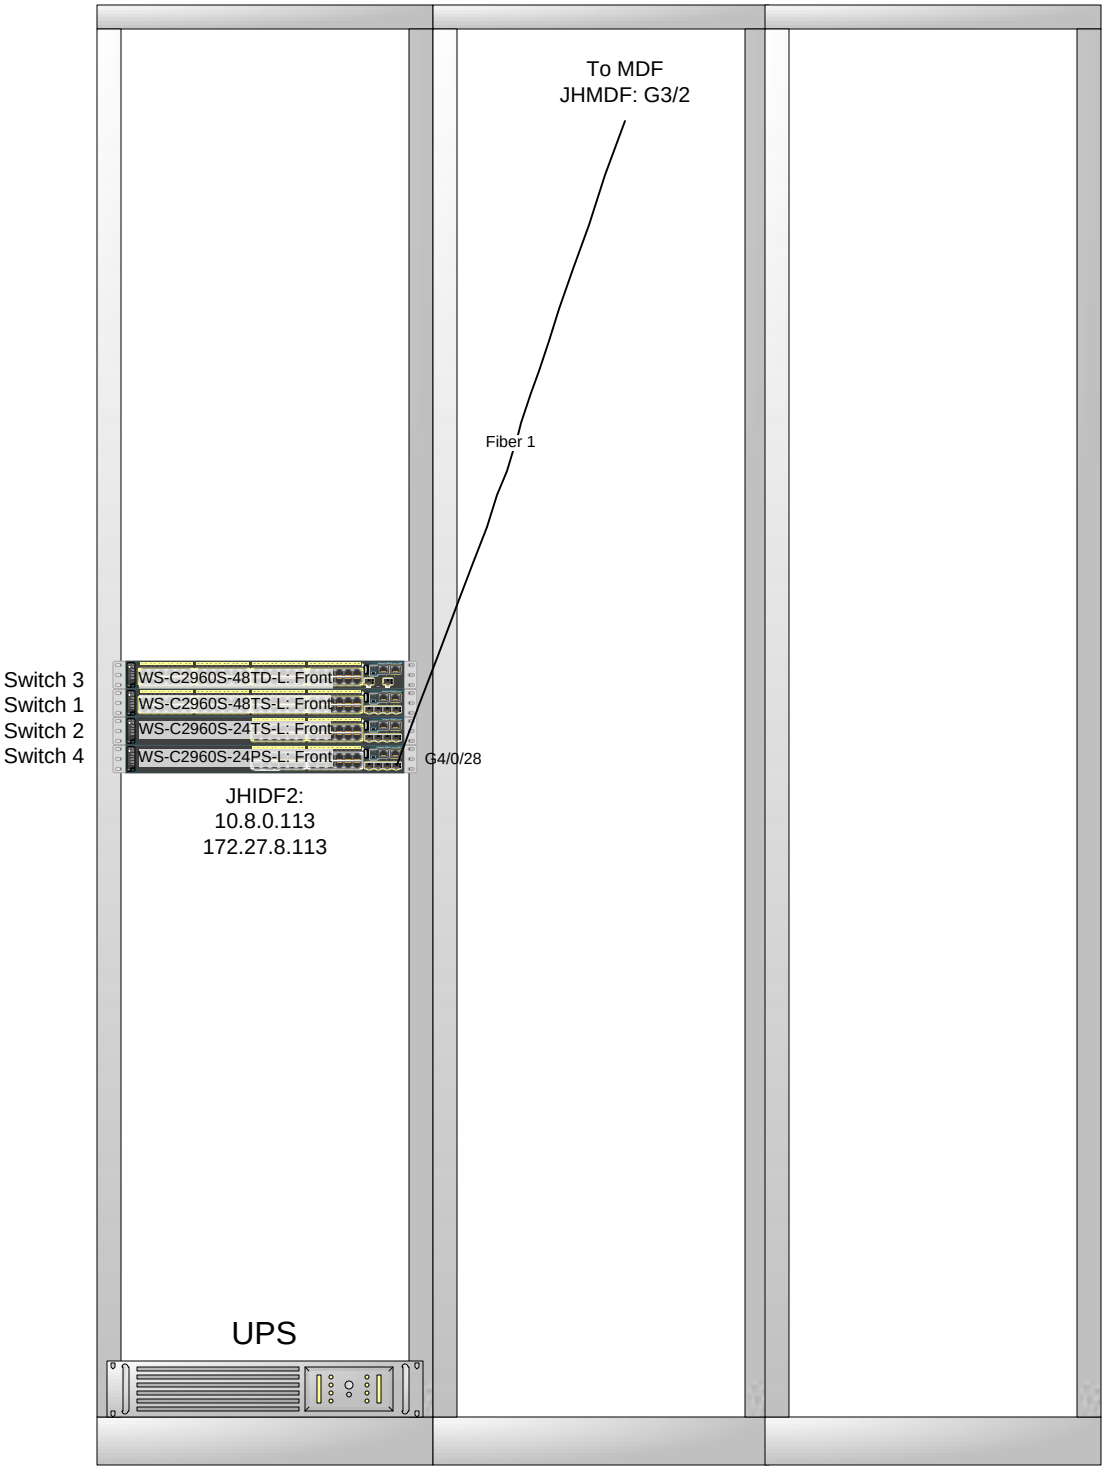
MDF-1


JH-Optimon:192.168.100.15
10.8.1.99; 172.27.8.99
JH-Data: 10.8.1.1 (C2921/K9)
ASA 5550: 10.8.0.1
Barracuda Spam Filter: 10.8.1.35
Internet switch C3750G-24TS
AT&T 2925/K9
12.205.204.1
JH-Voice: 10.8.1.2 (C2921/K9)
JH-WLC: 10.8.1.5
Mitel Controller
172.27.1.1
MAS: 172.27.1.9/12.205.204.2
LCD Monitor
KVM 4 Switch & Monitor
KVM 4-1
Sd144jhdc0: 10.8.1.20
KVM 4-2: AppleServer 10.8.1.81
KVM 4-3
Video-JH: 10.8.1.40
KVM 4-4
Emailserver: 10.8.1.115
KVM 4-5
Netserver4 - 10.8.1.102
KVM 4-6
Destiny: 10.8.1.111
KVM 4-7
Track-it: 10.8.1.118
KVM 4-8
TS3: 10.8.1.119
KVM 3-1
Sharepoint2010:
10.8.1.116
KVM 3-2
PSServer: 10.8.1.113
APC Smart-UPS 3000VA
APC Smart-UPS 3000VA
LCD Monitor
KVM 5 Switch & Monitor
KVM 5-5
Fileserver: 10.8.1.4
KVM 5-4
Exchange2010:
10.8.1.25
KVM 5-3
Sd144jh-Server:
10.8.1.15
KVM 5-2
Sd144jhdc1: 10.8.0.21
TS2: 10.8.1.117
KVM 5-1
Sophos: 10.8.0.10
APC Smart-UPS 3000VA
APC Smart-UPS 3000VA
WS-X4748-RJ45V+E
WS-X4748-RJ45V+E
WS-X4612-SFP-E
WS-X4748-RJ45-E
WS-X45-SUP7-E
WS-X4748-RJ45-E
WS-X4548-GB-RJ45
WS-C4510R+E
JHMDF: 10.8.1.100
172.27.8.100
NAS-24: 10.8.1.10
KVM 5-8
Barracuda Content Filter
10.8.1.28
KVM 5-6
Voip-Log
172.27.1.15
JHIDF1-PoE G1/0/28
JHIDF1-2 G4/0/52
JHIDF1-1 G1/0/52
JHIDF2 G4/0/28
Annex Te1/0/1
JHIDF3-PoE G2/0/28
JHIDF3-2 G2/0/52
JHIDF3-1 G3/0/52
JHIDF4-PoE G1/0/28
JHIDF4 G3/0/52
JHIDF5-PoE G1/0/28
JHIDF5 G3/0/52
JHMDF(G3/1)
Fiber 3:
JHMDF(G3/2)
Fiber 3:
JHMDF(Te5/1)
Single Fiber:
JHMDF(G3/3)
Fiber 2:
JHMDF(G 3/4)
Fiber 1:
JHMDF(G3/5)
Fiber 1:
Fiber 3:
JHMDF-1(G3/0/50)
Fiber 3:
JHMDF-1(G2/0/49)
Fiber 3:
JHMDF-1(G1/0/49)
Fiber 1:
JHMDF-1(G3/0/49)
Fiber 2:
JHMDF-1(G2/0/50)
Fiber 1:
JHMDF-1(G1/0/50)
JHMDF(G8/1) to
JHMDF-1(G1/0/48)
WS-C2960S-48TD-L: Front
WS-C2960S-48TD-L: Front
WS-C2960S-48TD-L: Front
JHMDF-1: 10.8.0.201
172.27.8.201
Switch 3
Switch 1
Switch 2
KVM 5-7
Students
10.8.1.30
Rack 6
Rack 7
Rack 8
Rack 9
Rack 10

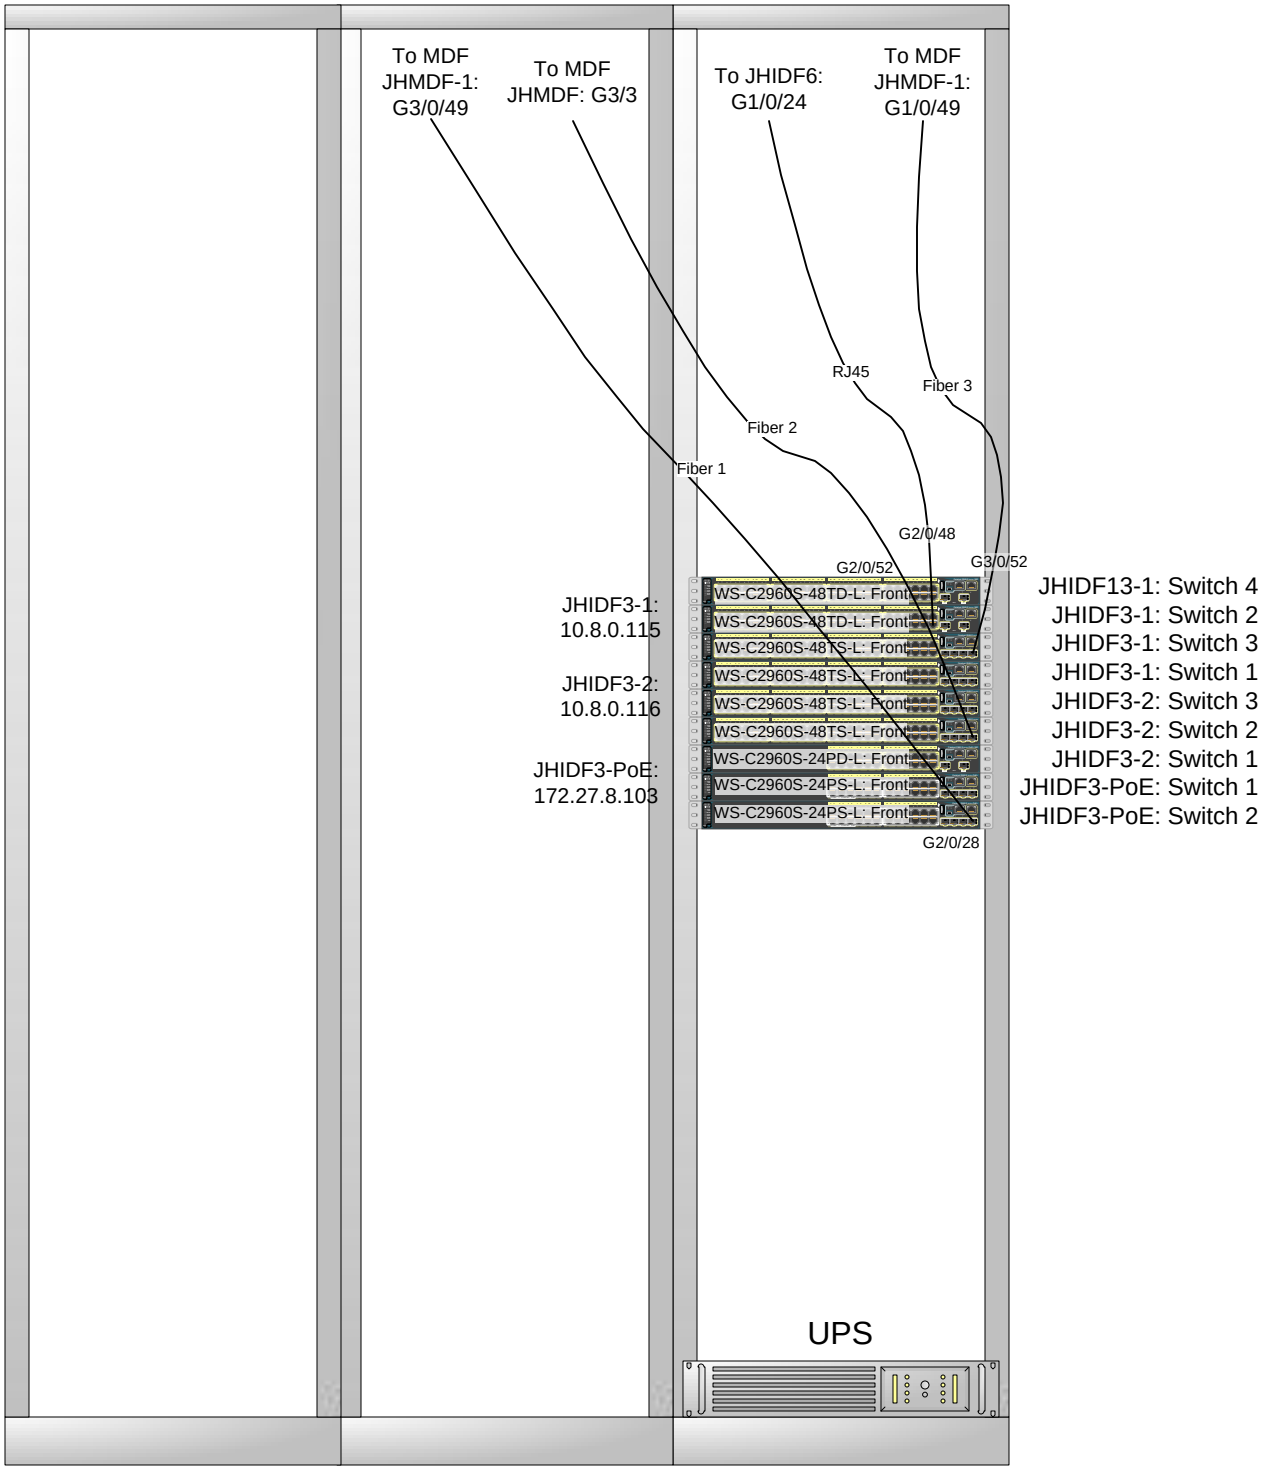
MDF-2


To MDF
JHMDF: G3/1
To MDF
JHMDF-1: G2/0/50
To MDF
JHMDF-1: G1/0/50
Fiber 3
Fiber 2
Fiber 1
JHIDF1-1: 10.8.0.111
JHIDF1-1: Switch 3
JHIDF1-1: Switch 4
JHIDF1-1: Switch 1
JHIDF1-2: Switch 1
JHIDF1-2: Switch 4
JHIDF1-1: Switch 2
JHIDF1-PoE: Switch 1
JHIDF1-PoE: Switch 2
JHIDF1-2: Switch 2
JHIDF1-2: Switch 3
WS-C2960S-48TD-L: Front
WS-C2960S-48TD-L: Front
WS-C2960S-48TS-L: Front
WS-C2960S-48TS-L: Front
WS-C2960S-48TS-L: Front
WS-C2960S-24PD-L: Front
WS-C2960S-24PS-L: Front
WS-C2960S-24PS-L: Front
WS-C2960S-48TS-L: Front
WS-C2960S-48TS-L: Front
G1/0/52
G4/0/52
G1/0/28
JHIDF1-PoE: 172.27.8.102
JHIDF1-2: 10.8.0.112
UPS

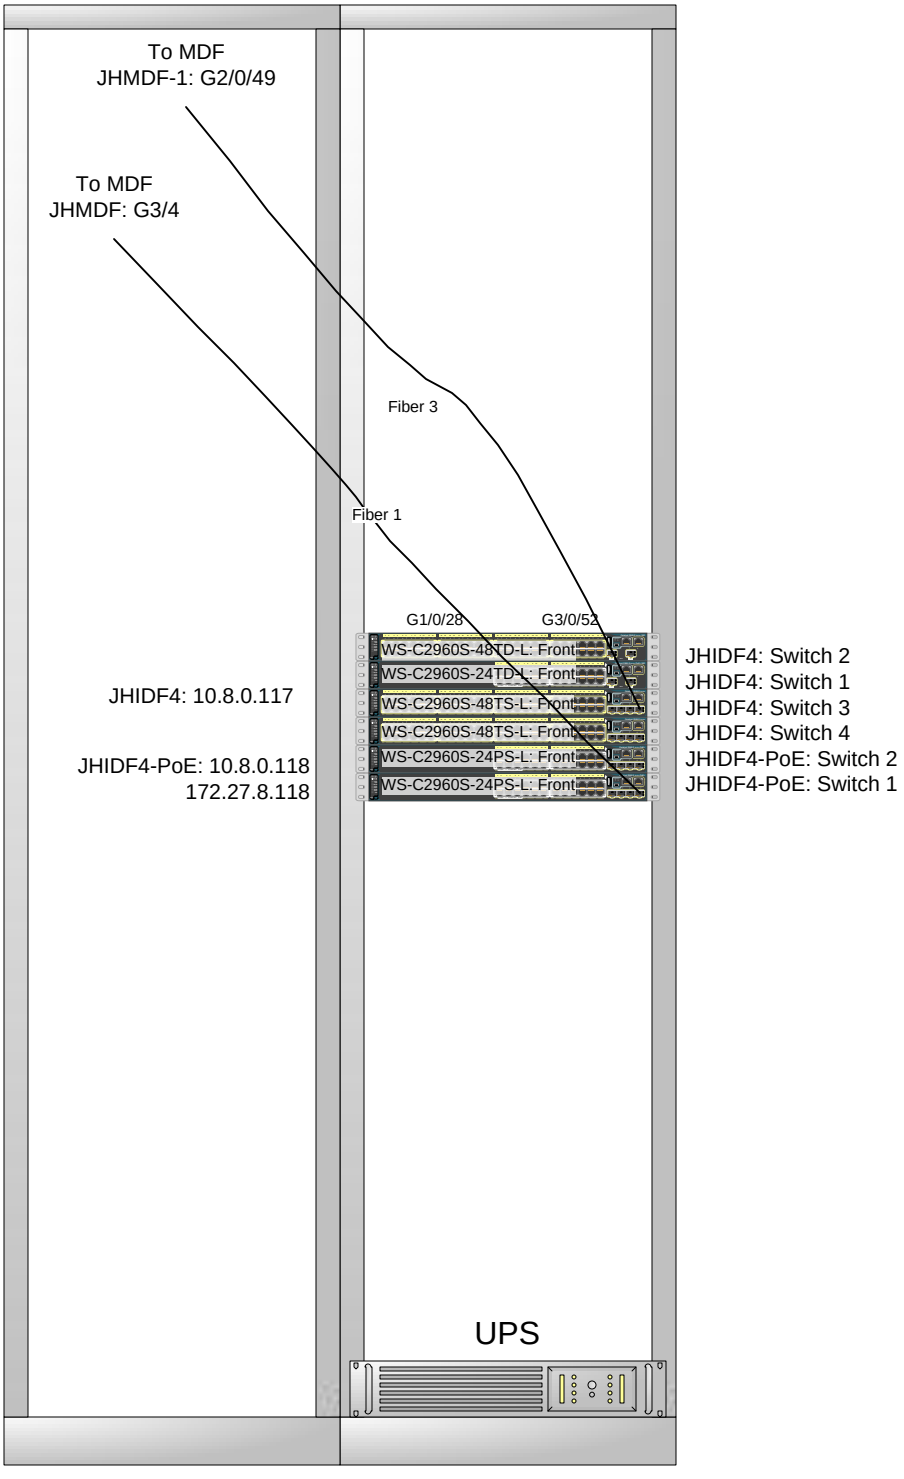
IDF 1


To MDF
JHMDF: G3/2
Fiber 1
Switch 3
Switch 1
Switch 2
Switch 4
WS-C2960S-48TD-L: Front
WS-C2960S-48TS-L: Front
WS-C2960S-24TS-L: Front
WS-C2960S-24PS-L: Front
G4/0/28
JHIDF2:
10.8.0.113
172.27.8.113
UPS

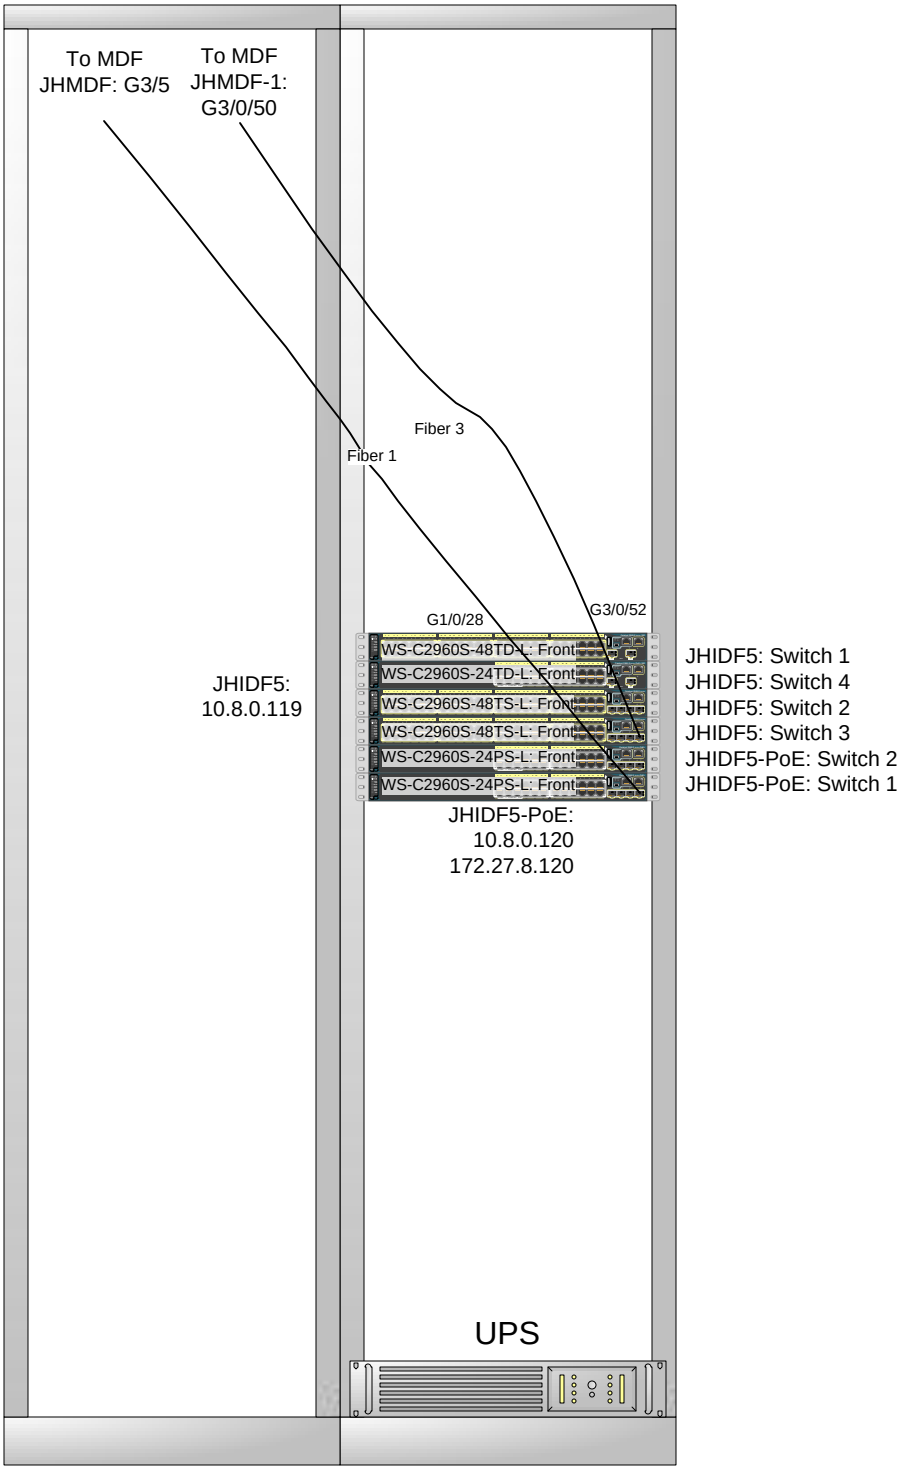
IDF 2


To MDF
JHMDF-1:
G3/0/49
To MDF
JHMDF: G3/3
To JHIDF6:
G1/0/24
To MDF
JHMDF-1:
G1/0/49
RJ45
Fiber 3
Fiber 2
Fiber 1
G2/0/48
G2/0/52
G3/0/52
JHIDF3-1:
10.8.0.115
JHIDF3-2:
10.8.0.116
JHIDF3-PoE:
172.27.8.103
WS-C2960S-48TD-L: Front
WS-C2960S-48TD-L: Front
WS-C2960S-48TS-L: Front
WS-C2960S-48TS-L: Front
WS-C2960S-48TS-L: Front
WS-C2960S-48TS-L: Front
WS-C2960S-24PD-L: Front
WS-C2960S-24PS-L: Front
WS-C2960S-24PS-L: Front
G2/0/28
JHIDF13-1: Switch 4
JHIDF3-1: Switch 2
JHIDF3-1: Switch 3
JHIDF3-1: Switch 1
JHIDF3-2: Switch 3
JHIDF3-2: Switch 2
JHIDF3-2: Switch 1
JHIDF3-PoE: Switch 1
JHIDF3-PoE: Switch 2
UPS

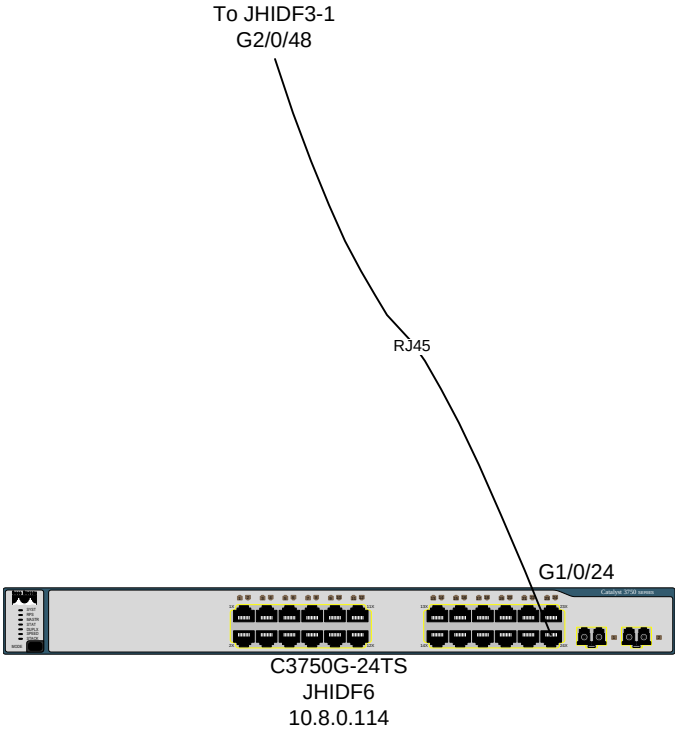
IDF 3


To MDF
JHMDF-1: G2/0/49
To MDF
JHMDF: G3/4
Fiber 3
Fiber 1
G1/0/28
G3/0/52
WS-C2960S-48TD-L: Front
WS-C2960S-24TD-L: Front
WS-C2960S-48TS-L: Front
WS-C2960S-48TS-L: Front
WS-C2960S-24PS-L: Front
WS-C2960S-24PS-L: Front
JHIDF4: 10.8.0.117
JHIDF4-PoE: 10.8.0.118
172.27.8.118
JHIDF4: Switch 2
JHIDF4: Switch 1
JHIDF4: Switch 3
JHIDF4: Switch 4
JHIDF4-PoE: Switch 2
JHIDF4-PoE: Switch 1
UPS

IDF 4


To MDF
JHMDF: G3/5
To MDF
JHMDF-1:
G3/0/50
Fiber 3
Fiber 1
G1/0/28
G3/0/52
WS-C2960S-48TD-L: Front
WS-C2960S-24TD-L: Front
WS-C2960S-48TS-L: Front
WS-C2960S-48TS-L: Front
WS-C2960S-24PS-L: Front
WS-C2960S-24PS-L: Front
JHIDF5:
10.8.0.119
JHIDF5: Switch 1
JHIDF5: Switch 4
JHIDF5: Switch 2
JHIDF5: Switch 3
JHIDF5-PoE: Switch 2
JHIDF5-PoE: Switch 1
JHIDF5-PoE:
10.8.0.120
172.27.8.120
UPS

IDF 5



IDF 6