



March 25, 2024

North Kansas City School District
2000 Northeast 46th Street
Kansas City, Missouri 64116

Project: Limited Lead in Drinking Water Testing
Address: 9201 North Indiana Avenue, Kansas City, Missouri 64156

On January 16, 2024, Bradley Young of Axiom Service Professionals (ASP), conducted lead in drinking water sampling at the above referenced address. Inspector certification is provided in Appendix A. A total of 76 samples were collected from various potential drinking water outlets including sources used for drinking, cooking, or cleaning of cooking and eating utensils throughout the building.

Drinking Water Standards

The use of lead solder and other lead-containing materials as defined in the EPA Safe Drinking Water Act in connecting household plumbing to public water supplies was prohibited as of 1986. The act established the definition of "lead free" to be less than 8% as a weighted average across wetted surfaces of a pipe, pipe fitting, plumbing fitting, and fixture and 0.2% lead for solder and flux. In 2011, the definition of "lead free" as it applied to wetted surfaces of a pipe, pipe fitting, and plumbing fitting and fixture was reduced from 8% to 0.25% as a weighted average. Many older structures still have lead pipe or lead-soldered plumbing internally, which may substantially increase the lead content of water at the tap. Nationwide regulations controlling the lead content of drinking-water coolers in schools went into effect in 1989.

In 1991, the EPA published the Lead and Copper Rule establishing limits on the amount of lead and copper in drinking water. This regulation can be found under 40 CFR Part 141, Subpart I. Reference: <https://www.epa.gov/dwreginfo/lead-and-copper-rule>

The EPA has set lead in drinking water standards as outlined below.

- For lead, the maximum contaminant level goal (MCLG) is zero. This is the levels determined to be safe by toxicological and biomedical considerations, independent of feasibility. EPA's National Primary Drinking Water Regulations for Lead establish a treatment level of **0.015 mg/L** or **15 ppb** (parts per billion) in municipal drinking water systems.

The Missouri Senate Bill 681 “Get the Lead Out of School Drinking Water Act”, passed in 2022, has set the standard summarized below.

Reference: https://www.senate.mo.gov/22info/BTS_Web/Bill.aspx?SessionType=R&BillID=71259862

- On or before January 1, 2024, each school shall conduct an inventory of all drinking water outlets and all outlets that are used for dispensing water for cooking or for cleaning cooking and eating utensils in each of the school's buildings. A plan for testing should then be developed, prioritizing early childhood education programs and elementary schools, and made available to the public.
- The bill outlines that beginning in the 2023-2024 school year and for each subsequent school year, each school shall provide drinking water with a lead concentration below five parts per billion (**5 ppb**). Any school with greater than or equal to 5 ppb shall provide results and remediation plans to parents and staff within 7 business days of receiving results.

Drinking Fountain Identification

Drinking fountains throughout the school were visually assessed to determine if they matched those listed by the EPA to be lead-containing. The list of drinking fountains reported by the EPA to contain lead-lined holding tanks or solder joints is presented as Appendix B. Below is a list of drinking fountains within the school that match those reported by the EPA to be lead-containing.

Location	Make	Model #	Serial #
None Matching			

Water Sampling Methods:

Water samples were collected from each selected location as “first draw” and/or “flush”. First draw samples typically represent worst case sample results. A flush sample is typically collected to determine if an elevation is originating beyond the fixture in the fixture supply line or beyond. Samples were deposited into a non-preserved 250-milliliter sterile Nalgene screw top bottle. Immediately following sample collection, the samples were delivered to Keystone Laboratories located at 8857 Long Street, Lenexa, Kansas 66215. Upon arrival at the laboratory, samples were preserved through addition of nitric acid.

Keystone Laboratories is accredited through the Missouri Department of Natural Resources for analysis of lead in water.

Below is a summary of the water sampling results as reported in Appendix C by Keystone Laboratories. Results exceeding the applicable drinking water standards are shown in **red text**.

January 16, 2024 Water Sampling Results:

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
9201-1-FD	Gateway Middle School - Room 19	Sink Tap	First Draw	<0.4
9201-2-FD	Gateway Middle School - Office Kitchenette	Sink Tap	First Draw	<0.4
9201-3-FD	Gateway Middle School - Room 100	Sink Tap	First Draw	<0.4
9201-4-FD	Gateway Middle School - Room 101	Sink Tap	First Draw	<0.4
9201-5-FD	Gateway Middle School - Room 102	Sink Tap	First Draw	<0.4
9201-6-FD	Gateway Middle School - Room 103	Sink Tap	First Draw	<0.4
9201-7-FD	Gateway Middle School - Room 104	Sink Tap	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
9201-8-FD	Gateway Middle School - Outside 608-Left	Drinking Fountain	First Draw	<0.4
9201-9-FD	Gateway Middle School - Outside 608-Right	Drinking Fountain	First Draw	<0.4
9201-10-FD	Gateway Middle School - Room 110	Sink Tap	First Draw	<0.4
9201-11-FD	Gateway Middle School - Southwest of Library	Drinking Fountain	First Draw	<0.4
9201-12-FD	Gateway Middle School - Southwest of Library-Right	Drinking Fountain	First Draw	<0.4
9201-13-FD	Gateway Middle School - Room 200	Sink Tap	First Draw	<0.4
9201-14-FD	Gateway Middle School - Room 201	Sink Tap	First Draw	<0.4
9201-15-FD	Gateway Middle School - Room 202	Sink Tap	First Draw	<0.4
9201-16-FD	Gateway Middle School - Room 203	Sink Tap	First Draw	<0.4
9201-17-FD	Gateway Middle School - Room 204	Sink Tap	First Draw	<0.4
9201-18-FD	Gateway Middle School - Room 300	Sink Tap	First Draw	0.5
9201-19-FD	Gateway Middle School - Room 301	Sink Tap	First Draw	<0.4
9201-20-FD	Gateway Middle School - Room 302	Sink Tap	First Draw	<0.4
9201-21-FD	Gateway Middle School - Room 303	Sink Tap	First Draw	<0.4
9201-22-FD	Gateway Middle School - Room 304	Sink Tap	First Draw	0.6
9201-23-FD	Gateway Middle School - Room 400	Sink Tap	First Draw	<0.4
9201-24-FD	Gateway Middle School - Room 401	Sink Tap	First Draw	<0.4
9201-25-FD	Gateway Middle School - Room 402	Sink Tap	First Draw	<0.4
9201-26-FD	Gateway Middle School - Room 403	Sink Tap	First Draw	<0.4
9201-27-FD	Gateway Middle School - Room 404	Sink Tap	First Draw	<0.4
9201-28-FD	Gateway Middle School - Outside 400 Pod-Left	Drinking Fountain	First Draw	<0.4
9201-29-FD	Gateway Middle School - Outside 400 Pod-Right	Drinking Fountain	First Draw	<0.4
9201-30-FD	Gateway Middle School - Library Office	Sink Tap	First Draw	<0.4
9201-31-FD	Gateway Middle School - Room 410	Sink Tap	First Draw	0.5
9201-32-FD	Gateway Middle School - Outside 601-Left	Drinking Fountain	First Draw	<0.4
9201-33-FD	Gateway Middle School - Outside 601-Right	Drinking Fountain	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
9201-34-FD	Gateway Middle School - Room 500	Sink Tap	First Draw	0.5
9201-35-FD	Gateway Middle School - Room 501	Sink Tap	First Draw	<0.4
9201-36-FD	Gateway Middle School - Room 502	Sink Tap	First Draw	0.4
9201-37-FD	Gateway Middle School - Room 503	Sink Tap	First Draw	0.4
9201-38-FD	Gateway Middle School - Room 504	Sink Tap	First Draw	<0.4
9201-39-FD	Gateway Middle School - Room 50	Sink Tap	First Draw	<0.4
9201-40-FD	Gateway Middle School - Room 51	Sink Tap	First Draw	<0.4
9201-41-FD	Gateway Middle School - Large Gym-Left	Drinking Fountain	First Draw	<0.4
9201-42-FD	Gateway Middle School - Large Gym-Right	Drinking Fountain	First Draw	<0.4
9201-43-FD	Gateway Middle School - Room 44-Left	Sink Tap	First Draw	<0.4
9201-44-FD	Gateway Middle School - Room 44-Right	Sink Tap	First Draw	<0.4
9201-45-FD	Gateway Middle School - Room 45-Left	Sink Tap	First Draw	<0.4
9201-46-FD	Gateway Middle School - Room 45-Right	Sink Tap	First Draw	<0.4
9201-47-FD	Gateway Middle School - Outside 45-Left	Drinking Fountain	First Draw	<0.4
9201-48-FD	Gateway Middle School - Outside 45-Right	Drinking Fountain	First Draw	<0.4
9201-49-FD	Gateway Middle School - Cafe-Left	Drinking Fountain	First Draw	<0.4
9201-50-FD	Gateway Middle School - Cafe-Right	Drinking Fountain	First Draw	<0.4
9201-51-FD	Gateway Middle School - Kitchen-South Middle Sink	Sink Tap	First Draw	<0.4
9201-52-FD	Gateway Middle School - Kitchen	Steam Kettle	First Draw	0.6
9201-53-FD	Gateway Middle School - Kitchen-North Middle Sink	Sink Tap	First Draw	<0.4
9201-54-FD	Gateway Middle School - Kitchen-Four Bay Sink-Left	Sink Tap	First Draw	<0.4
9201-55-FD	Gateway Middle School - Kitchen-Four Bay Sink-Middle	Sink Tap	First Draw	<0.4
9201-56-FD	Gateway Middle School - Kitchen-Four Bay Sink-Right	Sink Tap	First Draw	2.4
9201-57-FD	Gateway Middle School - Kitchen-Closest to Cafe	Sink Tap	First Draw	<0.4
9201-58-FD	Gateway Middle School - Cafe-South-Left	Drinking Fountain	First Draw	<0.4
9201-59-FD	Gateway Middle School - Cafe-South-Right	Drinking Fountain	First Draw	<0.4

Sample #	Location	Source Under Test	Test Type	Lead Result (ppb)
9201-60-FD	Gateway Middle School - Room 23	Sink Tap	First Draw	<0.4
9201-61-FD	Gateway Middle School - Room 23	Drinking Fountain	First Draw	<0.4
9201-62-FD	Gateway Middle School - Room 24	Sink Tap	First Draw	0.7
9201-63-FD	Gateway Middle School - Room 24	Drinking Fountain	First Draw	<0.4
9201-64-FD	Gateway Middle School - Staff Lounge	Sink Tap	First Draw	<0.4
9201-65-FD	Gateway Middle School - Staff Lounge	Ice Machine	First Draw	<0.4
9201-66-FD	Gateway Middle School - Room 22	Sink Tap	First Draw	<0.4
9201-67-FD	Gateway Middle School - Room 21	Sink Tap	First Draw	<0.4
9201-68-FD	Gateway Middle School - Outside 800 Hallway-Left	Drinking Fountain	First Draw	<0.4
9201-69-FD	Gateway Middle School - Outside 800 Hallway-Right	Drinking Fountain	First Draw	<0.4
9201-70-FD	Gateway Middle School - Room 011	Sink Tap	First Draw	0.6
9201-71-FD	Gateway Middle School - Outside 802-Left	Drinking Fountain	First Draw	<0.4
9201-72-FD	Gateway Middle School - Outside 802-Right	Drinking Fountain	First Draw	<0.4
9201-73-FD	Gateway Middle School - Outside Jumbo Gym-Far Left	Drinking Fountain	First Draw	<0.4
9201-74-FD	Gateway Middle School - Outside Jumbo Gym-Left Middle	Drinking Fountain	First Draw	<0.4
9201-75-FD	Gateway Middle School - Outside Jumbo Gym-Right Middle	Drinking Fountain	First Draw	<0.4
9201-76-FD	Gateway Middle School - Outside Jumbo Gym-Far Right	Drinking Fountain	First Draw	<0.4

Photos of the sampling locations are provided in Appendix D. A diagram containing identifiers on the outlets tested is provided in Appendix E.

Required Communication

- Contact staff and parents via written notification within seven (7) business days after receiving the test result.
- The notification shall include at least:
 - The test results and a summary that explains such results;
 - A description of any remedial steps taken; and
 - A description of general health effects of lead contamination and community specific resources; and
- Provide bottled water if there is not enough water to meet the drinking water needs of the students, teachers, and staff.
- Submit such annual testing results to the Missouri Department of Health and Senior Services (DHSS).
- Before August 1, 2024, or the first day on which students will be present in the building, whichever is later, and annually thereafter, each school shall conduct testing for lead by first-draw and follow-up flush samples of a random sampling of at least twenty-five percent (25%) of remediated drinking water outlets until all remediated sources have been tested as recommended by the 2018 version of the United States Environmental Protection Agency's "Training, Testing, and Taking Action" program. The testing shall be conducted and the results analyzed for both types of tests by an entity or entities approved by the department.
- Any measures taken to remediate any elevated lead levels identified must be recorded and documented.

General Recommendations

- Retesting of all potential cooking and drinking water sources is required five (5) years from previous testing completed.
- If the condition changes or significant alterations to existing plumbing is undertaken, consider performing additional lead in drinking water sampling.
- Ensure that the plumbing system is not used as an electrical ground.
- If equipment is added that could affect water pH, alkalinity, or hardness, consider performing lead in drinking water sampling.

Any work resulting from this report should be conducted in accordance with the EPA Safe Drinking Water Act, Missouri SB 681 & 662, HUD Lead Regulations 24 CFR 35, EPA Lead Regulations 40 CFR 745, and Consumer Product Safety Commission document #5056.

If you have any questions concerning this report, please contact me at 816-678-7894.

Sincerely,



Jeff Hurst
Axiom Service Professionals LLC
jeffh@axiomservicepros.com

Limitations Drinking Water Testing

The presence or absence of lead and copper (if collected) in drinking water applies only to the test locations on the date of the field visit and it should be understood that conditions may change due to deterioration, pH, alkalinity, hardness, use levels, or maintenance. The results noted within this report were accurate at the time of the evaluation and in no way reflect the conditions at the property before or after the date of the evaluation. No other environmental concerns or conditions were addressed during this evaluation.

Appendix A Certifications

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

LEAD OCCUPATION LICENSE REGISTRATION

Issued to:

Bradly A. Young

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

Lead Inspector
Category of License

Issuance Date: 10/4/2023
Expiration Date: 10/4/2025
License Number: 211004-300006201



Paula F. Nickelson

Paula F. Nickelson
Director

Department of Health and Senior Services

Lead Licensing Program, PO Box 570, Jefferson City, MO 65102

STATE OF MISSOURI
DEPARTMENT OF HEALTH AND SENIOR SERVICES

LEAD OCCUPATION LICENSE REGISTRATION

Issued to:

Jeffrey A. Hurst

The person, firm or corporation whose name appears on this certificate has fulfilled the requirements for licensure as set forth in the Missouri Revised Statutes 701.300-701.338, as long as not suspended or revoked, and is hereby authorized to engage in the activity listed below.

Lead Risk Assessor
Category of License

Issuance Date: **8/1/2022**
Expiration Date: **8/1/2024**
License Number: **000801-200166567**



**Missouri Department of Health
and Senior Services**

Lead Occupation License - ID Badge

License Number:

000801-200166567

Lead Risk Assessor

**Jeffrey
Hurst**

Expiration Date: **8/1/2024**

Paula F. Nickelson

Paula F. Nickelson
Acting Director

Missouri Department of Health and Senior Services

Kansas City, MO 65102

Appendix B
EPA Listed Lead Containing Drinking Fountains

Table C-1
Water Coolers With Other Lead Components

EBCO Manufacturing

- All pressure bubbler water coolers with shipping dates from 1962 through 1977 have a bubbler valve containing lead. The units contain a single, 50-50 tin-lead solder joint on the bubbler valve. Model numbers for coolers in this category are not available.
- The following models of pressure bubbler coolers produced from 1978 through 1981 contain one 50-50 tin-lead solder joint each.

CP3	DP15W	DPM8	7P	13P	DPM8H	DP15M	DP3R	DP8A
DP16M	DP5S	C10E	PX-10	DP7S	DP13SM	DP7M	DP7MH	DP7WD
WTC10	DP13M-60	DP14M	CP10-50	CP5	CP5M	DP15MW	DP3R	DP14S
DP20-50	DP7SM	DP10X	DP13A	DP13A-50	EP10F	DP5M	DP10F	CP3H
CP3-50	DP13M	DP3RH	DP5F	CP3M	EP5F	13PL	DP8AH	DP13S
CP10	DP20	DP12N	DP7WM	DP14A-50/60				

Halsey Taylor

- Lead solder was used in these models of water coolers manufactured between 1978 and the last week of 1987:

WMA-1	SCWT/SCWT-A	SWA-1	DC/DHC-1
S3/5/10D	BFC-4F/7F/4FS/7FS	S300/500/100D	

- The following coolers manufactured for Haws Drinking Faucet Company (Haws) by Halsey Taylor from November 1984 through December 18, 1987 are not lead-free because they contain 2 tin-lead solder joints. The model designations for these units are as follows:

HC8WT	HC14F	HC6W	HWC7D	HC8WTH	HC14FH	HC8W	HC2F	HC14WT
HC14FL	HC14W	HC2FH	HC14WTH	HC8FL	HC4F	HC5F	HC14WL	HCBF7D
HC4FH	HC10F	HC16WT	HCBF7HO	HC8F	HC8FH	HC4W	HWC7	

Table C-2
Halsey Taylor Water Coolers With Lead-Lined Tanks

- The following six model numbers have one or more units in the model series with lead-lined tanks:

WM8A WT8A GC10ACR GC10A GC5A RWM13A

- The following models and serial numbers contain lead-lined tanks:

WM14A Serial No. 843034	WM14A Serial No. 843006	WT11A Serial No. 222650
WT21A Serial No. 64309550	WT21A Serial No. 64309542	LL14A Serial No. 64346908

Appendix C

Laboratory Analytical Report



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HA0152

AXIOM Service Professionals

Jeff Hurst
PO Box 47166
Kansas City, MO 64188

Project Name: 9201 North Indiana Avenue

Project / PO Number: 9201 North Indiana Avenue
Received: 01/26/2024
Reported: 03/13/2024

Analytical Testing Parameters

Client Sample ID: 9201-1-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-01

Collected By: Bradley Young
Collection Date: 01/16/2024 7:18

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1630	RVV

Client Sample ID: 9201-2-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-02

Collected By: Bradley Young
Collection Date: 01/16/2024 7:18

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1633	RVV

Client Sample ID: 9201-3-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-03

Collected By: Bradley Young
Collection Date: 01/16/2024 7:19

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1647	RVV

Client Sample ID: 9201-4-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-04

Collected By: Bradley Young
Collection Date: 01/16/2024 7:19

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1656	RVV



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HA0152

Client Sample ID: 9201-5-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-05

Collected By: Bradley Young
Collection Date: 01/16/2024 7:19

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1659	RVV

Client Sample ID: 9201-6-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-06

Collected By: Bradley Young
Collection Date: 01/16/2024 7:20

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1702	RVV

Client Sample ID: 9201-7-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-07

Collected By: Bradley Young
Collection Date: 01/16/2024 7:20

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1705	RVV

Client Sample ID: 9201-8-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-08

Collected By: Bradley Young
Collection Date: 01/16/2024 7:21

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1708	RVV

Client Sample ID: 9201-9-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-09

Collected By: Bradley Young
Collection Date: 01/16/2024 7:21

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1717	RVV

Microbac Laboratories, Inc., Lenexa

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HA0152

Client Sample ID: 9201-10-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-10

Collected By: Bradley Young
Collection Date: 01/16/2024 7:21

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1720	RVV

Client Sample ID: 9201-11-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-11

Collected By: Bradley Young
Collection Date: 01/16/2024 7:22

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1723	RVV

Client Sample ID: 9201-12-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-12

Collected By: Bradley Young
Collection Date: 01/16/2024 7:22

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1726	RVV

Client Sample ID: 9201-13-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-13

Collected By: Bradley Young
Collection Date: 01/16/2024 7:24

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1729	RVV

Client Sample ID: 9201-14-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-14

Collected By: Bradley Young
Collection Date: 01/16/2024 7:24

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1732	RVV

Microbac Laboratories, Inc., Lenexa

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HA0152

Client Sample ID: 9201-15-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-15

Collected By: Bradley Young
Collection Date: 01/16/2024 7:24

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1735	RVV

Client Sample ID: 9201-16-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-16

Collected By: Bradley Young
Collection Date: 01/16/2024 7:25

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1738	RVV

Client Sample ID: 9201-17-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-17

Collected By: Bradley Young
Collection Date: 01/16/2024 7:25

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1741	RVV

Client Sample ID: 9201-18-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-18

Collected By: Bradley Young
Collection Date: 01/16/2024 7:27

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.5	0.4	ppb	2		03/11/24 1623	03/12/24 1744	RVV

Client Sample ID: 9201-19-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-19

Collected By: Bradley Young
Collection Date: 01/16/2024 7:27

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1753	RVV



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HA0152

Client Sample ID: 9201-20-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-20

Collected By: Bradley Young
Collection Date: 01/16/2024 7:27

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1756	RVV

Client Sample ID: 9201-21-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-21

Collected By: Bradley Young
Collection Date: 01/16/2024 7:28

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1759	RVV

Client Sample ID: 9201-22-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-22

Collected By: Bradley Young
Collection Date: 01/16/2024 7:28

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.6	0.4	ppb	2		03/11/24 1623	03/12/24 1802	RVV

Client Sample ID: 9201-23-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-23

Collected By: Bradley Young
Collection Date: 01/16/2024 7:30

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1811	RVV

Client Sample ID: 9201-24-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-24

Collected By: Bradley Young
Collection Date: 01/16/2024 7:30

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1820	RVV

Microbac Laboratories, Inc., Lenexa

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HA0152

Client Sample ID: 9201-25-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-25

Collected By: Bradley Young
Collection Date: 01/16/2024 7:31

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1829	RVV

Client Sample ID: 9201-26-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-26

Collected By: Bradley Young
Collection Date: 01/16/2024 7:31

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1832	RVV

Client Sample ID: 9201-27-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-27

Collected By: Bradley Young
Collection Date: 01/16/2024 7:32

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1835	RVV

Client Sample ID: 9201-28-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-28

Collected By: Bradley Young
Collection Date: 01/16/2024 7:32

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1838	RVV

Client Sample ID: 9201-29-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-29

Collected By: Bradley Young
Collection Date: 01/16/2024 7:33

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1841	RVV

Microbac Laboratories, Inc., Lenexa

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HA0152

Client Sample ID: 9201-30-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-30

Collected By: Bradley Young
Collection Date: 01/16/2024 7:35

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1844	RVV

Client Sample ID: 9201-31-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-31

Collected By: Bradley Young
Collection Date: 01/16/2024 7:37

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.5	0.4	ppb	2		03/11/24 1623	03/12/24 1847	RVV

Client Sample ID: 9201-32-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-32

Collected By: Bradley Young
Collection Date: 01/16/2024 7:37

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1850	RVV

Client Sample ID: 9201-33-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-33

Collected By: Bradley Young
Collection Date: 01/16/2024 7:37

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1853	RVV

Client Sample ID: 9201-34-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-34

Collected By: Bradley Young
Collection Date: 01/16/2024 7:40

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.5	0.4	ppb	2		03/11/24 1623	03/12/24 1856	RVV

Microbac Laboratories, Inc., Lenexa

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HA0152

Client Sample ID: 9201-35-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-35

Collected By: Bradley Young
Collection Date: 01/16/2024 7:40

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1905	RVV

Client Sample ID: 9201-36-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-36

Collected By: Bradley Young
Collection Date: 01/16/2024 7:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1908	RVV

Client Sample ID: 9201-37-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-37

Collected By: Bradley Young
Collection Date: 01/16/2024 7:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1911	RVV

Client Sample ID: 9201-38-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-38

Collected By: Bradley Young
Collection Date: 01/16/2024 7:41

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1914	RVV

Client Sample ID: 9201-39-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-39

Collected By: Bradley Young
Collection Date: 01/16/2024 7:43

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1917	RVV



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HA0152

Client Sample ID: 9201-40-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-40

Collected By: Bradley Young
Collection Date: 01/16/2024 7:44

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1920	RVV

Client Sample ID: 9201-41-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-41

Collected By: Bradley Young
Collection Date: 01/16/2024 7:46

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1923	RVV

Client Sample ID: 9201-42-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-42

Collected By: Bradley Young
Collection Date: 01/16/2024 7:46

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1926	RVV

Client Sample ID: 9201-43-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-43

Collected By: Bradley Young
Collection Date: 01/16/2024 7:48

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1941	RVV

Client Sample ID: 9201-44-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-44

Collected By: Bradley Young
Collection Date: 01/16/2024 7:48

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1950	RVV

Microbac Laboratories, Inc., Lenexa

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HA0152

Client Sample ID: 9201-45-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-45

Collected By: Bradley Young
Collection Date: 01/16/2024 7:50

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1953	RVV

Client Sample ID: 9201-46-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-46

Collected By: Bradley Young
Collection Date: 01/16/2024 7:50

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1956	RVV

Client Sample ID: 9201-47-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-47

Collected By: Bradley Young
Collection Date: 01/16/2024 7:51

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 1959	RVV

Client Sample ID: 9201-48-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-48

Collected By: Bradley Young
Collection Date: 01/16/2024 7:51

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 2002	RVV

Client Sample ID: 9201-49-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-49

Collected By: Bradley Young
Collection Date: 01/16/2024 7:52

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 2005	RVV

Microbac Laboratories, Inc., Lenexa

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HA0152

Client Sample ID: 9201-50-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-50

Collected By: Bradley Young
Collection Date: 01/16/2024 7:52

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 2008	RVV

Client Sample ID: 9201-51-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-51

Collected By: Bradley Young
Collection Date: 01/16/2024 7:54

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 2017	RVV

Client Sample ID: 9201-52-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-52

Collected By: Bradley Young
Collection Date: 01/16/2024 7:54

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.6	0.4	ppb	2		03/11/24 1623	03/12/24 2020	RVV

Client Sample ID: 9201-53-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-53

Collected By: Bradley Young
Collection Date: 01/16/2024 7:54

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 2023	RVV

Client Sample ID: 9201-54-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-54

Collected By: Bradley Young
Collection Date: 01/16/2024 7:55

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 2026	RVV



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HA0152

Client Sample ID: 9201-55-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-55

Collected By: Bradley Young
Collection Date: 01/16/2024 7:55

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 2029	RVV

Client Sample ID: 9201-56-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-56

Collected By: Bradley Young
Collection Date: 01/16/2024 7:56

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	2.4	0.4	ppb	2		03/11/24 1623	03/12/24 2032	RVV

Client Sample ID: 9201-57-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-57

Collected By: Bradley Young
Collection Date: 01/16/2024 7:56

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 2035	RVV

Client Sample ID: 9201-58-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-58

Collected By: Bradley Young
Collection Date: 01/16/2024 7:57

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 2038	RVV

Client Sample ID: 9201-59-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-59

Collected By: Bradley Young
Collection Date: 01/16/2024 7:57

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 2041	RVV

Microbac Laboratories, Inc., Lenexa

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HA0152

Client Sample ID: 9201-60-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-60

Collected By: Bradley Young
Collection Date: 01/16/2024 7:59

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 2044	RVV

Client Sample ID: 9201-61-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-61

Collected By: Bradley Young
Collection Date: 01/16/2024 7:59

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 2053	RVV

Client Sample ID: 9201-62-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-62

Collected By: Bradley Young
Collection Date: 01/16/2024 8:00

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.7	0.4	ppb	2		03/11/24 1623	03/12/24 2056	RVV

Client Sample ID: 9201-63-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-63

Collected By: Bradley Young
Collection Date: 01/16/2024 8:00

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 2105	RVV

Client Sample ID: 9201-64-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-64

Collected By: Bradley Young
Collection Date: 01/16/2024 8:01

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 2114	RVV

Microbac Laboratories, Inc., Lenexa

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HA0152

Client Sample ID: 9201-65-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-65

Collected By: Bradley Young
Collection Date: 01/16/2024 8:01

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 2117	RVV

Client Sample ID: 9201-66-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-66

Collected By: Bradley Young
Collection Date: 01/16/2024 8:03

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 2120	RVV

Client Sample ID: 9201-67-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-67

Collected By: Bradley Young
Collection Date: 01/16/2024 8:03

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 2129	RVV

Client Sample ID: 9201-68-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-68

Collected By: Bradley Young
Collection Date: 01/16/2024 8:05

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 2132	RVV

Client Sample ID: 9201-69-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-69

Collected By: Bradley Young
Collection Date: 01/16/2024 8:05

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 2135	RVV

Microbac Laboratories, Inc., Lenexa

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HA0152

Client Sample ID: 9201-70-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-70

Collected By: Bradley Young
Collection Date: 01/16/2024 8:07

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	0.6	0.4	ppb	2		03/11/24 1623	03/12/24 2138	RVV

Client Sample ID: 9201-71-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-71

Collected By: Bradley Young
Collection Date: 01/16/2024 8:08

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 2141	RVV

Client Sample ID: 9201-72-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-72

Collected By: Bradley Young
Collection Date: 01/16/2024 8:08

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 2144	RVV

Client Sample ID: 9201-73-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-73

Collected By: Bradley Young
Collection Date: 01/16/2024 8:10

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 2147	RVV

Client Sample ID: 9201-74-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-74

Collected By: Bradley Young
Collection Date: 01/16/2024 8:10

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 2150	RVV

Microbac Laboratories, Inc., Lenexa

8857 Long Street | Lenexa, KS 66215 | 913-321-7856 p | www.microbac.com



Microbac Laboratories, Inc., Lenexa

CERTIFICATE OF ANALYSIS

3HA0152

Client Sample ID: 9201-75-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-75

Collected By: Bradley Young
Collection Date: 01/16/2024 8:10

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 2153	RVV

Client Sample ID: 9201-76-FD
Sample Matrix: Drink Wtr
Lab Sample ID: 3HA0152-76

Collected By: Bradley Young
Collection Date: 01/16/2024 8:10

Analyses Performed by: Microbac Laboratories, Inc., Newton

Determination of Total Metals	Result	RL	Units	DF	Note	Prepared	Analyzed	Analyst
200.8								
Lead, total	<0.4	0.4	ppb	2		03/11/24 1623	03/12/24 2156	RVV

Definitions

RL: Reporting Limit

Report Comments

The data and information on this, and other accompanying documents, represents only the sample(s) analyzed. This report is incomplete unless all pages indicated in the footnote are present and an authorized signature is included. The services were provided under and subject to Microbac's standard terms and conditions which can be located and reviewed at <https://www.microbac.com/standard-terms-conditions>.

Reviewed and Approved By:

Carolyn Jackson
Project Manager
carolyn.jackson@microbac.com
03/13/24 13:32

Keystone

LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X

835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER: <u>Bradly Young</u>		NAME: <u>Jeff Hurst</u>		NAME: <u>Jeff Hurst</u>	
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS: <u>9201 North Indiana Avenue</u>		ADDRESS: <u>PO Box 47166</u>		ADDRESS: <u>PO Box 47166</u>	
CITY/ST/ZIP: <u>Kansas City, Missouri 64156</u>		CITY/ST/ZIP: <u>Kansas City, Missouri 64188</u>		CITY/ST/ZIP: <u>Kansas City, Missouri 64188</u>	
PHONE: <u>816-321-4702</u>		PHONE: <u>816-678-7894</u>		PHONE: <u>816-678-7894</u>	
		EMAIL: <u>jeffh@axiomservicepros.com</u>		EMAIL: <u>jeffh@axiomservicepros.com</u>	

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED								LAB USE ONLY	
							Lead								Wk Order #:	3HA0152
															Short Hold:	
															Rush:	
															Temp: oC	16.1°C
															Sample Condition	Sample #
9201-1-FD	1/16/2024	07:18	Gateway Middle School - Sink Tap - Room 19	1	Wt	Grab	X									01
9201-2-FD	1/16/2024	07:18	Gateway Middle School - Sink Tap - Office Kitchenette	1	Wt	Grab	X									02
9201-3-FD	1/16/2024	07:19	Gateway Middle School - Sink Tap - Room 100	1	Wt	Grab	X									03
9201-4-FD	1/16/2024	07:19	Gateway Middle School - Sink Tap - Room 101	1	Wt	Grab	X									04
9201-5-FD	1/16/2024	07:19	Gateway Middle School - Sink Tap - Room 102	1	Wt	Grab	X									05
9201-6-FD	1/16/2024	07:20	Gateway Middle School - Sink Tap - Room 103	1	Wt	Grab	X									06
9201-7-FD	1/16/2024	07:20	Gateway Middle School - Sink Tap - Room 104	1	Wt	Grab	X									07

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		
				1/26/24		
	Time:			Time:	10:20	



3HA0152

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone

LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X

835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	9201 North Indiana Avenue	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64156	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED							LAB USE ONLY	
							Lead							Wk Order #:	
														Short Hold:	
														Rush:	
														Temp: oC	
														Sample Condition	Sample #
9201-8-FD	1/16/2024	07:21	Gateway Middle School - Drinking Fountain - Outside 608-Left	1	Wt	Grab	X								08
9201-9-FD	1/16/2024	07:21	Gateway Middle School - Drinking Fountain - Outside 608-Right	1	Wt	Grab	X								09
9201-10-FD	1/16/2024	07:21	Gateway Middle School - Sink Tap - Room 110	1	Wt	Grab	X								10
9201-11-FD	1/16/2024	07:22	Gateway Middle School - Drinking Fountain - Southwest of Library	1	Wt	Grab	X								11
9201-12-FD	1/16/2024	07:22	Gateway Middle School - Drinking Fountain - Southwest of Library-Right	1	Wt	Grab	X								12
9201-13-FD	1/16/2024	07:24	Gateway Middle School - Sink Tap - Room 200	1	Wt	Grab	X								13
9201-14-FD	1/16/2024	07:24	Gateway Middle School - Sink Tap - Room 201	1	Wt	Grab	X								14

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		



3 H A 0 1 5 2

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone

LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

X

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	9201 North Indiana Avenue	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64156	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED							LAB USE ONLY	
							Lead							Wk Order #:	
														Short Hold:	
														Rush:	
														Temp: oC	
														Sample Condition	Sample #
9201-15-FD	1/16/2024	07:24	Gateway Middle School - Sink Tap - Room 202	1	Wt	Grab	X								15
9201-16-FD	1/16/2024	07:25	Gateway Middle School - Sink Tap - Room 203	1	Wt	Grab	X								16
9201-17-FD	1/16/2024	07:25	Gateway Middle School - Sink Tap - Room 204	1	Wt	Grab	X								17
9201-18-FD	1/16/2024	07:27	Gateway Middle School - Sink Tap - Room 300	1	Wt	Grab	X								18
9201-19-FD	1/16/2024	07:27	Gateway Middle School - Sink Tap - Room 301	1	Wt	Grab	X								19
9201-20-FD	1/16/2024	07:27	Gateway Middle School - Sink Tap - Room 302	1	Wt	Grab	X								20
9201-21-FD	1/16/2024	07:28	Gateway Middle School - Sink Tap - Room 303	1	Wt	Grab	X								21

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		



3 H A 0 1 5 2

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone

LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

X

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	9201 North Indiana Avenue	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64156	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED							LAB USE ONLY	
							Lead							Wk Order #:	
														Short Hold:	
														Rush:	
														Temp: oC	
														Sample Condition	Sample #
9201-22-FD	1/16/2024	07:28	Gateway Middle School - Sink Tap - Room 304	1	Wt	Grab	X								22
9201-23-FD	1/16/2024	07:30	Gateway Middle School - Sink Tap - Room 400	1	Wt	Grab	X								23
9201-24-FD	1/16/2024	07:30	Gateway Middle School - Sink Tap - Room 401	1	Wt	Grab	X								24
9201-25-FD	1/16/2024	07:31	Gateway Middle School - Sink Tap - Room 402	1	Wt	Grab	X								25
9201-26-FD	1/16/2024	07:31	Gateway Middle School - Sink Tap - Room 403	1	Wt	Grab	X								26
9201-27-FD	1/16/2024	07:32	Gateway Middle School - Sink Tap - Room 404	1	Wt	Grab	X								27
9201-28-FD	1/16/2024	07:32	Gateway Middle School - Drinking Fountain - Outside 400 Pod-Left	1	Wt	Grab	X								28

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		



3 H A 0 1 5 2

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone

LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856


205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

X

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	9201 North Indiana Avenue	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64156	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED							LAB USE ONLY	
							Lead							Wk Order #:	
														Short Hold:	
														Rush:	
														Temp: oC	
														Sample Condition	Sample #
9201-29-FD	1/16/2024	07:33	Gateway Middle School - Drinking Fountain - Outside 400 Pod-Right	1	Wt	Grab	X								29
9201-30-FD	1/16/2024	07:35	Gateway Middle School - Sink Tap - Library Office	1	Wt	Grab	X								30
9201-31-FD	1/16/2024	07:37	Gateway Middle School - Sink Tap - Room 410	1	Wt	Grab	X								31
9201-32-FD	1/16/2024	07:37	Gateway Middle School - Drinking Fountain - Outside 601-Left	1	Wt	Grab	X								32
9201-33-FD	1/16/2024	07:37	Gateway Middle School - Drinking Fountain - Outside 601-Right	1	Wt	Grab	X								33
9201-34-FD	1/16/2024	07:40	Gateway Middle School - Sink Tap - Room 500	1	Wt	Grab	X								34
9201-35-FD	1/16/2024	07:40	Gateway Middle School - Sink Tap - Room 501	1	Wt	Grab	X								35

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		



3 H A 0 1 5 2
AXIOM Service Professionals
PM: Carolyn Jackson

Keystone

LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

X

PRINT OR TYPE INFO BELOW:

SAMPLER: _____
SITE NAME: _____
ADDRESS: 9201 North Indiana Avenue
CITY/ST/ZIP: Kansas City, Missouri 64156
PHONE: 816-321-4702

REPORT TO:

NAME: Jeff Hurst
CO. NAME: _____
ADDRESS: PO Box 47166
CITY/ST/ZIP: Kansas City, Missouri 64188
PHONE: 816-678-7894
EMAIL: jeffh@axiomservicepros.com

BILL TO:

NAME: Jeff Hurst
CO. NAME: _____
ADDRESS: PO Box 47166
CITY/ST/ZIP: Kansas City, Missouri 64188
PHONE: 816-678-7894
EMAIL: jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED							LAB USE ONLY	
							Lead							Wk Order #:	
														Short Hold:	
														Rush:	
														Temp: oC	
														Sample Condition	Sample #
9201-36-FD	1/16/2024	07:41	Gateway Middle School - Sink Tap - Room 502	1	Wt	Grab	X								36
9201-37-FD	1/16/2024	07:41	Gateway Middle School - Sink Tap - Room 503	1	Wt	Grab	X								37
9201-38-FD	1/16/2024	07:41	Gateway Middle School - Sink Tap - Room 504	1	Wt	Grab	X								38
9201-39-FD	1/16/2024	07:43	Gateway Middle School - Sink Tap - Room 50	1	Wt	Grab	X								39
9201-40-FD	1/16/2024	07:44	Gateway Middle School - Sink Tap - Room 51	1	Wt	Grab	X								40
9201-41-FD	1/16/2024	07:46	Gateway Middle School - Drinking Fountain - Large Gym-Left	1	Wt	Grab	X								41
9201-42-FD	1/16/2024	07:46	Gateway Middle School - Drinking Fountain - Large Gym-Right	1	Wt	Grab	X								42

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		



3 H A 0 1 5 2

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone

LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X

835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:

SAMPLER: _____
SITE NAME: _____
ADDRESS: 9201 North Indiana Avenue
CITY/ST/ZIP: Kansas City, Missouri 64156
PHONE: 816-321-4702

REPORT TO:

NAME: Jeff Hurst
CO. NAME: _____
ADDRESS: PO Box 47166
CITY/ST/ZIP: Kansas City, Missouri 64188
PHONE: 816-678-7894
EMAIL: jeffh@axiomservicepros.com

BILL TO:

NAME: Jeff Hurst
CO. NAME: _____
ADDRESS: PO Box 47166
CITY/ST/ZIP: Kansas City, Missouri 64188
PHONE: 816-678-7894
EMAIL: jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED								LAB USE ONLY		
							Lead								Wk Order #:		
															Short Hold:		
															Rush:		
															Temp: oC		
															Sample Condition		Sample #
9201-43-FD	1/16/2024	07:48	Gateway Middle School - Sink Tap - Room 44-Left	1	Wt	Grab	X								43		
9201-44-FD	1/16/2024	07:48	Gateway Middle School - Sink Tap - Room 44-Right	1	Wt	Grab	X								44		
9201-45-FD	1/16/2024	07:50	Gateway Middle School - Sink Tap - Room 45-Left	1	Wt	Grab	X								45		
9201-46-FD	1/16/2024	07:50	Gateway Middle School - Sink Tap - Room 45-Right	1	Wt	Grab	X								46		
9201-47-FD	1/16/2024	07:51	Gateway Middle School - Drinking Fountain - Outside 45-Left	1	Wt	Grab	X								47		
9201-48-FD	1/16/2024	07:51	Gateway Middle School - Drinking Fountain - Outside 45-Right	1	Wt	Grab	X								48		
9201-49-FD	1/16/2024	07:52	Gateway Middle School - Drinking Fountain - Cafe-Left	1	Wt	Grab	X								49		

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		



3 H A 0 1 5 2

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone

LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

X

835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

PRINT OR TYPE INFO BELOW:

SAMPLER: _____
SITE NAME: _____
ADDRESS: 9201 North Indiana Avenue
CITY/ST/ZIP: Kansas City, Missouri 64156
PHONE: 816-321-4702


REPORT TO:

NAME: Jeff Hurst
CO. NAME: _____
ADDRESS: PO Box 47166
CITY/ST/ZIP: Kansas City, Missouri 64188
PHONE: 816-678-7894
EMAIL: jeffh@axiomservicepros.com

BILL TO:

NAME: Jeff Hurst
CO. NAME: _____
ADDRESS: PO Box 47166
CITY/ST/ZIP: Kansas City, Missouri 64188
PHONE: 816-678-7894
EMAIL: jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED							LAB USE ONLY	
							Lead							Wk Order #:	
														Short Hold:	
														Rush:	
														Temp: oC	
														Sample Condition	Sample #
9201-50-FD	1/16/2024	07:52	Gateway Middle School - Drinking Fountain - Cafe-Right	1	Wt	Grab	X								50
9201-51-FD	1/16/2024	07:54	Gateway Middle School - Sink Tap - Kitchen-South Middle Sink	1	Wt	Grab	X								51
9201-52-FD	1/16/2024	07:54	Gateway Middle School - Steam Kettle - Kitchen	1	Wt	Grab	X								52
9201-53-FD	1/16/2024	07:54	Gateway Middle School - Sink Tap - Kitchen-North Middle Sink	1	Wt	Grab	X								53
9201-54-FD	1/16/2024	07:55	Gateway Middle School - Sink Tap - Kitchen-4 Bay Sink-Left	1	Wt	Grab	X								54
9201-55-FD	1/16/2024	07:55	Gateway Middle School - Sink Tap - Kitchen-4 Bay Sink-Middle	1	Wt	Grab	X								55
9201-56-FD	1/16/2024	07:55	Gateway Middle School - Sink Tap - Kitchen-4 Bay Sink-Right	1	Wt	Grab	X								56

Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	Remarks:
				
Relinquished by: (Signature)	Date:	Received by: (Signature)	Date:	



3 H A 0 1 5 2

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone

LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

X

PRINT OR TYPE INFO BELOW:

SAMPLER: _____
SITE NAME: _____
ADDRESS: 9201 North Indiana Avenue
CITY/ST/ZIP: Kansas City, Missouri 64156
PHONE: 816-321-4702

REPORT TO:

NAME: Jeff Hurst
CO. NAME: _____
ADDRESS: PO Box 47166
CITY/ST/ZIP: Kansas City, Missouri 64188
PHONE: 816-678-7894
EMAIL: jeffh@axiomservicepros.com

BILL TO:

NAME: Jeff Hurst
CO. NAME: _____
ADDRESS: PO Box 47166
CITY/ST/ZIP: Kansas City, Missouri 64188
PHONE: 816-678-7894
EMAIL: jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED							LAB USE ONLY	
							Lead							Wk Order #:	
														Short Hold:	
														Rush:	
														Temp: oC	
														Sample Condition	Sample #
9201-57-FD	1/16/2024	07:56	Gateway Middle School - Sink Tap - Kitchen - Closest to Cafe	1	Wt	Grab	X								57
9201-58-FD	1/16/2024	07:57	Gateway Middle School - Drinking Fountain - Cafe - South-Left	1	Wt	Grab	X								58
9201-59-FD	1/16/2024	07:57	Gateway Middle School - Drinking Fountain - Cafe - South-Right	1	Wt	Grab	X								59
9201-60-FD	1/16/2024	07:59	Gateway Middle School - Sink Tap - Room 23	1	Wt	Grab	X								60
9201-61-FD	1/16/2024	07:59	Gateway Middle School - Drinking Fountain - Room 23	1	Wt	Grab	X								61
9201-62-FD	1/16/2024	08:00	Gateway Middle School - Sink Tap - Room 24	1	Wt	Grab	X								62
9201-63-FD	1/16/2024	08:00	Gateway Middle School - Drinking Fountain - Room 24	1	Wt	Grab	X								63

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		



3 H A 0 1 5 2

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone

LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023

X

PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	9201 North Indiana Avenue	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64156	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED							LAB USE ONLY	
							Lead							Wk Order #:	
														Short Hold:	
														Rush:	
														Temp: oC	
														Sample Condition	Sample #
9201-64-FD	1/16/2024	08:01	Gateway Middle School - Sink Tap - Staff Lounge	1	Wt	Grab	X								64
9201-65-FD	1/16/2024	08:01	Gateway Middle School - Ice Machine - Staff Lounge	1	Wt	Grab	X								65
9201-66-FD	1/16/2024	08:03	Gateway Middle School - Sink Tap - Room 22	1	Wt	Grab	X								66
9201-67-FD	1/16/2024	08:03	Gateway Middle School - Sink Tap - Room 21	1	Wt	Grab	X								67
9201-68-FD	1/16/2024	08:05	Gateway Middle School - Drinking Fountain - Outside 800 Hallway-Left	1	Wt	Grab	X								68
9201-69-FD	1/16/2024	08:05	Gateway Middle School - Drinking Fountain - Outside 800 Hallway-Right	1	Wt	Grab	X								69
9201-70-FD	1/16/2024	08:07	Gateway Middle School - Sink Tap - Room 011	1	Wt	Grab	X								70

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		



3 H A 0 1 5 2

AXIOM Service Professionals

PM: Carolyn Jackson

Keystone

LABORATORIES
A Microbac Company

600 E. 17th St. S
Newton, IA 50208
Phone: 641-792-8451

3012 Ansborough Ave
Waterloo, IA 50701
Phone: 319-235-4440

835 S St. Paul
Kansas City, KS 66105
Phone: 913-321-7856

205 E Van Buren St
Centerville, IA 52544
Phone: 641-437-7023



PRINT OR TYPE INFO BELOW:		REPORT TO:		BILL TO:	
SAMPLER:		NAME:	Jeff Hurst	NAME:	Jeff Hurst
SITE NAME:		CO. NAME:		CO. NAME:	
ADDRESS:	9201 North Indiana Avenue	ADDRESS:	PO Box 47166	ADDRESS:	PO Box 47166
CITY/ST/ZIP:	Kansas City, Missouri 64156	CITY/ST/ZIP:	Kansas City, Missouri 64188	CITY/ST/ZIP:	Kansas City, Missouri 64188
PHONE:	816-321-4702	PHONE:	816-678-7894	PHONE:	816-678-7894
		EMAIL:	jeffh@axiomservicepros.com	EMAIL:	jeffh@axiomservicepros.com

CLIENT SAMPLE #	DATE	TIME		# OF CONTAINERS	MATRIX	GRAB/COMPOSITE	ANALYSES REQUIRED								LAB USE ONLY	
							Lead								Wk Order #:	
															Short Hold:	
															Rush:	
															Temp: oC	
															Sample Condition	Sample #
9201-71-FD	1/16/2024	08:08	Gateway Middle School - Drinking Fountain - Outside 802-Left	1	Wt	Grab	X									71
9201-72-FD	1/16/2024	08:08	Gateway Middle School - Drinking Fountain - Outside 802-Right	1	Wt	Grab	X									72
9201-73-FD	1/16/2024	08:10	Gateway Middle School - Drinking Fountain - Outside Jumbo Gym-Far Left	1	Wt	Grab	X									73
9201-74-FD	1/16/2024	08:10	Gateway Middle School - Drinking Fountain - Outside Jumbo Gym-Left Middle	1	Wt	Grab	X									74
9201-75-FD	1/16/2024	08:10	Gateway Middle School - Drinking Fountain - Outside Jumbo Gym-Right Middle	1	Wt	Grab	X									75
9201-76-FD	1/16/2024	08:10	Gateway Middle School - Drinking Fountain - Outside Jumbo Gym-Far Right	1	Wt	Grab	X									76

Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		Remarks:
	Time:			Time:		
Relinquished by: (Signature)	Date:		Received by: (Signature)	Date:		
	Time:			Time:		



3 H A 0 1 5 2

AXIOM Service Professionals

PM: Carolyn Jackson

Appendix D

Photo Log



1/16/2024 - 9201-1 - Gateway Middle School - Room 19



1/16/2024 - 9201-2 - Gateway Middle School - Office Kitchenette



1/16/2024 - 9201-3 - Gateway Middle School - Room 100



1/16/2024 - 9201-4 - Gateway Middle School - Room 101



1/16/2024 - 9201-5 - Gateway Middle School - Room 102



1/16/2024 - 9201-6 - Gateway Middle School - Room 103



1/16/2024 - 9201-7 - Gateway Middle School - Room 104



1/16/2024 - 9201-8 - Gateway Middle School - Outside 608-Left



1/16/2024 - 9201-9 - Gateway Middle School -
Outside 608-Right



1/16/2024 - 9201-10 - Gateway Middle School -
Room 110



1/16/2024 - 9201-11 - Gateway Middle School -
Southwest of Library




1/16/2024 - 9201-12 - Gateway Middle School -
Southwest of Library-Right



1/16/2024 - 9201-13 - Gateway Middle School - Room 200



1/16/2024 - 9201-14 - Gateway Middle School - Room 201

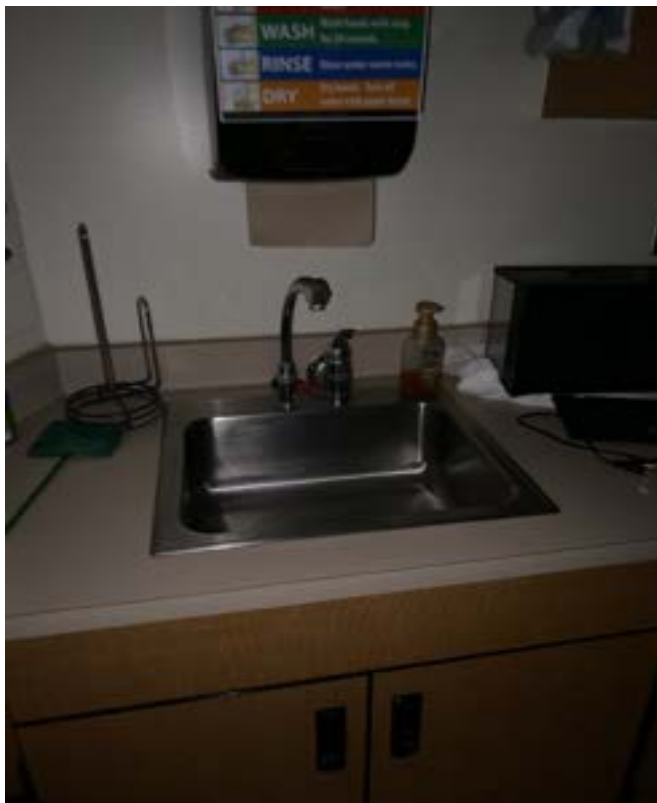

1/16/2024 - 9201-15 - Gateway Middle School - Room 202



1/16/2024 - 9201-16 - Gateway Middle School - Room 203



1/16/2024 - 9201-17 - Gateway Middle School - Room 204



1/16/2024 - 9201-18 - Gateway Middle School - Room 300




1/16/2024 - 9201-19 - Gateway Middle School - Room 301



1/16/2024 - 9201-20 - Gateway Middle School - Room 302



1/16/2024 - 9201-21 - Gateway Middle School -
Room 303

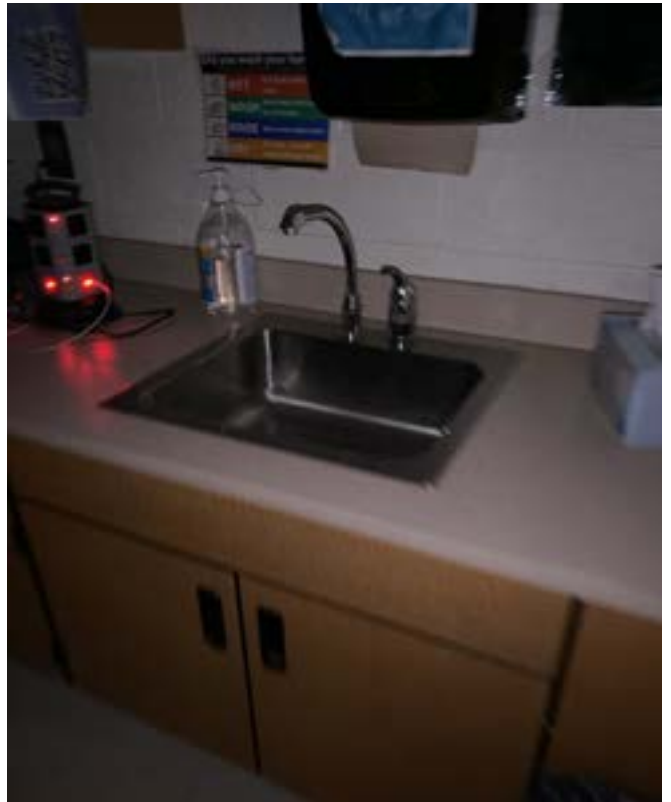

1/16/2024 - 9201-22 - Gateway Middle School -
Room 304




1/16/2024 - 9201-23 - Gateway Middle School -
Room 400




1/16/2024 - 9201-24 - Gateway Middle School -
Room 401



1/16/2024 - 9201-25 - Gateway Middle School - Room 402

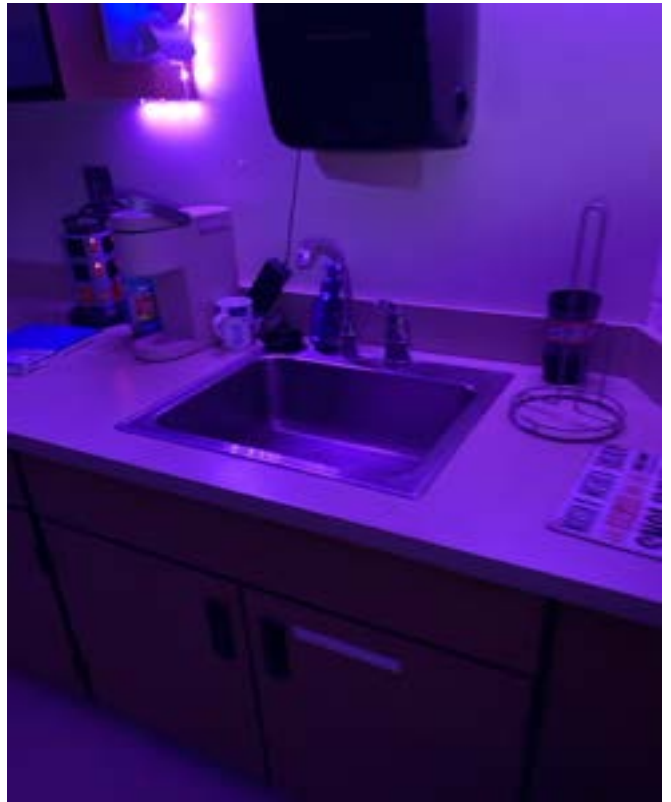

1/16/2024 - 9201-26 - Gateway Middle School - Room 403

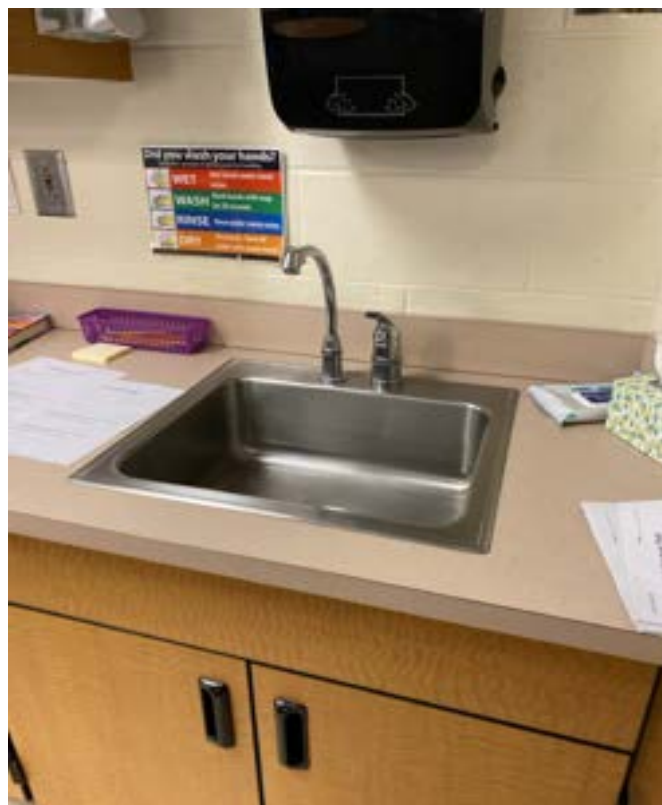

1/16/2024 - 9201-27 - Gateway Middle School - Room 404



1/16/2024 - 9201-28 - Gateway Middle School - Outside 400 Pod-Left



1/16/2024 - 9201-29 - Gateway Middle School -
Outside 400 Pod-Right



1/16/2024 - 9201-30 - Gateway Middle School -
Library Office



1/16/2024 - 9201-31 - Gateway Middle School -
Room 410



1/16/2024 - 9201-32 - Gateway Middle School -
Outside 601-Left



1/16/2024 - 9201-33 - Gateway Middle School - Outside 601-Right



1/16/2024 - 9201-34 - Gateway Middle School - Room 500



1/16/2024 - 9201-35 - Gateway Middle School - Room 501



1/16/2024 - 9201-36 - Gateway Middle School - Room 502



1/16/2024 - 9201-37 - Gateway Middle School - Room 503




1/16/2024 - 9201-38 - Gateway Middle School - Room 504




1/16/2024 - 9201-39 - Gateway Middle School - Room 50



1/16/2024 - 9201-40 - Gateway Middle School - Room 51

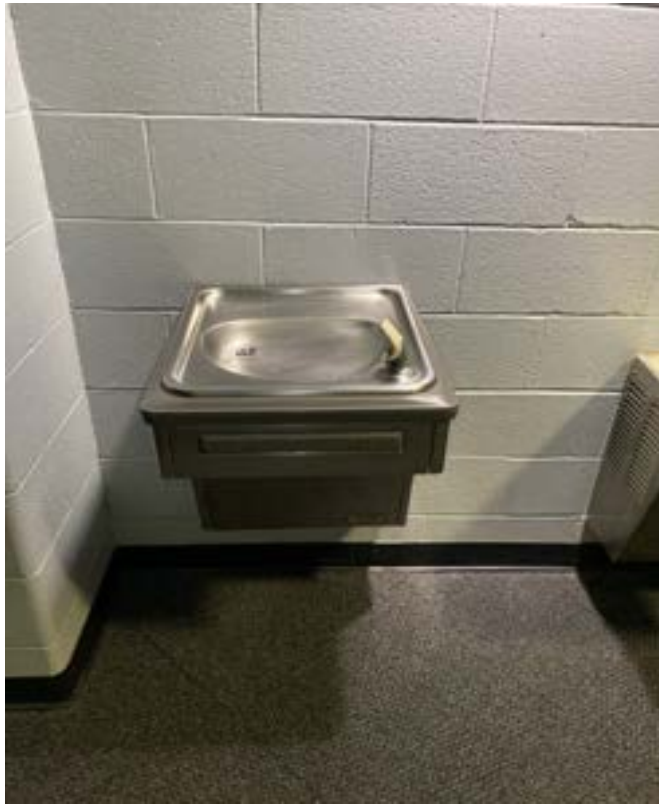

1/16/2024 - 9201-41 - Gateway Middle School - Large Gym-Left

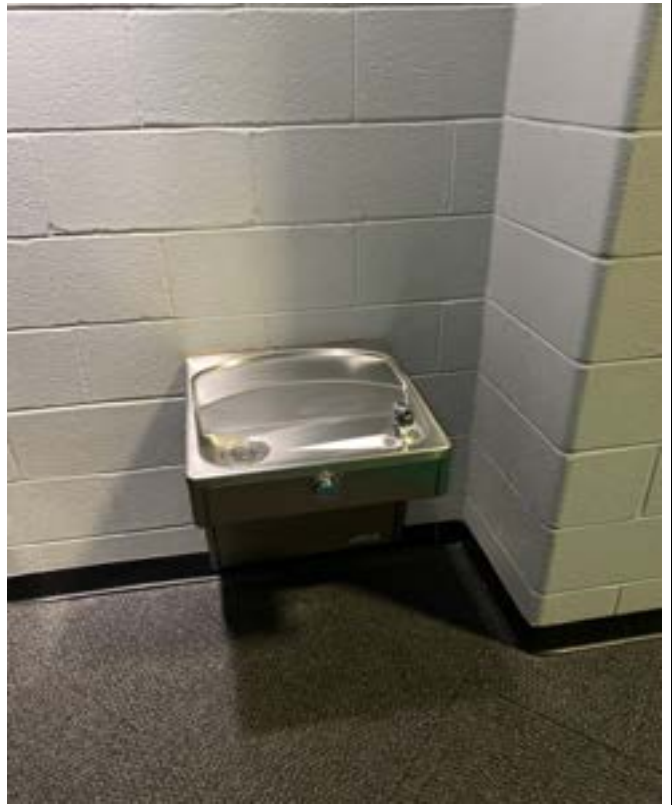

1/16/2024 - 9201-42 - Gateway Middle School - Large Gym-Right



1/16/2024 - 9201-43 - Gateway Middle School - Room 44-Left



1/16/2024 - 9201-44 - Gateway Middle School - Room 44-Right



1/16/2024 - 9201-45 - Gateway Middle School - Room 45-Left



1/16/2024 - 9201-46 - Gateway Middle School - Room 45-Right



1/16/2024 - 9201-47 - Gateway Middle School - Outside 45-Left



1/16/2024 - 9201-48 - Gateway Middle School - Outside 45-Right



1/16/2024 - 9201-49 - Gateway Middle School -
Cafe-Left



1/16/2024 - 9201-50 - Gateway Middle School -
Cafe-Right



1/16/2024 - 9201-51 - Gateway Middle School -
Kitchen-South Middle Sink



1/16/2024 - 9201-52 - Gateway Middle School -
Kitchen



1/16/2024 - 9201-53 - Gateway Middle School -
Kitchen-North Middle Sink



1/16/2024 - 9201-54 - Gateway Middle School -
Kitchen-Four Bay Sink-Left




1/16/2024 - 9201-55 - Gateway Middle School -
Kitchen-Four Bay Sink-Middle



1/16/2024 - 9201-56 - Gateway Middle School -
Kitchen-Four Bay Sink-Right




1/16/2024 - 9201-57 - Gateway Middle School -
Kitchen-Closest to Cafe

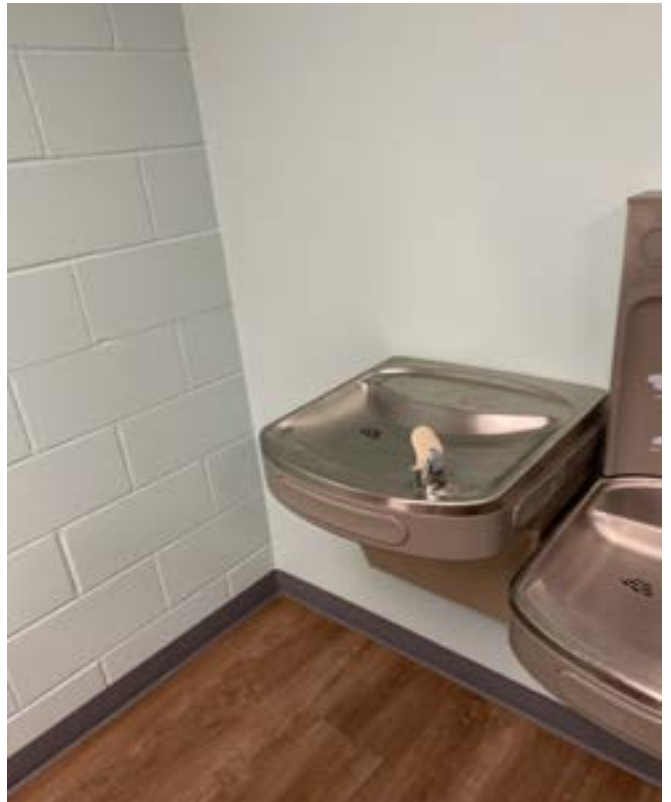

1/16/2024 - 9201-58 - Gateway Middle School -
Cafe-South-Left



1/16/2024 - 9201-59 - Gateway Middle School -
Cafe-South-Right

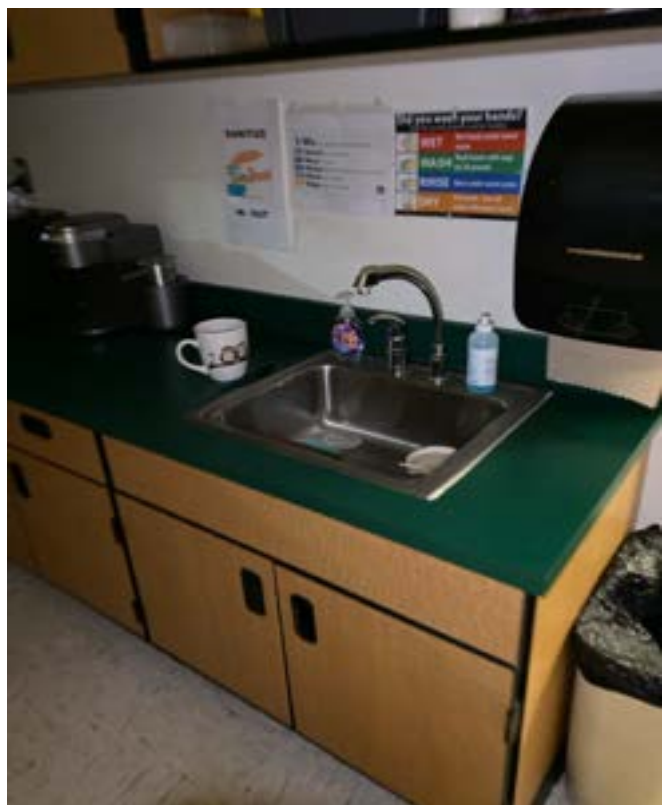

1/16/2024 - 9201-60 - Gateway Middle School -
Room 23




1/16/2024 - 9201-61 - Gateway Middle School - Room 23



1/16/2024 - 9201-62 - Gateway Middle School - Room 24



1/16/2024 - 9201-63 - Gateway Middle School - Room 24

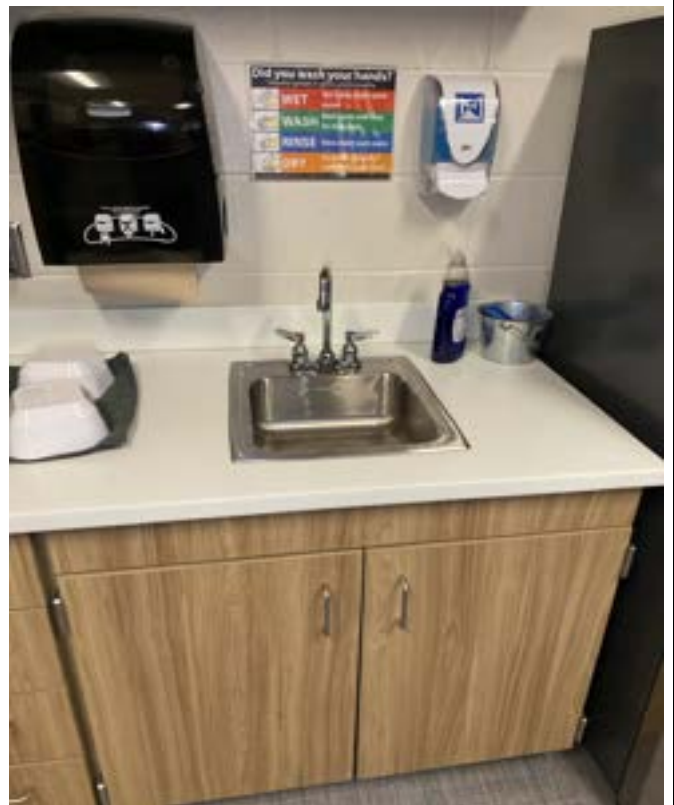

1/16/2024 - 9201-64 - Gateway Middle School - Staff Lounge



1/16/2024 - 9201-65 - Gateway Middle School - Staff Lounge



1/16/2024 - 9201-66 - Gateway Middle School - Room 22



1/16/2024 - 9201-67 - Gateway Middle School - Room 21



1/16/2024 - 9201-68 - Gateway Middle School - Outside 800 Hallway-Left



1/16/2024 - 9201-69 - Gateway Middle School - Outside 800 Hallway-Right



1/16/2024 - 9201-70 - Gateway Middle School - Room 011



1/16/2024 - 9201-71 - Gateway Middle School - Outside 802-Left



1/16/2024 - 9201-72 - Gateway Middle School - Outside 802-Right



1/16/2024 - 9201-73 - Gateway Middle School - Outside Jumbo Gym-Far Left



1/16/2024 - 9201-74 - Gateway Middle School - Outside Jumbo Gym-Left Middle



1/16/2024 - 9201-75 - Gateway Middle School - Outside Jumbo Gym-Right Middle




1/16/2024 - 9201-76 - Gateway Middle School - Outside Jumbo Gym-Far Right

Appendix E

Source Identification Diagram

ASP was provided sample locations by
North Kansas City School District

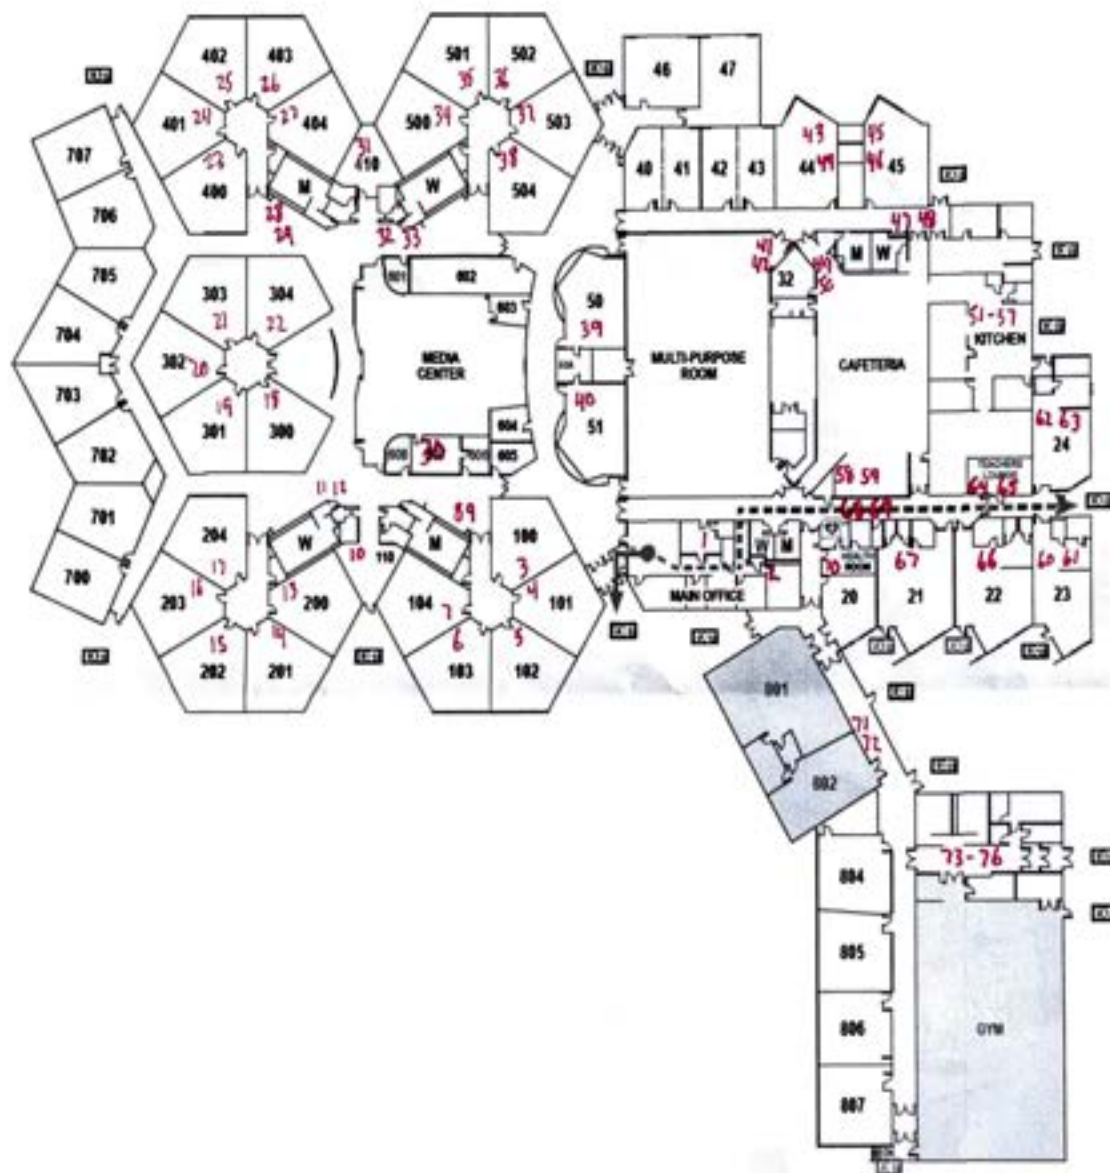

EMERGENCY INFORMATION

Gateway 6th Grade Center
9201 N. Indiana Avenue
Kansas City, MO 64156

- Primary Exit Route
- Secondary Exit Route
- You Are Here
- Exit Location
- Stairway
- Defibrillator
- Severe Weather Shelter

IN CASE OF SEVERE WEATHER

Go To Rooms 801/802

Emergency Egress Plan
Gateway 6th Grade Center

